



**CONTRACT NO: CV/2012/07**

**DEVELOPMENT AT ANDERSON ROAD -  
FOOTBRIDGE D AND ASSOCIATED WORKS AREA**

**QUARTERLY ENVIRONMENTAL MONITORING & AUDIT  
REPORT**

**-OCTOBER 2015 TO DECEMBER 2015 -**

**CLIENTS:**

Lam-Po Wing Joint Venture

**PREPARED BY:**

**Lam Environmental Services  
Limited**

11/F Centre Point  
181-185 Gloucester Road,  
Wanchai, H.K.

Telephone: (852) 2882-3939  
Facsimile: (852) 2882-3331  
E-mail: [info@lamenviro.com](mailto:info@lamenviro.com)  
Website: <http://www.lamenviro.com>

**CERTIFIED BY:**

A handwritten signature in blue ink, appearing to read "Derek Lo".

---

Derek Lo  
Environmental Team Leader

**DATE:**

23 January 2016

Ref.: OAPANDSNEM00\_0\_1637L.16

28 January 2016

Engineer's Representative  
Ove Arup & Partners  
Level 5, Festival Walk  
80 Tat Chee Avenue  
Kowloon Tong, Kowloon  
Hong Kong

By Email and Post

Attention: Mr. Dennis Leung

Dear Sir,

**Re: Contract No. CV/2012/07**  
**Development at Anderson Road**  
**Footbridge D and Associated Works Area**  
**Quarterly EM&A Report for October 2015 to December 2015**

Reference is made to the Environmental Team's submission of the draft Quarterly EM&A Report for October 2015 to December 2015 received by e-mail on 28 January 2016.

Please be informed that we have no adverse comment on the captioned submission.

Thank you very much for your kind attention and please do not hesitate to contact the undersigned should you have any queries.

Yours faithfully,



David Yeung  
Independent Environmental Checker

*Encl.*

c.c. Lam  
LPWJV

Attn.: Mr. Derek Lo  
Attn.: Mr. Tak-Leung Lo

Fax: 2882 3331  
Fax: 3171 7222

Q:\Projects\OAPANDSNEM00\Corr\OAPANDSNEM00\_0\_1637L.16.doc



**TABLE OF CONTENTS**

**EXECUTIVE SUMMARY .....3**

**1. INTRODUCTION.....4**

1.1 Scope of the Report .....4

1.2 Structure of the Report.....4

**2. PROJECT BACKGROUND.....5**

2.1 Background .....5

2.2 Scope of the Project and Site Description .....5

2.3 Project Organization and Contact Personnel.....5

**3. MONITORING REQUIREMENTS.....6**

3.1 Noise Monitoring.....6

3.2 Air Monitoring .....7

**4. MONITORING RESULTS .....9**

4.1 Noise Monitoring Results .....9

4.2 Air Monitoring Results .....10

4.3 Waste Monitoring Results .....12

**5. COMPLIANCE AUDIT .....13**

5.1 Noise Monitoring .....13

5.2 Air Monitoring .....13

5.3 Environmental Site Audit.....13

5.4 Review of the Reasons for and the Implications of Non-compliance.....13

5.5 Summary of action taken in the event of and follow-up on non-compliance .....13

**6. COMPLAINTS, NOTIFICATION OF SUMMONS AND PROSECUTION .....14**

**7. CONCLUSION .....15**



## LIST OF TABLES

<b>Table 1.1</b>	<b>Major Construction Activities for the Reporting Period</b>
<b>Table 2.1</b>	<b>Contact Details of Key Personnel</b>
<b>Table 3.1</b>	<b>Noise Monitoring Stations</b>
<b>Table 3.2</b>	<b>Air Monitoring Station</b>
<b>Table 4.1</b>	<b>Summary of Noise Monitoring Results at NM1 and NM2</b>
<b>Table 4.2</b>	<b>Summary of Air Monitoring Results at AQM1 - 24 hr TSP Monitoring</b>
<b>Table 4.3</b>	<b>Summary of Air Monitoring Results at AQM1 - 1 hr TSP Monitoring</b>
<b>Table 4.4</b>	<b>Details of Waste Disposal for Contract no. CV/2012/07</b>
<b>Table 6.1</b>	<b>Cumulative Statistics on Complaints</b>
<b>Table 6.2</b>	<b>Cumulative Statistics on Successful Prosecutions</b>

## LIST OF FIGURES

<u>Figure 2.1</u>	Project Layout
<u>Figure 2.2</u>	Project Organization Chart
<u>Figure 4.1</u>	Locations of Environmental Monitoring Stations

## LIST OF APPENDICES

<u>Appendix 3.1</u>	Environmental Mitigation Implementation Schedule
<u>Appendix 4.1</u>	Action and Limit Level
<u>Appendix 4.2</u>	Copies of Calibration Certificates
<u>Appendix 5.2</u>	Noise Monitoring Results and Graphical Presentations
<u>Appendix 5.3</u>	Air Quality Monitoring Results and Graphical Presentations
<u>Appendix 6.1</u>	Event Action Plans
<u>Appendix 6.2</u>	Summary for Notification of Exceedance_Air and Noise
<u>Appendix 8.1</u>	Complaint Log
<u>Appendix 9.1</u>	Construction Programme



**EXECUTIVE SUMMARY**

- i. This is the Environmental Monitoring and Audit (EM&A) Quarterly Report – [October 2015 to December 2015](#) project “Development at Anderson Road – Footbridge D and Associated Works Area” (Hereafter called “this Project”). The construction works of this project was commenced on 20 July 2013. This is the 10<sup>th</sup> quarterly of EM&A report presenting the environmental monitoring findings and information recorded during the period [1 October 2015 to 31 December 2015](#).

**Table1.1 Major Construction Activities for the Reporting Period**

October 2015	November 2015	December 2015
<ul style="list-style-type: none"> <li>● Construction of Tower C (Portion C2)</li> <li>● Construction of Pier D (Portion C2)</li> <li>● Construction of 1500 drainage pipe (Portion C3)</li> <li>● Backfilling of Tower A (Portion C3)</li> </ul>	<ul style="list-style-type: none"> <li>● Tower A reinstatement (Portion C3)</li> <li>● Φ1500 drainage pipe/ manhole construction (Portion C2)</li> <li>● Excavation of tower B footing (Portion C2)</li> <li>● Tower C construction (Portion C2)</li> </ul>	<ul style="list-style-type: none"> <li>● Construction Tower C (Portion C2)</li> <li>● Construction of Pier C2 (Portion C3)</li> <li>● Drainage works for Φ 1500 &amp; Φ228 pipe (Portion C2)</li> <li>● Excavation of tower B footing (Portion C2)</li> </ul>

Noise Monitoring

- ii. Noise monitoring during daytime was conducted at the stations NM1 and NM2 on a weekly basis in the reporting period. No exceedance was recorded in the reporting period.

Air Quality Monitoring

- iii. Air quality monitoring has been conducted at station AQM1. No action or limit level exceedance was recorded in the reporting period.

Complaints, Notifications of Summons and Successful Prosecutions

- iv. No complaint and notifications of summons or successful prosecutions were recorded in this reporting period.

Site Inspections and Audit

- v. The Environmental Team (ET) conducted weekly site inspections for Contract no. CV/2012/07 in the reporting period. Major observations and recommendations made during the audit sessions were rectified by the Contractors. No non-conformance was identified during the site inspections.

## 1. Introduction

### 1.1 Scope of the Report

- 1.1.1. Lam Environmental Services Limited (LES) has been appointed to work as the Environmental Team (ET) to implement the Environmental Monitoring and Audit (EM&A) programme as stipulated in the EM&A Manual of the approved Environmental Impact Assessment (EIA) Report for Development of Anderson Road.
- 1.1.2. This report presents the environmental monitoring and auditing work carried out in accordance to the Section 1.4 of EM&A Manual and “*Environmental Monitoring and Audit Requirements*” under Particular Specification Section 25.
- 1.1.3. The construction works of this project was commenced on 20 July 2013. This report documents the finding of EM&A works for this Project and during the period [1 October 2015 to 31 December 2015](#).

### 1.2 Structure of the Report

- Section 1**     ***Introduction*** – details the scope and structure of the report.
- Section 2**     ***Project Background*** – summarizes background and scope of the project, site description, project organization and contact details of key personnel during the reporting period.
- Section 3**     ***Monitoring Requirements*** – summarizes all monitoring parameters, monitoring methodology and equipment, monitoring locations, monitoring frequency, criteria and respective event and action plan and monitoring programmes.
- Section 4**     ***Monitoring Results*** – summarizes the monitoring results obtained in the reporting period.
- Section 5**     ***Compliance Audit*** – summarizes the auditing of monitoring results and environmental site inspection, all exceedances environmental parameters.
- Section 6**     ***Complaints, Notification of summons and Prosecution*** – summarizes the cumulative statistics on complaints, notification of summons and prosecution
- Section 7**     ***Conclusion***

## 2. Project Background

### 2.1 Background

- 2.1.1. The main objective of the project “Development at Anderson Road – Footbridge D and Associated Works Area” (Hereafter called “this Project”) is to construct a footbridge, Footbridge D, and associated lift towers across Shun On Road between the existing Shun Tin Estate and the future development platform.
- 2.1.2. For this project, Tin Wan House (NM1) and Ning Po No.2 College (NM2 and AQM1) are the designated monitoring station during the construction period. Owing to this contract is under the master project and on the other hand, the construction area is vicinity to the monitoring station (On Yat House) ID2 and (Sau Nga House) ID3 of the master project, so that the baseline noise and air quality monitoring will adopt the baseline data from those stations instead of conducting baseline monitoring. All the baseline data are referred to the baseline report from the public domain web site ([www.anderson-road.com/main.htm](http://www.anderson-road.com/main.htm)).
- 2.1.3. The construction works of this project was commenced on 20 July 2013. During the construction phase of the project, air quality (dust) and noise impacts from the development site itself and the adjacent Anderson Road Quarry and other nearby construction sites are identified as the major environmental issues of concern. Besides, waste management is also identified in the EIA study as another environmental issue during the construction phase of the project that requires mitigation measures.

### 2.2 Scope of the Project and Site Description

- 2.2.1. The Project is located mainly near Shun Tin Estate and Ning Po No.2 College, as shown in **Figure 2.1**.
- 2.2.2. The scope of the Project comprises:
- Construction of footbridge and associated lift towers between Shun On Road and future platform at +152mPD and across Shun On Road. In Conjunction with these footbridge works are the associated furniture, drainage system, irrigation system and traffic signs.
  - Construction of drainage system for diversion of an existing stream on the slope adjoining Footbridge D.
  - Site formation and associated slopeworks for Footbridge D adjacent to Shun On Road.

### 2.3 Project Organization and Contact Personnel

- 2.3.1. Civil Engineering and Development Department is the overall project controllers for this project. For the construction phase of the Project, Project Engineer, Contractor(s), Environmental Team and Independent Environmental Checker are appointed to manage and control environmental issues.

2.3.2. The proposed project organization and lines of communication with respect to environmental protection works are shown in **Figure 2.2**. Key personnel and contact particulars are summarized in **Table 2.1**:

**Table 2.1 Contact Details of Key Personnel**

Party	Role	Post	Name	Contact No.	Contact Fax
Ove Arup	Engineer	Chief Resident Engineer	Dennis Leung	2407 0300	2407 8382
		Resident Engineer	Kenneth Lee	3656 3000	3656 1000
Lam-Po Wing Joint Venture	Contractor under Contract no. CV/2012/07	Project Manager	K.C. Wong	2318 0281	3171 7222
		Site Agent	T.L. Lo	2318 0281	
		Safety Officer	K.W. Lau	2318 0281	
		Environmental Officer	K.I. Ip	2318 0281	
Ramboll Environ Hong Kong Limited	Independent Environmental Checker (IEC)	Independent Environmental Checker (IEC)	Mr. David Yeung	3465 2888	3465 2899
Lam Environmental Services Limited	Environmental Team (ET)	Environmental Team Leader (ETL)	Mr. Derek Lo	2882 3939	2882 3331

**Hotline telephone number for the public to make enquiries: (852) 5346 4647**

### 3. Monitoring Requirements

#### 3.1 Noise Monitoring

##### NOISE MONITORING STATIONS

3.1.1. The noise monitoring has been undertaken at the designated locations Tin Wan House (NM1) and Ning Po No.2 College (NM2). The detailed information of monitoring stations for the Project are listed and shown in **Table 3.1** and **Figure 4.1**. **Appendix 4.1** shows the established Action/Limit Levels for the monitoring works.

**Table 3.1 Noise Monitoring Stations**

Station ID	Monitoring Location
NM1	G/F of Tin Wan House
NM2	G/F of Ning Po No.2 College

##### NOISE MONITORING PARAMETERS, FREQUENCY AND DURATION





3.1.2. The construction noise level shall be measured in terms of the A-weighted equivalent continuous sound pressure level ( $L_{eq}$ ).  $L_{eq(30\text{ minutes})}$  shall be used as the monitoring parameter for the time period between 0700 and 1900 hours on normal weekdays. For all other time periods,  $L_{eq(5\text{ minutes})}$  shall be employed for comparison with the Noise Control Ordinance (NCO) criteria. Supplementary information for data auditing, statistical results such as L10 and L90 shall also be obtained for reference.

3.1.3. Noise monitoring shall be carried out at all the designated monitoring stations. The monitoring frequency shall depend on the scale of the construction activities. The following is an initial guide on the regular monitoring frequency for each station on a weekly basis when noise generating activities are underway:

- One set of measurements between 0700 and 1900 hours on normal weekdays.

3.1.4. If construction works are extended to include works during the hours of 1900 – 0700 as well as public holidays and Sundays, additional weekly impact monitoring shall be carried out during respective restricted hours periods. Applicable permits under NCO shall be obtained by the Contractor.

MONITORING EQUIPMENT

3.1.5. As referred to in the Technical Memorandum (TM) issued under the NCO, sound level meters in compliance with the International Electrotechnical Commission Publications 651: 1979 (Type 1) and 804: 1985 (Type 1) specifications shall be used for carrying out the noise monitoring. Immediately prior to and following each noise measurement the accuracy of the sound level meter shall be checked using an acoustic calibrator generating a known sound pressure level at a known frequency. Measurements may be accepted as valid only if the calibration level from before and after the noise measurement agree to within 1.0 dB.

3.1.6. Noise measurements shall not be made in fog, rain, wind with a steady speed exceeding 5 m/s or wind with gusts exceeding 10 m/s. The wind speed shall be checked with a portable wind speed meter capable of measuring the wind speed in m/s.

**3.2 Air Monitoring**

AIR QUALITY MONITORING STATIONS

3.2.1. The air monitoring has been conducted at the designated location Ning Po No.2 College (AQM1). The air monitoring stations for the Project are listed and shown in **Table 3.2** and **Figure 4.1**. **Appendix 4.1** shows the established Action/Limit Levels for the monitoring works.

**Table 3.2 Air Monitoring Station**

Station ID	Monitoring Location
AQM1	Roof Top of Ning Po No.2 College

AIR MONITORING PARAMETERS, FREQUENCY AND DURATION

3.2.2. One-hour and 24-hour TSP levels should be measured to indicate the impacts of construction dust on air quality. The 24-hour TSP levels shall be measured by following the standard high

volume sampling method as set out in the Title 40 of the Code of Federal Regulations, Chapter 1 (Part 50), Appendix B.

- 3.2.3. All relevant data including temperature, pressure, weather conditions, elapsed-time meter reading for the start and stop of the sampler, identification and weight of the filter paper, and any other local atmospheric factors affecting or affected by site conditions, etc., shall be recorded down in detail.
- 3.2.4. For regular impact monitoring, the sampling frequency of at least once in every six-days, shall be strictly observed at all the monitoring stations for 24-hour TSP monitoring. For 1-hour TSP monitoring, the sampling frequency of at least three times in every six-days should be undertaken when the highest dust impact occurs.

#### SAMPLING PROCEDURE AND MONITORING EQUIPMENT

- 3.2.5. High volume samplers (HVSs) in compliance with the following specifications shall be used for carrying out the 1-hour and 24-hour TSP monitoring:
- 0.6 - 1.7 m<sup>3</sup> per minute adjustable flow range;
  - equipped with a timing / control device with +/- 5 minutes accuracy for 24 hours operation;
  - installed with elapsed-time meter with +/- 2 minutes accuracy for 24 hours operation;
  - capable of providing a minimum exposed area of 406 cm<sup>2</sup>;
  - flow control accuracy: +/- 2.5% deviation over 24-hour sampling period;
  - equipped with a shelter to protect the filter and sampler;
  - incorporated with an electronic mass flow rate controller or other equivalent devices;
  - equipped with a flow recorder for continuous monitoring;
  - provided with a peaked roof inlet;
  - incorporated with a manometer;
  - able to hold and seal the filter paper to the sampler housing at horizontal position;
  - easily changeable filter; and
  - capable of operating continuously for a 24-hour period.
- 3.2.6. Initial calibration of dust monitoring equipment shall be conducted upon installation and thereafter at bi-monthly intervals. The transfer standard shall be traceable to the internationally recognized primary standard and be calibrated annually. The calibration data shall be properly documented for future reference by concerned parties such as the IEC. All the data should be converted into standard temperature and pressure equivalents.

#### LABORATORY MEASUREMENT / ANALYSIS

- 3.2.7. A clean laboratory with constant temperature and humidity control, and equipped with necessary measuring and conditioning instruments to handle the dust samples collected, shall be available for sample analysis, and equipment calibration and maintenance. The laboratory should be HOKLAS accredited.
- 3.2.8. If a site laboratory is set up or a non-HOKLAS accredited laboratory is retained for analysis, laboratory equipment shall be provided by the ER in consultation with the IC(E). Measurement performed by the laboratory shall be demonstrated to the satisfaction of the ER and the IC(E).



The IC(E) shall conduct regular audit to the measurement performed by the laboratory to ensure the accuracy of measurement results. The ET leader shall provide the ER with one copy of the Title 40 of the Code of Federal Regulations, Chapter 1 (Part 50), and Appendix B for his reference.

- 3.2.9. Filter paper of size 8" x 10" shall be labelled before sampling. It shall be a clean filter paper with no pinholes, and shall be conditioned in a humidity-controlled chamber for over 24-hours and be pre-weighed before use for the sampling.
- 3.2.10. After sampling, the filter paper loaded with dust shall be kept in a clean and tightly sealed plastic bag. The filter paper shall then be returned to the laboratory for reconditioning in the humidity controlled chamber followed by accurate weighing by an electronic balance with readout down to 0.1 mg. The balance shall be regularly calibrated against a traceable standard.
- 3.2.11. All the collected samples shall be kept in a good condition for 6 months prior to disposal.

**4. Monitoring Results**

4.0.1. The environmental monitoring will be implemented based on the sensitive receivers which would be mostly affected. Overall layout showing the work area, latest status of work commencement and monitoring stations are shown in **Figure 2.1** and **Figure 4.1**.

**4.1 Noise Monitoring Results**

4.1.1. The noise monitoring results for Contract no. CV/2012/07 are summarized in **Table 4.1** below:

**Table 4.1 Summary of Noise Monitoring Results at NM1 and NM2**

Date	Time	Location	Leq (dB)
5-Oct-15	13:28	NM1	63.6
	14:35	NM2	62.5
16-Oct-15	13:20	NM1	62.8
	14:30	NM2	61.0
22-Oct-15	9:00	NM1	64.2
	10:05	NM2	62.1
28-Oct-15	8:55	NM1	63.5
	10:15	NM2	62.9
3-Nov-15	13:10	NM1	64.1
	14:21	NM2	65.0
9-Nov-15	13:06	NM1	64.5
	14:11	NM2	66.2
20-Nov-15	13:08	NM1	65.3
	14:08	NM2	65.2

26-Nov-15	8:20	NM1	64.9
	9:22	NM2	65.1
2-Dec-15	8:30	NM1	63.7
	9:55	NM2	64.4
8-Dec-15	8:30	NM1	63.9
	10:00	NM2	64.3
14-Dec-15	8:45	NM1	64.2
	9:55	NM2	64.0
23-Dec-15	9:25	NM1	65.1
	9:22	NM2	64.9
29-Dec-15	10:15	NM1	65.6
	9:10	NM2	66.0
Limit Level			65 / 70 / 75*

Note :

- 70dB(A) and 65 dB(A) for schools during normal teaching periods and school examination periods, respectively.

4.1.2. Day time period noise monitoring was conducted at the Tin Wan House (NM1) and Ning Po No.2 College (NM2).

4.1.3. Noise monitoring results measured in this reporting period are reviewed and summarized. No action level exceedance was recorded in the reporting period. Details of noise monitoring results and graphical presentation can be referred in **Appendix 5.2**.

## 4.2 Air Monitoring Results

4.2.1. The air monitoring results are summarized in **Table 4.2** and **Table 4.3** below. No exceedance was recorded in the reporting period.

**Table 4.2 Summary of Air Monitoring Results at AQM1 - 24 hr TSP Monitoring**

Date	Time	TSP Level, ( $\mu\text{g}/\text{m}^3$ )
3-Oct-15	8:00	101
9-Oct-15	8:00	42
15-Oct-15	8:00	110
20-Oct-15	8:00	80
27-Oct-15	8:00	82
2-Nov-15	8:00	95
7-Nov-15	8:00	68
13-Nov-15	8:00	62
19-Nov-15	8:00	80
25-Nov-15	8:00	91
1-Dec-15	8:00	133
7-Dec-15	8:00	56
12-Dec-15	8:00	115



18-Dec-15	8:00	111
22-Dec-15	8:00	81
28-Dec-15	8:00	90
31-Dec-15	8:00	101
<b>Action Level</b>		<b>200</b>
<b>Limit Level:</b>		<b>260</b>

**Table 4.3 Summary of Air Monitoring Results at AQM1 - 1 hr TSP Monitoring**

Date	Time	TSP Level, ( $\mu\text{g}/\text{m}^3$ )
5-Oct-15	13:00	111
5-Oct-15	14:06	74
5-Oct-15	15:11	71
10-Oct-15	8:30	86
10-Oct-15	9:50	77
10-Oct-15	11:00	92
16-Oct-15	8:30	121
16-Oct-15	9:40	171
16-Oct-15	10:50	176
22-Oct-15	8:40	147
22-Oct-15	9:45	122
22-Oct-15	10:50	95
28-Oct-15	8:15	114
28-Oct-15	9:30	96
28-Oct-15	10:40	64
3-Nov-15	13:00	125
3-Nov-15	14:10	119
3-Nov-15	15:20	127
9-Nov-15	13:00	100
9-Nov-15	14:10	92
9-Nov-15	15:20	104
14-Nov-15	8:50	102
14-Nov-15	9:56	171
14-Nov-15	11:00	176
20-Nov-15	13:00	70
20-Nov-15	14:03	81
20-Nov-15	15:10	141
26-Nov-15	8:12	89
26-Nov-15	9:20	55
26-Nov-15	10:30	95
2-Dec-15	8:14	66
2-Dec-15	9:20	57
2-Dec-15	10:30	78
8-Dec-15	8:25	78
8-Dec-15	9:30	83
8-Dec-15	10:45	65
14-Dec-15	8:43	116
14-Dec-15	9:50	171



14-Dec-15	10:55	176
19-Dec-15	8:11	90
19-Dec-15	9:18	83
19-Dec-15	10:24	85
23-Dec-15	8:15	123
23-Dec-15	9:20	114
23-Dec-15	10:30	114
29-Dec-15	9:00	85
29-Dec-15	10:12	88
29-Dec-15	13:00	90
<b>Action Level</b>		<b>197</b>
<b>Limit Level:</b>		<b>500</b>

4.2.2. Air monitoring results measured in this reporting period are reviewed and summarized. No exceedance was recorded in reporting period. Details of air monitoring results can be referred in **Appendix 5.3**.

**4.3 Waste Monitoring Results**

4.3.1. Inert and non-inert C&D waste were disposed of in this reporting period. Details of the waste flow table are summarized in **Table 4.4**.

**Table 4.4 Details of Waste Disposal for Contract no. CV/2012/07**

Waste Type	Quantity this quarter	Cumulative Quantity-to-Date	Disposal / Dumping Grounds
Inert C&D materials disposed, m <sup>3</sup>	3.06881	11.44544	TKO137
Inert C&D materials recycled, m <sup>3</sup>	0	0	N/A
Non-inert C&D materials disposed, m <sup>3</sup>	0	0	N/A
Non-inert C&D materials recycled, kg	6	34.54	N/A
Chemical waste disposed, kg	0	0	N/A
General refuse, m <sup>3</sup>	0.02937	0.0631	NENT

Remark: Amount of Non-inert C&D materials disposed and recycled was rectified on October



**5. Compliance Audit**

5.0.1. The Event Action Plan for construction noise, air quality and water quality are presented in **Appendix 6.1.**

**5.1 Noise Monitoring**

5.1.1. No exceedance was recorded in the reporting period.

**5.2 Air Monitoring**

5.2.1. No exceedance was recorded in the TSP monitoring in the reporting period.

**5.3 Environmental Site Audit**

5.3.1. There was no non-compliance from the site audits in the reporting period. During environmental site inspections conducted during the reporting period, minor deficiencies were noted.

**5.4 Review of the Reasons for and the Implications of Non-compliance**

5.4.1. There was no non-compliance from the site audits in the reporting period.

**5.5 Summary of action taken in the event of and follow-up on non-compliance**

5.5.1. There was no particular action taken since no project-related non-compliance was recorded from the site audits and environmental monitoring in the reporting period.

**6. Complaints, Notification of Summons and Prosecution**

- 6.0.1. No complaint and notification of summons or successful prosecutions were recorded in this reporting period.
- 6.0.2. The details of cumulative complaint log and updated summary of complaints are presented in **Appendix 8.1**.
- 6.0.3. Cumulative statistic on complaints and successful prosecutions are summarized in **Table 6.1** and **Table 6.2** respectively.

**Table 6.1 Cumulative Statistics on Complaints**

Reporting Period	No. of Complaints
October 2015 – December 2015	0
<b>Project-to-Date</b>	<b>1</b>

**Table 6.2 Cumulative Statistics on Successful Prosecutions**

Environmental Parameters	Cumulative No. Brought Forward	No. of Successful Prosecutions this quarter (Offence Date)	Cumulative No. Project-to-Date
Air	-	0	0
Noise	-	0	0
Waste	-	0	0
<b>Total</b>	<b>-</b>	<b>0</b>	<b>0</b>






## **7. Conclusion**

- 7.0.1. The EM&A programme was carried out in accordance with the EM&A Manual requirements, minor alterations to the programme proposed were made in response to changing circumstances.
- 7.0.2. No construction air and noise monitoring results that triggered the action level and Limit Level was recorded. No complaint of air and noise were received by the ARUP and the contractor. Furthermore, no notification of summons or successful prosecution was received in this reporting period.



***Figure 2.1***

***Project Layout***

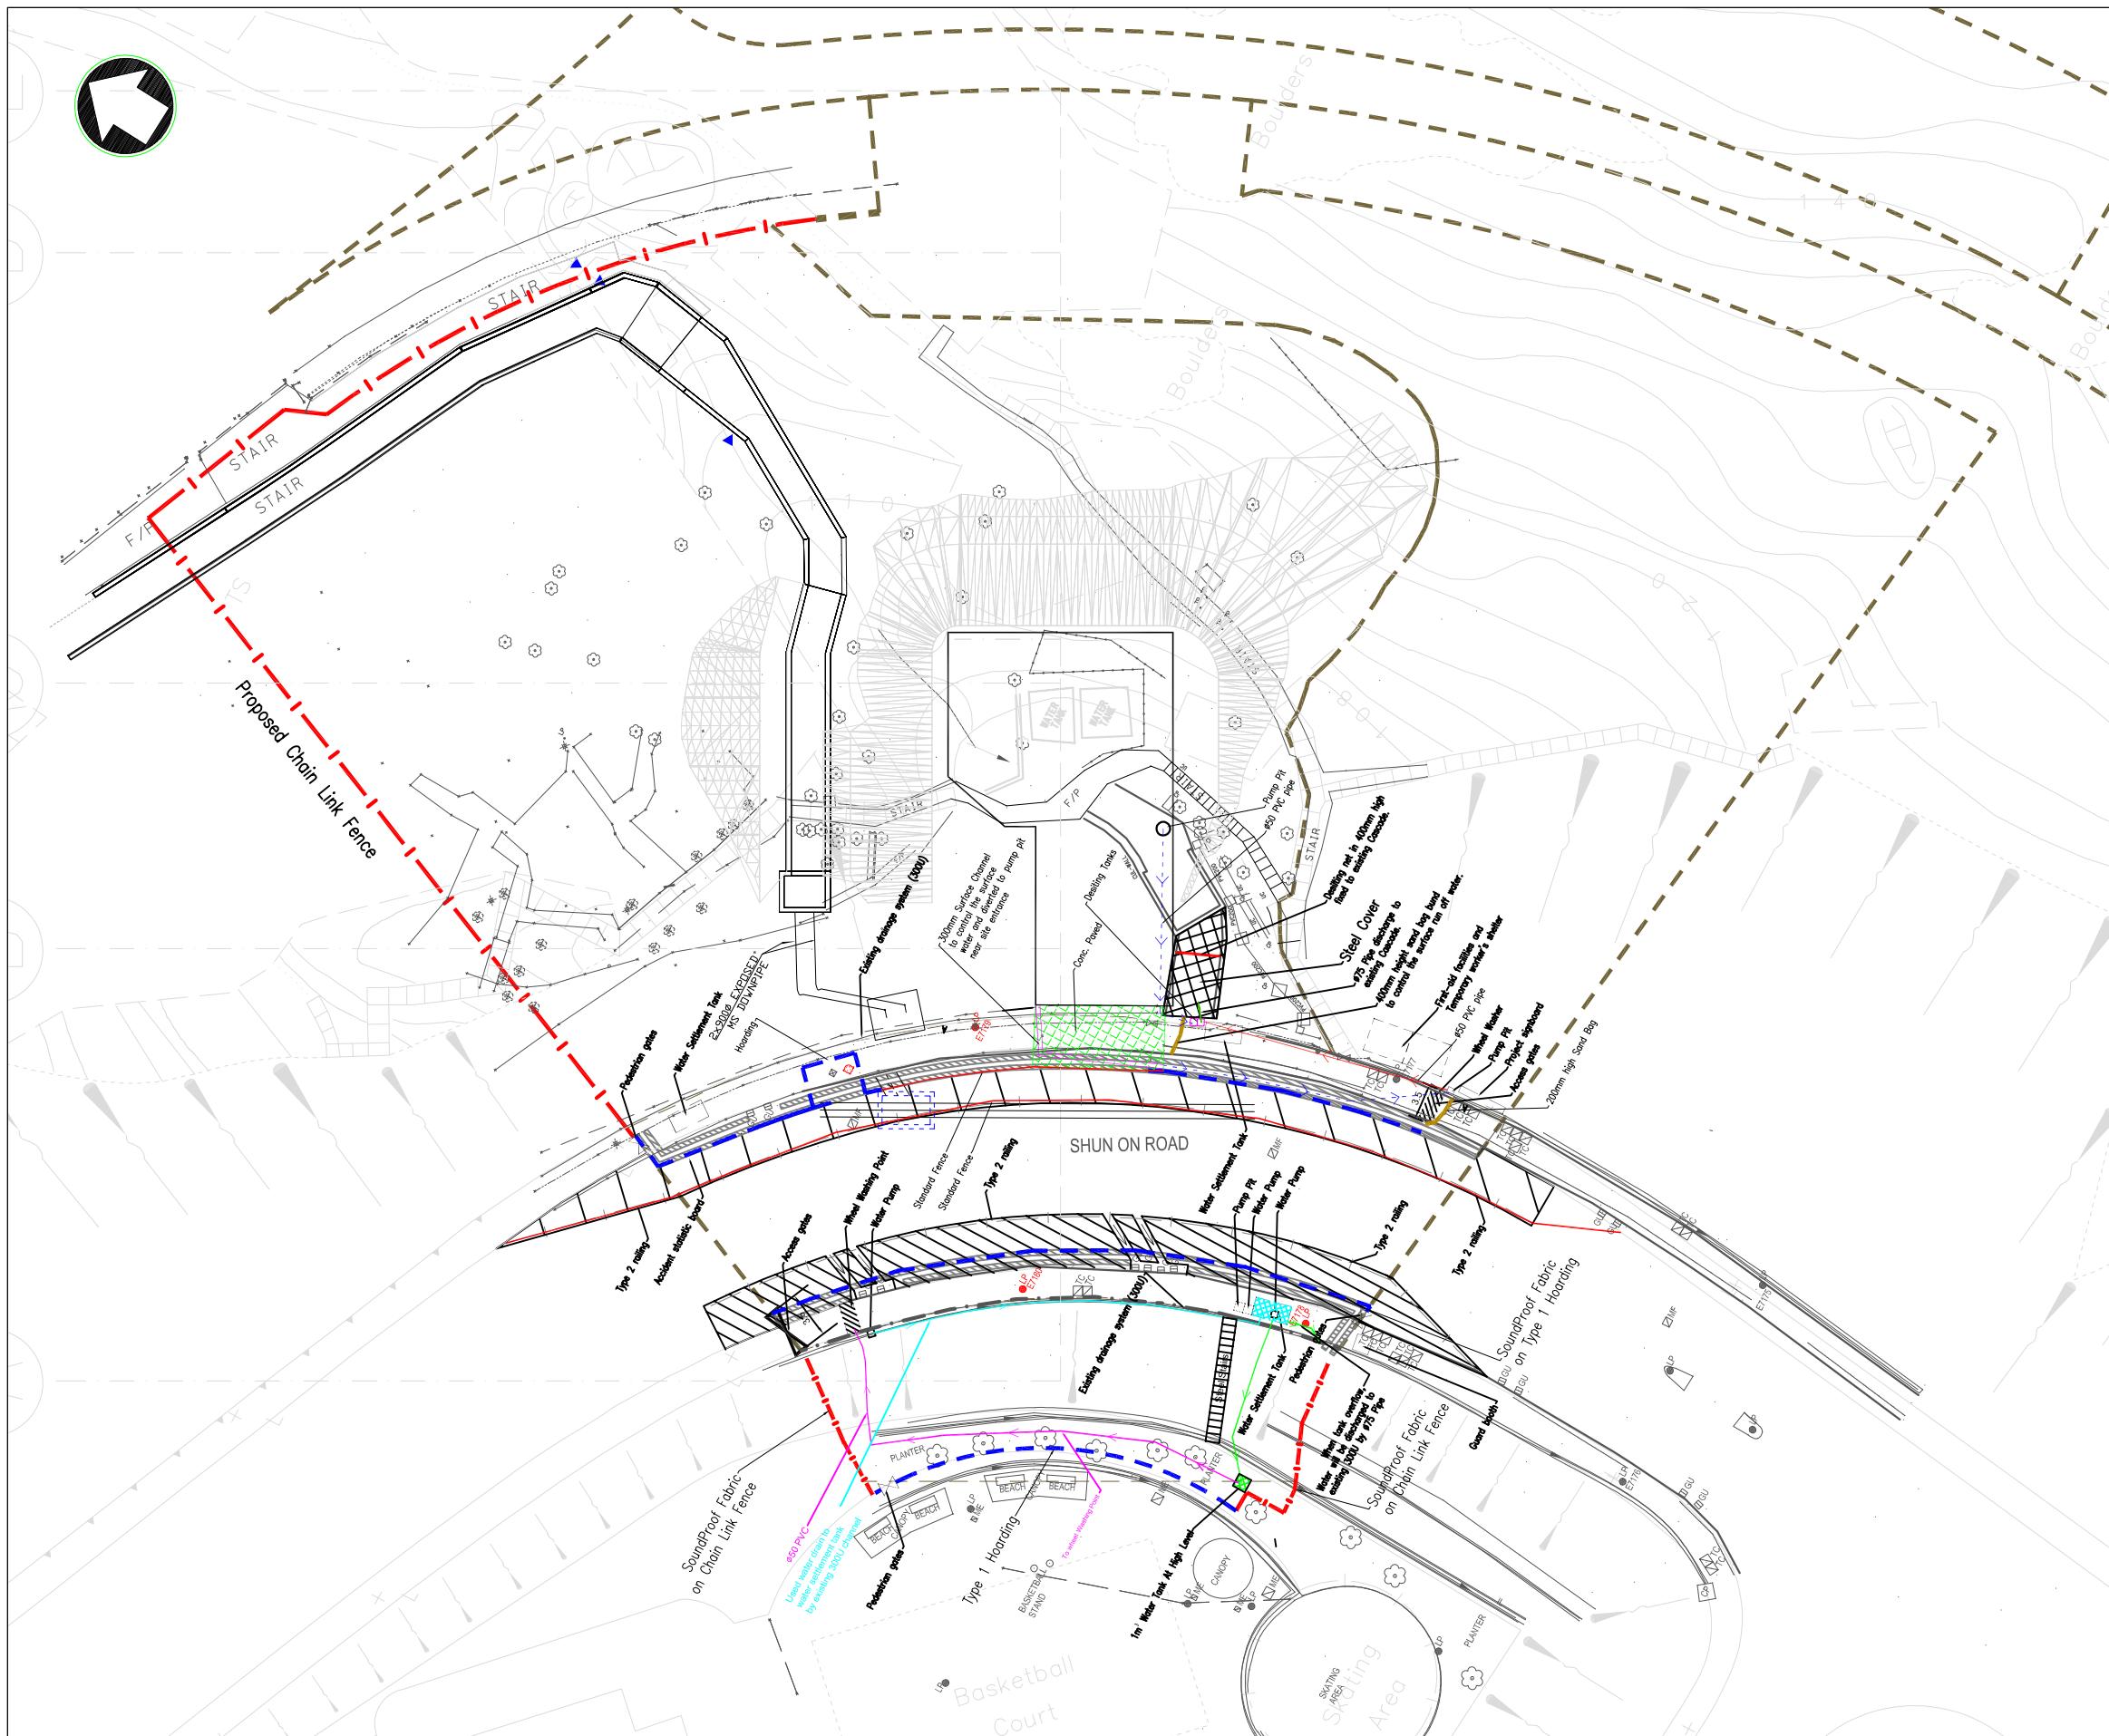

**NOTES:**


1. This drawing shall be read in conjunction with Drawing 24711/1052.
2. The location of fencing and hoarding is indicative only. The exact location is approved on site by Engineer.
3. For Detail of Access gate refer to CEDD Standard Drawing No. C1007.
4. Dimensions Are in Meters Unless Otherwise Shown.
5. The surface water inside Portion C3 will be collected by a pump pit and pump into water settlement tank for recycle purpose. In case the water inside the settlement tank is overflow, a  $\phi 75$  pipe will discharge the overflow water into existing 300U on slope toe.

**Legend**

- - - - - Proposed Chain Link Fence
- - - - - Proposed Safety Fence (Type A)
- - - - - Proposed Hoarding (Type I)
- - - - - Site Boundary

SCALE	1:500 @ A3	DATE	30 Sept. 2013
CHECK	HUNG	DRAWN	Bobby
JOB NO.	CV/2012/07	DRAWING NO.	SK011
		REV	I



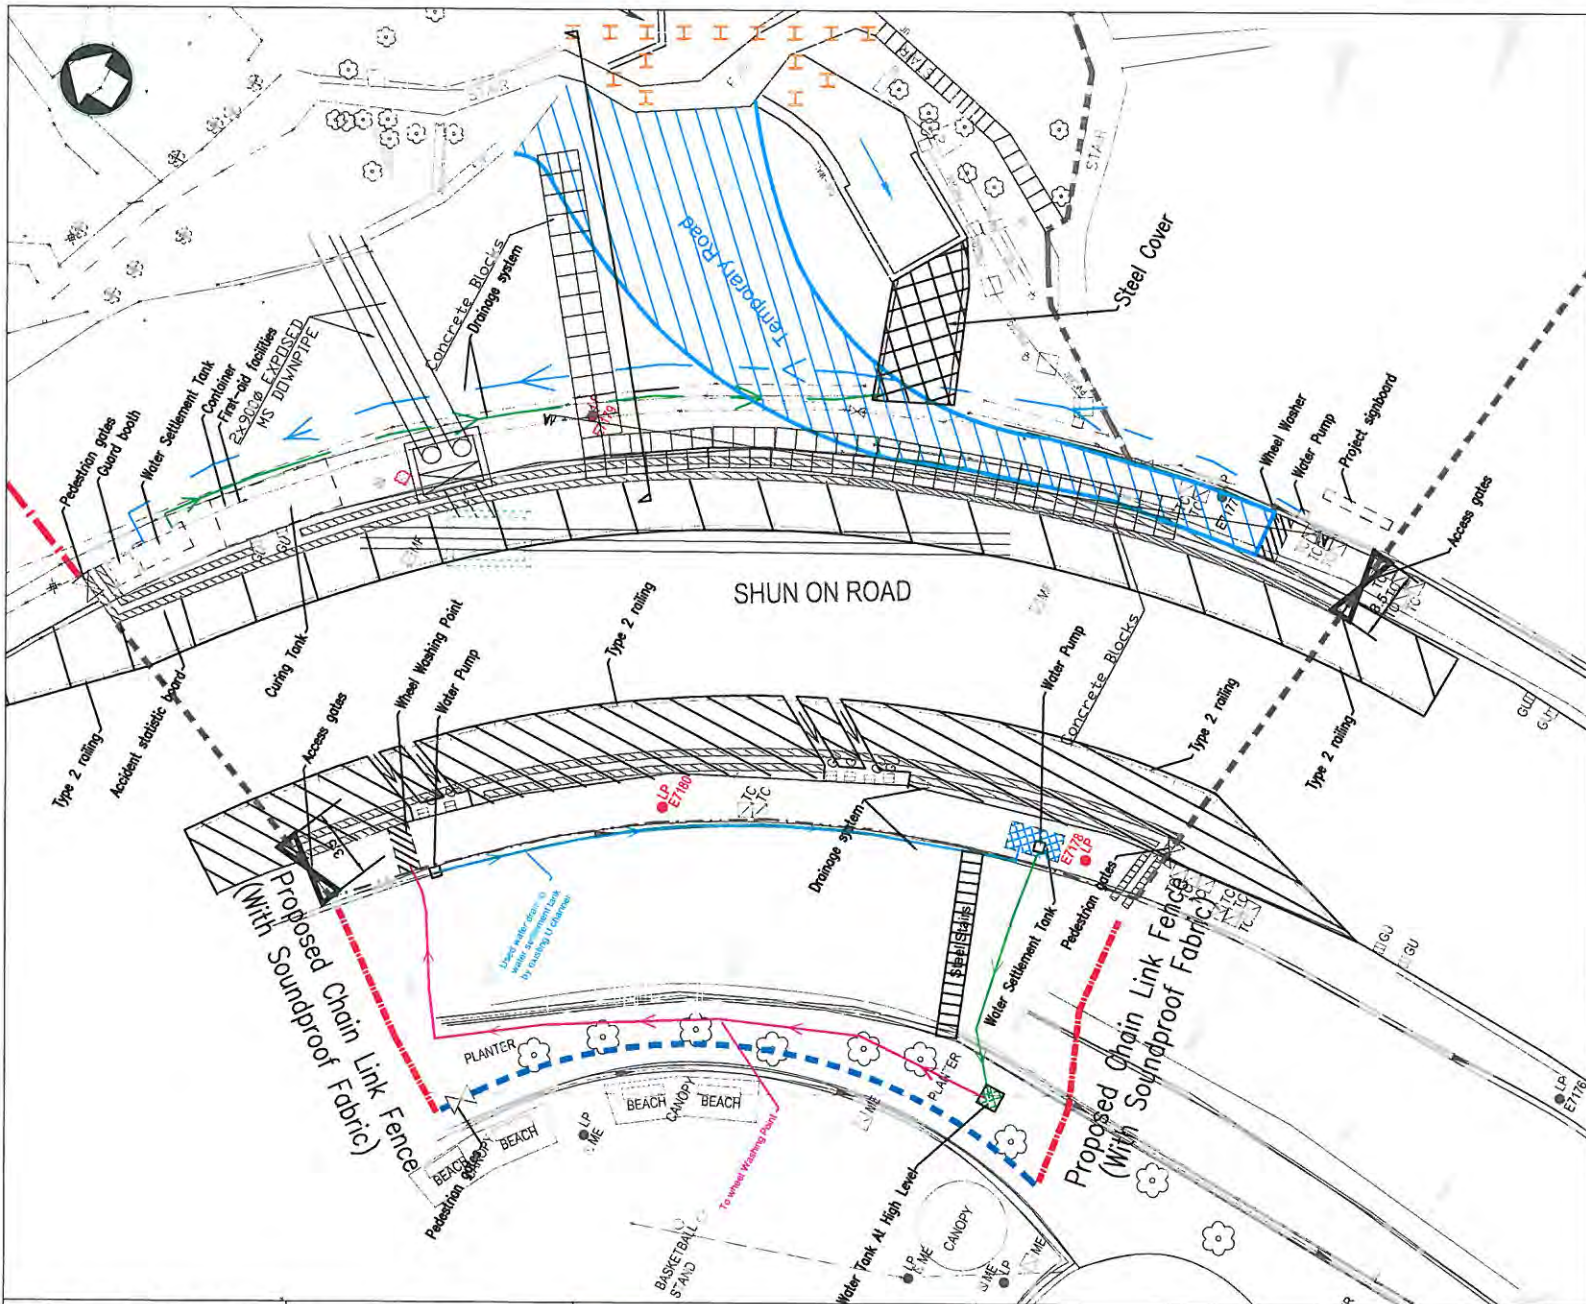

NOTES:

1. This drawing shall be read in conjunction with Drawing 24711/1052.
2. The location of fencing and hoarding is indicative only. The exact location is approved on site by Engineer.
3. For Detail of Access gate refer to CEDD Standard Drawing No. C1007.
4. Dimensions Are in Meters Unless Otherwise Shown.

Legend

- Proposed Chain Link Fence
- - - Proposed Safety Fence (Type A)
- Proposed Hoarding (Type I)
- Site Boundary

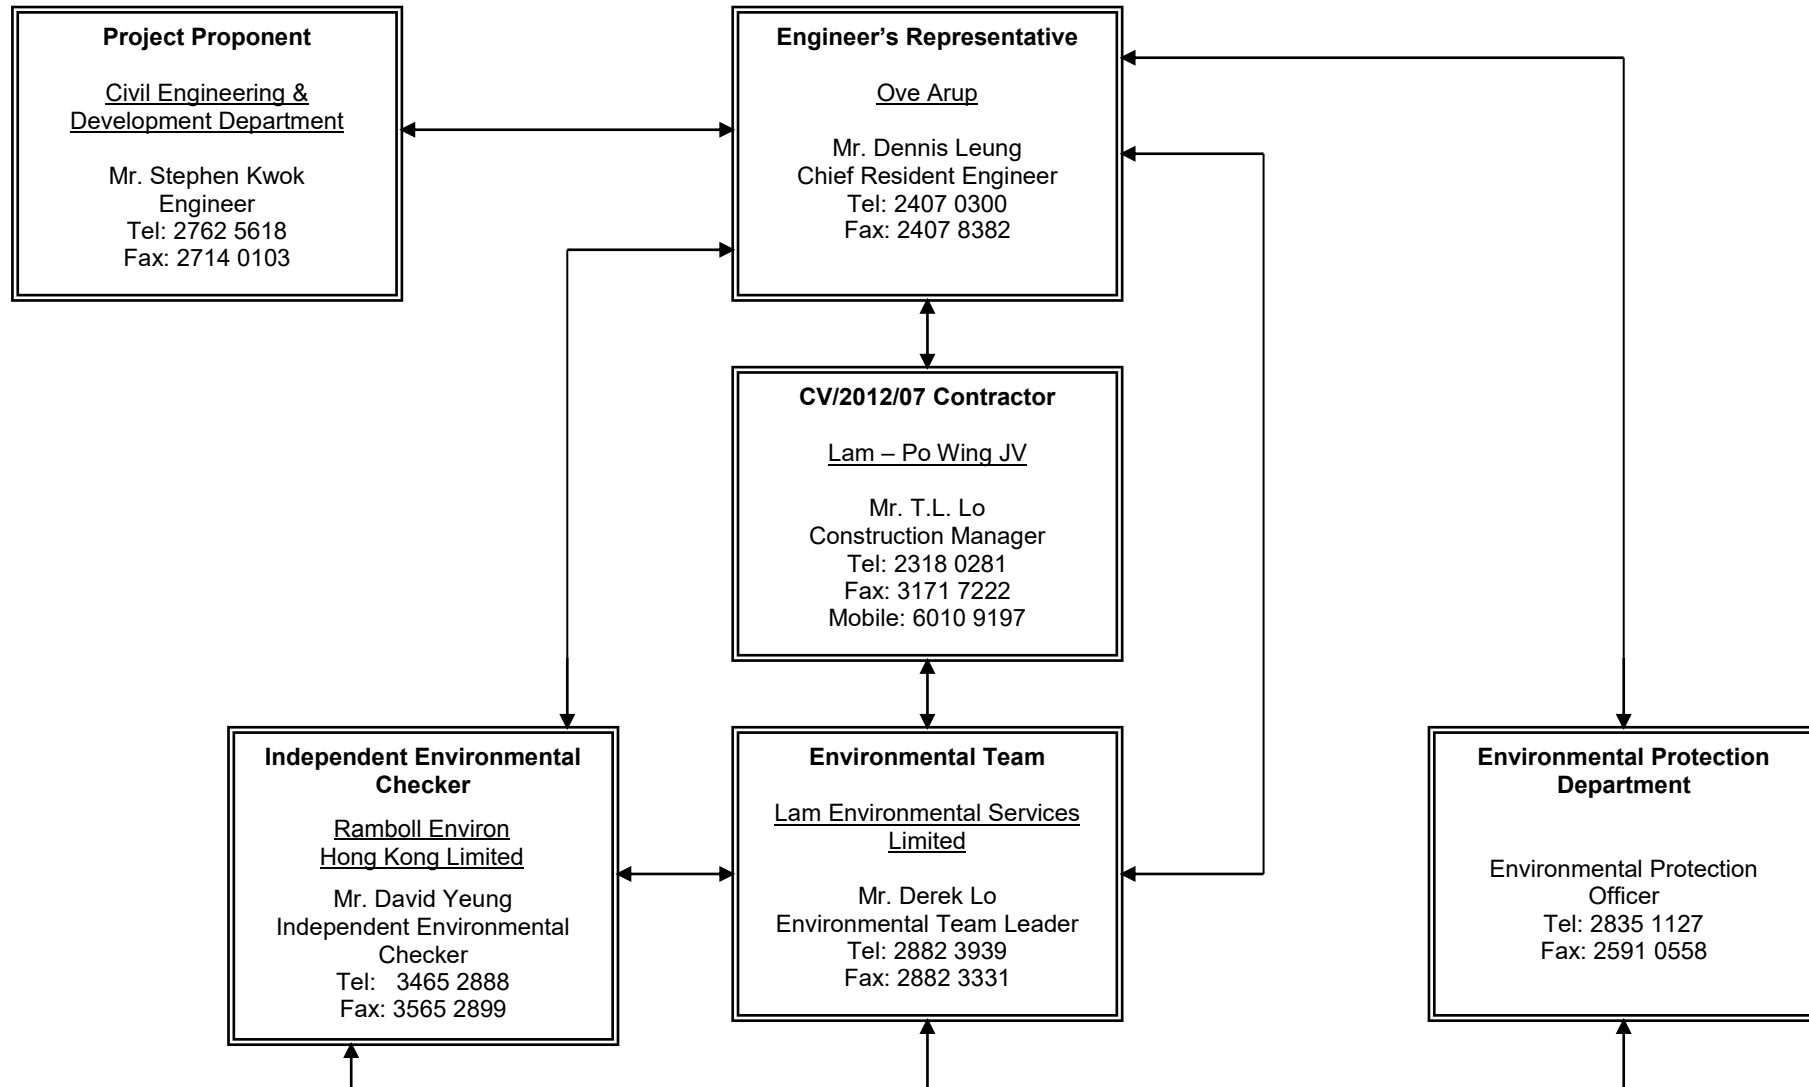


***Figure 2.2***

***Project Organization Chart***



**Project Organization Chart**

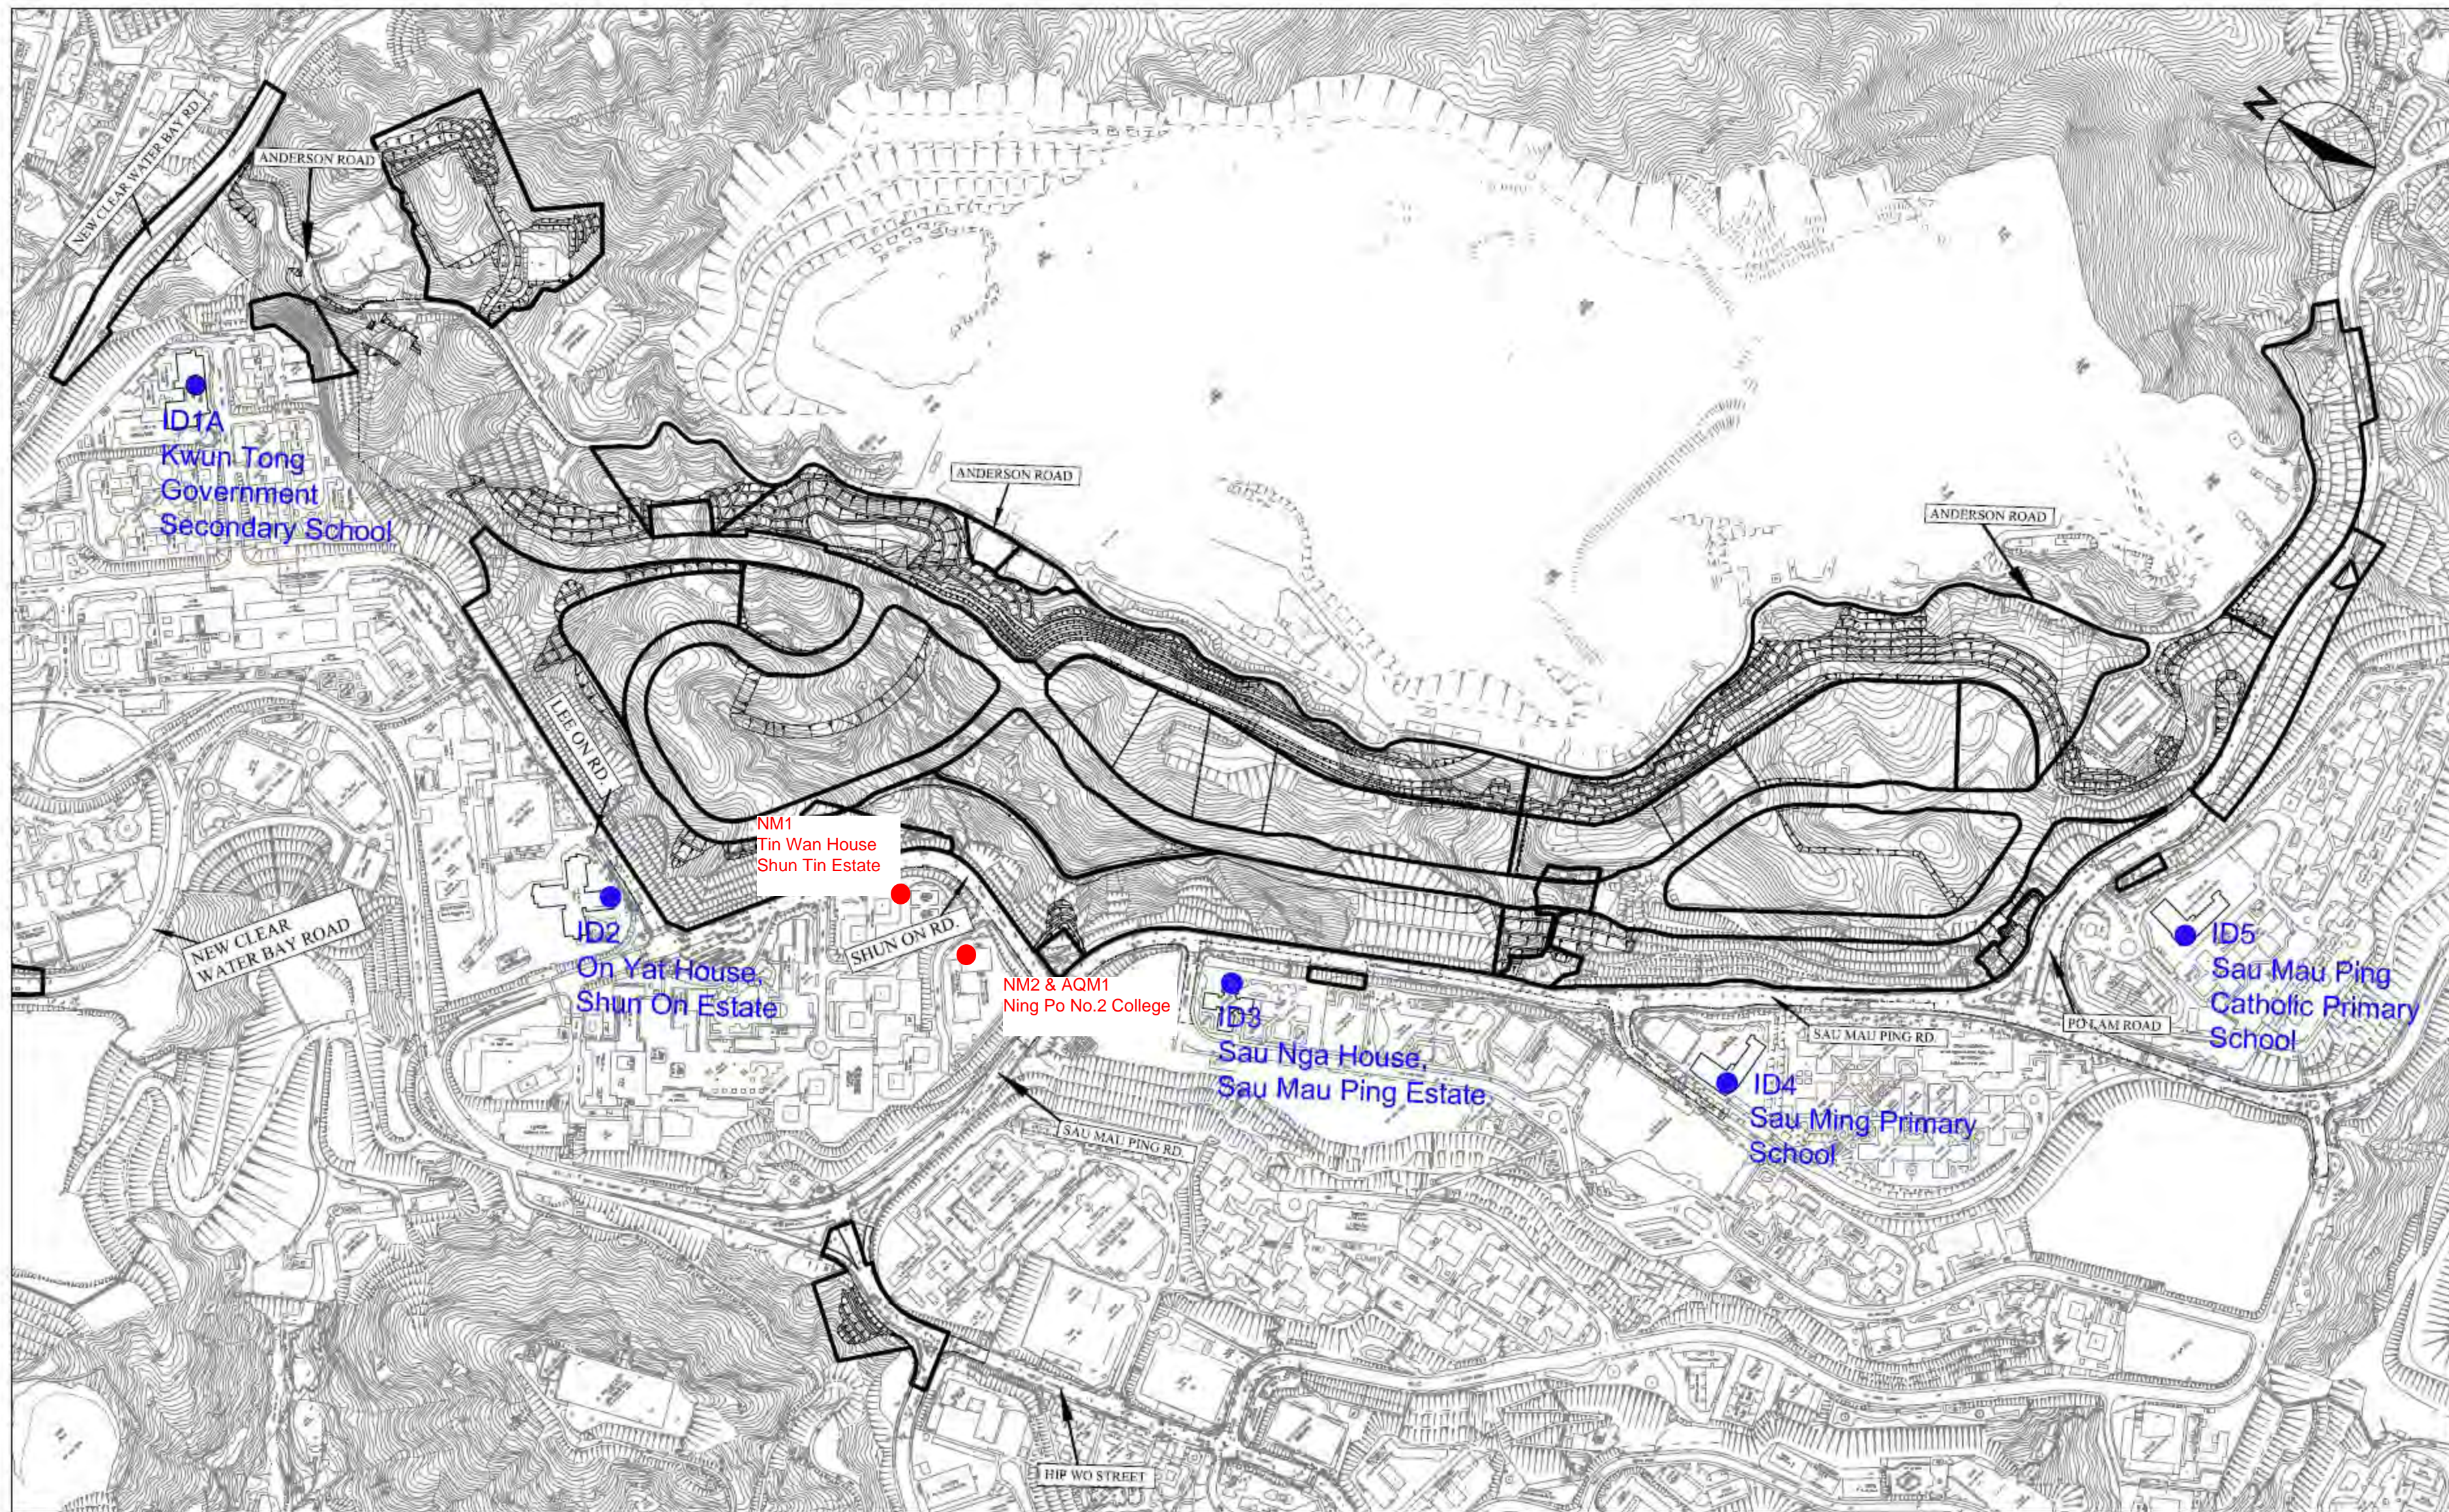




***Figure 4.1***

***Locations of Environmental Monitoring Stations***





**Figure 4.1. Environmental Monitoring Location**

**LEGEND**

- impact monitoring station
- Monitoring station of master project





***Appendix 3.1***

***Environmental Mitigation Implementation Schedule***



### Environmental Mitigation Implementation Schedule

#### Implementation Schedule for Construction Dust Control

EIA Ref.	EM&A Log Ref.	Environmental Protection Measures	Location (duration/ completion of measures)	Funding Agent	Implementation Agent	Implementation Stages**		Relevant Legislation & Guidelines
						D	C	
S2.7	S1, S2.8	<p><i>Site Practice</i></p> <ul style="list-style-type: none"> <li>• Mean vehicle speed of haulage trucks at 10 km/hr.</li> <li>• Twice daily watering of all open site areas.</li> <li>• Regular watering (once every 1 hour) of all site roads and access roads with frequent truck movement.</li> <li>• Tarpaulin covering of all dusty vehicle loads transported to, from and between site locations.</li> <li>• Establishment and use of vehicle wheel and body washing facilities at the exit points of the site, combined with cleaning of public roads where necessary.</li> <li>• Suitable side and tailboards on haulage vehicles.</li> <li>• Watering of temporary stockpiles.</li> </ul> <p><i>Blasting</i></p> <ul style="list-style-type: none"> <li>• Use of select aggregate and fines to stem the charge with drill holes and watering of blast face.</li> <li>• Use of vaccum extraction drilling methods.</li> <li>• Carefully sequenced blasting.</li> </ul> <p><i>Crushing</i></p> <ul style="list-style-type: none"> <li>• Fabric filters installed for the crushing plant.</li> <li>• Water sprays on the crusher.</li> </ul> <p><i>Loading and Unloading Points, and conyeyor Belt System</i></p> <ul style="list-style-type: none"> <li>• Water sprays at all fixed loading and unloading points (at the crusher and conveyor belts).</li> <li>• The loading point at the crusher is enclosed with dust curtains are used for controlling dust.</li> <li>• When transferring materials from conveyor belt or crusher to the dump trucks, chutes or dust curtains are used for controlling dust.</li> <li>• Cover the conveyor belts with steel roof and canvas sides.</li> </ul>	All Construction sites (late 2007 to 2016)	CEDD	Lam – Po Wing JV	√	√	TM on EIA Process, APCO, Air Pollution Control (Construction Dust) Regulation

\* All recommendations and requirements are summarized from approved EIA resulted during the course of EIA Process, including ACE and/or accepted public comment to the proposed project,

\*\* D=Design, C=Construction



Implementation Schedule for Construction Noise Control

EIA Ref.	EM&A Log Ref.	Environmental Protection Measures	Location (duration/ completion of measures)	Funding Agent	Implementation Agent	Implementation Stages**		Relevant Legislation & Guidelines
						D	C	
S3.7	S1, S3.7	<p><i>Site Formation</i></p> <ul style="list-style-type: none"> <li>Silenced powered mechanical equipment (PME) for most equipment5 (including drill rig, backhoe, dump truck, breaker and crane) and the decrease of percentage on time usage of drill rig among the Central Area form 50% to 40% is prosed.</li> <li>Temporary movable noise barrier shall be used to shield the noise emanating from the drilling rig in order to provide adequate shielding for the affected NSRs.</li> </ul>	All Construction sites (late 2007 to 2016)	CEDD	Lam – Po Wing JV	√	√	TM on EIA Process, NCO, TM on Noise from Construction Work other than Percussive Pilling, ProPECC Note PN2/93

\* All recommendations and requirements are summarized from approved EIA resulted during the course of EIA Process, including ACE and/or accepted public comment to the proposed project,

\*\* D=Design, C=Construction



Implementation Schedule for Water Quality Control

EIA Ref.	EM&A Log Ref.	Environmental Protection Measures	Location (duration/ completion of measures)	Funding Agent	Implementation Agent	Implementation Stages**		Relevant Legislation & Guidelines
						D	C	
S6.4	S1	<p><i>Construction Phase</i></p> <ul style="list-style-type: none"> <li>All active working areas should be bounded to retain storm water with sufficient retention time to ensure that suspended solids are not discharged from the site in concentrations above those specified in the TM for the Victor Harbour (Phase I) WCZ. All fuel storage areas should be bounded with drainage directed to an oil interceptor.</li> <li>Separate treatment facilities may be required for effluent from site offices, toilets (unless chemical toilets are used) and canteens.</li> <li>Discharged wastewater from the construction sites to surface water and /or public drainage systems should be controlled through licensing. Discharges should follow fully the terms and conditions in the licences.</li> <li>Relevant practice for dealing with various typr of construction discharges provided in EPD's ProPECC Note 1/94 should be adopted.</li> </ul>	All Construction sites (late 2007 to 2016)	CEDD	Lam – Po Wing JV	√	√	TM on EIA Process, WPCO, ProPECC Note PN 1/94

\* All recommendations and requirements are summarized from approved EIA resulted during the course of EIA Process, including ACE and/or accepted public comment to the proposed project,

\*\* D=Design, C=Construction



Implementation Schedule for Construction Waste Management

EIA Ref.	EM&A Log Ref.	Environmental Protection Measures	Location (duration/ completion of measures)	Funding Agent	Implementation Agent	Implementation Stages**		Relevant Legislation & Guidelines
						D	C	
S8.4	S1,S4	<p><i>Waste Disposal</i></p> <ul style="list-style-type: none"> <li>Different types of wastes should be segregated, stored, transported and disposed of proper practice of waste management.</li> <li>Sorting of wastes should be done on-site. Different types of wastes should be segregated and stored in different stockpiles, containers or skips to enhance recycling of materials and proper disposal of wastes.</li> <li>Excavated spoil should be used as much as possible to minimize off-site fill material requirements and disposal of spoil.</li> <li>During road transportation of excavated spoil, vehicles should be covered to avoid dust impact. Wheel washing facilities should be installed at all site exits together with regular watering of the site access roads.</li> <li>Chemical waste should be recycled on-site or removed by licenced companies. It should be handled according to the Code of practice on the packaging, Labelling and Storage of Chemical Wastes. When off-site disposal is required, it should be collected and delivered by licenced contractors to Tsing Yi Chemical Waste Treatment Facility and disposed of in accordance with the Chemical Waste (General) Regulation.</li> <li>Necessary mitigation measures should be adopted to prevent the uncontrolled disposal of chemical and hazardous waste into air, soil, surface waters and ground waters.</li> </ul>	All Construction sites (late 2007 to 2016)	CEDD	Lam – Po Wing JV	√	√	TM on EIA Process, WDO, DGO, Waste Disposal (Chemical Waste) (General) Regulation



		<p><i>Waste Storage</i></p> <ul style="list-style-type: none"><li>• Chemical material storage areas should be bounded, constructed of impervious materials, and have the capacity to contain 120 percent of the total volume of the containers. Indoor storage areas must have sufficient ventilation to prevent the build-up of fumes, and must be capable of evacuating the space in the event of an accidental release. Outdoor storage areas must be covered with a canopy or contain provisions for the safe removal of rainwater. In both cases, storage areas must not be connected to the foul or stormwater sewer system.</li><li>• Dangerous materials as defined under the DGO, including fuel, oil and lubricants, should be stored and properly labeled on site in accordance with the requirements in the DGO. If transportation of hazardous materials is necessary, hazardous materials, chemical wastes and fuel should be packed or stored in containers or vessels of suitable design and construction to prevent leakage, spillage or escape.</li><li>• Human waste should be discharged into septic tanks provided by the contractors and removed regularly by a hygiene services company. Refuse containers such as open skips should be provided at every work site for use by the workforce; On-site refuse collection points must also be provided.</li></ul>						
--	--	--	--	--	--	--	--	--

\* All recommendations and requirements are summarized from approved EIA resulted during the course of EIA Process, including ACE and/or accepted public comment to the proposed project,

\*\* D=Design, C=Construction



***Appendix 4.1***

***Action and Limit Level***



### Action and Limit Level

#### *Action and Limit Level for Noise Monitoring*

Time Period	Action Level	Limit Level
07:00 – 19:00 hours on normal weekdays	When one documented complaint is received.	75 dB(A)/ 70 dB(A)/ 65 dB(A) <sup>Note 1</sup>

Note 1:

- 70dB(A) and 65 dB(A) for schools during normal teaching periods and school examination periods, respectively.
- If works are to be carried out during the restricted hours, the conditions stipulated in the Construction Noise Permit (CNP) issued by the Noise Control Authority have to be followed.

#### *Action and Limit Level for Air Monitoring*

Monitoring Location	1-hour TSP Level in $\mu\text{g}/\text{m}^3$		24-hour TSP Level in $\mu\text{g}/\text{m}^3$	
	Action Level	Limit Level	Action Level	Limit Level
AQM1	197	500	200	260





***Appendix 4.2***

***Copies of Calibration Certificates***



Lam Environmental Services Limited

**Calibration Data for High Volume Sampler (TSP Sampler)**

**Location** : Ning Po No.2 College  
**ID** : AQM1

**Calibration Date** : 10-Aug-15  
**Calibration Due Date** : 10-Oct-15

**CALIBRATION OF CONTINUOUS FLOW RECORDER**

Ambient Condition			
Temperature, T <sub>a</sub>	301	Kelvin	Pressure, P <sub>a</sub>
			1005 mmHg

Orifice Transfer Standard Information			
Equipment No.	EL086	Slope, m <sub>c</sub>	2.00072
		Intercept, b <sub>c</sub>	-0.01209
Last Calibration Date	30-Jun-15	$(H \times P_a / 1013.3 \times 298 / T_a)^{1/2}$ $= m_c \times Q_{std} + b_c$	
Next Calibration Date	30-Jun-16		

Calibration of TSP						
Calibration Point	Manometer Reading			Q <sub>std</sub> (m <sup>3</sup> / min.) X-axis	Continuous Flow Recorder, W (CFM)	IC (W(P <sub>a</sub> /1013.3x298/T <sub>a</sub> ) <sup>1/2</sup> /35.31) Y-axis
	(up)	(down)	(difference)			
1	6.0	6.0	12.0	1.7218	52	51.5279
2	5.4	5.4	10.8	1.6337	46	45.5824
3	4.1	4.1	8.2	1.4243	39	38.6459
4	2.5	2.5	5.0	1.1135	30	29.7276
5	1.3	1.3	2.6	0.8047	18	17.8366

By Linear Regression of Y on X

Slope, m = 34.8550      Intercept, b = -10.0274  
 Correlation Coefficient\* = 0.9957  
 Calibration Accepted = Yes/No\*\*

\* if Correlation Coefficient &lt; 0.990, check and recalibration again.

\*\* Delete as appropriate.

Remarks : \_\_\_\_\_  
 \_\_\_\_\_

**Calibrated by** : LuLu Mar  
**Date** : 10-Aug-15

**Checked by** : Derek Lo  
**Date** : 10-Aug-15



Lam Environmental Services Limited

**Calibration Data for High Volume Sampler (TSP Sampler)**

**Location** : Ning Po No.2 College  
**ID** : AQM1

**Calibration Date** : 2-Oct-15  
**Calibration Due Date** : 2-Dec-15

**CALIBRATION OF CONTINUOUS FLOW RECORDER**

Ambient Condition			
Temperature, T <sub>a</sub>	303	Kelvin	Pressure, P <sub>a</sub>
			1011 mmHg

Orifice Transfer Standard Information			
Equipment No.	EL086	Slope, m <sub>c</sub>	2.00072
		Intercept, b <sub>c</sub>	-0.01209
Last Calibration Date	30-Jun-15	$(H \times P_a / 1013.3 \times 298 / T_a)^{1/2}$ $= m_c \times Q_{std} + b_c$	
Next Calibration Date	30-Jun-16		

Calibration of TSP						
Calibration Point	Manometer Reading			Q <sub>std</sub> (m <sup>3</sup> / min.) X-axis	Continuous Flow Recorder, W (CFM)	IC (W(P <sub>a</sub> /1013.3x298/T <sub>a</sub> ) <sup>1/2</sup> /35.31) Y-axis
	(up)	(down)	(difference)			
1	6.1	6.1	12.2	1.7354	52	51.5106
2	5.4	5.4	10.8	1.6332	45	44.5765
3	4.1	4.1	8.2	1.4238	38	37.6424
4	2.6	2.6	5.2	1.1351	30	29.7177
5	1.5	1.5	3.0	0.8636	18	17.8306

By Linear Regression of Y on X

Slope, m = 36.2076      Intercept, b = -12.9223  
 Correlation Coefficient\* = 0.9935  
 Calibration Accepted = Yes/No\*\*

\* if Correlation Coefficient &lt; 0.990, check and recalibration again.

\*\* Delete as appropriate.

Remarks : \_\_\_\_\_

**Calibrated by** : Kit Au  
**Date** : 2-Oct-15

**Checked by** : Derek Lo  
**Date** : 2-Oct-15



Lam Environmental Services Limited

**Calibration Data for High Volume Sampler (TSP Sampler)**

**Location** : Ning Po No.2 College  
**ID** : AQM1

**Calibration Date** : 30-Nov-15  
**Calibration Due Date** : 30-Jan-16

**CALIBRATION OF CONTINUOUS FLOW RECORDER**

Ambient Condition			
Temperature, T <sub>a</sub>	295	Kelvin	Pressure, P <sub>a</sub>
			1019 mmHg

Orifice Transfer Standard Information			
Equipment No.	EL086	Slope, m <sub>c</sub>	2.00072
		Intercept, b <sub>c</sub>	-0.01209
Last Calibration Date	30-Jun-15	$(H \times P_a / 1013.3 \times 298 / T_a)^{1/2}$ $= m_c \times Q_{std} + b_c$	
Next Calibration Date	30-Jun-16		

Calibration of TSP						
Calibration Point	Manometer Reading			Q <sub>std</sub> (m <sup>3</sup> / min.) X-axis	Continuous Flow Recorder, W (CFM)	IC (W(P <sub>a</sub> /1013.3x298/T <sub>a</sub> ) <sup>1/2</sup> /35.31) Y-axis
	(up)	(down)	(difference)			
1	6.1	6.1	12.2	1.7656	50	50.3947
2	5.3	5.3	10.6	1.6462	43	43.3395
3	3.5	3.5	7.0	1.3389	33	33.2605
4	2.3	2.3	4.6	1.0865	25	25.1974
5	1.2	1.2	2.4	0.7865	15	15.1184

By Linear Regression of Y on X

Slope, m = 34.8859      Intercept, b = -12.7524  
 Correlation Coefficient\* = 0.9969  
 Calibration Accepted = Yes/No\*\*

\* if Correlation Coefficient &lt; 0.990, check and recalibration again.

\*\* Delete as appropriate.

Remarks : \_\_\_\_\_  
 \_\_\_\_\_

**Calibrated by** : Kit Au  
**Date** : 30-Nov-15

**Checked by** : Derek Lo  
**Date** : 30-Nov-15



## CERTIFICATE OF CALIBRATION

Certificate No.: 15CA0312 03 Page 1 of 2

### Item tested

Description: Sound Level Meter (Type 1) , Microphone  
Manufacturer: CESVA Instruments s.l. , CESVA  
Type/Model No.: SC-20e , C-130  
Serial/Equipment No.: T217501 , 12624  
Adaptors used: - , -

### Item submitted by

Customer Name: Pilot Testing Limited  
Address of Customer: -  
Request No.: -  
Date of receipt: 12-Mar-2015

Date of test: 13-Mar-2015

### Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Multi function sound calibrator	B&K 4226	2288444	20-Jun-2015	CIGISMEC
Signal generator	DS 360	33873	09-Apr-2015	CEPREI
Signal generator	DS 360	61227	09-Apr-2015	CEPREI

### Ambient conditions

Temperature:  $21 \pm 1$  °C  
Relative humidity:  $60 \pm 10$  %  
Air pressure:  $1010 \pm 5$  hPa

### Test specifications

- 1, The Sound Level Meter has been calibrated in accordance with the requirements as specified in BS 7580: Part 1: 1997 and the lab calibration procedure SMTP004-CA-152.
- 2, The electrical tests were performed using an electrical signal substituted for the microphone which was removed and replaced by an equivalent capacitance within a tolerance of  $\pm 20\%$ .
- 3, The acoustic calibration was performed using an B&K 4226 sound calibrator and corrections was applied for the difference between the free-field and pressure responsiveness of the Sound Level Meter.


### Test results

This is to certify that the Sound Level Meter conforms to BS 7580: Part 1: 1997 for the conditions under which the test was performed.

Details of the performed measurements are presented on page 2 of this certificate.


Actual Measurement data are documented on worksheets.

Approved Signatory:

  
Huang Jian Min/Feng Jun Qi

Date: 13-Mar-2015

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument.



## CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 15CA0312 03 Page 2 of 2

### 1, Electrical Tests

The electrical tests were performed using an equivalent capacitance substituted for the microphone. The results are given in below with test status and the estimated uncertainties. The "Pass" means the result of the test is inside the tolerances stated in the test specifications. The "-" means the result of test is outside these tolerances.

Test:	Subtest:	Status:	Expanded Uncertainty (dB)	Coverage Factor
Self-generated noise	A	Pass	0.3	2.1
	C	Pass	0.8	
	Lin	N/A	N/A	
Linearity range for Leq	At reference range, Step 5 dB at 4 kHz	Pass	0.3	
	Reference SPL on all other ranges	Pass	0.3	
	2 dB below upper limit of each range	Pass	0.3	
	2 dB above lower limit of each range	Pass	0.3	
Linearity range for SPL	At reference range, Step 5 dB at 4 kHz	Pass	0.3	
	A	Pass	0.3	
	C	Pass	0.3	
Time weightings	Lin	N/A	N/A	
	Single Burst Fast	Pass	0.3	
	Single Burst Slow	Pass	0.3	
Peak response	Single 100µs rectangular pulse	Pass	0.3	
R.M.S. accuracy	Crest factor of 3	Pass	0.3	
Time weighting I	Single burst 5 ms at 2000 Hz	N/A	N/A	
	Repeated at frequency of 100 Hz	N/A	N/A	
Time averaging	1 ms burst duty factor 1/10 <sup>3</sup> at 4kHz	Pass	0.3	
	1 ms burst duty factor 1/10 <sup>4</sup> at 4kHz	Pass	0.3	
Pulse range	Single burst 10 ms at 4 kHz	Pass	0.4	
Sound exposure level	Single burst 10 ms at 4 kHz	Pass	0.4	
Overload indication	SPL	Pass	0.3	
	Leq	Pass	0.4	

### 2, Acoustic tests

The complete sound level meter was calibrated on the reference range using a B&K 4226 acoustic calibrator with 1000Hz and SPL 94 dB. The sensitivity of the sound level meter was adjusted. The test result at 125 Hz and 8000 Hz are given in below with test status and the estimated uncertainties.

Test:	Subtest	Status	Expanded Uncertainty (dB)	Coverage Factor
Acoustic response	Weighting A at 125 Hz	Pass	0.3	
	Weighting A at 8000 Hz	Pass	0.5	

### 3, Response to associated sound calibrator

N/A

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

Calibrated by:

Date: 13-Mar-2015

Fung Chi Yip

- End -

Checked by:

Date: 13-Mar-2015

Lam Tze Wai

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.





Test Data for Sound Level Meter

Page 1 of 5

Sound level meter type: SC-20e Serial No. T217501 Date 13-Mar-2015  
Microphone type: C-130 Serial No. 12624  
Report: 15CA0312 03

**SELF GENERATED NOISE TEST**

The noise test is performed in the most sensitive range of the SLM with the microphone replaced by an equivalent impedance.

Noise level in A weighting 17.3 dB  
Noise level in C weighting 21.6 dB

**LINEARITY TEST**

The linearity is tested relative to the reference sound pressure level using a continuous sinusoidal signal of frequency 4 kHz. The measurement is made on the reference range for indications at 5 dB intervals starting from the 94 dB reference sound pressure level. And until within 5 dB of the upper and lower limits of the reference range, the measurements shall be made at 1 dB intervals.(SLM set to LEQ/SPL)

Reference/Expected level	Actual level		Tolerance	Deviation	
	non-integrated	integrated		non-integrated	integrated
dB	dB	dB	+/- dB	dB	dB
94.0	94.0	94.0	0.7	0.0	0.0
99.0	99.0	99.0	0.7	0.0	0.0
104.0	104.0	104.0	0.7	0.0	0.0
109.0	109.0	109.0	0.7	0.0	0.0
114.0	114.0	114.0	0.7	0.0	0.0
119.0	119.0	119.0	0.7	0.0	0.0
124.0	124.0	124.0	0.7	0.0	0.0
125.0	125.0	125.0	0.7	0.0	0.0
126.0	126.0	126.0	0.7	0.0	0.0
127.0	127.0	127.0	0.7	0.0	0.0
128.0	127.9	127.9	0.7	-0.1	-0.1
129.0	128.9	128.9	0.7	-0.1	-0.1
130.0	129.9	129.9	0.7	-0.1	-0.1
89.0	89.0	89.0	0.7	0.0	0.0
84.0	84.0	84.0	0.7	0.0	0.0
79.0	79.0	79.0	0.7	0.0	0.0
74.0	74.0	74.0	0.7	0.0	0.0
69.0	69.0	69.0	0.7	0.0	0.0
64.0	64.0	64.0	0.7	0.0	0.0
59.0	59.0	59.0	0.7	0.0	0.0
54.0	53.9	53.9	0.7	-0.1	-0.1
49.0	48.9	48.9	0.7	-0.1	-0.1
44.0	43.9	43.9	0.7	-0.1	-0.1
39.0	38.9	38.9	0.7	-0.1	-0.1
34.0	33.9	33.9	0.7	-0.1	-0.1



Test Data for Sound Level Meter

Page 2 of 5

Sound level meter type: SC-20e Serial No. T217501 Date 13-Mar-2015  
Microphone type: C-130 Serial No. 12624  
Report: 15CA0312 03

33.0	33.0	33.0	0.7	0.0	0.0
32.0	32.1	32.1	0.7	0.1	0.1
31.0	31.1	31.1	0.7	0.1	0.1
30.0	30.1	30.1	0.7	0.1	0.1

Measurements for an indication of the reference SPL on all other ranges which include it

Other ranges	Expected level	Actual level	Tolerance	Deviation
dB	dB	dB	+/- dB	dB
30-130	94.0	94.0	0.7	0.0

Measurements on all level ranges for indications 2 dB below the upper limit and 2 dB above the lower limit

Ranges	Reference/Expected level	Actual level	Tolerance	Deviation
dB	dB	dB	+/- dB	dB
30-130	32.0	32.1	0.7	0.1
	128.0	127.9	0.7	-0.1

## FREQUENCY WEIGHTING TEST

The frequency response of the weighting networks are tested at octave intervals over the frequency ranges 31.5 Hz to 12500 Hz. The signal level at 1000 Hz is set to give an indication of the reference SPL.

Frequency weighting A:

Frequency Hz	Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
				+	-	
1000.0	94.0	94.0	94.0	0.0	0.0	0.0
31.6	94.0	54.6	54.4	1.5	1.5	-0.2
63.1	94.0	67.8	67.7	1.5	1.5	-0.1
125.9	94.0	77.9	77.8	1.0	1.0	-0.1
251.2	94.0	85.4	85.3	1.0	1.0	-0.1
501.2	94.0	90.8	90.7	1.0	1.0	-0.1
1995.0	94.0	95.2	95.2	1.0	1.0	0.0
3981.0	94.0	95.0	95.0	1.0	1.0	0.0
7943.0	94.0	92.9	92.8	1.5	3.0	-0.1
12590.0	94.0	89.7	87.8	3.0	6.0	-1.9

Frequency weighting C:

Frequency Hz	Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
				+	-	
1000.0	94.0	94.0	94.0	0.0	0.0	0.0
31.6	94.0	91.0	90.9	1.5	1.5	-0.1
63.1	94.0	93.2	93.0	1.5	1.5	-0.2
125.9	94.0	93.8	93.7	1.0	1.0	-0.1
251.2	94.0	94.0	93.9	1.0	1.0	-0.1





Test Data for Sound Level Meter

Sound level meter type: SC-20e Serial No. T217501 Date 13-Mar-2015  
Microphone type: C-130 Serial No. 12624  
Report: 15CA0312 03

501.2	94.0	94.0	94.0	1.0	1.0	0.0
1995.0	94.0	93.8	93.8	1.0	1.0	0.0
3981.0	94.0	93.2	93.2	1.0	1.0	0.0
7943.0	94.0	91.0	90.9	1.5	3.0	-0.1
12590.0	94.0	87.8	85.8	3.0	6.0	-2.0

TIME WEIGHTING FAST TEST

Time weighting F is tested on the reference range with a single sinusoidal burst of duration 200 ms at a frequency 2000 Hz and an amplitude which produces an indication 4 dB below the upper limit of the primary indicator range when the signal is continuous. (Weight A, Maximum hold)

Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
			+	-	
86.0	85.0	85.0	1.0	1.0	0.0

TIME WEIGHTING SLOW TEST

Time weighting S is tested on the reference range with a single sinusoidal burst of duration 500 ms at a frequency 2000 Hz and an amplitude which produces an indication 4 dB below the upper limit of the primary indicator range when the signal is continuous. (Weight A, Maximum hold)

Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
			+	-	
86.0	81.9	81.9	1.0	1.0	0.0

PEAK RESPONSE TEST

The onset time of the peak detector is tested on the reference range by comparing the response to a 100 us rectangular test pulse with the response to a 10 ms reference pulse of the same amplitude. The amplitude of the 10 ms reference pulse is such as to produce an indication 1 dB below the upper limit of the primary indicator range.

Positive polarities: (Weighting C, set the generator signal to single, Lcpmax)

Ref. level dB	Response to 10 ms dB	Response to 100 us dB	Tolerance +/- dB	Deviation dB
89.0	89.0	88.5	2.0	-0.5

Negative polarities:

Ref. level dB	Response to 10 ms dB	Response to 100 us dB	Tolerance +/- dB	Deviation dB
89.0	89.0	88.5	2.0	-0.5

RMS ACCURACY TEST

The RMS detector accuracy is tested on the reference range for a crest factor of 3.

Test frequency: 2000 Hz  
Amplitude: 2 dB below the upper limit of the primary indicator range.  
Burst repetition frequency: 40 Hz  
Tone burst signal: 11 cycles of a sine wave of frequency 2000 Hz. (Set to INT)

	Ref. Level dB	Expected level dB	Tone burst signal indication(dB)	Tolerance +/- dB	Deviation dB
Time wighting Slow	88.0+6.6	88.0	88.0	0.5	0.0



Test Data for Sound Level Meter

Page 4 of 5

Sound level meter type: SC-20e Serial No. T217501 Date 13-Mar-2015  
Microphone type: C-130 Serial No. 12624  
Report: 15CA0312 03

**TIME AVERAGING TEST**

This test compares the SLM reading for continuous sine signals with readings obtained from a sine tone burst sequence having the same RMS level. The test level is 30 dB below the upper limit of the linearity range and repeated for Type 1 SLM with 40 dB below the upper limit of the linearity.

Frequency of tone burst: 4000 Hz  
Duration of tone burst: 1 ms

Repetition Time	Level of tone burst	Expected Leq	Actual Leq	Tolerance	Deviation	Remarks
msec	dB	dB	dB	+/- dB	dB	
1000	100.0	100.0	99.9	1.0	-0.1	60s integ.
10000	90.0	90.0	89.9	1.0	-0.1	6min. integ.

**PULSE RANGE AND SOUND EXPOSURE LEVEL TEST**

The test tone burst signal is superimposed on a baseline signal corresponding to the lower limit of reference range

Test frequency: 4000 Hz  
Integration time: 10 sec

The integrating sound level meter set to Leq:

Duration	Rms level of tone burst (dB)	Expected	Actual	Tolerance	Deviation
msec	dB	dB	dB	+/- dB	dB
10	88.0	58.0	58.0	1.7	0.0

The integrating sound level meter set to SEL:

Duration	Rms level of tone burst (dB)	Expected	Actual	Tolerance	Deviation
msec	dB	dB	dB	+/- dB	dB
10.0	88.0	68.0	68.0	1.7	0.0

**OVERLOAD INDICATION TEST**

For SLM capable of operating in a non-integrating mode.

Test frequency: 2000 Hz  
Amplitude: 2 dB below the upper limit of the primary indicator range.  
Burst repetition frequency: 40 Hz  
Tone burst signal: 11 cycles of a sine wave of frequency 2000 Hz.

Level at overload (dB)	Level reduced by	Further reduced	Difference	Tolerance	Deviation
dB	dB	dB	dB	dB	dB
132.3	1 dB	128.3	3.0	1.0	0.0

For integrating SLM, with the instrument indicating Leq.

For integrating SLM, with the instrument indicating Leq and set to the reference range. The test signal as follow  
The test tone burst signal is superimposed on a baseline signal corresponding to the lower limit of reference range

Test frequency: 4000 Hz  
Integration time: 10 sec  
Single burst duration: 1 msec

Rms level at overload (dB)	Level reduced by	Expected level	Actual level	Tolerance	Deviation
dB	dB	dB	dB	dB	dB
	1 dB				





Test Data for Sound Level Meter

Page 5 of 5

Sound level meter type: SC-20e Serial No. T217501 Date 13-Mar-2015  
Microphone type: C-130 Serial No. 12624  
Report: 15CA0312 03

137.1	136.1	96.1	96.1	2.2	0.0
-------	-------	------	------	-----	-----

ACOUSTIC TEST

The acoustic test of the complete SLM is tested at the frequency 125 Hz and 8000 Hz using a B&K type 4226 Multifunction Acoustic Calibrator. The test is performed in A weighting.

Frequency Hz	Expected level dB	Actual level Measured (dB)	Tolerance (dB)		Deviation dB
			+	-	
1000	94.0	94.0	0.0	0.0	0.0
125	77.9	77.9	1.0	1.0	0.0
8000	92.9	91.6	1.5	3.0	-1.3

-----END-----



## CERTIFICATE OF CALIBRATION

Certificate No.: 14CA1201 04

Page: 1 of 2

### Item tested

Description: Acoustical Calibrator (Class 1)  
Manufacturer: Rion Co., Ltd.  
Type/Model No.: NC-73  
Serial/Equipment No.: 10707358  
Adaptors used: -

### Item submitted by

Customer: Lam Geotechnics Ltd.  
Address of Customer: -  
Request No.: -  
Date of receipt: 01-Dec-2014

Date of test: 10-Dec-2014

### Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Lab standard microphone	B&K 4180	2412857	13-May-2015	SCL
Preamplifier	B&K 2673	2239857	10-Apr-2015	CEPREI
Measuring amplifier	B&K 2610	2346941	08-Apr-2015	CEPREI
Signal generator	DS 360	61227	09-Apr-2015	CEPREI
Digital multi-meter	34401A	US36087050	01-Dec-2015	CEPREI
Audio analyzer	8903B	GB41300350	07-Apr-2015	CEPREI
Universal counter	53132A	MY40003662	11-Apr-2015	CEPREI

### Ambient conditions

Temperature:  $21 \pm 1$  °C  
Relative humidity:  $60 \pm 10$  %  
Air pressure:  $1010 \pm 5$  hPa

### Test specifications


- 1, The Sound Calibrator has been calibrated in accordance with the requirements as specified in IEC 60942 1997 Annex B and the lab calibration procedure SMTP004-CA-156.
- 2, The calibrator was tested with its axis vertical facing downwards at the specific frequency using insert voltage technique.
- 3, The results are rounded to the nearest 0.01 dB and 0.1 Hz and have not been corrected for variations from a reference pressure of 1013.25 hectoPascals as the maker's information indicates that the instrument is insensitive to pressure changes.

### Test results

This is to certify that the sound calibrator conforms to the requirements of annex B of IEC 60942: 1997 for the conditions under which the test was performed. This does not imply that the sound calibrator meets IEC 60942 under any other conditions.

Details of the performed measurements are presented on **page 2** of this certificate.

Approved Signatory:

  
Huang Jian Min/Feng Jun Qi

Date: 11-Dec-2014

Company Chop:

**Comments:** The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument.





## CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 14CA1201 04

Page: 2 of 2

### 1, Measured Sound Pressure Level

The output Sound Pressure Level in the calibrator head was measured at the setting and frequency shown using a calibrated laboratory standard microphone and insert voltage technique. The results are given in below with the estimated uncertainties.

Frequency Shown Hz	Output Sound Pressure Level Setting dB	Measured Output Sound Pressure Level dB	(Output level in dB re 20 $\mu$ Pa)
			Estimated Expanded Uncertainty dB
1000	94.00	94.09	0.10

### 2, Sound Pressure Level Stability - Short Term Fluctuations

The Short Term Fluctuations was determined by measuring the maximum and minimum of the fast weighted DC output of the B&K 2610 measuring amplifier over a 20 second time interval as required in the standard. The Short Term Fluctuation was found to be:

At 1000 Hz **STF = 0.001 dB**

Estimated expanded uncertainty 0.005 dB

### 3, Actual Output Frequency

The determination of actual output frequency was made using a B&K 4180 microphone together with a B&K 2673 preamplifier connected to a B&K 2610 measuring amplifier. The AC output of the B&K 2610 was taken to an universal counter which was used to determine the frequency averaged over 20 second of operation as required by the standard. The actual output frequency at 1 KHz was:

At 1000 Hz **Actual Frequency = 993.19 Hz**

Estimated expanded uncertainty 0.1 Hz Coverage factor k = 2.2

### 4, Total Noise and Distortion

For the Total Noise and Distortion measurement, the unfiltered AC output of the B&K 2610 measuring amplifier was connected to an Agilent Type 8903 B distortion analyser. The TND result at 1 KHz was:

At 1000 Hz **TND = 0.9 %**

Estimated expanded uncertainty 0.7 %

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

Calibrated by:

Date: 10-Dec-2014

Fung Chi Yip

- End -

Checked by:

Date: 11-Dec-2014

Lam Tze Wai

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.





## CERTIFICATE OF CALIBRATION

Certificate No.: 15CA1203 04-02

Page: 1 of 2

### Item tested

Description: Acoustical Calibrator (Class 1)  
Manufacturer: Rion Co., Ltd.  
Type/Model No.: NC-73  
Serial/Equipment No.: 10707358  
Adaptors used: -

### Item submitted by

Customer: Lam Geotechnics Ltd.  
Address of Customer: -  
Request No.: -  
Date of receipt: 03-Dec-2015

Date of test: 04-Dec-2015

### Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Lab standard microphone	B&K 4180	2341427	15-Apr-2016	SCL
Preamplifier	B&K 2673	2239857	22-Apr-2016	CEPREI
Measuring amplifier	B&K 2610	2346941	22-Apr-2016	CEPREI
Signal generator	DS 360	61227	16-Apr-2016	CEPREI
Digital multi-meter	34401A	US36087050	17-Apr-2016	CEPREI
Audio analyzer	8903B	GB41300350	17-Apr-2016	CEPREI
Universal counter	53132A	MY40003662	16-Apr-2016	CEPREI

### Ambient conditions

Temperature: 22 ± 1 °C  
Relative humidity: 50 ± 10 %  
Air pressure: 1010 ± 5 hPa

### Test specifications


- The Sound Calibrator has been calibrated in accordance with the requirements as specified in IEC 60942 1997 Annex B and the lab calibration procedure SMTP004-CA-156.
- The calibrator was tested with its axis vertical facing downwards at the specific frequency using insert voltage technique.
- The results are rounded to the nearest 0.01 dB and 0.1 Hz and have not been corrected for variations from a reference pressure of 1013.25 hectoPascals as the maker's information indicates that the instrument is insensitive to pressure changes.

### Test results

This is to certify that the sound calibrator conforms to the requirements of annex B of IEC 60942: 1997 for the conditions under which the test was performed. This does not imply that the sound calibrator meets IEC 60942 under any other conditions.


Details of the performed measurements are presented on page 2 of this certificate.

Approved Signatory:

  
Huang Jian Min/Feng Jun Qi

Date: 05-Dec-2015

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument.



## CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 15CA1203 04-02 Page: 2 of 2

### 1, Measured Sound Pressure Level

The output Sound Pressure Level in the calibrator head was measured at the setting and frequency shown using a calibrated laboratory standard microphone and insert voltage technique. The results are given in below with the estimated uncertainties.

Frequency Shown Hz	Output Sound Pressure Level Setting dB	Measured Output Sound Pressure Level dB	(Output level in dB re 20 $\mu$ Pa) Estimated Expanded Uncertainty dB
1000	94.00	94.05	0.10

### 2, Sound Pressure Level Stability - Short Term Fluctuations

The Short Term Fluctuations was determined by measuring the maximum and minimum of the fast weighted DC output of the B&K 2610 measuring amplifier over a 20 second time interval as required in the standard. The Short Term Fluctuation was found to be:

At 1000 Hz STF = 0.002 dB

Estimated expanded uncertainty 0.005 dB

### 3, Actual Output Frequency

The determination of actual output frequency was made using a B&K 4180 microphone together with a B&K 2673 preamplifier connected to a B&K 2610 measuring amplifier. The AC output of the B&K 2610 was taken to an universal counter which was used to determine the frequency averaged over 20 second of operation as required by the standard. The actual output frequency at 1 KHz was:

At 1000 Hz Actual Frequency = 992.8 Hz

Estimated expanded uncertainty 0.1 Hz Coverage factor k = 2.2

### 4, Total Noise and Distortion

For the Total Noise and Distortion measurement, the unfiltered AC output of the B&K 2610 measuring amplifier was connected to an Agilent Type 8903 B distortion analyser. The TND result at 1 KHz was:

At 1000 Hz TND = 0.3 %

Estimated expanded uncertainty 0.7 %

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

Calibrated by:

Date:

Fung Chi Yip  
04-Dec-2015

- End -

Checked by:

Date:

Lam Tze Wai  
05-Dec-2015

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.





TISCH ENVIRONMENTAL, INC.  
 145 SOUTH MIAMI AVE  
 VILLAGE OF CLEVELAND, OH  
 45002  
 513.467.9000  
 877.263.7610 TOLL FREE  
 513.467.9009 FAX

ORIFICE TRANSFER STANDARD CERTIFICATION WORKSHEET TE-5025A

Date - Jul 14, 2014 Rootsmeter S/N 0438320 Ta (K) - 298  
 Operator Tisch Orifice I.D. - 0005 Pa (mm) - 749.3

PLATE OR Run #	VOLUME START (m3)	VOLUME STOP (m3)	DIFF VOLUME (m3)	DIFF TIME (min)	METER DIFF Hg (mm)	ORFICE DIFF H2O (in.)
1	NA	NA	1.00	1.3870	3.2	2.00
2	NA	NA	1.00	0.9830	6.4	4.00
3	NA	NA	1.00	0.8760	7.9	5.00
4	NA	NA	1.00	0.8340	8.8	5.50
5	NA	NA	1.00	0.6860	12.7	8.00

DATA TABULATION

Vstd	(x axis) Qstd	(y axis)	Va	(x axis) Qa	(y axis)
0.9817	0.7078	1.4042	0.9957	0.7179	0.8919
0.9775	0.9944	1.9859	0.9915	1.0086	1.2613
0.9754	1.1135	2.2203	0.9894	1.1294	1.4101
0.9743	1.1683	2.3286	0.9882	1.1849	1.4790
0.9692	1.4128	2.8084	0.9830	1.4330	1.7837
Qstd slope (m) = 1.99175			Qa slope (m) = 1.24720		
intercept (b) = -0.00041			intercept (b) = -0.00026		
coefficient (r) = 0.99991			coefficient (r) = 0.99991		
y axis = SQRT[H2O(Pa/760) (298/Ta)]			y axis = SQRT[H2O(Ta/Pa)]		

CALCULATIONS

Vstd = Diff. Vol [(Pa-Diff. Hg)/760] (298/Ta)  
 Qstd = Vstd/Time

Va = Diff Vol [(Pa-Diff Hg)/Pa]  
 Qa = Va/Time

For subsequent flow rate calculations:

Qstd = 1/m{ [SQRT(H2O(Pa/760) (298/Ta))] - b}  
 Qa = 1/m{ [SQRT H2O(Ta/Pa)] - b}



***Appendix 5.2***

***Noise Monitoring Results and Graphical Presentations***



JOB NO : CS\_J2013-02\_CV201207

CLIENT : LPWJV

Daytime(07:00-19:00)					
Date	Time	Location	Leq (dB)	L10 (dB)	L90 (dB)
5-Oct-15	13:28	NM1	63.6	66.0	58.0
	14:35	NM2	62.5	65.0	58.0
16-Oct-15	13:20	NM1	62.8	66.0	59.0
	14:30	NM2	61.0	65.0	58.0
22-Oct-15	9:00	NM1	64.2	68.0	59.0
	10:05	NM2	62.1	68.0	59.0
28-Oct-15	8:55	NM1	63.5	67.0	58.0
	10:15	NM2	62.9	66.0	58.0
3-Nov-15	13:10	NM1	64.1	67.0	62.0
	14:21	NM2	65.0	69.0	62.0
9-Nov-15	13:06	NM1	64.5	69.0	61.0
	14:11	NM2	66.2	69.0	61.0
20-Nov-15	13:08	NM1	65.3	69.0	61.0
	14:08	NM2	65.2	69.0	61.0
26-Nov-15	8:20	NM1	64.9	70.0	61.0
	9:22	NM2	65.1	70.0	62.0
2-Dec-15	8:30	NM1	63.7	64.7	61.5
	9:55	NM2	64.4	66.2	62.5
8-Dec-15	8:30	NM1	63.9	65.1	61.4
	10:00	NM2	64.3	67.0	63.4
14-Dec-15	8:45	NM1	64.2	65.8	62.2
	9:55	NM2	64.0	65.9	63.7
23-Dec-15	9:25	NM1	65.1	66.0	61.0
	9:22	NM2	64.9	68.0	61.0
29-Dec-15	10:15	NM1	65.6	68.0	61.0
	9:10	NM2	66.0	69.0	61.0



NM1 - Tin Wan House

NM2 - Ning Po No. 2 College





**Graphic Presentation of Noise Monitoring Result**  
**Day Time (0700 - 1900hrs on normal weekdays)**

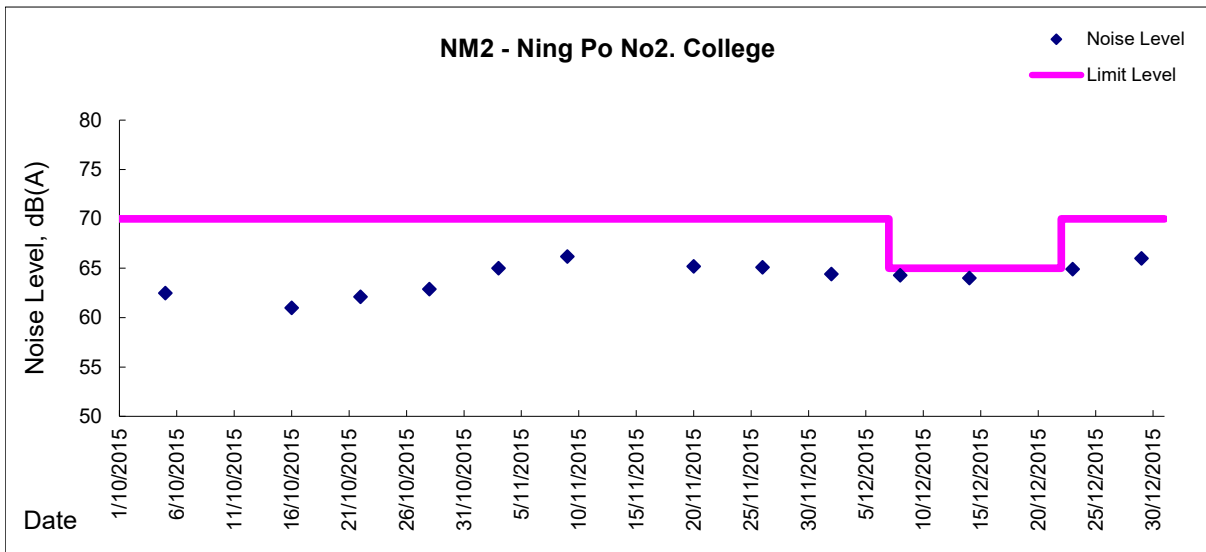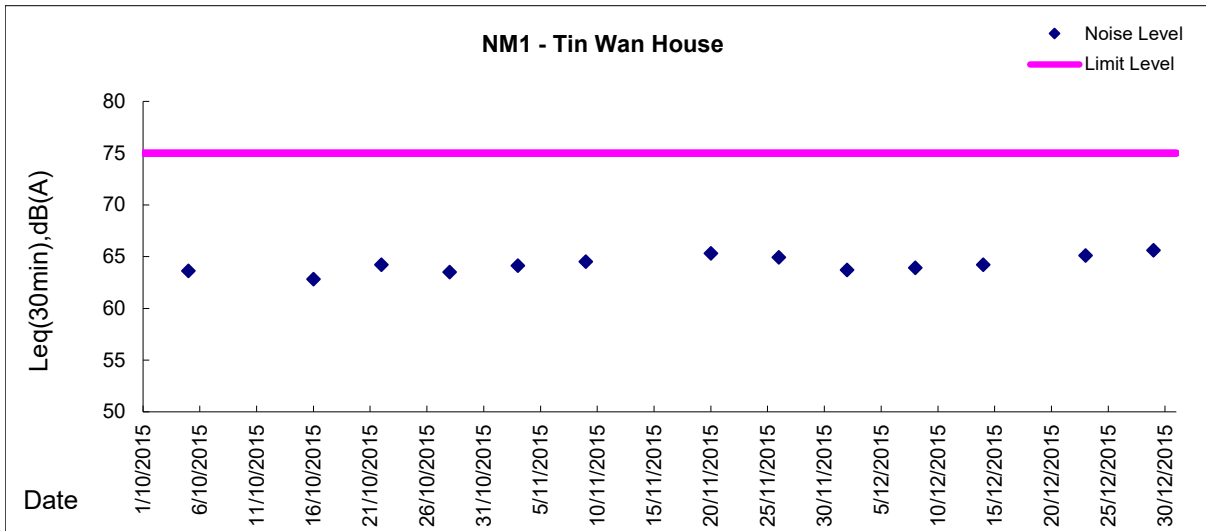



***Appendix 5.3***

***Air Quality Monitoring Results and Graphical Presentations***



Location: AQM1-Ning Po No.2 College

Report on 24-hour TSP monitoring

Action Level ( $\mu\text{g}/\text{m}^3$ ) - 200

Limit Level ( $\mu\text{g}/\text{m}^3$ ) - 260

Date	Sampling Time	Weather Condition	Filter paper no.	Filter Weight, g		Elapse Time, hr		Sampling Time, hr	Flow Rate, $\text{m}^3/\text{min}$			Total Volume, $\text{m}^3$	TSP Level, $\mu\text{g}/\text{m}^3$
				Initial	Final	Initial	Final		Initial, $Q_{si}$	Final, $Q_{sf}$	Average		
3-Oct-15	8:00	Cloudy	013224	2.8540	3.0471	3876.32	3900.32	24.00	1.33	1.33	1.33	1921	101
9-Oct-15	8:00	Cloudy	013222	2.8720	2.9563	3903.32	3927.32	24.00	1.39	1.39	1.39	2001	42
15-Oct-15	8:00	Fine	013341	2.8054	3.0263	3930.33	3954.33	24.00	1.39	1.39	1.39	2003	110
20-Oct-15	8:00	Cloudy	013451	2.8755	3.0282	3957.33	3981.33	24.00	1.33	1.33	1.33	1921	80
27-Oct-15	8:00	Cloudy	013447	2.8303	2.9886	3984.33	4008.33	24.00	1.34	1.34	1.34	1924	82
2-Nov-15	8:00	Cloudy	013443	2.8294	3.0128	4011.32	4035.32	24.00	1.34	1.34	1.34	1934	95
7-Nov-15	8:00	Cloudy	013439	2.8299	2.9607	4038.32	4062.32	24.00	1.34	1.34	1.34	1924	68
13-Nov-15	8:00	Cloudy	013369	2.7990	2.9190	4065.32	4089.32	24.00	1.34	1.34	1.34	1931	62
19-Nov-15	8:00	Cloudy	013921	2.8128	2.9678	4092.32	4116.32	24.00	1.34	1.34	1.34	1927	80
25-Nov-15	8:00	Fine	013913	2.8227	3.0002	4119.62	4143.62	24.00	1.34	1.35	1.35	1941	91
1-Dec-15	8:00	Cloudy	013914	2.8178	3.0857	4146.62	4170.62	24.00	1.40	1.40	1.40	2011	133
7-Dec-15	8:00	Cloudy	014088	2.9013	3.0101	4173.66	4197.66	24.00	1.36	1.35	1.35	1950	56
12-Dec-15	8:00	Cloudy	014087	2.9034	3.1272	4200.66	4224.66	24.00	1.35	1.35	1.35	1939	115
18-Dec-15	8:00	Fine	014074	2.8765	3.0944	4227.66	4251.66	24.00	1.36	1.36	1.36	1958	111
22-Dec-15	8:00	Cloudy	014082	2.8975	3.0552	4254.65	4278.65	24.00	1.35	1.35	1.35	1948	81
28-Dec-15	8:00	Cloudy	014078	2.8702	3.0468	4281.65	4305.65	24.00	1.36	1.36	1.36	1953	90
31-Dec-15	8:00	Cloudy	014305	2.8843	3.0945	4308.65	4332.65	24.00	1.44	1.46	1.45	2088	101

Report on 1-hour TSP monitoring


Action Level ( $\mu\text{g}/\text{m}^3$ ) - 197

Limit Level ( $\mu\text{g}/\text{m}^3$ ) - 500


Date	Sampling Time	Weather Condition	Filter paper no.	Filter Weight, g		Elapse Time, hr		Sampling Time, hr	Flow Rate, $\text{m}^3/\text{min}$			Total Volume, $\text{m}^3$	TSP Level, $\mu\text{g}/\text{m}^3$
				Initial	Final	Initial	Final		Initial, $Q_{si}$	Final, $Q_{sf}$	Average		
5-Oct-15	13:00	Cloudy	013374	2.7944	2.8033	3900.32	3901.32	1.00	1.34	1.34	1.34	80	111
5-Oct-15	14:06	Cloudy	013373	2.8027	2.8086	3901.32	3902.32	1.00	1.34	1.34	1.34	80	74
5-Oct-15	15:11	Cloudy	013372	2.7918	2.7975	3902.32	3903.32	1.00	1.34	1.34	1.34	80	71
10-Oct-15	8:30	Cloudy	013223	2.8670	2.8742	3927.32	3928.32	1.00	1.39	1.39	1.39	84	86
10-Oct-15	9:50	Cloudy	013221	2.8546	2.8610	3928.32	3929.32	1.00	1.39	1.39	1.39	84	77
10-Oct-15	11:00	Cloudy	013220	2.8766	2.8843	3929.32	3930.32	1.00	1.39	1.39	1.39	84	92
16-Oct-15	8:30	Fine	013219	2.8683	2.8780	3954.33	3955.33	1.00	1.34	1.34	1.34	80	121
16-Oct-15	9:40	Fine	013342	2.8021	2.8085	3955.33	3956.33	1.00	1.34	1.34	1.34	80	171
16-Oct-15	10:50	Fine	013218	2.8707	2.8793	3956.33	3957.33	1.00	1.34	1.34	1.34	80	176
22-Oct-15	8:40	Cloudy	013450	2.8573	2.8691	3981.33	3982.33	1.00	1.33	1.33	1.33	80	147
22-Oct-15	9:45	Cloudy	013449	2.8502	2.8600	3982.33	3983.33	1.00	1.33	1.33	1.33	80	122
22-Oct-15	10:50	Cloudy	013448	2.8531	2.8607	3983.33	3984.33	1.00	1.33	1.33	1.33	80	95
28-Oct-15	8:15	Cloudy	013446	2.8448	2.8539	4008.32	4009.32	1.00	1.34	1.34	1.34	80	114
28-Oct-15	9:30	Cloudy	013445	2.8369	2.8446	4009.32	4010.32	1.00	1.34	1.34	1.34	80	96
28-Oct-15	10:40	Cloudy	013444	2.8378	2.8429	4010.32	4011.32	1.00	1.34	1.34	1.34	80	64
3-Nov-15	13:00	Cloudy	013442	2.8239	2.8340	4035.32	4036.32	1.00	1.34	1.34	1.34	81	125
3-Nov-15	14:10	Cloudy	013441	2.8337	2.8433	4036.32	4037.32	1.00	1.34	1.34	1.34	81	119
3-Nov-15	15:20	Cloudy	013440	2.8310	2.8412	4037.32	4038.32	1.00	1.34	1.34	1.34	81	127
9-Nov-15	13:00	Cloudy	013438	2.8290	2.8370	4062.32	4063.32	1.00	1.34	1.34	1.34	80	100
9-Nov-15	14:10	Cloudy	013371	2.8070	2.8144	4063.32	4064.32	1.00	1.34	1.34	1.34	80	92
9-Nov-15	15:20	Cloudy	013370	2.8071	2.8154	4064.32	4065.32	1.00	1.34	1.34	1.34	80	104
14-Nov-15	8:50	Cloudy	013368	2.7988	2.8070	4089.32	4090.32	1.00	1.34	1.34	1.34	80	102
14-Nov-15	9:56	Cloudy	013367	2.8004	2.8081	4090.32	4091.32	1.00	1.34	1.34	1.34	80	171
14-Nov-15	11:00	Cloudy	013437	2.8314	2.8391	4091.32	4092.32	1.00	1.34	1.34	1.34	80	176
20-Nov-15	13:00	Cloudy	013920	2.8046	2.8102	4116.32	4117.32	1.00	1.34	1.34	1.34	80	70
20-Nov-15	14:03	Cloudy	013919	2.8048	2.8113	4117.32	4118.32	1.00	1.34	1.34	1.34	80	81
20-Nov-15	15:10	Cloudy	013918	2.8327	2.8440	4118.32	4119.32	1.00	1.34	1.34	1.34	80	141
26-Nov-15	8:12	Fine	013917	2.8224	2.8296	4143.62	4144.62	1.00	1.35	1.35	1.35	81	89
26-Nov-15	9:20	Fine	013916	2.8073	2.8118	4144.62	4145.62	1.00	1.35	1.35	1.35	81	55
26-Nov-15	10:30	Fine	013915	2.8140	2.8217	4145.62	4146.62	1.00	1.35	1.35	1.35	81	95
2-Dec-15	8:14	Cloudy	014090	2.9045	2.9098	4170.62	4171.62	1.00	1.34	1.34	1.34	81	66
2-Dec-15	9:20	Cloudy	014089	2.9043	2.9089	4171.62	4172.62	1.00	1.34	1.34	1.34	81	57
2-Dec-15	10:30	Cloudy	013909	2.8169	2.8232	4172.62	4173.62	1.00	1.34	1.34	1.34	81	78
8-Dec-15	8:25	Cloudy	013912	2.8179	2.8242	4197.66	4198.66	1.00	1.35	1.35	1.35	81	78
8-Dec-15	9:30	Cloudy	013911	2.8506	2.8573	4198.66	4199.66	1.00	1.35	1.35	1.35	81	83
8-Dec-15	10:45	Cloudy	013910	2.8329	2.8382	4199.66	4200.66	1.00	1.35	1.35	1.35	81	65
14-Dec-15	8:43	Cloudy	014086	2.9075	2.9169	4224.66	4225.66	1.00	1.35	1.35	1.35	81	116
14-Dec-15	9:50	Cloudy	014085	2.9130	2.9201	4225.66	4226.66	1.00	1.35	1.35	1.35	81	171
14-Dec-15	10:55	Cloudy	014073	2.8574	2.8647	4226.66	4227.66	1.00	1.35	1.35	1.35	81	176
19-Dec-15	8:11	Fine	014084	2.9066	2.9139	4251.66	4252.66	1.00	1.36	1.36	1.36	81	90
19-Dec-15	9:18	Fine	014072	2.8783	2.8851	4252.66	4253.66	1.00	1.36	1.36	1.36	81	83
19-Dec-15	10:24	Fine	014083	2.8929	2.9001	4253.66	4254.66	1.00	1.41	1.41	1.41	85	85
23-Dec-15	8:15	Cloudy	014081	2.8941	2.9040	4278.65	4279.65	1.00	1.35	1.35	1.35	81	123
23-Dec-15	9:20	Cloudy	014080	2.8987	2.9079	4279.65	4280.65	1.00	1.35	1.35	1.35	81	114
23-Dec-15	10:30	Cloudy	014079	2.8859	2.8951	4280.65	4281.65	1.00	1.35	1.35	1.35	81	114
29-Dec-15	9:00	Cloudy	014075	2.8713	2.8782	4305.65	4306.65	1.00	1.36	1.36	1.36	81	85
29-Dec-15	10:12	Cloudy	014077	2.8844	2.8921	4306.65	4307.65	1.00	1.46	1.46	1.46	88	88
29-Dec-15	13:00	Cloudy	014076	2.8664	2.8740	4307.65	4308.65	1.00	1.41	1.41	1.41	85	90



Graphic Presentation of 1 hour TSP Result

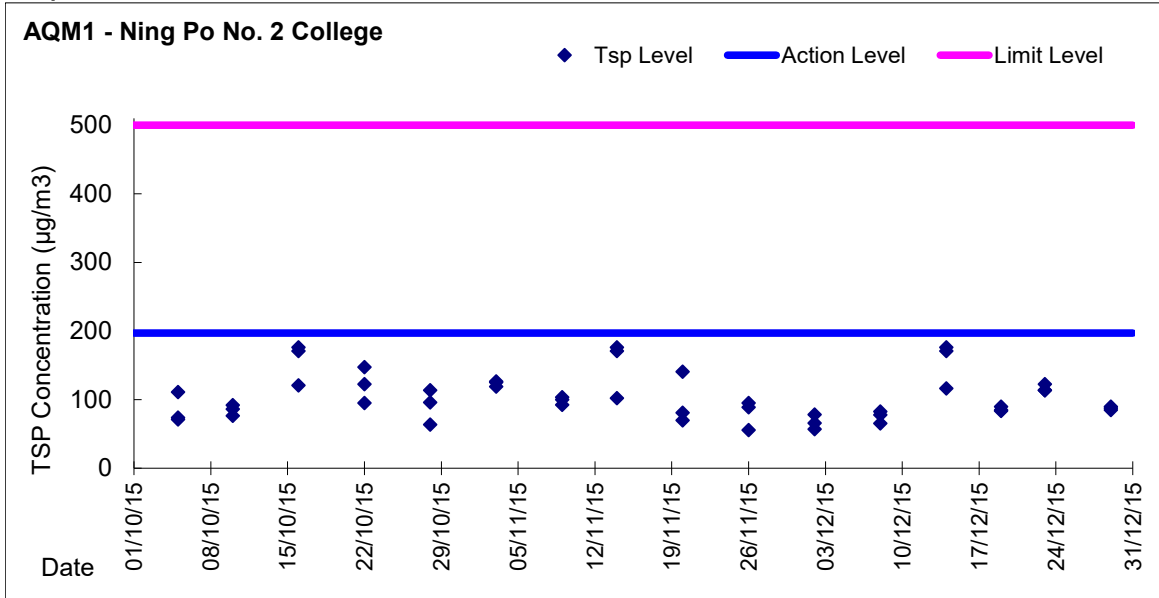

Graphic Presentation of 24 hour TSP Result

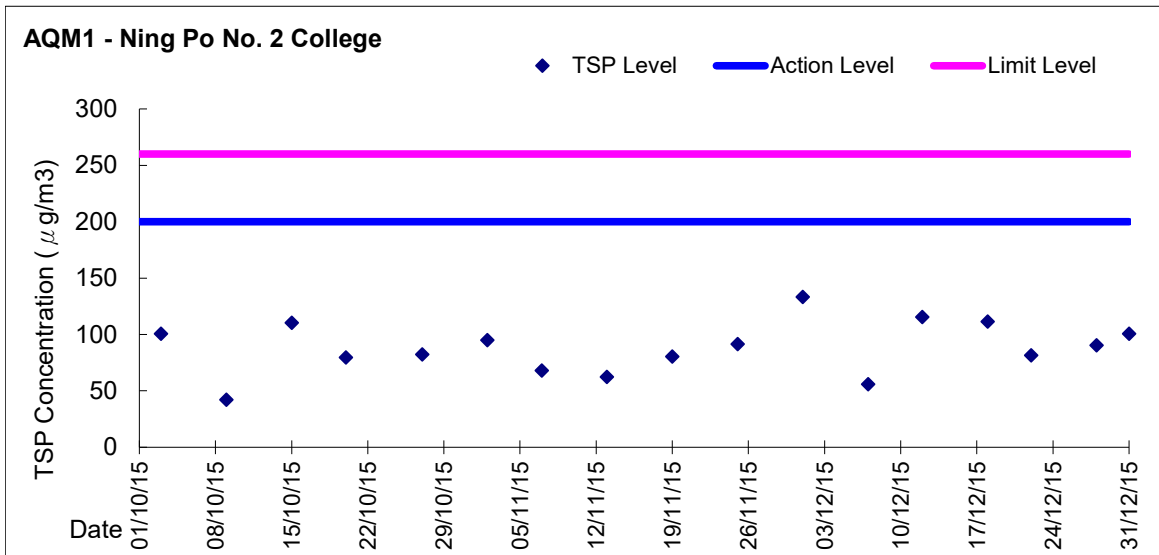





***Appendix 6.1***

***Event Action Plans***



**Event/Action Plan for Construction Noise**

EVENT	ACTION			
	ET	IC(E)	ER	CONTRACTOR
Exceedance for Action Level	<ol style="list-style-type: none"> <li>1. Notify IC(E) and Contractor;</li> <li>2. Carry out investigation;</li> <li>3. Report the results of investigation to IC(E) and Contractor;</li> <li>4. Discuss with Contractor and formulate remedial measures;</li> <li>5. Increase monitoring frequency to check mitigation effectiveness.</li> </ol>	<ol style="list-style-type: none"> <li>1. Review the analysed results submitted by ET;</li> <li>2. Review the proposed remedial measures by the Contractor and advise ER accordingly;</li> <li>3. Supervise the implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>1. Confirm receipt of notification of failure in writing;</li> <li>2. Notify Contractor;</li> <li>3. Require Contractor to propose remedial measures for the analysed noise problem;</li> <li>4. Ensure remedial measures are properly implemented.</li> </ol>	<ol style="list-style-type: none"> <li>1. Submit noise mitigation proposals to IC(E);</li> <li>2. Implement noise mitigation proposals.</li> </ol>
Exceedance for Limited Level	<ol style="list-style-type: none"> <li>1. Notify IC(E), ER, EPD and Contractor;</li> <li>2. Identify sources;</li> <li>3. Repeat measurements to confirm finding;</li> <li>4. Increase monitoring frequency;</li> <li>5. Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented;</li> <li>6. Inform IC(E), ER and EPD the causes and actions taken for the exceedances;</li> <li>7. Assess effectiveness of Contractor's remedial actions and keep IC(E), EPD and ER informed of the results;</li> <li>8. If exceedance stops, cease additional monitoring.</li> </ol>	<ol style="list-style-type: none"> <li>1. Discuss amongst ER, ET, and Contractor on the potential remedial actions;</li> <li>2. Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise ER accordingly.</li> </ol>	<ol style="list-style-type: none"> <li>1. Confirm receipt of notification of failure in writing;</li> <li>2. Notify Contractor;</li> <li>3. Require Contractor to propose remedial measures for the analysed noise problem;</li> <li>4. Ensure remedial measures are properly implemented;</li> <li>5. If exceedance continues, consider what portion of the work is responsible and instruct Contractor to stop that portion of work until the exceedance is abated.</li> </ol>	<ol style="list-style-type: none"> <li>1. Take immediate action to avoid further exceedance;</li> <li>2. Submit proposals for remedial actions to IC(E) within 3 working days of notification;</li> <li>3. Implement the agreed proposals;</li> <li>4. Resubmit proposals if problem still not under control;</li> <li>5. Stop the relevant portion of works as determined by the ER until the exceedance is abated.</li> </ol>



**Event / Action Plan for Construction Air Quality**

EVENT	ACTION			
	ET	IC(E)	ER	CONTRACTOR
<b>ACTION LEVEL</b>				
1. Exceedance for one sample	<ol style="list-style-type: none"> <li>Identify source;</li> <li>Inform IC(E) and ER;</li> <li>Repeat measurement to confirm finding;</li> <li>Increase monitoring frequency to daily.</li> </ol>	<ol style="list-style-type: none"> <li>Check monitoring data submitted by ET;</li> <li>Check Contractor's working method.</li> </ol>	<ol style="list-style-type: none"> <li>Notify Contractor.</li> </ol>	<ol style="list-style-type: none"> <li>Rectify any unacceptable practice;</li> <li>Amend working methods if appropriate.</li> </ol>
2. Exceedance for two or more consecutive samples	<ol style="list-style-type: none"> <li>Identify source;</li> <li>Inform IC(E) and ER;</li> <li>Repeat measurements to confirm findings;</li> <li>Increase monitoring frequency to daily;</li> <li>Discuss with IC(E) and Contractor for remedial actions required;</li> <li>If exceedance continues, arrange meeting with IC(E) and ER;</li> <li>If exceedance stops, cease additional monitoring.</li> </ol>	<ol style="list-style-type: none"> <li>Check monitoring data submitted by ET;</li> <li>Check Contractor's working method;</li> <li>Discuss with ET and Contractor on possible remedial measures;</li> <li>Advise the ER on the effectiveness of the proposed remedial measures;</li> <li>Supervise Implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>Confirm receipt of notification of failure in writing;</li> <li>Notify Contractor;</li> <li>Ensure remedial measures properly implemented.</li> </ol>	<ol style="list-style-type: none"> <li>Submit proposals for remedial actions to IC(E) within 3 working days of notification;</li> <li>Implement the agreed proposals;</li> <li>Amend proposal if appropriate.</li> </ol>
<b>LIMITED LEVEL</b>				
1. Exceedance for one sample	<ol style="list-style-type: none"> <li>Identify source;</li> <li>Inform ER, Contractor and EPD;</li> <li>Repeat measurement to confirm finding;</li> <li>Increase monitoring frequency to daily;</li> <li>Assess effectiveness of Contractor's remedial actions and keep IC(E), EPD and ER informed of the results.</li> </ol>	<ol style="list-style-type: none"> <li>Check monitoring data submitted by ET;</li> <li>Check Contractor's working method;</li> <li>Discuss with ET and Contractor on possible remedial measures;</li> <li>Advise the ER on the effectiveness of the proposed remedial measures;</li> <li>Supervise implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>Confirm receipt of notification of failure in writing;</li> <li>Notify Contractor;</li> <li>Ensure remedial measures properly implemented.</li> </ol>	<ol style="list-style-type: none"> <li>Take immediate action to avoid further exceedance;</li> <li>Submit proposals for remedial actions to IEC within 3 working days of notification;</li> <li>Implement the agreed proposals;</li> <li>Amend proposal if appropriate.</li> </ol>
2. Exceedance for two or more consecutive samples	<ol style="list-style-type: none"> <li>Notify IEC, ER, Contractor and EPD;</li> <li>Identify source;</li> <li>Repeat measurement to confirm findings;</li> <li>Increase monitoring frequency to daily;</li> <li>Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented;</li> <li>Arrange meeting with IEC and ER to discuss the remedial actions to be taken;</li> <li>Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results;</li> <li>If exceedance stops, cease additional monitoring.</li> </ol>	<ol style="list-style-type: none"> <li>Discuss amongst ER, ET, and Contractor on the potential remedial actions;</li> <li>Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly;</li> <li>Supervise the implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>Confirm receipt of notification of failure in writing;</li> <li>Notify Contractor;</li> <li>In consolidation with the IC(E), agree with the Contractor on the remedial measures to be implemented;</li> <li>Ensure remedial measures properly implemented;</li> <li>If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop that portion of work until the exceedance is abated.</li> </ol>	<ol style="list-style-type: none"> <li>Take immediate action to avoid further exceedance;</li> <li>Submit proposals for remedial actions to IC(E) within 3 working days of notification;</li> <li>Implement the agreed proposals;</li> <li>Resubmit proposals if problem still not under control;</li> <li>Stop the relevant portion of works as determined by the ER until the exceedance is abated.</li> </ol>

*Appendix 6.2*

*Summary for Notification of Exceedance \_Air and Noise*







Ref. No.	Date	Time	Location	Construction Noise Level	Unit	Action Level	Limit Level	Follow-up action
N/A	N/A	N/A	N/A	N/A		N/A	N/A	N/A



***Appendix 8.1***

***Complaint Log***

**Environmental Complaints Log**

Complaint Log No.	Date of Complaint	Received From and Received By	Location of Complainant	Nature of Complaint	Outcome	Status
140813	13 Aug 2014	Resident complained via hotline by RE	The slope opposite to Tin Wan House, Shun Tin Estate, Kowloon	Noise was emanated from the construction site at the slope opposite to Tin Wan House, Shun Tin Estate, Kowloon at around 1620 hrs on 13 Aug 2014 and requested follow up action by relevant department.	<ol style="list-style-type: none"> <li>1) RSS notified ET on 15 Aug 2014</li> <li>2) ET confirmed with site staff the major noise generating construction activities undertaken at works area at the slope opposite to Tin Wan House including slope works</li> <li>3) After reviewing the noise monitoring data at monitoring stations (NM1 - Tin Wan House and NM2 - Ning Po No.2 College), no limit level exceedances were recorded during routine noise monitoring event on 14 Aug 2014. As similar construction works activities conducted on 13 Aug 2014 was continued across the above monitoring period, the noise emanated from the construction activities under Contract CV/2012/07 was considered to comply with the statutory requirement.</li> <li>4) In addition, weekly environmental site inspection was conducted on 12 Aug 2014 at around 10:00. According to the inspection record, no particular observation regarding noise impact was recorded and the mitigation measures including erection of temporary noise barrier was observed in place.</li> </ol>	Closed



***Appendix 9.1***

***Construction Programme***

**Master Programme For Contract No. CV/2012/07  
Development at Anderson Road - Footbridge D and Associated Works  
(Rev. 2)**

ID	WBS	Task Name	Duration	Start	Finish	Predecessors	Successors	Total Slack	2013												2014												2015												2016											
									Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov
1	1	<b>Development at Anderson Road - Footbridge D and Associated Works</b>	<b>1119 days</b>	<b>Thu 31/01/13</b>	<b>Wed 30/11/16</b>			<b>0 days</b>	[Gantt bar for ID 1]																																															
2	1.1	<b>PRELIMINARY WORK</b>	<b>578 days</b>	<b>Thu 31/01/13</b>	<b>Sun 01/02/15</b>			<b>541 days</b>	[Gantt bar for ID 2]																																															
3	1.1.1	Application of XP, Site Access from Highways	140 days	Thu 31/01/13	Wed 31/07/13			88	[Gantt bar for ID 3]																																															
4	1.1.2	Tree Survey	12 days	Mon 18/02/13	Sat 02/03/13			5	[Gantt bar for ID 4]																																															
5	1.1.3	Transplant	30 days	Mon 04/03/13	Thu 11/04/13	4		0	[Gantt bar for ID 5]																																															
6	1.1.4	Air & noise baseline monitoring	50 days	Mon 18/02/13	Sat 20/04/13			46,47	[Gantt bar for ID 6]																																															
7	1.1.5	Record Survey, Condition Survey and Setting Out	90 days	Thu 31/01/13	Thu 30/05/13			1029	[Gantt bar for ID 7]																																															
8	1.1.6	Erect Fencing and Hoarding As Directed	48 days	Mon 08/04/13	Tue 04/06/13			16	[Gantt bar for ID 8]																																															
9	1.1.7	Design and material submission	120 days	Thu 31/01/13	Sat 06/07/13			38,79	[Gantt bar for ID 9]																																															
10	1.1.8	Handover of Portion A, B & C1	0 days	Sat 28/09/13	Sat 28/09/13			61	[Milestone diamond at 28/09]																																															
11	1.1.9	Handover of Portion E1	0 days	Fri 31/05/13	Fri 31/05/13			1029	[Milestone diamond at 31/05]																																															
12	1.1.10	Handover of Portion E2	0 days	Sun 01/02/15	Sun 01/02/15			541	[Milestone diamond at 01/02]																																															
13	1.2	<b>Section 1</b>	<b>781 days</b>	<b>Mon 08/04/13</b>	<b>Tue 01/12/15</b>			<b>20 days</b>	[Gantt bar for ID 13]																																															
14	1.2.1	<b>Lift Tower D-A</b>	<b>475 days</b>	<b>Wed 05/06/13</b>	<b>Wed 14/01/15</b>			<b>491 days</b>	[Gantt bar for ID 14]																																															
15	1.2.1.1	Method statement and material submission	30 days	Mon 23/09/13	Tue 29/10/13	18SS-60 days		905	[Gantt bar for ID 15]																																															
16	1.2.1.2	Excavation for Raft footing	150 days	Wed 05/06/13	Tue 03/12/13	8		17SS	[Gantt bar for ID 16]																																															
17	1.2.1.3	Rock Joint Mapping for founding material of raft footing	150 days	Wed 05/06/13	Tue 03/12/13	16SS		18	[Gantt bar for ID 17]																																															
18	1.2.1.4	Construct Raft footing	30 days	Wed 04/12/13	Fri 10/01/14	17		19,15SS-60 days	[Gantt bar for ID 18]																																															
19	1.2.1.5	Construct RC Lift Tower and Retaining Wall	80 days	Sat 11/01/14	Sat 26/04/14	18		20,41	[Gantt bar for ID 19]																																															
20	1.2.1.6	Erect Steelwork for Lift Shaft	70 days	Mon 28/04/14	Tue 22/07/14	19		21,22	[Gantt bar for ID 20]																																															
21	1.2.1.7	Installation of Lift	100 days	Wed 23/07/14	Wed 19/11/14	20		22FF+5 days, 23,24FS-60 days, 54	[Gantt bar for ID 21]																																															
22	1.2.1.8	M&E Installation	100 days	Tue 29/07/14	Tue 25/11/14	20,21FF+5 days		23,24FS-60 days	[Gantt bar for ID 22]																																															
23	1.2.1.9	T & C of M&E Equipment	30 days	Wed 26/11/14	Fri 02/01/15	21,22		24FF+7 days	[Gantt bar for ID 23]																																															
24	1.2.1.10	Finishing and Metal Works	100 days	Mon 15/09/14	Wed 14/01/15	21FS-60 days, 22FS-60 days, 23FF+7 days		550	[Gantt bar for ID 24]																																															
25	1.2.2	<b>Lift Tower D-B</b>	<b>480 days</b>	<b>Tue 08/10/13</b>	<b>Mon 01/06/15</b>			<b>439 days</b>	[Gantt bar for ID 25]																																															
26	1.2.2.1	Method statement and material submission	30 days	Tue 08/10/13	Tue 12/11/13	27SS-60 days		893	[Gantt bar for ID 26]																																															
27	1.2.2.2	Excavation for Raft footing	100 days	Wed 18/12/13	Tue 29/04/14	74		28SS,26SS-60 days	[Gantt bar for ID 27]																																															
28	1.2.2.3	Rock Joint Mapping for founding material of raft footing	100 days	Wed 18/12/13	Tue 29/04/14	27SS		29	[Gantt bar for ID 28]																																															
29	1.2.2.4	Construct Raft footing	30 days	Wed 30/04/14	Thu 05/06/14	28		30	[Gantt bar for ID 29]																																															
30	1.2.2.5	Construct RC Lift Tower and Retaining Wall	80 days	Fri 06/06/14	Wed 10/09/14	29		31,41	[Gantt bar for ID 30]																																															
31	1.2.2.6	Erect Steelwork for Lift Shaft	70 days	Thu 11/09/14	Wed 03/12/14	30		32,33	[Gantt bar for ID 31]																																															
32	1.2.2.7	Installation of Lift	100 days	Thu 04/12/14	Mon 13/04/15	31		33FF,34,35FS-60 days, 54	[Gantt bar for ID 32]																																															

Date: Mon 10/06/13  
Prepared By: T.L. Lo

Baseline Milestone ◊ Task [Pattern] Milestone ◊ Baseline [Pattern]  
Baseline Summary [Pattern] Critical Task [Pattern] Summary [Pattern] Progress [Pattern]

Assume Contract Start On 31-Jan-2013  
and Finish On 30-Nov-2016 (1399 days)  
Duration as shown by week day









