
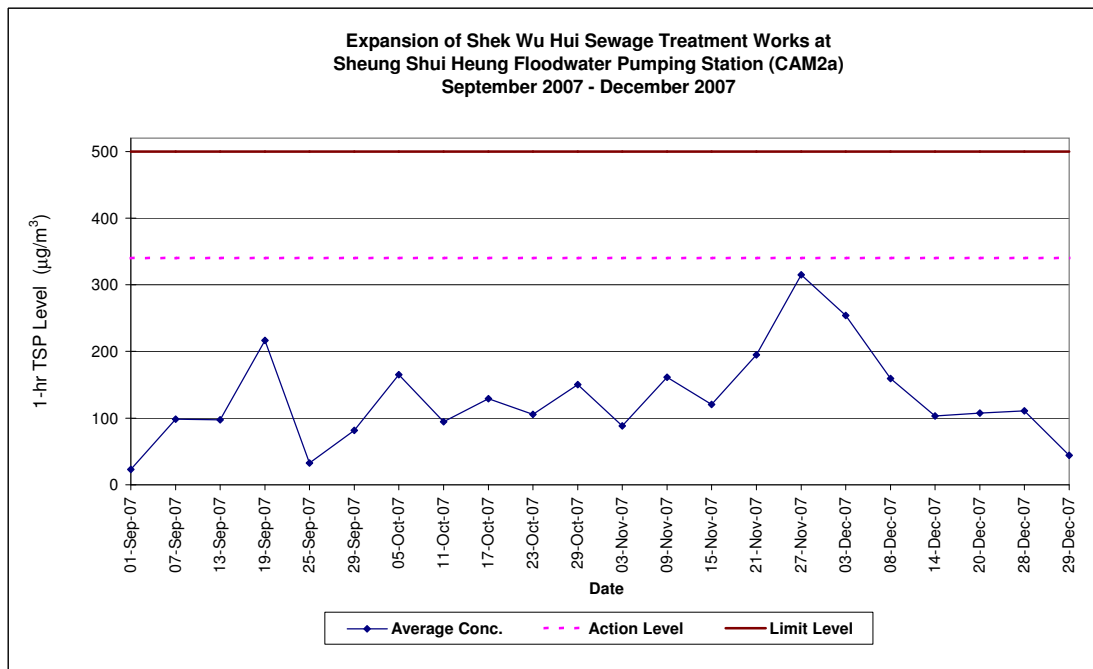


Expansion of Shek Wu Hui Sewage Treatment Works

Air Quality Impact Monitoring Results (1-Hour TSP)

Location	Monitoring Date	Weather Conditions	Wind Speed with Direction (m/s)	Temp (°C)	Timer-I	Timer-F	Time (mins)	Flow-I (CFM/Inches)	Flow-F (CFM/Inches)	Flow-I (m³/min)	Flow-F (m³/min)	Flow-avg (m³/min)	Volume (m³)	Weight-I (g)	Weight-F (g)	Weight-diff. (g)	1-hr TSP (ug/m³)	Average 1-Hr TSP (ug/m³)	Action/Limit Levels (ug/m³)	Remark		
San Po Street Pumping Station CAM1a	03-Dec-07	Fine	0.6N	25	528156	528255	59.4	45	45	1.14	1.14	1.14	67.49	2.7815	2.8022	0.0207	306.7	231.6	342.7/500			
		Fine	0.6N	25	528255	528354	59.4	45	45	1.14	1.14	1.14	67.49	2.7923	2.8044	0.0121	179.3					
		Fine	0.6N	25	528354	528451	58.2	45	45	1.14	1.14	1.14	66.13	2.7831	2.7969	0.0138	208.7					
	08-Dec-07	Cloudy	0.1NE	24	530896	530990	56.4	44	43	1.11	1.09	1.10	62.18	2.7559	2.7645	0.0086	138.3	138.5				
		Cloudy	0.1NE	24	530990	531084	56.4	44	44	1.11	1.11	1.11	62.82	2.7268	2.7340	0.0072	114.6					
		Cloudy	0.1NE	24	531084	531177	55.8	44	44	1.11	1.11	1.11	62.15	2.7901	2.8002	0.0101	162.5					
	14-Dec-07	Fine	1.8NE	23	533496	533591	57.0	42	42	1.07	1.07	1.07	60.92	2.7630	2.7682	0.0052	85.4	117.1				
		Fine	1.8NE	23	533591	533685	56.4	42	42	1.07	1.07	1.07	60.28	2.7718	2.7817	0.0099	164.2					
		Fine	1.8NE	23	533685	533780	57.0	42	42	1.07	1.07	1.07	60.92	2.8023	2.8085	0.0062	101.8					
	20-Dec-07	Fine	0.6NW	23	534710	534806	57.6	42	42	1.07	1.07	1.07	61.56	2.7549	2.7668	0.0119	193.3	120.7				
		Fine	0.6NW	23	534806	534904	58.8	42	42	1.07	1.07	1.07	62.84	2.7713	2.7765	0.0052	82.7					
		Fine	0.6NW	23	534904	535000	57.6	42	42	1.07	1.07	1.07	61.56	2.7827	2.7880	0.0053	86.1					
	24-Dec-07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-			-	Due to motor failure, no monitoring could be carried out. Monitoring was then carried out on 28 Dec 07.
		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
		-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-				
	28-Dec-07	Fine	0.4NE	21	537380	537477	58.2	44	44	1.11	1.11	1.11	64.82	2.7972	2.8073	0.0101	155.8	112.0				
		Fine	0.4NE	21	537477	537572	57.0	44	44	1.11	1.11	1.11	63.48	2.8045	2.8095	0.0050	78.8					
		Fine	0.4NE	21	537572	537668	57.6	44	44	1.11	1.11	1.11	64.15	2.7478	2.7543	0.0065	101.3					
	29-Dec-07	Fine	0.5NE	22	539882	540080	58.8	44	44	1.11	1.11	1.11	65.49	2.7731	2.7776	0.0045	68.7	71.0				
		Fine	0.5NE	22	540080	540176	57.6	44	44	1.11	1.11	1.11	64.15	2.7647	2.7686	0.0039	60.8					
Fine		0.5NE	22	540176	540271	57.0	44	44	1.11	1.11	1.11	63.48	2.7414	2.7467	0.0053	83.5						
Sheung Shui Heung Floodwater Pumping Station CAM2a	03-Dec-07	Fine	0.9N	25	633212	633310	58.8	45	45	1.06	1.06	1.06	62.18	2.747	2.7664	0.0194	312.0	253.8				
		Fine	0.9N	25	633310	633408	58.8	45	45	1.06	1.06	1.06	62.18	2.7819	2.7949	0.0130	209.1					
		Fine	0.9N	25	633408	633507	59.4	45	45	1.06	1.06	1.06	62.81	2.8089	2.8240	0.0151	240.4					
	08-Dec-07	Cloudy	0.3NE	24	635923	636017	56.4	45	45	1.06	1.06	1.06	59.64	2.7637	2.7724	0.0087	145.9	159.3				
		Cloudy	0.3NE	24	636017	636110	55.8	45	45	1.06	1.06	1.06	59.00	2.7835	2.7927	0.0092	155.9					
		Cloudy	0.3NE	24	636110	636204	56.4	45	45	1.06	1.06	1.06	59.64	2.8027	2.8132	0.0105	176.1					
	14-Dec-07	Fine	1.8NE	23	638560	638655	57.0	40	40	0.99	0.99	0.99	56.15	2.8013	2.8067	0.0054	96.2	103.3				
		Fine	1.8NE	23	638655	638750	57.0	40	40	0.99	0.99	0.99	56.15	2.7729	2.7798	0.0069	122.9					
		Fine	1.8NE	23	638750	638843	55.8	40	40	0.99	0.99	0.99	54.96	2.7598	2.7648	0.0050	91.0					
	20-Dec-07	Fine	0.8NW	23	641188	641285	58.2	40	40	0.99	0.99	0.99	57.33	2.7557	2.7638	0.0081	141.3	107.4				
		Fine	0.8NW	23	641285	641380	57.0	40	40	0.99	0.99	0.99	56.15	2.7666	2.7721	0.0055	98.0					
		Fine	0.8NW	23	641380	641478	58.8	40	40	0.99	0.99	0.99	57.92	2.7935	2.7983	0.0048	82.9					
	28-Dec-07	Fine	0.3NE	21	643809	643905	57.6	42	42	1.01	1.01	1.01	58.41	2.7517	2.7595	0.0078	133.5	110.8				
		Fine	0.3NE	21	643905	644002	58.2	42	42	1.01	1.01	1.01	59.01	2.7330	2.7390	0.0060	101.7					
		Fine	0.3NE	21	644002	644100	58.8	42	42	1.01	1.01	1.01	59.62	2.7605	2.7663	0.0058	97.3					
	29-Dec-07	Fine	0.2NE	22	646486	646582	57.6	42	42	1.01	1.01	1.01	58.41	2.7531	2.7537	0.0006	10.3	44.0				
		Fine	0.2NE	22	646582	646678	57.6	42	42	1.01	1.01	1.01	58.41	2.7502	2.7528	0.0026	44.5					
		Fine	0.2NE	22	646678	646780	61.2	42	42	1.01	1.01	1.01	62.06	2.7527	2.7575	0.0048	77.4					

Shading indicates an exceedance of Action Level. *Bold and shading* indicates an exceedance of Limit Level.


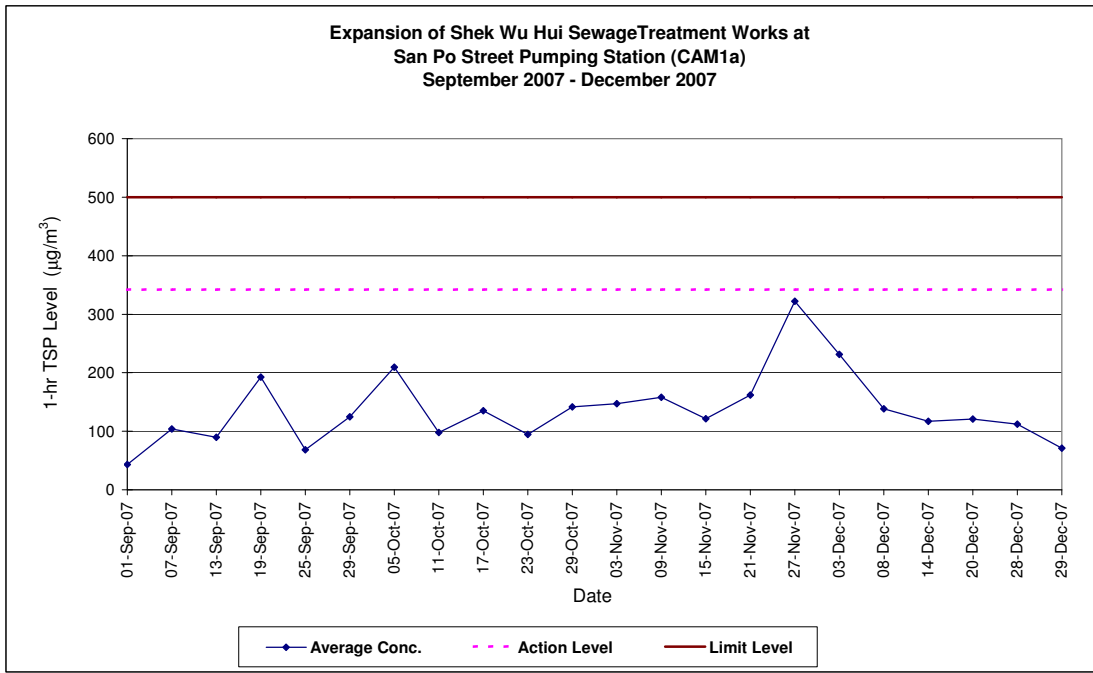


Expansion of Shek Wu Hui Sewage Treatment Works

Air Quality Impact Monitoring Results (24-Hour TSP)

Location	Monitoring Date	Weather Conditions	Wind Speed with Direction (m/s)	Temp (°C)	Pressure (mmHg)	Timer-I	Timer-F	Time (mins)	Flow-I (CFM/ Inches)	Flow-F (CFM/ Inches)	Flow-I (m³/min)	Flow-F (m³/min)	Flow-avg (m³/min)	Volume (m³)	Weight-I (g)	Weight-F (g)	Weight-diff. (g)	24-hr TSP (ug/m³)	Action/Limit Levels (ug/m³)	Remark	
San Po Street Pumping Station CAM1a	03-Dec-07	Fine	0.6N	25	759.3	528451	530896	1467	46	45	1.16	1.14	1.15	1683.36	2.7617	3.1027	0.3410	202.6	203/260		
	08-Dec-07	Cloudy	0.1NE	24	756.9	531177	533496	1391.4	43	43	1.09	1.09	1.09	1518.36	2.7901	2.9856	0.1955	128.8			
	14-Dec-07	Fine	1.8NE	23	754.5	533780	534710	558	42	42	1.07	1.07	1.07	596.36	2.7833	2.8851	0.1018	170.7		Due to power failure, only 10 hours TSP was obtained	
	20-Dec-07	Fine	0.6NW	23	750.9	535000	537380	1428	43	43	1.09	1.09	1.09	1558.30	2.7960	2.8927	0.0967	62.1			
	24-Dec-07	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-		-	Due to motor failure, no monitoring could be carried out. Monitoring was then carried out on 28 Dec 07.
	28-Dec-07	Fine	0.4NE	21	751.9	537668	539982	1388.4	44	44	1.11	1.11	1.11	1546.32	2.7860	3.0402	0.2742	177.3			
29-Dec-07	Fine	0.5NE	22	753.6	540271	542646	1425	44	44	1.11	1.11	1.11	1587.09	2.7446	2.9801	0.2355	148.4				
Sheung Shui Heung Floodwater Pumping Station CAM2a	03-Dec-07	Fine	0.9N	25	759.3	633507	635923	1449.6	46	46	1.07	1.07	1.07	1553.85	2.8228	3.1344	0.3116	200.5	201/260		
	08-Dec-07	Cloudy	0.3NE	24	756.9	636204	638560	1413.6	40	40	0.99	0.99	0.99	1392.41	2.7528	2.9903	0.2375	170.6			
	14-Dec-07	Fine	1.8NE	23	754.5	638843	641188	1407	39	39	0.97	0.97	0.97	1365.53	2.7830	2.9633	0.1803	132.0			
	20-Dec-07	Fine	0.8NW	23	750.9	641478	643809	1398.6	39	39	0.97	0.97	0.97	1357.37	2.8048	2.8356	0.0308	22.7			
	28-Dec-07	Fine	0.3NE	21	751.9	644100	646486	1431.6	42	42	1.01	1.01	1.01	1451.61	2.7424	2.9985	0.2561	176.4			
	29-Dec-07	Fine	0.2NE	22	753.6	646780	649215	1461	42	42	1.01	1.01	1.01	1481.42	2.7686	2.9952	0.2266	153.0			

Shading indicates an exceedance of Action Level. *Bold and shading* indicates an exceedance of Limit Level.

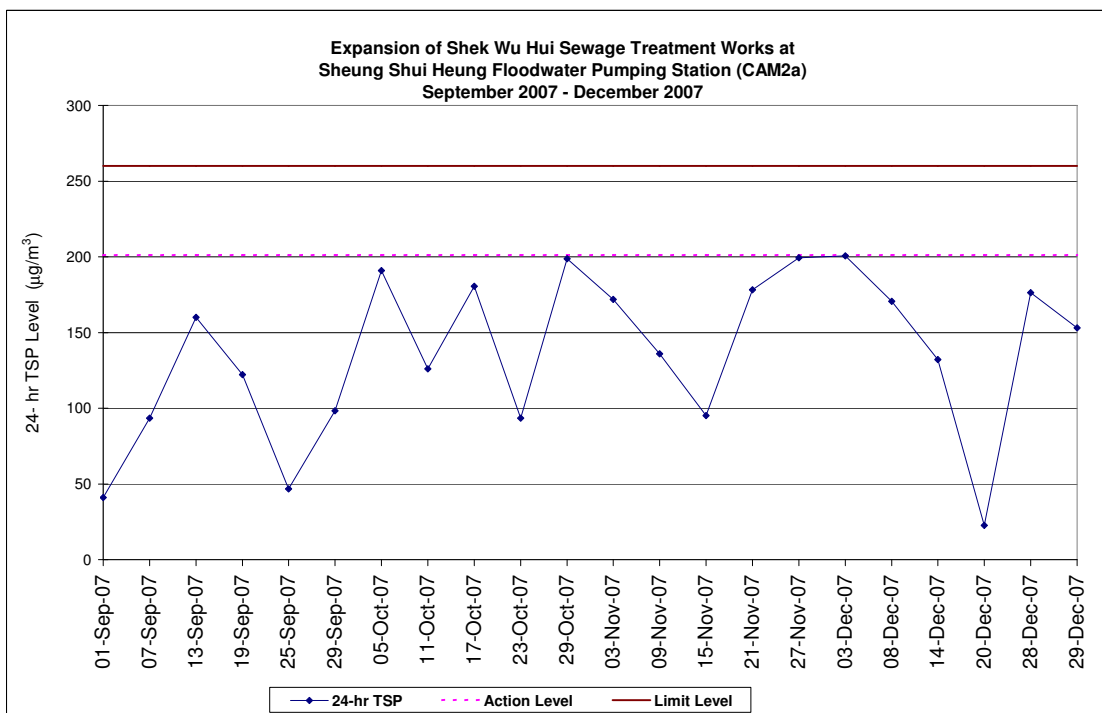
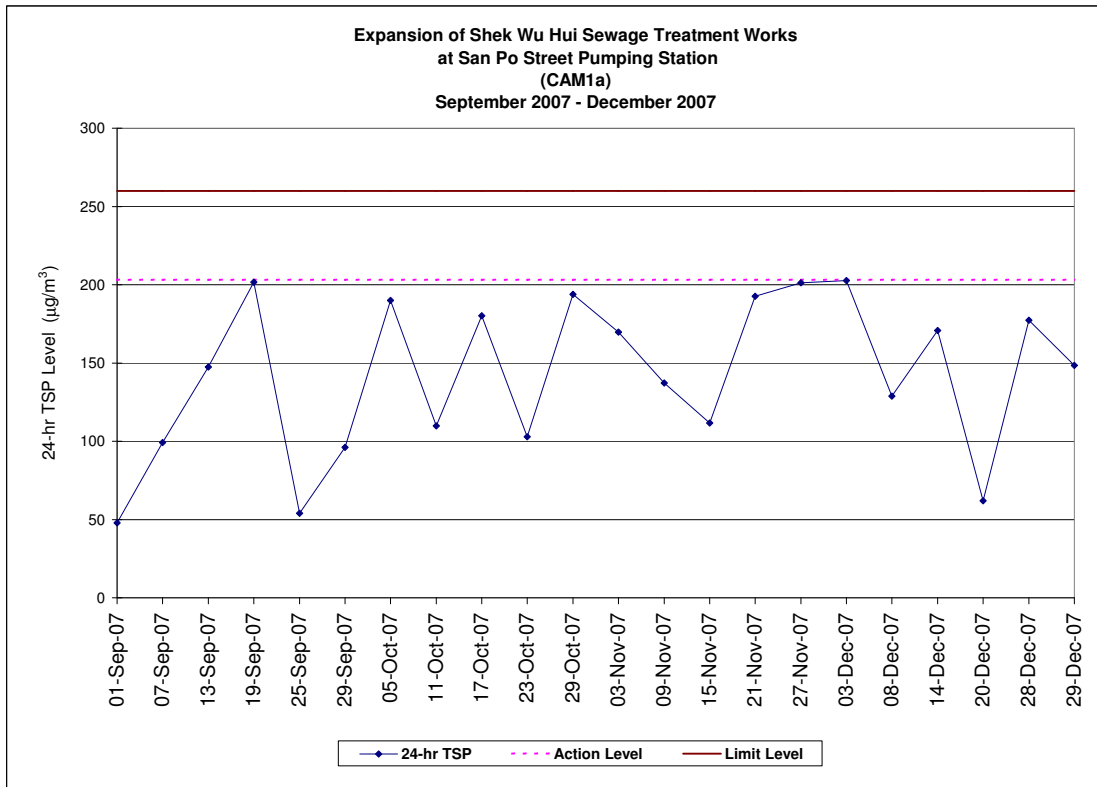


Expansion of Shek Wu Hui Sewage Treatment Works

Noise Impact Monitoring Results

Monitoring Locations	Date	Weather Conditions	Temperature	Wind Speed	Wind	Start Time	End Time	Limit Levels	L _{eq(30min)}	L _{10(30min)}	L _{90(30min)}	Remark
			(°C)	(m/s)	Direction			dB(A)	dB(A)	dB(A)	dB(A)	
Wai Loi Tsuen NM1	03-Dec-07	Fine	25	0.6	N	10:20	10:50	75	63.5	66.5	60.5	
	14-Dec-07	Cloudy	23	1.8	NE	10:20	10:50	75	57.2	59.9	54.0	
	20-Dec-07	Fine	23	0.6	NW	09:30	10:00	75	59.2	61.3	54.3	
	28-Dec-07	Fine	21	0.1	E	09:30	10:00	75	60.2	62.3	55.1	
Temporary Domestic Structure NM2	03-Dec-07	Cloudy	23	0.9	N	11:20	11:50	75	53.6	54.8	50.5	
	14-Dec-07	Cloudy	20	1.8	NE	11:20	11:50	75	53.8	55.8	51.0	
	20-Dec-07	Fine	18	0.8	NW	10:30	11:00	75	53.6	56.0	50.0	
	28-Dec-07	Cloudy	20	0.2	E	10:30	11:00	75	53.3	57.0	49.5	

A façade correction of 3 dB(A) was applied to each measurement result. "Shading" indicates an Limit Level exceedance.

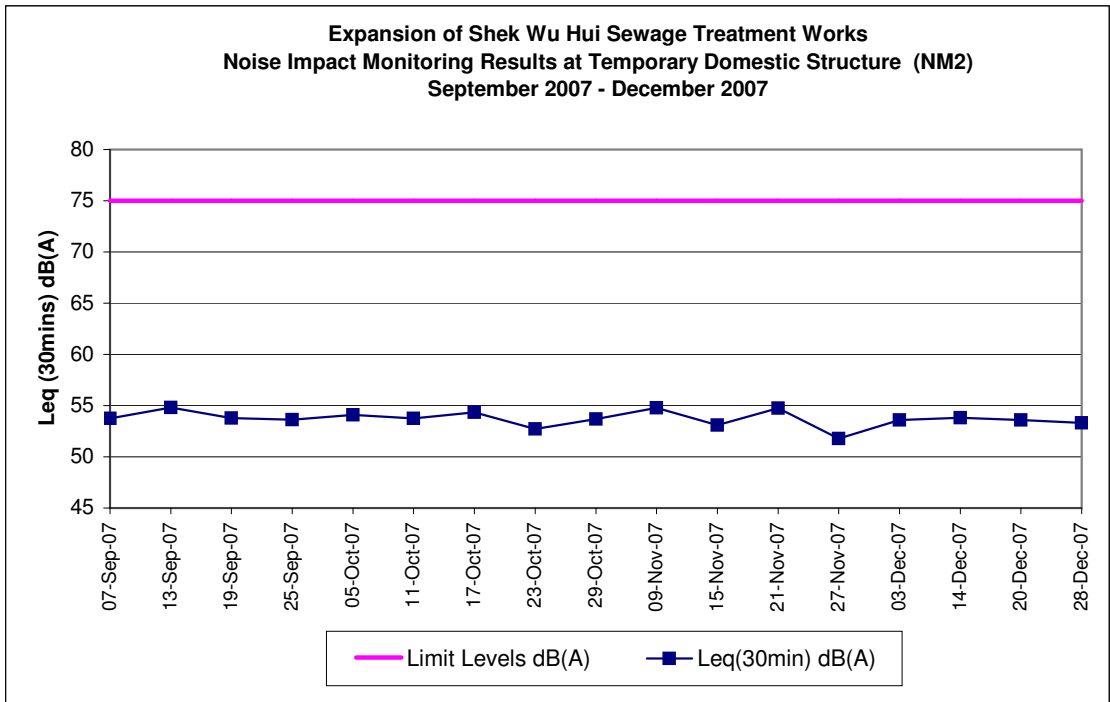
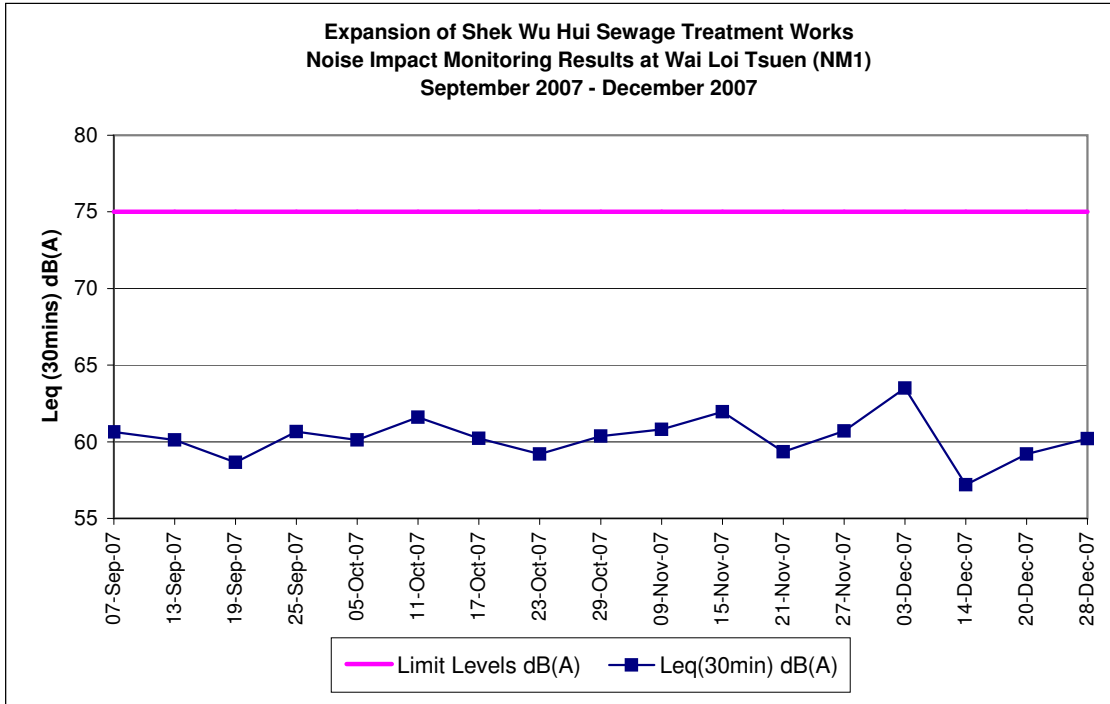


Expansion of Shek Wu Hui Sewage Treatment Works

Air Quality Impact Monitoring Results (1-Hour TSP)

Location	Monitoring Date	Weather Conditions	Wind Speed with Direction (m/s)	Temp (°C)	Timer-I	Timer-F	Time (mins)	Flow-I (CFM/Inches)	Flow-F (CFM/Inches)	Flow-I (m³/min)	Flow-F (m³/min)	Flow-avg (m³/min)	Volume (m³)	Weight-I (g)	Weight-F (g)	Weight-diff. (g)	1-hr TSP (ug/m³)	Average 1-Hr TSP (ug/m³)	Action/Limit Levels (ug/m³)	Remark
San Po Street Pumping Station CAM1a	04-Jan-08	Fine	0.3N	24	542646	542743	58.2	43	43	1.09	1.09	1.09	63.67	2.7452	2.7524	0.0072	113.1	110.7	342.7/500	
		Fine	0.3N	24	542743	542840	58.2	43	43	1.09	1.09	1.09	63.67	2.7386	2.7453	0.0067	105.2			
		Fine	0.3N	24	542840	542935	57.0	43	43	1.09	1.09	1.09	62.36	2.7169	2.7240	0.0071	113.9			
	10-Jan-08	Cloudy	0.7NE	22	545295	545390	57.0	42	42	1.07	1.07	1.07	61.06	2.7564	2.7629	0.0065	106.5			
		Cloudy	0.7NE	22	545390	545488	58.8	42	42	1.07	1.07	1.07	62.98	2.7784	2.7857	0.0073	115.9			
		Cloudy	0.7NE	22	545488	545583	57.0	42	42	1.07	1.07	1.07	61.06	2.7702	2.7759	0.0057	93.4			
	16-Jan-08	Fine	0.1E	20	547934	548029	57.0	42	42	1.07	1.07	1.07	61.06	2.7572	2.7636	0.0064	104.8			
		Fine	0.1E	20	548029	548125	57.6	42	42	1.07	1.07	1.07	61.70	2.7769	2.7871	0.0102	165.3			
		Fine	0.1E	20	548125	548222	58.2	41	41	1.05	1.05	1.05	61.01	2.7694	2.7789	0.0095	155.7			
	22-Jan-08	Cloudy	1.1NE	21	550564	550660	57.6	41	41	1.05	1.05	1.05	60.38	2.7823	2.7961	0.0138	228.5			
		Cloudy	1.1NE	21	550660	550757	58.2	41	41	1.05	1.05	1.05	61.01	2.7151	2.7301	0.0150	245.9			
		Cloudy	1.1NE	21	550757	550852	57.0	41	41	1.05	1.05	1.05	59.75	2.8882	2.9037	0.0155	259.4			
	28-Jan-08	Cloudy	0.9N	12	553221	553320	59.4	40	40	1.03	1.03	1.03	60.91	2.7726	2.7765	0.0039	64.0			
		Cloudy	0.9N	12	553320	553417	58.2	40	40	1.03	1.03	1.03	59.68	2.7880	2.7925	0.0045	75.4			
		Cloudy	0.9N	12	553417	553515	58.8	40	40	1.03	1.03	1.03	60.30	2.7657	2.7699	0.0042	69.7			
Sheung Shui Heung Floodwater Pumping Station CAM2a	04-Jan-08	Fine	0.6N	24	645725	645822	58.2	44	44	1.06	1.06	1.06	61.66	2.7454	2.7548	0.0094	152.4	231.7	340/500	
		Fine	0.6N	24	645822	645918	57.6	44	44	1.06	1.06	1.06	61.02	2.7269	2.7397	0.0128	209.8			
		Fine	0.6N	24	645918	646025	64.2	44	45	1.06	1.07	1.07	68.51	2.7656	2.7884	0.0228	332.8			
	10-Jan-08	Cloudy	1.0NE	22	648343	648440	58.2	43	44	1.04	1.06	1.05	61.22	2.8086	2.8174	0.0088	143.8			
		Cloudy	1.0NE	22	648440	648538	58.8	44	44	1.06	1.06	1.06	62.30	2.7329	2.7342	0.0103	165.3			
		Cloudy	1.0NE	22	648538	648634	57.6	44	44	1.06	1.06	1.06	61.02	2.7374	2.7473	0.0099	162.2			
	16-Jan-08	Fine	0.1E	20	650991	651089	58.8	42	42	1.03	1.03	1.03	60.51	2.7843	2.7957	0.0114	188.4			
		Fine	0.1E	20	651091	651187	57.6	42	42	1.03	1.03	1.03	59.27	2.7751	2.7870	0.0119	200.8			
		Fine	0.1E	20	651187	651284	58.2	42	42	1.03	1.03	1.03	59.89	2.8111	2.8213	0.0102	170.3			
	22-Jan-08	Cloudy	1.5NE	21	653607	653704	58.2	42	42	1.03	1.03	1.03	59.89	2.7280	2.7446	0.0166	277.2			
		Cloudy	1.5NE	21	653704	653800	57.6	42	42	1.03	1.03	1.03	59.27	2.8671	2.8854	0.0183	308.8			
		Cloudy	1.5NE	21	653800	653896	57.6	42	42	1.03	1.03	1.03	59.27	2.8200	2.8374	0.0174	293.6			
	28-Jan-08	Cloudy	0.3N	12	656262	656359	58.2	42	42	1.03	1.03	1.03	59.89	2.7745	2.7818	0.0073	121.9			
		Cloudy	0.3N	12	656359	656454	57.0	42	42	1.03	1.03	1.03	58.65	2.7959	2.8009	0.0050	85.2			
		Cloudy	0.3N	12	656454	656555	60.6	42	42	1.03	1.03	1.03	62.36	2.8448	2.8489	0.0041	65.8			

Shading indicates an exceedance of Action Level. *Bold and shading* indicates an exceedance of Limit Level.

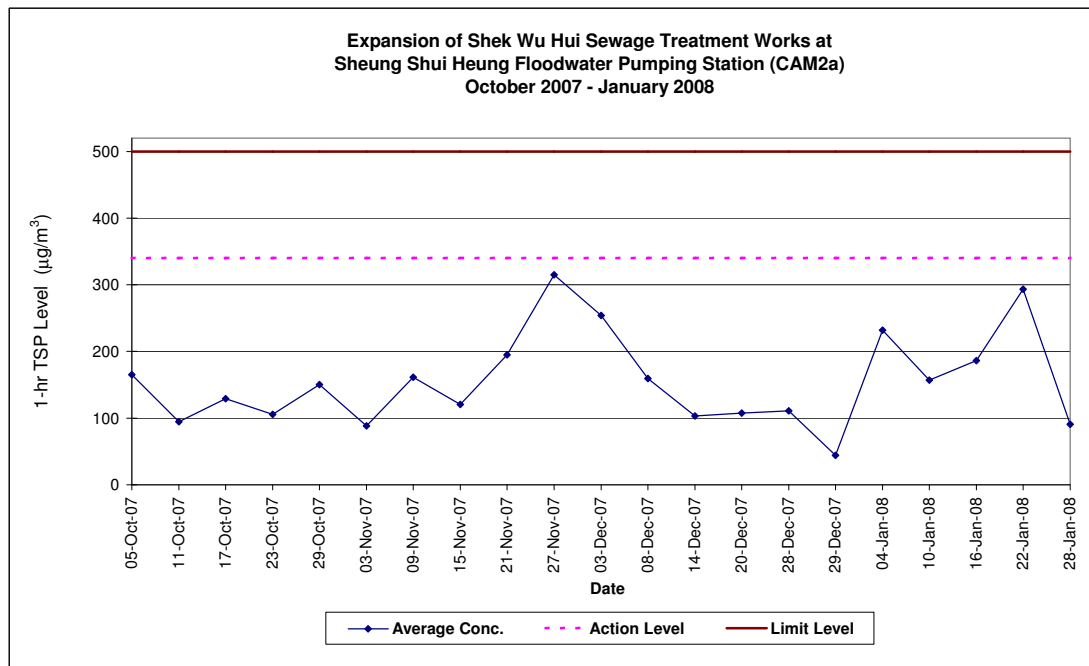
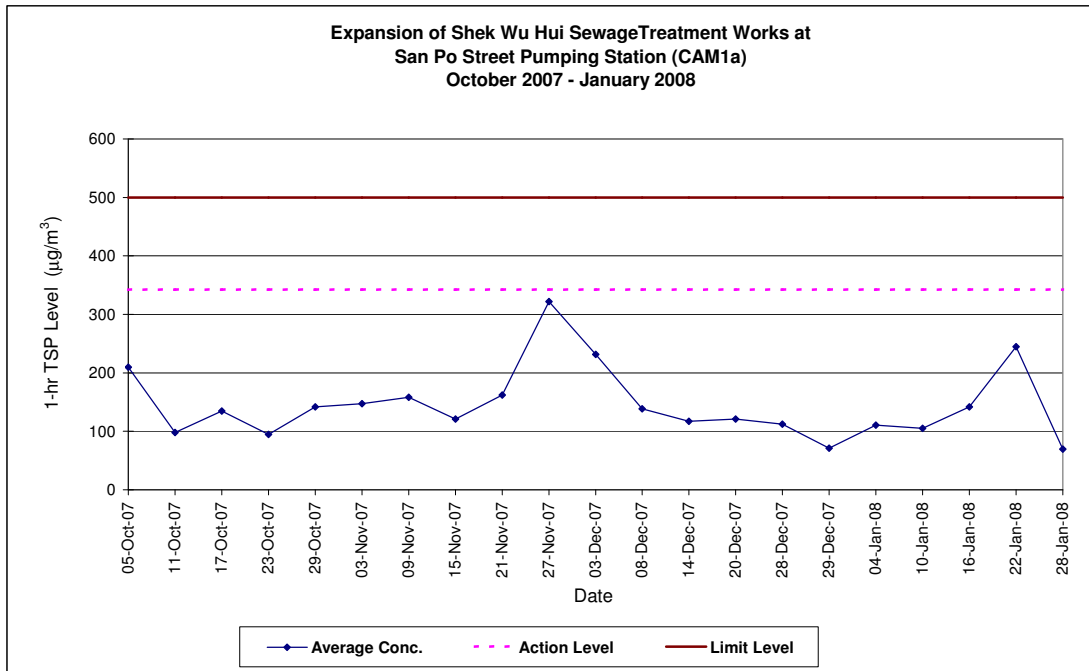


Expansion of Shek Wu Hui Sewage Treatment Works

Air Quality Impact Monitoring Results (24-Hour TSP)

Location	Monitoring Date	Weather Conditions	Wind Speed with Direction (m/s)	Temp (°C)	Pressure (mmHg)	Timer-I	Timer-F	Time (mins)	Flow-I (CFM/Inches)	Flow-F (CFM/Inches)	Flow-I (m³/min)	Flow-F (m³/min)	Flow-avg (m³/min)	Volume (m³)	Weight-I (g)	Weight-F (g)	Weight-diff. (g)	24-hr TSP (ug/m³)	Action/Limit Levels (ug/m³)	Remark
San Po Street Pumping Station CAM1a	04-Jan-08	Fine	0.3N	24	745.9	542935	545295	1416	43	43	1.09	1.09	1.09	1549.14	2.7586	2.9822	0.2236	144.3	203/260	
	10-Jan-08	Cloudy	0.7NE	22	760.5	545583	547934	1410.6	42	42	1.07	1.07	1.07	1510.97	2.7783	2.9537	0.1754	116.1		
	16-Jan-08	Fine	0.1E	20	749.9	548222	550564	1405.2	42	42	1.07	1.07	1.07	1505.19	2.7706	3.0704	0.2998	199.2		
	22-Jan-08	Cloudy	1.1NE	21	753.5	550852	553221	1421.4	41	41	1.05	1.05	1.05	1490.04	2.7567	3.0221	0.2654	178.1		
	28-Jan-08	Cloudy	0.9N	12	754.2	553515	555900	1431	41	41	1.05	1.05	1.05	1500.11	2.7947	2.8256	0.0309	20.6		
Sheung Shui Heung Floodwater Pumping Station CAM2a	04-Jan-08	Fine	0.6N	24	745.9	646025	648343	1390.8	44	44	1.06	1.06	1.06	1473.48	2.7561	3.0206	0.2645	179.5	201/260	
	10-Jan-08	Cloudy	1.0NE	22	760.5	648634	650991	1414.2	43	43	1.04	1.04	1.04	1476.74	2.8018	2.9984	0.1966	133.1		
	16-Jan-08	Fine	0.1E	20	749.9	651284	653607	1393.8	42	42	1.03	1.03	1.03	1434.22	2.7700	3.0493	0.2793	194.7		
	22-Jan-08	Cloudy	1.5NE	21	753.5	653896	656262	1419.6	42	42	1.03	1.03	1.03	1460.77	2.7494	3.0050	0.2556	175.0		
	28-Jan-08	Cloudy	0.3N	12	754.2	656555	658886	1398.6	42	42	1.03	1.03	1.03	1439.16	2.8102	2.9202	0.11	76.4		

Shading indicates an exceedance of Action Level. *Bold and shading* indicates an exceedance of Limit Level.

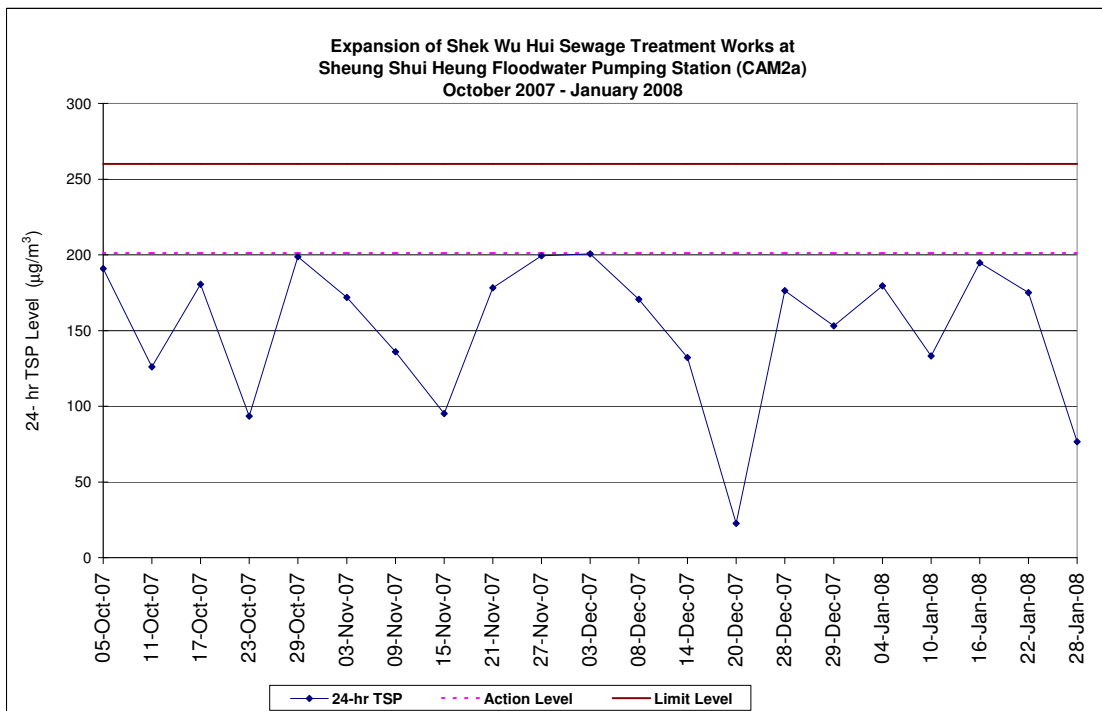
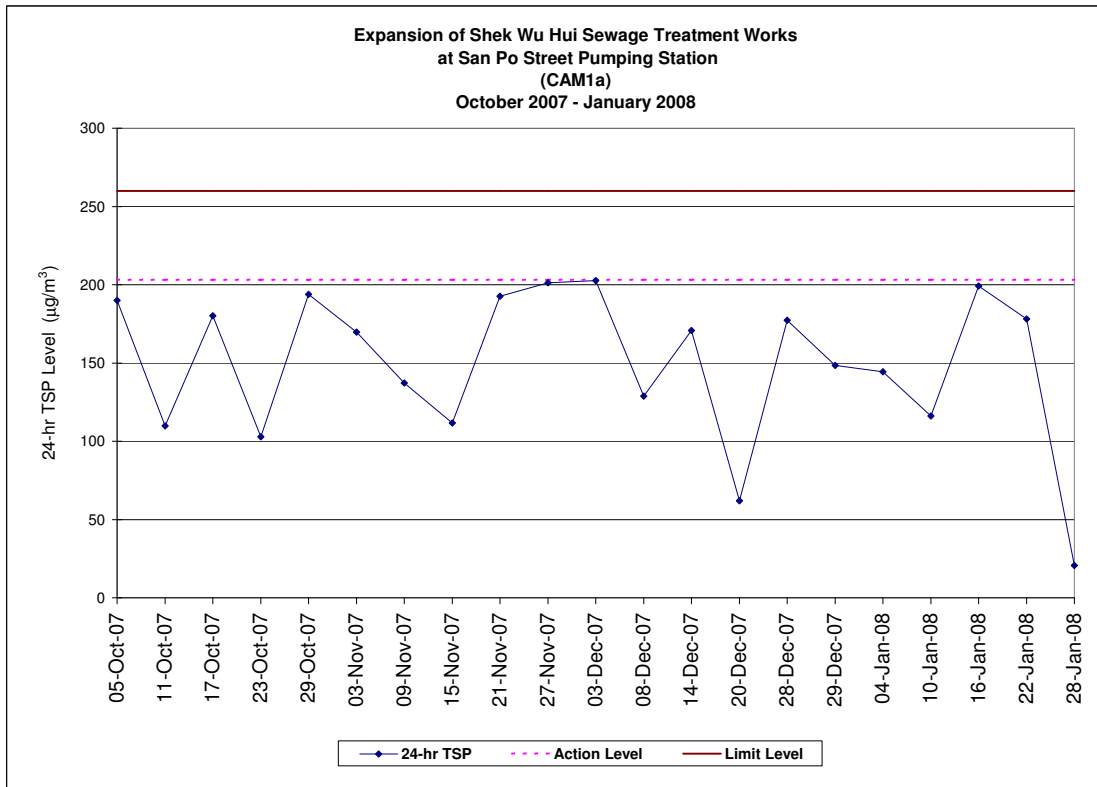


Expansion of Shek Wu Hui Sewage Treatment Works

Noise Impact Monitoring Results

Monitoring Locations	Date	Weather Conditions	Temperature	Wind Speed	Wind	Start Time	End Time	Limit Levels	L _{eq(30min)}	L _{10(30min)}	L _{90(30min)}	Remark
			(°C)	(m/s)	Direction			dB(A)	dB(A)	dB(A)	dB(A)	
Wai Loi Tsuen NM1	04-Jan-08	Fine	24	0.3	N	10:20	10:50	75	58.7	61.0	54.0	
	10-Jan-08	Cloudy	22	0.7	NE	10:20	10:50	75	60.6	62.8	57.0	
	16-Jan-08	Fine	21	0.1	E	09:30	10:00	75	58.3	61.2	55.5	
	22-Jan-08	Cloudy	20	1.1	NE	09:30	10:00	75	59.6	63.1	56.5	
	28-Jan-08	Cloudy	15	0.1	N	10:00	10:30	75	59.2	61.6	56.8	
Temporary Domestic Structure NM2	04-Jan-08	Fine	24	0.6	N	11:20	11:50	75	54.2	57.0	51.0	
	10-Jan-08	Cloudy	22	1	NE	11:20	11:50	75	54.2	57.0	50.5	
	16-Jan-08	Fine	21	0.1	E	10:30	11:00	75	52.6	56.0	50.0	
	22-Jan-08	Cloudy	20	1.5	NE	10:30	11:00	75	53.2	57.0	51.0	
	28-Jan-08	Cloudy	15	0.3	N	11:00	11:30	75	53.4	56.0	50.6	

A façade correction of 3 dB(A) was applied to each measurement result. "Shading" indicates an Limit Level exceedance.

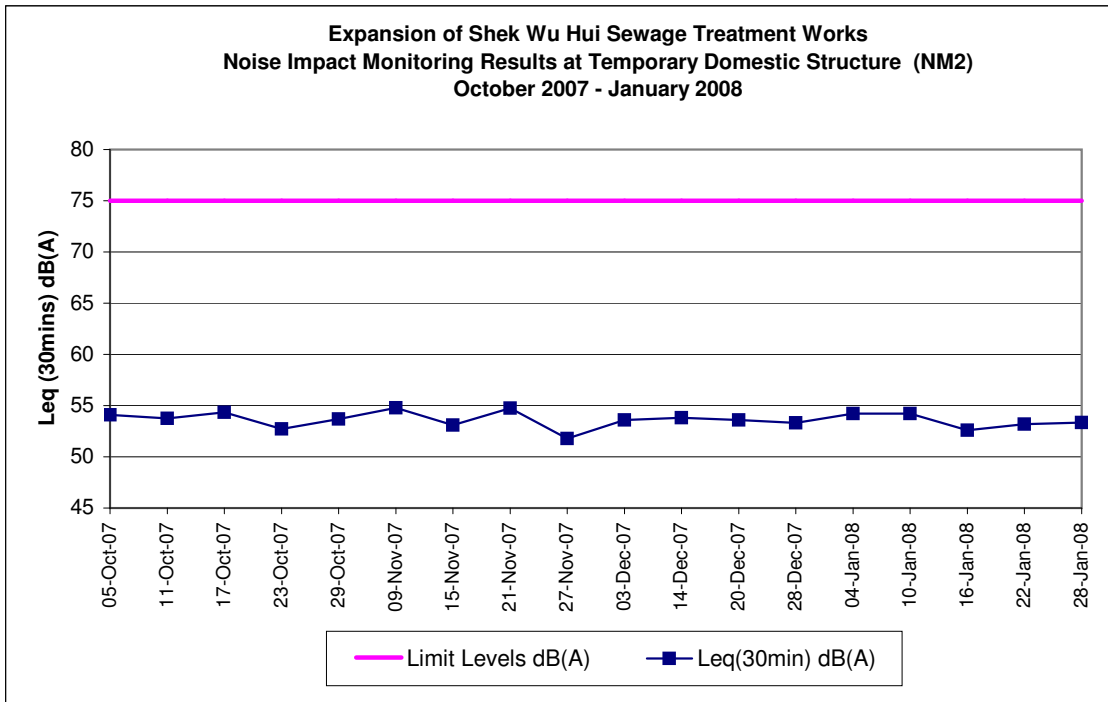
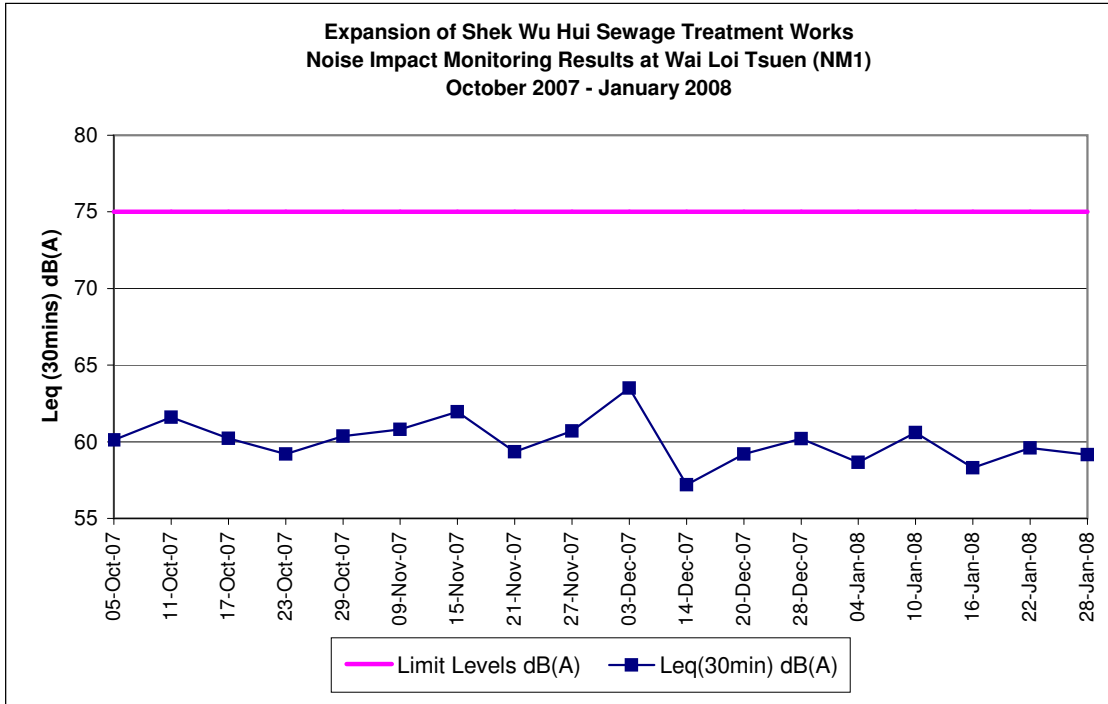


Expansion of Shek Wu Hui Sewage Treatment Works

Air Quality Impact Monitoring Results (1-Hour TSP)

Location	Monitoring Date	Weather Conditions	Wind Speed with Direction (m/s)	Temp (°C)	Timer-I	Timer-F	Time (mins)	Flow-I (CFM/ Inches)	Flow-F (CFM/ Inches)	Flow-I (m³/min)	Flow-F (m³/min)	Flow-avg (m³/min)	Volume (m³)	Weight-I (g)	Weight-F (g)	Weight-diff. (g)	1-hr TSP (ug/m³)	Average 1-Hr TSP (ug/m³)	Action/Limit Levels (ug/m³)	Remark
San Po Street Pumping Station CAM1a	02-Feb-08	Cloudy	0.3N	12	555395	555493	58.8	43	43	1.09	1.09	1.09	64.33	2.7947	2.8032	0.0085	132.1	105.0	342.7/500	
		Cloudy	0.3N	12	555493	555590	58.2	43	43	1.09	1.09	1.09	63.67	2.7880	2.7925	0.0045	70.7			
		Cloudy	0.3N	12	555590	555689	59.4	43	43	1.09	1.09	1.09	64.98	2.7745	2.7818	0.0073	112.3			
	06-Feb-08	Cloudy	0.7NE	11	557903	558000	58.2	42	42	1.07	1.07	1.07	62.34	2.7687	2.7770	0.0083	133.1	65.0		
		Cloudy	0.7NE	11	558000	558098	58.8	42	42	1.07	1.07	1.07	62.98	2.7918	2.7938	0.0020	31.8			
		Cloudy	0.7NE	11	558098	558196	58.8	42	42	1.07	1.07	1.07	62.98	2.7848	2.7867	0.0019	30.2			
	12-Feb-08	Cloudy	0.1E	10	560576	560675	59.4	42	42	1.07	1.07	1.07	63.63	2.7904	2.7928	0.0024	37.7	62.1		
		Cloudy	0.1E	10	560675	560772	58.2	42	42	1.07	1.07	1.07	62.34	2.7904	2.7961	0.0057	91.4			
		Cloudy	0.1E	10	560772	560870	58.8	42	42	1.07	1.07	1.07	62.98	2.7808	2.7844	0.0036	57.2			
	18-Feb-08	Fine	0.9NE	15	563237	563332	57.0	45	45	1.14	1.14	1.14	64.97	2.7701	2.7832	0.0131	201.6	199.1		
		Fine	0.9NE	15	563332	563426	56.4	45	45	1.14	1.14	1.14	64.28	2.7859	2.7988	0.0129	200.7			
		Fine	0.9NE	15	563426	563534	64.8	45	45	1.14	1.14	1.14	73.86	2.7651	2.7795	0.0144	195.0			
	23-Feb-08	Cloudy	1.1N	14	565934	566027	55.8	45	45	1.14	1.14	1.14	63.60	2.7988	2.8068	0.0080	125.8	89.1		
		Cloudy	1.1N	14	566027	566119	55.2	45	45	1.14	1.14	1.14	62.91	2.7985	2.8043	0.0058	92.2			
		Cloudy	1.1N	14	566119	566217	58.8	45	45	1.14	1.14	1.14	67.02	2.8072	2.8105	0.0033	49.2			
	29-Feb-08	Cloudy	0.6 N	17	568607	568707	60.0	45	45	1.14	1.14	1.14	68.39	2.7745	2.7862	0.0117	171.1	241.3		
		Cloudy	0.6 N	17	568707	568807	60.0	45	45	1.14	1.14	1.14	68.39	2.7903	2.8064	0.0161	235.4			
		Cloudy	0.6 N	17	568807	568907	60.0	45	45	1.14	1.14	1.14	68.39	2.7686	2.7903	0.0217	317.3			
Sheung Shui Heung Floodwater Pumping Station CAM2a	02-Feb-08	Cloudy	0.3N	12	658886	658984	58.8	44	44	1.06	1.06	1.06	62.30	2.7726	2.7765	0.0039	62.6	70.6		
		Cloudy	0.3N	12	658984	659080	57.6	44	44	1.06	1.06	1.06	61.02	2.7657	2.7699	0.0042	68.8			
		Cloudy	0.3N	12	659080	659177	58.2	44	45	1.06	1.07	1.07	62.10	2.7959	2.8009	0.0050	80.5			
	06-Feb-08	Cloudy	0.7NE	11	661602	661699	58.2	43	44	1.04	1.06	1.05	61.22	2.7930	2.7978	0.0048	78.4	44.8		
		Cloudy	0.7NE	11	661699	661798	59.4	44	44	1.06	1.06	1.06	62.93	2.8022	2.8049	0.0027	42.9			
		Cloudy	0.7NE	11	661798	661895	58.2	44	44	1.06	1.06	1.06	61.66	2.7796	2.7804	0.0008	13.0			
	12-Feb-08	Cloudy	0.1E	10	664198	664297	59.4	42	42	1.03	1.03	1.03	61.12	2.7853	2.7861	0.0008	13.1	41.2		
		Cloudy	0.1E	10	664297	664398	60.6	42	42	1.03	1.03	1.03	62.36	2.7842	2.7878	0.0036	57.7			
		Cloudy	0.1E	10	664398	664496	58.8	42	42	1.03	1.03	1.03	60.51	2.7850	2.7882	0.0032	52.9			
	18-Feb-08	Fine	1NE	15	666862	666962	60.0	30	30	0.85	0.85	0.85	50.78	2.7851	2.7967	0.0116	228.4	202.3		
		Fine	1NE	15	666962	667054	55.2	30	30	0.85	0.85	0.85	46.72	2.7624	2.7708	0.0084	179.8			
		Fine	1NE	15	667054	667161	64.2	30	30	0.85	0.85	0.85	54.33	2.7824	2.7932	0.0108	198.8			
	23-Feb-08	Cloudy	0.9N	14	669654	669654	59.4	30	30	0.85	0.85	0.85	50.27	2.8306	2.8358	0.0052	103.4	84.9		
		Cloudy	0.9N	14	669654	669751	58.2	30	30	0.85	0.85	0.85	49.26	2.7746	2.7792	0.0046	93.4			
		Cloudy	0.9N	14	669751	669843	55.2	30	30	0.85	0.85	0.85	46.72	2.8310	2.8337	0.0027	57.8			
	29-Feb-08	Cloudy	0.6N	17	672235	672335	60.0	42	42	1.03	1.03	1.03	61.74	2.795	2.8505	0.0555	898.9	509.1		
		Cloudy	0.6N	17	672335	672435	60.0	42	42	1.03	1.03	1.03	61.74	2.7732	2.7935	0.0203	328.8			
		Cloudy	0.6N	17	672435	672535	60.0	42	42	1.03	1.03	1.03	61.74	2.7484	2.7669	0.0185	299.6			

Shading indicates an exceedance of Action Level. *Bold and shading* indicates an exceedance of Limit Level.

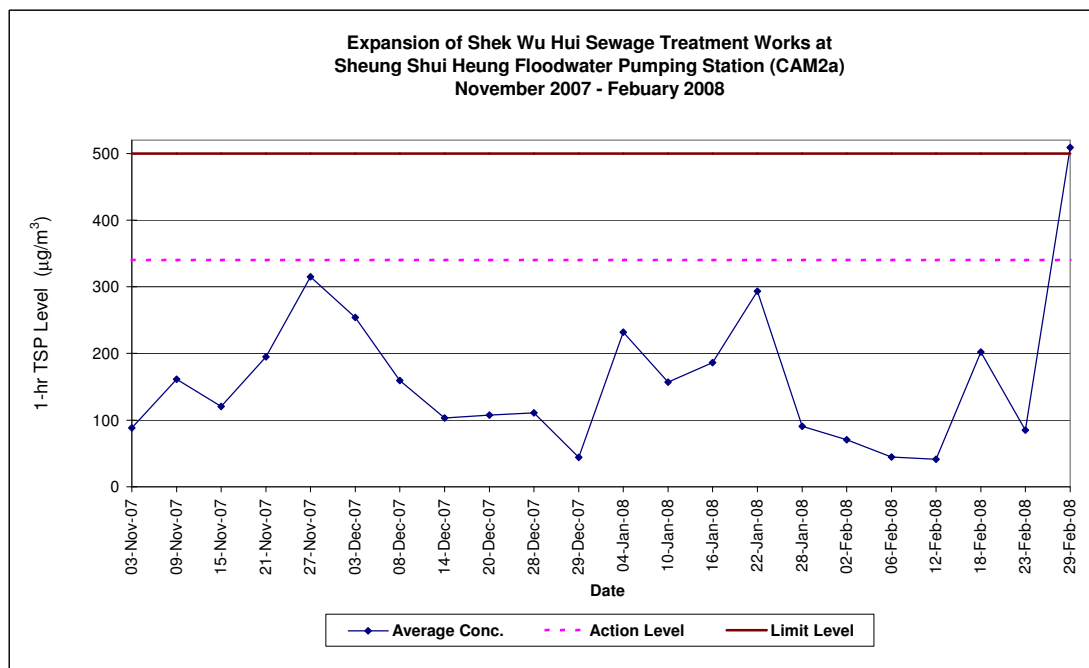
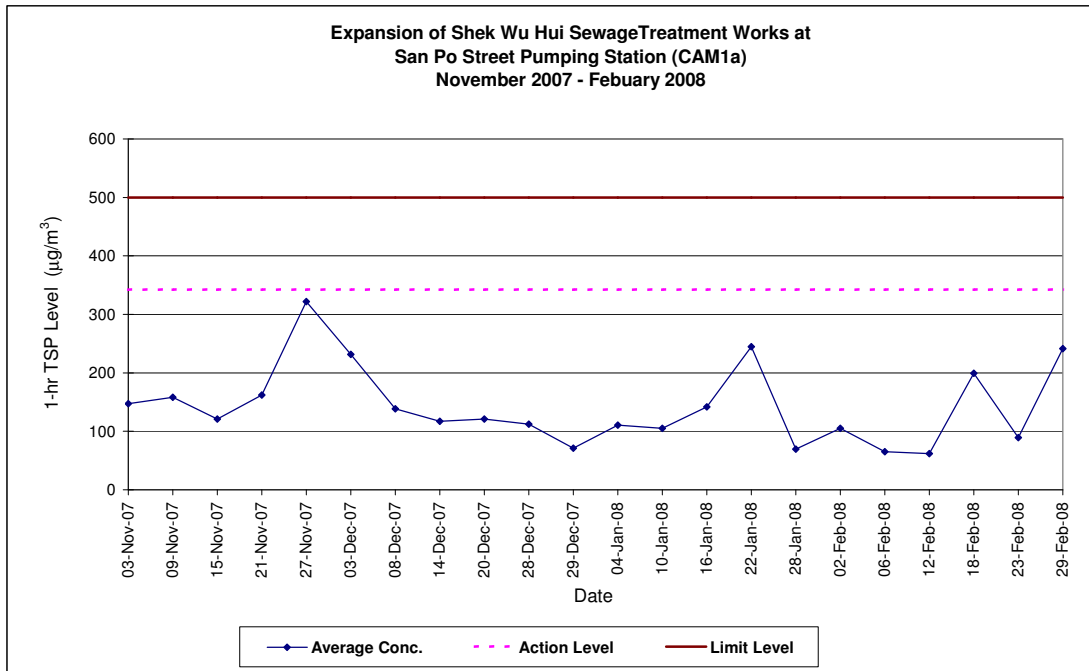


Expansion of Shek Wu Hui Sewage Treatment Works

Air Quality Impact Monitoring Results (24-Hour TSP)

Location	Monitoring Date	Weather Conditions	Wind Speed with Direction (m/s)	Temp (°C)	Pressure (mmHg)	Timer-I	Timer-F	Time (mins)	Flow-I (CFM/Inches)	Flow-F (CFM/Inches)	Flow-I (m³/min)	Flow-F (m³/min)	Flow-avg (m³/min)	Volume (m³)	Weight-I (g)	Weight-F (g)	Weight-diff. (g)	24-hr TSP (ug/m³)	Action/Limit Levels (ug/m³)	Remark
San Po Street Pumping Station CAM1a	02-Feb-08	Cloudy	0.3N	12	745.9	555689	557903	1328.4	43	43	1.09	1.09	1.09	1453.30	2.8102	2.9202	0.1100	75.7	203/260	
	06-Feb-08	Cloudy	0.7NE	11	760.5	558196	560576	1428	42	42	1.07	1.07	1.07	1529.61	2.7945	3.0062	0.2117	138.4		
	12-Feb-08	Cloudy	0.1E	10	749.9	560870	563237	1420.2	42	42	1.07	1.07	1.07	1521.26	2.7714	2.9753	0.2039	134.0		
	18-Feb-08	Fine	0.9NE	15	768.5	563534	565934	1440	45	45	1.14	1.14	1.14	1641.25	2.7906	3.0520	0.2614	159.3		
	23-Feb-08	Cloudy	1.1N	14	763.6	566217	568607	1434	45	45	1.14	1.14	1.14	1634.41	2.7420	2.9268	0.1848	113.1		
	29-Feb-08	Cloudy	0.6 N	17	763.7	568907	571284	1426.2	45	45	1.14	1.14	1.14	1625.52	2.7877	3.099	0.3113	191.5		
Sheung Shui Heung Floodwater Pumping Station CAM2a	02-Feb-08	Cloudy	0.3N	12	745.9	659177	661602	1455	44	44	1.06	1.06	1.06	1541.49	2.8448	2.8489	0.0041	2.7	201/260	
	06-Feb-08	Cloudy	0.7NE	11	760.5	661895	664198	1381.8	43	43	1.04	1.04	1.04	1442.91	2.7948	2.9495	0.1547	107.2		
	12-Feb-08	Cloudy	0.1E	10	749.9	664496	666862	1419.6	42	42	1.03	1.03	1.03	1460.77	2.7839	2.9347	0.1508	103.2		
	18-Feb-08	Fine	1NE	15	768.5	667161	669555	1436.4	30	30	0.85	0.85	0.85	1215.66	2.7485	2.9349	0.1864	153.3		
	23-Feb-08	Cloudy	0.9N	14	763.6	669843	672235	1435.2	30	30	0.85	0.85	0.85	1214.65	2.7735	2.9102	0.1367	112.5		
	29-Feb-08	Cloudy	0.6N	17	763.7	672535	674917	1429.2	42	41	1.03	1.01	1.02	1459.77	2.7757	3.1901	0.4144	283.9		Soil handling works for construction of planter in pumping station was observed during monitoring.

Shading indicates an exceedance of Action Level. *Bold and shading* indicates an exceedance of Limit Level.

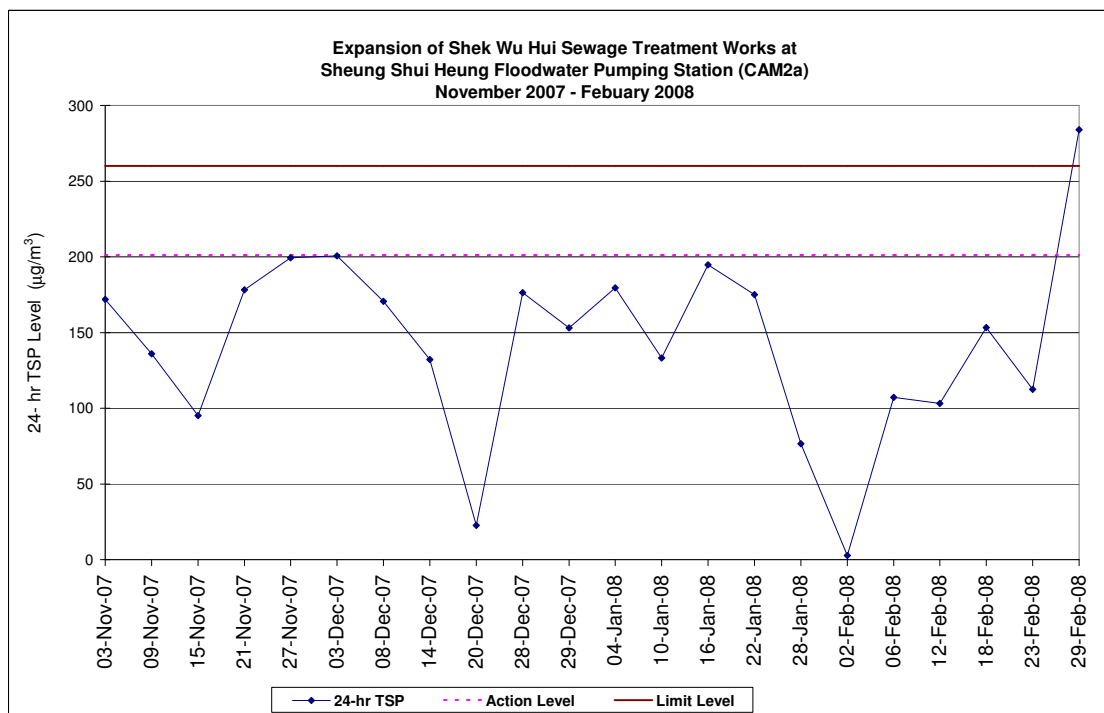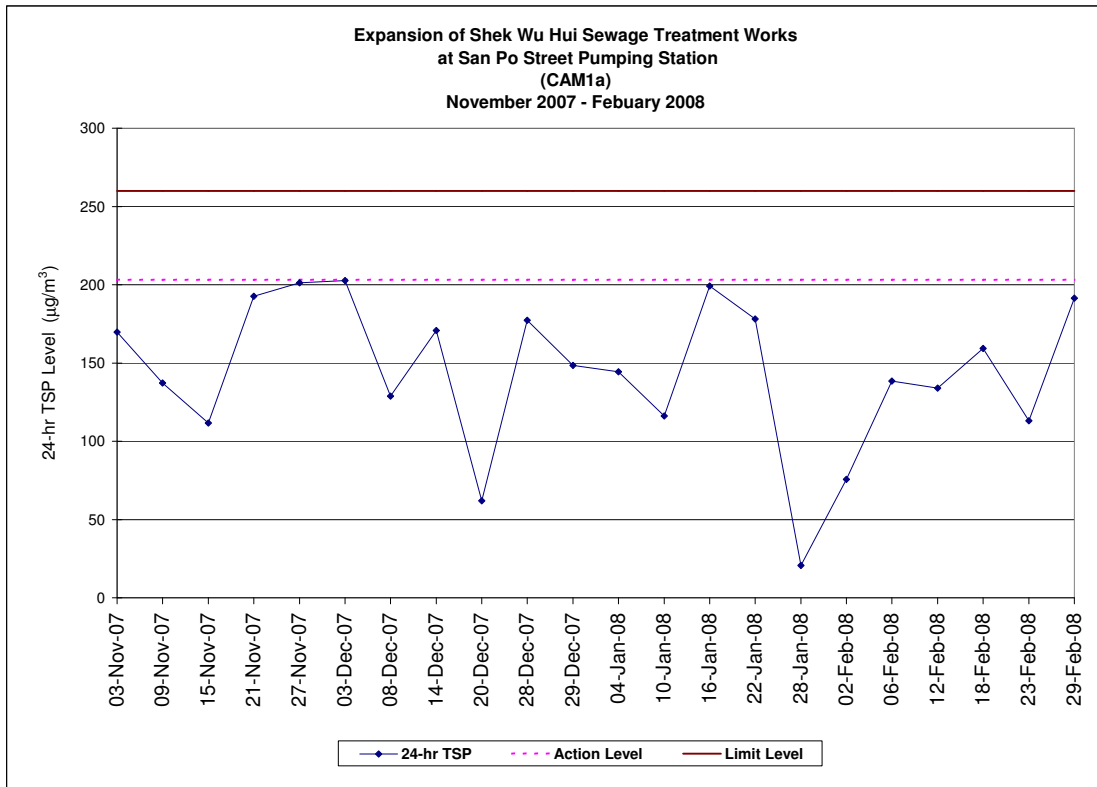

Expansion of Shek Wu Hui Sewage Treatment Works

Noise Impact Monitoring Results

Monitoring Locations	Date	Weather Conditions	Temperature	Wind Speed	Wind	Start Time	End Time	Limit Levels	L _{eq(30min)}	L _{10(30min)}	L _{90(30min)}	Remark
			(°C)	(m/s)	Direction			dB(A)	dB(A)	dB(A)	dB(A)	
Wai Loi Tsuen NM1	02-Feb-08	Cloudy	12	0.4	N	10:20	10:50	75	58.8	61.8	54.5	
	06-Feb-08	Cloudy	11	0.7	NE	10:20	10:50	75	61.1	62.9	57.4	
	12-Feb-08	Cloudy	10	0.6	NE	09:30	10:00	75	58.7	61.2	56.4	
	18-Feb-08	Fine	15	0.9	NE	09:30	10:00	75	60.3	63.4	57.2	
	23-Feb-08	Cloudy	14	1.1	N	09:30	10:00	75	58.9	61.8	54.2	
	29-Feb-08	Cloudy	17	0.6	N	10:00	10:30	75	61.0	63.3	57.2	
Temporary Domestic Structure NM2	02-Feb-08	Cloudy	10	0.6	N	11:20	11:50	75	54.8	57.6	50.7	
	06-Feb-08	Cloudy	12	1.2	NE	11:20	11:50	75	53.3	56.9	50.3	
	12-Feb-08	Cloudy	16	1.9	E	10:30	11:00	75	53.9	57.0	51.6	
	18-Feb-08	Fine	15	1.3	NE	10:30	11:00	75	53.6	56.9	51.3	
	23-Feb-08	Cloudy	14	1.2	N	10:30	11:00	75	53.1	56.9	50.6	
	29-Feb-08	Cloudy	17	0.8	N	11:00	11:30	75	53.4	57.2	51.8	

A façade correction of 3 dB(A) was applied to each measurement result. "Shading" indicates an Limit Level exceedance.

