Jardine Engineering Corporation Limited

Contract No. DE/2009/09 Construction of Tai Po Sewage Treatment Works – Stage V Phase II B

Monthly Environmental Monitoring and Audit Report for January 2012

(Version 3.0)

Certified By

(Environmental Team Leader)

REMARKS:

The information supplied and contained within this report is, to the best of our knowledge, correct at the time of printing.

CINOTECH accepts no responsibility for changes made to this report by third parties.

CINOTECH CONSULTANTS LTD

Room 1710, Technology Park, 18 On Lai Street, Shatin, NT, Hong Kong Tel: (852) 2151 2083 Fax: (852) 3107 1388

Email: info@cinotech.com.hk

TABLE OF CONTENTS

	Pa	ge
EX	ECUTIVE SUMMARY	. 1
Intr	oduction	1
Env	vironmental Monitoring and Audit Works	1
Env	rironmental Licenses and Permits	. 1
	/ Information in the Reporting Month	
Fut	ure Key Issues	2
1	INTRODUCTION	3
Bac	ekground	3
	nstruction Programme	
	nmary of EM&A Requirements	
2	AIR QUALITY MONITORING	. 6
Mo	nitoring Requirements	6
	nitoring Locations	
	nitoring Equipment	
	nitoring Parameters, Frequency and Duration	
	nitoring Methodology and QA/QC Procedure	
Res	sults and Observations	. 8
3	NOISE MONITORING	10
Mo	nitoring Requirements	10
	nitoring Locations	
	nitoring Equipment	
	nitoring Parameters, Frequency and Duration	
	nitoring Methodology and QA/QC Procedures	
Kes	sults and Observations	12
4	ENVIRONMENTAL AUDIT	13
	e Audits	
	view of Environmental Monitoring Procedures	
	tus of Environmental Licensing and Permitting	
	tus of Waste Managementblementation Status of Environmental Mitigation Measures	
	nmary of Exceedances	
	blementation Status of Event Action Plans	
	nmary of Complaint and Prosecution	
5	FUTURE KEY ISSUES	
Mo	nitoring Schedule for the Next Month	
	nstruction Program for the Next Month	
6	CONCLUSIONS AND RECOMMENDATIONS	17
Cor	nclusions	17
	commendations	

LIST OF TABLES

Table I	Summary Table for Events Recorded in the Reporting Month
Table II	Summary Table for Key Information in the Reporting Month
Table 1.1	Key Project Contacts
Table 2.1	Locations for Air Quality Monitoring
Table 2.2	Air Quality Monitoring Equipment
Table 2.3	Impact Dust Monitoring Parameters, Frequency and Duration
Table 2.4	Summary Table of Air Quality Monitoring Results during the reporting month
Table 3.1	Location of Noise Monitoring Station
Table 3.2	Noise Monitoring Equipment
Table 3.3	Noise Monitoring Parameters, Frequency and Duration
Table 3.4	Summary Table of Noise Monitoring Results during the Reporting Month
Table 4.1	Summary of Environmental Licensing and Permit Status
Table 4.2	Observations and Recommendations of Site Audit

LIST OF FIGURE

Figure 1.1 Figure 1.2

Site Layout Plan Locations of Air Quality and Noise Monitoring Stations

LIST OF APPENDICES

Appendix A	Action and Limit Levels
Appendix B	Copies of Calibration Certificates
Appendix C	Environmental Monitoring Schedules
Appendix D	1-hour TSP Monitoring Results and Graphical Presentations
Appendix E	24-hour TSP Monitoring Results and Graphical Presentations
Appendix F	Noise Monitoring Results and Graphical Presentations
Appendix G	Summary of Exceedance
Appendix H	Site Audit Summary
Appendix I	Event Action Plans
Appendix J	Updated Environmental Mitigation Implementation Schedule
Appendix K	Waste Generation in the Reporting Month
Appendix L	Complaint Log
Appendix M	Construction Programme

EXECUTIVE SUMMARY

Introduction

- 1. This is the 7th monthly Environmental Monitoring and Audit (EM&A) Report prepared by Cinotech Consultants Limited for DSD Contract no. DE/2009/09 "Supply and Installation of Electrical and Mechanical Equipment for Tai Po Sewage Treatment Works Stage 5 Phase 2B". This report documents the findings of EM&A Works conducted in January 2012.
- 2. The major site activities undertaken in the reporting month included:
 - Relocation of earthing terminals at CBC basement;
 - Rectification of defects for Section IV of the Works; and
 - Positioning of sludge feed pump at Sludge Dewatering Housing.

Environmental Monitoring and Audit Works

- 3. Environmental monitoring and audit works for the Project were performed regularly as stipulated in the Final EM&A Manual and the results were checked and reviewed. The implementation of the environmental mitigation measures, Event Action Plans and environmental complaint handling procedures were also checked.
- 4. Summary of the events and action taken in the reporting month is tabulated in **Table I**.

Table I Summary Table for Events Recorded in the Reporting Month

Donomoton	No. of Ex	ceedance	No. of Events	A ation Tokon	
Parameter	Action Level	Limit Level	Due to this Project	Action Taken	
1-hr TSP	0	0	0	N/A	
24-hr TSP	0	0	0	N/A	
Noise	0	0	0	N/A	

Environmental Licenses and Permits

5. Environmental related licenses/permits granted to the Project include the Environmental Permit (EP) for the Project.

Key Information in the Reporting Month

6. Summary of key information in this reporting month is tabulated in Table II.

Table II Summary Table for Key Information in the Reporting Month

Event	Ev	ent Details	Action Taken	Status	Remark
Event	Number	Nature	Action Taken	Status	Kemark
Complaint received	0		N/A	N/A	
Changes to the assumptions and key construction / operation activities recorded	0		N/A	N/A	
Status of submissions	1	Monthly EM&A Report (December 11)	Submitted to EPD on 27 th January 2012 (EP condition 6.6)	N/A	
under EP	1	Quarterly EM&A Report (October - December 11)	Submitted to EPD on 31 st January 2012 (EP condition 6.6)	N/A	
Notifications of any summons & prosecutions	0		N/A	N/A	

Future Key Issues

- 7. Major site activities for the coming two months will include:
 - Dismantling existing Ferric Chloride Dosing System;
 - Installation of bridge scrapers for FC No. 11B & 12B;
 - Cabling for FC No. 11B & 12B;
 - Installation of penstocks at Flow Distribution Chamber No. 2; and
 - Installation of sludge feed pump at Sludge Dewatering Housing
- 8. The future environmental concerns are air quality, noise impacts and waste management from construction works.

1 INTRODUCTION


Background

- 1.1 Tai Po Sewage Treatment Works (TPSTW) is located within the Tai Po Industrial Estate. It currently comprises four Stages: I, II, IVA and IVB works. The TPSTW Stage V aims to upgrade the existing STW to provide additional sewage treatment capacity from the present design flow of 88,000 m³/day to 130,000 m³/day to meet the demands of both the existing and future developments, and to meet the revised discharge license requirements.
- 1.2 The TPSTW Stage V, Phase I and Phase II are Designated Projects under the Environmental Impact Assessment Ordinance (Cap. 449) with the same EIAO Register No. AEIAR 081/2004. A study of environmental impact assessment (EIA) was undertaken to evaluate various environmental impacts associated with the works within these two Designed Projects. An EIA Report as well as an Environmental Monitoring and Audit (EM&A) Manual were approved by the Environmental Protection Department (EPD) on 28 October 2004.
- 1.3 The Stage V works will be implemented in 2 phases. The design capacities of Phase I and Phase II works are 100,000 m³/d and 130,000 m³/d respectively. An Environmental Permit (EP) No. EP-265/2007 was issued on 22 March 2007 for the TPSTW Stage V Phase II to the Drainage Services Department (DSD) as the Permit Holder. The project "Tai Po Sewage Treatment Works Stage V Phase IIB" formed part of the Phase II works, includes additional secondary treatment process units (1 primary clarifier; 3 bioreactors and 2 final clarifiers) in TPSTW for its future extended plant design capacity of 120,000 m³/day. A master construction programme of the Project is provided in **Appendix M**. A site layout plan is provided in **Figure 1.1**. The construction activities of the Project commenced on 16 May 2011.
- 1.4 Cinotech Consultants Ltd. was commissioned by the Contractor as the Environmental Team (ET) to undertake the EM&A works for the Project. Dr. Priscilla CHOY of Cinotech Consultants Ltd. was appointed as the ET Leader as per the Condition 2.1 of the EP. Ove Arup and Partners Hong Kong Limited. was appointed as the IEC under Condition 2.2 of the EP. This is the 7th monthly EM&A report summarizing the EM&A works for the Project in January 2012.

Project Organizations

- 1.5 Different parties with different levels of involvement in the project organization include:
 - Project Proponent / Engineer's Representative (ER) Drainage Services Department
 - Environmental Team (ET) Cinotech Consultants Ltd.
 - Independent Environmental Checker (IEC) Ove Arup and Partners Hong Kong Limited
 - Contractor Jardine Engineering Corporation Ltd.
- 1.6 The responsibilities of respective parties are detailed in Section 1.10 of the Final EM&A Manual of the Project.

1.7 The Project Organization during Construction Phase

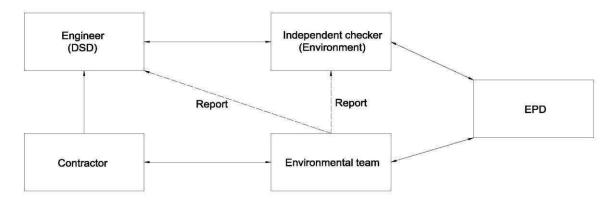

1.8 The key contacts of the Project are shown in **Table 1.1**.

Table 1.1 Key Project Contacts

Party	Role	Name	Position	Phone No.	Fax No.
DSD	E&M Branch	Mr. TONG Sau Kit	Senior Engineer	2594 7304	2827 8532
טטט	EXIVI DIAIICII	Mr. TSE Ho	Engineer	2660 7638	2027 0332
		Dr. Priscilla CHOY	ET Leader	2151 2089	
Cinotech	Environmental Team	Mr. Johnny Fung	Project Coordinator and Audit Team Leader	2151 2078	3107 1388
		Mr. Henry LEUNG	Monitoring Team Leader 2151 2087		
A mun	Independent Environmental	Mr. Coleman NG	Independent Environmental Checker	2268 3097	2865 6493
Arup	Checker	Mr. Lawrence KAN	Assistant to Independent Environmental Checker	2268 3212	2803 0493
	E 0-M	Mr. Alex Law	Project Manager	9312 8659	
JEC	E&M Contractor	Mr. Dexter Chan	Site Agent	6391 2499	2887 9090
	Contractor	Mr. Alex Iu	Environmental Officer	6393 2904	

Construction Programme

- 1.9 The site activities undertaken in the reporting month were:
 - Relocation of earthing terminals at CBC basement;
 - Rectification of defects for Section IV of the Works; and
 - Positioning of sludge feed pump at Sludge Dewatering Housing

Monthly EM&A Report – January 2012

Summary of EM&A Requirements

- 1.10 The EM&A programme requires construction phase air quality and noise monitoring as well as environmental site audits. The EM&A requirements are described in the following sections, including:
 - All monitoring parameters;
 - Action and Limit levels for all environmental parameters;
 - Event / Action Plans;
 - Environmental mitigation measures, as recommended in the project EIA study final report; and
 - Environmental requirements in contract documents.
- 1.11 The advice on the implementation status of environmental protection and pollution control/mitigation measures is summarized in Section 5 of this report.
- 1.12 This report presents the monitoring results, observations, locations, equipment, period, methodology and QA/QC procedures of the required monitoring parameters, namely air quality and noise as well as audit works for the Project in the reporting month.

2 AIR QUALITY MONITORING

Monitoring Requirements

- 2.1 Monitoring of 1-hour and 24-hour Total Suspended Particulates (TSP) was conducted to monitor the air quality during construction phase. **Appendix A** shows the established Action/Limit Levels for the environmental monitoring works.
- 2.2 In accordance with Section 2.30 of the EM&A Manual, a baseline checking of ambient TSP levels shall be carried out every six months at each monitoring station, when no dusty works activities are in operation. The number and location of monitoring stations and parameters shall be reviewed by ET Leader every three months according to section 8.8 of EM&A Manual.

Monitoring Locations

2.3 Impact air quality monitoring was conducted at the 3 monitoring stations, as shown in **Figure 1.2**. **Table 2.1** describes the locations of the air quality monitoring stations.

Table 2.1 Locations for Air Quality Monitoring

Monitoring Stations Description		Location of Measurement
CAM1	Government Staff Quarters	Rooftop
CAM2	Hung Hing Printing Centre	On the site boundary just next to the Hung Hing Printing Centre
CAM3	Talcon Industrial Ltd.	On the site boundary just next to Talcon Industrial Ltd.

Monitoring Equipment

2.4 **Table 2.2** summarizes the equipment used for the air quality monitoring.

Table 2.2 Air Quality Monitoring Equipment

Equipment Model and Make		Qty.
ING	Graseby GMW 2310 HVS, Model GS-2310105-1, Serial no. 10239 and 0810	2
HVS	Tisch Environmental, Inc.; Model no. TE-5170, Serial no. 1704	1
Calibrator	Thermo Andersen.; Model no. G25A Serial no. 1536	1

Monitoring Parameters, Frequency and Duration

2.5 **Table 2.3** summarizes the monitoring parameters and frequencies of impact dust monitoring for the whole construction period.

 Table 2.3
 Impact Dust Monitoring Parameters, Frequency and Duration

Monitoring Stations	Parameter	Duration	Period	Frequency
CAM1, CAM2 and	1-hour TSP	1 hour	During daytime period	3 times / 6-day
CAM3	24-hour TSP	24 hours	24 hours	Once / 6-day

Monitoring Methodology and QA/QC Procedure

Instrumentation

2.6 High Volume Samplers (HVS) connected with appropriate sampling inlets were employed for air quality monitoring. Each sampler was composed of a motor, a filter holder, a flow controller and a sampling inlet and its performance specification complies with that required by USEPA Standard Title 40, Code of Federation Regulations Chapter 1 (Part 50).

HVS Installation

- 2.7 The following guidelines were adopted during the installation of HVS:
 - Sufficient support was provided to secure the samplers against gusty wind.
 - No two samplers were placed less than 2 meters apart.
 - The distance between the sampler and an obstacle, such as buildings, was at least twice the height that the obstacle protrudes above the sampler.
 - A minimum of 2 meters of separation from walls, parapets and penthouses was required for rooftop samples.
 - A minimum of 2 meters separation from any supporting structure, measured horizontally was required.
 - No furnaces or incineration flues were nearby.
 - Airflow around the sampler was unrestricted.
 - The samplers were more than 20 meters from the drip line.
 - Any wire fence and gate, to protect the sampler, should not cause any obstruction during monitoring.

Filters Preparation

- 2.8 Fiberglass filters were used which have a collection efficiency of larger than 99% for particles of 0.3 µm diameter. A HOKLAS accredited laboratory, Wellab Ltd., was responsible for the preparation of pre-weighed filter papers for Cinotech's monitoring team.
- 2.9 All filters, which were prepared by Wellab Ltd., were equilibrated in the conditioning environment for 24 hours before weighing. The conditioning environment temperature was around 25 °C and not variable by more than ±3 °C; the relative humidity (RH) was < 50% and not variable by more than ±5%. A convenient working RH was 40%.
- 2.10 Wellab Ltd. has a comprehensive quality assurance and quality control programmes.

Monthly EM&A Report – January 2012

Operating/Analytical Procedures

- 2.11 Operating/analytical procedures for the TSP monitoring were highlighted as follows:
 - Prior to the commencement of the dust sampling, the flow rate of the HVS was properly set (between 1.1 and 1.4 m³/min.) in accordance with the manufacturer's instruction to within the range recommended in USEPA Standard.
 - The power supply was checked to ensure the sampler worked properly.
 - On sampling, the sampler was operated for 5 minutes to establish thermal equilibrium before placing any filter media at the air quality monitoring station.
 - The filter holding frame was then removed by loosening the four nuts and carefully a weighted and conditioned filter was centered with the stamped number upwards, on a supporting screen.
 - The filter was aligned on the screen so that the gasket formed an airtight seal on the outer edges of the filter. Then the filter holding frame was tightened to the filter holder with swing bolts to avoid air leakage at the edges.
 - The shelter lid was closed and secured with the aluminum strip.
 - The timer was then programmed. Information was recorded on the record sheet, which included the starting time, the weather condition and the filter number (the initial weight of the filter paper can be found out by using the filter number).
 - The flow rate of the HVS sampler would be verified to be constant and recorded on the data sheet after sampling.
 - After sampling, the filter was removed and sent to the Wellab Ltd. for weighing. The elapsed time was also recorded.
 - Before weighing, all filters were equilibrated in a conditioning environment for 24 hours. The conditioning environment should be between 25°C and 30°C and not vary by more than ±3°C; the relative humidity (RH) should be < 50% and not vary by more than ±5%. A convenient working RH is 40%. Weighing results were returned to Cinotech for further analysis of TSP concentrations collected by each filter.

Maintenance/Calibration

- 2.12 The following maintenance/calibration was required for the HVS:
 - The high volume motors and their accessories were properly maintained. Appropriate maintenance such as routine motor brushes replacement and electrical wiring checking were made to ensure that the equipment and necessary power supply are in good working condition.
 - Calibration of the HVS (five point calibration) using Calibration Kit was carried out every two months. Copies of calibration certificates are attached in **Appendix B**.
 - The HVS calibration orifice will be calibrated annually.

Results and Observations

- 2.13 In the reporting month, 1-hr TSP monitoring was carried out as schedule at each designated monitoring station on 14 occasions. 24-hr TSP monitoring was carried out as scheduled at each designated monitoring station on 6 occasions. The monitoring schedule was updated and is shown in **Appendix C**. The weather during the monitoring sessions was mainly sunny, cloudy and rainy.
- 2.14 All measured 1-hr and 24-hr TSP levels were below the Action/Limit Levels. No exceedance was recorded in the reporting month.

Monthly EM&A Report – January 2012

2.15 The monitoring data and graphical presentations of 1-hour and 24-hour TSP monitoring results are shown in **Appendices D** and **E**, respectively.

Table 2.4 Summary Table of Air Quality Monitoring Results during the reporting month

Paramete r	Minimum μg/m³	Maximum μg/m³	Average μg/m³	Action Level, μg/m³	Limit Level, µg/m³	
1-hr TSP (CAM1)	48	116	87	315	500	
24-hr TSP (CAM1)	30	60	50	171	260	
1-hr TSP (CAM2)	69	186	109	336	500	
24-hr TSP (CAM2)	49	93	70	177	260	
1-hr TSP (CAM3)	79	159	119	344	500	
24-hr TSP (CAM3)	55	69	62	192	260	

2.16 According to our field observations, the major dust source identified at the designated air quality monitoring stations are as follows:

Station	Major Pollution Source
CAM1 – Government Staff Quarters	Road Traffic Dust
CAM2 – Hung Hing Printing Centre	Road Traffic Dust and Excavation
CAM3 – Talcon Industrial Ltd.	Road Traffic Dust and Excavation

3 NOISE MONITORING

Monitoring Requirements

- 3.1 Noise monitoring was conducted in accordance with the EM&A Manual. **Appendix A** shows the established Action and Limit Levels for the environmental monitoring works.
- 3.2 The number and location of monitoring stations and parameters shall be reviewed by ET Leader every three months according to section 8.8 of EM&A Manual.

Monitoring Locations

3.3 Noise monitoring was conducted at one designated monitoring station as presented in **Table 3.1**. **Figure 1.2** shows the locations of the monitoring station.

Table 3.1 Location of Noise Monitoring Station

Monitoring Station	Description	Location of Measurement
NM1	Government Staff Quarters	The corridor at the first floor.

Monitoring Equipment

3.4 **Table 3.2** summarizes the noise monitoring equipment model being used.

Table 3.2 Noise Monitoring Equipment

Equipment	Model and Make	Quantity
Integrating Sound Level Meter	SVAN 955 (Serial No. 14303)	1
Calibrator	B&K (Serial No. 2412367)	1
Wind Speed Anemometer	Vane Anemometer, Model AZ8904 (Serial no. 974835)	1

Monitoring Parameters, Frequency and Duration

3.5 **Table 3.3** summarizes the monitoring parameters, frequency and total duration of monitoring.

 Table 3.3
 Noise Monitoring Parameters, Frequency and Duration

Station	Parameter	Period	Frequency
NM1	$L_{eq}(30 \text{ min.})$ (L_{10} and L_{90} were also recorded as supplementary information)	0700-1900 hrs. on normal weekdays	Once a week

3.6 If construction works are extended to include works during the hours of 1900 - 0700, additional weekly impact monitoring would be carried out during evening and night-time works. Applicable permits under NCO have been obtained by the Contractor. The details of the Construction Noise Permit can be referred to **Table 5.1**.

Monitoring Methodology and QA/QC Procedures

Field Monitoring

- 3.7 The monitoring procedures are as follows:
 - The microphone head of the sound level meter was positioned 1m exterior of the noise sensitive facade and lowered sufficiently so that the building's external wall acts as a reflecting surface.
 - The battery condition was checked to ensure good functioning of the meter.
 - Parameters such as frequency weighting, the time weighting and the measurement time were set as follows:

frequency weighting : Atime weighting : Fast

- measurement time : 30 minutes

- Prior to and after noise measurement, the meter was calibrated using the calibrator for 94.0 dB at 1000 Hz. If the difference in the calibration level before and after measurement is more than 1.0 dB, the measurement was considered invalid and repeat of noise measurement was required after re-calibration or repair of the equipment.
- The wind speed at the monitoring station was checked with the portable wind meter. Noise monitoring was cancelled in the presence of fog, rain, and wind with a steady speed exceeding 5 m/s, or wind with gusts exceeding 10 m/s.
- Noise measurement was paused during periods of high intrusive noise if possible and observation was recorded when intrusive noise was not avoided.
- At the end of the monitoring period, the L_{eq} , L_{10} and L_{90} were recorded. In addition, site conditions and noise sources were recorded on a standard record sheet.

Maintenance and Calibration

- 3.8 Maintenance and Calibration procedures were as follows:
 - The microphone head of the sound level meter and calibrator were cleaned with a soft cloth at quarterly intervals.
 - The sound level meter and calibrator were checked and calibrated at yearly intervals. Copies of calibration certificates are attached in **Appendix B**.

Results and Observations

- In the reporting month, noise monitoring during non-restricted hours was conducted as scheduled at the designated location on 4 occasions. As advised by the Contractor, no construction activities will be undertaken during restricted hours as such noise monitoring during restricted hours was omitted. The noise monitoring schedule is provided in **Appendix C**.
- 3.10 The details of the monitoring results and graphical presentations are shown in **Appendix F.** The weather during the monitoring sessions was mainly sunny and fine.
- 3.11 No Action/Limit Level exceedance for construction noise monitoring was recorded in the reporting month.

Table 3.4 Summary Table of Noise Monitoring Results during the Reporting Month

Parameter	Minimum Leq(30min) dB(A)	Maximum Leq(30min) dB(A)	Average Leq(30min) dB (A)	Action Level	Limit Level
NM1	54.1	58.9	56.2	When one documented complaint is received	75dB(A)

3.12 According to our field observations, the major noise source identified at the designated air quality monitoring stations are as follows:

Station	Major Noise Source
NM1 – Government Staff Quarters	Road Traffic
	Construction of Main Site

4 ENVIRONMENTAL AUDIT

Site Audits

- 4.1 Site audits were carried out by ET on weekly basis to monitor the timely implementation of proper environmental management practices and mitigation measures in the Project site. The summaries of site audits are attached in **Appendix H**.
- 4.2 Site audits were conducted on 5th, 13th, 20th and 26th January 2012 by ET. A joint site audit with the representative with IEC, ER, the Contractor and the ET was carried out on 13th January 2012. No site inspection was conducted by EPD during the reporting month. The details of observations during site audit can refer to **Table 4.2**.

Review of Environmental Monitoring Procedures

4.3 The monitoring works conducted by the monitoring team were inspected regularly. The following observations have been recorded for the monitoring works:

Air Quality Monitoring

- The monitoring team recorded all observations around the monitoring stations within and outside the construction site.
- The monitoring team recorded the temperature and weather conditions on the monitoring days.

Noise Monitoring

- The monitoring team recorded all observations around the monitoring stations, which might affect the monitoring result.
- Major noise sources were identified and recorded. Other intrusive noise attributing to the result was trimmed off by pausing the monitoring temporarily.

Status of Environmental Licensing and Permitting

4.4 All permits/licenses obtained for the Project are summarized in **Table 4.1**.

Monthly EM&A Report – January 2012

Table 4.1 S	ummary of	Environment	al Licensing and Permit Status
mit / Licongo No	Valid	Period	Deteils
mit / License No.	E	TD.	Details

Permit / License No.	Valid	Period	Details	Status
refilit/ License No.	From	To	Details	Status
Environmental Permi	it (EP)			
EP-265/2007	22/3/2007	N/A	Expansion and upgrading of existing Tai Po Sewage Treatment Works from 100,000 m³/day to 130,000 m³/day: (a) additional secondary treatment process units(1 primary clarified; 3 bioreactors and 2 final clarifiers); (b) reconstruction of 4 existing final clarified; (c) provision of ultraviolet disinfection facilities; (d) additional sludge treatment facilities; and (e) ancillary works to existing treatment facilities.	Valid

Status of Waste Management

4.5 The Construction and Demolition (C&D) materials generated in the reporting month were mainly inert C&D waste and C&D waste. The quantities of waste generated in this reporting month are summarized in **Appendix K**. No chemical waste was generated in the reporting month.

Implementation Status of Environmental Mitigation Measures

- 4.6 According to the EIA Study Report, Environmental Permit and the EM&A Manual of the Project, the mitigation measures detailed in the documents are recommended to be implemented during the construction phase. An updated summary of the EMIS is provided in **Appendix J**.
- 4.7 During site inspections in the reporting month, no observation and non-conformance were identified. In addition, there was no major environmental deficiency being identified on 5th and 26th January 2012. The observations and recommendations made during the audit sessions are summarized in **Table 4.2**.

Table 4.2 Observations and Recommendations of Site Audit

Parameters	Date	Observations and Recommendations	Follow-up
Water Quality	20 January 2012	Reminder: - Stagnant water should be collected at FC12B.	The situation was observed rectified in audit session 120126.
Waste/Chemical Management	13 January 2012	Reminder: - C&D waste should be cleaned regularly	The situation was observed rectified in audit session

Supply and Installation of Electrical and Mechanical Equipment for Tai Po Sewage Treatment Works Stage 5 Phase 2B Monthly EM&A Report – January 2012

	in the receptacles outside the site office.	120120.

Summary of Exceedances

No exceedance of monitoring results was recorded in the reporting month. Summary of 4.8 exceedance is provided in **Appendix G**.

Implementation Status of Event Action Plans

The Event Action Plans for air quality and construction noise monitoring are presented in Appendix I. No exceedance was recorded and thus no action was required to be implemented.

Summary of Complaint and Prosecution

- 4.10 No environmental related complaint, prosecution or notification of summons was received in the reporting month.
- 4.11 There was no environmental complaint, prosecution or notification of summons received since the Project commencement. The Complaint Log is attached in **Appendix** L.

5 FUTURE KEY ISSUES

- 5.1 Key issues to be considered in the coming month include:
 - Effluent discharge generated from surface runoff;
 - Dust generated from excavation works, backfilling works and stockpile of dusty materials;
 - Maintenance of de-silting facilities and drainage system, such as U-channels;
 - Accumulation of stagnant water in the site areas; and
 - Accumulation of C&D waste and general waste on site.

Monitoring Schedule for the Next Month

5.2 The tentative environmental monitoring schedule for the next month is shown in **Appendix C**.

Construction Program for the Next Month

- 5.3 A tentative construction programme is provided in **Appendix M**. The major construction activities in the coming month will include:
 - Dismantling existing Ferric Chloride Dosing System;
 - Installation of bridge scrapers for FC No. 11B & 12B;
 - Cabling for FC No. 11B & 12B;
 - Installation of penstocks at Flow Distribution Chamber No. 2; and
 - Installation of sludge feed pump at Sludge Dewatering Housing.

6 CONCLUSIONS AND RECOMMENDATIONS

Conclusions

- 6.1 Environmental monitoring and audit works were conducted in the reporting month. Site inspections were conducted on a weekly basis. The results were reviewed and checked.
- 6.2 No exceedance of monitoring results was recorded in the reporting month.
- 6.3 There was no environmental complaint, prosecution or notification of summons received.

Recommendations

6.4 According to the environmental audit performed in the reporting month, the following recommendations were made:

Water Impact

• To avoid accumulation of stagnant water on site.


Dust Impact


- To remove fugitive dusty material on the haul road periodically.
- To spray with water on dry dust haul road.

Waste / Chemical Management

- To provide proper rubbish bins / skips for waste collection.
- To avoid and check for any accumulation of waste materials or rubbish on site.
- Provide drip tray with adequate capacity and maintain well for equipment and chemical waste.

FIGURES

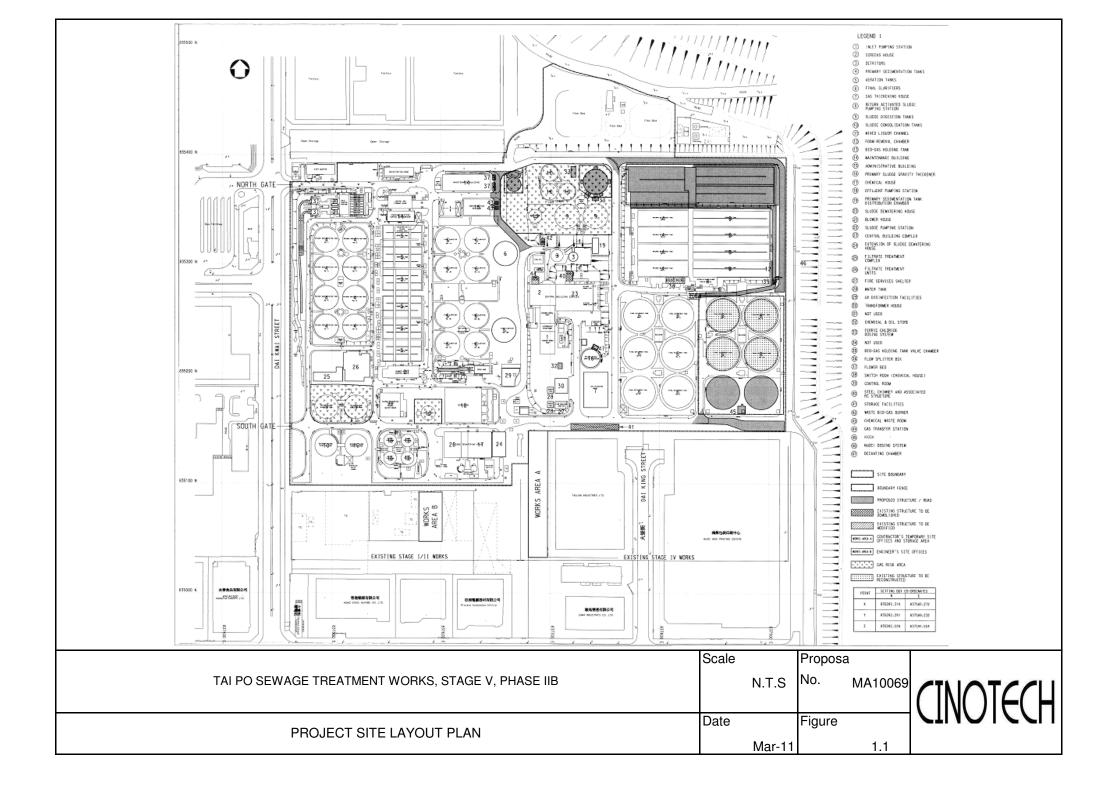

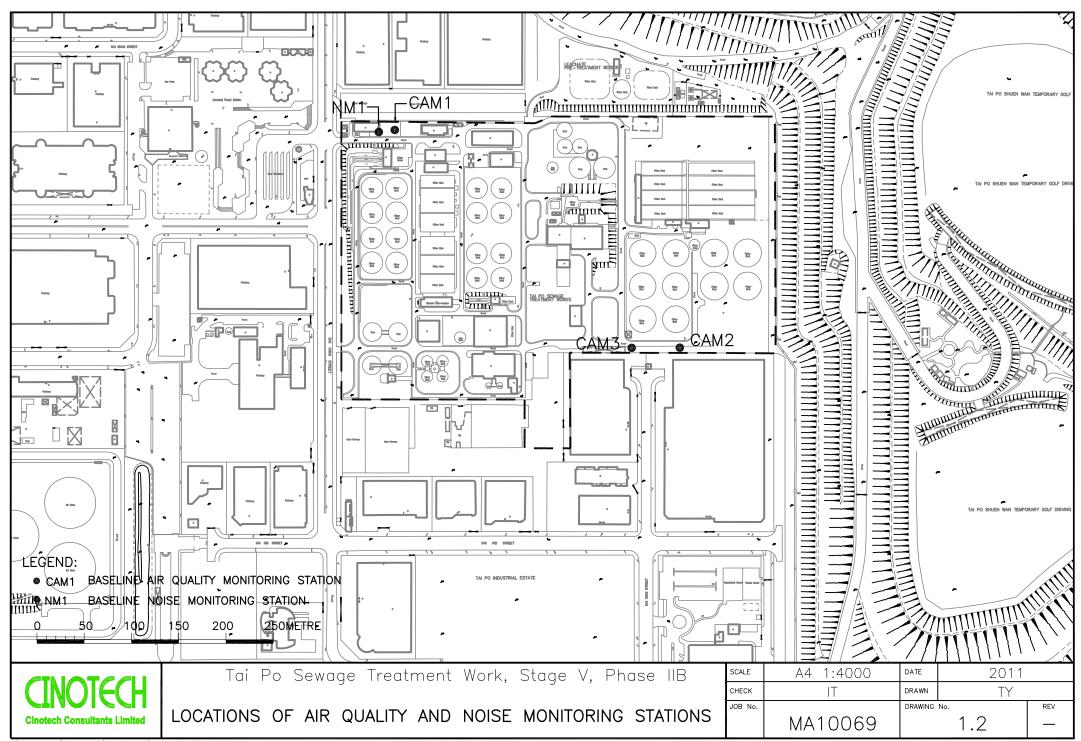

APPENDIX A ACTION AND LIMIT LEVELS

APPENDIX A – Action and Limit Levels

1-Hour TSP

Location	Action Level, μg/m ³	Limit Level, μg/m³
CAM1	315	
CAM2	336	500
CAM3	344	

24-Hour TSP

Location	Action Level, μg/m ³	Limit Level, μg/m ³
CAM1	171	
CAM2	177	260
CAM3	192	

Construction Noise

Time Period	Action Level	Limit Level
0700-1900 hrs on normal weekdays		75 dB(A)
0700-2300 hrs on holidays; and 1900-2300 hrs on all other days	When one documented complaint is received	70* dB(A)
2300-0700 hrs of next day	1	55* dB(A)

Notes:

^{*} The Area Sensitivity Rating for Station NM1 is taken as C, due to the nearby industrial area, according to Table 1 of EPD's Technical Memorandum on Noise from Construction Work other than Percussive Piling.

APPENDIX B COPIES OF CALIBRATION CERTIFCATES

CINOTECH

File No. MA0010/37/0041 Station CAM1 - Government Staff Quarter WK Operator: 18-Nov-11 Date: Next Due Date: 17-Jan-12 Equipment No.: A-01-37 Serial No. 1704 **Ambient Condition** Temperature, Ta (K) 298.8 Pressure, Pa (mmHg) 758.3 Orifice Transfer Standard Information Equipment No.: A-04-01 Slope, mc 0.0568 Intercept, be -0.0432 mc x Qstd + bc = $[\Delta H \times (Pa/760) \times (298/Ta)]^{1/2}$ Last Calibration Date: 9-Oct-11 Qstd = $\{ [\Delta H \times (Pa/760) \times (298/Ta)]^{1/2} - bc \} / mc$ **Next Calibration Date:** 8-Oct-12 Calibration of TSP Sampler Orfice HVS Calibration ΔH (orifice), $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2} Y$ Qstd (CFM) ΔW Point [ΔH x (Pa/760) x (298/Ta)]1/2 in, of water X - axis (HVS), in. of oil axis 11.9 1 3.44 61.34 8.2 2.86 2 9.8 55.74 2.54 3.12 6.5 7.4 48.54 3 2.71 5.2 2.27 4 5.1 2.25 40.42 3.3 1.81 5 3.2 1.78 32.18 2.0 1.41 By Linear Regression of Y on X Slope, mw = <u>0.0</u>492 Intercept, bw: -0.1658 Correlation coefficient* = *If Correlation Coefficient < 0.990, check and recalibrate. Set Point Calculation From the TSP Field Calibration Curve, take Qstd = 43 CFM From the Regression Equation, the "Y" value according to mw x Qstd + bw = $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2}$ Therefore, Set Point; $W = (mw \times Qstd + bw)^2 \times (760 / Pa) \times (Ta / 298) =$ Remarks: Date: Checked by: 12 Date:

CINOTECH

File No. MA0010/37/0042 CAM1 - Government Staff Quarter Station Operator: WK Date: 16-Jan-12 Next Due Date: 15-Mar-12 Equipment No.: A-01-37 Serial No. 1704 **Ambient Condition** 288.5 Temperature, Ta (K) Pressure, Pa (mmHg) Orifice Transfer Standard Information Equipment No.: A-04-01 Slope, mc 0.0568 Intercept, be -0.0432 me x Qstd + bc = $[\Delta H \times (Pa/760) \times (298/Ta)]^{1/2}$ Last Calibration Date: 9-Oct-11 Qstd = $\{[\Delta H \times (Pa/760) \times (298/\Gamma a)]^{1/2} -bc\} / mc$ Next Calibration Date: 8-Oct-12 Calibration of TSP Sampler Orfice HVS Calibration ΔH (orifice), $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2} Y$ Qstd (CFM) ΔW Point [ΔH x (Pa/760) x (298/Ta)]1/2 in. of water X - axis (HVS), in. of oil axis 11.7 1 3.48 62,02 8.3 2.93 9.8 3.18 2 56.83 6.5 2.59 2.79 7.5 49.81 5.1 2.30 4 2.30 41.21 5.1 3.2 1.82 5 3.3 1.85 33.30 2.0 1.44 By Linear Regression of Y on X Slope, $mw = _{0.0513}$ Intercept, bw : -0.2802 Correlation coefficient* = *If Correlation Coefficient < 0.990, check and recalibrate. Set Point Calculation From the TSP Field Calibration Curve, take Qstd = 43 CFM From the Regression Equation, the "Y" value according to mw x Qstd + bw = $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2}$ Therefore, Set Point; $W = (mw \times Qstd + bw)^2 \times (760 / Pa) \times (Ta / 298) =$ Remarks: Signature: Date:

CINOTECH

File No. MA0010/A40/0041 Station CAM2 - Hung Hing Printing Centre WK Operator: Date: 18-Nov-11 Next Due Date: 17-Jan-12 Equipment No.: A-01-40 Serial No. 10239 **Ambient Condition** Temperature, Ta (K) 298.8 Pressure, Pa (mmHg) 758.3 Orifice Transfer Standard Information 0.0568 Equipment No.: A-04-01 Slope, mc Intercept, be -0.0432 mc x Qstd + bc = $[\Delta H \times (Pa/760) \times (298/Ta)]^{1/2}$ Last Calibration Date: 9-Oct-11 Qstd = $\{[\Delta H \times (Pa/760) \times (298/Ta)]^{1/2} - bc\} / mc$ Next Calibration Date: 8-Oct-12 Calibration of TSP Sampler Orfice HVS Calibration ΔH (orifice), Qstd (CFM) $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2} Y$ ΔW Point [ΔH x (Pa/760) x (298/Ta)]^{1/2} in. of water X - axis (HVS), in. of oil axis 11.3 1 3.35 59.80 7.8 2.79 2 9.5 3.07 54.89 6.5 2.54 3 7.5 48.86 2.73 5.2 2.27 4 2.27 40.81 5.2 1.81 3.3 3.2 1.78 32.18 2.0 1,41 By Linear Regression of Y on X Slope, mw = 0.0503Intercept, bw : -0.2142 Correlation coefficient* = *If Correlation Coefficient < 0.990, check and recalibrate. Set Point Calculation From the TSP Field Calibration Curve, take Qstd = 43 CFM From the Regression Equation, the "Y" value according to mw x Qstd + bw = $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2}$ Therefore, Set Point; $W = (mw \times Qstd + bw)^2 \times (760 / Pa) \times (Ta / 298) =$ Remarks: Date:

Date:

CINOTECH

File No. MA0010/A40/0042 Station CAM2 - Hung Hing Printing Centre WK Operator: Date: 16-Jan-12 Next Due Date: 15-Mar-12 Equipment No.: A-01-40 Serial No. 10239 **Ambient Condition** Temperature, Ta (K) 288.5 Pressure, Pa (mmHg) 761.4 Orifice Transfer Standard Information Equipment No.: A-04-01 Slope, mc 0.0568 Intercept, be -0.0432 me x Qstd + bc = $[\Delta H \times (Pa/760) \times (298/Ta)]^{1/2}$ Last Calibration Date: 9-Oct-11 Qstd = $\{ [\Delta H \times (Pa/760) \times (298/Ta)]^{1/2} -bc \} / mc$ Next Calibration Date: 8-Oct-12 Calibration of TSP Sampler Orfice HVS Calibration ΔH (orifice), $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2} Y$ Qstd (CFM) ΔW Point [AH x (Pa/760) x (298/Ta)]1/2 in. of water X - axis (HVS), in. of oil axis 11.6 1 3.46 61.76 7.9 2.86 2 9.3 3.10 55.38 6.4 2.57 7.3 2.75 49.15 5.1 2.30 4 5.1 2.30 41.21 3.2 1.82 3.3 1.85 33.30 1.9 1.40 By Linear Regression of Y on X Slope, mw = 0.0518-0.3023 Intercept, bw: Correlation coefficient* = *If Correlation Coefficient < 0.990, check and recalibrate. Set Point Calculation From the TSP Field Calibration Curve, take Qstd = 43 CFM From the Regression Equation, the "Y" value according to mw x Qstd + bw = $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2}$ Therefore, Set Point; $W = (mw \times Qstd + bw)^2 \times (760 / Pa) \times (Ta / 298) =$ Remarks: Kiwai Conducted by: Whan Signature: Date:

CINOTECH

CAM3 - Talcon					THE NO.	MA0010/35/0041
CANIO - Talcon	Industrial Ltd	-	Operator	:WK		
18-Nov-11			Next Due Date:	: <u>17-Jan</u>	-12	
A-01-35		•	Serial No.	0810		
						:
			Condition			
e, Ta (K)	298.8	Pressure, Pa	(mmHg)		758.3	
					·	
	Oı		T			
		Slope, mc	·			-0.0432
tion Date:	8-Oct-12		$Qstd = \{ \Delta H $	x (Pa/760) x (298	/Ta)]'' ² -bc} /	mc
	•			and the second		
	***		TSP Sampler			n near egyptein fin
ATT ('C)	Ort	fice	Ta . 1 (a== =		HVS	1/2
ΔH (orifice), in. of water	[ΔH x (Pa/76)	0) x (298/Ta)] ^{1/2}	Qstd (CFM) X - axis	ΔW (HVS), in. of oil	[ΔW x (Pa/76	60) x (298/Ta)] ^{1/2} Y- axis
11.7	3	.41	60.83	7.8		2.79
9.8	3	.12	55.74	6.9		2.62
7.5	2	.73	48.86	5.1		2.25
5.2	2	.27	40.81	3.3		1.81
3.1	1	.76	31.68	1.9		1.38
0.0498 efficient* ==	- 0.99	983	Intercept, bw	-0.199	8	
		Sat Baint C	aloulation			
d Calibration C			ลเงนเสนเปม			:
on Equation, the	o i vaiuo accui	ung w				
	mw x Q	$std + bw = [\Delta W]$	x (Pa/760) x (29	98/Ta)] ^{1/2}		
	AH (orifice), in. of water 11.7 9.8 7.5 5.2 3.1 ssion of Y on X 0.0498 efficient < 0.99	Or Or Or	A-01-35 Ambient	A-01-35 Serial No	A-01-35 Serial No. 0810	A-01-35 Serial No. 0810

CINOTECH

File No. MA0010/35/0042 CAM3 - Talcon Industrial Ltd WK Station Operator: Date: 16-Jan-12 Next Due Date: 15-Mar-12 Equipment No.: A-01-35 Serial No. 0810 **Ambient Condition** Temperature, Ta (K) 288.5 Pressure, Pa (mmHg) 761.4 Orifice Transfer Standard Information Equipment No.: A-04-01 Slope, mc 0.0568 Intercept, bc -0.0432 me x Qstd + bc = $[\Delta H \times (Pa/760) \times (298/Ta)]^{1/2}$ 9-Oct-11 Last Calibration Date: Qstd = $\{ [\Delta H \times (Pa/760) \times (298/Ta) \}^{1/2} - bc \} / mc$ **Next Calibration Date:** 8-Oct-12 Calibration of TSP Sampler Orfice HVS Calibration $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2} Y$ ΔH (orifice), Qstd (CFM) ΔW Point [ΔH x (Pa/760) x (298/Ta)]1/2 in. of water X - axis (HVS), in. of oil axis 1 11.5 3.45 61.50 7.9 2.86 2 9.8 3.18 56.83 6.8 2.65 3 7.3 2.75 49.15 5.1 2.30 4 5.2 2.32 41.60 3.3 1.85 5 3.0 1.76 31.78 2.0 1.44 By Linear Regression of Y on X Slope , mw = ______ 0.0488 Intercept, bw :______-0.1322 Correlation coefficient* = *If Correlation Coefficient < 0.990, check and recalibrate. Set Point Calculation From the TSP Field Calibration Curve, take Qstd = 43 CFM From the Regression Equation, the "Y" value according to mw x Qstd + bw = $[\Delta W \times (Pa/760) \times (298/Ta)]^{1/2}$ Therefore, Set Point; $W = (mw \times Qstd + bw)^2 \times (760 / Pa) \times (Ta / 298) =$ Remarks: Date: 16/1/2
Date: 16 January Oold Kwai Conducted by: Wh Tanz Signature:



WELLAB LIMITED

Rms 816, 1516 & 1701, Technology Park, 18 On Lai Street, Shatin, N.T, Hong Kong. Tel: 2898 7388 Fax: 2898 7076 Website: www.wellab.com.hk

TEST REPORT

APPLICANT: Cinotech Consultants Limited

Room 1710, Technology Park,

18 On Lai Street,

Shatin, NT, Hong Kong

Test Report No.:	C/11/110503
Date of Issue:	2011-05-03
Date Received:	2011-04-29
Date Tested:	2011-04-29
Date Completed:	2011-05-03
Next Due Date:	2012-05-02

ATTN:

Mr. Henry Leung

Page:

1 of 1

Certificate of Calibration

Item for calibration:

Description

: RS232 Integral Vane Digital Anemometer

Manufacturer

: AZ Instrument

Model No.

: AZ8904

Serial No.

: 974835

Equipment No.

: A-03-03

Test conditions:

Room Temperature

: 23 degree Celsius

Relative Humidity

: 65%

Pressure

: 101.3 kPa

Methodology:

The anemometer has been calibrated in accordance with the documented procedures and using standard(s) and instrument(s) which are recommended by the manufacturer, or equivalent.

Results:

	Reference Set Point	Instrument Readings
Measuring Air Velocity, m/s	2.00	2.00
Temperature, °C	21.0	21.0

PREPARED AND CHECKED BY:

For and On Behalf of WELLAB Ltd.

PATRICK TSE

Laboratory Manager

This report may not be reproduced except with prior written approval from WELLAB LIMITED and the results relate only to the items calibrated or tested.



WELLAB LIMITED Rms 816, 1516 & 1701, Technology Park, 18 On Lai Street, Shatin, N.T, Hong Kong. Tel: 2898 7388 Fax: 2898 7076 Website: www.wellab.com.hk

TEST REPORT

Description Calibration Orifice

Serial No. 1536 Model No.

Date

G25A

9 October 2011

Manufacturer

Thermo Andersen

Temperature, Ta (K) Pressure, Pa (mmHg) 298

762.3

Plate	Diff.Vol (m³)	Diff.Time (min)	Diff.Hg (mm)	Diff.H ₂ O (in.)
1	1.00	1.3760	3.4	2.00
2	1.00	0.9740	6.4	4.00
_3	1.00	0.8730	7.9	5.00
4	1.00	0.8320	8.6	5.50
5	1.00	0.6890	12.8	8.00

DATA TABULATION

Vstd	(X axis) Qstd	(Y axis)
0.9985	0.7257	1.4163
0.9946	1.0211	2.0030
0.9926	1.1370	2.2394
0.9917	1.1919	2.3487
0.9861	1.4313	2.8326

Y axis= $SQRT[H_2O(Pa/760)(298/Ta)]$

Qstd Slope (m) = 2.00766Intercept (b) = -0.04318

Coefficient (r) = 0.99999

Va	(X axis) Qa	(Y axis)
0.9955	0.7235	0.8842
0.9916	1.0181	1.2505
0.9896	1.1336	1.3981
0.9887	1.1884	1.4664
0.9832	1.4270	1.7685

Y axis= SQRT[H2O(Ta/Pa)]

Qa Slope (m) = 1.25716

intercept (b) = -0.02696

Coefficient (r) = 0.99999

CALCULATIONS

Vstd=Diff. Vol[(Pa-Diff.Hg)/760](298/Ta) Qstd=Vstd/Time Va=Diff.Vol[(Pa-Diff.Hg)/Pa] Qa=Va/Time

For subsequent flow rate calculations: Qstd=I/m{[SQRT(H₂O(Pa/760)(298/Ta))]-b} Qa=I/m{[SQRT H₂O(Ta/Pa)]-b}

> PREPARED AND CHECKED BY: For and On Behalf of WELLAB Ltd.


> > PATRICK TSE

Laboratory Manager

This report may not be reproduced except with prior written approval from WELLAB LIMITED and the results relate only to the items calibrat or tested.



TEST REPORT

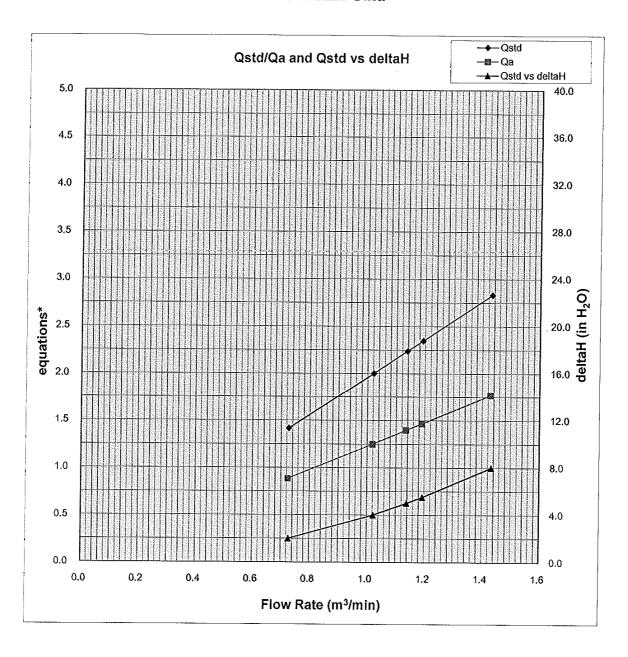

Y-axis equations:

Qstd series: SQRT[\(\triangle H(Pa/Pstd)(Tstd/Ta))]

Qa series: $SQRT[\Delta H(Ta/Pa)]$

This report may not be reproduced except with prior written approval from WELLAB LIMITED and the results relate only to the items calibrat or tested.



WELLAB LIMITED

Rms 816, 1516 & 1701, Technology Park, 18 On Lai Street, Shatin, N.T, Hong Kong. Tel: 2898 7388 Fax: 2898 7076

Website: www.wellab.com.hk

TEST REPORT

APPLICANT:

Cinotech Consultants Limited

Room 1710, Technology Park,

18 On Lai Street,

Shatin, NT, Hong Kong

Test Report No.:	C/N/110906/1
Date of Issue:	2011-09-07
Date Received:	2011-09-06
Date Tested:	2011-09-06
Date Completed:	2011-09-07
Next Due Date	2012-09-06

ATTN:

Mr. Henry Leung

Page:

1 of 1

Certificate of Calibration

Item for calibration:

Description

: 'SVANTEK' Integrating Sound Level Meter

Manufacturer

: SVANTEK

Model No.

: SVAN 957 : 21455

Serial No. Microphone No.

: 43730

Equipment No.

: N-08-07

Test conditions:

Room Temperatre

: 22 degree Celsius

Relative Humidity

: 66%

Test Specifications:

Performance checking at 94 and 114 dB

Methodology:

In-house method, according to manufacturer instruction manual

Results:

Reference Set Point, dB	Instrument Readings, dB
94	94.0
114	114.0

PREPARED AND CHECKED BY:

For and On Behalf of WELLAB Ltd.

PATRICK TSE Laboratory Manager

This report may not be reproduced except with prior written approval from WELLAB LIMITED and the results relate only to the items calibrated or tested.



WELLAB LIMITED

Rms 816, 1516 & 1701, Technology Park, 18 On Lai Street, Shatin, N.T, Hong Kong. Tel: 2898 7388 Fax: 2898 7076

Website: www.wellab.com.hk

TEST REPORT

APPLICANT:

Cinotech Consultants Limited

Room 1710, Technology Park,

18 On Lai Street,

Shatin, NT, Hong Kong

	W0-1-1-10-1-1-1-1-1-1-1-1-1-1-1-1-1-1-1-
Test Report No.:	C/N/111008/1
Date of Issue:	2011-10-10
Date Received:	2011-10-08
Date Tested:	2011-10-08
Date Completed:	2011-10-10

ATTN:

Mr. Henry Leung

Page:

Next Due Date:

1 of 1

2012-10-09

Item for calibration:

Description

: Acoustical Calibrator

Manufacturer

: SVANTEK

Model No.

: SV30A

Serial No.

: 24803

Equipment No.

: N-09-03

Test conditions:

Room Temperatre

: 22 degree Celsius

Relative Humidity

: 62%

Methodology:

The Sound Level Calibrator has been calibrated in accordance with the documented procedures and using standard(s) and instrument(s) which are recommended by the manufacturer, or equivalent.

Results:

Sound Pressure Level (1kHz)	Measured SPL	Tolerance
At 94 dB SPL	94.0	94.0 ± 0.1 dB
At 114 dB SPL	114.0	114.0 ± 0.1 dB

PREPARED AND CHECKED BY:

For and On Behalf of WELLAB Ltd.

PATRICK TSE

Laboratory Manager

This report may not be reproduced except with prior written approval from WELLAB LIMITED and the results relate only to the items calibrated or tested.

APPENDIX C ENVIRONMENTAL MONITORING SCHEDULE

Contract No. DE/2009/09 - Construction of Tai Po Sewage Treatment Works - Stage 5 Phase 2B Impact Air Quality and Noise Monitoring Schedule for January 2012

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
1-Jan	2-Jan	3-Jan	4-Jan	5-Jan	6-Jan	7-Jan
		24 hr TSP	1 hr TSP	1 hr TSP Noise	1 hr TSP	
8-Jan	9-Jan	10-Jan	11-Jan	12-Jan	13-Jan	14-Jan
	24 hr TSP	1 hr TSP	1 hr TSP Noise		1 hr TSP	24 hr TSP
15-Jan	16-Jan	17-Jan	18-Jan	19-Jan	20-Jan	21-Jan
	1 hr TSP	1 hr TSP		1 hr TSP Noise	24 hr TSP	
22-Jan	23-Jan	24-Jan	25-Jan	26-Jan	27-Jan	28-Jan
				1 hr TSP 24 hr TSP	1 hr TSP Noise	
29-Jan	30-Jan	31-Jan	1-Feb	2-Feb	3-Feb	4-Feb
	1 hr TSP	1 hr TSP Noise				

The schedule may be changed due to unforeseen circumstances (adverse weather, etc)

Contract No. DE/2009/09 - Construction of Tai Po Sewage Treatment Works - Stage 5 Phase 2B Tentative Impact Air Quality and Noise Monitoring Schedule for February 2012

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
			1-Feb	2-Feb	3-Feb	4-Feb
			1 hr TSP 24 hr TSP	1 hr TSP Noise	1 hr TSP	
	(7.1		0.77.1	0.7.1	10.77.1	
5-Feb	6-Feb	7-Feb	8-Feb	9-Feb	10-Feb	11-Feb
		1 hr TSP Noise 24 hr TSP	1 hr TSP		1 hr TSP	
12-Feb	13-Feb	14-Feb	15-Feb	16-Feb	17-Feb	18-Feb
	24 hr TSP	1 hr TSP	1 hr TSP	1 hr TSP Noise		24 hr TSP
19-Feb	20-Feb	21-Feb	22-Feb	23-Feb	24-Feb	25-Feb
	1 hr TSP Noise	1 hr TSP		1 hr TSP		
					24 hr TSP	
26-Feb	27-Feb	28-Feb	29-Feb			
	1 hr TSP	1 hr TSP Noise				

The schedule may be changed due to unforeseen circumstances (adverse weather, etc)

APPENDIX D 1-HOUR TSP MONITORING RESULTS AND GRAPHICAL PRESENTATION

Appendix D - 1-hour TSP Monitoring Results

Station CAM1 Government Staff Quarters

Date	Sampling	Weather	Air	Atmospheric	Filter W	eight (g)	Particulate	Elapse	e Time	Sampling	Flow Rate	e (m³/min.)	Av. flow	Total vol.	Conc.
Dale	Time	Condition	Temp. (K)	Pressure (Pa)	Initial	Final	weight (g)	Initial	Final	Time(hrs.)	Initial	Final	(m ³ /min)	(m^3)	$(\mu g/m^3)$
4-Jan-12	13:00	Sunny	286.9	770.3	3.2724	3.2808	0.0084	16913.1	16914.1	1.0	1.25	1.25	1.25	74.7	112
5-Jan-12	09:00	Cloudy	282.9	772.0	3.2623	3.2687	0.0064	16914.1	16915.1	1.0	1.26	1.25	1.26	75.3	85
6-Jan-12	09:00	Cloudy	283.0	771.5	3.3040	3.3108	0.0068	16915.1	16916.1	1.0	1.25	1.25	1.25	75.3	90
10-Jan-12	14:00	Sunny	285.6	771.6	3.2461	3.2548	0.0087	16940.1	16941.1	1.0	1.25	1.25	1.25	75.0	116
11-Jan-12	09:00	Cloudy	288.1	771.6	3.2143	3.2222	0.0079	16941.1	16942.1	1.0	1.24	1.24	1.24	74.7	106
13-Jan-12	09:00	Cloudy	287.6	769.4	3.2906	3.2942	0.0036	16942.1	16943.1	1.0	1.24	1.24	1.24	74.6	48
16-Jan-12	14:00	Cloudy	288.7	761.8	3.3982	3.4051	0.0069	16967.1	16968.1	1.0	1.24	1.24	1.24	74.2	93
17-Jan-12	09:00	Sunny	286.9	766.0	3.2804	3.2877	0.0073	16968.1	16969.1	1.0	1.23	1.23	1.23	73.5	99
19-Jan-12	09:00	Sunny	292.4	764.6	3.1074	3.1121	0.0047	16969.1	16970.1	1.0	1.21	1.21	1.21	72.9	65
26-Jan-12	11:00	Cloudy	283.6	769.1	3.0861	3.0903	0.0042	16994.1	16995.1	1.0	1.23	1.23	1.23	74.0	57
27-Jan-12	16:00	Cloudy	288.5	764.2	3.1081	3.1126	0.0045	17019.1	17020.1	1.0	1.22	1.22	1.22	73.3	61
30-Jan-12	15:00	Sunny	290.6	767.3	3.0771	3.0846	0.0075	17045.1	17046.1	1.0	1.22	1.22	1.22	73.2	102
31-Jan-12	09:00	Sunny	286.3	770.8	3.3178	3.3250	0.0072	17046.1	17047.1	1.0	1.23	1.23	1.23	73.8	98
_	_			_				•		_				Min	48
														Max	116
														Average	87

Station CAM2 Heng Hing Printing Centre

Date	Sampling	Weather	Air	Atmospheric	Filter W	eight (g)	Particulate	Elapse	e Time	Sampling	Flow Rate	e (m³/min.)	Av. flow	Total vol.	Conc.
Dale	Time	Condition	Temp. (K)	Pressure (Pa)	Initial	Final	weight (g)	Initial	Final	Time(hrs.)	Initial	Final	(m ³ /min)	(m^3)	(μg/m ³)
4-Jan-12	13:00	Sunny	286.9	770.3	3.2869	3.2975	0.0106	26087.2	26088.2	1.0	1.25	1.25	1.25	74.7	142
5-Jan-12	09:00	Cloudy	282.9	772.0	3.2760	3.2831	0.0071	26088.2	26089.2	1.0	1.26	1.25	1.25	75.3	94
6-Jan-12	09:00	Cloudy	283.0	771.5	3.2902	3.2976	0.0074	26089.2	26090.2	1.0	1.25	1.25	1.25	75.3	98
10-Jan-12	14:00	Sunny	288.1	771.6	3.2008	3.2147	0.0139	26114.2	26115.2	1.0	1.24	1.24	1.24	74.7	186
11-Jan-12	09:00	Cloudy	288.1	771.6	3.2429	3.2515	0.0086	26115.2	26116.2	1.0	1.24	1.24	1.24	74.7	115
13-Jan-12	09:00	Cloudy	287.6	769.4	3.2703	3.2764	0.0061	26116.2	26117.2	1.0	1.24	1.24	1.24	74.6	82
16-Jan-12	14:00	Cloudy	288.7	761.8	3.3871	3.3941	0.0070	26141.2	26142.2	1.0	1.24	1.24	1.24	74.2	94
17-Jan-12	09:00	Sunny	286.9	766.0	3.2798	3.2860	0.0062	26142.2	26143.2	1.0	1.23	1.23	1.23	73.5	84
19-Jan-12	09:00	Sunny	292.4	764.6	3.1207	3.1276	0.0069	26143.2	26144.2	1.0	1.22	1.21	1.21	72.9	95
26-Jan-12	11:00	Cloudy	283.6	769.1	3.0903	3.0954	0.0051	26168.2	26169.2	1.0	1.23	1.23	1.23	74.1	69
27-Jan-12	16:00	Cloudy	288.5	764.2	3.0990	3.1057	0.0067	26193.2	26194.2	1.0	1.22	1.22	1.22	73.3	91
30-Jan-12	15:00	Sunny	290.6	767.3	3.0687	3.0774	0.0087	26219.2	26220.2	1.0	1.22	1.22	1.22	73.2	119
31-Jan-12	09:00	Sunny	286.3	770.8	3.3216	3.3323	0.0107	26220.2	26221.2	1.0	1.23	1.23	1.23	73.8	145
														Min	69
														Max	186
														Average	109


MA10069/App D - 1hr TSP

Appendix D - 1-hour TSP Monitoring Results

Station CAM3 Talcon Industrial Ltd

Date	Sampling	Weather	Air	Atmospheric	Filter W	eight (g)	Particulate	Elapse	e Time	Sampling	Flow Rate	e (m³/min.)	Av. flow	Total vol.	Conc.
Date	Time	Condition	Temp. (K)	Pressure (Pa)	Initial	Final	weight (g)	Initial	Final	Time(hrs.)	Initial	Final	(m ³ /min)	(m ³)	$(\mu g/m^3)$
4-Jan-12	13:00	Sunny	286.9	770.3	3.2493	3.2603	0.0110	19352.9	19353.9	1.0	1.25	1.25	1.25	75.0	147
5-Jan-12	09:00	Cloudy	282.9	772.0	3.2924	3.3007	0.0083	19353.9	19354.9	1.0	1.26	1.26	1.26	75.6	110
6-Jan-12	09:00	Cloudy	283.0	771.5	3.2574	3.2655	0.0081	19354.9	19355.9	1.0	1.26	1.26	1.26	75.5	107
10-Jan-12	14:00	Sunny	288.1	771.6	3.1908	3.2027	0.0119	19379.9	19380.9	1.0	1.25	1.25	1.25	74.9	159
11-Jan-12	09:00	Cloudy	288.1	771.6	3.2286	3.2403	0.0117	19380.9	19381.9	1.0	1.25	1.25	1.25	74.9	156
13-Jan-12	09:00	Cloudy	287.6	769.4	3.2762	3.2852	0.0090	19381.9	19382.9	1.0	1.25	1.25	1.25	74.9	120
16-Jan-12	14:00	Cloudy	288.7	761.8	3.2592	3.2651	0.0059	19406.9	19407.9	1.0	1.24	1.24	1.24	74.4	79
17-Jan-12	09:00	Sunny	286.9	766.0	3.2682	3.2764	0.0082	19407.9	19408.9	1.0	1.22	1.22	1.22	73.1	112
19-Jan-12	09:00	Sunny	292.4	764.6	3.1096	3.1176	0.0080	19408.9	19409.9	1.0	1.21	1.21	1.21	72.4	111
26-Jan-12	11:00	Cloudy	283.6	769.1	3.0876	3.0950	0.0074	19433.9	19434.9	1.0	1.23	1.23	1.23	73.6	101
27-Jan-12	16:00	Cloudy	288.5	764.2	3.0926	3.1006	0.0080	19458.9	19459.9	1.0	1.21	1.21	1.21	72.8	110
30-Jan-12	15:00	Sunny	290.6	767.3	3.0963	3.1056	0.0093	19484.9	19485.9	1.0	1.21	1.21	1.21	72.7	128
31-Jan-12	09:00	Sunny	286.3	770.8	3.3079	3.3159	0.0080	19485.9	19486.9	1.0	1.22	1.22	1.22	73.4	109
			_								_			Min	79
														Max	159
														Average	119

MA10069/App D - 1hr TSP

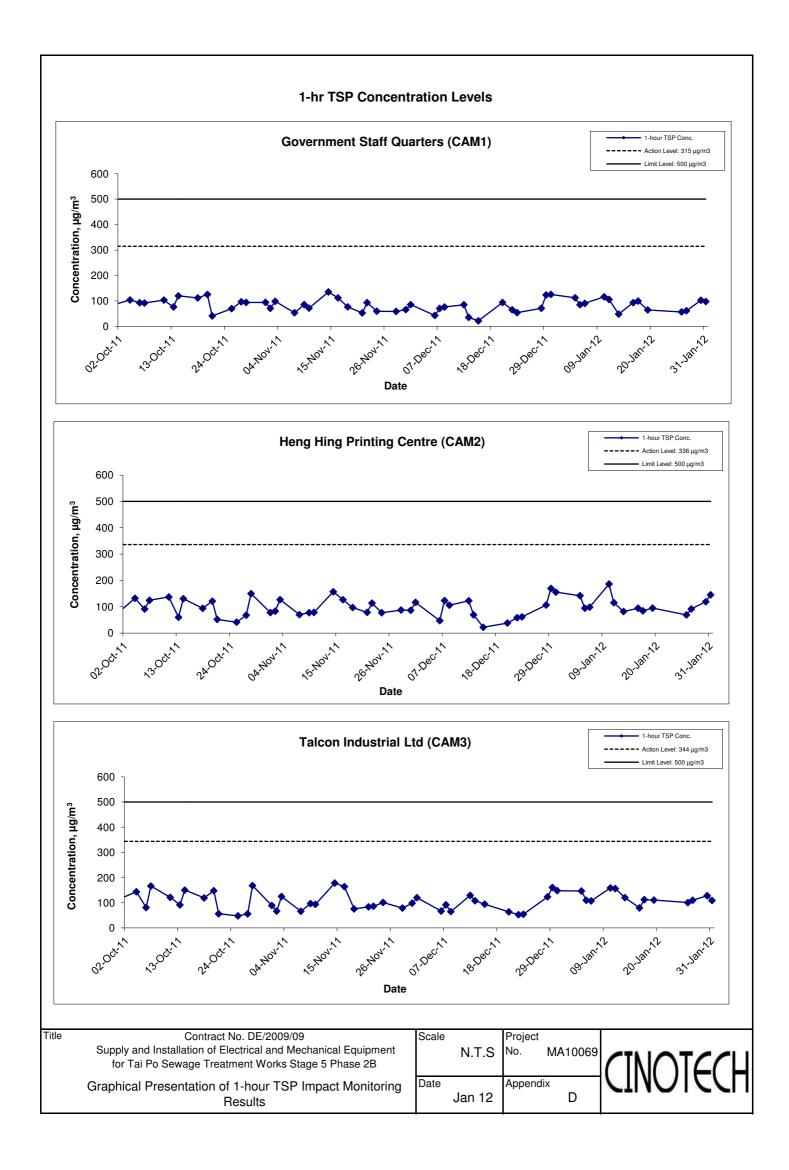

APPENDIX E 24-HOUR TSP MONITORING RESULTS AND GRAPHICAL PRESENTATION

Appendix E - 24-hour TSP Monitoring Results

Station CAM1 Government Staff Quarters


Start Date	Weather	Air	Atmospheric	Filter W	eight (g)	Particulate	Elapse	e Time	Sampling	Flow Rate	e (m³/min.)	Av. flow	Total vol.	Conc.
Start Date	Condition	Temp. (K)	Pressure (Pa)	Initial	Final	weight (g)	Initial	Final	Time(hrs.)	Initial	Final	(m ³ /min)	(m^3)	$(\mu g/m^3)$
3-Jan-12	Sunny	288.9	769.4	3.2263	3.3116	0.0853	16889.1	16913.1	24.0	1.24	1.24	1.24	1787.3	48
9-Jan-12	Sunny	285.7	771.7	3.2597	3.3630	0.1033	16916.1	16940.1	24.0	1.25	1.25	1.25	1799.0	57
14-Jan-12	Cloudy	289.9	765.3	3.2298	3.2827	0.0529	16943.1	16967.1	24.0	1.24	1.24	1.24	1780.0	30
20-Jan-12	Sunny	289.5	766.0	3.1202	3.2257	0.1055	16970.1	16994.1	24.0	1.22	1.22	1.22	1757.8	60
26-Jan-12	Cloudy	286.3	766.7	3.1007	3.1951	0.0944	16995.1	17019.1	24.0	1.23	1.22	1.23	1767.1	53
													Min	30
													Max	60
													Average	50

Station CAM2 Heng Hing Printing Centre

Start Date	Weather	Air	Atmospheric	Filter W	eight (g)	Particulate	Elaps	e Time	Sampling	Flow Rate	e (m³/min.)	Av. flow	Total vol.	Conc.
Start Date	Condition	Temp. (K)	Pressure (Pa)	Initial	Final	weight (g)	Initial	Final	Time(hrs.)	Initial	Final	(m ³ /min)	(m^3)	$(\mu g/m^3)$
3-Jan-12	Sunny	288.9	769.4	3.2309	3.3385	0.1076	26063.2	26087.2	24.0	1.24	1.24	1.24	1787.4	60
9-Jan-12	Sunny	285.7	771.7	3.2517	3.4192	0.1675	26090.2	26114.2	24.0	1.25	1.25	1.25	1798.8	93
14-Jan-12	Cloudy	289.9	765.3	3.2496	3.3377	0.0881	26117.2	26141.2	24.0	1.24	1.24	1.24	1780.3	49
20-Jan-12	Sunny	289.5	766.0	3.0991	3.2216	0.1225	26144.2	26168.2	24.0	1.22	1.22	1.22	1758.2	70
26-Jan-12	Cloudy	286.3	766.7	3.1013	3.2361	0.1348	26169.2	26193.2	24.0	1.23	1.22	1.23	1767.4	76
													Min	49
													Max	93
													Average	70

Station CAM3 Talcon Industrial Ltd

Start Date	Weather	Air	Atmospheric	Filter W	eight (g)	Particulate	Elapse	Time	Sampling	Flow Rate	(m³/min.)	Av. flow	Total vol.	Conc.
Start Date	Condition	Temp. (K)	Pressure (Pa)	Initial	Final	weight (g)	Initial	Final	Time(hrs.)	Initial	Final	(m ³ /min)	(m^3)	$(\mu g/m^3)$
3-Jan-12	Sunny	288.9	769.4	3.2434	3.3578	0.1144	19328.9	19352.9	24.0	1.25	1.25	1.25	1793.6	64
9-Jan-12	Sunny	285.7	771.7	3.2513	3.3650	0.1137	19355.9	19379.9	24.0	1.25	1.25	1.25	1805.1	63
14-Jan-12	Cloudy	289.9	765.3	3.2562	3.3538	0.0976	19382.9	19406.9	24.0	1.24	1.24	1.24	1786.4	55
20-Jan-12	Sunny	289.5	766.0	3.0970	3.2171	0.1201	19409.9	19433.9	24.0	1.21	1.21	1.21	1746.5	69
26-Jan-12	Cloudy	286.3	766.7	3.0874	3.1913	0.1039	19434.9	19458.9	24.0	1.22	1.22	1.22	1756.4	59
													Min	55
													Max	69
													Average	62

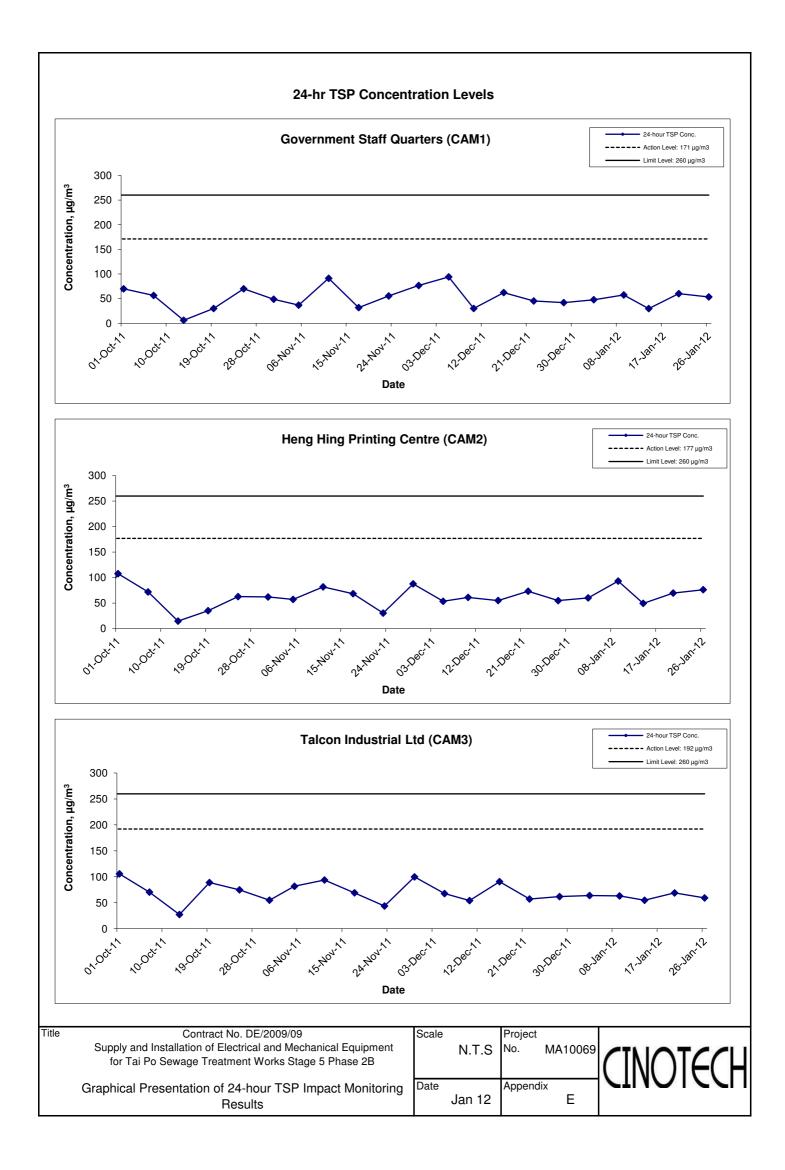


APPENDIX F NOISE MONITORING RESULTS AND GRAPHICAL PRESENTATION

Appendix F - Noise Monitoring Results

Location NM1	- Governme	ent Staff Quar	ters		
Dete	Times	\\/aatlaau	dB	(A) (30-min))
Date	Time	Weather	L _{eq}	L ₁₀	L 90
5-Jan-12	9:45	Cloudy	58.9	59.9	52.6
11-Jan-12	13:05	Cloudy	55.7	56.9	52.4
19-Jan-12	9:00	Sunny	54.1	56.2	53.8
27-Jan-12	14:00	Sunny	55.6	57.8	54.0
31-Jan-12	13:00	Sunny	56.5	59.3	52.8
		Average	56.2	58.0	53.1
		Minimum	54.1	56.2	52.4
		Maximum	58.9	59.9	54.0

MA10069/App F - Noise Cinotech

Noise Levels

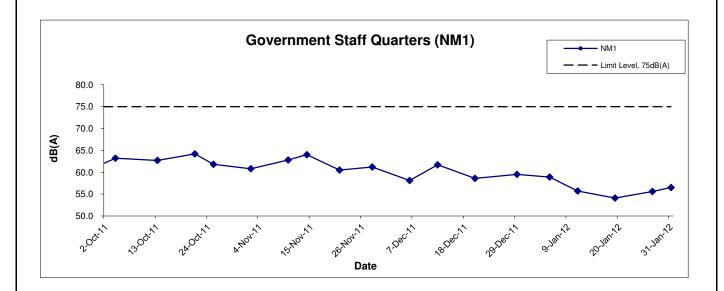

Title Contract No. DE/2009/09
Supply and Installation of Electrical and Mechanical Equipment
for Tai Po Sewage Treatment Works Stage 5 Phase 2B

Graphical Presentation of Construction Noise Monitoring Results

Scale Project
No.
N.T.S MA10069

Date Appendix
Jan 12 F



APPENDIX G SUMMARY OF EXCEEDANCE

APPENIDX G - SUMMARY OF EXCEEDANCE

Reporting Month: January 2012

- a) Exceedance Report for 1-hr TSP (NIL)
- b) Exceedance Report for 24-hr TSP (NIL)
- c) Exceedance Report for Construction Noise (NIL)

APPENDIX H SITE AUDIT SUMMARY

Contract No. DE/2009/09

Supply and Installation of Electrical ad Mechanical Equipment for Tai Po Sewage Treatment Works Stage 5 Phase 2B

Record Summary of Environmental Site Inspection

Non-Compliance

None identified

Inspection Information

Ref. No.

Checklist Reference Number	120105
Date	5 th January 2012 (Thursday)
Time	09:30-10:00

Related Item No.

Ref. No.	Remarks/Observations	Related Item No.
	Part C - Water Quality	
	No environmental deficiency was identified during the site inspection.	
	Part D - Air Quality	
	No environmental deficiency was identified during the site inspection.	
	Part E - Noise	
	No environmental deficiency was identified during the site inspection.	
	Part F - Waste / Chemical Management	
	No environmental deficiency was identified during the site inspection.	
	Part G - Permit / Licenses	
	No environmental deficiency was identified during the site inspection.	
	Part H - Remark	
	No environmental deficiency was identified during the site inspection.	
	Others	

	Name	Signature	Date
Recorded by	Mr. William Lai	lasto	5 January 2012
Checked by	Dr. Priscilla Choy	MZ	5 January 2012
Спескей бу		W7	3 January 2012

 Follow-up on the previous audit sessions (Ref. No.111229), no environmental deficiency was identified during the site inspection.

CINOTECH MA10069 120106_audit120105

Contract No. DE/2009/09

Supply and Installation of Electrical ad Mechanical Equipment for

Tai Po Sewage Treatment Works Stage 5 Phase 2B

Record Summary of Environmental Site Inspection

Inspection Information

Checklist Reference Number	120113
Date	13 th January 2012 (Friday)
Time	09:30-10:00

Ref. No.	Non-Compliance	Related Item No.
<u>-</u>	None identified	-

Ref. No.	Remarks/Observations	Related Item No.
	Part C - Water Quality	
	No environmental deficiency was identified during the site inspection.	
	Part D - Air Quality	
	No environmental deficiency was identified during the site inspection.	
!	Part E - Noise	
	No environmental deficiency was identified during the site inspection.	
120113-R01	Part F - Waste / Chemical Management C&D waste should be cleaned regularly in the receptacles outside the site office.	Flii
	Part G - Permit / Licenses	
	No environmental deficiency was identified during the site inspection.	
	Part H - Remark	· ·
	No environmental deficiency was identified during the site inspection.	
	Others	
	• Follow-up on the previous audit sessions (Ref. No.120105), no environmental deficiency was identified during the site inspection.	

	Name	Signature	Date
Recorded by	Mr. William Lai	GA	13 January 2012
Checked by	Dr. Priscilla Choy	W.	13 January 2012

CINOTECH MA10069 120106_audit120105

Contract No. DE/2009/09

Supply and Installation of Electrical ad Mechanical Equipment for

Tai Po Sewage Treatment Works Stage 5 Phase 2B

Record Summary of Environmental Site Inspection

Inspection Information

Checklist Reference Number	120120	
Date	20 th January 2012 (Friday)	
Time	11:00-11:45	

Ref. No.	Non-Compliance	Related Item No.
**	None identified	-

Ref. No. Remarks/Observations Related Item No. Part C - Water Quality 120120-R01 • Stagnant water should be collected at FC12B. C8 Part D - Air Quality • No environmental deficiency was identified during the site inspection. Part E - Noise • No environmental deficiency was identified during the site inspection. Part F - Waste / Chemical Management • No environmental deficiency was identified during the site inspection. Part G - Permit / Licenses • No environmental deficiency was identified during the site inspection. Part H - Remark • No environmental deficiency was identified during the site inspection. Others • Follow-up on the previous audit sessions (Ref. No.120113), no environmental deficiency was identified during the site inspection.

	Name	Signature	Date
Recorded by	Mr. William Lai	646	20 January 2012
Checked by	Dr. Priscilla Choy	WT	20 January 2012

CINOTECH MA10069 120120_audit120120

Supply and Installation of Electrical ad Mechanical Equipment for

Tai Po Sewage Treatment Works Stage 5 Phase 2B

Record Summary of Environmental Site Inspection

Inspection Information

Checklist Reference Number	120126
Date	26 th January 2012 (Friday)
Time	09:40-10:30

Ref. No.	Non-Compliance	Related Item No.
-	None identified	-

Ref. No. Remarks/Observations

Related Item No.

Part C - Water Quality

No environmental deficiency was identified during the site inspection.

Part D - Air Quality

• No environmental deficiency was identified during the site inspection.

Part E - Noise

• No environmental deficiency was identified during the site inspection.

Part F - Waste / Chemical Management

• No environmental deficiency was identified during the site inspection.

Part G - Permit / Licenses

• No environmental deficiency was identified during the site inspection.

Part H - Remark

· No environmental deficiency was identified during the site inspection.

Others

• Follow-up on the previous audit sessions (Ref. No.120120), no environmental deficiency was identified during the site inspection.

	Name	Signature	Date
Recorded by	Mr. William Lai	1 gt	26 January 2012
Checked by	Dr. Priscilla Choy	WZ	26 January 2012

CINOTECH MA10069 120127_audit120126

APPENDIX I EVENT ACTION PLANS

APPENDIX I (1) – Event Action Plan for Air Quality Monitoring (Construction Phase)

EVENT	ACTION								
EVENT	ET	IEC	ER	CONTRACTOR					
ACTION LEVEL									
Exceedance for one sample	Identify source, investigate the causes of exceedance and propose remedial measures; Inform IEC and ER; Repeat measurement to confirm finding; Increase monitoring frequency to daily.	Check monitoring data submitted by ET; Check Contractor's working method.	1. Notify Contractor.	Rectify any unacceptable practice; Amend working methods if appropriate.					
Exceedance for two or more consecutive samples	 Identify source; Inform IC(E) and ER; Advise the ER on the effectiveness of the proposed remedial measures; Repeat measurements to confirm findings; Increase monitoring frequency to daily; Discuss with IEC and Contractor on remedial actions required; If exceedance continues, arrange meeting with IEC and ER; If exceedance stops, cease additional monitoring. 	 Check monitoring data submitted by ET; Check Contractor's working method; Discuss with ET and Contractor on possible remedial measures; Advise the ET on the effectiveness of the proposed remedial measures; Supervise Implementation of remedial measures. 	Confirm receipt of notification of exceedance in writing; Ensure remedial measures properly implemented.	Submit proposals for remedial actions to IEC within three working days of notification; Implement the agreed proposals; Amend proposal if appropriate.					
LIMIT LEVEL									
Exceedance for one sample	Identify source, investigate the causes of exceedance and propose remedial measures; Inform Contractor, IEC, ER, and EPD; Repeat measurement to confirm finding; Increase monitoring frequency to daily; Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results.	Check monitoring data submitted by ET; Check Contractor's working method; Discuss with ET and Contractor on possible remedial measures; Advise the ER on the effectiveness of the proposed remedial measures; Supervise implementation of remedial measures.	Confirm receipt of notification of exceedance in writing; Notify Contractor; Ensure remedial measures properly implemented.	Take immediate action to avoid further exceedance; Submit proposals for remedial actions to IEC within three working days of notification; Implement the agreed proposals; 4. Amend proposal if appropriate.					
Exceedance for two or more consecutive samples	 Notify IEC, ER, Contractor and EPD; Identify source; Repeat measurement to confirm findings; Increase monitoring frequency to daily; Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented; Arrange meeting with IEC and ER to discuss the remedial actions to be taken; Assess effectiveness of Contractor's remedial actions and keep IC(E), EPD and ER informed of the results; If exceedance stops, cease additional monitoring. 	Discuss amongst ER, ET, and Contractor on the potential remedial actions; Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly; Supervise the implementation of remedial measures.	1. Confirm receipt of notification of exceedance in writing; 2. Notify Contractor; 3. In consolidation with the IEC, agree with the Contractor on the remedial measures to be implemented; 4. Ensure remedial measures properly implemented; 5. If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop that portion of work until the exceedance is abated.	Take immediate action to avoid further exceedance; Submit proposals for remedial actions to IEC within three working days of notification; Implement the agreed proposals; Resubmit proposals if problem still not under control; Stop the relevant portion of works as determined by the ER until the exceedance is abated.					

APPENDIX I (2) – Event Action Plan for Construction Noise Monitoring (Construction Phase)

EVENT	ACTION							
EVENI	ET	IEC	ER	CONTRACTOR				
ACTION LEVEL	 Notify IEC and Contractor; Carry out investigation; Report the results of investigation to the IEC, ER and Contractor; Discuss with the Contractor and formulate remedial measures; Increase monitoring frequency to check mitigation effectiveness. 	 Review the analyzed results submitted by the ET; Review the propose d remedial measures by the Contractor and advise the ER accordingly; Supervise the implementation of remedial measures. 	1.Confirm receipt of notification of failure in writing; 2.Notify Contractor; 3.Require Contractor to propose remedial measures for the analyzed noise problem; 4.Ensure remedial measures are properly implemented.	 Submit noise mitigation proposals to IEC; Implement noise mitigation proposals. 				
LIMIT LEVEL	 Identify source; Inform IEC, ER, EPD and Contractor; Repeat measurements to confirm findings; Increase monitoring frequency; Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented; Inform IEC, ER and EPD the causes and actions taken for the exceedances; Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results; If exceedance stops, cease additional monitoring. 	Discuss amongst ER, ET, and Contractor on the potential remedial actions; Review Contractors remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly; Supervise the implementation of remedial measures.	1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. Require Contractor to propose remedial measures for the analysed noise problem; 4. Ensure remedial measures properly implemented; 5. If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop that portion of work until the exceedance is abated.	 Take immediate action to avoid further exceedance; Submit proposals for remedial actions to IEC within 3 working days of notification; Implement the agreed proposals; Resubmit proposals if problem still not under control; Stop the relevant portion of works as determined by the ER until the exceedance is abated. 				

APPENDIX J UPDATED ENVIRONMENTAL MITIGATION IMPLEMENTATION SCHEDULE

APPENDIX J – Updated Environmental Mitigation Implementation Schedule (During Construction Phase)

Type of Impact	Recommended Mitigation Measures	Status				
Air Quality	Dust mitigation measures stipulated in <i>the Air Pollution Control (Construction Dust) Regulation</i> shall be incorporated to control dust emission. Notice shall be given to authority prior to commencing of work					
Noise	Use of quiet PME	N/A				
	 Good Site Practice Only well-maintained plant should be operated on-site and plant should be serviced regularly during the construction program; Silencers or mufflers on construction equipment should be utilized and should be properly maintained during the construction program; Mobile plant, if any, should be sited as far from NSRs as possible; Machines and plant (such as trucks) that may be in intermittent use should be shut down between work periods or should be throttled down to a minimum; Plant known to emit noise strongly in one direction should, wherever possible, be orientated so that the noise is directed away from the nearby NSRs; and Material stockpiles and other structures should be effectively utilised, wherever practicable, in screening noise from on-site construction activities. 	V				
Water Quality	The practices outlined in ProPECC PN 1/94 Construction Site Drainage should be adopted to minimize the potential water quality impacts from construction site runoff and various construction activities. The recommendation to install perimeter drains to collect site runoff and to properly treat the runoff by settlement tank/treatment system shall apply to all sites including those for mainlaying works. Minimum distances of 100 m should be maintained between the discharge points of construction site runoff and the existing WSD saltwater intake at Tai Po.	V				
	A discharge licence needs to be applied from EPD for discharging effluent from the construction site. The discharge quality is required to meet the requirements specified in the discharge licence. All the runoff and wastewater generated from the works areas should be treated so that it satisfies with all the standards listed in the TM. Reuse and recycling of the treated effluent can minimize water consumption and reduce the effluent discharge volume. The beneficial uses of the treated effluent may include dust suppression, wheel washing and general cleaning. Monitoring of the discharge quality of treated effluent should be part of the Environmental Monitoring and Audit (EM&A) programme. Detailed effluent sampling programme for water quality control during construction phase should be submitted to EPD, AFCD and WSD for approval prior to commencement of the construction works.	V				
	The construction programme should be properly planned to minimize soil excavation, if any, in rainy seasons. This prevents soil erosion from exposed soil surfaces. Any exposed soil surfaces should also be properly protected to minimize dust emission. In areas where a large amount of exposed soils exist, earth bunds or sand bags should be provided. Exposed stockpiles should be covered with tarpaulin or impervious sheets at all time. The stockpiles of materials should be placed in the locations away from any stream courses so as to avoid releasing materials into the water bodies. Final surfaces of earthworks should be compacted and protected by permanent work. It is suggested that haul roads should be paved with concrete and the temporary access roads are protected using crushed stone or gravel, wherever practicable. Wheel washing facilities should be provided at all site exits to ensure that earth, mud and debris would not be carried out of the works areas by vehicles.	V				
	Good site practices should be adopted to clean the rubbish and litter on the construction sites so as to prevent the rubbish and litter from dropping into the nearby environment. It is recommended to clean the construction sites on a regular basis.	V				

Type of Impact	Recommended Mitigation Measures	Status
	It is recommended to provide sufficient chemical toilets in the works areas. The toilet facilities should not be less than 30 m from any watercourse. A licensed waste collector should be deployed to clean the chemical toilets on a regular basis. The construction workers can also make use of the existing toilet facilities within the TPSTW as necessary.	√
	Notices should be posted at conspicuous locations to remind the workers not to discharge any sewage or wastewater into the nearby environment during the construction phase of the project. Implementation of environmental audit on the construction site can provide an effective control of any malpractices and can achieve continual improvement of environmental performance on site.	V
	It is required to register as a chemical waste producer if chemical wastes would be produced from the construction activities. The Waste Disposal Ordinance (Cap 354) and its subsidiary regulations in particular the Waste Disposal (Chemical Waste) (General) Regulation should be observed and complied with for control of chemical wastes.	√
	Any service shop and minor maintenance facilities should be located on hard standings within a bunded area, and sumps and oil interceptors should be provided. Maintenance of vehicles and equipment involving activities with potential for leakage and spillage should only be undertaken with the areas appropriately equipped to control these discharges.	√
	Disposal of chemical wastes should be carried out in compliance with the Waste Disposal Ordinance. The Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes published under the Waste Disposal Ordinance details the requirements to deal with chemical wastes. General requirements are given as follows: • Suitable containers should be used to hold the chemical wastes to avoid leakage or spillage during storage, handling and transport • Chemical waste containers should be suitably labelled to notify and warn the personnel who are handling the wastes to avoid accidents. • Storage area should be selected at a safe location on site and adequate space should be allocated to the storage area.	V
	Marine water quality monitoring should be carried out under emergency condition or during maintenance of the THEES tunnel to verify the findings of the water quality modelling. It is recommended that the maintenance of the THEES tunnel, if unavoidable, should be conducted during winter season or low flow periods and to avoid the "blooming" season of algae (normally from April to June) if practicable. Details of the monitoring requirements are specified in the EM&A Manual.	N/A

Type of Impact	Recommended Mitigation Measures	Status				
Waste	Good site practices during the construction activities include:	√				
Management	Nomination of approved personnel, such as a site manager, to be responsible for good site					
	practices, arrangements for collection and effective disposal to an appropriate facility, of all					
	wastes generated at the site.					
	Training of site personnel in proper waste management and chemical waste handling procedures.					
	Provision of sufficient waste disposal points and regular collection for disposal.					
	Appropriate measures to minimise windblown litter and dust during transportation of waste by					
	either covering trucks or by transporting wastes in enclosed containers.					
	Separation of chemical wastes for special handling and appropriate treatment at the Chemical					
	Waste Treatment Facility.					
	Regular cleaning and maintenance programme for drainage systems, sumps and oil interceptors.					
	A Waste Management Plan shall be prepared and this WMP shall be submitted to the Engineer					
	for approval. One may make reference to ETWB TCW No. 15/2003 for details.					
	• In order to monitor the disposal of C&D materials at landfills and public filling areas, and to					
	control fly tipping, a trip-ticket system shall be included as one of the contractual requirements					
	and implemented by an Environmental Team undertaking the Environmental Monitoring and					
	Audit work. One may make reference to WBTC No. 21/2002 for details.					
	A recording system for the amount of wastes generated, recycled and disposed (including the					
	disposal sites) shall be proposed.					
	Waste reduction is best achieved at the planning and design stage, as well as by ensuring the	√				
	implementation of good site practices. Recommendations to achieve waste reduction include:					
	Segregation and storage of different types of waste in different containers, skips or stockpiles to					
	enhance reuse or recycling of materials and their proper disposal.					
	To encourage collection of aluminum cans by individual collectors, separate labelled bins shall be					
	provided to segregate this waste from other general refuse generated by the work force.					
	Any unused chemicals or those with remaining functional capacity shall be recycled.					
	Maximize the use of reusable steel formwork to reduce the amount of C&D material.					
	Prior to disposal of C&D waste, it is recommended that wood, steel and other metals shall be					
	separated for re-use and / or recycling to minimize the quantity of waste to be disposed of to					
	landfill.					
	Proper storage and site practices to minimize the potential for damage or contamination of					
	construction materials.					
	Plan and stock construction materials carefully to minimize amount of waste generated and avoid					
	unnecessary generation of waste.					
	Minimize over ordering of concrete, mortars and cement grout by doing careful check before					
	ordering					
	General Refuse	√				
	General refuse shall be stored in enclosed bins or compaction units separate from C&D material. A					
	reputable waste collector shall be employed by the contractor to remove general refuse from the site,					
	separately from C&D material. An enclosed and covered area is preferred to reduce the occurrence					
	of 'wind blown' light material.					
	Construction & Demolition (C&D) Material	√				
	C&D material generated from the site formation and demolition works shall be sorted on-site into					
	inert C&D material (i.e. public fill) and C&D waste. In order to minimise the impact resulting from					
	collection and transportation of C&D material for off-site disposal, the excavated material					
	comprising fill material shall be reused on-site as backfilling material as far as practicable. C&D					
	waste, such as wood, plastic, steel and other metals shall be reused or recycled and, as a last resort,					
	disposed of to landfill. A suitable area shall be designated within the site for temporary stockpiling of					
	C&D material and to facilitate the sorting process.					

Monthly EM&A Report

Type of Impact	Recommended Mitigation Measures	Status
	Bentonite Slurry	N/A
	Bentonite slurries used in construction works should be reconditioned and reused wherever	
	practicable. Residual used bentonite slurry should be disposed of from the site as soon as possible.	
	The Contractor should explore alternative disposal outlets for the residual used bentonite slurry and	
	disposal at landfill should be the last resort.	

Note:
√ -

 $\sqrt{}$ – Compliance of mitigation measures X – Non-compliance of mitigation measures N/A – Not applicable

APPENDIX K
WASTE GENERATION IN THE
REPORTING MONTH

APPENDIX K - WASTE GENERATION IN THE REPORTING MONTH

Monthly Summary Waste Flow Table January 2012 (Year)

	Actual Quantities of Inert C&D Materials Generated Monthly				Actual Quantities of C&D Wastes Generated Monthly						
Month	Total Quantity Generated	Broken Concrete (see Note 3)	Reused in the Contract	Reused in other Projects	Disposed as Public Fill	Imported Fill	Metals	Paper/ cardboard packaging	Plastic (see Note 2)	Chemical Waste	Others, e.g. general refuse
	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000m ³)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000m3)
Jan	0	0	0	0	0	0	0	0	0	0	3.9
Feb											
Mar											
Apr											
May											
June											
Sub-total											
July											
Aug											
Sept											
Oct											
Nov											
Dec											
Total											

Notes:

- (1) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (2) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material.
- (3) Broken concrete for recycling into aggregates.

APPENDIX L COMPLAINT LOG

APPENDIX L - COMPLAINT LOG

Reporting Month: January 2012

Log Ref.	Location Received Date		Details of Complaint	Investigation/Mitigation Action	Status
N/A	N/A	N/A	N/A	N/A	N/A

Remarks: No environmental complaint was received in the reporting month.

APPENDIX M CONSTRUCTION PROGRAMME

DSD Contract : DE/2009/09 Supply and Installation of Electrical and Mechanical Equipment for Tai Po Sewage Treatment Works Stage 5 Phase 2B Section V Works Programme | Task Name | 201 | SAS Thickening System | 202 | Equipment & Material Delivery to Site 336 days Wed 01/02/12 Tue 01/01/13 155 days Wed 01/02/12 Thu 05/07/12 0 days Thu 05/07/12 Thu 05/07/12 0 days Wed 01/02/12 Wed 01/02/12 Centrifuge SAS Feed Pump 0 days Wed 01/02/12 Wed 01/02/12 0 days Thu 01/03/12 Thu 01/03/12 Polyelectrolyte Feed Pump Thickened Sludge Storage Tank 0 days Wed 01/02/12 Wed 01/02/12 Pipework & Valves 0 days Wed 22/02/12 Wed 22/02/12 Vibration Monitoring System PLC System M Panel 0 days Thu 01/03/12 Thu 01/03/12 Site Possession / Available Civil Works Provision (By Civil Contractor) 0 days Thu 01/03/12 Thu 01/03/12 0 days Thu 01/03/12 Thu 01/03/12 217 days Thu 01/03/12 Wed 03/10/12 Installation Centrifuge, Vibration Monitoring System & Associated Accessories 30 days Thu 05/07/12 Fri 03/08/12 SAS Feed Pump & Associated Pipework Polyelectrolyte Feed Pump & Associated Pipework 16 days Mon 03/09/12 Tue 18/09/12 Thickened Sludge Storage Tank & Associated Access 30 days Sat 04/08/12 Sun 02/09/12 Centrate Pipework 16 days Mon 03/09/12 Tue 18/09/12 Existing L.V. Switchboard Modification 90 days Thu 01/03/12 Tue 29/05/12 90 days Fri 06/07/12 Wed 03/10/12 60 days Sun 05/08/12 Wed 03/10/12 Electrical Installation SCADA/PLC System Testing & Commissioning 90 days Thu 04/10/12 Tue 01/01/13 362 days Tue 01/11/11 Sat 27/10/12 223 Sludge Dewatering System