

## Proposed 11kV Submarine Cables Replacement Connecting Liu Ko Ngam and Pak Sha Tau Tsui at Kat O - Environmental Monitoring & Audit

*Bi-weekly Impact Water Quality Monitoring Report*

1 February 2016

Submitted by  
**Environmental Resources Management**  
16/F Berkshire House  
25 Westlands Road  
Quarry Bay, Hong Kong  
Telephone 2271 3000  
Facsimile 2723 5660

[www.erm.com](http://www.erm.com)






# Proposed 11kV Submarine Cables Replacement Connecting Liu Ko Ngam and Pak Sha Tau Tsui at Kat O - Environmental Monitoring & Audit

**Environmental Resources Management**

16/F Berkshire House  
25 Westlands Road  
Quarry Bay, Hong Kong  
Telephone: (852) 2271 3000  
Facsimile: (852) 2723 5660  
E-mail: post.hk@erm.com  
http://www.erm.com

## Bi-weekly Impact Water Quality Monitoring Report

**Document Code: 0259952\_Bi-weekly Impact Monitoring Report for Fourth and Fifth Week Water Quality Monitoring.doc**

Client:  CLP Power Hong Kong Limited (CLP)		Project No:  0259952			
Summary:  This document presents the monitoring requirements, methodologies and results of the fourth and fifth week impact water quality measurements at the monitoring locations near the proposed 11kV submarine cables replacement connecting Liu Ko Ngam and Pak Sha Tau Tsui at Kat O.		Date: 1 February 2016			
		Approved by:    Terence Fong Partner			
v0	Bi-weekly Impact Water Quality Monitoring Report (Fourth and Fifth Week)	YL	FZ	TF	1/2/16
Revision	Description	By	Checked	Approved	Date
<p>This report has been prepared by Environmental Resources Management the trading name of 'ERM Hong-Kong, Limited', with all reasonable skill, care and diligence within the terms of the Contract with the client, incorporating our General Terms and Conditions of Business and taking account of the resources devoted to it by agreement with the client.</p> <p>We disclaim any responsibility to the client and others in respect of any matters outside the scope of the above.</p> <p>This report is confidential to the client and we accept no responsibility of whatsoever nature to third parties to whom this report, or any part thereof, is made known. Any such party relies on the report at their own risk.</p>		<p>Distribution</p> <p><input type="checkbox"/> Internal</p> <p><input checked="" type="checkbox"/> Public</p> <p><input type="checkbox"/> Confidential</p>			
		 			



**Proposed 11kV Submarine Cables Replacement Connecting Liu Ko Ngam  
and Pak Sha Tau Tsui at Kat O - Environmental Monitoring & Audit  
Environmental Certification Sheet  
EP-461/2013**


**Reference Document/Plan**

Document/ <del>Plan to be Certified</del> / Verified:	Bi-weekly Impact Monitoring Report for Fourth and Fifth Week Impact Water Quality Monitoring
Date of Report:	1 February 2016
Date prepared by Environmental Team:	1 February 2016
Date received by IC:	1 February 2016

**Reference Project Profile Annex E EM&A Requirement and EP Requirement**

EM&A Requirement:	Project Profile, Annex E EM&A Requirements, Section E1
Content:	<i>Water Quality Monitoring and Reporting</i>
E.1.3	“Impact Monitoring will comprise sampling two times a week during the cable installation works at the same location as the Baseline Monitoring Stations. Samples shall be taken during both mid flood and mid ebb tidal states on each sampling occasion...In case the Impact Monitoring is ceased with reasons such as the operations of the cable installation has no disturbance of seabed or the works are suspended due to safety issue or adverse weather conditions etc. for more than 1 week. The Contractor should send a confirmation letter to EPD and AFCD 1 week before the cessation of Impact Monitoring.”
E.1.5	“Schedule for impact monitoring should be submitted to EPD and AFCD at least 1 week before commencement of the monitoring works for agreement. A letter report shall be provided to EPD and AFCD that shall include the monitoring results and an interpretation of monitoring results. The monitoring data should be provided graphically to show the relationship between the Control, Gradient and Impact Stations and compliance or noncompliance with respect to the Action/Limit Levels.... An Impact Monitoring Report shall be provided within one week of completing every weekly monitoring survey for the first three impact monitoring weeks. If there are no exceedances recorded during the first three weeks, a Bi-weekly Impact Monitoring Report shall be provided within 1 week of completing every two weekly monitoring surveys.”
EP Condition:	Condition No. 2.1
Content:	<i>Water Quality Monitoring</i>
2.1	All measures described in the Project Profile (No. PP-489/2013) submitted by the applicant on 30 May 2013 shall be fully implemented.

**IC Verification**

I hereby verify that the above referenced document/ <del>plan</del> complies with the above referenced condition of EP-461/2013.	
	
Terence Fong, Independent Checker	Date: 1 February 2016

## CONTENTS

	<i>EXECUTIVE SUMMARY</i>	<i>i</i>
<b>1</b>	<b>INTRODUCTION</b>	<b>1</b>
<b>1.1</b>	<b>PURPOSE OF THE REPORT</b>	<b>1</b>
<b>1.2</b>	<b>STRUCTURE OF THE REPORT</b>	<b>1</b>
<b>2</b>	<b>PROJECT INFORMATION</b>	<b>2</b>
<b>2.1</b>	<b>BACKGROUND</b>	<b>2</b>
<b>2.2</b>	<b>MARINE CONSTRUCTION WORKS UNDERTAKEN DURING REPORTING WEEK</b>	<b>3</b>
<b>2.3</b>	<b>STATUS OF ENVIRONMENTAL APPROVAL DOCUMENTS</b>	<b>3</b>
<b>3</b>	<b>IMPACT WATER QUALITY MONITORING REQUIREMENTS</b>	<b>4</b>
<b>3.1</b>	<b>MONITORING LOCATIONS</b>	<b>4</b>
<b>3.2</b>	<b>MONITORING PARAMETERS</b>	<b>5</b>
<b>3.3</b>	<b>MONITORING EQUIPMENT AND METHODOLOGY</b>	<b>5</b>
<b>3.4</b>	<b>ACTION AND LIMIT LEVELS</b>	<b>7</b>
<b>3.5</b>	<b>EVENT AND ACTION PLAN</b>	<b>8</b>
<b>4</b>	<b>IMPACT WATER QUALITY MONITORING RESULTS</b>	<b>9</b>
<b>5</b>	<b>ENVIRONMENTAL NON-CONFORMANCES</b>	<b>10</b>
<b>5.1</b>	<b>SUMMARY OF ENVIRONMENTAL EXCEEDANCE</b>	<b>10</b>
<b>5.2</b>	<b>SUMMARY OF ENVIRONMENTAL NON-COMPLIANCE</b>	<b>10</b>
<b>5.3</b>	<b>SUMMARY OF ENVIRONMENTAL COMPLAINT</b>	<b>10</b>
<b>5.4</b>	<b>SUMMARY OF ENVIRONMENTAL SUMMONS AND PROSECUTION</b>	<b>10</b>
<b>6</b>	<b>FUTURE KEY ISSUES</b>	<b>11</b>
<b>7</b>	<b>CONCLUSIONS</b>	<b>12</b>

## LIST OF TABLES

<i>Table 2.1</i>	<i>Summary of Environmental Licensing, Notification, Permit and Reporting Status</i>
<i>Table 3.1</i>	<i>Water Quality Monitoring Stations</i>
<i>Table 3.2</i>	<i>Equipment Used during Impact Water Quality Monitoring</i>
<i>Table 3.3</i>	<i>Action and Limit Levels of Water Quality</i>
<i>Table 3.4</i>	<i>Event Action Plan for Water Quality</i>

## LIST OF FIGURES

<i>Figure 2.1</i>	<i>Alignment of the Proposed 11kV Submarine Cable Circuit from Liu Ko Ngam to Pak Sha Tau Tsui</i>
<i>Figure 3.1</i>	<i>Water Quality Monitoring Station</i>

## LIST OF ANNEXES

<i>Annex A</i>	<i>Impact Water Quality Monitoring Schedule</i>
<i>Annex B</i>	<i>Calibration Reports of Multi-parameter Sensor</i>
<i>Annex C</i>	<i>QA/QC Results for Suspended Solids Testing</i>
<i>Annex D</i>	<i>Fourth and Fifth Week Impact Water Quality Monitoring Results</i>

## **EXECUTIVE SUMMARY**

The submarine cable installation works for the 11kV submarine cable connecting Liu Ko Ngam to Pak Sha Tau Tsui at Kat O commenced in the week starting 21 December 2015. This is the *Bi-weekly Impact Monitoring Report for Fourth and Fifth Week Impact Water Quality Monitoring* presenting results and findings of the impact water quality monitoring conducted during the period from 11 to 24 January 2016 in accordance with the *Environmental Monitoring and Audit Requirement (EM&A Requirement)*.

### Water Quality Monitoring

Four (4) monitoring events were scheduled in the reporting period, on 13, 15, 20 and 22 January 2016. Monitoring events at designated monitoring stations were performed on schedule.

### Environmental Non-conformance

No exceedances of Action and Limit Levels were recorded during the reporting week.

No complaint and summons/prosecution was received during the reporting week.

Given that there will be no construction works and all construction vessels will be demobilized in the following week, water quality monitoring works will be suspended until construction work resumes.

# 1 INTRODUCTION

ERM-Hong Kong, Limited (ERM) was appointed by CLP Power Hong Kong Limited (CLP) as the Environmental Team (ET) to implement the Environmental Monitoring and Audit (EM&A) programme for the installation of an 11kV submarine cable connecting Liu Ko Ngam to Pak Sha Tau Tsui at Kat O (the Project).

## 1.1 PURPOSE OF THE REPORT

This is the *Bi-weekly Impact Monitoring Report for Fourth and Fifth Week Impact Water Quality Monitoring*, which summarises the results of impact water quality monitoring as part of the EM&A programme during the reporting period from 11 to 24 January 2016.

## 1.2 STRUCTURE OF THE REPORT

The structure of the Report is as follows:

*Section 1 : Introduction*

Provides the Project background, purpose and report structure.

*Section 2 : Project Information*

Summarises background and scope of the project, the construction works undertaken and the status of Environmental Permits/Licenses during the reporting period.

*Section 3 : Impact Water Quality Monitoring Requirements*

Summarises the monitoring parameters, monitoring programmes, monitoring methodologies, monitoring frequency, monitoring locations, Action and Limit Levels, and Event Action Plan.

*Section 4 : Impact Water Quality Monitoring Results*

Summarises the water quality monitoring results obtained in the reporting period.

*Section 5 : Environmental Non-conformance*

Summarises any monitoring exceedance, environmental complaints and environmental summons within the reporting period.

*Section 6 : Future Key Issues*

Summarises the monitoring schedule for the next reporting period.

*Section 7 : Conclusions*

Presents the key findings of the impact monitoring results.

## 2.1

## BACKGROUND

CLP Power Hong Kong Limited (CLP) proposes to enhance the security of power supply to Kat O Island. At present, there is only one set of 11kV submarine cable connecting Liu Ko Ngam to Pak Sha Tau Tsui at Kat O for power supply. The existing 11kV submarine cable is however more than 30 years old and deteriorating, thus potentially limiting the continuous supply of electricity in the future. CLP therefore proposes to replace the existing 11kV submarine cable connecting Liu Ko Ngam to Pak Sha Tau Tsui at Kat O to ensure the continuous power supply for Kat O. The Project involves the installation of an 11kV cable circuit consisting of two individual cables, with an intended burial depth up to 5 m for the submarine cable section and about 1 m for the land section. The two submarine cables (except the shore end sections which will be at only about 1 m separation and joining into a single cable trench at each landing site) will be 30 m away from each other and running parallel along the alignment. In areas (especially near the landing site) where the cable burial depth does not meet the requirements due to seabed geotechnical constraints, a protective cover such as a concrete slab will be adopted. The total length of the proposed cable alignment is approximately 880 m. A map showing the proposed submarine cable route is presented in *Figure 2.1*.

A *Project Profile* (Register No. PP-489/2013, *Replacement of the Existing 11kV Submarine Cable Circuit Connecting Liu Ko Ngam and Pak Sha Tau Tsui at Kat O*) which includes an assessment of the potential environmental impacts associated with the installation of the submarine cables was prepared and submitted to the Environmental Protection Department (EPD) according to *Section 5(11) of the Environmental Impact Assessment Ordinance (EIAO)* for the application for Permission to apply directly for *Environmental Permit (EP)*. On 11 July 2013 EPD approved the *Project Profile (PP)* and a direct application for *EP* was submitted on 23 July 2013 (Application No. AEP-461/2013). On 27 August 2013 EPD granted an environmental permit for the Project (EP - 461/2013) pursuant to *Section 10 of EIAO*.

Pursuant to *Condition 2.1 of the EP, Water Quality Sampling*, as set out in the approved *PP Annex E Environmental Monitoring & Audit (EM&A) Requirements* (henceforth "*EM&A Requirement*"), is required for this Project. Water Quality Sampling shall be conducted prior to and throughout the cable installation works, and after its completion as set out in the *EM&A Requirement*.

Baseline water quality monitoring was conducted prior to the installation works and results were summarised in the *Baseline Water Quality Monitoring Report* of November 2015.

Impact monitoring started on 22 December 2015, when the cable installation works commenced. Impact monitoring is being conducted twice a week



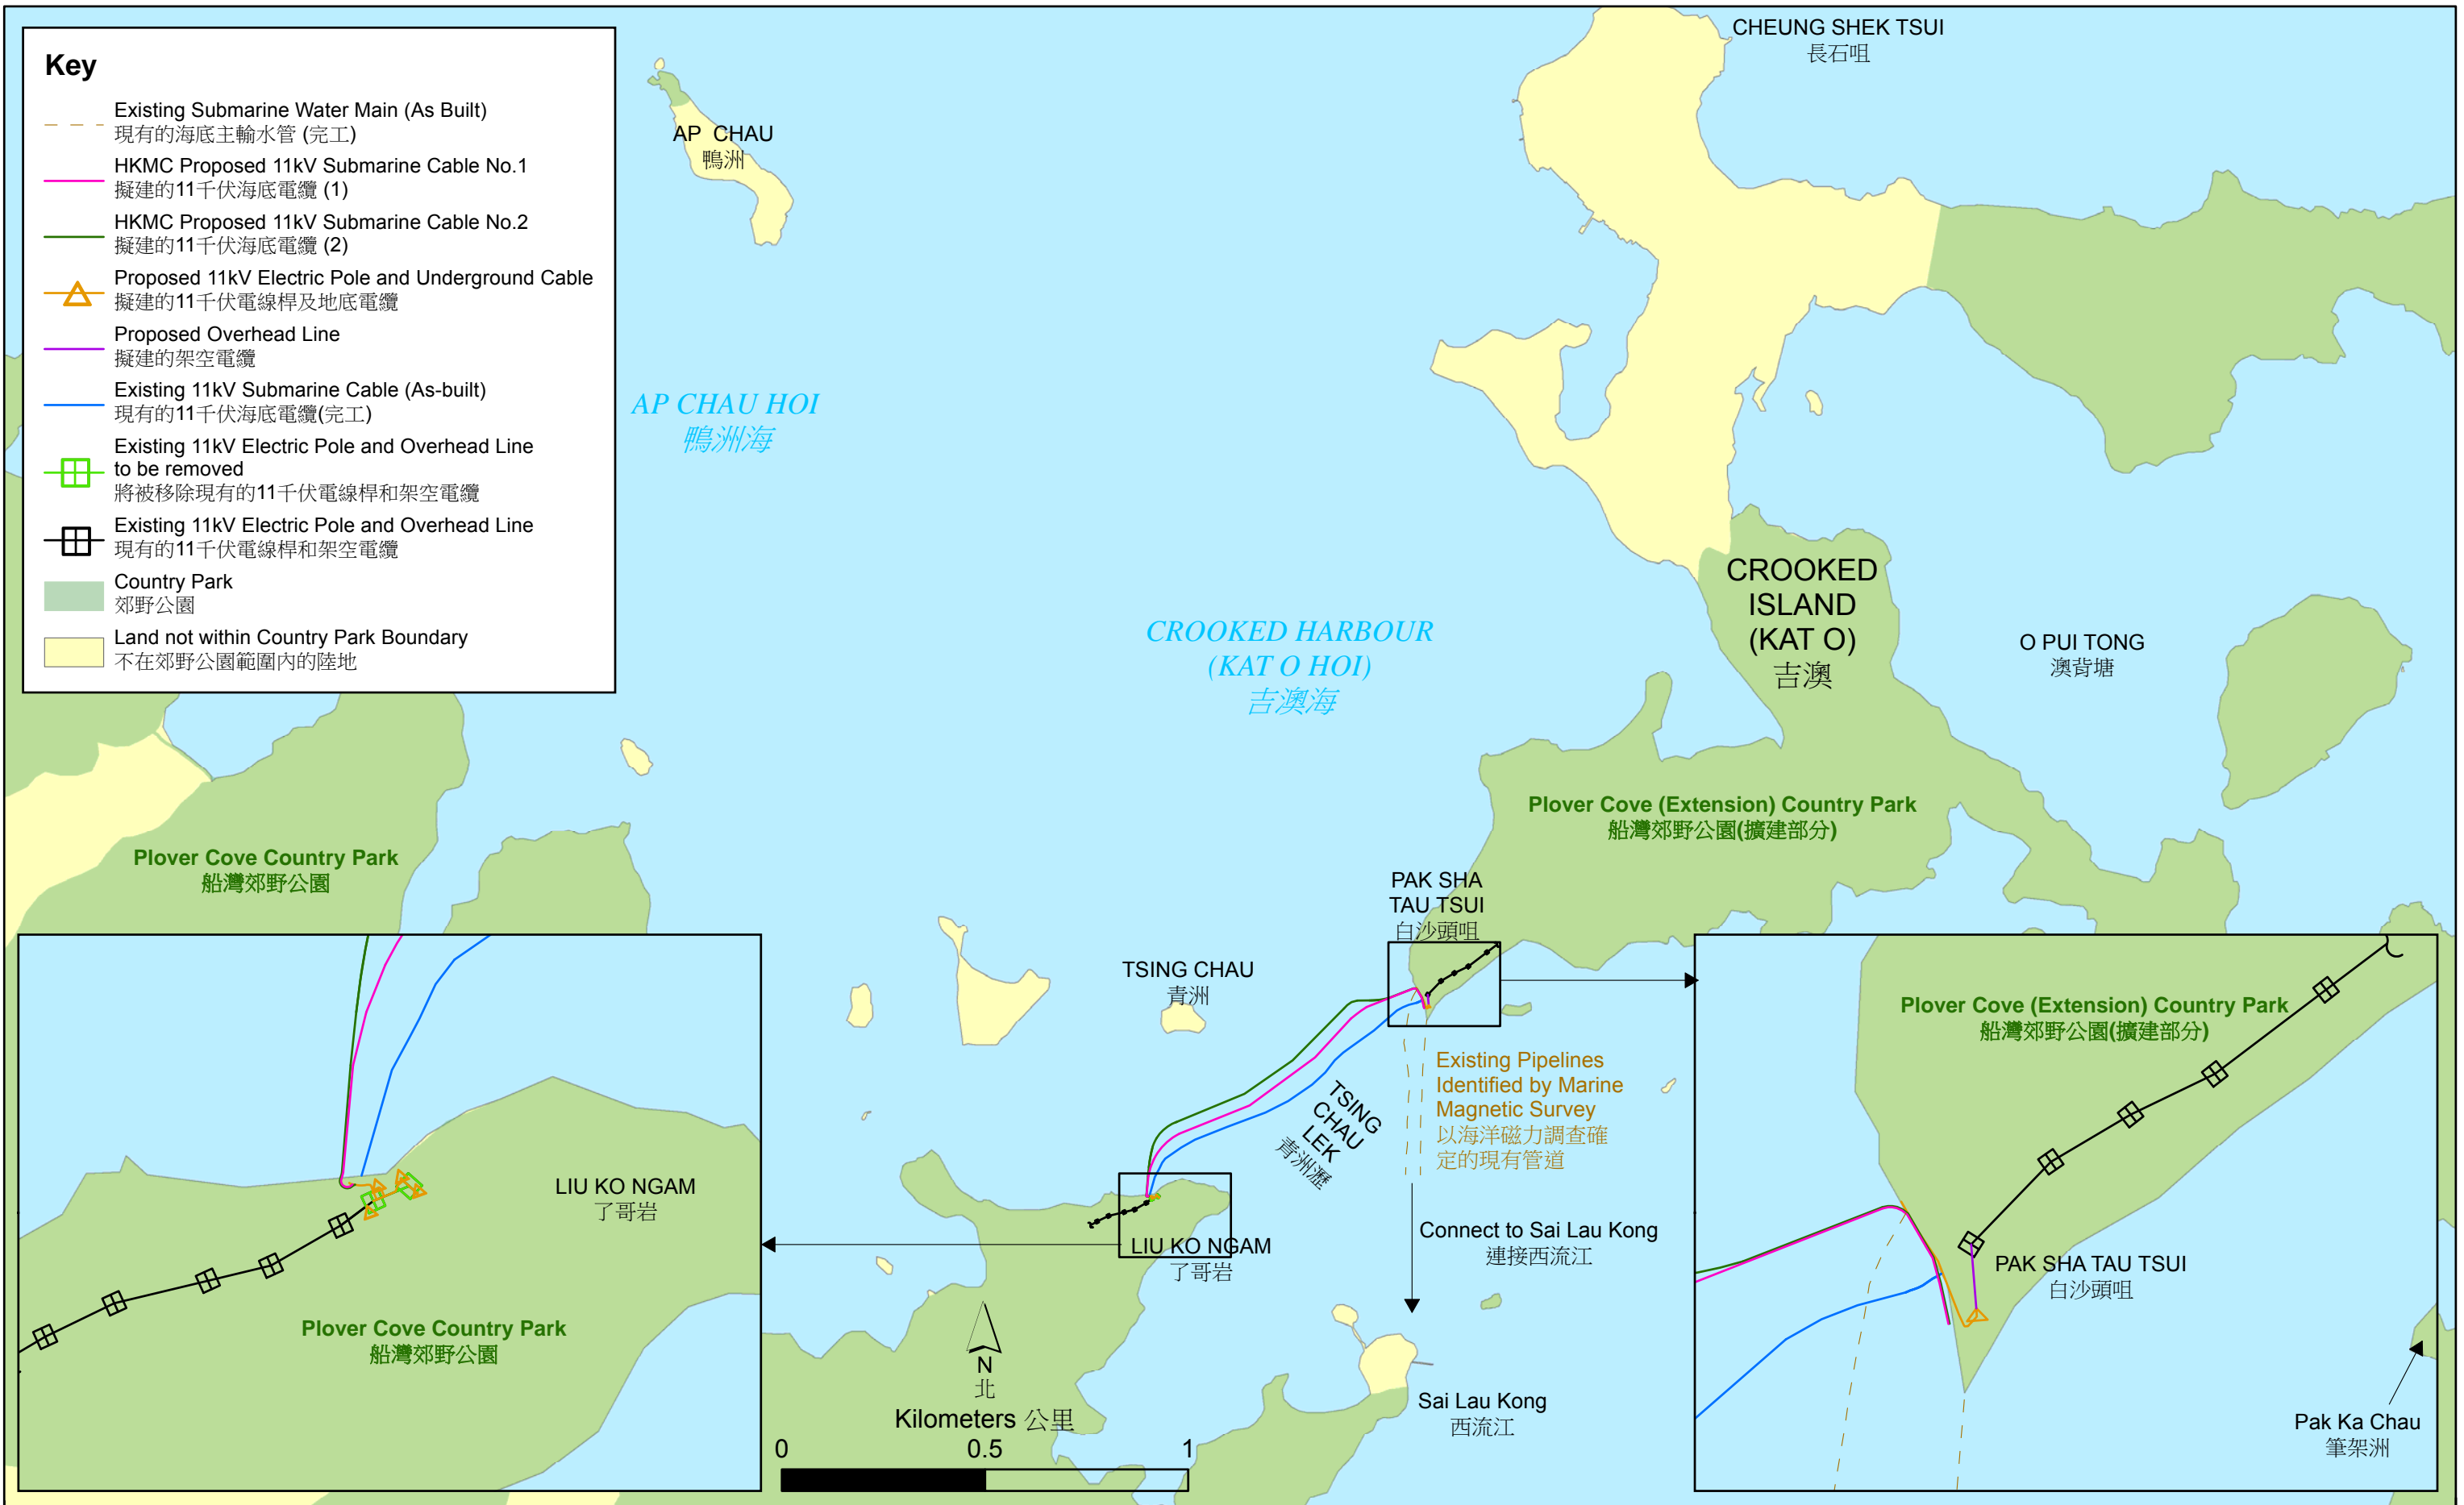


Figure 2.1  
圖 2.1

Alignment of the Proposed 11kV Submarine Cable Circuit from Liu Ko Ngam to Pak Sha Tau Tsui  
了哥岩至白沙頭咀的擬建11kV海底電纜路線

during cable installation works. The *First, Second and Third Weekly Impact Water Quality Monitoring Report* were submitted on 4, 11 and 18 January 2016 respectively. The impact water quality monitoring is used to reflect the water quality conditions and to identify potential water quality impacts during the cable installation works. Given that there are no exceedances of Action and Limit Levels during the first three weeks of impact water quality monitoring, with reference to the *EM&A Requirement* a bi-weekly impact monitoring report will be provided within 1 week of completing every two weekly monitoring surveys. This *Bi-weekly Impact Monitoring Report for Fourth and Fifth Week Impact Water Quality Monitoring* (the "Report") presents the results and findings for the fourth and fifth week impact monitoring conducted between 11 and 24 January 2016, at the same locations as the baseline monitoring stations.

## 2.2 *MARINE CONSTRUCTION WORKS UNDERTAKEN DURING REPORTING WEEK*

During the reporting period from 11 to 24 January 2016, marine trenching works were conducted near Liu Ko Ngam, and the marine vessel returned to anchor near To Kwa Wan.

## 2.3 *STATUS OF ENVIRONMENTAL APPROVAL DOCUMENTS*

A summary of the relevant permits, licences and reports on marine water quality for this Project is presented in *Table 2.1*.

**Table 2.1** *Summary of Environmental Licensing, Notification, Permit and Reporting Status*

<b>Permit / Licence / Notification / Report</b>	<b>Reference</b>	<b>Validity Period</b>	<b>Remarks</b>
Project Profile	PP-489/2013	Throughout the construction and operation stages	Submitted on 30 May 2013
Environmental Permit	EP-461/2013	Throughout the construction and operation stages	Granted on 27 August 2013
Baseline Water Quality Monitoring Report	-	Throughout the construction period	Submitted on 20 November 2015
First Weekly Impact Water Quality Monitoring Report	-	Construction period of week from 21 to 27 December 2015	Submitted on 4 January 2016
Second Weekly Impact Water Quality Monitoring Report	-	Construction period of week from 28 December 2015 to 3 January 2016	Submitted on 11 January 2016
Third Weekly Impact Water Quality Monitoring Report	-	Construction period of week from 4 to 10 January 2016	Submitted on 18 January 2016

### 3.1 MONITORING LOCATIONS

In accordance with the *EM&A Requirement*, water quality monitoring samples were collected at the ten (10) stations situated around the cable installation works, following commencement of Project marine installation works. The locations of the sampling stations are shown in *Figure 3.1*.

- C1 is a Control Station to the north of the cable alignment (approximately 1.4 km away) with the same coordinates as EPD routine monitoring station MM2, which is not supposed to be influenced by the construction works due to its remoteness to the Project works area;
- C2 is a Control Station to the south of the cable alignment (over a distance of 1.6 km) with the same coordinates as EPD routine monitoring station MM7, which is not supposed to be influenced by the construction works due to its remoteness to the Project site;
- SR1 is Impact Station used to monitor the effect of the cable installation works on coral communities of high ecological concern at Tsing Chau;
- SR2 is Impact Station used to monitor the effect of the cable installation works on coral communities of high ecological concern at Ngau Shi Wu Wan;
- SR3 is Impact Station used to monitor the effect of the cable installation works on Lai Chi Wo/ Yan Chau Tong Marine Park (to the west of the Project site);
- SR4 is Impact Station used to monitor the effect of the cable installation works on Yan Chau Tong Marine Park (to the south of the Project site);
- SR5 is Impact Station used to monitor the effect of the cable installation works on Sai Lau Kong FCZ;
- G1 is regarded as a Gradient Station in between Impact Station SR1 and the construction work alignment;
- G2 is Gradient Station located between Impact Stations SR2, SR4 and SR5 and construction work alignment; and
- G3 is Gradient Station located between Impact Stations SR3 and the construction work alignment and landing point at Kiu Ko Ngam.

The co-ordinates of the above monitoring stations are listed in *Table 3.1*.

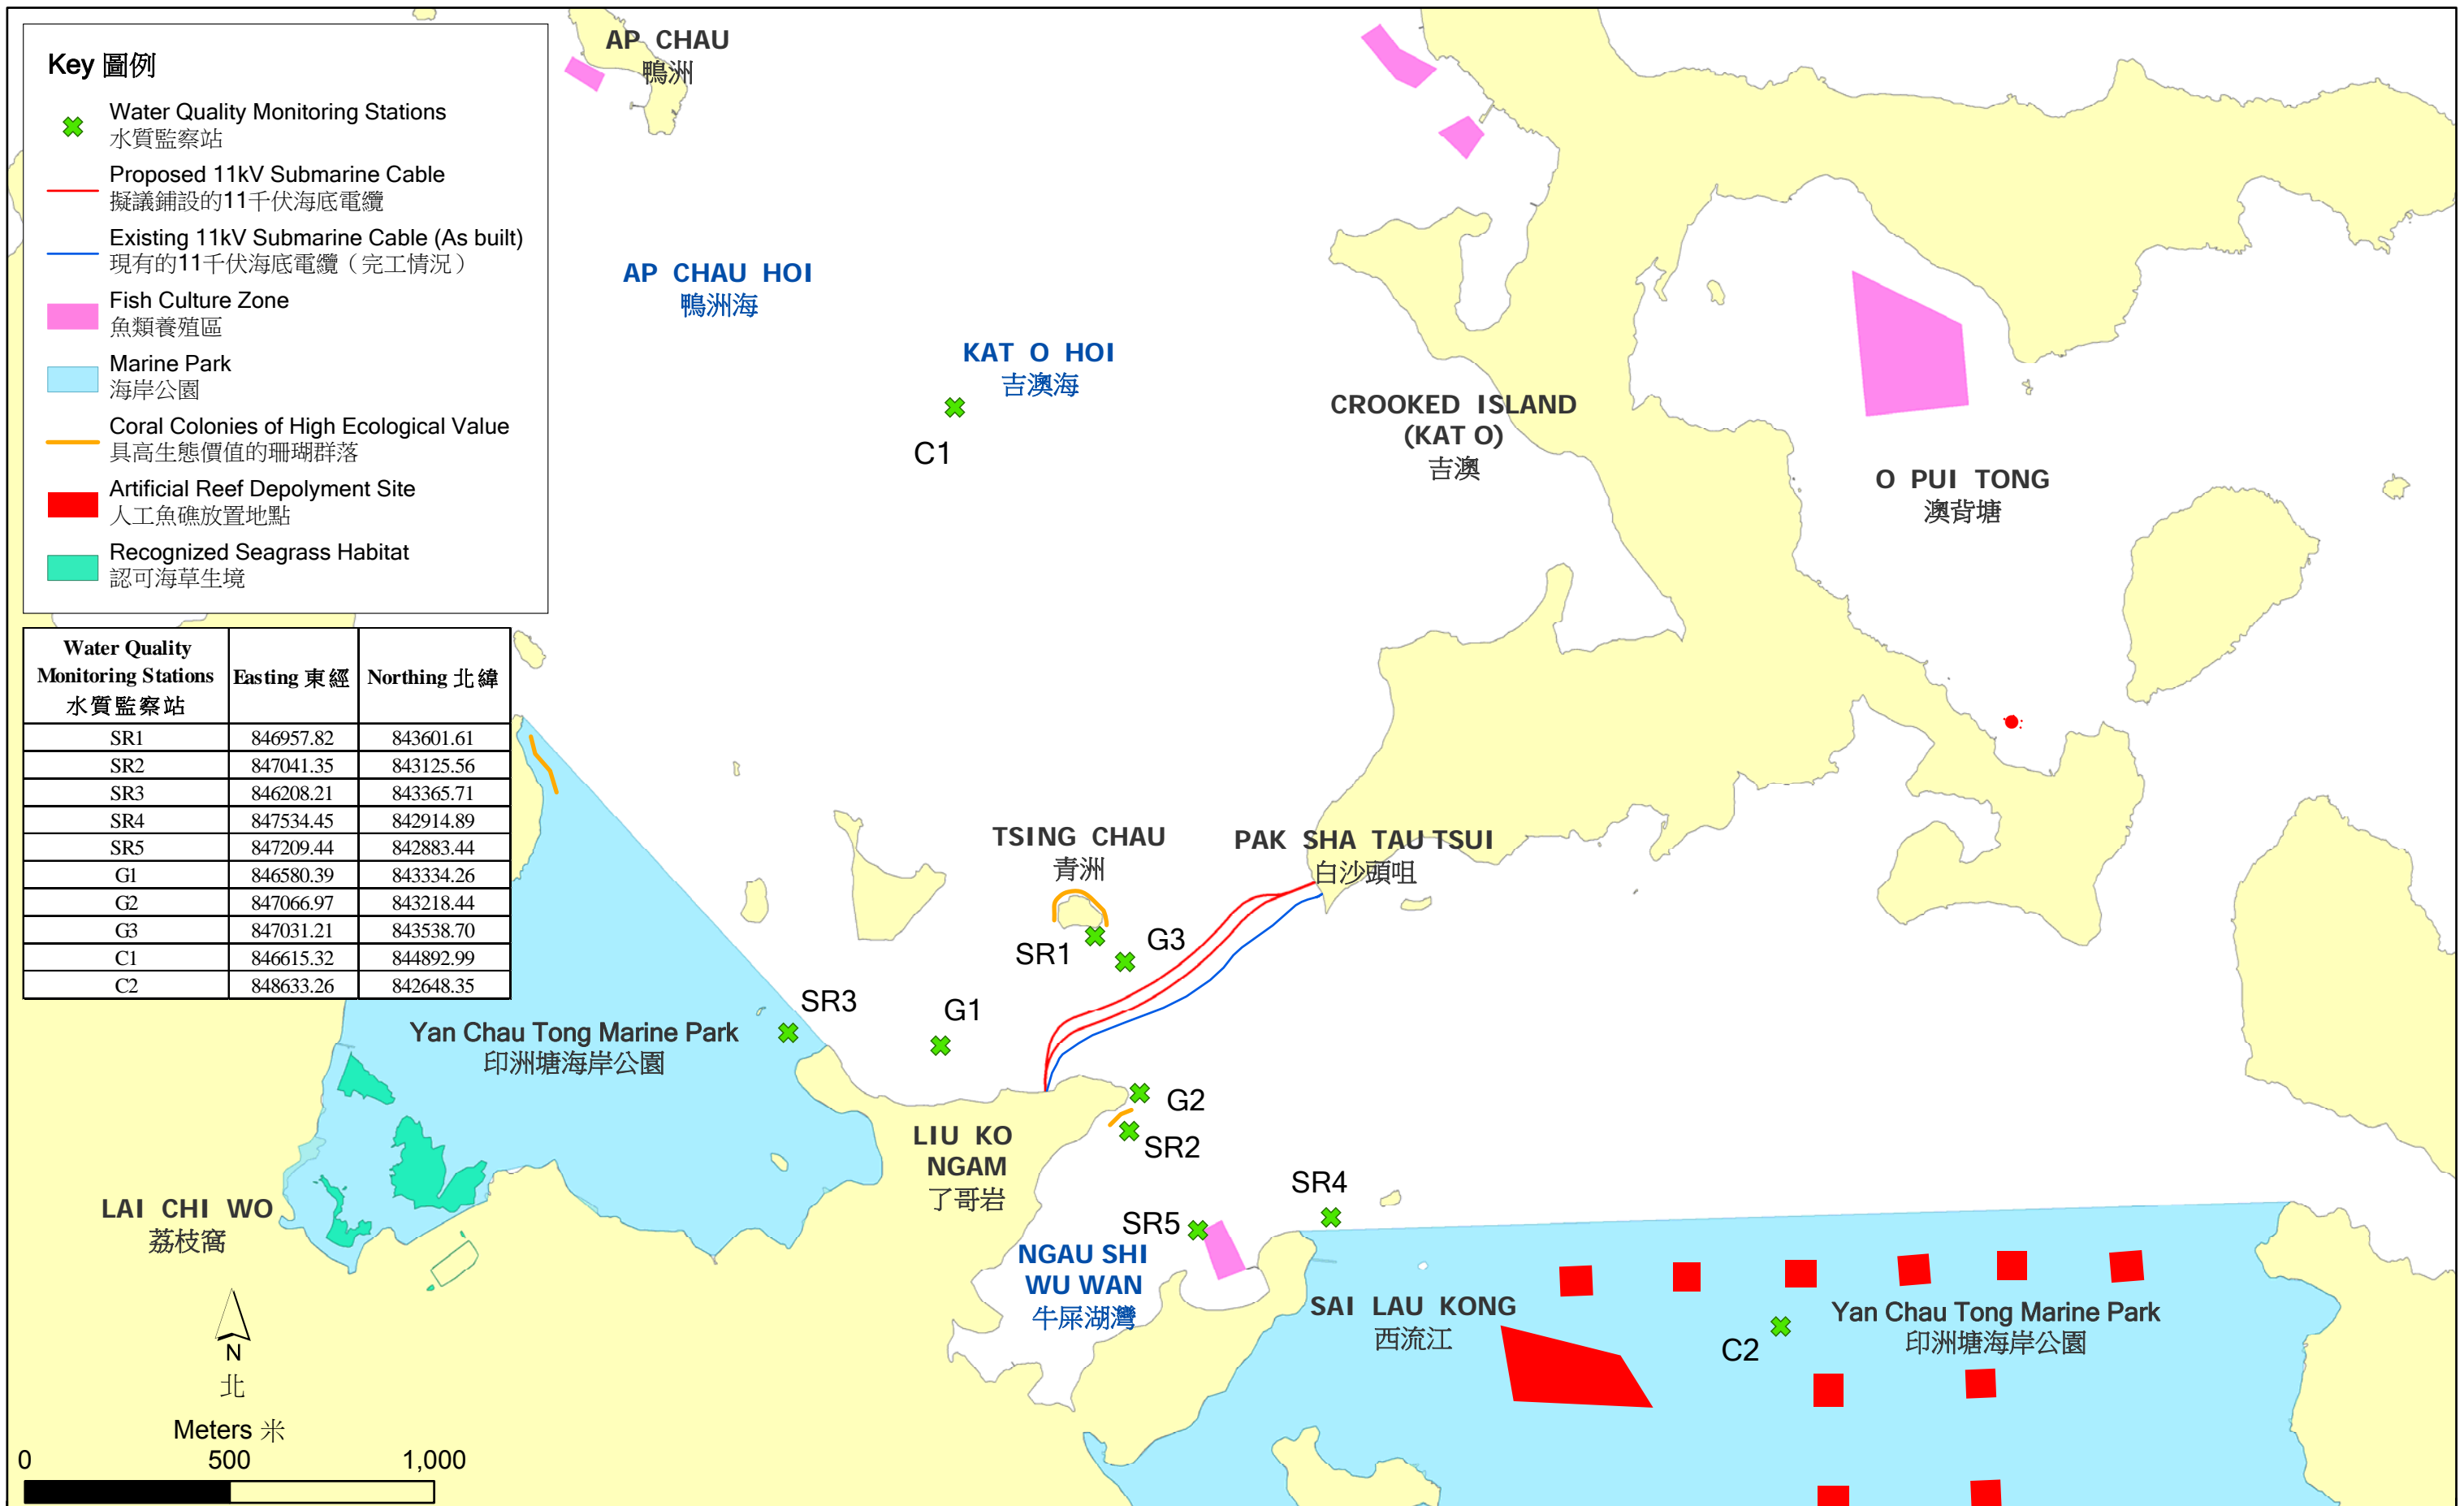


Figure 3.1  
圖 3.1

Water Quality Monitoring Stations

水質監察站

File: T:\GIS\CONTRACT\0259952\Mxd\0259952\_WQMS.mxd  
Date: 30/12/2015

**Table 3.1 Water Quality Monitoring Stations**

<b>Station</b>	<b>Nature</b>	<b>Easting</b>	<b>Northing</b>
C1	Control Station	846615.32	844892.99
C2	Control Station	848633.26	842648.35
SR1	Impact Station	846957.82	843601.61
SR2	Impact Station	847041.35	843125.56
SR3	Impact Station	846208.21	843365.71
SR4	Impact Station	847534.45	842914.89
SR5	Impact Station	847209.44	842883.44
G1	Gradient Station	846580.39	843334.26
G2	Gradient Station	847025.97	843218.44
G3	Gradient Station	847031.21	843538.70

### 3.2 MONITORING PARAMETERS

The fourth and fifth week impact water quality monitoring was conducted in accordance with the requirements stated in the *EM&A Requirement*. Monitoring parameters are presented below.

The parameters measured *in situ* were:

- Dissolved Oxygen (DO) (% saturation and mg/L)
- Water temperature (°C)
- Turbidity (Nephelometric Turbidity Units [NTU])
- Salinity (parts per thousand [ppt])

The only parameter to be measured in the laboratory was:

- Suspended solids (SS) (mg/L)

In addition to the water quality parameters, other relevant data were also measured and recorded in field logs, including the location of the sampling stations, water depth, sampling depth, current velocity and direction, time, weather conditions, sea conditions (where appropriate), tidal state (where appropriate), special phenomena and work activities undertaken around the monitoring and Project works area that may have influenced the monitoring results.

These parameters will be monitored at all designated marine water quality monitoring stations throughout the whole impact monitoring phase.

### 3.3 MONITORING EQUIPMENT AND METHODOLOGY

#### 3.3.1 Monitoring Equipment

Table 3.2 summaries the equipment used for the impact water quality monitoring.

**Table 3.2** *Equipment Used during Impact Water Quality Monitoring*

<b>Equipment</b>	<b>Model</b>
Global Positioning Device	GARMIN eTrex 10
Water Depth Gauge	Speedtech Instruments SM-5
Water Sampling Equipment	Wildlife Kemmerer 1520
Salinity, DO, Temperature Measuring Meter	YSI PRO 2030
Current Velocity and Direction	Global Water FP111
Turbidity Meter	HACH 2100Q

### 3.3.2 *Monitoring Frequency and Timing*

The water quality monitoring was carried out on two occasions (days) and the intervals between the two sets of monitoring were not less than 36 hours. The water quality sampling was undertaken within a 3 hour window of 1.5 hours before and 1.5 hours after mid flood and mid-ebb tides. The tidal range selected for the baseline monitoring was at least 0.5 m for both flood and ebb tides as far as practicable.

Reference were made to the predicted tides at Ko Lau Wan, which is the tidal station nearest to the Project Site, published on the website of the Hong Kong Observatory <sup>(1)</sup>. Based on the predicted tidal levels at Ko Lau Wan, the fourth and fifth week water quality monitoring was conducted on 13, 15, 20 and 22 January 2016, following the schedule presented in *Annex A*.

### 3.3.3 *Sampling/Testing Protocol*

All *in situ* monitoring instruments were checked, calibrated and certified by a laboratory accredited under HOKLAS or any other international accreditation scheme before use (see calibration reports in *Annex B*), and subsequently will be re-calibrated at-monthly intervals throughout all stages of the water quality monitoring. Responses of sensors and electrodes were checked with certified standard solutions before each use.

For the on-site calibration of field equipment, the *BS 1427: 1993, Guide to Field and On-Site Test Methods for the Analysis of Waters* was observed. Sufficient stocks of spare parts were maintained for replacements when necessary. Backup monitoring equipment was made available.

Water samples for SS measurements were collected in high density polythene bottles, packed in ice (cooled to 4° C without being frozen), and delivered to a HOKLAS laboratory as soon as possible after collection.

At each measurement / sampling depth, two (2) consecutive *in-situ* measurements (DO concentration and saturation, temperature, turbidity, and salinity) and two water samples for SS were taken for lab analysis.

<sup>(1)</sup> Hong Kong Observatory (2015) <http://www.hko.gov.hk/tide/eQUBtide.htm> [Accessed in December 2015]

### 3.3.4 *Laboratory Analysis*

All laboratory work was carried out in a HOKLAS accredited laboratory. Water samples of about 1,000 mL were collected at the monitoring and control stations for carrying out the laboratory determinations. The determination work started within the next working day after collection of the water samples. The SS laboratory measurements were provided within two (2) days of the sampling event (i.e. within 48 hours). The analyses followed the standard methods as described in APHA Standard Methods for the *Examination of Water and Wastewater*, 19th Edition, unless otherwise specified (APHA 2540D for SS).

The QA/QC details were in accordance with requirements of HOKLAS or another internationally accredited scheme (*Annex C*)

### 3.3.5 *Sampling Depths & Replication*

Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

For *in situ* measurements, duplicate readings were made at each water depth at each station. Duplicate water samples were collected at each water depth at each station.

## 3.4 *ACTION AND LIMIT LEVELS*

The Action and Limit levels which were established based on the results of *Baseline Water Quality Monitoring*, are presented in *Table 3.3*.

**Table 3.3** *Action and Limit Levels of Water Quality*

<b>Parameter</b>	<b>Action Level</b>	<b>Limit Level</b>
DO in mg/L <sup>a</sup>	<u>Surface and Middle</u> 5%-ile of baseline data for surface and middle layer (4.85 mg/L), and 20% exceedance of value at any impact station compared with corresponding data from control stations  <u>Bottom</u> 5%-ile of baseline data for bottom layers (4.72 mg/L), and 20% exceedance of value at any impact station compared with corresponding data from control stations	<u>Surface and Middle</u> 1%-ile of baseline for surface and middle layer (4.57 mg/L)  <u>Bottom</u> 1%-ile of baseline data for bottom layer (4.46 mg/L)

Parameter	Action Level	Limit Level
SS in mg/L (Depth-averaged b) c	95%-ile of baseline data (5.40 mg/L) and 20% exceedance of value at any impact station compared with corresponding data from control stations	99%-ile of baseline data (5.71 mg/L) and 30% exceedance of value at any impact station compared with corresponding data from control stations
Turbidity in NTU (Depth-averaged a) c	95%-ile of baseline data (4.92 NTU) and 20% exceedance of value at any impact station compared with corresponding data from control stations	99%-ile of baseline data (5.11 NUT) and 30% exceedance of value at any impact station compared with corresponding data from control stations

**Notes:**

- a. For DO, non-compliance of the water quality limits occurs when monitoring result is lower than the limits.
- b. "Depth-averaged" is calculated by taking the arithmetic means of reading of all three depths (at 1 metre below surface, mid-depth and 1 metre above seabed for the definition of sampling water depth).
- c. For SS and turbidity, non-compliance of the water quality limits occurs when monitoring result is higher than the limits.

### 3.5

#### EVENT AND ACTION PLAN

The Event and Action Plan for water quality monitoring which was stipulated in *EM&A Requirement* is presented in *Table 3.4*.

**Table 3.4** *Event Action Plan for Water Quality*

Event	Contractor
Action Level Exceedance	<p><b>Step 1</b> - repeat sampling event to confirm findings.</p> <p><b>Step 2</b> - if findings are confirmed, discuss with cable installation contractor the most appropriate method of reducing suspended solids during cable installation (e.g. reduce cable laying speed/ volume of water used during installation, increase effectiveness of silt curtain).</p> <p><b>Step 3</b> - repeat measurements after implementation of mitigation for confirmation of compliance.</p> <p><b>Step 4</b> - if non-compliance continues - increase measures in Step 2 and repeat measurements in Step 3. If non-compliance occurs at a third time, the cable laying operations should be suspended.</p>
Limit Level Exceedance	<p>Inform EPD and AFCD and confirm notification of the non-compliance in writing within 24 hours after a limit level exceedance is recorded.</p> <p>Undertake <b>Steps 1-3</b> immediately, if further non-compliance continues at the Limit Level, suspend cable laying operations until an effective solution is identified.</p>



A total of four (4) monitoring events (days) were scheduled in the fourth and fifth week impact monitoring from 11 to 24 January 2016 (*Annex A*). In each monitoring day (13, 15, 20 and 22 January 2016), two rounds of water quality measurement and sampling were undertaken, at mid-ebb and mid-flood tidal stage respectively. Monitoring events at all designated monitoring stations were performed on schedule.

The results from the first to the fifth week impact monitoring (from 21 December 2015 to 24 January 2016) and their graphical presentations are included in *Annex D*. No exceedances of Action and Limit Levels were recorded in the monitoring period. The monitoring results of Turbidity, SS and DO are discussed together as follows.

The overall DO concentrations at all the water depths (surface, mid-depth and bottom) during the fourth and fifth week impact monitoring were observed generally above 7.0 mg/L, well above the Action Level of 4.85 mg/L (for surface and mid-depth) and of 4.72 mg/L (for bottom depth) as shown in *Figure D1-D3* of *Annex D*. Minor fluctuations of DO levels at each station have been observed since monitoring started, and the overall DO levels in the fourth and fifth monitoring weeks were similar to levels in the first to third impact monitoring weeks.

Depth-averaged Turbidity levels recorded from the first to the fifth week impact monitoring are shown in *Figure D4* of *Annex D*. Turbidity levels in the fourth and fifth impact monitoring weeks were generally below 2.2 NTU, well below the Action Level of 4.92 NTU. Although minor fluctuations have been observed since impact monitoring started, the differences of Turbidity levels among the stations were within a limited range of 1.1 NTU.

SS levels recorded in the fourth and fifth week impact monitoring were between 1.1 mg/L to 2.7 mg/L, well below the Action Level of 5.4 mg/L (*Figure D5* of *Annex D*). In general, levels of depth-averaged SS measured since impact monitoring started have shown a minor variation over time. Differences among the stations were recorded in the fourth and fifth impact monitoring weeks, similarly to the first three weeks, but no exceedances of Action and Limit Levels were observed.

In general, the water quality was stable throughout the fourth and fifth week impact monitoring (similarly to the first to third week) and the overall Turbidity, SS and DO levels recorded at the impact stations did not exceed Action or Limit Levels.

5 *ENVIRONMENTAL NON-CONFORMANCES*

5.1 *SUMMARY OF ENVIRONMENTAL EXCEEDANCE*

No exceedances of the Action and Limit Levels were recorded during the reporting period.

5.2 *SUMMARY OF ENVIRONMENTAL NON-COMPLIANCE*

No non-compliance events were recorded during the reporting period.

5.3 *SUMMARY OF ENVIRONMENTAL COMPLAINT*

No complaints were received during the reporting period.

5.4 *SUMMARY OF ENVIRONMENTAL SUMMONS AND PROSECUTION*

No summons or prosecution on environmental matters were received during the reporting period.

Given that there will be no construction works and all construction vessels will be demobilized in the following week, water quality monitoring works will be suspended until construction work resumes.

## CONCLUSIONS

This *Bi-weekly Impact Monitoring Report for Fourth and Fifth Week Impact Water Quality Monitoring* presents the results and findings of impact water quality monitoring undertaken during the period of the week from 11 to 24 January 2016 in accordance with the *EM&A Requirement* and the requirements under Environmental Permit (EP - 461/2013) for the Project.

No exceedances of Action and Limit Levels were recorded during the fourth and fifth weeks of water quality impact monitoring. No complaints or summons/prosecutions were received either during the reporting period.

Water quality was generally stable throughout the reporting period. Although some small differences of DO, Turbidity and SS levels among the sampling stations were recorded, no exceedances of Action and Limit Levels were observed.

In general, the overall water quality at the impact stations was found to be similar to that at the control stations. It is concluded that there was no deterioration of water quality during the reporting period and hence the effect of the Project cable installation works on water quality is considered to be negligible over this reporting period.

Water quality monitoring works will be suspended since there will be no construction works in the following week and all construction vessels will be demobilized.

Annex A

## Impact Water Quality Monitoring Schedule

**Replacement of the Existing 11 KV Submarine Cable Circuit Connecting  
Liu Ko Ngam and Pak Sha Tau at Kat O  
Impact Marine Water Quality Monitoring (WQM) Schedule**

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
20-Dec	21-Dec	22-Dec	23-Dec	24-Dec	25-Dec	26-Dec
		<b>WQM</b> Mid-Ebb 9:19 (07:34 - 11:04) Mid-Flood 15:29 (13:44 - 17:14)		<b>WQM</b> Mid-Ebb 11:13 (09:28 - 12:58) Mid-Flood 17:10 (15:25 - 18:55)		
27-Dec	28-Dec	29-Dec	30-Dec	31-Dec	01-Jan	02-Jan
		<b>WQM</b> Mid-Flood 9:14 (07:29 - 10:59) Mid-Ebb 14:31 (12:46 - 16:16)		<b>WQM</b> Mid-Flood 10:44 (08:59 - 12:29) Mid-Ebb 16:12 (14:27 - 17:57)		
03-Jan	04-Jan	05-Jan	06-Jan	07-Jan	08-Jan	09-Jan
			<b>WQM</b> Mid-Ebb 9:36 (07:12 - 10:42) Mid-Flood 15:05 (13:20 - 16:50)		<b>WQM</b> Mid-Ebb 11:09 (09:24 - 12:54) Mid-Flood 16:35 (14:50 - 18:20)	
10-Jan	11-Jan	12-Jan	13-Jan	14-Jan	15-Jan	16-Jan
			<b>WQM</b> Mid-Flood 8:57 (08:19 - 11:49) Mid-Ebb 14:38 (12:53 - 16:23)		<b>WQM</b> Mid-Flood 10:27 (08:42 - 12:12) Mid-Ebb 16:25 (14:40 - 18:10)	
17-Jan	18-Jan	19-Jan	20-Jan	21-Jan	22-Jan	23-Jan
			<b>WQM</b> Mid-Ebb 8:58 (07:13 - 10:43) Mid-Flood 15:00 (13:15 - 16:45)		<b>WQM</b> Mid-Ebb 11:00 (09:15 - 12:45) Mid-Flood 16:52 (15:07 - 18:37)	
24-Jan	25-Jan	26-Jan	27-Jan	28-Jan	29-Jan	30-Jan
	<b>No construction works are scheduled. Therefore no water quality monitoring works are planned in parallel.</b>					
31-Jan	01-Feb	02-Feb	03-Feb	04-Feb	05-Feb	06-Feb
	<b>WQM</b> Mid-Flood 11:47 (10:02 - 13:32) Mid-Ebb 18:14 (16:29 - 19:59)					

Annex B

## Calibration Reports of Multi-parameter Sensor



### Internal Calibration Report of Dissolved Oxygen Meter

Equipment Ref. No. : <u>ET/EW/008/006</u>	Manufacturer : <u>YSI</u>
Model No. : <u>Pro 2030</u>	Serial No. : <u>12A 100554</u>
Date of Calibration : <u>19/12/2015</u>	Calibration Due Date : <u>18/01/2016</u>

#### *Temperature Verification*

Ref. No. of Reference Thermometer : ET/0521/020  
 Ref. No. of Water Bath : ---

Reference Thermometer reading	Temperature (°C)		
	Measured	19.7	Corrected
DO Meter reading	Measured	20	Difference
			0.4

#### *Standardization of sodium thiosulphate (Na<sub>2</sub>S<sub>2</sub>O<sub>3</sub>) solution*

Reagent No. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> titrant	<u>CPE/012/4.5/001/13</u>	Reagent No. of 0.025N K <sub>2</sub> Cr <sub>2</sub> O <sub>7</sub>	<u>CPE/012/4.4/002/05</u>
		Trial 1	Trial 2
Initial Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)		0.00	10.20
Final Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)		10.20	20.50
Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> used (ml)		10.20	10.30
Normality of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> solution (N)		0.02451	0.02427
Average Normality (N) of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> solution (N)		0.02439	
Acceptance criteria, Deviation		Less than ± 0.001N	

Calculation: Normality of Na<sub>2</sub>S<sub>2</sub>O<sub>3</sub>, N = 0.25 / ml Na<sub>2</sub>S<sub>2</sub>O<sub>3</sub> used

#### *Lineality Checking*

##### *Determination of dissolved oxygen content by Winkler Titration \**

Purging Time (min)	2		5		10	
	1	2	1	2	1	2
Initial Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	0.00	11.10	22.00	0.00	6.80	10.40
Final Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	11.10	22.00	28.80	6.80	10.40	14.00
Vol. (V) of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> used (ml)	11.10	10.90	6.80	6.80	3.60	3.60
Dissolved Oxygen (DO), mg/L	7.27	7.14	4.45	4.45	2.36	2.36
Acceptance criteria, Deviation	Less than + 0.3mg/L		Less than + 0.3mg/L		Less than + 0.3mg/L	

Calculation: DO (mg/L) = V x N x 8000/298

Purging time, min	DO meter reading, mg/L			Winkler Titration result *, mg/L			Difference (%) of DO Content
	1	2	Average	1	2	Average	
2	7.31	7.41	7.36	7.27	7.14	7.21	2.06
5	4.23	4.31	4.27	4.45	4.45	4.45	4.13
10	2.25	2.31	2.28	2.36	2.36	2.36	3.45
Linear regression coefficient				0.9980			





### Internal Calibration Report of Dissolved Oxygen Meter

#### *Zero Point Checking*

DO meter reading, mg/L	0.00
------------------------	------

#### *Salinity Checking*

Reagent No. of NaCl (10ppt)	CPE/012/4.7/003/712	Reagent No. of NaCl (30ppt)	CPE/012/4.8/003/12
-----------------------------	---------------------	-----------------------------	--------------------

#### *Determination of dissolved oxygen content by Winkler Titration \*\**

Salinity (ppt)	10		30	
	1	2	1	2
Trial				
Initial Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	0.00	11.10	22.30	32.00
Final Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	11.10	22.30	32.00	41.50
Vol. (V) of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> used (ml)	11.10	11.20	9.70	9.50
Dissolved Oxygen (DO), mg/L	7.27	7.33	6.35	6.22
Acceptance criteria, Deviation	Less than + 0.3mg/L		Less than + 0.3mg/L	

Calculation:  $DO (mg/L) = V \times N \times 8000/298$

Salinity (ppt)	DO meter reading, mg/L			Winkler Titration result**, mg/L			Difference (%) of DO Content
	1	2	Average	1	2	Average	
10	7.43	7.45	7.44	7.27	7.33	7.30	1.90
30	6.51	6.38	6.45	6.35	6.22	6.29	2.51

#### *Acceptance Criteria*

- (1) Differenc between temperature readings from temperature sensor of DO probe and reference thermometer : < 0.5 °C
- (2) Linear regression coefficient : >0.99
- (3) Zero checking: 0.0mg/L
- (4) Difference (%) of DO content from the meter reading and by winkler titration : within ± 5%

The equipment complies # / ~~does not comply~~ # with the specified requirements and is deemed acceptable # / unacceptable # for use.


# Delete as appropriate

Calibrated by

:



Approved by :





## Performance Check of Salinity Meter

Equipment Ref. No. : ET/EW/008/006      Manufacturer : YSI  
Model No. : Pro 2030      Serial No. : 12A 100554  
Date of Calibration : 19/12/2015      Due Date : 18/01/2016

Ref. No. of Salinity Standard used (30ppt)

S/001/5


Salinity Standard (ppt)	Measured Salinity (ppt)	Difference %
30.0	30.6	2.00


(\*) Difference (%) = (Measured Salinity – Salinity Standard value) / Salinity Standard value x 100

Acceptance Criteria

Difference : -10 % to 10 %

The salinity meter complies \* / ~~does not comply~~ \* with the specified requirements and is deemed acceptable \* / ~~unacceptable~~ \* for use. Measurements are traceable to national standards.

Checked by : 

Approved by : 



### Internal Calibration Report of Dissolved Oxygen Meter

Equipment Ref. No. : <u>ET/EW/008/006</u>	Manufacturer : <u>YSI</u>
Model No. : <u>Pro 2030</u>	Serial No. : <u>12A 100554</u>
Date of Calibration : <u>19/01/2016</u>	Calibration Due Date : <u>18/02/2016</u>

#### *Temperature Verification*

Ref. No. of Reference Thermometer : ET/0521/005  
 Ref. No. of Water Bath : ---

		Temperature (°C)		
Reference Thermometer reading	Measured	20.0	Corrected	20.3
DO Meter reading	Measured	20	Difference	0.3

#### *Standardization of sodium thiosulphate (Na<sub>2</sub>S<sub>2</sub>O<sub>3</sub>) solution*

Reagent No. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> titrant	CPE/012/4.5/001/13	Reagent No. of 0.025N K <sub>2</sub> Cr <sub>2</sub> O <sub>7</sub>	CPE/012/4.4/002/07
		Trial 1	Trial 2
Initial Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)		0.00	10.15
Final Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)		10.15	20.50
Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> used (ml)		10.15	10.35
Normality of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> solution (N)		0.02463	0.02415
Average Normality (N) of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> solution (N)		0.02439	
Acceptance criteria, Deviation		Less than ± 0.001N	

Calculation: Normality of Na<sub>2</sub>S<sub>2</sub>O<sub>3</sub>, N = 0.25 / ml Na<sub>2</sub>S<sub>2</sub>O<sub>3</sub> used

#### *Linearity Checking*

##### *Determination of dissolved oxygen content by Winkler Titration \**

Purging Time (min)	2		5		10	
	1	2	1	2	1	2
Initial Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	0.00	11.10	22.00	0.00	6.80	10.30
Final Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	11.10	22.00	28.80	6.80	10.30	14.10
Vol. (V) of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> used (ml)	11.10	10.90	6.80	6.80	3.50	3.80
Dissolved Oxygen (DO), mg/L	7.27	7.14	4.45	4.45	2.29	2.49
Acceptance criteria, Deviation	Less than + 0.3mg/L		Less than + 0.3mg/L		Less than + 0.3mg/L	

Calculation: DO (mg/L) = V x N x 8000/298

Purging time, min	DO meter reading, mg/L			Winkler Titration result *, mg/L			Difference (%) of DO Content
	1	2	Average	1	2	Average	
2	7.28	7.31	7.30	7.27	7.14	7.21	1.24
5	4.22	4.26	4.24	4.45	4.45	4.45	4.83
10	2.31	2.33	2.32	2.29	2.49	2.39	2.97
Linear regression coefficient				0.9977			



### Internal Calibration Report of Dissolved Oxygen Meter

**Zero Point Checking**

DO meter reading, mg/L	0.00
------------------------	------

**Salinity Checking**

Reagent No. of NaCl (10ppt)	CPE/012/4.7/003/714	Reagent No. of NaCl (30ppt)	CPE/012/4.8/003/14
-----------------------------	---------------------	-----------------------------	--------------------

**Determination of dissolved oxygen content by Winkler Titration \*\***

Salinity (ppt)	10		30	
	1	2	1	2
Trial				
Initial Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	0.00	11.40	22.80	32.50
Final Vol. of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> (ml)	11.40	22.80	32.50	42.10
Vol. (V) of Na <sub>2</sub> S <sub>2</sub> O <sub>3</sub> used (ml)	11.40	11.40	9.70	9.60
Dissolved Oxygen (DO), mg/L	7.46	7.46	6.35	6.29
Acceptance criteria, Deviation	Less than + 0.3mg/L		Less than + 0.3mg/L	

Calculation: DO (mg/L) = V x N x 8000/298

Salinity (ppt)	DO meter reading, mg/L			Winkler Titration result**, mg/L			Difference (%) of DO Content
	1	2	Average	1	2	Average	
10	7.34	7.29	7.32	7.46	7.46	7.46	1.89
30	6.51	6.40	6.46	6.35	6.29	6.32	2.19

**Acceptance Criteria**

- (1) Differenc between temperature readings from temperature sensor of DO probe and reference thermometer : < 0.5 °C
- (2) Linear regression coefficient : >0.99
- (3) Zero checking: 0.0mg/L
- (4) Difference (%) of DO content from the meter reading and by winkler titration : within ± 5%

The equipment complies # / ~~does not comply~~ # with the specified requirements and is deemed acceptable # / unacceptable # for use.

# Delete as appropriate

Calibrated by : \_\_\_\_\_

Approved by : \_\_\_\_\_



## Performance Check of Salinity Meter

Equipment Ref. No. : ET/EW/008/006      Manufacturer : YSI  
Model No. : Pro 2030      Serial No. : 12A 100554  
Date of Calibration : 19/01/2016      Due Date : 18/02/2016

Ref. No. of Salinity Standard used (30ppt)

S/001/5

Salinity Standard (ppt)	Measured Salinity (ppt)	Difference %
30.0	30.3	1.00


(\*) Difference (%) = (Measured Salinity – Salinity Standard value) / Salinity Standard value x 100

Acceptance Criteria

Difference : -10 % to 10 %


The salinity meter complies \* / ~~does not comply~~ \* with the specified requirements and is deemed acceptable \* / ~~unacceptable~~ \* for use. Measurements are traceable to national standards.

Checked by : 

Approved by : 



## Performance Check of Turbidity Meter

Equipment Ref. No. : ET/0505/011                      Manufacturer : HACH  
Model No. : 2100Q                                      Serial No. : 12060 C 018534  
Date of Calibration : 19/12/2015                      Due Date : 18/01/2015 <sup>2016</sup> 

Theoretical Value of Turbidity Standard (NTU)	Measured Value (NTU)	Difference % *
20	19.7	-1.5
100	96.4	-3.6
800	782	-2.25


(\*) Difference = (Measured Value – Theoretical Value) / Theoretical Value x 100

Acceptance Criteria

Difference : -5 % to 5 %

The turbidity meter complies \* / ~~does not comply~~ \* with the specified requirements and is deemed acceptable \* / ~~unacceptable~~ \* for use. Measurements are traceable to national standards.

Prepared by : 

Checked by : 



## Performance Check of Turbidity Meter

Equipment Ref. No. : ET/0505/011 Manufacturer : HACH

Model No. : 2100Q Serial No. : 11110 C 014260

Date of Calibration : 19/01/2016 Due Date : 18/02/2016

Ref. No. of Turbidity Standard used (4000NTU)

005/6.1/001/10

Theoretical Value of Turbidity Standard (NTU)	Measured Value (NTU)	Difference % *
20	20.8	4.00
100	97.4	-2.60
800	786	-1.75

(\* ) Difference = (Measured Value – Theoretical Value) / Theoretical Value x 100

Acceptance Criteria

Difference : -5 % to 5 %

The turbidity meter complies \* / ~~does not comply~~ \* with the specified requirements and is deemed acceptable \* / ~~unacceptable~~ \* for use. Measurements are traceable to national standards.

Prepared by : 

Checked by : 

Annex C

## QA/QC Results for Suspended Solids Testing





**QA/QC Results of Laboratory Analysis of Total Suspended Solids**

Sampling Date	QC Sample	Sample Duplicate		Sample Spike	
	% Recovery *	Sample ID	% Error #	Sample ID	% Recovery @
1/13/2016	97.6	FC1-S1	4.08	FG3-B2	107.3
	99.7	FSR2-M1	6.06	FSR3-M2	98.7
	98.6	FSR3-B1	0.00	FC2 -B2	93.9
	98.2	EC1-S1	4.08	EG3-B2	95.5
	101.9	ESR2-M1	8.70	ESR3-M2	93.2
	100.4	ESR3-B1	5.71	EC2-B2	102.1

Note: (\*) % Recovery of QC sample should be between 85.5% to 113.5%.  
 (#) % Error of Sample Duplicate should be between 0% to 10%.  
 (@) % Recovery of Sample Spike should be between 80% to 120%.  
 (\*\*) % Error of Sample Duplicate >10% but invalid due to sample results less than PQL (2.0 mg/L).

Sampling Date	QC Sample	Sample Duplicate		Sample Spike	
	% Recovery *	Sample ID	% Error #	Sample ID	% Recovery @
1/15/2016	106.2	FC1-S1	8.00	FSR3-M2	100.3
	94.6	FSR3-B1	3.39	FG1-B2	101.3
	104.5	FG2-M1	3.70	FG3 -B2	104.1
	101.8	EC1-S1	9.05	ESR3-M2	95.0
	103.7	ESR3-B1	9.14	EG1-B2	97.4
	95.8	EG2-M1	2.78	EG3-B2	97.4

Note: (\*) % Recovery of QC sample should be between 85.5% to 113.5%.  
 (#) % Error of Sample Duplicate should be between 0% to 10%.  
 (@) % Recovery of Sample Spike should be between 80% to 120%.  
 (\*\*) % Error of Sample Duplicate >10% but invalid due to sample results less than PQL (2.0 mg/L).

Sampling Date	QC Sample	Sample Duplicate		Sample Spike	
	% Recovery *	Sample ID	% Error #	Sample ID	% Recovery @
1/20/2016	106.6	FC1-S1	0.00	FSR1-M2	96.5
	101.9	FG3-S1	0.00	FSR4-M2	104.1
	97.4	FSR4-B1	6.06	FC2 -B2	96.1
	102.1	EC1-S1	7.41	ESR1-M2	99.5
	102.2	EG3-S1	0.00	ESR4-M2	105.4
	97.4	ESR4-B1	7.41	EC2-B2	102.0

Note: (\*) % Recovery of QC sample should be between 85.5% to 113.5%.  
 (#) % Error of Sample Duplicate should be between 0% to 10%.  
 (@) % Recovery of Sample Spike should be between 80% to 120%.  
 (\*\*) % Error of Sample Duplicate >10% but invalid due to sample results less than PQL (2.0 mg/L).


Sampling Date	QC Sample	Sample Duplicate		Sample Spike	
	% Recovery *	Sample ID	% Error #	Sample ID	% Recovery @
1/22/2016	102.8	FC1-S1	0.00	FSR3-M2	107.8
	99.5	FSR3-B1	5.71	FG1-B2	100.7
	98.6	FG2-M1	7.41	EC2 -B2	96.7
	92.3	ESR1-M1	0.00	ESR5-M2	96.4
	105.5	ESR5-B1	4.88	EG3-B2	106.9

Note: (\*) % Recovery of QC sample should be between 85.5% to 113.5%.  
 (#) % Error of Sample Duplicate should be between 0% to 10%.  
 (@) % Recovery of Sample Spike should be between 80% to 120%.  
 (\*\*) % Error of Sample Duplicate >10% but invalid due to sample results less than PQL (2.0 mg/L).

Annex D

## Fourth and Fifth Week Water Quality Monitoring Results

### Mid-ebb Dissolved Oxygen (Surface)

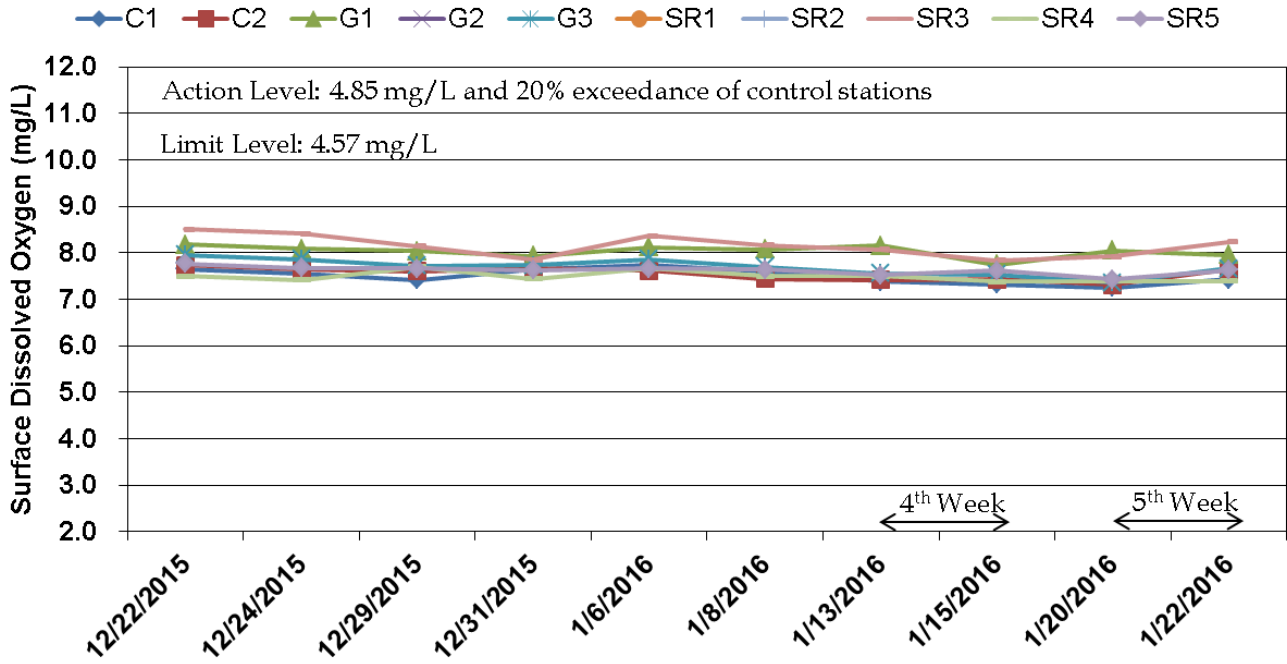

### Mid-flood Dissolved Oxygen (Surface)


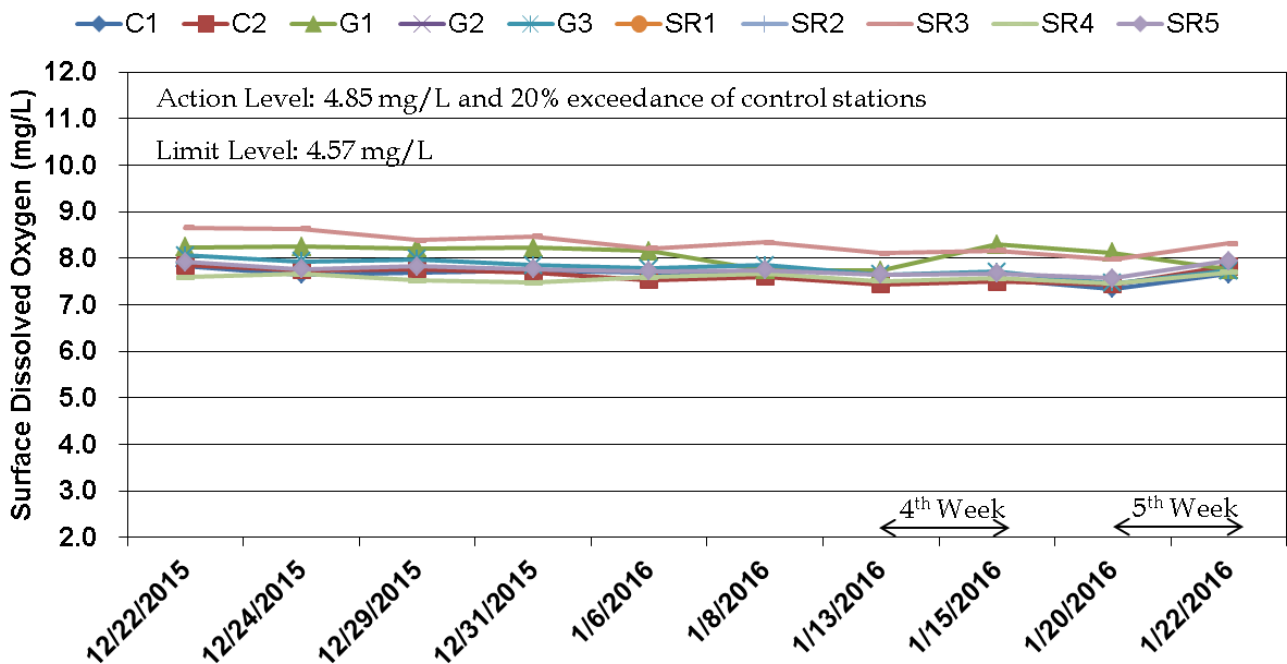


Figure D1 Dissolved oxygen (mg/L) at surface of water column measured during the impact monitoring period from 21 December 2015 to 24 January 2016



### Mid-ebb Dissolved Oxygen (Mid-depth)

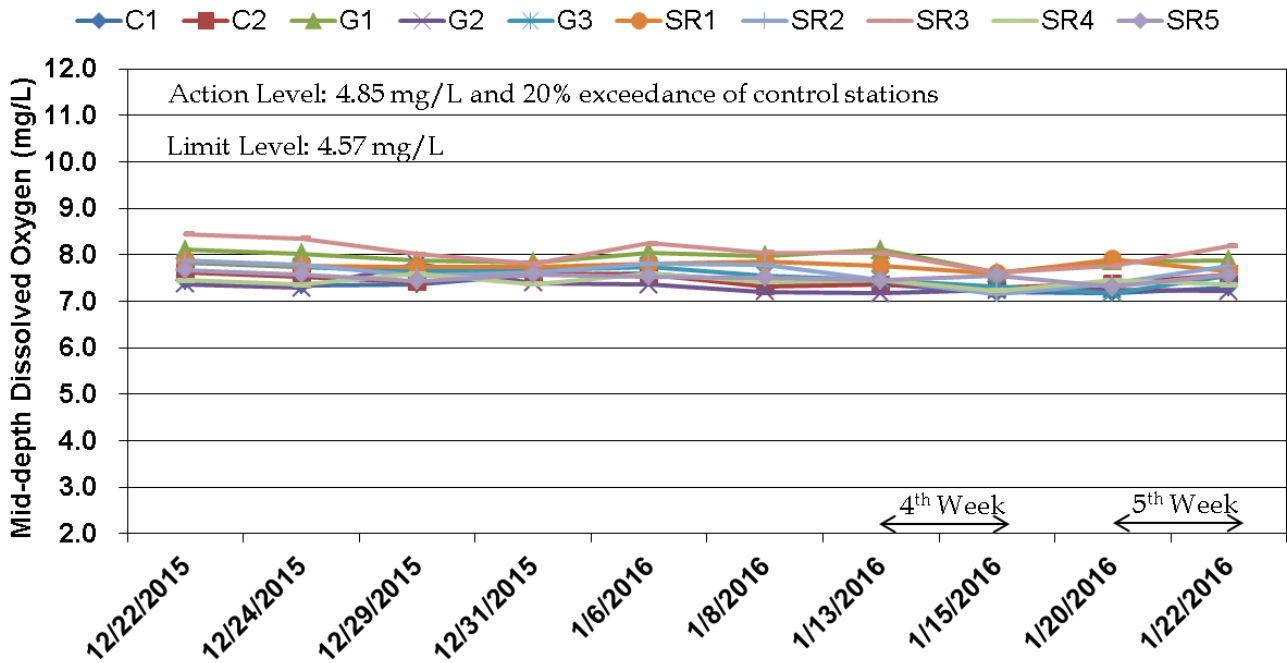

### Mid-flood Dissolved Oxygen (Mid-depth)


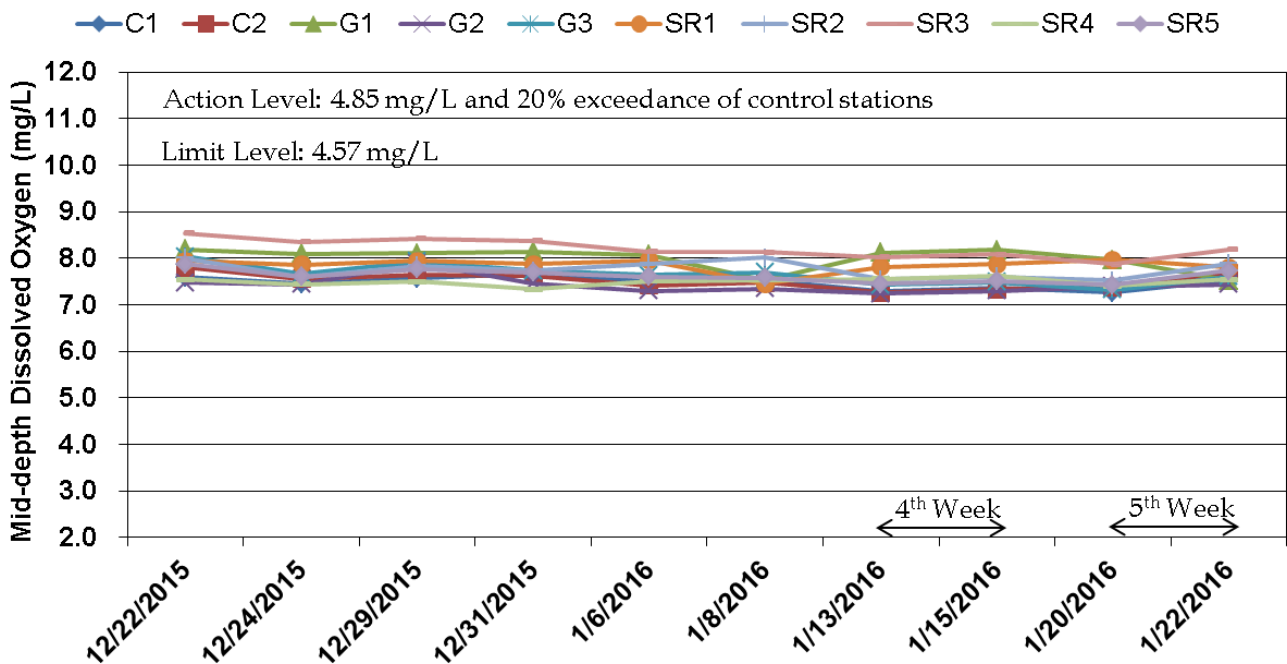


Figure D2 Dissolved oxygen (mg/L) at mid-depth of water column measured during the impact monitoring period from 21 December 2015 to 24 January 2016



### Mid-ebb Dissolved Oxygen (Bottom)

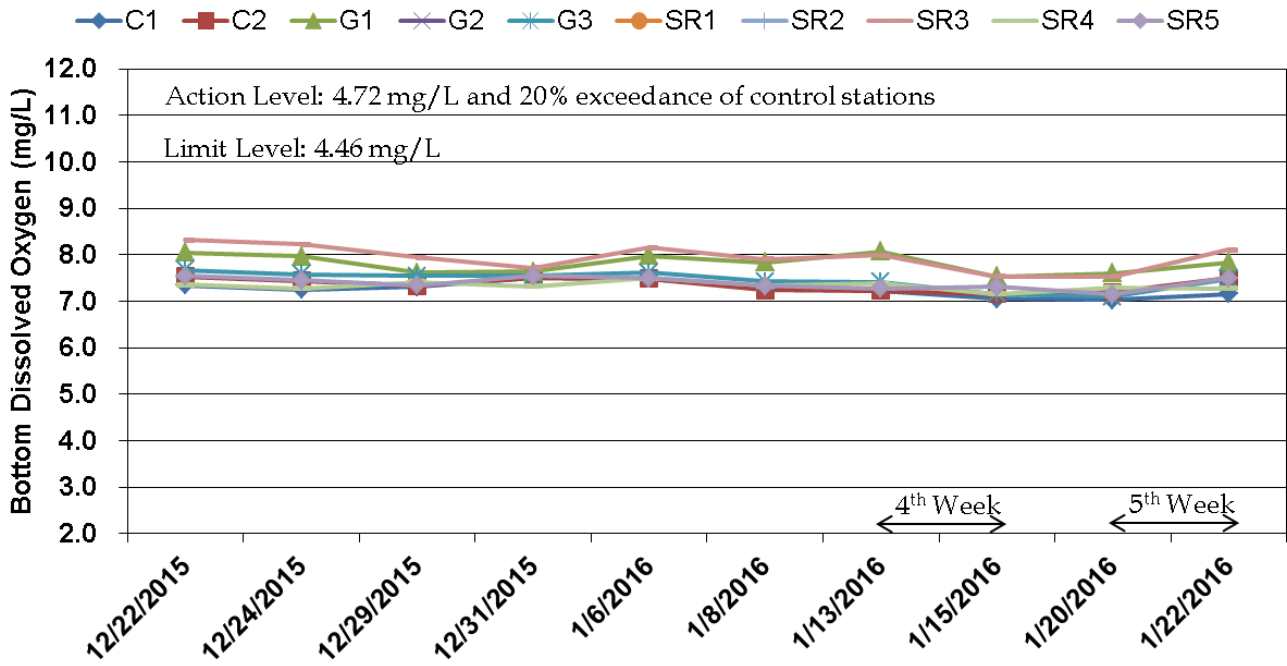

### Mid-flood Dissolved Oxygen (Bottom)

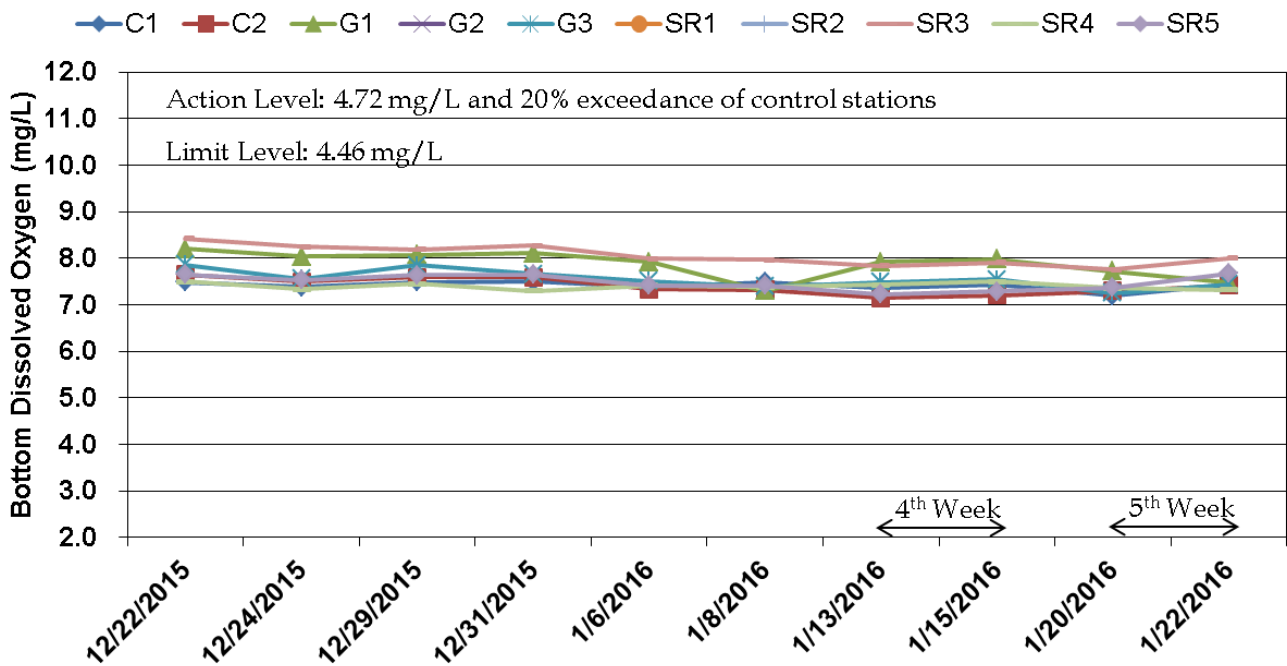


Figure D3 Dissolved oxygen (mg/L) at bottom of water column measured during the impact monitoring period from 21 December 2015 to 24 January 2016





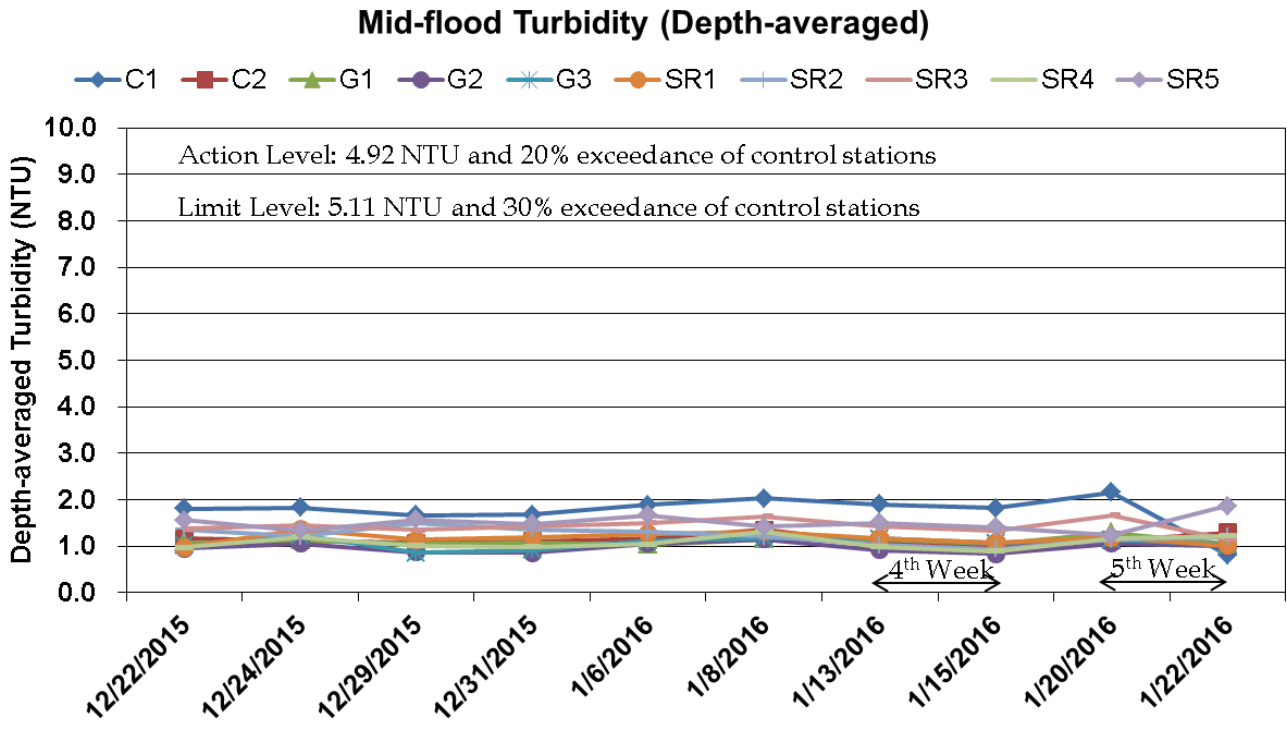


Figure D4 Depth-averaged turbidity (NTU) of water column measured during the impact monitoring period from 21 December 2015 to 24 January 2016

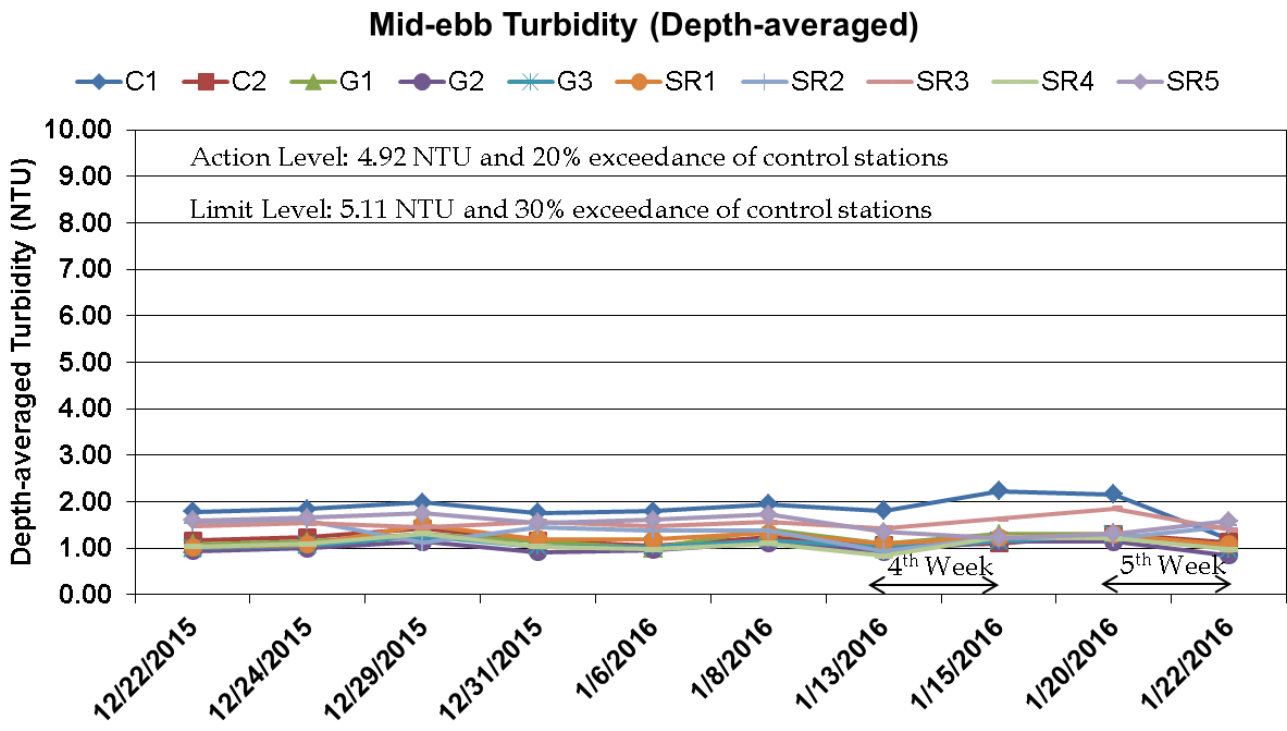

### Mid-ebb Suspended Solids (Depth-averaged)

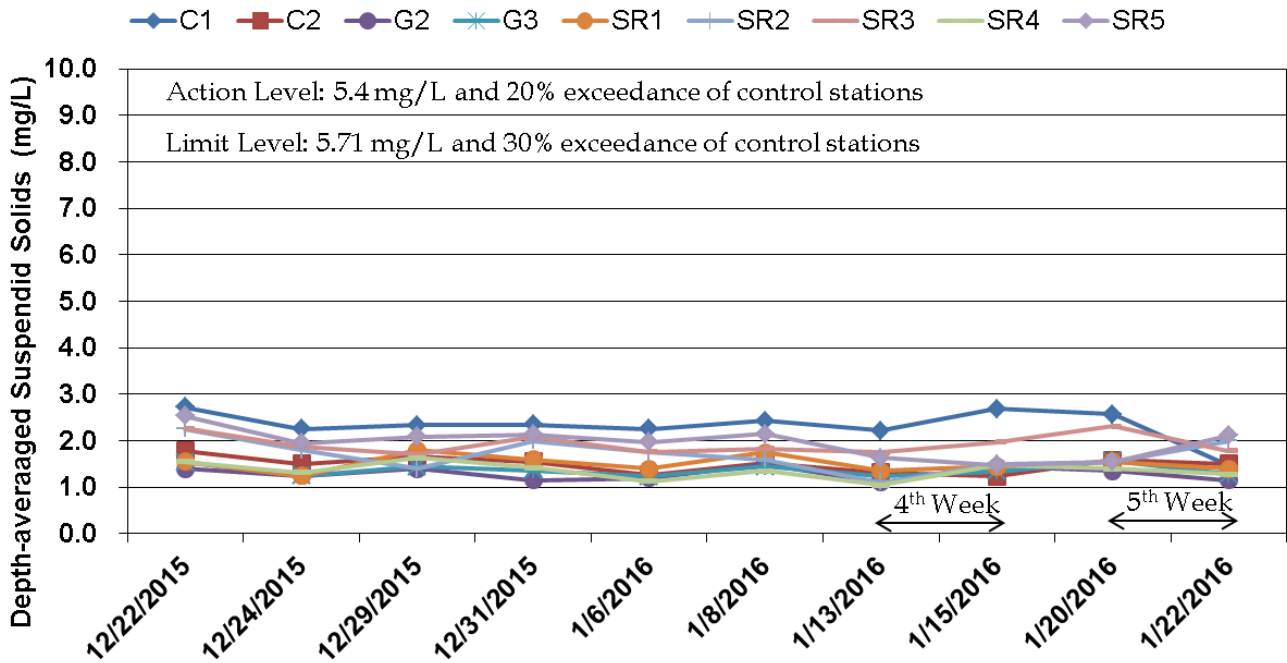

### Mid-flood Suspended Solids (Depth-averaged)

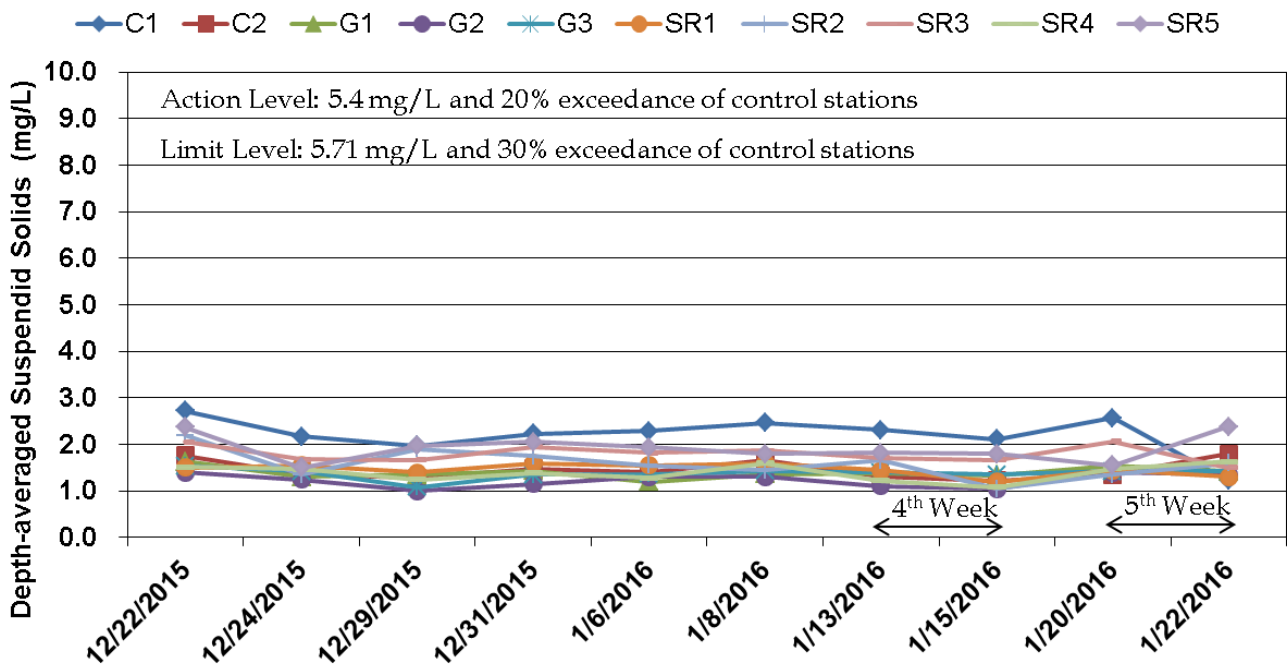


Figure D5 Depth-averaged suspended solid (mg/L) of water column measured during the impact monitoring period from 21 December 2015 to 24 January 2016



Date: 13-Jan-16  
Tide: Mid-Flood  
Weather: Cloudy  
Sea Conditions: Small Wave

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	0919-0927	13.2	S	0.1	Surface	19.3	19.4	19.4	32.1	32.2	32.2	7.5	7.5	7.5	98.1	98.8	98.5	2.0	2.0	2.0		2.5	2.4	2.5	
					Middle	19.4	19.4	19.4	32.3	32.4	32.4	7.3	7.3	7.3	96.2	95.8	96.0	1.8	1.8	1.8	1.9	2.2	2.1	2.2	2.3
					Bottom	19.3	19.2	19.3	32.5	32.6	32.6	7.4	7.4	7.4	96.2	97.0	96.6	2.0	1.9	1.9		2.4	2.3	2.4	
C2	1042-1049	13.2	S	0.1	Surface	19.7	19.7	19.7	32.2	32.3	32.3	7.5	7.4	7.4	98.1	97.7	97.9	0.9	1.0	1.0		1.1	1.3	1.2	
					Middle	19.6	19.6	19.6	32.4	32.5	32.5	7.3	7.3	7.3	95.8	95.3	95.6	1.0	1.1	1.1	1.1	1.2	1.4	1.3	1.3
					Bottom	19.6	19.5	19.6	32.5	32.5	32.5	7.1	7.2	7.1	93.7	94.1	93.9	1.2	1.2	1.2		1.5	1.4	1.5	
G1	0941-0948	11.7	S	0.1	Surface	19.3	19.3	19.3	32.2	32.3	32.3	8.3	7.2	7.7	108.6	107.9	108.3	1.2	1.1	1.1		1.4	1.3	1.4	
					Middle	19.3	19.4	19.4	32.3	32.4	32.4	8.1	8.1	8.1	107.0	106.6	106.8	0.9	1.0	1.0	1.2	1.1	1.2	1.2	1.4
					Bottom	19.4	19.3	19.4	32.4	32.5	32.5	7.9	7.9	7.9	104.4	103.9	104.2	1.3	1.4	1.4		1.6	1.7	1.7	
G2	1008-1012	2.2	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.5	19.5	19.5	32.3	32.3	32.3	7.3	7.2	7.2	95.6	94.1	94.9	1.0	0.9	0.9	0.9	1.1	1.1	1.1	1.1
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	0959-1006	15.5	S	0.1	Surface	19.4	19.5	19.5	32.2	32.3	32.3	7.6	7.7	7.7	100.3	100.8	100.6	0.9	0.9	0.9		1.1	1.1	1.1	
					Middle	19.4	19.4	19.4	32.4	32.5	32.5	7.4	7.4	7.4	97.8	97.4	97.6	1.3	1.2	1.2	1.2	1.5	1.4	1.5	1.4
					Bottom	19.4	19.3	19.4	32.6	32.7	32.7	7.5	7.5	7.5	98.2	98.6	98.4	1.4	1.3	1.4		1.7	1.6	1.7	
SR1	0951-0956	2.2	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.4	19.5	19.5	32.1	32.2	32.2	7.8	7.8	7.8	103.1	102.4	102.8	1.1	1.2	1.2	1.2	1.4	1.5	1.5	1.5
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	1015-1019	1.8	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.5	19.6	19.6	32.2	32.3	32.3	7.6	7.5	7.6	99.6	98.3	99.0	1.0	1.1	1.0	1.0	1.6	1.7	1.7	1.7
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	0930-0938	6.8	S	0.1	Surface	19.4	19.3	19.4	32.0	32.1	32.1	8.1	8.1	8.1	106.7	106.3	106.5	1.5	1.6	1.5		1.7	1.8	1.8	
					Middle	19.3	19.3	19.3	32.2	32.2	32.2	8.0	8.0	8.0	105.7	105.3	105.5	1.3	1.3	1.3	1.4	1.6	1.7	1.7	1.7
					Bottom	19.4	19.4	19.4	32.3	32.3	32.3	7.8	7.9	7.8	102.9	103.3	103.1	1.4	1.5	1.4		1.7	1.8	1.8	
SR4	1033-1040	6.4	S	0.1	Surface	19.7	19.6	19.7	32.4	32.4	32.4	7.5	7.5	7.5	99.0	98.4	98.7	1.0	0.9	1.0		1.3	1.2	1.3	
					Middle	19.7	19.7	19.7	32.3	32.4	32.4	7.6	7.6	7.6	99.3	99.5	99.4	0.9	0.9	0.9	1.0	1.1	1.0	1.1	1.2
					Bottom	19.6	19.6	19.6	32.4	32.5	32.5	7.5	7.4	7.4	98.1	97.4	97.8	1.1	1.1	1.1		1.3	1.4	1.4	
SR5	1022-1030	9.7	S	0.1	Surface	19.6	19.7	19.7	32.3	32.4	32.4	7.6	7.7	7.7	100.4	99.9	100.2	1.2	1.3	1.3		1.5	1.6	1.6	
					Middle	19.6	19.6	19.6	32.4	32.5	32.5	7.5	7.4	7.5	98.3	97.7	98.0	1.5	1.5	1.5	1.5	1.8	1.9	1.9	1.8
					Bottom	19.5	19.5	19.5	32.6	32.6	32.6	7.2	7.2	7.2	95.2	94.8	95.0	1.7	1.8	1.7		2.0	2.1	2.1	

Remark or Observation:

1. \* Average; \*\* Depth Average

2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.



Date: 13-Jan-16  
Tide: Mid-Ebb  
Weather: Fine  
Sea Conditions: Small Wave

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	1253-1303	13.0	N	0.2	Surface	19.6	19.8	19.7	32.3	32.2	32.3	7.4	7.4	7.4	97.3	96.8	97.1	2.0	2.0	2.0	1.8	2.5	2.4	2.5	2.2
					Middle	19.4	19.6	19.5	32.4	32.2	32.3	7.4	7.3	7.4	96.9	96.5	96.7	1.7	1.8	1.7	2.1	2.2	2.2	2.2	
					Bottom	19.3	19.4	19.4	32.0	32.3	32.2	7.2	7.3	7.2	94.8	95.5	95.2	1.7	1.7	1.7	2.0	2.1	2.1		
C2	1450-1500	13.0	N	0.1	Surface	19.6	19.4	19.5	32.4	32.2	32.3	7.4	7.4	7.4	97.4	97.6	97.5	0.9	0.9	0.9	1.1	1.2	1.2	1.3	
					Middle	19.3	19.5	19.4	32.3	32.2	32.3	7.4	7.3	7.4	96.9	96.5	96.7	1.1	1.0	1.0	1.4	1.2	1.3	1.3	
					Bottom	19.1	19.0	19.1	32.4	32.2	32.3	7.3	7.2	7.2	95.5	94.8	95.2	1.2	1.2	1.2	1.4	1.5	1.5		
G1	1320-1330	11.4	N	0.1	Surface	19.6	19.4	19.5	32.1	32.2	32.2	8.2	8.1	8.2	107.4	107.0	107.2	1.1	1.2	1.2	1.1	1.4	1.4	1.4	1.3
					Middle	19.3	19.4	19.4	32.3	32.1	32.2	8.1	8.1	8.1	106.5	106.8	106.7	0.9	0.9	0.9	1.1	1.1	1.1	1.1	
					Bottom	19.1	19.4	19.3	32.2	32.3	32.3	8.1	8.1	8.1	106.4	105.9	106.2	1.2	1.3	1.2	1.5	1.5	1.5		
G2	1359-1406	2.1	N	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---		
					Middle	19.4	19.6	19.5	32.3	32.2	32.3	7.2	7.2	7.2	94.2	94.4	94.3	0.9	0.9	0.9	0.9	1.0	1.2	1.1	1.1
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	1345-1355	15.2	N	0.1	Surface	19.4	19.7	19.6	32.4	32.1	32.3	7.5	7.6	7.6	99.2	99.5	99.4	0.8	0.8	0.8	1.0	1.0	1.0	1.2	
					Middle	19.6	19.5	19.6	32.3	32.2	32.3	7.5	7.4	7.5	98.4	97.8	98.1	1.0	1.0	1.0	1.0	1.2	1.2	1.2	1.2
					Bottom	19.3	19.4	19.4	32.3	32.2	32.3	7.4	7.4	7.4	97.4	97.6	97.5	1.3	1.2	1.2	1.5	1.5	1.5		
SR1	1334-1341	2.0	N	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---		
					Middle	19.2	19.4	19.3	32.3	32.4	32.4	7.8	7.8	7.8	102.2	102.0	102.1	1.1	1.1	1.1	1.1	1.3	1.4	1.4	1.4
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	1410-1416	1.6	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---		
					Middle	19.3	19.6	19.5	32.0	32.2	32.1	7.4	7.5	7.5	97.8	98.2	98.0	0.9	0.9	0.9	0.9	1.1	1.1	1.1	1.1
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	1307-1317	6.4	N	0.1	Surface	19.7	19.9	19.8	32.1	32.4	32.3	8.1	8.1	8.1	106.1	106.4	106.3	1.5	1.5	1.5	1.4	1.8	1.9	1.9	1.8
					Middle	19.6	19.6	19.6	32.3	32.1	32.2	8.0	8.1	8.0	105.8	105.9	105.9	1.3	1.4	1.3	1.5	1.7	1.6	1.8	
					Bottom	19.5	19.6	19.6	32.4	32.3	32.4	8.0	8.0	8.0	105.3	104.9	105.1	1.4	1.5	1.5	1.8	1.8	1.8		
SR4	1436-1446	6.2	N	0.1	Surface	19.7	19.4	19.6	32.4	32.1	32.3	7.5	7.5	7.5	98.8	98.6	98.7	0.9	0.9	0.9	0.8	1.2	1.1	1.2	1.1
					Middle	19.3	19.3	19.3	32.2	32.4	32.3	7.5	7.4	7.5	98.1	97.8	98.0	0.7	0.8	0.8	0.8	1.1	0.9	1.0	1.1
					Bottom	19.1	19.2	19.2	32.3	32.4	32.4	7.4	7.4	7.4	96.9	97.2	97.1	0.9	0.9	0.9	0.9	0.9	1.1	1.0	
SR5	1421-1431	9.6	N	0.1	Surface	19.6	19.7	19.7	32.4	32.5	32.5	7.5	7.5	7.5	98.6	99.2	98.9	1.2	1.3	1.2	1.4	1.5	1.5	1.5	
					Middle	19.4	19.2	19.3	32.3	32.5	32.4	7.5	7.4	7.5	98.4	97.7	98.1	1.3	1.4	1.3	1.7	1.6	1.7	1.6	
					Bottom	19.3	19.1	19.2	32.4	32.2	32.3	7.3	7.3	7.3	95.6	95.9	95.8	1.5	1.5	1.5	1.7	1.8	1.8		

Remark or Observation:

1. \* Average; \*\* Depth Average

2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

Date: 15-Jan-16  
Tide: Mid-Flood  
Weather: Cloudy  
Sea Conditions: Small Wave

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	0942-0952	13.6	S	0.1	Surface	19.4	19.5	19.5	32.3	32.2	32.3	7.5	7.6	7.5	99.0	99.7	99.4	2.0	1.9	1.9		2.2	2.2	2.2	
					Middle	19.5	19.4	19.5	32.4	32.5	32.5	7.4	7.4	7.4	97.0	96.7	96.9	1.7	1.7	1.7	1.8	2.1	2.0	2.1	2.1
					Bottom	19.4	19.3	19.4	32.6	32.7	32.7	7.4	7.4	7.4	97.1	97.8	97.5	1.9	1.8	1.8		2.2	2.0	2.1	
C2	1202-1212	13.4	S	0.1	Surface	19.8	19.7	19.8	32.3	32.4	32.4	7.5	7.5	7.5	99.0	98.6	98.8	0.8	0.9	0.9		1.1	1.1	1.1	
					Middle	19.6	19.7	19.7	32.5	32.6	32.6	7.4	7.3	7.3	96.7	96.1	96.4	1.0	1.0	1.0	1.0	1.1	1.3	1.2	1.2
					Bottom	19.7	19.7	19.7	32.6	32.7	32.7	7.2	7.2	7.2	94.5	94.9	94.7	1.1	1.1	1.1		1.3	1.4	1.4	
G1	1012-1022	12.2	S	0.1	Surface	19.4	19.3	19.4	32.3	32.4	32.4	8.3	8.3	8.3	109.5	108.8	109.2	1.1	1.0	1.0		1.4	1.4	1.4	
					Middle	19.4	19.5	19.5	32.4	32.5	32.5	8.2	8.2	8.2	107.8	107.4	107.6	0.9	0.9	0.9	1.1	1.0	1.1	1.1	1.3
					Bottom	19.5	19.4	19.5	32.5	32.6	32.6	8.0	8.0	8.0	105.3	104.8	105.1	1.2	1.3	1.3		1.6	1.5	1.6	
G2	1057-1107	2.6	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.6	19.5	19.6	32.3	32.4	32.4	7.3	7.3	7.3	96.5	95.9	96.2	0.9	0.8	0.8	0.8	1.1	1.0	1.1	1.1
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	1042-1052	15.8	S	0.1	Surface	19.5	19.6	19.6	32.3	32.4	32.4	7.7	7.7	7.7	101.2	101.6	101.4	0.8	0.8	0.8		1.0	1.1	1.1	
					Middle	19.5	19.5	19.5	32.6	32.5	32.6	7.5	7.5	7.5	98.7	98.2	98.5	1.2	1.1	1.1	1.1	1.5	1.4	1.5	1.4
					Bottom	19.5	19.4	19.5	32.7	32.8	32.8	7.5	7.6	7.5	99.1	99.5	99.3	1.3	1.2	1.3		1.6	1.5	1.6	
SR1	1027-1037	2.4	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.5	19.6	19.6	32.2	32.3	32.3	7.9	7.9	7.9	104.0	103.3	103.7	1.0	1.1	1.1	1.1	1.1	1.3	1.2	1.2
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	1112-1122	2.2	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.7	19.6	19.7	32.3	32.4	32.4	7.6	7.6	7.6	100.5	99.8	100.2	0.9	1.0	0.9	0.9	1.0	1.1	1.1	1.1
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	0957-1007	7.2	S	0.1	Surface	19.5	19.4	19.5	32.1	32.2	32.2	8.2	8.2	8.2	107.6	107.2	107.4	1.4	1.5	1.4		1.7	1.9	1.8	
					Middle	19.4	19.3	19.4	32.2	32.3	32.3	8.1	8.1	8.1	106.6	106.2	106.4	1.2	1.2	1.2	1.3	1.3	1.5	1.4	1.7
					Bottom	19.3	19.4	19.4	32.4	32.5	32.5	7.9	7.9	7.9	103.8	104.1	104.0	1.3	1.4	1.3		1.8	1.8	1.8	
SR4	1147-1157	6.8	S	0.1	Surface	19.8	19.7	19.8	32.4	32.5	32.5	7.6	7.6	7.6	99.9	99.3	99.6	0.9	0.9	0.9		1.1	0.9	1.0	
					Middle	19.8	19.8	19.8	32.5	32.6	32.6	7.6	7.6	7.6	100.1	100.3	100.2	0.8	0.8	0.8	0.9	0.9	1.1	1.0	1.1
					Bottom	19.7	19.6	19.7	32.6	32.7	32.7	7.5	7.5	7.5	99.0	98.2	98.6	1.0	1.0	1.0		1.2	1.3	1.3	
SR5	1127-1137	10.2	S	0.1	Surface	19.7	19.8	19.8	32.4	32.5	32.5	7.7	7.7	7.7	101.3	100.7	101.0	1.2	1.2	1.2		1.6	1.5	1.6	
					Middle	19.6	19.7	19.7	32.5	32.6	32.6	7.5	7.5	7.5	99.2	98.6	98.9	1.4	1.4	1.4	1.4	1.8	1.8	1.8	1.8
					Bottom	19.6	19.5	19.6	32.6	32.7	32.7	7.3	7.3	7.3	96.1	95.7	95.9	1.6	1.7	1.7		1.9	2.2	2.1	

Remark or Observation:

1. \* Average; \*\* Depth Average

2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

Date: 15-Jan-16  
Tide: Mid-Ebb  
Weather: Cloudy  
Sea Conditions: Small Wave

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	1440-1455	13.3	S	0.1	Surface	18.0	17.9	18.0	32.0	32.1	32.1	7.3	7.3	7.3	93.6	93.4	93.5	2.1	2.1	2.1		2.5	2.6	2.6	
					Middle	17.8	17.7	17.8	32.2	32.3	32.3	7.2	7.2	7.2	91.7	91.5	91.6	2.2	2.3	2.2	2.2	2.9	2.7	2.8	2.7
					Bottom	17.6	17.7	17.7	32.4	32.5	32.5	7.0	7.1	7.1	89.4	89.6	89.5	2.3	2.4	2.3		2.8	2.6	2.7	
C2	1659-1710	13.1	S	0.2	Surface	18.1	18.2	18.2	32.0	32.1	32.1	7.4	7.4	7.4	95.1	94.9	95.0	1.0	1.0	1.0		1.1	1.2	1.2	
					Middle	18.0	17.9	18.0	32.2	32.3	32.3	7.3	7.3	7.3	93.0	92.8	92.9	1.1	1.1	1.1	1.1	1.2	1.2	1.2	1.2
					Bottom	17.7	17.6	17.7	32.4	32.4	32.4	7.2	7.2	7.2	91.0	90.8	90.9	1.2	1.2	1.2		1.4	1.3	1.4	
G1	1520-1535	11.9	S	0.1	Surface	18.1	18.0	18.1	32.1	32.2	32.2	7.7	7.8	7.8	98.9	100.0	99.5	1.1	1.1	1.1		1.4	1.4	1.4	
					Middle	17.7	17.8	17.8	32.3	32.3	32.3	7.6	7.6	7.6	96.9	97.1	97.0	1.3	1.4	1.4	1.3	1.6	1.7	1.7	1.6
					Bottom	17.7	17.7	17.7	32.4	32.4	32.4	7.5	7.5	7.5	95.6	95.4	95.5	1.4	1.4	1.4		1.7	1.9	1.8	
G2	1620-1625	2.4	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	17.6	17.7	17.7	32.1	32.2	32.2	7.3	7.2	7.2	92.3	92.1	92.2	1.1	1.2	1.1	1.1	1.5	1.4	1.5	1.5
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	1600-1615	15.5	S	0.2	Surface	18.1	18.0	18.1	32.0	32.1	32.1	7.6	7.5	7.5	96.4	96.2	96.3	1.0	1.0	1.0		1.2	1.1	1.2	
					Middle	17.9	17.8	17.9	32.2	32.3	32.3	7.3	7.3	7.3	93.0	93.3	93.2	1.1	1.1	1.1	1.2	1.4	1.2	1.3	1.3
					Bottom	17.7	17.6	17.7	32.4	32.5	32.5	7.2	7.2	7.2	91.1	90.9	91.0	1.3	1.3	1.3		1.7	1.4	1.6	
SR1	1540-1555	2.2	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	17.6	17.7	17.7	32.1	32.2	32.2	7.6	7.6	7.6	96.6	96.8	96.7	1.2	1.2	1.2	1.2	1.5	1.4	1.5	1.5
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	1626-1631	2.0	S	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	17.8	17.9	17.9	32.0	32.0	32.0	7.2	7.2	7.2	91.0	91.3	91.2	1.2	1.3	1.3	1.3	1.6	1.4	1.5	1.5
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	1500-1515	7.0	S	0.2	Surface	17.9	17.8	17.9	32.0	32.0	32.0	7.9	7.8	7.8	100.3	100.1	100.2	1.5	1.5	1.5		1.6	1.8	1.7	
					Middle	17.7	17.7	17.7	32.1	32.2	32.2	7.6	7.6	7.6	96.9	97.1	97.0	1.7	1.7	1.7	1.6	2.0	2.0	2.0	2.0
					Bottom	17.5	17.6	17.6	32.3	32.4	32.4	7.6	7.5	7.5	95.8	95.6	95.7	1.7	1.8	1.7		2.1	2.3	2.2	
SR4	1645-1655	6.5	S	0.2	Surface	18.0	18.1	18.1	32.1	32.2	32.2	7.4	7.4	7.4	94.1	94.3	94.2	1.1	1.1	1.1		1.2	1.5	1.4	
					Middle	17.8	17.8	17.8	32.3	32.3	32.3	7.2	7.2	7.2	91.9	92.1	92.0	1.3	1.3	1.3	1.2	1.5	1.4	1.5	1.5
					Bottom	17.6	17.5	17.6	32.4	32.5	32.5	7.2	7.2	7.2	90.8	91.0	90.9	1.3	1.4	1.3		1.6	1.7	1.7	
SR5	1633-1643	9.9	S	0.1	Surface	18.1	18.1	18.1	32.1	32.2	32.2	7.6	7.6	7.6	97.3	97.5	97.4	1.1	1.1	1.1		1.4	1.3	1.4	
					Middle	17.9	17.8	17.9	32.3	32.3	32.3	7.6	7.6	7.6	96.4	96.2	96.3	1.2	1.3	1.2	1.2	1.4	1.5	1.5	1.5
					Bottom	17.7	17.6	17.7	32.4	32.4	32.4	7.3	7.3	7.3	92.9	92.7	92.8	1.3	1.3	1.3		1.7	1.6	1.7	

Remark or Observation:  
1. \* Average; \*\* Depth Average  
2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

Date: 20-Jan-16  
Tide: Mid-Flood  
Weather: Drizzle  
Sea Conditions: Small Wave

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	1315-1331	13.3	N	0.2	Surface	19.3	19.4	19.4	31.8	31.9	31.9	7.3	7.4	7.4	95.9	96.2	96.1	2.0	2.1	2.1		2.4	2.5	2.5	
					Middle	19.2	19.3	19.3	32.0	32.0	32.0	7.3	7.2	7.3	95.3	94.8	95.1	2.2	2.2	2.2	2.2	2.6	2.6	2.6	2.6
					Bottom	19.2	19.1	19.2	32.1	32.1	32.1	7.2	7.2	7.2	94.3	93.9	94.1	2.2	2.2	2.2		2.7	2.6	2.7	
C2	1536-1545	13.4	N	0.2	Surface	19.3	19.2	19.3	31.7	31.8	31.8	7.4	7.5	7.4	97.3	97.5	97.4	1.0	1.0	1.0		1.1	1.1	1.1	
					Middle	19.2	19.1	19.2	31.9	31.8	31.9	7.4	7.4	7.4	96.9	96.5	96.7	1.1	1.1	1.1	1.1	1.4	1.3	1.4	1.4
					Bottom	19.1	19.0	19.1	32.0	32.1	32.1	7.3	7.3	7.3	95.6	95.4	95.5	1.3	1.3	1.3		1.5	1.7	1.6	
G1	1355-1410	11.8	N	0.2	Surface	19.3	19.2	19.3	31.8	31.7	31.8	8.1	8.1	8.1	105.9	106.3	106.1	1.3	1.2	1.2		1.5	1.5	1.5	
					Middle	19.2	19.2	19.2	31.8	31.9	31.9	8.0	8.0	8.0	104.1	104.3	104.2	1.3	1.2	1.3	1.3	1.4	1.5	1.5	1.5
					Bottom	19.1	19.1	19.1	32.0	31.9	32.0	7.7	7.7	7.7	100.7	101.2	101.0	1.4	1.3	1.4		1.7	1.6	1.7	
G2	1442-1447	2.3	N	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.3	19.3	19.3	31.8	31.9	31.9	7.4	7.4	7.4	96.6	96.9	96.8	1.0	1.1	1.1	1.1	1.3	1.5	1.4	1.4
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	1424-1438	15.6	N	0.2	Surface	19.3	19.4	19.4	31.8	31.9	31.9	7.5	7.4	7.5	97.8	97.3	97.6	1.0	0.9	0.9		1.1	1.1	1.1	
					Middle	19.2	19.3	19.3	32.0	32.1	32.1	7.3	7.3	7.3	95.6	95.8	95.7	1.1	1.2	1.2	1.1	1.5	1.5	1.5	1.4
					Bottom	19.2	19.1	19.2	32.2	32.1	32.2	7.3	7.2	7.3	94.9	94.7	94.8	1.4	1.3	1.4		1.6	1.7	1.7	
SR1	1414-1419	2.4	N	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.3	19.2	19.3	31.7	31.8	31.8	8.0	8.0	8.0	104.3	103.9	104.1	1.2	1.2	1.2	1.2	1.5	1.4	1.5	1.5
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	1452-1457	2.1	N	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.2	19.3	19.3	31.7	31.8	31.8	7.5	7.5	7.5	98.3	98.4	98.4	1.2	1.1	1.2	1.2	1.4	1.3	1.4	1.4
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	1337-1351	6.9	N	0.1	Surface	19.4	19.3	19.4	31.7	31.8	31.8	8.0	8.0	8.0	104.1	104.4	104.3	1.7	1.6	1.7		2.1	2.0	2.1	
					Middle	19.4	19.4	19.4	31.9	31.8	31.9	7.9	7.9	7.9	102.5	103.1	102.8	1.5	1.6	1.6	1.7	2.0	1.9	2.0	2.1
					Bottom	19.3	19.3	19.3	31.9	32.0	32.0	7.8	7.7	7.8	101.6	101.2	101.4	1.8	1.7	1.8		2.3	2.1	2.2	
SR4	1523-1533	6.8	N	0.2	Surface	19.3	19.2	19.3	31.8	31.7	31.8	7.5	7.5	7.5	97.6	97.8	97.7	1.1	1.1	1.1		1.3	1.3	1.3	
					Middle	19.2	19.3	19.3	31.8	31.8	31.8	7.4	7.4	7.4	96.9	96.7	96.8	1.2	1.2	1.2	1.2	1.4	1.5	1.5	1.5
					Bottom	19.2	19.2	19.2	31.9	31.8	31.9	7.3	7.4	7.4	96.1	96.4	96.3	1.2	1.3	1.2		1.7	1.7	1.7	
SR5	1502-1517	9.8	N	0.2	Surface	19.3	19.4	19.4	31.8	31.9	31.9	7.6	7.6	7.6	98.9	99.1	99.0	1.1	1.2	1.1		1.2	1.6	1.4	
					Middle	19.3	19.3	19.3	31.9	31.9	31.9	7.4	7.5	7.4	97.1	97.5	97.3	1.3	1.2	1.3	1.2	1.7	1.5	1.6	1.6
					Bottom	19.2	19.2	19.2	32.0	32.1	32.1	7.4	7.4	7.4	96.6	96.2	96.4	1.3	1.3	1.3		1.6	1.7	1.7	

Remark or Observation:

1. \* Average; \*\* Depth Average

2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

Date: 20-Jan-16  
 Tide: Mid-Ebb  
 Weather: Drizzle  
 Sea Conditions: Small Wave

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	0820-0835	12.9	N	0.2	Surface	19.1	19.0	19.1	31.6	31.7	31.7	7.2	7.3	7.3	94.4	94.9	94.7	2.1	2.2	2.2		2.8	2.7	2.8	
					Middle	19.0	19.0	19.0	31.8	31.8	31.8	7.2	7.2	7.2	94.0	93.4	93.7	2.0	2.0	2.0	2.2	2.2	2.4	2.3	2.6
					Bottom	19.0	18.9	19.0	32.0	32.1	32.1	7.0	7.1	7.0	91.7	92.0	91.9	2.3	2.3	2.3		2.6	2.7	2.7	
C2	1035-1043	12.9	N	0.2	Surface	19.2	19.1	19.2	31.6	31.6	31.6	7.3	7.3	7.3	95.6	95.2	95.4	1.1	1.1	1.1		1.5	1.4	1.5	
					Middle	19.1	19.1	19.1	31.8	31.8	31.8	7.4	7.4	7.4	96.1	96.6	96.4	1.2	1.3	1.3	1.3	1.5	1.4	1.5	1.6
					Bottom	19.0	19.0	19.0	32.0	31.9	32.0	7.2	7.2	7.2	94.2	93.8	94.0	1.6	1.5	1.5		2.0	1.7	1.9	
G1	0857-0912	11.4	N	0.2	Surface	19.1	19.0	19.1	31.4	31.5	31.5	8.1	8.0	8.1	105.6	104.9	105.3	1.3	1.4	1.4		1.6	1.7	1.7	
					Middle	19.0	19.0	19.0	31.6	31.6	31.6	7.9	7.8	7.9	102.8	102.3	102.6	1.1	1.2	1.2	1.3	1.5	1.4	1.5	1.6
					Bottom	19.0	18.9	19.0	31.8	31.9	31.9	7.6	7.6	7.6	99.6	99.1	99.4	1.4	1.5	1.4		1.7	1.6	1.7	
G2	0944-0951	2.0	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.1	19.1	19.1	31.6	31.7	31.7	7.3	7.2	7.3	95.0	94.2	94.6	1.1	1.2	1.1	1.1	1.4	1.3	1.4	1.4
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	0927-0940	15.2	N	0.2	Surface	19.2	19.1	19.2	31.5	31.6	31.6	7.3	7.4	7.4	95.8	96.3	96.1	1.0	1.1	1.1		1.2	1.5	1.4	
					Middle	19.1	19.1	19.1	31.8	31.8	31.8	7.2	7.2	7.2	94.0	93.6	93.8	1.2	1.3	1.3	1.3	1.5	1.5	1.5	1.6
					Bottom	19.0	19.0	19.0	32.0	32.1	32.1	7.1	7.1	7.1	92.4	92.9	92.7	1.5	1.6	1.5		1.8	1.9	1.9	
SR1	0916-0923	2.0	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.2	19.1	19.2	31.5	31.6	31.6	7.9	7.9	7.9	103.4	102.9	103.2	1.3	1.3	1.3	1.3	1.6	1.5	1.6	1.6
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	0955-1003	1.6	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.2	19.1	19.2	31.6	31.6	31.6	7.4	7.4	7.4	96.6	96.0	96.3	1.3	1.2	1.2	1.2	1.7	1.4	1.6	1.6
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	0838-0852	6.6	N	0.2	Surface	19.1	19.1	19.1	31.6	31.6	31.6	7.9	7.9	7.9	103.6	103.1	103.4	1.8	1.9	1.9		2.4	2.3	2.4	
					Middle	19.1	19.1	19.1	31.8	31.7	31.8	7.8	7.7	7.8	101.5	101.0	101.3	1.8	1.8	1.8	1.9	2.1	2.2	2.2	2.3
					Bottom	19.0	19.0	19.0	31.9	31.9	31.9	7.6	7.5	7.5	98.6	98.0	98.3	1.9	2.0	1.9		2.5	2.4	2.5	
SR4	1025-1032	6.2	N	0.2	Surface	19.2	19.2	19.2	31.6	31.5	31.6	7.4	7.4	7.4	96.3	96.7	96.5	1.2	1.2	1.2		1.5	1.5	1.5	
					Middle	19.2	19.1	19.2	31.6	31.6	31.6	7.4	7.5	7.5	97.1	97.5	97.3	1.1	1.1	1.1	1.2	1.2	1.3	1.3	1.4
					Bottom	19.1	19.1	19.1	31.7	31.8	31.8	7.3	7.3	7.3	95.6	95.2	95.4	1.3	1.4	1.3		1.4	1.5	1.5	
SR5	1008-1020	9.4	N	0.2	Surface	19.2	19.2	19.2	31.6	31.6	31.6	7.5	7.4	7.4	97.2	96.7	97.0	1.3	1.2	1.2		1.5	1.4	1.5	
					Middle	19.2	19.2	19.2	31.8	31.8	31.8	7.3	7.3	7.3	95.6	95.3	95.5	1.4	1.3	1.3	1.3	1.7	1.5	1.6	1.6
					Bottom	19.1	19.0	19.1	32.0	32.0	32.0	7.2	7.1	7.2	93.6	92.7	93.2	1.4	1.4	1.4		1.7	1.5	1.6	

Remark or Observation:

1. \* Average; \*\* Depth Average

2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

Date: 22-Jan-16  
Tide: Mid-Flood  
Weather: Cloudy  
Sea Conditions: Calm

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	1507-1522	12.5	N	0.3	Surface	18.6	18.5	18.6	31.5	31.6	31.6	7.7	7.7	7.7	98.5	98.3	98.4	0.6	0.7	0.6		1.0	1.2	1.1	
					Middle	18.4	18.3	18.4	31.7	31.8	31.8	7.5	7.5	7.5	96.5	96.3	96.4	0.8	0.8	0.8	0.8	1.1	1.2	1.2	1.2
					Bottom	18.2	18.1	18.2	31.9	31.9	31.9	7.4	7.4	7.4	95.0	94.8	94.9	1.0	1.0	1.0		1.4	1.4	1.4	
C2	1732-1737	13.5	N	0.2	Surface	18.4	18.3	18.4	31.5	31.6	31.6	7.8	7.8	7.8	100.4	100.6	100.5	1.1	1.1	1.1		1.6	1.6	1.6	
					Middle	18.2	18.2	18.2	31.7	31.8	31.8	7.7	7.7	7.7	98.4	98.2	98.3	1.3	1.3	1.3	1.3	1.8	1.8	1.8	1.8
					Bottom	18.1	18.0	18.1	31.9	32.0	32.0	7.4	7.4	7.4	94.6	94.8	94.7	1.4	1.5	1.5		2.0	2.0	2.0	
G1	1547-1602	11.3	N	0.2	Surface	18.4	18.3	18.4	31.5	31.6	31.6	7.8	7.8	7.8	99.5	99.7	99.6	1.1	1.2	1.2		1.5	1.6	1.6	
					Middle	18.3	18.2	18.3	31.7	31.7	31.7	7.5	7.5	7.5	96.3	96.1	96.2	1.1	1.1	1.1	1.0	1.4	1.5	1.5	1.4
					Bottom	18.1	18.2	18.2	31.8	31.9	31.9	7.5	7.5	7.5	95.5	95.7	95.6	0.9	0.9	0.9		1.3	1.2	1.3	
G2	1641-1651	1.8	N	0.3	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	18.3	18.3	18.3	31.6	31.7	31.7	7.4	7.5	7.4	95.1	95.3	95.2	1.0	1.0	1.0	1.0	1.3	1.4	1.4	1.4
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	1625-1639	15.3	N	0.2	Surface	18.4	18.3	18.4	31.6	31.7	31.7	7.8	7.7	7.7	99.5	99.3	99.4	1.1	1.1	1.1		1.5	1.7	1.6	
					Middle	18.2	18.1	18.2	31.7	31.8	31.8	7.6	7.6	7.6	97.4	97.2	97.3	0.9	0.9	0.9	1.0	1.2	1.3	1.3	1.4
					Bottom	18.1	18.0	18.1	31.9	32.0	32.0	7.4	7.5	7.4	94.9	95.1	95.0	1.0	1.1	1.0		1.5	1.4	1.5	
SR1	1607-1622	2.3	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	18.3	18.4	18.4	31.6	31.7	31.7	7.8	7.8	7.8	99.7	99.9	99.8	1.0	1.0	1.0	1.0	1.3	1.3	1.3	1.3
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	1653-1703	1.7	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	18.2	18.1	18.2	31.7	31.7	31.7	7.9	7.9	7.9	100.8	101.0	100.9	1.2	1.2	1.2	1.2	1.6	1.6	1.6	1.6
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	1527-1542	6.3	N	0.2	Surface	18.5	18.4	18.5	31.6	31.7	31.7	8.3	8.3	8.3	107.0	106.8	106.9	1.0	1.0	1.0		1.2	1.3	1.3	
					Middle	18.3	18.3	18.3	31.8	31.8	31.8	8.2	8.2	8.2	104.9	104.7	104.8	1.1	1.1	1.1	1.1	1.5	1.5	1.5	1.5
					Bottom	18.2	18.2	18.2	31.9	32.0	32.0	8.0	8.0	8.0	102.1	102.3	102.2	1.3	1.3	1.3		1.7	1.8	1.8	
SR4	1720-1730	6.7	N	0.1	Surface	18.5	18.5	18.5	31.4	31.5	31.5	7.7	7.7	7.7	98.8	99.0	98.9	1.1	1.1	1.1		1.5	1.5	1.5	
					Middle	18.4	18.3	18.4	31.6	31.7	31.7	7.5	7.6	7.6	96.5	96.7	96.6	1.2	1.3	1.2	1.2	1.6	1.7	1.7	1.6
					Bottom	18.2	18.1	18.2	31.8	31.9	31.9	7.3	7.3	7.3	93.6	93.4	93.5	1.3	1.3	1.3		1.7	1.8	1.8	
SR5	1706-1716	9.5	N	0.1	Surface	18.6	18.5	18.6	31.5	31.6	31.6	7.9	8.0	7.9	101.4	101.6	101.5	1.8	1.8	1.8		2.2	2.3	2.3	
					Middle	18.3	18.4	18.4	31.7	31.8	31.8	7.7	7.7	7.7	99.1	98.9	99.0	1.9	1.9	1.9	1.9	2.5	2.4	2.5	2.4
					Bottom	18.2	18.1	18.2	31.9	32.0	32.0	7.7	7.7	7.7	97.8	98.0	97.9	1.9	2.0	2.0		2.4	2.5	2.5	

Remark or Observation:

1. \* Average; \*\* Depth Average

2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

Date: 22-Jan-16  
 Tide: Mid-Ebb  
 Weather: Cloudy  
 Sea Conditions: Small Wave

Location	Sampling Time	Water Depth (m)	Current direction	Current speed (ms <sup>-1</sup> )	Monitoring Depth	Temperature (°C)			Salinity (ppt)			DO (mg/l)			DO Saturation (%)			Turbidity (NTU)				Suspended Solids (mg/l)			
						1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	1	2	Ave.*	D.A.**	1	2	Ave.*	D.A.**
C1	1015-1025	12.2	N	0.1	Surface	19.0	19.1	19.1	31.8	31.6	31.7	7.4	7.5	7.4	98.4	99.2	98.8	0.9	0.9	0.9		1.2	1.1	1.2	
					Middle	19.0	19.0	19.0	31.7	31.6	31.7	7.3	7.3	7.3	96.8	97.4	97.1	1.0	1.1	1.1	1.2	1.4	1.3	1.4	1.5
					Bottom	18.9	18.7	18.8	31.9	31.8	31.9	7.2	7.1	7.2	95.4	95.0	95.2	1.6	1.6	1.6		2.0	1.9	2.0	
C2	1142-1152	13.0	N	0.1	Surface	18.9	18.7	18.8	32.0	32.1	32.1	7.6	7.7	7.6	101.2	101.9	101.6	1.1	1.0	1.0		1.4	1.3	1.4	
					Middle	18.6	18.8	18.7	32.0	32.1	32.1	7.6	7.6	7.6	101.1	100.5	100.8	1.2	1.1	1.2	1.1	1.6	1.5	1.6	1.5
					Bottom	18.7	18.8	18.8	31.9	32.0	32.0	7.5	7.5	7.5	99.5	99.9	99.7	1.2	1.2	1.2		1.6	1.6	1.6	
G1	1038-1047	11.0	N	0.1	Surface	19.2	19.0	19.1	31.7	31.9	31.8	7.9	8.0	8.0	105.6	106.0	105.8	0.8	0.8	0.8		1.0	1.0	1.0	
					Middle	19.1	19.0	19.1	31.8	32.0	31.9	7.9	7.9	7.9	105.1	104.7	104.9	1.0	1.1	1.1	1.0	1.4	1.5	1.5	1.3
					Bottom	19.0	18.9	19.0	32.0	31.9	32.0	7.8	7.9	7.8	104.0	104.4	104.2	1.2	1.3	1.2		1.6	1.5	1.6	
G2	1107-1112	1.6	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.0	19.1	19.1	31.9	32.1	32.0	7.2	7.2	7.2	95.8	96.3	96.1	0.8	0.9	0.9	0.9	1.1	1.2	1.2	1.2
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
G3	1056-1106	15.0	N	0.1	Surface	19.2	19.0	19.1	31.8	31.9	31.9	7.6	7.7	7.7	101.6	102.3	102.0	0.7	0.7	0.7		0.9	0.8	0.9	
					Middle	19.1	19.2	19.2	31.9	31.9	31.9	7.5	7.6	7.5	100.1	100.5	100.3	1.1	1.1	1.1	1.0	1.4	1.5	1.5	1.3
					Bottom	19.1	19.0	19.1	32.0	31.9	32.0	7.5	7.5	7.5	99.8	99.5	99.7	1.2	1.1	1.2		1.5	1.6	1.6	
SR1	1048-1054	2.0	N	0.1	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.0	19.0	19.0	31.9	32.0	32.0	7.7	7.6	7.7	102.0	101.6	101.8	1.1	1.1	1.1	1.1	1.3	1.5	1.4	1.4
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR2	1113-1118	1.6	N	0.2	Surface	---	---	---	---	---	---	---	---	---	---	---	---	---	---		---	---	---		
					Middle	19.0	18.8	18.9	32.0	32.1	32.1	7.8	7.7	7.8	103.3	102.9	103.1	1.5	1.5	1.5	1.5	2.0	2.0	2.0	2.0
					Bottom	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---
SR3	1026-1036	6.0	N	0.1	Surface	19.1	19.2	19.2	31.7	31.9	31.8	8.3	8.2	8.2	109.9	109.3	109.6	1.2	1.2	1.2		1.6	1.5	1.6	
					Middle	19.0	19.1	19.1	32.0	31.8	31.9	8.2	8.2	8.2	109.0	109.1	109.1	1.6	1.6	1.6	1.4	2.0	2.0	2.0	1.8
					Bottom	19.0	19.0	19.0	31.9	31.8	31.9	8.1	8.1	8.1	107.6	108.1	107.9	1.4	1.4	1.4		1.7	1.9	1.8	
SR4	1130-1140	6.4	N	0.1	Surface	18.9	19.0	19.0	32.1	32.0	32.1	7.4	7.4	7.4	98.6	98.2	98.4	0.9	0.9	0.9		1.1	1.2	1.2	
					Middle	19.1	19.0	19.1	32.0	32.1	32.1	7.3	7.4	7.4	97.6	98.3	98.0	1.0	0.9	1.0	1.0	1.3	1.3	1.3	1.3
					Bottom	18.8	18.7	18.8	31.9	32.0	32.0	7.3	7.3	7.3	96.6	97.0	96.8	1.1	1.1	1.1		1.4	1.4	1.4	
SR5	1119-1129	9.2	N	0.1	Surface	18.7	18.9	18.8	32.0	31.9	32.0	7.6	7.6	7.6	101.2	101.6	101.4	1.6	1.5	1.6		1.9	2.1	2.0	
					Middle	18.6	18.9	18.8	31.9	31.8	31.9	7.6	7.6	7.6	100.5	100.9	100.7	1.6	1.7	1.6	1.6	2.2	2.3	2.3	2.1
					Bottom	18.8	18.7	18.8	31.9	31.8	31.9	7.5	7.5	7.5	99.5	100.0	99.8	1.6	1.5	1.6		2.1	2.1	2.1	

Remark or Observation:

1. \* Average; \*\* Depth Average

2. Each station was sampled and measurements/ water samples were taken at three depths, namely, 1 m below water surface, mid-depth and 1 m above sea bed, except where the water depth less than 6 m, the mid-depth station may be omitted. For stations that are less than 3 m in depth, only the mid-depth sample was taken.

**ERM has over 140 offices  
Across the following  
countries worldwide**

Argentina	New Zealand
Australia	Panama
Belgium	Peru
Brazil	Poland
Canada	Portugal
China	Puerto Rico
Colombia	Romania
France	Russia
Germany	Singapore
Hong Kong	South Africa
Hungary	Spain
India	Sweden
Indonesia	Taiwan
Ireland	Thailand
Italy	The Netherlands
Japan	United Arab Emirates
Kazakhstan	United Kingdom
Korea	United States
Malaysia	Vietnam
Mexico	


**Environmental Resources Management**

**16/F Berkshire House  
25 Westlands Road  
Quarry Bay, Hong Kong**

**T: 2271 3000**

**F: 2723 5660**

**[www.erm.com](http://www.erm.com)**



**ERM**