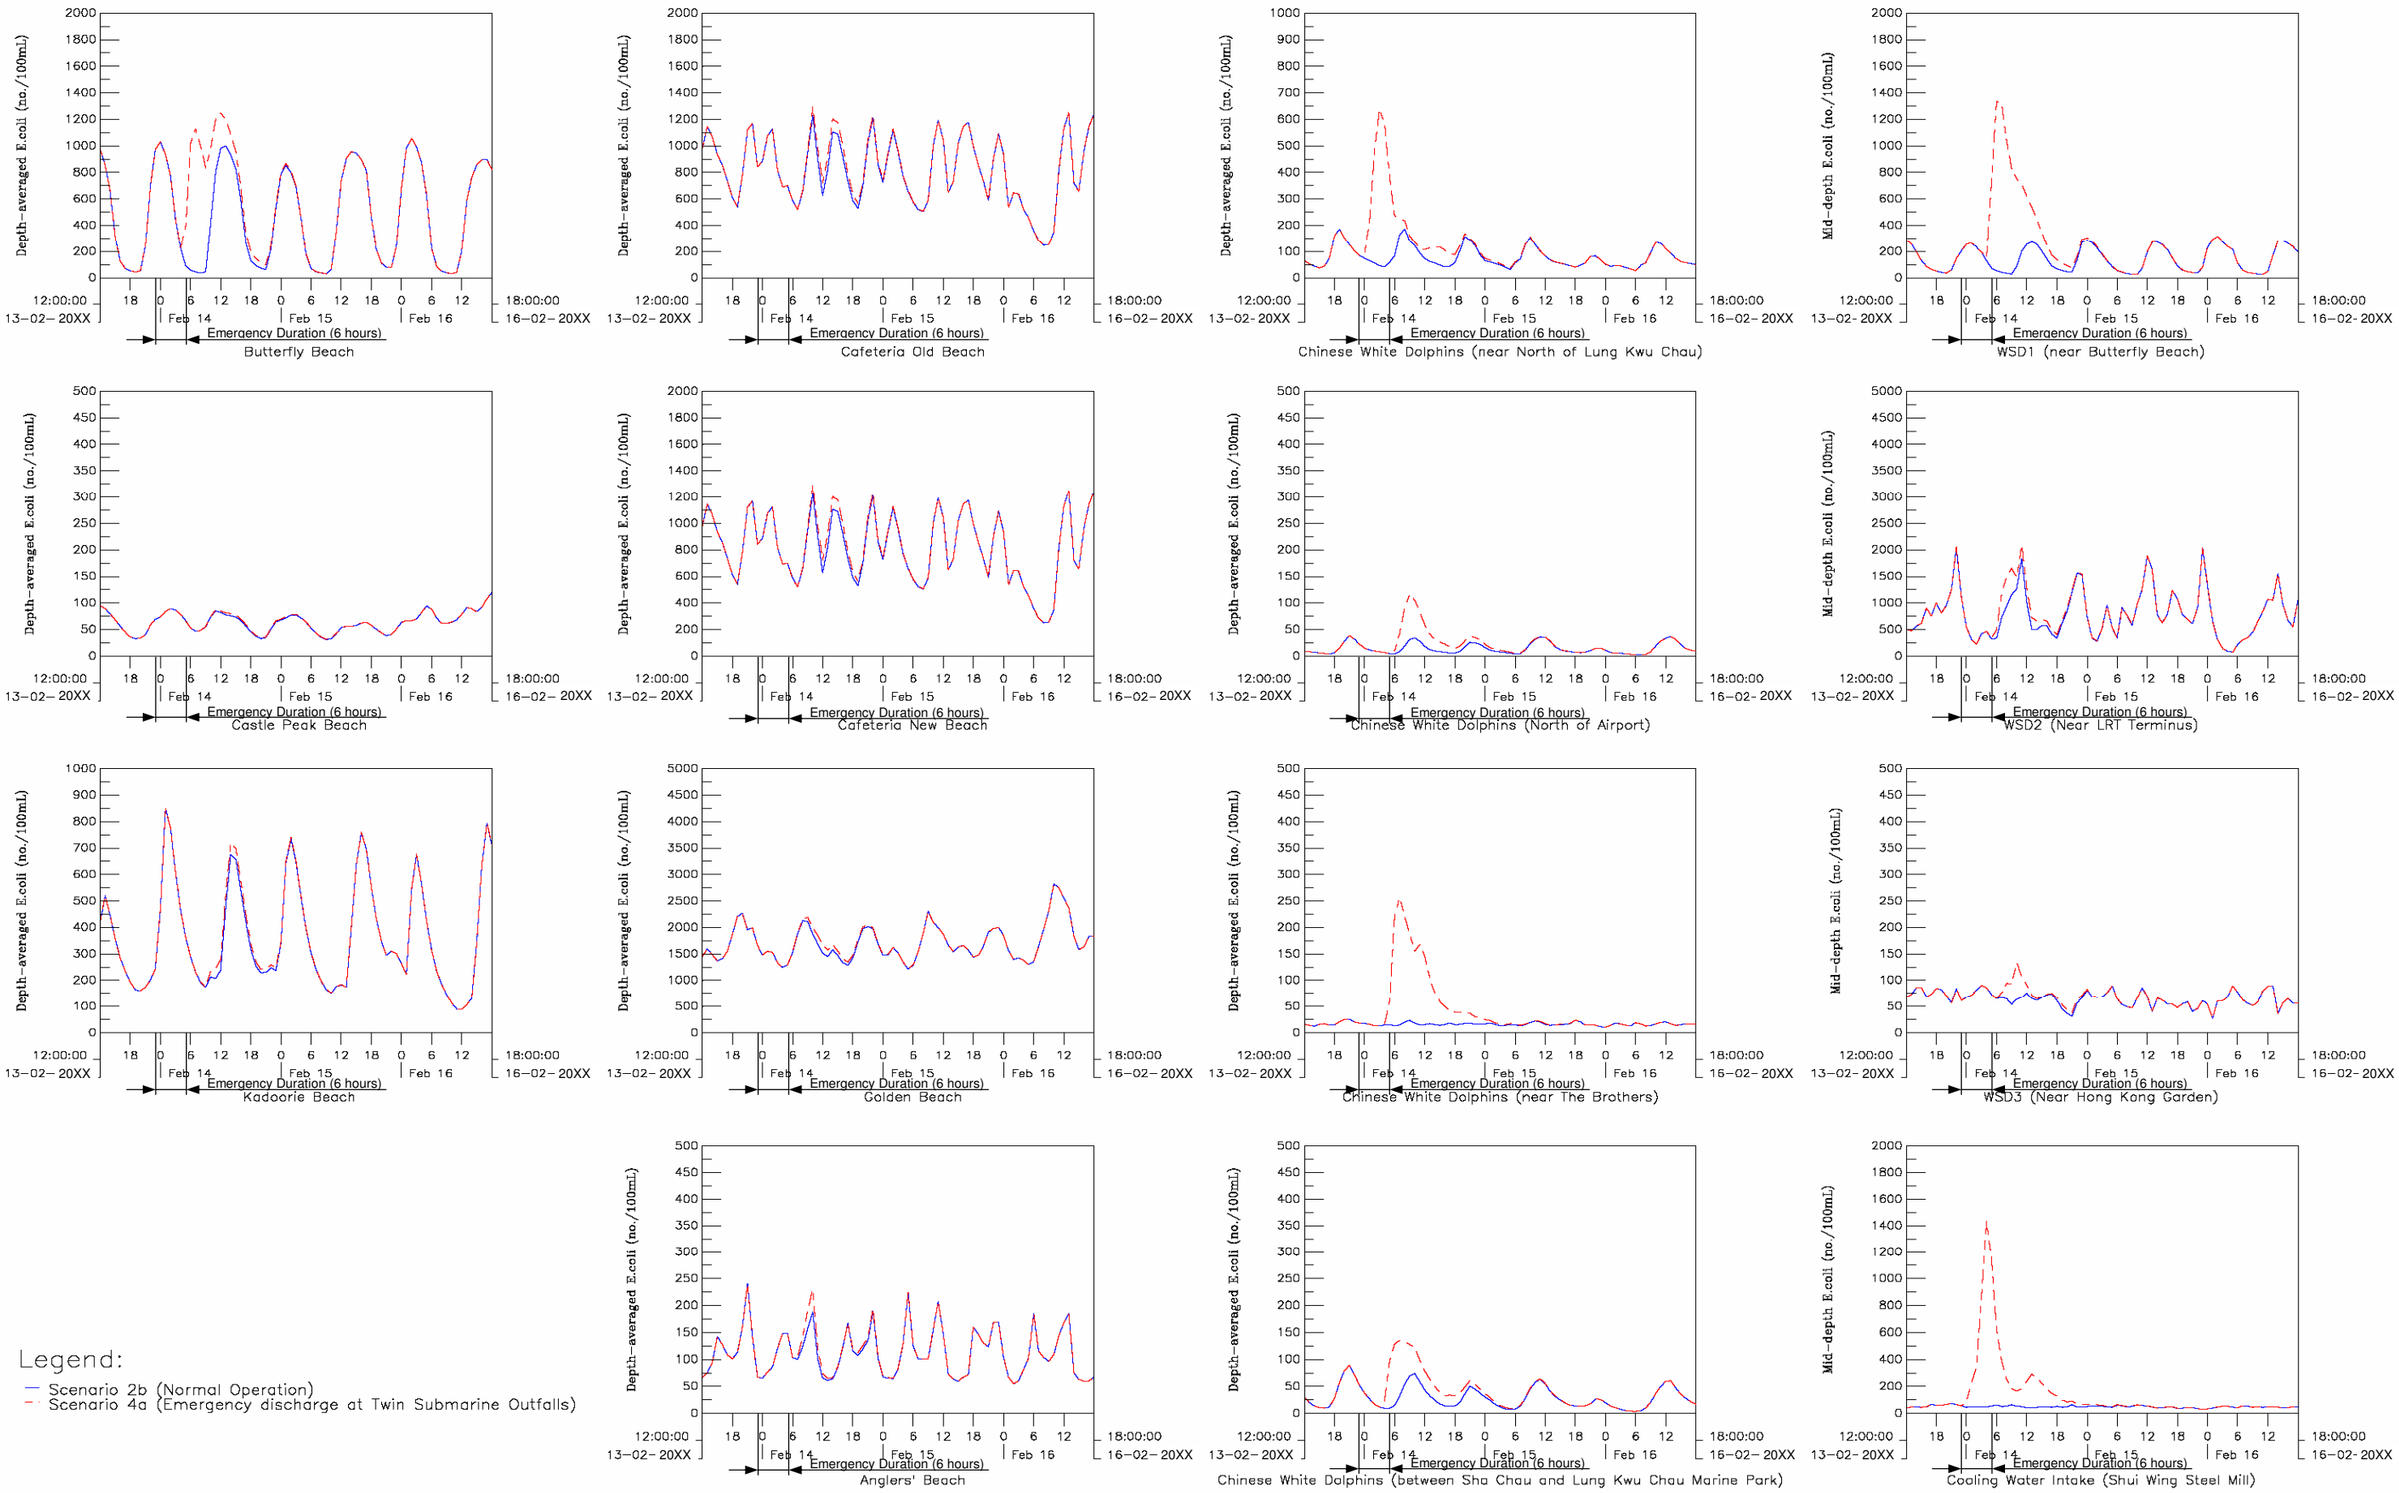

MAUNSELL | AECOM

Metcalf and Eddy Ltd

Agreement No. CE 51 / 2002 (DS)

Upgrading of Pillar Point Sewage Treatment Works - Investigation, Design and Construction

EMERGENCY DISCHARGE OF UNTREATED EFFLUENT AT TWIN SUBMARINE OUTFALLS - UDS DRY SEASON - *E.COLI*

SCALE	N.T.S.	DATE	SEP 2006
CHECK	AKYC	DRAWN	LHKJ
JOB NO.	A06205	DRAWING No. Figure 4.53	Rev -

P:\60017222\REPORTS\Draft EIA\Figure\Fig 4-53 20XXDry-Scn4a-Ecoli