


# SCOPES OF THE SCISTW STAGE 2A UPGRADE

- (1) CONSTRUCTION OF THE FOLLOWING NEW FACILITIES:
  - \* INFLUENT PUMPING STATION
  - \* CHEMICALLY ENHANCED PRIMARY TREATMENT FACILITIES USING DOUBLE-DECK SEDIMENTATION TANKS
  - \* SLUDGE STORAGE, DEWATERING AND HANDLING FACILITIES
  - \* CHLORINATION/DECHLORINATION DISINFECTION FACILITIES
  - \* EFFLUENT TUNNEL AND ITS ASSOCIATED CHAMBERS
  - \* ODOUR CONTROL FACILITIES
  - \* PRIMARY SUBSTATION AND SWITCH GEAR BUILDING
- (2) INTERCONNECTION BETWEEN MAIN INFLUENT PUMPING STATIONS AND FLOW DIVERSION WORKS
- (3) MINOR UPGRADE AND MODIFICATION WORKS

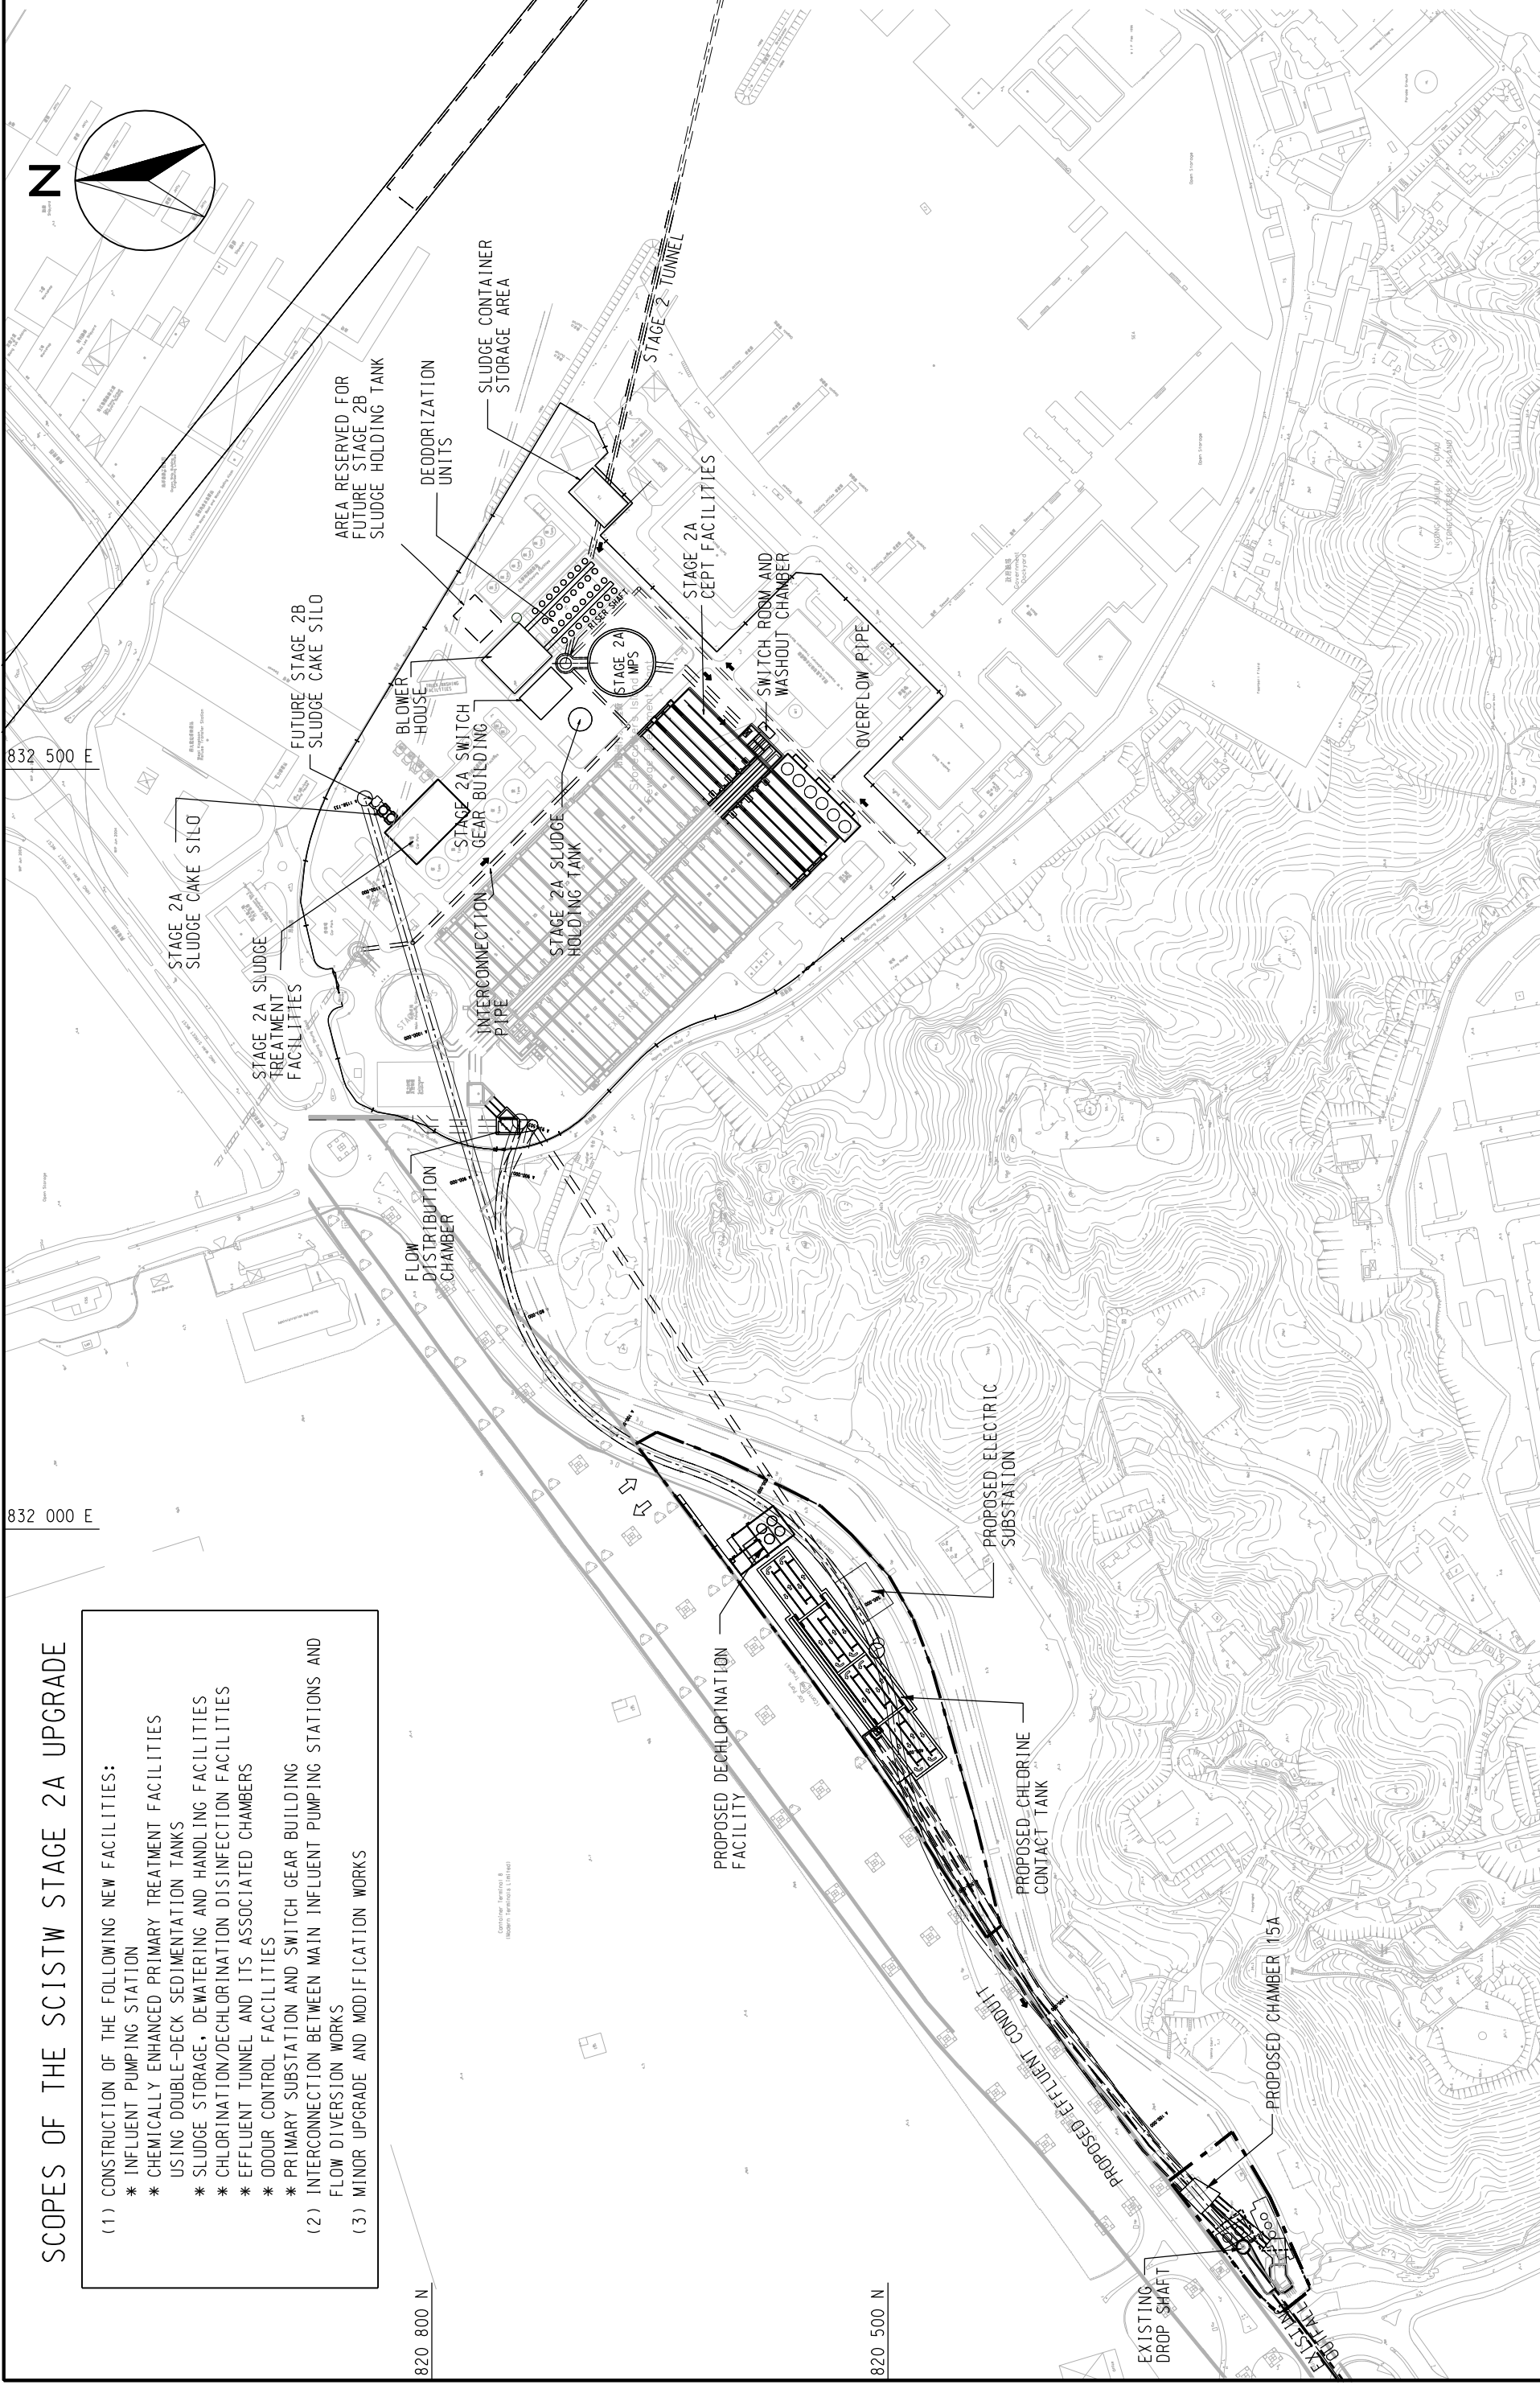

AGREEMENT NO. CE 43/2005 (EP)  
 HARBOUR AREA TREATMENT SCHEME (HATS) STAGE 2A ENVIRONMENTAL IMPACT ASSESSMENT STUDY - INVESTIGATION  
**PROPOSED LAYOUT FOR SCISTW UPGRADE**

SCALE	A3 1:4000	DATE	APR 08
CHECK	-	DRAWN	LDF
JOB NO.	60017198	FIGURE NO.	1.2
		REV	A

