

ARUP

BY FAX (2739 5879) AND BY POST

Fire Services Department
9/F (MG1),
Fire Services Headquarters Building
No.1 Hong Chong Road
Tsim Sha Tsui East, Kowloon
Hong Kong

Attention: Mr. LEE Kui-hung

Level 5 Festival Walk
80 Tat Chee Avenue
Kowloon Tong
Kowloon
Hong Kong

t +852 25283031
d +852 22684901
f +852 22683950

franki.chiu@arup.com
www.arup.com

18 October 2016

Dear Mr. Lee,


Request for Information on Dangerous Goods

We refer to our previous letter dated 10 March 2016 (Ref.: 248118/L001/ST/FC/EL/VN/kw) regarding the captioned subject. Thank you for your reply (Ref.: (50) in FSD GR 6-5/4 R Pt. 12) on 18 April 2016. According to the latest project development, the works area of the Project would include an eastern connection access on Sham Shui Kok Drive and a western access via Tai Ho Interchange. Also, utilities connecting the site and the Siu Ho Wan Sewage Treatment Works is proposed. These accesses / utilities works area (i.e. eastern connection access on Sham Shui Kok Drive, western access via Tai Ho Interchange and utilities) are indicated in the enclosed figure. It would be appreciated if you could further provide us the following information for our assessment:

- The records of Dangerous Goods License issued to the accesses / utilities works area;
- Past and present incident records of the accesses / utilities works area; and
- Any other information related to the use and/or storage of dangerous goods in the accesses / utilities works area.

Your response by fax (fax no. 2268 3950) on or before 28 October 2016 would be much appreciated. Should you have any query, please feel free to contact our Miss Klaine Wong at 2908 4901.


Yours sincerely



Franki Chiu
Director

Encl.

cc. MTRC Mr. Simon Chan (By fax: 2750 1230)

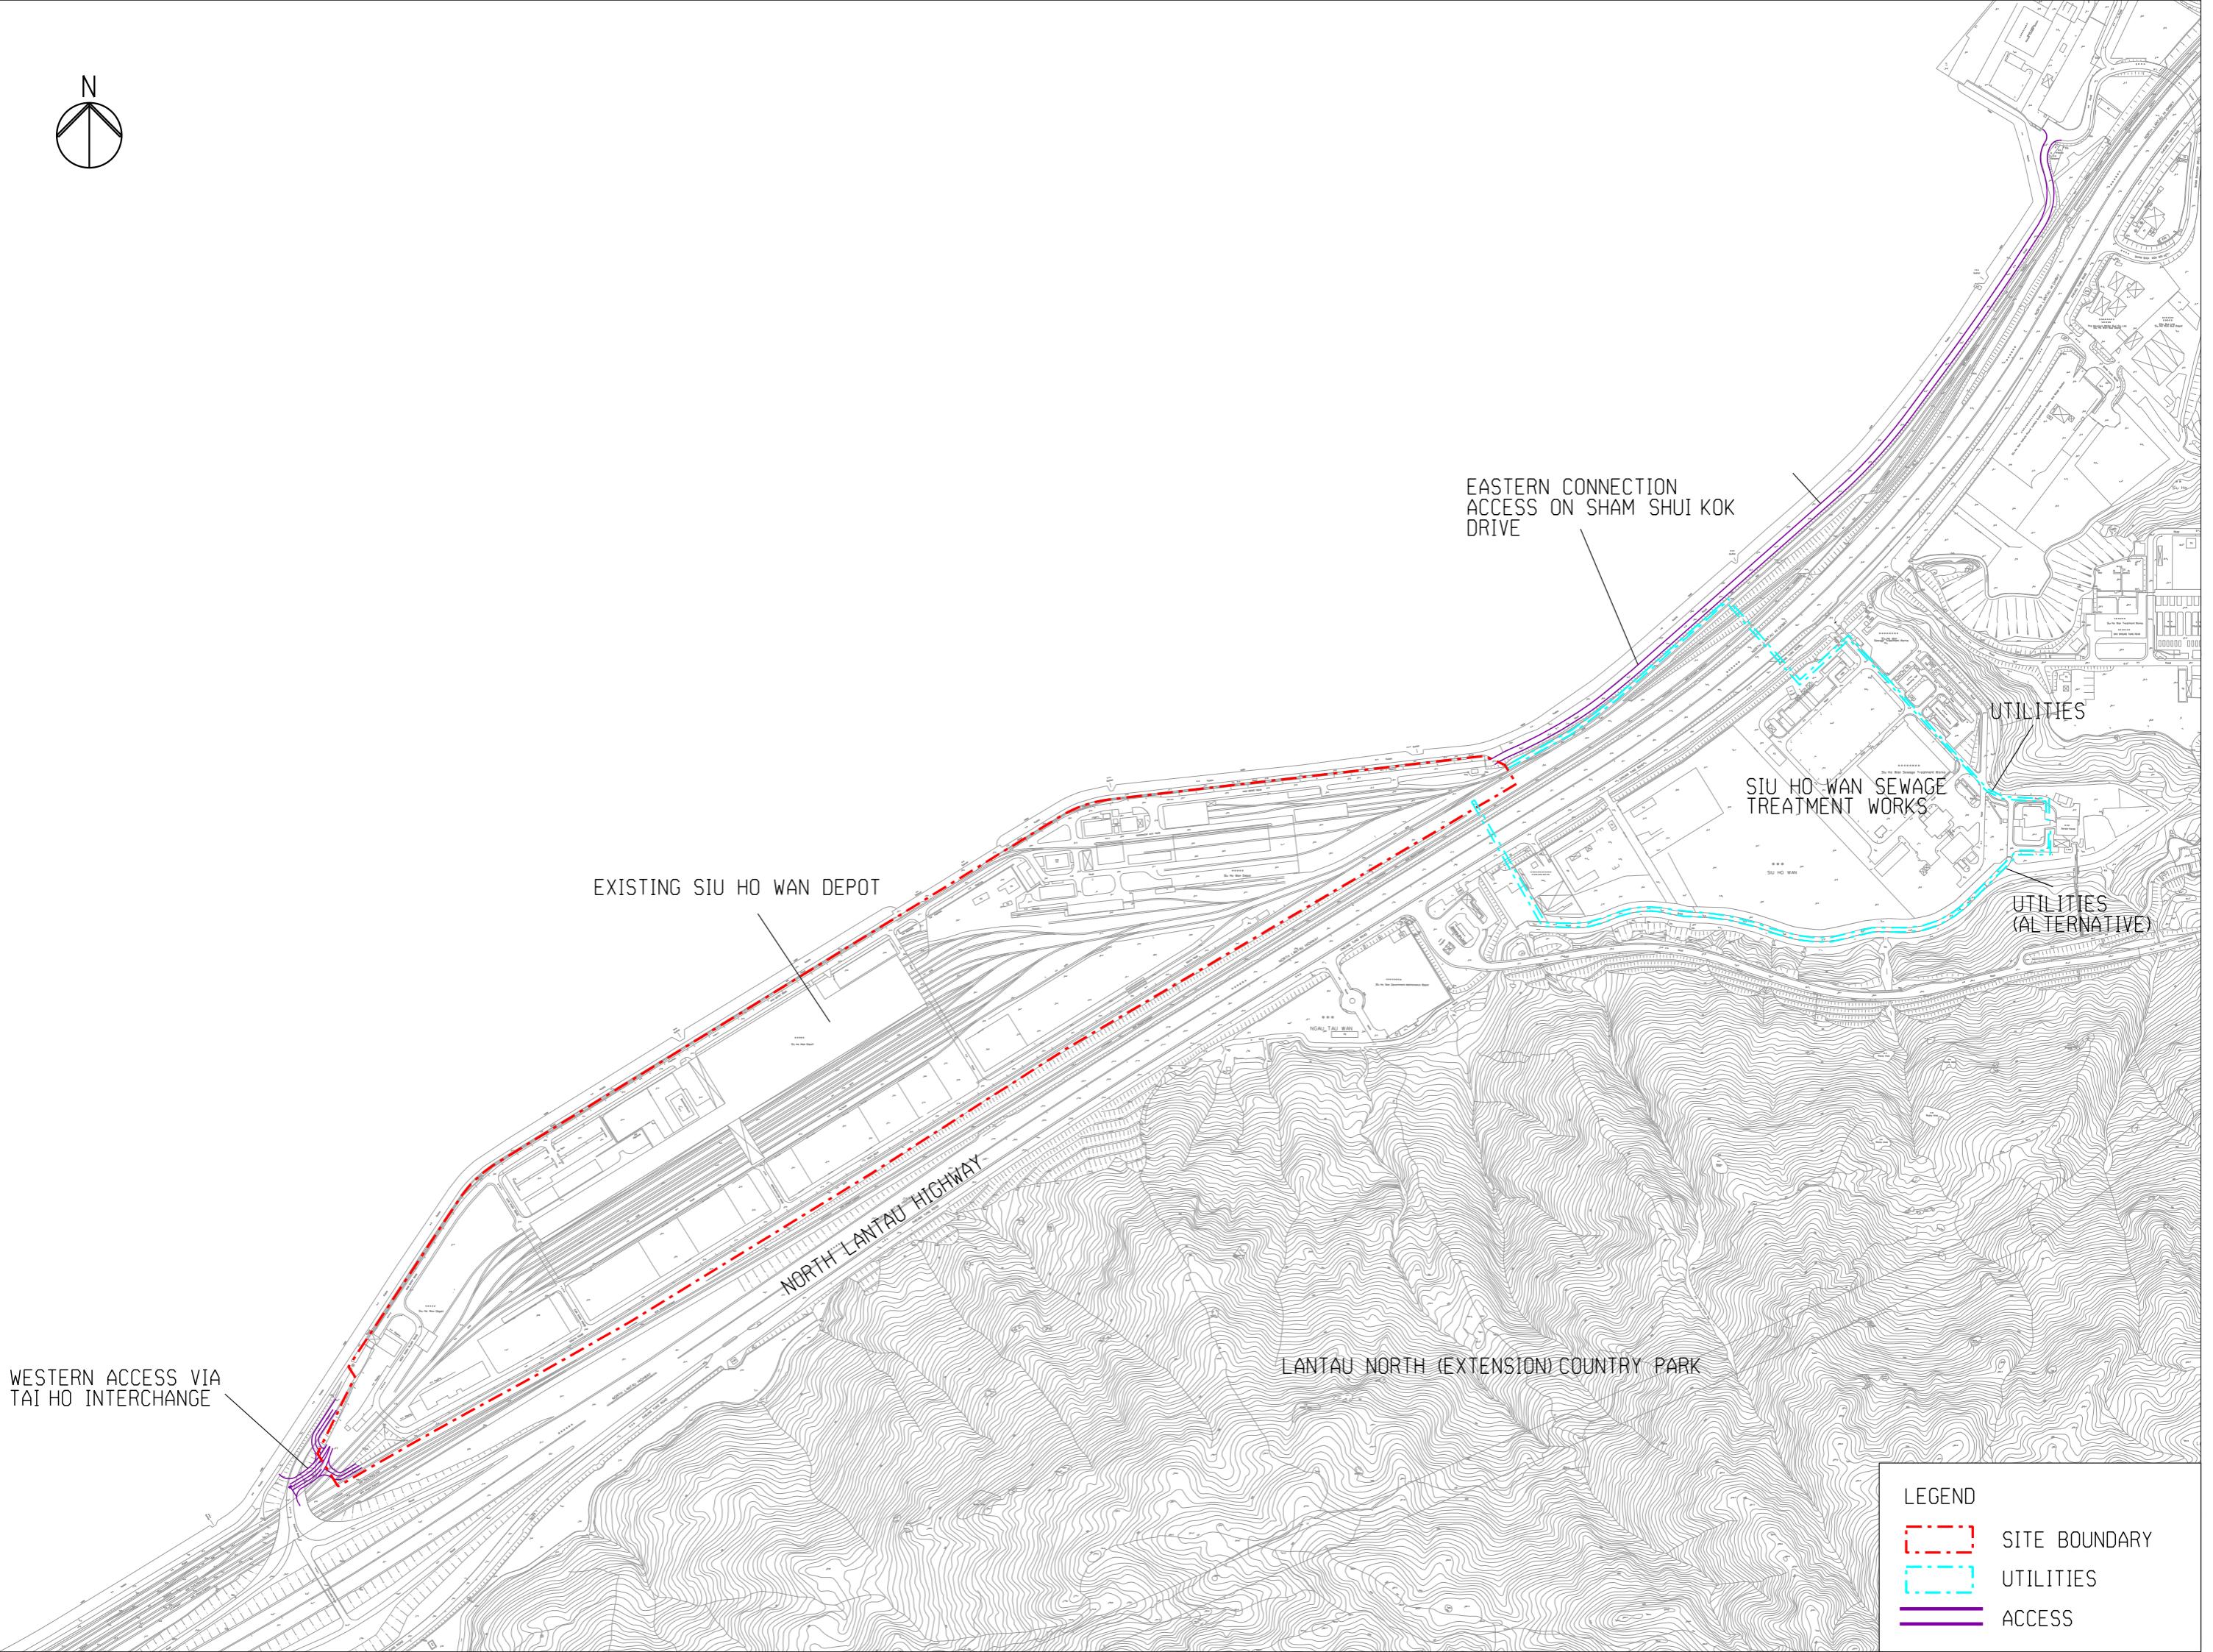

消防處
香港九龍尖沙咀東部康莊道1號
消防總部大廈



FIRE SERVICES DEPARTMENT
FIRE SERVICES HEADQUARTERS
BUILDING,
No.1 Hong Chong Road,
Tsim Sha Tsui East, Kowloon,
Hong Kong.

本處檔號 OUR REF. : (147) in FSD GR 6-5/4 R Pt. 13
來函檔號 YOUR REF. : 248118/L019/ST/FC/EL/HW/kw
電子郵件 E-mail : hkfsdenq@hkfsd.gov.hk
圖文傳真 FAX NO. : 2739 5879
電話 TEL NO. : 2733 5848

8 November 2016

ARUP
Level 5,
Festival Walk,
80 Tat Chee Avenue,
Kowloon Tong, Kowloon
(Attn: Mr. Franki CHIU, Director)

Dear Mr. CHIU,

ARUP		Job No. File No.
Master Ref.	Project Ref.:	
Reply Ref.:	By :	Date
Action Required:		
Received 15 NOV 2016		
Initials	SJ	Re: KW
Action		
Info.		
Copy		

Request for Information of Dangerous Goods & Incident Records

I refer to your letter of 18.10.2016 regarding the captioned request and reply below in response to your questions.

According to our record, a dangerous goods license has been issued by this department to the subject address, with details as shown in Appendix A. No incident record was found at the aforesaid location with your given conditions.

If you have further questions, please feel free to contact the undersigned.

Yours sincerely,

(CHAN Kwok-ming)
for Director of Fire Services

Request for Information of Dangerous Goods & Incident Records

Item	Type of DG	Quantity	Storage Method
1.	Diesel	10,000 Litre	AG Tank
2.	Electrical Cleaning Solvent 303/1	1,000 Litre	Permanent Store
3.	Paint Remover Ardrox 2106	200 Litre	Permanent Store
4.	Acid Electrolyte	50 Litre	Permanent Store
5.	Alkaline Electrolyte	120 Litre	Permanent Store
6.	Alkaline Cleaner 'TM44"	50 Litre	Permanent Store
7.	Electrical Cleaning Solvent 303/1	200 Litre	Permanent Store
8.	Paint Remover Ardrox 2106	100 Litre	Permanent Store
9.	Potassium Hydroxide (Solid form)	500 Kg	Permanent Store
10.	Sodium Hydroxide (Solution)	200 Litre	Permanent Store
11.	Alkaline Cleaner 'TM44"	50 Litre	Permanent Store
12.	Weiclean RM31 XTRA	100 Litre	Permanent Store
13.	Hydrochloric Acid 30% - 35%	1,000 Litre	Permanent Store
14.	Sulphuric Acid 98%	300 Litre	Permanent Store
15.	Freon	25 X 56 kg cylinder	Permanent Store
16.	Nitrogen	30 X 47 kg cylinder	Permanent Store
17.	Oxygen	20 X 47 kg cylinder	Permanent Store
18.	Argon	5 X 56 kg cylinder	Permanent Store
19.	Acetylene	25 X 47 kg cylinder	Permanent Store
20.	Paint & Varnish	3,000 Litre	Permanent Store
21.	Petrol	1,000 Litre	Permanent Store
22.	Kerosene	2,000 Litre	Permanent Store
23.	Turpentine	500 Litre	Permanent Store
24.	Thinner	1,000 Litre	Permanent Store
25.	Thermit Portions	5,000 kg	Permanent Store
26.	Thermic Starter (Railtech)	500 kg	Permanent Store
27.	Phosphoric Acid	2,000 Litre	Permanent Store
28.	Oxygen	10 X 47 L cylinder	Temporary Store
29.	Acetylene	10 X 48 L cylinder	Temporary Store