



A Guide to the Air Pollution Control (Furnaces, Ovens and Chimneys) (Installation and Alteration) Regulations

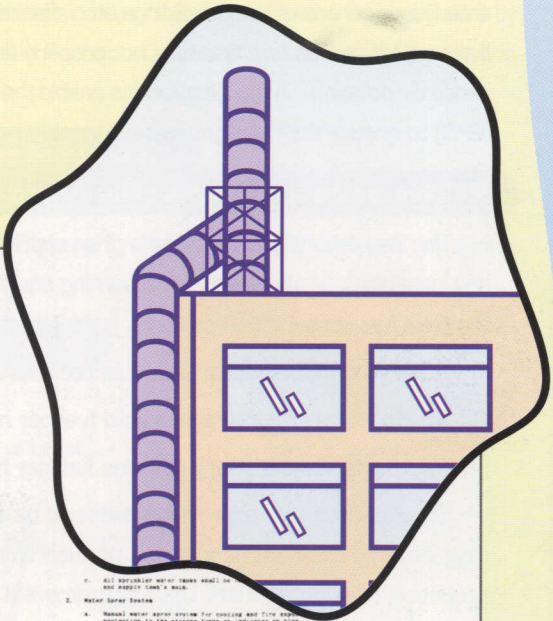

1. All sprayer water tanks shall be constructed in accordance with...
2. Water Spray System
 - a. Manual water spray system for cooling and fire protection to the storage tanks as indicated on plan shall be installed.
 - b. The system shall be designed and installed in accordance with... in which a density of discharge of not less than 0.1 m³/m²...
 - c. The nozzles shall be directed so cooling water shall be that area of the exposed tank walls which fall within a 45-degree angle from the center of adjacent tanks to cover 90% area of the exposed tank. For tanks which are also cooling with a spray cooling system, the water spray specification shall be based on the lower half of the exposed tank area.
3. Floor Pans System
 - a. Manual floor pans system for fire installations in the storage tanks as indicated on plan shall be installed.
 - b. The system shall be designed and installed in accordance with... in which a flow rate of not less than 0.1 m³/m²... for tanks which are also cooling with a spray cooling system, the water spray specification shall be based on the lower half of the exposed tank area.

CHIMNEY PLAN AND ELEVATION	
煙囪平面及立视图	
Scale: Vertical Elevation	1:100
Scale: Plan	1:100
Drawn by: [Signature]	Checked by: [Signature]
Date: 11/11/88	Scale: 1:100

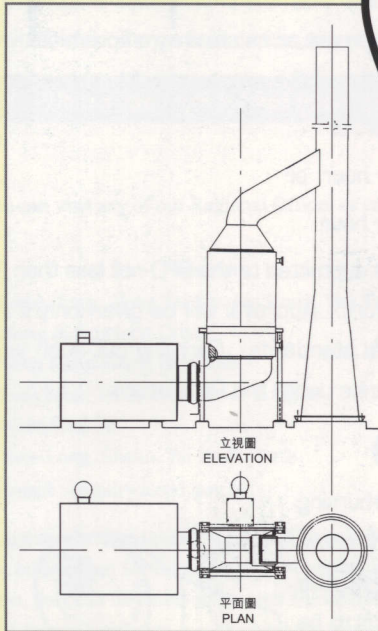