


Table 2 : COORDINATES OF RESTRICTED AREA

表二 : 限制區的坐標

Id	EASTING	NORTHING
1	837090.66270	811058.63001
2	837094.85188	811065.83541
3	837115.04376	811065.08136

DEEP WATER BAY

深水灣

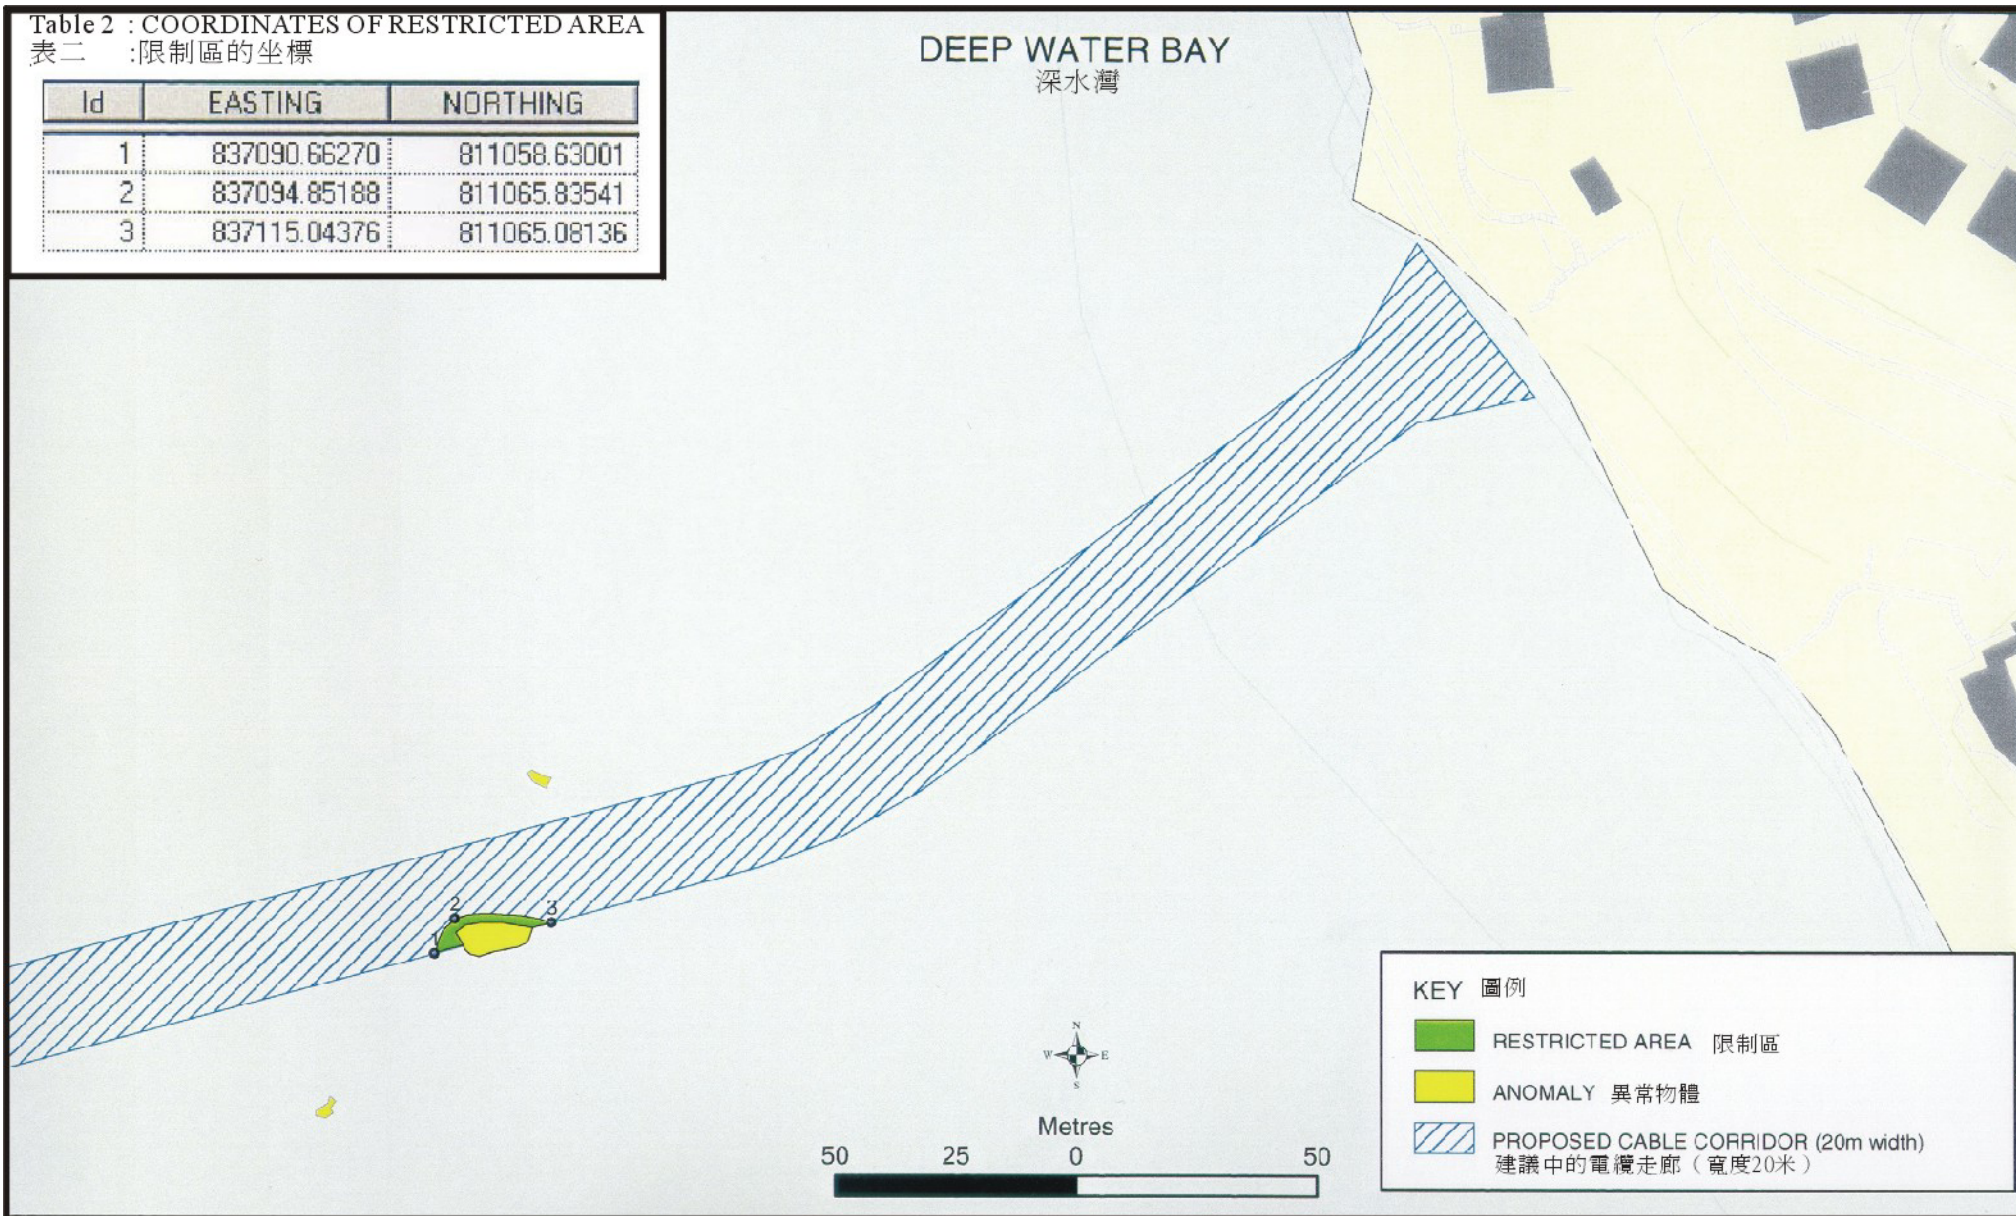

132kV Submarine Cable Installation for Wong Chuk Hang - Chung Hom Kok 132kV Circuits

黃竹坑—春坎角 132kV 電路之 132kV 海底電纜敷設工程

Environmental Permit No. EP-132/2002

環境許可證 EP-132/2002

Figure 3 : Location of Restricted Area to Protect the Anomaly within the Cable Corridor

圖三 : 電纜走廊內保護異常物體之限制區的位置

Note 註:

(Reproduced from the application documents of AEP-132/2002)

(摘自申請文件AEP-132/2002)



Environmental
Protection
Department
環境保護署