

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Monthly EM&A Report October 2022

Client : Drainage Services Department

Project : Contract No. CM 14/2016  
Environmental Team for Operational  
Environmental Monitoring and Audit for Siu  
Ho Wan Sewage Treatment Works

Report No.: : 0041/17/ED/0688

Prepared by: Andy K. H. Choi

Reviewed by: Cyrus C. Y. Lai

Certified by:

A handwritten signature in black ink, appearing to be "Colin K. L. Yung", written over a horizontal line.

Colin K. L. Yung  
Environmental Team Leader  
Fugro Technical Services Limited

Our Ref. 1458/22-0044



**Drainage Services Department**  
Projects and Development Branch  
Consultants Management Division  
42/F, Revenue Tower,  
5 Gloucester Road  
Wan Chai, Hong Kong

27/F, Overseas Trust Bank Building  
160 Gloucester Road  
Wan Chai  
Hong Kong  
T: +852 2815 7028  
F: +852 2815 5399

[www.asecg.com](http://www.asecg.com)

**Attn: Mr. LAU Ka Kin, Marcus (E/CM16)**

11 November 2022

**By E-mail & Post**

Dear Sir,

**RE: CONTRACT No. CM 13/2016**  
**INDEPENDENT ENVIRONMENTAL CHECKER FOR OPERATIONAL ENVIRONMENTAL MONITORING**  
**AND AUDIT FOR SIU HO WAN SEWAGE TREATMENT WORKS (SHWSTW)**  
**MONTHLY ENVIRONMENTAL MONITORING AND AUDIT (EM&A) REPORT (OCTOBER 2022)**

Reference is made to the submission of the Monthly Environmental Monitoring and Audit (EM&A) Report for October 2022 (Report No.: 0041/17/ED/0688) from the Environmental Team (ET), Fugro Technical Services Ltd., received on 9 November 2022 via email.

We would like to inform you that we have no adverse comment on the captioned submission and hereby verify the same in accordance with Condition 4.3 of the Environmental Permit (EP) for the captioned Project (Permit No.: EP-076/2000).

Should you have any queries, please feel free to contact the undersigned, or our Mr. Timmy WONG at 2815 7028.

Yours faithfully,

For and on behalf of  
**Allied Environmental Consultants Ltd.**

A handwritten signature in black ink, appearing to be 'Grace M. H. Kwok', written in a cursive style.

Grace M. H. KWOK  
Independent Environmental Checker

GK/jn/tw

c.c. Fugro Technical Service (ET Leader)  
AECOM

Attn: Mr. Colin YUNG  
Attn: Ms. Joanne TSOI

(By E-mail)  
(By E-mail)

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

## TABLE OF CONTENTS

	<b>EXECUTIVE SUMMARY .....</b>	<b>1</b>
<b>1.</b>	<b>INTRODUCTION.....</b>	<b>3</b>
<b>2.</b>	<b>AIR QUALITY MONITORING .....</b>	<b>5</b>
<b>3.</b>	<b>WATER QUALITY MONITORING .....</b>	<b>10</b>
<b>4.</b>	<b>SEDIMENT QUALITY MONITORING AND BENTHIC SURVEY .....</b>	<b>21</b>
<b>5.</b>	<b>CHINESE WHITE DOLPHIN MONITORING .....</b>	<b>28</b>
<b>6.</b>	<b>ADVICE ON IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES .....</b>	<b>29</b>
<b>7.</b>	<b>ADVICE ON THE SOLID AND LIQUID WASTE MANAGEMENT STATUS .....</b>	<b>30</b>
<b>8.</b>	<b>SUMMARY OF EXCEEDANCE OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS .....</b>	<b>31</b>
<b>9.</b>	<b>SUMMARY OF ENVIRONMENTAL COMPLAINTS .....</b>	<b>32</b>
<b>10.</b>	<b>FUTURE KEY ISSUES .....</b>	<b>33</b>
<b>11.</b>	<b>CONCLUSION .....</b>	<b>34</b>

## FIGURE

- Figure 1      Monitoring Stations of Air Sensitive Receivers**
- Figure 2      Odour Patrol Points of Modified Odour Patrol**
- Figure 3      Monitoring Stations of Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey**
- Figure 4      Location of the Tide Gauge**

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## APPENDICES

- Appendix A Project Organization Chart**
- Appendix B Monitoring Schedule for Present and Next Reporting Period**
- Appendix C Event and Action Plan for Air Quality Monitoring**
- Appendix D Results and Graphical Presentation of Air Quality Monitoring**
- Appendix E Copy of the Calibration Certificates for Water Quality Monitoring Equipment**
- Appendix F Results and Graphical Presentation of Water Quality Monitoring**
- Appendix G Tidal Data obtained from Ma Wan Marine Traffic Station**
- Appendix H Results and Graphical Presentation of Laboratory Analysis for Sediment Quality Monitoring and Benthic Survey**
- Appendix I Benthic Survey Report**
- Appendix J Photos of Grab Samplers**
- Appendix K Environmental Complaints Log and Incident Report**
- Appendix L Environmental Mitigation Implementation Schedule (EMIS)**



## EXECUTIVE SUMMARY

This Monthly Environmental Monitoring and Audit (EM&A) Report is prepared for Contract No. CM 14/2016 – “Environmental Monitoring and Audit for Operation of Siu Ho Wan Sewage Treatment Works” (hereafter referred to as “the Contract”) for the Drainage Services Department (DSD) of Hong Kong Special Administrative Region. Fugro Technical Services Limited (hereafter referred to as “FTS”) was appointed as the Environmental Team (ET) by DSD, to implement the Environmental Monitoring & Audit (EM&A) programme in accordance with the Operational EM&A Plan of the Contract.

The Contract is part of the “Upgrading of Siu Ho Wan Sewage Treatment Works” (hereinafter referred as “the Project”) which was classified as “Designated Project” under Schedule 2 of the Environmental Impact Assessment Ordinance (EIAO) (Cap 499) and Environmental Impact Assessment (EIA) Report (Register No. EIAR-124BC) was completed in September 1997. The current Environmental Permit (EP) No. EP-076/2000 was issued in August 2000 to DSD.

In accordance with the EP, an approved operational EM&A Plan was submitted. According to the approved EM&A plan, air quality monitoring (i.e. H<sub>2</sub>S concentration monitoring, odour patrol monitoring and olfactometry analysis of H<sub>2</sub>S), in addition, water quality monitoring, sediment quality monitoring, benthic survey, Chinese White Dolphin (CWD) monitoring and waste management are the key environmental concern of the Project.

This is the Sixty-third Monthly EM&A Report for the Project which summarizes findings of the EM&A works during the reporting period from 1 October 2022 to 31 October 2022 (the “reporting period”).

### Breaches of Action and Limit Levels

Odour patrol monitoring was resumed from January 2020 and carried out on 7, 13, 19, 25 and 31 October 2022. The modified odour patrol monitoring plan including updated Event and Action Plan was approved on March 2020, and modified odour patrol monitoring was commenced from 20 March 2020. No exceedances of Action/Limit levels at Air Sensitive Receivers (ASR) and odour patrol points were recorded and no non-compliance of odour monitoring at ASR were recorded in the reporting period.

Water quality monitoring, sediment quality monitoring and benthic survey were carried out on 10 October 2022. No specific Action/Limit level has to be followed since the purpose of the monitoring is to collect data for future purpose.

### Complaint Log

There were no complaints received in relation to environmental impact during the reporting period.

### Notifications of Summons and Successful Prosecutions

There were no notifications of summons or prosecutions received during the reporting period.

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

Page 2

### **Summary of the Environmental Mitigations Measures**

Mitigation measures specified in the EP and EIA Report such as aeration, chemical dosing system, covering or enclosing the pressing and sludge thickening facilities and ventilating air to a biological treatment unit prior to stack exhaust were implemented during the reporting period.

### **Future Key Issues**

The key issues to be considered in the succeeding reporting month include:

Potential environmental impacts arising from the operations of Siu Ho Wan Sewage Treatment Works (SHWSTW) are mainly associated with air quality, water quality, sediment quality, benthic ecology, waste management and distribution and abundance of Chinese White Dolphins (CWDs).

According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD's memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.

## 1. INTRODUCTION

### 1.1 Background

- 1.1.1 The Project "Upgrading of Siu Ho Wan Sewage Treatment Works" is to upgrade SHWSTW from the preliminary treatment level to Chemically Enhanced Primary Treatment (CEPT) level with Ultraviolet (UV) disinfection facilities. The Project is required to comply with the Environmental Permit (EP) in respect of the construction and operation phases of the Plant.
- 1.1.2 Under the EIAO, the Project was classified as "Designated Project". The Environmental Impact Assessment (EIA) study was completed in September 1997 with the EIA Report of Register No. EIAR-124BC, Operational Environmental Monitoring and Audit (EM&A) Plan and the EP of No. EP-076/2000 was issued in August 2000 to Drainage Services Department (DSD).
- 1.1.3 The CEPT part has been completed and was put into operation in March 2005. The UV disinfection works were substantially completed in December 2006. It is considered that the operation of the Project shall be deemed to start when the UV disinfection facilities have been completely installed and tested.

### 1.2 Project Description

- 1.2.1 The project proponent was DSD. AECOM was commissioned by DSD as the Engineer for the Project. Allied Environmental Consultants Limited (AEC) was commissioned by DSD as the Independent Environmental Checker (IEC) in the operation phase of the Project. FTS was appointed as the ET by DSD to implement the EM&A programme for the operation phase of the Project including air quality monitoring, water quality monitoring, sediment quality and benthic survey and CWDs monitoring.

### 1.3 Project Organization

- 1.3.1 The project organization for environmental works is shown in **Appendix A**. The contact person and telephone numbers of key personnel for the captioned project are shown in **Table 1.1**.

**Table 1.1 Contact Persons and Telephone Numbers of Key Personnel**

Organization	Role	Contact Person	Telephone No.	Fax No.
DSD	Project Proponent Representative	Mr. Marcus Lau	2594 7218	3104 6426
AECOM	Engineer Representative (ER)	Ms. Joanne Tsoi	3922 9423	3922 9797
AEC	Independent Environmental Checker (IEC)	Ms. Grace Kwok	2815 7028	2815 5399
FTS	ET Leader (ETL)	Mr. Colin Yung	3565 4114	2450 8032

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

Page 4

### 1.4 Works Undertaken during the Reporting Period

1.4.1 During this reporting period, the principal work activities included:

- Perform comprehensive operation and maintenance services for the electrical, mechanical and electronic systems/equipment at SHWSTW.
- Alleviate as far as practicable the impact that the facilities and sewage systems imposed on the environment of Hong Kong.



## 2. AIR QUALITY MONITORING

### 2.1 Methodology of H<sub>2</sub>S Concentration Monitoring

2.1.1 15-min H<sub>2</sub>S concentration was measured using a Jerome 631-X analyzer. This analyzer is capable of measuring H<sub>2</sub>S concentration in the range of 1 ppb to 50 ppm with a resolution of 1 ppb and operates within a temperature range of 0°C to 40°C at an air flow rate of 0.15 L/min. Odour gas samples were drawn by built-in a suction pump of the analyzer and passed through a gold film sensor. The trace level of H<sub>2</sub>S of the samples were determined electrochemically on the gold film sensor. Meteorological conditions including temperature, wind speed, wind direction and relative humidity were also measured at the time of the monitoring. Table 2.1 summarizes the equipment used in H<sub>2</sub>S monitoring.

**Table 2.1 Equipment used for H<sub>2</sub>S Concentration Monitoring**

Equipment	Manufacturer / Model	Serial Number	Sensor Number
Gold Film Hydrogen Sulphide Analyzer	JEROME X631 0003	2966	14-11-23-R2D

### 2.2 Methodology of Modified Odour Patrol Monitoring

2.2.1 Due to the complaint case received on 28 November 2019, a modified version of odour patrol monitoring is proposed and approved on 13 March 2020. According to the approved proposal for odour patrol monitoring plan (0041/17/ED/0524G), a modified version of odour patrol monitoring was commenced on 20 March 2020 to ensure the mitigation measures are effectively implemented. The modified odour patrol conducted once per week by two independent trained personnel/competent persons (the "patrollists") patrolling and sniffing along the SHWSTW boundary and the air sensitive receivers (ASRs).

2.2.2 The odour monitoring should not be undertaken on rainy days. Subject to the prevailing weather forecast condition, odour patrol shall be conducted by two patrollists at the downwind locations. During the patrol, the sequence should start from less odourous locations to stronger odourous locations.

2.2.3 The two patrollists shall be satisfied the below requirements during odour patrol:

- Have their individual odour threshold of n-butanol in nitrogen gas in the range of 20 to 80 ppb/V required by the European Standard method: BS EN13725.
- Be free from any respiratory illnesses.
- Not be allowed to smoke, eat, drink (except water) or use chewing gum or sweets 30min before and during odour patrol.
- Take great care not to cause any interference with their own perception or that of others by lack of personal hygiene or the use of perfumes, deodorants, body lotions or cosmetics.
- Not communicate with each other about the results of their choices.

2.2.4 During the odour patrol monitoring, the meteorological and surrounding information are recorded as follows:

- i. Prevailing Weather Condition;
- ii. Wind Direction;
- iii. Wind Speed;
- iv. Location where Odour is detected;
- v. Source of Odour detected;
- vi. Perceived intensity of Odour detected;
- viii. Duration of Odour detected; and
- ix. Characteristics of Odour detected

2.2.5 The perceived intensity is to be divided into 5 levels which are ranked in a descending order as follows:

**Table 2.2 Categories of Odour Intensity for Modified Odour Patrol Monitoring**

<b>Odour Level</b>	<b>Odour Intensity</b>	<b>Classification Criteria</b>
0	Not detected	No odour perceived or an odour so weak that it cannot be easily characterised or described.
1	Slight	Slight identifiable odour, and slight chance to have odour nuisance.
2	Moderate	Moderate identifiable odour, and moderate chance to have odour nuisance.
3	Strong	Strong identifiable, likely to have odour nuisance.
4	Extreme	Extreme severe odour, and unacceptable odour level.

## 2.3 Methodology of Odour Sampling and Olfactometry Analysis

- 2.3.1 Odour gas samples were collected in a Nalophan sampling bag placed inside a vacuum air-tight sampler using passive sampling technique. Approximately 60 liter of gas sample was collected at each sampling. All samples collected on the sampling day were returned to laboratory for olfactometry analysis within 24 hours and analyzed within 2 hours upon receiving.
- 2.3.2 ALS Technichem (HK) Pty Ltd. (HOKLAS Reg. No. 066), was the appointed laboratory for olfactometry analysis of the gas sample.
- 2.3.3 The odour concentration of the samples were determined by Forced-choice Dynamic Olfactometer in accordance with the European Standard Method: BS EN13725. Testing were also performed by a panel of six members who have been trained to comply with the requirement of European Standard Method: BS EN13725. All testing were completed within 24 hours upon sampling.

## 2.4 Monitoring Location

- 2.4.1 H<sub>2</sub>S concentration monitoring and odour sampling at ASR, Cheung Tung Road near the Bus Depot at the west of the Siu Ho Wan Treatment Plant, were temporarily suspended from 14 May 2018. The location of ASR is shown in **Figure 1**.
- 2.4.2 9 odour patrol points is chosen to conduct the modified odour patrol for collecting more representative data and identify the particular source of odour in the site. The nine odour patrol points is as below:

**Table 2.3 Odour Patrol Point**

Odour Patrol Point	Description
OD1	Eastern Site Boundary
OD2	Southern Site Boundary
OD3	Western Site Boundary
OD4	Northern Site Boundary
OD5	Spur Road near Discovery Bay Tunnel Outlet
OD6	Cheung Tung Road near the Bus Depot
OD7	Cheung Tung Road near O-PARK1
OD8	Sham Shui Kok Dr near MTR Depot
OD9	Discovery Bay Tunnel Toll Plaza

- 2.4.3 The odour patrol points of modified odour patrol is shown in **Figure 2**.

## 2.5 Monitoring Frequency and Duration

- 2.5.1 The durations and frequencies of H<sub>2</sub>S concentration measurement, odour patrolling and odour sampling are summarized in **Table 2.4** below.



**Table 2.4 Durations and Frequencies of Air Quality Monitoring Programme**

	Duration	Frequency
H <sub>2</sub> S concentration monitoring	15 minutes	<sup>1</sup> Weekly basis for 6 months during the initial operation stage
Odour patrol		<sup>4,5</sup> Weekly basis
Odour sampling for olfactometry analysis	<sup>3</sup> 15 minutes	<sup>2</sup> First week of the odour patrol monitoring

Remark:

- 1) In case excessive odour nuisance was detected during the odour patrol monitoring or the standard of the 5 odour units cannot be complied with during the odour panel monitoring, the odour patrol monitoring and H<sub>2</sub>S concentration monitoring shall be extended for a period of three months to cater for the warm-up period of the functioning of the additional mitigation measures.
- 2) In case the relationship between H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>) cannot conclude from the correlation study carried out at the first week of the odour patrol monitoring due to invalid data, additional odour sampling for olfactometry analysis shall be carried out for the correlation study.
- 3) Sufficient air samples (approximate 60L) may be collected in less than 15 minutes during odour sampling.
- 4) As advice by EPD on the odour complaint received in November 2019, odour patrol monitoring was resumed on weekly basis from 15 January 2020.
- 5) As instruction from the company of Discovery Bay Tunnel, odour patrol monitoring at OD5 (Spur Road near Discovery Bay Tunnel Outlet) was conducted on monthly basis.

2.5.2 The monitoring schedule for the present and next reporting period is provided in **Appendix B**.

**2.6 Event and Action Plan**

2.6.1 According to the approved proposal for odour patrol monitoring plan (0041/17/ED/0524G), updated Action and limit levels for air quality monitoring are presented in **Table 2.5**.

**Table 2.5 Action and Limit Levels for Air Quality Monitoring**

Parameter	Action	Limit
Odour Nuisance	One complaint received for specific odour event / Odour intensity of 2 or above is measured from odour patrol	Two or more independent complaints received for specific odour event in 3 months / Odour intensity of 3 or above is measured from odour patrol



2.6.2 The event and action plan for air quality monitoring is provided in **Appendix C**.

**2.7 Quality Assurance and Quality Control**

2.7.1 A control sample was collected by purging odour-free nitrogen gas from a certified gas cylinder on site at each sampling.

2.7.2 Calibration of the analyzer is conducted every year at the laboratory of the manufacturer.

2.7.3 In order to ensure the analyzer is functioning properly, manual sensor regeneration and zero adjustment were performed before each set of odour monitoring.

**2.8 Monitoring Results and Observations**

2.8.1 As advice by EPD on the odour complaint received in November 2019, odour patrol monitoring was resumed on weekly basis. The odour patrol monitoring was carried out on 7, 13, 19, 25 and 31 October 2022. As instruction from the company of Discovery Bay Tunnel, odour patrol monitoring at OD5 (Spur Road near Discovery Bay Tunnel Outlet) was conducted on monthly basis.

2.8.2 The meteorological data including temperature, wind speed and direction of the reporting period at ASR is summarised in **Table 2.6**.

**Table 2.6 Summary of Meteorological Data in Reporting Period**

Date	Location	Temperature (°C)	Relative Humidity (%)	Wind Direction	Wind Speed (m/s)
7 October 2022	OD1	30.0	69	E	1.9
	OD2			-	0.0
	OD3			NE	1.7
	OD4			NE	0.7
	OD6			E	0.8
	OD7			E	1.4
	OD8			NE	0.4
	OD9			E	0.3
	13 October 2022			OD1	25.9
OD2		-	0.0		
OD3		E	0.4		
OD4		NE	0.1		
OD6		NE	0.1		
OD7		-	0.0		
OD8		-	0.0		
OD9		-	0.0		
19 October 2022		OD1	24.0	36	
	OD2	-			0.0
	OD3	E			0.6
	OD4	E			0.3
	OD6	NE			0.4
	OD7	-			0.0
	OD8	NE			0.3

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



25 October 2022	OD9	25.9	51	NE	0.7
	OD1			NE	1.6
	OD2			NE	1.1
	OD3			-	0.0
	OD4			N	0.9
	OD5			-	0.0
	OD6			NE	1.0
	OD7			NE	2.5
	OD8			NE	1.8
31 October 2022	OD9	25.1	53	N	0.9
	OD1			NE	0.5
	OD2			N	0.4
	OD3			-	0.0
	OD4			N	1.3
	OD6			-	0.0
	OD7			NE	0.7
	OD8			NE	0.4
	OD9			N	0.9

2.8.3 The monitoring results in the reporting period are summarised in **Table 2.7**. Graphical pots of results and details of monitoring data are shown in **Appendix D**.

**Table 2.7 Summary of Air Quality Monitoring Result in Reporting Period**

Monitoring Location	Monitoring Parameter
	Odour Patrol <sup>^</sup> (Odour Level)
	Range
OD1	0 - 0
OD2	0 - 1
OD3	0 - 1
OD4	0 - 0
OD5	0 - 0
OD6	0 - 0
OD7	0 - 0
OD8	0 - 0
OD9	0 - 0

Remark:

<sup>^</sup>Odour Level: 0 – Not detected, 1 – Slight, 2 – Moderate, 3 – Strong, 4 – Extreme



- 2.8.4 According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD's memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.
- 2.8.5 No exceedances of Action/Limit levels at ASR were recorded as no complaint was received during the reporting period.
- 2.8.6 Odour mitigation measures such as aeration, chemical dosing system, covering or enclosing the pressing and sludge thickening facilities and ventilating air to a biological treatment unit prior to stack exhaust were implemented during the reporting period.

### 3. WATER QUALITY MONITORING

#### 3.1 Monitoring Station

3.1.1 In accordance with Section 5 of the EM&A Plan, water quality monitoring should be carried out at eight designated monitoring stations (two impact stations and six control stations) during the first five years of the operational phase of the Project. The monitoring stations shall be the same monitoring stations that were used for the baseline monitoring programme and have been approved by EPD. The coordinates of the monitoring stations are shown in **Table 3.1** and their locations are shown in **Figure 3**.

**Table 3.1 Location of Water Quality Monitoring**

Sampling Location		Easting	Northing
A	The Brothers, Control Station	816 100	822 500
B	The Brothers, Control Station	816 680	822 440
C	Siu Ho Wan Outfall, Impact Station	816 800	820 180
D	Siu Ho Wan Outfall, Impact Station	817 160	820 360
E	Cheung Sok, Control Station	819 817	821 655
F	Cheung Sok, Control Station	820 158	821 922
G	Tai Ching Chau, Control Station	822 214	822 692
H	Tai Ching Chau, Control Station	822 494	822 939

#### 3.2 Monitoring Parameter

3.2.1 The monitoring parameters for water quality monitoring are summarized in **Table 3.2**.

**Table 3.2 Parameters for Water Quality Monitoring**

Monitoring Parameters	
In-situ Measurement	Laboratory Analysis
Dissolved oxygen (mg/L)	<i>E. coli</i> (cfu/100ml)
Temperature (degree Celsius)	5-day BOD (mg/l)
pH value	Suspended Solids (mg/l)
Water depth (m)	Ammonia as N (mg/l)
Salinity (ppt)	Nitrate as N (mg/l)
Turbidity (NTU)	Nitrite as N (mg/l)
Current Speed (m/s)	Total inorganic nitrogen (mg/l)
Current Direction (degree magnetic)	Total phosphorus (soluble and particulate) (mg/l)





3.2.2 Apart from the parameters listed in the **Table 3.2**, other relevant supplementary information such as monitoring location, time, weather conditions and any special phenomena will be also recorded.

3.2.3 The tidal data will be obtained from the tide gauge installed in Ma Wan Marine Traffic Station, managed by the Hydrographic Office of Marine Department. Location of the tide gauge is shown in **Figure 4**.

**3.3 Monitoring Equipment**

3.3.1 A multifunctional meter (YSI 6920 V2/ Aqua TROLL 600) will be used to measure dissolved oxygen (DO), concentration, DO saturation, temperature, salinity, pH and turbidity, simultaneously at the same location and water depth. An Acoustic Doppler Current Profiler (ADCP) integrated with echo sounder function will be used to measure water depth, current velocity (speed and direction). The data measured by ADCP will then be downloaded on site to computer on-board. The water depth data measured by the ADCP shall be electronically logged and available for output. All measurement data from the multiparameter monitoring device and ADCP will be integrated with the GPS data from the DGPS logging device, so that data collected at a specific time and location can be shown. The water sampler will be equipped with a multiparameter monitoring device (with water depth probe to determine the exact sampling depth at which a sample is collected). The equipment employed for the monitoring and sampling and their specifications are presented in **Table 3.3**. **Table 3.4** summarizes the equipment used in water quality monitoring. Copy of the calibration certificates for water quality monitoring equipment are presented in **Appendix E**.

**Table 3.3 Water Quality Monitoring and Sampling Equipment**

Parameter	Equipment	Model	Range	Equipment Accuracy
Temperature, Dissolved Oxygen, salinity, pH, Turbidity, Sampling Depth	Water Quality Monitoring Device	1) YSI 6920V2-2-M Sonde 2) Aqua TROLL 600 Multiparameter Sonde	Temp: -5 to 50°C DO: 0-50mg/L DO%: 0-500% Sal: 0 to 70 ppt pH: 0 to 14 pH units Turb: 0-1000NTU Depth: 0-61 meters	Temp: ±0.15°C DO: ±0.1mg/L or 1% (whichever greater) for 0-20mg/L; ±15% for 20-50mg/L (with correction for salinity and temperature) Sal: ±1% or 0.1ppt (whichever greater) pH: ±0.2 units Turb: ±2% or 0.3NTU (whichever greater) Depth: ±0.12m
Water Depth, Current Speed, Current Direction	Acoustic Doppler Current Profiler	RiverSurveyor M9	Water Depth: 0-80m	Water Depth: 1% Current speed: ±0.25% of measured velocity or ±0.2cm/s Current direction: ±2degree magnetic
Positioning	DGPS	Simrad MX521B Smart Antenna with Simrad MX610 CDU	NA	GPS: ±1m
Water Sampling	Water Sampler	Aquatic Research Transparent PC Vertical Water Sampler 2.2L / 3L / 5L	NA	NA



**Table 3.4 Equipment used for Water Quality Monitoring**

Equipment	Manufacturer / Model	Serial Number
Water Quality Monitoring Device	Aqua TROLL 600 Multiparameter Sonde	525120
Acoustic Doppler Current Profiler	RiverSurveyor M9	5906

3.3.2 Apart from the equipment mentioned in Section 3.3.1, a Class III commercially licensed vessel will be used as survey vessel. DGPS logging device with accuracy of  $\pm 1\text{m}$  at 95% confidence level will be installed on the survey vessel to ascertain that measurement can be made accurately on the specific transects. All GPS data collected during the whole survey will be automatically and electronically logged. Powered winch will be used on-board the Survey Vessel to assist the monitoring. Experienced supervisor will be present all throughout the monitoring activities on-board the survey vessel.

3.3.3 Water samples will be collected by water sampler and stored in high density polythene bottles and sterilized glass bottles (for bacterial analysis), packed in ice (cooled to  $4^{\circ}\text{C}$  without being frozen), and delivered to the laboratory on the same day of collection for analysis. All sampling bottles will be pre-rinsed with the same water samples. The sampling bottles will then be taken to a HOKLAS accredited laboratory for analysis of *E. coli*, BOD<sub>5</sub>, Suspended Solids, NH<sub>3</sub>-N, NO<sub>3</sub>-N, NO<sub>2</sub>-N, Total inorganic nitrogen, Total phosphorus (soluble and particulate).

**3.4 Laboratory Measurement and Analysis**

3.4.1 With reference to EPD’s letter (Ref: Ax(7) to EP 2/No/F/50 Pt.7) dated 8 February 2022, Change of Laboratory on Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey (0041\_17\_ED\_0632A) is approved. Fugro Technical Services Limited (HOKLAS Reg. No. 015), is the appointed laboratory for analysis of water samples. The methods adopted by the laboratory and the reporting limits are detailed in **Table 3.5**.

**Table 3.5 Laboratory Measurement/Analysis Methods and Reporting Limits**

Analysis Description	Method	Reporting limits
<i>E. coli</i>	DoE Section 7.8, 7.9.4.2& 7.9.4.4 plus in situ urease test	1 cfu/100mL
5-day Biochemical Oxygen Demand	APHA 23rd edition 5210B	1 mg/L
Total Suspended Solid	APHA 23rd edition 2540D	0.5 mg/L
Ammonia as N	APHA 23rd edition 4500 - NH <sub>3</sub> H	0.005 mg/L
Nitrate as N	APHA 23rd edition 4500 - NO <sub>3</sub> <sup>-</sup> I	0.005 mg/L
Nitrite as N	APHA 23rd edition 4500 - NO <sub>2</sub> <sup>-</sup> A & NO <sub>3</sub> <sup>-</sup> I	0.005 mg/L
Total Inorganic Nitrogen	By Calculation	0.01 mg/L

Analysis Description	Method	Reporting limits
Total phosphorus (soluble and particulate)	APHA 17th edition 4500-PB5 (digestion) and In-house method E-T-056 (determination)	0.01 mg/L

### 3.5 Monitoring Frequency and Duration

- 3.5.1 The water quality monitoring programme will be carried out once per two months for a period of five years of the operational phase of the Project.
- 3.5.2 Water quality monitoring for two tides at eight designated stations will be carried out for each monitoring event. For each station at each tide, duplicate samples for in-situ parameter and laboratory analysis at three designated water depths (1 m below water surface, mid-depth and 1 m above the seabed) will be taken and analyzed.
- 3.5.3 The monitoring schedule for the present and next reporting period is provided in **Appendix B**.

### 3.6 Quality Assurance / Quality Control

- 3.6.1 The equipment is in compliance with the requirements set out in the EM&A Plan. All in-situ monitoring instruments were calibrated by a HOKLAS-accredited laboratory or by standard solutions. Calibration of temperature, DO, salinity, pH and turbidity is conducted in three month interval.
- 3.6.2 During the measurements of DO concentration, DO saturation, salinity, turbidity, pH and temperature, duplicate readings will be taken. If the difference between the first and second readings of DO or turbidity is more than 25% of the value of the first reading, the reading was discarded and further readings will be taken.
- 3.6.3 The laboratory incorporates a variety of QA/QC monitoring programme into their testing system. Where applicable or available, the quality of the analysis will be monitored by conducting the following QC analysis:

For each batch of 20 samples:

- A minimal of 1 laboratory method blank will be analyzed;
- A minimal of 1 sample duplicate will be analyzed;
- A minimal of 1 sample matrix spike will be analyzed.



**3.7 Event and Action Plan**

3.7.1 Since the purpose of the water quality monitoring is to collect data for future propose, no specific event and action has to be followed.

**3.8 Monitoring Results and Observations**

3.8.1 Water quality monitoring is carried out was 10 October 2022. A summary of the in-situ water quality monitoring results are presented in **Table 3.6** (Mid-ebb) and **Table 3.7** (Mid-flood) respectively. The complete record and graphical presentation of the in-situ water quality monitoring results is given in **Appendix F**.

**Table 3.6 Summary of In-situ Monitoring Results (Mid-ebb)**

Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)
A	17	S 1	5.19	28.52	8.41	30.23	5.7	0.18	92.6
		S 1	5.17	28.54	8.42	30.26	5.6	0.14	91.1
		M 8.5	4.99	28.26	8.31	30.46	5.5	0.23	74.2
		M 8.5	4.97	28.22	8.32	30.49	5.1	0.24	74.1
		B 16	4.91	28.11	8.34	30.99	5.3	0.14	80.8
		B 16	4.89	28.14	8.37	30.97	5.1	0.16	81.2
B	14	S 1	4.49	27.42	8.24	32.04	4.2	0.17	203.4
		S 1	4.51	27.44	8.22	32.06	4.6	0.13	206.1
		M 7	4.32	27.29	8.19	31.73	4.4	0.14	184.3
		M 7	4.29	27.22	8.29	31.74	4.7	0.13	184.7
		B 13	4.28	27.14	8.11	31.99	4.6	0.12	199.1
		B 13	4.27	27.15	8.19	31.96	4.2	0.13	194.6
C	12	S 1	5.28	28.46	8.62	30.83	3.5	0.26	74.2
		S 1	5.24	28.49	8.66	30.91	3.2	0.21	77.1
		M 6	5.09	28.24	8.69	30.84	3.9	0.29	90.6
		M 6	5.08	28.22	8.68	30.81	3.5	0.28	90.8
		B 11	4.99	28.04	8.69	31.07	3.9	0.14	82.4
		B 11	4.97	28.06	8.64	31.06	3.6	0.19	82.5
D	13	S 1	4.83	28.71	8.71	33.44	2.3	0.17	43.1
		S 1	4.84	28.72	8.72	33.26	2.4	0.13	43.2
		M 6.5	4.71	28.46	8.73	33.97	3.1	0.14	52.6
		M 6.5	4.74	28.48	8.74	33.96	3.3	0.16	52.8
		B 12	4.52	28.39	8.69	31.43	3.4	0.18	49.7
		B 12	4.51	28.33	8.68	31.29	3.6	0.20	49.9
E	16	S 1	5.01	28.14	8.77	32.44	4.7	0.32	90.4
		S 1	5.06	28.17	8.79	32.39	4.8	0.34	91.2
		M 8	5.12	28.84	8.64	32.86	4.1	0.29	93.4
		M 8	5.11	28.81	8.61	32.88	4.2	0.29	93.3
		B 15	5.01	28.77	8.54	32.94	4.7	0.34	79.4
		B 15	5.02	28.71	8.51	32.99	4.6	0.39	79.9
F	23	S 1	5.77	31.15	8.51	31.17	4.5	0.24	74.1
		S 1	5.69	31.14	8.52	31.14	4.9	0.26	72.6
		M 11.5	5.12	31.26	8.59	31.46	4.1	0.28	64.2
		M 11.5	5.14	31.28	8.57	31.49	4.2	0.29	69.1
		B 22	5.05	31.13	8.84	31.15	4.9	0.24	68.2
		B 22	5.06	31.49	8.81	31.17	5.1	0.21	68.1

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)
G	22	S 1	5.34	28.41	8.11	32.88	4.4	0.17	264.1
		S 1	5.33	28.42	8.13	32.89	4.6	0.17	266.2
		M 11	5.17	28.94	8.46	32.64	4.5	0.11	281.5
		M 11	5.16	28.99	8.41	32.66	4.8	0.12	284.9
		B 21	4.92	28.65	8.24	31.06	4.7	0.14	311.4
		B 21	4.91	28.61	8.23	31.04	4.9	0.12	312.6
H	19	S 1	5.81	27.93	8.14	31.26	3.9	0.24	137.2
		S 1	5.82	27.94	8.16	31.24	3.8	0.27	133.4
		M 9.5	5.43	27.41	8.23	31.39	3.7	0.24	129.9
		M 9.5	5.42	27.42	8.24	31.38	3.6	0.27	129.8
		B 18	5.31	27.33	8.20	31.56	3.2	0.27	109.1
		B 18	5.32	27.34	8.19	31.54	3.3	0.29	109.2

Table 3.7 Summary of In-situ Monitoring Results (Mid-flood)

Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)
A	15	S 1	5.38	28.57	8.56	31.12	3.9	0.10	77.1
		S 1	5.34	28.64	8.57	31.14	3.8	0.14	72.4
		M 7.5	5.13	28.59	8.69	31.11	4.1	0.12	73.9
		M 7.5	5.14	28.58	8.67	31.11	4.2	0.16	73.8
		B 14	5.09	28.44	8.81	31.10	4.9	0.16	82.6
		B 14	5.08	28.49	8.82	31.12	4.8	0.19	82.4
B	14	S 1	5.27	28.77	8.61	31.77	4.3	0.06	241.2
		S 1	5.26	28.74	8.62	31.74	4.0	0.04	244.3
		M 7	5.10	28.33	8.52	31.57	4.9	0.17	226.1
		M 7	5.06	28.34	8.53	31.56	4.8	0.19	229.2
		B 13	4.92	28.11	8.44	31.44	4.1	0.18	257.3
		B 13	4.91	28.14	8.41	31.41	4.2	0.16	256.4
C	12	S 1	4.83	28.53	8.44	31.30	4.1	0.24	24.5
		S 1	4.87	28.54	8.39	31.40	4.2	0.29	22.6
		M 6	4.71	28.49	8.57	31.07	4.4	0.17	47.1
		M 6	4.73	28.44	8.56	31.06	4.6	0.19	48.2
		B 11	4.67	28.31	8.48	31.02	5.1	0.14	44.9
		B 11	4.69	28.30	8.47	31.03	5.2	0.16	44.1
D	14	S 1	5.11	29.12	8.44	32.46	2.9	0.09	208.8
		S 1	5.06	29.11	8.41	32.51	2.5	0.11	211.4
		M 7	4.87	29.06	8.32	32.94	3.4	0.14	234.5
		M 7	4.86	29.04	8.37	32.99	3.7	0.15	236.1
		B 13	4.84	28.71	8.58	33.17	3.1	0.11	234.1
		B 13	4.83	28.76	8.56	33.16	3.2	0.12	239.2
E	14	S 1	5.08	28.49	8.23	30.79	3.6	0.14	264.1
		S 1	5.10	28.46	8.24	30.77	3.4	0.17	266.2
		M 7	4.81	28.23	8.17	31.22	3.8	0.12	250.1
		M 7	4.79	28.22	8.16	31.26	3.9	0.13	250.3
		B 13	4.64	28.07	8.03	31.40	3.9	0.15	243.4
		B 13	4.66	28.04	8.04	31.41	4.1	0.19	233.1
F	18	S 1	6.02	28.22	8.14	30.24	2.7	0.12	140.3



Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)
		S 1	6.04	28.21	8.19	30.26	2.8	0.13	139.2
		M 9	5.97	28.14	8.24	30.74	2.2	0.14	102.3
		M 9	5.96	28.13	8.23	30.77	2.3	0.16	103.4
		B 17	5.84	28.04	8.18	30.91	3.1	0.14	128.1
		B 17	5.83	28.01	8.17	30.94	3.4	0.15	127.7
G	13	S 1	5.51	28.43	8.46	30.44	4.2	0.22	90.6
		S 1	5.49	28.44	8.49	30.41	4.1	0.24	90.4
		M 6.5	5.20	28.21	8.65	30.91	4.4	0.21	87.1
		M 6.5	5.19	28.20	8.66	30.92	4.1	0.22	87.2
		B 12	5.08	28.11	8.84	31.11	4.2	0.24	92.6
		B 12	5.09	28.14	8.81	31.12	4.1	0.27	92.4
H	19	S 1	4.92	28.51	8.41	30.41	4.3	0.17	206.1
		S 1	4.94	28.54	8.42	30.46	4.1	0.18	206.4
		M 9.5	4.71	28.84	8.26	30.60	4.7	0.19	204.1
		M 9.5	4.74	28.86	8.29	30.62	4.8	0.21	201.1
		B 18	4.61	28.94	8.18	30.94	4.4	0.12	223.4
		B 18	4.62	28.99	8.17	30.99	4.3	0.13	226.1

3.8.2 Results of laboratory analysis of water quality are presented in **Table 3.8** (Mid-ebb) and **Table 3.9** (Mid-flood) respectively. The complete record and graphical presentation of laboratory analysis results are given in **Appendix F**.

Table 3.8 Summary of Laboratory Analysis Results (Mid-ebb)

Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)
A	17	S 1	6	0.13	0.071	0.10	0.30	200	0.03	<1
		S 1	6	0.12	0.072	0.13	0.32	180	0.03	<1
		M 8.5	6	0.13	0.071	0.17	0.37	190	0.03	<1
		M 8.5	6	0.13	0.071	0.19	0.40	210	0.04	<1
		B 16	7	0.16	0.071	0.26	0.49	200	0.03	<1
		B 16	7	0.15	0.070	0.27	0.49	190	0.04	<1
B	14	S 1	7	0.18	0.071	0.41	0.66	140	0.04	<1
		S 1	7	0.17	0.071	0.34	0.58	170	0.04	<1
		M 7	7	0.20	0.071	0.17	0.44	170	0.04	<1
		M 7	7	0.20	0.071	0.15	0.42	160	0.04	<1
		B 13	5	0.25	0.070	0.17	0.49	160	0.03	<1
		B 13	5	0.25	0.070	0.11	0.43	200	0.03	<1
C	12	S 1	6	0.20	0.065	0.31	0.58	290	0.03	<1
		S 1	5	0.20	0.065	0.30	0.57	200	0.04	<1
		M 6	6	0.20	0.065	0.37	0.54	190	0.04	<1
		M 6	5	0.19	0.065	0.28	0.53	240	0.04	<1
		B 11	6	0.19	0.067	0.31	0.56	230	0.03	<1
		B 11	5	0.19	0.065	0.23	0.49	200	0.03	<1
D	13	S 1	5	0.10	0.063	0.17	0.34	350	0.04	<1
		S 1	5	0.11	0.062	0.18	0.34	240	0.03	<1
		M 6.5	5	0.19	0.064	0.27	0.52	130	0.03	<1
		M 6.5	5	0.19	0.065	0.27	0.53	200	0.03	<1
		B 12	6	0.17	0.065	0.25	0.49	190	0.04	<1

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)
		B 12	6	0.18	0.065	0.30	0.55	180	0.04	<1
E	16	S 1	3	0.24	0.057	0.28	0.57	1200	0.03	<1
		S 1	3	0.23	0.058	0.23	0.51	1100	0.03	<1
		M 8	3	0.20	0.058	0.25	0.50	1200	0.04	<1
		M 8	3	0.21	0.058	0.27	0.54	1100	0.04	<1
		B 15	7	0.22	0.058	0.26	0.54	1200	0.02	<1
		B 15	7	0.22	0.057	0.22	0.49	1100	0.01	<1
F	23	S 1	7	0.21	0.062	0.25	0.52	1000	0.03	<1
		S 1	6	0.22	0.057	0.15	0.42	1100	0.03	<1
		M 11.5	6	0.23	0.058	0.18	0.47	1100	0.04	<1
		M 11.5	6	0.22	0.057	0.18	0.46	1100	0.04	<1
		B 22	5	0.22	0.057	0.22	0.50	1000	0.03	<1
		B 22	5	0.22	0.058	0.17	0.45	1100	0.03	<1
G	22	S 1	5	0.22	0.053	0.27	0.52	730	0.04	<1
		S 1	4	0.22	0.058	0.20	0.48	790	0.04	<1
		M 11	4	0.21	0.058	0.13	0.39	690	0.05	<1
		M 11	4	0.20	0.058	0.14	0.40	760	0.04	<1
		B 21	6	0.24	0.058	0.17	0.47	700	0.03	<1
		B 21	6	0.23	0.057	0.18	0.47	750	0.03	<1
H	19	S 1	6	0.16	0.057	0.12	0.33	1200	0.03	<1
		S 1	6	0.16	0.057	0.18	0.40	1200	0.03	<1
		M 9.5	5	0.14	0.057	0.19	0.38	1100	0.03	<1
		M 9.5	6	0.14	0.057	0.15	0.35	1300	0.04	<1
		B 18	6	0.14	0.057	0.16	0.36	1200	0.04	<1
		B 18	6	0.15	0.057	0.15	0.35	1100	0.04	<1

Table 3.9 Summary of Laboratory Analysis Results (Mid-flood)

Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)
A	15	S 1	5	0.18	0.071	0.22	0.47	240	0.04	<1
		S 1	6	0.18	0.071	0.24	0.49	200	0.03	<1
		M 7.5	5	0.16	0.071	0.25	0.48	180	0.04	<1
		M 7.5	6	0.20	0.071	0.21	0.48	220	0.05	<1
		B 14	5	0.12	0.071	0.24	0.43	240	0.05	<1
		B 14	5	0.12	0.071	0.24	0.42	180	0.06	<1
B	14	S 1	6	0.16	0.071	0.26	0.49	220	0.04	<1
		S 1	6	0.16	0.072	0.30	0.53	190	0.03	<1
		M 7	5	0.13	0.071	0.22	0.42	210	0.05	<1
		M 7	6	0.13	0.071	0.28	0.48	180	0.05	<1
		B 13	5	0.16	0.069	0.17	0.40	220	0.09	<1
		B 13	6	0.16	0.072	0.15	0.38	200	0.09	<1
C	12	S 1	5	0.18	0.067	0.28	0.53	200	0.03	<1
		S 1	5	0.18	0.067	0.31	0.56	180	0.04	<1
		M 6	5	0.13	0.065	0.16	0.36	250	0.04	1.1
		M 6	5	0.14	0.065	0.21	0.40	200	0.04	1.2
		B 11	4	0.19	0.065	0.22	0.47	230	0.03	1.4
		B 11	4	0.19	0.065	0.19	0.45	180	0.03	<1
D	14	S 1	5	0.17	0.25	0.18	0.48	300	0.02	<1
		S 1	5	0.17	0.19	0.18	0.42	340	0.03	<1



Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)
		M 7	5	0.17	0.20	0.19	0.43	390	0.04	<1
		M 7	5	0.17	0.25	0.19	0.49	320	0.04	<1
		B 13	5	0.16	0.25	0.18	0.48	340	0.03	<1
		B 13	5	0.16	0.28	0.18	0.51	300	0.03	<1
E	14	S 1	5	0.18	0.053	0.24	0.47	1100	0.03	<1
		S 1	5	0.18	0.053	0.24	0.47	1000	0.04	<1
		M 7	5	0.18	0.057	0.23	0.47	1100	0.03	<1
		M 7	6	0.18	0.058	0.22	0.60	1000	0.02	<1
		B 13	6	0.17	0.058	0.28	0.52	1100	0.04	<1
		B 13	6	0.17	0.057	0.23	0.46	1000	0.04	<1
F	18	S 1	5	0.20	0.057	0.13	0.37	1600	0.03	<1
		S 1	5	0.20	0.057	0.14	0.37	1600	0.04	<1
		M 9	6	0.17	0.057	0.33	0.57	1500	0.04	1.8
		M 9	6	0.16	0.057	0.28	0.52	1500	0.04	1.7
		B 17	8	0.15	0.057	0.21	0.44	1500	0.04	2.0
		B 17	7	0.14	0.057	0.23	0.46	1600	0.04	1.9
G	13	S 1	7	0.20	0.057	0.22	0.48	920	0.03	1.9
		S 1	7	0.13	0.058	0.25	0.51	960	0.02	2.0
		M 6.5	8	0.20	0.057	0.21	0.43	900	0.03	1.8
		M 6.5	8	0.11	0.057	0.21	0.43	950	0.03	2.1
		B 12	8	0.12	0.057	0.23	0.43	850	0.03	2.6
		B 12	8	0.12	0.058	0.23	0.44	900	0.03	1.8
H	19	S 1	7	0.12	0.056	0.39	0.57	1200	0.03	1.9
		S 1	7	0.13	0.056	0.35	0.54	1200	0.03	1.9
		M 9.5	7	0.12	0.056	0.35	0.52	1100	0.04	1.9
		M 9.5	8	0.11	0.056	0.35	0.52	1100	0.04	1.8
		B 18	5	0.12	0.057	0.24	0.42	1200	0.03	1.6
		B 18	5	0.12	0.057	0.20	0.38	1100	0.04	1.7

3.8.3 The tidal data is obtained from the tide gauge installed in Ma Wan Marine Traffic Station, managed by Hydrographic Office of Marine Department. Tidal data obtained from Ma Wan Marine Traffic Station is present in **Appendix G**.

3.8.4 Heavy marine traffic was observed nearby the Project site and its vicinity and may affect the water quality. The above conditions may affect monitoring results. The weather condition is summarized and presented in **Table 3.10**.

Table 3.10 Weather condition of water quality monitoring

Date	Air Temperature			Mean Relative Humidity (%)	Total Rainfall (mm)
	Maximum (deg. C)	Mean (deg. C)	Minimum (deg. C)		
10 October 2022	26.6	24.0	21.6	51	0.0

Source: Hong Kong Observatory



**4. SEDIMENT QUALITY MONITORING AND BENTHIC SURVEY**

**4.1 Monitoring Station**

4.1.1 In accordance with Section 6 of the EM&A Plan, sediment quality monitoring and benthic survey should be carried out at eight designated monitoring stations (two impact stations and six control stations) during the first five years of the operational phase of the Project. The proposed monitoring stations shall be the same monitoring stations that were used for the baseline monitoring programme and have been approved by EPD. The coordinates of the monitoring stations are shown in **Table 4.1** and their locations are shown in **Figure 3**.

**Table 4.1 Location of Sediment Quality Monitoring and Benthic Survey**

Sampling Location		Easting	Northing
A	The Brothers, Control Station	816 100	822 500
B	The Brothers, Control Station	816 680	822 440
C	Siu Ho Wan Outfall, Impact Station	816 800	820 180
D	Siu Ho Wan Outfall, Impact Station	817 160	820 360
E	Cheung Sok, Control Station	819 817	821 655
F	Cheung Sok, Control Station	820 158	821 922
G	Tai Ching Chau, Control Station	822 214	822 692
H	Tai Ching Chau, Control Station	822 494	822 939

**4.2 Monitoring Parameter**

4.2.1 The monitoring parameters for sediment quality monitoring and benthic survey are summarized in **Table 4.2**.

**Table 4.2 Parameters for Sediment Quality Monitoring and Benthic Survey**

Monitoring Parameters	
Sediment Quality Monitoring	Rinsate Blank for Benthic Survey
Grain size profile* (i.e. Particle Size Distribution) (%)	Cadmium (µg/L)
Total organic carbon* (%)	Chromium (µg/L)
pH value	Copper (µg/L)
Ammonia as N (mg-N/kg)	Lead (µg/L)
Total nitrogen (mg-N/kg)	Mercury ((µg/L)
Total phosphorus (mg-N/kg)	Nickel (µg/L)
Cadmium (mg/kg)	Zinc (µg/L)
Chromium (mg/kg)	Arsenic (µg/L)
Copper (mg/kg)	Silver (µg/L)
Lead (mg/kg)	
Mercury (mg/kg)	
Nickel (mg/kg)	
Zinc (mg/kg)	
Arsenic (mg/kg)	
Silver (mg/kg)	

\*Grain size profile and total organic carbon is determined from the sediment sampled collected for benthic survey.

4.2.2 Apart from the parameters listed in the Table 4.2, other relevant supplementary information such as monitoring location, time, weather conditions and any special phenomena will be also recorded.

4.2.3 The tidal data will be obtained from the tide gauge installed in Ma Wan Marine Traffic Station, managed by the Hydrographic Office of Marine Department. Location of the tide gauge is shown in **Figure 4**.

### 4.3 Sampling Equipment

4.3.1 Ponar grab sampler (capacity of ~ 1 litre) will be used for collection of samples for sediment analysis. The grab will be capable of collecting sufficient amount of surficial (top 5 cm) sediment for the required analysis in a single deployment at each sampling location. The grab will be constructed with non-contaminating material to prevent sample contamination. Photos of ponar grab sampler are shown in **Appendix J**.

4.3.2 A modified Van Veen grab sampler (capacity of ~ 11.3 litres) will be used for collecting sediment samples for benthic survey. The top of the grab will have openings to allow the easy flow of water through the grab as it descends. The openings will be covered with 0.5 mm mesh to prevent the loss of any benthic fauna once sediment samples are taken. In addition the top openings will be sealable by movable flaps which will close when the grab is hauled to surface. Photos of modified Van Veen grab sampler are shown in **Appendix J**.

4.3.3 Class III commercially licensed vessel will be used as survey vessel. DGPS logging device in the ADCP with accuracy of  $\pm 1\text{m}$  at 95% confidence level will be installed on the survey vessel to ascertain that measurement can be made accurately on the specific transects. All GPS data collected during the whole survey will be automatically and electronically logged. Powered winch will be used on-board the survey vessel to assist the monitoring. 4 fixed sieve stations will be equipped on survey vessel. Experienced supervisor will be present all throughout the monitoring activity on-board the survey vessel.

### 4.4 Sampling Procedure

#### Benthic Survey, Particle Size Distribution and TOC Analysis

4.4.1 A modified Van Veen grab sampler (capacity of ~ 11.3 litres) will be deployed using a winch at each of the benthic survey stations to collect single grab sample at each station. The grab sampler will be lowered through the water column slowly at a constant rate (approximately 30 cm/s) to prevent the formation of a pressure wave that may disturb surficial deposits. The grab will then be retrieved and evaluated on board of the survey vessel. Any sample showing uneven penetration or only partially filled with sediment shall be rejected. Samples will be placed in a plastic box with an identification card. Sub-samples (approximately 1 kg) will be splitted up for analysis of particle size distribution and TOC. The remaining sediment samples will be washed gently to separate the benthic organisms and the sediment using a watering hose with marine seawater supply, by a sieve stack (comprising 1 mm and 0.5 mm meshes). Benthic organisms remaining on the sieve will be removed into pre-labeled ziplock plastic bags. A 10% solution of buffered formalin containing Rose Bengal in seawater will be added to the bag to ensure tissue preservation. Samples will be sealed in plastic containers for transport to the laboratory for sorting and identification of benthic organisms.

Sediment Quality Monitoring (Except Particle Size Distribution and TOC Analysis)

4.4.2 Ponar grab sampler (capacity of ~ 1 litres) will be deployed at each of the benthic survey stations to collect single grab sample at each station. The grab sampler should be lowered through the water column slowly at a constant rate (approximately 30 cm/s) to prevent the formation of a pressure wave that may disturb surficial deposits. The grab will then be retrieved and evaluated on board of the survey vessel. Any sample showing uneven penetration or only partially filled with sediment will be rejected. Samples will be placed in a plastic box with an identification card. Sediment samples will be then transferred into brand new soil jars with QA/QC monitoring for laboratory analysis. Samples will be preserved and stored in accordance with approved SOP of HOKLAS accredited laboratory and the recommendations stipulated in ETWB TC (W) No. 34/2002.

4.4.3 Sediment samples shall be collected and packed in ice (cooled to 4°C without being frozen), and delivered to the laboratory on the same day of collection for analysis.

**4.5 Laboratory Measurement and Analysis**

4.5.1 With reference to EPD’s letter (Ref: Ax(7) to EP 2/No/F/50 Pt.7) dated 8 February 2022, Change of Laboratory on Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey (0041\_17\_ED\_0632A) is approved. Fugro Technical Services Limited (HOKLAS Reg. No. 015), is the appointed laboratory for analysis of sediment samples. The methods adopted by the laboratory and the reporting limits are detailed in **Table 4.3**.

**Table 4.3 Laboratory Measurement/Analysis Methods and Reporting Limits**

Analysis Description	Method	Reporting limits
Particle Size Distribution	Geospec 3 : 2001 Test 8.1, 8.5 and 8.7	1%
Total Organic Carbon	APHA 23rd edition 5310B	0.05%
pH value	APHA 23rd edition 4500-H+B	0.1 pH unit
Ammonia as N	APHA 23rd edition 4500 NH3: B & C / In house method E-T-039	0.5 mg/kg
Total Nitrogen	APHA 23rd edition 4500 N <sub>org</sub> : D (digestion), In-house method E-T-036, E-T-037 & APHA 23rd edition 4500 - NO <sub>3</sub> <sup>-</sup> I	10 mg/kg
Total Phosphorus	APHA 17th edition 4500 – PB.5 (digestion) & In house method E-T-056 (determination)	10 mg/kg
Cadmium	USEPA method 3050B (digestion) and 6020A (determination)	0.1 mg/kg
Chromium		0.5 mg/kg
Copper		0.2 mg/kg
Lead		0.2 mg/kg
Mercury		0.05 mg/kg
Nickel		0.2 mg/kg
Zinc		0.5 mg/kg
Arsenic		0.5 mg/kg
Silver		0.1 mg/kg

**4.6 Taxonomic Identification of Benthic Organism**

4.6.1 Taxonomic identification of benthic organisms will be performed using stereo dissecting and high-power compound microscopes where it is necessary. Benthic organisms will be counted

and identified to lower taxonomic levels as far as practicable with biomass (wet weight, to 0.01gram) of each individual recorded. If breakage of soft-bodied organism occurs, only anterior portions of fragments will be counted, although all fragments will be retained and weighted for biomass determinations (wet weight, to 0.01gram). Data of species abundance and biomass will be recorded.

4.6.2 Data collected during surveys will be presented and summarized in tables and graphics. Species/taxon richness and abundance of marine benthic fauna communities will be analyzed by Shannon-Weiner diversity and Pielou's Evenness.

#### **4.7 Monitoring Frequency and Duration**

4.7.1 The sediment quality monitoring and benthic survey programmed shall be carried out once per two months for a period of five years of the operational phase of the Project. Since the purpose of the sediment quality monitoring and benthic survey is to collect data for future reference, only a single round of sediment quality monitoring and benthic survey at 8 designated locations will be carried out for each monitoring event. For each location, only a single sample will be taken and analyzed.

#### **4.8 Quality Assurance / Quality Control**

4.8.1 A rinsate blank will be collected in each monitoring location before each sediment sampling for benthic survey, so as to monitor the effectiveness of field decontamination procedure.

4.8.2 The laboratory incorporates a variety of QA/QC monitoring programme into their testing system. Where applicable or available, the quality of the analysis will be monitored by conducting the following QC analysis:

For each batch of 20 samples:

- A minimal of 1 laboratory method blank will be analyzed;
- A minimal of 1 sample duplicate will be analyzed;
- A minimal of 1 sample matrix spike will be analyzed.

#### **4.9 Event and Action Plan**

4.9.1 Since the purpose of the sediment quality monitoring and benthic survey is to collect data for future purpose, no specific event and action has to be followed.

#### **4.10 Monitoring Results and Observations**

4.10.1 Sediment quality monitoring and benthic survey is carried out on 10 October 2022. A summary of laboratory analysis results for the sediment quality monitoring and benthic survey are presented in **Table 4.4** and **Table 4.5** respectively. The complete record and graphical presentation of the sediment quality monitoring results is given in **Appendix H**.

**Table 4.4 Summary of laboratory analysis results for sediment monitoring**

Monitoring Station	pH value	NH <sub>3</sub> as N (mg/L)	Total N (mg-N/kg)	Total P (mg-P/kg)	Cd (mg/kg)	Cr (mg/kg)	Cu (mg/kg)	Pb (mg/kg)	Hg (mg/kg)	Ni (mg/kg)	Zn (mg/kg)	As (mg/kg)	Ag (mg/kg)
A	8.2	13	1100	380	<0.1	25	24	31	0.14	15	78	12	0.2
B	8.2	10	1200	340	<0.1	27	29	32	0.11	16	84	11	0.3
C	8.0	16	1500	400	<0.1	32	33	37	0.13	19	95	11	0.3
D	8.0	11	1500	410	<0.1	29	29	35	0.13	17	88	11	0.3
E	7.9	20	1500	450	<0.1	30	33	34	0.12	18	94	10	0.3
F	8.0	32	1500	500	<0.1	33	34	37	0.14	19	98	11	0.3
G	8.1	6.2	850	340	<0.1	18	31	25	0.06	11	63	8.3	0.2
H	8.1	10	1100	400	<0.1	22	30	27	0.08	13	76	7.4	0.3

**Table 4.5 Summary of laboratory analysis results for benthic survey**

Monitoring Station	Total organic carbon (%)	Grain size profile (%)				Description
		Gravel	Sand	Silt	Clay	
A	1.0	0	27	27	46	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY
B	0.8	2	21	33	44	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY
C	1.2	1	5	40	54	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY
D	0.9	1	8	39	52	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY
E	1.6	0	4	39	57	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY
F	1.2	0	2	36	62	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY
G	1.7	4	10	37	49	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
H	1.3	1	7	39	53	Moist, grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments

4.10.2 Rinsate blank was collected for chemical analysis. The laboratory data results are provided in **Appendix H**.

4.10.3 Construction works from expansion of Hong Kong International Airport was observed nearby the Project site and its vicinity and may affect the sediment quality. The above conditions may affect monitoring results. The weather condition is summarized and presented in **Table 4.6**.

**Table 4.6 Weather condition of water quality monitoring**

Date	Air Temperature			Mean Relative Humidity (%)	Total Rainfall (mm)
	Maximum (deg. C)	Mean (deg. C)	Minimum (deg. C)		
10 October 2022	26.6	24.0	21.6	51	0.0

Source: Hong Kong Observatory

4.10.4 The benthic survey data are summarized and presented in **Table 4.7**.

Table 4.7 Summary of benthic survey data on 10 October 2022

Monitoring Station	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	57	0.84	10	1.90	15.57
B	43	0.49	11	1.90	17.13
C	20	0.68	7	1.47	18.19
D	68	0.49	12	1.59	25.98
E	55	1.59	12	2.09	16.26
F	32	0.19	7	1.62	14.58
G	38	3.13	11	2.18	14.08
H	34	0.43	10	2.10	13.46

4.10.5 The benthic survey results are analyzed and presented as below:

i) Abundance

A total of 347 benthic organisms were recorded from the eight monitoring stations during the October 2022 monitoring period. Current monitoring results showed lower total monthly abundance compared to both dry (March 2004) and wet (August 2004) seasons baseline data results. The current decrease in overall abundance may be attributed to the decrease in *Trypauchen* and *Styela* abundance which could have been due to the concurrent increase in ammonia of the sediments relative to August 2022 data. As shown in several studies, higher levels of ammonia may cause lower macrobenthic density (Lai et al., 2020). Similar with previous monitoring periods, total monthly abundance of benthic organisms exhibits significant seasonal variation (F-value = 4.52; F-crit = 1.54; p-value = 2.05E-10;  $\alpha$  = 0.05).

In terms of spatial distribution, the lowest abundance of 20 ind. was recorded in the impact station, Station C, while the highest (68 ind.) was also noted in other impact station, Station D. Total macro-benthic abundances, similar with the previous monitoring periods, showed statistically significant spatial distribution (F-value = 3.62; F-crit = 2.05; P-value = 0.001;  $\alpha$  = 0.05).

ii) Biomass

The total wet biomass recorded in the eight monitoring stations was 7.84 g with the highest biomass recorded in the reference station, Station G (3.13 g) while the lowest biomass (0.19 g) was observed in the reference station, Station F. Relative to the August 2022 period, a decrease in biomass was observed during the current monitoring period. Most of the current decrease was attributed to the biomass decrease of *Trypauchen* and *Styela* in the benthic community.

iii) Taxonomic Composition

A total of six phyla comprising of 20 families and 24 genera were identified. During the current monitoring period, the annelids (76.66%) dominated the macro-benthic assemblage, followed by the molluscs (10.95%). Relative to the August 2022 community assemblage, current results showed that the annelids still maintained their dominance of the community.



The dominance of annelids in the community assemblage was still noted as it is still wet season during the current survey.

iv) Diversity

Benthic diversity index ( $H'$ ) in the impact stations ranged from 1.47 to 1.59. In the reference stations,  $H'$  values ranged from 1.62 to 2.18. Currently, reference station, Station G had the highest diversity value among the different monitoring stations, while the lowest was the reference station, Station F. In terms of evenness index ( $J$ ) values, impact Station D was noted with relatively high value as compared to other monitoring stations. Moreover, current monitoring results indicated an overall increase in both diversity and evenness values from the baseline survey condition.

The detailed benthic survey results are provided in **Appendix I**.

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

Page 28

### 5. CHINESE WHITE DOLPHIN MONITORING

#### 5.1 Data Interpretation

5.1.1 In accordance with Section 4.1 of the EM&A Plan, relevant information on the distribution and abundance of CWDs in Hong Kong should be obtained from the Agriculture, Fisheries and Conservation Department (AFCD), and be reviewed on a bimonthly basis during the operational phase of the Project for a period of 5 years.

5.1.2 The latest AFCD's report dated 7 July 2022, "*Monitoring of Marine Mammals in Hong Kong Waters (2021-22)*", in terms of the distribution and abundance of CWDs, was reviewed in the Monthly EM&A report in August 2022. According to the advice from AFCD, the data of distribution and abundance of CWDs would only be available in the annual reports for Monitoring of Marine Mammals In Hong Kong Waters which cover monitoring data from 1 April to 31 March (next year). The updated status of the distribution and abundance of CWDs will be provided once the annual report (2022-23) is uploaded to AFCD's webpage.



## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

Page 29

### 6. ADVICE ON IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES

#### 6.1 Implementation Status

- 6.1.1 Although no site inspection is prescribed during the operation of the Plant in accordance with the approved EM&A Plan, SHWSTW is reminded to fully and properly implement the mitigation measures specified in the EP and EIA Report. Mitigation measures such as aeration, chemical dosing system, covering or enclosing the pressing and sludge thickening facilities and ventilating air to a biological treatment prior to stack exhaust was implemented in the reporting period. A summary of mitigation measures implementation schedule is provided in **Appendix L**.



## **7. ADVICE ON THE SOLID AND LIQUID WASTE MANAGEMENT STATUS**

7.1.1 SHWSTW is reminded to fully comply with EP conditions. All measures and recommendations in the EP, EIA Report and approved Waste Management Plan (WMP) shall be fully and properly implemented. During the reporting period, following measures in related to solid and liquid waste management were implemented:

- The influent of waste water shall be treated by CEPT with UV disinfection;
- Trip-ticket system shall be implemented for sludge and sediment;
- The acceptance criteria for Landfill disposal should be followed;
- Chemical waste should be properly handled and stored temporarily in designated chemical waste storage area on site in accordance with the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes.

7.1.2 A summary of mitigation measures implementation schedule is provided in **Appendix L**.

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

Page 31

### **8. SUMMARY OF EXCEEDANCE OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS**

- 8.1.1 Odour patrol monitoring was resumed and carried out on 7, 13, 19, 25 and 31 October 2022. No exceedances of Action/Limit levels at ASRs were recorded.
- 8.1.2 Water quality monitoring, sediment quality monitoring and benthic survey were carried out on 10 October 2022. No specific Action/Limit level has to be followed since the purpose of the monitoring is to collect data for future purpose.

## 9. SUMMARY OF ENVIRONMENTAL COMPLAINTS

9.1.1 No complaint (written or verbal), inspection notice, notification of summons or prosecution was received in relation to environmental impact during the report period. Summaries of complaints, notification of summons and successful prosecutions are presented in **Table 9.1** and **Table 9.2**.

**Table 9.1 Cumulative Statistics on Complaints**

Environmental Parameters	Cumulative No. Brought Forward	No. of Complaints This Month	Cumulative Project-to-Date
Air	0	0	1
Noise	0	0	0
Water	0	0	0
Waste	0	0	0
Others	0	0	0
Total	0	0	0

**Table 9.2 Cumulative Statistics on Notification of Summons and Successful Prosecutions**

Environmental Parameters	Cumulative No. Brought Forward	No. of Notification of Summons and Prosecutions This Month	Cumulative Project-to-Date
Air	0	0	0
Noise	0	0	0
Water	0	0	0
Waste	0	0	0
Others	0	0	0
Total	0	0	0

9.1.2 The cumulative complaint log and summaries of complaints are presented in **Appendix K**.



## 10. FUTURE KEY ISSUES

10.1.1 The key issues to be considered in the coming reporting month include:

- i. Potential environmental impacts arising from the operation of SHWSTW are mainly associated with air quality, water quality, sediment quality, benthic ecology, waste management and distribution and abundance of CWDs.
- ii. According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD's memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.

## 11. CONCLUSION

- 11.1.1 Odour patrol monitoring was resumed from January 2020 and carried out on 7, 13, 19, 25 and 31 October 2022. The modified odour patrol monitoring plan including updated Event and Action Plan was approved on March 2020, and odour patrol monitoring was commenced from 20 March 2020. No exceedances of Action/Limit levels at Air Sensitive Receivers (ASR) and odour patrol points were recorded and no non-compliance of odour monitoring at odour patrol points were recorded in the reporting period.
- 11.1.2 According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD's memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.
- 11.1.3 Water quality monitoring, sediment quality monitoring and benthic survey were conducted on 10 October 2022 to collect data for future reference in accordance with Section 5.5 and 6.5 of the Operational EM&A Plan. The details of methodology and results collected of the monitoring were presented in Section 3 and Section 4. Heavy marine traffic and construction works from expansion of Hong Kong International Airport were observed nearby the Project site and its vicinity and may affect the water and sediment quality The above conditions may affect monitoring results.
- 11.1.4 The latest AFCD's report dated 7 July 2022, "*Monitoring of Marine Mammals in Hong Kong Waters (2021-22)*" in terms of the distribution and abundance of CWDs was reviewed. According to the advice from AFCD, the data of distribution and abundance of CWDs would only be available in the annual reports for Monitoring of Marine Mammals In Hong Kong Waters which cover monitoring data from 1 April to 31 March (next year). The updated status of the distribution and abundance of CWDs will be provided once the annual report (2022-23) is uploaded to AFCD's webpage.
- 11.1.5 SHWSTW is reminded to fully *comply with EP conditions. All environmental mitigation measures* and recommendations in the EP, EIA Report and approved waste management plan shall be fully and properly implemented.
- 11.1.6 No complaint (written or verbal), inspection notice, notification of summons or prosecution was received in relation to environmental impact during the report period.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com




---


Report No.: 0041/17/ED/0688


Figure 1

Monitoring Stations of Air Sensitive Receivers

**圖例**  
**LEGEND :**

-  **MONITORING STATION**
- A1** MTR SIU HO WAN DEPOT
- A2** SIU HO WAN GOVERNMENT DEPOT
- A3** NORTH LANTAU EXPRESSWAY (OPPOSITE TO SIU HO WAN STP)
- A4** ADMINISTRATION BUILDING OF SIU HO WAN STP
- A5** ACCESS ROAD LENDING TO DISCOVERY BAY TUNNEL
- A6** VEHICLE DETENTION CENTRE
- A7** OFFICE OF SIU HO WAN WATER TREATMENT WORKS

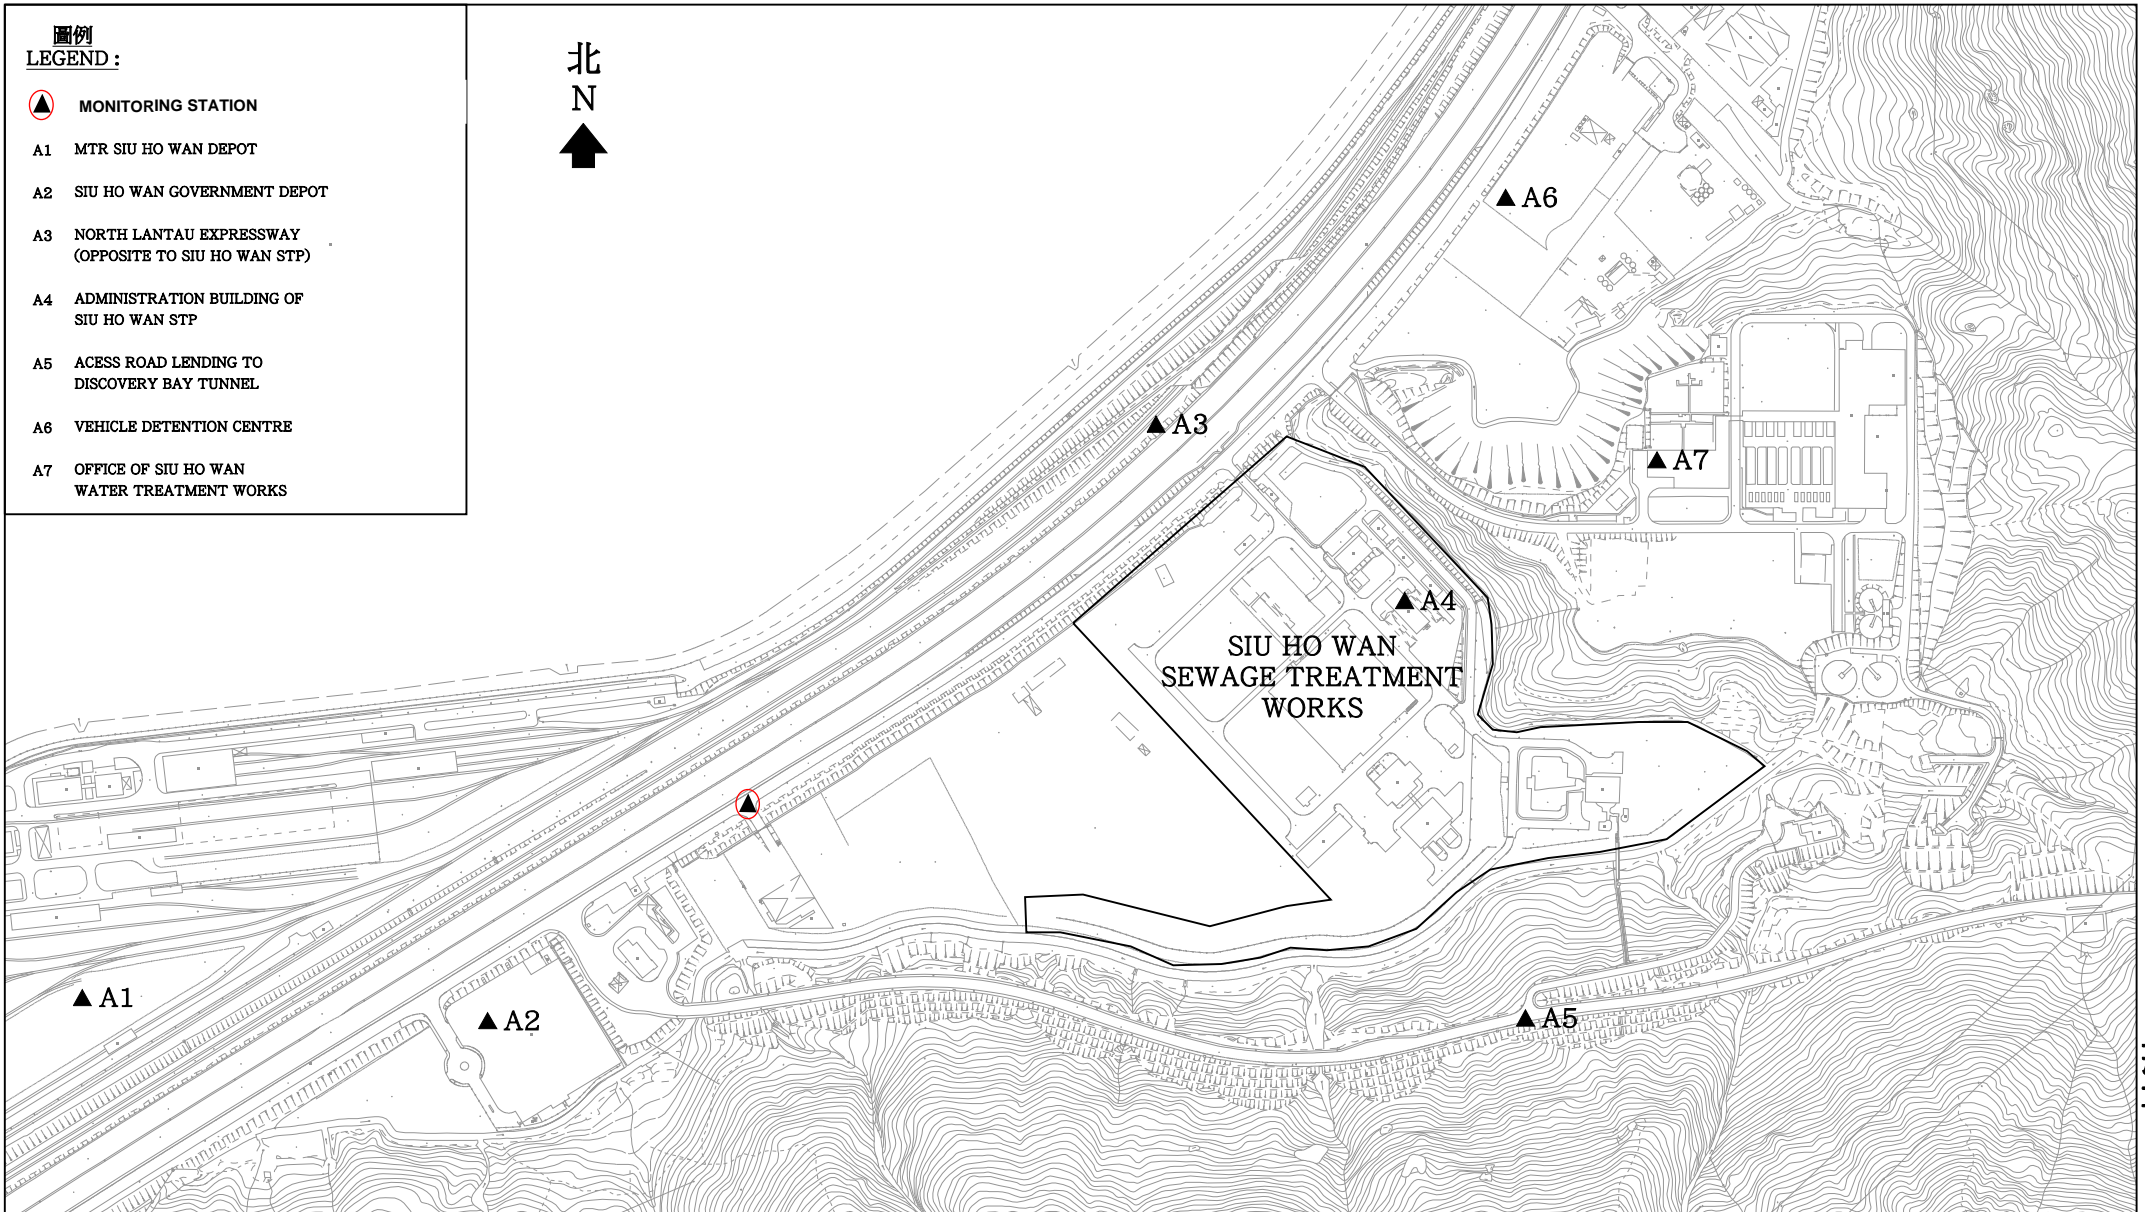

<p>圖則名稱 drawing title</p> <p><b>UPGRADING OF SIU HO WAN SEWAGE TREATMENT PLANT OPTIONAL ENVIRONMENTAL MONITORING AND AUDIT PLAN ODOUR PATROL MONITORING STATIONS</b></p>	繪畫 drawn	C.W. CHAN	日期 date	16-08-2006
	核對 checked	C.K. LAM	日期 date	16-08-2006
	批核 approved	S.K. WONG	日期 date	16-08-2006
	部門 office	顧問工程管理部 CONSULTANTS MANAGEMENT DIVISION		
			圖則編號 drawing no.	比例 scale
			<b>DCM/2006/063</b>	N.T.S.
保留版權 COPYRIGHT RESERVED				
				香港特別行政區政府渠務署 DRAINAGE SERVICES DEPARTMENT GOVERNMENT OF THE HONG KONG SPECIAL ADMINISTRATIVE REGION



# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---


Report No.: 0041/17/ED/0688

## Figure 2

### Odour Patrol Points of Modified Odour Patrol

圖例  
LEGEND:

- Odour Patrol Points
- OD1 Eastern Site Boundary
- OD2 Southern Site Boundary
- OD3 Western Site Boundary
- OD4 Northern Site Boundary
- OD5 Spur Road near Discovery Bay Tunnel Outlet
- OD6 Cheung Tung Road near the Bus Depot
- OD7 Cheung Tung Road near O-PARK1
- OD8 Sham Shui Kok Dr near MTR Depot
- OD9 Discovery Bay Tunnel Toll Plaza

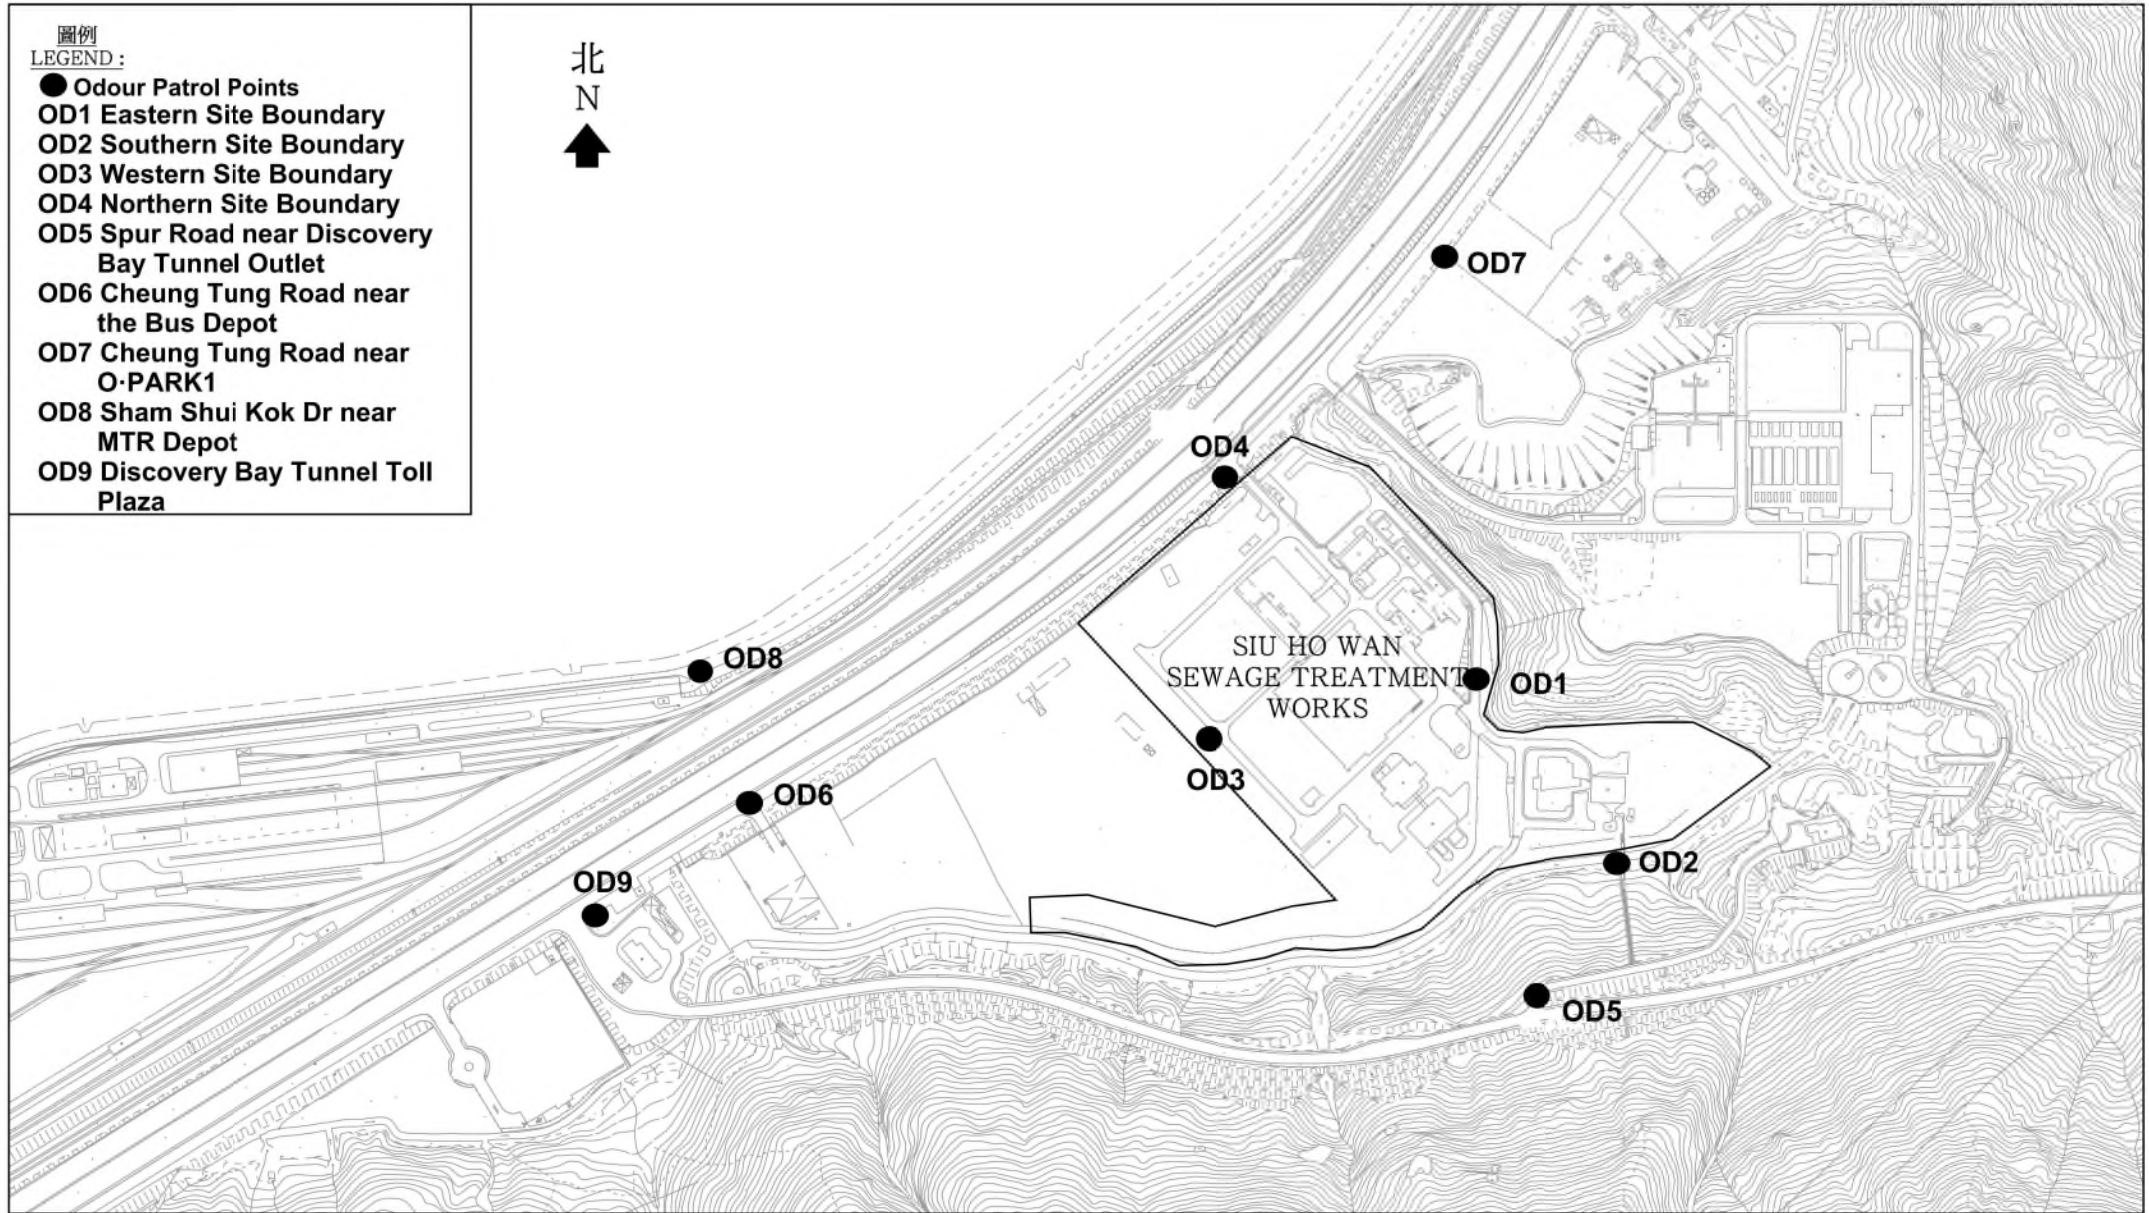

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

### Figure 3

Monitoring Stations of Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey



816000E

818000E

820000E

822000E

822000N

大小磨刀  
BROTHERS


820000N

## CO-ORDINATES OF CONTROL STATIONS :

CONTROL STATION No.	CO-ORDINATES	
	NORTHING	EASTING
A	822500	816100
B	822440	816680
E	821655	819817
F	821922	820158
G	822692	822214
H	822939	822494

## CO-ORDINATES OF IMPACT STATIONS :

IMPACT STATION No.	CO-ORDINATES	
	NORTHING	EASTING
C	820180	816800
D	820360	817160

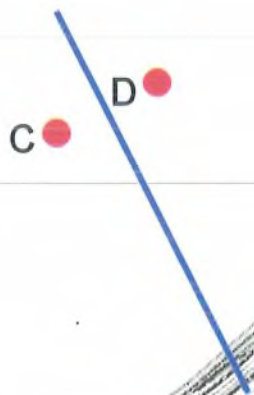圖例  
LEGEND :

- IMPACT STATION
- ⊕ CONTROL STATION
- SUBMARINE OUTFALL

圖則名稱 drawing title

UPGRADING OF SIU HO WAN SEWAGE TREATMENT PLANT  
BASELINE MONITORING - LOCATION OF MONITORING STATIONS

繪畫 drawn

H.K. LAI

日期 date

06-02-2004

核對 checked

C.K. LAM

日期 date

04-03-2004

批核 approved

S.K. WONG

日期 date

04-03-2004

部門 office

顧問工程管理部

CONSULTANTS MANAGEMENT DIVISION

圖則編號 drawing no.

DCM/2004/002

比例 scale

N.T.S.

保留版權

COPYRIGHT RESERVED



香港特別行政區政府渠務署  
DRAINAGE SERVICES DEPARTMENT  
GOVERNMENT OF THE  
HONG KONG  
SPECIAL ADMINISTRATIVE REGION

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

Figure 4

Location of the Tide Gauge

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Location of the Tide Gauge

Source: Google Maps

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix A Project Organization Chart


# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

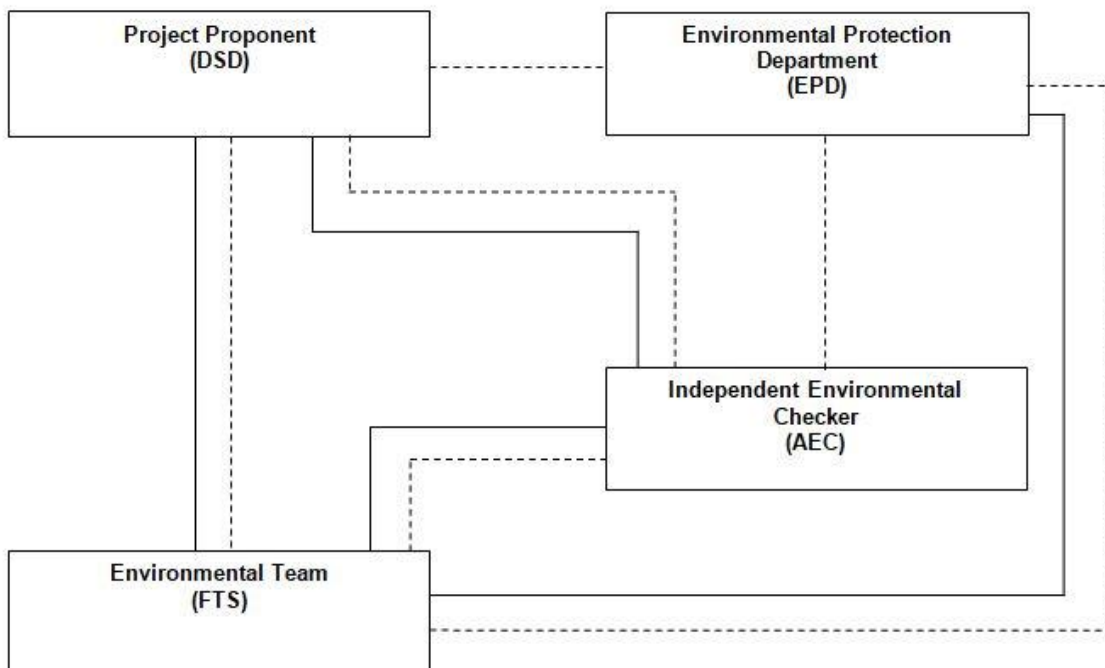

Legend:  
— Line of Reporting  
- - - Line of Communication



# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix B

### Monitoring Schedule for Present and Next Reporting Period

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

## Monitoring Schedule for the Present Reporting Period

Sun	Mon	Tue	Wed	Thur	Fri	Sat
						1
2	3	4	5	6	7 Odour Patrol	8
9	10 Water Quality Monitoring and Sediment Quality Monitoring and Benthic Survey Mid-Flood (06:28) Mid-Ebb (12:40)	11	12	13 Odour Patrol	14	15
16	17	18	19 Odour Patrol	20	21	22
23	24	25 Odour Patrol	26	27	28	29
30	31 Odour Patrol					

### Remarks

1. Due to raining on 25 August 2022, the odour patrol monitoring was rescheduled to 26 August 2022.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

## Monitoring Schedule for the Next Reporting Period

Sun	Mon	Tue	Wed	Thur	Fri	Sat
		1 November	2	3	4	5
6	7	8	9	10	11 Odour Patrol	12
13	14	15	16	17 Odour Patrol	18	19
20	21	22	23 Odour Patrol	24	25	26
27	28	29 Odour Patrol	30			

### Remarks

- Actual monitoring will be subjected to change due to any safety concern or adverse weather condition.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix C

### Event and Action Plan for Air Quality Monitoring

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

EVENT	ACTION		
	ET	IEC	*Operator
<b>Action Level</b>			
One complaint received for specific odour event / Odour intensity of 2 or above is measured from odour patrol	<ol style="list-style-type: none"> <li>1. Identify source/reason of exceedance or odour complaints;</li> <li>2. Notify the IEC and Operator of exceedance;</li> <li>3. Repeat odour patrol to confirm finding;</li> <li>4. If exceedance continues, notify the IEC and Operator;</li> <li>5. Carry out investigation to identify the source/reason of exceedance or complaints;</li> <li>6. Check Operator's working methods; and</li> <li>7. Discuss with Operator on required remedial actions.</li> </ol>	<ol style="list-style-type: none"> <li>1. Check odour patrol results submitted by ET;</li> <li>2. Discuss with ET and Operator on the possible remedial actions;</li> <li>3. Advise the Operator on the effectiveness of the proposed remedial measures;</li> <li>4. Supervise implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>1. Notify the ET and IEC when receipt of odour complaint;</li> <li>2. Confirm receipt of notification of exceedance in writing;</li> <li>3. Identify/ confirm source with ET;</li> <li>4. Discuss with ET for remedial actions required;</li> <li>5. Ensure remedial actions properly implemented</li> <li>6. Rectify any unacceptable practice; and</li> <li>7. Amend operation methods if appropriate.</li> </ol>
<b>Limit Level</b>			
More than one complaint in 3 months / Odour intensity of 3 or above is measured from odour patrol	<ol style="list-style-type: none"> <li>1. Identify source/reason of exceedance or odour complaints;</li> <li>2. Notify the IEC and Operator of exceedance;</li> <li>3. Repeat odour patrol to confirm finding;</li> <li>4. If exceedance continues, notify the IEC and Operator;</li> <li>5. Carry out investigation to identify the source/reason of exceedance or complaints;</li> <li>6. Check Operator's working methods;</li> <li>7. Carry out analysis of Operator's working procedures to determine possible mitigation to be implemented;</li> <li>8. Arrange meeting with ET and EPD to discuss the remedial actions to be taken;</li> <li>9. Discuss with EPD and the</li> </ol>	<ol style="list-style-type: none"> <li>1. Check odour patrol results submitted by ET;</li> <li>2. Discuss amongst ET and the Operator on the potential remedial actions;</li> <li>3. Review the proposed remedial actions whenever necessary to assure their effectiveness and advise the Operator accordingly;</li> <li>4. Supervise implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>1. Notify the ET and IEC when receipt of odour complaint;</li> <li>2. Confirm receipt of notification of exceedance in writing;</li> <li>3. Identify/ confirm source with ET;</li> <li>4. Inform ET, IEC and EPD;</li> <li>5. Discuss with EPD and ET on the required remedial actions;</li> <li>6. Ensure remedial actions properly implemented;</li> <li>7. Take immediate action to avoid further exceedance;</li> <li>8. Implement the agreed proposals.</li> </ol>

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

	<p>Operator on the required remedial actions;</p> <ol style="list-style-type: none"><li>10. Submit proposals for remedial actions within 3 working days of notification;</li><li>11. Assess effectiveness of Operator's remedial actions and keep EPD informed of the results;</li><li>12. Amend proposal if appropriate; and</li><li>13. Resubmit proposal if problem still not under control.</li></ol>		
--	---	--	--

\* The operator who is the constructor responsible for the operation during the maintenance period.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix D

### Results and Graphical Presentation of Air Quality Monitoring


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

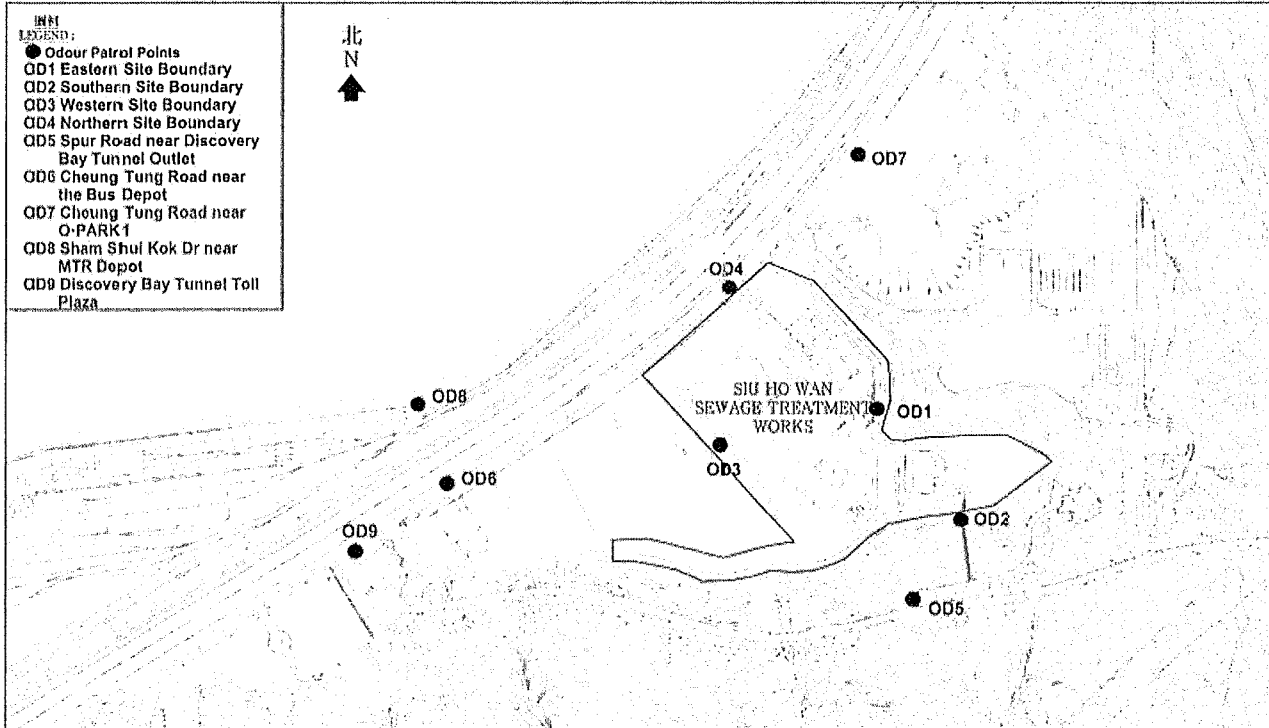

Date	2022/10/7	Weather	Fine	Temperature	30°C	Humidity	69%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	11:16	E	1.9	0	/	
OD2	Southern Site Boundary	11:19	/	0.0	0	/	
OD3	Western Site Boundary	11:14	NE	1.7	1	Effluent	
OD4	Northern Site Boundary	11:11	NE	0.7	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	11:01	E	0.9	0	/	
OD7	Cheung Tung Road near O-PARK1	11:03	E	1.4	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	10:50	NE	0.4	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	10:57	E	0.3	0	/	


**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level


Recorded by: Yeung Tak Sang  
Name: Yeung Tak Sang  
Date: 2022/10/7

Checked by: Choi Kam Ho  
Name: Choi Kam Ho  
Date: 7 October 2022





**Contract No. CM 14/2016**  
**Environmental Team for Operational Environmental Monitoring and Audit for**  
**Siu Ho Wan Sewage Treatment Works**  
**Odour Patrol Record Sheet**

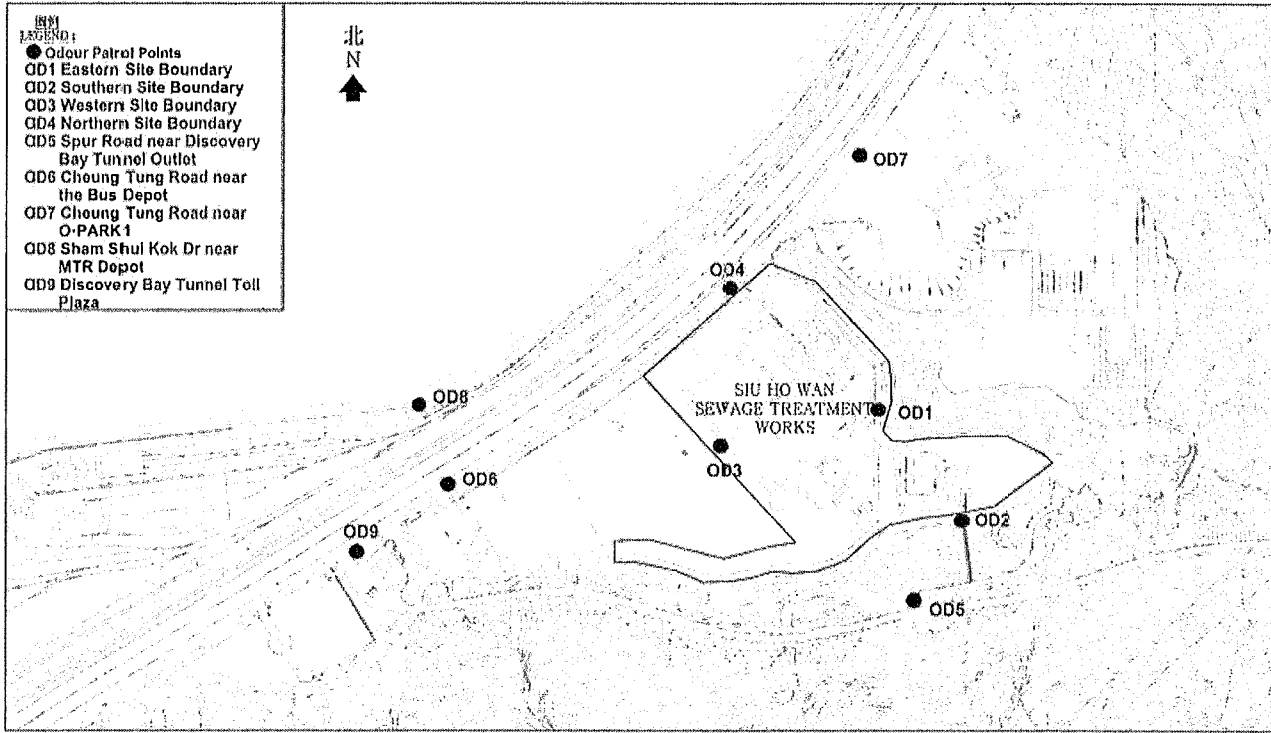

Date	7/10/2022	Weather	Fine	Temperature	30.0°C	Humidity	69%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	11:16	E	1.9	0	/	
OD2	Southern Site Boundary	11:18	/	0	0	/	
OD3	Western Site Boundary	11:14	NE	1.7	0	/	
OD4	Northern Site Boundary	11:11	NE	0.7	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	11:01	E	0.8	0	/	
OD7	Cheung Tung Road near O-PARK1	11:03	E	1.4	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	10:50	NE	0.4	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	10:57	E	0.3	0	/	

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Tsz Ip  
Name: Tsz Ip Hin  
Date: 7/10/2022

Checked by: [Signature]  
Name: CHOI KAM HO  
Date: 7 October 2022


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

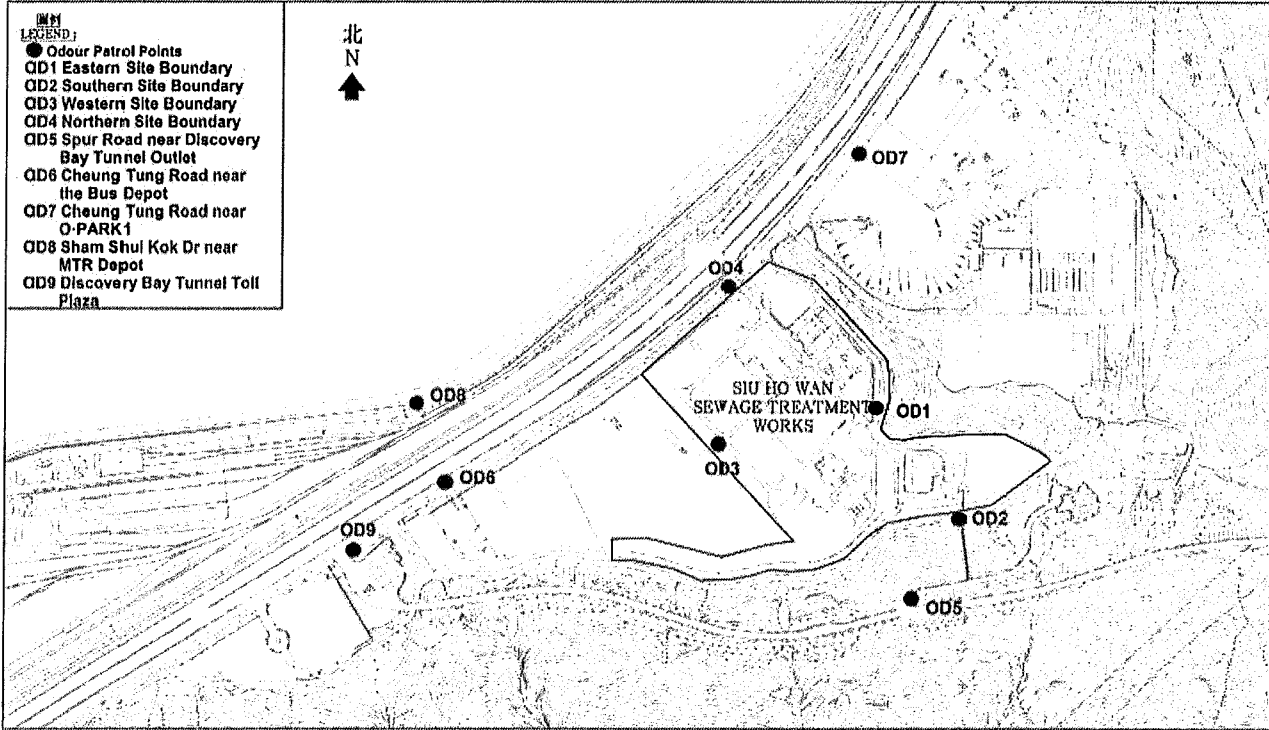

Date	2022/10/13		Weather	Fine	Temperature	25.9°C	Humidity	35%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics		
OD1	Eastern Site Boundary	10:48	/	/	0	/		
OD2	Southern Site Boundary	10:51	/	/	0	/		
OD3	Western Site Boundary	10:46	E	0.4	0	/		
OD4	Northern Site Boundary	10:44	NE	0.1	0	/		
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/		
OD6	Cheung Tung Road near the Bus Depot	10:34	NE	0.1	0	/		
OD7	Cheung Tung Road near O-PARK1	10:37	/	/	0	/		
OD8	Sham Shui Kok Dr near MTR Depot	10:22	/	/	0	/		
OD9	Discovery Bay Tunnel Toll Plaza	10:50	/	/	0	/		

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by:         
 Name: Yeung Tak Sang  
 Date: 2022/10/13

Checked by:         
 Name: CHOI KAN HO  
 Date: 13 October 2022


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

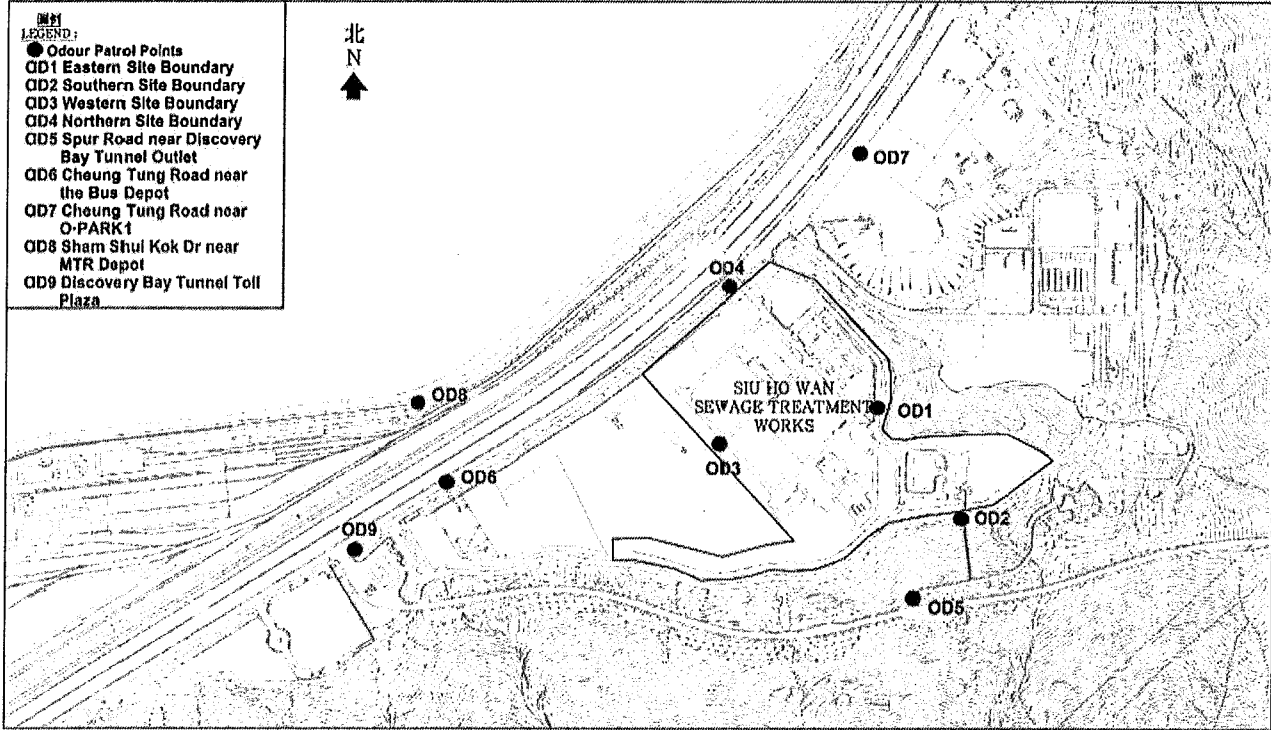

Date	13/10/2022		Weather	Fine		Temperature	25.9 °C		Humidity	35%	
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics					
OD1	Eastern Site Boundary	1048	/	0	0	/					
OD2	Southern Site Boundary	1051	/	0	0	/					
OD3	Western Site Boundary	1046	E	0.4	0	/					
OD4	Northern Site Boundary	1044	NE	0.1	0	/					
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/					
OD6	Cheung Tung Road near the Bus Depot	1034	NE	0.1	0	/					
OD7	Cheung Tung Road near O-PARK1	1037	/	0	0	/					
OD8	Sham Shui Kok Dr near MTR Depot	1022	/	0	0	/					
OD9	Discovery Bay Tunnel Toll Plaza	1030	/	0	0	/					

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level


Recorded by: Ip Tsz Han  
Name: Ip Tsz Han  
Date: 13/10/2022

Checked by: [Signature]  
Name: CHOI Kam Ho  
Date: 13 October 2022


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

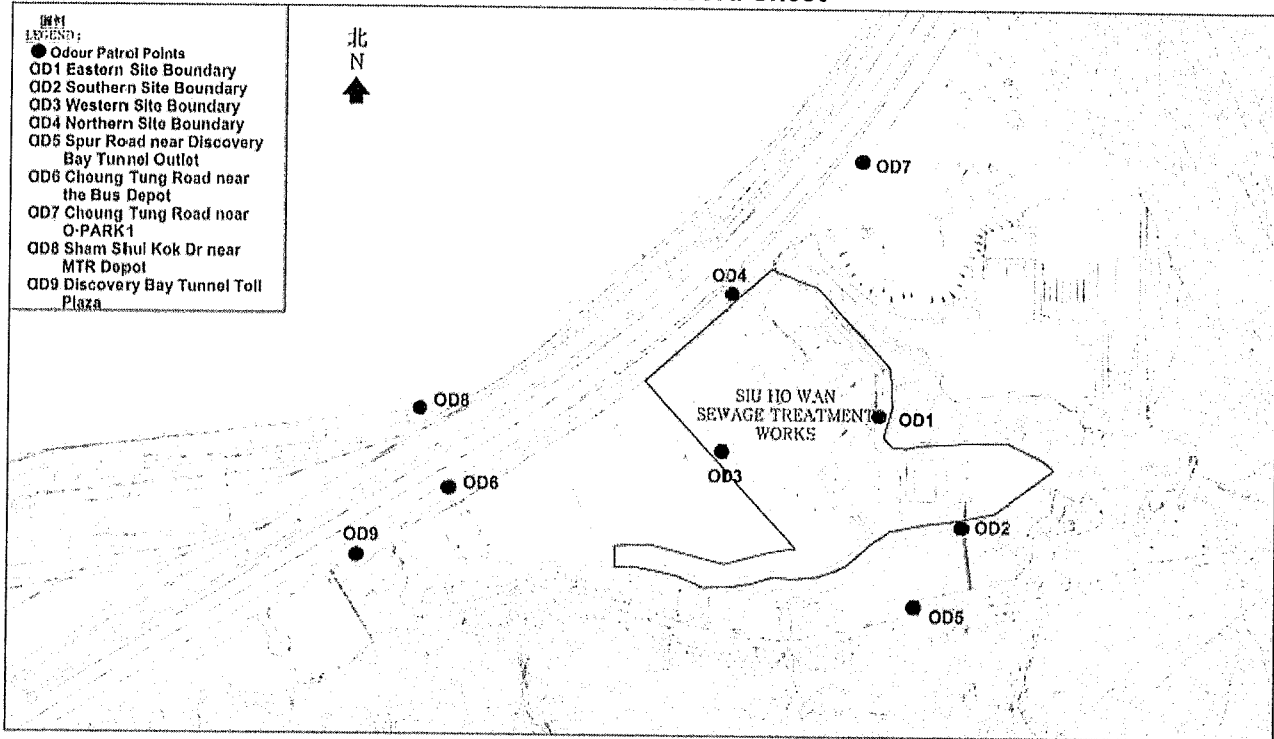

Date		Weather	Temperature	Humidity		
19 Oct 2022		Fine	24°C	36%		
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics
OD1	Eastern Site Boundary	11:07	/	/	0	/
OD2	Southern Site Boundary	11:10	/	/	0	/
OD3	Western Site Boundary	11:05	E	0.6	0	/
OD4	Northern Site Boundary	11:03	E	0.3	0	/
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/
OD6	Cheung Tung Road near the Bus Depot	10:54	NE	0.4	0	/
OD7	Cheung Tung Road near O-PARK1	10:57	/	/	0	/
OD8	Sham Shui Kok Dr near MTR Depot	10:50	NE	0.3	0	/
OD9	Discovery Bay Tunnel Toll Plaza	10:52	NE	0.7	0	/

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Wing Wai  
Name: Wing Wai  
Date: 19 Oct 2022

Checked by: CHOR  
Name: CHOR Kam Ho  
Date: 19 October 2022


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

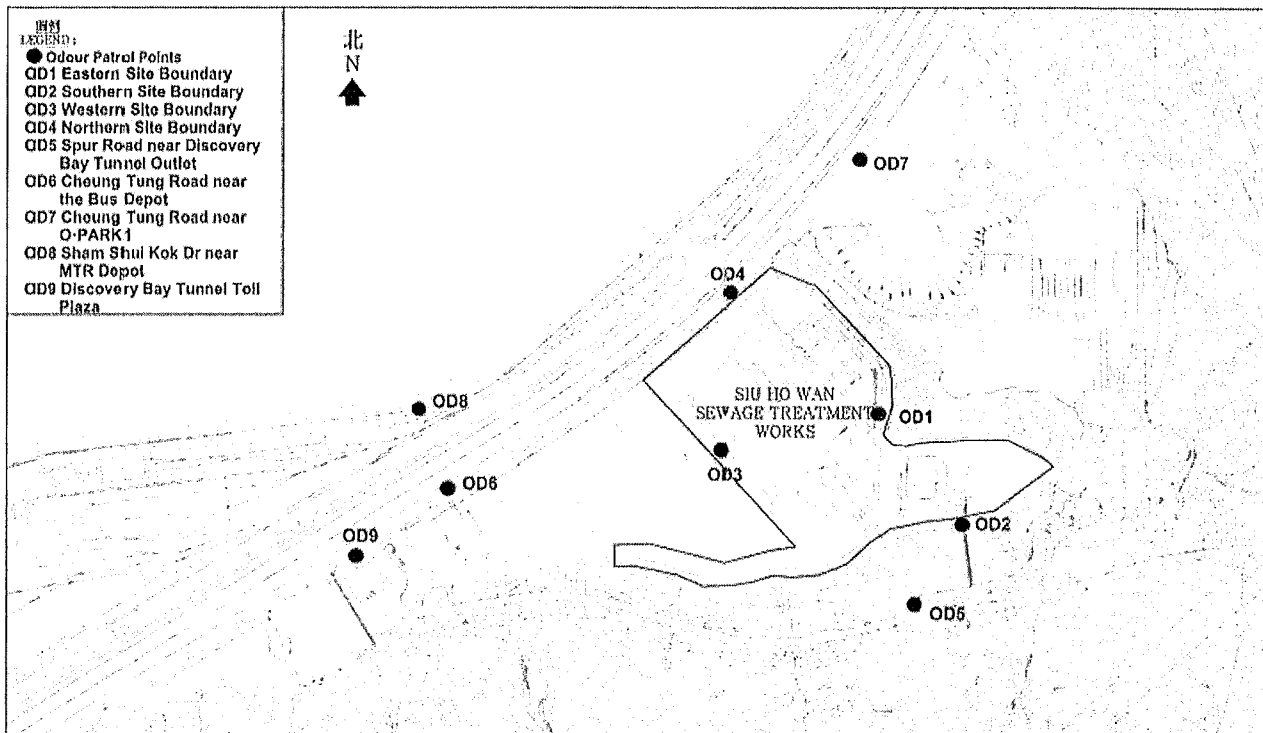

Date		19/10/2022	Weather		Fine	Temperature		24 °C	Humidity		36 %
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics					
OD1	Eastern Site Boundary	11:07	/	0	0	/					
OD2	Southern Site Boundary	11:10	/	0	0	/					
OD3	Western Site Boundary	11:05	E	0.6	0	/					
OD4	Northern Site Boundary	11:03	E	0.3	0	/					
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/					
OD6	Cheung Tung Road near the Bus Depot	10:54	NE	0.4	0	/					
OD7	Cheung Tung Road near O-PARK1	10:57	/	0	0	/					
OD8	Sham Shui Kok Dr near MTR Depot	10:50	NE	0.3	0	/					
OD9	Discovery Bay Tunnel Toll Plaza	10:52	NE	0.7	0	/					

**\*Classification Criteria:**


- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Ip Ka Hin  
Name: Ip Ka Hin  
Date: 19/10/2022

Checked by: [Signature]  
Name: CHOI KAM HO  
Date: 19 October 2022



**Contract No. CM 14/2016**  
**Environmental Team for Operational Environmental Monitoring and Audit for**  
**Siu Ho Wan Sewage Treatment Works**  
**Odour Patrol Record Sheet**

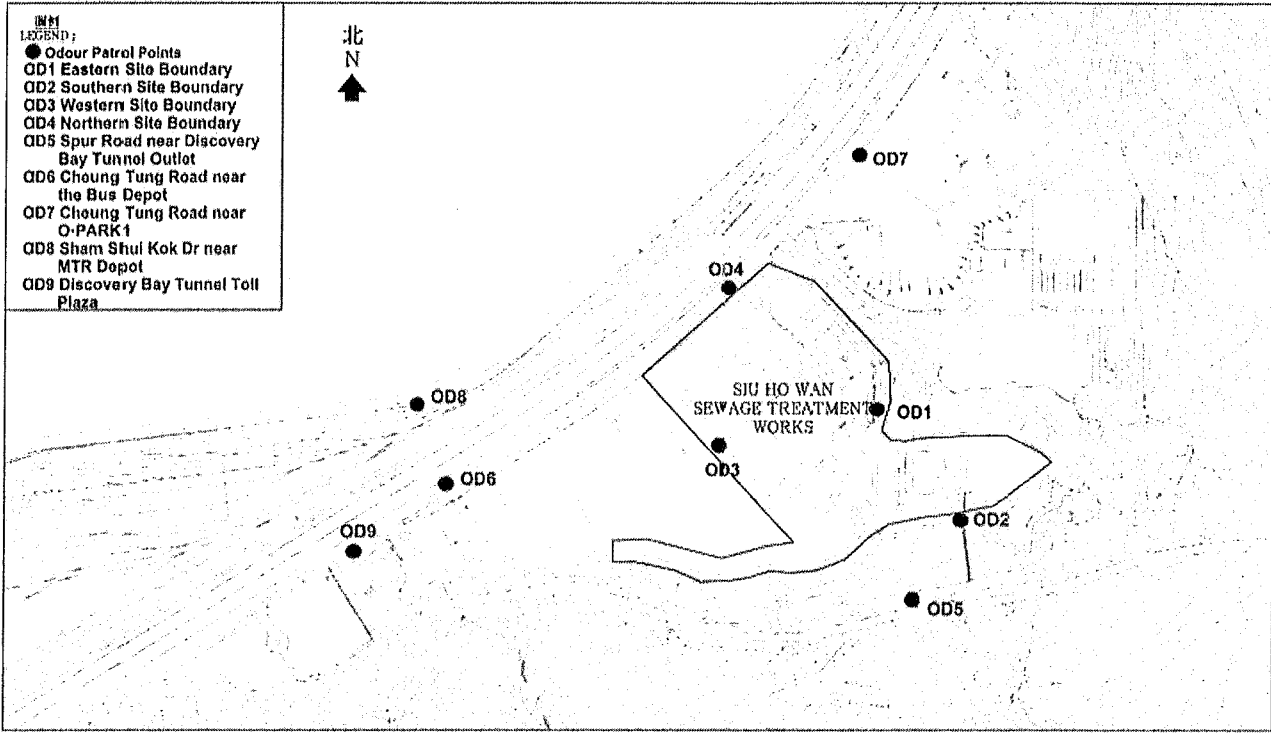

Date	25/10/2022	Weather	Pine	Temperature	25.9 °C	Humidity	51 %
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	1514	NE	1.6	0	/	
OD2	Southern Site Boundary	1516	NE	1.1	1	Effluent	
OD3	Western Site Boundary	1512	/	/	0	/	
OD4	Northern Site Boundary	1510	N	0.9	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	1532	/	/	0	/	
OD6	Cheung Tung Road near the Bus Depot	1457	NE	1.0	0	/	
OD7	Cheung Tung Road near O-PARK1	1459	NE	2.5	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	1449	NE	1.8	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	1454	N	0.9	0	/	

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by:           
Name:           
Date:         

Checked by:           
Name:           
Date:


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

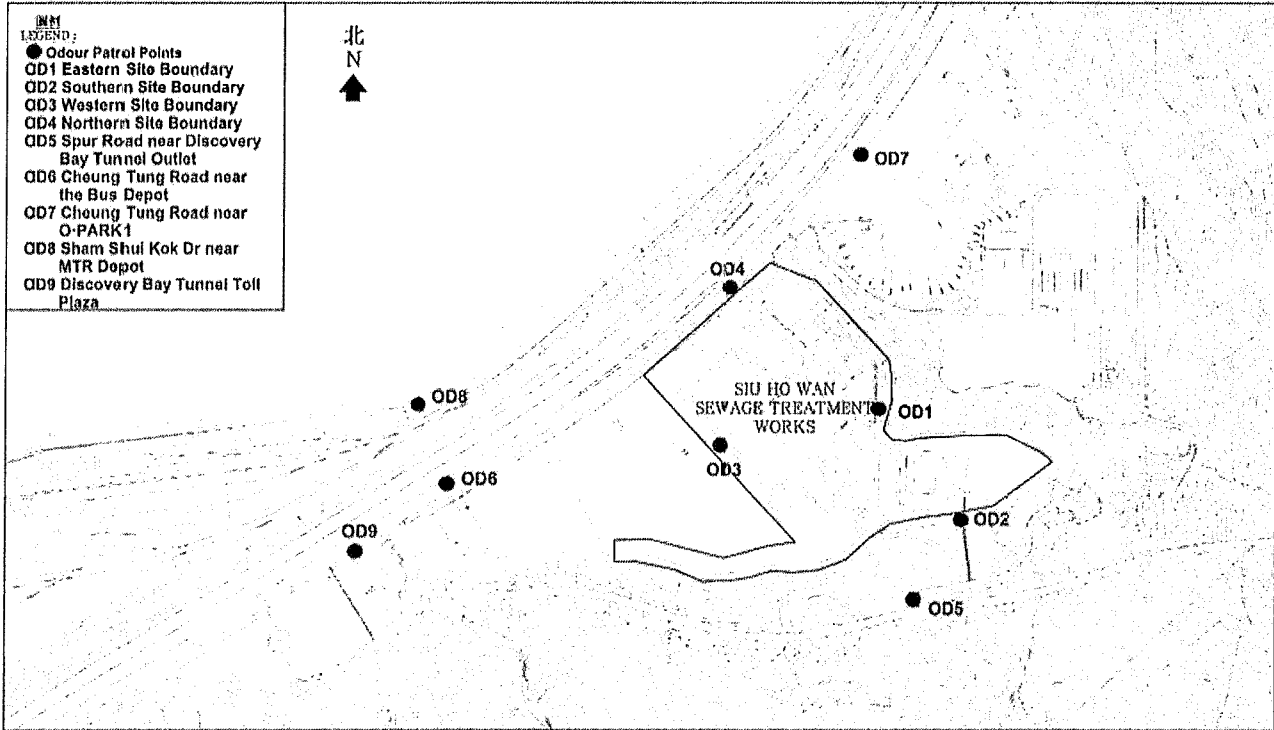

Date	25/10/2022	Weather	fine	Temperature	25.9°C	Humidity	51%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	1514	NE	1.6	0	/	
OD2	Southern Site Boundary	1516	NE	1.1	1	Effluent	
OD3	Western Site Boundary	1512	/	/	0	/	
OD4	Northern Site Boundary	1510	N	0.9	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	1532	/	/	0	/	
OD6	Cheung Tung Road near the Bus Depot	1452	NE	1.0	0	/	
OD7	Cheung Tung Road near O-PARK1	1459	NE	2.5	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	1449	NE	1.8	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	1459	N	0.9	0	/	

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level


Recorded by: Ip Tsz Hin  
Name: Ip Tsz Hin  
Date: 25/10/2022

Checked by: [Signature]  
Name: CHOI Kam Ho  
Date: 25 October 2022


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

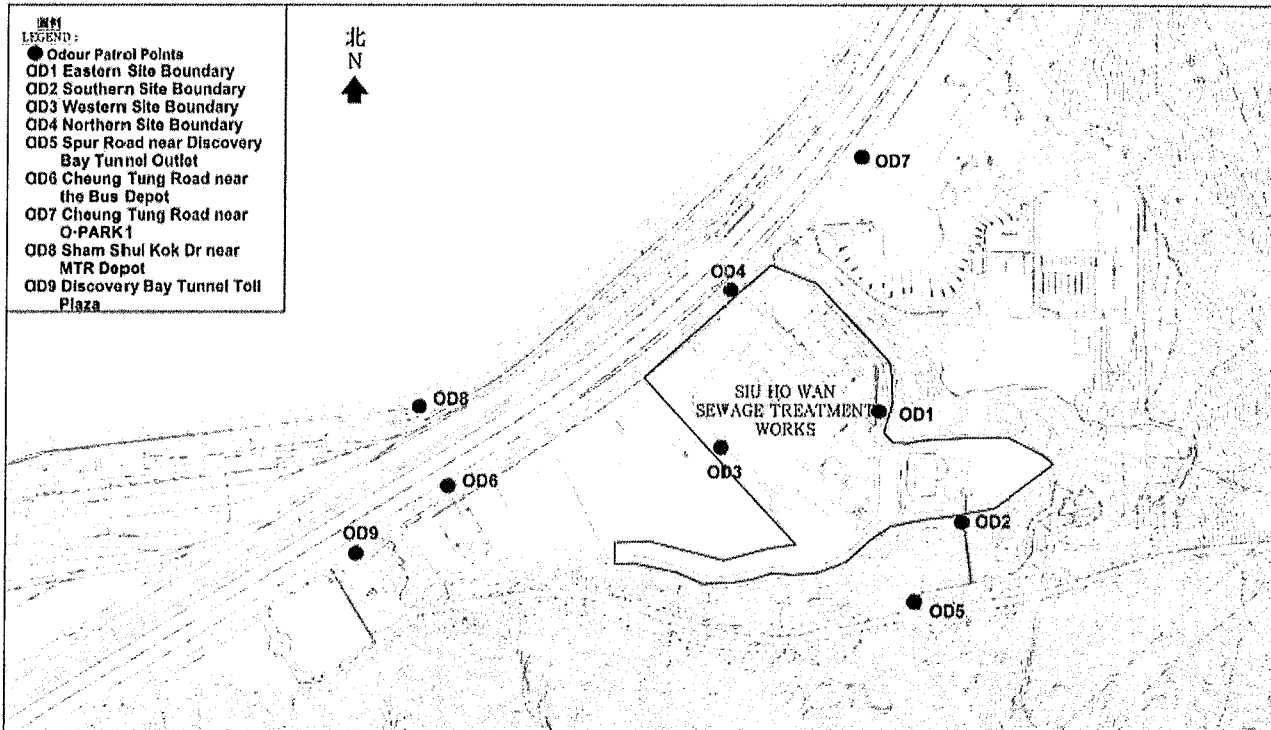

Date		31/10/2022	Weather		Fine	Temperature		25.1°C	Humidity		53%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics					
OD1	Eastern Site Boundary	1053	N	0.5	0	/					
OD2	Southern Site Boundary	1056	N	0.4	0	/					
OD3	Western Site Boundary	1051	/	0	0	/					
OD4	Northern Site Boundary	1049	N	1.3	0	/					
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/					
OD6	Cheung Tung Road near the Bus Depot	1036	/	0	0	/					
OD7	Cheung Tung Road near O-PARK1	1039	NE	0.7	0	/					
OD8	Sham Shui Kok Dr near MTR Depot	1032	NE	0.4	0	/					
OD9	Discovery Bay Tunnel Toll Plaza	1034	N	0.9	0	/					

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Fong Ka Lun  
Name: Fong Ka Lun  
Date: 31/10/2022

Checked by: Chris Kam Ho  
Name: Chris Kam Ho  
Date: 31 October 2022




# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

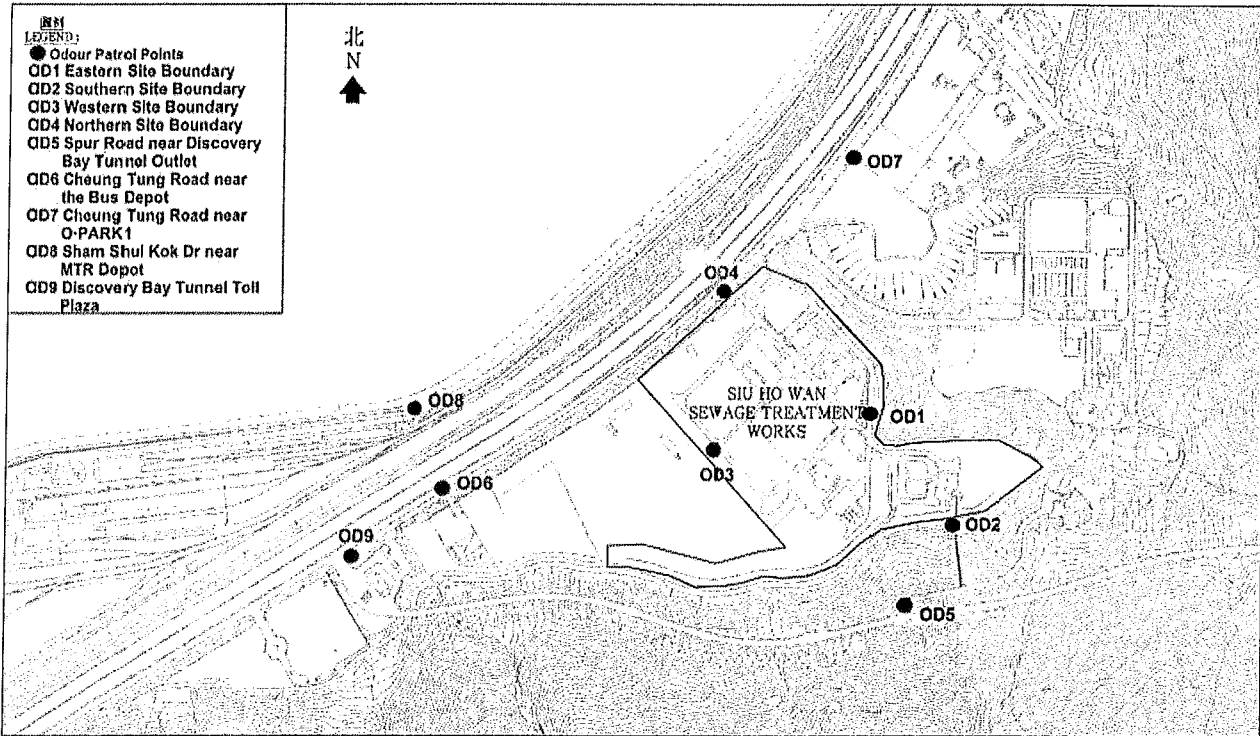


Date	31/10/2022	Weather	Fine	Temperature	25.1°C	Humidity	53%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	10:53	N	0.5	0	/	
OD2	Southern Site Boundary	10:56	N	0.4	0	/	
OD3	Western Site Boundary	10:51	/	0	0	/	
OD4	Northern Site Boundary	10:49	N	1.3	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	10:36	/	0	0	/	
OD7	Cheung Tung Road near O-PARK1	10:39	NE	0.7	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	10:32	NE	0.4	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	10:34	N	0.9	0	/	

**\*Classification Criteria:**


- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Zp Tse Hin  
Name: Zp Tse Hin  
Date: 31/10/2022


Checked by: AK  
Name: CHOW KAM HO  
Date: 31 October 2022

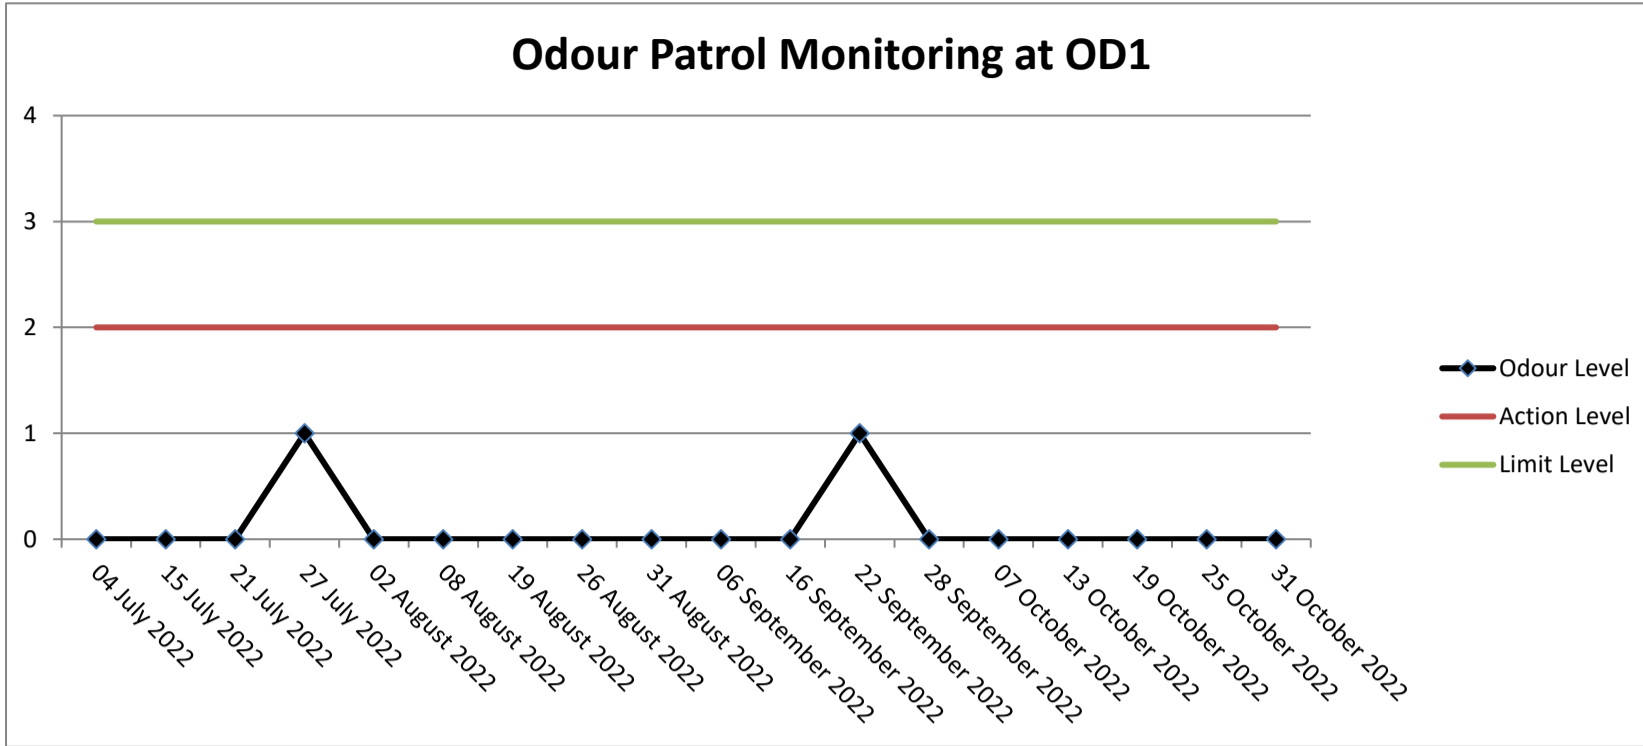


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

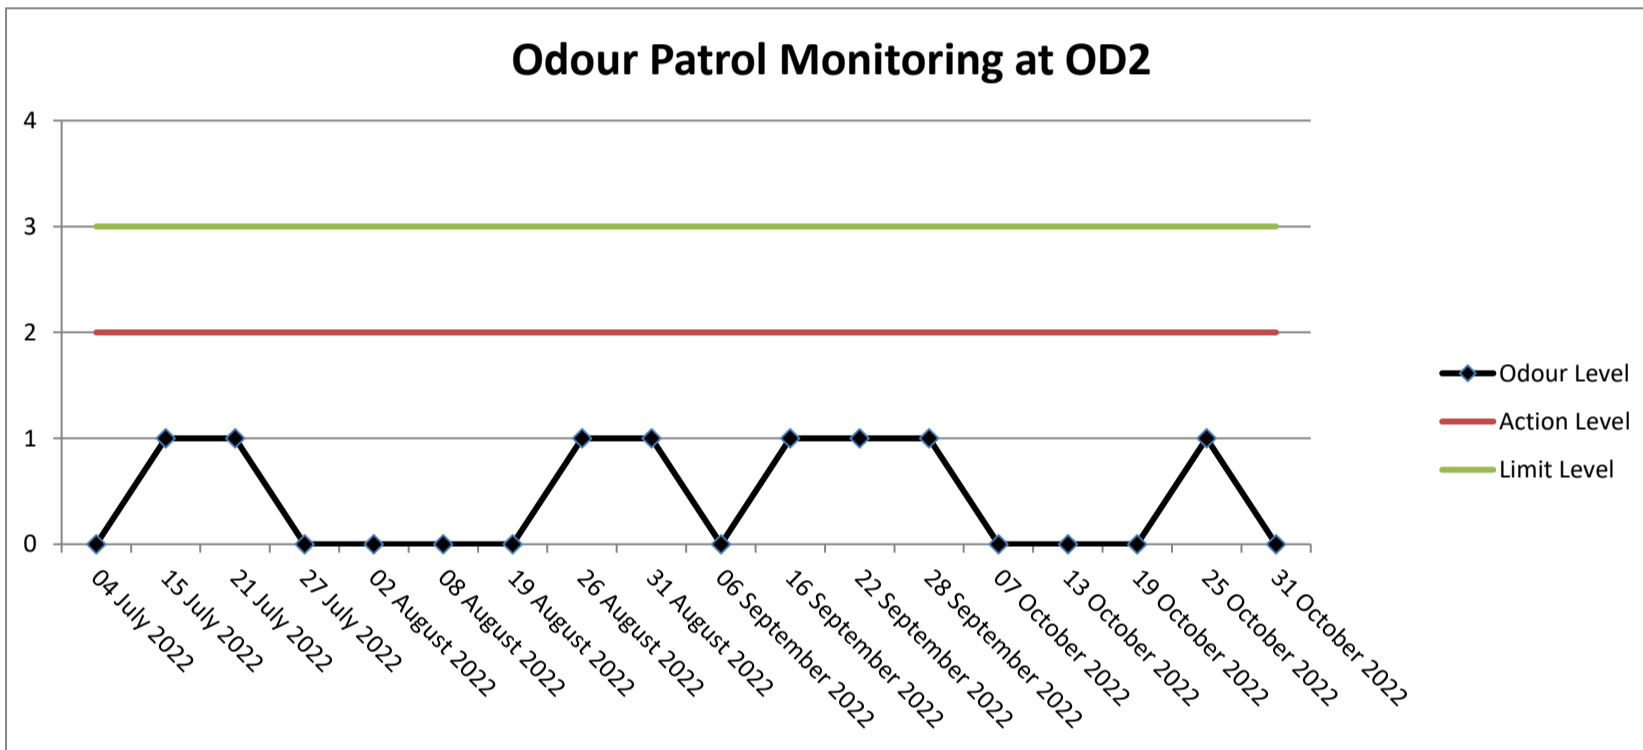


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

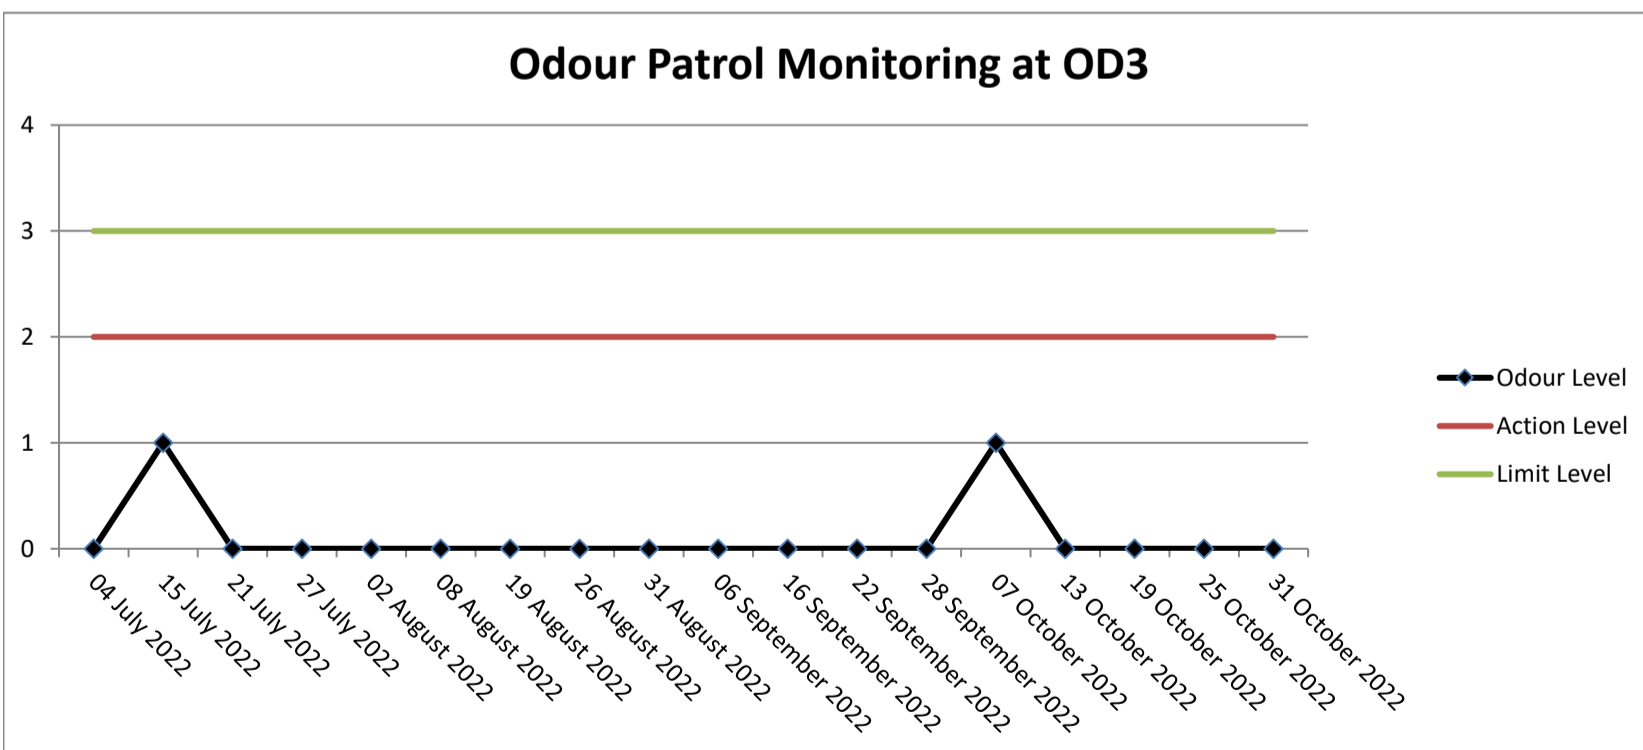


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

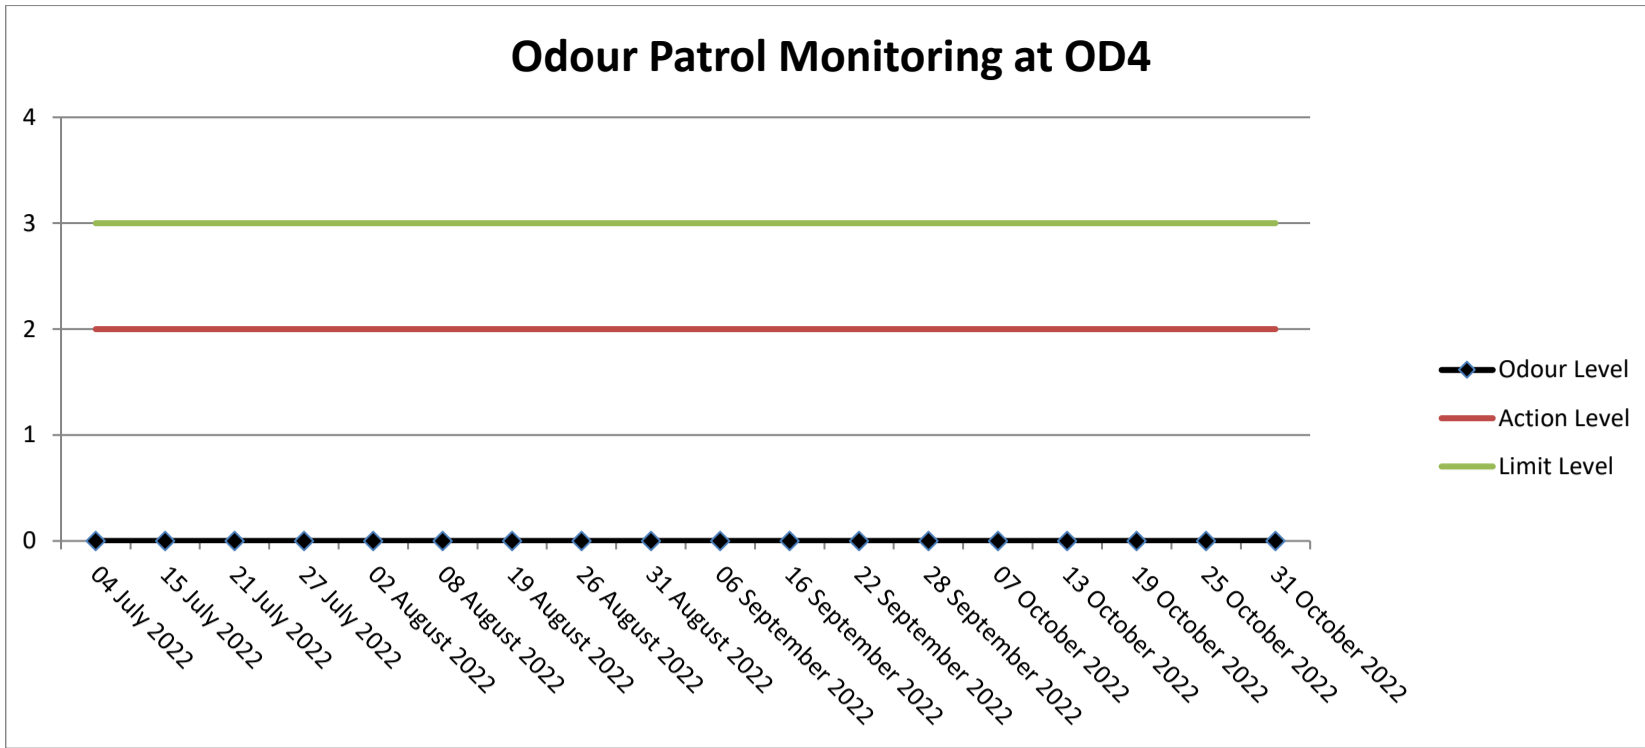


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

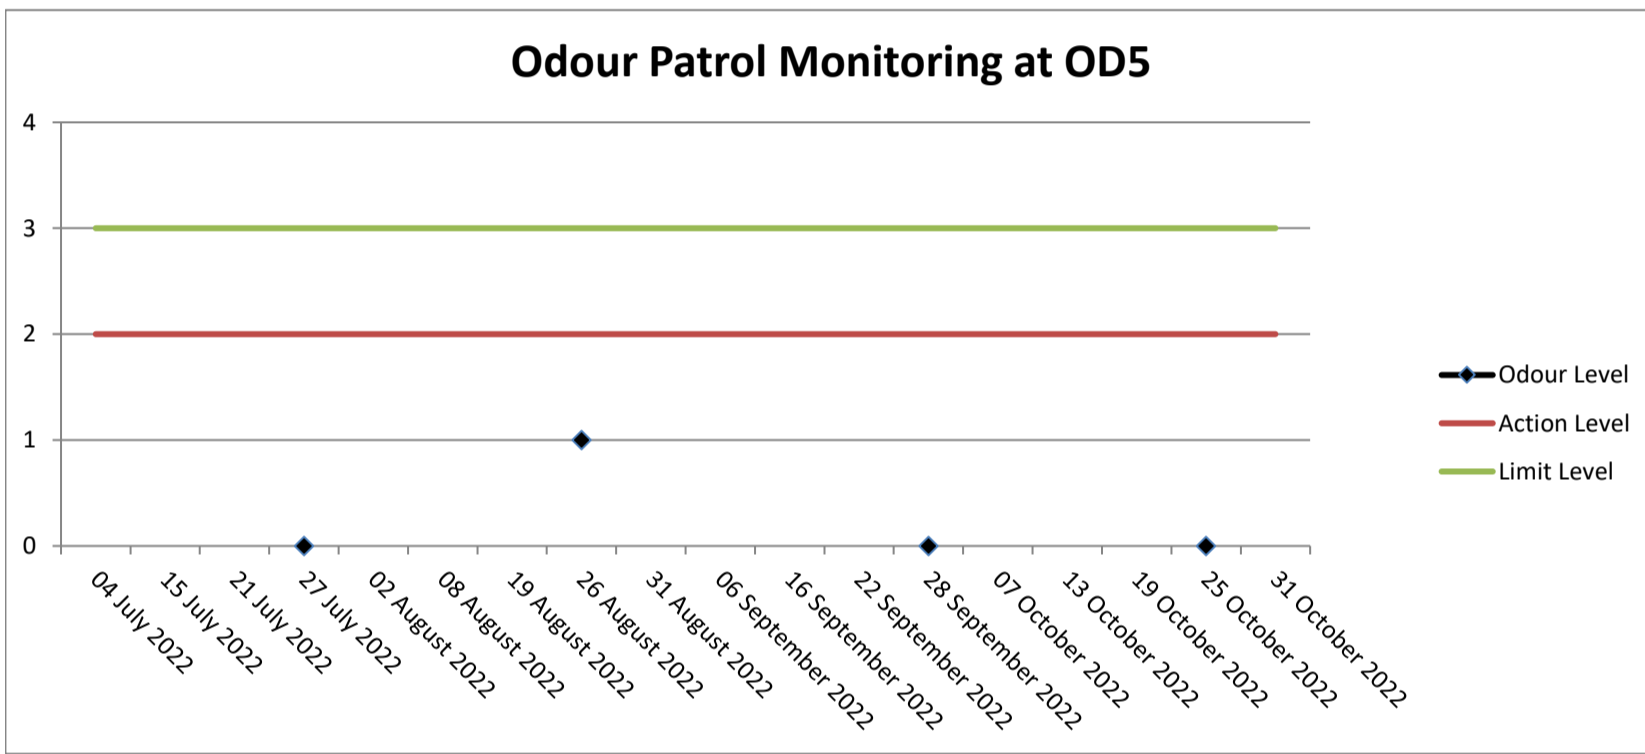


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

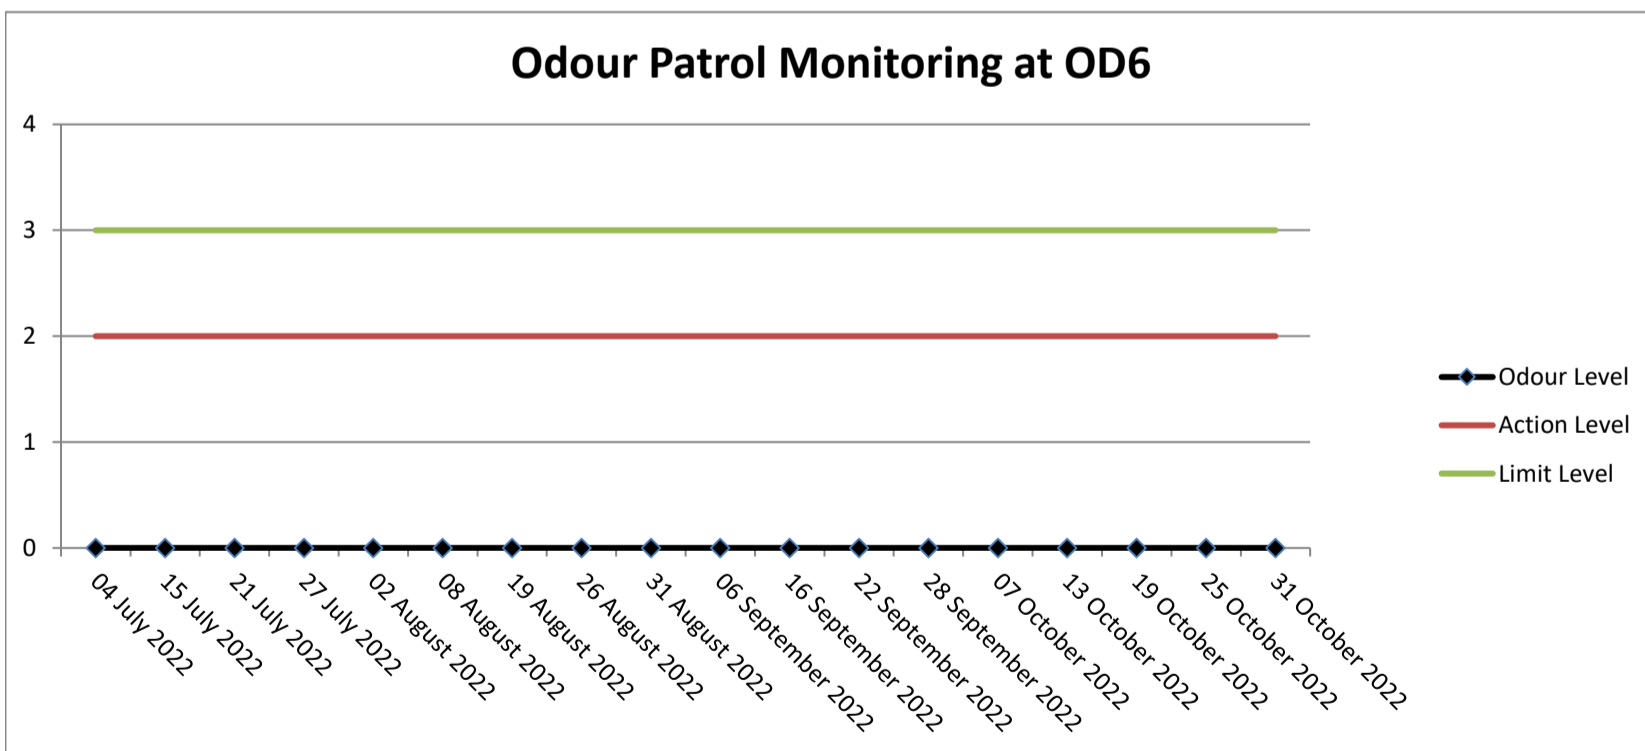


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

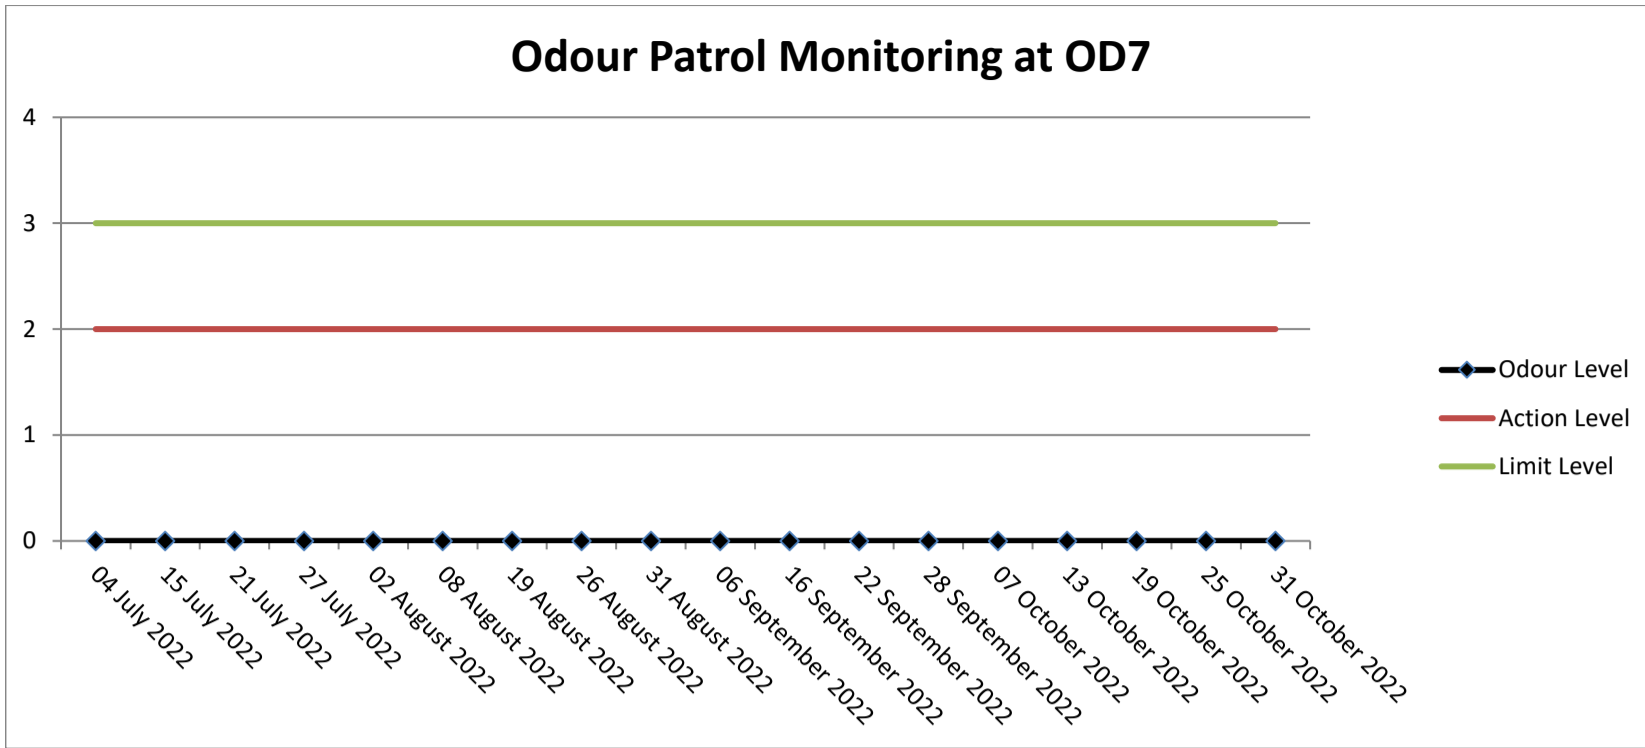

Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

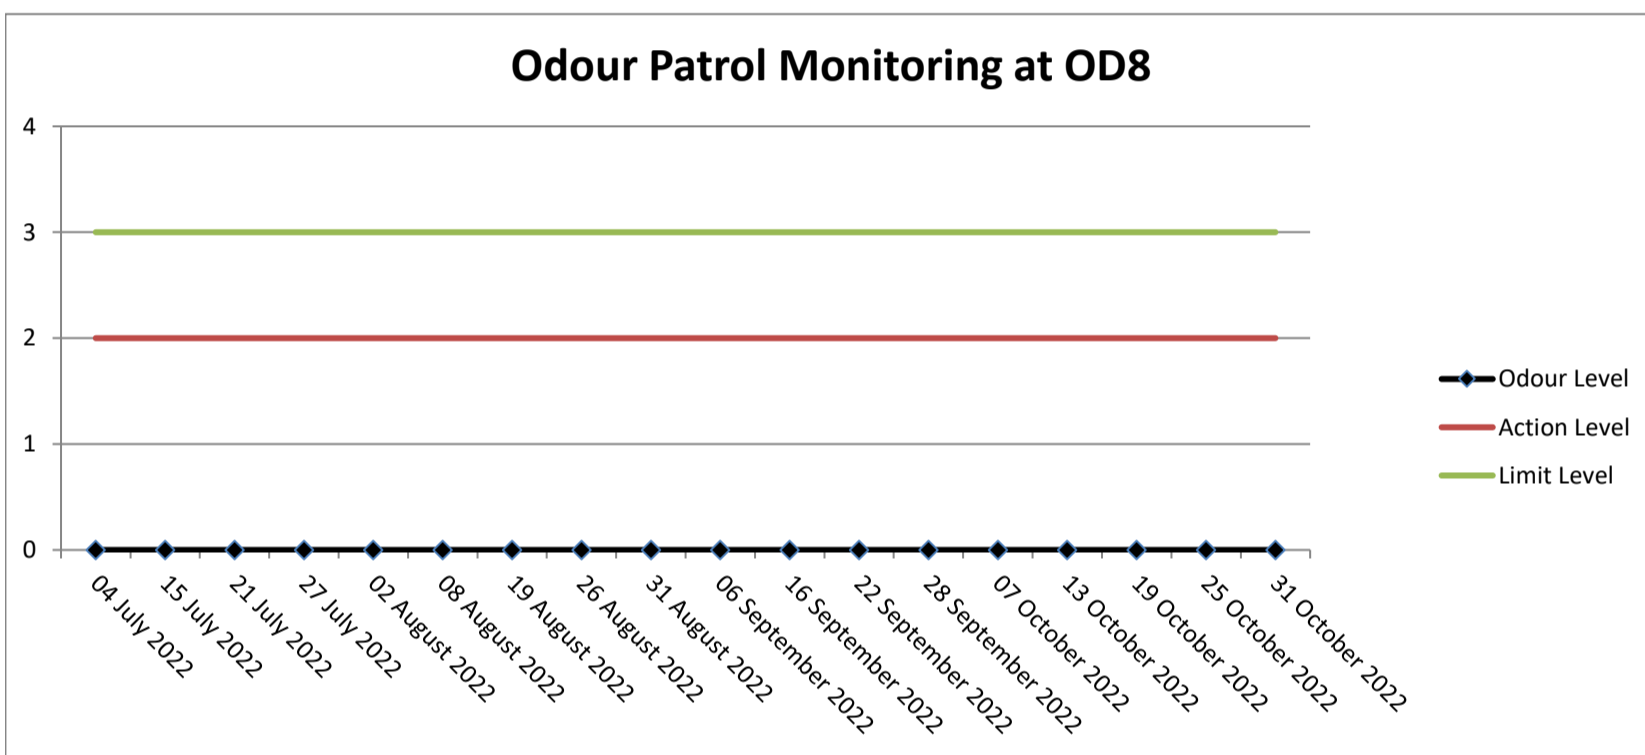

Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

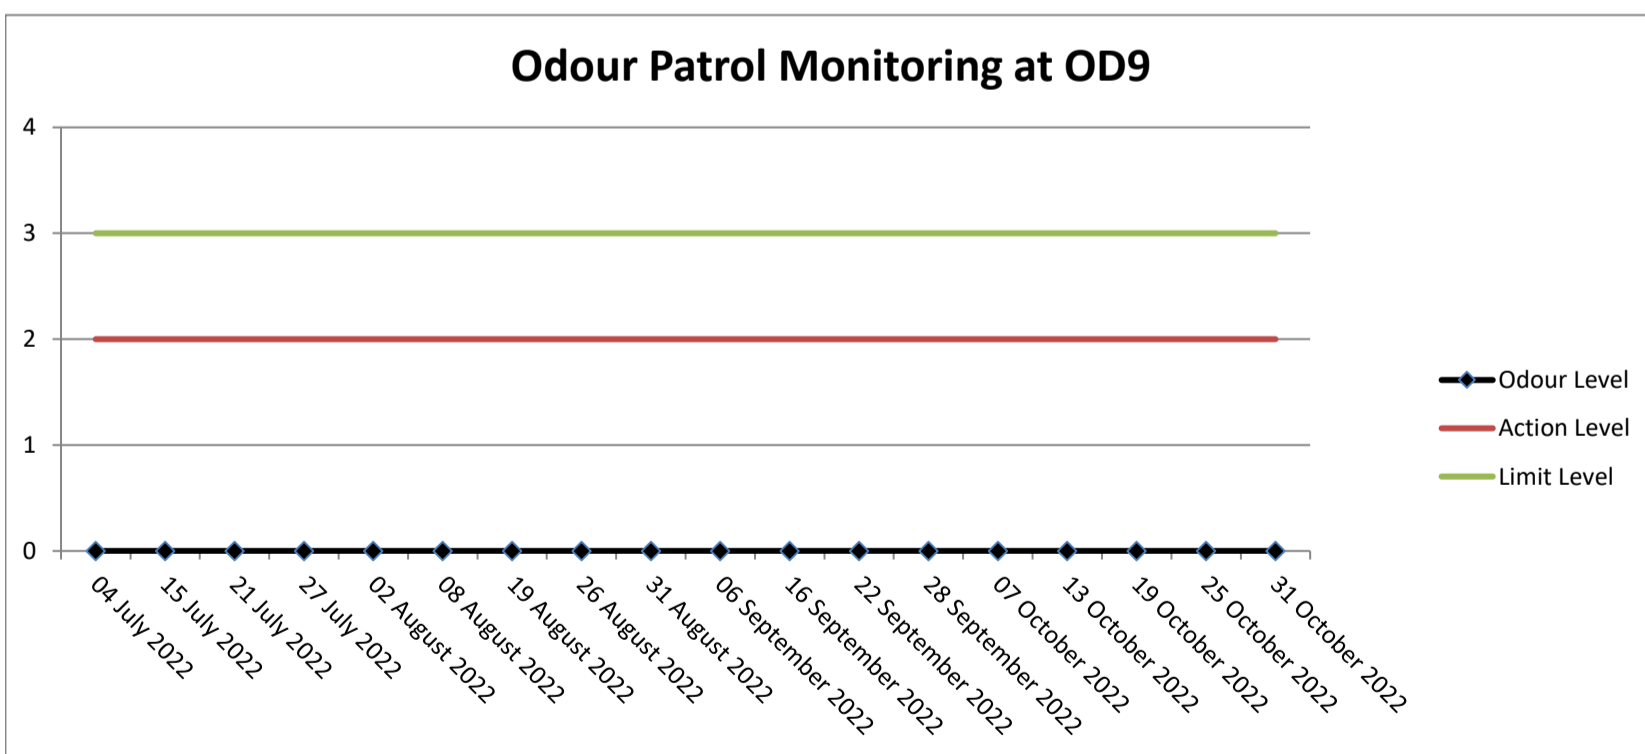

Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

## **FUGRO TECHNICAL SERVICES LIMITED**

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

### Appendix E

#### Copy of the Calibration Certificates for Water Quality Monitoring Equipment

Report No. : 142626WA222316



Page 1 of 3

**Report on Calibration of Aqua Troll 600 Multi-parameter Water Quality Meter****Information Supplied by Client**

Client : Fugro Technical Services Limited (MCL)

Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K.

Sample description : One Aqua Troll 600 Multi-parameter Water Quality Meter

Client sample ID : Serial No. 525120

Test required : Calibration of the Aqua Troll 600 Multi-parameter Water Quality Meter

**Laboratory Information**

Lab. sample ID : WA222316/1

Date of calibration : 05/10/2022

Next calibration date : 04/01/2023

Test method used : In-house comparison method

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 142626WA222316

Page 2 of 3

**Results :**
**A. pH calibration**

pH reading at 25°C for Q.C. solution(9.16) and at 25°C for Q.C. solution(6.88)		
Theoretical	Measured	Deviation
9.16	9.15	-0.01
6.88	6.89	+0.01


**B. Salinity calibration**

Salinity, ppt			
Theoretical	Measured	Deviation	Maximum acceptable Deviation
10	10.04	+0.04	± 0.5
20	20.12	+0.12	± 1.0
30	30.47	+0.47	± 1.5
40	40.61	+0.61	± 2.0

**C. Dissolved Oxygen calibration**

Trial No.	Dissolved oxygen content, mg/L	
	By calibrated D.O. meter	By D.O. meter
1	7.53	7.55
2	7.54	7.55
3	7.54	7.54
Average	7.54	7.55

Differences of D.O. Content between calibrated D.O. meter and D.O. meter should be less than 0.4mg/L.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 142626WA222316

Page 3 of 3

**Results :**

**D. Temperature calibration**

Thermometer reading, °C	Meter reading, °C
25.07	25.05

**E. Turbidity calibration**

Turbidity, N.T.U.			
Theoretical	Measured	Deviation	Maximum acceptable Deviation
4	4.11	+0.11	± 0.6
8	8.11	+0.11	± 0.8
40	40.62	+0.62	± 3.0
80	80.91	+0.91	± 4.0

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/2022  
 \*\* End of Report \*\*

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*





a xylem brand

9940 Summers Ridge Road  
San Diego, CA 92121  
Tel: (858) 546-8327  
support@sontek.com

## Certificate of Calibration

### TEST REPORT

Serial Number	5906
System Type	M9
System Orientation	Down
Compass Type	Sontek
Compass Offset (degrees)	N/A
Communications Output	RS232
Recorder Size (GB)	14.9
Firmware Version	4.02
Date Tested	05/23/2017

### POWER TEST

Command Mode (W):	0.17	Range : 0.00 – 0.30
Sleep Mode (W):	N/A	Range : N/A
Ping Mode - 18V (W):	2.67	Range : 1.50 – 3.50
Power Check		PASS

### NOISE TEST

Beam 1 – 3.0 MHz (counts)	95
Beam 2 – 1.0 MHz (counts)	96
Beam 3 – 3.0 MHz (counts)	95
Beam 4 – 1.0 MHz (counts)	101
Beam 5 – 3.0 MHz (counts)	93
Beam 6 – 1.0 MHz (counts)	95
Beam 7 – 3.0 MHz (counts)	91
Beam 8 – 1.0 MHz (counts)	100
Beam Vertical – 500KHz (counts)	88
Noise Test	PASS

## VERIFICATION

Velocity Check	PASS
Transmit Output	PASS
Sensitivity	PASS
Temperature Sensor	PASS
Compass Heading Check	PASS
Compass Level Check	PASS
Burn-in (24 hrs)	PASS
Load Default Parameters	DONE

## OPTIONS

Bottom Track	Installed
SmartPulse HD <sup>TM</sup>	Enabled
Stationary	Disabled
GPS Compass Integration	Disabled
RiverSurveyor	Enabled
HydroSurveyor	Disabled

Verified by: **ainthasane**

This report was generated on 5/24/2017.

ATTENTION: New Warranty Terms as of March 4, 2013:

This system is covered under a two year limited warranty that extends to all parts and labor for any malfunction due to workmanship or errors in the manufacturing process. The warranty is valid only if you properly maintain and operate this system under normal use as outlined in the User's Manual. The warranty does not cover shortcomings that are due to the design, or any incidental damages as a result of errors in the measurements.

SonTek will repair and/or replace, at its sole option, any product established to be defective with a product of like type. CLAIMS FOR LABOR COSTS AND/OR OTHER CHARGES RESULTING FROM THE USE OF SonTek GOODS AND/OR PRODUCTS ARE NOT COVERED BY THIS LIMITED WARRANTY.

SonTek DISCLAIMS ALL EXPRESS WARRANTIES OTHER THAN THOSE CONTAINED ABOVE AND ALL IMPLIED WARRANTIES, INCLUDING BUT NOT LIMITED TO WARRANTIES OF MERCHANTABILITY AND/OR FITNESS FOR A PARTICULAR PURPOSE. SonTek DISCLAIMS AND WILL NOT BE LIABLE, UNDER ANY CIRCUMSTANCE, IN CONTRACT, TORT OR WARRANTY, FOR ANY SPECIAL, INDIRECT, INCIDENTAL OR CONSEQUENTIAL DAMAGES OF ANY KIND, INCLUDING BUT NOT LIMITED TO LOST PROFITS, BUSINESS INTERRUPTION LOSSES, LOSS OF GOODWILL, OR LOSS OF BUSINESS OR CUSTOMER RELATIONSHIPS.

If your system is not functioning properly, first try to identify the source of the problem. If additional support is required, we encourage you to contact us immediately. We will work to resolve the problem as quickly as possible.

If the system needs to be returned to the factory, please contact SonTek to obtain a Service Request (SR) number. We reserve the right to refuse receipt of shipments without SRs. We require the system to be shipped back in the original shipping container using the original packing material with all delivery costs covered by the customer (including all taxes and duties). If the system is returned without appropriate packing, the customer will be required to cover the cost of a new packaging crate and material.

The warranty for repairs performed at an authorized SonTek Service Center is one year.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix F

### Results and Graphical Presentation of Water Quality Monitoring

Water Quality Monitoring Data

Monitoring Location	Date	Tide Mode	Weather	Sea Condition	Time	Water Depth (m)	Monitoring Level	Monitoring Level (m)	Replicate	In-situ Measurement								Laboratory Analysis							
										pH	Salinity (ppt)	Temperature (degree C)	DO Saturation (%)	DO (mg/L)	Turbidity (NTU)	Current Speed (m/s)	Current Direction (degree magnetic)	Total Suspended Solids (mg/L)	Ammonia Nitrogen (mg/L-N)	Nitrite Nitrogen (mg/L-N)	Nitrate Nitrogen (mg/L-N)	Total Inorganic Nitrogen (mg/L-N)	E.coli (cfu/100mL)	Total phosphorus (soluble and particulate) (mg/L)	BOD <sub>5</sub> (mg/L)
										Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value
A	10/10/2022	Mid-Ebb	Fine	Moderate	11:18	17	S	1	1	8.41	30.23	28.52	79.4	5.19	5.7	0.18	92.6	6	0.13	0.071	0.10	0.30	200	0.03	<1
A	10/10/2022	Mid-Ebb	Fine	Moderate	11:18	17	S	1	2	8.42	30.26	28.54	79.2	5.17	5.6	0.14	91.1	6	0.12	0.072	0.13	0.32	180	0.03	<1
A	10/10/2022	Mid-Ebb	Fine	Moderate	11:18	17	M	8.5	1	8.31	30.46	28.26	77.1	4.99	5.5	0.23	74.2	6	0.13	0.071	0.17	0.37	190	0.03	<1
A	10/10/2022	Mid-Ebb	Fine	Moderate	11:18	17	M	8.5	2	8.32	30.49	28.22	77.2	4.97	5.1	0.24	74.1	6	0.13	0.071	0.19	0.40	210	0.04	<1
A	10/10/2022	Mid-Ebb	Fine	Moderate	11:18	17	B	16	1	8.34	30.99	28.11	76.4	4.91	5.3	0.14	80.8	7	0.16	0.071	0.26	0.49	200	0.03	<1
A	10/10/2022	Mid-Ebb	Fine	Moderate	11:18	17	B	16	2	8.37	30.97	28.14	76.2	4.89	5.1	0.16	81.2	7	0.15	0.070	0.27	0.49	190	0.04	<1
B	10/10/2022	Mid-Ebb	Fine	Moderate	11:34	14	S	1	1	8.24	32.04	27.42	70.2	4.49	4.2	0.17	203.4	7	0.18	0.071	0.41	0.66	140	0.04	<1
B	10/10/2022	Mid-Ebb	Fine	Moderate	11:34	14	S	1	2	8.22	32.06	27.44	70.4	4.51	4.6	0.13	206.1	7	0.17	0.071	0.34	0.58	170	0.04	<1
B	10/10/2022	Mid-Ebb	Fine	Moderate	11:34	14	M	7	1	8.19	31.73	27.29	68.7	4.32	4.4	0.14	184.3	7	0.20	0.071	0.17	0.44	170	0.04	<1
B	10/10/2022	Mid-Ebb	Fine	Moderate	11:34	14	M	7	2	8.29	31.74	27.22	68.4	4.29	4.7	0.13	184.7	7	0.20	0.071	0.15	0.42	160	0.04	<1
B	10/10/2022	Mid-Ebb	Fine	Moderate	11:34	14	B	13	1	8.11	31.99	27.14	67.7	4.28	4.6	0.12	199.1	5	0.25	0.070	0.17	0.49	160	0.03	<1
B	10/10/2022	Mid-Ebb	Fine	Moderate	11:34	14	B	13	2	8.19	31.96	27.15	67.1	4.27	4.2	0.13	194.6	5	0.25	0.070	0.11	0.43	200	0.03	<1
C	10/10/2022	Mid-Ebb	Fine	Moderate	11:54	12	S	1	1	8.62	30.83	28.46	80.9	5.28	3.5	0.26	74.2	6	0.20	0.065	0.31	0.58	290	0.03	<1
C	10/10/2022	Mid-Ebb	Fine	Moderate	11:54	12	S	1	2	8.66	30.91	28.49	80.7	5.24	3.2	0.21	77.1	5	0.20	0.065	0.30	0.57	200	0.04	<1
C	10/10/2022	Mid-Ebb	Fine	Moderate	11:54	12	M	6	1	8.69	30.84	28.24	79.2	5.09	3.9	0.29	90.6	6	0.20	0.065	0.37	0.54	190	0.04	<1
C	10/10/2022	Mid-Ebb	Fine	Moderate	11:54	12	M	6	2	8.68	30.81	28.22	79.1	5.08	3.5	0.28	90.8	5	0.19	0.065	0.28	0.53	240	0.04	<1
C	10/10/2022	Mid-Ebb	Fine	Moderate	11:54	12	B	11	1	8.69	31.07	28.04	78.4	4.99	3.9	0.14	82.4	6	0.19	0.067	0.31	0.56	230	0.03	<1
C	10/10/2022	Mid-Ebb	Fine	Moderate	11:54	12	B	11	2	8.64	31.06	28.06	78.2	4.97	3.6	0.19	82.5	5	0.19	0.065	0.23	0.49	200	0.03	<1
D	10/10/2022	Mid-Ebb	Fine	Moderate	12:11	13	S	1	1	8.71	33.44	28.71	77.4	4.83	2.3	0.17	43.1	5	0.10	0.063	0.17	0.34	350	0.04	<1
D	10/10/2022	Mid-Ebb	Fine	Moderate	12:11	13	S	1	2	8.72	33.26	28.72	77.2	4.84	2.4	0.13	43.2	5	0.11	0.062	0.18	0.34	240	0.03	<1
D	10/10/2022	Mid-Ebb	Fine	Moderate	12:11	13	M	6.5	1	8.73	33.97	28.46	75.8	4.71	3.1	0.14	52.6	5	0.19	0.064	0.27	0.52	130	0.03	<1
D	10/10/2022	Mid-Ebb	Fine	Moderate	12:11	13	M	6.5	2	8.74	33.96	28.48	75.4	4.74	3.3	0.16	52.8	5	0.19	0.065	0.27	0.53	200	0.03	<1
D	10/10/2022	Mid-Ebb	Fine	Moderate	12:11	13	B	12	1	8.69	31.43	28.39	70.9	4.52	3.4	0.18	49.7	6	0.17	0.065	0.25	0.49	190	0.04	<1
D	10/10/2022	Mid-Ebb	Fine	Moderate	12:11	13	B	12	2	8.68	31.29	28.33	70.8	4.51	3.6	0.20	49.9	6	0.18	0.065	0.30	0.55	180	0.04	<1
E	10/10/2022	Mid-Ebb	Fine	Moderate	12:32	16	S	1	1	8.77	32.44	28.14	76.4	5.01	4.7	0.32	90.4	3	0.24	0.057	0.28	0.57	1200	0.03	<1
E	10/10/2022	Mid-Ebb	Fine	Moderate	12:32	16	S	1	2	8.79	32.39	28.17	76.9	5.06	4.8	0.34	91.2	3	0.23	0.058	0.23	0.51	1100	0.03	<1
E	10/10/2022	Mid-Ebb	Fine	Moderate	12:32	16	M	8	1	8.64	32.86	28.84	77.1	5.12	4.1	0.29	93.4	3	0.20	0.058	0.25	0.50	1200	0.04	<1
E	10/10/2022	Mid-Ebb	Fine	Moderate	12:32	16	M	8	2	8.61	32.88	28.81	77.4	5.11	4.2	0.29	93.3	3	0.21	0.058	0.27	0.54	1100	0.04	<1
E	10/10/2022	Mid-Ebb	Fine	Moderate	12:32	16	B	15	1	8.54	32.94	28.77	74.1	5.01	4.7	0.34	79.4	7	0.22	0.058	0.26	0.54	1200	0.02	<1
E	10/10/2022	Mid-Ebb	Fine	Moderate	12:32	16	B	15	2	8.51	32.99	28.71	74.2	5.02	4.6	0.39	79.9	7	0.22	0.057	0.22	0.49	1100	0.01	<1
F	10/10/2022	Mid-Ebb	Fine	Moderate	12:47	23	S	1	1	8.51	31.17	31.15	82.2	5.77	4.5	0.24	74.1	7	0.21	0.062	0.25	0.52	1000	0.03	<1
F	10/10/2022	Mid-Ebb	Fine	Moderate	12:47	23	S	1	2	8.52	31.14	31.14	81.6	5.69	4.9	0.26	72.6	6	0.22	0.057	0.15	0.42	1100	0.03	<1
F	10/10/2022	Mid-Ebb	Fine	Moderate	12:47	23	M	11.5	1	8.59	31.46	31.26	78.6	5.12	4.1	0.28	64.2	6	0.23	0.058	0.18	0.47	1100	0.04	<1
F	10/10/2022	Mid-Ebb	Fine	Moderate	12:47	23	M	11.5	2	8.57	31.49	31.28	78.4	5.14	4.2	0.29	69.1	6	0.22	0.057	0.18	0.46	1100	0.04	<1
F	10/10/2022	Mid-Ebb	Fine	Moderate	12:47	23	B	22	1	8.84	31.15	31.13	77.5	5.05	4.9	0.24	68.2	5	0.22	0.057	0.22	0.50	1000	0.03	<1
F	10/10/2022	Mid-Ebb	Fine	Moderate	12:47	23	B	22	2	8.81	31.17	31.49	77.6	5.06	5.1	0.21	68.1	5	0.22	0.058	0.17	0.45	1100	0.03	<1
G	10/10/2022	Mid-Ebb	Fine	Moderate	13:06	22	S	1	1	8.11	32.88	28.41	82.4	5.34	4.4	0.17	264.1	5	0.22	0.053	0.27	0.52	730	0.04	<1
G	10/10/2022	Mid-Ebb	Fine	Moderate	13:06	22	S	1	2	8.13	32.89	28.42	72.6	5.33	4.6	0.17	266.2	4	0.22	0.058	0.20	0.48	790	0.04	<1
G	10/10/2022	Mid-Ebb	Fine	Moderate	13:06	22	M	11	1	8.46	32.64	28.94	79.1	5.17	4.5	0.11	281.5	4	0.21	0.058	0.13	0.39	690	0.05	<1
G	10/10/2022	Mid-Ebb	Fine	Moderate	13:06	22	M	11	2	8.41	32.66	28.99	79.2	5.16	4.8	0.12	284.9	4	0.20	0.058	0.14	0.40	760	0.04	<1
G	10/10/2022	Mid-Ebb	Fine	Moderate	13:06	22	B	21	1	8.24	31.06	28.65	76.4	4.92	4.7	0.14	311.4	6	0.24	0.058	0.17	0.47	700	0.03	<1
G	10/10/2022	Mid-Ebb	Fine	Moderate	13:06	22	B	21	2	8.23	31.04	28.61	76.1	4.91	4.9	0.12	312.6	6	0.23	0.057	0.18	0.47	750	0.03	<1
H	10/10/2022	Mid-Ebb	Fine	Moderate	13:23	19	S	1	1	8.14	31.26	27.93	90.3	5.81	3.9	0.24	137.2	6	0.16	0.057	0.12	0.33	1200	0.03	<1
H	10/10/2022	Mid-Ebb	Fine	Moderate	13:23	19	S	1	2	8.16	31.24	27.94	90.4	5.82	3.8	0.27	133.4	6	0.16	0.057	0.18	0.40	1200	0.03	<1
H	10/10/2022	Mid-Ebb	Fine	Moderate	13:23	19	M	9.5	1	8.23	31.39	27.41	86.5	5.43	3.7	0.24	129.9	5	0.14	0.057	0.19	0.38	1100	0.03	<1
H	10/10/2022	Mid-Ebb	Fine	Moderate	13:23	19	M	9.5	2	8.24	31.38	27.42	86.4	5.42	3.6	0.27	129.8	6	0.14	0.057	0.15	0.35	1300	0.04	<1
H	10/10/2022	Mid-Ebb	Fine	Moderate	13:23	19	B	18	1	8.20	31.56	27.33	81.7	5.31	3.2	0.27	109.1	6	0.14	0.057	0.16	0.36	1200	0.04	<1
H	10/10/2022	Mid-Ebb	Fine	Moderate	13:23	19	B	18	2	8.19	31.54	27.34	81.7	5.32	3.3	0.29	109.2	6	0.15	0.057	0.15	0.35	1100	0.04	<1

Note: 1. ND: Not Detected

Water Quality Monitoring Data

Monitoring Location	Date	Tide Mode	Weather	Sea Condition	Time	Water Depth (m)	Monitoring Level	Monitoring Level (m)	Replicate	In-situ Measurement								Laboratory Analysis							
										pH	Salinity (ppt)	Temperature (degree C)	DO Saturation (%)	DO (mg/L)	Turbidity (NTU)	Current Speed (m/s)	Current Direction (degree magnetic)	Total Suspended Solids (mg/L)	Ammonia Nitrogen (mg/L-N)	Nitrite Nitrogen (mg/L-N)	Nitrate Nitrogen (mg/L-N)	Total Inorganic Nitrogen (mg/L-N)	E.coli (cfu/100mL)	Total phosphorus (soluble and particulate) (mg/L)	BOD <sub>5</sub> (mg/L)
										Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value
A	10/10/2022	Mid-Flood	Fine	Moderate	07:49	15	S	1	1	8.56	31.12	28.57	80.9	5.38	3.9	0.10	77.1	5	0.18	0.071	0.22	0.47	240	0.04	<1
A	10/10/2022	Mid-Flood	Fine	Moderate	07:49	15	S	1	2	8.57	31.14	28.64	80.7	5.34	3.8	0.14	72.4	6	0.18	0.071	0.24	0.49	200	0.03	<1
A	10/10/2022	Mid-Flood	Fine	Moderate	07:49	15	M	7.5	1	8.69	31.11	28.59	78.8	5.13	4.1	0.12	73.9	5	0.16	0.071	0.25	0.48	180	0.04	<1
A	10/10/2022	Mid-Flood	Fine	Moderate	07:49	15	M	7.5	2	8.67	31.11	28.58	78.9	5.14	4.2	0.16	73.8	6	0.20	0.071	0.21	0.48	220	0.05	<1
A	10/10/2022	Mid-Flood	Fine	Moderate	07:49	15	B	14	1	8.81	31.10	28.44	78.1	5.09	4.9	0.16	82.6	5	0.12	0.071	0.24	0.43	240	0.05	<1
A	10/10/2022	Mid-Flood	Fine	Moderate	07:49	15	B	14	2	8.82	31.12	28.49	77.9	5.08	4.8	0.19	82.4	5	0.12	0.071	0.24	0.42	180	0.06	<1
B	10/10/2022	Mid-Flood	Fine	Moderate	07:32	14	S	1	1	8.61	31.77	28.77	80.2	5.27	4.3	0.06	241.2	6	0.16	0.071	0.26	0.49	220	0.04	<1
B	10/10/2022	Mid-Flood	Fine	Moderate	07:32	14	S	1	2	8.62	31.74	28.74	80.3	5.26	4.0	0.04	244.3	6	0.16	0.072	0.30	0.53	190	0.03	<1
B	10/10/2022	Mid-Flood	Fine	Moderate	07:32	14	M	7	1	8.52	31.57	28.33	77.9	5.10	4.9	0.17	226.1	5	0.13	0.071	0.22	0.42	210	0.05	<1
B	10/10/2022	Mid-Flood	Fine	Moderate	07:32	14	M	7	2	8.53	31.56	28.34	77.6	5.06	4.8	0.19	229.2	6	0.13	0.071	0.28	0.48	180	0.05	<1
B	10/10/2022	Mid-Flood	Fine	Moderate	07:32	14	B	13	1	8.44	31.44	28.11	76.4	4.92	4.1	0.18	257.3	5	0.16	0.069	0.17	0.40	220	0.09	<1
B	10/10/2022	Mid-Flood	Fine	Moderate	07:32	14	B	13	2	8.41	31.41	28.14	76.3	4.91	4.2	0.16	256.4	6	0.16	0.072	0.15	0.38	200	0.09	<1
C	10/10/2022	Mid-Flood	Fine	Moderate	07:13	12	S	1	1	8.44	31.30	28.53	74.1	4.83	4.1	0.24	24.5	5	0.18	0.067	0.28	0.53	200	0.03	<1
C	10/10/2022	Mid-Flood	Fine	Moderate	07:13	12	S	1	2	8.39	31.40	28.54	74.9	4.87	4.2	0.29	22.6	5	0.18	0.067	0.31	0.56	180	0.04	<1
C	10/10/2022	Mid-Flood	Fine	Moderate	07:13	12	M	6	1	8.57	31.07	28.49	72.3	4.71	4.4	0.17	47.1	5	0.13	0.065	0.16	0.36	250	0.04	1.1
C	10/10/2022	Mid-Flood	Fine	Moderate	07:13	12	M	6	2	8.56	31.06	28.44	72.1	4.73	4.6	0.19	48.2	5	0.14	0.065	0.21	0.40	200	0.04	1.2
C	10/10/2022	Mid-Flood	Fine	Moderate	07:13	12	B	11	1	8.48	31.02	28.31	71.4	4.67	5.1	0.14	44.9	4	0.19	0.065	0.22	0.47	230	0.03	1.4
C	10/10/2022	Mid-Flood	Fine	Moderate	07:13	12	B	11	2	8.47	31.03	28.30	71.8	4.69	5.2	0.16	44.1	4	0.19	0.065	0.19	0.45	180	0.03	<1
D	10/10/2022	Mid-Flood	Fine	Moderate	06:57	14	S	1	1	8.44	32.46	29.12	79.4	5.11	2.9	0.09	208.8	5	0.17	0.25	0.18	0.48	300	0.02	<1
D	10/10/2022	Mid-Flood	Fine	Moderate	06:57	14	S	1	2	8.41	32.51	29.11	79.2	5.06	2.5	0.11	211.4	5	0.17	0.19	0.18	0.42	340	0.03	<1
D	10/10/2022	Mid-Flood	Fine	Moderate	06:57	14	M	7	1	8.32	32.94	29.06	78.3	4.87	3.4	0.14	234.5	5	0.17	0.20	0.19	0.43	390	0.04	<1
D	10/10/2022	Mid-Flood	Fine	Moderate	06:57	14	M	7	2	8.37	32.99	29.04	78.1	4.86	3.7	0.15	236.1	5	0.17	0.25	0.19	0.49	320	0.04	<1
D	10/10/2022	Mid-Flood	Fine	Moderate	06:57	14	B	13	1	8.58	33.17	28.71	77.2	4.84	3.1	0.11	234.1	5	0.16	0.25	0.18	0.48	340	0.03	<1
D	10/10/2022	Mid-Flood	Fine	Moderate	06:57	14	B	13	2	8.56	33.16	28.76	77.1	4.83	3.2	0.12	239.2	5	0.16	0.28	0.18	0.51	300	0.03	<1
E	10/10/2022	Mid-Flood	Fine	Moderate	06:40	14	S	1	1	8.23	30.79	28.49	77.4	5.08	3.6	0.14	264.1	5	0.18	0.053	0.24	0.47	1100	0.03	<1
E	10/10/2022	Mid-Flood	Fine	Moderate	06:40	14	S	1	2	8.24	30.77	28.46	77.9	5.10	3.4	0.17	266.2	5	0.18	0.053	0.24	0.47	1000	0.04	<1
E	10/10/2022	Mid-Flood	Fine	Moderate	06:40	14	M	7	1	8.17	31.22	28.23	72.8	4.81	3.8	0.12	250.1	5	0.18	0.057	0.23	0.47	1100	0.03	<1
E	10/10/2022	Mid-Flood	Fine	Moderate	06:40	14	M	7	2	8.16	31.26	28.22	72.4	4.79	3.9	0.13	250.3	6	0.18	0.058	0.22	0.60	1000	0.02	<1
E	10/10/2022	Mid-Flood	Fine	Moderate	06:40	14	B	13	1	8.03	31.40	28.07	70.7	4.64	3.9	0.15	243.4	6	0.17	0.058	0.28	0.52	1100	0.04	<1
E	10/10/2022	Mid-Flood	Fine	Moderate	06:40	14	B	13	2	8.04	31.41	28.04	70.6	4.66	4.1	0.19	233.1	6	0.17	0.057	0.23	0.46	1000	0.04	<1
F	10/10/2022	Mid-Flood	Fine	Moderate	06:18	18	S	1	1	8.14	30.24	28.22	91.3	6.02	2.7	0.12	140.3	5	0.20	0.057	0.13	0.37	1600	0.03	<1
F	10/10/2022	Mid-Flood	Fine	Moderate	06:18	18	S	1	2	8.19	30.26	28.21	91.4	6.04	2.8	0.13	139.2	5	0.20	0.057	0.14	0.37	1600	0.04	<1
F	10/10/2022	Mid-Flood	Fine	Moderate	06:18	18	M	9	1	8.24	30.74	28.14	89.1	5.97	2.2	0.14	102.3	6	0.17	0.057	0.33	0.57	1500	0.04	1.8
F	10/10/2022	Mid-Flood	Fine	Moderate	06:18	18	M	9	2	8.23	30.77	28.13	89.2	5.96	2.3	0.16	103.4	6	0.16	0.057	0.28	0.52	1500	0.04	1.7
F	10/10/2022	Mid-Flood	Fine	Moderate	06:18	18	B	17	1	8.18	30.91	28.04	88.1	5.84	3.1	0.14	128.1	8	0.15	0.057	0.21	0.44	1500	0.04	2.0
F	10/10/2022	Mid-Flood	Fine	Moderate	06:18	18	B	17	2	8.17	30.94	28.01	87.9	5.83	3.4	0.15	127.7	7	0.14	0.057	0.23	0.46	1600	0.04	1.9
G	10/10/2022	Mid-Flood	Fine	Moderate	05:58	13	S	1	1	8.46	30.44	28.43	84.5	5.51	4.2	0.22	90.6	7	0.20	0.057	0.22	0.48	920	0.03	1.9
G	10/10/2022	Mid-Flood	Fine	Moderate	05:58	13	S	1	2	8.49	30.41	28.44	84.4	5.49	4.1	0.24	90.4	7	0.13	0.058	0.25	0.51	960	0.02	2.0
G	10/10/2022	Mid-Flood	Fine	Moderate	05:58	13	M	6.5	1	8.65	30.91	28.21	82.7	5.20	4.4	0.21	87.1	8	0.20	0.057	0.21	0.43	900	0.03	1.8
G	10/10/2022	Mid-Flood	Fine	Moderate	05:58	13	M	6.5	2	8.66	30.92	28.20	82.6	5.19	4.1	0.22	87.2	8	0.11	0.057	0.21	0.43	950	0.03	2.1
G	10/10/2022	Mid-Flood	Fine	Moderate	05:58	13	B	12	1	8.84	31.11	28.11	82.1	5.08	4.2	0.24	92.6	8	0.12	0.057	0.23	0.43	850	0.03	2.6
G	10/10/2022	Mid-Flood	Fine	Moderate	05:58	13	B	12	2	8.81	31.12	28.14	82.2	5.09	4.1	0.27	92.4	8	0.12	0.058	0.23	0.44	900	0.03	1.8
H	10/10/2022	Mid-Flood	Fine	Moderate	05:41	19	S	1	1	8.41	30.41	28.51	79.1	4.92	4.3	0.17	206.1	7	0.12	0.056	0.39	0.57	1200	0.03	1.9
H	10/10/2022	Mid-Flood	Fine	Moderate	05:41	19	S	1	2	8.42	30.46	28.54	79.3	4.94	4.1	0.18	206.4	7	0.13	0.056	0.35	0.54	1200	0.03	1.9
H	10/10/2022	Mid-Flood	Fine	Moderate	05:41	19	M	9.5	1	8.26	30.60	28.84	77.4	4.71	4.7	0.19	204.1	7	0.12	0.056	0.35	0.52	1100	0.04	1.9
H	10/10/2022	Mid-Flood	Fine	Moderate	05:41	19	M	9.5	2	8.29	30.62	28.86	77.6	4.74	4.8	0.21	201.1	8	0.11	0.056	0.35	0.52	1100	0.04	1.8
H	10/10/2022	Mid-Flood	Fine	Moderate	05:41	19	B	18	1	8.18	30.94	28.94	75.2	4.61	4.4	0.12	223.4	5	0.12	0.057	0.24	0.42	1200	0.03	1.6
H	10/10/2022	Mid-Flood	Fine	Moderate	05:41	19	B	18	2	8.17	30.99	28.99	75.3	4.62	4.3	0.13	226.1	5	0.12	0.057	0.20	0.38	1100	0.04	1.7

Note: 1. ND: Not Detected

Report No. : 181172WA222096



Page 1 of 18

**Test Report on Analysis of Water**
**Information Supplied by Client**

Client : Fugro Technical Services Limited

Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Sample description : Ninety-six samples of water taken by the staff of FTS on 10/10/2022

Client sample ID : Refer to pages 3 to 18

Tests required : 
 

1. Biochemical oxygen demand
2. Total suspended solids dried at 103°C – 105°C
3. Ammoniacal Nitrogen content
4. Nitrate-Nitrogen content
5. Nitrite-Nitrogen content
6. Total Inorganic Nitrogen content
7. Total phosphorus content
8. Total phosphorus content (Filtered)
9. E. coli count

**Laboratory Information**

Lab. sample ID :	Chemical tests	Microbiological tests
	WA222096/1-96	WA222096/1B-96B

	Chemical tests	Microbiological tests
Container	Ninety-six 250 mL and 3 L plastic bottles	Ninety-six sterilized 250 mL plastic bottles with thiosulphate added
Appearance	Colourless	
Temperature	Cooled	

Date of receipt of sample : 10/10/2022

Date test commenced : 10/10/2022

Date test completed : 19/10/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096

Page 2 of 18

Test methods used : Biochemical oxygen demand  
*APHA 23ed. 5210B*

Total suspended solids dried at 103°C – 105°C  
*APHA 23ed. 2540D*

Ammoniacal Nitrogen content  
*APHA 23ed. 4500-NH<sub>3</sub> H*

Nitrate-Nitrogen content  
*APHA 23ed. 4500-NO<sub>3</sub><sup>-</sup> I*

Nitrite-Nitrogen content  
*APHA 23ed. 4500-NO<sub>2</sub><sup>-</sup> A & NO<sub>3</sub><sup>-</sup> I*

Total Inorganic Nitrogen content  
*In-house method E-T-112 (By Calculation)*

Total phosphorus content  
*APHA 17ed. 4500-PB.5 (Digestion) &  
In-house method E-T-056 (Determination)*

Total phosphorus content (Filtered)  
*APHA 17ed. 4500-PB.5 (Digestion) &  
In-house method E-T-056 (Determination)*

E. coli count  
*The Bacteriological Examination of Drinking Water Supplies  
1982, DoE (1983) Membrane Filtration Procedure: Sections 7.8,  
7.9.4.2 Bacterial Confirmation: Section 7.9.4.4 & in-situ urease  
test*

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*


Report No. : 181172WA222096

Page 3 of 18

**Results :**

Test parameters	Sample identification							
	A/S/E	A/S/E/Dup	A/M/E	A/M/E/Dup	A/B/E	A/B/E/Dup	A/B/E/Dup	A/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	6	6	6	6	7	7	7	7
3. Ammoniacal nitrogen content, mg/L	0.13	0.12	0.13	0.13	0.16	0.16	0.15	0.15
4. Nitrate-Nitrogen content, mg/L	0.10	0.13	0.17	0.19	0.26	0.26	0.27	0.27
5. Nitrite-Nitrogen content, mg/L	0.071	0.072	0.071	0.071	0.071	0.071	0.070	0.070
6. Total Inorganic Nitrogen content, mg/L	0.30	0.32	0.37	0.40	0.49	0.49	0.49	0.49
7. Total phosphorus content, mg/L	0.03	0.03	0.03	0.04	0.03	0.03	0.04	0.04
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.02
9. E. coli count, cfu/100ml	2.0 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>	1.9 x 10 <sup>2</sup>	2.1 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>	1.9 x 10 <sup>2</sup>	1.9 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

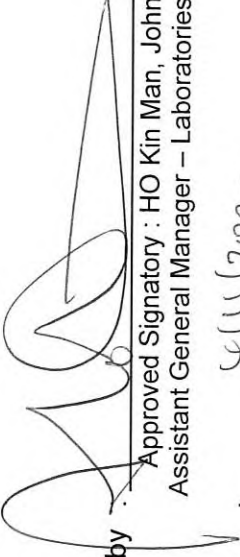Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 4/11/2022

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.




Report No. : 181172WA222096

Page 4 of 18

**Results :**

Test parameters	Sample identification							
	B/S/E	B/S/E/Dup	B/M/E	B/M/E/Dup	B/B/E	B/B/E/Dup	B/B/E/Dup	B/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	7	7	7	7	5	5	5	5
3. Ammoniacal nitrogen content, mg/L	0.18	0.17	0.20	0.20	0.25	0.25	0.25	0.25
4. Nitrate-Nitrogen content, mg/L	0.41	0.34	0.17	0.15	0.17	0.17	0.11	0.11
5. Nitrite-Nitrogen content, mg/L	0.071	0.071	0.071	0.071	0.070	0.070	0.070	0.070
6. Total Inorganic Nitrogen content, mg/L	0.66	0.58	0.44	0.42	0.49	0.49	0.43	0.43
7. Total phosphorus content, mg/L	0.04	0.04	0.04	0.04	0.03	0.03	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.02	0.02	0.02	0.02	0.02	0.02
9. E. coli count, cfu/100ml	1.4 x 10 <sup>2</sup>	1.7 x 10 <sup>2</sup>	1.7 x 10 <sup>2</sup>	1.6 x 10 <sup>2</sup>	1.6 x 10 <sup>2</sup>	1.6 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date :                     

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096

Page 5 of 18

**Results :**

Test parameters	Sample identification					
	C/S/E	C/S/E/Dup	C/M/E	C/M/E/Dup	C/B/E	C/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	6	5	6	5	6	5
3. Ammoniacal nitrogen content, mg/L	0.20	0.20	0.20	0.19	0.19	0.19
4. Nitrate-Nitrogen content, mg/L	0.31	0.30	0.37	0.28	0.31	0.23
5. Nitrite-Nitrogen content, mg/L	0.065	0.065	0.065	0.065	0.067	0.065
6. Total Inorganic Nitrogen content, mg/L	0.58	0.57	0.54	0.53	0.56	0.49
7. Total phosphorus content, mg/L	0.03	0.04	0.04	0.04	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.02	0.02	0.02	0.02	0.02	0.01
9. E. coli count, cfu/100ml	2.9 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>	1.9 x 10 <sup>2</sup>	2.4 x 10 <sup>2</sup>	2.3 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/2020

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096


Page 6 of 18

**Results :**

Test parameters	Sample identification					
	D/S/E	D/S/E/Dup	D/M/E	D/M/E/Dup	D/B/E	D/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	5	5	5	5	6	6
3. Ammoniacal nitrogen content, mg/L	0.10	0.11	0.19	0.19	0.17	0.18
4. Nitrate-Nitrogen content, mg/L	0.17	0.18	0.27	0.27	0.25	0.30
5. Nitrite-Nitrogen content, mg/L	0.063	0.062	0.064	0.065	0.065	0.065
6. Total Inorganic Nitrogen content, mg/L	0.34	0.34	0.52	0.53	0.49	0.55
7. Total phosphorus content, mg/L	0.04	0.03	0.03	0.03	0.04	0.04
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.02	0.02	0.02	0.02
9. E. coli count, cfu/100ml	3.5 x 10 <sup>2</sup>	2.4 x 10 <sup>2</sup>	1.3 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>	1.9 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
2. Temperature of ice-box when samples being received were 5.3°C.

Certified by

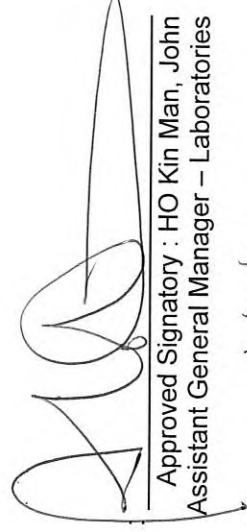

Approved Signatory : HO Kin Man, John  
Assistant General Manager – Laboratories

Date

4/11/20

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

Report No. : 181172WA222096


Page 7 of 18

**Results :**

Test parameters	Sample identification					
	E/S/E	E/S/E/Dup	E/M/E	E/M/E/Dup	E/B/E	E/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	7	7
3. Ammoniacal nitrogen content, mg/L	0.24	0.23	0.20	0.21	0.22	0.22
4. Nitrate-Nitrogen content, mg/L	0.28	0.23	0.25	0.27	0.26	0.22
5. Nitrite-Nitrogen content, mg/L	0.057	0.058	0.058	0.058	0.058	0.057
6. Total Inorganic Nitrogen content, mg/L	0.57	0.51	0.50	0.54	0.54	0.49
7. Total phosphorus content, mg/L	0.03	0.03	0.04	0.04	0.02	0.03
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.01	0.01	0.02	0.01
9. E. coli count, cfu/100ml	1.2 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.2 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.2 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.  
 3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml.

Certified by :

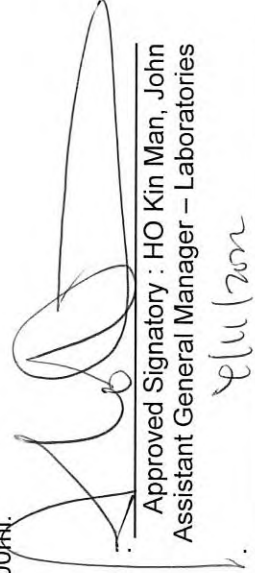

Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date :

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

Report No. : 181172WA222096

Page 8 of 18

**Results :**


Test parameters	Sample identification					
	F/S/E	F/S/E/Dup	F/M/E	F/M/E/Dup	F/B/E	F/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	7	6	6	6	5	5
3. Ammoniacal nitrogen content, mg/L	0.21	0.22	0.23	0.22	0.22	0.22
4. Nitrate-Nitrogen content, mg/L	0.25	0.15	0.18	0.18	0.22	0.17
5. Nitrite-Nitrogen content, mg/L	0.062	0.057	0.058	0.057	0.057	0.058
6. Total Inorganic Nitrogen content, mg/L	0.52	0.42	0.47	0.46	0.50	0.45
7. Total phosphorus content, mg/L	0.03	0.03	0.04	0.04	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.02	0.02	0.01	0.01
9. E. coli count, cfu/100ml	1.0 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.0 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)

2. Temperature of ice-box when samples being received were 5.3°C.

3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml.

Certified by :

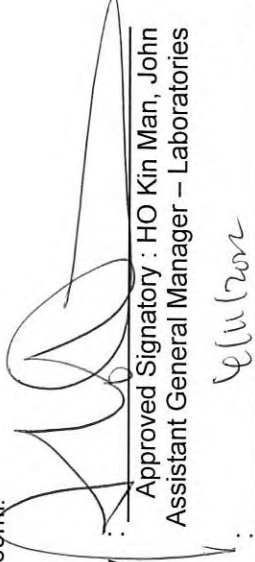

Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date :

26/11/2020

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA222096

Page 9 of 18

**Results :**

Test parameters	Sample identification					
	G/S/E	G/S/E/Dup	G/M/E	G/M/E/Dup	G/B/E	G/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	5	4	4	4	6	6
3. Ammoniacal nitrogen content, mg/L	0.22	0.22	0.21	0.20	0.24	0.23
4. Nitrate-Nitrogen content, mg/L	0.27	0.20	0.13	0.14	0.17	0.18
5. Nitrite-Nitrogen content, mg/L	0.053	0.058	0.058	0.058	0.058	0.057
6. Total Inorganic Nitrogen content, mg/L	0.52	0.48	0.39	0.40	0.47	0.47
7. Total phosphorus content, mg/L	0.04	0.04	0.05	0.04	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.01	0.02	0.02	0.02	0.02	0.02
9. E. coli count, cfu/100ml	7.3 x 10 <sup>2</sup>	7.9 x 10 <sup>2</sup>	6.9 x 10 <sup>2</sup>	7.6 x 10 <sup>2</sup>	7.0 x 10 <sup>2</sup>	7.5 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 4/11/2018

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

Report No. : 181172WA222096

Page 10 of 18

**Results :**

Test parameters	Sample identification					
	H/S/E	H/S/E/Dup	H/M/E	H/M/E/Dup	H/B/E	H/B/E/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	6	6	5	6	6	6
3. Ammoniacal nitrogen content, mg/L	0.16	0.16	0.14	0.14	0.14	0.15
4. Nitrate-Nitrogen content, mg/L	0.12	0.18	0.19	0.15	0.16	0.15
5. Nitrite-Nitrogen content, mg/L	0.057	0.057	0.057	0.057	0.057	0.057
6. Total Inorganic Nitrogen content, mg/L	0.33	0.40	0.38	0.35	0.36	0.35
7. Total phosphorus content, mg/L	0.03	0.03	0.03	0.04	0.04	0.04
8. Total phosphorus content (Filtered), mg/L	0.02	0.02	0.02	0.02	0.02	0.02
9. E. coli count, cfu/100ml	1.2 x 10 <sup>3</sup> *	1.2 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.3 x 10 <sup>3</sup> *	1.2 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)

2. Temperature of ice-box when samples being received were 5.3°C.

3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml.

Certified by :



Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date :

6/11/2011

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA222096

Page 11 of 18

**Results :**

Test parameters	Sample identification					
	A/S/F	A/S/F/Dup	A/M/F	A/M/F/Dup	A/B/F	A/B/F/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	5	6	5	6	5	5
3. Ammoniacal nitrogen content, mg/L	0.18	0.18	0.16	0.20	0.12	0.12
4. Nitrate-Nitrogen content, mg/L	0.22	0.24	0.25	0.21	0.24	0.24
5. Nitrite-Nitrogen content, mg/L	0.071	0.071	0.071	0.071	0.071	0.071
6. Total Inorganic Nitrogen content, mg/L	0.47	0.49	0.48	0.48	0.43	0.42
7. Total phosphorus content, mg/L	0.04	0.03	0.04	0.05	0.05	0.06
8. Total phosphorus content (Filtered), mg/L	0.02	0.02	0.02	0.02	0.02	0.01
9. E. coli count, cfu/100ml	2.4 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>	2.2 x 10 <sup>2</sup>	2.4 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

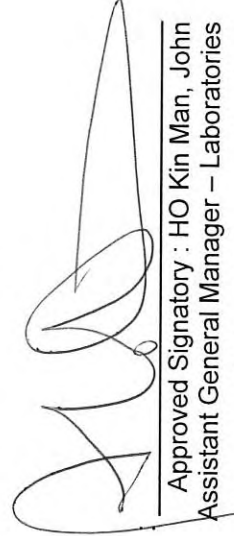Certified by   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 8/11/2022

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.




Report No. : 181172WA222096

Page 12 of 18

**Results :**

Test parameters	Sample identification					
	B/S/F	B/S/F/Dup	B/M/F	B/M/F/Dup	B/B/F	B/B/F/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	6	6	5	6	5	6
3. Ammoniacal nitrogen content, mg/L	0.16	0.16	0.13	0.13	0.16	0.16
4. Nitrate-Nitrogen content, mg/L	0.26	0.30	0.22	0.28	0.17	0.15
5. Nitrite-Nitrogen content, mg/L	0.071	0.072	0.071	0.071	0.069	0.072
6. Total Inorganic Nitrogen content, mg/L	0.49	0.53	0.42	0.48	0.40	0.38
7. Total phosphorus content, mg/L	0.04	0.03	0.05	0.05	0.09	0.09
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.01	0.01	0.02	0.02
9. E. coli count, cfu/100ml	2.2 x 10 <sup>2</sup>	1.9 x 10 <sup>2</sup>	2.1 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>	2.2 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

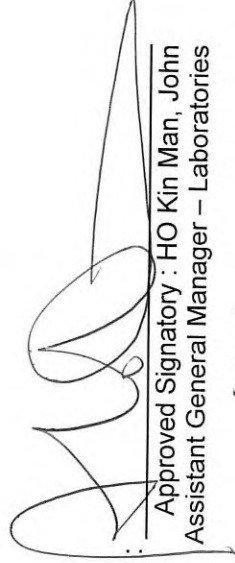Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 4/11/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*


Report No. : 181172WA222096

Page 13 of 18

**Results :**

Test parameters	Sample identification					
	C/S/IF	C/S/IF/Dup	C/M/F	C/M/F/Dup	C/B/F	C/B/F/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	1.1	1.2	1.4	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	5	5	5	5	4	4
3. Ammoniacal nitrogen content, mg/L	0.18	0.18	0.13	0.14	0.19	0.19
4. Nitrate-Nitrogen content, mg/L	0.28	0.31	0.16	0.21	0.22	0.19
5. Nitrite-Nitrogen content, mg/L	0.067	0.067	0.065	0.065	0.065	0.065
6. Total Inorganic Nitrogen content, mg/L	0.53	0.56	0.36	0.40	0.47	0.45
7. Total phosphorus content, mg/L	0.03	0.04	0.04	0.04	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.02	0.02	0.02	0.02	0.02	0.01
9. E. coli count, cfu/100ml	2.0 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>	2.5 x 10 <sup>2</sup>	2.0 x 10 <sup>2</sup>	2.3 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

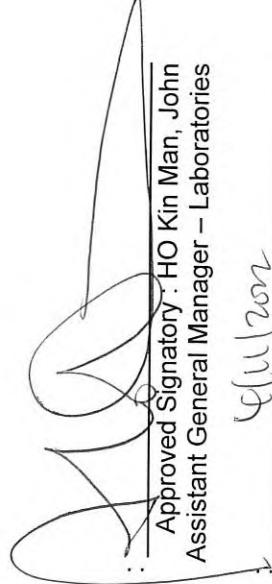Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 4/11/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*


Report No. : 181172WA222096

Page 14 of 18

**Results :**

Test parameters	Sample identification					
	D/S/F	D/S/F/Dup	D/M/F	D/M/F/Dup	D/B/F	D/B/F/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	5	5	5	5	5	5
3. Ammoniacal nitrogen content, mg/L	0.17	0.17	0.17	0.17	0.16	0.16
4. Nitrate-Nitrogen content, mg/L	0.18	0.18	0.19	0.19	0.18	0.18
5. Nitrite-Nitrogen content, mg/L	0.25	0.19	0.20	0.25	0.25	0.28
6. Total Inorganic Nitrogen content, mg/L	0.48	0.42	0.43	0.49	0.48	0.51
7. Total phosphorus content, mg/L	0.02	0.03	0.04	0.04	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.02	0.02	0.02	0.02
9. E. coli count, cfu/100ml	3.0 x 10 <sup>2</sup>	3.4 x 10 <sup>2</sup>	3.9 x 10 <sup>2</sup>	3.2 x 10 <sup>2</sup>	3.4 x 10 <sup>2</sup>	3.0 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

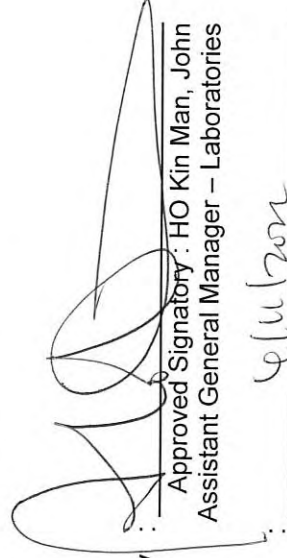Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/20

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096

Page 15 of 18

**Results :**

Test parameters	Sample identification					
	E/S/F	E/S/F/Dup	E/M/F	E/M/F/Dup	E/B/F	E/B/F/Dup
1. Biochemical oxygen demand, mg/L	<1	<1	<1	<1	<1	<1
2. Total suspended solids dried at 103°C - 105°C, mg/L	5	5	5	6	6	6
3. Ammoniacal nitrogen content, mg/L	0.18	0.18	0.18	0.18	0.17	0.17
4. Nitrate-Nitrogen content, mg/L	0.24	0.24	0.23	0.22	0.28	0.23
5. Nitrite-Nitrogen content, mg/L	0.053	0.053	0.057	0.058	0.058	0.057
6. Total Inorganic Nitrogen content, mg/L	0.47	0.47	0.47	0.46	0.52	0.46
7. Total phosphorus content, mg/L	0.03	0.04	0.03	0.02	0.04	0.04
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.01	0.01	0.02	0.02
9. E. coli count, cfu/100ml	1.1 x 10 <sup>3</sup> *	1.0 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.0 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.0 x 10 <sup>3</sup> *

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)

2. Temperature of ice-box when samples being received were 5.3°C.

3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml

Certified by :

Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date

9/11/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096

Page 16 of 18

**Results :**


Test parameters	Sample identification							
	F/S/F	F/S/F/Dup	F/M/F	F/M/F/Dup	F/B/F	F/B/F/Dup		
1. Biochemical oxygen demand, mg/L	<1	<1	1.8	1.7	2.0	1.9		
2. Total suspended solids dried at 103°C - 105°C, mg/L	5	5	6	6	8	7		
3. Ammoniacal nitrogen content, mg/L	0.20	0.20	0.17	0.16	0.15	0.14		
4. Nitrate-Nitrogen content, mg/L	0.13	0.14	0.33	0.28	0.21	0.23		
5. Nitrite-Nitrogen content, mg/L	0.057	0.057	0.057	0.057	0.057	0.057		
6. Total Inorganic Nitrogen content, mg/L	0.37	0.37	0.57	0.52	0.44	0.46		
7. Total phosphorus content, mg/L	0.03	0.04	0.04	0.04	0.04	0.04		
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.02	0.02	0.01	0.01		
9. E. coli count, cfu/100ml	1.6 x 10 <sup>3</sup> *	1.6 x 10 <sup>3</sup> *	1.5 x 10 <sup>3</sup> *	1.5 x 10 <sup>3</sup> *	1.5 x 10 <sup>3</sup> *	1.6 x 10 <sup>3</sup> *		

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)

2. Temperature of ice-box when samples being received were 5.3°C.

3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml.

Certified by :

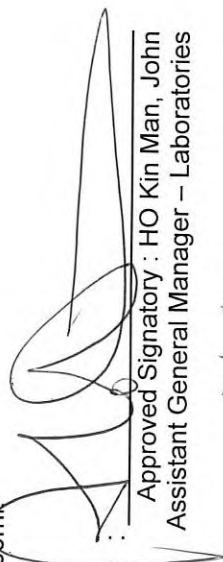

Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date :

4/11/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*


Report No. : 181172WA222096

Page 17 of 18

**Results :**

Test parameters	Sample identification							
	G/S/F	G/S/F/Dup	G/M/F	G/M/F/Dup	G/B/F	G/B/F/Dup	G/B/F/Dup	G/B/F/Dup
1. Biochemical oxygen demand, mg/L	1.9	2.0	1.8	2.1	2.6	2.6	1.8	1.8
2. Total suspended solids dried at 103°C - 105°C, mg/L	7	7	8	8	8	8	8	8
3. Ammoniacal nitrogen content, mg/L	0.20	0.13	0.20	0.11	0.12	0.12	0.12	0.12
4. Nitrate-Nitrogen content, mg/L	0.22	0.25	0.21	0.21	0.23	0.23	0.23	0.23
5. Nitrite-Nitrogen content, mg/L	0.057	0.058	0.057	0.057	0.057	0.057	0.058	0.058
6. Total Inorganic Nitrogen content, mg/L	0.48	0.51	0.43	0.43	0.43	0.43	0.44	0.44
7. Total phosphorus content, mg/L	0.03	0.02	0.03	0.03	0.03	0.03	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.01	0.02	0.02	0.02	0.02	0.02	0.02	0.02
9. E. coli count, cfu/100ml	9.2 x 10 <sup>2</sup>	9.6 x 10 <sup>2</sup>	9.0 x 10 <sup>2</sup>	9.5 x 10 <sup>2</sup>	8.5 x 10 <sup>2</sup>	8.5 x 10 <sup>2</sup>	9.0 x 10 <sup>2</sup>	9.0 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 5.3°C.

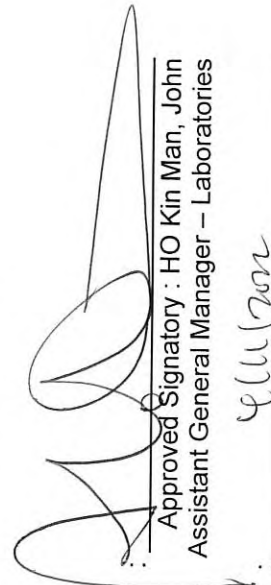Certified by:   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date: 20/11/2022

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

Report No. : 181172WA222096

Page 18 of 18

**Results :**

Test parameters	Sample identification							
	H/S/F	H/S/F/Dup	H/M/F	H/M/F/Dup	H/B/F	H/B/F/Dup	H/B/F/Dup	H/B/F/Dup
1. Biochemical oxygen demand, mg/L	1.9	1.9	1.9	1.8	1.6	1.6	1.7	1.7
2. Total suspended solids dried at 103°C - 105°C, mg/L	7	7	7	8	5	5	5	5
3. Ammoniacal nitrogen content, mg/L	0.12	0.13	0.12	0.11	0.12	0.12	0.12	0.12
4. Nitrate-Nitrogen content, mg/L	0.39	0.35	0.35	0.35	0.24	0.24	0.20	0.20
5. Nitrite-Nitrogen content, mg/L	0.056	0.056	0.056	0.056	0.057	0.057	0.057	0.057
6. Total Inorganic Nitrogen content, mg/L	0.57	0.54	0.52	0.52	0.42	0.42	0.38	0.38
7. Total phosphorus content, mg/L	0.03	0.03	0.04	0.04	0.03	0.03	0.04	0.04
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.01	0.01	0.02	0.02	0.01	0.01
9. E. coli count, cfu/100ml	1.2 x 10 <sup>3</sup> *	1.2 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.2 x 10 <sup>3</sup> *	1.2 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *	1.1 x 10 <sup>3</sup> *

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) + Ammoniacal Nitrogen Content (in mg/L)

2. Temperature of ice-box when samples being received were 5.3°C.

3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml.

Certified by :



Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date

4/11/2022


\*\* End of Report \*\*

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

**Note**

**Laboratory Duplicate, Quality Assurance/Quality Control Report**

Biochemical oxygen demand, mg/L						Nitrate-Nitrogen content, mg/L					
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%
			Original result	Duplicate result					Original result	Duplicate result	
1	<1	-	0.76	0.71	6.80	0.005	-	-	-	-	-
			0.66	0.6	9.52				-	-	-
			0.37	0.35	5.56				-	-	-
			0.86	0.85	1.17				-	-	-
			1.65	1.68	1.80						
Total suspended solids dried at 103°C – 105°C, mg/L						Nitrite-Nitrogen content, mg/L					
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%
			Original result	Duplicate result					Original result	Duplicate result	
1	<1	93.38	5.25	5.6	6.45	0.005	<0.005	107.50	0.063	0.062	1.60
			4.7	4.15	12.43				0.057	0.058	1.74
			5.85	5.7	2.60				0.071	0.074	4.14
			5.1	4.85	5.03				0.057	0.058	1.74
			5.05	5.55	9.43				0.057	0.057	0.00
			101.00								
			100.27								
			96.05								
			101.25								

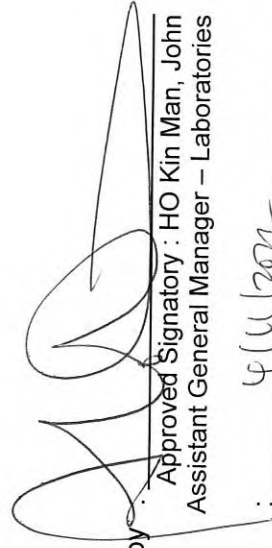Certified by:   
 Approved Signatory: HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date: 4/11/2022


Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.



**Note**

**Laboratory Duplicate, Quality Assurance/Quality Control Report**





Ammoniacal Nitrogen content, mg/L									
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	
			Original result	Duplicate result				Original result	Duplicate result
0.005	<0.005	111.17	0.111	0.106	0.005	-	-	-	-
	<0.005	112.33	0.203	0.205		-	-	-	-
	<0.005	107.33	0.16	0.161		-	-	-	-
	<0.005	110.92	0.18	0.172		-	-	-	-
	<0.005	101.42	0.124	0.12		-	-	-	-
Total phosphorus content, mg/L									
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	
			Original result	Duplicate result				Original result	Duplicate result
0.01	<0.01	99.6	0.027	0.025	0.01	<0.01	99.5	0.013	0.014
	<0.01	98.2	0.043	0.045		<0.01	99.6	0.017	0.017
	<0.01	99.7	0.089	0.092		<0.01	99.1	0.017	0.017
	<0.01	100.1	0.037	0.034		<0.01	99.5	0.015	0.014
	<0.01	98.8	0.034	0.036		<0.01	100.3	0.014	0.015
E. coli count, cfu/100ml									
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	
			Original result	Duplicate result				Original result	Duplicate result
1	0	-	2.2 x 10 <sup>2</sup>	2.6 x 10 <sup>2</sup>	1	0	-	7.2 x 10 <sup>2</sup>	7.9 x 10 <sup>2</sup>
			2.1 x 10 <sup>2</sup>	1.8 x 10 <sup>2</sup>				1.8 x 10 <sup>2</sup>	15.38
			1.6 x 10 <sup>3</sup>	1.5 x 10 <sup>3</sup>				1.5 x 10 <sup>3</sup>	6.45
			1.1 x 10 <sup>3</sup>	1.2 x 10 <sup>3</sup>				1.2 x 10 <sup>3</sup>	8.70

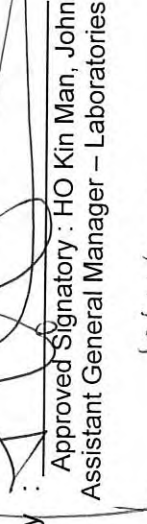Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories


Date :                     

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.





pH value

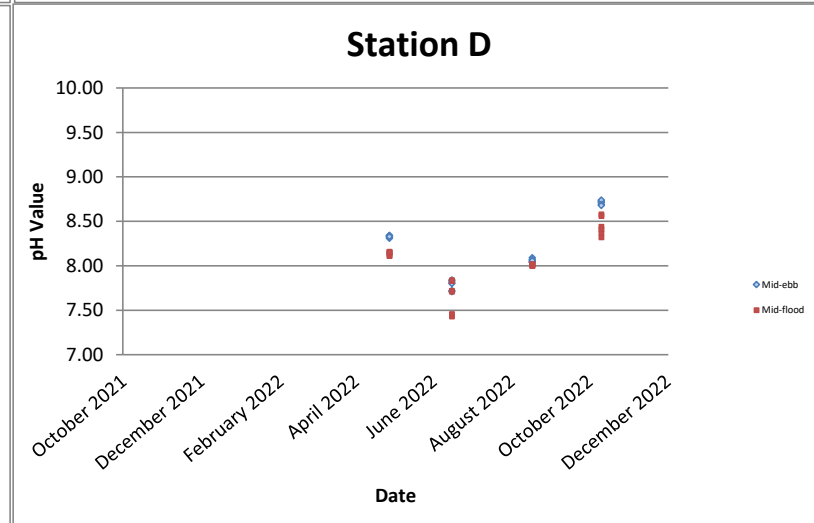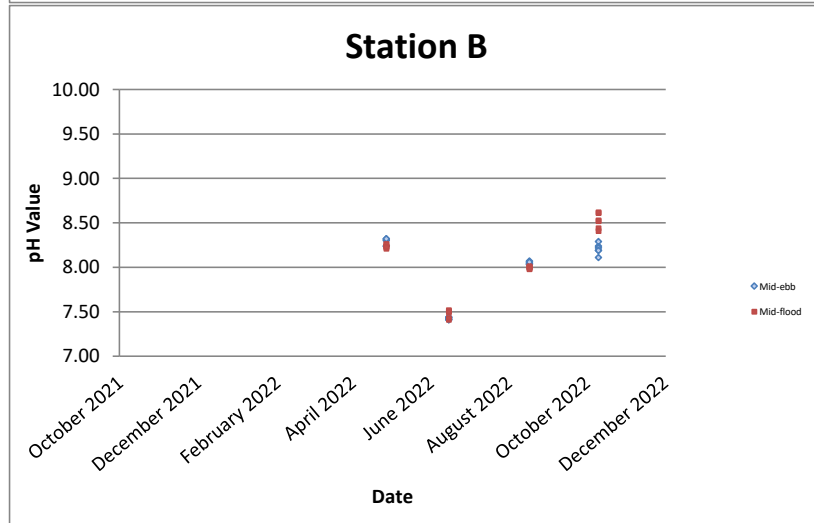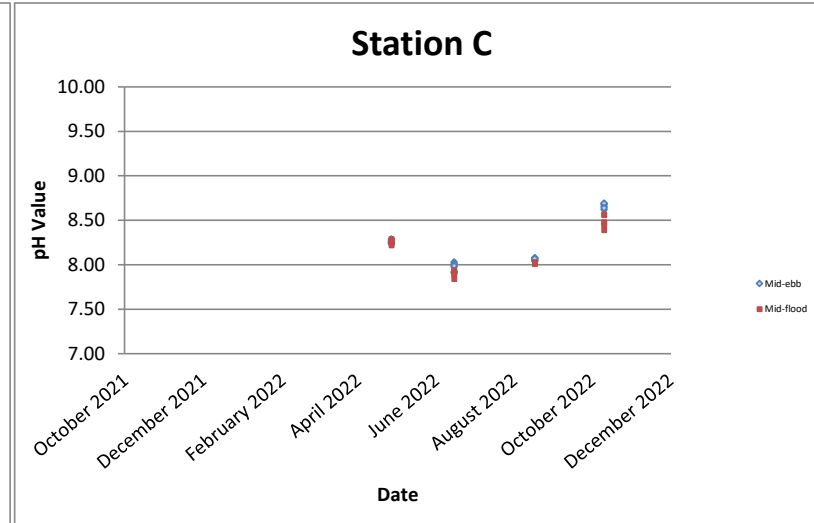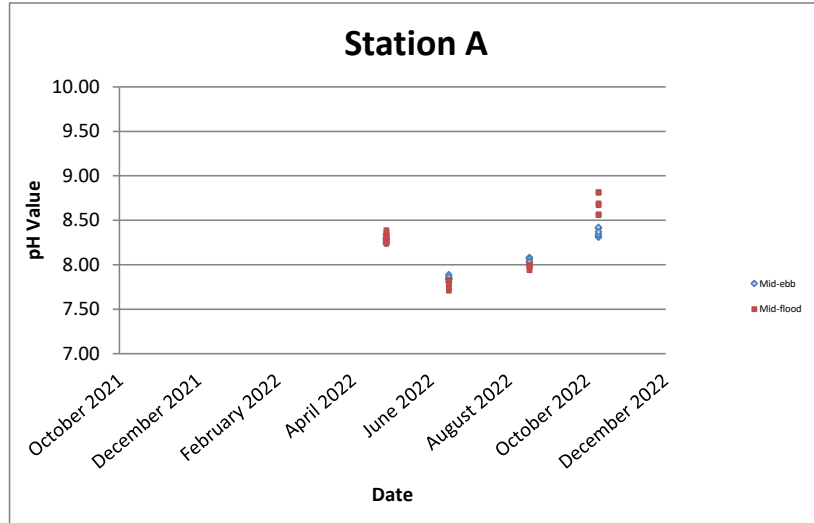


pH value

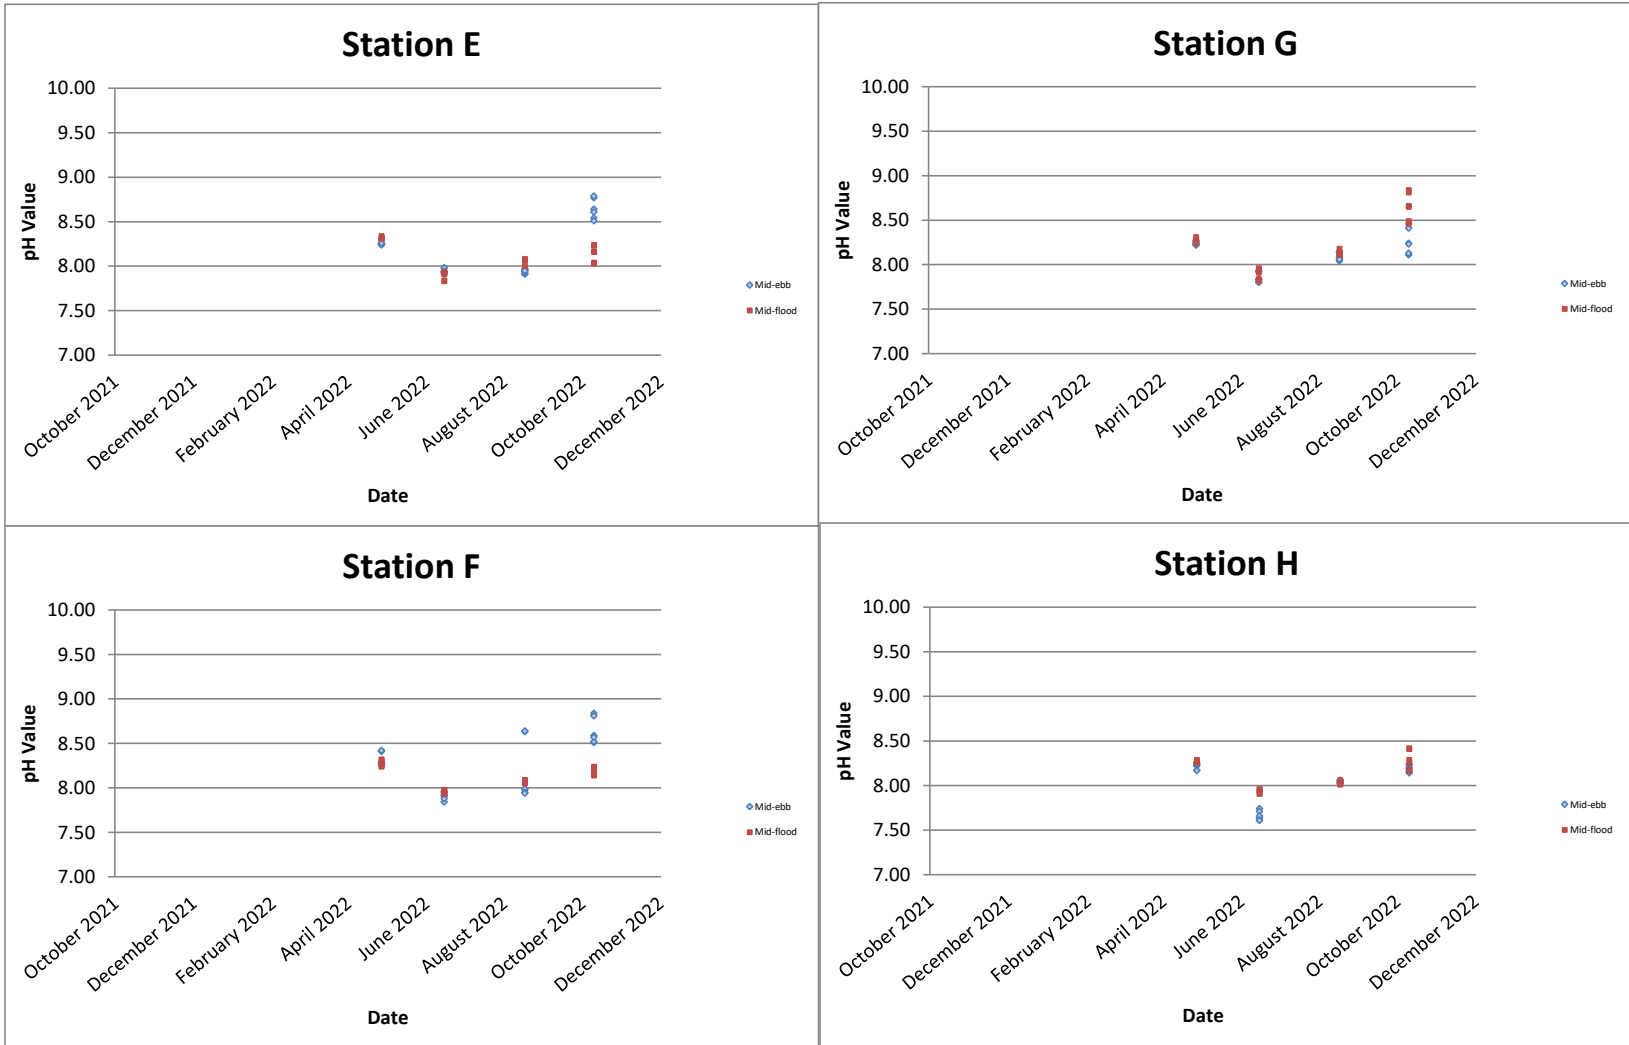





Salinity (ppt)

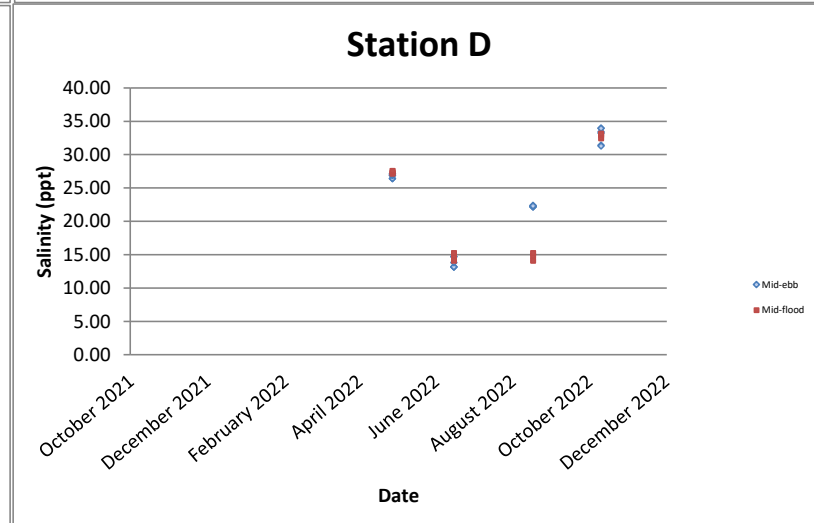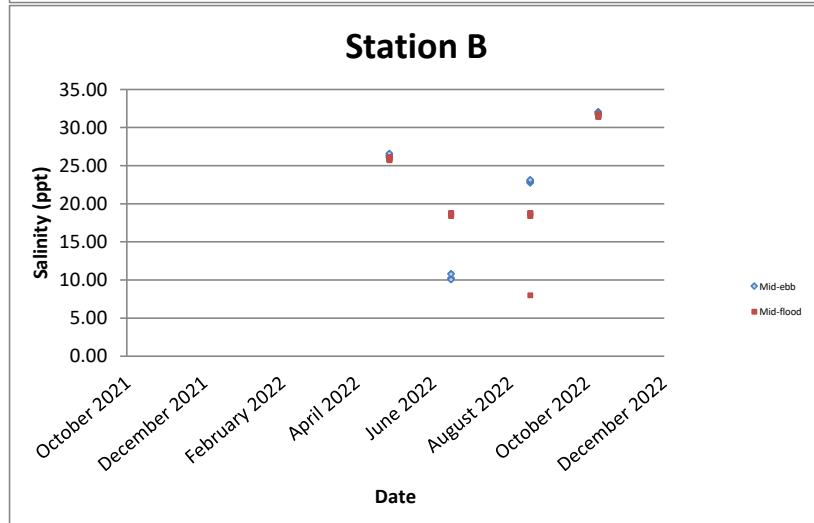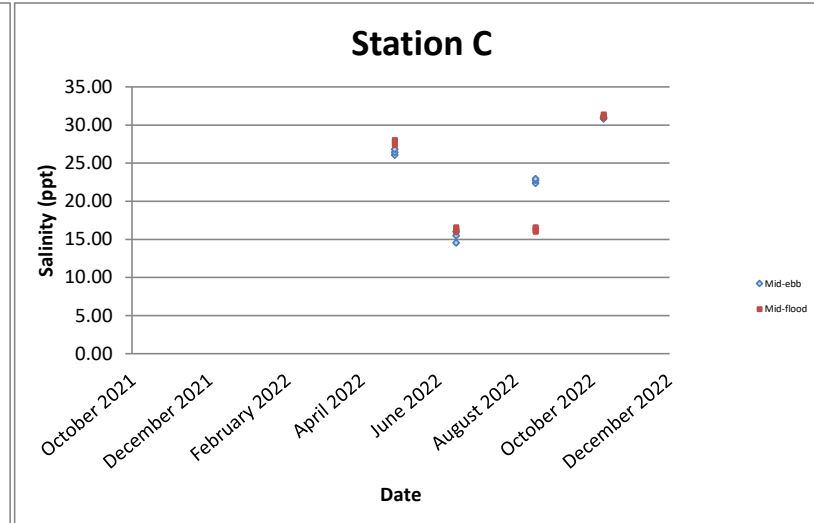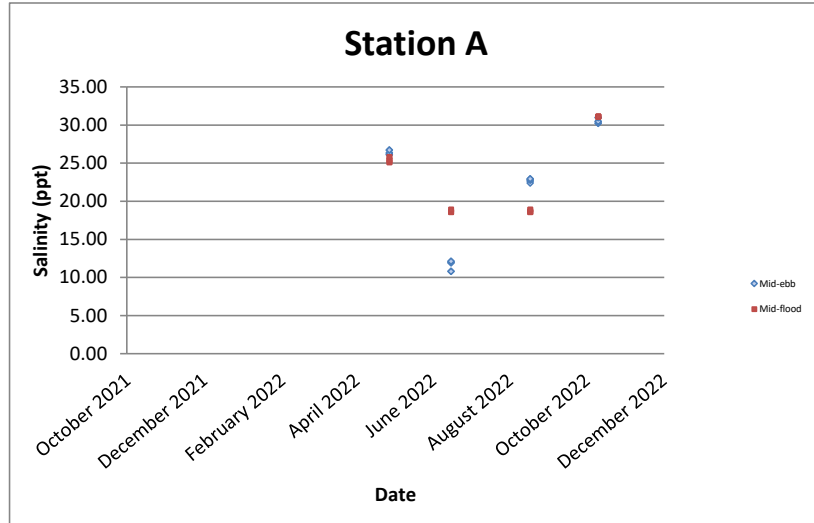


Salinity (ppt)

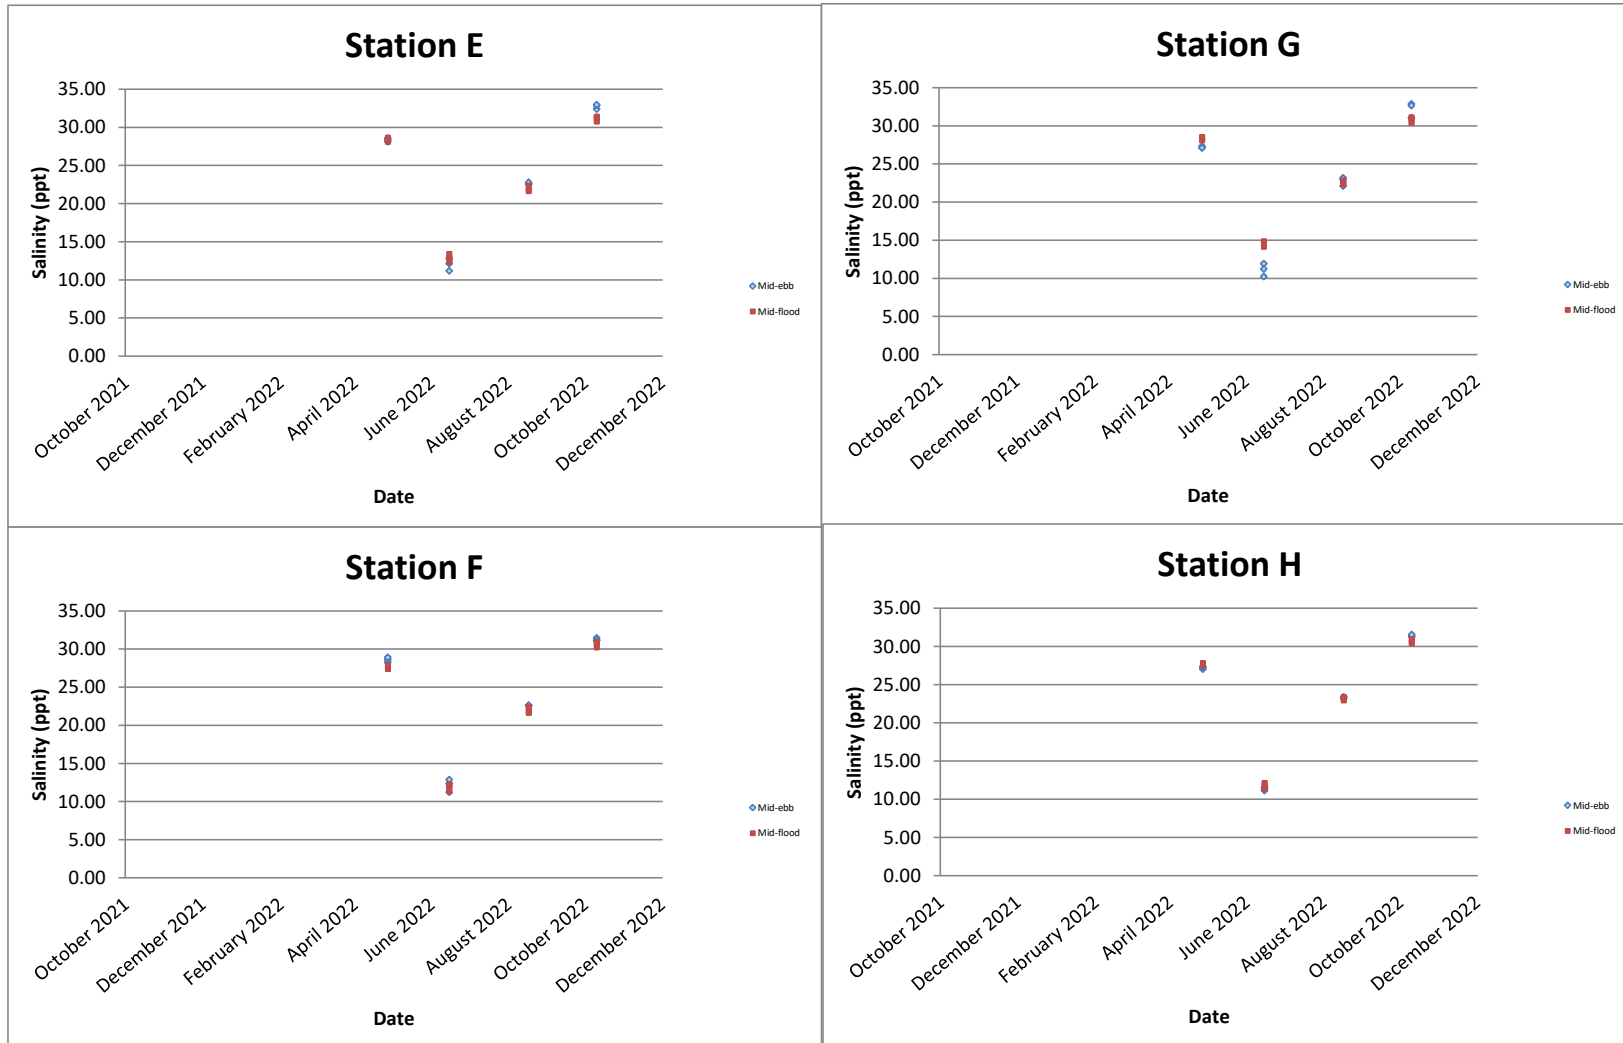





Temperature (degree C)

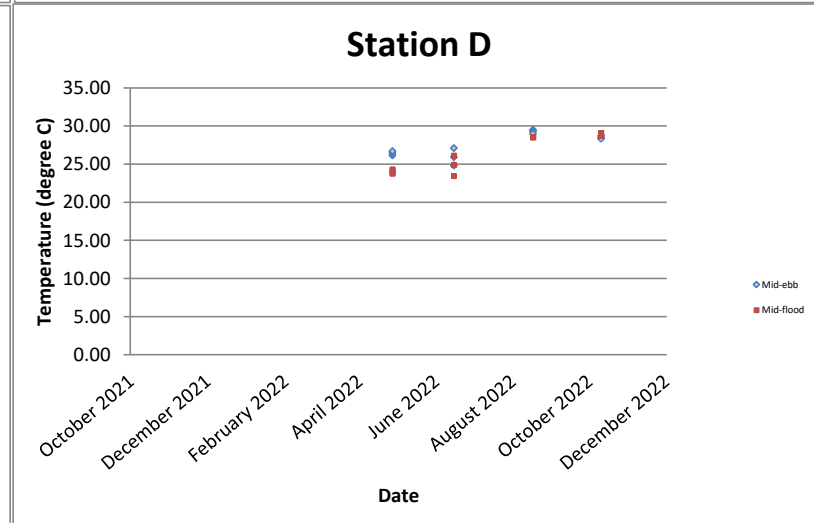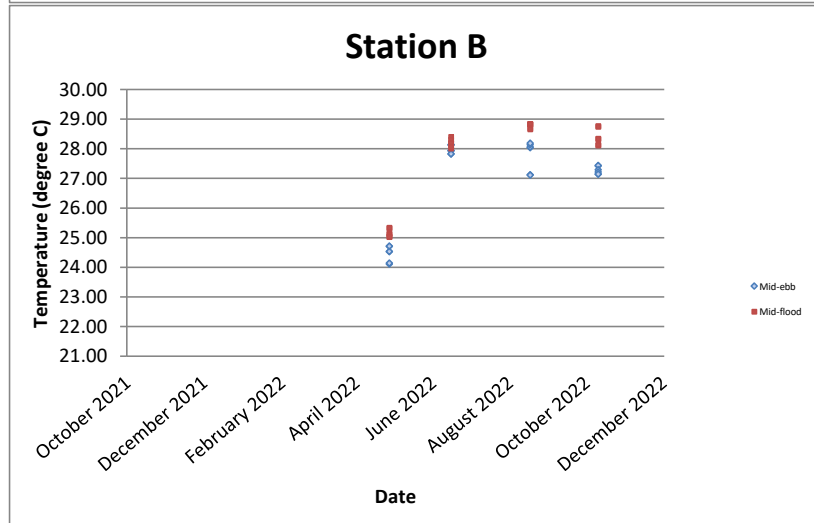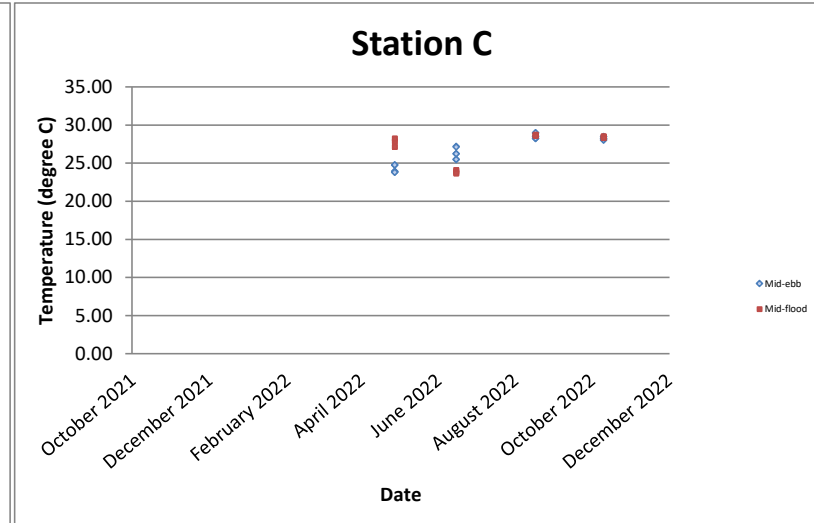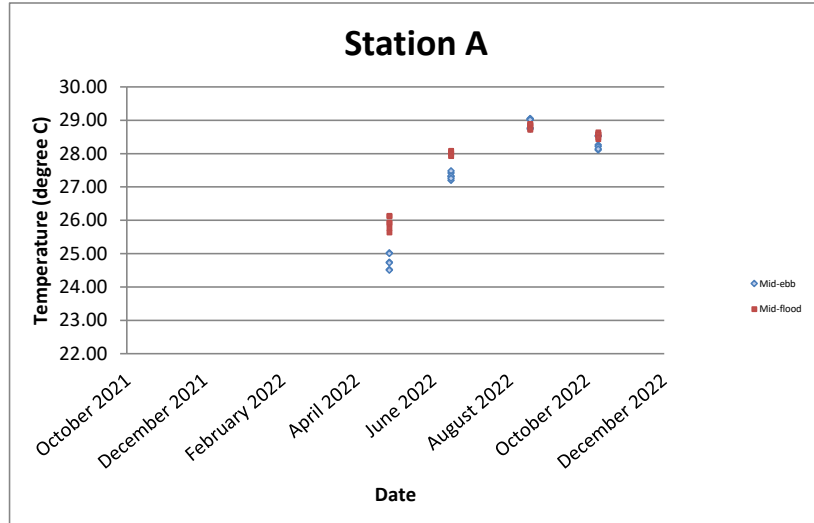

Temperature (degree C)

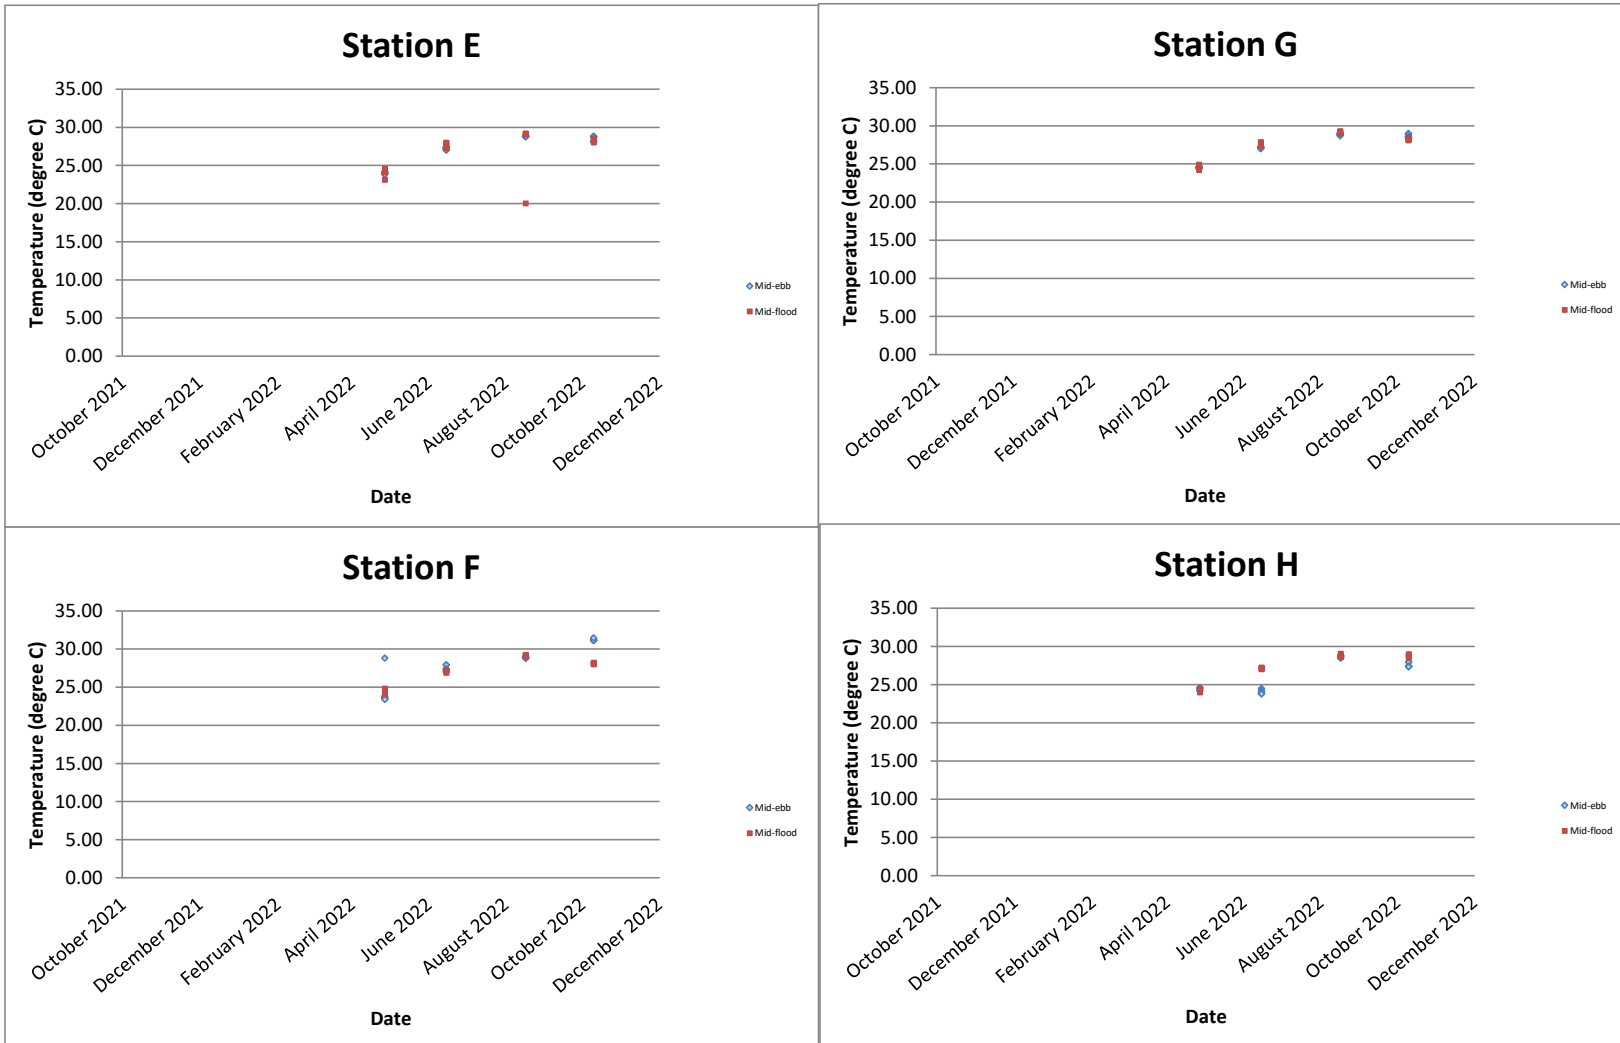


Dissolved oxygen (mg/L)

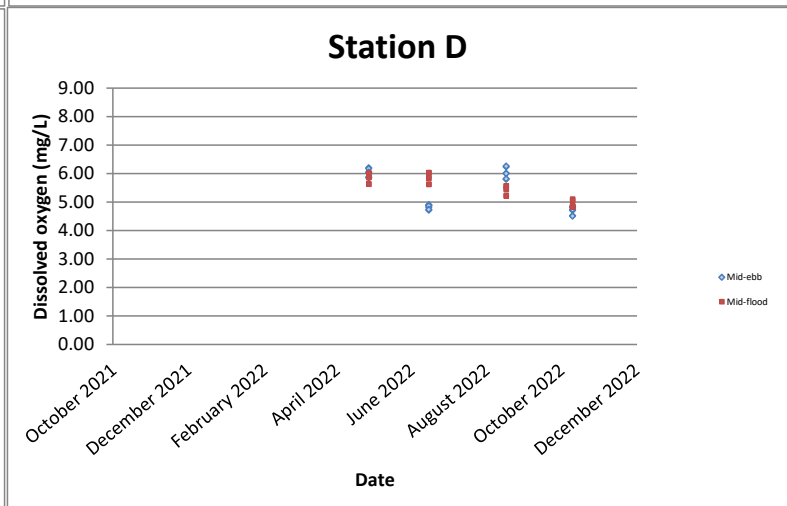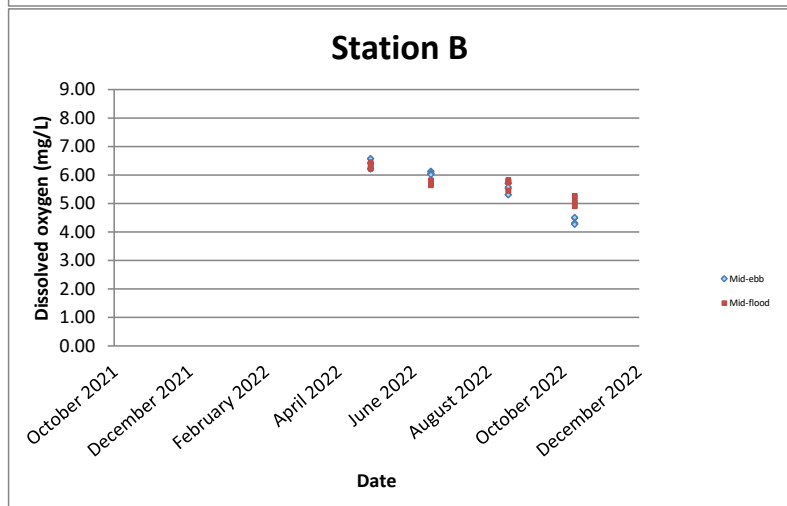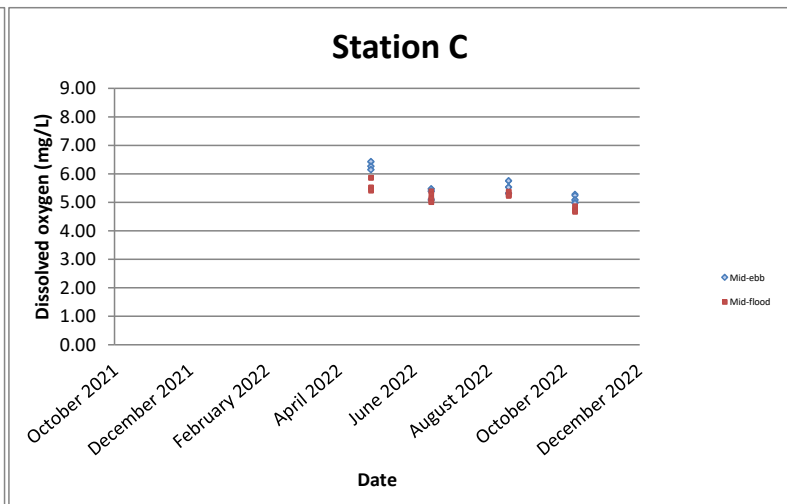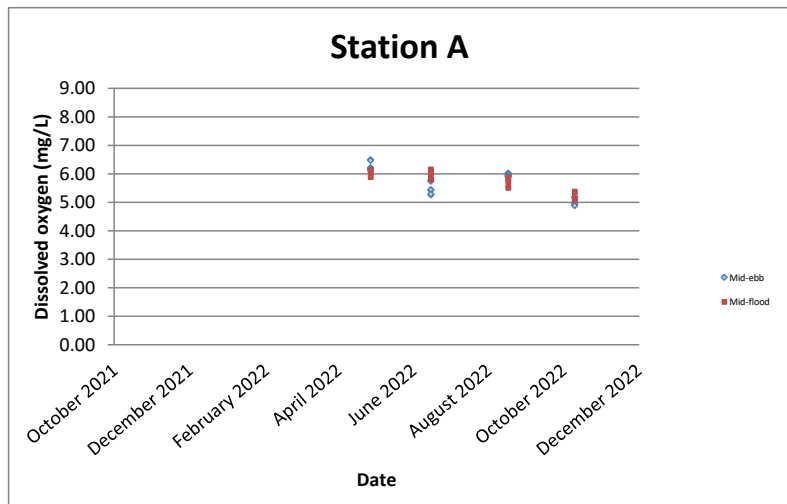





Dissolved oxygen (mg/L)

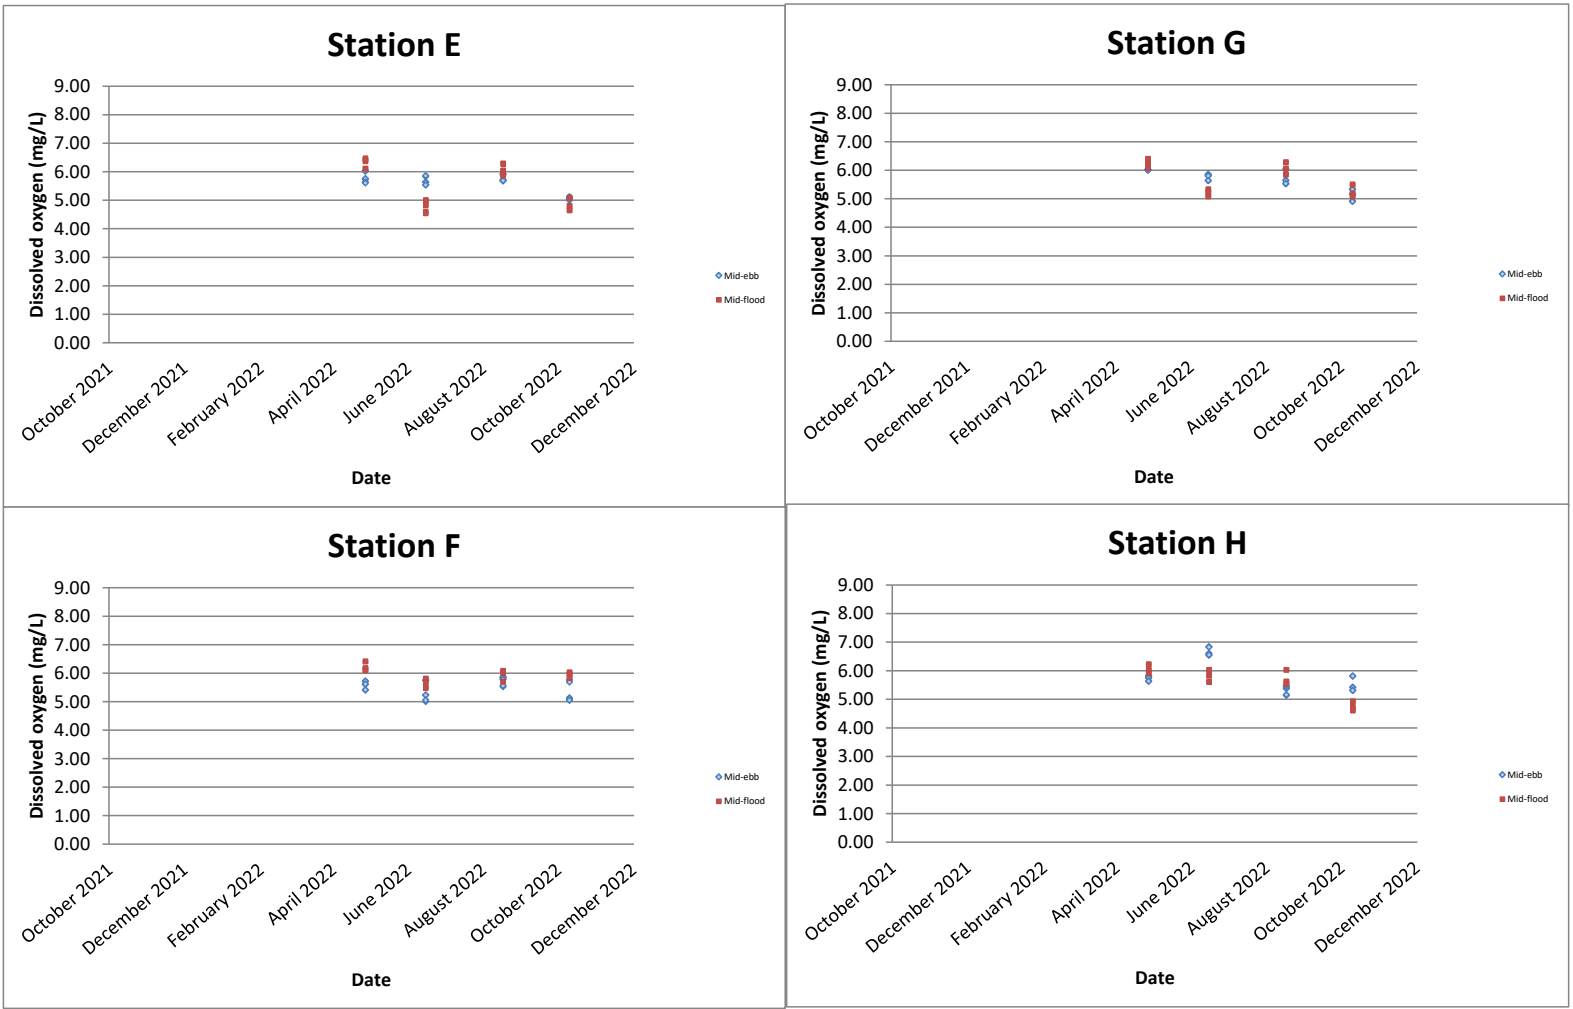


# Turbidity (NTU)

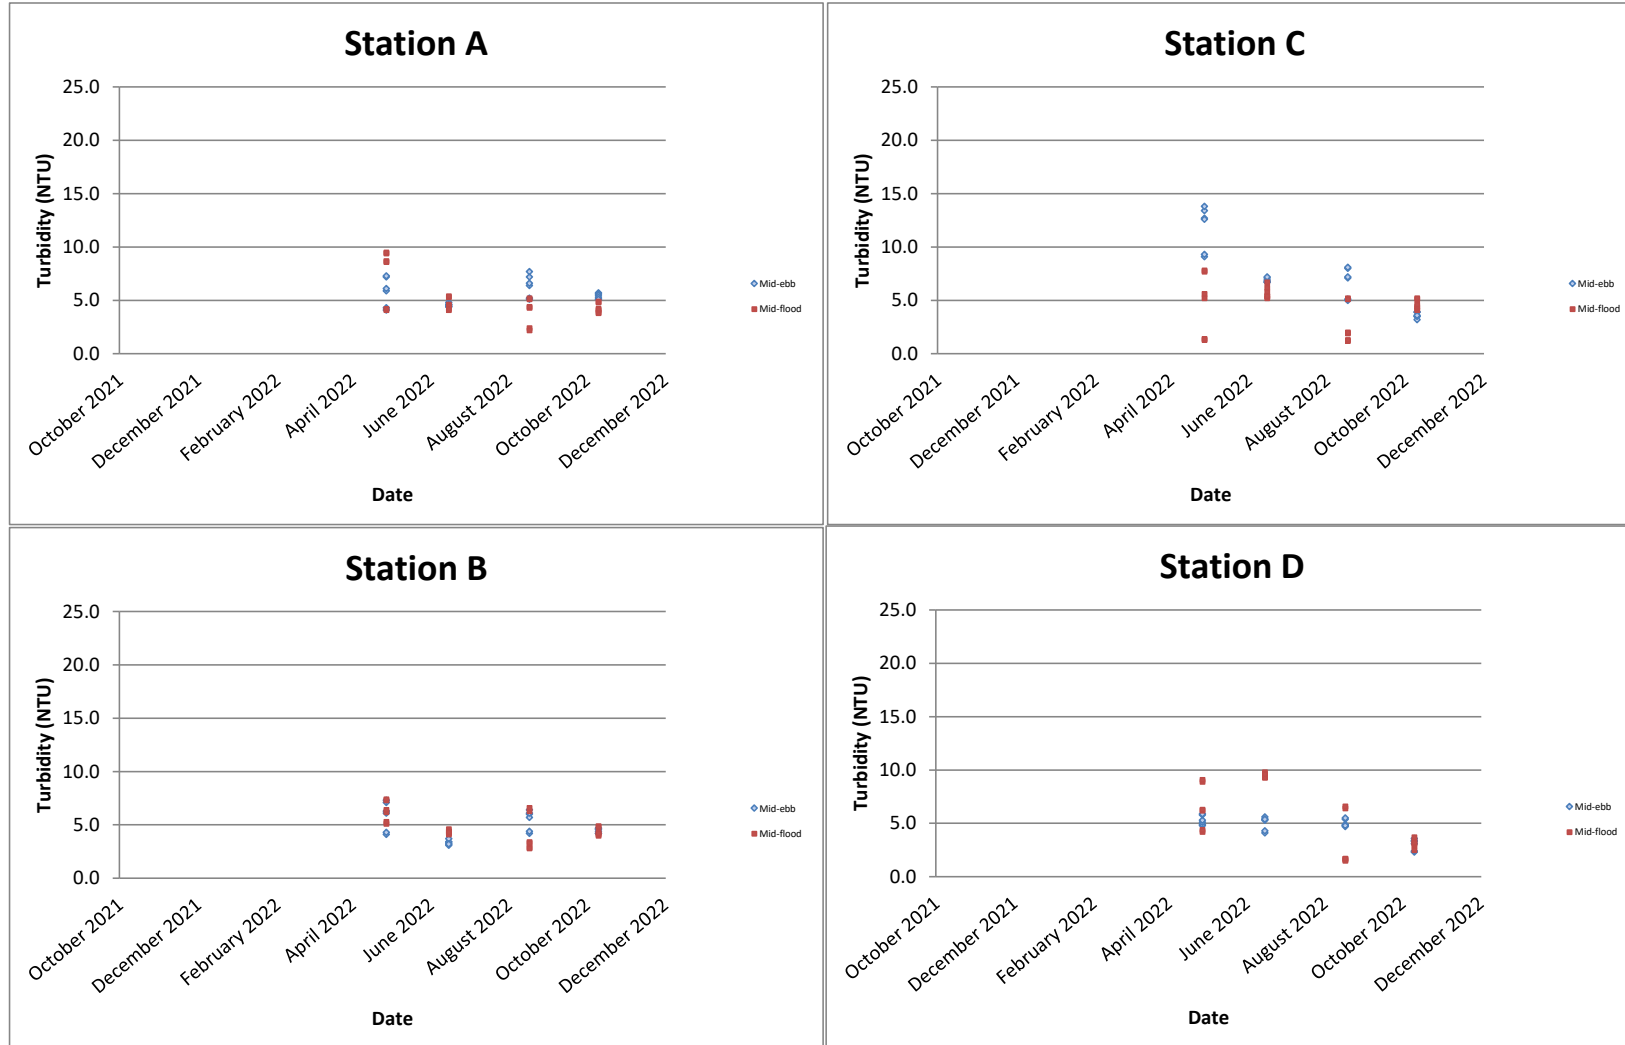

Turbidity (NTU)

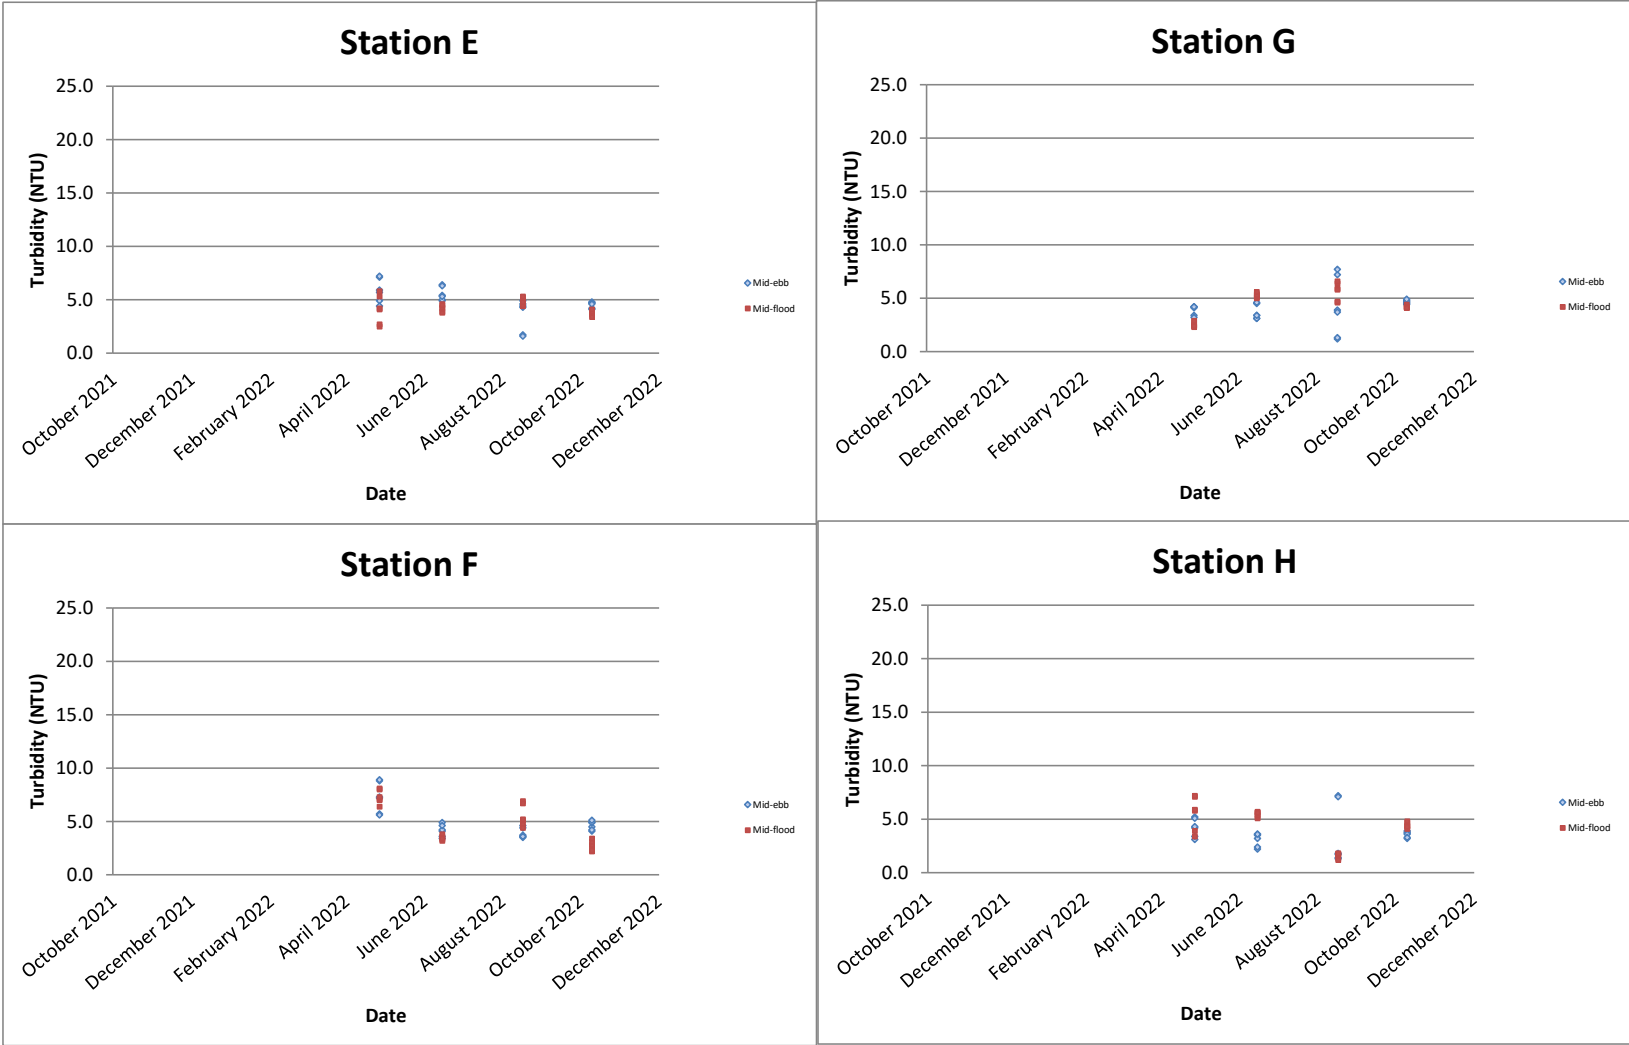


Total Suspended Solids (mg/L)

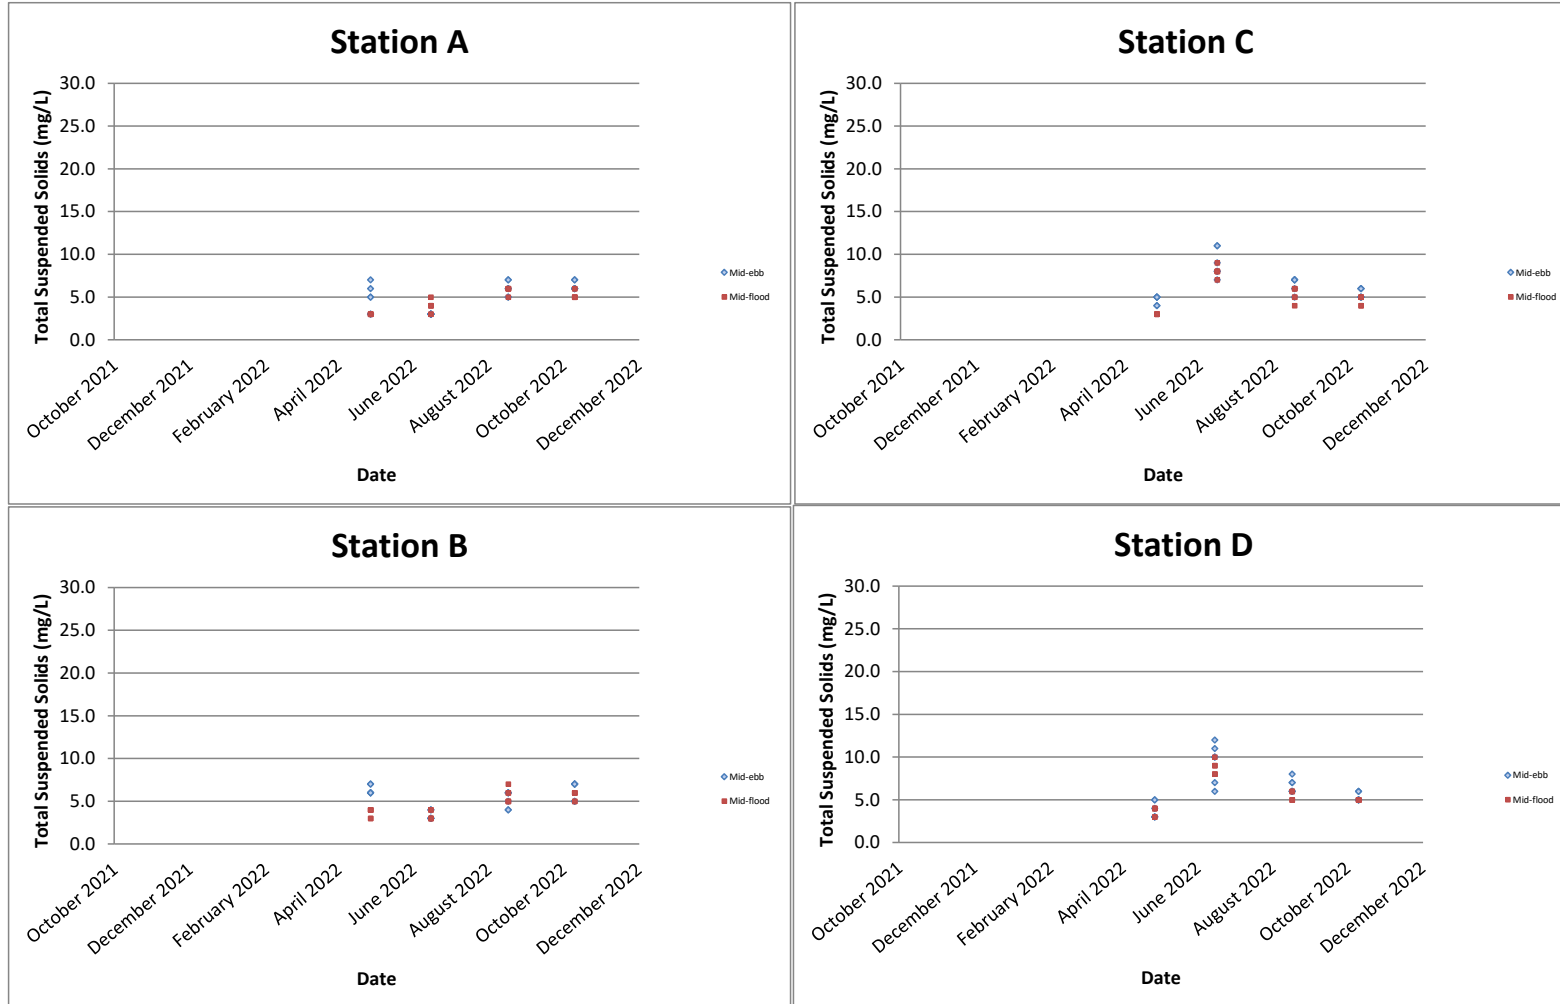





Remark: All below the Limit of Report sample results (<0.5 mg/L) for Total Suspended Solids is regarded as 0.5 mg/L in graphical presentation.

Total Suspended Solids (mg/L)

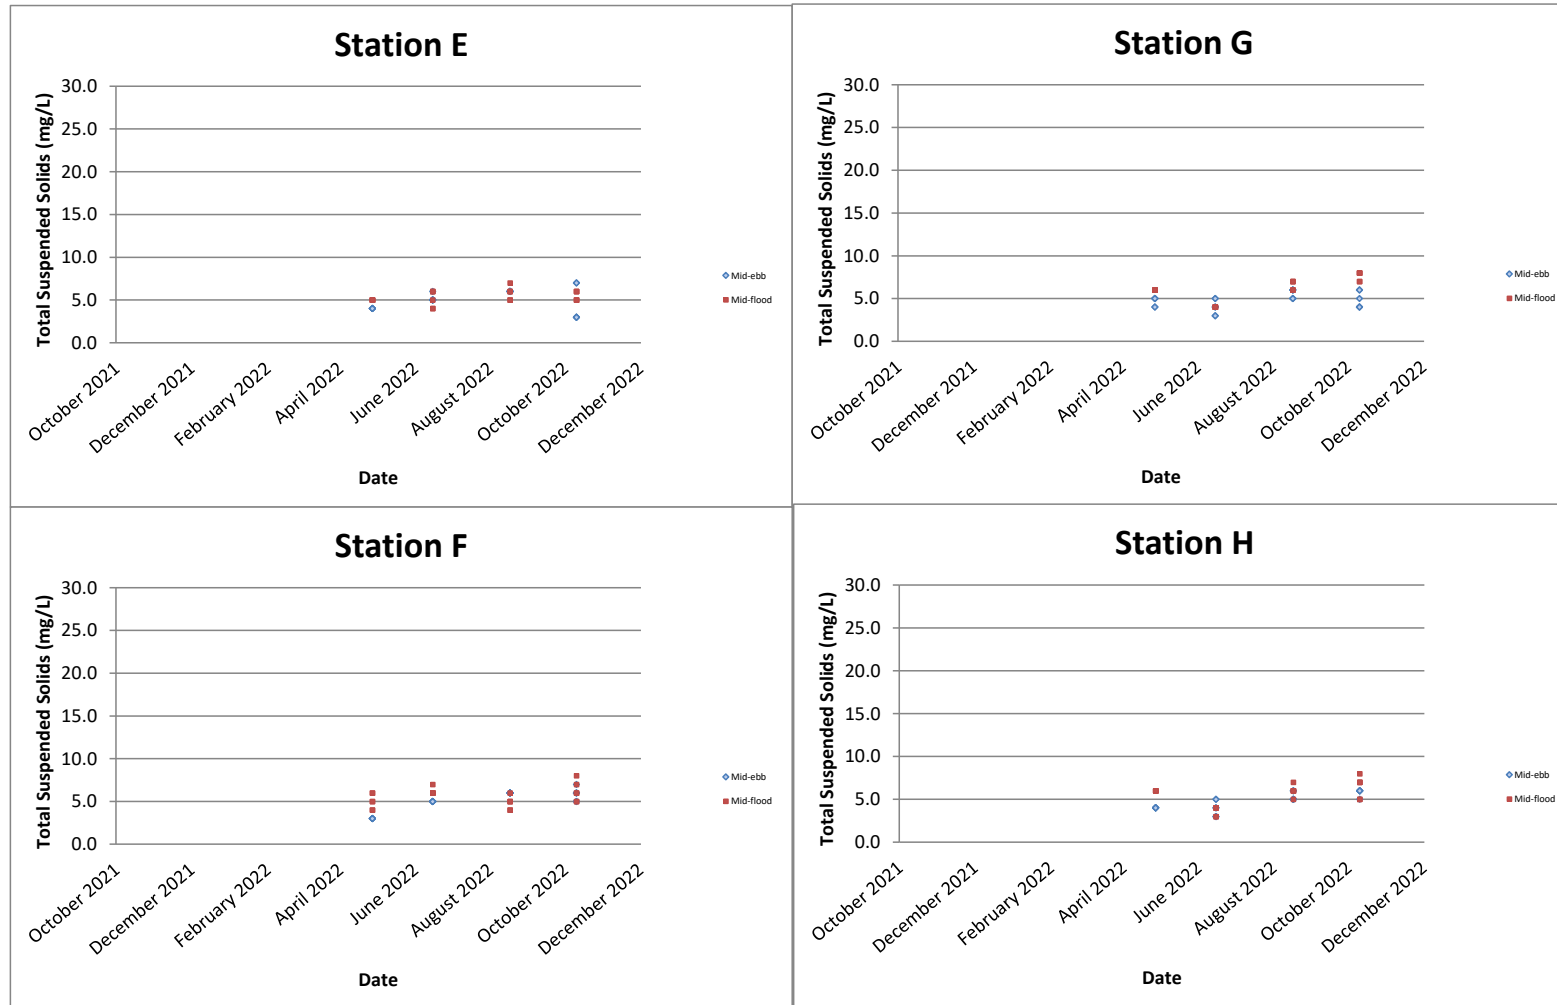


Remark: All below the Limit of Report sample results (<0.5 mg/L) for Total Suspended Solids is regarded as 0.5 mg/L in graphical presentation.

Ammonia Nitrogen (mg/L-N)

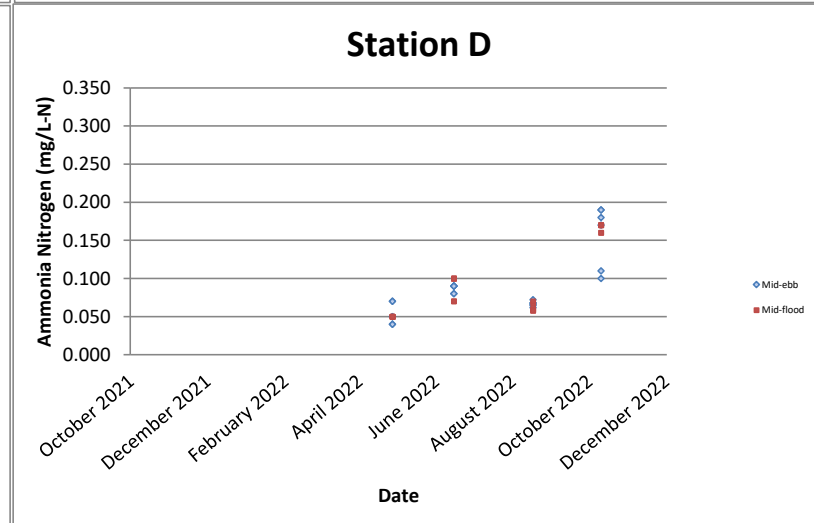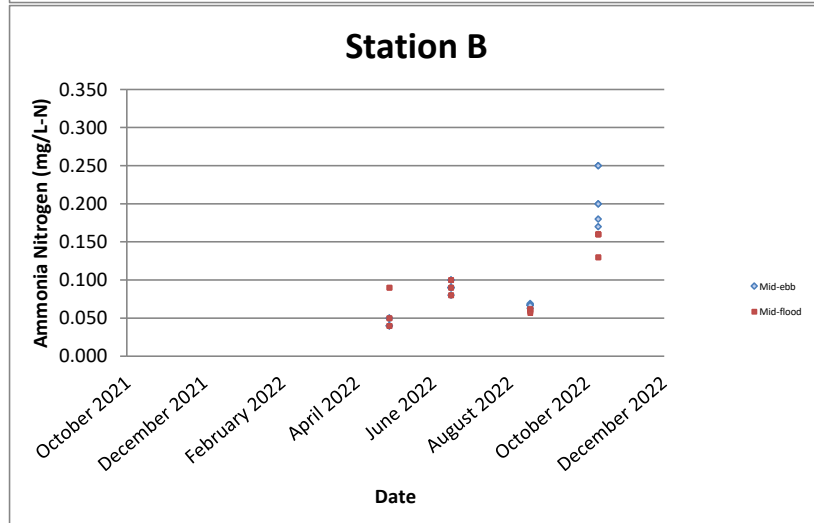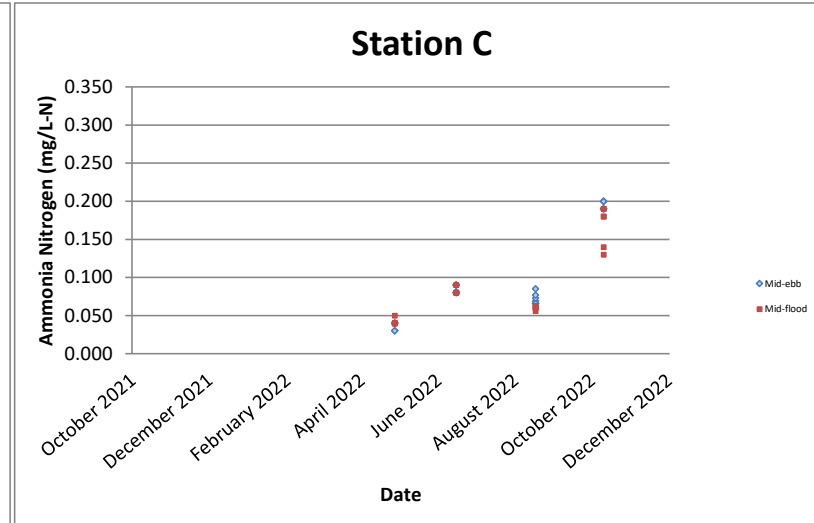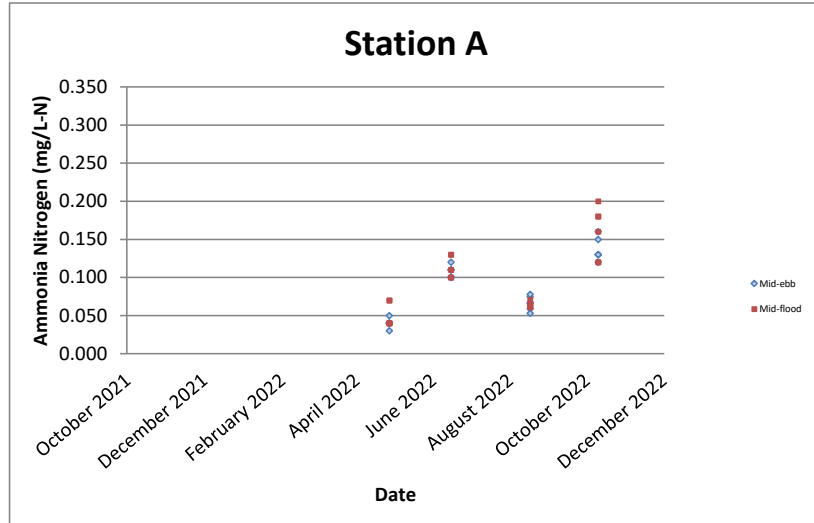





Remark: All below the Limit of Report sample results (<0.005 mg/L) for Ammonia Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Ammonia Nitrogen (mg/L-N)

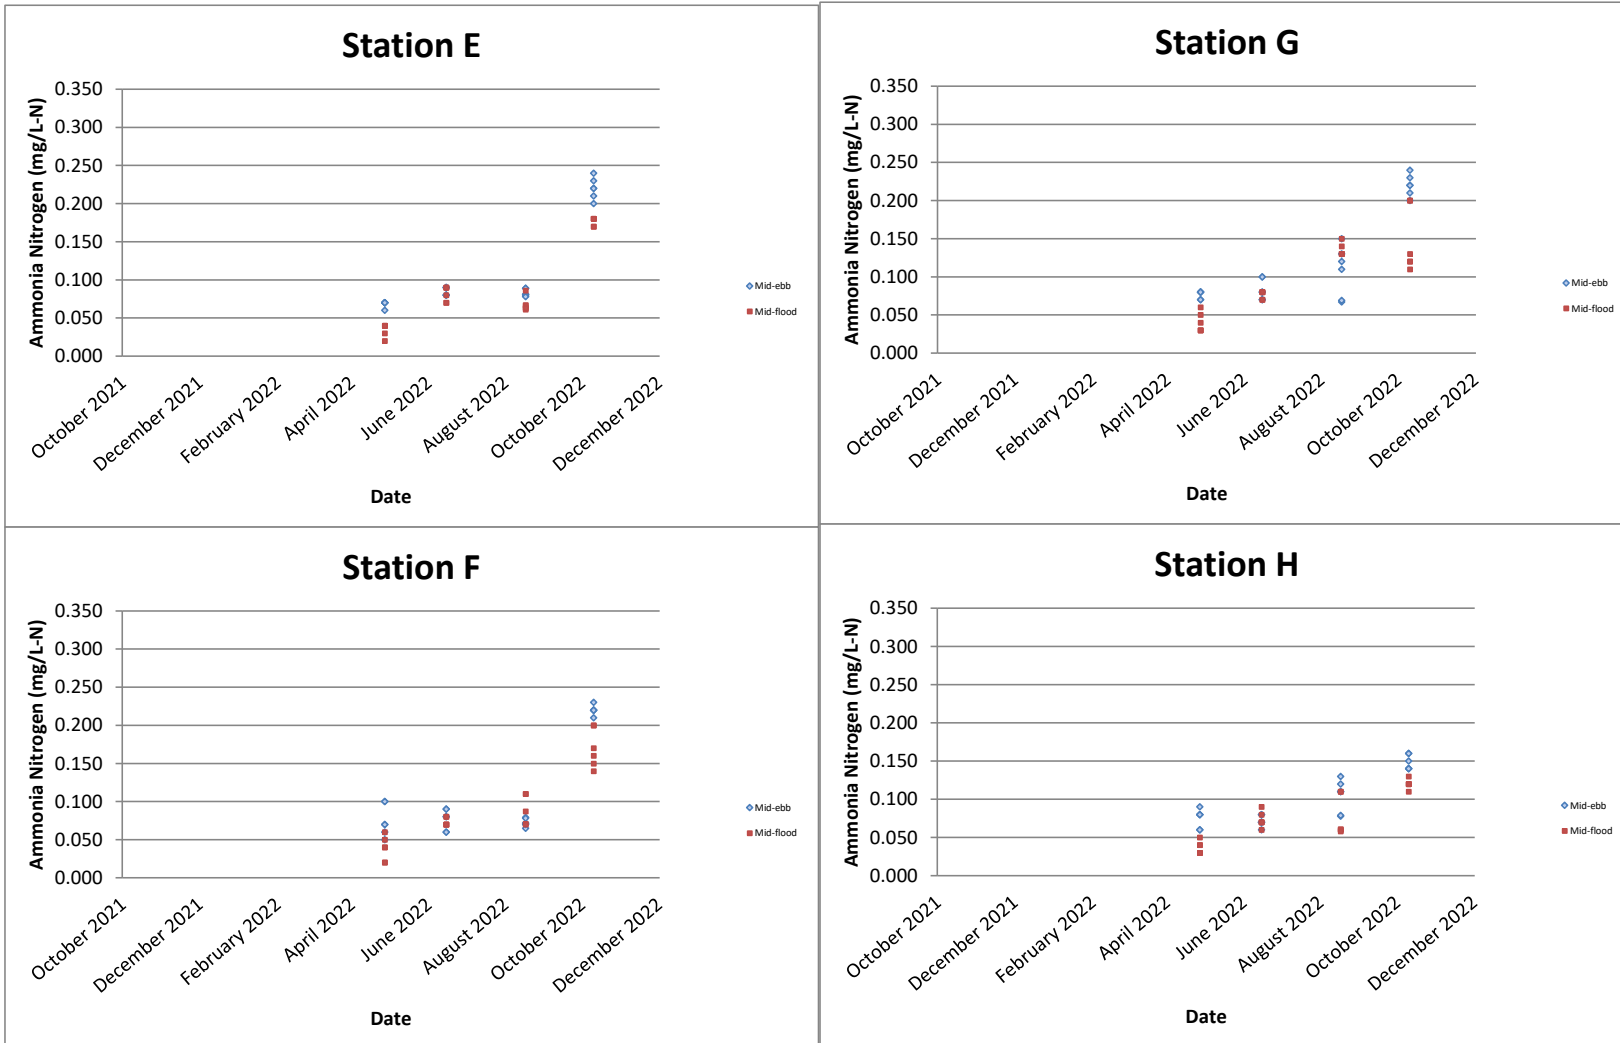

Remark: All below the Limit of Report sample results (<0.005 mg/L) for Ammonia Nitrogen is regarded as 0.005 mg/L in graphical presentation.


Nitrite Nitrogen (mg/L-N)

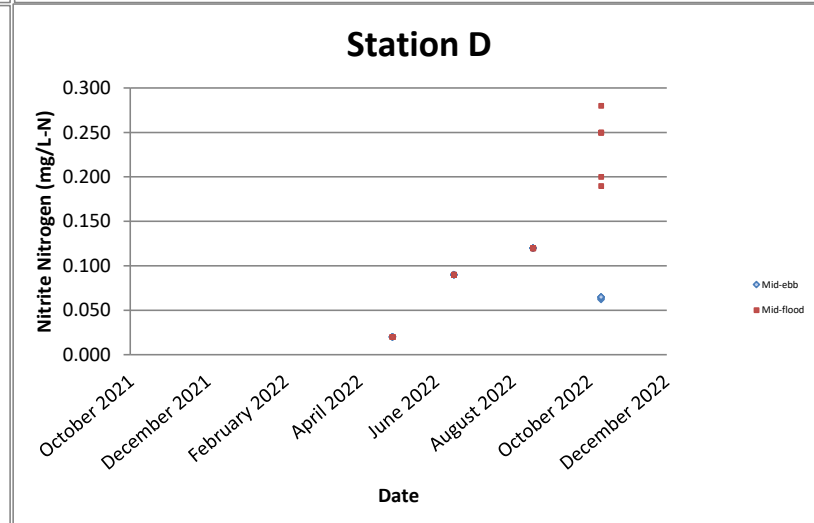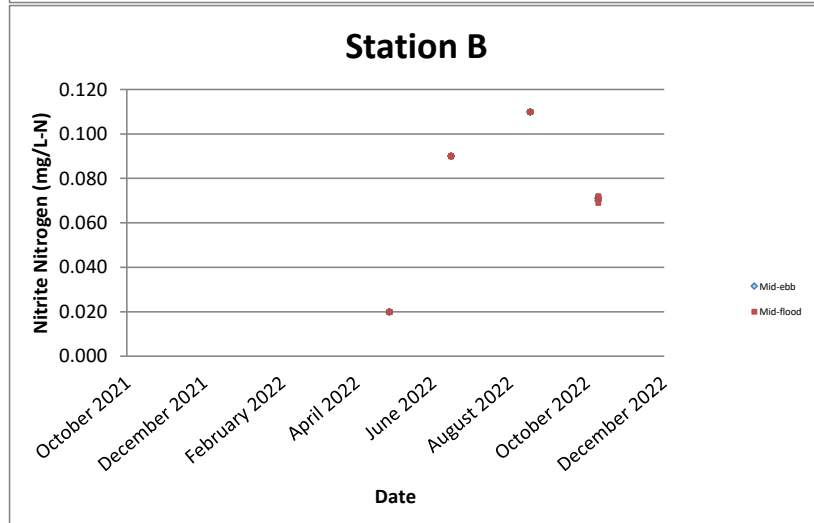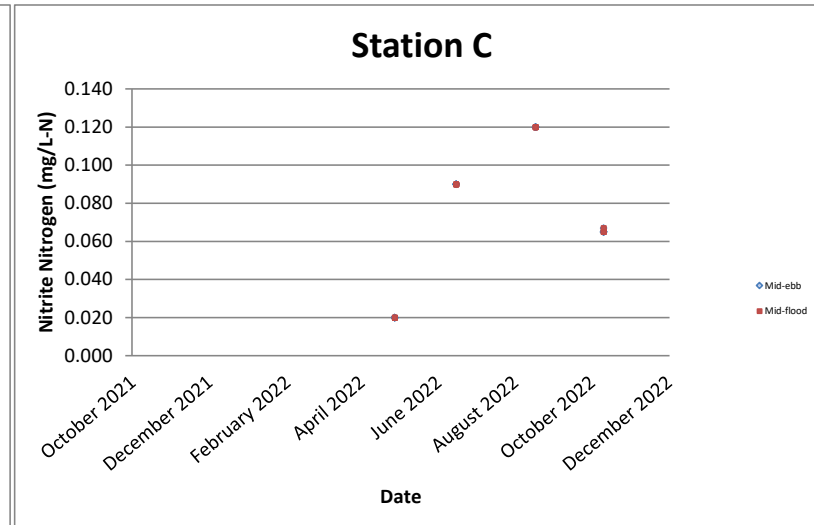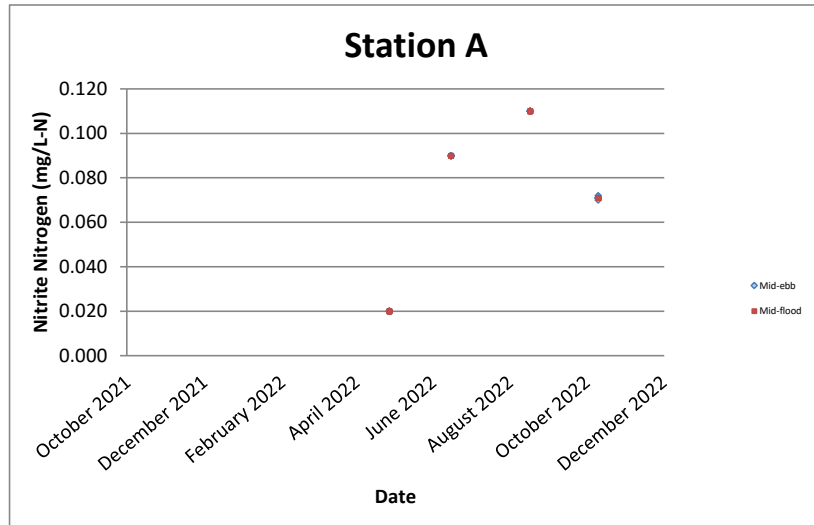

Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrite Nitrogen is regarded as 0.005 mg/L in graphical presentation.




Nitrite Nitrogen (mg/L-N)

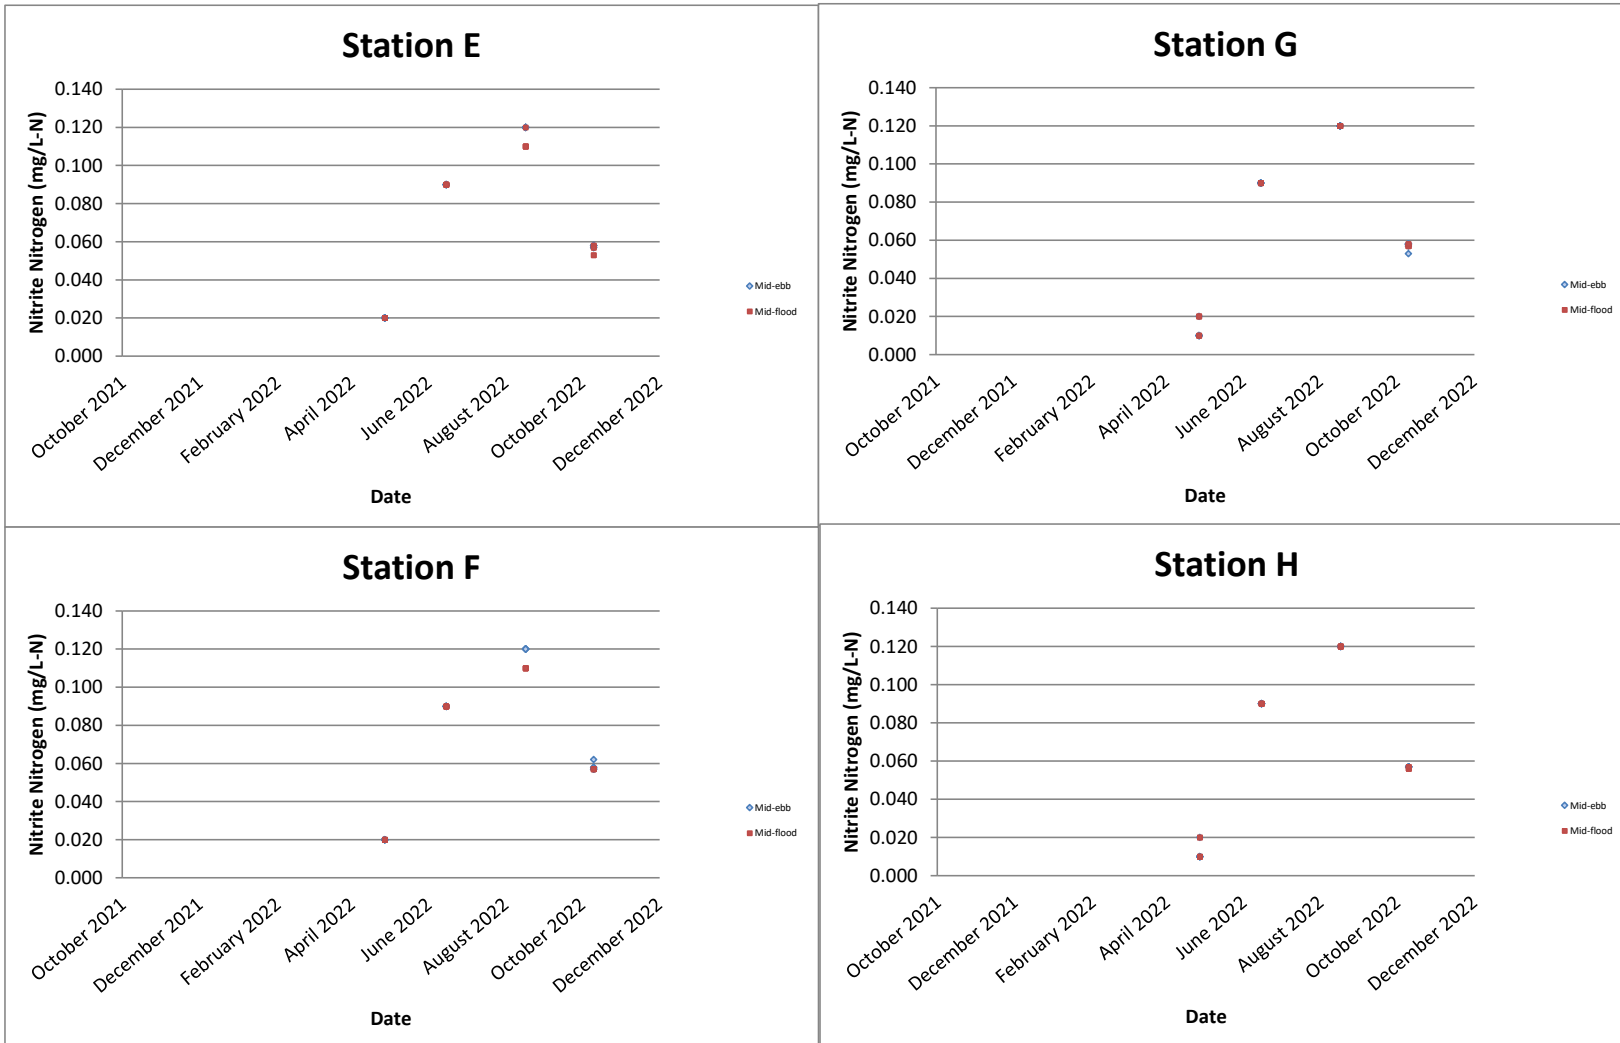


Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrite Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Nitrate Nitrogen (mg/L-N)

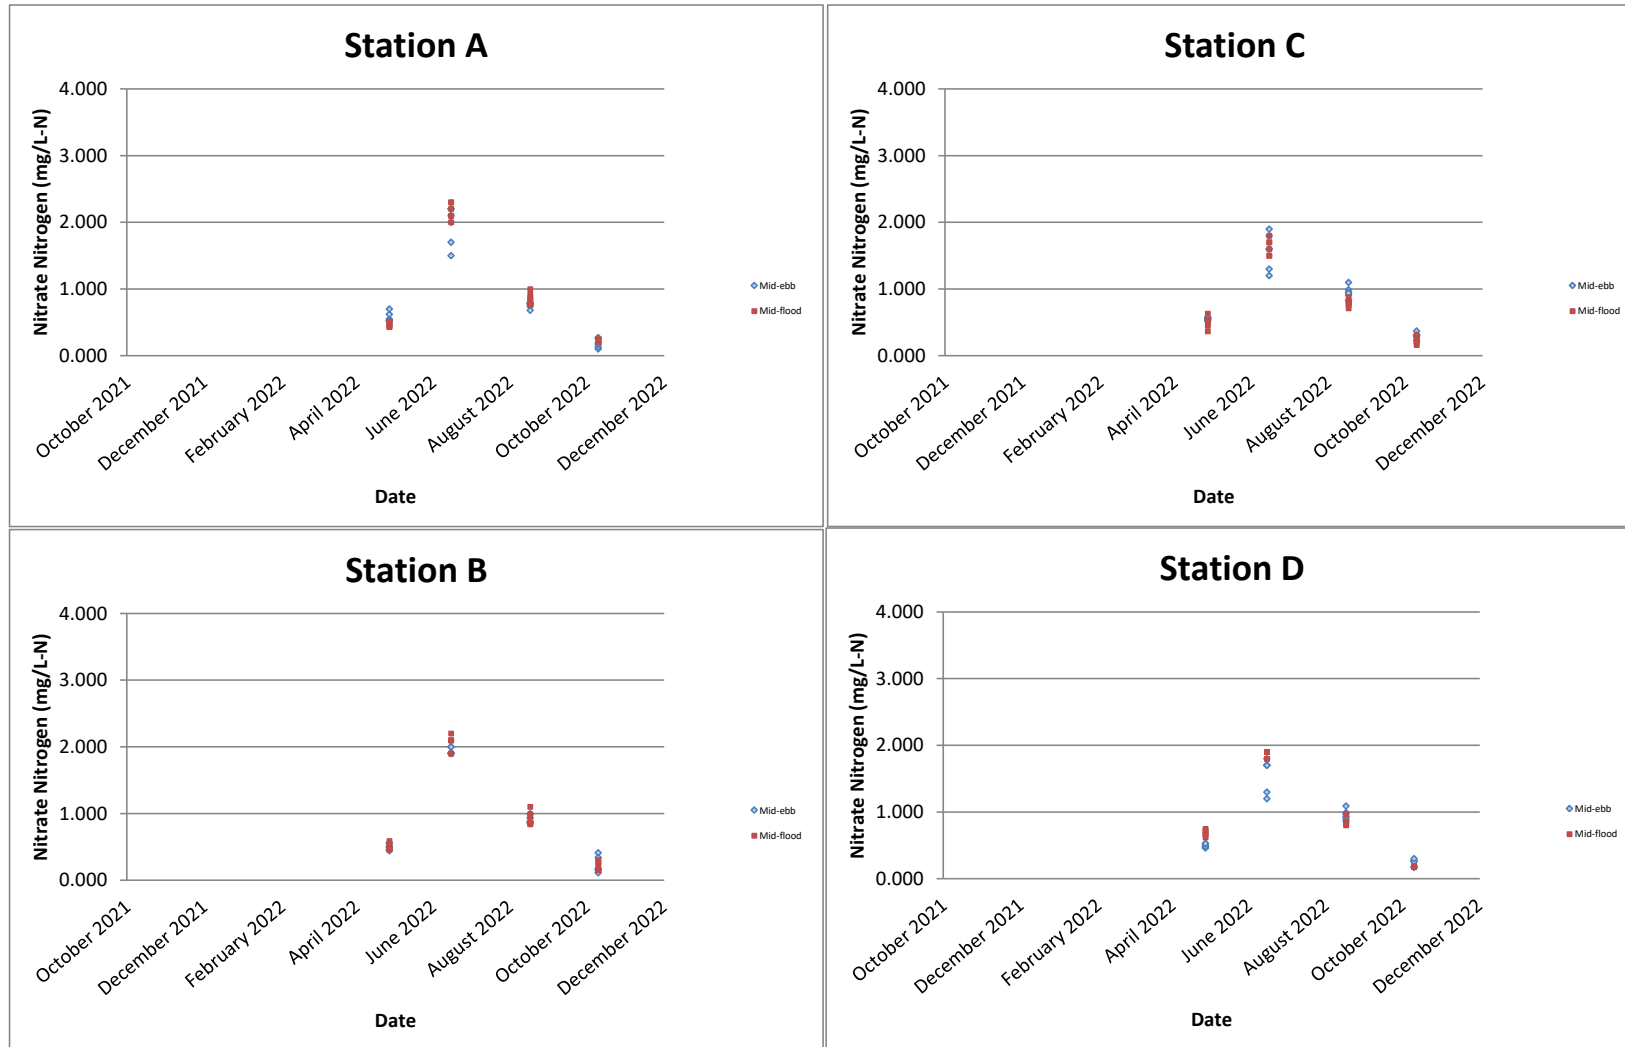





Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrate Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Nitrate Nitrogen (mg/L-N)

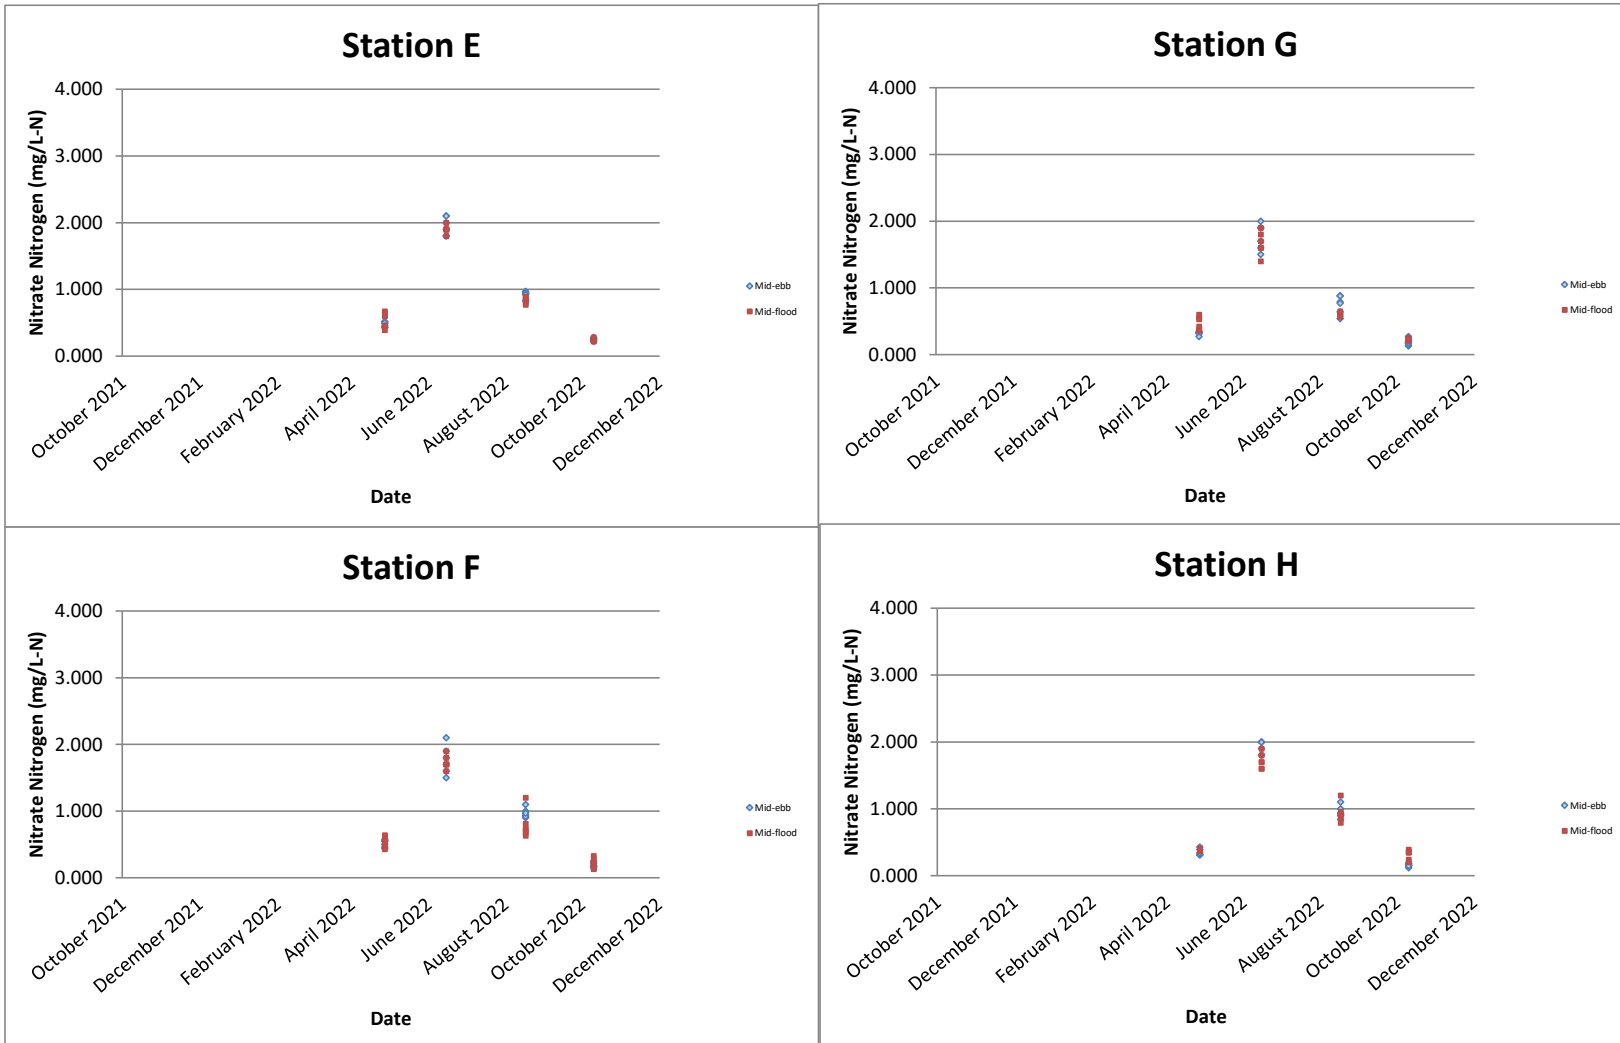


Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrate Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Total Inorganic Nitrogen (mg/L-N)

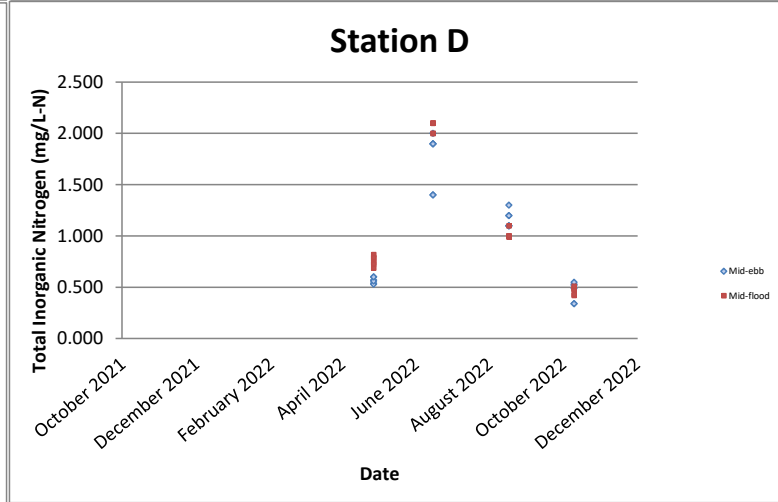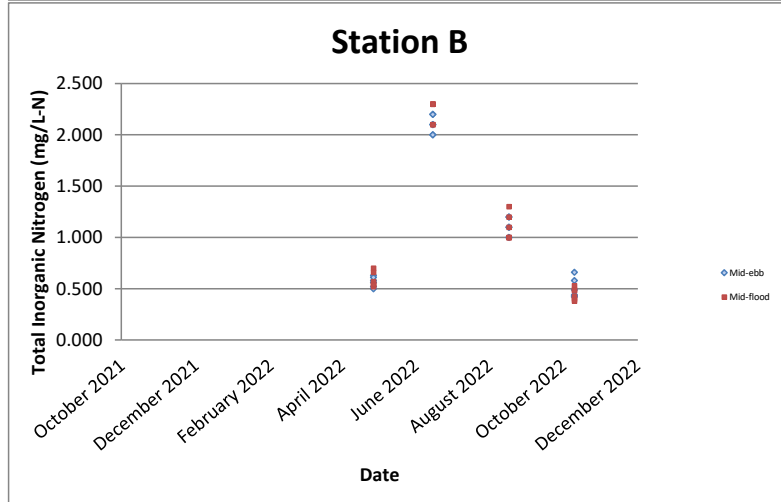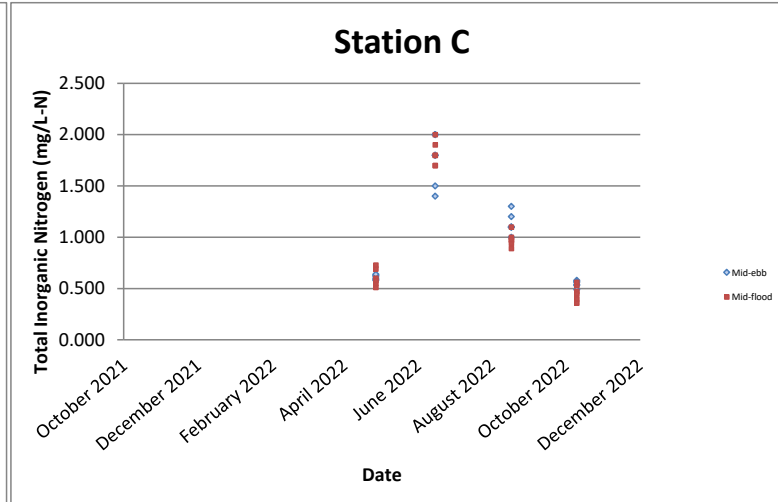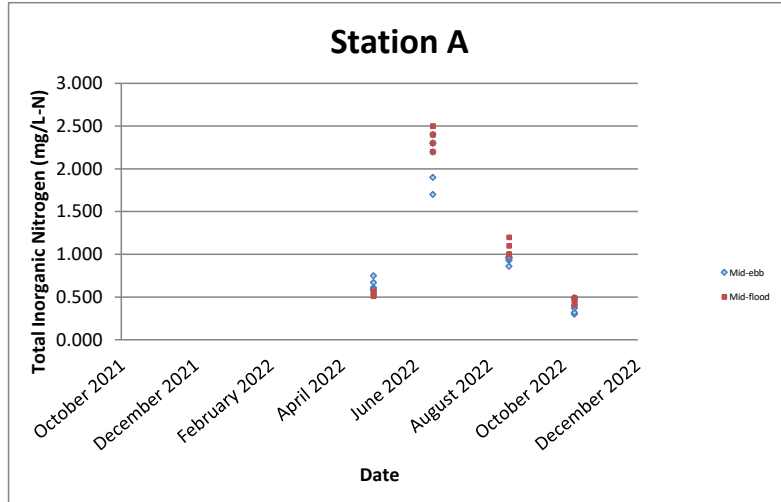


Remark: All below the Limit of Report sample results (<0.010 mg/L) for Total Inorganic Nitrogen is regarded as 0.010 mg/L in graphical presentation.

Total Inorganic Nitrogen (mg/L-N)

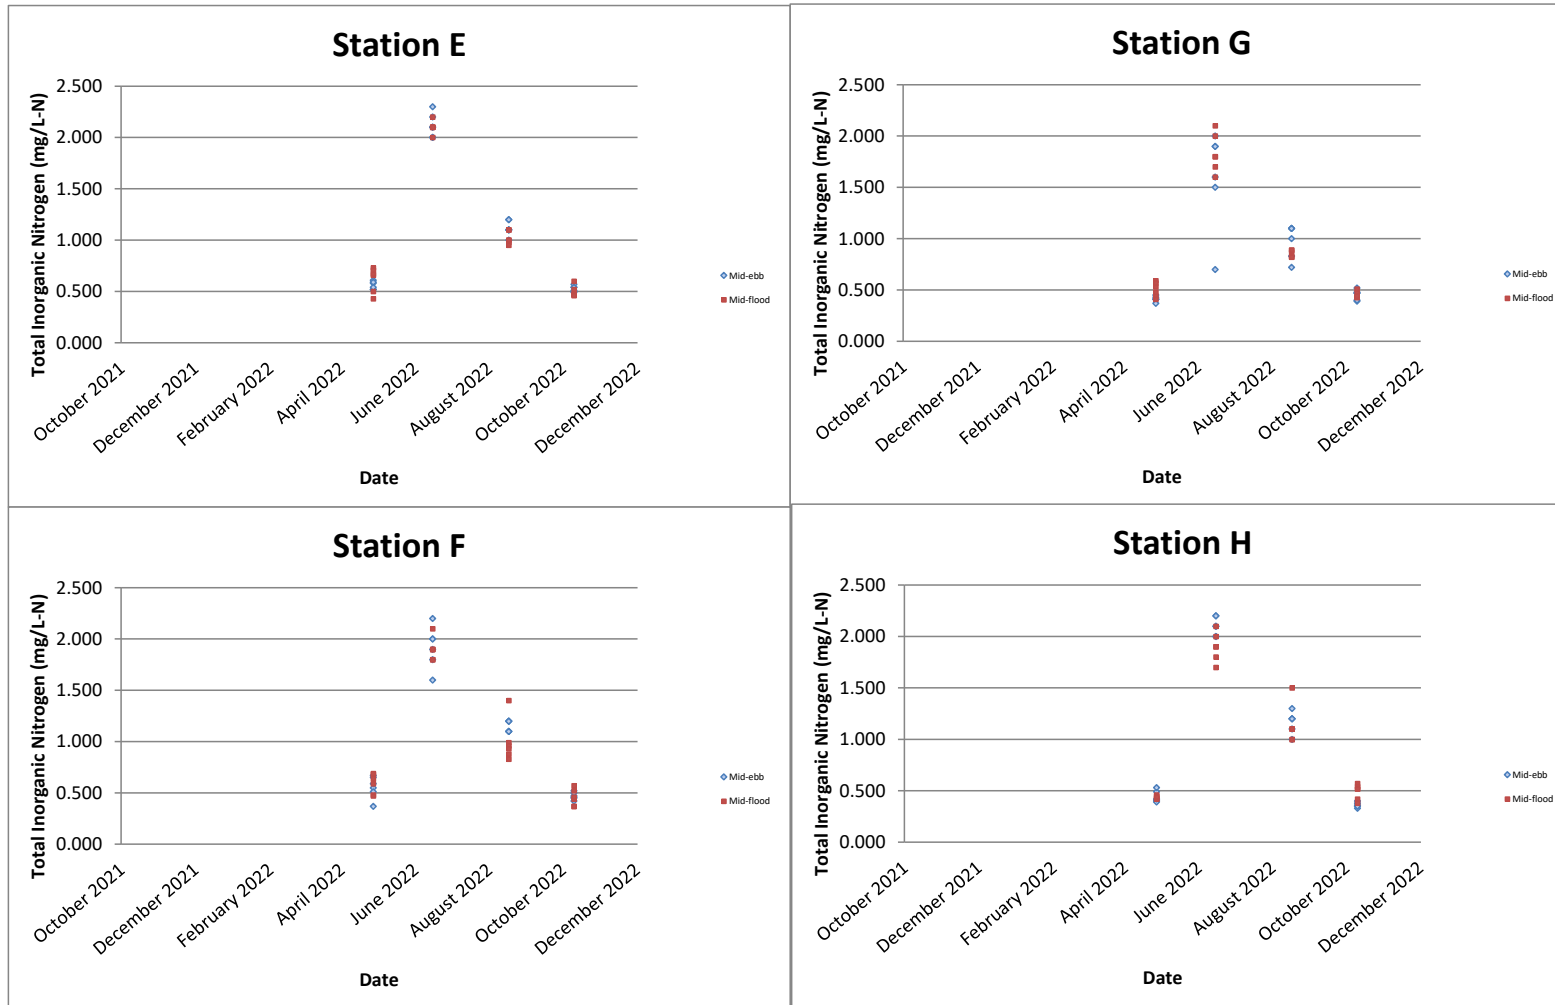


Remark: All below the Limit of Report sample results (<0.010 mg/L) for Total Inorganic Nitrogen is regarded as 0.010 mg/L in graphical presentation.

E.coli (cfu/100mL)

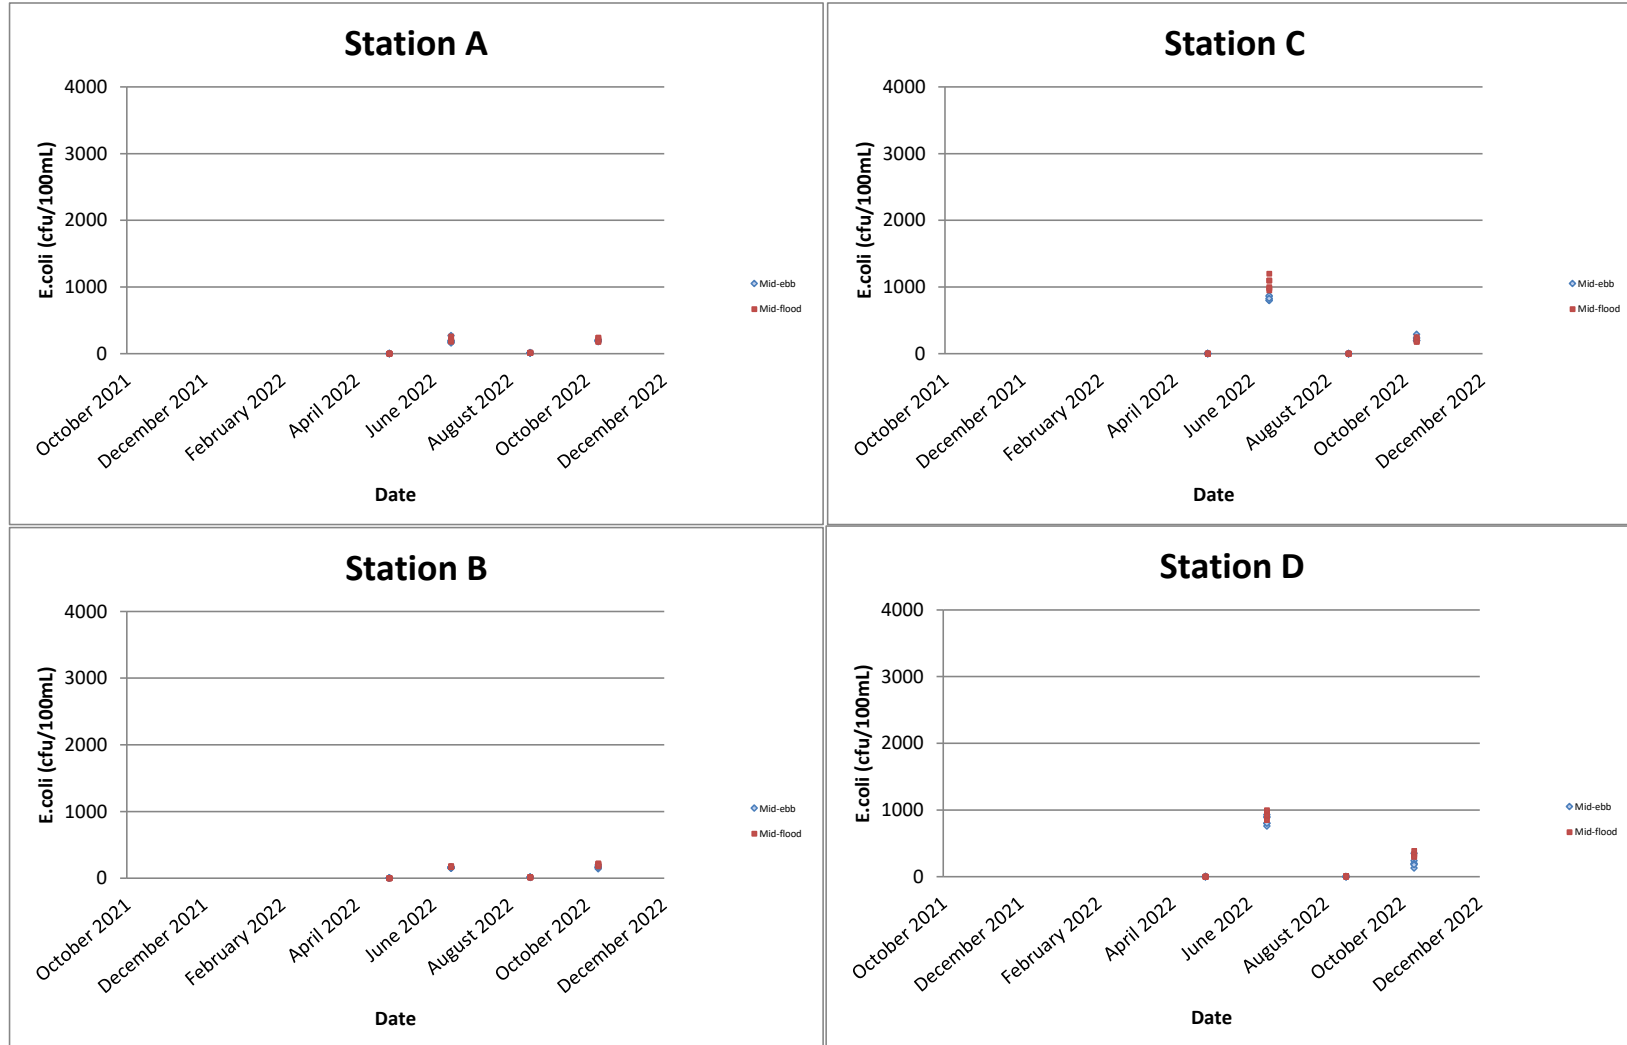


Remark: All below the Limit of Report sample results (<1 CFU/100mL) for E.coli is regarded as 1 CFU/100mL in graphical presentation.

E.coli (cfu/100mL)

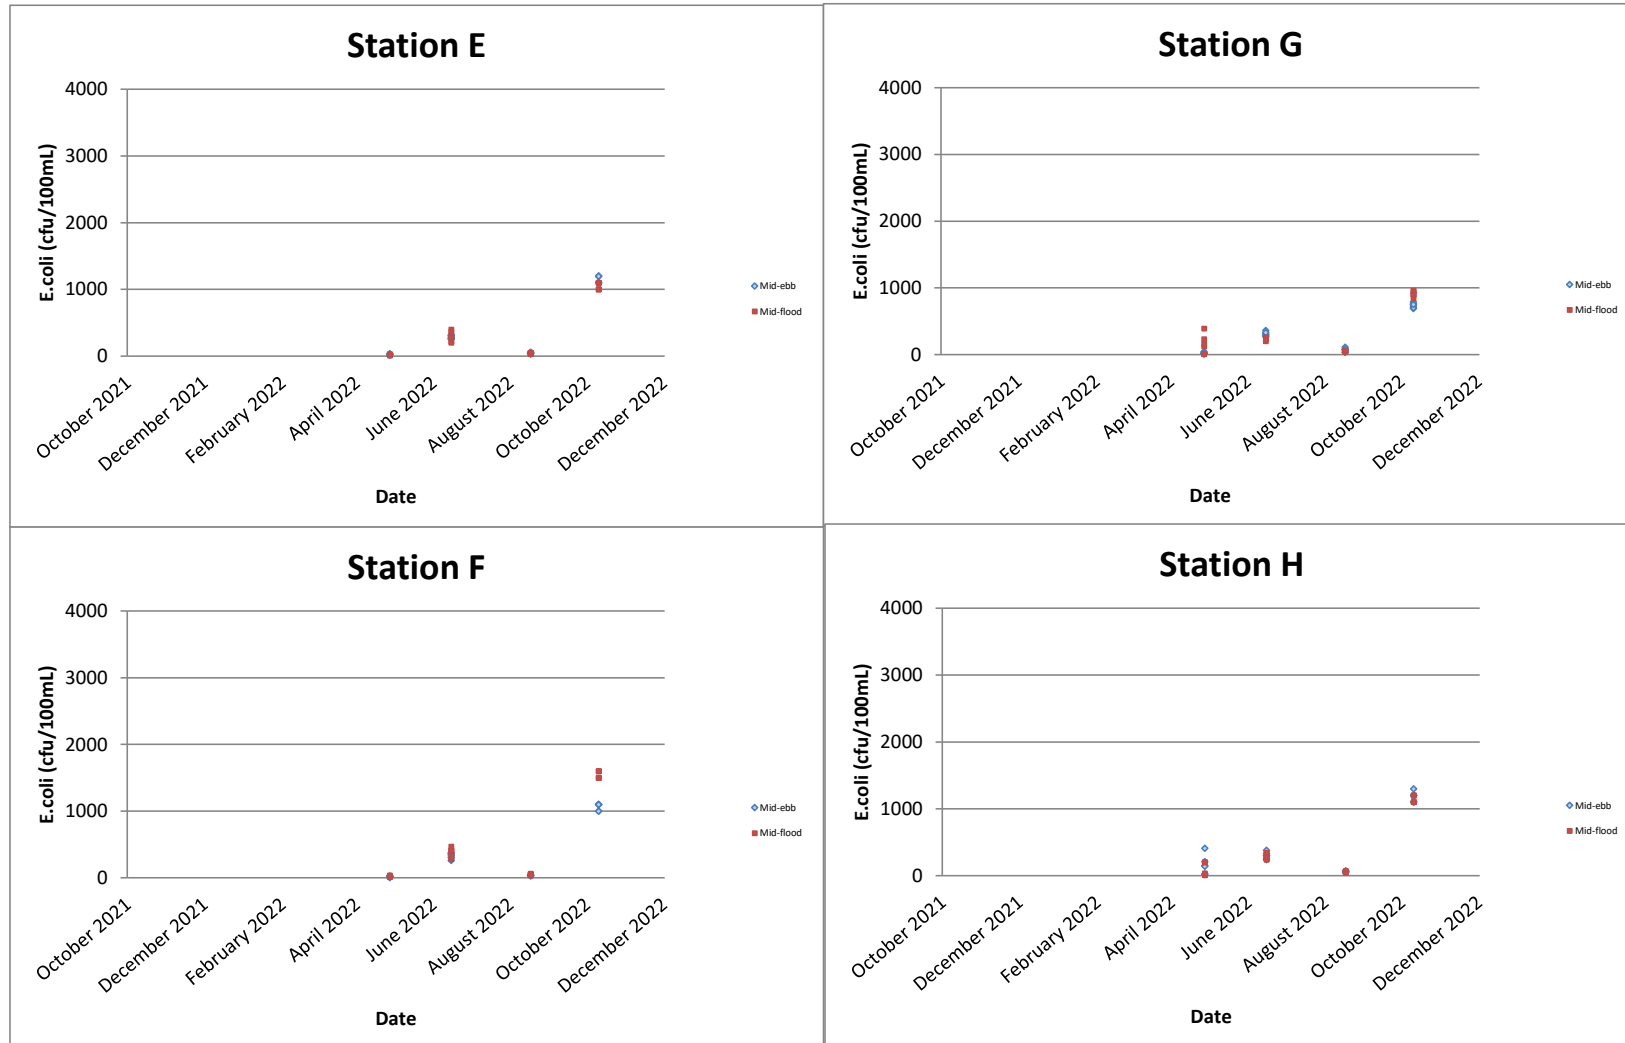

Remark: All below the Limit of Report sample results (<1 CFU/100mL) for E.coli is regarded as 1 CFU/100mL in graphical presentation.


Total Phosphorus (soluble and particulate) (mg/L)

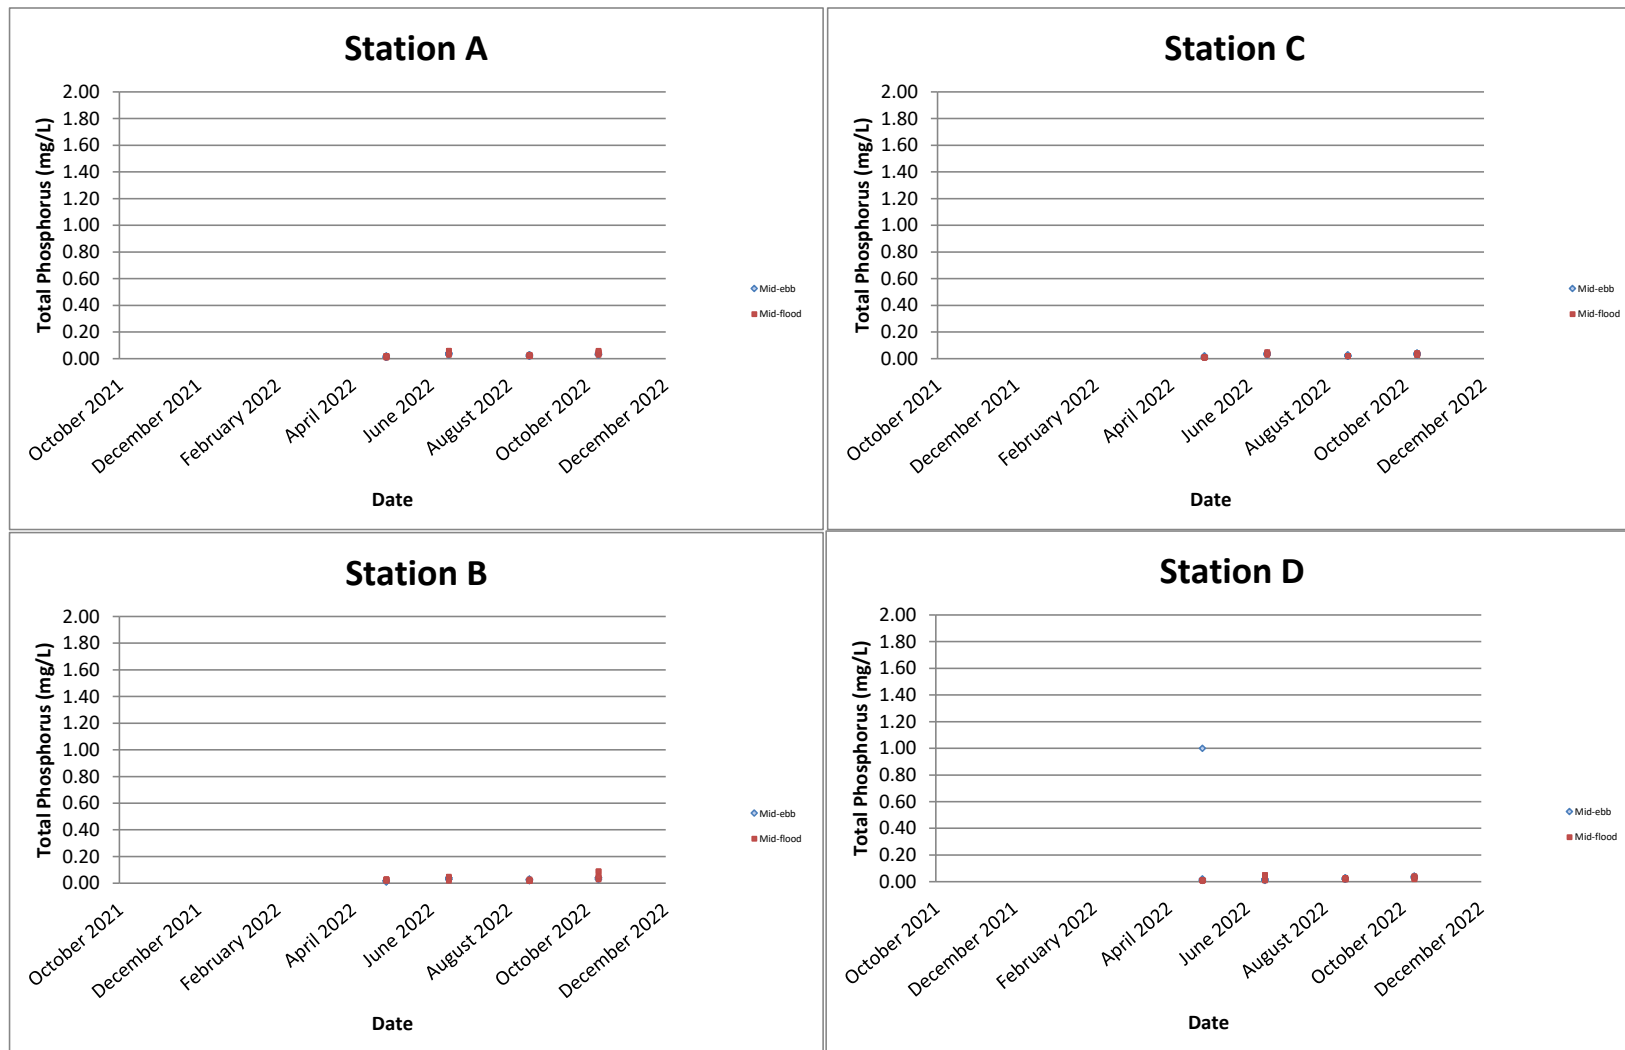

Remark: All below the Limit of Report sample results (<0.01 mg/L) for Total Phosphorus is regarded as 0.01 mg/L in graphical presentation.




Total Phosphorus (soluble and particulate) (mg/L)

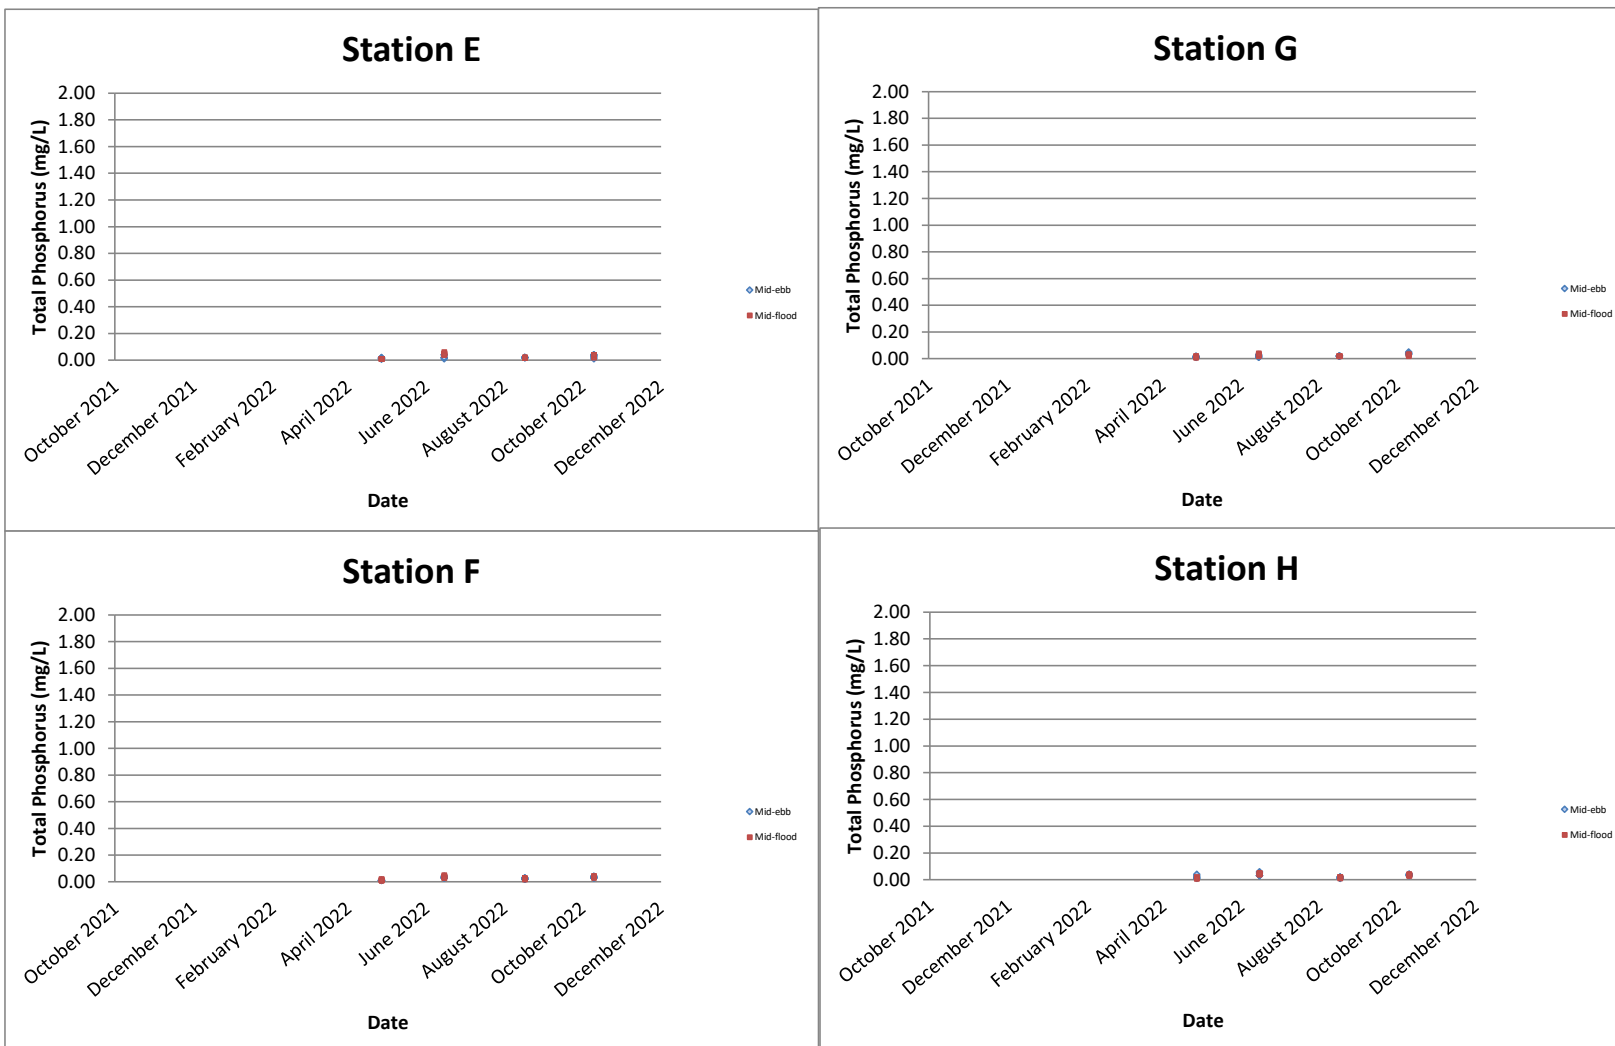


Remark: All below the Limit of Report sample results (<0.01 mg/L) for Total Phosphorus is regarded as 0.01 mg/L in graphical presentation.

BOD<sub>5</sub> (mg/L)

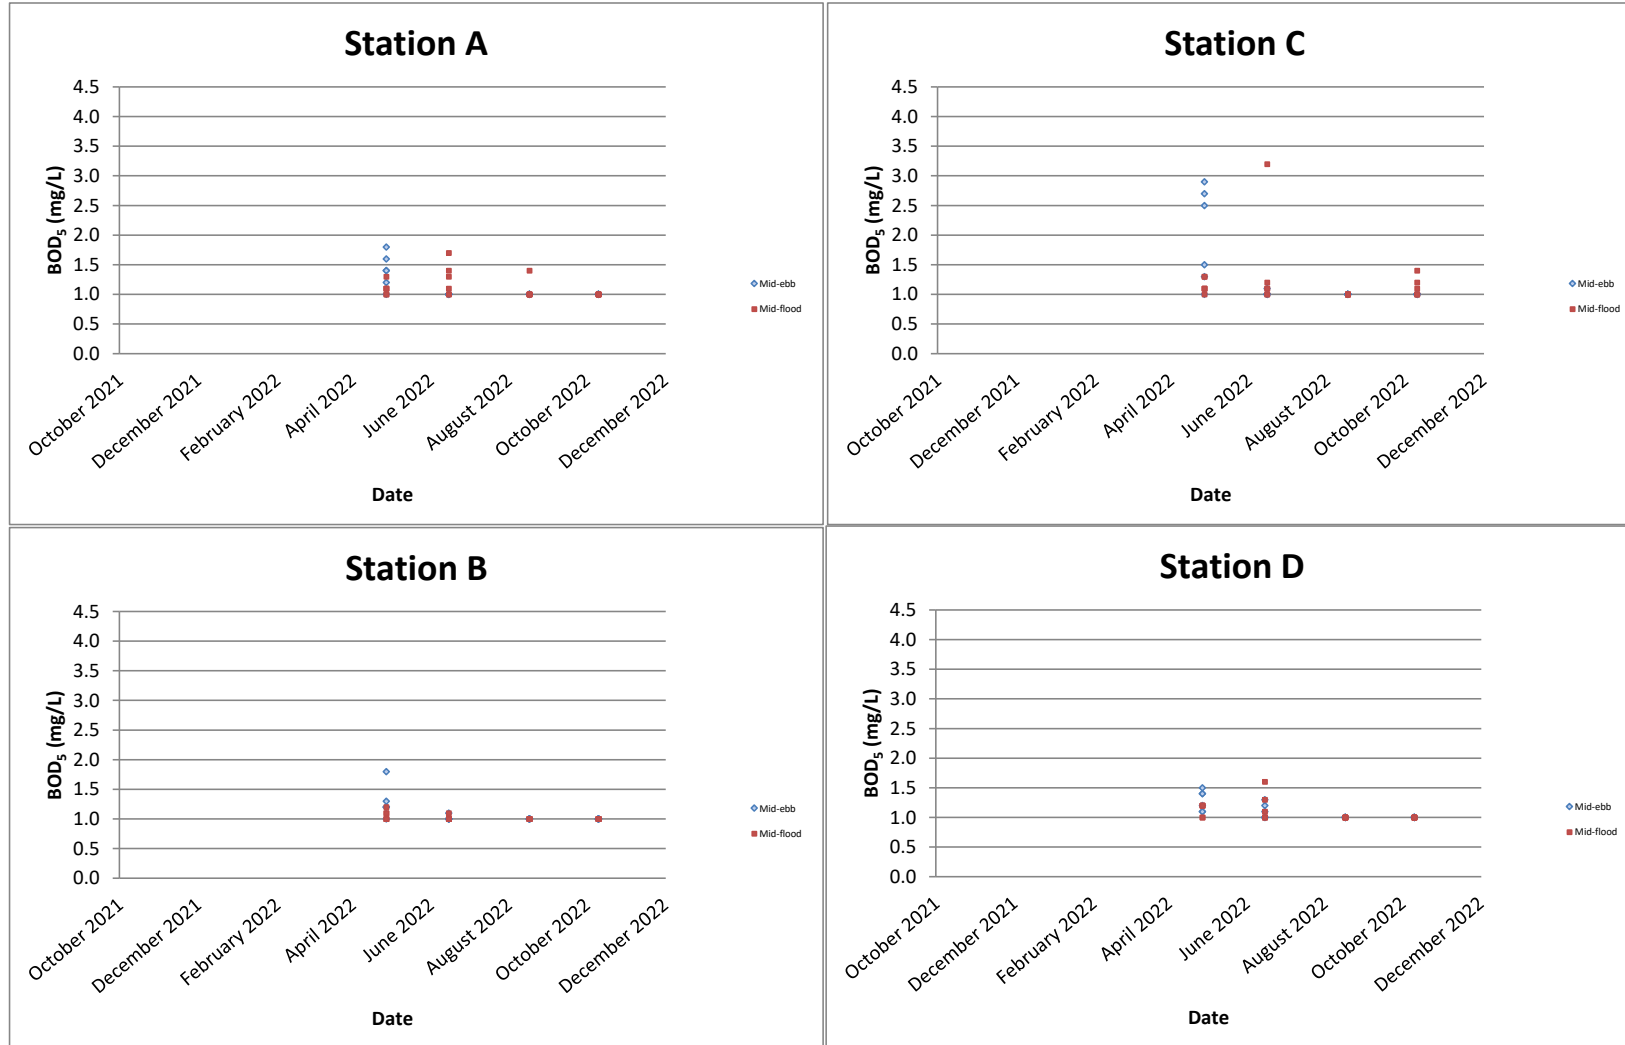

Remark: All below the Limit of Report sample results (<1.0 mg/L) for BOD<sub>5</sub> is regarded as 1.0 mg/L in graphical presentation.

BOD<sub>5</sub> (mg/L)

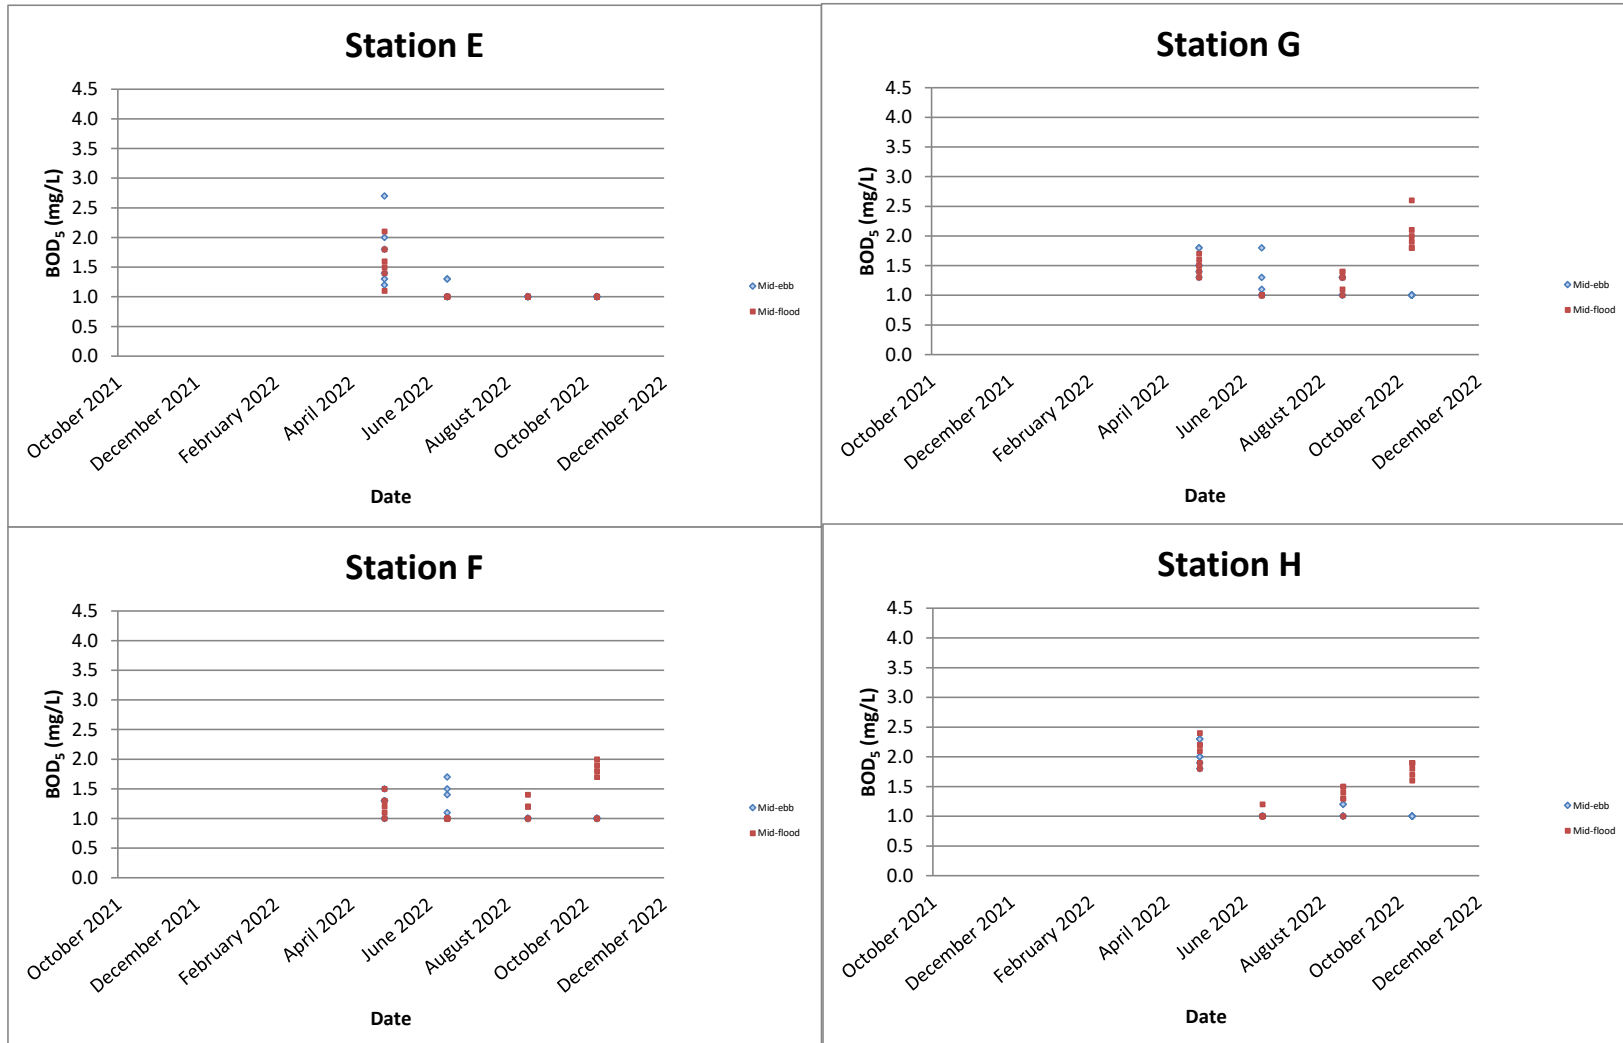

Remark: All below the Limit of Report sample results (<1.0 mg/L) for BOD<sub>5</sub> is regarded as 1.0 mg/L in graphical presentation.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix G

Tidal Data obtained from Ma Wan Marine Traffic Station

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

## Ma Wan



# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix H

### Results and Graphical Presentation of Laboratory Analysis for Sediment Quality Monitoring and Benthic Survey

Monitoring Location	Date	Weather	Sea Condition	Time	Sediment Monitoring												
					pH	Ammonia as N (mg-N/kg)	Total Nitrogen (mg-N/kg)	Total Phosphorus (mg-P/kg)	Cadmium (mg/kg)	Chromium (mg/kg)	Copper (mg/kg)	Lead (mg/kg)	Mercury (mg/kg)	Nickel (mg/kg)	Zinc (mg/kg)	Arsenic (mg/kg)	Silver (mg/kg)
A	10/10/2022	Fine	Moderate	10:53	8.2	13	1100	380	<0.1	25	24	31	0.14	15	78	12	0.2
B	10/10/2022	Fine	Moderate	10:37	8.2	10	1200	340	<0.1	27	29	32	0.11	16	84	11	0.3
C	10/10/2022	Fine	Moderate	10:18	8.0	16	1500	400	<0.1	32	33	37	0.13	19	95	11	0.3
D	10/10/2022	Fine	Moderate	10:01	8.0	11	1500	410	<0.1	29	29	35	0.13	17	88	11	0.3
E	10/10/2022	Fine	Moderate	09:42	7.9	20	1500	450	<0.1	30	33	34	0.12	18	94	10	0.3
F	10/10/2022	Fine	Moderate	09:26	8.0	32	1500	500	<0.1	33	34	37	0.14	19	98	11	0.3
G	10/10/2022	Fine	Moderate	09:05	8.1	6.2	850	340	<0.1	18	31	25	0.06	11	63	8.3	0.2
H	10/10/2022	Fine	Moderate	08:49	8.1	10	1100	400	<0.1	22	30	27	0.08	13	76	7.4	0.3

Monitoring Location	Date	Weather	Sea Condition	Time	Benthic Survey				
					Total Organic Carbon (%)	Particle Size Distribution			
						Gravel (%)	Sand (%)	Silt (%)	Clay (%)
A	10/10/2022	Fine	Moderate	10:53	1.0	0	27	27	46
B	10/10/2022	Fine	Moderate	10:37	0.8	2	21	33	44
C	10/10/2022	Fine	Moderate	10:18	1.2	1	5	40	54
D	10/10/2022	Fine	Moderate	10:01	0.9	1	8	39	52
E	10/10/2022	Fine	Moderate	09:42	1.6	0	4	39	57
F	10/10/2022	Fine	Moderate	09:26	1.2	0	2	36	62
G	10/10/2022	Fine	Moderate	09:05	1.7	4	10	37	49
H	10/10/2022	Fine	Moderate	08:49	1.3	1	7	39	53

Report No. : 181172WA222096(1)



Page 1 of 3

**Test Report on Analysis of Sediment****Information Supplied by Client**

Client : Fugro Technical Services Limited

Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Sample description : Eight samples of sediment taken by the staff of FTS on 10/10/2022

Client sample ID : Refer to page 3

Tests required :  
1. pH value  
2. Moisture content  
3. Ammoniacal nitrogen content  
4. Total nitrogen content  
5. Total phosphorus content  
6. Cadmium content  
7. Chromium content  
8. Copper content  
9. Lead content  
10. Mercury content  
11. Nickel content  
12. Zinc content  
13. Arsenic content  
14. Silver content

**Laboratory Information**

Lab. sample ID : WA222096(1)/1-8

Date of receipt of sample : 10/10/2022

Date test commenced : 10/10/2022

Date test completed : 24/10/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*



Report No. : 181172WA222096(1)

Page 2 of 3

Test methods used : pH value  
*APHA 23ed. 4500-H<sup>+</sup>B*

Moisture content  
*In house method E-T-186*

Ammoniacal Nitrogen content  
*In house method E-T-095*

Total nitrogen  
*In house method E-T-114 (By Calculation),  
In house method E-T-036 & APHA 23ed. 4500-NO<sub>3</sub><sup>-</sup>-I*

Total phosphorus content  
*APHA 17ed. 4500-PB.5 (Digestion) &  
In house method E-T-056 (Determination)*

Cadmium, Chromium, Copper, Lead, Mercury, Nickel, Zinc,  
Arsenic, Silver content  
*USEPA method 3050B (Digestion) & 6020A (Determination)*


*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096(1)

Page 3 of 3

**Results :**

Test parameters	Sample identification													
	A/Sediment	B/Sediment	C/Sediment	D/Sediment	E/Sediment	F/Sediment	G/Sediment	H/Sediment						
1. pH value at 25°C	8.2	8.2	8.0	8.0	7.9	8.0	8.1	8.1						
2. Moisture content, %	55.5	54.9	61.7	56.9	63.4	64.5	43.1	59.7						
3. Ammoniacal nitrogen content, mg/kg	13	10	16	11	20	32	6.2	10						
4. Total nitrogen, mg/kg	1100	1200	1500	1500	1500	1500	850	1100						
5. Total phosphorus content, mg/kg	380	340	400	410	450	500	340	400						
6. Cadmium content, mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1						
7. Chromium content, mg/kg	25	27	32	29	30	33	18	22						
8. Copper content, mg/kg	24	29	33	29	33	34	31	30						
9. Lead content, mg/kg	31	32	37	35	34	37	25	27						
10. Mercury content, mg/kg	0.14	0.11	0.13	0.13	0.12	0.14	0.06	0.08						
11. Nickel content, mg/kg	15	16	19	17	18	19	11	13						
12. Zinc content, mg/kg	78	84	95	88	94	98	63	76						
13. Arsenic content, mg/kg	12	11	11	11	10	11	8.3	7.4						
14. Silver content, mg/kg	0.2	0.3	0.3	0.3	0.3	0.3	0.2	0.3						

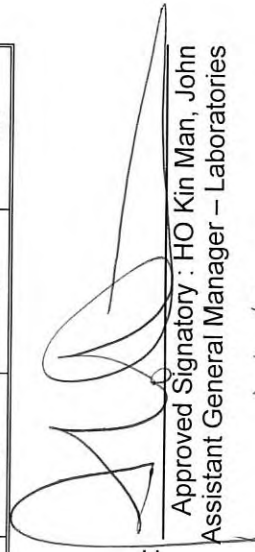Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/2020

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received. **\*\*\* End of Report \*\*\***

**Note**

**Laboratory Duplicate, Quality Assurance/Quality Control Report**

pH value				Moisture content, %			
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate
0.1	-	-	Original result 8.08 Duplicate result 8.07	0.1	-	-	Original result 55.74 Duplicate result 55.52
Ammoniacal nitrogen content, mg/kg				Total nitrogen, mg/kg			
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate
0.5	<0.5	-	Original result - Duplicate result -	50	-	-	Original result 1119.01 Duplicate result 1098.75
Total phosphorus content, mg/kg							
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate				
10	<10	-	Original result 398.68 Duplicate result 396.2	RPD% - 0.62			
				RPD% - 1.83			

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories


Date : 4/11/2020

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

**Note**

**Method Blank (MB), Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report**

Item	Method Blank (MB) Report		Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report						
	LOR	Result	Spike Concentration	Spike recovery (%)		Recovery limits (%)		RPD%	
				MS	MSD	Low	High	Value	Control Limited
Arsenic	0.5	< 0.5	10	106.43	-	75	125	-	-
Cadmium	0.1	< 0.1	2	96.77	-	75	125	-	-
Chromium	0.5	< 0.5	50	94.48	-	75	125	-	-
Copper	0.2	< 0.2	50	92.18	-	75	125	-	-
Lead	0.2	< 0.2	50	99.00	-	75	125	-	-
Mercury	0.05	< 0.05	1	88.35	-	75	125	-	-
Nickel	0.2	< 0.2	20	91.48	-	75	125	-	-
Silver	0.1	< 0.1	2	102.83	-	75	125	-	-
Zinc	0.5	< 0.5	200	92.05	-	75	125	-	-

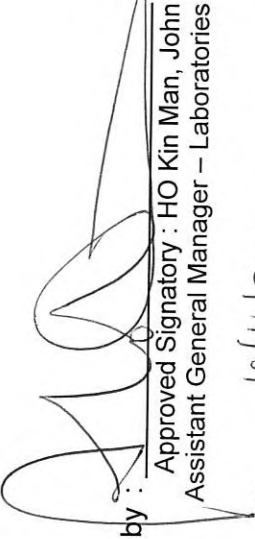Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/2022

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096(2)



Page 1 of 2

**Test Report on Analysis of Sediment****Information Supplied by Client**

Client : Fugro Technical Services Limited

Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Sample description : Eight samples of benthic survey sediment taken by the staff of FTS on 10/10/2022

Client sample ID : Refer to page 2

Tests required : 1. Moisture content  
2. Total organic carbon content

**Laboratory Information**

Lab. sample ID : WA222096(1)/9-16

Date of receipt of sample : 10/10/2022

Date test commenced : 10/10/2022

Date test completed : 27/10/2022

Test methods used : 1. In-house method E-T-186  
2. APHA 23ed. 5310B


*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA222096(2)

Page 2 of 2

**Results :**

Test parameters	Sample identification							
	A/Benthic Survey	B/Benthic Survey	C/Benthic Survey	D/Benthic Survey	E/Benthic Survey	F/Benthic Survey	G/Benthic Survey	H/Benthic Survey
1. Moisture content, %	56.7	55.1	59.5	58.4	60.8	66.1	55.8	58.8
2. Total organic carbon content, %	1.0	0.8	1.2	0.9	1.6	1.2	1.7	1.3

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/2021

\*\* End of Report \*\*

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*



Report No. : 181172EN222238



Page 1 of 2

**Test Report on Analysis of Water and Wastewater****Information Supplied by Client**

Client : Fugro Technical Services Limited

Client's address : Rm 723-726, 7/F, Profit Industrial Building, No.1-15, Kwai Fung Crescent, Kwai Chung, N.T.

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Sampling date : 10/10/2022

Sampling location : -

Sample description : Eight sample(s) of Rinsate Blank

Sample identification :  
1. A/Rinsate Blank  
2. B/Rinsate Blank  
3. C/Rinsate Blank  
4. D/Rinsate Blank  
5. E/Rinsate Blank  
6. F/Rinsate Blank  
7. G/Rinsate Blank  
8. H/Rinsate Blank

Test required : Total recoverable metals:  
1. Arsenic content  
2. Cadmium content  
3. Chromium content  
4. Copper content  
5. Lead content  
6. Mercury content  
7. Nickel content  
8. Silver content  
9. Zinc content

**Laboratory Information**

Lab sample ID : EN222238/1-8

Date of receipt of sample : 10/10/2022

Date test completed : 20/10/2022

Test method used : In-house method E-T-189 & E-T-190 (ICP-MS)

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*



Report No. : 181172EN222238


Page 2 of 2

**Results :**

Item	LOR	Client sample ID Unit	A/Rinsate Blank	B/Rinsate Blank	C/Rinsate Blank	D/Rinsate Blank
In-house method E-T-189 & E-T-190 (ICP-MS)						
Arsenic	1	µg/L	<1	<1	1	<1
Cadmium	0.2	µg/L	<0.2	<0.2	<0.2	<0.2
Chromium	1	µg/L	7	1	<1	10
Copper	1	µg/L	2	3	3	2
Lead	1	µg/L	2	<1	<1	<1
Mercury	0.5	µg/L	<0.5	<0.5	<0.5	<0.5
Nickel	1	µg/L	2	2	<1	2
Silver	1	µg/L	<1	<1	<1	<1
Zinc	10	µg/L	<10	13	<10	11

Item	LOR	Client sample ID Unit	E/Rinsate Blank	F/Rinsate Blank	G/Rinsate Blank	H/Rinsate Blank
In-house method E-T-189 & E-T-190 (ICP-MS)						
Arsenic	1	µg/L	<1	<1	<1	<1
Cadmium	0.2	µg/L	<0.2	<0.2	<0.2	<0.2
Chromium	1	µg/L	2	2	7	2
Copper	1	µg/L	2	2	3	3
Lead	1	µg/L	<1	<1	<1	<1
Mercury	0.5	µg/L	<0.5	<0.5	<0.5	<0.5
Nickel	1	µg/L	2	2	2	2
Silver	1	µg/L	<1	<1	<1	<1
Zinc	10	µg/L	10	11	<10	17

- Remark: 1. The sampling procedure for the sample received in this report is outside the scope of accreditation.  
 2. µg/L - microgram per litre

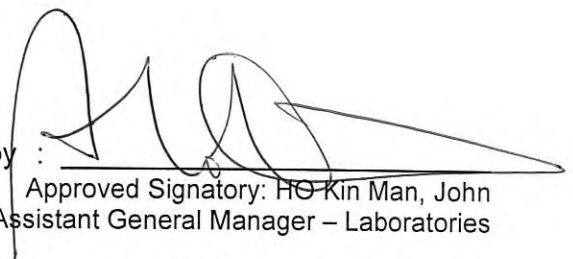Certified by :   
 Approved Signatory: HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 4/11/2022

**\*\* End of Report \*\***


*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172EN222238

**Note**
**Method Blank (MB), Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report**

Heavy metals content, µg/L									
Item	Method Blank (MB) Report		Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report						
	LOR	Result	Spike Concentration	Spike recovery (%)		Recovery limits (%)		RPD%	
				MS	MSD	Low	High	Value	Control Limited
Arsenic	1	< 0.5	10	101.2%	-	75.0%	125.0%	-	-
Cadmium	0.2	< 0.1	10	100.6%	-	75.0%	125.0%	-	-
Chromium	1	< 0.5	10	101.9%	-	75.0%	125.0%	-	-
Copper	1	< 0.5	10	96.0%	-	75.0%	125.0%	-	-
Lead	1	< 0.5	10	97.2%	-	75.0%	125.0%	-	-
Mercury	0.5	< 0.25	0.5	84.0%	-	75.0%	125.0%	-	-
Nickel	1	< 0.5	10	101.0%	-	75.0%	125.0%	-	-
Silver	1	< 0.5	10	97.3%	-	75.0%	125.0%	-	-
Zinc	10	< 5	100	97.5%	-	75.0%	125.0%	-	-

Certified by :


  
 Approved Signatory: HO Kin Man, John  
 Assistant General Manager – Laboratories

Date :

4/11/2012

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Test Report No. : M160554SL220361

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -

 Client sample No. : A  
 Borehole No. : -  
 Depth (m) : From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey


Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Service/Works Order No. :

 Laboratory sample I.D. : SL220361/1  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) :  
 From : Full Mix  
 To : -

**Laboratory Information**

 Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY.


Test Result (Sieve Analysis)		
Initial dry mass (m <sub>1</sub> ) g	Sieve size mm	Mass retained (g) / Percent passing (%)
131.114	100	0.000 / 100
	75	0.000 / 100
	63	0.000 / 100
	50	0.000 / 100
	37.5	0.000 / 100
	28	0.000 / 100
	20	0.000 / 100
Passing (m <sub>2</sub> )	20	131.114
Riffled passing (m <sub>3</sub> )	20	131.114
Wash passing (m <sub>4</sub> )	20	36.170
	14	0.000 / 100
	10	0.000 / 100
	6.3	0.000 / 100
Passing (m <sub>5</sub> )	6.3	36.170
Riffled passing (m <sub>6</sub> )	6.3	36.170
	5.0	0.050 / 100
	3.35	0.162 / 100
	2.00	0.300 / 100
	1.18	0.452 / 99
	0.600	0.920 / 99
	0.425	0.700 / 98
	0.300	1.440 / 97
	0.212	5.492 / 93
	0.150	10.450 / 85
	0.063	15.884 / 73
Pan (m <sub>7</sub> )		0.320

Test Result (Sedimentation Analysis)								
Hydrometer Serial No.	:	8295797						
Particle density (Assumed)	:	2.65						
Initial dry mass*	g	23.076						
Mass retained on 63µm	g	5.431						

Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
13-10-2022	9:30	0.5	25.00	15.0	0.5	0.067	101	73
		1	25.00	14.5	0.5	0.048	97	71
		2	25.00	14.0	0.5	0.034	94	68
		4	25.00	14.0	0.5	0.024	94	68
		8	25.00	13.5	0.5	0.017	90	66
		30	25.00	12.5	0.5	0.0090	84	61
		120	25.00	11.5	0.5	0.0045	77	56
		480	25.00	10.0	0.5	0.0023	66	48
		1440	25.00	9.0	0.5	0.0014	59	43

# Hydrometer reading in solution only (R<sub>0</sub>)  
 K\* modified according to Geospec 3 (November 2001) Test Method 8.7

<b>SUMMATION :</b>	<b>GRAVEL</b>	<b>% :</b>	<b>0</b>
	<b>SAND</b>	<b>% :</b>	<b>27</b>
	<b>SILT</b>	<b>% :</b>	<b>27</b>
	<b>CLAY</b>	<b>% :</b>	<b>46</b>

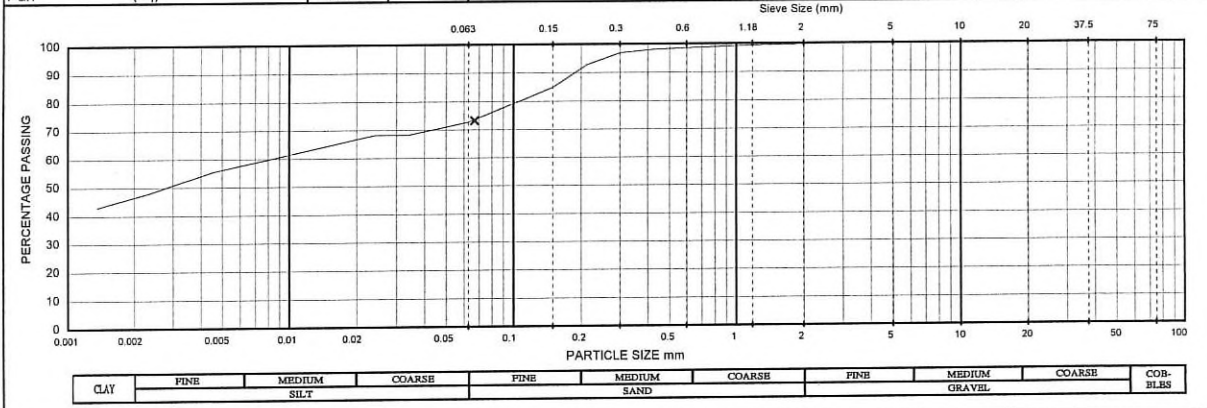
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date : 27 OCT 2022

\*\*End of Report\*\*

Test Report No. : M160554SL220361(1)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**

Information supplied by Client

Client : Fugro Technical Services Limited  
 Client's Address : -



Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Client sample No. : B  
 Borehole No. : -  
 Depth (m) : From - To -  
 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. :

Laboratory Information

Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY.

Laboratory sample I.D. : SL220361/2  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) : From Full Mix To -


Test Result (Sieve Analysis)			
Initial dry mass (m <sub>1</sub> ) g	Sieve size mm	Mass retained (g)	Percent passing (%)
140.636	100	0.000	100
	75	0.000	100
	63	0.000	100
	50	0.000	100
	37.5	0.000	100
	28	0.000	100
	20	0.000	100
Passing (m <sub>2</sub> )	20	140.636	
Riffled passing (m <sub>3</sub> )	20	140.636	
Wash passing (m <sub>4</sub> )	20	33.049	
	14	0.000	100
	10	0.000	100
	6.3	0.000	100
Passing (m <sub>5</sub> )	6.3	33.049	
Riffled passing (m <sub>6</sub> )	6.3	33.049	
	5.0	0.410	100
	3.35	0.612	99
	2.00	1.580	98
	1.18	1.540	97
	0.600	1.975	96
	0.425	0.980	95
	0.300	1.220	94
	0.212	2.260	92
	0.150	5.230	89
	0.063	16.692	77
Pan (m <sub>7</sub> )		0.550	

Test Result (Sedimentation Analysis)								
Hydrometer Serial No.	:	8295797						
Particle density (Assumed)	:	2.65						
Initial dry mass*	g	23.546						
Mass retained on 63µm	g	4.697						

Date	Time Started	Period min	Temp. °C	Hydro. Rdg.	Hydro. Rdg #	Particle dia. mm	K %	K* %
13-10-2022	9:25	0.5	25.00	14.0	0.5	0.068	92	78
		1	25.00	13.5	0.5	0.049	89	75
		2	25.00	13.0	0.5	0.035	85	72
		4	25.00	12.5	0.5	0.025	82	69
		8	25.00	12.0	0.5	0.017	78	66
		30	25.00	11.0	0.5	0.0092	72	60
		120	25.00	10.0	0.5	0.0046	65	55
		480	25.00	8.5	0.5	0.0024	55	46
		1440	25.00	7.5	0.5	0.0014	48	40

# Hydrometer reading in solution only (R<sub>0</sub>)  
 K\* modified according to Geospec 3 (November 2001) Test Method 8.7

**SUMMATION :** GRAVEL % : 2  
 SAND % : 21  
 SILT % : 33  
 CLAY % : 44

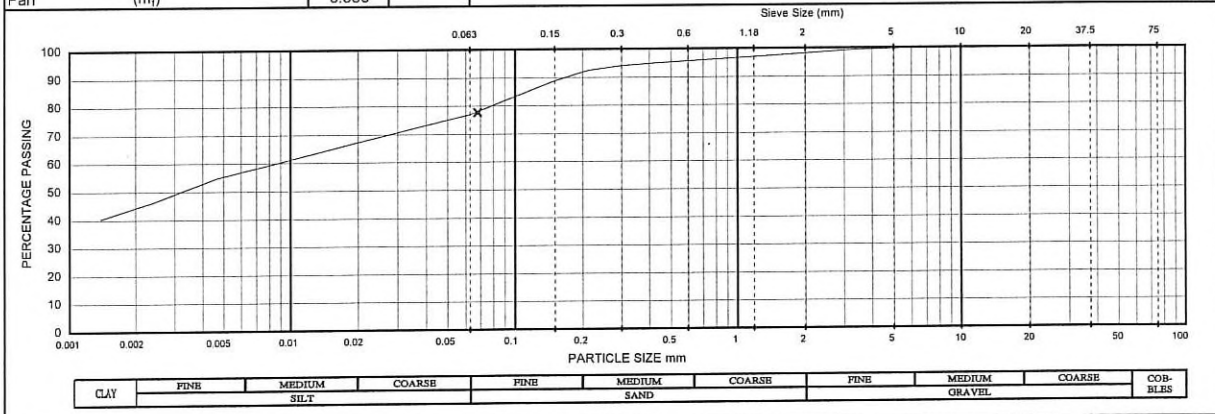

Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date : 27 OCT 2022

\*\*End of Report\*\*

Test Report No. : M160554SL220361(2)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**

Information supplied by Client

Client : Fugro Technical Services Limited  
 Client's Address : -



Client sample No. : C  
 Borehole No. : -  
 Depth (m) : From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Service/Works Order No. :


Laboratory Information

Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY.

Laboratory sample I.D. : SL220361/3  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) :  
 From : Full Mix  
 To : -

Test Result (Sieve Analysis)			
Initial dry mass (m <sub>1</sub> ) g	Sieve size mm	Mass retained (g)	Percent passing (%)
126.073	100	0.000	100
	75	0.000	100
	63	0.000	100
	50	0.000	100
	37.5	0.000	100
	28	0.000	100
	20	0.000	100
Passing (m <sub>2</sub> )	20	126.073	
Riffled passing (m <sub>3</sub> )	20	126.073	
Wash passing (m <sub>4</sub> )	20	8.559	
	14	0.000	100
	10	0.000	100
	6.3	0.000	100
Passing (m <sub>5</sub> )	6.3	8.559	
Riffled passing (m <sub>6</sub> )	6.3	8.559	
	5.0	0.000	100
	3.35	0.630	100
	2.00	0.962	99
	1.18	0.513	98
	0.600	0.560	98
	0.425	0.290	98
	0.300	0.283	97
	0.212	0.300	97
	0.150	0.430	97
	0.063	4.221	94
Pan (m <sub>7</sub> )		0.370	

Test Result (Sedimentation Analysis)								
Hydrometer Serial No.							8295797	
Particle density (Assumed)							2.65	
Initial dry mass*					g		22.016	
Mass retained on 63µm					g		0.721	
Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
13-10-2022	9:20	0.5	25.00	14.5	0.5	0.068	102	94
		1	25.00	14.5	0.5	0.048	102	94
		2	25.00	14.0	0.5	0.034	98	90
		4	25.00	13.5	0.5	0.024	95	87
		8	25.00	13.0	0.5	0.017	91	83
		30	25.00	12.0	0.5	0.0090	84	77
		120	25.00	11.0	0.5	0.0046	77	70
		480	25.00	9.0	0.5	0.0023	62	57
		1440	25.00	8.0	0.5	0.0014	55	50
# Hydrometer reading in solution only (R <sub>0</sub> )								
K* modified according to Geospec 3 (November 2001) Test Method 8.7								
<b>SUMMATION :</b> GRAVEL % : 1 SAND % : 5 SILT % : 40 CLAY % : 54								

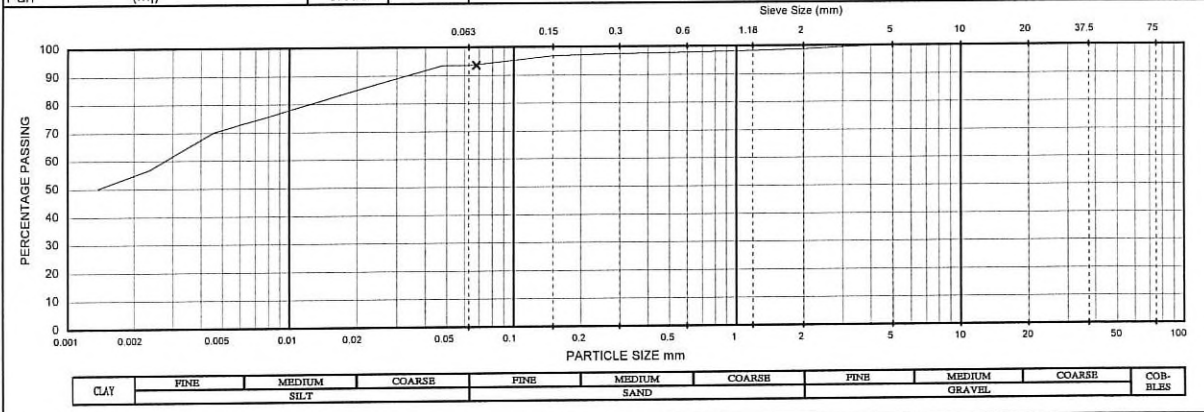

Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date : 27 OCT 2022

\*\*End of Report\*\*

Test Report No. : M160554SL220361(3)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

 Client sample No. : D  
 Borehole No. : -  
 Depth (m) : From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. :

**Laboratory Information**

 Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY.


 Laboratory sample I.D. : SL220361/4  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) :  
 From : Full Mix  
 To : -

Test Result (Sieve Analysis)		
Initial dry mass (m <sub>1</sub> ) g	Mass retained (g)	Percent passing (%)
136.022		
Sieve size mm		
100	0.000	100
75	0.000	100
63	0.000	100
50	0.000	100
37.5	0.000	100
28	0.000	100
20	0.000	100
Passing (m <sub>2</sub> )	20	136.022
Riffling passing (m <sub>3</sub> )	20	136.022
Wash passing (m <sub>4</sub> )	20	12.964
	14	0.000
	10	0.000
	6.3	0.000
Passing (m <sub>5</sub> )	6.3	12.964
Riffling passing (m <sub>6</sub> )	6.3	12.964
	5.0	0.540
	3.35	0.254
	2.00	0.590
	1.18	0.454
	0.600	0.683
	0.425	0.230
	0.300	0.395
	0.212	0.800
	0.150	0.540
	0.063	7.938
Pan (m <sub>1</sub> )		0.540

Test Result (Sedimentation Analysis)								
Hydrometer Serial No.							8295797	
Particle density (Assumed)							2.65	
Initial dry mass*					g		22.122	
Mass retained on 63µm					g		1.492	
Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
13-10-2022	9:15	0.5	25.00	14.5	0.5	0.068	102	92
		1	25.00	14.0	0.5	0.048	98	88
		2	25.00	13.5	0.5	0.034	94	85
		4	25.00	13.0	0.5	0.024	91	82
		8	25.00	12.5	0.5	0.017	87	79
		30	25.00	11.5	0.5	0.0091	80	72
		120	25.00	10.0	0.5	0.0046	69	62
		480	25.00	9.0	0.5	0.0023	62	56
		1440	25.00	7.5	0.5	0.0014	51	46

# Hydrometer reading in solution only (R<sub>0</sub>)  
 K\* modified according to Geospec 3 (November 2001) Test Method 8.7

**SUMMATION :** GRAVEL % : 1  
 SAND % : 8  
 SILT % : 39  
 CLAY % : 52

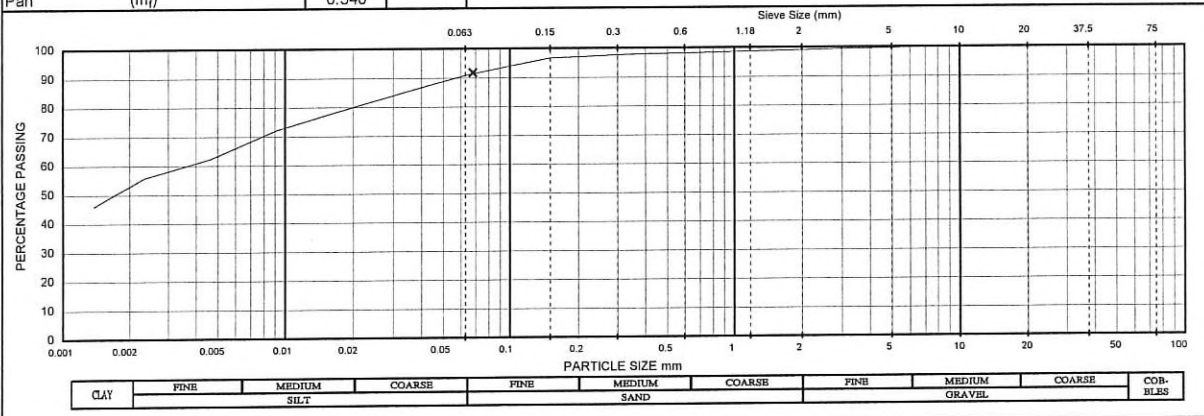
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date : 27 OCT 2022

\*\*End of Report\*\*

Test Report No. : M160554SL220361(4)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**

Information supplied by Client

Client : Fugro Technical Services Limited  
 Client's Address : -



Client sample No. : E

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Borehole No. : -  
 Depth (m) : From - To -  
 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. :

Laboratory Information

Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY.


Laboratory sample I.D. : SL220361/5  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) : From Full Mix To -

Test Result (Sieve Analysis)			
Initial dry mass (m <sub>1</sub> ) g	Sieve size mm	Mass retained (g)	Percent passing (%)
122.214	100	0.000	100
	75	0.000	100
	63	0.000	100
	50	0.000	100
	37.5	0.000	100
	28	0.000	100
	20	0.000	100
Passing (m <sub>2</sub> )	20	122.214	
Riffled passing (m <sub>3</sub> )	20	122.214	
Wash passing (m <sub>4</sub> )	20	4.675	
	14	0.000	100
	10	0.000	100
	6.3	0.000	100
Passing (m <sub>5</sub> )	6.3	4.675	
Riffled passing (m <sub>6</sub> )	6.3	4.675	
	5.0	0.000	100
	3.35	0.050	100
	2.00	0.072	100
	1.18	0.134	100
	0.600	0.223	100
	0.425	0.120	100
	0.300	0.152	99
	0.212	0.183	99
	0.150	0.330	99
	0.063	3.111	96
Pan (m <sub>7</sub> )		0.300	

Test Result (Sedimentation Analysis)								
Hydrometer Serial No.							8295797	
Particle density (Assumed)							2.65	
Initial dry mass*					g		20.434	
Mass retained on 63µm					g		0.595	
Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
13-10-2022	9:10	0.5	25.00	14.5	0.5	0.068	110	97
		1	25.00	14.0	0.5	0.048	106	94
		2	25.00	13.5	0.5	0.034	102	90
		4	25.00	13.0	0.5	0.024	98	87
		8	25.00	12.5	0.5	0.017	94	83
		30	25.00	11.5	0.5	0.0091	86	76
		120	25.00	10.0	0.5	0.0046	75	66
		480	25.00	9.0	0.5	0.0023	67	59
		1440	25.00	8.0	0.5	0.0014	59	52

# Hydrometer reading in solution only (R<sub>0</sub>)  
 K\* modified according to Geospec 3 (November 2001) Test Method 8.7

**SUMMATION :** GRAVEL % : 0  
 SAND % : 4  
 SILT % : 39  
 CLAY % : 57

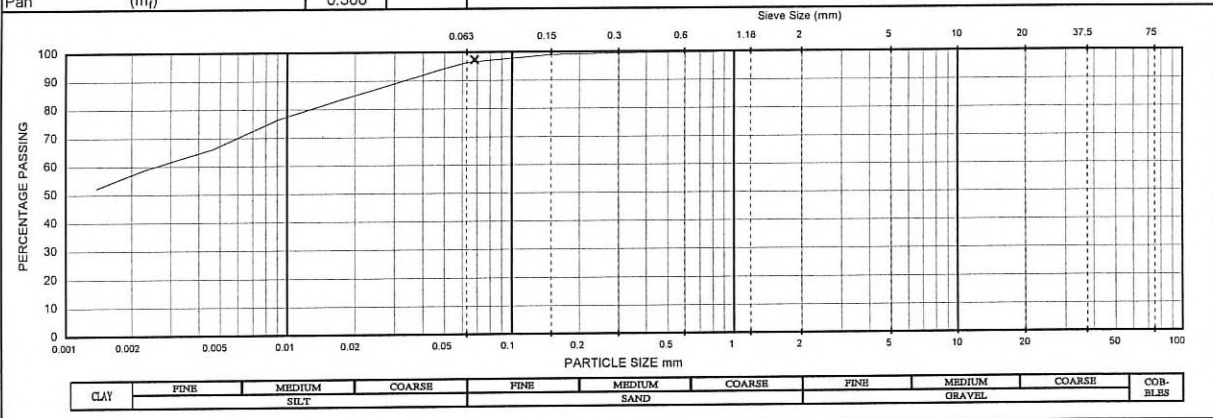

Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date : 27 OCT 2022

\*\*End of Report\*\*

Test Report No. : M160554SL220361(5)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**

Information supplied by Client

Client : Fugro Technical Services Limited  
 Client's Address : -

Client sample No. : F



Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Borehole No. : -  
 Depth (m) : From - To -  
 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. :

Laboratory Information

Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY.


Laboratory sample I.D. : SL220361/6  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) : From Full Mix To -

Test Result (Sieve Analysis)			
Initial dry mass (m <sub>1</sub> ) g	Sieve size mm	Mass retained (g)	Percent passing (%)
105.531	100	0.000	100
	75	0.000	100
	63	0.000	100
	50	0.000	100
	37.5	0.000	100
	28	0.000	100
	20	0.000	100
Passing (m <sub>2</sub> )	20	105.531	
Riffled passing (m <sub>3</sub> )	20	105.531	
Wash passing (m <sub>4</sub> )	20	2.567	
	14	0.000	100
	10	0.000	100
	6.3	0.000	100
Passing (m <sub>5</sub> )	6.3	2.567	
Riffled passing (m <sub>6</sub> )	6.3	2.567	
	5.0	0.000	100
	3.35	0.070	100
	2.00	0.130	100
	1.18	0.220	100
	0.600	0.240	99
	0.425	0.120	99
	0.300	0.100	99
	0.212	0.142	99
	0.150	0.130	99
	0.063	1.265	98
Pan (m <sub>7</sub> )	0.150		

Test Result (Sedimentation Analysis)								
Hydrometer Serial No.			: 8295797					
Particle density (Assumed)			: 2.65					
Initial dry mass*			g		: 18.123			
Mass retained on 63µm			g		: 0.141			
Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
13-10-2022	9:00	0.5	25.00	13.5	0.5	0.069	115	99
		1	25.00	13.0	0.5	0.049	111	95
		2	25.00	13.0	0.5	0.035	111	95
		4	25.00	12.5	0.5	0.025	106	91
		8	25.00	12.0	0.5	0.017	102	87
		30	25.00	11.0	0.5	0.0092	93	80
		120	25.00	10.0	0.5	0.0046	84	72
		480	25.00	9.0	0.5	0.0023	75	65
		1440	25.00	8.0	0.5	0.0014	66	57

# Hydrometer reading in solution only (R<sub>0</sub>)  
 K\* modified according to Geospec 3 (November 2001) Test Method 8.7

**SUMMATION :** GRAVEL % : 0  
 SAND % : 2  
 SILT % : 36  
 CLAY % : 62

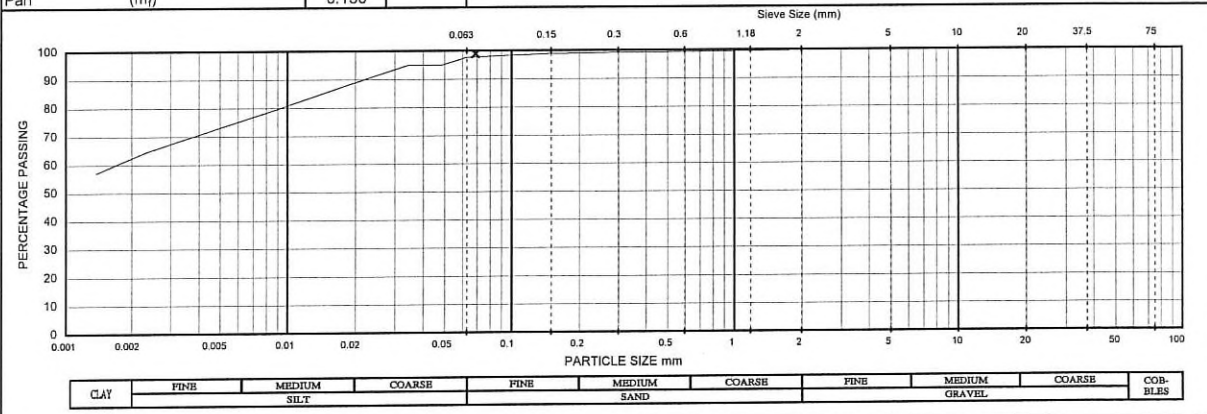

Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager  
 \*\*End of Report\*\*

Date : 27 OCT 2022



Test Report No. : M160554SL220361(6)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -

 Client sample No. : G  
 Borehole No. : -  
 Depth (m) : From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey

 Project : Contract No. CM 14/2016 Environmental Team for  
 Operational Environmental Monitoring and Audit for Siu Ho  
 Wan Sewage Treatment Works


Service/Works Order No. :

 Laboratory sample I.D. : SL220361/7  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation  
 within original sample (m)  
 From : Full Mix  
 To : -

**Laboratory Information**

 Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY  
 with shell fragments.

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)																																																																																													
Initial dry mass (m <sub>1</sub> ) g	: 134.887	Mass retained (g)	Percent passing (%)	Hydrometer Serial No.	:	8295797																																																																																											
Sieve size mm				Particle density (Assumed)	:	2.65																																																																																											
100	0.000	100		Initial dry mass*	g	22.218																																																																																											
75	0.000	100		Mass retained on 63µm	g	1.259																																																																																											
63	0.000	100		<table border="1"> <thead> <tr> <th>Date</th> <th>Time Started</th> <th>Period min</th> <th>Temp. °C</th> <th>Hydro. Rdg</th> <th>Hydro. Rdg #</th> <th>Particle dia. mm</th> <th>K %</th> <th>K* %</th> </tr> </thead> <tbody> <tr> <td>13-10-2022</td> <td>8:55</td> <td>0.5</td> <td>25.00</td> <td>14.5</td> <td>0.5</td> <td>0.068</td> <td>101</td> <td>87</td> </tr> <tr> <td></td> <td></td> <td>1</td> <td>25.00</td> <td>14.0</td> <td>0.5</td> <td>0.048</td> <td>98</td> <td>84</td> </tr> <tr> <td></td> <td></td> <td>2</td> <td>25.00</td> <td>13.5</td> <td>0.5</td> <td>0.034</td> <td>94</td> <td>80</td> </tr> <tr> <td></td> <td></td> <td>4</td> <td>25.00</td> <td>13.5</td> <td>0.5</td> <td>0.024</td> <td>94</td> <td>80</td> </tr> <tr> <td></td> <td></td> <td>8</td> <td>25.00</td> <td>13.0</td> <td>0.5</td> <td>0.017</td> <td>90</td> <td>77</td> </tr> <tr> <td></td> <td></td> <td>30</td> <td>25.00</td> <td>12.0</td> <td>0.5</td> <td>0.0090</td> <td>83</td> <td>71</td> </tr> <tr> <td></td> <td></td> <td>120</td> <td>25.00</td> <td>11.0</td> <td>0.5</td> <td>0.0046</td> <td>76</td> <td>65</td> </tr> <tr> <td></td> <td></td> <td>480</td> <td>25.00</td> <td>9.0</td> <td>0.5</td> <td>0.0023</td> <td>61</td> <td>53</td> </tr> <tr> <td></td> <td></td> <td>1440</td> <td>25.00</td> <td>7.5</td> <td>0.5</td> <td>0.0014</td> <td>51</td> <td>43</td> </tr> </tbody> </table>				Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %	13-10-2022	8:55	0.5	25.00	14.5	0.5	0.068	101	87			1	25.00	14.0	0.5	0.048	98	84			2	25.00	13.5	0.5	0.034	94	80			4	25.00	13.5	0.5	0.024	94	80			8	25.00	13.0	0.5	0.017	90	77			30	25.00	12.0	0.5	0.0090	83	71			120	25.00	11.0	0.5	0.0046	76	65			480	25.00	9.0	0.5	0.0023	61	53			1440	25.00	7.5	0.5	0.0014	51	43
Date	Time Started	Period min	Temp. °C					Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %																																																																																					
13-10-2022	8:55	0.5	25.00					14.5	0.5	0.068	101	87																																																																																					
		1	25.00					14.0	0.5	0.048	98	84																																																																																					
		2	25.00					13.5	0.5	0.034	94	80																																																																																					
		4	25.00					13.5	0.5	0.024	94	80																																																																																					
		8	25.00					13.0	0.5	0.017	90	77																																																																																					
		30	25.00					12.0	0.5	0.0090	83	71																																																																																					
		120	25.00					11.0	0.5	0.0046	76	65																																																																																					
		480	25.00					9.0	0.5	0.0023	61	53																																																																																					
		1440	25.00	7.5	0.5	0.0014	51	43																																																																																									
50	0.000	100		# Hydrometer reading in solution only (R <sub>0</sub> )																																																																																													
37.5	0.000	100		K* modified according to Geospec 3 (November 2001) Test Method 8.7																																																																																													
28	0.000	100		<p style="text-align: center;"><b>SUMMATION :</b></p> <table> <tr> <td>GRAVEL</td> <td>% :</td> <td>4</td> </tr> <tr> <td>SAND</td> <td>% :</td> <td>10</td> </tr> <tr> <td>SILT</td> <td>% :</td> <td>37</td> </tr> <tr> <td>CLAY</td> <td>% :</td> <td>49</td> </tr> </table>				GRAVEL	% :	4	SAND	% :	10	SILT	% :	37	CLAY	% :	49																																																																														
GRAVEL	% :	4																																																																																															
SAND	% :	10																																																																																															
SILT	% :	37																																																																																															
CLAY	% :	49																																																																																															
20	0.000	100																																																																																															
Passing (m <sub>2</sub> )	20	134.887																																																																																															
Riffled passing (m <sub>3</sub> )	20	134.887																																																																																															
Wash passing (m <sub>4</sub> )	20	19.256																																																																																															
	14	0.000	100																																																																																														
	10	2.870	98																																																																																														
	6.3	0.712	97																																																																																														
Passing (m <sub>5</sub> )	6.3	15.674																																																																																															
Riffled passing (m <sub>6</sub> )	6.3	15.674																																																																																															
	5.0	0.170	97																																																																																														
	3.35	0.580	97																																																																																														
	2.00	0.832	96																																																																																														
	1.18	1.220	95																																																																																														
	0.600	1.690	94																																																																																														
	0.425	0.712	93																																																																																														
	0.300	0.980	93																																																																																														
	0.212	1.432	92																																																																																														
	0.150	1.790	90																																																																																														
	0.063	6.038	86																																																																																														
Pan (m <sub>7</sub> )		0.230																																																																																															

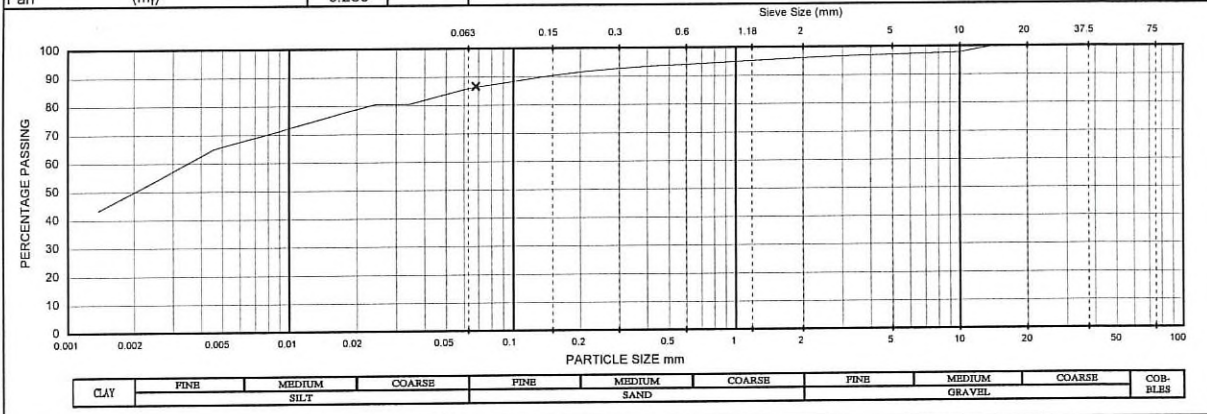
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date : 27 OCT 2022

\*\*End of Report\*\*

Test Report No. : M160554SL220361(7)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**

Information supplied by Client

Client : Fugro Technical Services Limited  
 Client's Address : -



Client sample No. : H  
 Borehole No. : -  
 Depth (m) : From - To -  
 Sample origin : -  
 Description : Benthic Survey

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Service/Works Order No. :

Laboratory Information

Date sample received : 11-10-2022  
 Date test commenced : 11-10-2022  
 Date test completed : 14-10-2022  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments.


Laboratory sample I.D. : SL220361/8  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) : From Full Mix To -

Test Result (Sieve Analysis)		
Initial dry mass (m <sub>1</sub> ) g	Sieve size mm	Mass retained (g) / Percent passing (%)
129.142	100	0.000 / 100
	75	0.000 / 100
	63	0.000 / 100
	50	0.000 / 100
	37.5	0.000 / 100
	28	0.000 / 100
	20	0.000 / 100
Passing (m <sub>2</sub> )	20	129.142
Riffled passing (m <sub>3</sub> )	20	129.142
Wash passing (m <sub>4</sub> )	20	11.225
	14	0.000 / 100
	10	0.000 / 100
	6.3	0.510 / 100
Passing (m <sub>5</sub> )	6.3	10.715
Riffled passing (m <sub>6</sub> )	6.3	10.715
	5.0	0.000 / 100
	3.35	0.470 / 99
	2.00	0.832 / 99
	1.18	0.890 / 98
	0.600	1.250 / 97
	0.425	0.700 / 96
	0.300	0.954 / 96
	0.212	1.240 / 95
	0.150	1.110 / 94
	0.063	3.009 / 92
Pan (m <sub>7</sub> )	0.260	

Test Result (Sedimentation Analysis)								
Hydrometer Serial No.							8295797	
Particle density (Assumed)							2.65	
Initial dry mass*							g : 21.092	
Mass retained on 63µm							g : 1.457	
Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
13-10-2022	8:50	0.5	25.00	14.5	0.5	0.068	107	92
		1	25.00	14.0	0.5	0.048	103	89
		2	25.00	13.5	0.5	0.034	99	86
		4	25.00	13.0	0.5	0.024	95	82
		8	25.00	12.5	0.5	0.017	91	79
		30	25.00	12.0	0.5	0.0090	88	76
		120	25.00	11.0	0.5	0.0046	80	69
		480	25.00	9.0	0.5	0.0023	65	56
		1440	25.00	7.5	0.5	0.0014	53	46

# Hydrometer reading in solution only (R<sub>0</sub>)  
 K\* modified according to Geospec 3 (November 2001) Test Method 8.7

**SUMMATION :** GRAVEL % : 1  
 SAND % : 7  
 SILT % : 39  
 CLAY % : 53

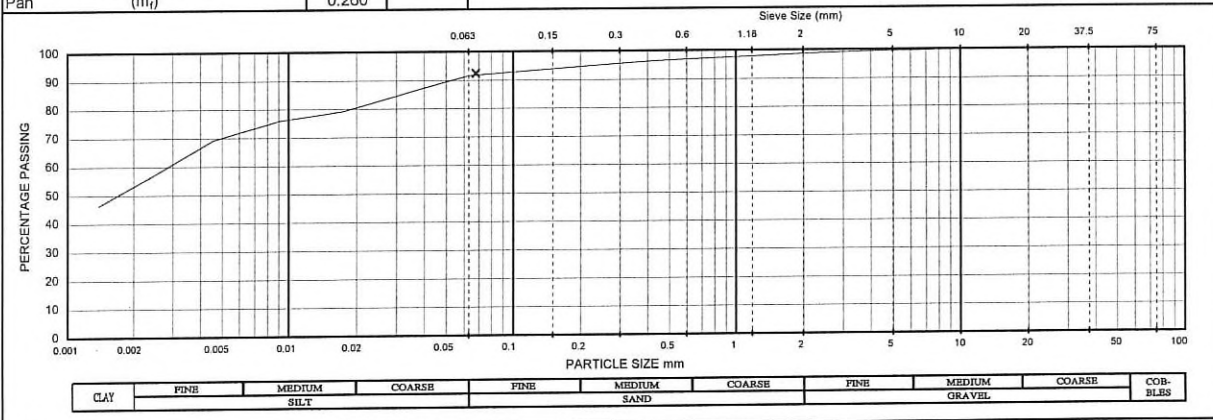





Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.


Approved Signatory : Au Yeung Wai Kit - Laboratory Manager Date : 27 OCT 2022

\*\*End of Report\*\*





pH value

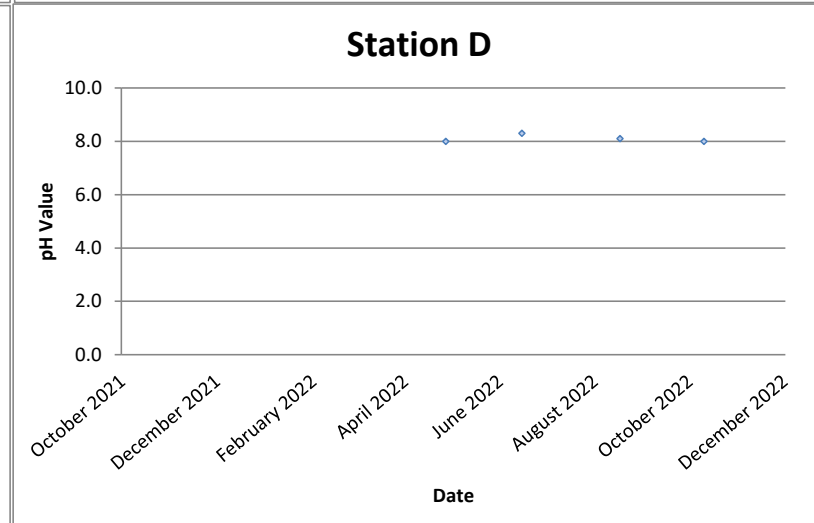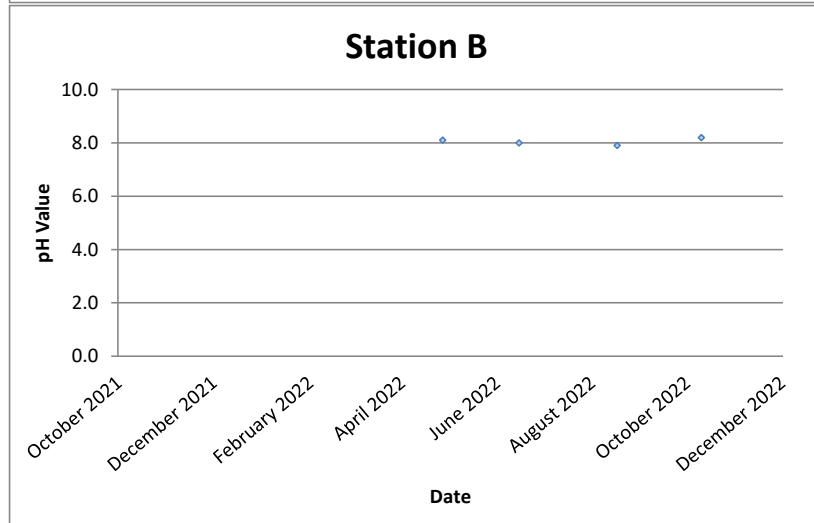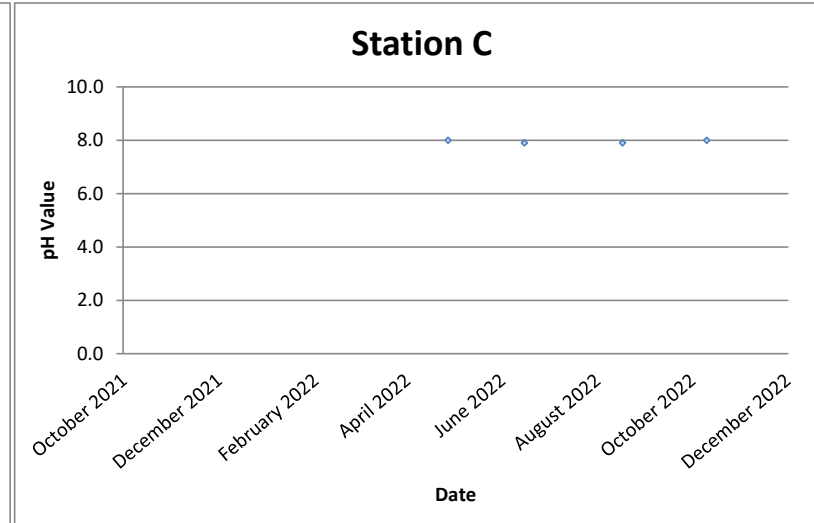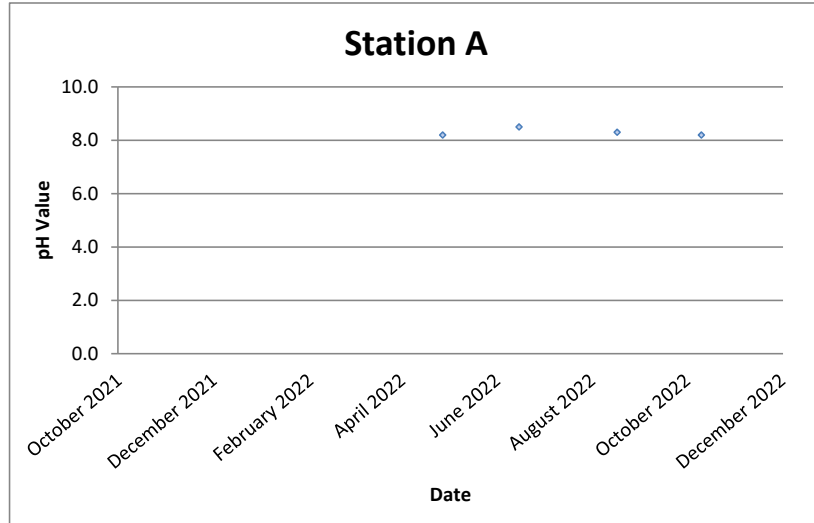


pH value

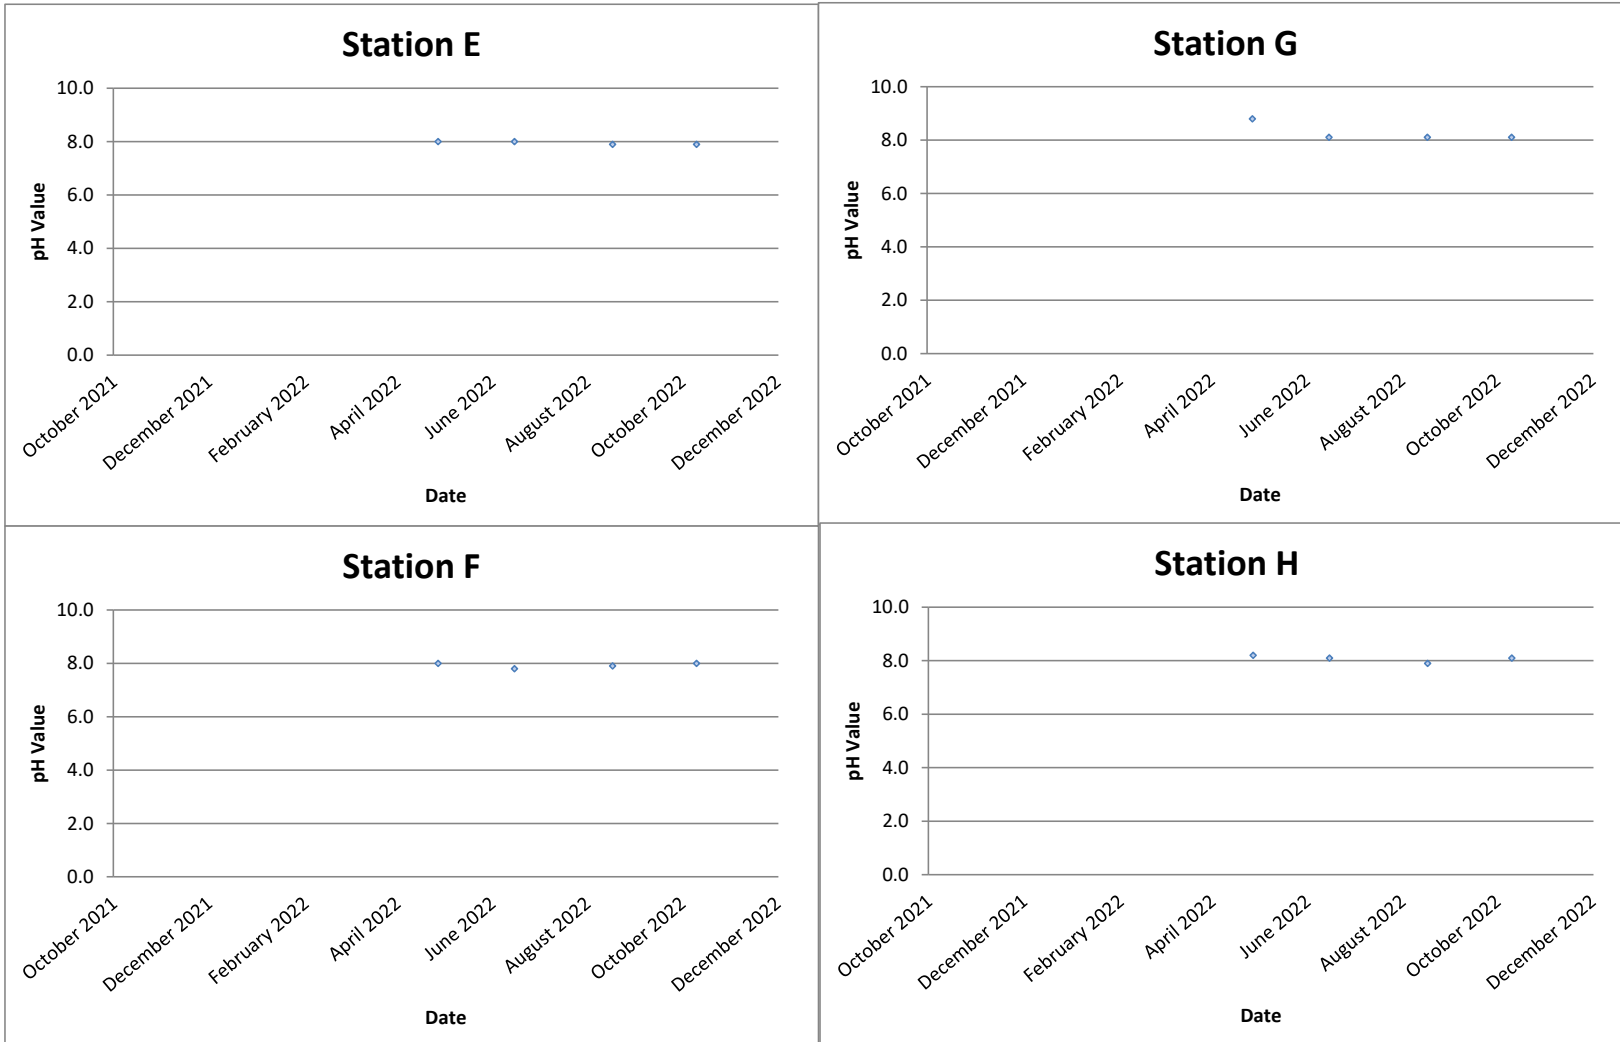





Ammonia Nitrogen (mg-N/kg)

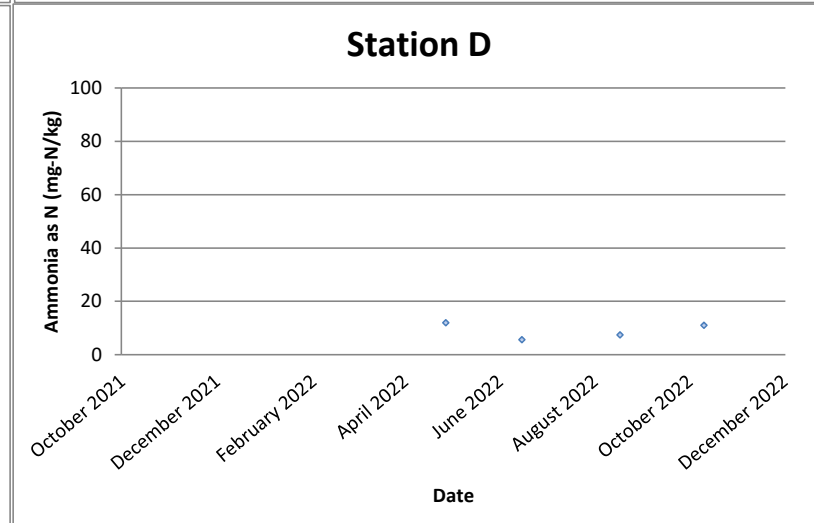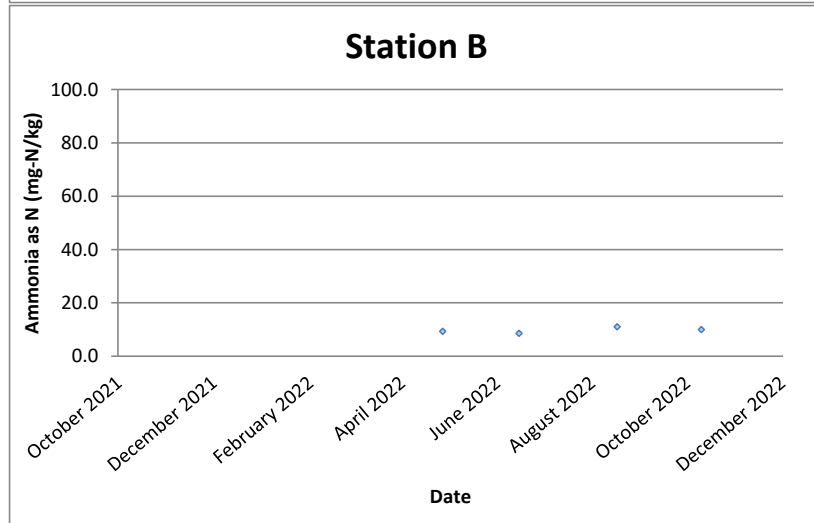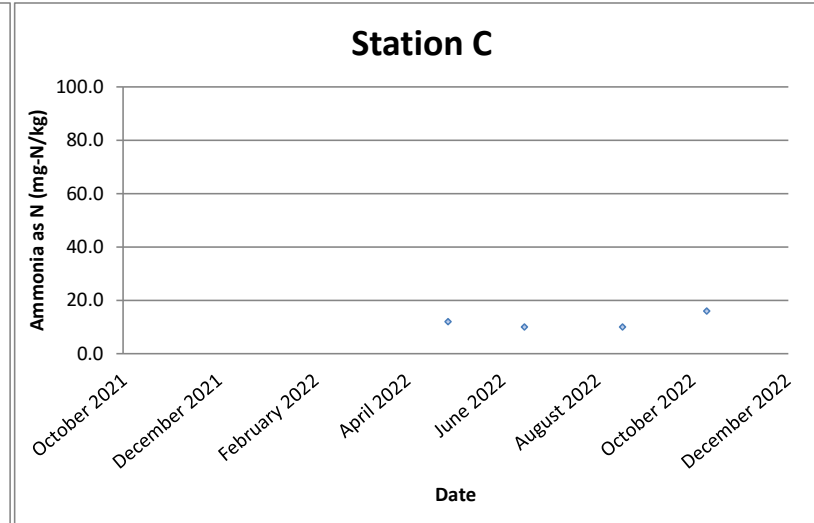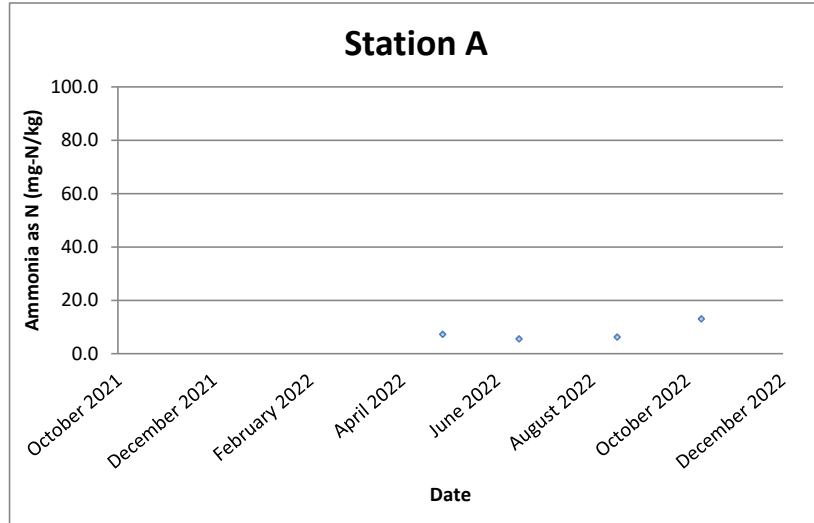


Ammonia Nitrogen (mg-N/kg)

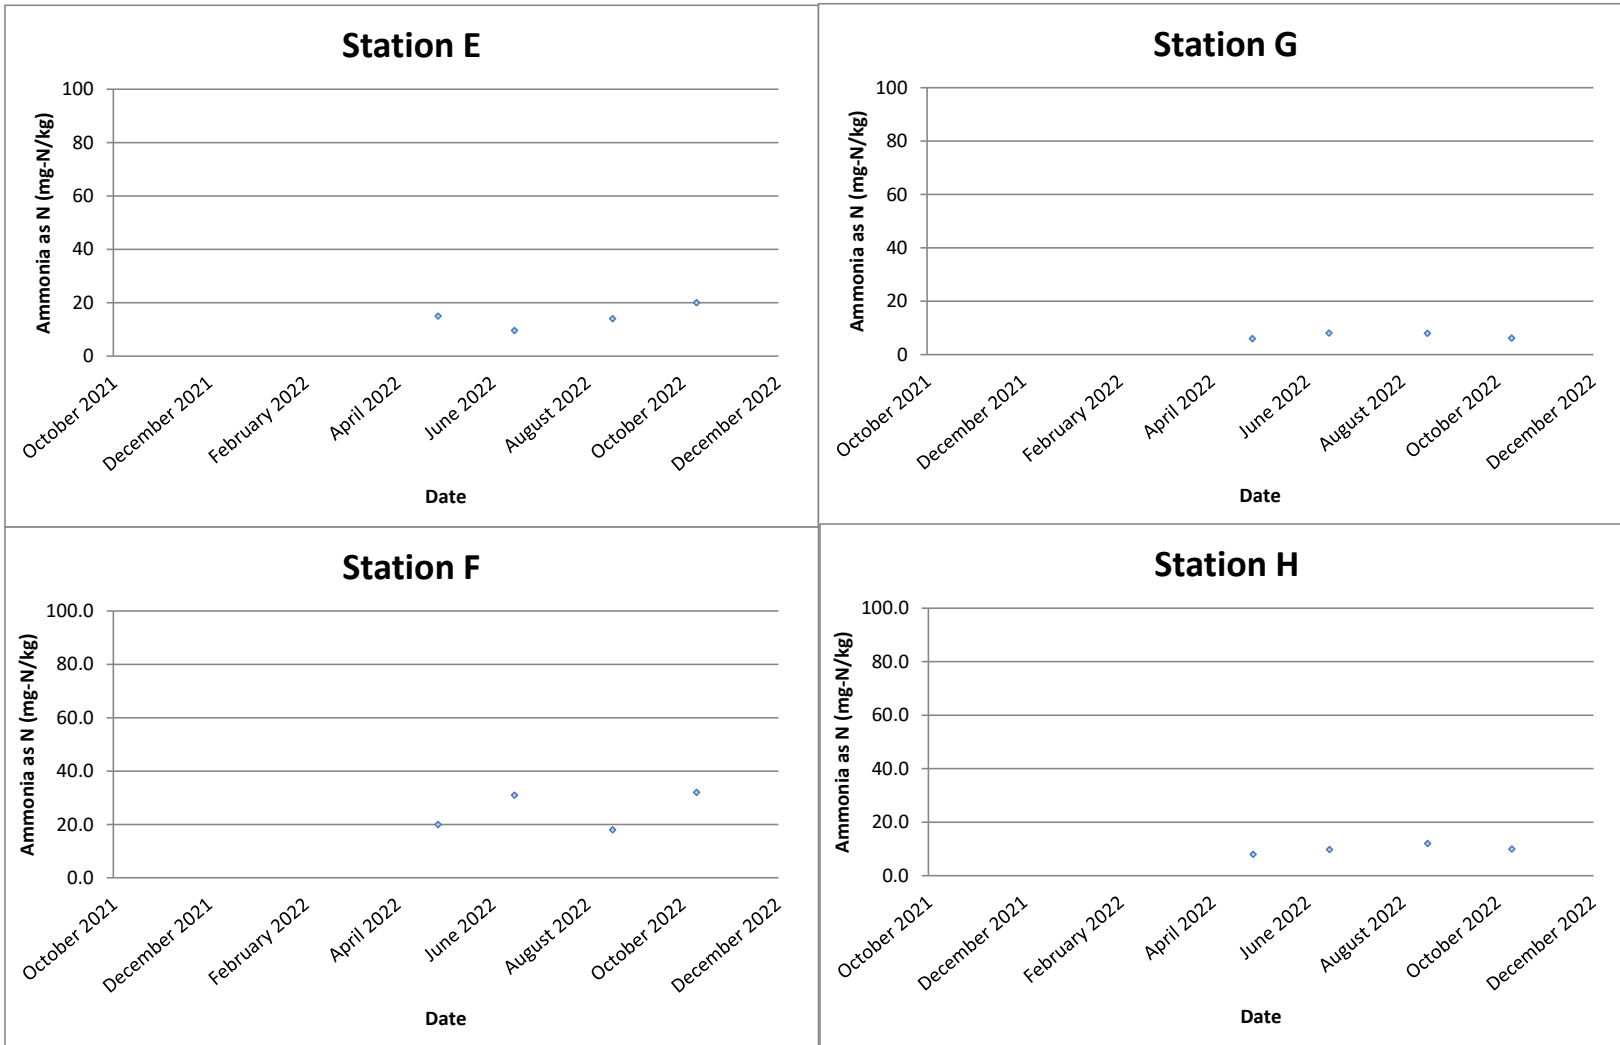

Total Nitrogen (mg-N/kg)

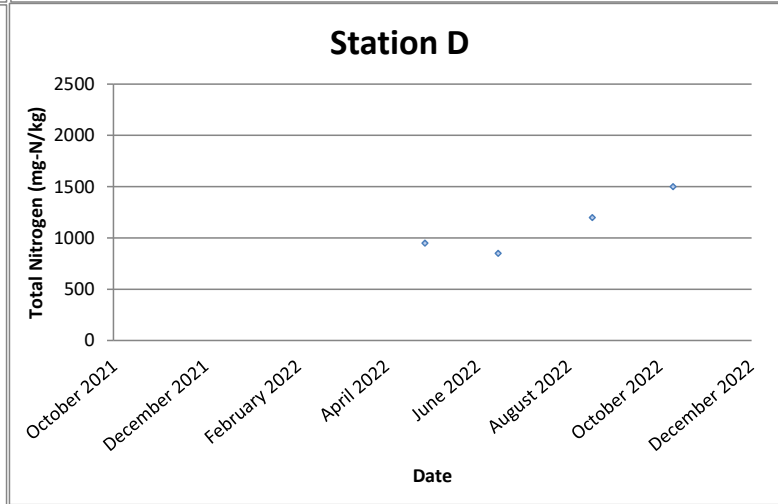
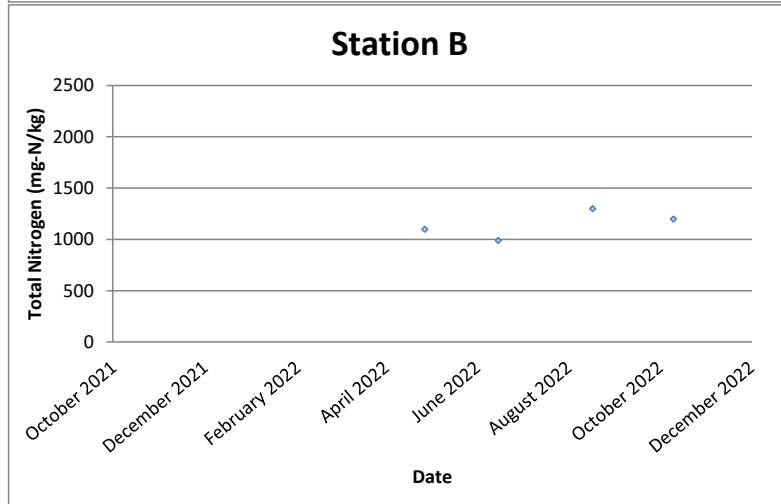
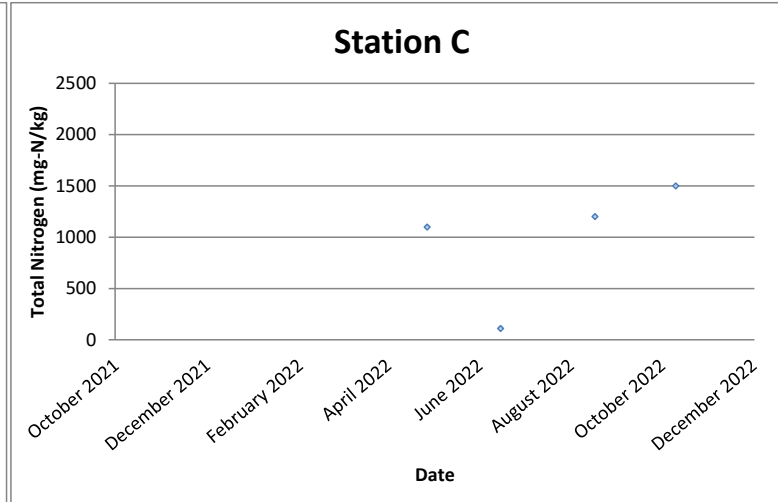
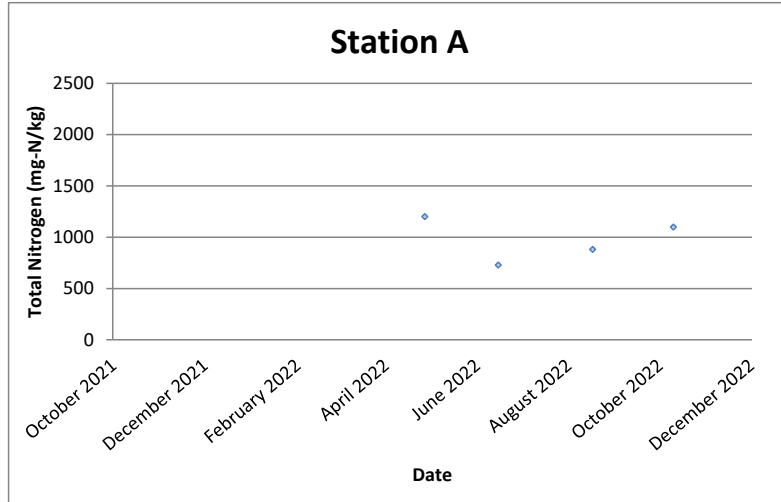


Total Nitrogen (mg-N/kg)

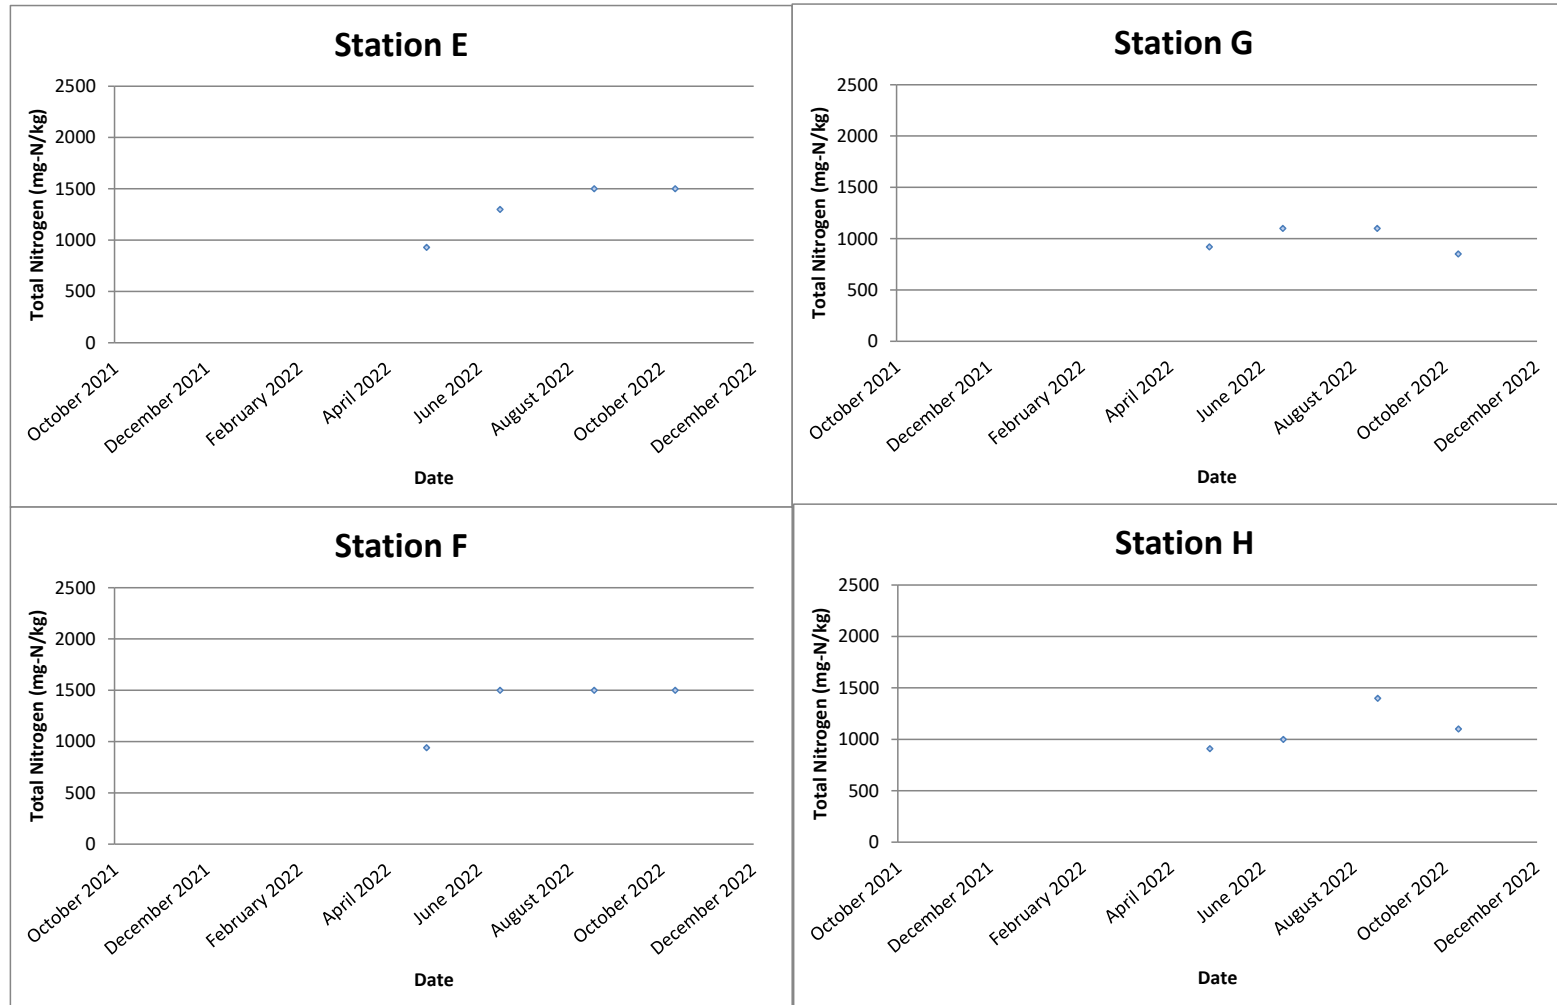





Total Phosphorus (mg-P/kg)

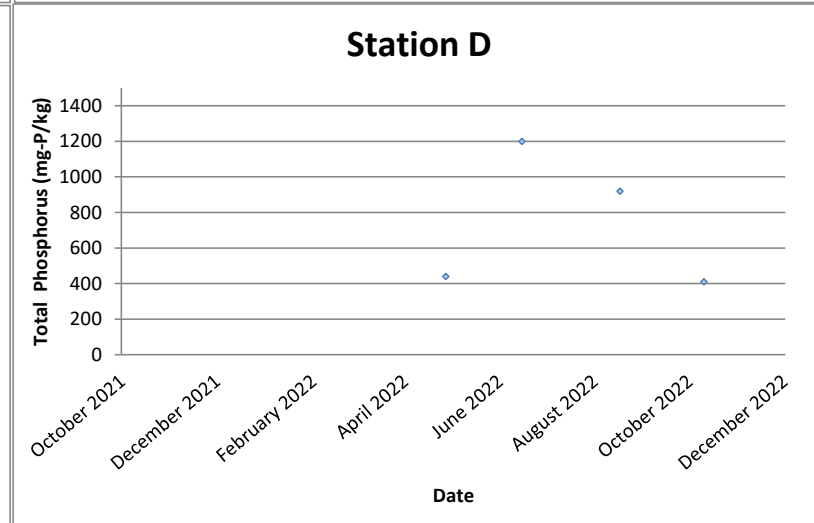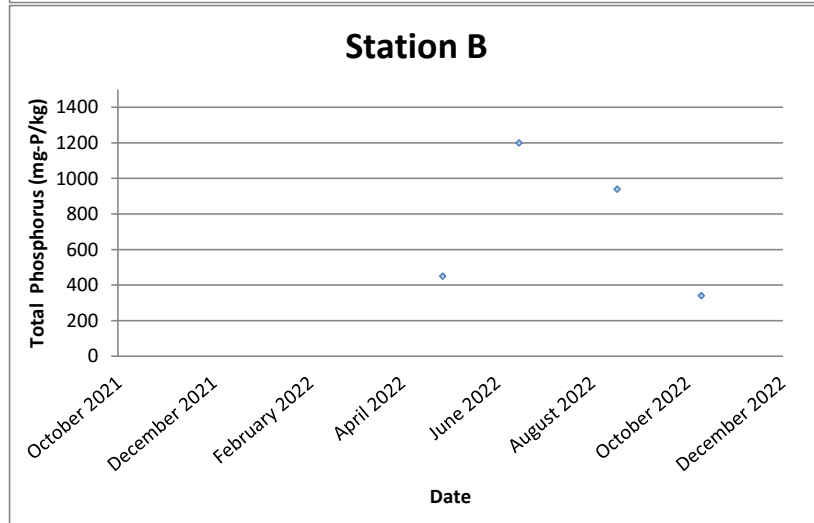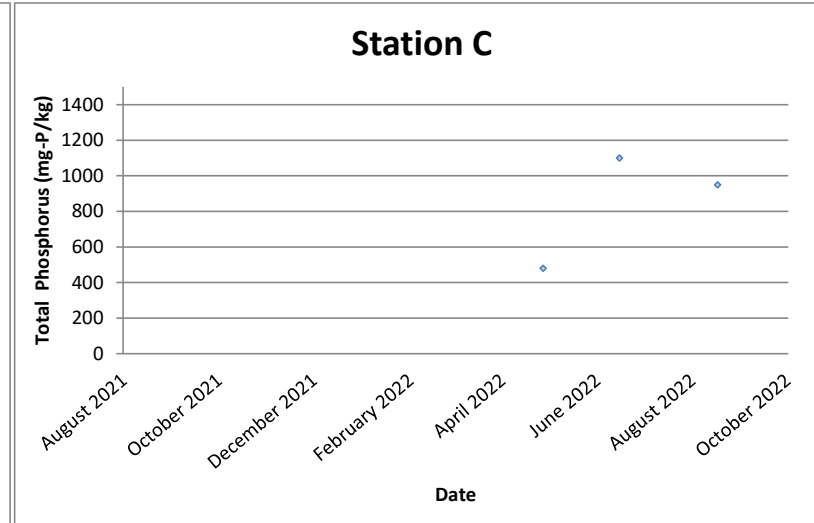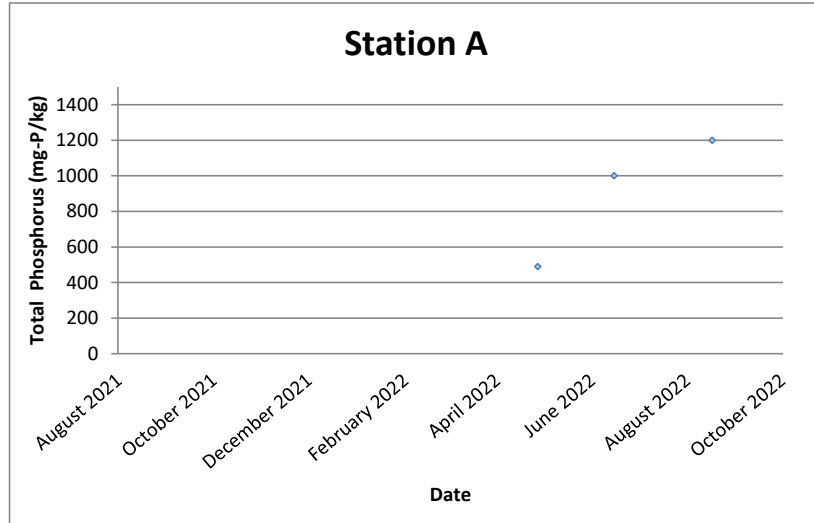

Total Phosphorus (mg-P/kg)

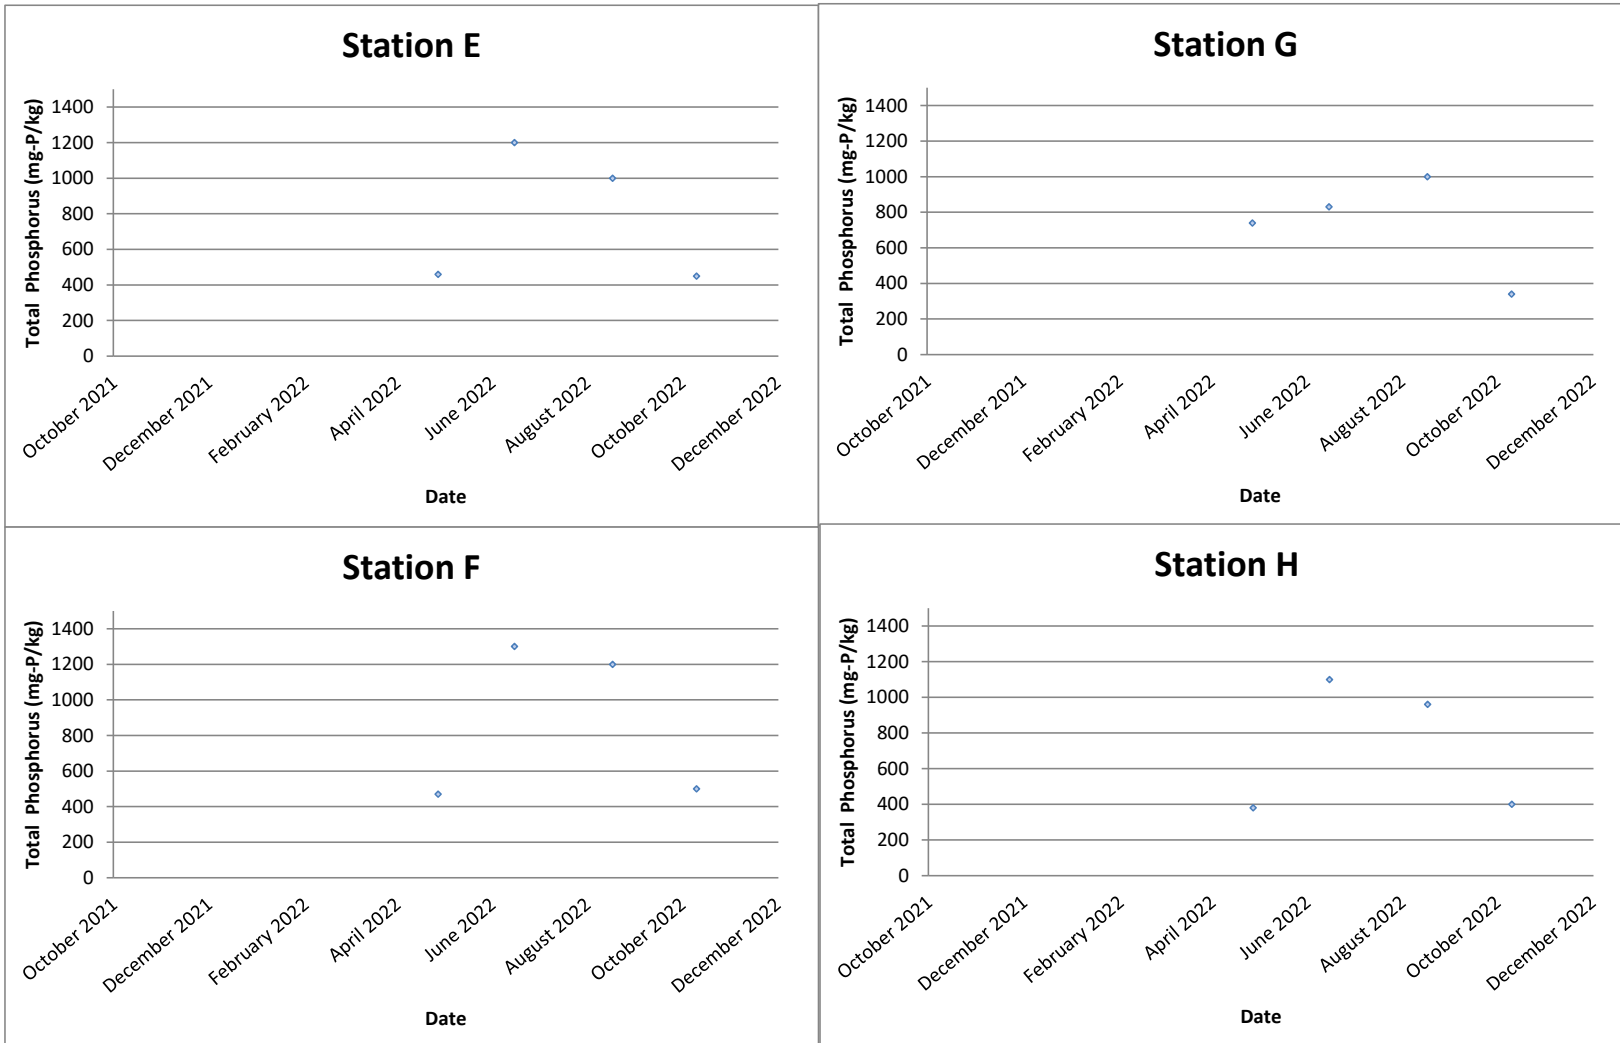


Cadmium (mg/kg)

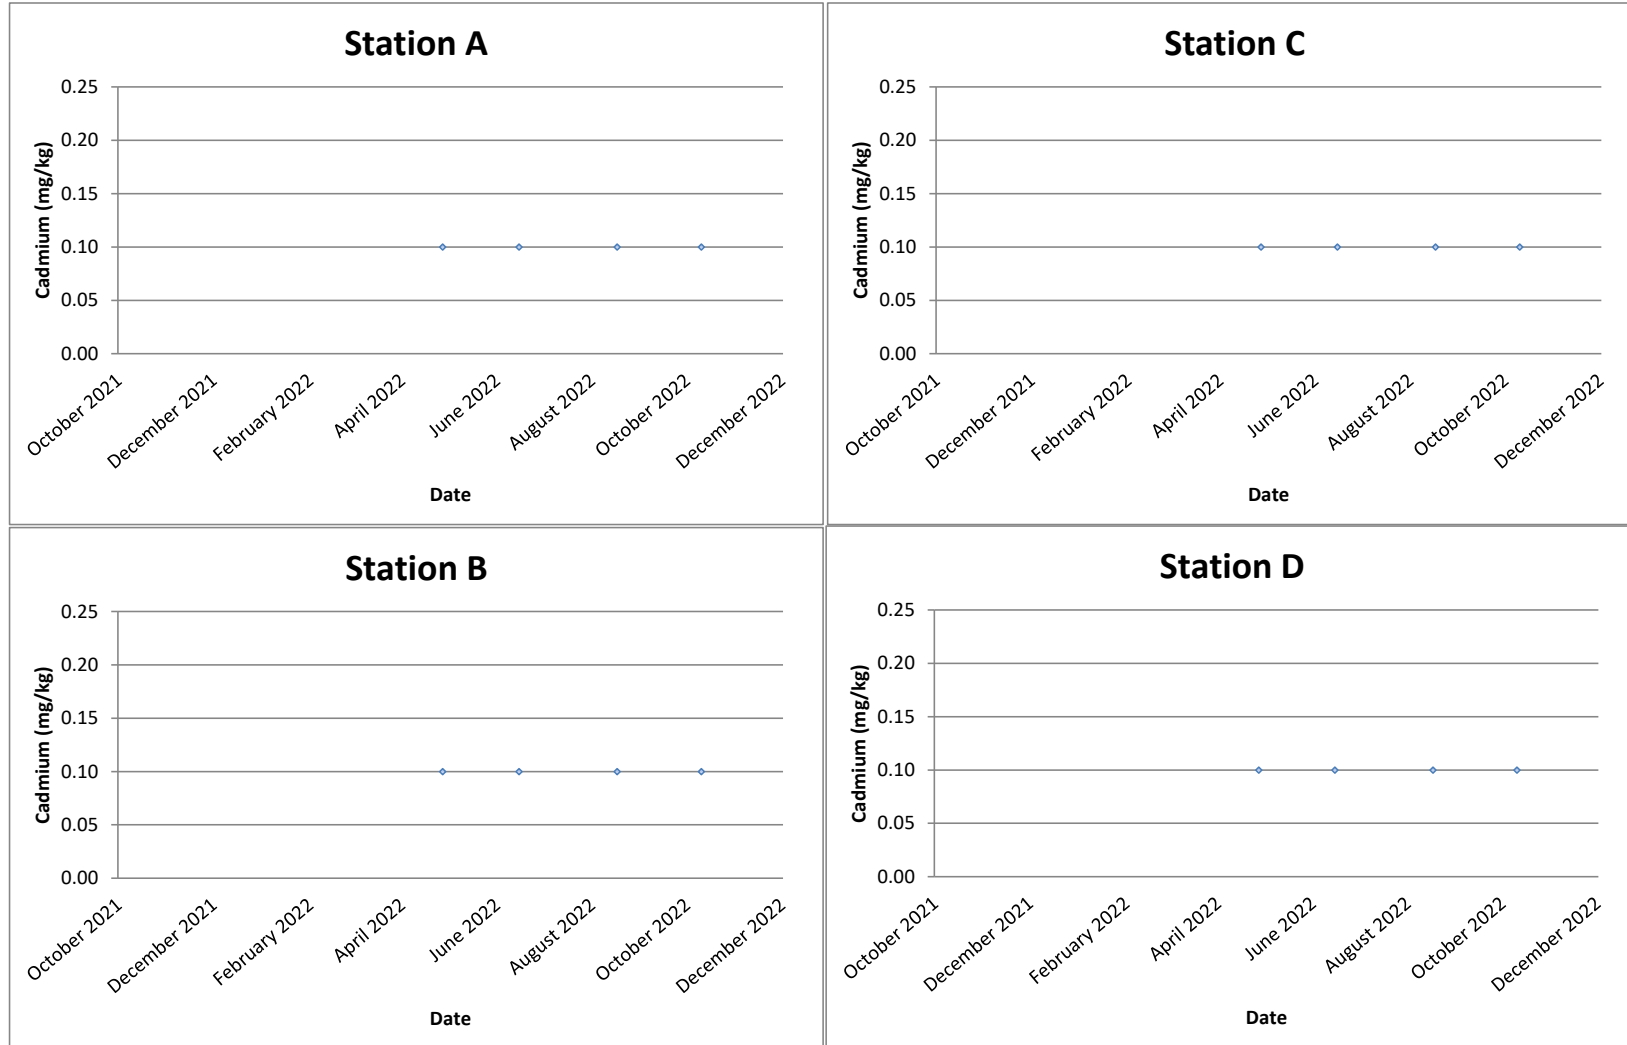


Remark: All below the Limit of Report sample results (<0.1 mg/kg) for Cadmium is regarded as 0.1 mg/kg in graphical presentation.

Cadmium (mg/kg)

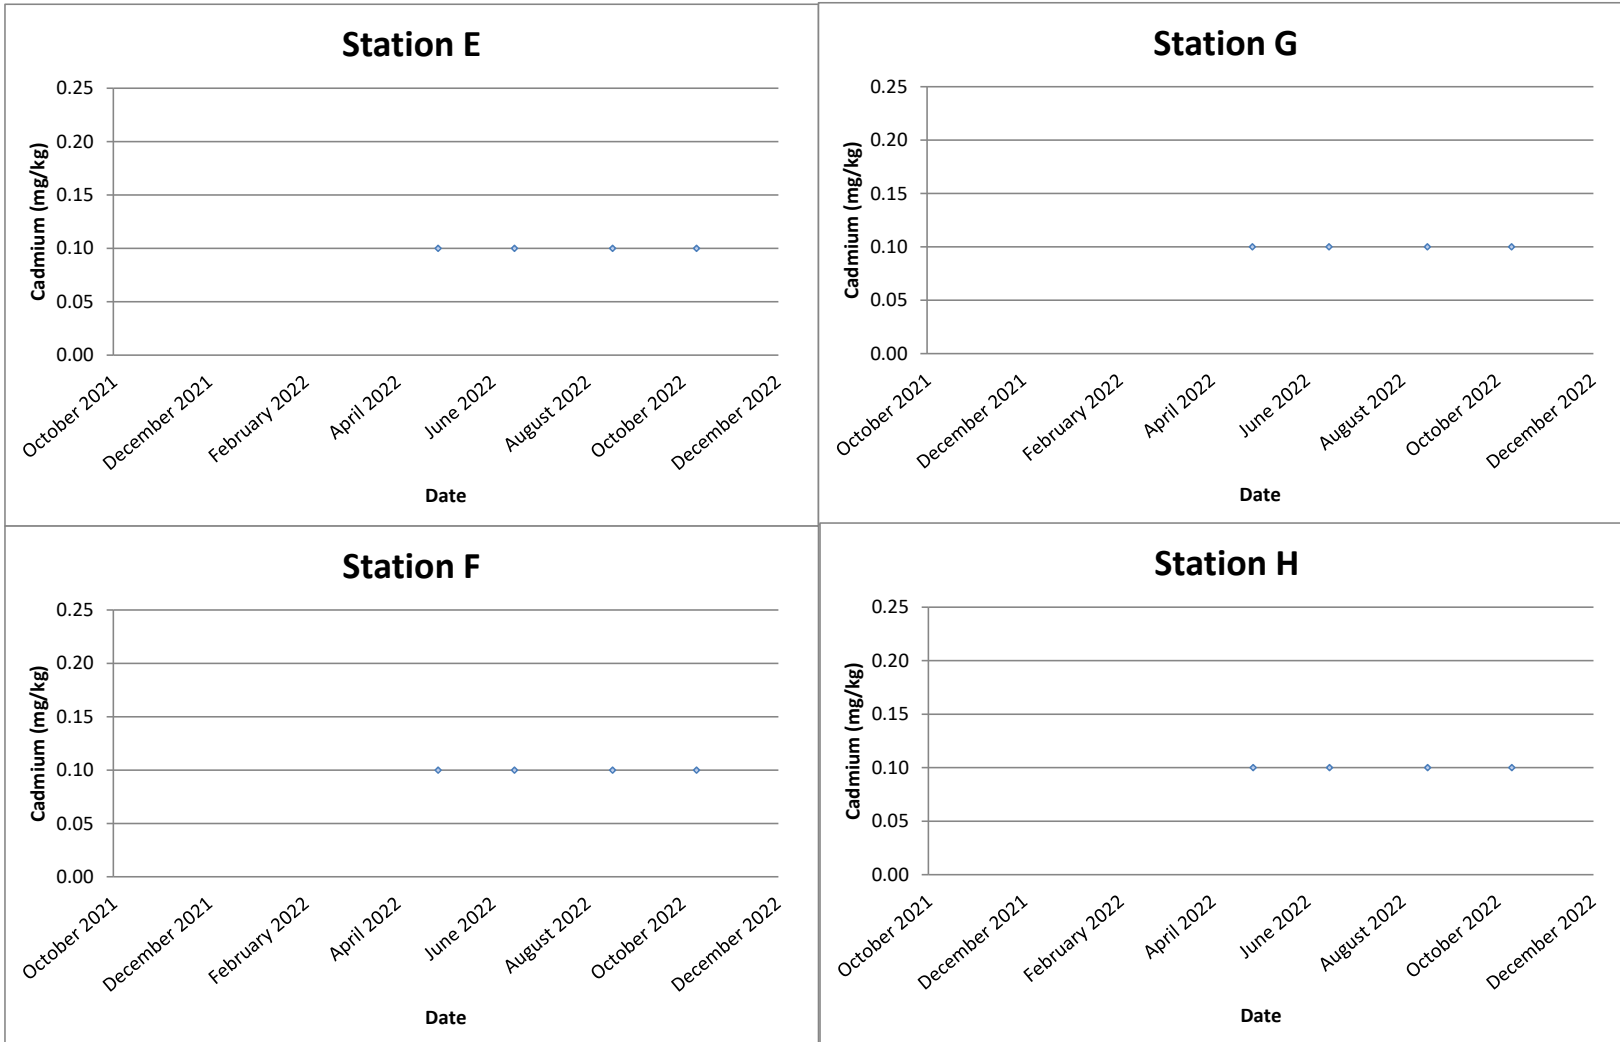


Remark: All below the Limit of Report sample results (<0.1 mg/kg) for Cadmium is regarded as 0.1 mg/kg in graphical presentation.





Chromium (mg/kg)

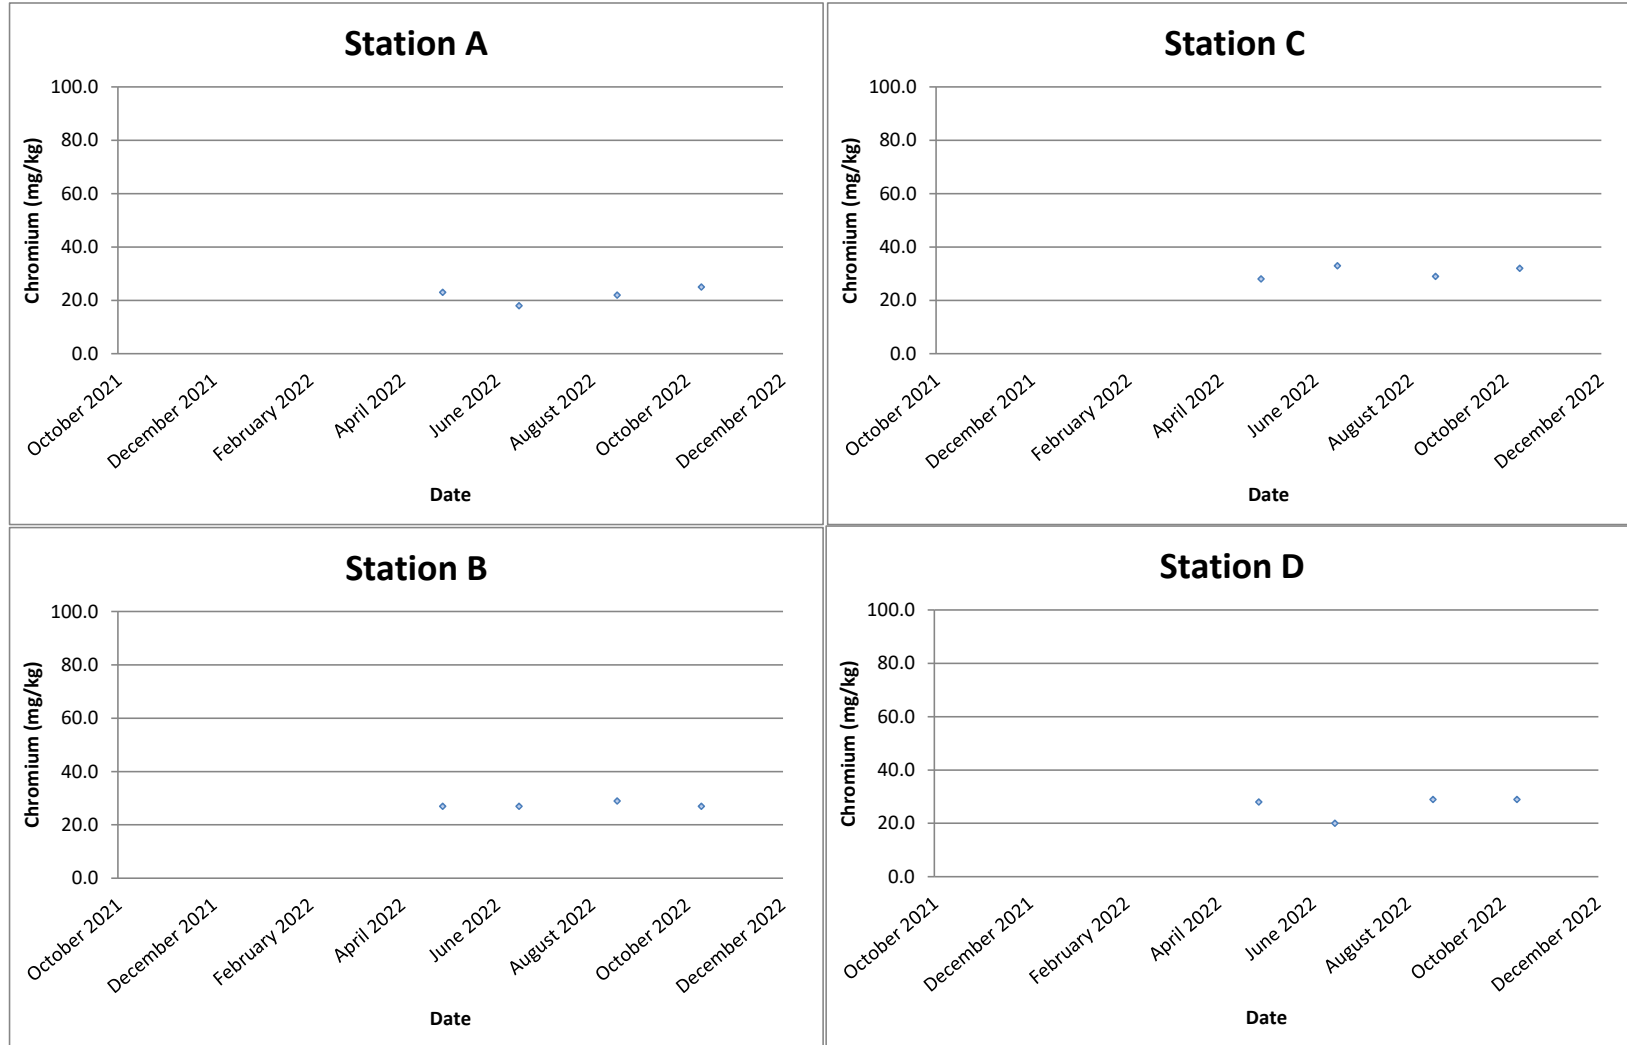


Chromium (mg/kg)

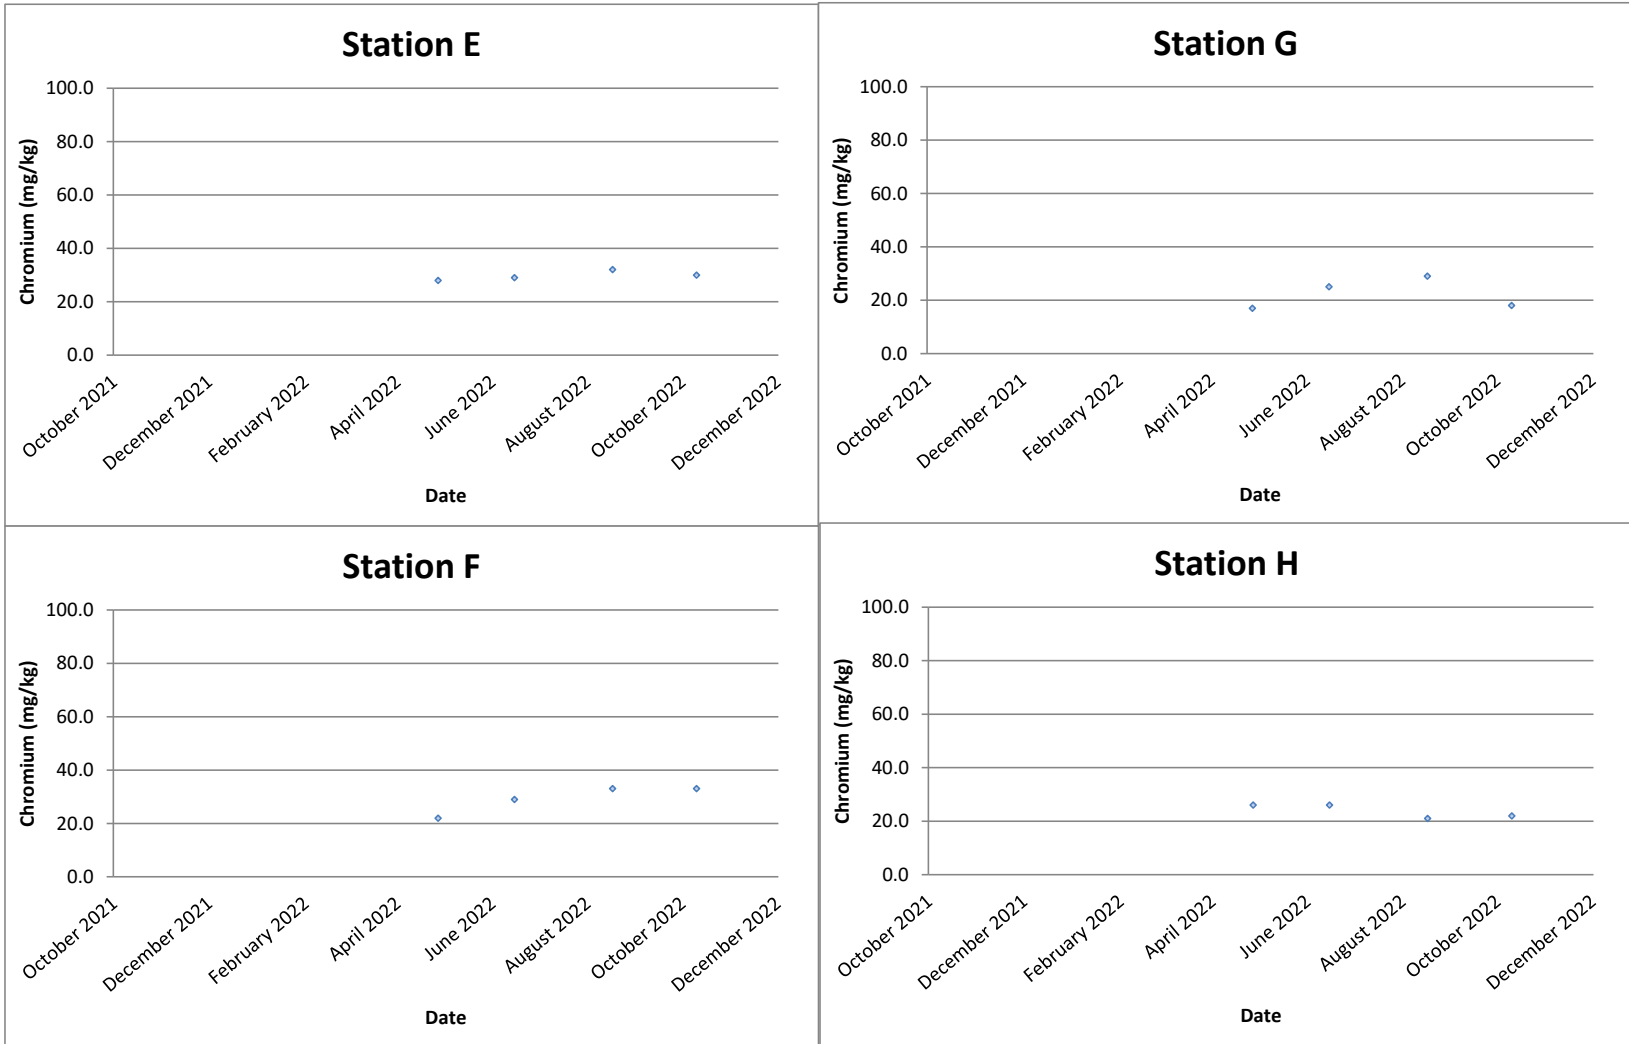

Copper (mg/kg)

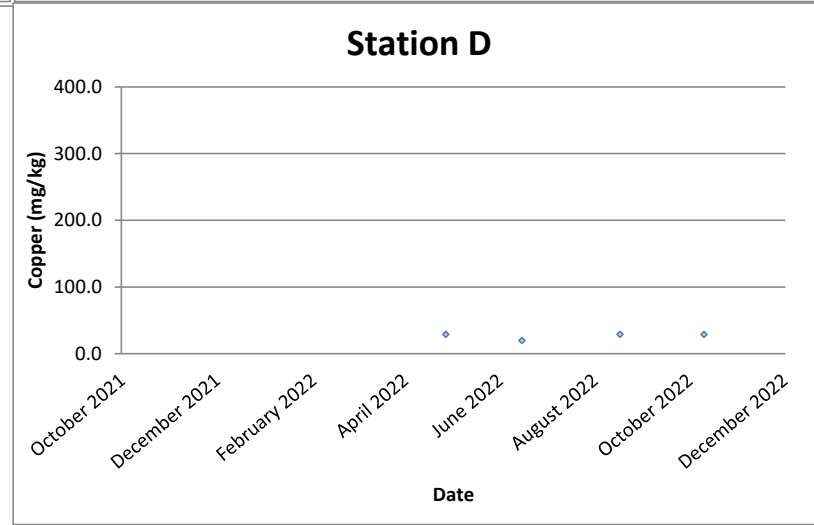
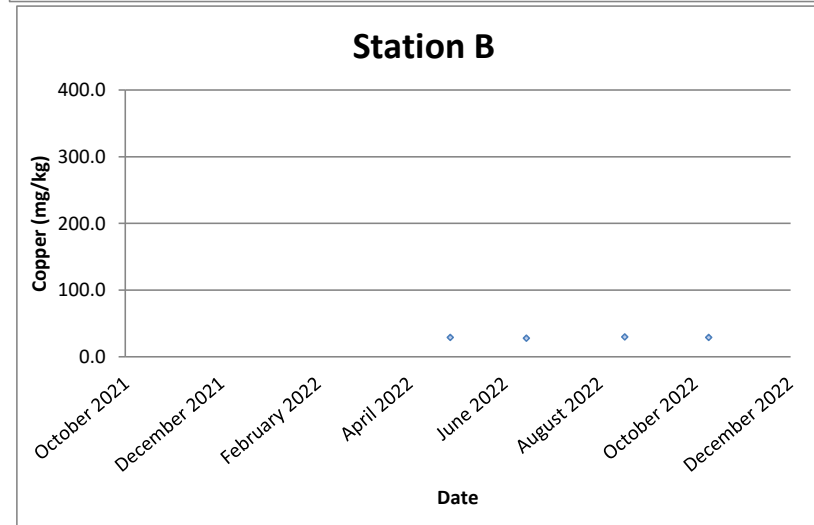
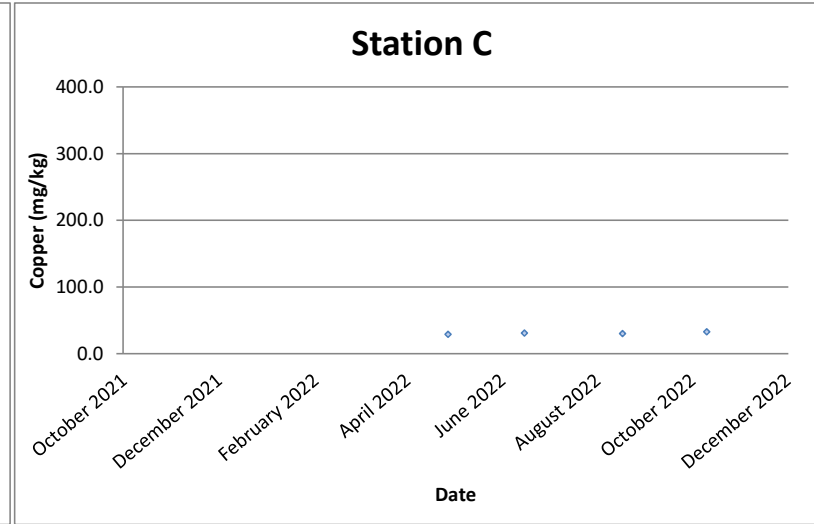
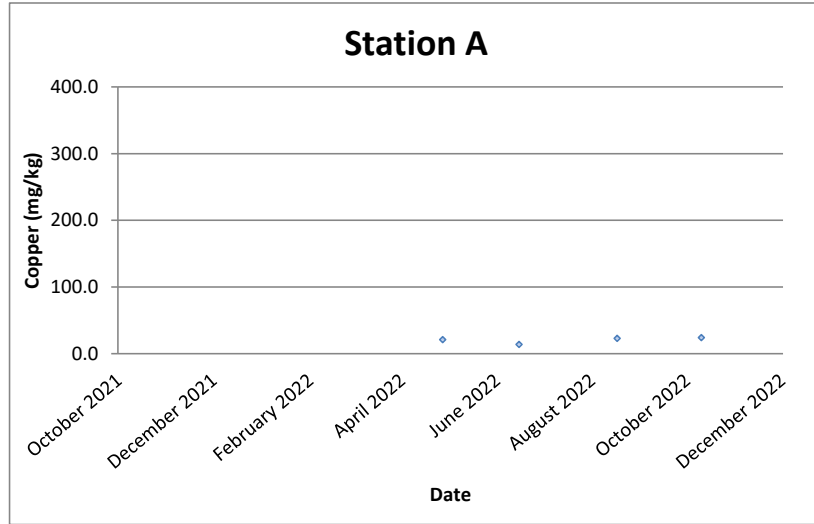


Copper (mg/kg)

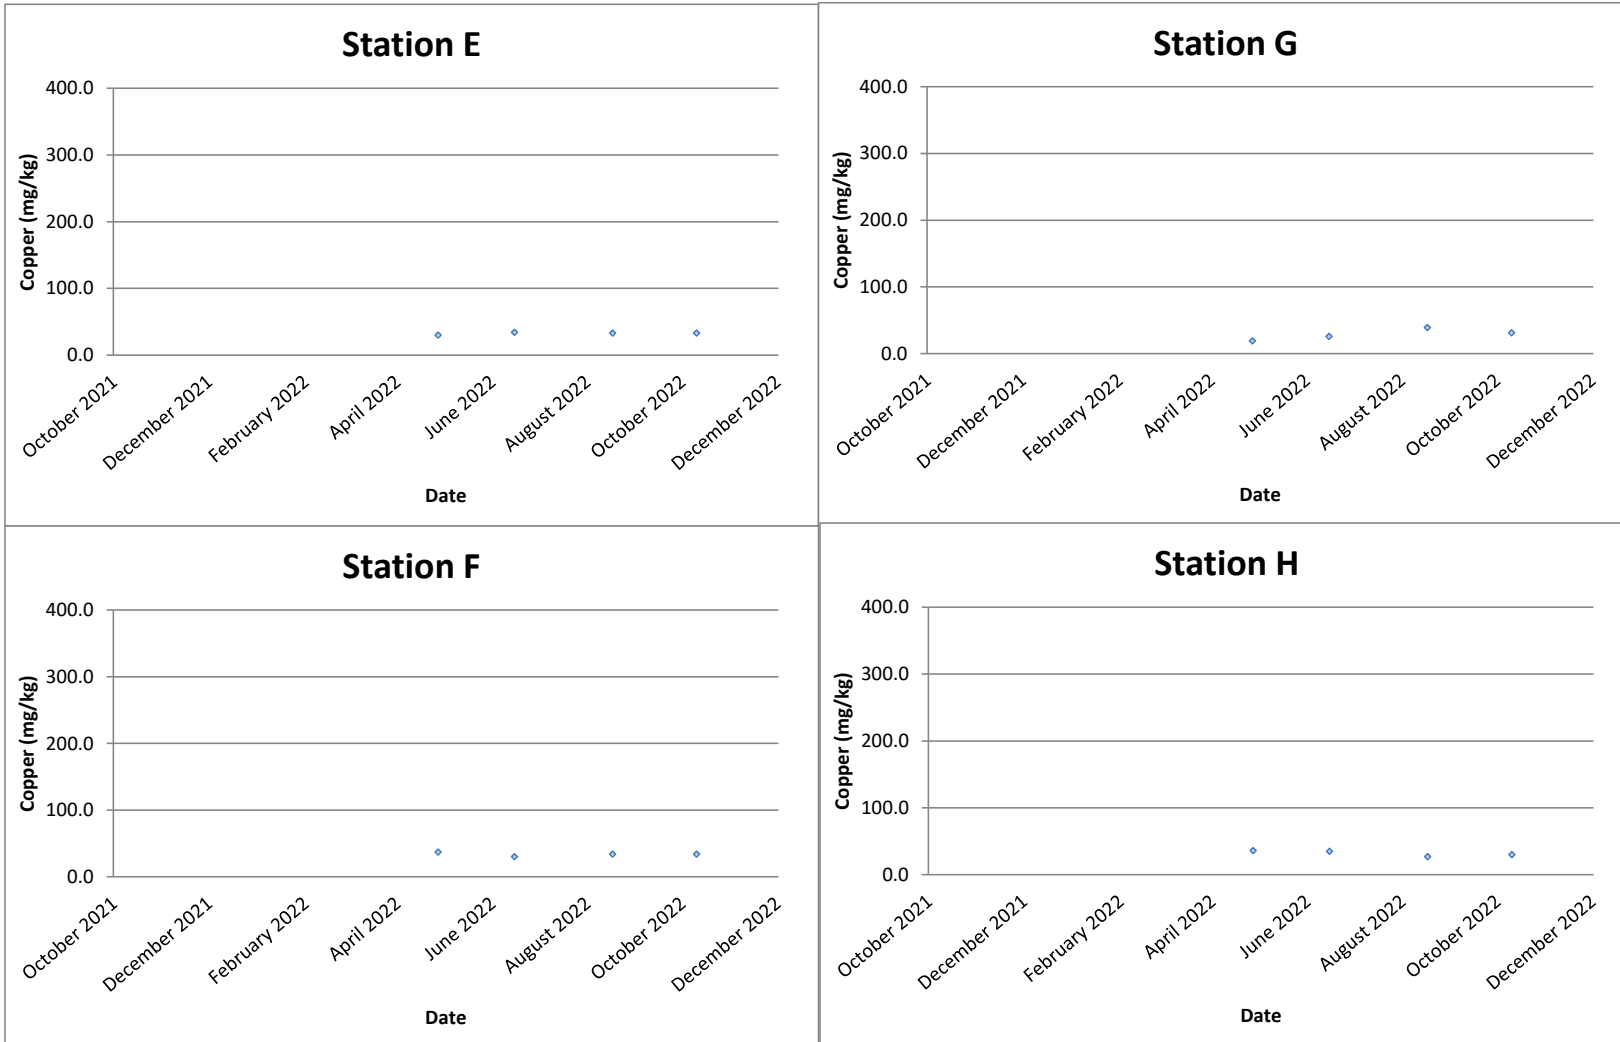





Lead (mg/kg)

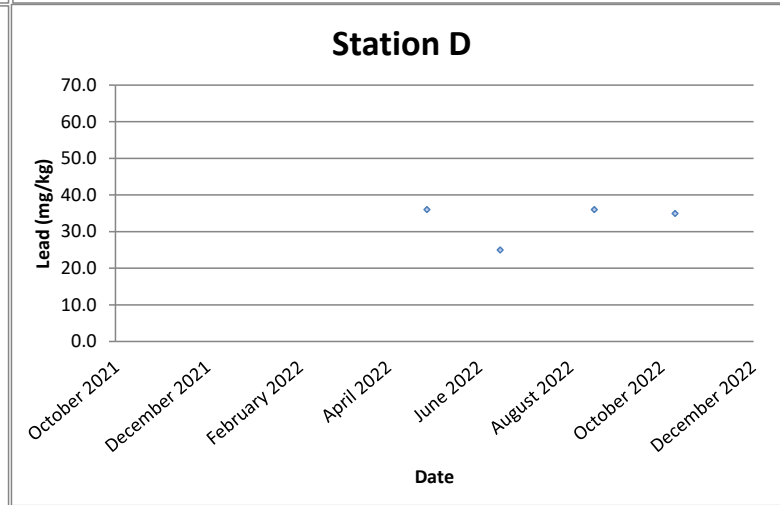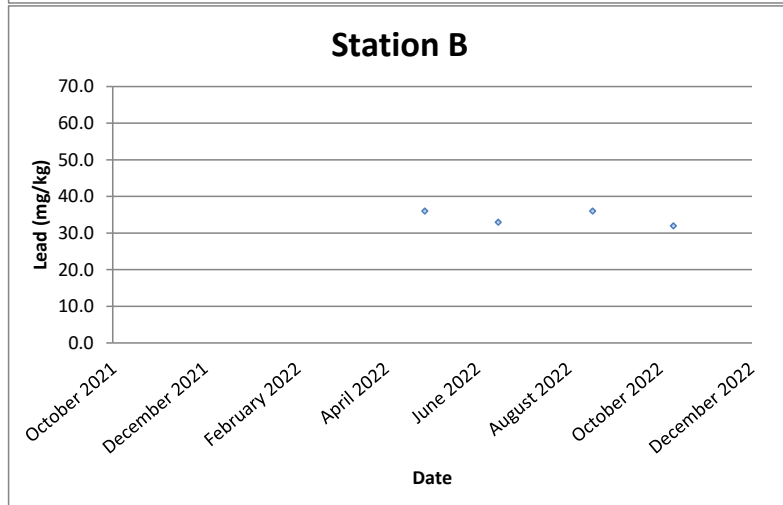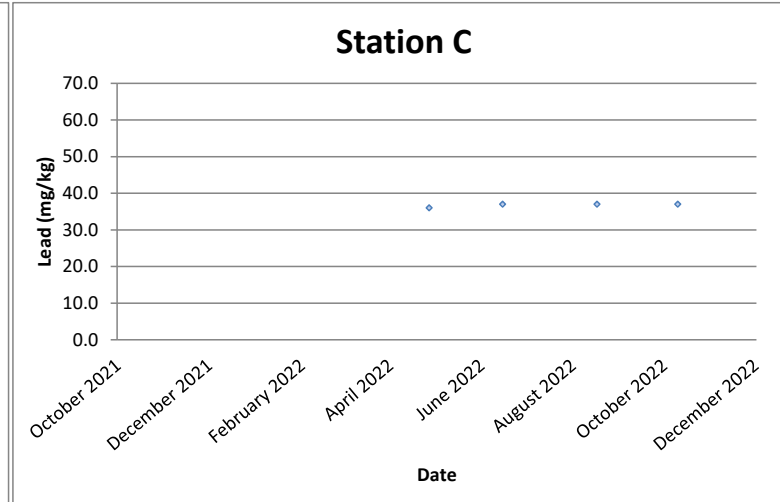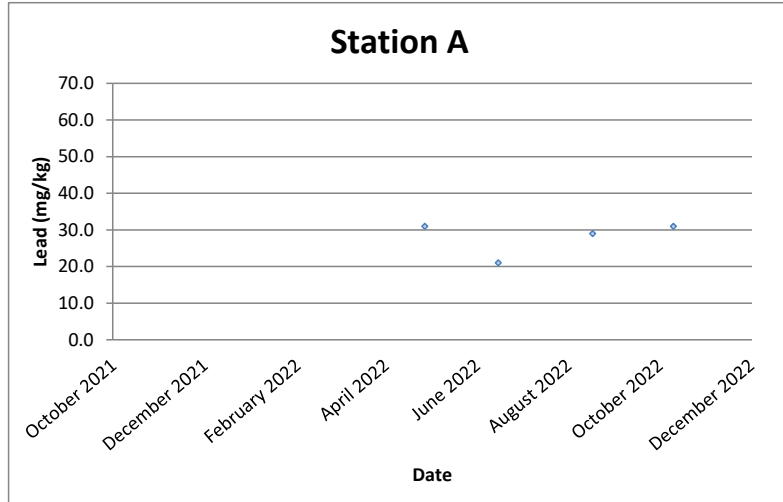


Lead (mg/kg)

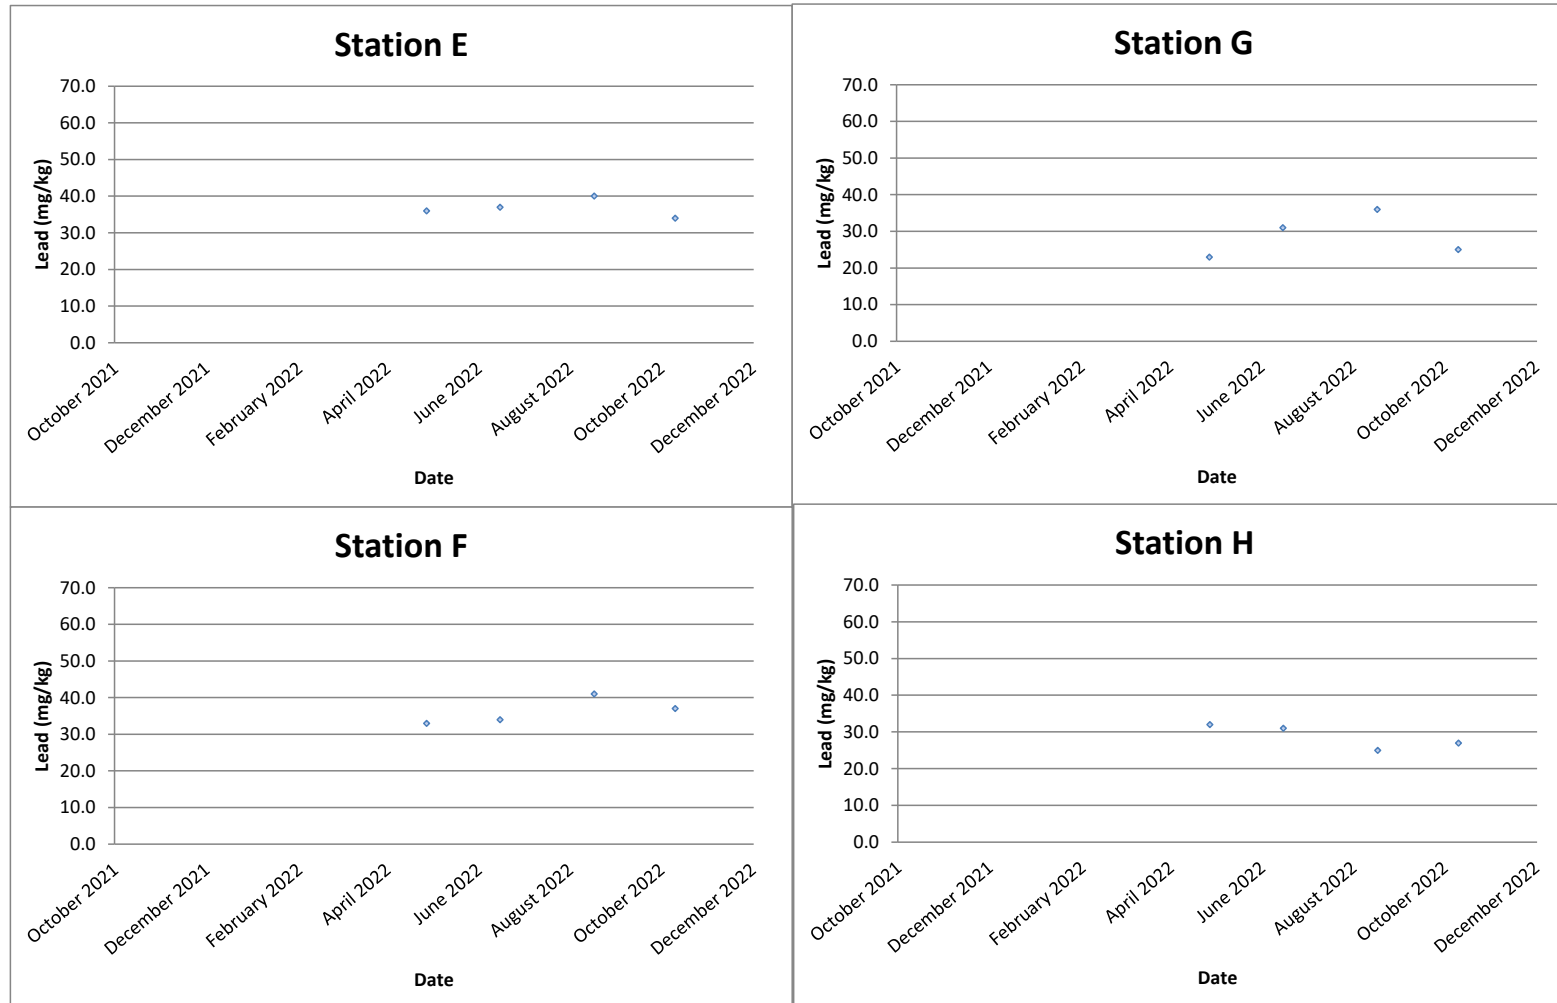





Mercury (mg/kg)

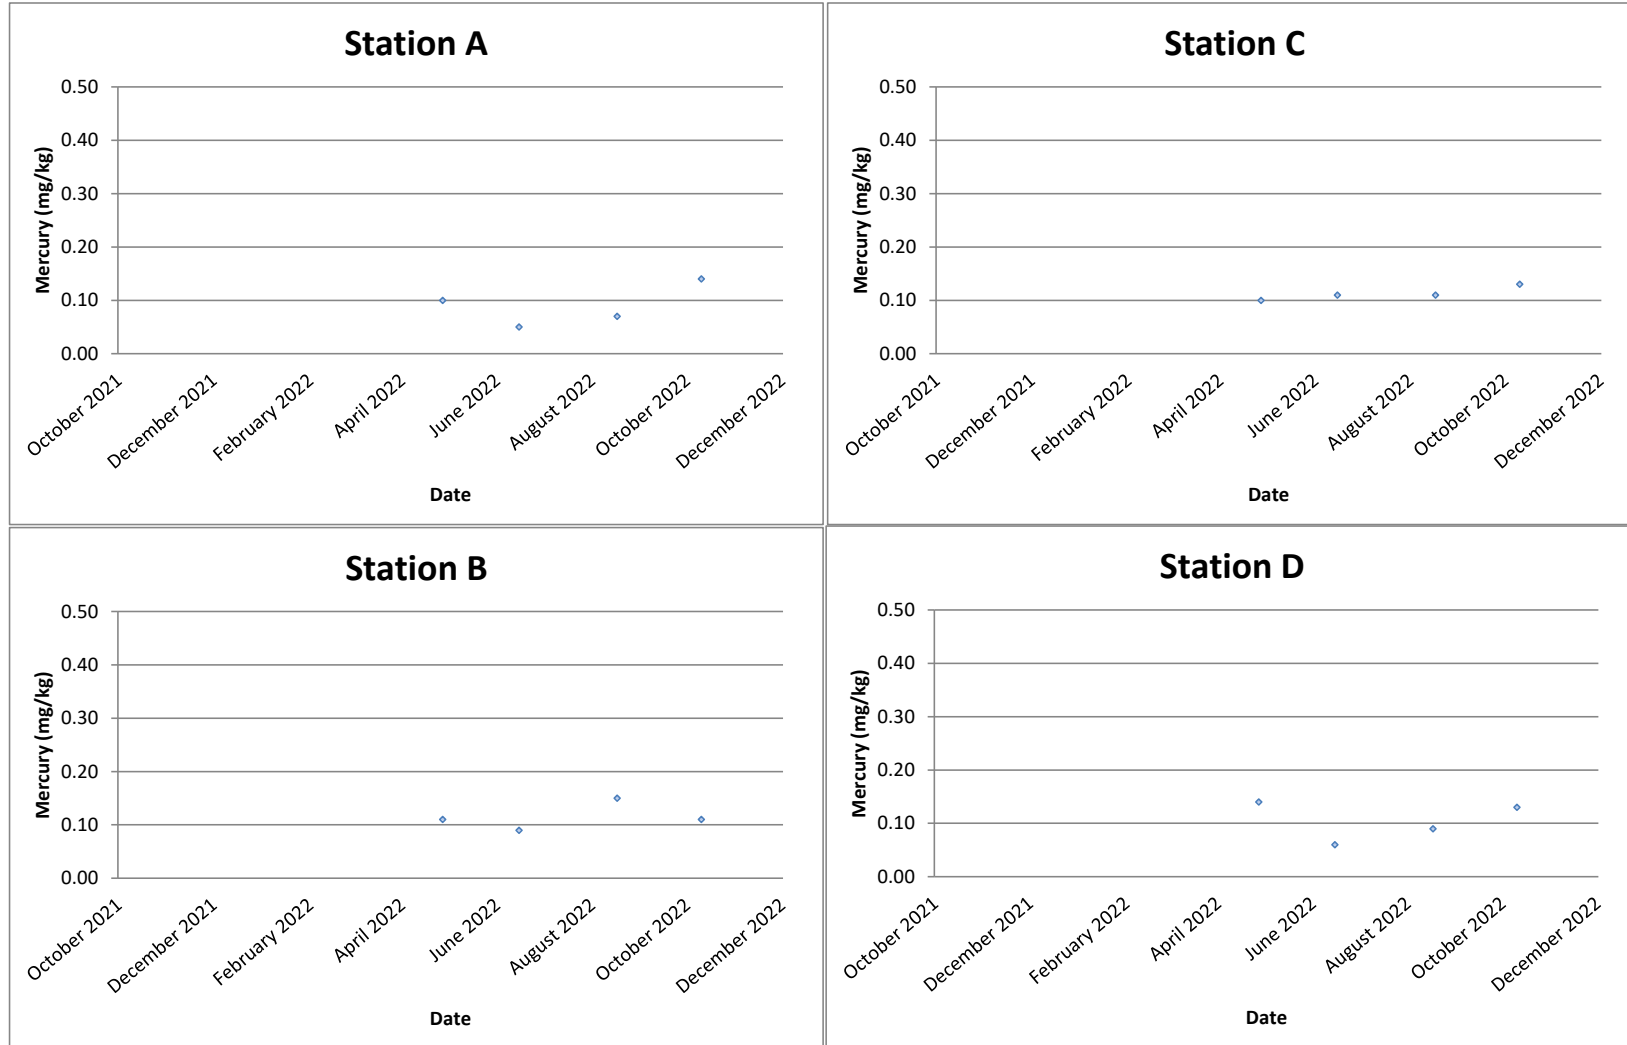


Mercury (mg/kg)

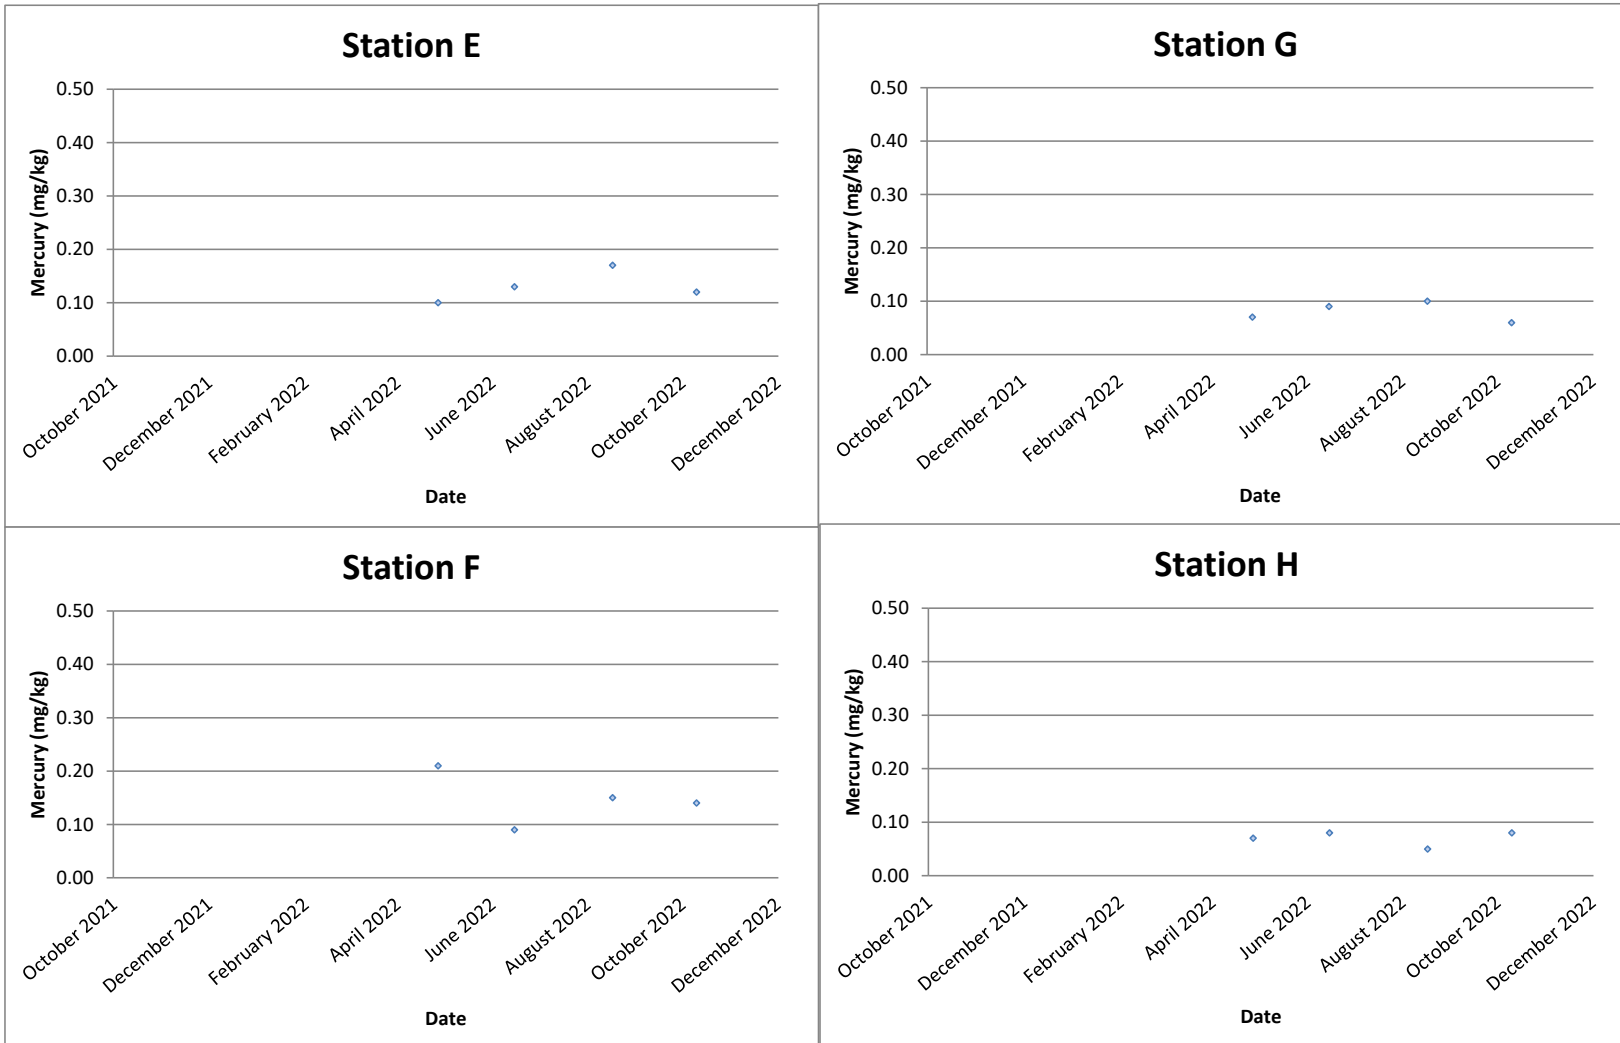





Nickel (mg/kg)

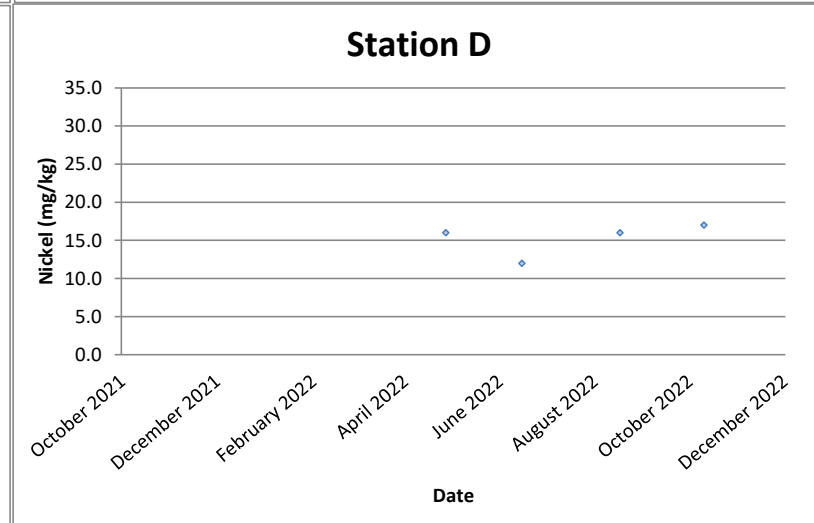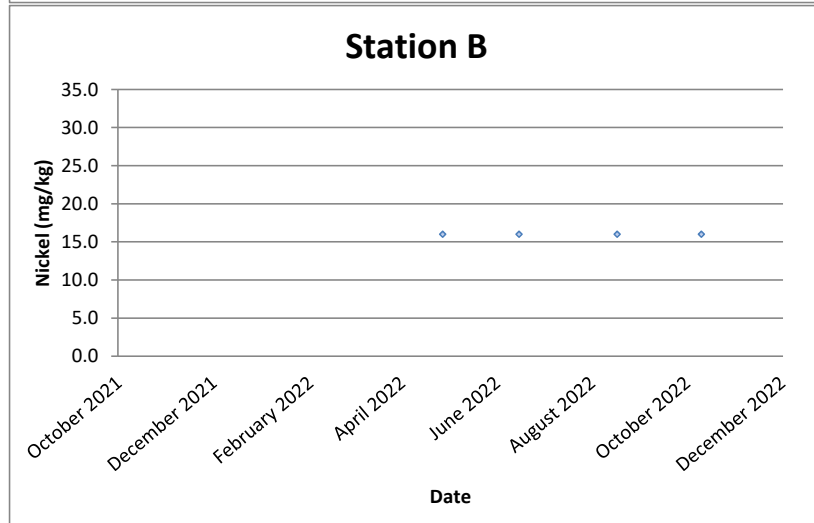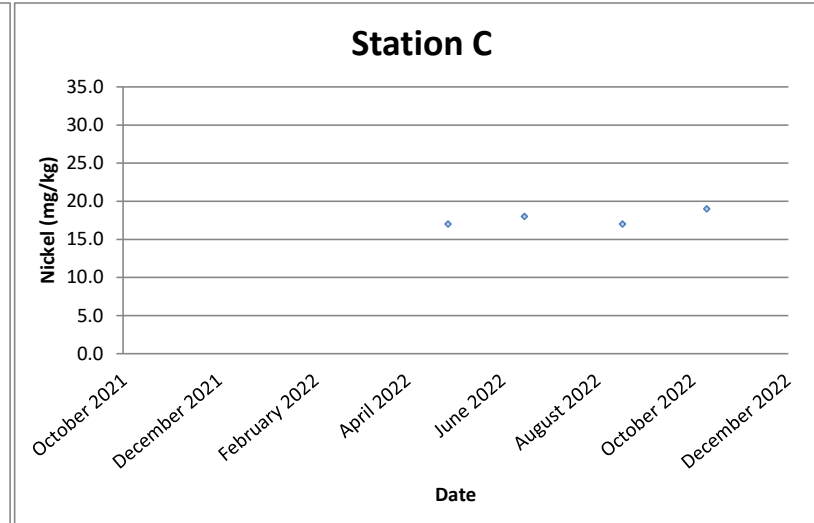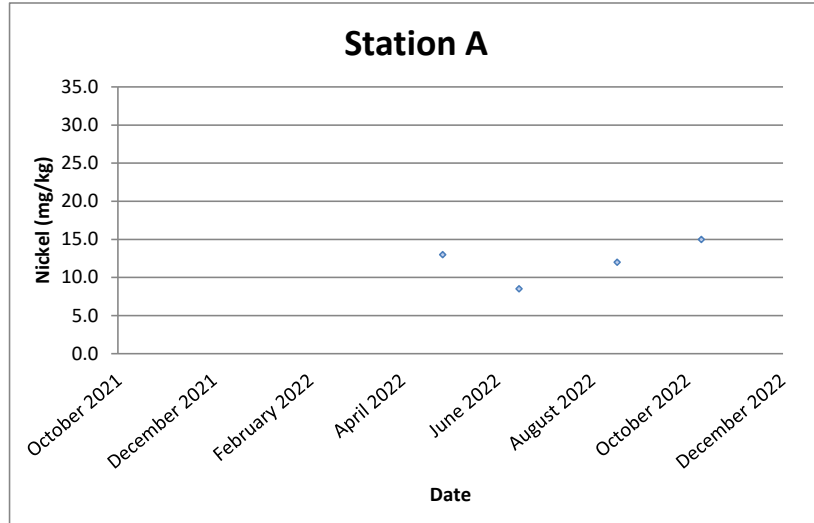


Nickel (mg/kg)

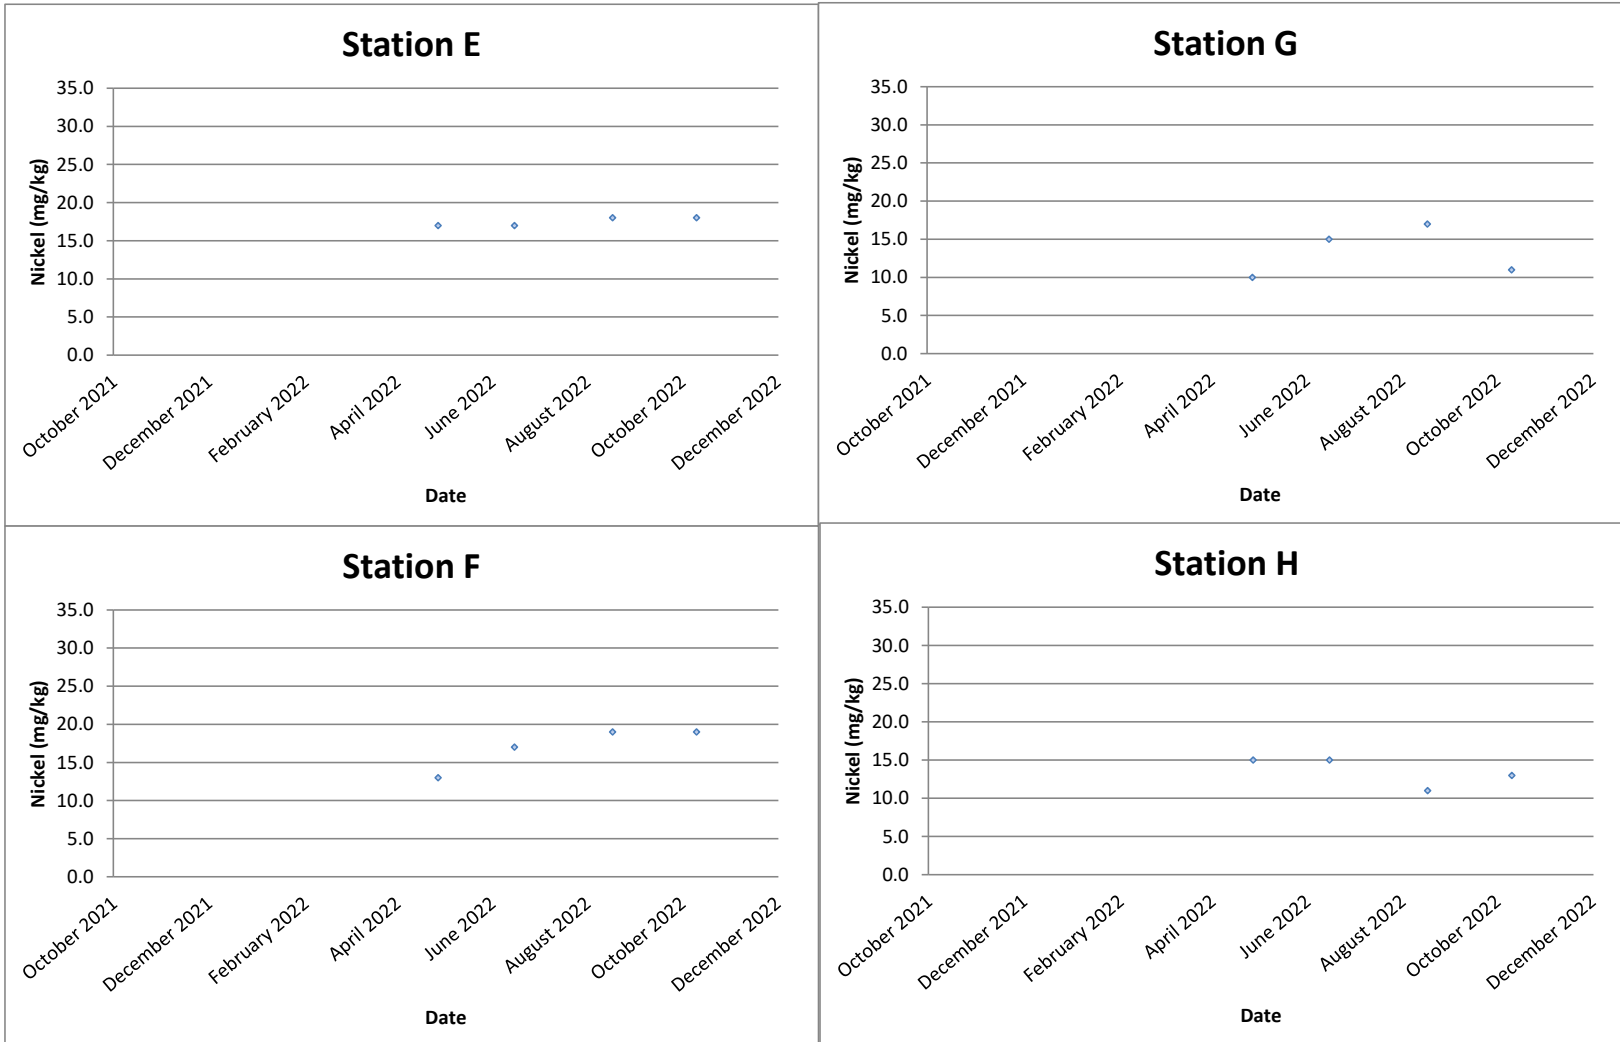

Zinc (mg/kg)

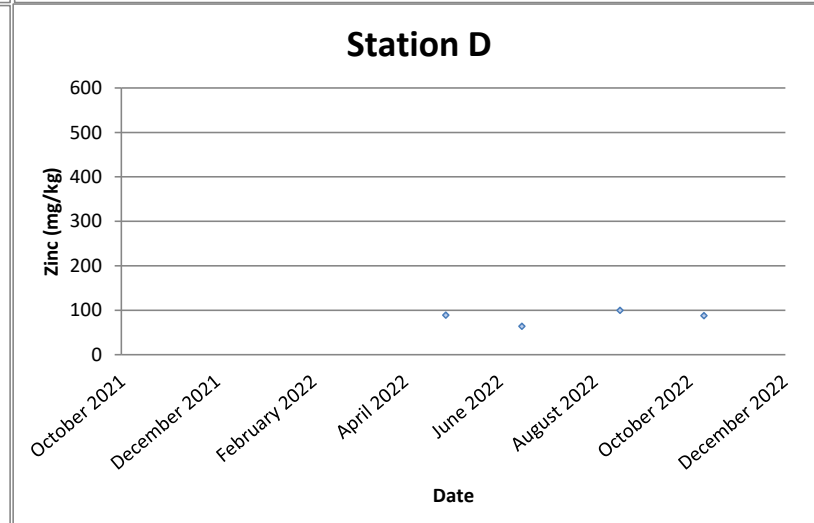
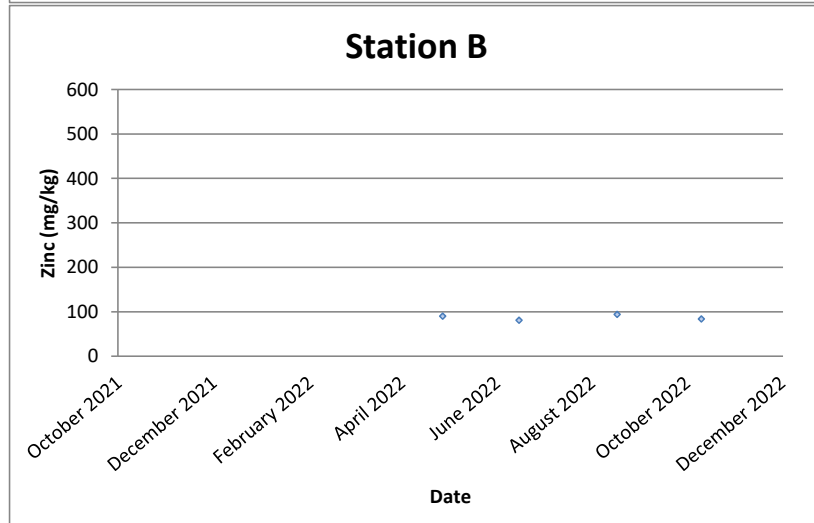
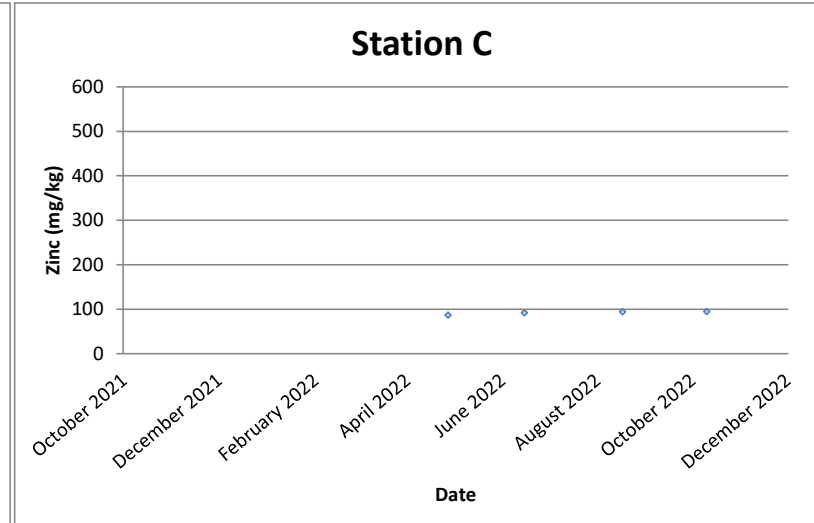
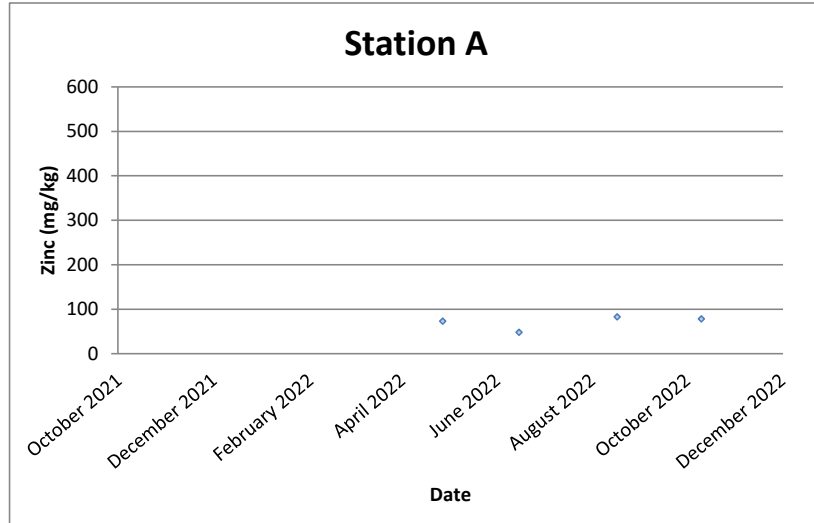


Zinc (mg/kg)

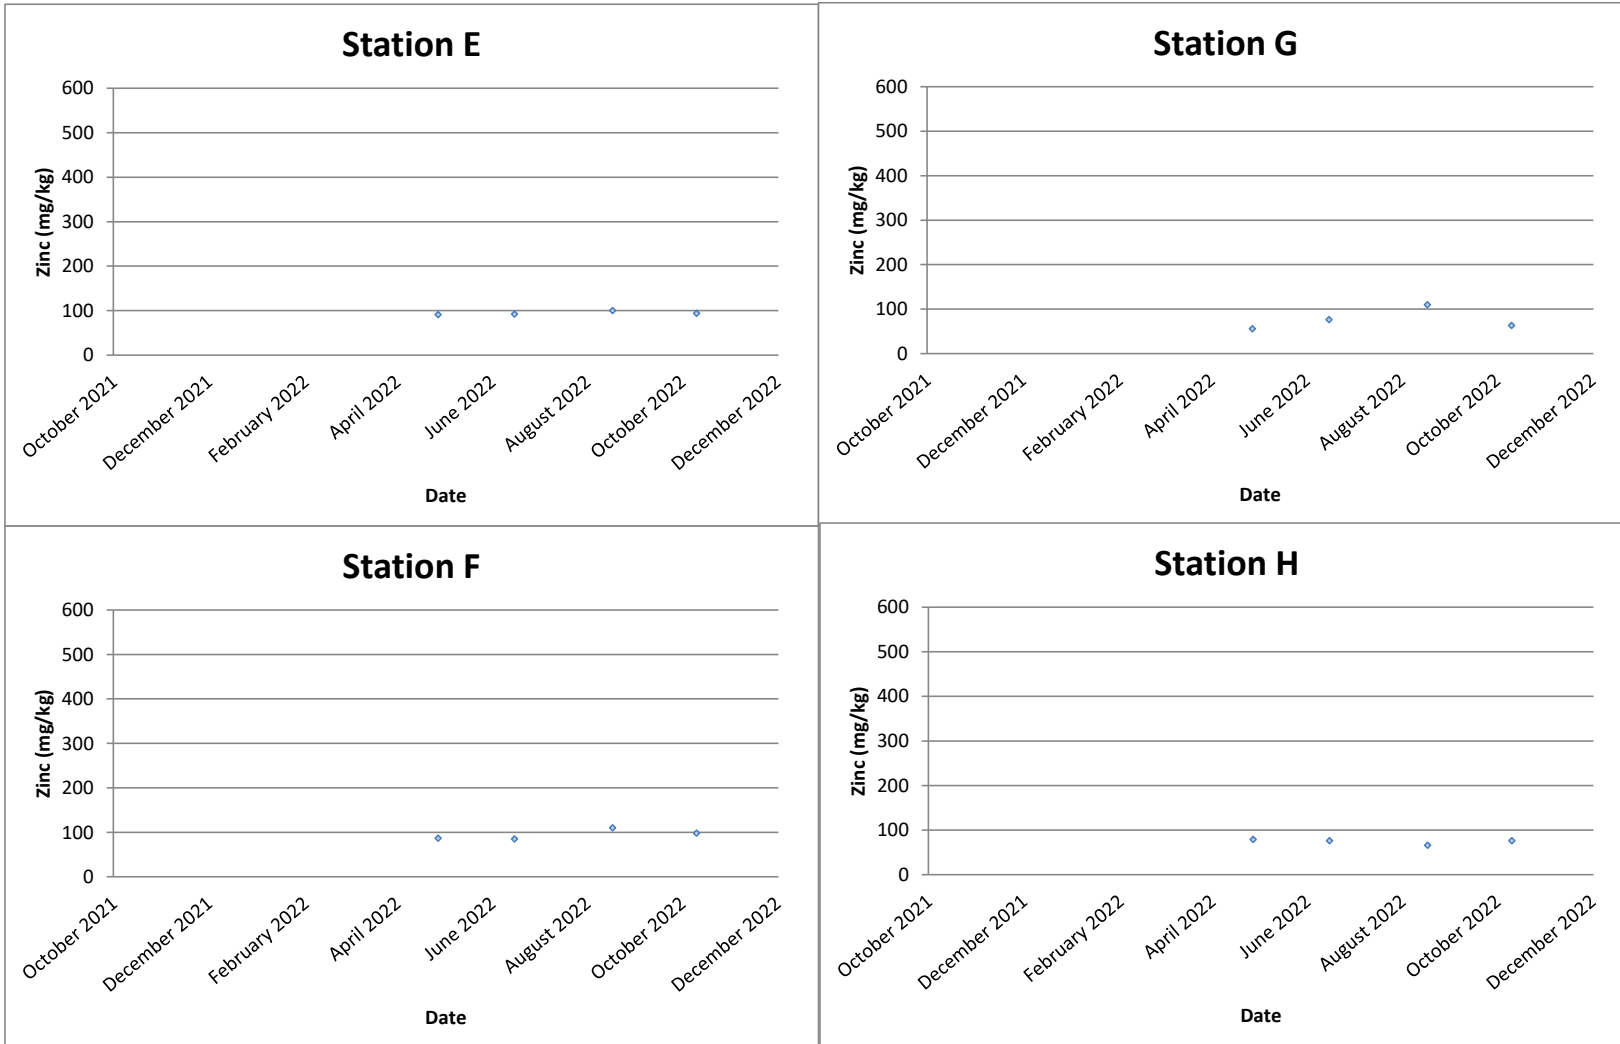





Arsenic (mg/kg)

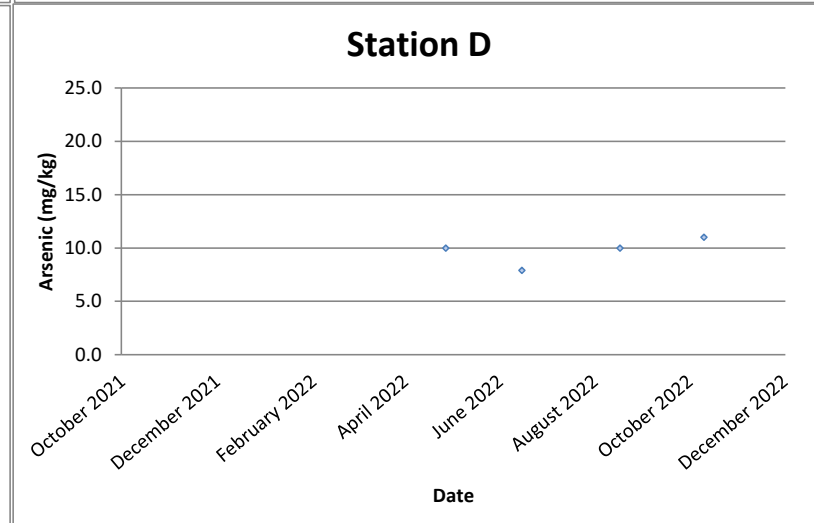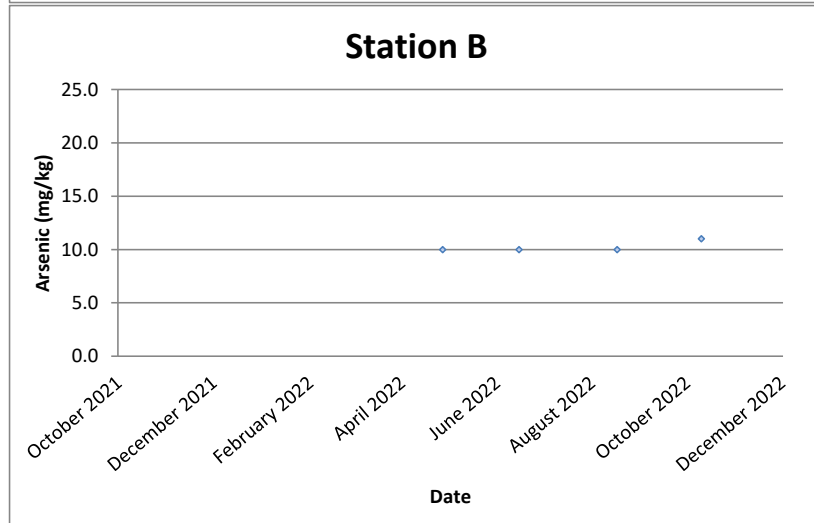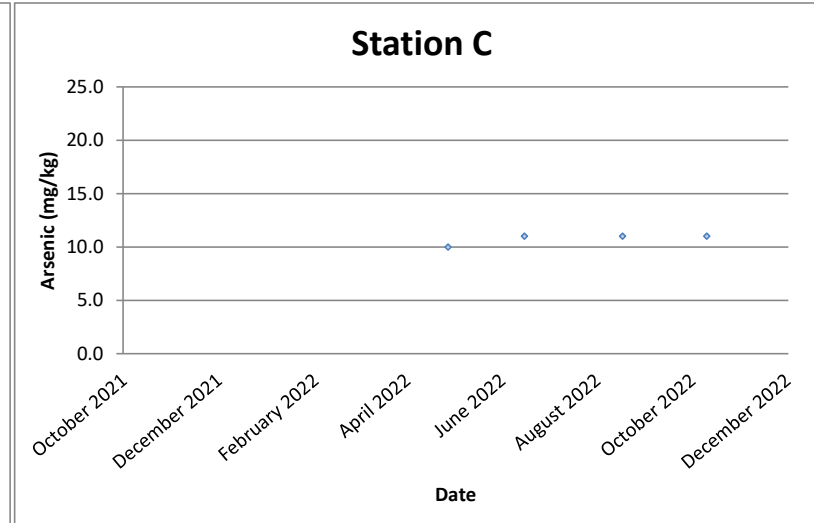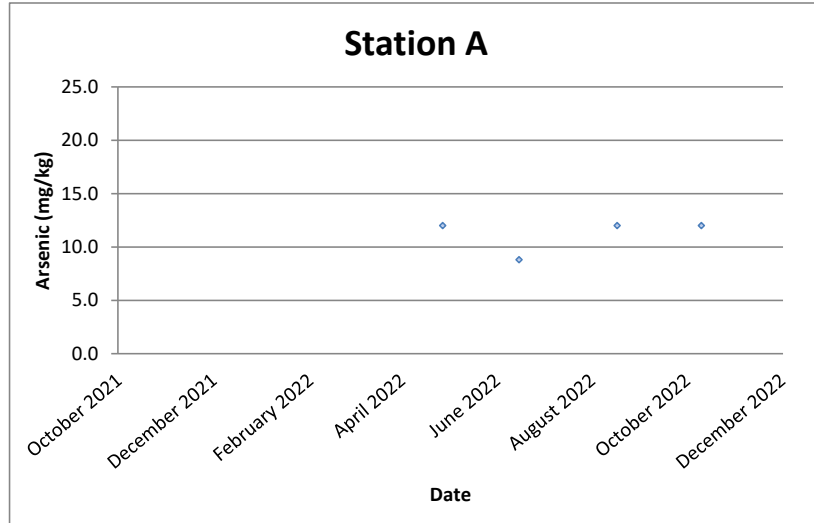


Arsenic (mg/kg)

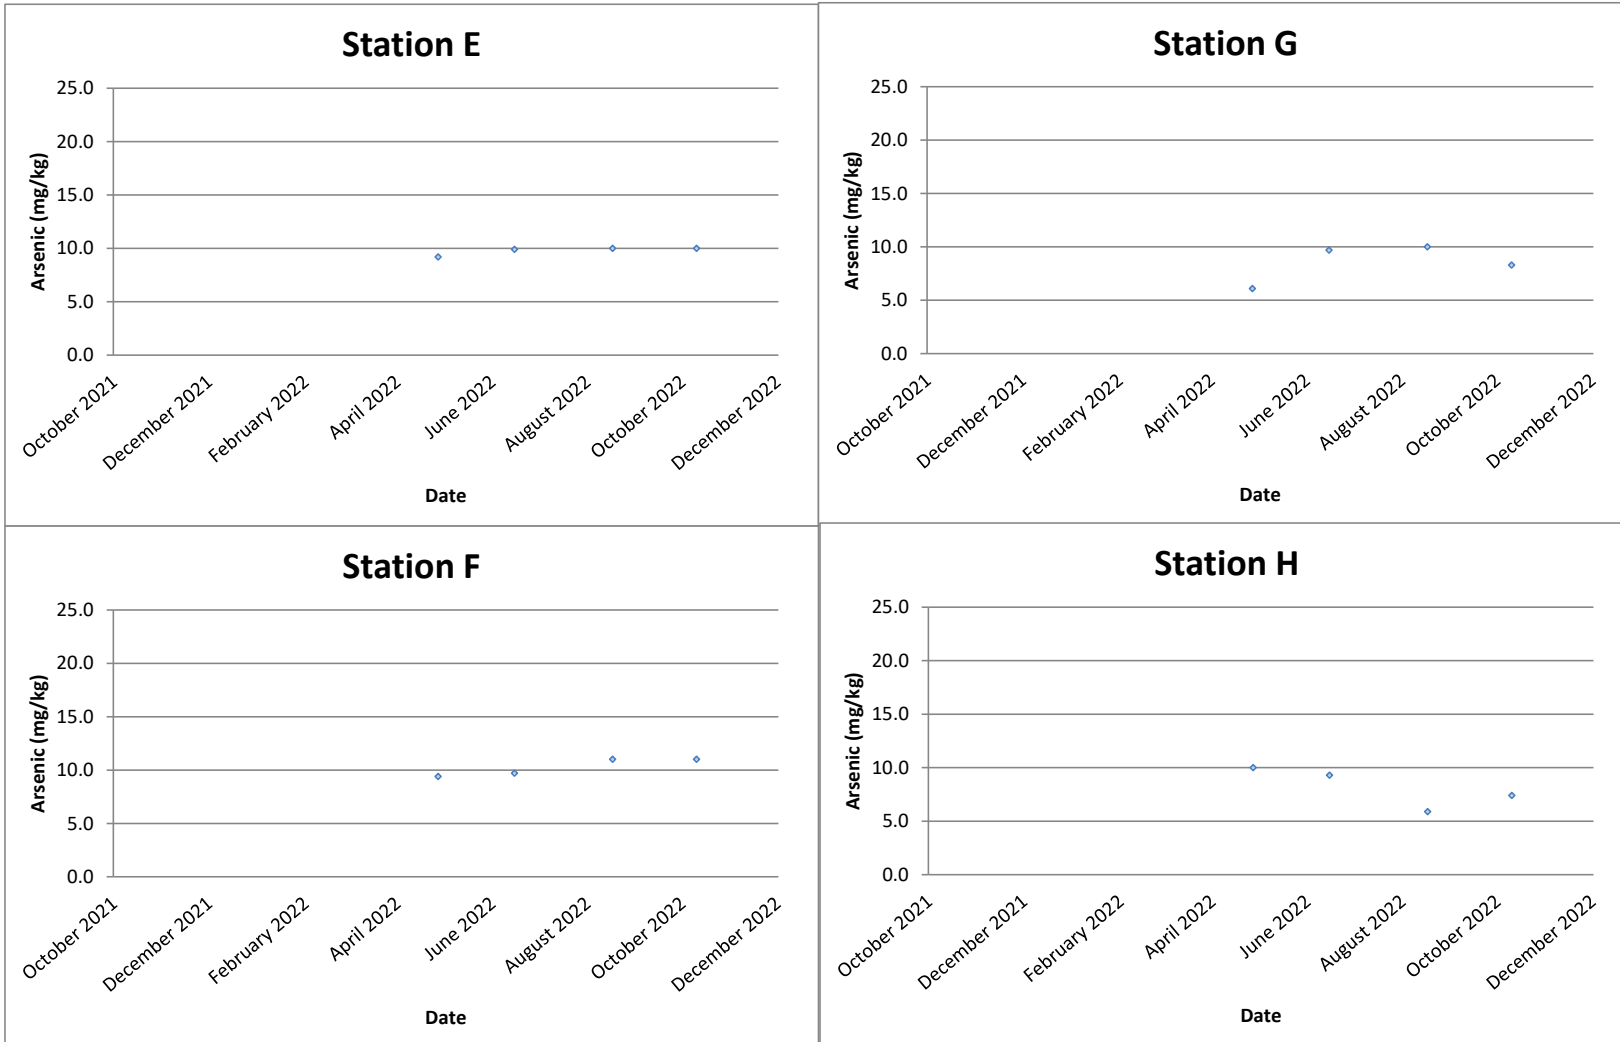

Silver (mg/kg)

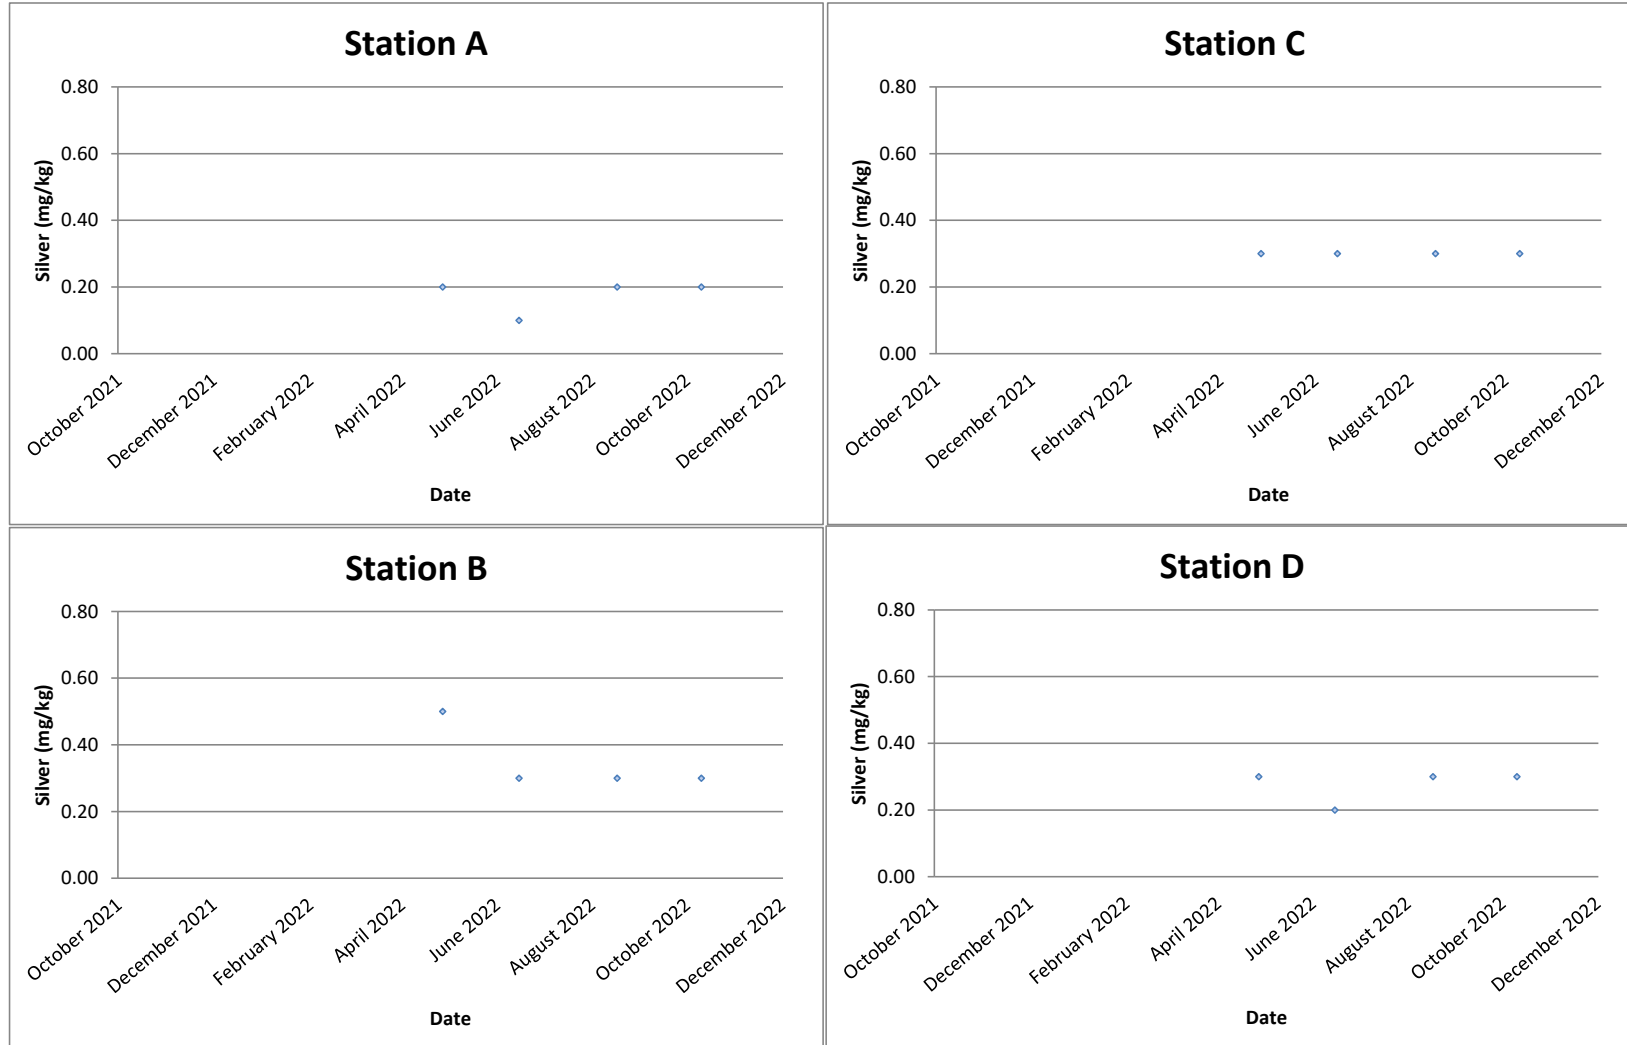

Silver (mg/kg)

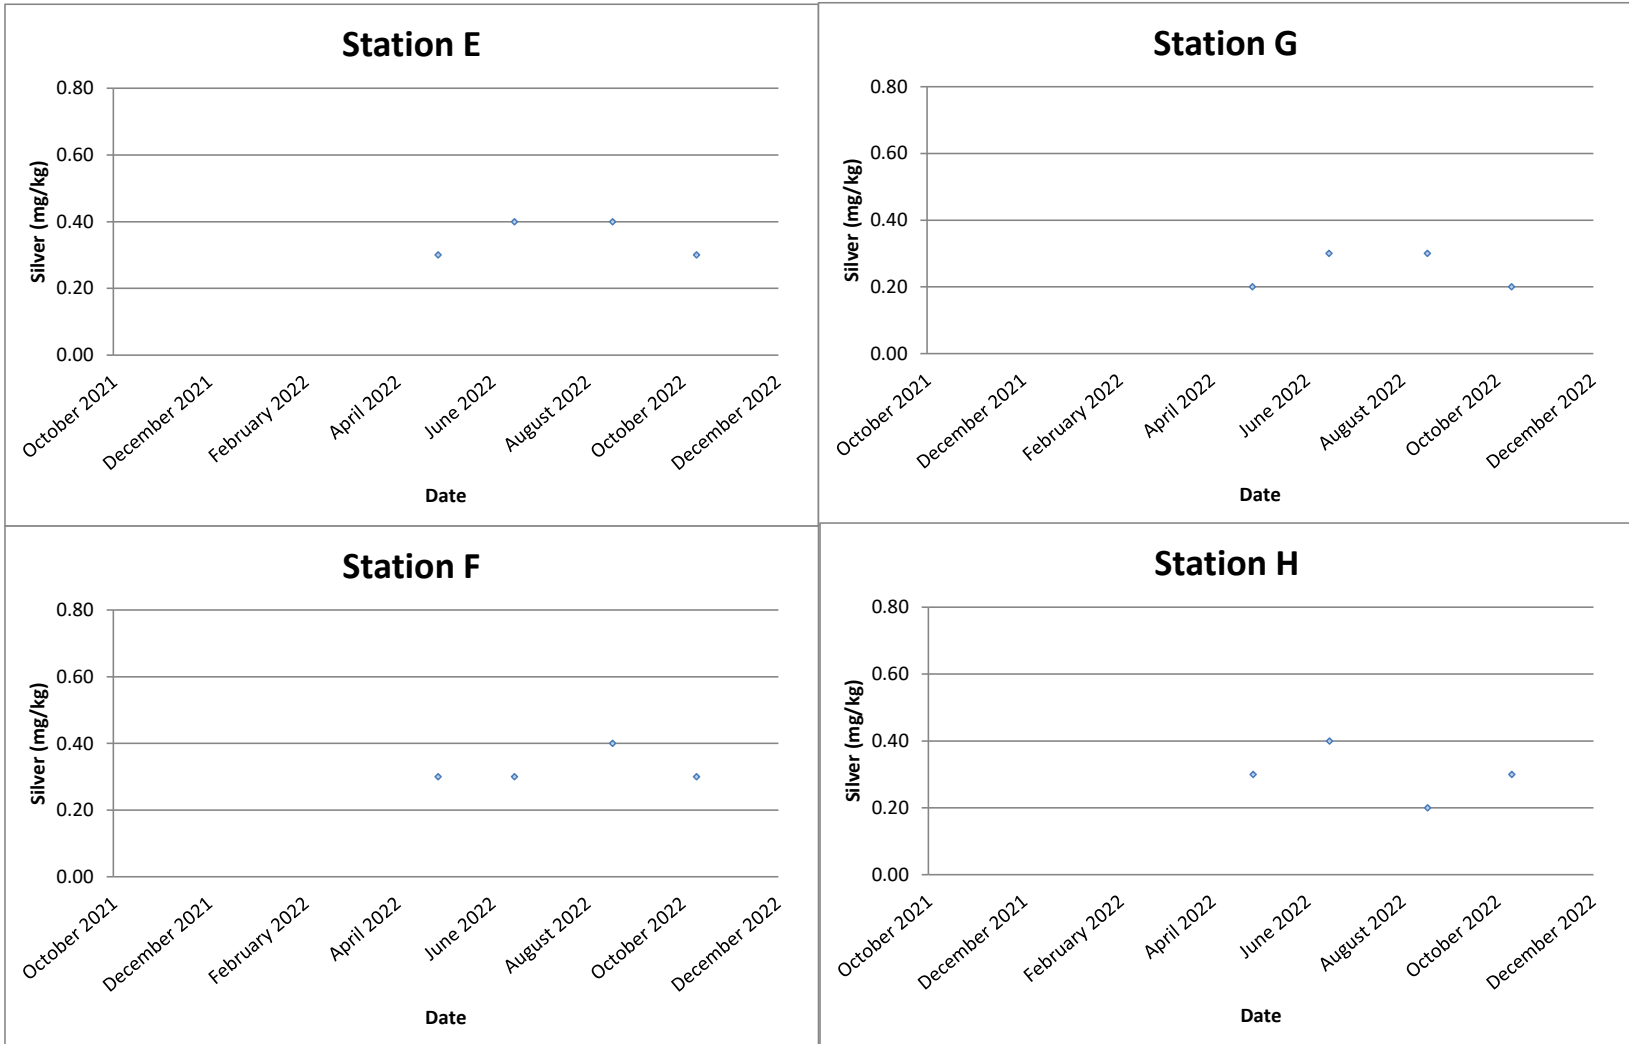

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix I Benthic Survey Report

# Benthic Survey Report (10 October 2022)

## Abundance

A total of 347 benthic organisms were recorded from the eight monitoring stations during the October 2022 monitoring period. Current monitoring results showed lower total monthly abundance compared to both dry (March 2004) and wet (August 2004) seasons baseline data results (**Figure 1**). The current decrease in overall abundance may be attributed to the decrease in *Trypauchen* and *Styela* abundance which could have been due to the concurrent increase in ammonia of the sediments relative to August 2022 data. As shown in several studies, higher levels of ammonia may cause lower macrobenthic density (Lai et al., 2020). Similar with previous monitoring periods, total monthly abundance of benthic organisms exhibits significant seasonal variation (F-value = 4.52; F-crit = 1.54; p-value = 2.05E-10;  $\alpha$  = 0.05).

In terms of spatial distribution, the lowest abundance of 20 ind. was recorded in the impact station, Station C, while the highest (68 ind.) was also noted in other impact station, Station D (**Figure 2**). Total macro-benthic abundances, similar with the previous monitoring periods, showed statistically significant spatial distribution (F-value = 3.62; F-crit = 2.05; P-value = 0.001;  $\alpha$  = 0.05).

## Biomass

The total wet biomass recorded in the eight monitoring stations was 7.84 g with the highest biomass recorded in the reference station, Station G (3.13 g) while the lowest biomass (0.19 g) was observed in the reference station, Station F. Relative to the August 2022 period, a decrease in biomass was observed during the current monitoring period (**Figure 3**). Most of the current decrease was attributed to the biomass decrease of *Trypauchen* and *Styela* in the benthic community.

## Taxonomic Composition

A total of six phyla comprising of 20 families and 24 genera were identified. During the current monitoring period, the annelids (76.66%) dominated the macro-benthic assemblage, followed by the molluscs (10.95%) (**Figure 4**). Relative to the August 2022 community assemblage, current results showed that the annelids still maintained their dominance of the community.

The dominance of annelids in the community assemblage was still noted as it is still the wet season during the current survey.

## Diversity

Benthic diversity index (H') in the impact stations ranged from 1.47 to 1.59. In the reference stations, H' values ranged from 1.62 to 2.18. Currently, reference station, Station G had the highest diversity value among the different monitoring stations, while the lowest was the reference station, Station F. In terms of evenness index (J) values, impact Station D was noted with relatively high value as compared to other monitoring stations. Moreover, current monitoring results indicated an overall increase in both diversity and evenness values from the baseline survey condition.

## Summary Tables

Abundance and biomass of macro-benthic organisms are shown in **Tables 1** and **2**, respectively. Data summary for different monitoring periods are presented in **Tables 3** to **7**. Representative photos of specimen are shown in the last pages of this benthic survey report.

# Figures

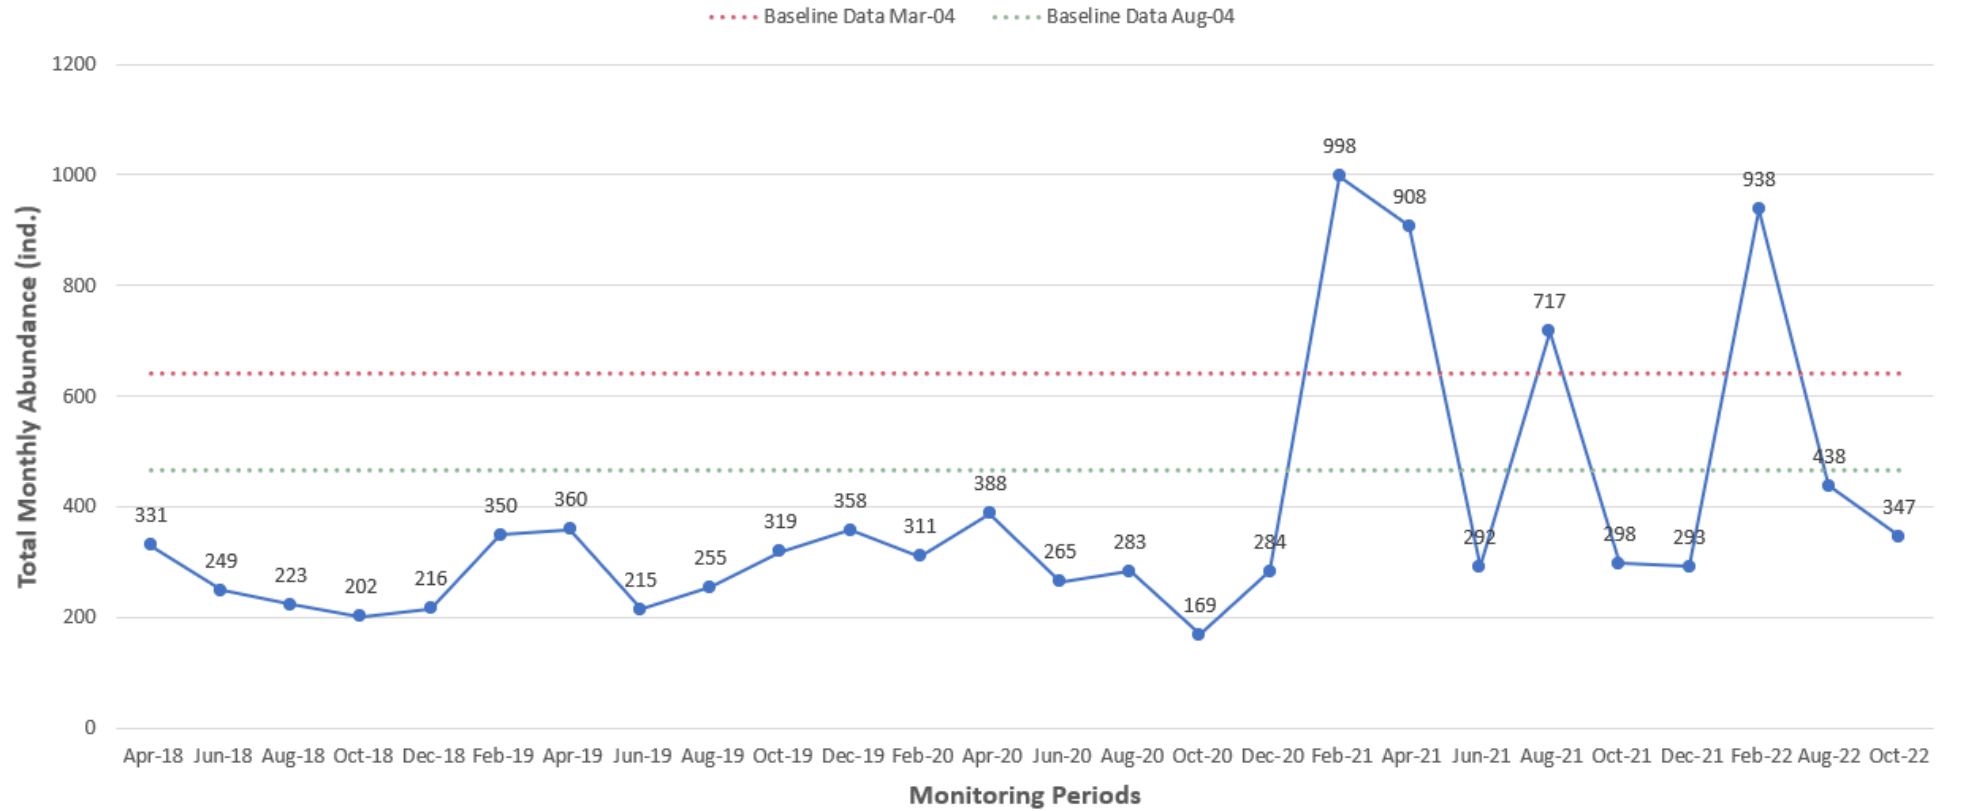


Figure 1: Monthly total abundance (ind.) of benthic organisms across monitoring periods



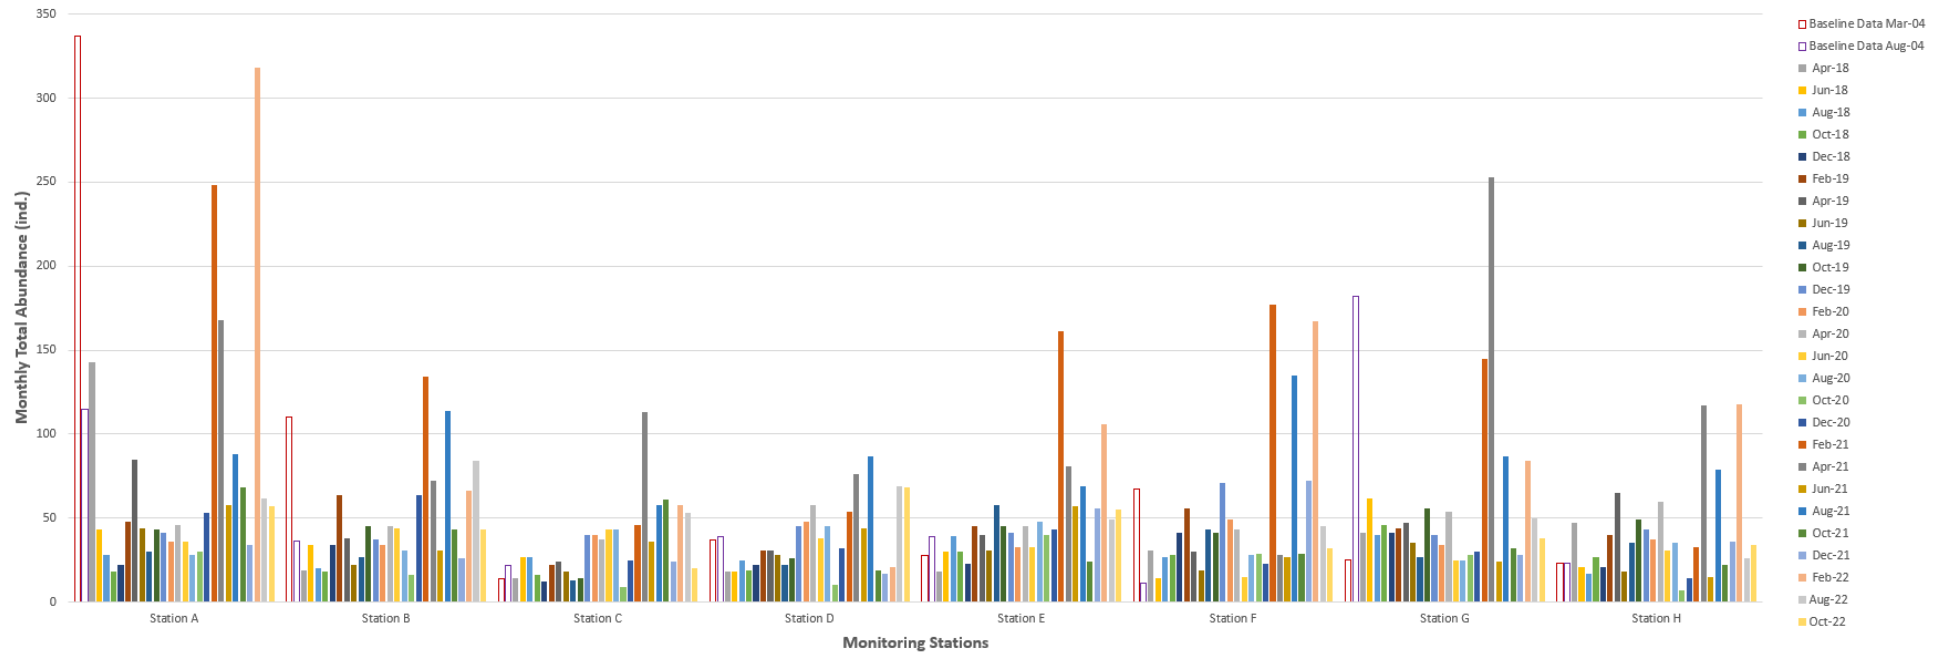


Figure 2: Monthly total abundance (ind.) of benthic organisms across monitoring stations

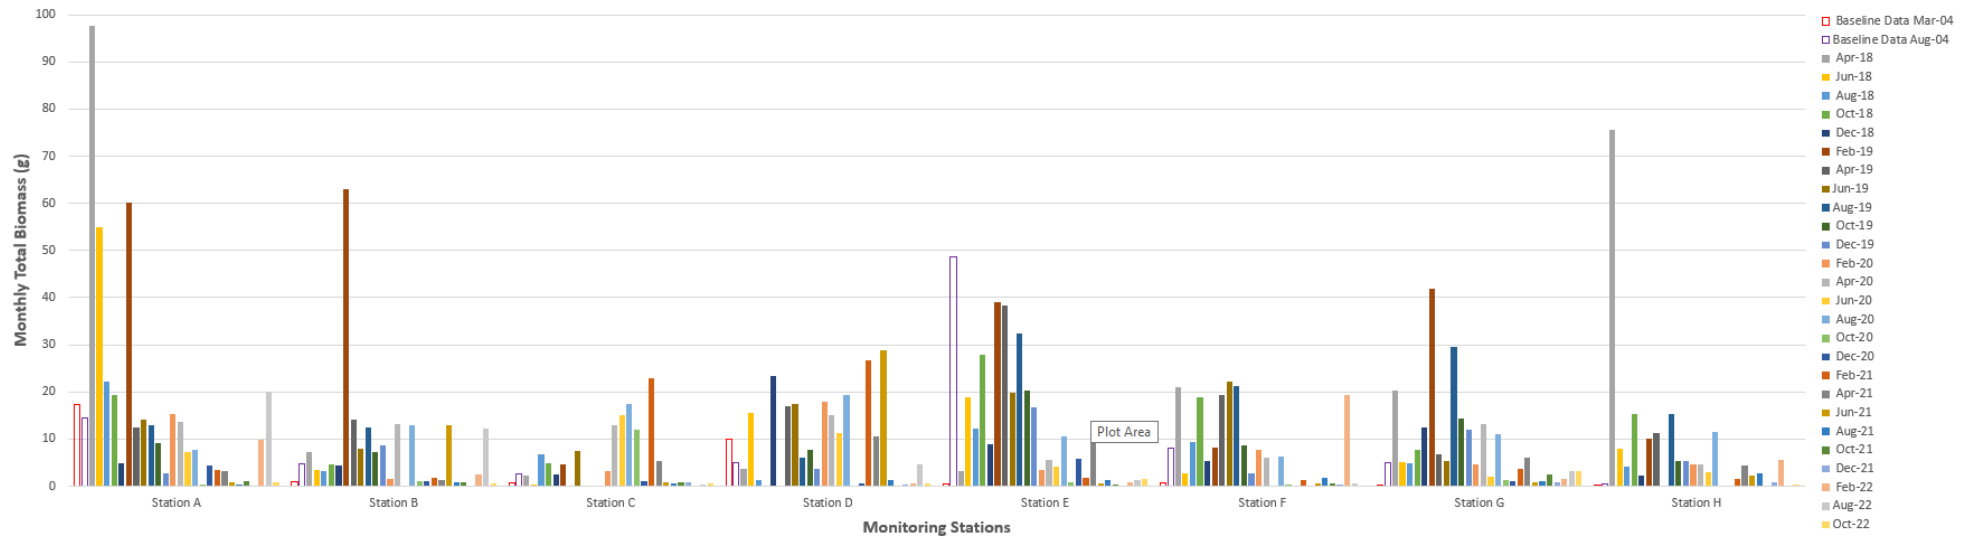


Figure 3: Monthly total biomass (g) of benthic organisms across monitoring stations

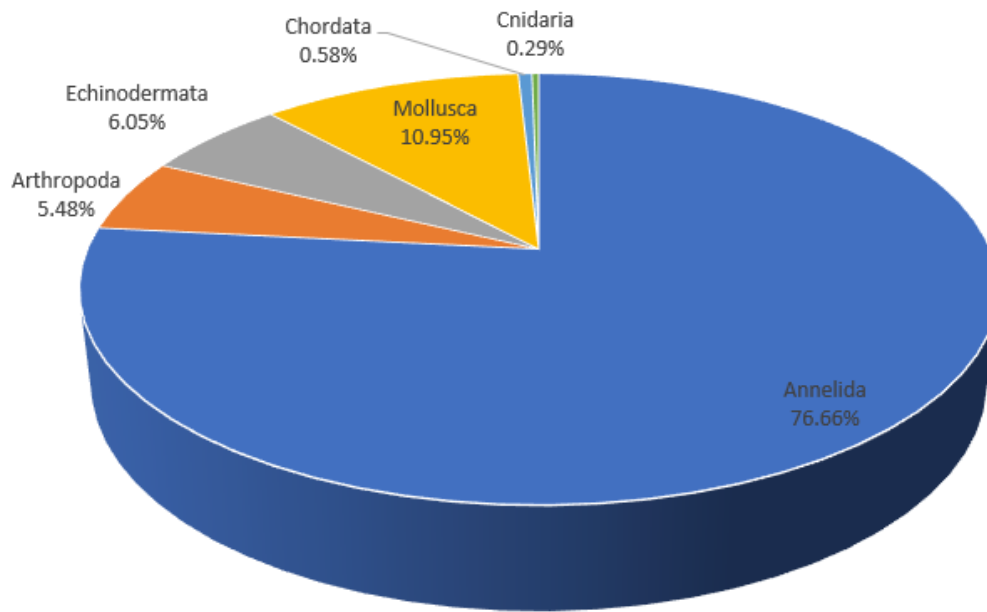


Figure 4: Percent composition of benthic organisms

# Data Summaries

Table 1: Abundance (ind.) of macrobenthic communities in the eight monitoring stations, 10 October 2022

Phylum	Class	Order	Family	Genus	Monitoring Stations							
					A	B	C	D	E	F	G	H
Annelida	Clitellata	Lumbriculida	Lumbriculidae	<i>Lumbriculus</i>	3	5	1	1	1	2	0	2
Annelida	Polychaeta	Amphinomida	Amphinomidae	<i>Chloeia</i>	0	0	0	0	2	0	0	0
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Capitella</i>	18	15	9	38	21	12	4	4
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Notomastus</i>	0	0	0	0	0	0	1	0
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Mediomastus</i>	0	0	0	0	0	0	3	5
Annelida	Polychaeta	Eunicida	Lumbrineridae	<i>Scoletoma</i>	0	2	0	0	0	0	0	0
Annelida	Polychaeta	Phyllodocida	Phyllodocidae	<i>Eteone</i>	1	0	0	8	4	0	7	6
Annelida	Polychaeta	Phyllodocida	Pilargidae	<i>Sigambra</i>	14	10	6	5	3	8	7	8
Annelida	Polychaeta	Sedentaria	Opheliidae	<i>Ophelia</i>	0	0	1	1	3	0	7	0
Annelida	Polychaeta	Terebellida	Terebellidae	<i>Amaeana</i>	6	1	0	5	4	0	0	0
Annelida	Polychaeta	Terebellida	Sternaspidae	<i>Sternaspis</i>	0	1	1	0	0	0	0	0
Arthropoda	Malacostraca	Amphipoda	Gammaridae	<i>Gammarus</i>	0	0	0	0	2	0	0	0
Arthropoda	Malacostraca	Decapoda	Penaeidae	Shrimp juvenile	2	0	1	0	2	0	2	1
Arthropoda	Malacostraca	Decapoda	Pilumnidae	<i>Typhlocarcinus</i>	0	0	0	0	0	1	1	2
Arthropoda	Malacostraca	Decapoda	Scalopidiidae	<i>Scalopidia</i>	4	0	0	1	0	0	0	0
Chordata	Actinopteri	Gobiiformes	Gobiidae	<i>Trypauchen</i>	1	0	0	1	0	0	0	0
Cnidaria	Anthozoa	Alcyonacea	Melithaeidae	<i>Acabaria</i>	0	1	0	0	0	0	0	0
Echinodermata	Ophiuroidea	Ophiurida	Amphiuridae	<i>Amphioplus</i>	6	4	0	5	3	3	0	0
Mollusca	Bivalvia	Adapedonta	Pharidae	<i>Sinonovacula</i>	0	0	0	0	0	0	0	1
Mollusca	Bivalvia	Cardiida	Cardiidae	<i>Cardium</i>	0	1	0	0	0	5	0	0
Mollusca	Bivalvia	Cardiida	Tellinidae	<i>c.f. Phylloda foliacea</i>	2	0	1	1	6	0	2	3
Mollusca	Bivalvia	Cardiida	Tellinidae	<i>c.f. Angulus</i>	0	2	0	1	4	1	2	2
Mollusca	Bivalvia	Veneroida	Veneridae	<i>Paphia (P. undulata)</i>	0	1	0	0	0	0	0	0
Mollusca	Bivalvia	Veneroida	Veneridae	<i>Ruditapes (R. philippinarum)</i>	0	0	0	1	0	0	2	0

Table 2: Biomass (g) of macrobenthic communities in the eight monitoring stations, 10 October 2022

Phylum	Class	Order	Family	Genus	Monitoring Stations							
					A	B	C	D	E	F	G	H
Annelida	Clitellata	Lumbriculida	Lumbriculidae	<i>Lumbriculus</i>	0.0301	0.0328	0.0250	0.0001	0.0047	0.0037	0	0.0076
Annelida	Polychaeta	Amphinomida	Amphinomidae	<i>Chloeia</i>	0	0	0	0	0.1325	0	0	0
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Capitella</i>	0.0719	0.0572	0.0205	0.0469	0.0519	0.0118	0.0043	0.0101
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Notomastus</i>	0	0	0	0	0	0	0.0334	0
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Mediomastus</i>	0	0	0	0	0	0	0.010	0.026
Annelida	Polychaeta	Eunicida	Lumbrineridae	<i>Scoletoma</i>	0	0.0039	0	0	0	0	0	0
Annelida	Polychaeta	Phyllodocida	Phyllodocidae	<i>Eteone</i>	0.0144	0	0	0.0125	0.0085	0	0.0121	0.0103
Annelida	Polychaeta	Phyllodocida	Pilargidae	<i>Sigambra</i>	0.1878	0.0518	0.0204	0.0169	0.0239	0.0392	0.0352	0.0395
Annelida	Polychaeta	Sedentaria	Opheliidae	<i>Ophelia</i>	0	0	0.1125	0.0138	0.1223	0	0.7499	0
Annelida	Polychaeta	Terebellida	Terebellidae	<i>Amaeana</i>	0.0613	0.0068	0	0.0082	0.0205	0	0	0
Annelida	Polychaeta	Terebellida	Sternaspidae	<i>Sternaspis</i>	0	0.0160	0.0283	0	0	0	0	0
Arthropoda	Malacostraca	Decapoda	Scalopidiidae	<i>Scalopidia</i>	0.1629	0	0	0.0234	0	0	0	0
Arthropoda	Malacostraca	Decapoda	Penaeidae	Shrimp juvenile	0.0318	0	0.1774	0	0.0488	0	0.0227	0.017
Arthropoda	Malacostraca	Decapoda	Pilumnidae	<i>Typhlocarcinus</i>	0	0	0	0	0	0.0364	0.3444	0.0696
Arthropoda	Malacostraca	Amphipoda	Gammaridae	<i>Gammarus</i>	0	0	0	0	0.0024	0	0	0
Chordata	Actinopteri	Gobiiformes	Gobiidae	<i>Trypauchen</i>	0.0219	0	0	0.0424	0	0	0	0
Cnidaria	Anthozoa	Alcyonacea	Melithaeidae	<i>Acabaria</i>		0.0135	0	0	0	0	0	0
Echinodermata	Ophiuroidea	Ophiurida	Amphiuridae	<i>Amphioplus</i>	0.1201	0.1182	0	0.0279	0.0391	0.0514	0	0
Mollusca	Bivalvia	Cardiida	Tellinidae	<i>c.f. Phylloda foliacea</i>	0.1351	0	0.2951	0.0837	1.014	0	0.0154	0.172
Mollusca	Bivalvia	Cardiida	Tellinidae	<i>c.f. Angulus</i>	0	0.0387	0	0.0122	0.1255	0.0232	0.0922	0.0461
Mollusca	Bivalvia	Veneroida	Veneridae	<i>Paphia (P. undulata)</i>	0	0.1519	0	0	0	0	0	0
Mollusca	Bivalvia	Veneroida	Veneridae	<i>Ruditapes (R. philippinarum)</i>	0	0	0	0.1992	0	0	1.8151	0
Mollusca	Bivalvia	Cardiida	Cardiidae	<i>Cardium</i>	0	0.0032	0	0	0	0.0212	0	0
Mollusca	Bivalvia	Adapedonta	Pharidae	<i>Sinonovacula</i>	0	0	0	0	0	0	0	0.0335

Table 3: Summary of Benthic Survey Data, October 2022

Stations	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	57	0.84	10	1.90	15.57
B	43	0.49	11	1.90	17.13
C*	20	0.68	7	1.47	18.19
D*	68	0.49	12	1.59	25.98
E	55	1.59	12	2.09	16.26
F	32	0.19	7	1.62	14.58
G	38	3.13	11	2.18	14.08
H	34	0.43	10	2.10	13.46

\*impact sites

Table 4: Summary of Benthic Survey Baseline Data, August 2004

Stations	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	115	14.56	24	0.93	0.29
B	36	4.76	14	0.89	0.34
C*	22	2.66	13	0.80	0.31
D*	39	5.07	11	0.62	0.26
E	39	48.69	16	0.89	0.32
F	11	8.07	9	0.68	0.31
G	182	4.91	31	1.10	0.32
H	23	0.49	11	0.81	0.34

\*impact sites

Table 5: Summary of Benthic Survey Baseline Data, March 2004

Stations	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	337	17.39	38	0.78	0.21
B	110	0.9	21	0.82	0.27
C*	14	0.7	10	0.69	0.3
D*	37	10.07	20	1.01	0.34
E	28	0.44	11	0.76	0.32
F	67	0.78	16	0.85	0.31
G	25	0.09	9	0.64	0.29
H	23	0.15	11	0.44	0.18

\*impact sites

Table 6: Taxonomic Composition (%) of Benthic Survey

Taxa	Mar-04	Aug-04	Apr-19	Jun-19	Aug-19	Oct-19	Dec-19	Feb-20	Apr-20	Jun-20	Aug-20	Oct-20	Dec-20
Annelida	80.19	73.29	70.28	0.47	64.31	66.14	59.78	60.77	56.44	69.06	63.25	51.48	50.35
Sipuncula	0.78	0.21	0.00	0.00	1.57	1.25	0.00	1.29	0.52	1.13	0.35	1.78	1.06
Arthropoda	11.23	18.80	10.83	4.65	9.80	19.75	14.53	13.83	28.87	8.30	13.43	18.93	20.77
Echinodermata	0.62	3.63	4.72	0.47	5.10	3.13	1.68	1.61	0.77	2.26	3.53	2.96	2.82
Cnidaria	1.72	0.43	0.00	1.86	0.39	0.00	0.84	0.32	0.26	0.75	0.00	1.18	0.00
Mollusca	5.46	3.42	13.33	0.47	17.25	8.15	22.35	19.94	11.60	15.85	15.90	18.93	24.65
Chordata	0.00	0.21	0.56	0.47	1.18	0.94	0.00	0.32	0.52	1.13	1.41	0.00	0.35
Nemertea	0.00	0.00	0.28	98.60	0.39	0.63	0.84	1.93	1.03	1.51	2.12	4.73	0.00

Taxa	Feb-21	Apr-21	Jun-21	Aug-21	Oct-21	Dec-21	Feb-22	Apr-22	Jun-22	Aug-22	Oct-22
Annelida	22.75	31.72	73.63	78.52	64.43	45.05	15.57	33.78	57.32	88.56	76.66
Sipuncula	0.70	0.00	0.34	0.00	8.05	0.00	0.00	1.34	6.28	0.00	0.00
Arthropoda	70.14	55.95	10.27	9.90	11.41	36.86	78.25	26.54	5.86	1.60	5.48
Echinodermata	0.30	1.43	4.11	1.39	4.03	4.10	0.43	0.80	1.26	0.46	6.05
Cnidaria	0.00	0.00	0.00	0.00	0.00	0.68	0.00	0.00	0.00	0.00	0.29
Mollusca	5.81	10.90	11.64	10.04	11.74	9.22	5.22	37.27	28.87	8.47	10.95
Chordata	0.10	0.00	0.00	0.14	0.34	0.00	0.11	0.00	0.42	0.92	0.58
Nemertea	0.00	0.00	0.00	0.00	0.00	4.10	0.43	0.27	0.00	0.00	0.00

Table 7: Taxonomic Composition (Abundance) of Benthic Survey

Taxa	Mar-04	Aug-04	Apr-19	Jun-19	Aug-19	Oct-19	Dec-19	Feb-20	Apr-20	Jun-20	Aug-20	Oct-20	Dec-20
Annelida	514	343	253	124	164	211	214	189	219	183	179	87	143
Sipuncula	5	1	0	0	4	4	0	4	2	3	1	3	3
Arthropoda	72	88	39	17	25	63	52	43	112	22	38	32	59
Echinodermata	4	17	17	10	13	10	6	5	3	6	10	5	8
Cnidaria	11	2	0	2	1	0	3	1	1	2	0	2	0
Mollusca	35	16	48	59	44	26	80	62	45	42	45	32	70
Chordata	0	1	2	2	3	3	0	1	2	3	4	0	1
Nemertea	0	0	1	1	1	2	3	6	4	4	6	8	0


Taxa	Feb-21	Apr-21	Jun-21	Aug-21	Oct-21	Dec-21	Feb-22	Apr-22	Jun-22	Aug-22	Oct-22
Annelida	227	288	215	563	192	132	146	126	137	387	266
Sipuncula	7	0	1	0	24	0	0	5	15	0	0
Arthropoda	700	508	30	71	34	108	734	99	14	7	19
Echinodermata	3	13	12	10	12	12	4	3	3	2	21
Cnidaria	0	0	0	0	0	2	0	0	0	0	1
Mollusca	58	99	34	72	35	27	49	139	69	37	38
Chordata	1	0	0	1	1	0	1	0	1	4	2
Nemertea	2	0	0	0	0	12	4	1	0	0	0




Photos of Macrobenthic Assemblages




Station A

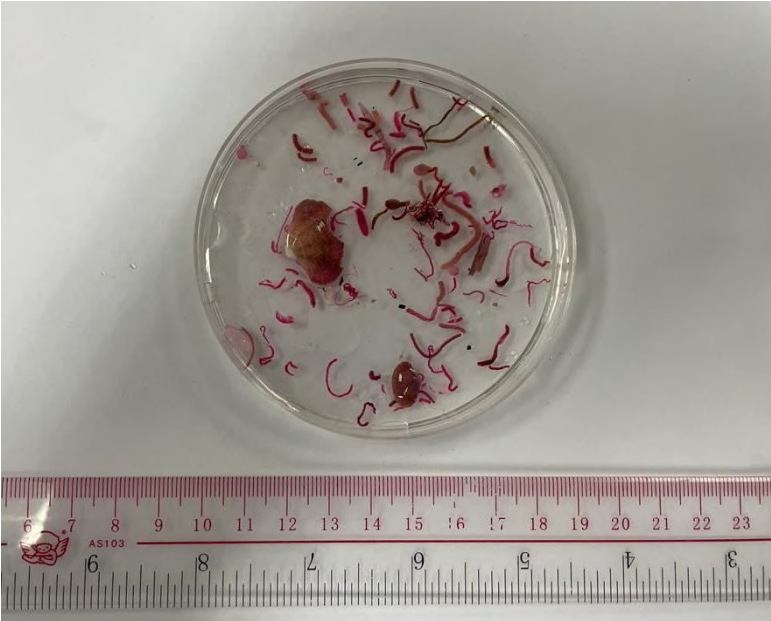

Station B

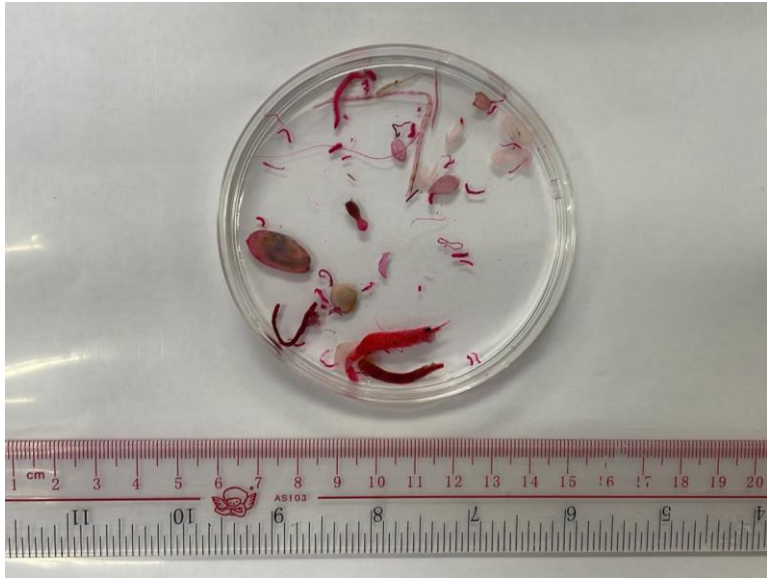


Station C

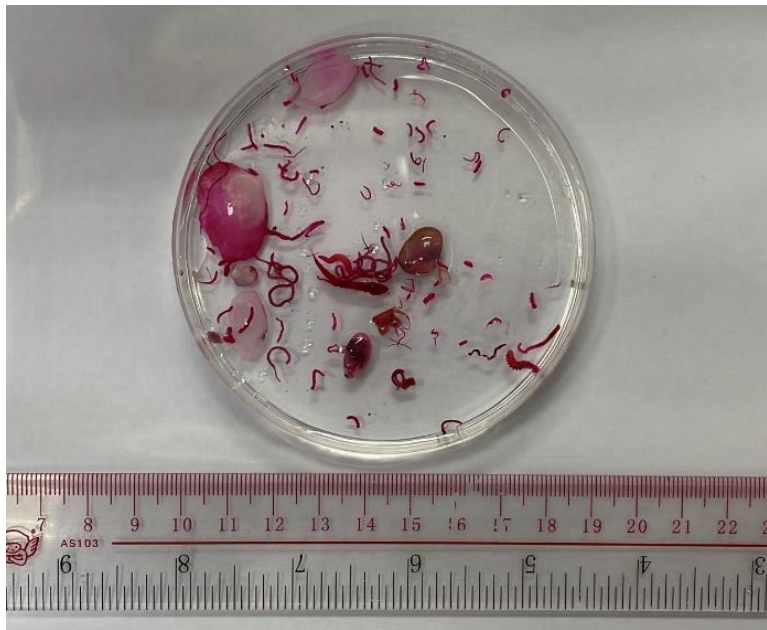


Station D




Station E

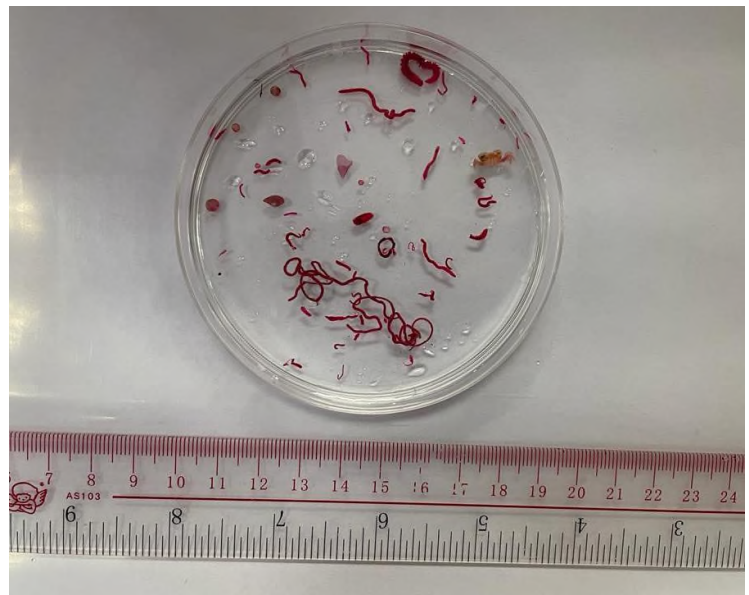

Station F

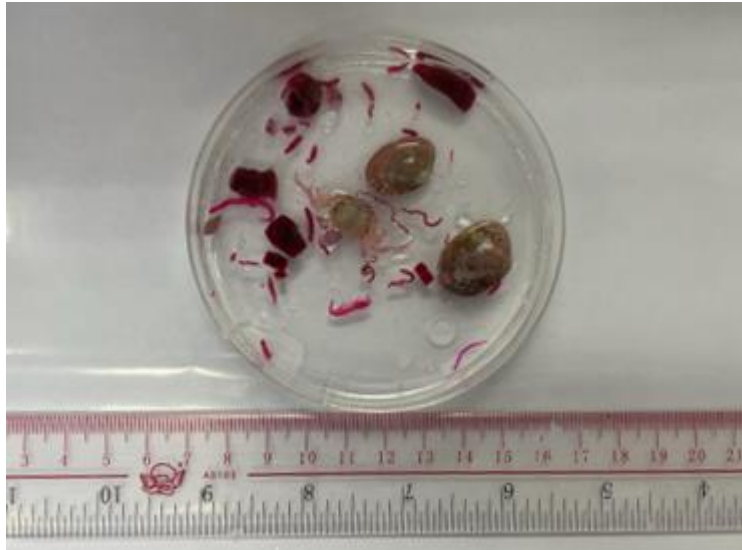


Station G

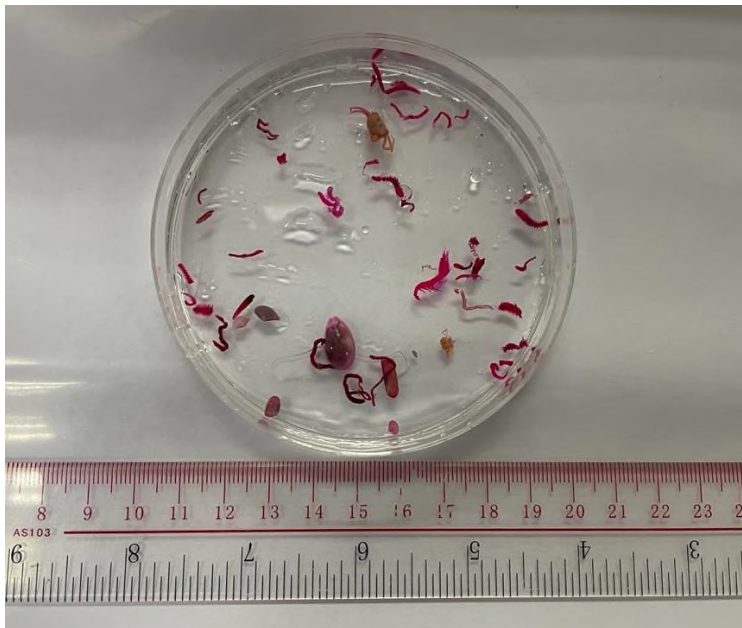

Station H


## Photos of Representative Taxa Identified

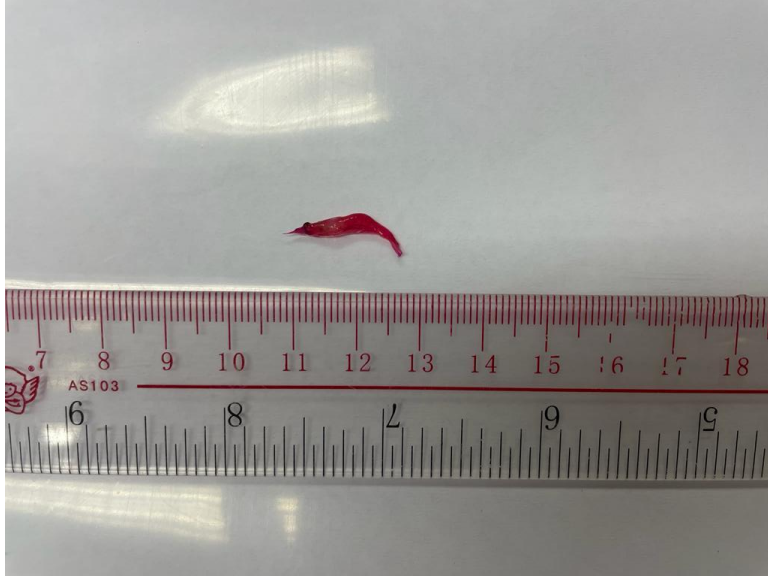

**Juvenile Shrimp**



***Ophelia***

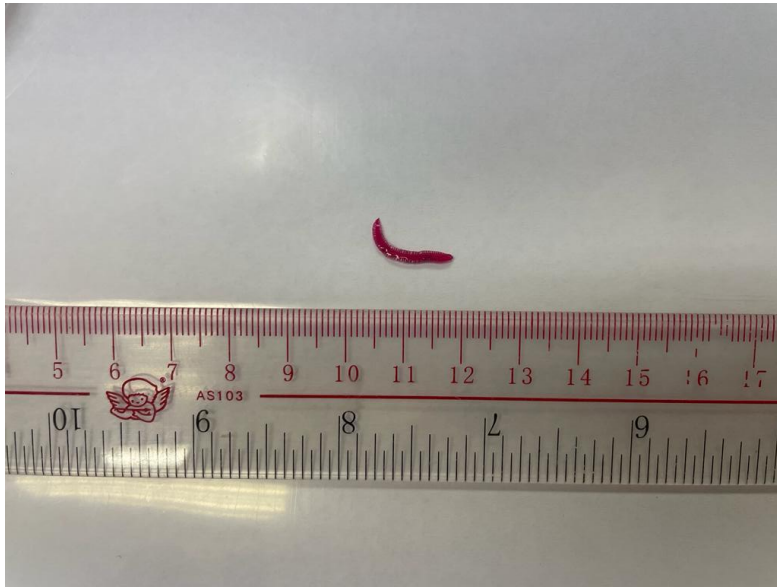

*Capitella*



*Chloeia*



*Phylloda foliacea*

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix J

### Photos of Grab Samplers



# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

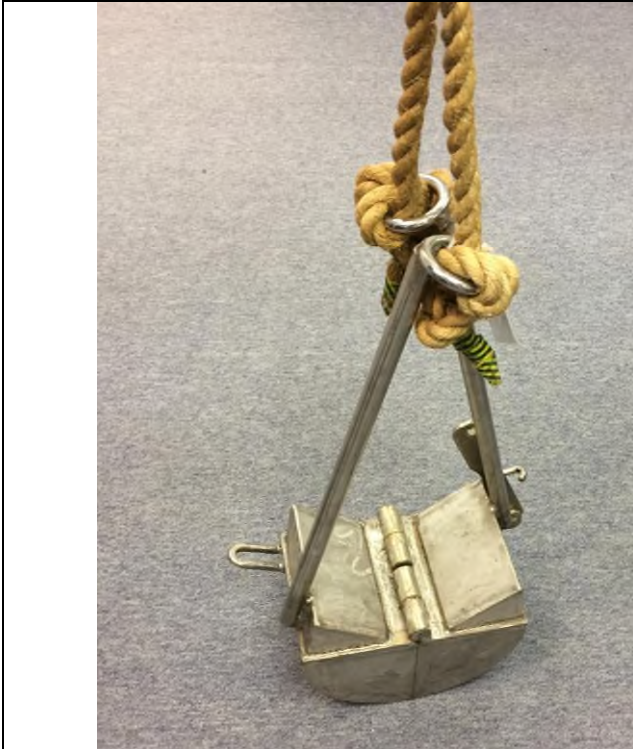


Photo 1. A ponar grab sampler

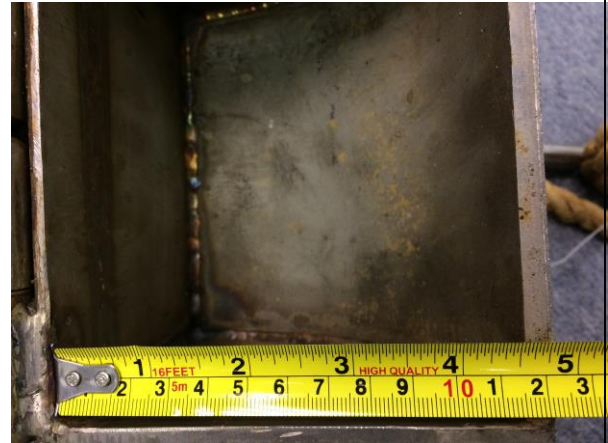


Photo 2. Grab dimension 1



Photo3. Grab dimension 2



Photo4. Grab dimension 3

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

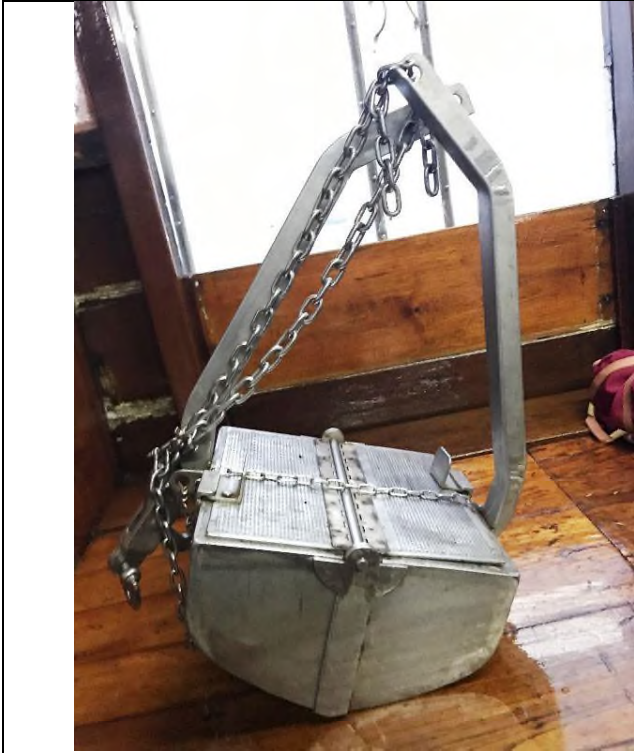


Photo 1. A modified Van Veen grab sampler



Photo 2. Grab dimension 1



Photo3. Grab dimension 2



Photo4. Grab dimension 3

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix K Environmental Complaints Log

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

### Environmental Complaints Log

Complaint Log No.	Date of Complaint	Received From and Received By	Nature of Complaint	Investigation
1	28 November 2019	EPD	According to EPD, a member of public complained that SHWSTW cause a malodour and was smelled as far as the Discovery Bay tunnel portal.	As advised by DSD, the operation of Siu Ho Wan Sewage Treatment Works was properly functioned and there was no special activity on 28 <sup>th</sup> November 2019. Due to the possibility of having unpleasant gases or odours emitted from these non-DSD premises cannot be precluded, the complaint is considered as non-project related.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0688

## Appendix L

### Environmental Mitigation Implementation Schedule (EMIS)

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

EP Ref.	EIA Ref.	WMP Ref.	Environmental Protection Measures	Location of the measures	Implementation Status
<b>Air Quality</b>					
NA	4.5	NA	Odour reduction measures like aeration, chemical dosing system shall be implemented to reduce any odour impacts to an acceptable level.	SHWSTW	Implemented
3.4	4.5	NA	Sewage treatment works including sludge thickening tanks, the sludge pump house and sludge press house shall be completely enclosed.	SHWSTW	Implemented
3.4	4.5	NA	Exhaust air shall be ventilated to an odour scrubber prior to discharge. Ventilating air to a biological treatment unit with 95% odour removal efficiency prior to stack exhaust shall be implemented	SHWSTW	Implemented
<b>Water Quality</b>					
3.3	NA	4.01	To avoid impacts on the marine ecology due to effluent discharge, the disinfection facility as in Part B of the EP shall be equipped with an UV disinfection system capable of removing at least 99.9% of E.coli from the sewage	SHWSTW	Implemented
<b>Waste Management</b>					
3.6	NA	NA	Transportation of sludge shall be carried out in fully enclosed containers, or be placed in sludge skips with tarpaulin covers	SHWSTW	Implemented
NA	NA	5.02	Trip-ticket system mentioned shall be implemented. Trip-ticket is required for each truckload delivered to the landfills facilities according to WBTC No. 31/2004.	SHWSTW	Implemented
NA	NA	5.02	The acceptance criteria for Landfill disposal should be followed, i.e. solid content of sludge waste should be more than 30%.	SHWSTW	Implemented
NA	NA	5.02	The disposal of grit & debris (if any) generated during primary screening works should follow the requirement set in the WMP Section 4.05.	SHWSTW	Implemented
NA	NA	5.03	The wet sludge should be temporarily stored at the sludge buffer tank. It should then be transported to the centrifuge building for dewatering and discharged to the container for disposal. The whole process should be managed by the automatic electronic electronic system and monitored by the operators during operation.	SHWSTW	Implemented
NA	NA	5.04	The other solid waste material such as sediment and grit, refuse containers or collection bags should be temporarily stored in slips at designated area. Operators should ensure sufficient space is identified and provided for temporary storage of waste materials to facilitate collection. Storage of waste material on site will be kept to a minimum to avoid nuisance to local residents.	SHWSTW	Implemented
NA	NA	5.05	Chemical wastes which likely to be generated by activities arise from the maintenance, shall followed the Waste Disposal (Chemical Waste) (General) Regulation, includes Schedule 1 of the Regulation.	SHWSTW	Implemented
NA	NA	5.06	In case of unlikely occurred chemical spillage, procedures should be followed as according to the WMP Section 5.06.	SHWSTW	Implemented
NA	NA	5.07	Temporary storage areas should be identify and provided for the temporary storage of general	SHWSTW	Implemented

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

EP Ref.	EIA Ref.	WMP Ref.	Environmental Protection Measures	Location of the measures	Implementation Status
			refuse to facilitate collection		
NA	NA	5.07	Domestics wastes refuse generated on-site will be stored in enclosed bins or compaction units separately	SHWSTW	Implemented
NA	NA	5.07	Sufficient dustbins should be provided for domestic waste if required.	SHWSTW	Implemented
NA	NA	5.07	Domestics wastes should be cleared daily and will be disposed off to the nearest licensed landfill or refuse transfer station.	SHWSTW	Implemented
NA	NA	5.07	Separate labeled bins should be provided to segregate the waste generated by workforce. Waste recycle collector should be employed to collect the segregated waste	SHWSTW	Implemented
NA	NA	5.07	Cardboard and paper packaging (for plant, equipment and materials) should be recovered on site, properly stockpiled in dry condition and covered to prevent cross contamination by other materials.	SHWSTW	Implemented
NA	NA	5.07	Office waste should be minimized through using papers on both sides. Communication by electronic means should be used as far as possible.	SHWSTW	Implemented
NA	NA	5.07	The burning of refuse on-site is prohibited by law and shall not be undertaken	SHWSTW	Implemented
NA	NA	5.07	Toilet wastewater shall be transported to the STW for treatment	SHWSTW	Implemented
NA	NA	5.07	Arrangement for collection of recyclable materials by recycling contractors should be followed as according to the WMP Section 5.07.	SHWSTW	Implemented
NA	NA	5.08	All recycling materials removed by the recycling contractors should be properly recorded before the removal. The natures and quantities of the recycling materials, the date of removal and the name of the recycling contractor should be recorded.	SHWSTW	Implemented
NA	NA	5.09	To maintain the site in a clean and tidy condition during the operation, general measures specified in the WMP should be implemented on site at all times. Regular site inspections shall be undertaken by the management team to ensure the measures are implemented.	SHWSTW	Implemented
NA	NA	5.10	Daily cleaning should be performed daily after work within the plant and the public areas immediately next to the site.	SHWSTW	Implemented
NA	NA	5.11	The work officer in charge of the corresponding area should perform daily inspection on the items mentioned in the WMP Section 5.10. If observations were discovered, the work officer should record the result of the inspection on an inspection checklist with photos taken and submitted to the inspectors or Chief Technical Officer for review on the following day. Any deficiency should be rectified promptly.	SHWSTW	Implemented
NA	NA	5.12	Weekly tidying should be performed weekly within the site.	SHWSTW	Implemented
NA	NA	5.13	The inspector should perform Weekly Inspection on the items mentioned in the WMP Section 5.12. If observations were discovered, the work officer should record the result on an inspection checklist and submitted to the Chief Technical Officer for review on the following day. Any deficiency should be rectified promptly.	SHWSTW	Implemented

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0688

EP Ref.	EIA Ref.	WMP Ref.	Environmental Protection Measures	Location of the measures	Implementation Status
NA	NA	5.14	All wastes generated through the operational phase will be managed in accordance with the protocols set out in the WMP Section 5.14.	SHWSTW	Implemented

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.