

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

## Monthly EM&A Report February 2023

Client : Drainage Services Department

Project : Contract No. CM 14/2016  
Environmental Team for Operational  
Environmental Monitoring and Audit for Siu  
Ho Wan Sewage Treatment Works

Report No.: : 0041/17/ED/0704A

Prepared by: Andy K. H. Choi

Reviewed by: Cyrus C. Y. Lai

Certified by:

A handwritten signature in black ink, appearing to be "Colin K. L. Yung", written over a horizontal line.

Colin K. L. Yung  
Environmental Team Leader  
Fugro Technical Services Limited

Our Ref. 1458/23-0005



**Drainage Services Department**  
Projects and Development Branch  
Consultants Management Division  
42/F, Revenue Tower,  
5 Gloucester Road  
Wan Chai, Hong Kong

27/F, Overseas Trust Bank Building  
160 Gloucester Road  
Wan Chai  
Hong Kong  
T: +852 2815 7028  
F: +852 2815 5399

[www.asecg.com](http://www.asecg.com)

**Attn: Mr. LAU Ka Kin, Marcus (E/CM16)**

17 March 2023

**By E-mail & Post**

Dear Sir,

**RE: CONTRACT No. CM 13/2016**  
**INDEPENDENT ENVIRONMENTAL CHECKER FOR OPERATIONAL ENVIRONMENTAL MONITORING**  
**AND AUDIT FOR SIU HO WAN SEWAGE TREATMENT WORKS (SHWSTW)**  
**MONTHLY ENVIRONMENTAL MONITORING AND AUDIT (EM&A) REPORT (FEBRUARY 2023)**

Reference is made to the submission of the Monthly Environmental Monitoring and Audit (EM&A) Report for February 2023 (Report No.: 0041/17/ED/0704A) from the Environmental Team (ET), Fugro Technical Services Ltd., received on 17 March 2023 via email.

We would like to inform you that we have no adverse comment on the captioned submission and hereby verify the same in accordance with Condition 4.3 of the Environmental Permit (EP) for the captioned Project (Permit No.: EP-076/2000).

Should you have any queries, please feel free to contact the undersigned, or our Mr. Timmy WONG at 2815 7028.

Yours faithfully,

For and on behalf of  
**Allied Environmental Consultants Ltd.**

A handwritten signature in black ink, appearing to be 'Grace M. H. Kwok', written in a cursive style.

Grace M. H. KWOK  
Independent Environmental Checker

GK/jn/tw

c.c. Fugro Technical Service (ET Leader)  
AECOM

Attn: Mr. Colin YUNG  
Attn: Ms. Joanne TSOI

(By E-mail)  
(By E-mail)

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

## TABLE OF CONTENTS

	<b>EXECUTIVE SUMMARY .....</b>	<b>1</b>
<b>1.</b>	<b>INTRODUCTION.....</b>	<b>3</b>
<b>2.</b>	<b>AIR QUALITY MONITORING .....</b>	<b>5</b>
<b>3.</b>	<b>WATER QUALITY MONITORING .....</b>	<b>10</b>
<b>4.</b>	<b>SEDIMENT QUALITY MONITORING AND BENTHIC SURVEY .....</b>	<b>20</b>
<b>5.</b>	<b>CHINESE WHITE DOLPHIN MONITORING .....</b>	<b>27</b>
<b>6.</b>	<b>ADVICE ON IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES .....</b>	<b>28</b>
<b>7.</b>	<b>ADVICE ON THE SOLID AND LIQUID WASTE MANAGEMENT STATUS .....</b>	<b>29</b>
<b>8.</b>	<b>SUMMARY OF EXCEEDANCE OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS .....</b>	<b>30</b>
<b>9.</b>	<b>SUMMARY OF ENVIRONMENTAL COMPLAINTS .....</b>	<b>31</b>
<b>10.</b>	<b>FUTURE KEY ISSUES .....</b>	<b>32</b>
<b>11.</b>	<b>CONCLUSION .....</b>	<b>33</b>

## FIGURE

- Figure 1      Monitoring Stations of Air Sensitive Receivers**
- Figure 2      Odour Patrol Points of Modified Odour Patrol**
- Figure 3      Monitoring Stations of Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey**
- Figure 4      Location of the Tide Gauge**

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## APPENDICES

- Appendix A** Project Organization Chart
- Appendix B** Monitoring Schedule for Present and Next Reporting Period
- Appendix C** Event and Action Plan for Air Quality Monitoring
- Appendix D** Results and Graphical Presentation of Air Quality Monitoring
- Appendix E** Copy of the Calibration Certificates for Water Quality Monitoring Equipment
- Appendix F** Results and Graphical Presentation of Water Quality Monitoring
- Appendix G** Tidal Data obtained from Ma Wan Marine Traffic Station
- Appendix H** Results and Graphical Presentation of Laboratory Analysis for Sediment Quality Monitoring and Benthic Survey
- Appendix I** Benthic Survey Report
- Appendix J** Photos of Grab Samplers
- Appendix K** Environmental Complaints Log and Incident Report
- Appendix L** Environmental Mitigation Implementation Schedule (EMIS)

**EXECUTIVE SUMMARY**

This Monthly Environmental Monitoring and Audit (EM&A) Report is prepared for Contract No. CM 14/2016 – “Environmental Monitoring and Audit for Operation of Siu Ho Wan Sewage Treatment Works” (hereafter referred to as “the Contract”) for the Drainage Services Department (DSD) of Hong Kong Special Administrative Region. Fugro Technical Services Limited (hereafter referred to as “FTS”) was appointed as the Environmental Team (ET) by DSD, to implement the Environmental Monitoring & Audit (EM&A) programme in accordance with the Operational EM&A Plan of the Contract.

The Contract is part of the “Upgrading of Siu Ho Wan Sewage Treatment Works” (hereinafter referred as “the Project”) which was classified as “Designated Project” under Schedule 2 of the Environmental Impact Assessment Ordinance (EIAO) (Cap 499) and Environmental Impact Assessment (EIA) Report (Register No. EIAR-124BC) was completed in September 1997. The current Environmental Permit (EP) No. EP-076/2000 was issued in August 2000 to DSD.

In accordance with the EP, an approved operational EM&A Plan was submitted. According to the approved EM&A plan, air quality monitoring (i.e. H<sub>2</sub>S concentration monitoring, odour patrol monitoring and olfactometry analysis of H<sub>2</sub>S), in addition, water quality monitoring, sediment quality monitoring, benthic survey, Chinese White Dolphin (CWD) monitoring and waste management are the key environmental concern of the Project.

This is the Sixty-seventh Monthly EM&A Report for the Project which summarizes findings of the EM&A works during the reporting period from 1 February 2023 to 28 February 2023 (the “reporting period”).

**Breaches of Action and Limit Levels**

Odour patrol monitoring was resumed from January 2020 and carried out on 1, 7, 13 and 24 February 2023. The modified odour patrol monitoring plan including updated Event and Action Plan was approved on March 2020, and modified odour patrol monitoring was commenced from 20 March 2020. No exceedances of Action/Limit levels at Air Sensitive Receivers (ASR) and odour patrol points were recorded and no non-compliance of odour monitoring at ASR were recorded in the reporting period.

Water quality monitoring, sediment quality monitoring and benthic survey were carried out on 8 February 2023. No specific Action/Limit level has to be followed since the purpose of the monitoring is to collect data for future purpose.

**Complaint Log**

There were no complaints received in relation to environmental impact during the reporting period.

**Notifications of Summons and Successful Prosecutions**

There were no notifications of summons or prosecutions received during the reporting period.

**Summary of the Environmental Mitigations Measures**



Mitigation measures specified in the EP and EIA Report such as aeration, chemical dosing system, covering or enclosing the pressing and sludge thickening facilities and ventilating air to a biological treatment unit prior to stack exhaust were implemented during the reporting period.

### **Future Key Issues**

The key issues to be considered in the succeeding reporting month include:

Potential environmental impacts arising from the operations of Siu Ho Wan Sewage Treatment Works (SHWSTW) are mainly associated with air quality, water quality, sediment quality, benthic ecology, waste management and distribution and abundance of Chinese White Dolphins (CWDs).

According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD's memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.

**1. INTRODUCTION****1.1 Background**

1.1.1 The Project "Upgrading of Siu Ho Wan Sewage Treatment Works" is to upgrade SHWSTW from the preliminary treatment level to Chemically Enhanced Primary Treatment (CEPT) level with Ultraviolet (UV) disinfection facilities. The Project is required to comply with the Environmental Permit (EP) in respect of the construction and operation phases of the Plant.

1.1.2 Under the EIAO, the Project was classified as "Designated Project". The Environmental Impact Assessment (EIA) study was completed in September 1997 with the EIA Report of Register No. EIAR-124BC, Operational Environmental Monitoring and Audit (EM&A) Plan and the EP of No. EP-076/2000 was issued in August 2000 to Drainage Services Department (DSD).

1.1.3 The CEPT part has been completed and was put into operation in March 2005. The UV disinfection works were substantially completed in December 2006. It is considered that the operation of the Project shall be deemed to start when the UV disinfection facilities have been completely installed and tested.

**1.2 Project Description**

1.2.1 The project proponent was DSD. AECOM was commissioned by DSD as the Engineer for the Project. Allied Environmental Consultants Limited (AEC) was commissioned by DSD as the Independent Environmental Checker (IEC) in the operation phase of the Project. FTS was appointed as the ET by DSD to implement the EM&A programme for the operation phase of the Project including air quality monitoring, water quality monitoring, sediment quality and benthic survey and CWDs monitoring.

**1.3 Project Organization**

1.3.1 The project organization for environmental works is shown in **Appendix A**. The contact person and telephone numbers of key personnel for the captioned project are shown in **Table 1.1**.

**Table 1.1 Contact Persons and Telephone Numbers of Key Personnel**

Organization	Role	Contact Person	Telephone No.	Fax No.
DSD	Project Proponent Representative	Mr. Marcus Lau	2594 7218	3104 6426
AECOM	Engineer Representative (ER)	Ms. Joanne Tsoi	3922 9423	3922 9797
AEC	Independent Environmental Checker (IEC)	Ms. Grace Kwok	2815 7028	2815 5399
FTS	ET Leader (ETL)	Mr. Colin Yung	3565 4114	2450 8032

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

Page 4

## 1.4 Works Undertaken during the Reporting Period

1.4.1 During this reporting period, the principal work activities included:

- Perform comprehensive operation and maintenance services for the electrical, mechanical and electronic systems/equipment at SHWSTW.
- Alleviate as far as practicable the impact that the facilities and sewage systems imposed on the environment of Hong Kong.



**2. AIR QUALITY MONITORING****2.1 Methodology of H<sub>2</sub>S Concentration Monitoring**

2.1.1 15-min H<sub>2</sub>S concentration was measured using a Jerome 631-X analyzer. This analyzer is capable of measuring H<sub>2</sub>S concentration in the range of 1 ppb to 50 ppm with a resolution of 1 ppb and operates within a temperature range of 0°C to 40°C at an air flow rate of 0.15 L/min. Odour gas samples were drawn by built-in a suction pump of the analyzer and passed through a gold film sensor. The trace level of H<sub>2</sub>S of the samples were determined electrochemically on the gold film sensor. Meteorological conditions including temperature, wind speed, wind direction and relative humidity were also measured at the time of the monitoring. Table 2.1 summarizes the equipment used in H<sub>2</sub>S monitoring.

**Table 2.1 Equipment used for H<sub>2</sub>S Concentration Monitoring**

Equipment	Manufacturer / Model	Serial Number	Sensor Number
Gold Film Hydrogen Sulphide Analyzer	JEROME X631 0003	2966	14-11-23-R2D

**2.2 Methodology of Modified Odour Patrol Monitoring**

2.2.1 Due to the complaint case received on 28 November 2019, a modified version of odour patrol monitoring is proposed and approved on 13 March 2020. According to the approved proposal for odour patrol monitoring plan (0041/17/ED/0524G), a modified version of odour patrol monitoring was commenced on 20 March 2020 to ensure the mitigation measures are effectively implemented. The modified odour patrol conducted once per week by two independent trained personnel/competent persons (the "patrollists") patrolling and sniffing along the SHWSTW boundary and the air sensitive receivers (ASRs).

2.2.2 The odour monitoring should not be undertaken on rainy days. Subject to the prevailing weather forecast condition, odour patrol shall be conducted by two patrollists at the downwind locations. During the patrol, the sequence should start from less odourous locations to stronger odourous locations.

2.2.3 The two patrollists shall be satisfied the below requirements during odour patrol:

- Have their individual odour threshold of n-butanol in nitrogen gas in the range of 20 to 80 ppb/V required by the European Standard method: BS EN13725.
- Be free from any respiratory illnesses.
- Not be allowed to smoke, eat, drink (except water) or use chewing gum or sweets 30min before and during odour patrol.
- Take great care not to cause any interference with their own perception or that of others by lack of personal hygiene or the use of perfumes, deodorants, body lotions or cosmetics.
- Not communicate with each other about the results of their choices.

2.2.4 During the odour patrol monitoring, the meteorological and surrounding information are recorded as follows:

- i. Prevailing Weather Condition;
- ii. Wind Direction;
- iii. Wind Speed;
- iv. Location where Odour is detected;
- v. Source of Odour detected;
- vi. Perceived intensity of Odour detected;
- viii. Duration of Odour detected; and
- ix. Characteristics of Odour detected

2.2.5 The perceived intensity is to be divided into 5 levels which are ranked in a descending order as follows:

**Table 2.2 Categories of Odour Intensity for Modified Odour Patrol Monitoring**

Odour Level	Odour Intensity	Classification Criteria
0	Not detected	No odour perceived or an odour so weak that it cannot be easily characterised or described.
1	Slight	Slight identifiable odour, and slight chance to have odour nuisance.
2	Moderate	Moderate identifiable odour, and moderate chance to have odour nuisance.
3	Strong	Strong identifiable, likely to have odour nuisance.
4	Extreme	Extreme severe odour, and unacceptable odour level.

## 2.3 Methodology of Odour Sampling and Olfactometry Analysis

2.3.1 Odour gas samples were collected in a Nalophan sampling bag placed inside a vacuum air-tight sampler using passive sampling technique. Approximately 60 liter of gas sample was collected at each sampling. All samples collected on the sampling day were returned to laboratory for olfactometry analysis within 24 hours and analyzed within 2 hours upon receiving.

2.3.2 ALS Technichem (HK) Pty Ltd. (HOKLAS Reg. No. 066), was the appointed laboratory for olfactometry analysis of the gas sample.

2.3.3 The odour concentration of the samples were determined by Forced-choice Dynamic Olfactometer in accordance with the European Standard Method: BS EN13725. Testing were also performed by a panel of six members who have been trained to comply with the



Report No.: 0041/17/ED/0704A

Page 7

requirement of European Standard Method: BS EN13725. All testing were completed within 24 hours upon sampling.

## 2.4 Monitoring Location

2.4.1 H<sub>2</sub>S concentration monitoring and odour sampling at ASR, Cheung Tung Road near the Bus Depot at the west of the Siu Ho Wan Treatment Plant, were temporarily suspended from 14 May 2018. The location of ASR is shown in **Figure 1**.

2.4.2 9 odour patrol points is chosen to conduct the modified odour patrol for collecting more representative data and identify the particular source of odour in the site. The nine odour patrol points is as below:

**Table 2.3 Odour Patrol Point**

Odour Patrol Point	Description
OD1	Eastern Site Boundary
OD2	Southern Site Boundary
OD3	Western Site Boundary
OD4	Northern Site Boundary
OD5	Spur Road near Discovery Bay Tunnel Outlet
OD6	Cheung Tung Road near the Bus Depot
OD7	Cheung Tung Road near O-PARK1
OD8	Sham Shui Kok Dr near MTR Depot
OD9	Discovery Bay Tunnel Toll Plaza

2.4.3 The odour patrol points of modified odour patrol is shown in **Figure 2**.

## 2.5 Monitoring Frequency and Duration

2.5.1 The durations and frequencies of H<sub>2</sub>S concentration measurement, odour patrolling and odour sampling are summarized in **Table 2.4** below.



**Table 2.4 Durations and Frequencies of Air Quality Monitoring Programme**

	Duration	Frequency
H <sub>2</sub> S concentration monitoring	15 minutes	<sup>1</sup> Weekly basis for 6 months during the initial operation stage
Odour patrol		<sup>4,5</sup> Weekly basis
Odour sampling for olfactometry analysis	<sup>3</sup> 15 minutes	<sup>2</sup> First week of the odour patrol monitoring

Remark:

- 1) In case excessive odour nuisance was detected during the odour patrol monitoring or the standard of the 5 odour units cannot be complied with during the odour panel monitoring, the odour patrol monitoring and H<sub>2</sub>S concentration monitoring shall be extended for a period of three months to cater for the warm-up period of the functioning of the additional mitigation measures.
- 2) In case the relationship between H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>) cannot conclude from the correlation study carried out at the first week of the odour patrol monitoring due to invalid data, additional odour sampling for olfactometry analysis shall be carried out for the correlation study.
- 3) Sufficient air samples (approximate 60L) may be collected in less than 15 minutes during odour sampling.
- 4) As advice by EPD on the odour complaint received in November 2019, odour patrol monitoring was resumed on weekly basis from 15 January 2020.
- 5) As instruction from the company of Discovery Bay Tunnel, odour patrol monitoring at OD5 (Spur Road near Discovery Bay Tunnel Outlet) was conducted on monthly basis.

2.5.2 The monitoring schedule for the present and next reporting period is provided in **Appendix B**.

**2.6 Event and Action Plan**

2.6.1 According to the approved proposal for odour patrol monitoring plan (0041/17/ED/0524G), updated Action and limit levels for air quality monitoring are presented in **Table 2.5**.

**Table 2.5 Action and Limit Levels for Air Quality Monitoring**

Parameter	Action	Limit
Odour Nuisance	One complaint received for specific odour event / Odour intensity of 2 or above is measured from odour patrol	Two or more independent complaints received for specific odour event in 3 months / Odour intensity of 3 or above is measured from odour patrol



2.6.2 The event and action plan for air quality monitoring is provided in **Appendix C**.

**2.7 Quality Assurance and Quality Control**

- 2.7.1 A control sample was collected by purging odour-free nitrogen gas from a certified gas cylinder on site at each sampling.
- 2.7.2 Calibration of the analyzer is conducted every year at the laboratory of the manufacturer.
- 2.7.3 In order to ensure the analyzer is functioning properly, manual sensor regeneration and zero adjustment were performed before each set of odour monitoring.

**2.8 Monitoring Results and Observations**

- 2.8.1 As advice by EPD on the odour complaint received in November 2019, odour patrol monitoring was resumed on weekly basis. The odour patrol monitoring was carried out on 1, 7, 13 and 24 February 2023. As instruction from the company of Discovery Bay Tunnel, odour patrol monitoring at OD5 (Spur Road near Discovery Bay Tunnel Outlet) was conducted on monthly basis.
- 2.8.2 The meteorological data including temperature, wind speed and direction of the reporting period at ASR is summarised in **Table 2.6**.

**Table 2.6 Summary of Meteorological Data in Reporting Period**

Date	Location	Temperature (°C)	Relative Humidity (%)	Wind Direction	Wind Speed (m/s)
1 February 2023	OD1	20.9	77	N	3.4
	OD2			E	0.8
	OD3			NE	1.1
	OD4			E	1.6
	OD6			E	1.6
	OD7			E	0.8
	OD8			NE	0.7
	OD9			E	1.5
	7 February 2023			OD1	21.3
OD2		NE	1.1		
OD3		-	0.0		
OD4		NE	0.4		
OD6		NE	2.0		
OD7		NE	2.1		
OD8		E	1.3		
OD9		NE	1.3		
13 February 2023		OD1	22.7	89	
	OD2	E			0.2
	OD3	E			0.8
	OD4	N			1.6
	OD6	NE			2.3
	OD7	N			2.6
	OD8	NE			1.4



24 February 2023	OD9	21.6	49	NE	0.4
	OD1			N	0.7
	OD2			-	0.0
	OD3			NE	1.4
	OD4			N	0.3
	OD5			N	0.9
	OD6			NE	1.2
	OD7			N	0.9
	OD8			NE	1.6
	OD9			N	1.5

2.8.3 The monitoring results in the reporting period are summarised in **Table 2.7**. Graphical pots of results and details of monitoring data are shown in **Appendix D**.

**Table 2.7 Summary of Air Quality Monitoring Result in Reporting Period**

Monitoring Location	Monitoring Parameter
	Odour Patrol^ (Odour Level)
	Range
OD1	0 – 1
OD2	0 – 1
OD3	0 – 0
OD4	0 – 0
OD5	0 – 0
OD6	0 – 0
OD7	0 – 0
OD8	0 – 0
OD9	0 – 0

Remark:

^Odour Level: 0 – Not detected, 1 – Slight, 2 – Moderate, 3 – Strong, 4 – Extreme

2.8.4 According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD’s memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.

2.8.5 No exceedances of Action/Limit levels at ASR were recorded as no complaint was received during the reporting period.

2.8.6 Odour mitigation measures such as aeration, chemical dosing system, covering or enclosing the pressing and sludge thickening facilities and ventilating air to a biological treatment unit prior to stack exhaust were implemented during the reporting period.



**3. WATER QUALITY MONITORING**

**3.1 Monitoring Station**

3.1.1 In accordance with Section 5 of the EM&A Plan, water quality monitoring should be carried out at eight designated monitoring stations (two impact stations and six control stations) during the first five years of the operational phase of the Project. The monitoring stations shall be the same monitoring stations that were used for the baseline monitoring programme and have been approved by EPD. The coordinates of the monitoring stations are shown in **Table 3.1** and their locations are shown in **Figure 3**.

**Table 3.1 Location of Water Quality Monitoring**

Sampling Location		Easting	Northing
A	The Brothers, Control Station	816 100	822 500
B	The Brothers, Control Station	816 680	822 440
C	Siu Ho Wan Outfall, Impact Station	816 800	820 180
D	Siu Ho Wan Outfall, Impact Station	817 160	820 360
E	Cheung Sok, Control Station	819 817	821 655
F	Cheung Sok, Control Station	820 158	821 922
G	Tai Ching Chau, Control Station	822 214	822 692
H	Tai Ching Chau, Control Station	822 494	822 939

**3.2 Monitoring Parameter**

3.2.1 The monitoring parameters for water quality monitoring are summarized in **Table 3.2**.

**Table 3.2 Parameters for Water Quality Monitoring**

Monitoring Parameters	
In-situ Measurement	Laboratory Analysis
Dissolved oxygen (mg/L)	<i>E. coli</i> (cfu/100ml)
Temperature (degree Celsius)	5-day BOD (mg/l)
pH value	Suspended Solids (mg/l)
Water depth (m)	Ammonia as N (mg/l)
Salinity (ppt)	Nitrate as N (mg/l)
Turbidity (NTU)	Nitrite as N (mg/l)
Current Speed (m/s)	Total inorganic nitrogen (mg/l)
Current Direction (degree magnetic)	Total phosphorus (soluble and particulate) (mg/l)



3.2.2 Apart from the parameters listed in the **Table 3.2**, other relevant supplementary information such as monitoring location, time, weather conditions and any special phenomena will be also recorded.

3.2.3 The tidal data will be obtained from the tide gauge installed in Ma Wan Marine Traffic Station, managed by the Hydrographic Office of Marine Department. Location of the tide gauge is shown in **Figure 4**.

**3.3 Monitoring Equipment**

3.3.1 A multifunctional meter (YSI 6920 V2/ Aqua TROLL 600) will be used to measure dissolved oxygen (DO), concentration, DO saturation, temperature, salinity, pH and turbidity, simultaneously at the same location and water depth. An Acoustic Doppler Current Profiler (ADCP) integrated with echo sounder function will be used to measure water depth, current velocity (speed and direction). The data measured by ADCP will then be downloaded on site to computer on-board. The water depth data measured by the ADCP shall be electronically logged and available for output. All measurement data from the multiparameter monitoring device and ADCP will be integrated with the GPS data from the DGPS logging device, so that data collected at a specific time and location can be shown. The water sampler will be equipped with a multiparameter monitoring device (with water depth probe to determine the exact sampling depth at which a sample is collected). The equipment employed for the monitoring and sampling and their specifications are presented in **Table 3.3**. **Table 3.4** summarizes the equipment used in water quality monitoring. Copy of the calibration certificates for water quality monitoring equipment are presented in **Appendix E**.

**Table 3.3 Water Quality Monitoring and Sampling Equipment**

Parameter	Equipment	Model	Range	Equipment Accuracy
Temperature, Dissolved Oxygen, salinity, pH, Turbidity, Sampling Depth	Water Quality Monitoring Device	1) YSI 6920V2-2-M Sonde 2) Aqua TROLL 600 Multiparameter Sonde	Temp: -5 to 50°C DO: 0-50mg/L DO%: 0-500% Sal: 0 to 70 ppt pH: 0 to 14 pH units Turb: 0-1000NTU Depth: 0-61 meters	Temp: ±0.15°C DO: ±0.1mg/L or 1% (whichever greater) for 0-20mg/L; ±15% for 20-50mg/L (with correction for salinity and temperature) Sal: ±1% or 0.1ppt (whichever greater) pH: ±0.2 units Turb: ±2% or 0.3NTU (whichever greater) Depth: ±0.12m
Water Depth, Current Speed, Current Direction	Acoustic Doppler Current Profiler	RiverSurveyor M9	Water Depth: 0-80m	Water Depth: 1% Current speed: ±0.25% of measured velocity or ±0.2cm/s Current direction: ±2degree magnetic
Positioning	DGPS	Simrad MX521B Smart Antenna with Simrad MX610 CDU	NA	GPS: ±1m
Water Sampling	Water Sampler	Aquatic Research Transparent PC Vertical Water Sampler 2.2L / 3L / 5L	NA	NA





**Table 3.4 Equipment used for Water Quality Monitoring**

Equipment	Manufacturer / Model	Serial Number
Water Quality Monitoring Device	Aqua TROLL 600 Multiparameter Sonde	525120
Acoustic Doppler Current Profiler	RiverSurveyor M9	5906

3.3.2 Apart from the equipment mentioned in Section 3.3.1, a Class III commercially licensed vessel will be used as survey vessel. DGPS logging device with accuracy of ±1m at 95% confidence level will be installed on the survey vessel to ascertain that measurement can be made accurately on the specific transects. All GPS data collected during the whole survey will be automatically and electronically logged. Powered winch will be used on-board the Survey Vessel to assist the monitoring. Experienced supervisor will be present all throughout the monitoring activities on-board the survey vessel.

3.3.3 Water samples will be collected by water sampler and stored in high density polythene bottles and sterilized glass bottles (for bacterial analysis), packed in ice (cooled to 4°C without being frozen), and delivered to the laboratory on the same day of collection for analysis. All sampling bottles will be pre-rinsed with the same water samples. The sampling bottles will then be taken to a HOKLAS accredited laboratory for analysis of *E. coli*, BOD<sub>5</sub>, Suspended Solids, NH<sub>3</sub>-N, NO<sub>3</sub>-N, NO<sub>2</sub>-N, Total inorganic nitrogen, Total phosphorus (soluble and particulate).

**3.4 Laboratory Measurement and Analysis**

3.4.1 With reference to EPD’s letter (Ref: Ax(7) to EP 2/No/F/50 Pt.7) dated 8 February 2022, Change of Laboratory on Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey (0041\_17\_ED\_0632A) is approved. Fugro Technical Services Limited (HOKLAS Reg. No. 015), is the appointed laboratory for analysis of water samples. The methods adopted by the laboratory and the reporting limits are detailed in **Table 3.5**.

**Table 3.5 Laboratory Measurement/Analysis Methods and Reporting Limits**

Analysis Description	Method	Reporting limits
<i>E. coli</i>	DoE Section 7.8, 7.9.4.2& 7.9.4.4 plus in situ urease test	1 cfu/100mL
5-day Biochemical Oxygen Demand	APHA 23rd edition 5210B	1 mg/L
Total Suspended Solid	APHA 23rd edition 2540D	0.5 mg/L
Ammonia as N	APHA 23rd edition 4500 - NH <sub>3</sub> H	0.005 mg/L
Nitrate as N	APHA 23rd edition 4500 - NO <sub>3</sub> <sup>-</sup> I	0.005 mg/L
Nitrite as N	APHA 23rd edition 4500 - NO <sub>2</sub> <sup>-</sup> A & NO <sub>3</sub> <sup>-</sup> I	0.005 mg/L
Total Inorganic Nitrogen	By Calculation	0.01 mg/L



Analysis Description	Method	Reporting limits
Total phosphorus (soluble and particulate)	APHA 17th edition 4500-PB5 (digestion) and In-house method E-T-056 (determination)	0.01 mg/L

**3.5 Monitoring Frequency and Duration**

- 3.5.1 The water quality monitoring programme will be carried out once per two months for a period of five years of the operational phase of the Project.
- 3.5.2 Water quality monitoring for two tides at eight designated stations will be carried out for each monitoring event. For each station at each tide, duplicate samples for in-situ parameter and laboratory analysis at three designated water depths (1 m below water surface, mid-depth and 1 m above the seabed) will be taken and analyzed.
- 3.5.3 The monitoring schedule for the present and next reporting period is provided in **Appendix B**.

**3.6 Quality Assurance / Quality Control**

- 3.6.1 The equipment is in compliance with the requirements set out in the EM&A Plan. All in-situ monitoring instruments were calibrated by a HOKLAS-accredited laboratory or by standard solutions. Calibration of temperature, DO, salinity, pH and turbidity is conducted in three month interval.
- 3.6.2 During the measurements of DO concentration, DO saturation, salinity, turbidity, pH and temperature, duplicate readings will be taken. If the difference between the first and second readings of DO or turbidity is more than 25% of the value of the first reading, the reading was discarded and further readings will be taken.
- 3.6.3 The laboratory incorporates a variety of QA/QC monitoring programme into their testing system. Where applicable or available, the quality of the analysis will be monitored by conducting the following QC analysis:

For each batch of 20 samples:

- A minimal of 1 laboratory method blank will be analyzed;
- A minimal of 1 sample duplicate will be analyzed;
- A minimal of 1 sample matrix spike will be analyzed.

**3.7 Event and Action Plan**

- 3.7.1 Since the purpose of the water quality monitoring is to collect data for future propose, no specific event and action has to be followed.

**3.8 Monitoring Results and Observations**

- 3.8.1 Water quality monitoring is carried out was 8 February 2023. A summary of the in-situ water quality monitoring results are presented in **Table 3.6** (Mid-ebb) and **Table 3.7** (Mid-flood)



respectively. The complete record and graphical presentation of the in-situ water quality monitoring results is given in **Appendix F**.

**Table 3.6 Summary of In-situ Monitoring Results (Mid-ebb)**

Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)
A	17	S 1	6.89	19.76	7.32	30.26	2.4	0.23	264.1
		S 1	6.84	19.77	7.31	30.22	2.6	0.21	266.2
		M 8.5	6.62	18.24	6.94	30.54	2.4	0.14	204.5
		M 8.5	6.61	18.26	6.99	30.56	2.7	0.16	205.1
		B 16	6.54	19.11	6.98	30.97	2.4	0.13	209.1
		B 16	6.57	19.17	6.97	30.96	2.5	0.14	209.9
B	14	S 1	6.84	18.94	7.74	31.24	1.4	0.14	74.1
		S 1	6.82	18.92	7.73	31.29	1.5	0.12	72.6
		M 7	6.70	18.73	7.54	31.57	1.3	0.13	74.9
		M 7	6.71	18.71	7.53	31.56	1.4	0.14	74.4
		B 13	6.74	18.54	7.41	31.84	2.3	0.23	81.2
		B 13	6.75	18.53	7.42	31.86	2.4	0.24	81.3
C	12	S 1	7.14	18.43	7.83	30.43	1.4	0.36	264.5
		S 1	7.13	18.47	7.82	30.42	1.6	0.32	266.1
		M 6	7.04	18.21	7.44	30.57	1.4	0.27	259.2
		M 6	7.03	18.23	7.46	30.56	1.6	0.28	259.4
		B 11	6.84	18.04	7.48	30.72	1.9	0.24	267.3
		B 11	6.83	18.06	7.49	30.70	1.8	0.26	266.1
D	13	S 1	6.74	18.42	7.54	31.46	1.2	0.38	146.2
		S 1	6.72	18.46	7.51	31.42	1.3	0.37	144.1
		M 6.5	6.69	18.72	7.52	31.87	1.8	0.24	123.5
		M 6.5	6.68	18.73	7.58	31.86	1.9	0.39	122.4
		B 12	6.54	18.94	7.59	31.34	2.4	0.23	154.6
		B 12	6.53	18.96	7.56	31.39	2.6	0.26	157.0
E	16	S 1	6.94	19.04	8.51	32.46	1.6	0.17	257.1
		S 1	6.91	19.02	8.52	32.44	1.8	0.16	255.2
		M 8	6.83	18.43	8.56	32.91	1.7	0.14	271.2
		M 8	6.82	18.41	8.57	32.94	1.8	0.18	277.3
		B 15	6.74	18.32	8.54	32.83	1.2	0.16	261.4
		B 15	6.73	18.33	8.53	32.84	1.3	0.14	261.1
F	23	S 1	6.64	19.32	8.73	32.46	1.4	0.12	312.7
		S 1	6.63	19.31	8.74	32.41	1.3	0.14	311.6
		M 11.5	6.73	19.46	8.69	32.58	1.4	0.16	326.1
		M 11.5	6.78	19.47	8.68	32.55	1.6	0.13	324.5
		B 22	6.51	19.31	8.64	32.74	1.9	0.16	322.3
		B 22	6.52	19.34	8.62	32.71	1.8	0.14	321.4
G	22	S 1	8.61	18.41	8.41	31.34	1.3	0.14	97.1
		S 1	8.64	18.42	8.42	31.33	1.4	0.16	97.4
		M 11	8.52	18.26	8.39	31.45	1.3	0.19	103.2
		M 11	8.51	18.22	8.38	31.49	1.2	0.13	104.1
		B 21	8.43	18.19	8.30	31.78	1.8	0.17	99.5
		B 21	8.42	18.18	8.36	31.77	1.9	0.18	99.2
H	19	S 1	8.94	18.03	8.64	31.01	1.4	0.24	245.1
		S 1	8.96	18.04	8.66	31.04	1.6	0.23	244.2
		M 9.5	8.90	17.94	8.68	31.34	1.1	0.18	237.3

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

Page 16

Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)
		M 9.5	8.91	17.92	8.67	31.33	2.2	0.19	236.4
		B 18	8.84	17.45	8.64	31.56	1.3	0.14	229.6
		B 18	8.82	17.46	8.63	31.59	1.4	0.16	229.1

Table 3.7 Summary of In-situ Monitoring Results (Mid-flood)

Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)
A	15	S 1	8.91	19.23	8.67	31.09	1.4	0.13	54.1
		S 1	8.94	19.24	8.64	31.04	1.5	0.17	53.2
		M 7.5	8.67	19.03	8.66	31.17	1.6	0.14	46.4
		M 7.5	8.64	19.04	8.64	31.19	1.4	0.14	46.5
		B 14	8.34	19.27	8.69	31.34	1.2	0.17	59.2
		B 14	8.35	19.26	8.67	31.33	1.3	0.16	59.4
B	14	S 1	8.13	19.46	8.78	31.46	1.6	0.15	64.1
		S 1	8.14	19.42	8.76	31.48	1.8	0.12	64.2
		M 7	8.46	19.57	8.61	31.82	1.3	0.19	71.3
		M 7	8.42	19.55	8.62	31.84	1.4	0.18	71.4
		B 13	8.61	19.56	8.79	31.87	1.5	0.16	71.2
		B 13	8.62	19.54	8.74	31.92	1.6	0.17	70.6
C	12	S 1	8.44	19.14	8.42	33.94	1.2	0.24	94.2
		S 1	8.41	19.26	8.43	33.92	1.3	0.27	99.1
		M 6	8.29	19.44	8.47	33.64	1.9	0.21	424.5
		M 6	8.26	19.48	8.46	33.68	1.6	0.26	122.3
		B 11	8.27	19.17	8.41	33.17	1.7	0.34	98.4
		B 11	8.24	19.16	8.43	33.18	1.8	0.31	99.1
D	14	S 1	8.16	19.02	8.34	34.56	1.9	0.14	314.5
		S 1	8.14	19.01	8.33	34.54	2.0	0.12	312.6
		M 7	8.02	19.34	8.71	35.27	2.4	0.24	274.1
		M 7	8.01	19.36	8.72	35.36	2.6	0.26	277.3
		B 13	7.94	18.47	8.73	36.14	2.1	0.14	264.5
		B 13	7.93	18.46	8.74	36.17	2.4	0.12	261.1
E	14	S 1	9.24	18.17	8.58	30.82	1.2	0.19	321.4
		S 1	9.22	18.14	8.54	30.81	1.3	0.18	322.5
		M 7	9.02	18.09	8.62	30.99	1.4	0.14	317.8
		M 7	9.06	18.04	8.61	30.97	1.3	0.16	316.4
		B 13	9.16	18.11	8.63	30.91	1.3	0.09	329.3
		B 13	9.14	18.12	8.62	30.92	1.3	0.08	329.9
F	18	S 1	9.04	18.55	8.23	30.44	1.5	0.26	241.3
		S 1	9.02	18.51	8.27	30.41	1.6	0.24	242.5
		M 9	8.47	18.32	8.19	31.14	1.8	0.20	267.7
		M 9	8.46	18.31	8.17	31.15	1.7	0.21	267.8
		B 17	8.57	18.44	8.19	31.24	1.6	0.24	245.9
		B 17	8.56	18.42	8.16	31.28	1.6	0.29	245.2
G	13	S 1	9.03	18.97	8.53	31.01	1.4	0.14	99.5
		S 1	9.02	18.94	8.54	31.02	1.6	0.17	94.4
		M 6.5	8.73	18.10	8.59	31.44	1.9	0.16	87.1
		M 6.5	8.74	18.11	8.56	31.45	1.8	0.14	87.2

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

Page 17

Monitoring Station	Water Depth (m)	Sampling Depth (m)	Dissolved oxygen (mg/L)	Temperature (degree Celsius)	pH	Salinity (ppt)	Turbidity (NTU)	Current speed (m/s)	Current velocity (degree magnetic)	
H		B	12	8.54	18.01	8.62	30.99	1.4	0.27	103.1
		B	12	8.53	18.02	8.64	30.94	1.3	0.24	104.2
	19	S	1	8.44	17.94	8.61	30.44	1.8	0.14	209.7
		S	1	8.41	17.92	8.62	30.41	1.6	0.12	209.1
		M	9.5	8.26	17.46	8.54	30.92	1.3	0.24	234.5
		M	9.5	8.25	17.44	8.53	30.94	1.4	0.26	233.1
		B	18	8.19	17.29	8.49	31.14	1.6	0.24	217.2
		B	18	8.18	17.28	8.48	31.16	1.7	0.21	216.4

3.8.2 Results of laboratory analysis of water quality are presented in **Table 3.8** (Mid-ebb) and **Table 3.9** (Mid-flood) respectively. The complete record and graphical presentation of laboratory analysis results are given in **Appendix F**.

Table 3.8 Summary of Laboratory Analysis Results (Mid-ebb)

Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)	
A	17	S	1	3	0.23	0.008	0.15	0.39	420	0.03	1.6
		S	1	3	0.22	0.009	0.15	0.38	530	0.03	1.3
		M	8.5	3	0.23	0.008	0.18	0.42	500	0.03	1.6
		M	8.5	3	0.22	0.009	0.16	0.39	450	0.03	1.4
		B	16	3	0.22	0.009	0.18	0.41	400	0.03	1.5
		B	16	3	0.20	0.009	0.22	0.42	480	0.03	1.3
B	14	S	1	3	0.33	0.009	0.21	0.56	460	0.02	1.2
		S	1	3	0.33	0.009	0.17	0.51	400	0.02	1.3
		M	7	3	0.57	0.017	0.70	1.3	500	0.03	1.3
		M	7	3	0.57	0.017	0.58	1.2	430	0.03	1.4
		B	13	3	0.25	0.009	0.23	0.49	530	0.02	1.3
		B	13	4	0.24	0.008	0.24	0.49	580	0.02	1.4
C	12	S	1	3	0.21	0.010	0.23	0.45	400	0.03	2.0
		S	1	4	0.21	0.009	0.23	0.45	460	0.03	1.4
		M	6	3	0.19	0.009	0.22	0.42	390	0.03	1.4
		M	6	3	0.20	0.008	0.24	0.44	360	0.03	1.3
		B	11	4	0.21	0.008	0.24	0.46	450	0.04	1.3
		B	11	4	0.20	0.008	0.23	0.44	490	0.04	1.7
D	13	S	1	4	0.17	0.009	0.24	0.42	420	0.04	1.4
		S	1	4	0.18	0.008	0.23	0.41	450	0.04	1.4
		M	6.5	4	0.19	0.008	0.19	0.38	510	0.03	1.2
		M	6.5	4	0.20	0.009	0.12	0.32	520	0.04	1.1
		B	12	4	0.19	0.011	0.11	0.31	600	0.03	1.3
		B	12	4	0.19	0.008	0.11	0.31	530	0.03	1.4
E	16	S	1	3	0.18	0.008	0.14	0.32	110	0.02	1.5
		S	1	3	0.18	0.009	0.14	0.32	120	0.03	1.5
		M	8	3	0.18	0.011	0.11	0.30	98	0.03	1.5
		M	8	3	0.18	0.009	0.12	0.31	110	0.03	1.5
		B	15	4	0.20	0.009	0.12	0.33	130	0.02	1.5
		B	15	4	0.19	0.008	0.13	0.33	120	0.02	1.3
F	23	S	1	4	0.16	0.029	0.32	0.51	100	0.04	1.4
		S	1	4	0.16	0.029	0.31	0.50	160	0.03	1.6

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

Page 18

Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)
		M 11.5	3	0.17	0.008	0.12	0.30	120	0.03	1.3
		M 11.5	3	0.15	0.010	0.12	0.29	110	0.02	1.5
		B 22	4	0.18	0.010	0.20	0.39	140	0.03	1.3
		B 22	4	0.19	0.009	0.19	0.39	120	0.03	1.4
G	22	S 1	3	0.14	0.009	0.20	0.35	97	0.03	1.6
		S 1	3	0.16	0.009	0.13	0.30	110	0.03	1.4
		M 11	3	0.20	0.009	0.14	0.35	81	0.03	1.4
		M 11	3	0.19	0.009	0.15	0.35	78	0.03	1.4
		B 21	4	0.15	0.008	0.18	0.33	120	0.02	1.5
		B 21	4	0.15	0.009	0.12	0.28	110	0.02	1.4
H	19	S 1	4	0.15	0.009	0.12	0.28	99	0.02	1.7
		S 1	3	0.13	0.009	0.12	0.26	98	0.02	1.5
		M 9.5	4	0.17	0.008	0.12	0.30	82	0.02	1.8
		M 9.5	4	0.17	0.009	0.12	0.29	78	0.03	1.5
		B 18	4	0.16	0.009	0.12	0.29	69	0.04	1.4
		B 18	4	0.16	0.010	0.11	0.28	88	0.03	1.6

Table 3.9 Summary of Laboratory Analysis Results (Mid-flood)

Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)
A	15	S 1	4	0.22	0.010	0.12	0.35	320	0.03	1.5
		S 1	4	0.19	0.009	0.13	0.33	390	0.03	1.4
		M 7.5	3	0.19	0.011	0.12	0.31	420	0.03	1.5
		M 7.5	3	0.19	0.010	0.12	0.32	370	0.03	1.3
		B 14	3	0.17	0.008	0.12	0.30	500	0.02	1.4
		B 14	3	0.17	0.008	0.11	0.29	450	0.02	1.5
B	14	S 1	3	0.19	0.009	0.12	0.32	320	0.02	1.4
		S 1	3	0.18	0.010	0.12	0.31	480	0.03	1.3
		M 7	3	0.19	0.008	0.11	0.31	280	0.03	1.5
		M 7	3	0.18	0.008	0.13	0.32	320	0.03	1.4
		B 13	3	0.15	0.009	0.13	0.29	400	0.03	1.4
		B 13	3	0.16	0.009	0.13	0.30	350	0.03	1.4
C	12	S 1	3	0.15	0.009	0.13	0.29	550	0.02	1.1
		S 1	3	0.15	0.008	0.13	0.29	450	0.03	1.4
		M 6	3	0.16	0.009	0.11	0.28	490	0.02	1.5
		M 6	3	0.16	0.009	0.12	0.28	420	0.02	1.6
		B 11	3	0.18	0.009	0.13	0.32	590	0.02	1.7
		B 11	3	0.18	0.008	0.13	0.32	500	0.02	1.7
D	14	S 1	3	0.19	0.008	0.19	0.31	300	0.02	1.6
		S 1	3	0.19	0.009	0.19	0.31	240	0.02	1.6
		M 7	3	0.19	0.009	0.19	0.30	280	0.05	1.6
		M 7	3	0.18	0.008	0.18	0.30	230	0.05	1.5
		B 13	3	0.18	0.008	0.18	0.30	360	0.02	1.3
		B 13	3	0.19	0.009	0.19	0.31	300	0.02	1.7
E	14	S 1	4	0.18	0.008	0.18	0.30	82	0.02	1.7
		S 1	4	0.16	0.009	0.16	0.28	110	0.03	1.5
		M 7	3	0.15	0.008	0.15	0.28	100	0.02	1.1
		M 7	3	0.15	0.009	0.15	0.28	120	0.02	1.2
		B 13	3	0.19	0.009	0.19	0.32	69	0.02	1.6



Monitoring Station	Water Depth (m)	Sampling Depth (m)	TSS (mg/L)	NH <sub>3</sub> as N (mg/L)	NO <sub>2</sub> <sup>-</sup> as N (mg/L)	NO <sub>3</sub> <sup>-</sup> as N (mg/L)	TIN (mg/L)	E.coli (cfu/100mL)	Total P (mg/L)	BOD <sub>5</sub> (mg/L)
F	18	B 13	3	0.16	0.009	0.16	0.28	76	0.02	1.4
		S 1	3	0.19	0.008	0.12	0.31	100	0.02	1.5
		S 1	4	0.17	0.008	0.13	0.30	74	0.02	1.3
		M 9	3	0.22	0.009	0.19	0.42	100	0.03	1.3
		M 9	3	0.22	0.009	0.14	0.37	69	0.02	1.6
		B 17	3	0.22	0.009	0.12	0.35	80	0.03	1.6
		B 17	3	0.22	0.008	0.11	0.34	89	0.03	1.4
G	13	S 1	3	0.12	0.009	0.11	0.24	100	0.02	1.4
		S 1	3	0.12	0.008	0.11	0.24	84	0.02	1.6
		M 6.5	3	0.15	0.009	0.11	0.27	96	0.02	1.5
		M 6.5	3	0.15	0.008	0.12	0.27	110	0.02	1.5
		B 12	3	0.16	0.009	0.12	0.28	79	0.02	1.3
		B 12	3	0.16	0.009	0.11	0.28	67	0.02	1.3
H	19	S 1	3	0.14	0.009	0.13	0.28	52	0.02	1.4
		S 1	3	0.13	0.009	0.11	0.25	62	0.02	1.6
		M 9.5	3	0.18	0.008	0.12	0.31	86	0.02	1.5
		M 9.5	3	0.18	0.008	0.12	0.30	69	0.02	1.4
		B 18	3	0.15	0.009	0.12	0.28	54	0.02	1.7
		B 18	3	0.16	0.009	0.13	0.29	46	0.02	1.7

3.8.3 The tidal data is obtained from the tide gauge installed in Ma Wan Marine Traffic Station, managed by Hydrographic Office of Marine Department. Tidal data obtained from Ma Wan Marine Traffic Station is present in **Appendix G**.

3.8.4 Heavy marine traffic was observed nearby the Project site and its vicinity and may affect the water quality. The above conditions may affect monitoring results. The weather condition is summarized and presented in **Table 3.10**.

Table 3.10 Weather condition of water quality monitoring

Date	Air Temperature			Mean Relative Humidity (%)	Total Rainfall (mm)
	Maximum (deg. C)	Mean (deg. C)	Minimum (deg. C)		
8 February 2023	20.1	18.5	17.2	84	Trace

Source: Hong Kong Observatory



**4. SEDIMENT QUALITY MONITORING AND BENTHIC SURVEY**

**4.1 Monitoring Station**

4.1.1 In accordance with Section 6 of the EM&A Plan, sediment quality monitoring and benthic survey should be carried out at eight designated monitoring stations (two impact stations and six control stations) during the first five years of the operational phase of the Project. The proposed monitoring stations shall be the same monitoring stations that were used for the baseline monitoring programme and have been approved by EPD. The coordinates of the monitoring stations are shown in **Table 4.1** and their locations are shown in **Figure 3**.

**Table 4.1 Location of Sediment Quality Monitoring and Benthic Survey**

Sampling Location		Easting	Northing
A	The Brothers, Control Station	816 100	822 500
B	The Brothers, Control Station	816 680	822 440
C	Siu Ho Wan Outfall, Impact Station	816 800	820 180
D	Siu Ho Wan Outfall, Impact Station	817 160	820 360
E	Cheung Sok, Control Station	819 817	821 655
F	Cheung Sok, Control Station	820 158	821 922
G	Tai Ching Chau, Control Station	822 214	822 692
H	Tai Ching Chau, Control Station	822 494	822 939

**4.2 Monitoring Parameter**

4.2.1 The monitoring parameters for sediment quality monitoring and benthic survey are summarized in **Table 4.2**.

**Table 4.2 Parameters for Sediment Quality Monitoring and Benthic Survey**

Monitoring Parameters	
Sediment Quality Monitoring	Rinsate Blank for Benthic Survey
Grain size profile* (i.e. Particle Size Distribution) (%)	Cadmium (µg/L)
Total organic carbon* (%)	Chromium (µg/L)
pH value	Copper (µg/L)
Ammonia as N (mg-N/kg)	Lead (µg/L)
Total nitrogen (mg-N/kg)	Mercury ((µg/L)
Total phosphorus (mg-N/kg)	Nickel (µg/L)
Cadmium (mg/kg)	Zinc (µg/L)
Chromium (mg/kg)	Arsenic (µg/L)
Copper (mg/kg)	Silver (µg/L)
Lead (mg/kg)	
Mercury (mg/kg)	
Nickel (mg/kg)	
Zinc (mg/kg)	
Arsenic (mg/kg)	
Silver (mg/kg)	



\*Grain size profile and total organic carbon is determined from the sediment sampled collected for benthic survey.

4.2.2 Apart from the parameters listed in the Table 4.2, other relevant supplementary information such as monitoring location, time, weather conditions and any special phenomena will be also recorded.

4.2.3 The tidal data will be obtained from the tide gauge installed in Ma Wan Marine Traffic Station, managed by the Hydrographic Office of Marine Department. Location of the tide gauge is shown in **Figure 4**.

#### **4.3 Sampling Equipment**

4.3.1 Ponar grab sampler (capacity of ~ 1 litre) will be used for collection of samples for sediment analysis. The grab will be capable of collecting sufficient amount of surficial (top 5 cm) sediment for the required analysis in a single deployment at each sampling location. The grab will be constructed with non-contaminating material to prevent sample contamination. Photos of ponar grab sampler are shown in **Appendix J**.

4.3.2 A modified Van Veen grab sampler (capacity of ~ 11.3 litres) will be used for collecting sediment samples for benthic survey. The top of the grab will have openings to allow the easy flow of water through the grab as it descends. The openings will be covered with 0.5 mm mesh to prevent the loss of any benthic fauna once sediment samples are taken. In addition the top openings will be sealable by movable flaps which will close when the grab is hauled to surface. Photos of modified Van Veen grab sampler are shown in **Appendix J**.

4.3.3 Class III commercially licensed vessel will be used as survey vessel. DGPS logging device in the ADCP with accuracy of  $\pm 1\text{m}$  at 95% confidence level will be installed on the survey vessel to ascertain that measurement can be made accurately on the specific transects. All GPS data collected during the whole survey will be automatically and electronically logged. Powered winch will be used on-board the survey vessel to assist the monitoring. 4 fixed sieve stations will be equipped on survey vessel. Experienced supervisor will be present all throughout the monitoring activity on-board the survey vessel.

#### **4.4 Sampling Procedure**

##### *Benthic Survey, Particle Size Distribution and TOC Analysis*

4.4.1 A modified Van Veen grab sampler (capacity of ~ 11.3 litres) will be deployed using a winch at each of the benthic survey stations to collect single grab sample at each station. The grab sampler will be lowered through the water column slowly at a constant rate (approximately 30 cm/s) to prevent the formation of a pressure wave that may disturb surficial deposits. The grab will then be retrieved and evaluated on board of the survey vessel. Any sample showing uneven penetration or only partially filled with sediment shall be rejected. Samples will be placed in a plastic box with an identification card. Sub-samples (approximately 1 kg) will be splitted up for analysis of particle size distribution and TOC. The remaining sediment samples will be washed gently to separate the benthic organisms and the sediment using a watering hose with marine seawater supply, by a sieve stack (comprising 1 mm and 0.5 mm meshes). Benthic organisms remaining on the sieve will be removed into pre-labeled ziplock plastic bags. A 10% solution of buffered formalin containing Rose Bengal in seawater will be added to the bag to ensure tissue



preservation. Samples will be sealed in plastic containers for transport to the laboratory for sorting and identification of benthic organisms.

Sediment Quality Monitoring (Except Particle Size Distribution and TOC Analysis)

4.4.2 Ponar grab sampler (capacity of ~ 1 litres) will be deployed at each of the benthic survey stations to collect single grab sample at each station. The grab sampler should be lowered through the water column slowly at a constant rate (approximately 30 cm/s) to prevent the formation of a pressure wave that may disturb surficial deposits. The grab will then be retrieved and evaluated on board of the survey vessel. Any sample showing uneven penetration or only partially filled with sediment will be rejected. Samples will be placed in a plastic box with an identification card. Sediment samples will be then transferred into brand new soil jars with QA/QC monitoring for laboratory analysis. Samples will be preserved and stored in accordance with approved SOP of HOKLAS accredited laboratory and the recommendations stipulated in ETWB TC (W) No. 34/2002.

4.4.3 Sediment samples shall be collected and packed in ice (cooled to 4°C without being frozen), and delivered to the laboratory on the same day of collection for analysis.

**4.5 Laboratory Measurement and Analysis**

4.5.1 With reference to EPD’s letter (Ref: Ax(7) to EP 2/No/F/50 Pt.7) dated 8 February 2022, Change of Laboratory on Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey (0041\_17\_ED\_0632A) is approved. Fugro Technical Services Limited (HOKLAS Reg. No. 015), is the appointed laboratory for analysis of sediment samples. The methods adopted by the laboratory and the reporting limits are detailed in **Table 4.3**.

**Table 4.3 Laboratory Measurement/Analysis Methods and Reporting Limits**

Analysis Description	Method	Reporting limits
Particle Size Distribution	Geospec 3 : 2001 Test 8.1, 8.5 and 8.7	1%
Total Organic Carbon	APHA 23rd edition 5310B	0.05%
pH value	APHA 23rd edition 4500-H*B	0.1 pH unit
Ammonia as N	APHA 23rd edition 4500 NH3: B & C / In house method E-T-039	0.5 mg/kg
Total Nitrogen	APHA 23rd edition 4500 N <sub>org</sub> : D (digestion), In-house method E-T-036, E-T-037 & APHA 23rd edition 4500 - NO <sub>3</sub> <sup>-</sup> I	10 mg/kg
Total Phosphorus	APHA 17th edition 4500 – PB.5 (digestion) & In house method E-T-056 (determination)	10 mg/kg
Cadmium	USEPA method 3050B (digestion) and 6020A (determination)	0.1 mg/kg
Chromium		0.5 mg/kg
Copper		0.2 mg/kg
Lead		0.2 mg/kg
Mercury		0.05 mg/kg
Nickel		0.2 mg/kg
Zinc		0.5 mg/kg
Arsenic		0.5 mg/kg
Silver		0.1 mg/kg

#### **4.6 Taxonomic Identification of Benthic Organism**

4.6.1 Taxonomic identification of benthic organisms will be performed using stereo dissecting and high-power compound microscopes where it is necessary. Benthic organisms will be counted and identified to lower taxonomic levels as far as practicable with biomass (wet weight, to 0.01gram) of each individual recorded. If breakage of soft-bodied organism occurs, only anterior portions of fragments will be counted, although all fragments will be retained and weighted for biomass determinations (wet weight, to 0.01gram). Data of species abundance and biomass will be recorded.

4.6.2 Data collected during surveys will be presented and summarized in tables and graphics. Species/taxon richness and abundance of marine benthic fauna communities will be analyzed by Shannon-Weiner diversity and Pielou's Evenness.

#### **4.7 Monitoring Frequency and Duration**

4.7.1 The sediment quality monitoring and benthic survey programmed shall be carried out once per two months for a period of five years of the operational phase of the Project. Since the purpose of the sediment quality monitoring and benthic survey is to collect data for future reference, only a single round of sediment quality monitoring and benthic survey at 8 designated locations will be carried out for each monitoring event. For each location, only a single sample will be taken and analyzed.

#### **4.8 Quality Assurance / Quality Control**

4.8.1 A rinsate blank will be collected in each monitoring location before each sediment sampling for benthic survey, so as to monitor the effectiveness of field decontamination procedure.

4.8.2 The laboratory incorporates a variety of QA/QC monitoring programme into their testing system. Where applicable or available, the quality of the analysis will be monitored by conducting the following QC analysis:

For each batch of 20 samples:

- A minimal of 1 laboratory method blank will be analyzed;
- A minimal of 1 sample duplicate will be analyzed;
- A minimal of 1 sample matrix spike will be analyzed.

#### **4.9 Event and Action Plan**

4.9.1 Since the purpose of the sediment quality monitoring and benthic survey is to collect data for future purpose, no specific event and action has to be followed.

#### **4.10 Monitoring Results and Observations**

4.10.1 Sediment quality monitoring and benthic survey is carried out on 8 February 2023. A summary of laboratory analysis results for the sediment quality monitoring and benthic survey are presented in **Table 4.4** and **Table 4.5** respectively. The complete record and graphical presentation of the sediment quality monitoring results is given in **Appendix H**.



**Table 4.4 Summary of laboratory analysis results for sediment monitoring**

Monitoring Station	pH value	NH <sub>3</sub> as N (mg/L)	Total N (mg-N/kg)	Total P (mg-P/kg)	Cd (mg/kg)	Cr (mg/kg)	Cu (mg/kg)	Pb (mg/kg)	Hg (mg/kg)	Ni (mg/kg)	Zn (mg/kg)	As (mg/kg)	Ag (mg/kg)
A	8.3	9.6	680	460	<0.1	27	23	34	0.11	14	79	14	0.2
B	8.2	16	950	70	<0.1	28	26	34	0.10	15	85	10	0.3
C	8.1	18	1200	54	<0.1	30	28	36	0.11	17	92	10	0.3
D	8.1	14	1400	300	<0.1	29	29	35	0.10	16	88	10	0.3
E	8.2	20	1100	290	<0.1	25	30	30	0.08	14	76	8	0.3
F	8.1	19	1400	43	<0.1	39	35	46	0.15	23	130	13	0.3
G	8.3	7.4	750	260	<0.1	37	43	47	0.14	19	210	13	0.4
H	8.2	7.0	900	360	<0.1	33	31	38	0.11	18	89	11	0.4

**Table 4.5 Summary of laboratory analysis results for benthic survey**

Monitoring Station	Total organic carbon (%)	Grain size profile (%)				Description
		Gravel	Sand	Silt	Clay	
A	1.1	1	2	42	55	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
B	1.1	0	17	37	46	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
C	1.1	2	5	43	50	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
D	1.1	0	6	42	52	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
E	1.3	6	17	36	41	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
F	1.2	0	10	42	48	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
G	0.56	3	28	29	40	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments
H	1.1	3	13	37	47	Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments

4.10.2 Rinsate blank was collected for chemical analysis. The laboratory data results are provided in **Appendix H**.

4.10.3 Construction works from expansion of Hong Kong International Airport was observed nearby the Project site and its vicinity and may affect the sediment quality. The above conditions may affect monitoring results. The weather condition is summarized and presented in **Table 4.6**.

**Table 4.6 Weather condition of water quality monitoring**

Date	Air Temperature			Mean Relative Humidity (%)	Total Rainfall (mm)
	Maximum (deg. C)	Mean (deg. C)	Minimum (deg. C)		
8 February 2023	20.1	18.5	17.2	84	Trace

Source: Hong Kong Observatory



4.10.4 The benthic survey data are summarized and presented in **Table 4.7**.

Table 4.7 Summary of benthic survey data on 8 February 2023

Monitoring Station	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	65	1.29	12	1.91	0.77
B	45	0.44	9	1.95	0.89
C	28	0.34	8	1.70	0.82
D	29	0.71	10	2.00	0.87
E	52	0.38	8	1.63	0.78
F	67	0.54	8	1.08	0.52
G	39	2.68	8	1.46	0.70
H	29	0.14	7	0.86	0.44

4.10.5 The benthic survey results are analyzed and presented as below:

i) Abundance

A total of 354 benthic organisms was recorded from the eight monitoring stations during the February 2023 monitoring period. Current monitoring results showed lower total monthly abundance compared to both dry (March 2004) and wet (August 2004) seasons baseline data results. Similar with previous monitoring periods, total monthly abundance of benthic organisms exhibits significant seasonal variation (F-value = 4.63; F-crit = 1.5; p-value = 4.82E-12;  $\alpha$  = 0.05).

In terms of spatial distribution, the lowest abundance of 28 ind. was recorded in the impact station, Station C, while the highest (67 ind.) was noted in reference station, Station F. The total macrobenthic abundance as similar with the previous monitoring periods, showed statistically significant different spatial distribution (F-value = 3.81; F-crit = 2.05; P-value = 0.001;  $\alpha$  = 0.05).

ii) Biomass

The total wet biomass recorded in the eight monitoring stations was 6.52 g with the highest biomass recorded in the reference station, Station G (2.68 g) while the lowest biomass (0.14 g) was observed in reference station, Station H. Relative to the December 2022 period, a general decrease in biomass was observed during the current monitoring period (Figure 3). Most of the current decrease was attributed to the low biomass of *Mytilopsis* in the benthic community.

iii) Taxonomic Composition

A total of four phyla comprising of 22 families and about 27 genera were identified. During the current monitoring period, the annelids (47.18%) dominated the macrobenthic assemblage, and followed by the arthropods (38.98%). Relative to the December 2022 community assemblage, current results showed that the annelids still maintained their dominance within the benthic community.

The dominance of annelids could be due to the high percentage of silt on all the monitoring areas as shown by the results of sediment particle size distribution analyses for the current monitoring month.



iv) Diversity

Benthic diversity index ( $H'$ ) in the impact stations ranged from 1.70 to 2.00. Among the reference stations,  $H'$  values ranged from 0.86 to 1.95. Currently, impact station, Station D had the highest diversity value among the different monitoring stations, while the lowest was the reference station, Station H. In terms of evenness index ( $J$ ) values, reference Station B was noted with the highest value among the monitoring stations. Moreover, current monitoring results indicated an overall increase in both diversity and evenness values from the baseline survey condition.

The detailed benthic survey results are provided in **Appendix I**.



**5. CHINESE WHITE DOLPHIN MONITORING**

**5.1 Data Interpretation**

- 5.1.1 In accordance with Section 4.1 of the EM&A Plan, relevant information on the distribution and abundance of CWDs in Hong Kong should be obtained from the Agriculture, Fisheries and Conservation Department (AFCD), and be reviewed on a bimonthly basis during the operational phase of the Project for a period of 5 years.
- 5.1.2 The latest AFCD's report dated 7 July 2022, "*Monitoring of Marine Mammals in Hong Kong Waters (2021-22)*", in terms of the distribution and abundance of CWDs, was reviewed in the Monthly EM&A report in August 2022. According to the advice from AFCD, the data of distribution and abundance of CWDs would only be available in the annual reports for Monitoring of Marine Mammals In Hong Kong Waters which cover monitoring data from 1 April to 31 March (next year). The updated status of the distribution and abundance of CWDs will be provided once the annual report (2022-23) is uploaded to AFCD's webpage.



**6. ADVICE ON IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES**

**6.1 Implementation Status**

- 6.1.1 Although no site inspection is prescribed during the operation of the Plant in accordance with the approved EM&A Plan, SHWSTW is reminded to fully and properly implement the mitigation measures specified in the EP and EIA Report. Mitigation measures such as aeration, chemical dosing system, covering or enclosing the pressing and sludge thickening facilities and ventilating air to a biological treatment prior to stack exhaust was implemented in the reporting period. A summary of mitigation measures implementation schedule is provided in **Appendix L**.





**7. ADVICE ON THE SOLID AND LIQUID WASTE MANAGEMENT STATUS**

7.1.1 SHWSTW is reminded to fully comply with EP conditions. All measures and recommendations in the EP, EIA Report and approved Waste Management Plan (WMP) shall be fully and properly implemented. During the reporting period, following measures in related to solid and liquid waste management were implemented:

- The influent of waste water shall be treated by CEPT with UV disinfection;
- Trip-ticket system shall be implemented for sludge and sediment;
- The acceptance criteria for Landfill disposal should be followed;
- Chemical waste should be properly handled and stored temporarily in designated chemical waste storage area on site in accordance with the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes.

7.1.2 A summary of mitigation measures implementation schedule is provided in **Appendix L**.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

Page 30

## 8. SUMMARY OF EXCEEDANCE OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS

- 8.1.1 Odour patrol monitoring was resumed and carried out on 1, 7, 13 and 24 February 2023. No exceedances of Action/Limit levels at ASRs were recorded.
- 8.1.2 Water quality monitoring, sediment quality monitoring and benthic survey were carried out on 8 February 2023. No specific Action/Limit level has to be followed since the purpose of the monitoring is to collect data for future purpose.



**9. SUMMARY OF ENVIRONMENTAL COMPLAINTS**

9.1.1 No complaint (written or verbal), inspection notice, notification of summons or prosecution was received in relation to environmental impact during the report period. Summaries of complaints, notification of summons and successful prosecutions are presented in **Table 9.1** and **Table 9.2**.

**Table 9.1 Cumulative Statistics on Complaints**

Environmental Parameters	Cumulative No. Brought Forward	No. of Complaints This Month	Cumulative Project-to-Date
Air	0	0	1
Noise	0	0	0
Water	0	0	0
Waste	0	0	0
Others	0	0	0
Total	0	0	0

**Table 9.2 Cumulative Statistics on Notification of Summons and Successful Prosecutions**

Environmental Parameters	Cumulative No. Brought Forward	No. of Notification of Summons and Prosecutions This Month	Cumulative Project-to-Date
Air	0	0	0
Noise	0	0	0
Water	0	0	0
Waste	0	0	0
Others	0	0	0
Total	0	0	0

9.1.2 The cumulative complaint log and summaries of complaints are presented in **Appendix K**.



**10. FUTURE KEY ISSUES**

10.1.1 The key issues to be considered in the coming reporting month include:

- i. Potential environmental impacts arising from the operation of SHWSTW are mainly associated with air quality, water quality, sediment quality, benthic ecology, waste management and distribution and abundance of CWDs.
- ii. According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD's memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.

**11. CONCLUSION**

- 11.1.1 Odour patrol monitoring was resumed from January 2020 and carried out on 1, 7, 13 and 24 February 2023. The modified odour patrol monitoring plan including updated Event and Action Plan was approved on March 2020, and odour patrol monitoring was commenced from 20 March 2020. No exceedances of Action/Limit levels at Air Sensitive Receivers (ASR) and odour patrol points were recorded and no non-compliance of odour monitoring at odour patrol points were recorded in the reporting period.
- 11.1.2 According to the approved EM&A plan, a correlation study has to be carried out to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). H<sub>2</sub>S measurement and olfactometry analysis conducted between August 2017 and May 2018 was considered as unlikely way to establish the relationship of H<sub>2</sub>S concentration (ppb) with the odour unit (OU/m<sup>3</sup>). Since six months air quality monitoring and additional three months air quality monitoring had been conducted according to Section 2.2 of OEM&A Plan without any complaint or non-compliance recorded, air quality monitoring was temporarily suspension on air quality monitoring was approved by EPD's memo dated 14 May 2018. In order to recommence the monitoring, a review on air quality monitoring had been carried out to determine reasonable odour-related criteria and was submitted to EPD for approval on 24 March 2020. Comments from EPD was received on 1 April 2020 and the review is currently under revision for further submission to the EPD.
- 11.1.3 Water quality monitoring, sediment quality monitoring and benthic survey were conducted on 8 February 2023 to collect data for future reference in accordance with Section 5.5 and 6.5 of the Operational EM&A Plan. The details of methodology and results collected of the monitoring were presented in Section 3 and Section 4. Heavy marine traffic and construction works from expansion of Hong Kong International Airport were observed nearby the Project site and its vicinity and may affect the water and sediment quality The above conditions may affect monitoring results.
- 11.1.4 The latest AFCD's report dated 7 July 2022, "*Monitoring of Marine Mammals in Hong Kong Waters (2021-22)*" in terms of the distribution and abundance of CWDs was reviewed. According to the advice from AFCD, the data of distribution and abundance of CWDs would only be available in the annual reports for Monitoring of Marine Mammals In Hong Kong Waters which cover monitoring data from 1 April to 31 March (next year). The updated status of the distribution and abundance of CWDs will be provided once the annual report (2022-23) is uploaded to AFCD's webpage.
- 11.1.5 SHWSTW is reminded to fully *comply with EP conditions. All environmental mitigation measures* and recommendations in the EP, EIA Report and approved waste management plan shall be fully and properly implemented.
- 11.1.6 No complaint (written or verbal), inspection notice, notification of summons or prosecution was received in relation to environmental impact during the report period.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com




---


Report No.: 0041/17/ED/0704A


## Figure 1

### Monitoring Stations of Air Sensitive Receivers

**圖例**  
**LEGEND :**

-  **MONITORING STATION**
- A1** MTR SIU HO WAN DEPOT
- A2** SIU HO WAN GOVERNMENT DEPOT
- A3** NORTH LANTAU EXPRESSWAY  
(OPPOSITE TO SIU HO WAN STP)
- A4** ADMINISTRATION BUILDING OF  
SIU HO WAN STP
- A5** ACCESS ROAD LENDING TO  
DISCOVERY BAY TUNNEL
- A6** VEHICLE DETENTION CENTRE
- A7** OFFICE OF SIU HO WAN  
WATER TREATMENT WORKS

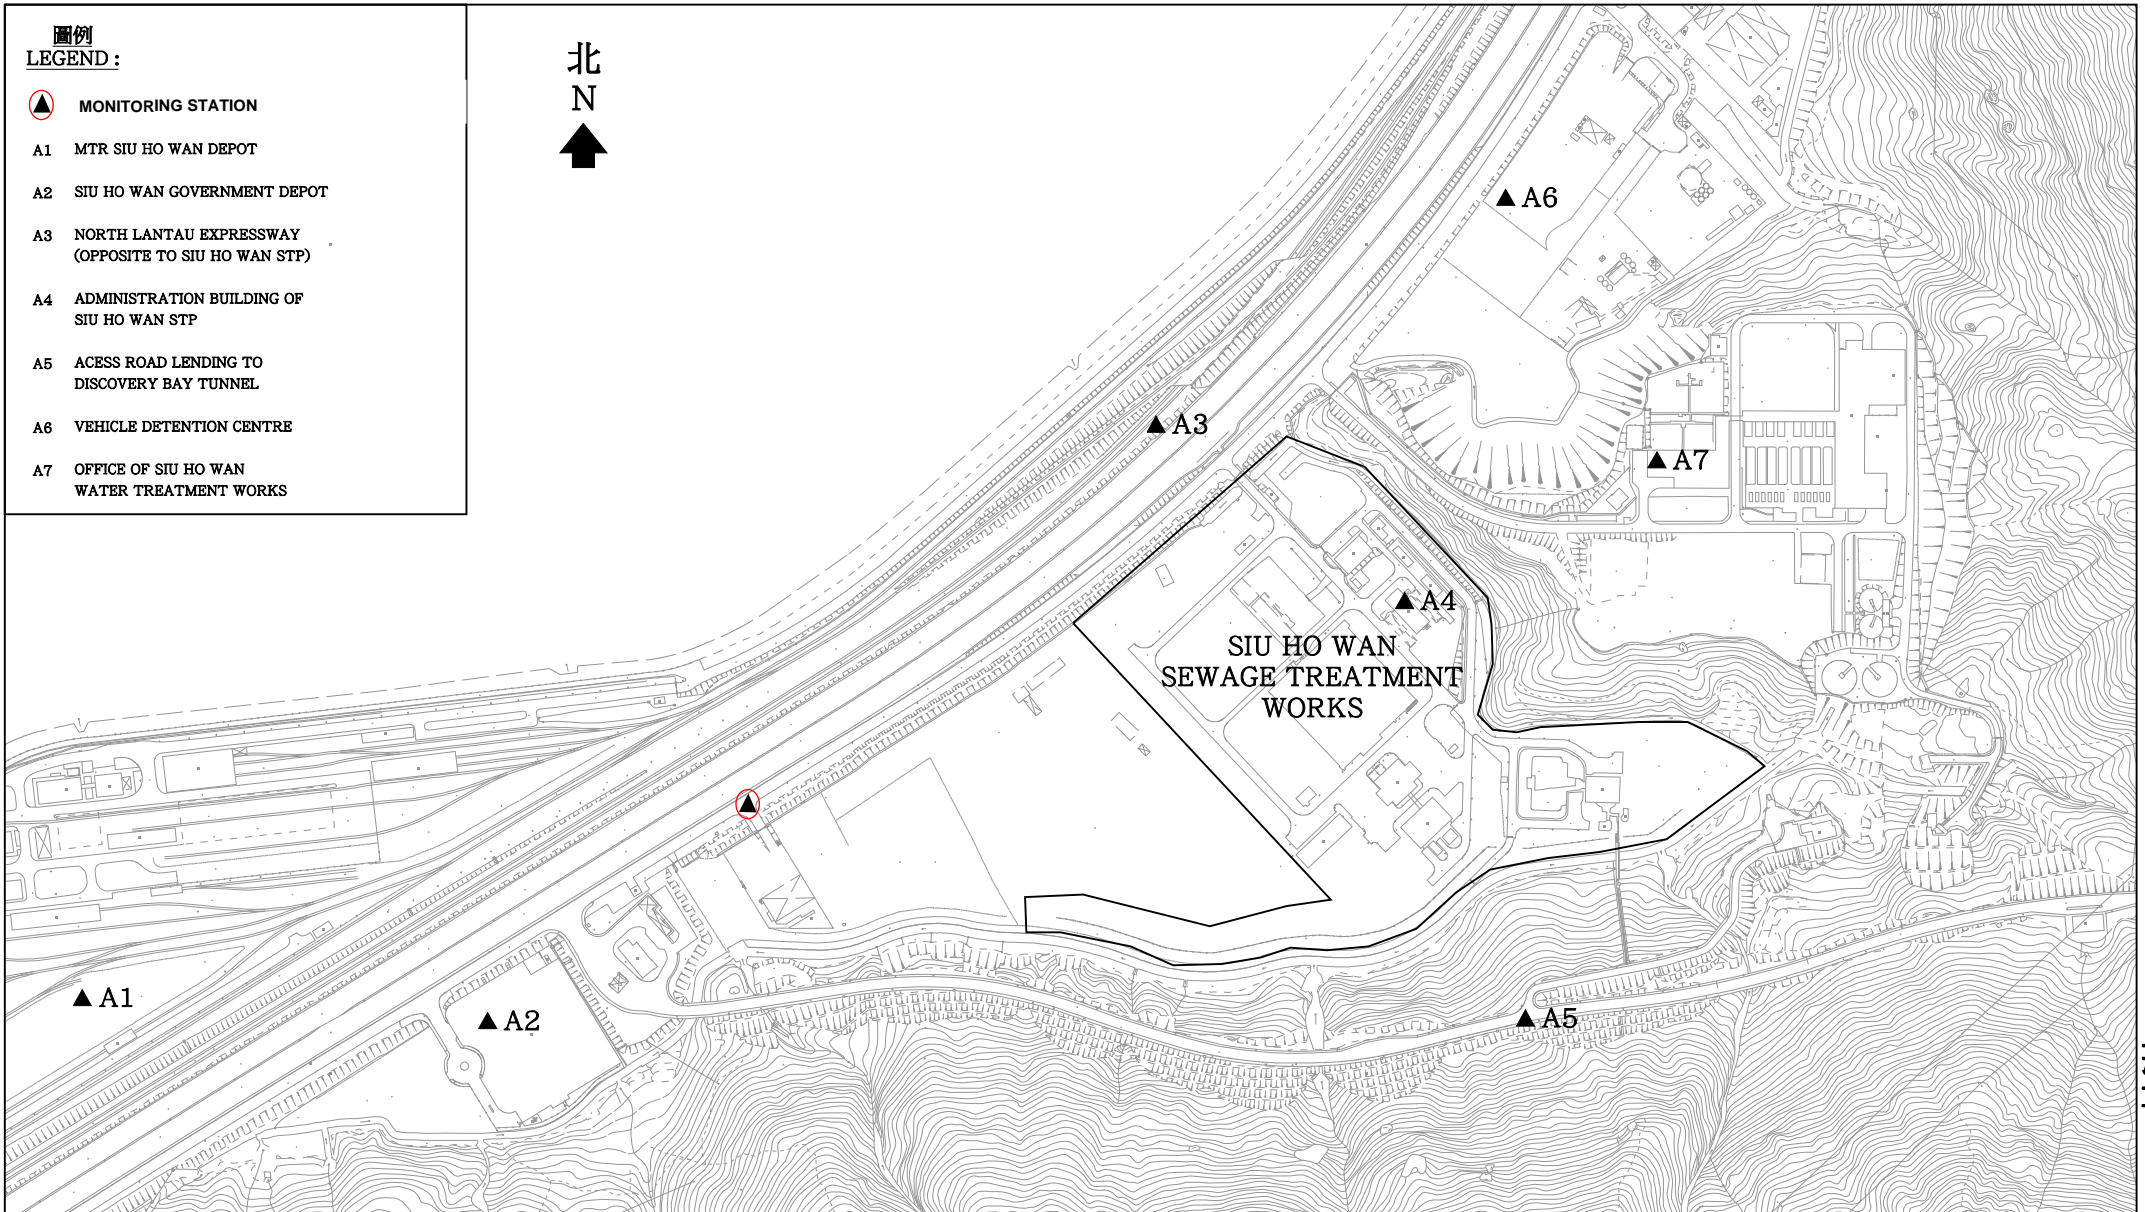

<p><b>圖則名稱 drawing title</b></p> <p style="text-align: center;"><b>UPGRADING OF SIU HO WAN SEWAGE TREATMENT PLANT OPTIONAL ENVIRONMENTAL MONITORING AND AUDIT PLAN ODOUR PATROL MONITORING STATIONS</b></p>	繪畫 drawn	C.W. CHAN	日期 date	16-08-2006	
	核對 checked	C.K. LAM	日期 date	16-08-2006	
	批核 approved	S.K. WONG	日期 date	16-08-2006	
	部門 office	<b>顧問工程管理部 CONSULTANTS MANAGEMENT DIVISION</b>			
			圖則編號 drawing no.	<b>DCM/2006/063</b>	
			比例 scale		N.T.S.
<b>保留版權 COPYRIGHT RESERVED</b>					
			 <p style="font-size: small; margin: 0;">香港特別行政區政府渠務署 DRAINAGE SERVICES DEPARTMENT GOVERNMENT OF THE HONG KONG SPECIAL ADMINISTRATIVE REGION</p>		

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A


## Figure 2

Odour Patrol Points of Modified Odour Patrol



圖例  
LEGEND:

- Odour Patrol Points
- OD1 Eastern Site Boundary
- OD2 Southern Site Boundary
- OD3 Western Site Boundary
- OD4 Northern Site Boundary
- OD5 Spur Road near Discovery Bay Tunnel Outlet
- OD6 Cheung Tung Road near the Bus Depot
- OD7 Cheung Tung Road near O-PARK1
- OD8 Sham Shui Kok Dr near MTR Depot
- OD9 Discovery Bay Tunnel Toll Plaza

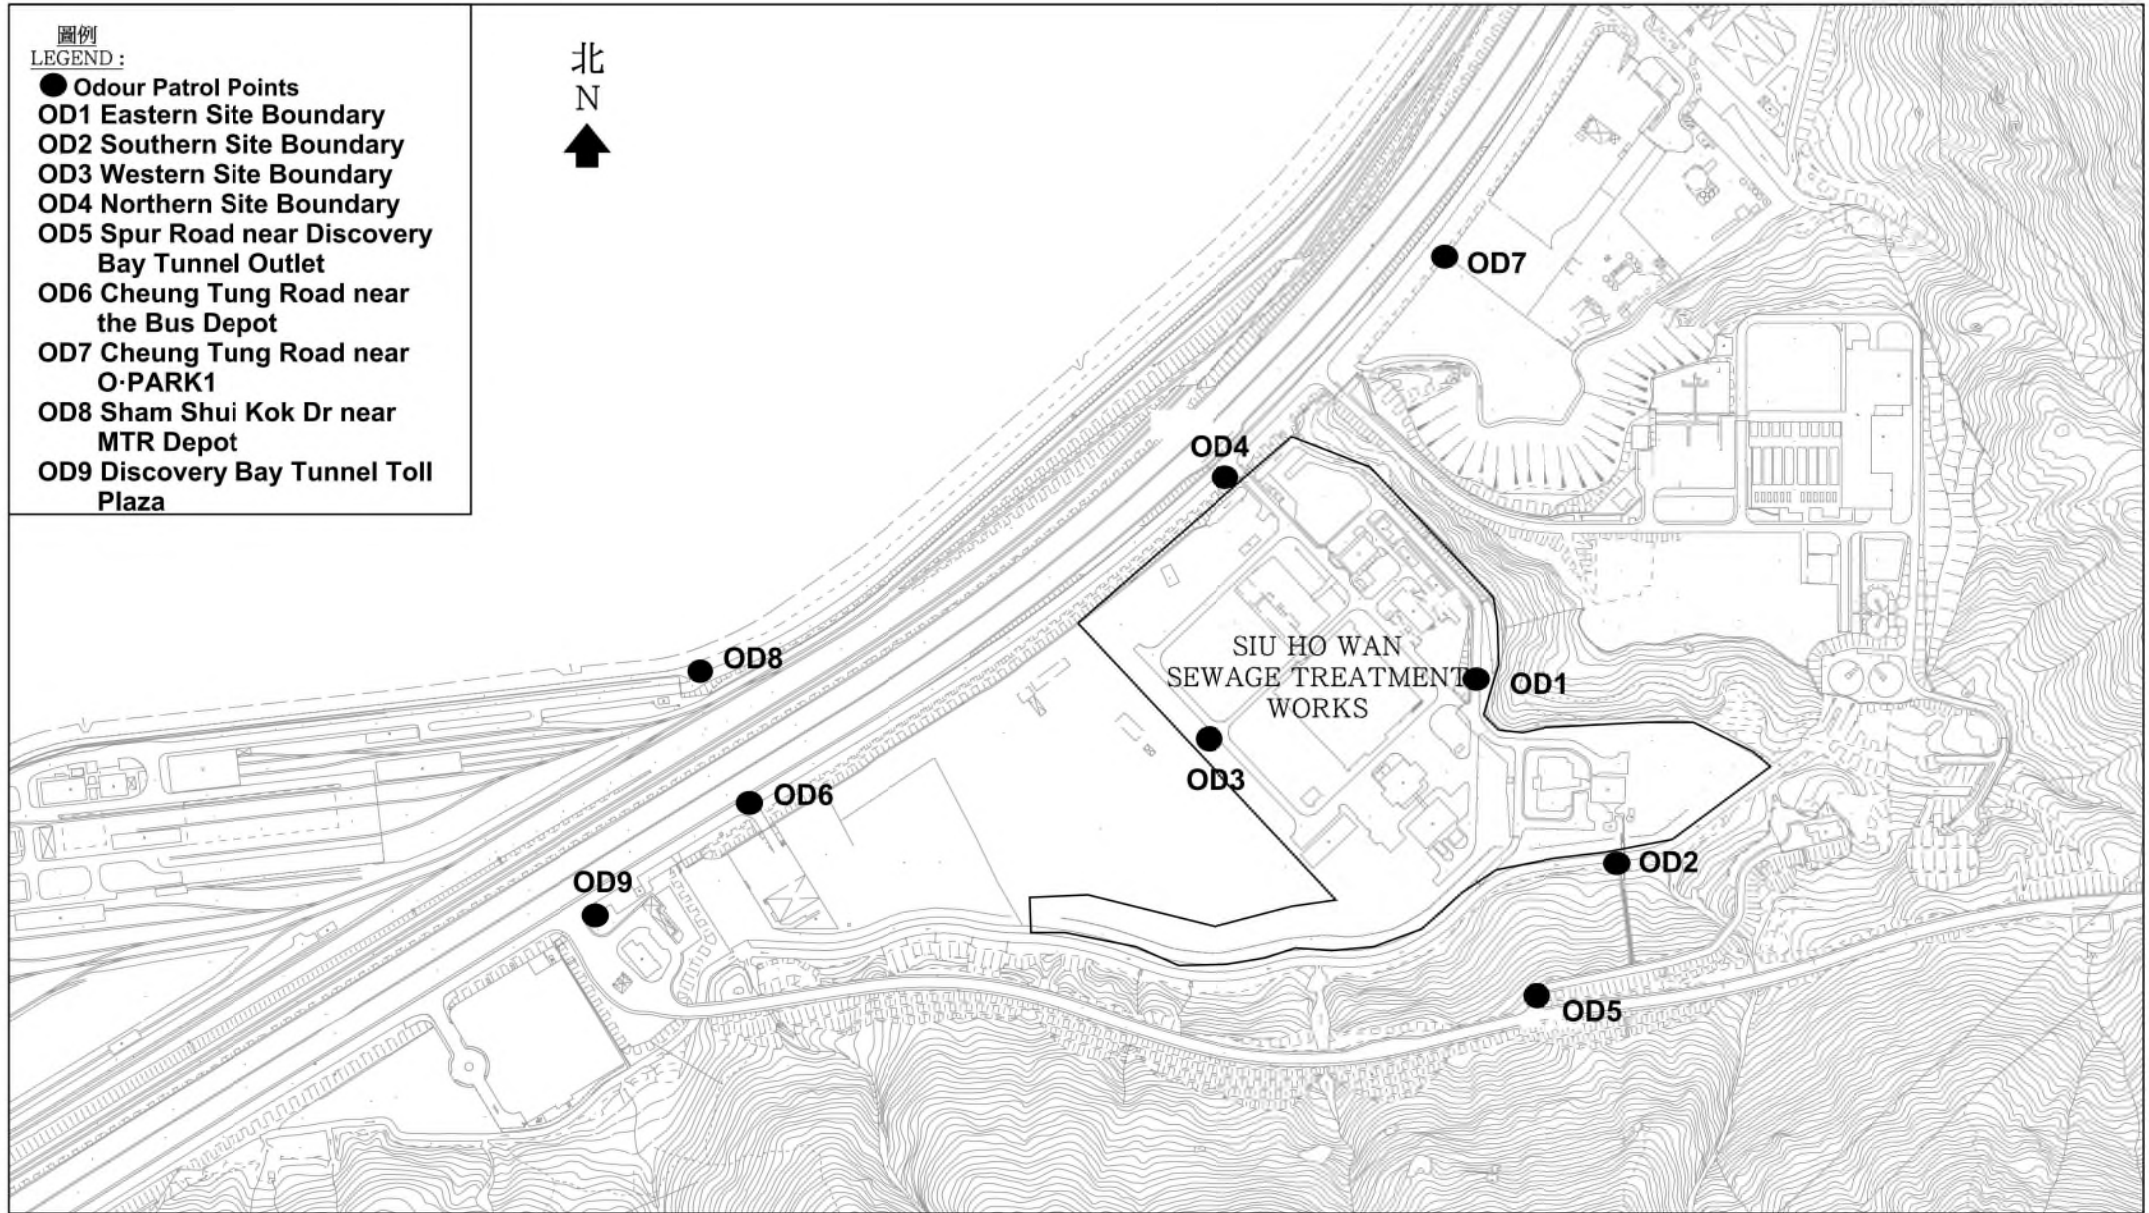

## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

### Figure 3

Monitoring Stations of Water Quality Monitoring, Sediment Quality Monitoring and Benthic Survey



816000E

818000E

820000E

822000E

822000N

大小磨刀  
BROTHERS


820000N

## CO-ORDINATES OF CONTROL STATIONS :

CONTROL STATION No.	CO-ORDINATES	
	NORTHING	EASTING
A	822500	816100
B	822440	816680
E	821655	819817
F	821922	820158
G	822692	822214
H	822939	822494

## CO-ORDINATES OF IMPACT STATIONS :

IMPACT STATION No.	CO-ORDINATES	
	NORTHING	EASTING
C	820180	816800
D	820360	817160

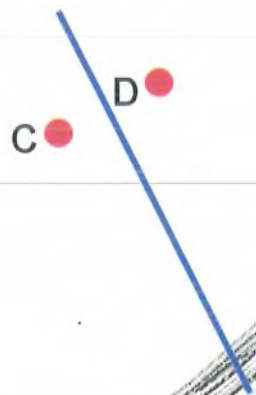圖例  
LEGEND :

- IMPACT STATION
- ⊕ CONTROL STATION
- SUBMARINE OUTFALL

圖則名稱 drawing title

UPGRADING OF SIU HO WAN SEWAGE TREATMENT PLANT  
BASELINE MONITORING - LOCATION OF MONITORING STATIONS

繪畫 drawn

H.K. LAI

日期 date  
06-02-2004

核對 checked

C.K. LAM

日期 date  
04-03-2004

批核 approved

S.K. WONG

日期 date  
04-03-2004

部門 office

顧問工程管理部

CONSULTANTS MANAGEMENT DIVISION

圖則編號 drawing no.

DCM/2004/002

比例 scale

N.T.S.

保留版權

COPYRIGHT RESERVED



香港特別行政區政府渠務署  
DRAINAGE SERVICES DEPARTMENT  
GOVERNMENT OF THE  
HONG KONG  
SPECIAL ADMINISTRATIVE REGION

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

Figure 4  
Location of the Tide Gauge

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Location of the Tide Gauge

Source: Google Maps

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix A Project Organization Chart


# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

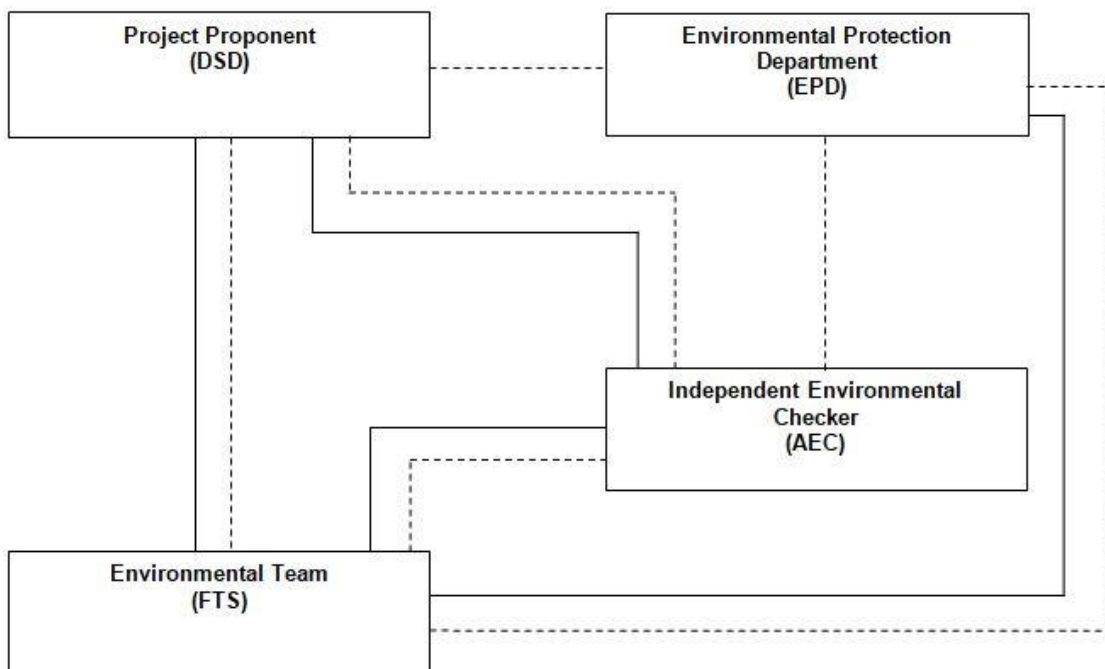

Legend:  
— Line of Reporting  
--- Line of Communication

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix B

### Monitoring Schedule for Present and Next Reporting Period



# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

## Monitoring Schedule for the Present Reporting Period

Sun	Mon	Tue	Wed	Thur	Fri	Sat
			1 February Odour Patrol	2	3	4
5	6	7 Odour Patrol	8 Water Quality Monitoring and Sediment Quality Monitoring and Benthic Survey Mid-Flood (08:45) Mid-Ebb (14:09)	9	10	11
12	13 Odour Patrol	14	15	16	17	18
19	20	21	22	23	24 Odour Patrol	25
26	27	28				

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix C

### Event and Action Plan for Air Quality Monitoring

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

EVENT	ACTION		
	ET	IEC	*Operator
<b>Action Level</b>			
One complaint received for specific odour event / Odour intensity of 2 or above is measured from odour patrol	<ol style="list-style-type: none"> <li>1. Identify source/reason of exceedance or odour complaints;</li> <li>2. Notify the IEC and Operator of exceedance;</li> <li>3. Repeat odour patrol to confirm finding;</li> <li>4. If exceedance continues, notify the IEC and Operator;</li> <li>5. Carry out investigation to identify the source/reason of exceedance or complaints;</li> <li>6. Check Operator's working methods; and</li> <li>7. Discuss with Operator on required remedial actions.</li> </ol>	<ol style="list-style-type: none"> <li>1. Check odour patrol results submitted by ET;</li> <li>2. Discuss with ET and Operator on the possible remedial actions;</li> <li>3. Advise the Operator on the effectiveness of the proposed remedial measures;</li> <li>4. Supervise implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>1. Notify the ET and IEC when receipt of odour complaint;</li> <li>2. Confirm receipt of notification of exceedance in writing;</li> <li>3. Identify/ confirm source with ET;</li> <li>4. Discuss with ET for remedial actions required;</li> <li>5. Ensure remedial actions properly implemented</li> <li>6. Rectify any unacceptable practice; and</li> <li>7. Amend operation methods if appropriate.</li> </ol>
<b>Limit Level</b>			
More than one complaint in 3 months / Odour intensity of 3 or above is measured from odour patrol	<ol style="list-style-type: none"> <li>1. Identify source/reason of exceedance or odour complaints;</li> <li>2. Notify the IEC and Operator of exceedance;</li> <li>3. Repeat odour patrol to confirm finding;</li> <li>4. If exceedance continues, notify the IEC and Operator;</li> <li>5. Carry out investigation to identify the source/reason of exceedance or complaints;</li> <li>6. Check Operator's working methods;</li> <li>7. Carry out analysis of Operator's working procedures to determine possible mitigation to be implemented;</li> <li>8. Arrange meeting with ET and EPD to discuss the remedial actions to be taken;</li> </ol>	<ol style="list-style-type: none"> <li>1. Check odour patrol results submitted by ET;</li> <li>2. Discuss amongst ET and the Operator on the potential remedial actions;</li> <li>3. Review the proposed remedial actions whenever necessary to assure their effectiveness and advise the Operator accordingly;</li> <li>4. Supervise implementation of remedial measures.</li> </ol>	<ol style="list-style-type: none"> <li>1. Notify the ET and IEC when receipt of odour complaint;</li> <li>2. Confirm receipt of notification of exceedance in writing;</li> <li>3. Indentify/ confirm source with ET;</li> <li>4. Inform ET, IEC and EPD;</li> <li>5. Discuss with EPD and ET on the required remedial actions;</li> <li>6. Ensure remedial actions properly implemented;</li> <li>7. Take immediate action to avoid further exceedance;</li> </ol>

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

	<p>9. Discuss with EPD and the Operator on the required remedial actions; 10. Submit proposals for remedial actions within 3 working days of notification; 11. Assess effectiveness of Operator's remedial actions and keep EPD informed of the results; 12. Amend proposal if appropriate; and 13. Resubmit proposal if problem still not under control.</p>		<p>8. Implement the agreed proposals.</p>
--	---	--	---

\* The operator who is the constructor responsible for the operation during the maintenance period.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---


Report No.: 0041/17/ED/0704A

## Appendix D

### Results and Graphical Presentation of Air Quality Monitoring



**Contract No. CM 14/2016**  
**Environmental Team for Operational Environmental Monitoring and Audit for**  
**Siu Ho Wan Sewage Treatment Works**  
**Odour Patrol Record Sheet**

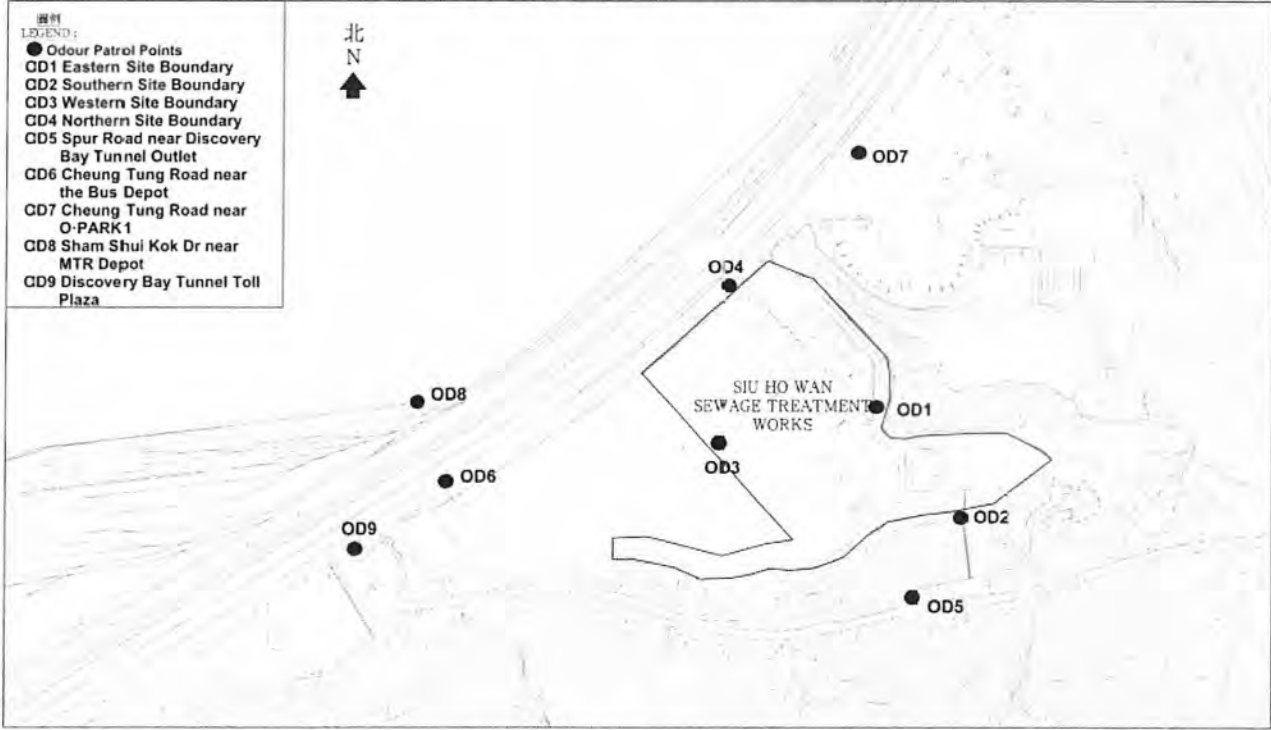

Date	2023/2/1	Weather	Fine	Temperature	20.9°C	Humidity	77%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	1044	N	3.4	0	/	
OD2	Southern Site Boundary	1046	E	0.8	0	/	
OD3	Western Site Boundary	1042	NE	1.1	0	/	
OD4	Northern Site Boundary	1048	E	1.6	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	1038	E	1.6	0	/	
OD7	Cheung Tung Road near O-PARK1	1040	E	0.8	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	1032	NE	0.7	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	1037	E	1.5	0	/	

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: 生  
Name: Yeung Tak Sang  
Date: 2023/2/1

Checked by: AK  
Name: CHOI KAM HO  
Date: 1 February 2023


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

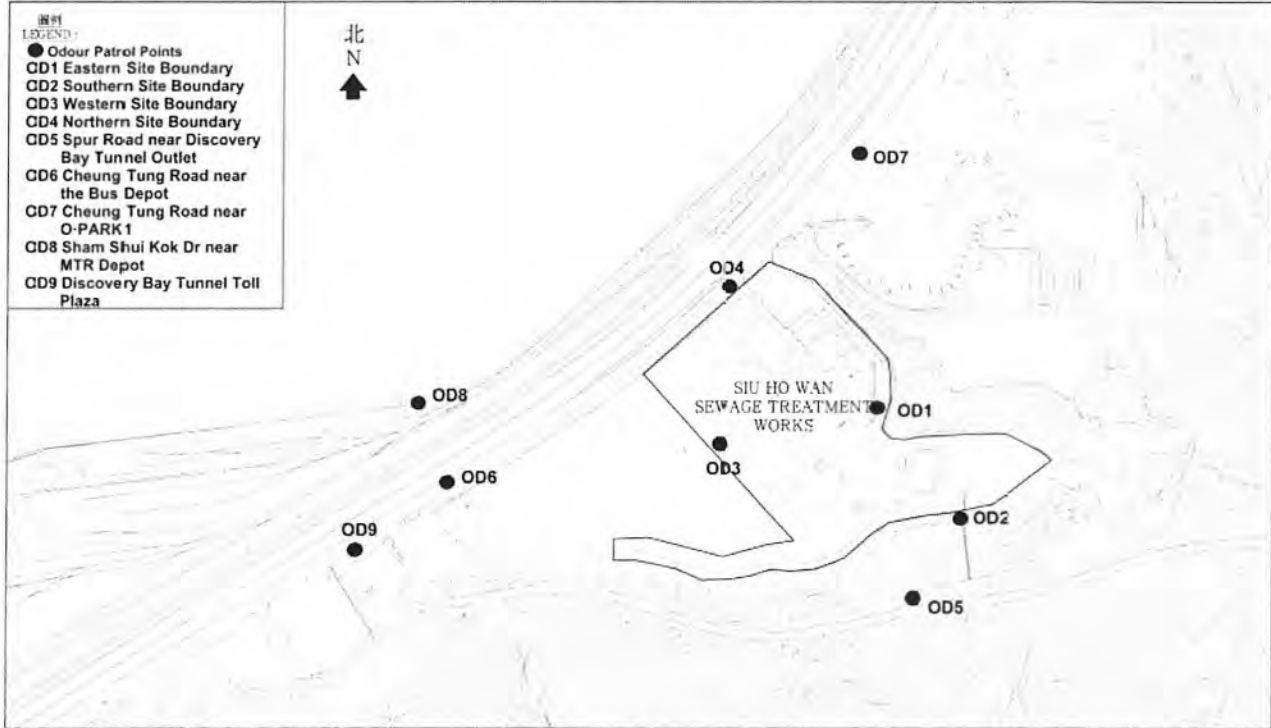

Date	1/2/2023	Weather	Fine	Temperature	20.9°C	Humidity	77%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	10:44	N	3.4	0	/	
OD2	Southern Site Boundary	10:46	E	0.8	0	/	
OD3	Western Site Boundary	10:42	NE	1.1	0	/	
OD4	Northern Site Boundary	10:48	E	1.6	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	10:38	E	1.6	0	/	
OD7	Cheung Tung Road near O-PARK1	10:40	E	0.8	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	10:32	NE	0.7	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	10:37	E	1.5	0	/	

**\*Classification Criteria:**


- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: IP Tsz Hing  
Name: Ip Tsz Hing  
Date: 1/2/2023

Checked by: [Signature]  
Name: CHOI KAM HO  
Date: 1 February 2023



**Contract No. CM 14/2016**  
**Environmental Team for Operational Environmental Monitoring and Audit for**  
**Siu Ho Wan Sewage Treatment Works**  
**Odour Patrol Record Sheet**

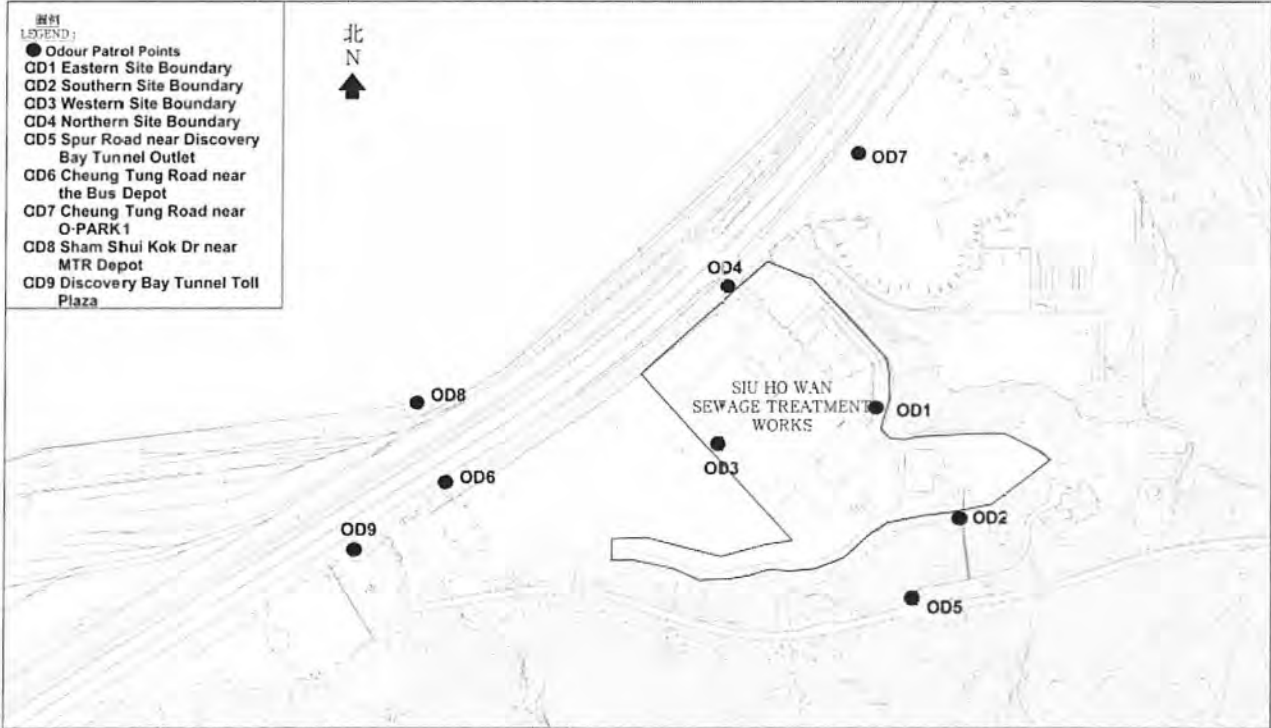

Date	2023/2/7	Weather	Cloudy	Temperature	21.3°C	Humidity	81%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	11:25	N	1.3	0	/	
OD2	Southern Site Boundary	11:23	NE	1.1	0	/	
OD3	Western Site Boundary	11:20	/	0	0	/	
OD4	Northern Site Boundary	11:16	NE	0.4	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	11:12	NE	2.0	0	/	
OD7	Cheung Tung Road near O-PARK1	11:14	NE	2.1	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	11:06	E	1.3	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	11:00	NE	1.3	0	/	

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level


Recorded by: Yenny Tak Sung  
Name: Yenny Tak Sung  
Date: 2023/2/7

Checked by: CHOI KAM HO  
Name: CHOI KAM HO  
Date: 7 February 2023





**Contract No. CM 14/2016**  
**Environmental Team for Operational Environmental Monitoring and Audit for**  
**Siu Ho Wan Sewage Treatment Works**  
**Odour Patrol Record Sheet**

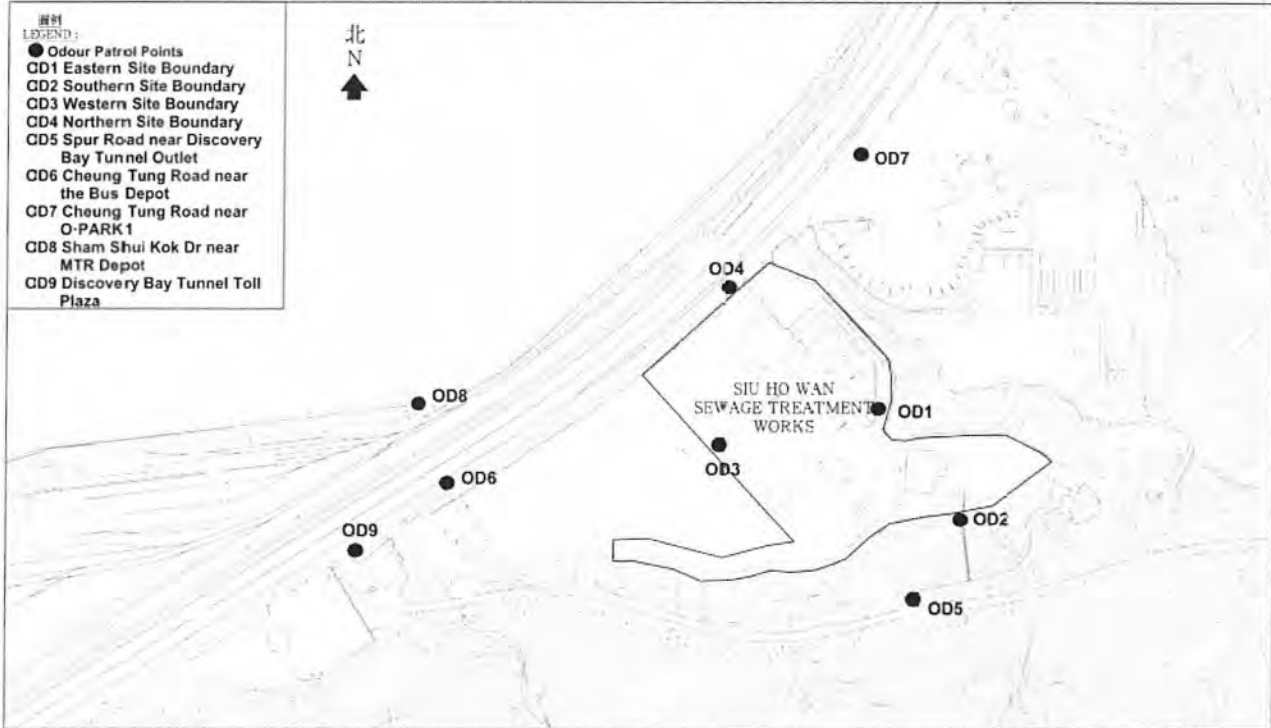

Date	7/2/2023	Weather	Cloudy	Temperature	21.3°C	Humidity	81%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	11:25	N	1.3	0	/	
OD2	Southern Site Boundary	11:23	NE	1.1	0	/	
OD3	Western Site Boundary	11:20	/	0	0	/	
OD4	Northern Site Boundary	11:16	NE	0.4	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	11:12	NE	2.0	0	/	
OD7	Cheung Tung Road near O-PARK1	11:14	NE	2.1	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	11:06	E	1.3	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	11:10	NE	1.3	0	/	

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Ip Tsz Him  
Name: Ip Tsz Him  
Date: 7/2/2023

Checked by: AK  
Name: CHOI KAM HO  
Date: 7 February 2023


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

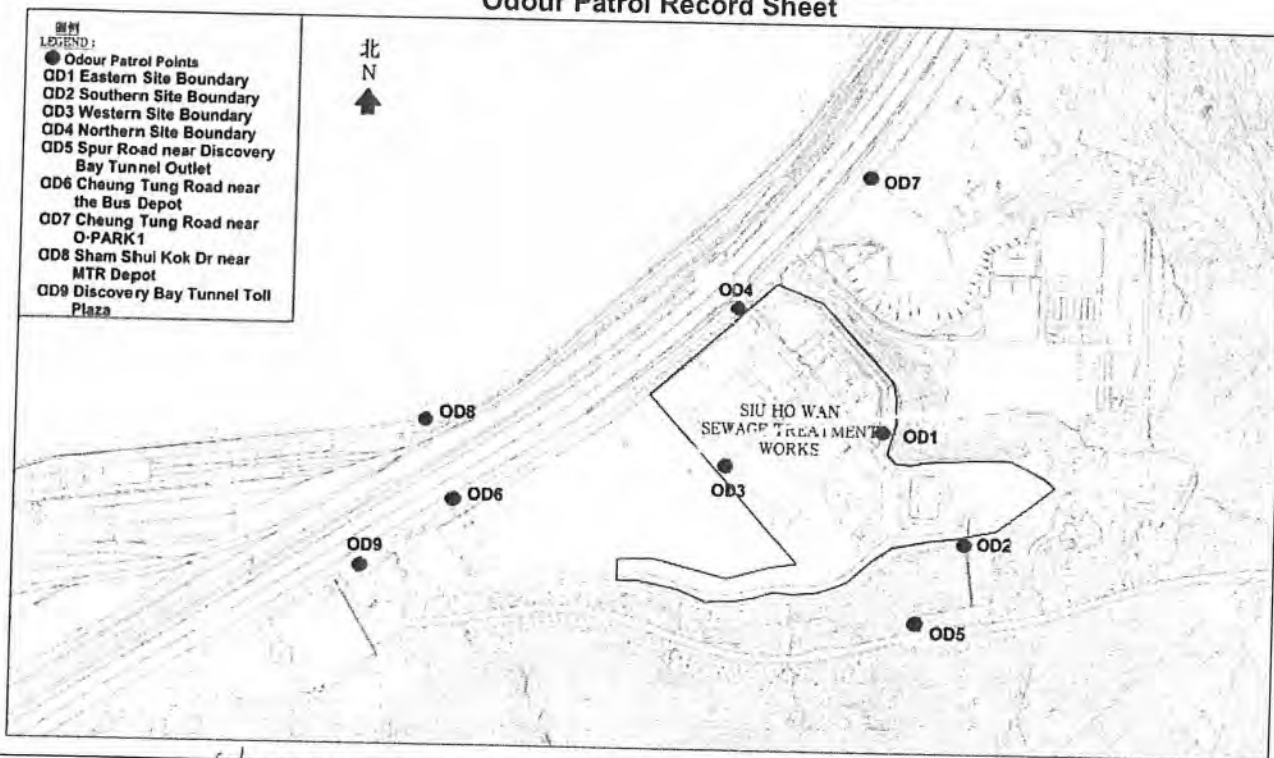

Date	13/2/2023	Weather	Fine	Temperature	22.7°C	Humidity	99%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	1022	E	3.7	0	/	
OD2	Southern Site Boundary	1024	E	0.2	1	Effluent	
OD3	Western Site Boundary	1020	E	0.8	0	/	
OD4	Northern Site Boundary	1026	N	1.6	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	1613	NE	2.3	0	/	
OD7	Cheung Tung Road near O-PARK1	1029	N	2.6	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	1610	NE	1.4	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	1615	NE	0.4	0	/	

**\*Classification Criteria:**


- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Ip Tsz Hin  
Name: Ip Tsz Hin  
Date: 13/2/2023

Checked by: [Signature]  
Name: CHOI KAM HO  
Date: 13 February 2023



**Contract No. CM 14/2016**  
**Environmental Team for Operational Environmental Monitoring and Audit for**  
**Siu Ho Wan Sewage Treatment Works**  
**Odour Patrol Record Sheet**

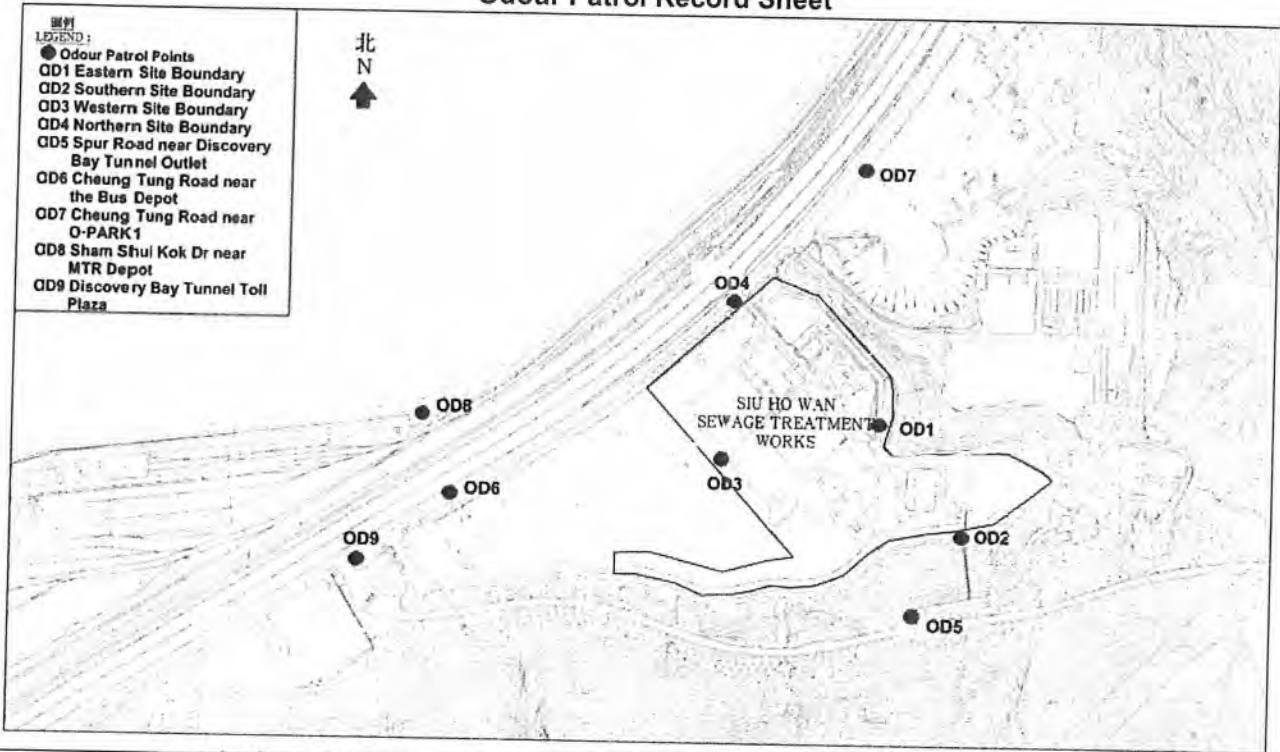

Date	2023/2/13	Weather	Fine	Temperature	22.7 °C	Humidity	89%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	10:22	E	3.7	0	/	
OD2	Southern Site Boundary	10:24	E	0.2	1	Effluent	
OD3	Western Site Boundary	10:20	E	0.8	0	/	
OD4	Northern Site Boundary	10:26	W	1.6	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	/	/	/	/	/	
OD6	Cheung Tung Road near the Bus Depot	10:13	NE	2.3	0	/	
OD7	Cheung Tung Road near O-PARK1	10:29	N	2.6	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	10:10	NE	1.4	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	10:15	NE	0.4	0	/	


**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Yung Tak Sang  
Name: Yung Tak Sang  
Date: 2023/2/13

Checked by: Choi Kam Ho  
Name: Choi Kam Ho  
Date: 13 February 2023

**Contract No. CM 14/2016**  
**Environmental Team for Operational Environmental Monitoring and Audit for**  
**Siu Ho Wan Sewage Treatment Works**  
**Odour Patrol Record Sheet**

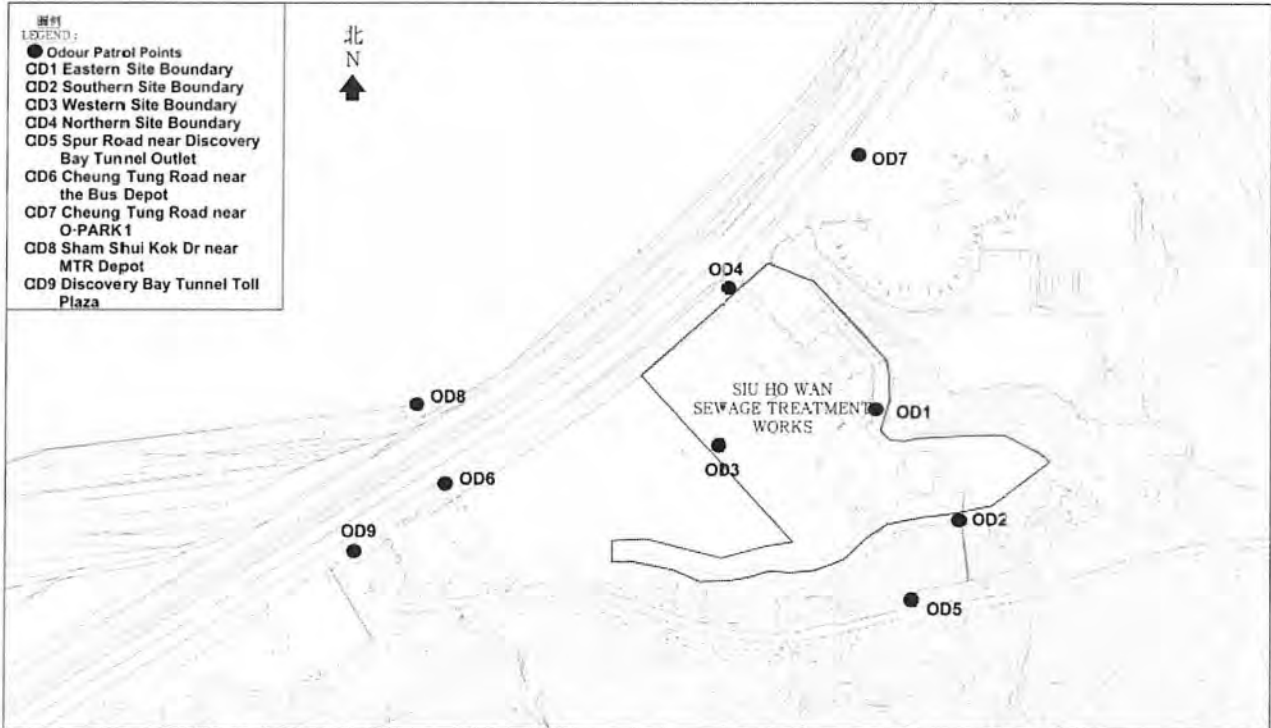

Date	24/2/2023	Weather	Fine	Temperature	21.6°C	Humidity	49%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	1449	N	0.7	1	Effluent	
OD2	Southern Site Boundary	1401	✓	0	0	/	
OD3	Western Site Boundary	1457	NE	1.4	0	/	
OD4	Northern Site Boundary	1456	N	0.3	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	1523	N	0.9	0	/	
OD6	Cheung Tung Road near the Bus Depot	1508	NE	1.2	0	/	
OD7	Cheung Tung Road near O-PARK1	1448	N	0.9	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	1441	NE	1.6	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	1509	N	1.5	0	/	

**\*Classification Criteria:**

- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: Ip Tsz Hin  
Name: Ip Tsz Hin  
Date: 24/2/2023

Checked by: [Signature]  
Name: CHOI KAM HO  
Date: 24 February 2023


# FUGRO TECHNICAL SERVICES LIMITED

Room 723 - 726, 7/F, Block B,  
Profit Industrial Building,  
1-15 Kwai Fung Crescent, Kwai Fong,  
Hong Kong.

Tel : (852)-24508238  
Fax : (852)-24508032  
Email : mcl@fugro.com.hk



## Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works Odour Patrol Record Sheet

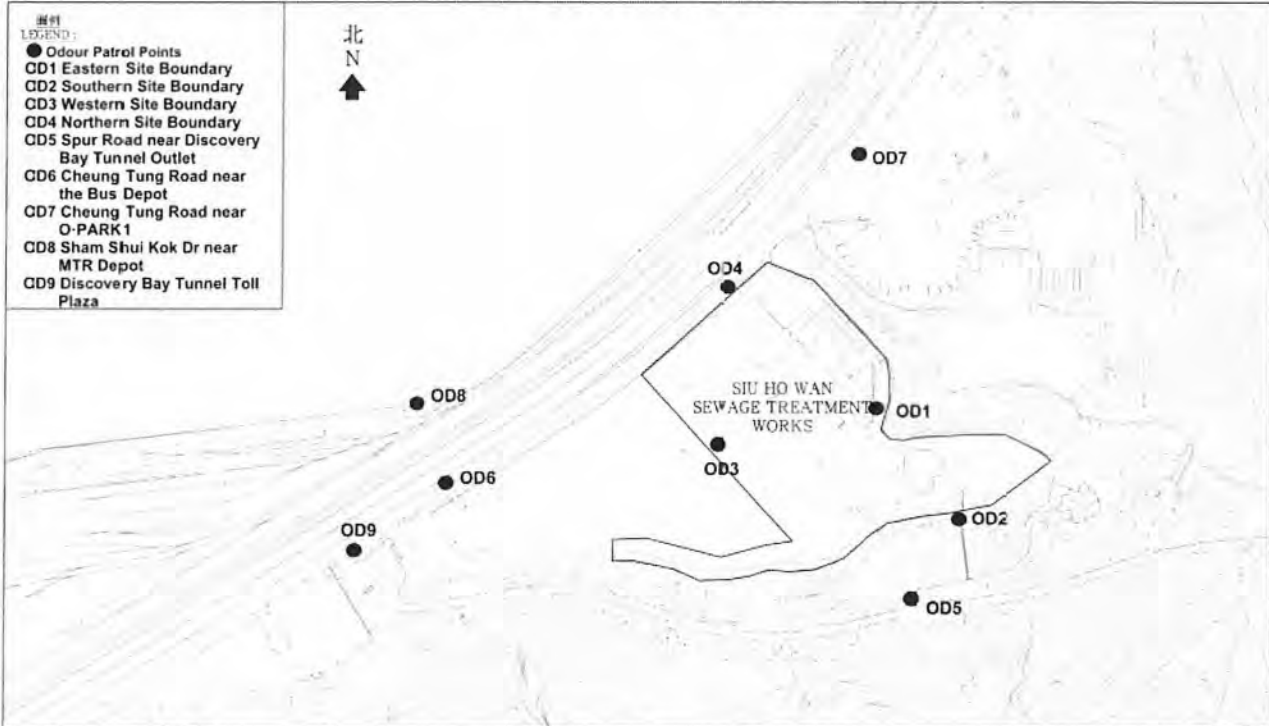


Date	24/2/2023	Weather	Fine	Temperature	21.6°C	Humidity	49%
ID	Location	Time	Wind Direction	Wind Speed (m/s)	Odour intensity	Odour Characteristics	
OD1	Eastern Site Boundary	14:59	N	0.7	1	Effluent	
OD2	Southern Site Boundary	15:01	/	0	0	/	
OD3	Western Site Boundary	14:57	NE	1.4	0	/	
OD4	Northern Site Boundary	14:56	N	0.3	0	/	
OD5	Spur Road near Discovery Bay Tunnel Outlet	15:23	N	0.9	0	/	
OD6	Cheung Tung Road near the Bus Depot	15:06	NE	1.2	0	/	
OD7	Cheung Tung Road near O-PARK1	14:46	N	0.9	0	/	
OD8	Sham Shui Kok Dr near MTR Depot	14:41	NE	1.6	0	/	
OD9	Discovery Bay Tunnel Toll Plaza	15:09	N	1.5	0	/	

**\*Classification Criteria:**


- Not detected : No odour perceived or an odour so weak that it cannot be easily characterised or described
- Slight : Slight identifiable odour, and slight chance to have odour nuisance
- Moderate : Moderate identifiable odour, and moderate chance to have odour nuisance
- Strong : Strong identifiable, likely to have odour nuisance
- Extreme : Extreme severe odour, and unacceptable odour level

Recorded by: [Signature]  
Name: KAN KWE TUNG  
Date: 24/2/2023


Checked by: [Signature]  
Name: CHOI KAM HO  
Date: 24 February 2023

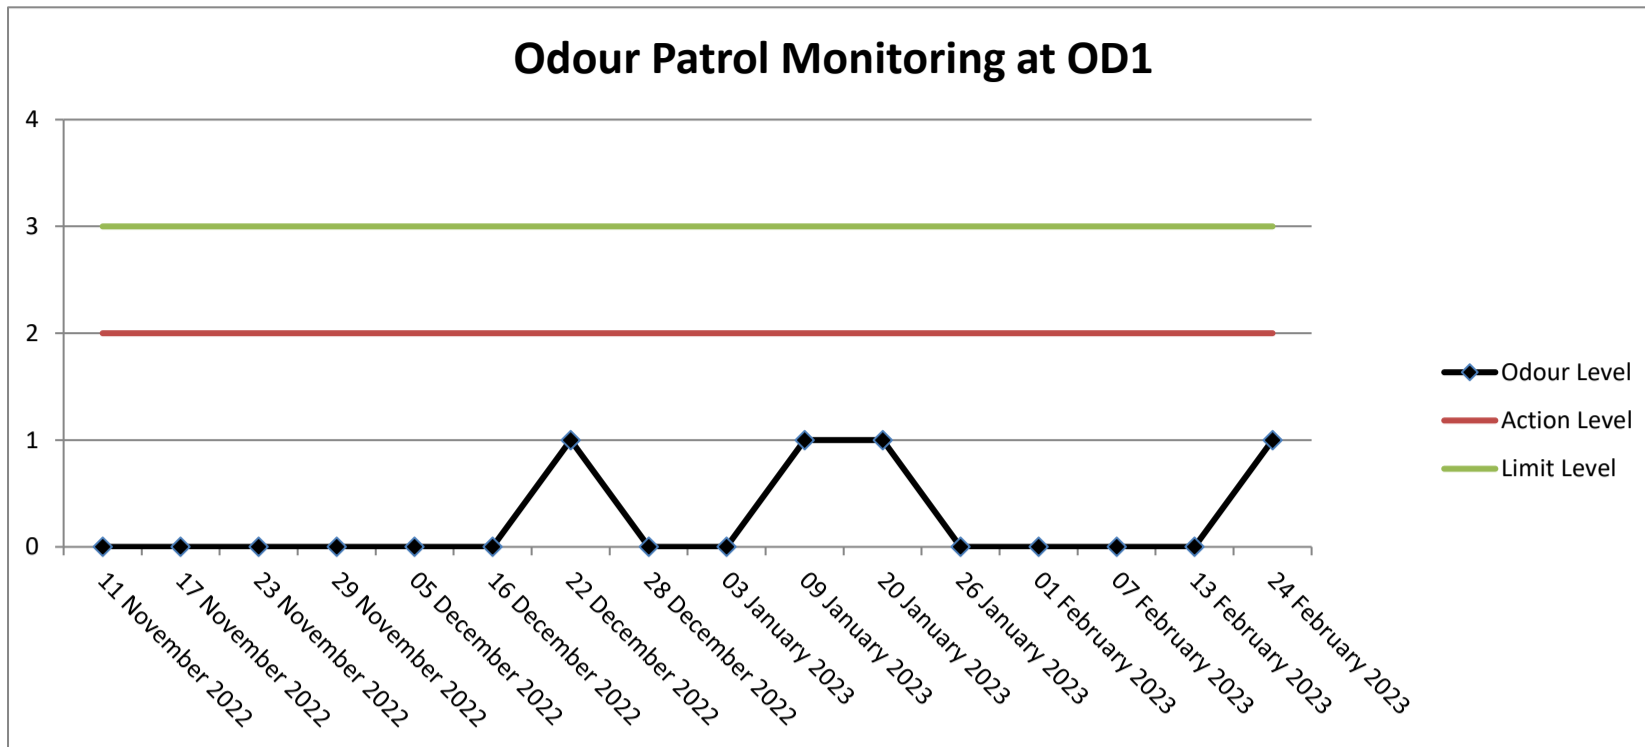


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

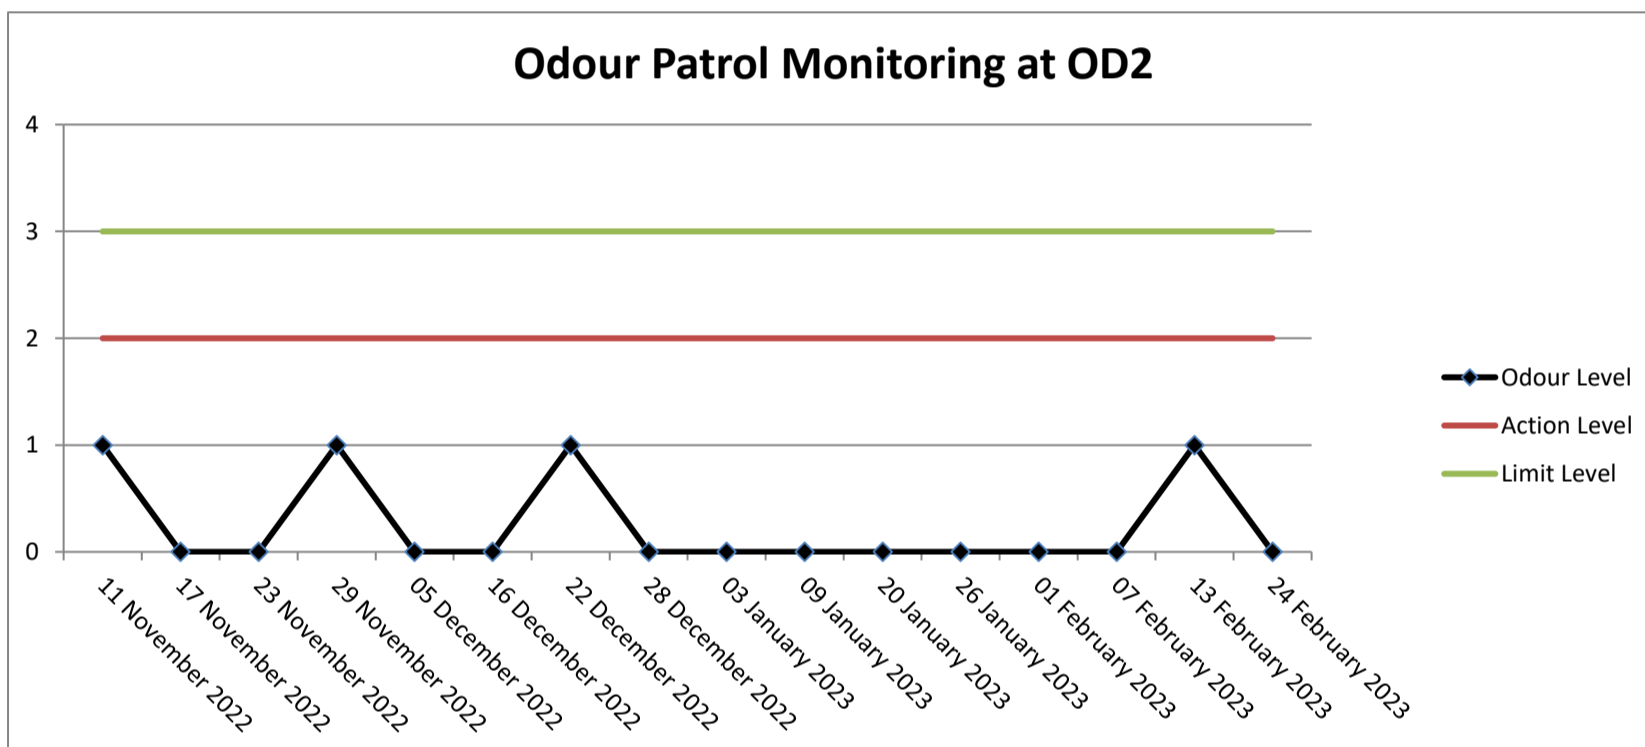


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

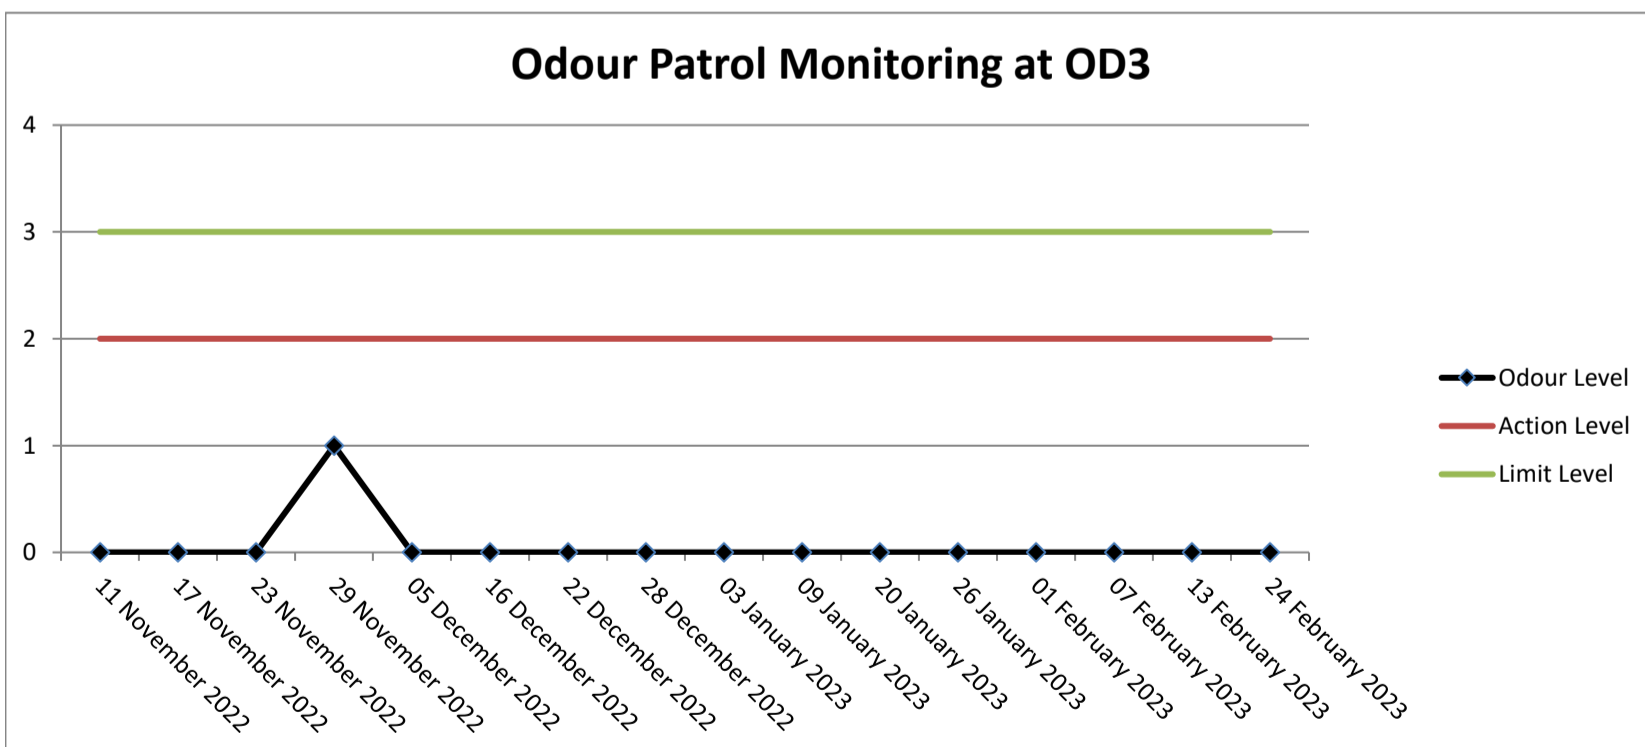


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

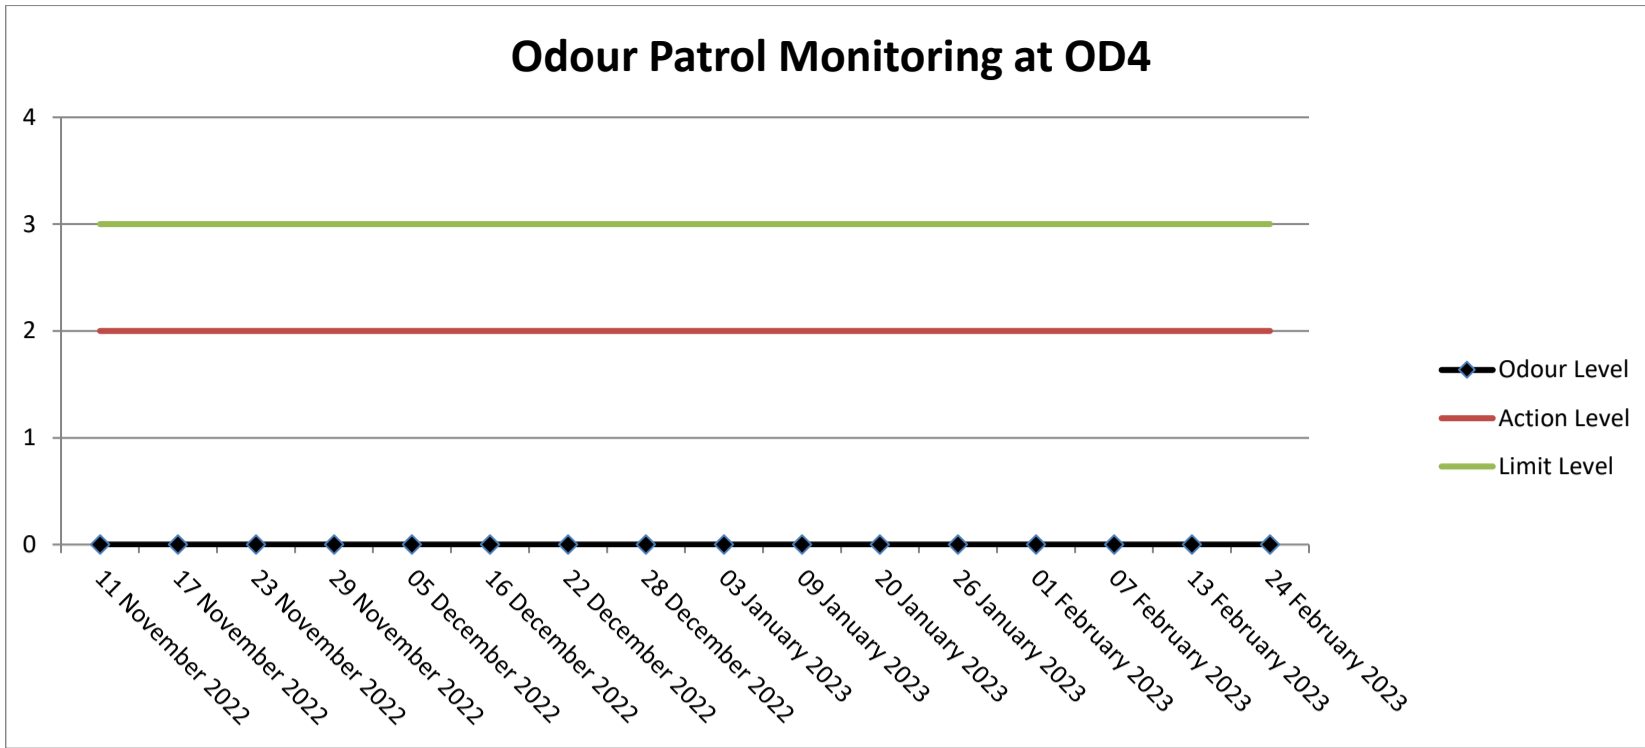


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

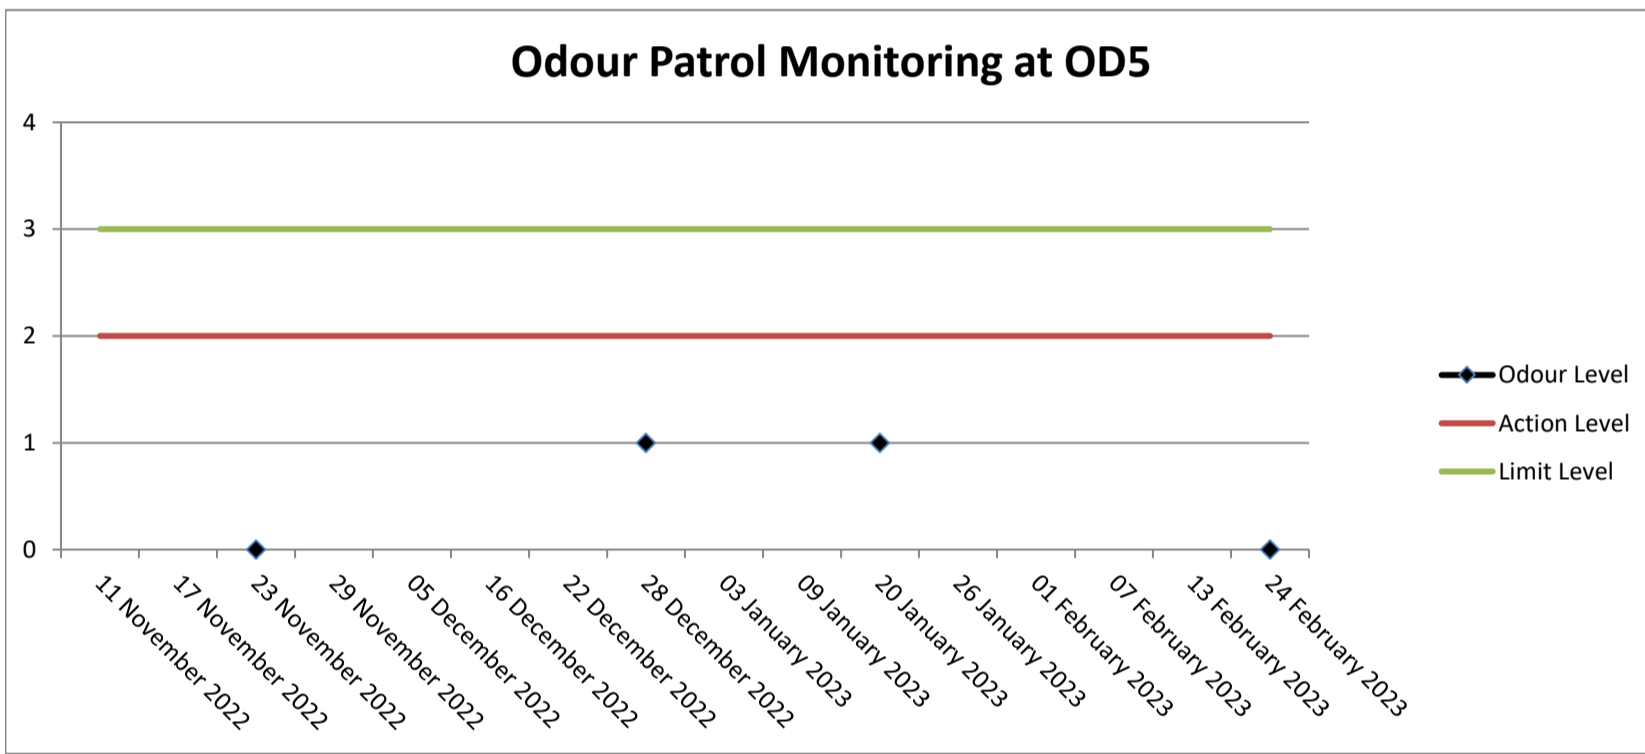


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

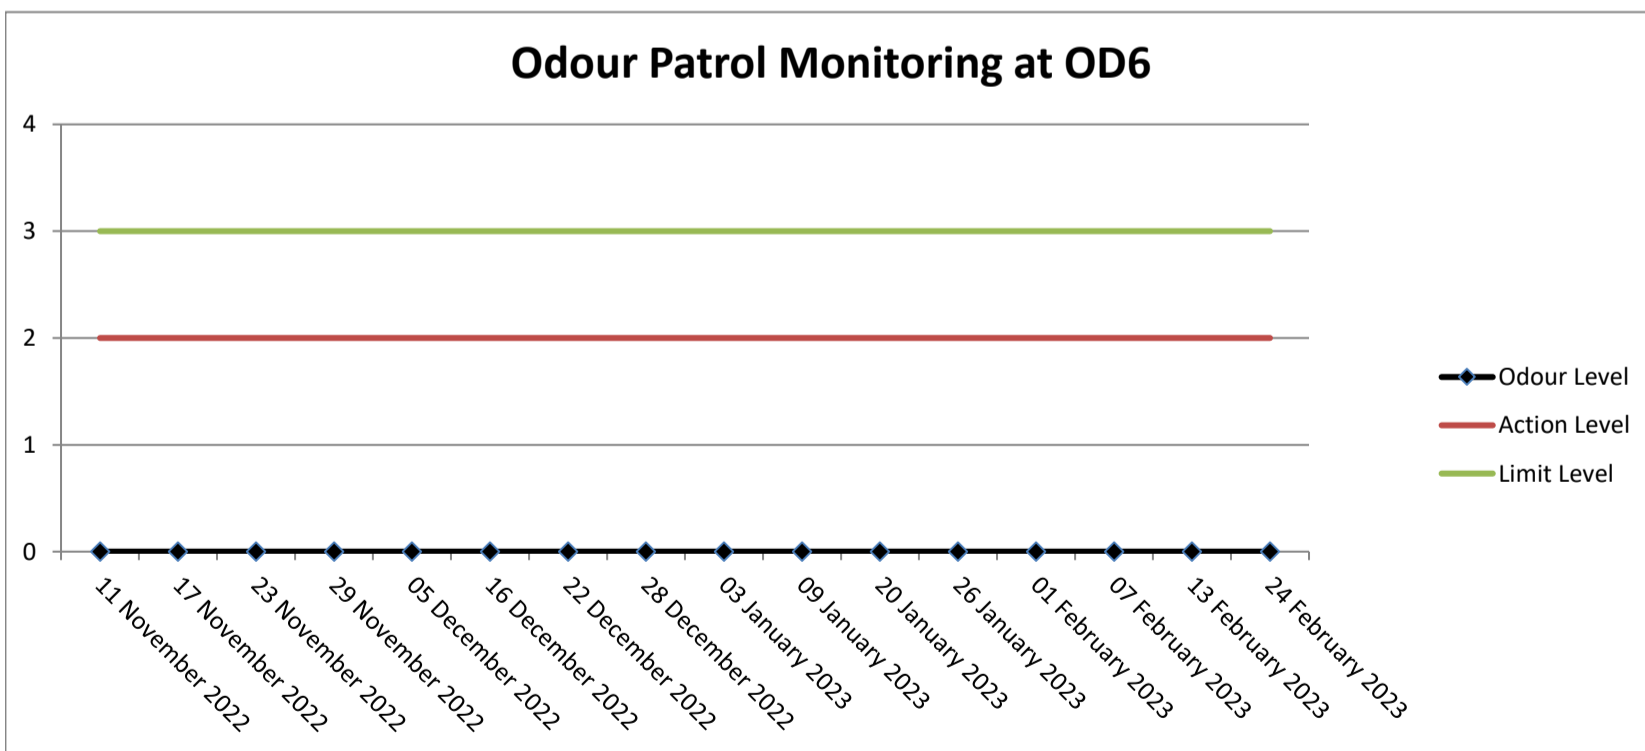


Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

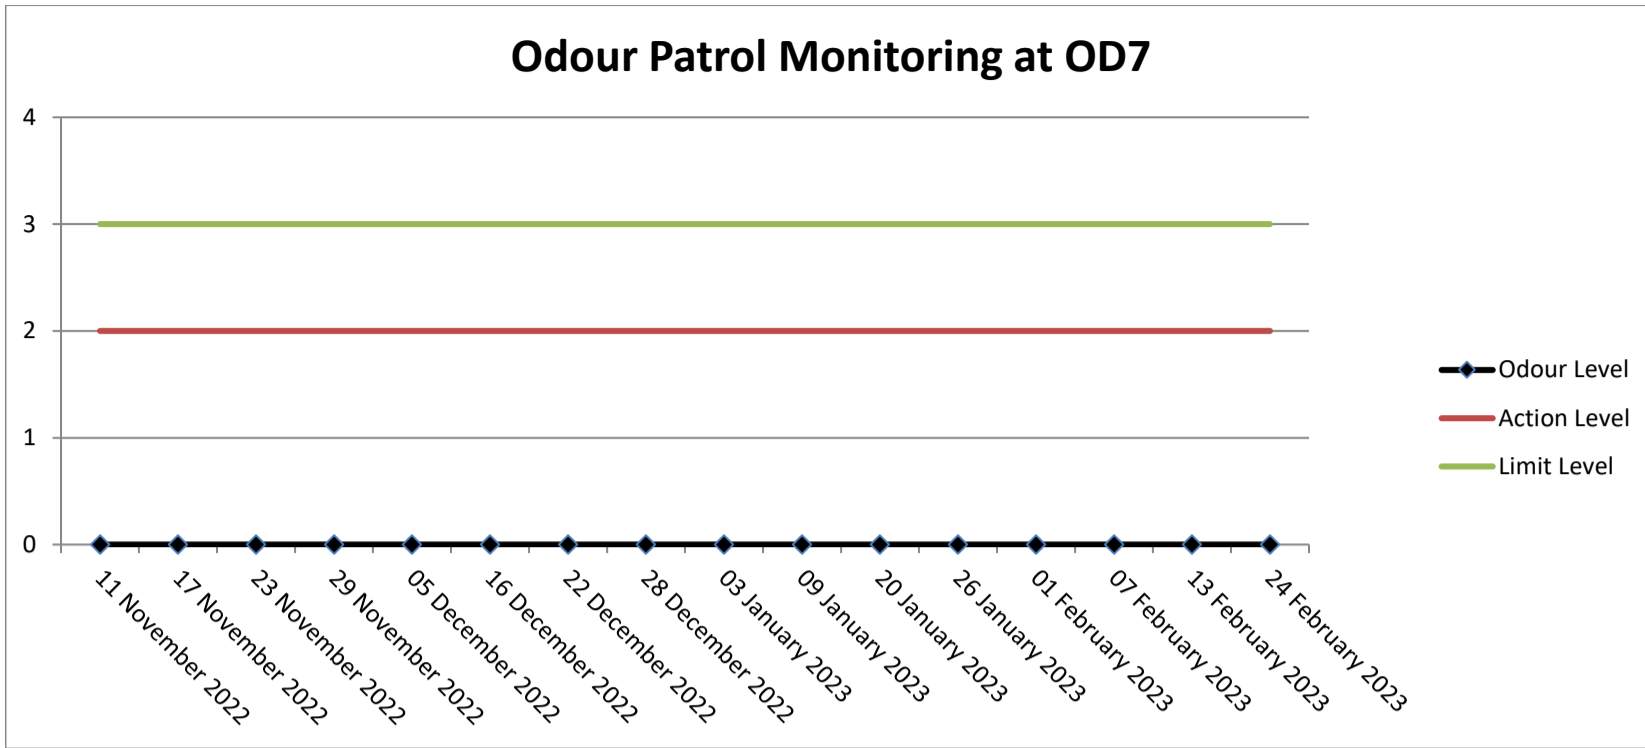

Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

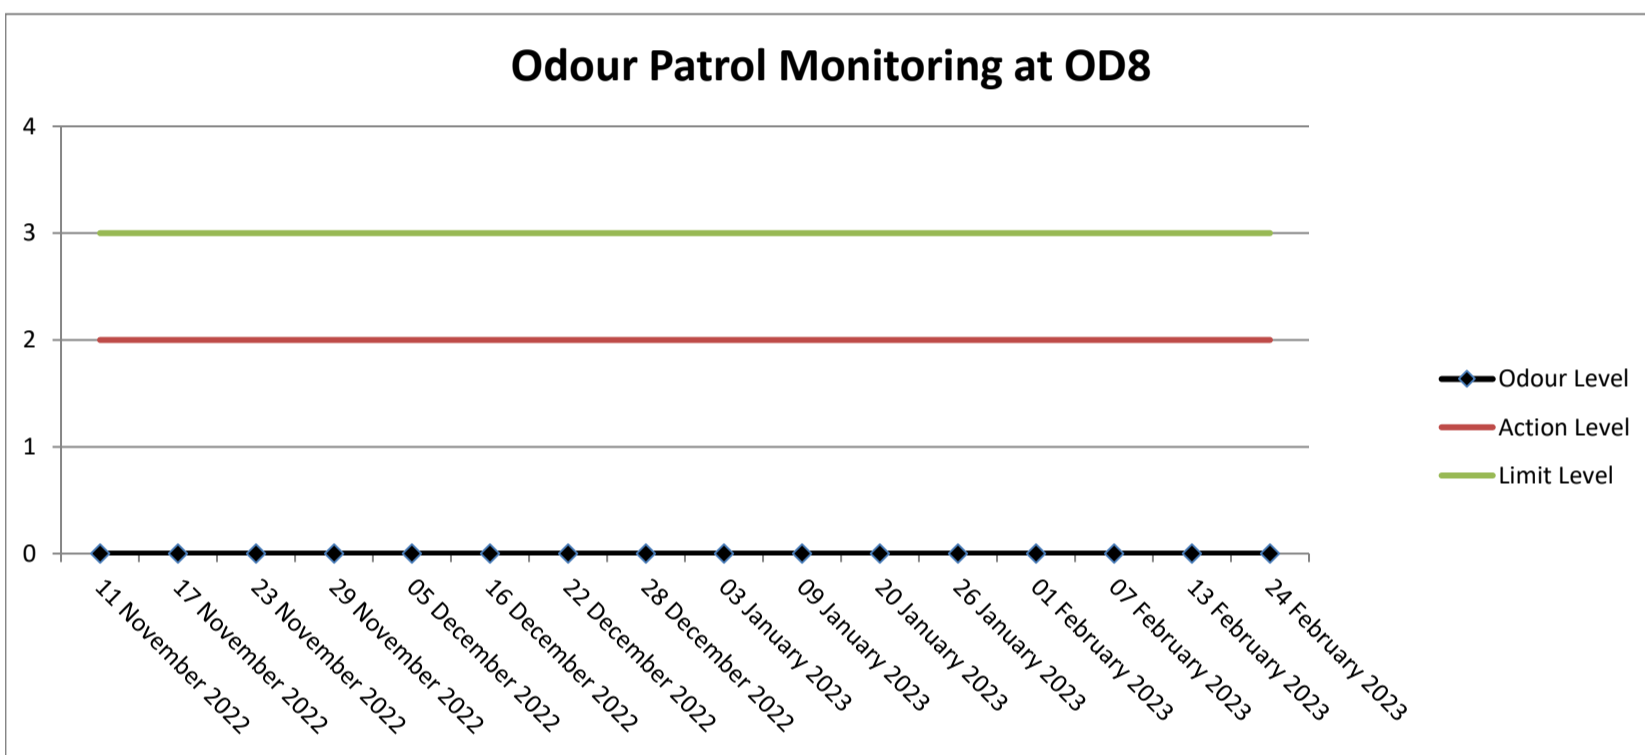

Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme

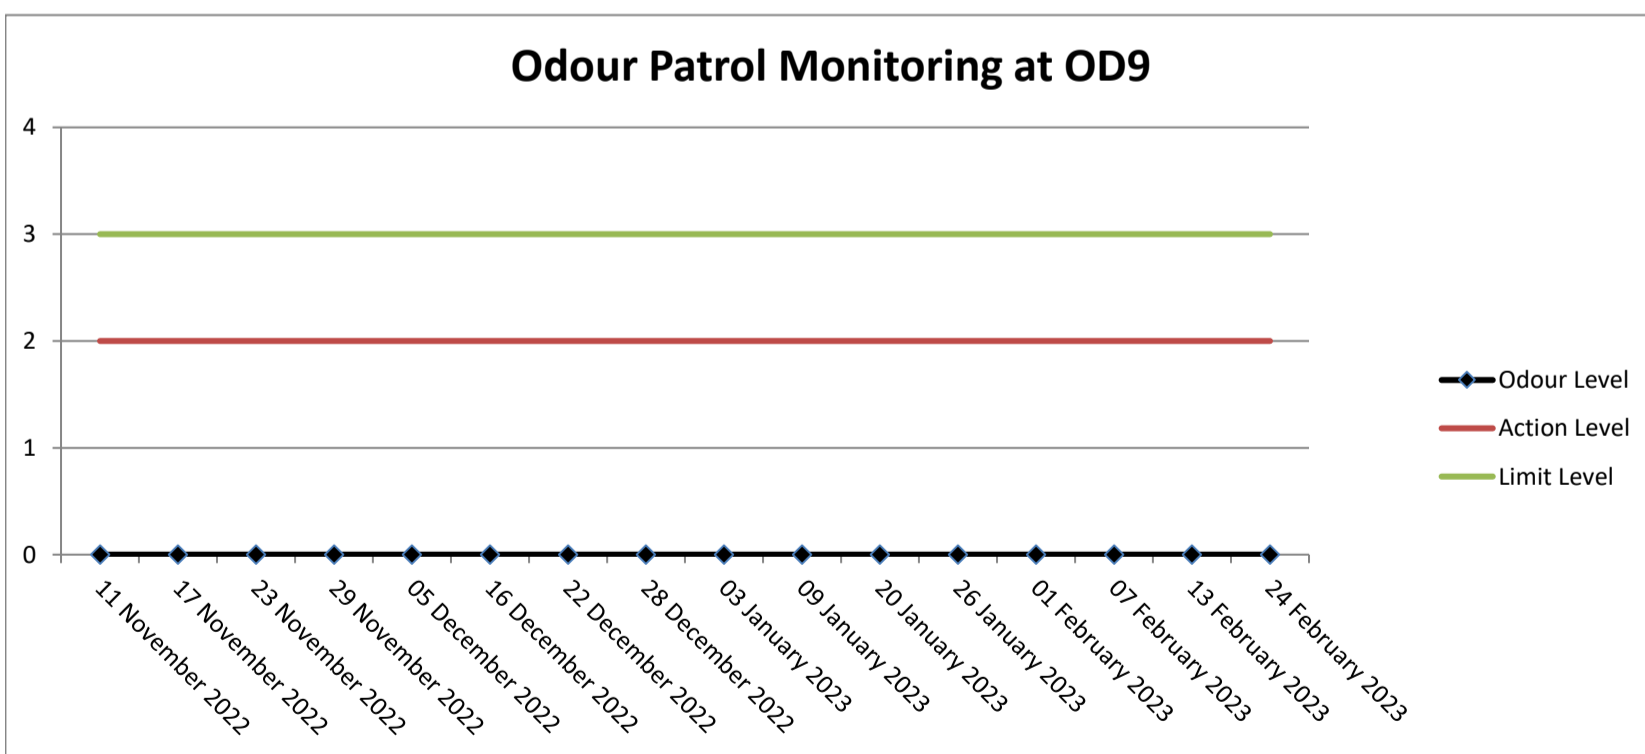

Note:  
Y-axis refers to the Odour Level: 0 - Not Detected; 1- Slight; 2 - Moderate; 3 - Strong; 4 - Extreme



## FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

### Appendix E

Copy of the Calibration Certificates for Water Quality Monitoring Equipment

Report No. : 142626WA230589



Page 1 of 3

**Report on Calibration of Aqua Troll 600 Multi-parameter Water Quality Meter****Information Supplied by Client**

Client : Fugro Technical Services Limited (MCL)

Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K.

Sample description : One Aqua Troll 600 Multi-parameter Water Quality Meter

Client sample ID : Serial No. 525120

Test required : Calibration of the Aqua Troll 600 Multi-parameter Water Quality Meter

**Laboratory Information**

Lab. sample ID : WA230589/1

Date of calibration : 03/02/2023

Next calibration date : 02/05/2023

Test method used : In-house comparison method

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 142626WA230589

Page 2 of 3

**Results :**
**A. pH calibration**

pH reading at 25°C for Q.C. solution(9.16) and at 25°C for Q.C. solution(6.88)		
Theoretical	Measured	Deviation
9.16	9.19	+0.03
6.88	6.87	-0.01

**B. Salinity calibration**

Salinity, ppt			
Theoretical	Measured	Deviation	Maximum acceptable Deviation
10	10.07	+0.07	± 0.5
20	20.19	+0.19	± 1.0
30	30.62	+0.62	± 1.5
40	40.85	+0.85	± 2.0

**C. Dissolved Oxygen calibration**

Trial No.	Dissolved oxygen content, mg/L	
	By calibrated D.O. meter	By D.O. meter
1	7.52	7.53
2	7.53	7.54
3	7.53	7.53
Average	7.53	7.53

Differences of D.O. Content between calibrated D.O. meter and D.O. meter should be less than 0.4mg/L.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 13/3/2023

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 142626WA230589

Page 3 of 3

**Results :**

**D. Temperature calibration**

Thermometer reading, °C	Meter reading, °C
25.03	25.05

**E. Turbidity calibration**

Turbidity, N.T.U.			
Theoretical	Measured	Deviation	Maximum acceptable Deviation
4	4.16	+0.16	± 0.6
8	8.24	+0.24	± 0.8
40	40.73	+0.73	± 3.0
80	81.01	+1.01	± 4.0

Certified by : 

Approved Signatory : HO Kin Man, John  
Assistant General Manager – Laboratories

Date : 13/3/2024

\*\* End of Report \*\*

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*



a xylem brand

9940 Summers Ridge Road  
San Diego, CA 92121  
Tel: (858) 546-8327  
support@sontek.com

## Certificate of Calibration

### TEST REPORT

Serial Number	5906
System Type	M9
System Orientation	Down
Compass Type	Sontek
Compass Offset (degrees)	N/A
Communications Output	RS232
Recorder Size (GB)	14.9
Firmware Version	4.02
Date Tested	05/23/2017

### POWER TEST

Command Mode (W):	0.17	Range : 0.00 – 0.30
Sleep Mode (W):	N/A	Range : N/A
Ping Mode - 18V (W):	2.67	Range : 1.50 – 3.50
Power Check		PASS

### NOISE TEST

Beam 1 – 3.0 MHz (counts)	95
Beam 2 – 1.0 MHz (counts)	96
Beam 3 – 3.0 MHz (counts)	95
Beam 4 – 1.0 MHz (counts)	101
Beam 5 – 3.0 MHz (counts)	93
Beam 6 – 1.0 MHz (counts)	95
Beam 7 – 3.0 MHz (counts)	91
Beam 8 – 1.0 MHz (counts)	100
Beam Vertical – 500KHz (counts)	88
Noise Test	PASS

## VERIFICATION

Velocity Check	PASS
Transmit Output	PASS
Sensitivity	PASS
Temperature Sensor	PASS
Compass Heading Check	PASS
Compass Level Check	PASS
Burn-in (24 hrs)	PASS
Load Default Parameters	DONE

## OPTIONS

Bottom Track	Installed
SmartPulse HD <sup>TM</sup>	Enabled
Stationary	Disabled
GPS Compass Integration	Disabled
RiverSurveyor	Enabled
HydroSurveyor	Disabled

Verified by: **ainthasane**

This report was generated on 5/24/2017.

ATTENTION: New Warranty Terms as of March 4, 2013:

This system is covered under a two year limited warranty that extends to all parts and labor for any malfunction due to workmanship or errors in the manufacturing process. The warranty is valid only if you properly maintain and operate this system under normal use as outlined in the User's Manual. The warranty does not cover shortcomings that are due to the design, or any incidental damages as a result of errors in the measurements.

SonTek will repair and/or replace, at its sole option, any product established to be defective with a product of like type. CLAIMS FOR LABOR COSTS AND/OR OTHER CHARGES RESULTING FROM THE USE OF SonTek GOODS AND/OR PRODUCTS ARE NOT COVERED BY THIS LIMITED WARRANTY.

SonTek DISCLAIMS ALL EXPRESS WARRANTIES OTHER THAN THOSE CONTAINED ABOVE AND ALL IMPLIED WARRANTIES, INCLUDING BUT NOT LIMITED TO WARRANTIES OF MERCHANTABILITY AND/OR FITNESS FOR A PARTICULAR PURPOSE. SonTek DISCLAIMS AND WILL NOT BE LIABLE, UNDER ANY CIRCUMSTANCE, IN CONTRACT, TORT OR WARRANTY, FOR ANY SPECIAL, INDIRECT, INCIDENTAL OR CONSEQUENTIAL DAMAGES OF ANY KIND, INCLUDING BUT NOT LIMITED TO LOST PROFITS, BUSINESS INTERRUPTION LOSSES, LOSS OF GOODWILL, OR LOSS OF BUSINESS OR CUSTOMER RELATIONSHIPS.

If your system is not functioning properly, first try to identify the source of the problem. If additional support is required, we encourage you to contact us immediately. We will work to resolve the problem as quickly as possible.

If the system needs to be returned to the factory, please contact SonTek to obtain a Service Request (SR) number. We reserve the right to refuse receipt of shipments without SRs. We require the system to be shipped back in the original shipping container using the original packing material with all delivery costs covered by the customer (including all taxes and duties). If the system is returned without appropriate packing, the customer will be required to cover the cost of a new packaging crate and material.

The warranty for repairs performed at an authorized SonTek Service Center is one year.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix F

### Results and Graphical Presentation of Water Quality Monitoring

Water Quality Monitoring Data

Monitoring Location	Date	Tide Mode	Weather	Sea Condition	Time	Water Depth (m)	Monitoring Level	Monitoring Level (m)	Replicate	In-situ Measurement								Laboratory Analysis							
										pH	Salinity (ppt)	Temperature (degree C)	DO Saturation (%)	DO (mg/L)	Turbidity (NTU)	Current Speed (m/s)	Current Direction (degree magnetic)	Total Suspended Solids (mg/L)	Ammonia Nitrogen (mg/L-N)	Nitrite Nitrogen (mg/L-N)	Nitrate Nitrogen (mg/L-N)	Total Inorganic Nitrogen (mg/L-N)	E.coli (cfu/100mL)	Total phosphorus (soluble and particulate) (mg/L)	BOD <sub>5</sub> (mg/L)
										Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value	Value
A	8/2/2023	Mid-Ebb	Fine	Moderate	13:23	17	S	1	1	7.32	30.26	19.76	104.2	6.89	2.4	0.23	264.1	3	0.23	0.008	0.15	0.39	420	0.03	1.6
A	8/2/2023	Mid-Ebb	Fine	Moderate	13:23	17	S	1	2	7.31	30.22	19.77	102.1	6.84	2.6	0.21	266.2	3	0.22	0.009	0.15	0.38	530	0.03	1.3
A	8/2/2023	Mid-Ebb	Fine	Moderate	13:23	17	M	8.5	1	6.94	30.54	18.24	93.2	6.62	2.4	0.14	204.5	3	0.23	0.008	0.18	0.42	500	0.03	1.6
A	8/2/2023	Mid-Ebb	Fine	Moderate	13:23	17	M	8.5	2	6.99	30.56	18.26	93.4	6.61	2.7	0.16	205.1	3	0.22	0.009	0.16	0.39	450	0.03	1.4
A	8/2/2023	Mid-Ebb	Fine	Moderate	13:23	17	B	16	1	6.98	30.97	19.11	91.2	6.54	2.4	0.13	209.1	3	0.22	0.009	0.18	0.41	400	0.03	1.5
A	8/2/2023	Mid-Ebb	Fine	Moderate	13:23	17	B	16	2	6.97	30.96	19.17	91.1	6.57	2.5	0.14	209.9	3	0.20	0.009	0.22	0.42	480	0.03	1.3
B	8/2/2023	Mid-Ebb	Fine	Moderate	13:40	14	S	1	1	7.74	31.24	18.94	99.4	6.84	1.4	0.14	74.1	3	0.33	0.009	0.21	0.56	460	0.02	1.2
B	8/2/2023	Mid-Ebb	Fine	Moderate	13:40	14	S	1	2	7.73	31.29	18.92	99.1	6.82	1.5	0.12	72.6	3	0.33	0.009	0.17	0.51	400	0.02	1.3
B	8/2/2023	Mid-Ebb	Fine	Moderate	13:40	14	M	7	1	7.54	31.57	18.73	98.3	6.70	1.3	0.13	74.9	3	0.57	0.017	0.70	1.3	500	0.03	1.3
B	8/2/2023	Mid-Ebb	Fine	Moderate	13:40	14	M	7	2	7.53	31.56	18.71	98.2	6.71	1.4	0.14	74.4	3	0.57	0.017	0.58	1.2	430	0.03	1.4
B	8/2/2023	Mid-Ebb	Fine	Moderate	13:40	14	B	13	1	7.41	31.84	18.54	97.4	6.74	2.3	0.23	81.2	3	0.25	0.009	0.23	0.49	530	0.02	1.3
B	8/2/2023	Mid-Ebb	Fine	Moderate	13:40	14	B	13	2	7.42	31.86	18.53	97.3	6.75	2.4	0.24	81.3	4	0.24	0.008	0.24	0.49	580	0.02	1.4
C	8/2/2023	Mid-Ebb	Fine	Moderate	13:59	12	S	1	1	7.83	30.43	18.43	95.8	7.14	1.4	0.36	264.5	3	0.21	0.010	0.23	0.45	400	0.03	2.0
C	8/2/2023	Mid-Ebb	Fine	Moderate	13:59	12	S	1	2	7.82	30.42	18.47	95.7	7.13	1.6	0.32	266.1	4	0.21	0.009	0.23	0.45	460	0.03	1.4
C	8/2/2023	Mid-Ebb	Fine	Moderate	13:59	12	M	6	1	7.44	30.57	18.21	94.3	7.04	1.4	0.27	259.2	3	0.19	0.009	0.22	0.42	390	0.03	1.4
C	8/2/2023	Mid-Ebb	Fine	Moderate	13:59	12	M	6	2	7.46	30.56	18.23	94.7	7.03	1.6	0.28	259.4	3	0.20	0.008	0.24	0.44	360	0.03	1.3
C	8/2/2023	Mid-Ebb	Fine	Moderate	13:59	12	B	11	1	7.48	30.72	18.04	93.2	6.84	1.9	0.24	267.3	4	0.21	0.008	0.24	0.46	450	0.04	1.3
C	8/2/2023	Mid-Ebb	Fine	Moderate	13:59	12	B	11	2	7.49	30.70	18.06	93.1	6.83	1.8	0.26	266.1	4	0.20	0.008	0.23	0.44	490	0.04	1.7
D	8/2/2023	Mid-Ebb	Fine	Moderate	14:14	13	S	1	1	7.54	31.46	18.42	92.4	6.74	1.2	0.38	146.2	4	0.17	0.009	0.24	0.42	420	0.04	1.4
D	8/2/2023	Mid-Ebb	Fine	Moderate	14:14	13	S	1	2	7.51	31.42	18.46	92.6	6.72	1.3	0.37	144.1	4	0.18	0.008	0.23	0.41	450	0.04	1.4
D	8/2/2023	Mid-Ebb	Fine	Moderate	14:14	13	M	6.5	1	7.52	31.87	18.72	91.4	6.69	1.8	0.24	123.5	4	0.19	0.008	0.19	0.38	510	0.03	1.2
D	8/2/2023	Mid-Ebb	Fine	Moderate	14:14	13	M	6.5	2	7.58	31.86	18.73	91.3	6.68	1.9	0.39	122.4	4	0.20	0.009	0.12	0.32	520	0.04	1.1
D	8/2/2023	Mid-Ebb	Fine	Moderate	14:14	13	B	12	1	7.59	31.34	18.94	90.7	6.54	2.4	0.23	154.6	4	0.19	0.011	0.11	0.31	600	0.03	1.3
D	8/2/2023	Mid-Ebb	Fine	Moderate	14:14	13	B	12	2	7.56	31.39	18.96	90.8	6.53	2.6	0.26	157.0	4	0.19	0.008	0.11	0.31	530	0.03	1.4
E	8/2/2023	Mid-Ebb	Fine	Moderate	14:32	16	S	1	1	8.51	32.46	19.04	87.9	6.94	1.6	0.17	257.1	3	0.18	0.008	0.14	0.32	110	0.02	1.5
E	8/2/2023	Mid-Ebb	Fine	Moderate	14:32	16	S	1	2	8.52	32.44	19.02	87.4	6.91	1.8	0.16	255.2	3	0.18	0.009	0.14	0.32	120	0.03	1.5
E	8/2/2023	Mid-Ebb	Fine	Moderate	14:32	16	M	8	1	8.56	32.91	18.43	86.2	6.83	1.7	0.14	271.2	3	0.18	0.011	0.11	0.30	98	0.03	1.5
E	8/2/2023	Mid-Ebb	Fine	Moderate	14:32	16	M	8	2	8.57	32.94	18.41	86.1	6.82	1.8	0.18	277.3	3	0.18	0.009	0.12	0.31	110	0.03	1.5
E	8/2/2023	Mid-Ebb	Fine	Moderate	14:32	16	B	15	1	8.54	32.83	18.32	85.4	6.74	1.2	0.16	261.4	4	0.20	0.009	0.12	0.33	130	0.02	1.5
E	8/2/2023	Mid-Ebb	Fine	Moderate	14:32	16	B	15	2	8.53	32.84	18.33	85.3	6.73	1.3	0.14	261.1	4	0.19	0.008	0.13	0.33	120	0.02	1.3
F	8/2/2023	Mid-Ebb	Fine	Moderate	14:49	23	S	1	1	8.73	32.46	19.32	83.1	6.64	1.4	0.12	312.7	4	0.16	0.029	0.32	0.51	100	0.04	1.4
F	8/2/2023	Mid-Ebb	Fine	Moderate	14:49	23	S	1	2	8.74	32.41	19.31	83.2	6.63	1.3	0.14	311.6	4	0.16	0.029	0.31	0.50	160	0.03	1.6
F	8/2/2023	Mid-Ebb	Fine	Moderate	14:49	23	M	11.5	1	8.69	32.58	19.46	84.5	6.73	1.4	0.16	326.1	3	0.17	0.008	0.12	0.30	120	0.03	1.3
F	8/2/2023	Mid-Ebb	Fine	Moderate	14:49	23	M	11.5	2	8.68	32.55	19.47	84.6	6.78	1.6	0.13	324.5	3	0.15	0.010	0.12	0.29	110	0.02	1.5
F	8/2/2023	Mid-Ebb	Fine	Moderate	14:49	23	B	22	1	8.64	32.74	19.31	82.5	6.51	1.9	0.16	322.3	4	0.18	0.010	0.20	0.39	140	0.03	1.3
F	8/2/2023	Mid-Ebb	Fine	Moderate	14:49	23	B	22	2	8.62	32.71	19.34	82.4	6.52	1.8	0.14	321.4	4	0.19	0.009	0.19	0.39	120	0.03	1.4
G	8/2/2023	Mid-Ebb	Fine	Moderate	15:08	22	S	1	1	8.41	31.34	18.41	104.5	8.61	1.3	0.14	97.1	3	0.14	0.009	0.20	0.35	97	0.03	1.6
G	8/2/2023	Mid-Ebb	Fine	Moderate	15:08	22	S	1	2	8.42	31.33	18.42	106.2	8.64	1.4	0.16	97.4	3	0.16	0.009	0.13	0.30	110	0.03	1.4
G	8/2/2023	Mid-Ebb	Fine	Moderate	15:08	22	M	11	1	8.39	31.45	18.26	103.4	8.52	1.3	0.19	103.2	3	0.20	0.009	0.14	0.35	81	0.03	1.4
G	8/2/2023	Mid-Ebb	Fine	Moderate	15:08	22	M	11	2	8.38	31.49	18.22	103.2	8.51	1.2	0.13	104.1	3	0.19	0.009	0.15	0.35	78	0.03	1.4
G	8/2/2023	Mid-Ebb	Fine	Moderate	15:08	22	B	21	1	8.30	31.78	18.19	98.4	8.43	1.8	0.17	99.5	4	0.15	0.008	0.18	0.33	120	0.02	1.5
G	8/2/2023	Mid-Ebb	Fine	Moderate	15:08	22	B	21	2	8.36	31.77	18.18	98.7	8.42	1.9	0.18	99.2	4	0.15	0.009	0.12	0.28	110	0.02	1.4
H	8/2/2023	Mid-Ebb	Fine	Moderate	15:24	19	S	1	1	8.64	31.01	18.03	115.2	8.94	1.4	0.24	245.1	4	0.15	0.009	0.12	0.28	99	0.02	1.7
H	8/2/2023	Mid-Ebb	Fine	Moderate	15:24	19	S	1	2	8.66	31.04	18.04	115.4	8.96	1.6	0.23	244.2	3	0.13	0.009	0.12	0.26	98	0.02	1.5
H	8/2/2023	Mid-Ebb	Fine	Moderate	15:24	19	M	9.5	1	8.68	31.34	17.94	112.3	8.90	1.1	0.18	237.3	4	0.17	0.008	0.12	0.30	82	0.02	1.8
H	8/2/2023	Mid-Ebb	Fine	Moderate	15:24	19	M	9.5	2	8.67	31.33	17.92	112.4	8.91	2.2	0.19	236.4	4	0.17	0.009	0.12	0.29	78	0.03	1.5
H	8/2/2023	Mid-Ebb	Fine	Moderate	15:24	19	B	18	1	8.64	31.56	17.45	108.4	8.84	1.3	0.14	229.6	4	0.16	0.009	0.12	0.29	69	0.04	1.4
H	8/2/2023	Mid-Ebb	Fine	Moderate	15:24	19	B	18	2	8.63	31.59	17.46	108.6	8.82	1.4	0.16	229.1	4	0.16	0.010	0.11	0.28	88	0.03	1.6

Note: 1. ND: Not Detected





Report No. : 181172WA230220



Page 1 of 18

**Test Report on Analysis of Water**
**Information Supplied by Client**

Client : Fugro Technical Services Limited  
 Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K.  
 Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works  
 Sample description : Ninety-six samples of water taken by the staff of FTS on 08/02/2023  
 Client sample ID : Refer to pages 3 to 18  
 Tests required : 
 

1. Biochemical oxygen demand
2. Total suspended solids dried at 103°C – 105°C
3. Ammoniacal Nitrogen content
4. Nitrate-Nitrogen content
5. Nitrite-Nitrogen content
6. Total Inorganic Nitrogen content
7. Total phosphorus content
8. Total phosphorus content (Filtered)
9. E. coli count

**Laboratory Information**

Lab. sample ID :	Chemical tests	Microbiological tests
	WA230220/1-96	WA230220/1B-96B

	Chemical tests	Microbiological tests
Container	Ninety-six 250 mL and 3 L plastic bottles	Ninety-six sterilized 250 mL plastic bottles with thiosulphate added
Appearance	Colourless	
Temperature	Cooled	

Date of receipt of sample : 08/02/2023

Date test commenced : 08/02/2023

Date test completed : 16/02/2023

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA230220

Page 2 of 18

Test methods used : Biochemical oxygen demand  
*APHA 23ed. 5210B*

Total suspended solids dried at 103°C – 105°C  
*APHA 23ed. 2540D*

Ammoniacal Nitrogen content  
*APHA 23ed. 4500-NH<sub>3</sub> H*

Nitrate-Nitrogen content  
*APHA 23ed. 4500-NO<sub>3</sub><sup>-</sup> I*

Nitrite-Nitrogen content  
*APHA 23ed. 4500-NO<sub>2</sub><sup>-</sup> A & NO<sub>3</sub><sup>-</sup> I*

Total Inorganic Nitrogen content  
*In-house method E-T-112 (By Calculation)*

Total phosphorus content  
*APHA 17ed. 4500-PB.5 (Digestion) &  
In-house method E-T-056 (Determination)*

Total phosphorus content (Filtered)  
*APHA 17ed. 4500-PB.5 (Digestion) &  
In-house method E-T-056 (Determination)*

E. coli count  
*The Bacteriological Examination of Drinking Water Supplies  
1982, DoE (1983) Membrane Filtration Procedure: Sections 7.8,  
7.9.4.2 Bacterial Confirmation: Section 7.9.4.4 & in-situ urease  
test*

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*


Report No. : 181172WA230220

Page 3 of 18

**Results :**

Test parameters	Sample identification							
	A/S/E	A/S/E/Dup	A/M/E	A/M/E/Dup	A/B/E	A/B/E/Dup	A/V/E	A/V/E/Dup
1. Biochemical oxygen demand, mg/L	1.6	1.3	1.6	1.4	1.5	1.3		
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	3	3		
3. Ammoniacal nitrogen content, mg/L	0.23	0.22	0.23	0.22	0.22	0.20		
4. Nitrate-Nitrogen content, mg/L	0.15	0.15	0.18	0.16	0.18	0.22		
5. Nitrite-Nitrogen content, mg/L	0.008	0.009	0.008	0.009	0.009	0.009		
6. Total Inorganic Nitrogen content, mg/L	0.39	0.38	0.42	0.39	0.41	0.42		
7. Total phosphorus content, mg/L	0.03	0.03	0.03	0.03	0.03	0.03		
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.02	0.02	<0.01	<0.01		
9. E. coli count, cfu/100ml	4.2 x 10 <sup>2</sup>	5.3 x 10 <sup>2</sup>	5.0 x 10 <sup>2</sup>	4.5 x 10 <sup>2</sup>	4.0 x 10 <sup>2</sup>	4.8 x 10 <sup>2</sup>		

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

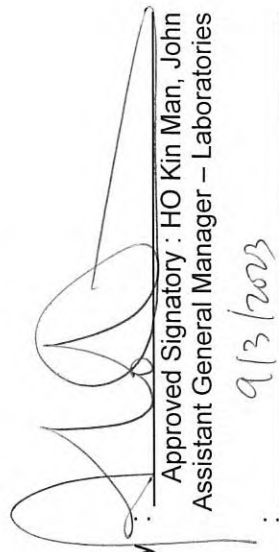Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 4 of 18

**Results :**

Test parameters	Sample identification									
	B/S/E	B/S/E/Dup	B/M/E	B/M/E/Dup	B/B/E	B/B/E/Dup	B/S/E	B/S/E/Dup	B/M/E	B/M/E/Dup
1. Biochemical oxygen demand, mg/L	1.2	1.3	1.3	1.4	1.3	1.4				
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	3	4				
3. Ammoniacal nitrogen content, mg/L	0.33	0.33	0.57	0.57	0.25	0.24				
4. Nitrate-Nitrogen content, mg/L	0.21	0.17	0.70	0.58	0.23	0.24				
5. Nitrite-Nitrogen content, mg/L	0.009	0.009	0.017	0.017	0.009	0.008				
6. Total Inorganic Nitrogen content, mg/L	0.56	0.51	1.3	1.2	0.49	0.49				
7. Total phosphorus content, mg/L	0.02	0.02	0.03	0.03	0.02	0.02				
8. Total phosphorus content (Filtered), mg/L	<0.01	0.01	0.01	0.01	0.01	0.01				
9. E. coli count, cfu/100ml	4.6 x 10 <sup>2</sup>	4.0 x 10 <sup>2</sup>	5.0 x 10 <sup>2</sup>	4.3 x 10 <sup>2</sup>	5.3 x 10 <sup>2</sup>	5.8 x 10 <sup>2</sup>				

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

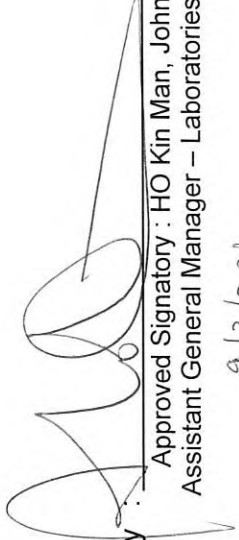Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2013

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 5 of 18

**Results :**

Test parameters	Sample identification							
	C/S/E	C/S/E/Dup	C/M/E	C/M/E/Dup	C/B/E	C/B/E/Dup	C/S/E	C/S/E/Dup
1. Biochemical oxygen demand, mg/L	2.0	1.4	1.4	1.3	1.3	1.7		
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	4	3	3	4	4		
3. Ammoniacal nitrogen content, mg/L	0.21	0.21	0.19	0.20	0.21	0.20		
4. Nitrate-Nitrogen content, mg/L	0.23	0.23	0.22	0.24	0.24	0.23		
5. Nitrite-Nitrogen content, mg/L	0.010	0.009	0.009	0.008	0.008	0.008		
6. Total Inorganic Nitrogen content, mg/L	0.45	0.45	0.42	0.44	0.46	0.44		
7. Total phosphorus content, mg/L	0.03	0.03	0.03	0.03	0.04	0.04		
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	<0.01	<0.01	0.01	0.01		
9. E. coli count, cfu/100ml	4.0 x 10 <sup>2</sup>	4.6 x 10 <sup>2</sup>	3.9 x 10 <sup>2</sup>	3.6 x 10 <sup>2</sup>	4.5 x 10 <sup>2</sup>	4.9 x 10 <sup>2</sup>		

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

Report No. : 181172WA230220

Page 6 of 18

**Results :**

Test parameters	Sample identification							
	D/S/E	D/S/E/Dup	D/M/E	D/M/E/Dup	D/B/E	D/B/E/Dup	D/S/E	D/S/E/Dup
1. Biochemical oxygen demand, mg/L	1.4	1.4	1.2	1.1	1.3	1.4		
2. Total suspended solids dried at 103°C - 105°C, mg/L	4	4	4	4	4	4		
3. Ammoniacal nitrogen content, mg/L	0.17	0.18	0.19	0.20	0.19	0.19		
4. Nitrate-Nitrogen content, mg/L	0.24	0.23	0.19	0.12	0.11	0.11		
5. Nitrite-Nitrogen content, mg/L	0.009	0.008	0.008	0.009	0.011	0.008		
6. Total Inorganic Nitrogen content, mg/L	0.42	0.41	0.38	0.32	0.31	0.31		
7. Total phosphorus content, mg/L	0.04	0.04	0.03	0.04	0.03	0.03		
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	<0.01	<0.01	<0.01	0.01		
9. E. coli count, cfu/100ml	4.2 x 10 <sup>2</sup>	4.5 x 10 <sup>2</sup>	5.1 x 10 <sup>2</sup>	5.2 x 10 <sup>2</sup>	6.0 x 10 <sup>2</sup>	5.3 x 10 <sup>2</sup>		

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by:   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date: 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 7 of 18

**Results :**

Test parameters	Sample identification					
	E/S/E	E/S/E/Dup	E/M/E	E/M/E/Dup	E/B/E	E/B/E/Dup
1. Biochemical oxygen demand, mg/L	1.5	1.5	1.5	1.5	1.5	1.3
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	4	4
3. Ammoniacal nitrogen content, mg/L	0.18	0.18	0.18	0.18	0.20	0.19
4. Nitrate-Nitrogen content, mg/L	0.14	0.14	0.11	0.12	0.12	0.13
5. Nitrite-Nitrogen content, mg/L	0.008	0.009	0.011	0.009	0.009	0.008
6. Total Inorganic Nitrogen content, mg/L	0.32	0.32	0.30	0.31	0.33	0.33
7. Total phosphorus content, mg/L	0.02	0.03	0.03	0.03	0.02	0.02
8. Total phosphorus content (Filtered), mg/L	<0.01	<0.01	0.01	0.01	0.01	0.01
9. E. coli count, cfu/100ml	1.1 x 10 <sup>2</sup>	1.2 x 10 <sup>2</sup>	9.8 x 10	1.1 x 10 <sup>2</sup>	1.3 x 10 <sup>2</sup>	1.2 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

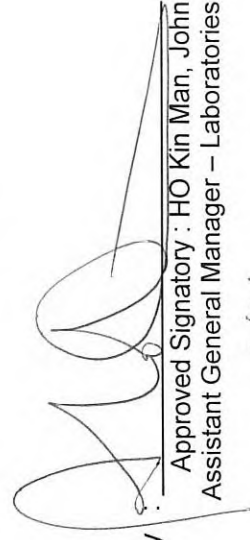Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.



Report No. : 181172WA230220

Page 8 of 18

**Results :**

Test parameters	Sample identification							
	F/S/E	F/S/E/Dup	F/M/E	F/M/E/Dup	F/B/E	F/B/E/Dup	F/S/E	F/S/E/Dup
1. Biochemical oxygen demand, mg/L	1.4	1.6	1.3	1.5	1.3	1.4		
2. Total suspended solids dried at 103°C - 105°C, mg/L	4	4	3	3	4	4		
3. Ammoniacal nitrogen content, mg/L	0.16	0.16	0.17	0.15	0.18	0.19		
4. Nitrate-Nitrogen content, mg/L	0.32	0.31	0.12	0.12	0.20	0.19		
5. Nitrite-Nitrogen content, mg/L	0.029	0.029	0.008	0.010	0.010	0.009		
6. Total Inorganic Nitrogen content, mg/L	0.51	0.50	0.30	0.29	0.39	0.39		
7. Total phosphorus content, mg/L	0.04	0.03	0.03	0.02	0.03	0.03		
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	<0.01	<0.01	<0.01	<0.01		
9. E. coli count, cfu/100ml	1.0 x 10 <sup>2</sup> *	1.6 x 10 <sup>2</sup>	1.2 x 10 <sup>2</sup>	1.1 x 10 <sup>2</sup>	1.4 x 10 <sup>2</sup>	1.2 x 10 <sup>2</sup>		

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.  
 3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2013

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 9 of 18

**Results :**

Test parameters	Sample identification							
	G/S/E	G/S/E/Dup	G/M/E	G/M/E/Dup	G/B/E	G/B/E/Dup	G/I/E	G/I/E/Dup
1. Biochemical oxygen demand, mg/L	1.6	1.4	1.4	1.4	1.5	1.4	1.4	1.4
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	4	4	4	4
3. Ammoniacal nitrogen content, mg/L	0.14	0.16	0.20	0.19	0.15	0.15	0.15	0.15
4. Nitrate-Nitrogen content, mg/L	0.20	0.13	0.14	0.15	0.18	0.12	0.12	0.12
5. Nitrite-Nitrogen content, mg/L	0.009	0.009	0.009	0.009	0.008	0.009	0.009	0.009
6. Total Inorganic Nitrogen content, mg/L	0.35	0.30	0.35	0.35	0.33	0.28	0.28	0.28
7. Total phosphorus content, mg/L	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.02
8. Total phosphorus content (Filtered), mg/L	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01
9. E. coli count, cfu/100ml	9.7 x 10	1.1 x 10 <sup>2</sup>	8.1 x 10	7.8 x 10	1.2 x 10 <sup>2</sup>	1.1 x 10 <sup>2</sup>	1.1 x 10 <sup>2</sup>	1.1 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

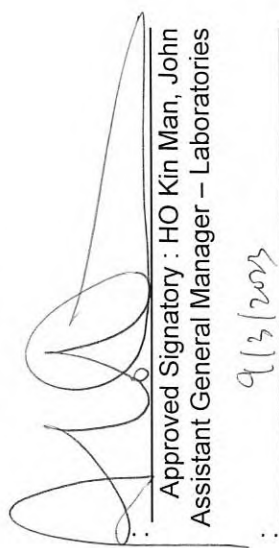Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

Report No. : 181172WA230220

Page 10 of 18

**Results :**

Test parameters	Sample identification									
	H/S/E	H/S/E/Dup	H/M/E	H/M/E/Dup	H/B/E	H/B/E/Dup	H/S/E	H/S/E/Dup	H/M/E	H/M/E/Dup
1. Biochemical oxygen demand, mg/L	1.7	1.5	1.8	1.5	1.4	1.6				
2. Total suspended solids dried at 103°C - 105°C, mg/L	4	3	4	4	4	4				
3. Ammoniacal nitrogen content, mg/L	0.15	0.13	0.17	0.17	0.16	0.16				
4. Nitrate-Nitrogen content, mg/L	0.12	0.12	0.12	0.12	0.12	0.11				
5. Nitrite-Nitrogen content, mg/L	0.009	0.009	0.008	0.009	0.009	0.010				
6. Total Inorganic Nitrogen content, mg/L	0.28	0.26	0.30	0.29	0.29	0.28				
7. Total phosphorus content, mg/L	0.02	0.02	0.02	0.03	0.04	0.03				
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	<0.01	<0.01	0.01	0.01				
9. E. coli count, cfu/100ml	9.9 x 10	9.8 x 10	8.2 x 10	7.8 x 10	6.9 x 10	8.8 x 10				

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2003

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 11 of 18

**Results :**

Test parameters	Sample identification					
	A/S/F	A/S/F/Dup	A/M/F	A/M/F/Dup	A/B/F	A/B/F/Dup
1. Biochemical oxygen demand, mg/L	1.5	1.4	1.5	1.3	1.4	1.5
2. Total suspended solids dried at 103°C - 105°C, mg/L	4	4	3	3	3	3
3. Ammoniacal nitrogen content, mg/L	0.22	0.19	0.19	0.19	0.17	0.17
4. Nitrate-Nitrogen content, mg/L	0.12	0.13	0.12	0.12	0.12	0.11
5. Nitrite-Nitrogen content, mg/L	0.010	0.009	0.011	0.010	0.008	0.008
6. Total Inorganic Nitrogen content, mg/L	0.35	0.33	0.31	0.32	0.30	0.29
7. Total phosphorus content, mg/L	0.03	0.03	0.03	0.03	0.02	0.02
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	0.02	0.02	<0.01	<0.01
9. E. coli count, cfu/100ml	3.2 x 10 <sup>2</sup>	3.9 x 10 <sup>2</sup>	4.2 x 10 <sup>2</sup>	3.7 x 10 <sup>2</sup>	5.0 x 10 <sup>2</sup>	4.5 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 12 of 18

**Results :**

Test parameters	Sample identification					
	B/S/F	B/S/F/Dup	B/M/F	B/M/F/Dup	B/B/F	B/B/F/Dup
1. Biochemical oxygen demand, mg/L	1.4	1.3	1.5	1.4	1.4	1.4
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	3	3
3. Ammoniacal nitrogen content, mg/L	0.19	0.18	0.19	0.18	0.15	0.16
4. Nitrate-Nitrogen content, mg/L	0.12	0.12	0.11	0.13	0.13	0.13
5. Nitrite-Nitrogen content, mg/L	0.009	0.010	0.008	0.008	0.009	0.009
6. Total Inorganic Nitrogen content, mg/L	0.32	0.31	0.31	0.32	0.29	0.30
7. Total phosphorus content, mg/L	0.02	0.03	0.03	0.03	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	<0.01	0.01	0.01	0.01	<0.01	0.13
9. E. coli count, cfu/100ml	3.2 x 10 <sup>2</sup>	4.8 x 10 <sup>2</sup>	2.8 x 10 <sup>2</sup>	3.2 x 10 <sup>2</sup>	4.0 x 10 <sup>2</sup>	3.5 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

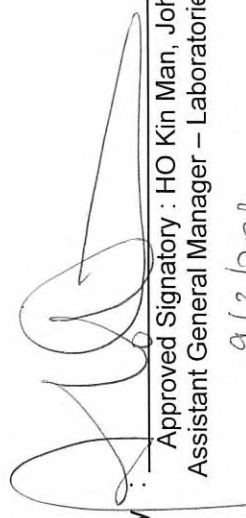Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 13 of 18

**Results :**

Test parameters	Sample identification							
	C/S/F	C/S/F/Dup	C/M/F	C/M/F/Dup	C/B/F	C/B/F/Dup	C/B/F	C/B/F/Dup
1. Biochemical oxygen demand, mg/L	1.1	1.4	1.5	1.6	1.7	1.7	1.7	1.7
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	3	3	3	3
3. Ammoniacal nitrogen content, mg/L	0.15	0.15	0.16	0.16	0.18	0.18	0.18	0.18
4. Nitrate-Nitrogen content, mg/L	0.13	0.13	0.11	0.12	0.13	0.13	0.13	0.13
5. Nitrite-Nitrogen content, mg/L	0.009	0.008	0.009	0.009	0.009	0.008	0.009	0.008
6. Total Inorganic Nitrogen content, mg/L	0.29	0.29	0.28	0.28	0.32	0.32	0.32	0.32
7. Total phosphorus content, mg/L	0.02	0.03	0.02	0.02	0.02	0.02	0.02	0.02
8. Total phosphorus content (Filtered), mg/L	0.02	0.02	<0.01	0.01	0.01	0.01	0.01	0.01
9. E. coli count, cfu/100ml	5.5 x 10 <sup>2</sup>	4.5 x 10 <sup>2</sup>	4.9 x 10 <sup>2</sup>	4.2 x 10 <sup>2</sup>	5.9 x 10 <sup>2</sup>	5.9 x 10 <sup>2</sup>	5.9 x 10 <sup>2</sup>	5.0 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 14 of 18

**Results :**

Test parameters	Sample identification					
	D/S/F	D/S/F/Dup	D/M/F	D/M/F/Dup	D/B/F	D/B/F/Dup
1. Biochemical oxygen demand, mg/L	1.6	1.6	1.6	1.5	1.3	1.7
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	3	3
3. Ammoniacal nitrogen content, mg/L	0.19	0.19	0.19	0.18	0.18	0.19
4. Nitrate-Nitrogen content, mg/L	0.11	0.11	0.11	0.11	0.11	0.12
5. Nitrite-Nitrogen content, mg/L	0.008	0.009	0.009	0.008	0.008	0.009
6. Total Inorganic Nitrogen content, mg/L	0.31	0.31	0.30	0.30	0.30	0.31
7. Total phosphorus content, mg/L	0.02	0.02	0.05	0.05	0.02	0.02
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	<0.01	<0.01	0.01	0.01
9. E. coli count, cfu/100ml	3.0 x 10 <sup>2</sup>	2.4 x 10 <sup>2</sup>	2.8 x 10 <sup>2</sup>	2.3 x 10 <sup>2</sup>	3.6 x 10 <sup>2</sup>	3.0 x 10 <sup>2</sup>

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

Report No. : 181172WA230220

Page 15 of 18


**Results :**

Test parameters	Sample identification									
	E/S/IF	E/S/IF/Dup	E/M/IF	E/M/IF/Dup	E/B/F	E/B/F/Dup	E/S/IF	E/S/IF/Dup	E/M/IF	E/M/IF/Dup
1. Biochemical oxygen demand, mg/L	1.7	1.5	1.1	1.2	1.6	1.4				
2. Total suspended solids dried at 103°C - 105°C, mg/L	4	4	3	3	3	3				
3. Ammoniacal nitrogen content, mg/L	0.18	0.16	0.15	0.15	0.19	0.16				
4. Nitrate-Nitrogen content, mg/L	0.11	0.11	0.12	0.12	0.12	0.11				
5. Nitrite-Nitrogen content, mg/L	0.008	0.009	0.008	0.009	0.009	0.009				
6. Total Inorganic Nitrogen content, mg/L	0.30	0.28	0.28	0.28	0.32	0.28				
7. Total phosphorus content, mg/L	0.02	0.03	0.02	0.02	0.02	0.02				
8. Total phosphorus content (Filtered), mg/L	<0.01	<0.01	0.02	0.02	0.01	0.02				
9. E. coli count, cfu/100ml	8.2 x 10	1.1 x 10 <sup>2*</sup>	1.0 x 10 <sup>2</sup>	1.2 x 10 <sup>2</sup>	6.9 x 10	7.6 x 10				

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)

2. Temperature of ice-box when samples being received were 3.9°C.

3.\* Estimated for E. coli count means the colonies counted was not in the range of 10 to 100 cfu/100ml.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/13/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.




Report No. : 181172WA230220

Page 16 of 18

**Results :**

Test parameters	Sample identification							
	F/S/F	F/S/F/Dup	F/M/F	F/M/F/Dup	F/B/F	F/B/F/Dup	F/B/F	F/B/F/Dup
1. Biochemical oxygen demand, mg/L	1.5	1.3	1.3	1.6	1.6	1.4	1.6	1.4
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	4	3	3	3	3	3	3
3. Ammoniacal nitrogen content, mg/L	0.19	0.17	0.22	0.22	0.22	0.22	0.22	0.22
4. Nitrate-Nitrogen content, mg/L	0.12	0.13	0.19	0.14	0.12	0.11	0.12	0.11
5. Nitrite-Nitrogen content, mg/L	0.008	0.008	0.009	0.009	0.009	0.008	0.009	0.008
6. Total Inorganic Nitrogen content, mg/L	0.31	0.30	0.42	0.37	0.35	0.34	0.35	0.34
7. Total phosphorus content, mg/L	0.02	0.02	0.03	0.02	0.03	0.03	0.03	0.03
8. Total phosphorus content (Filtered), mg/L	0.01	0.01	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01
9. E. coli count, cfu/100ml	1.0 x 10 <sup>2</sup>	7.4 x 10	1.0 x 10 <sup>2</sup>	6.9 x 10	8.0 x 10	8.9 x 10	8.0 x 10	8.9 x 10

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 17 of 18

**Results :**

Test parameters	Sample identification									
	G/S/F	G/S/F/Dup	G/M/F	G/M/F/Dup	G/B/F	G/B/F/Dup	G/S/F	G/S/F/Dup	G/M/F	G/M/F/Dup
1. Biochemical oxygen demand, mg/L	1.4	1.6	1.5	1.5	1.3	1.3				
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	3	3				
3. Ammoniacal nitrogen content, mg/L	0.12	0.12	0.15	0.15	0.16	0.16				
4. Nitrate-Nitrogen content, mg/L	0.11	0.11	0.11	0.12	0.12	0.11				
5. Nitrite-Nitrogen content, mg/L	0.009	0.008	0.009	0.008	0.009	0.009				
6. Total Inorganic Nitrogen content, mg/L	0.24	0.24	0.27	0.27	0.28	0.28				
7. Total phosphorus content, mg/L	0.02	0.02	0.02	0.02	0.02	0.02				
8. Total phosphorus content (Filtered), mg/L	<0.01	<0.01	<0.01	<0.01	<0.01	<0.01				
9. E. coli count, cfu/100ml	1.0 x 10 <sup>2</sup>	8.4 x 10	9.6 x 10	1.1 x 10 <sup>2</sup>	7.9 x 10	6.7 x 10				

Remarks: 1. Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

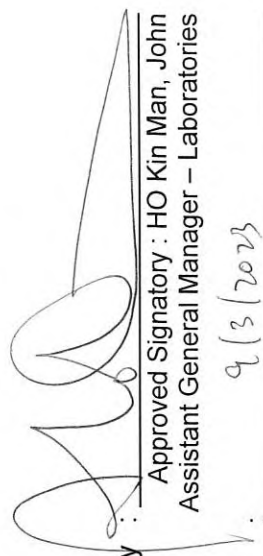Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.


Report No. : 181172WA230220

Page 18 of 18

**Results :**

Test parameters	Sample identification									
	H/S/F	H/S/F/Dup	H/M/F	H/M/F/Dup	H/B/F	H/B/F/Dup	H/S/F	H/S/F/Dup	H/M/F	H/M/F/Dup
1. Biochemical oxygen demand, mg/L	1.4	1.6	1.5	1.4	1.7	1.7				
2. Total suspended solids dried at 103°C - 105°C, mg/L	3	3	3	3	3	3				
3. Ammoniacal nitrogen content, mg/L	0.14	0.13	0.18	0.18	0.15	0.16				
4. Nitrate-Nitrogen content, mg/L	0.13	0.11	0.12	0.12	0.12	0.13				
5. Nitrite-Nitrogen content, mg/L	0.009	0.009	0.008	0.008	0.009	0.009				
6. Total Inorganic Nitrogen content, mg/L	0.28	0.25	0.31	0.30	0.28	0.29				
7. Total phosphorus content, mg/L	0.02	0.02	0.02	0.02	0.02	0.02				
8. Total phosphorus content (Filtered), mg/L	0.01	<0.01	<0.01	<0.01	0.01	0.01				
9. E. coli count, cfu/100ml	5.2 x 10	6.2 x 10	8.6 x 10	6.9 x 10	5.4 x 10	4.6 x 10				

Remarks: 1.Total Inorganic Nitrogen (in mg/L) = Total Oxidised Nitrogen Content (in mg/L) x 10 Ammoniacal Nitrogen Content (in mg/L)  
 2. Temperature of ice-box when samples being received were 3.9°C.

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories  
 Date : 9/3/2023


\*\* End of Report \*\*

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

**Note**

**Laboratory Duplicate, Quality Assurance/Quality Control Report**

Biochemical oxygen demand, mg/L						Nitrate-Nitrogen content, mg/L					
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%
			Original result	Duplicate result					Original result	Duplicate result	
1	<1	-	1.2	1.7	34	0.005	-	-			
			1.4	1.5	6.9						
			1.4	1.4	0						
			1.3	1.3	0						
			1.7	1.7	0						
Total suspended solids dried at 103°C – 105°C, mg/L						Nitrite-Nitrogen content, mg/L					
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate		RPD%
			Original result	Duplicate result					Original result	Duplicate result	
1	<1	93.38	4.1	3.9	5.0	0.005	<0.005	101.00	0.008	0.009	12
			2.6	2.6	0				0.009	0.009	0
			2.8	2.7	3.6				0.009	0.009	0
			3.9	4.2	7.4				0.009	0.008	12
			3.2	3.3	3.1				0.009	0.010	11

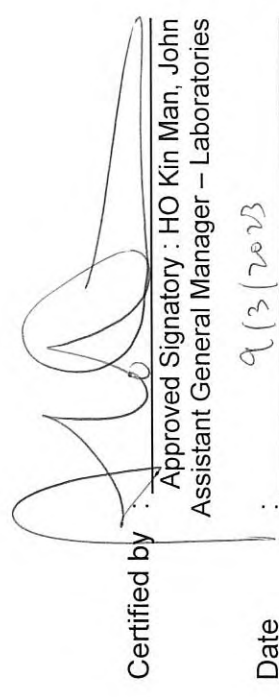Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 9/3/2023

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

**Note**

**Laboratory Duplicate, Quality Assurance/Quality Control Report**

Ammoniacal Nitrogen content, mg/L				Total Inorganic Nitrogen content, mg/L			
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate
			Original result				Original result
			Duplicate result				Duplicate result
			RPD%				RPD%
0.005	<0.005	96.92	0.18	0.17	5.7		
	<0.005	104.92	0.19	0.19	0		
	<0.005	100.83	0.16	0.16	0		
	<0.005	101.17	0.17	0.17	0		
	<0.005	100.00	0.16	0.16	0		
Total phosphorus content, mg/L				Total phosphorus content (Filtered), mg/L			
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate
			Original result				Original result
			Duplicate result				Duplicate result
			RPD%				RPD%
0.01	<0.01	99.1	0.037	0.035	5.6	<0.01	0.012
	<0.01	100.2	0.028	0.027	3.6	<0.01	0.007
	<0.01	100	0.032	0.033	3.1	<0.01	0.011
	<0.01	99.7	0.021	0.02	4.9	<0.01	0.011
	<0.01	99.2	0.023	0.024	4.3	<0.01	0.013
E. coli count, cfu/100ml							
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate
			Original result				Original result
			Duplicate result				Duplicate result
			Precision				Precision
1	0	-	4.0 x 10 <sup>2</sup>	5.0 x 10 <sup>2</sup>	0.097	4.0 x 10 <sup>2</sup>	0.013
			1.2 x 10 <sup>2</sup>	1.4 x 10 <sup>2</sup>	0.067	4.0 x 10 <sup>2</sup>	0.005
			3.0 x 10 <sup>2</sup>	3.9 x 10 <sup>2</sup>	0.11	4.0 x 10 <sup>2</sup>	0.012
			7.2 x 10	7.5 x 10	0.12	4.0 x 10 <sup>2</sup>	0.01
			4.0 x 10	5.2 x 10	0.11	4.0 x 10 <sup>2</sup>	0.013

Certified by :





Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date :


9/3/2023

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.





pH value

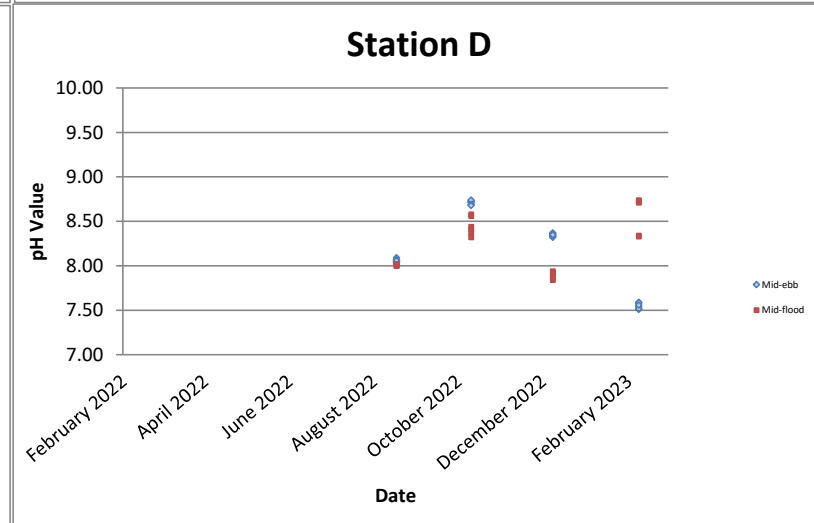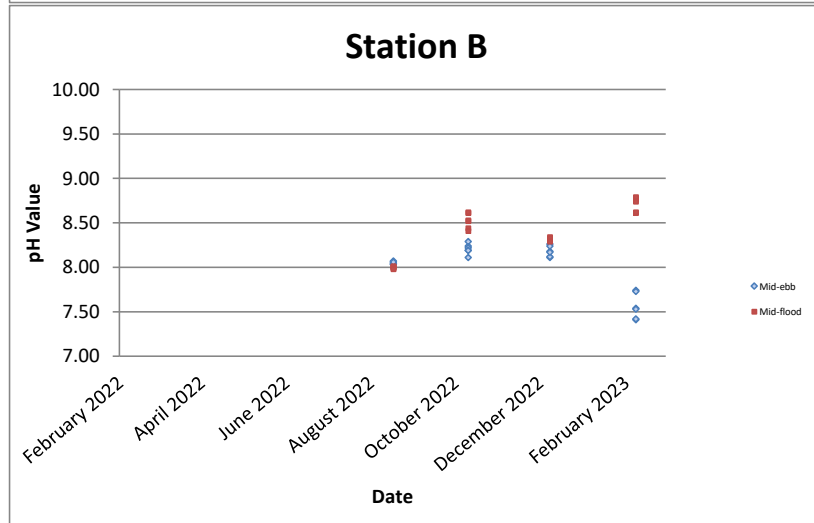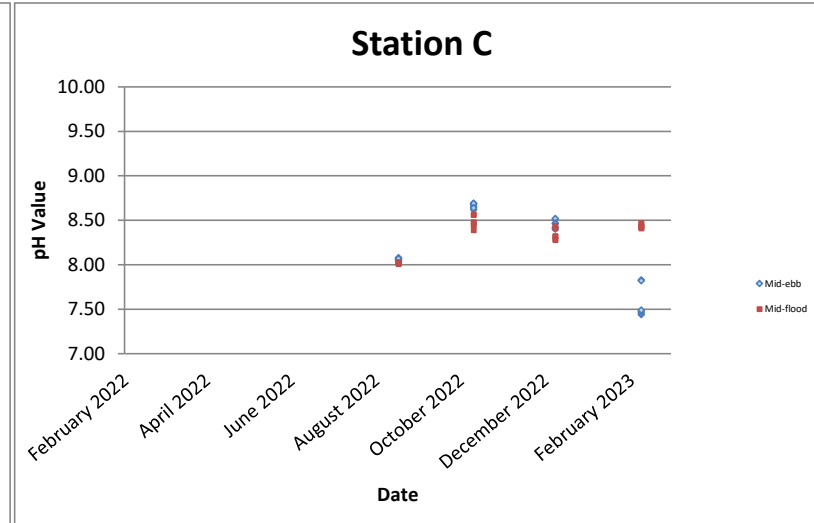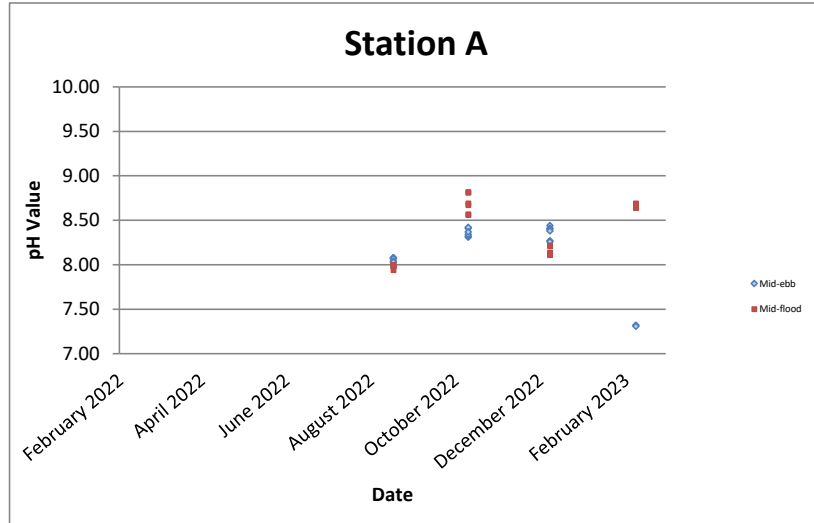

pH value

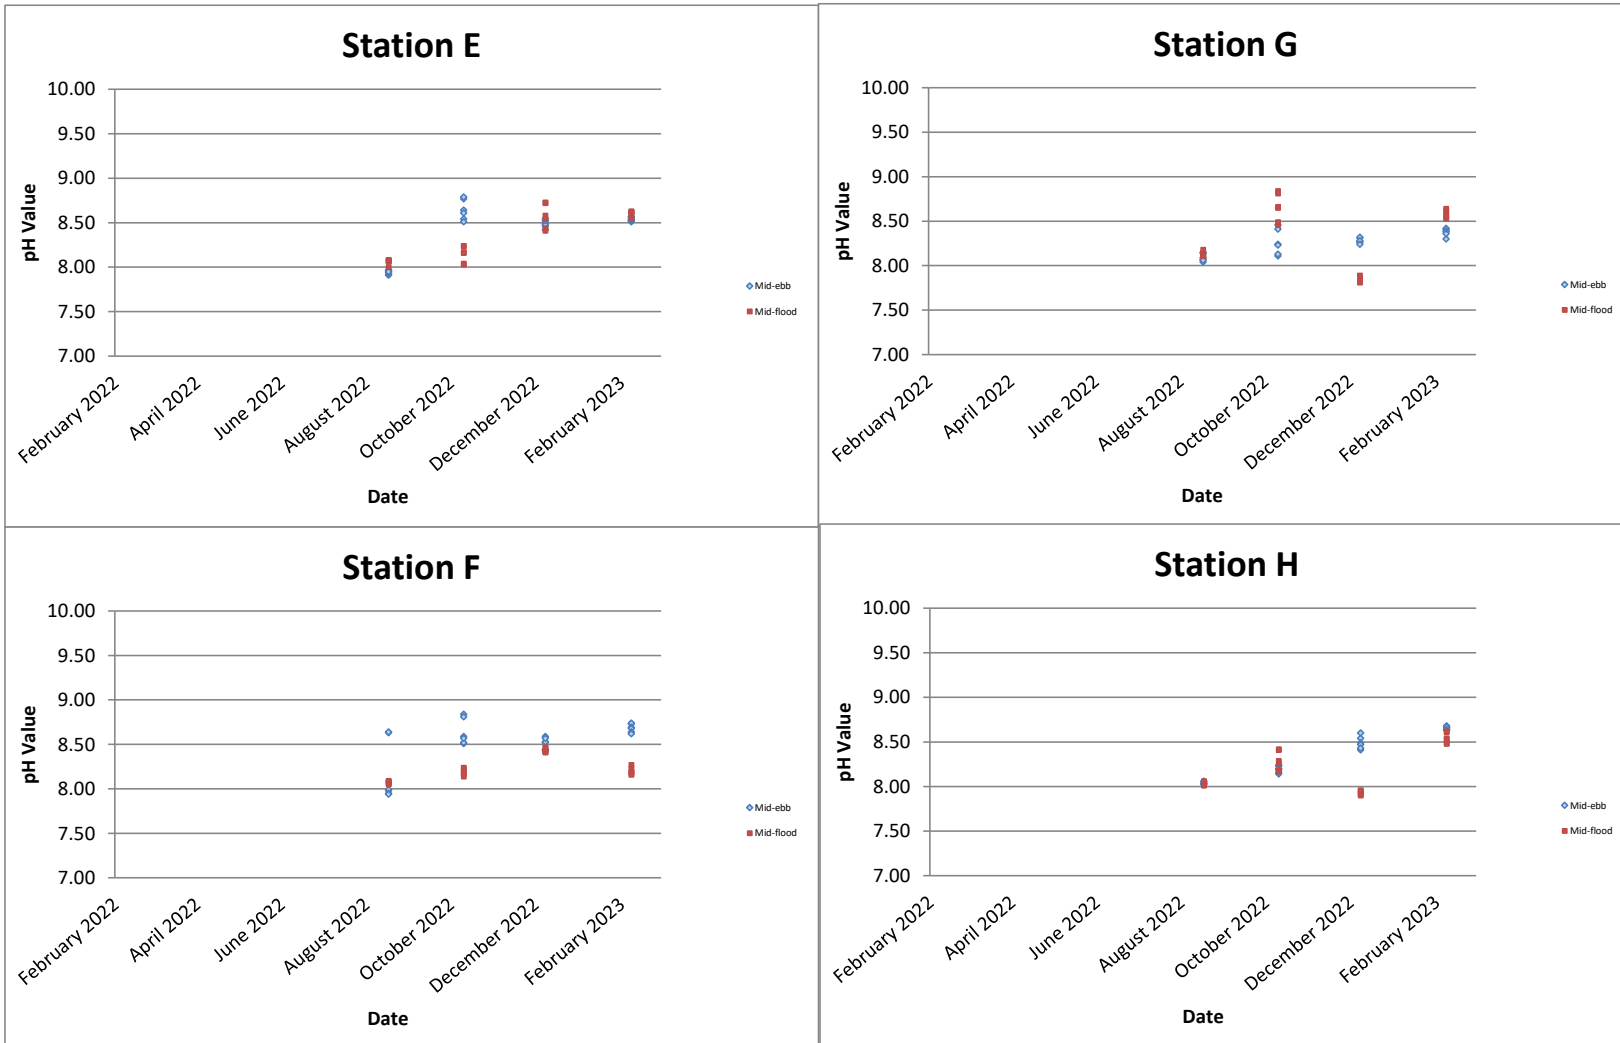


Salinity (ppt)

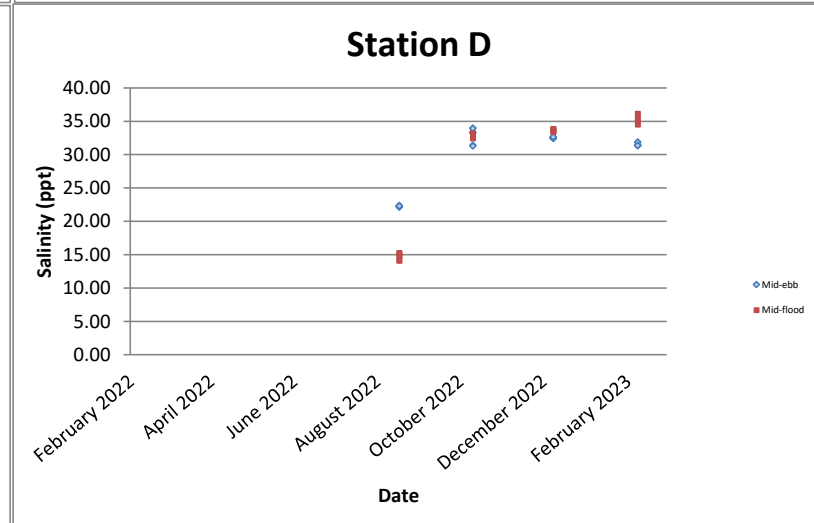
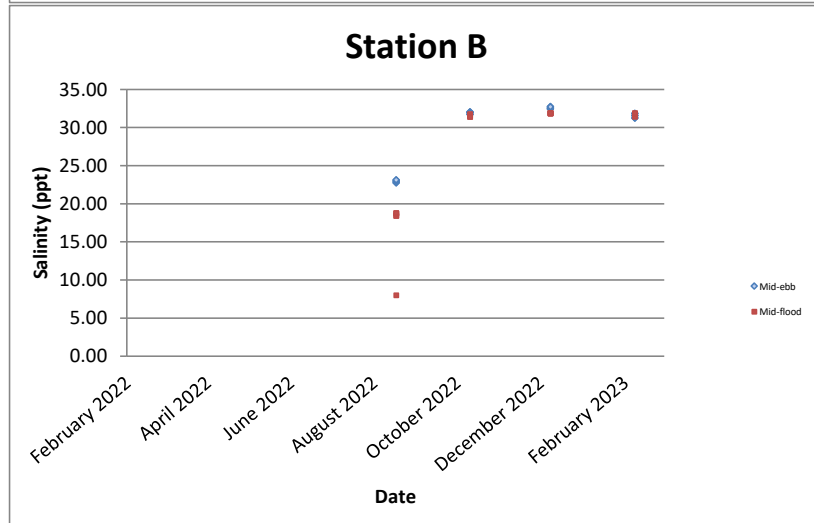
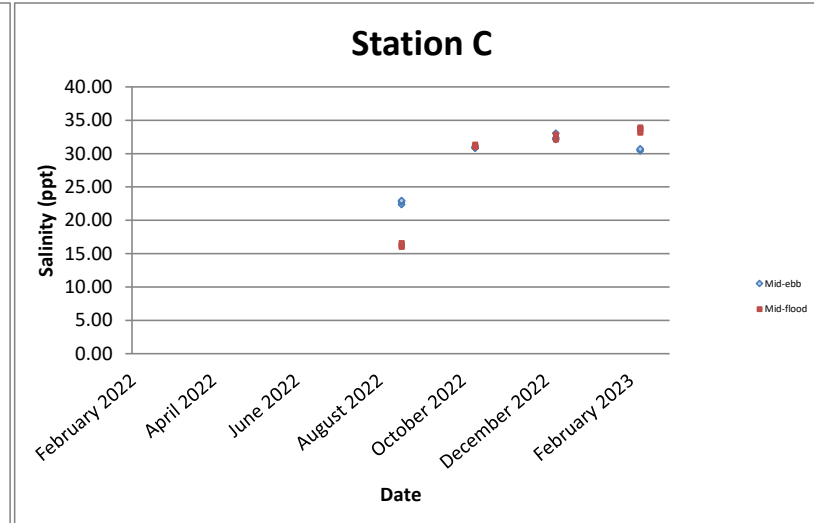
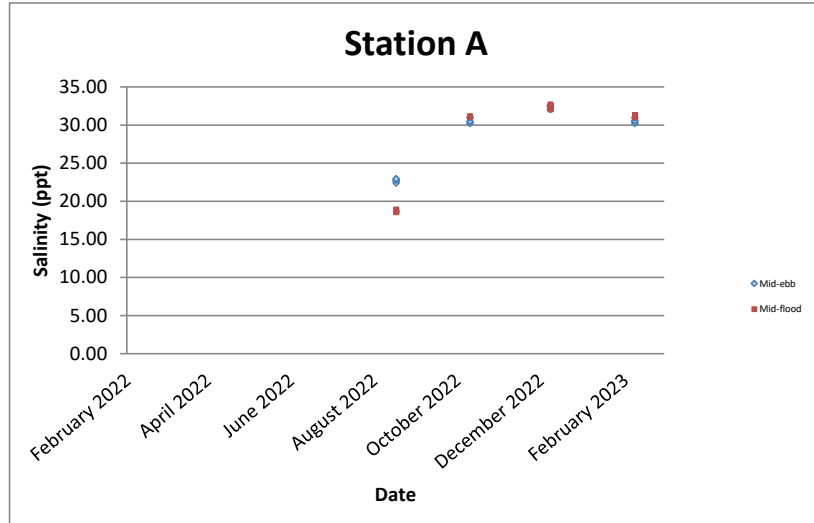





Salinity (ppt)

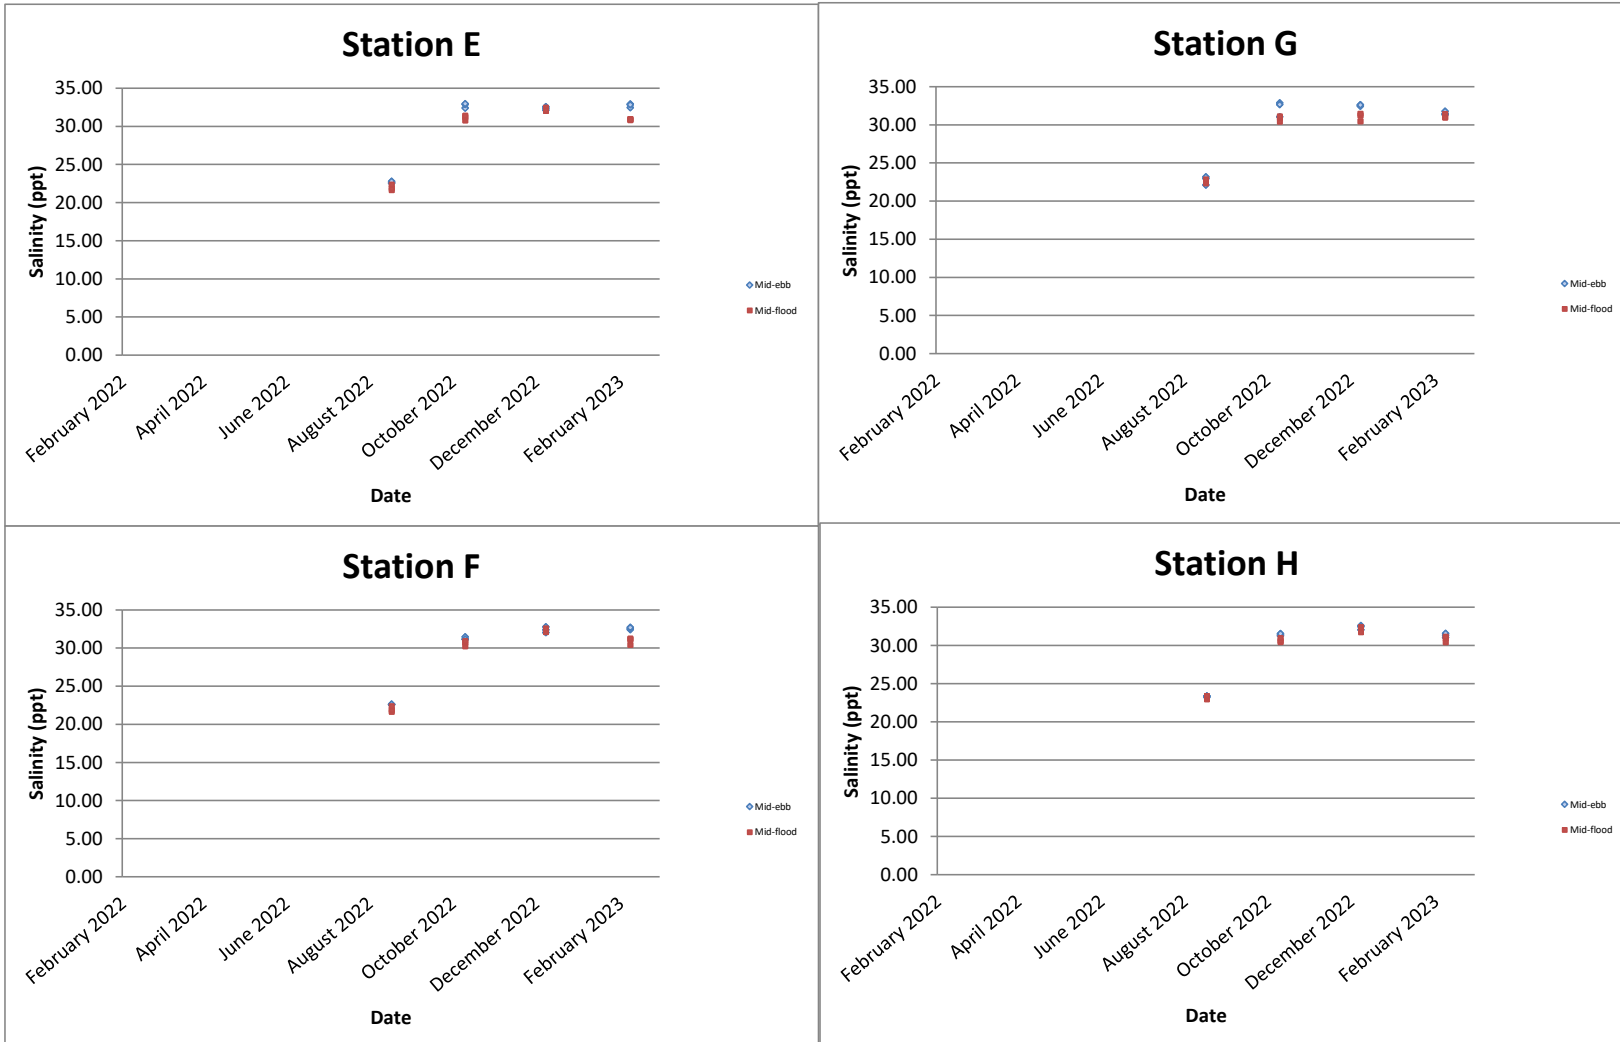


Temperature (degree C)

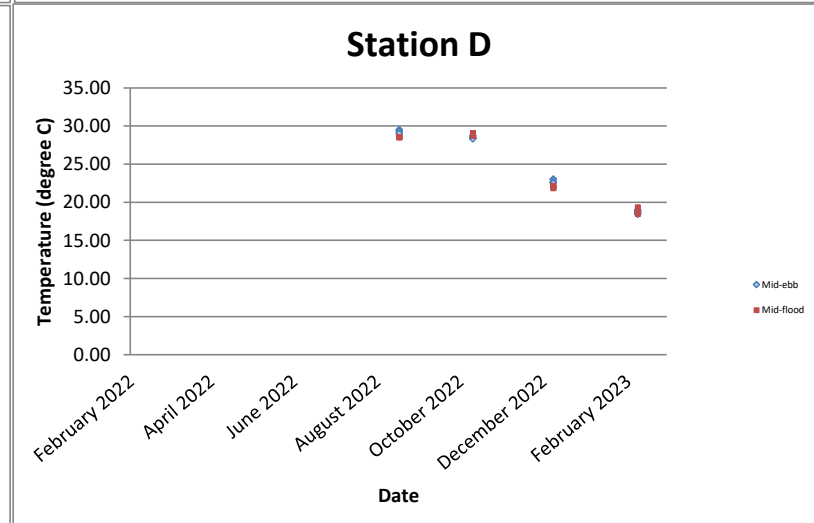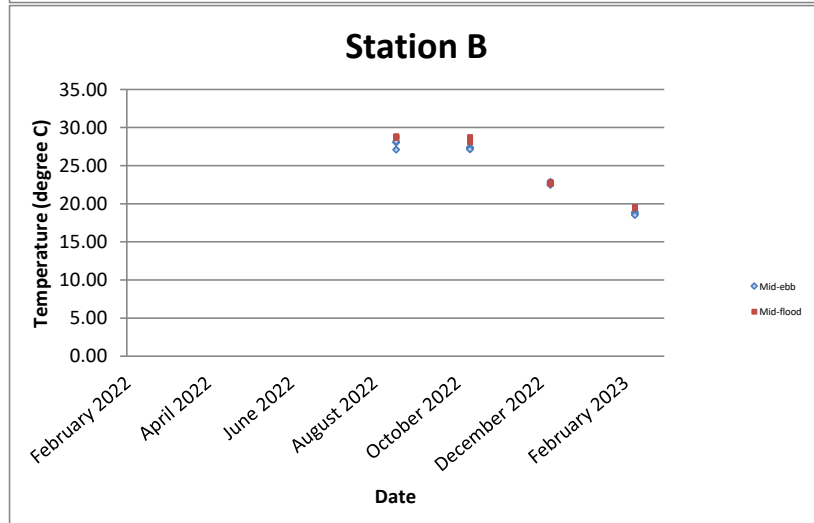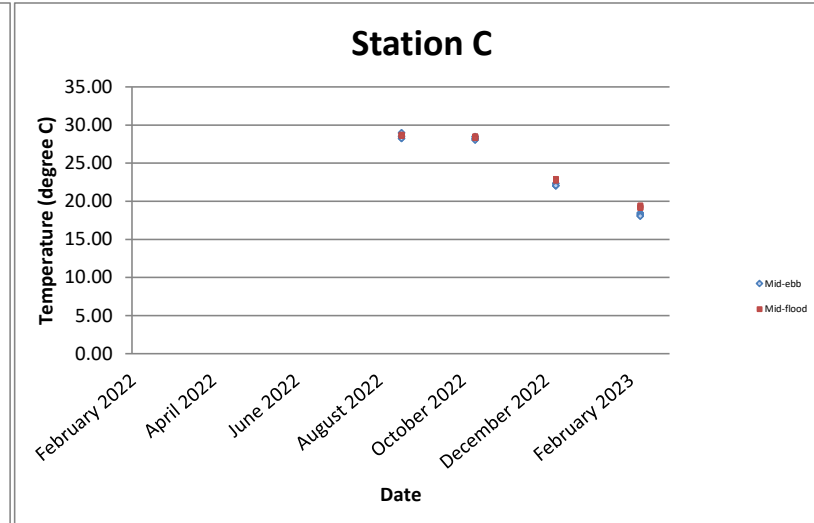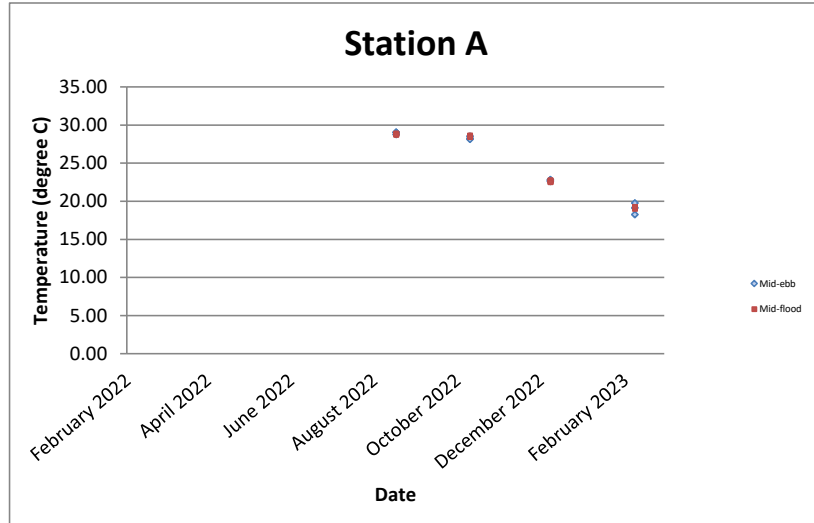


Temperature (degree C)

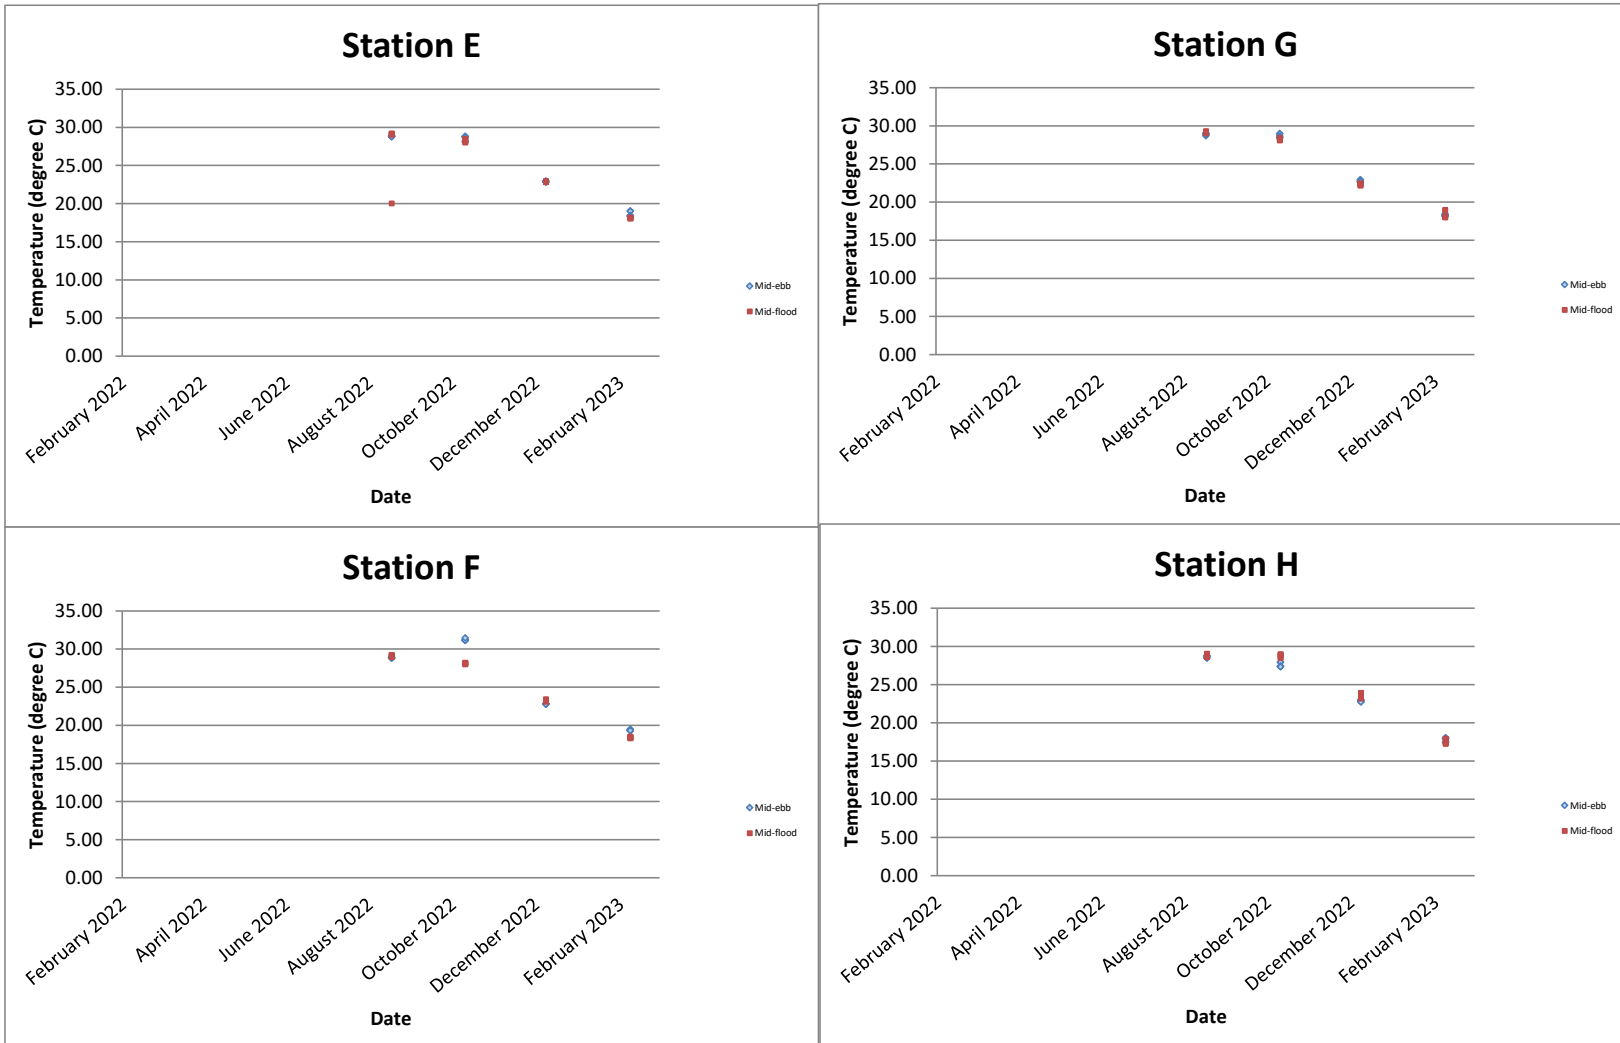





Dissolved oxygen (mg/L)

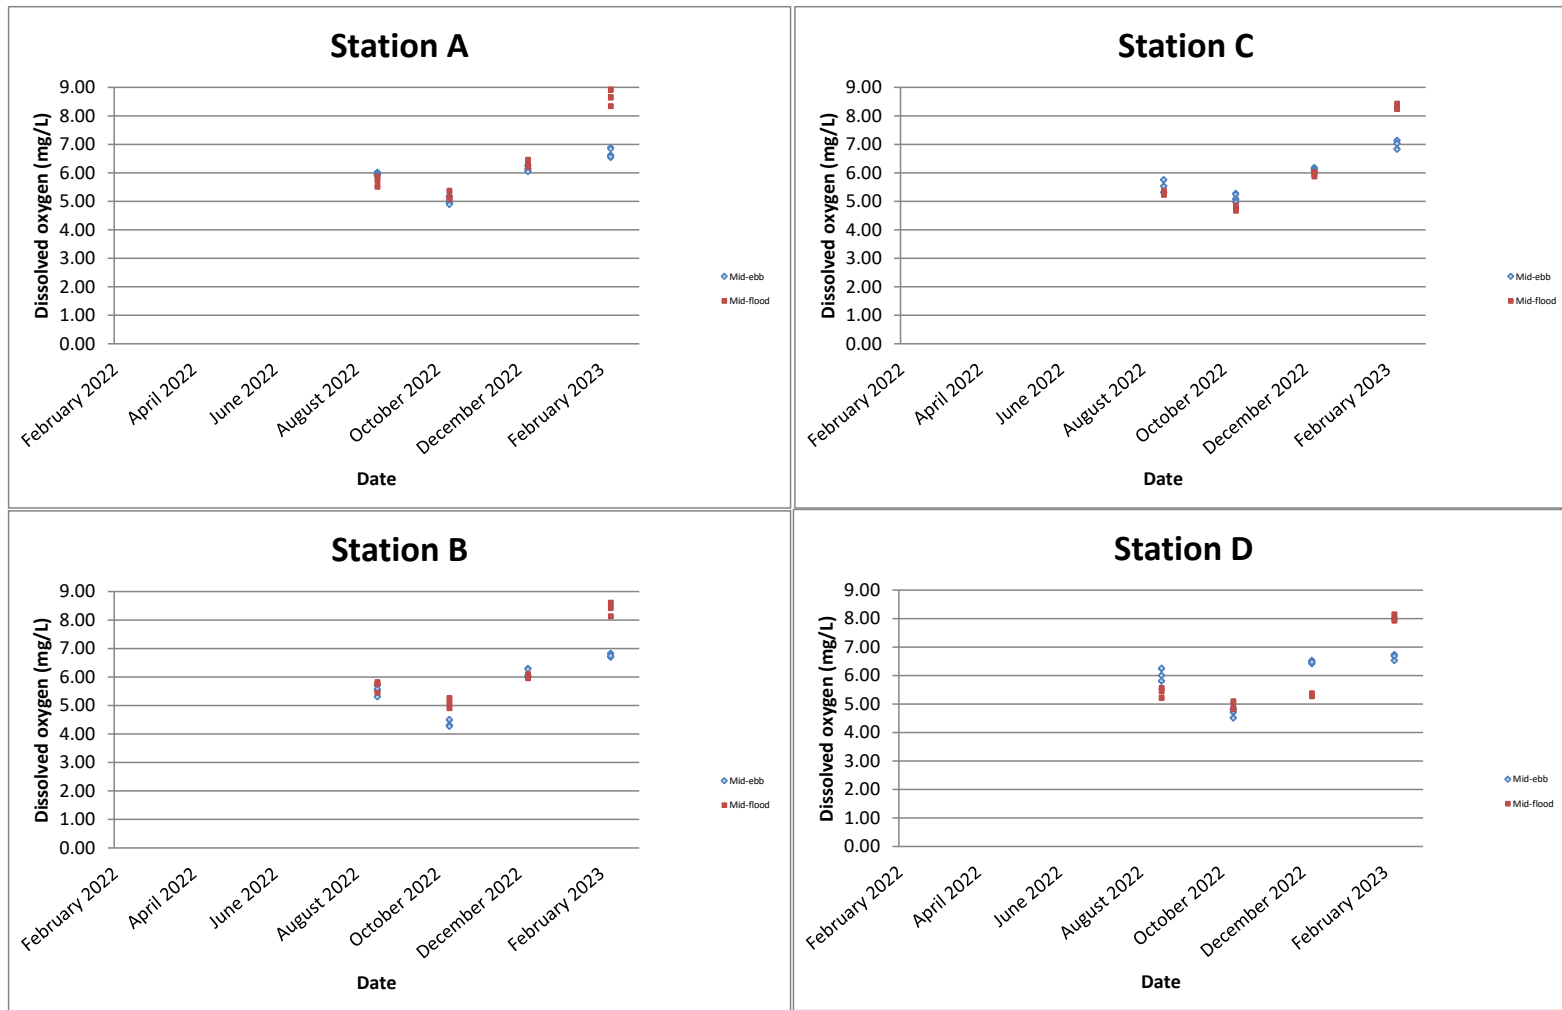


Dissolved oxygen (mg/L)

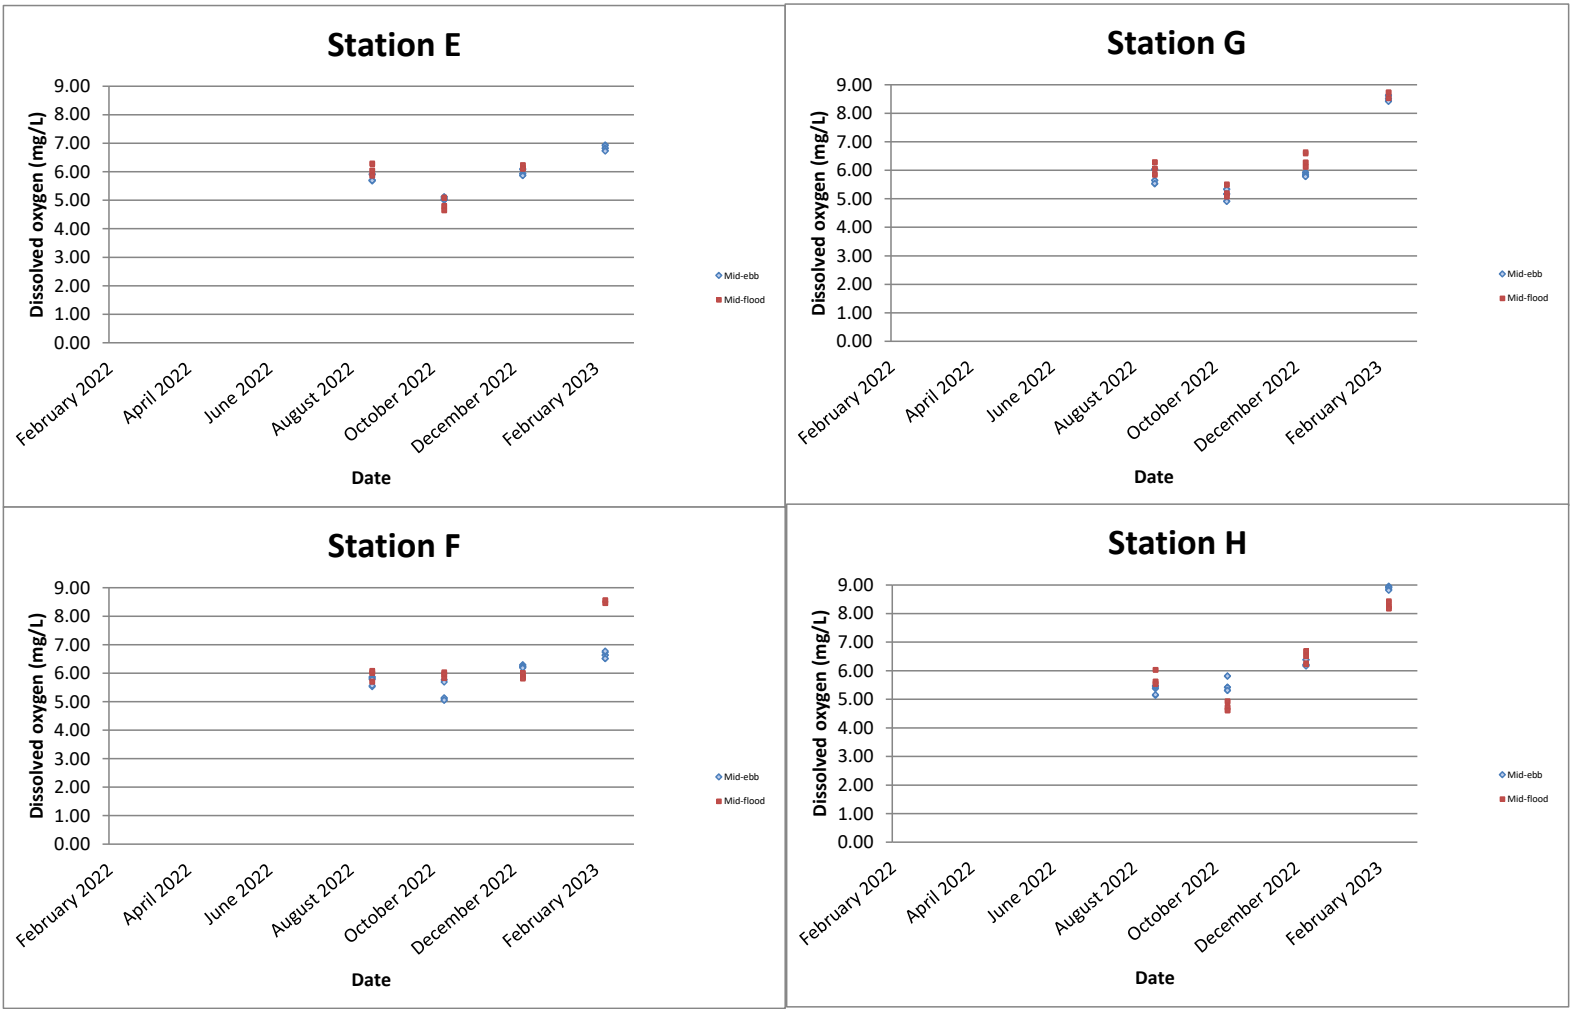


Turbidity (NTU)

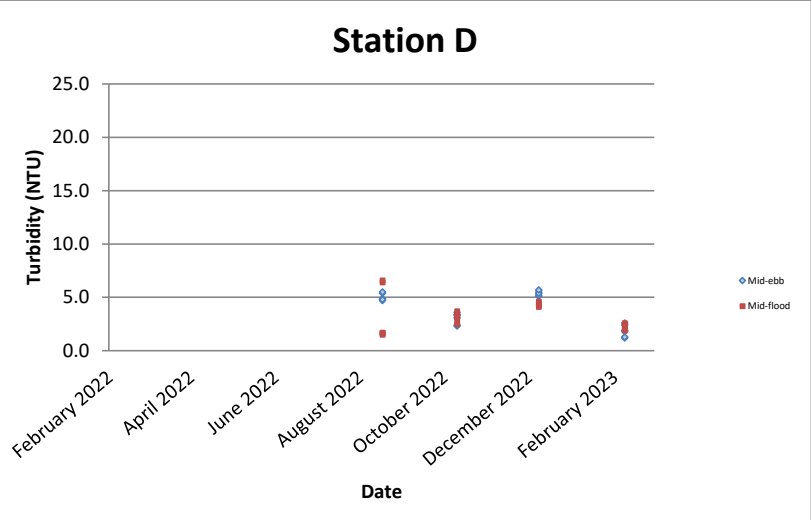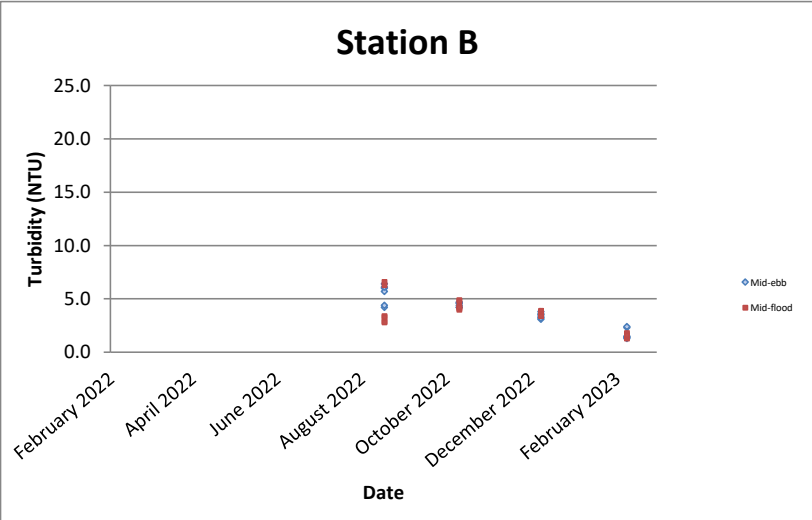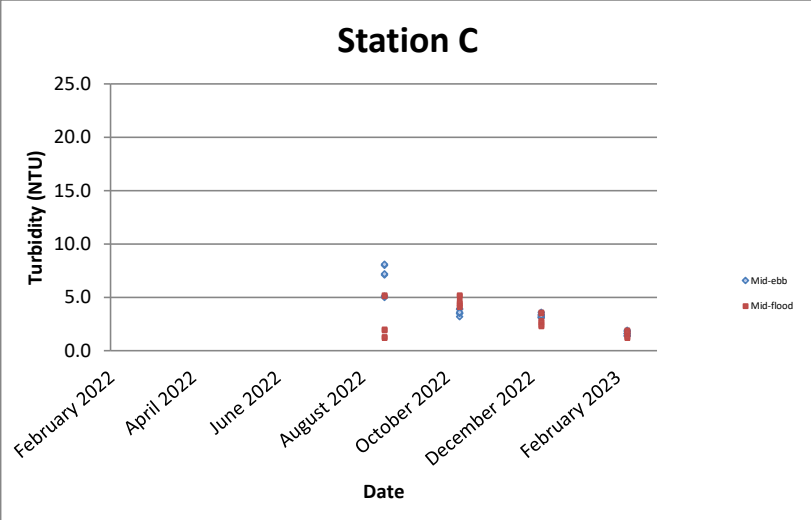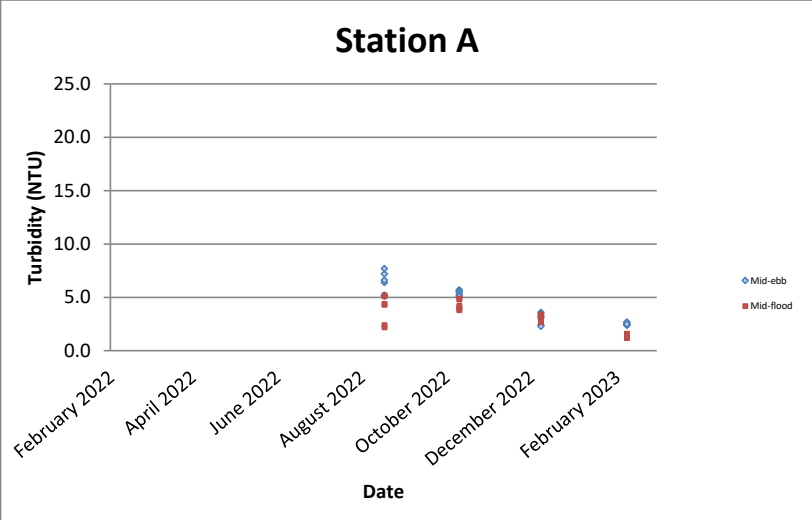

Turbidity (NTU)

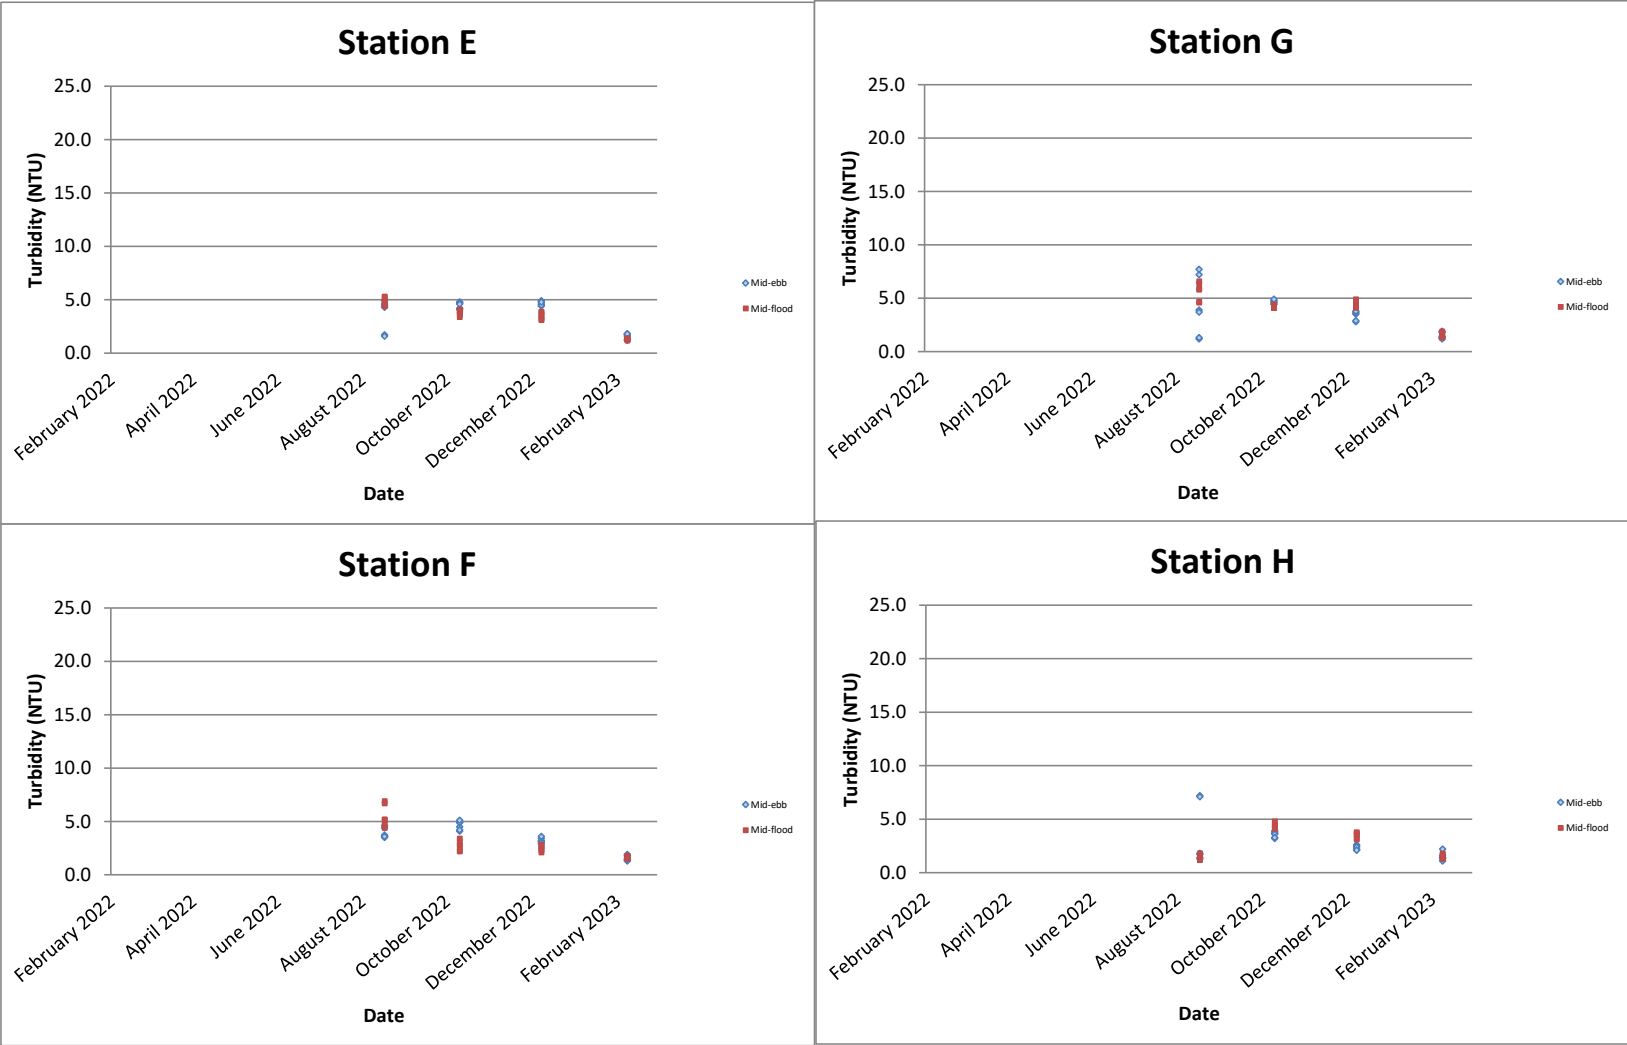


Total Suspended Solids (mg/L)

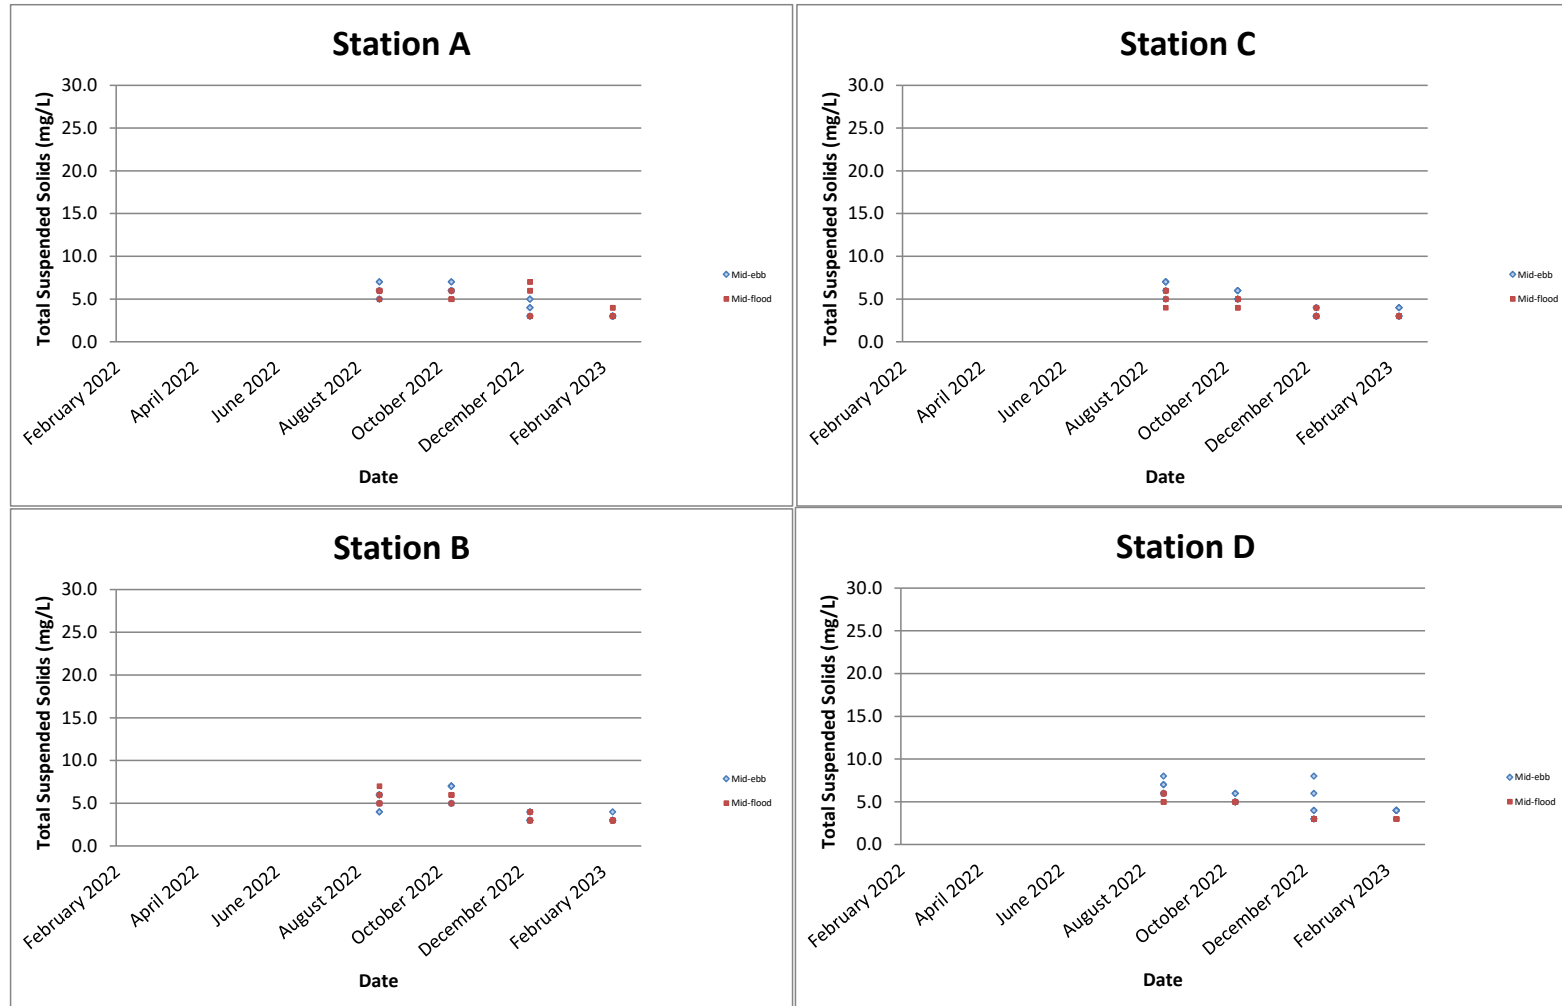

Remark: All below the Limit of Report sample results (<0.5 mg/L) for Total Suspended Solids is regarded as 0.5 mg/L in graphical presentation.




Total Suspended Solids (mg/L)

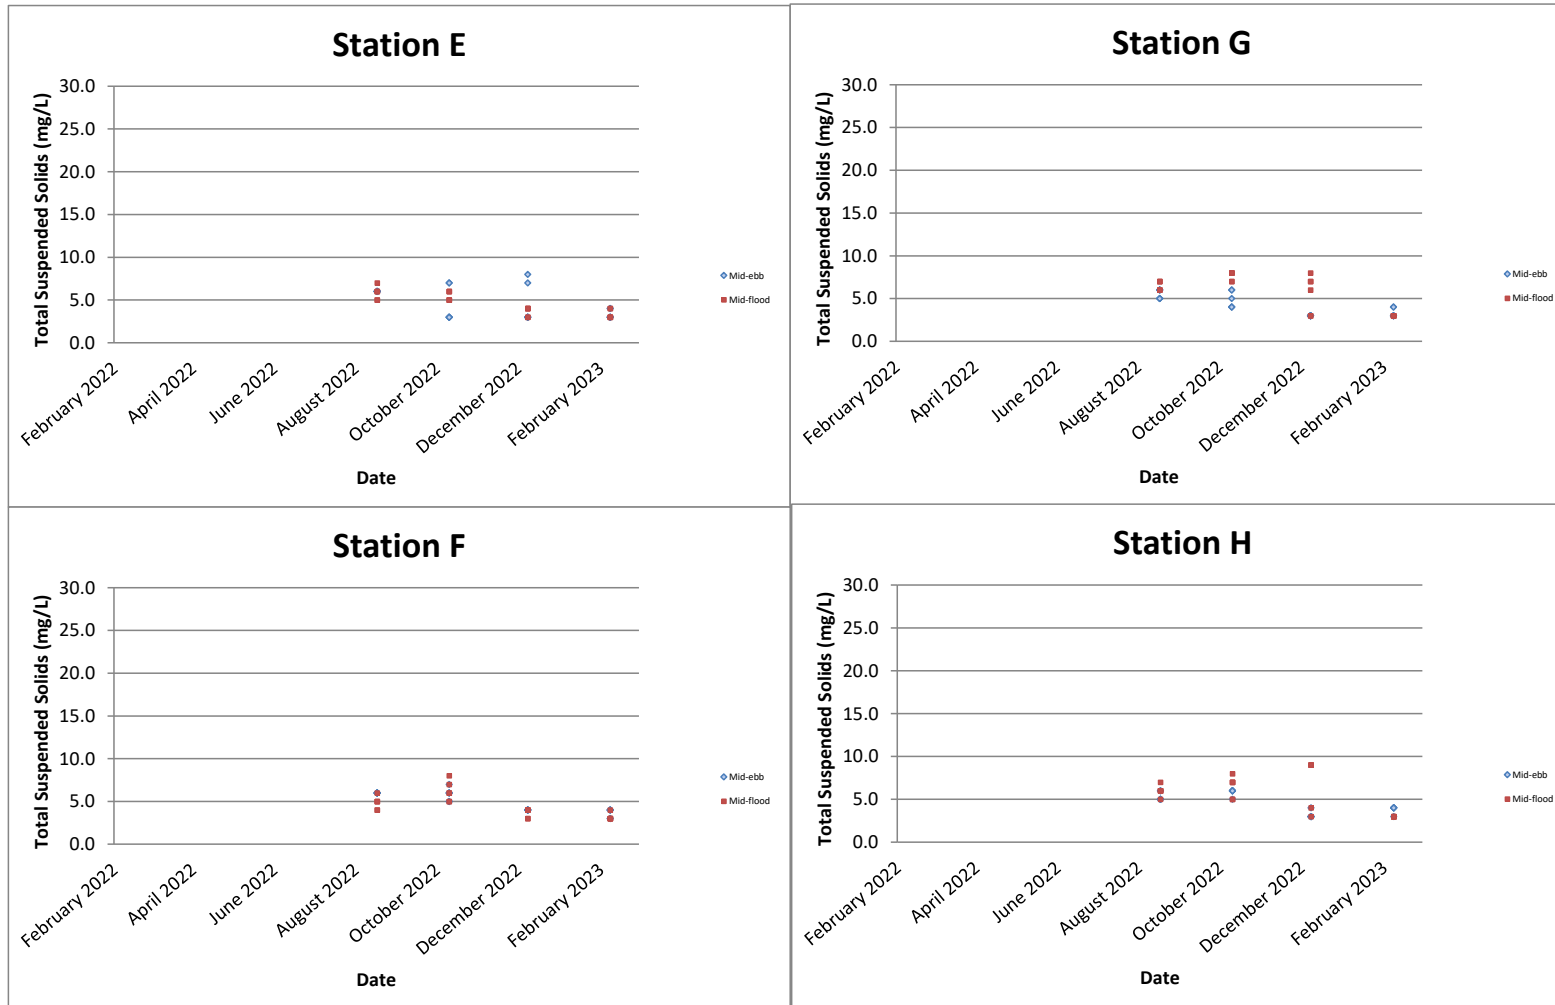


Remark: All below the Limit of Report sample results (<0.5 mg/L) for Total Suspended Solids is regarded as 0.5 mg/L in graphical presentation.

Ammonia Nitrogen (mg/L-N)

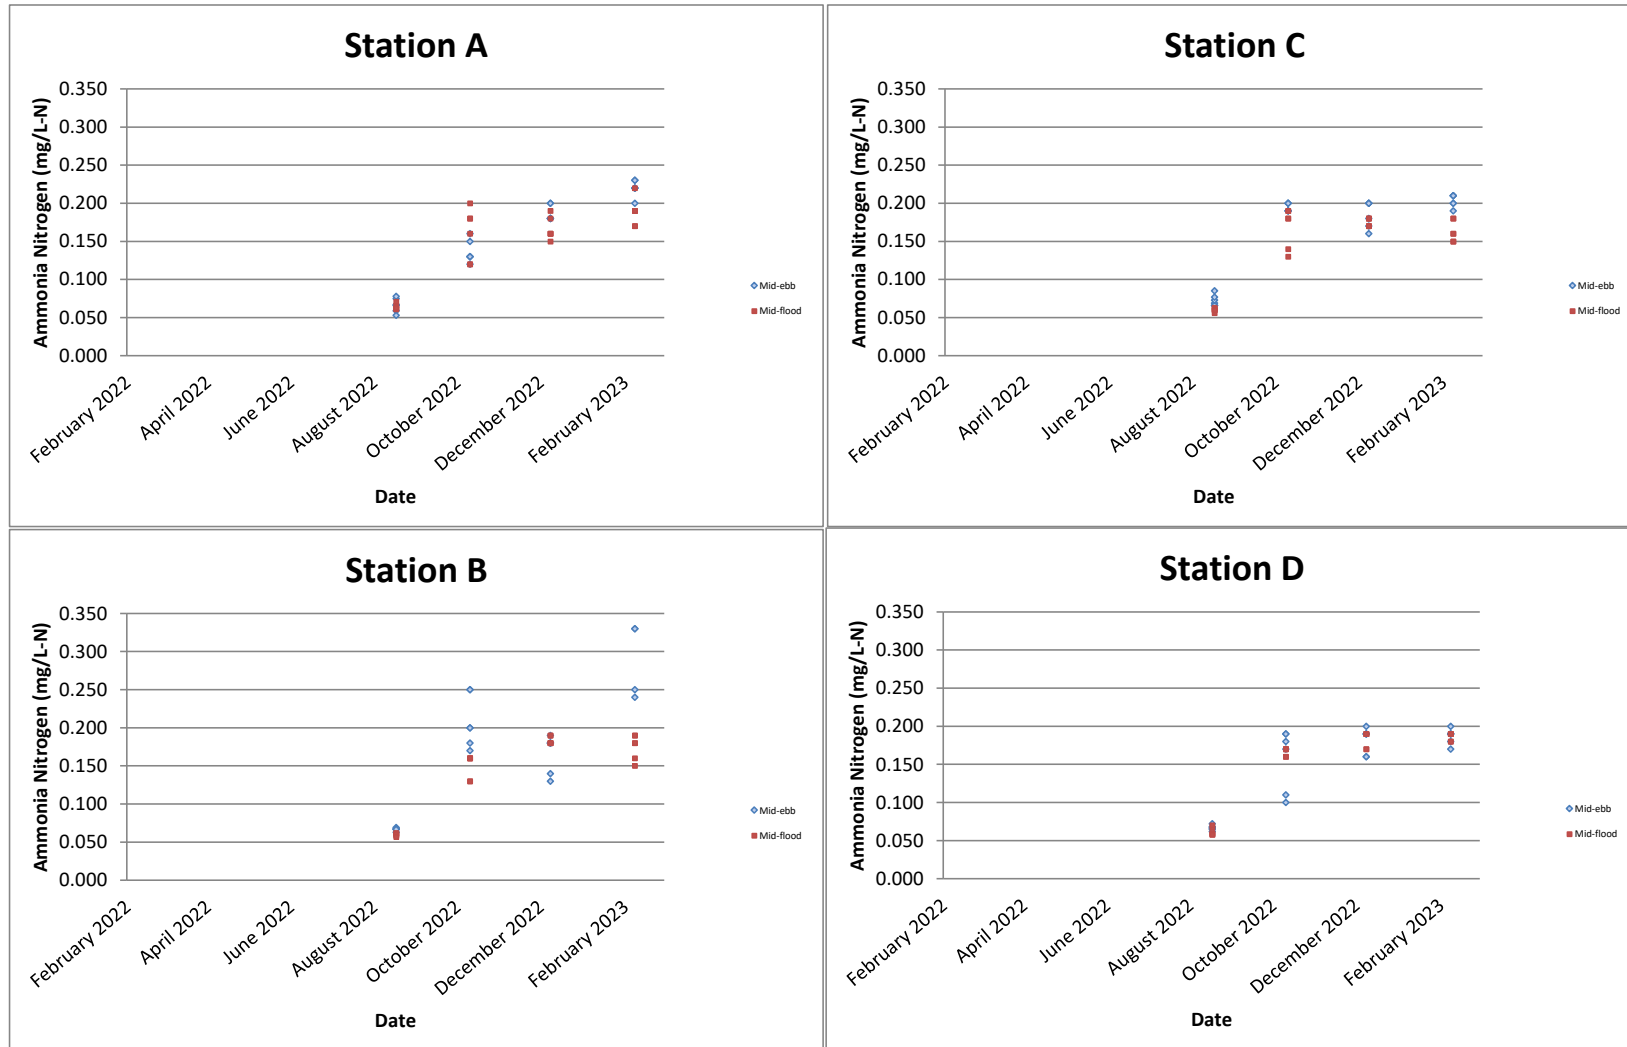


Remark: All below the Limit of Report sample results (<0.005 mg/L) for Ammonia Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Ammonia Nitrogen (mg/L-N)

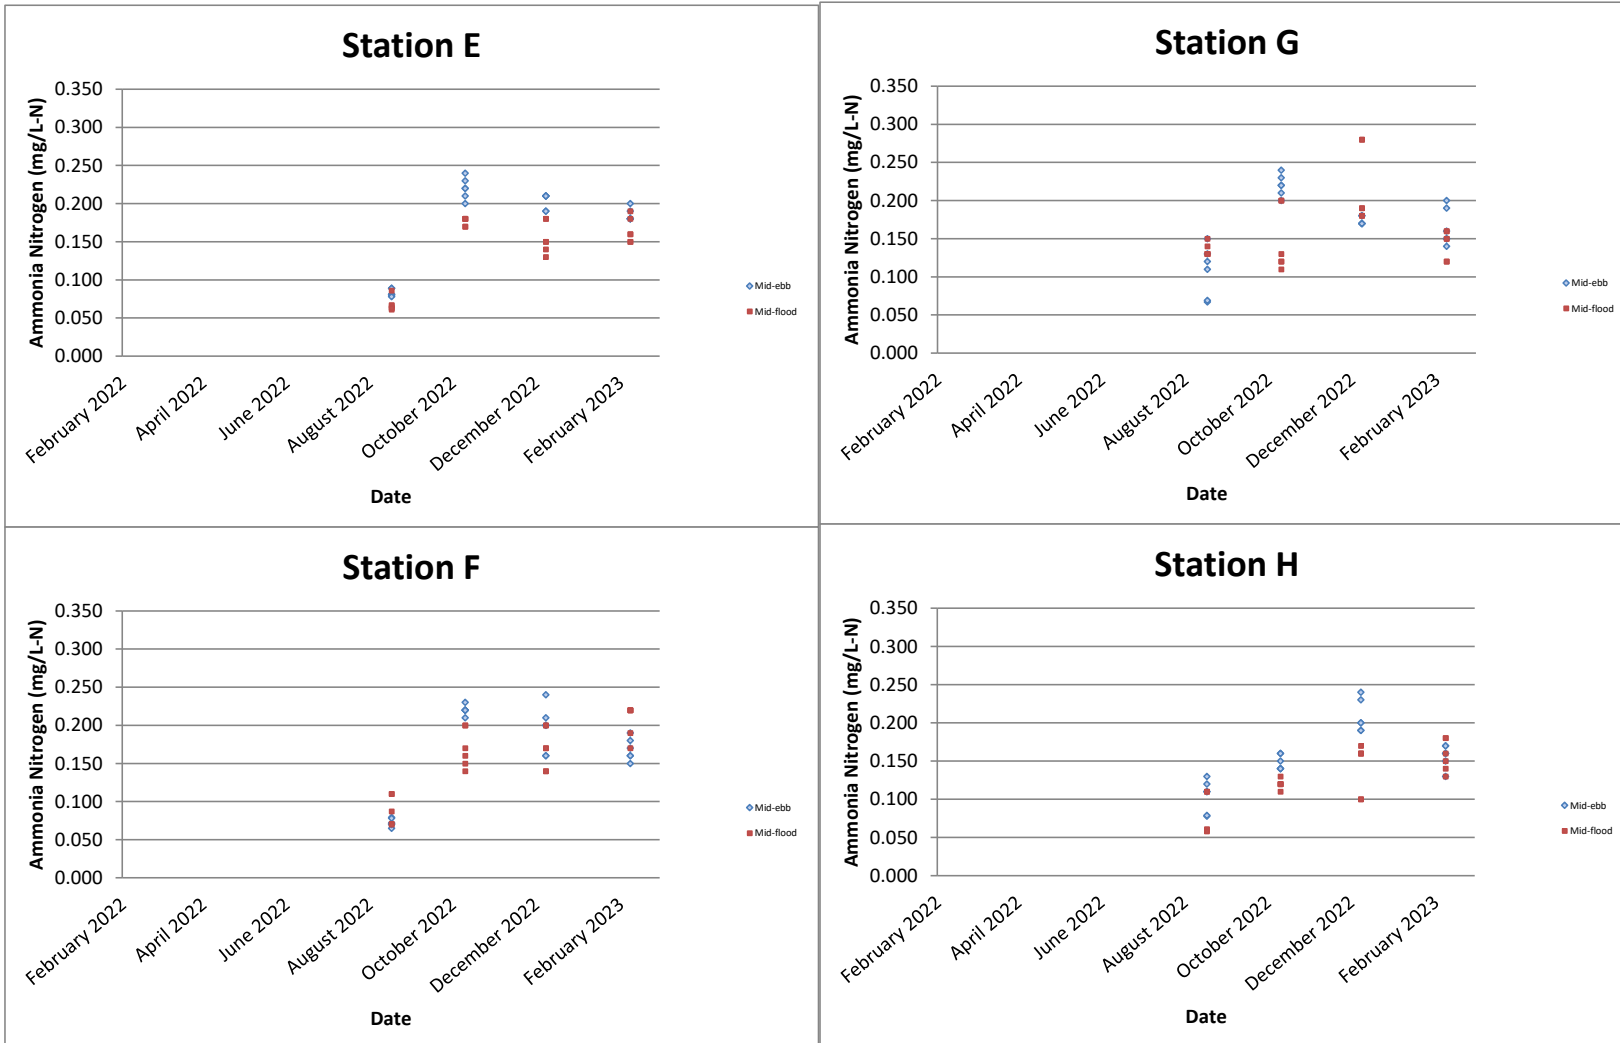


Remark: All below the Limit of Report sample results (<0.005 mg/L) for Ammonia Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Nitrite Nitrogen (mg/L-N)

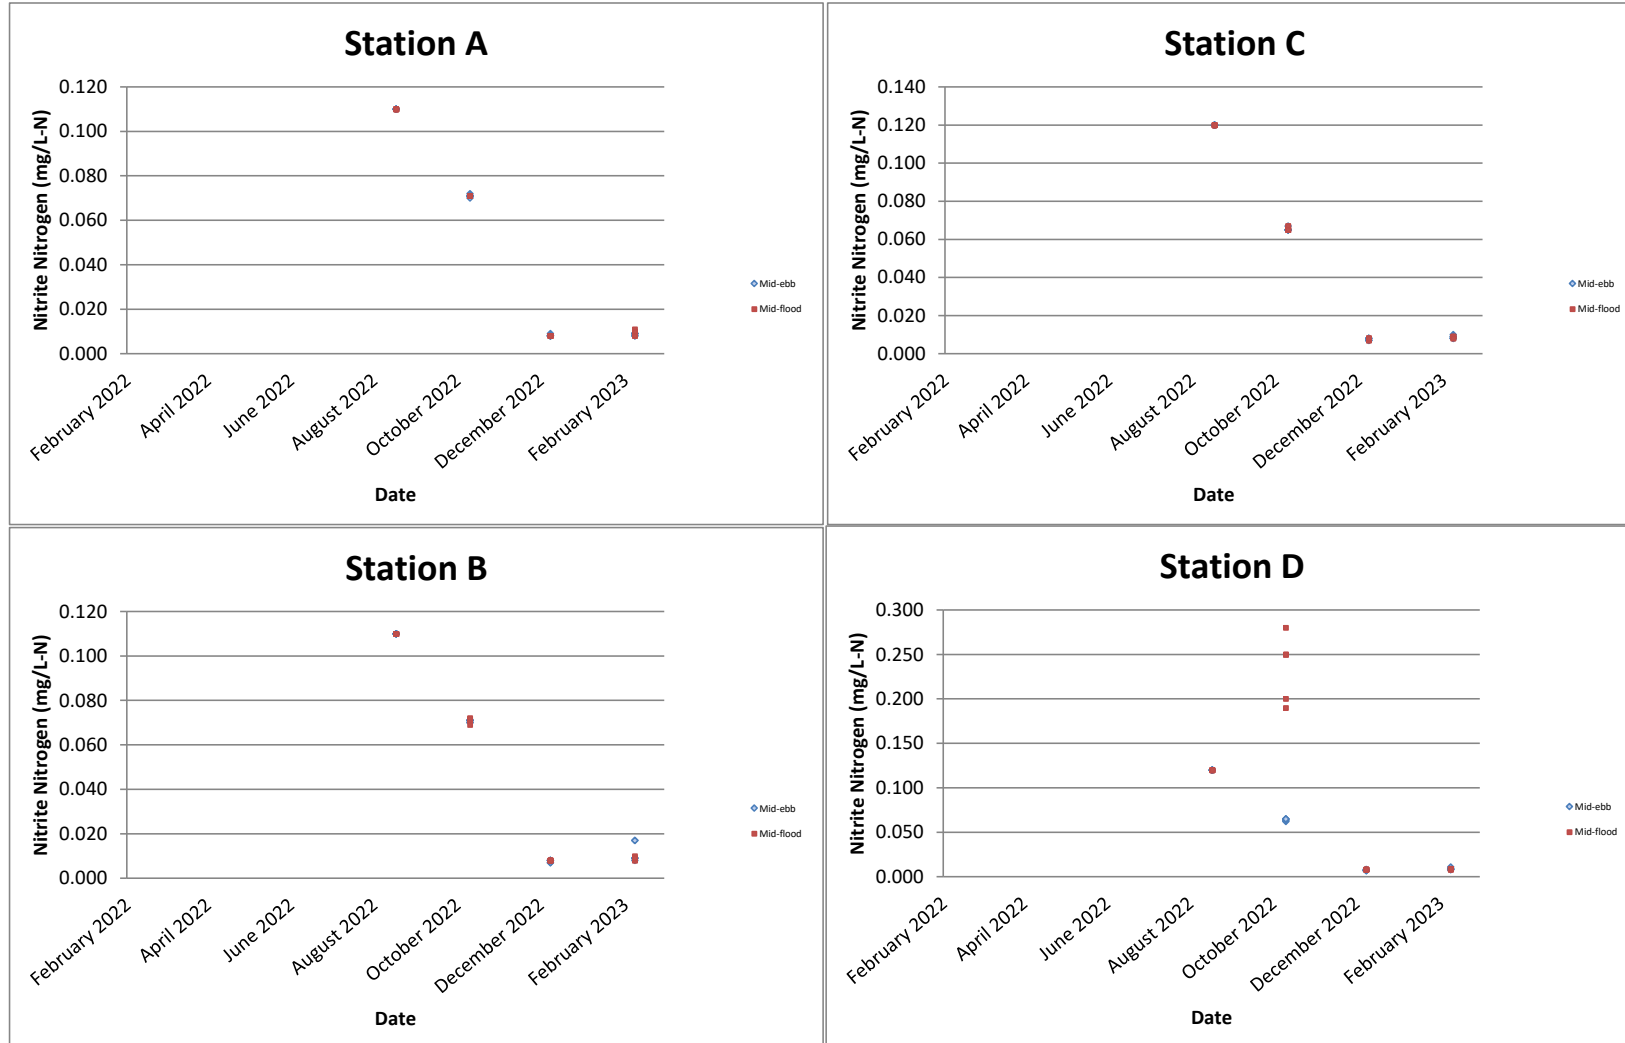


Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrite Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Nitrite Nitrogen (mg/L-N)

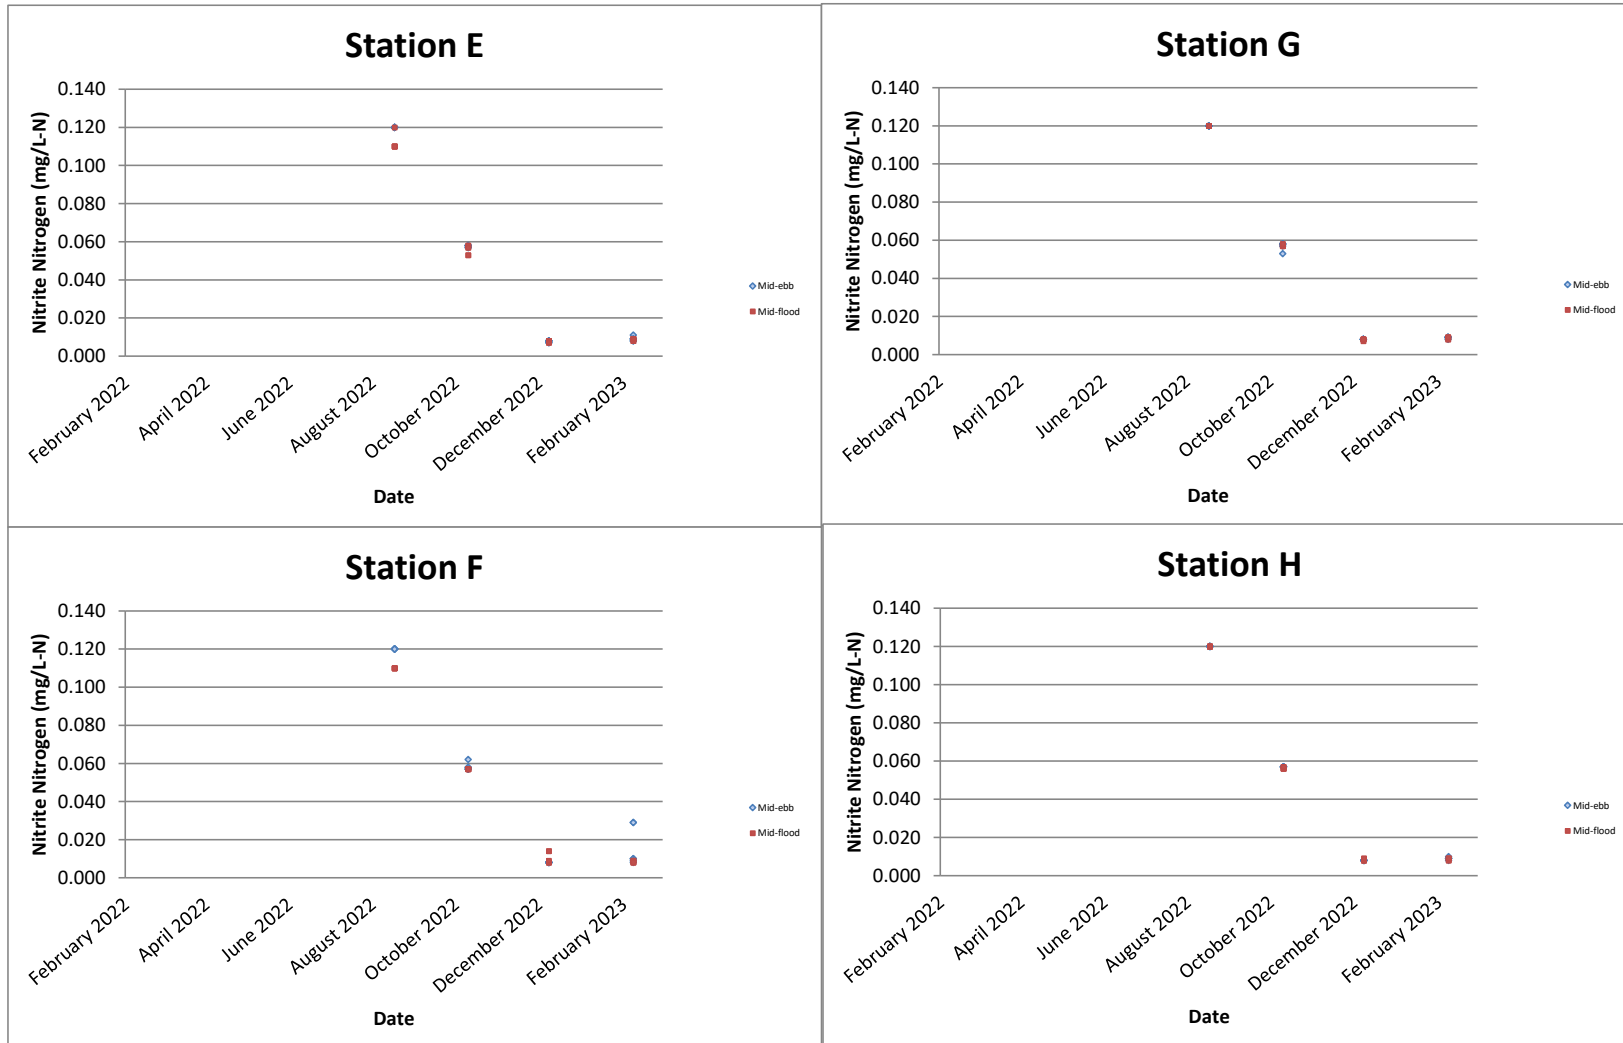


Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrite Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Nitrate Nitrogen (mg/L-N)

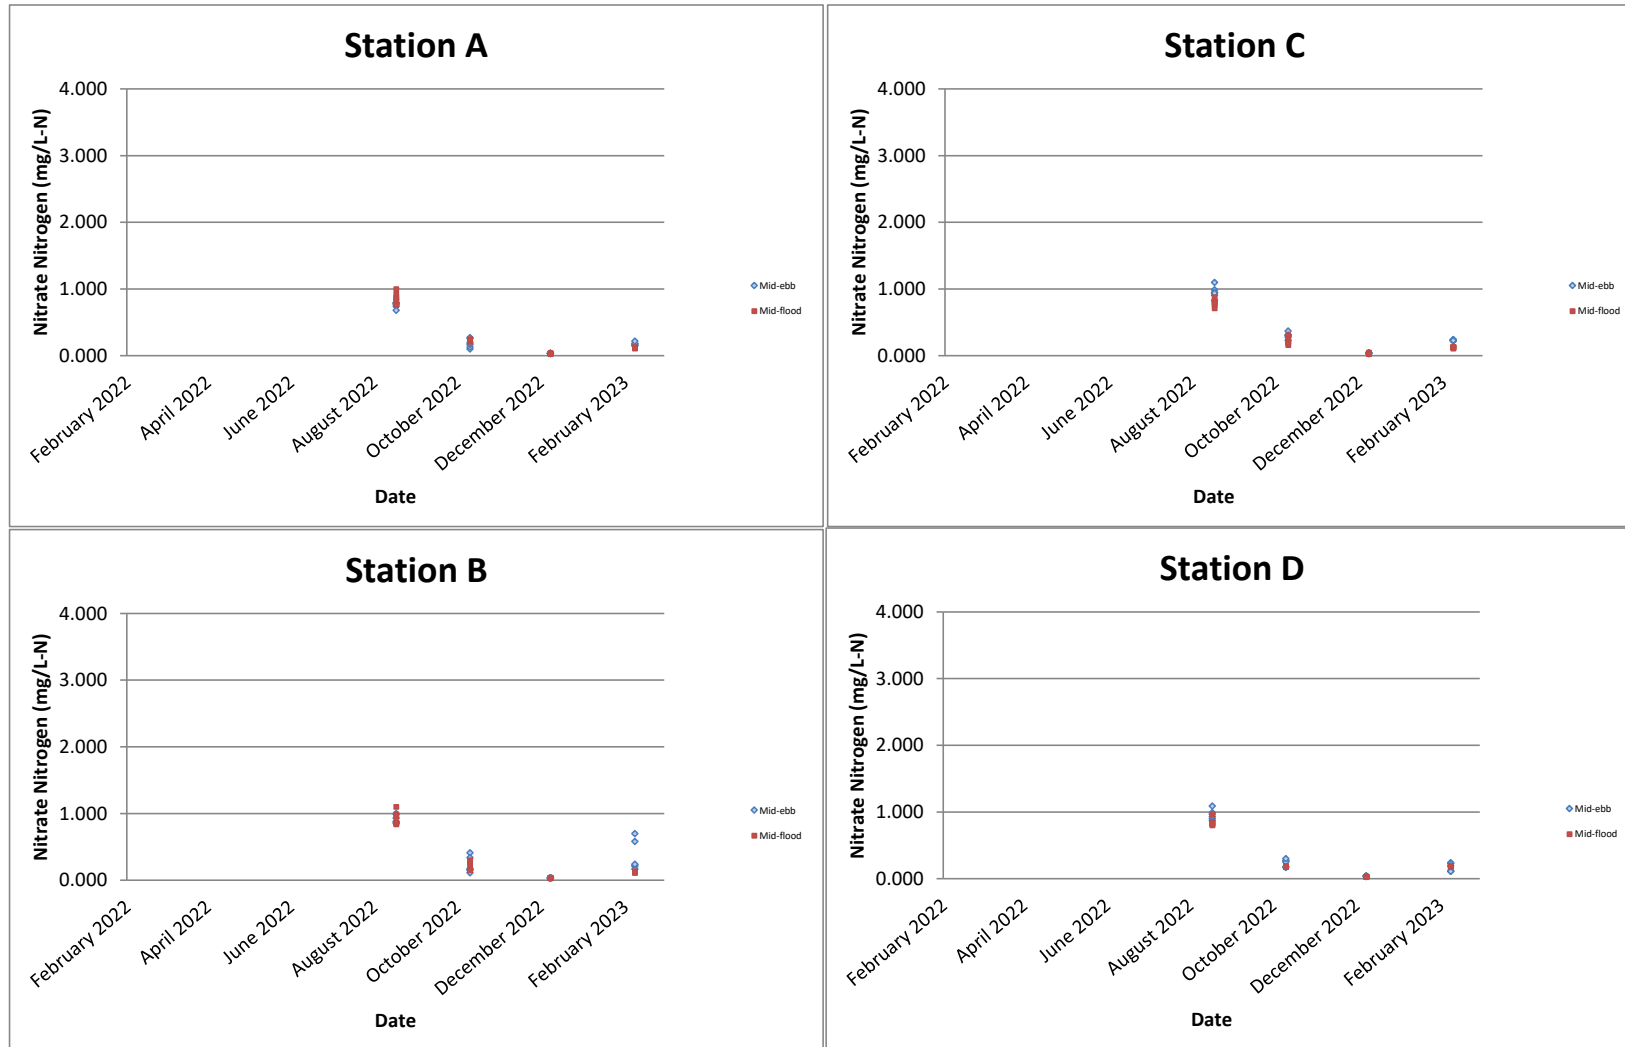





Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrate Nitrogen is regarded as 0.005 mg/L in graphical presentation.

Nitrate Nitrogen (mg/L-N)

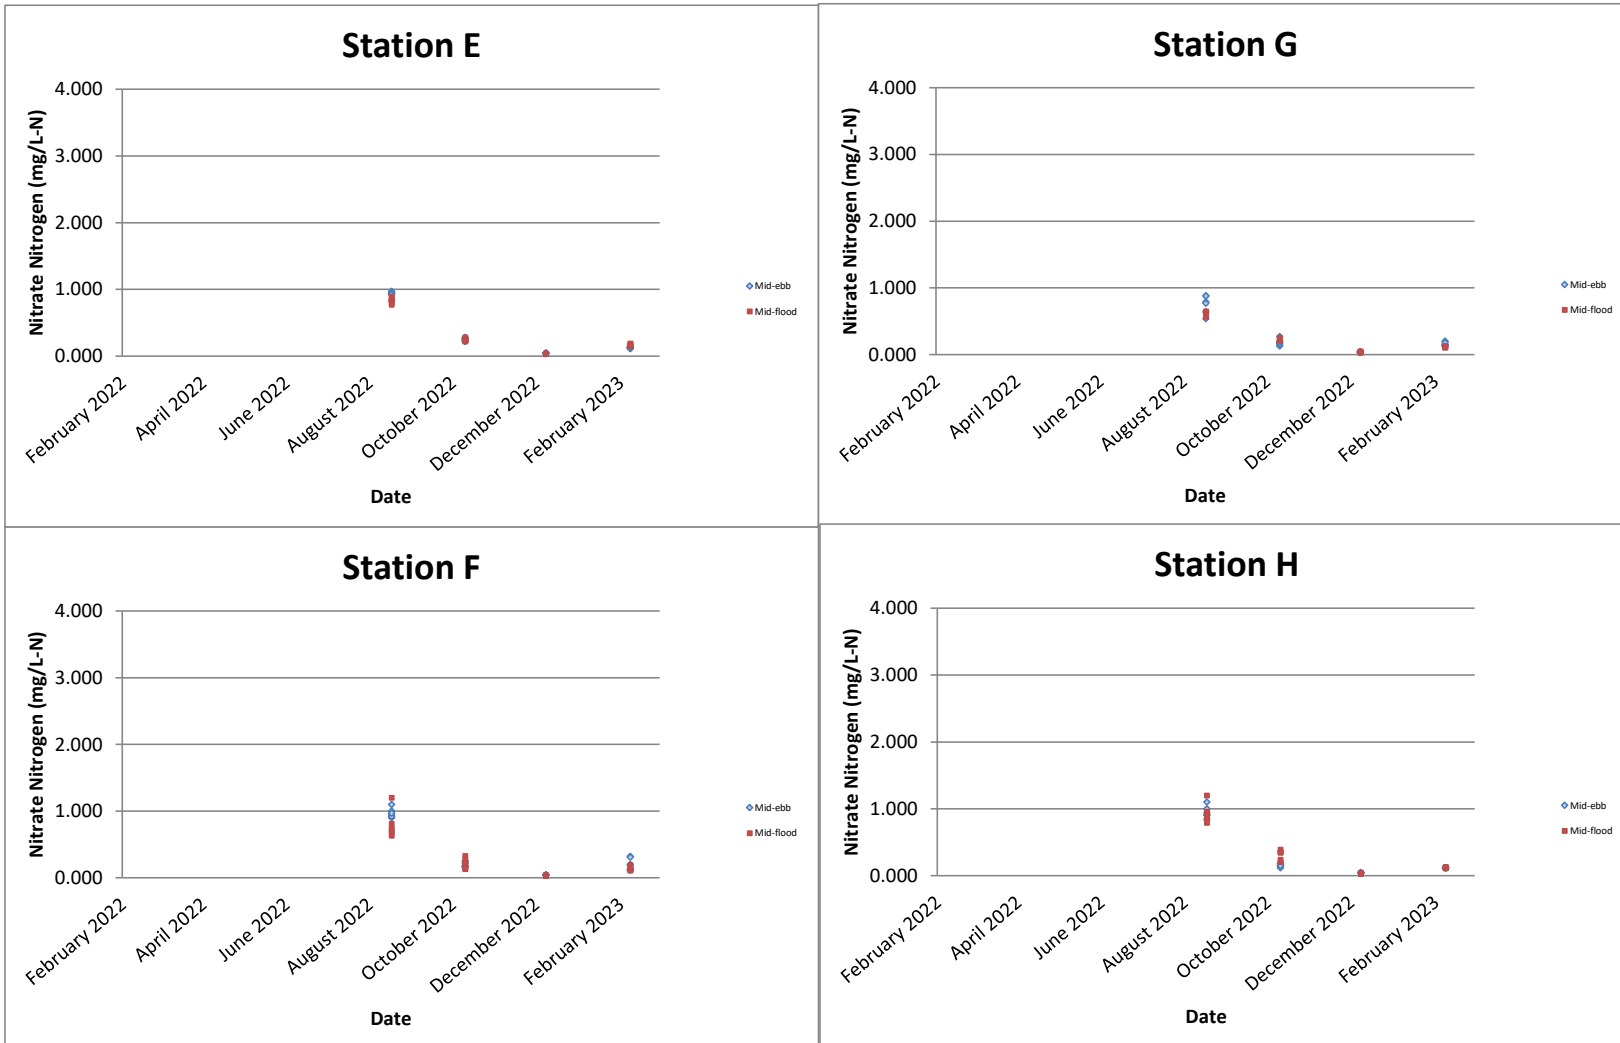

Remark: All below the Limit of Report sample results (<0.005 mg/L) for Nitrate Nitrogen is regarded as 0.005 mg/L in graphical presentation.


Total Inorganic Nitrogen (mg/L-N)

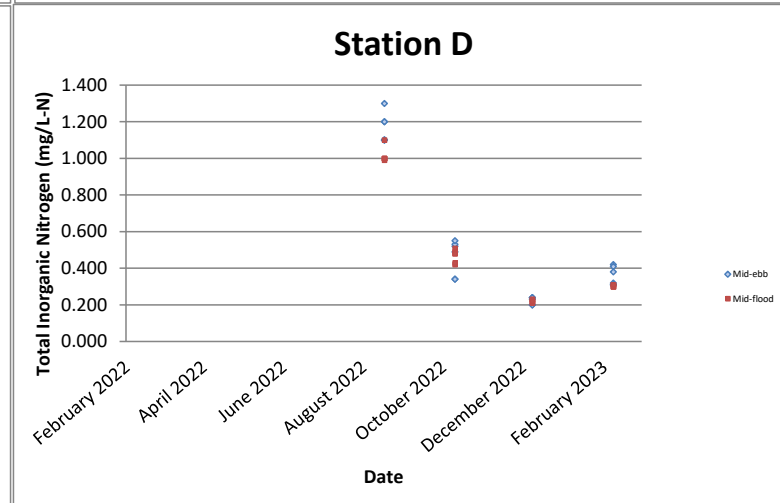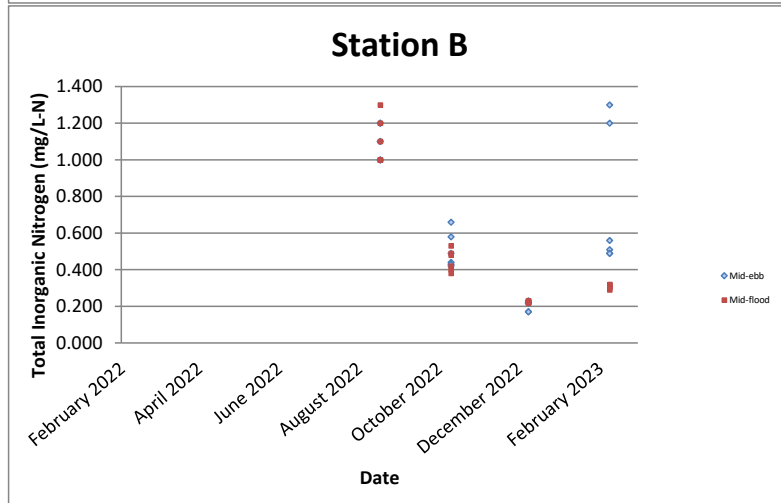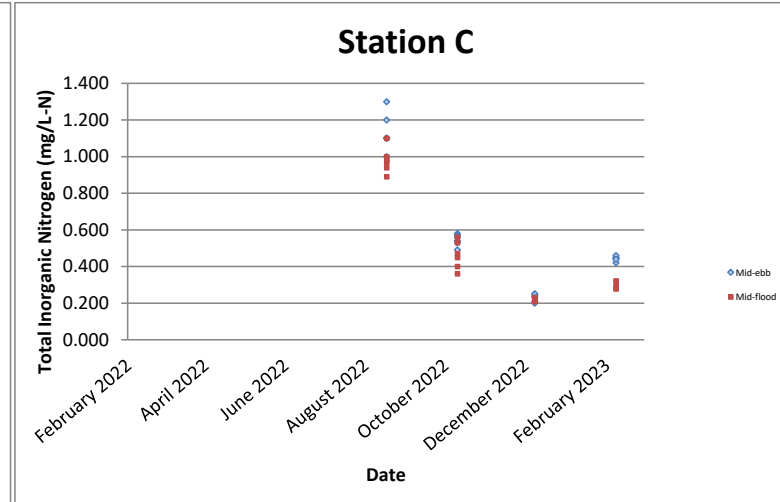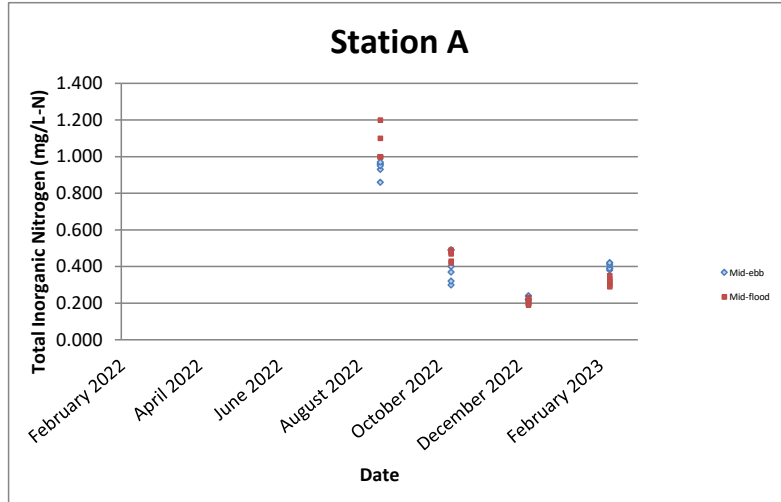

Remark: All below the Limit of Report sample results (<0.010 mg/L) for Total Inorganic Nitrogen is regarded as 0.010 mg/L in graphical presentation.




Total Inorganic Nitrogen (mg/L-N)

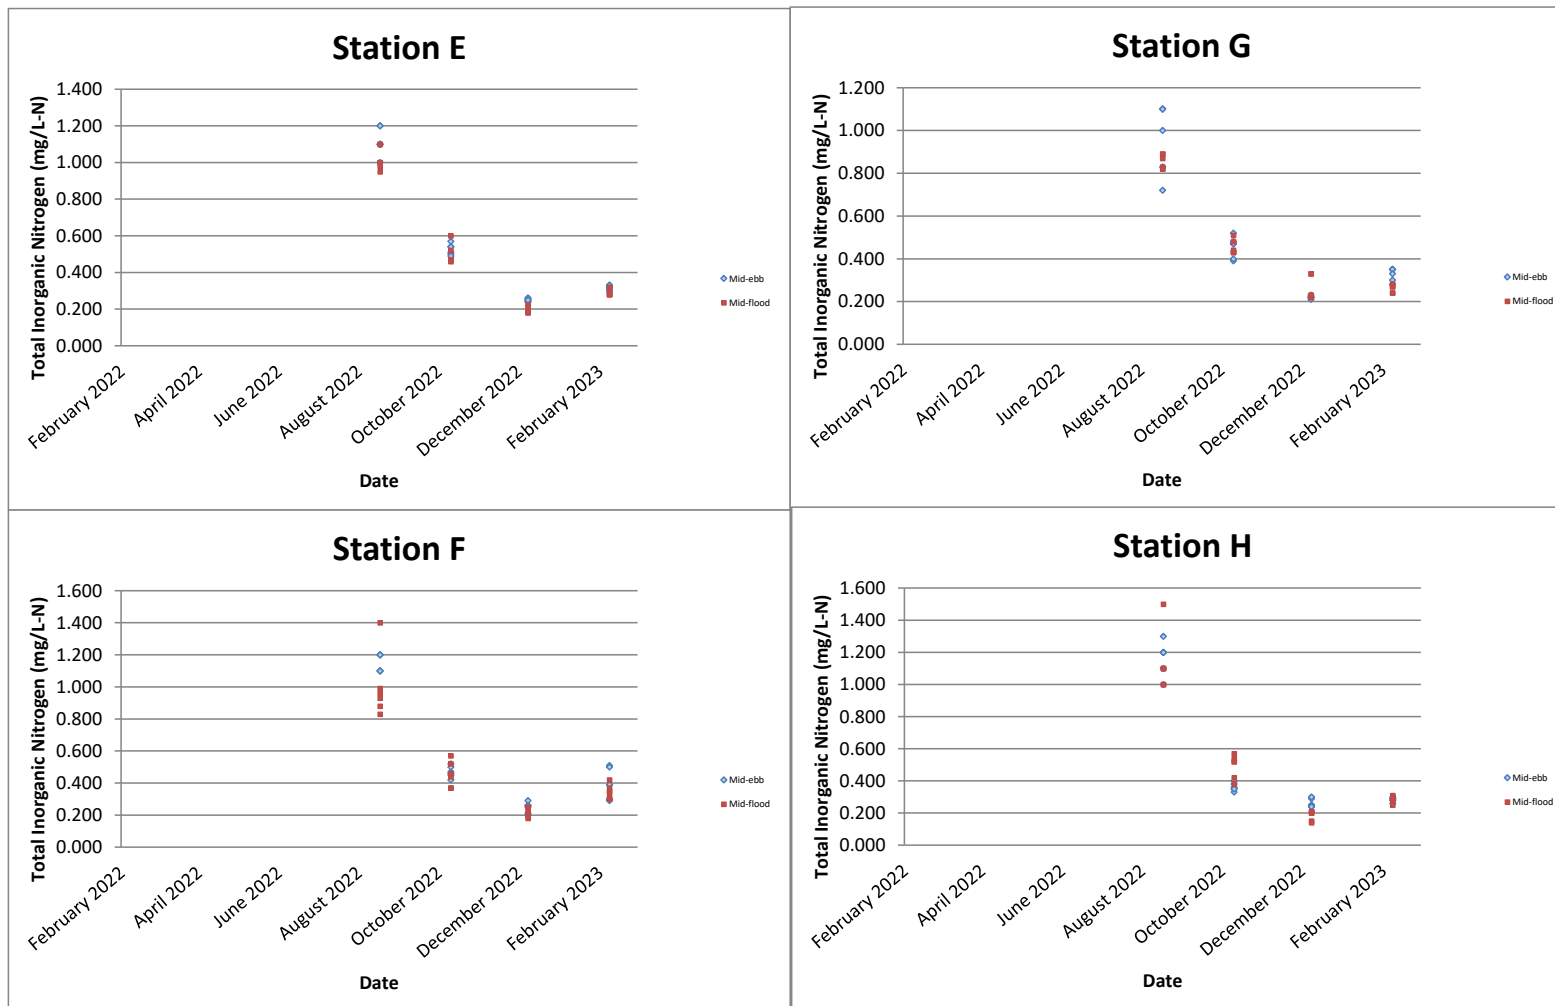


Remark: All below the Limit of Report sample results (<0.010 mg/L) for Total Inorganic Nitrogen is regarded as 0.010 mg/L in graphical presentation.

E.coli (cfu/100mL)

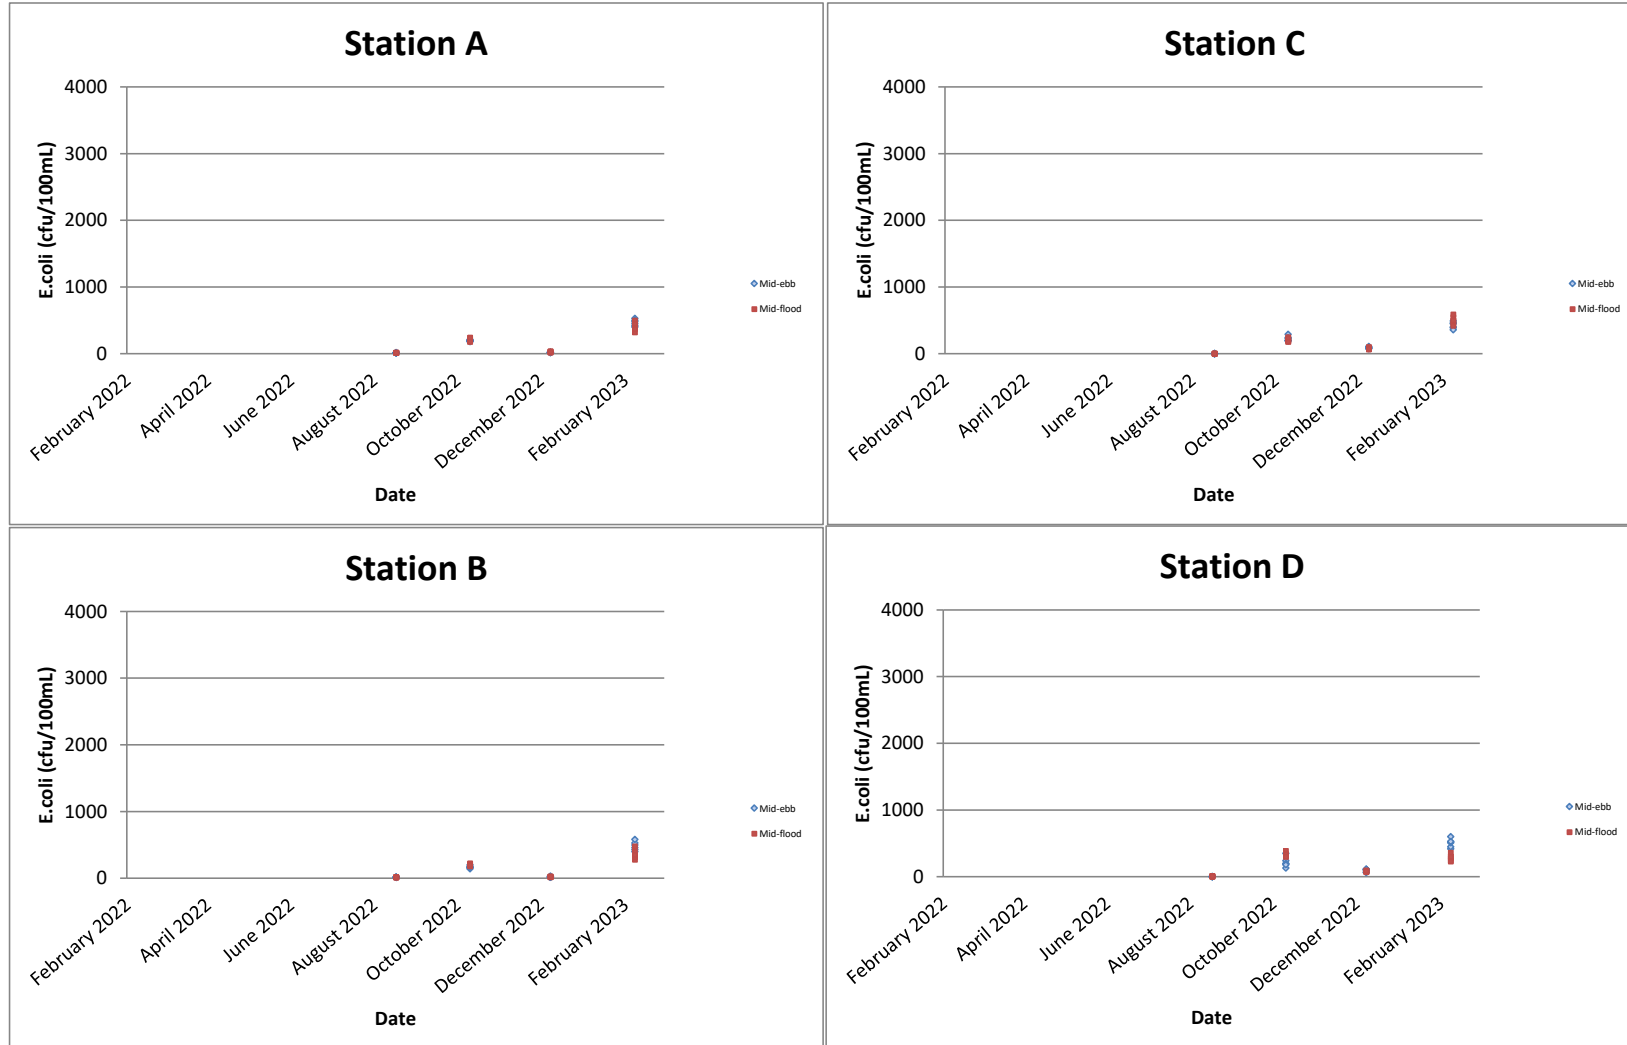





Remark: All below the Limit of Report sample results (<1 CFU/100mL) for E.coli is regarded as 1 CFU/100mL in graphical presentation.

E.coli (cfu/100mL)

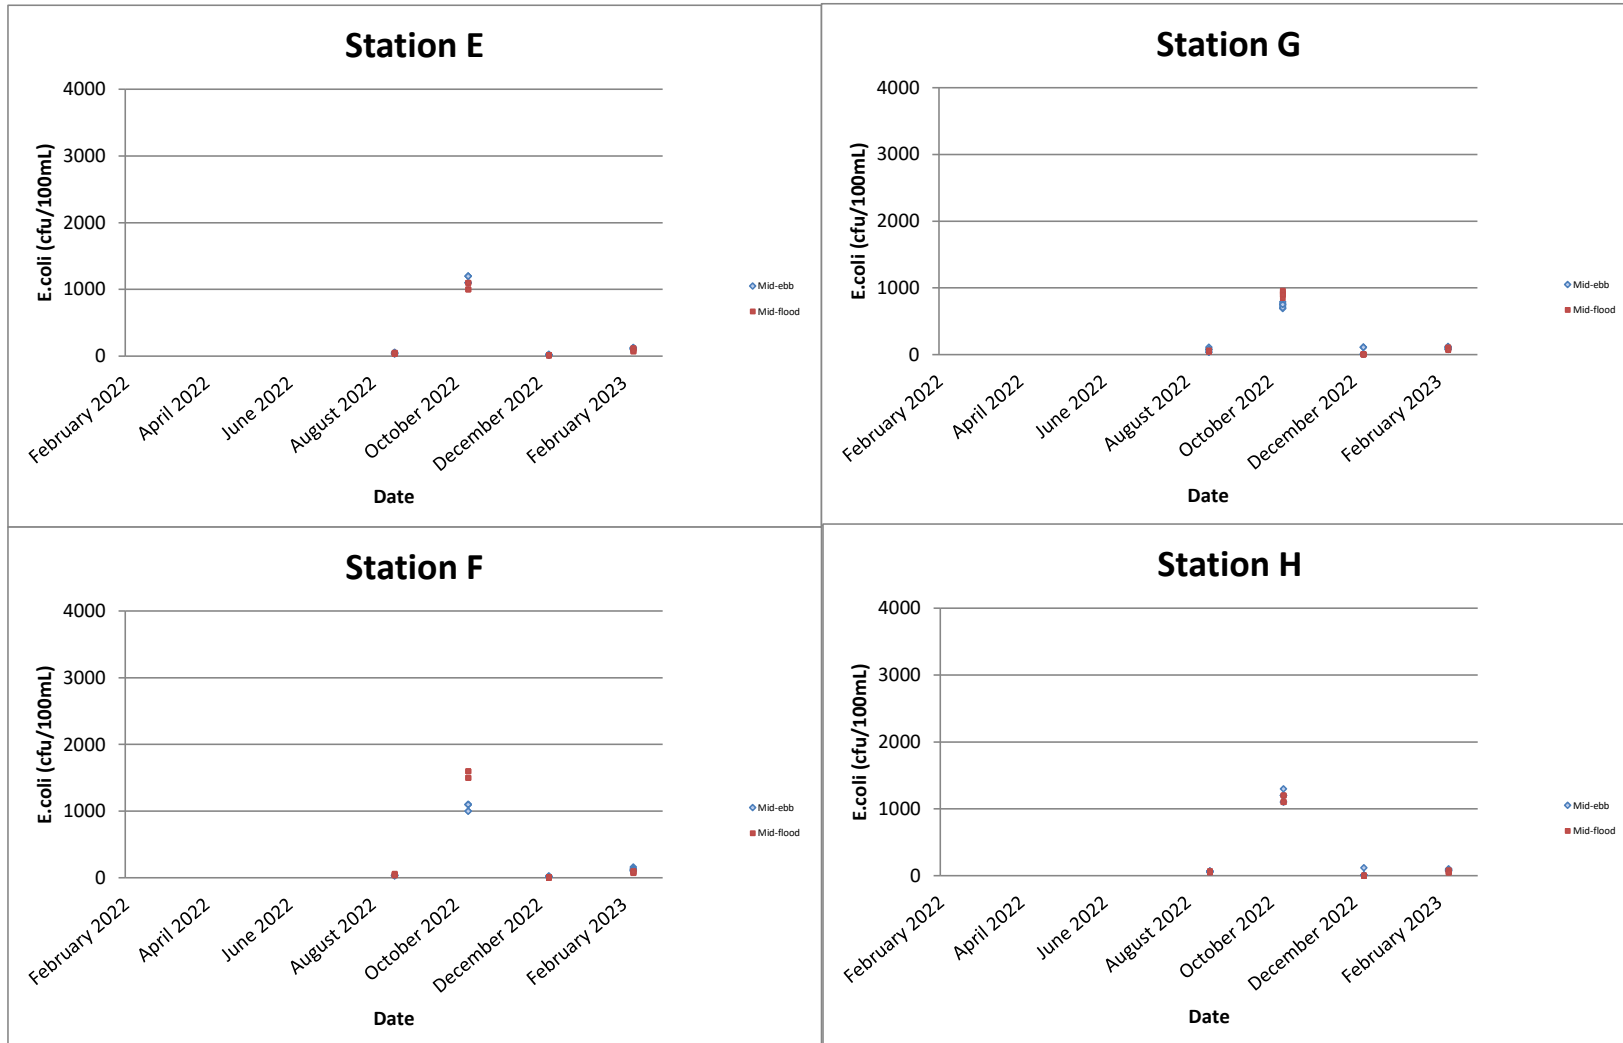


Remark: All below the Limit of Report sample results (<1 CFU/100mL) for E.coli is regarded as 1 CFU/100mL in graphical presentation.

Total Phosphorus (soluble and particulate) (mg/L)

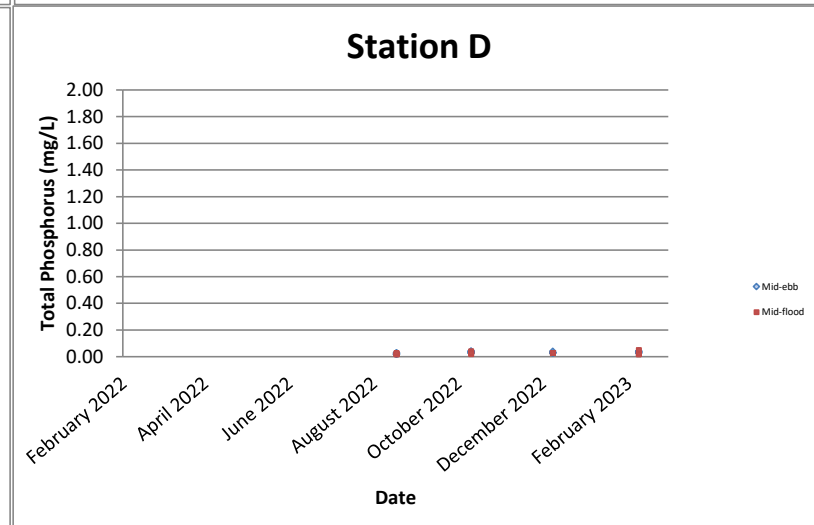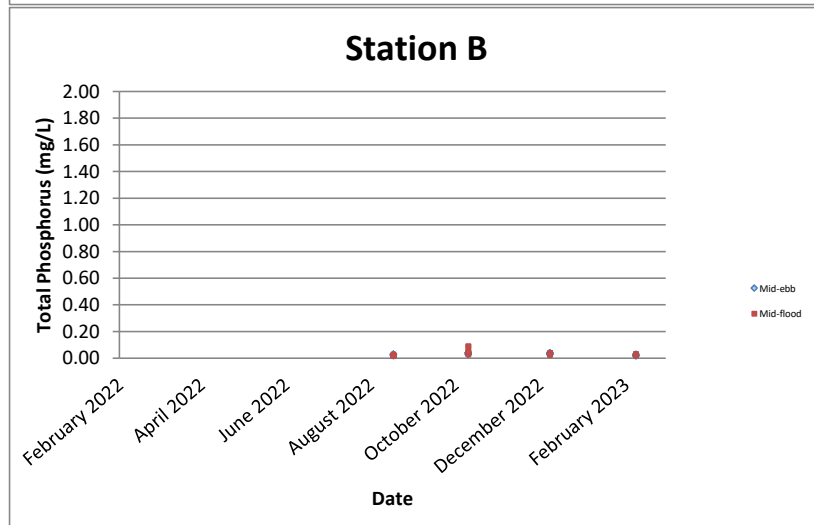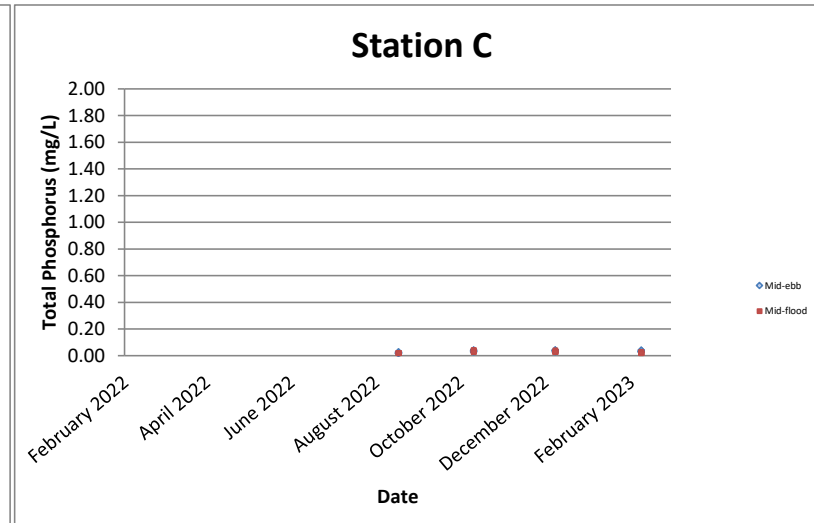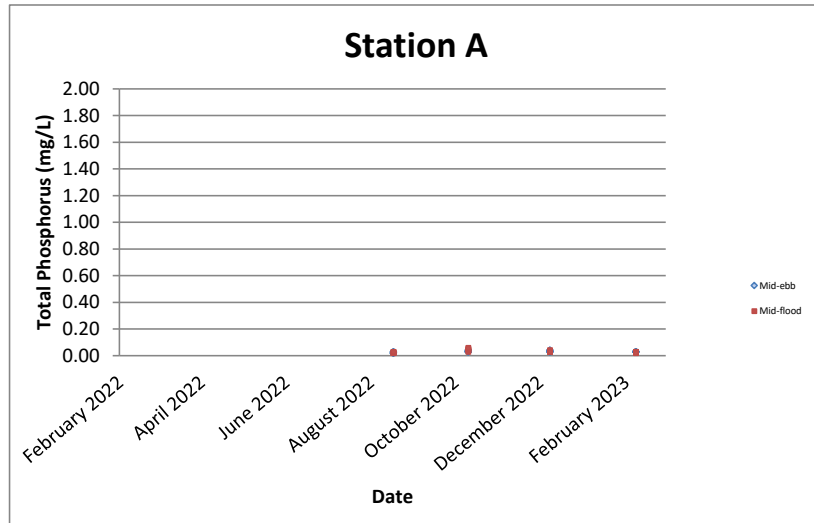


Remark: All below the Limit of Report sample results (<0.01 mg/L) for Total Phosphorus is regarded as 0.01 mg/L in graphical presentation.

Total Phosphorus (soluble and particulate) (mg/L)

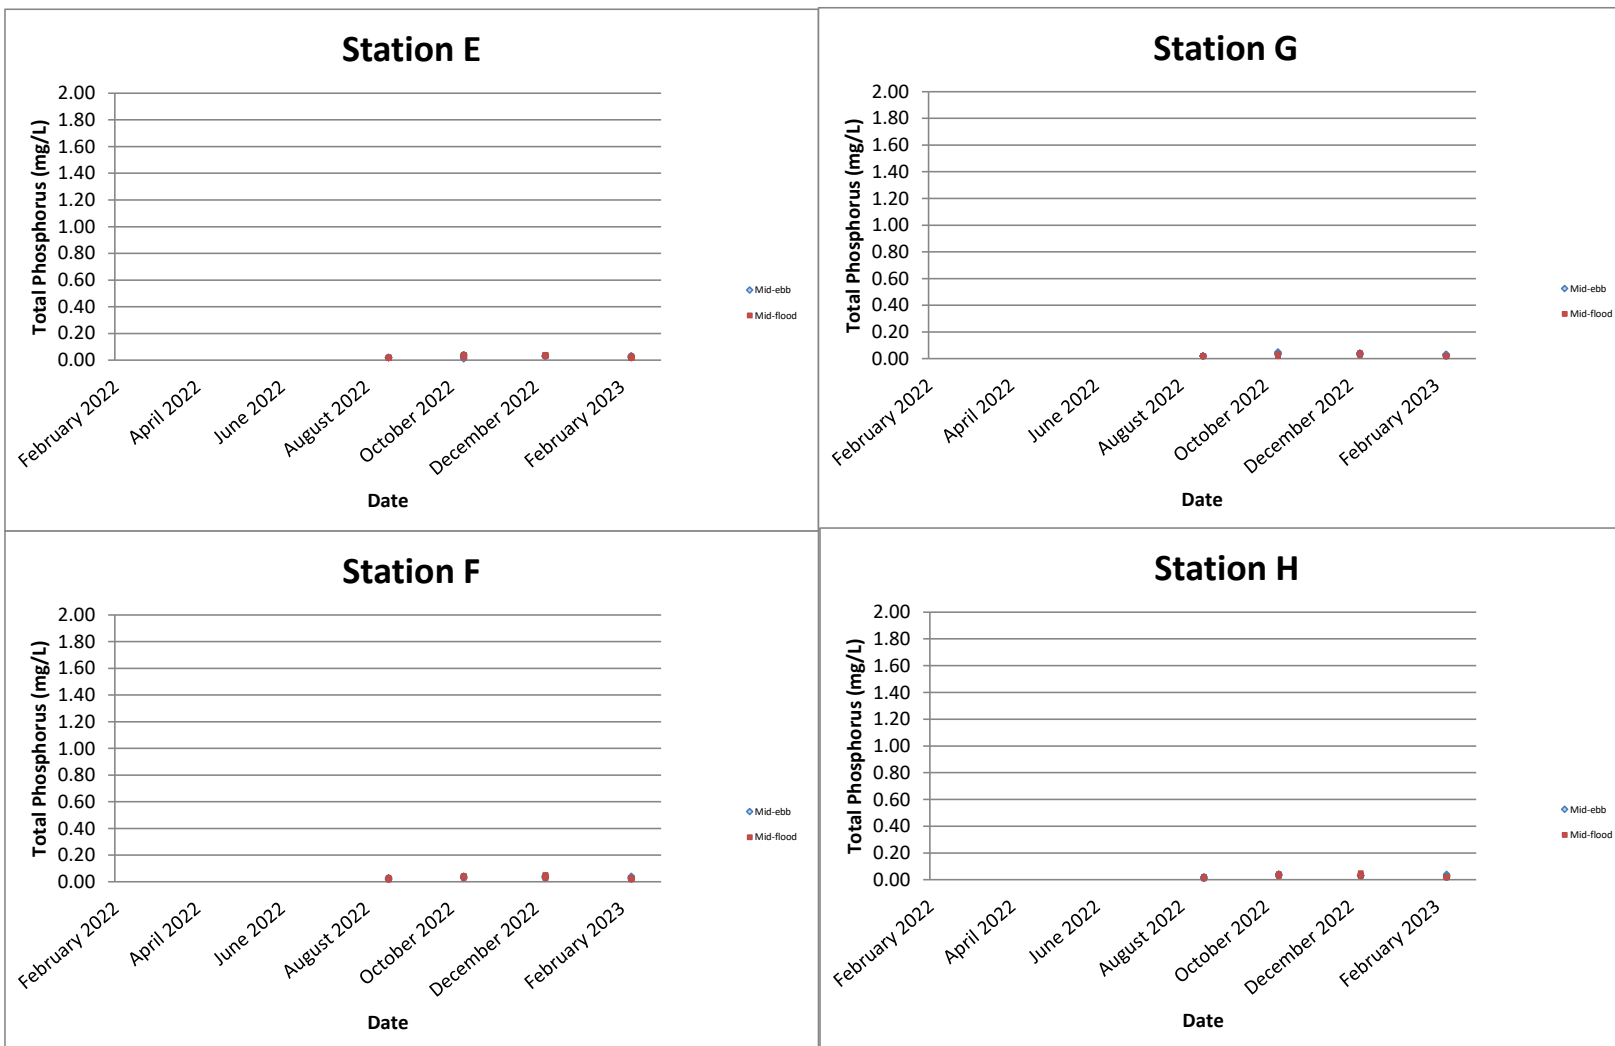


Remark: All below the Limit of Report sample results (<0.01 mg/L) for Total Phosphorus is regarded as 0.01 mg/L in graphical presentation.

# BOD<sub>5</sub> (mg/L)

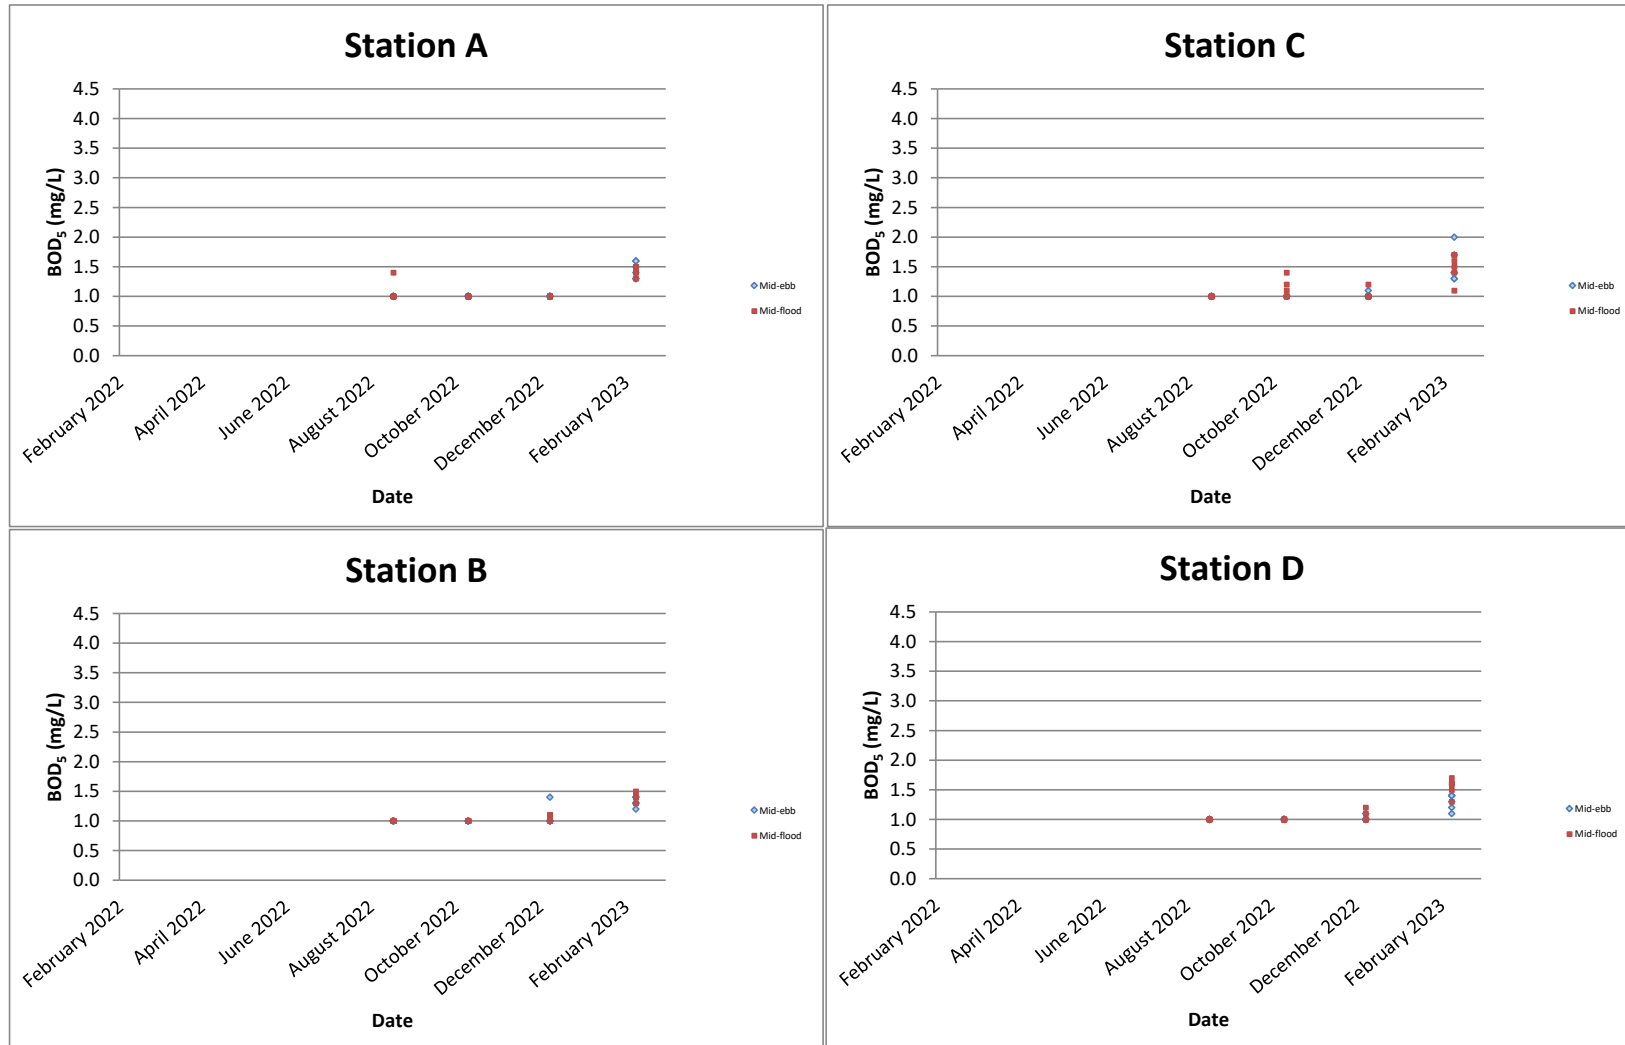

Remark: All below the Limit of Report sample results (<1.0 mg/L) for BOD<sub>5</sub> is regarded as 1.0 mg/L in graphical presentation.

BOD<sub>5</sub> (mg/L)

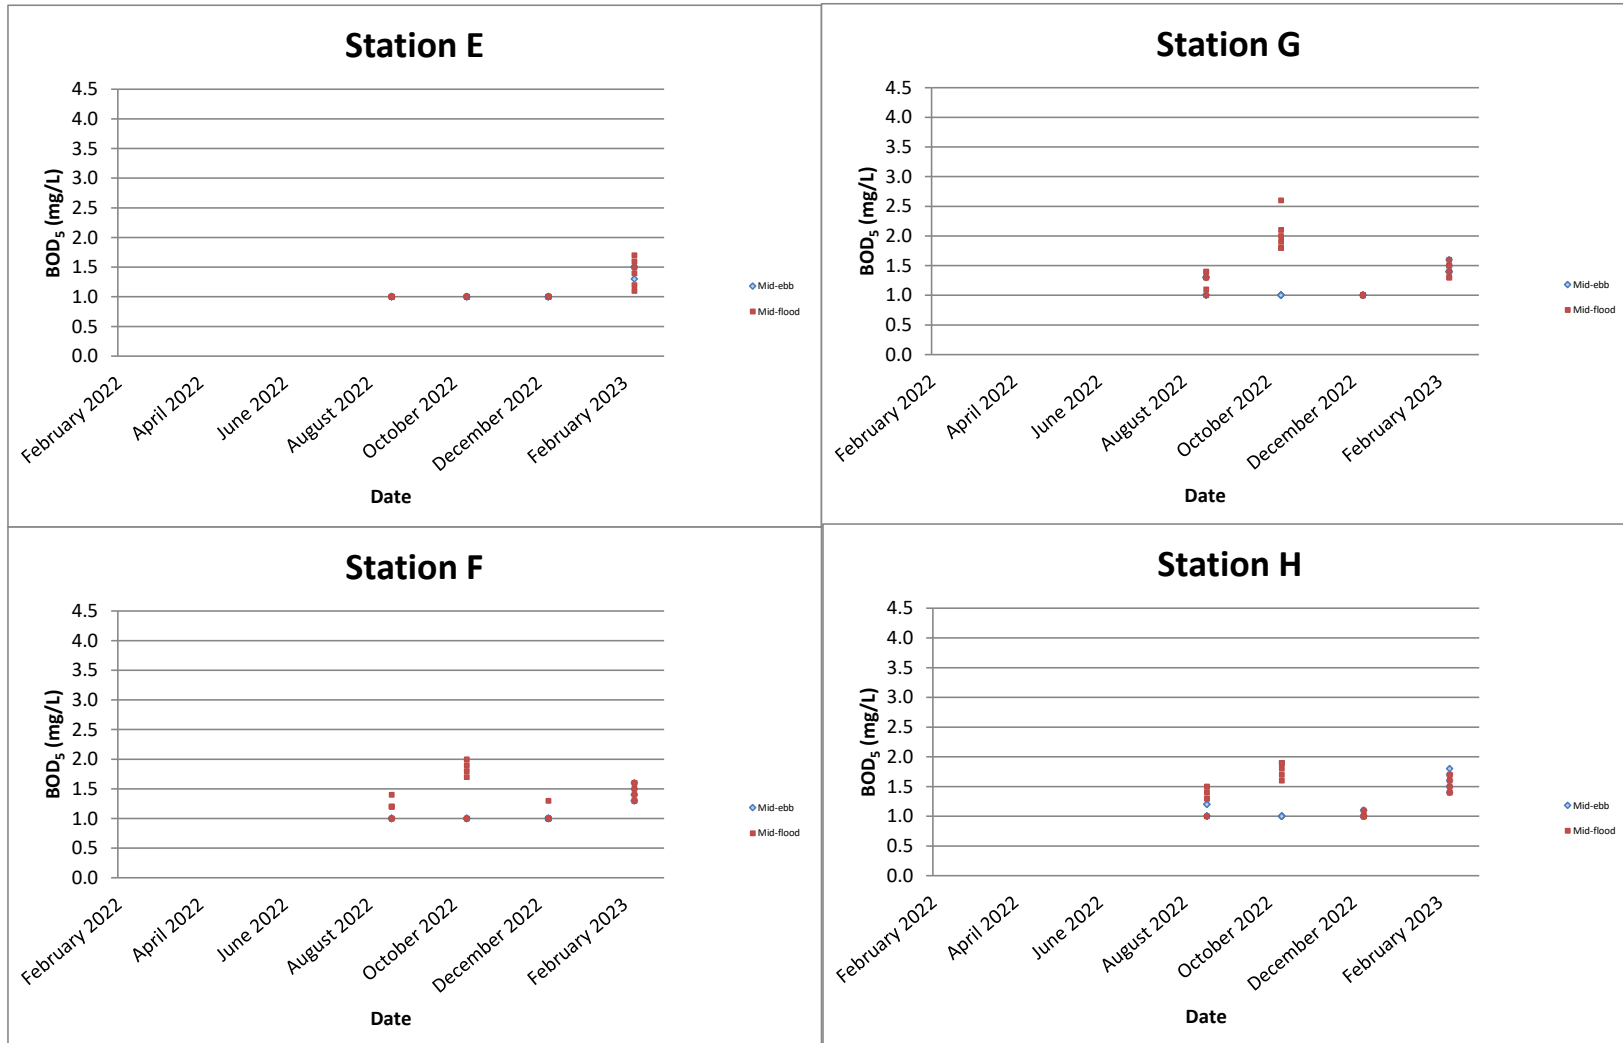

Remark: All below the Limit of Report sample results (<1.0 mg/L) for BOD<sub>5</sub> is regarded as 1.0 mg/L in graphical presentation.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix G

Tidal Data obtained from Ma Wan Marine Traffic Station



# FUGRO TECHNICAL SERVICES LIMITED


Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

## 馬灣

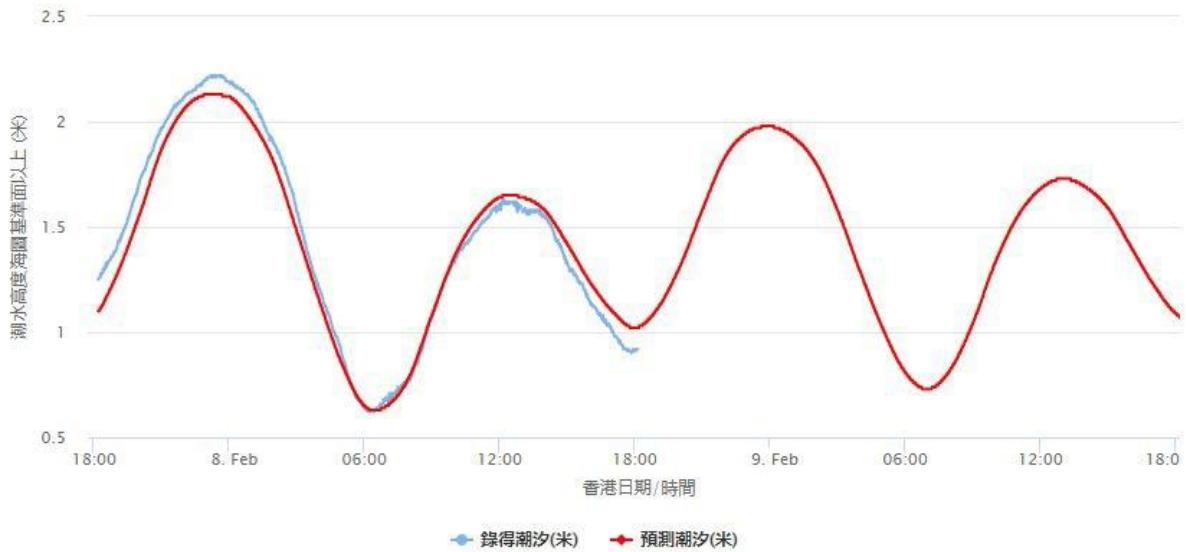

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix H

### Results and Graphical Presentation of Laboratory Analysis for Sediment Quality Monitoring and Benthic Survey

Monitoring Location	Date	Weather	Sea Condition	Time	Sediment Monitoring												
					pH	Ammonia as N (mg-N/kg)	Total Nitrogen (mg-N/kg)	Total Phosphorus (mg-P/kg)	Cadmium (mg/kg)	Chromium (mg/kg)	Copper (mg/kg)	Lead (mg/kg)	Mercury (mg/kg)	Nickel (mg/kg)	Zinc (mg/kg)	Arsenic (mg/kg)	Silver (mg/kg)
A	8/2/2023	Fine	Moderate	12:47	8.3	9.6	680	460	<0.1	27	23	34	0.11	14	79	14	0.2
B	8/2/2023	Fine	Moderate	12:28	8.2	16	950	70	<0.1	28	26	34	0.10	15	85	10	0.3
C	8/2/2023	Fine	Moderate	12:07	8.1	18	1200	54	<0.1	30	28	36	0.11	17	92	10	0.3
D	8/2/2023	Fine	Moderate	11:50	8.1	14	1400	300	<0.1	29	29	35	0.10	16	88	10	0.3
E	8/2/2023	Fine	Moderate	11:31	8.2	20	1100	290	<0.1	25	30	30	0.08	14	76	8	0.3
F	8/2/2023	Fine	Moderate	11:15	8.1	19	1400	43	<0.1	39	35	46	0.15	23	130	13	0.3
G	8/2/2023	Fine	Moderate	11:00	8.3	7.4	750	260	<0.1	37	43	47	0.14	19	210	13	0.4
H	8/2/2023	Fine	Moderate	10:38	8.2	7.0	900	360	<0.1	33	31	38	0.11	18	89	11	0.4

Monitoring Location	Date	Weather	Sea Condition	Time	Benthic Survey				
					Total Organic Carbon (%)	Particle Size Distribution			
						Gravel (%)	Sand (%)	Silt (%)	Clay (%)
A	8/2/2023	Fine	Moderate	12:47	1.1	1	2	42	55
B	8/2/2023	Fine	Moderate	12:28	1.1	0	17	37	46
C	8/2/2023	Fine	Moderate	12:07	1.1	2	5	43	50
D	8/2/2023	Fine	Moderate	11:50	1.1	0	6	42	52
E	8/2/2023	Fine	Moderate	11:31	1.3	6	17	36	41
F	8/2/2023	Fine	Moderate	11:15	1.2	0	10	42	48
G	8/2/2023	Fine	Moderate	11:00	0.56	3	28	29	40
H	8/2/2023	Fine	Moderate	10:38	1.1	3	13	37	47

Report No. : 181172WA230220(1)



Page 1 of 3

**Test Report on Analysis of Sediment****Information Supplied by Client**

Client : Fugro Technical Services Limited

Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Sample description : Eight samples of sediment taken by the staff of FTS on 08/02/2023

Client sample ID : Refer to page 3

Tests required :  
1. pH value  
2. Moisture content  
3. Ammoniacal nitrogen content  
4. Total nitrogen content  
5. Total phosphorus content  
6. Cadmium content  
7. Chromium content  
8. Copper content  
9. Lead content  
10. Mercury content  
11. Nickel content  
12. Zinc content  
13. Arsenic content  
14. Silver content

**Laboratory Information**

Lab. sample ID : WA230220(1)/1-8

Date of receipt of sample : 08/02/2023

Date test commenced : 08/02/2023

Date test completed : 27/02/2023

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA230220(1)

Page 2 of 3

Test methods used : pH value  
*APHA 23ed. 4500-H<sup>+</sup>B*

Moisture content  
*In house method E-T-186*

Ammoniacal Nitrogen content  
*In house method E-T-095*

Total nitrogen  
*In house method E-T-114 (By Calculation),  
In house method E-T-036 & APHA 23ed.4500-NO<sub>3</sub><sup>-</sup>-I*

Total phosphorus content  
*APHA 17ed. 4500-PB.5 (Digestion) &  
In house method E-T-056 (Determination)*

Cadmium, Chromium, Copper, Lead, Mercury, Nickel, Zinc,  
Arsenic, Silver content  
*USEPA method 3050B (Digestion) & 6020A (Determination)*


*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA230220(1)

Page 3 of 3

**Results :**

Test parameters	Sample identification													
	A/Sediment	B/Sediment	C/Sediment	D/Sediment	E/Sediment	F/Sediment	G/Sediment	H/Sediment						
1. pH value at 25°C	8.3	8.2	8.1	8.1	8.2	8.1	8.3	8.2						
2. Moisture content, %	51	58	61	58	61	64	56	60						
3. Ammoniacal nitrogen content, mg/kg	9.6	16	18	14	20	19	7.4	7.0						
4. Total nitrogen, mg/kg	680	950	1200	1400	1100	1400	750	900						
5. Total phosphorus content, mg/kg	460	70	54	300	290	43	260	360						
6. Cadmium content, mg/kg	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1						
7. Chromium content, mg/kg	27	28	30	29	25	39	37	33						
8. Copper content, mg/kg	24	30	31	30	27	130	160	49						
9. Lead content, mg/kg	34	34	36	35	30	46	47	38						
10. Mercury content, mg/kg	0.11	0.10	0.11	0.10	0.08	0.15	0.14	0.11						
11. Nickel content, mg/kg	14	15	17	16	14	23	19	18						
12. Zinc content, mg/kg	79	85	92	88	76	130	210	89						
13. Arsenic content, mg/kg	14	10	10	10	8	13	13	11						
14. Silver content, mg/kg	0.2	0.3	0.3	0.3	0.3	0.3	0.4	0.4						

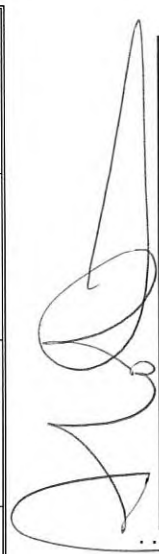Certified by :  :  
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 9/3/2023

**\*\* End of Report \*\***  
 Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

**Note**

**Laboratory Duplicate, Quality Assurance/Quality Control Report**

pH value		Moisture content, %			
Reporting Limit	Blank	Spike recovery (%)	Original result	Duplicate result	RPD%
0.1	-	-	8.18	8.18	0
Ammoniacal nitrogen content, mg/kg					
Reporting Limit	Blank	Spike recovery (%)	Original result	Duplicate result	RPD%
0.5	<0.5	-	1.8	1.6	12
Total phosphorus content, mg/kg					
Reporting Limit	Blank	Spike recovery (%)	Original result	Duplicate result	RPD%
10	<10	-	360	370	2.7
Total nitrogen, mg/kg		Moisture content, %			
Reporting Limit	Blank	Spike recovery (%)	Original result	Duplicate result	RPD%
50	-	-	52	54	3.8
Laboratory Duplicate		Laboratory Duplicate			
Original result	Duplicate result	Original result	Duplicate result	RPD%	RPD%
40	40	40	40	0	0

Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories


Date : 9/3/2013

Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.

**Note**

**Method Blank (MB), Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report**

Item	Method Blank (MB) Report		Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report						
	LOR	Result	Spike Concentration	Spike recovery (%)		Recovery limits (%)		RPD%	
				MS	MSD	Low	High	Value	Control Limited
Arsenic	0.5	< 0.5	10	103.1	-	75	125	-	-
Cadmium	0.1	< 0.1	10	99.6	-	75	125	-	-
Chromium	0.5	< 0.5	10	100.4	-	75	125	-	-
Copper	0.2	< 0.2	10	100.3	-	75	125	-	-
Lead	0.2	< 0.2	10	91.3	-	75	125	-	-
Mercury	0.05	< 0.05	0.5	97.4	-	75	125	-	-
Nickel	0.2	< 0.2	10	97.7	-	75	125	-	-
Silver	0.1	< 0.1	10	97.9	-	75	125	-	-
Zinc	0.5	< 0.5	100	98.1	-	75	125	-	-

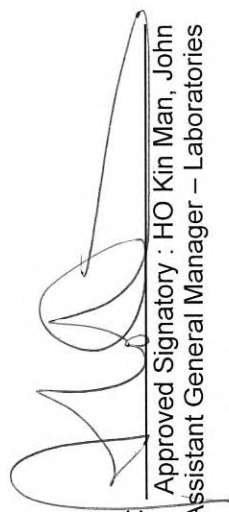Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 9/3/2023

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*



Report No. : 181172WA230220(2)



Page 1 of 2

**Test Report on Analysis of Sediment****Information Supplied by Client**

Client : Fugro Technical Services Limited

Client's address : 13/F, Fugro House – KCC2, No. 1 Kwai On Road, Kwai Chung, N.T., H.K

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Sample description : Eight samples of benthic survey sediment taken by the staff of FTS on 08/02/2023

Client sample ID : Refer to page 2

Tests required : 1. Moisture content  
2. Total organic carbon content

**Laboratory Information**

Lab. sample ID : WA230220(1)/9-16

Date of receipt of sample : 08/02/2023

Date test commenced : 08/02/2023

Date test completed : 27/02/2023

Test methods used : 1. In-house method E-T-186  
2. APHA 23ed. 5310B


*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172WA230220(2)

Page 2 of 2

**Results :**

Test parameters	Sample identification							
	A/Benthic Survey	B/Benthic Survey	C/Benthic Survey	D/Benthic Survey	E/Benthic Survey	F/Benthic Survey	G/Benthic Survey	H/Benthic Survey
1. Moisture content, %	54	58	60	58	61	63	52	60
2. Total organic carbon content, %	1.1	1.1	1.1	1.1	1.3	1.2	0.56	1.1

Certified by   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date 9/3/2023


\*\* End of Report \*\*

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

**Note**

**Laboratory Duplicate, Quality Assurance/Quality Control Report**

Moisture content, %				Total organic carbon content, %			
Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate	Reporting Limit	Blank	Spike recovery (%)	Laboratory Duplicate
			Original result	Limit			Original result
0.1	-	-	40	0.05	-	-	1.0
			40				1.1
							9.52

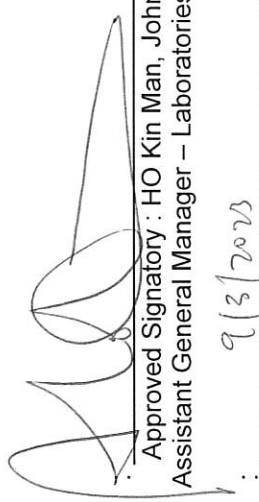Certified by :   
 Approved Signatory : HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 9/3/2023

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Test Report No. : M160554SL230031

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

 Client sample No. : A  
 Borehole No. : -  
 Depth (m) From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey


Service/Works Order No. : -

**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments.

 Laboratory sample I.D. : SL230031/1  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) :  
 From : Full Mix  
 To : -

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)																																																																																																		
Initial dry mass (m <sub>1</sub> ) g	: 117.557	Mass retained (g)	Percent passing (%)	Hydrometer Serial No.					:	3311121																																																																																												
Sieve size mm				Particle density (Assumed)					:	2.65																																																																																												
100	0.000	100		Initial dry mass*					:	21.798																																																																																												
75	0.000	100		Mass retained on 63µm					:	0.705																																																																																												
63	0.000	100		<table border="1"> <thead> <tr> <th>Date</th> <th>Time Started</th> <th>Period min</th> <th>Temp. °C</th> <th>Hydro. Rdg.</th> <th>Hydro. Rdg #</th> <th>Particle dia. mm</th> <th>K %</th> <th>K* %</th> </tr> </thead> <tbody> <tr> <td>14-02-2023</td> <td>9:00</td> <td>0.5</td> <td>25.00</td> <td>14.0</td> <td>0.5</td> <td>0.068</td> <td>99</td> <td>98</td> </tr> <tr> <td></td> <td></td> <td>1</td> <td>25.00</td> <td>13.5</td> <td>0.5</td> <td>0.048</td> <td>96</td> <td>94</td> </tr> <tr> <td></td> <td></td> <td>2</td> <td>25.00</td> <td>13.0</td> <td>0.5</td> <td>0.034</td> <td>92</td> <td>91</td> </tr> <tr> <td></td> <td></td> <td>4</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.024</td> <td>88</td> <td>87</td> </tr> <tr> <td></td> <td></td> <td>8</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.017</td> <td>88</td> <td>87</td> </tr> <tr> <td></td> <td></td> <td>30</td> <td>25.00</td> <td>11.5</td> <td>0.5</td> <td>0.0090</td> <td>81</td> <td>80</td> </tr> <tr> <td></td> <td></td> <td>120</td> <td>25.00</td> <td>10.0</td> <td>0.5</td> <td>0.0046</td> <td>70</td> <td>69</td> </tr> <tr> <td></td> <td></td> <td>480</td> <td>25.00</td> <td>8.5</td> <td>0.5</td> <td>0.0023</td> <td>59</td> <td>58</td> </tr> <tr> <td></td> <td></td> <td>1440</td> <td>25.00</td> <td>7.5</td> <td>0.5</td> <td>0.0014</td> <td>52</td> <td>51</td> </tr> </tbody> </table>									Date	Time Started	Period min	Temp. °C	Hydro. Rdg.	Hydro. Rdg #	Particle dia. mm	K %	K* %	14-02-2023	9:00	0.5	25.00	14.0	0.5	0.068	99	98			1	25.00	13.5	0.5	0.048	96	94			2	25.00	13.0	0.5	0.034	92	91			4	25.00	12.5	0.5	0.024	88	87			8	25.00	12.5	0.5	0.017	88	87			30	25.00	11.5	0.5	0.0090	81	80			120	25.00	10.0	0.5	0.0046	70	69			480	25.00	8.5	0.5	0.0023	59	58			1440	25.00	7.5	0.5	0.0014	52	51
Date	Time Started	Period min	Temp. °C	Hydro. Rdg.	Hydro. Rdg #	Particle dia. mm	K %	K* %																																																																																														
14-02-2023	9:00	0.5	25.00	14.0	0.5	0.068	99	98																																																																																														
		1	25.00	13.5	0.5	0.048	96	94																																																																																														
		2	25.00	13.0	0.5	0.034	92	91																																																																																														
		4	25.00	12.5	0.5	0.024	88	87																																																																																														
		8	25.00	12.5	0.5	0.017	88	87																																																																																														
		30	25.00	11.5	0.5	0.0090	81	80																																																																																														
		120	25.00	10.0	0.5	0.0046	70	69																																																																																														
		480	25.00	8.5	0.5	0.0023	59	58																																																																																														
		1440	25.00	7.5	0.5	0.0014	52	51																																																																																														
50	0.000	100		# Hydrometer reading in solution only (R <sub>0</sub> )																																																																																																		
37.5	0.000	100		K* modified according to Geospec 3 (November 2001) Test Method 8.7																																																																																																		
28	0.000	100		<p style="text-align: center;"><b>SUMMATION :</b></p> <table style="margin-left: auto; margin-right: auto;"> <tr> <td>GRAVEL</td> <td>% :</td> <td>1</td> </tr> <tr> <td>SAND</td> <td>% :</td> <td>2</td> </tr> <tr> <td>SILT</td> <td>% :</td> <td>42</td> </tr> <tr> <td>CLAY</td> <td>% :</td> <td>55</td> </tr> </table>									GRAVEL	% :	1	SAND	% :	2	SILT	% :	42	CLAY	% :	55																																																																														
GRAVEL	% :	1																																																																																																				
SAND	% :	2																																																																																																				
SILT	% :	42																																																																																																				
CLAY	% :	55																																																																																																				
20	0.000	100																																																																																																				
Passing (m <sub>2</sub> )	20	117.557																																																																																																				
Riffled passing (m <sub>3</sub> )	20	117.557																																																																																																				
Wash passing (m <sub>4</sub> )	20	3.872																																																																																																				
	14	0.000	100																																																																																																			
	10	0.000	100																																																																																																			
	6.3	0.000	100																																																																																																			
Passing (m <sub>5</sub> )	6.3	3.872																																																																																																				
Riffled passing (m <sub>6</sub> )	6.3	3.872																																																																																																				
	5.0	0.100	100																																																																																																			
	3.35	0.130	100																																																																																																			
	2.00	0.450	99																																																																																																			
	1.18	0.382	99																																																																																																			
	0.600	0.340	99																																																																																																			
	0.425	0.130	99																																																																																																			
	0.300	0.130	99																																																																																																			
	0.212	0.192	98																																																																																																			
	0.150	0.220	98																																																																																																			
	0.063	1.428	97																																																																																																			
Pan (m <sub>7</sub> )		0.370																																																																																																				

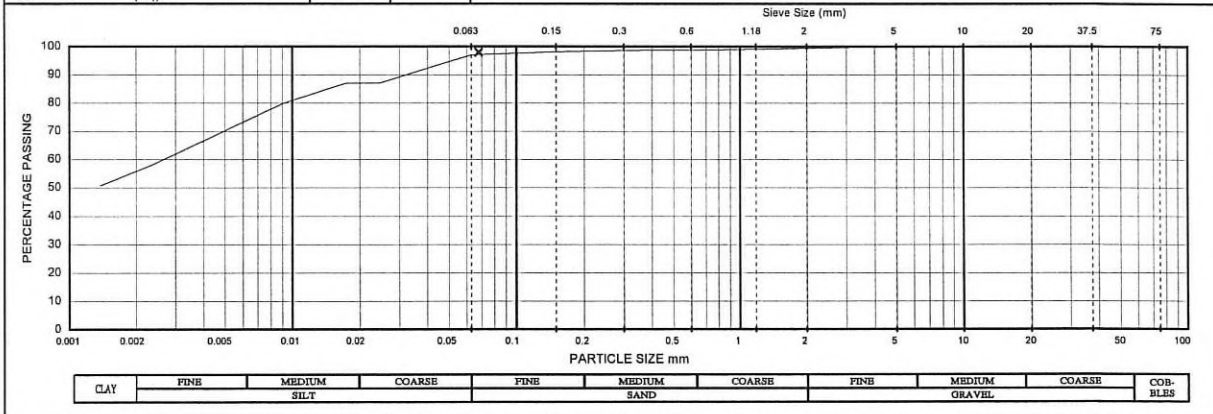
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)

- The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date :

20 Feb 2023

\*\*End of Report\*\*



Test Report No. : M160554SL230031(1)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -

 Client sample No. : B  
 Borehole No. : -  
 Depth (m) : From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey

 Project : Contract No. CM 14/2016 Environmental Team for  
 Operational Environmental Monitoring and Audit for Siu Ho  
 Wan Sewage Treatment Works


Service/Works Order No. : -

**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY  
 with shell fragments.

 Laboratory sample I.D. : SL230031/2  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation  
 within original sample (m)  
 From : Full Mix  
 To : -

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)																																																																																																		
Initial dry mass (m <sub>1</sub> ) g	: 154.575	Mass retained (g)	Percent passing (%)	Hydrometer Serial No.					:	3311121																																																																																												
Sieve size mm				Particle density (Assumed)					:	2.65																																																																																												
100	0.000	100		Initial dry mass*					g	27.433																																																																																												
75	0.000	100		Mass retained on 63µm					g	5.040																																																																																												
63	0.000	100		<table border="1"> <thead> <tr> <th>Date</th> <th>Time Started</th> <th>Period min</th> <th>Temp. °C</th> <th>Hydro. Rdg.</th> <th>Hydro. Rdg #</th> <th>Particle dia. mm</th> <th>K %</th> <th>K* %</th> </tr> </thead> <tbody> <tr> <td>14-02-2023</td> <td>9:15</td> <td>0.5</td> <td>25.00</td> <td>14.5</td> <td>0.5</td> <td>0.067</td> <td>82</td> <td>83</td> </tr> <tr> <td></td> <td></td> <td>1</td> <td>25.00</td> <td>14.0</td> <td>0.5</td> <td>0.048</td> <td>79</td> <td>80</td> </tr> <tr> <td></td> <td></td> <td>2</td> <td>25.00</td> <td>13.5</td> <td>0.5</td> <td>0.034</td> <td>76</td> <td>77</td> </tr> <tr> <td></td> <td></td> <td>4</td> <td>25.00</td> <td>13.0</td> <td>0.5</td> <td>0.024</td> <td>73</td> <td>74</td> </tr> <tr> <td></td> <td></td> <td>8</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.017</td> <td>70</td> <td>71</td> </tr> <tr> <td></td> <td></td> <td>30</td> <td>25.00</td> <td>11.0</td> <td>0.5</td> <td>0.0091</td> <td>61</td> <td>63</td> </tr> <tr> <td></td> <td></td> <td>120</td> <td>25.00</td> <td>10.0</td> <td>0.5</td> <td>0.0046</td> <td>56</td> <td>57</td> </tr> <tr> <td></td> <td></td> <td>480</td> <td>25.00</td> <td>8.5</td> <td>0.5</td> <td>0.0023</td> <td>47</td> <td>48</td> </tr> <tr> <td></td> <td></td> <td>1440</td> <td>25.00</td> <td>7.5</td> <td>0.5</td> <td>0.0014</td> <td>41</td> <td>42</td> </tr> </tbody> </table>									Date	Time Started	Period min	Temp. °C	Hydro. Rdg.	Hydro. Rdg #	Particle dia. mm	K %	K* %	14-02-2023	9:15	0.5	25.00	14.5	0.5	0.067	82	83			1	25.00	14.0	0.5	0.048	79	80			2	25.00	13.5	0.5	0.034	76	77			4	25.00	13.0	0.5	0.024	73	74			8	25.00	12.5	0.5	0.017	70	71			30	25.00	11.0	0.5	0.0091	61	63			120	25.00	10.0	0.5	0.0046	56	57			480	25.00	8.5	0.5	0.0023	47	48			1440	25.00	7.5	0.5	0.0014	41	42
Date	Time Started	Period min	Temp. °C	Hydro. Rdg.	Hydro. Rdg #	Particle dia. mm	K %	K* %																																																																																														
14-02-2023	9:15	0.5	25.00	14.5	0.5	0.067	82	83																																																																																														
		1	25.00	14.0	0.5	0.048	79	80																																																																																														
		2	25.00	13.5	0.5	0.034	76	77																																																																																														
		4	25.00	13.0	0.5	0.024	73	74																																																																																														
		8	25.00	12.5	0.5	0.017	70	71																																																																																														
		30	25.00	11.0	0.5	0.0091	61	63																																																																																														
		120	25.00	10.0	0.5	0.0046	56	57																																																																																														
		480	25.00	8.5	0.5	0.0023	47	48																																																																																														
		1440	25.00	7.5	0.5	0.0014	41	42																																																																																														
50	0.000	100		# Hydrometer reading in solution only (R <sub>0</sub> )																																																																																																		
37.5	0.000	100		K* modified according to Geospec 3 (November 2001) Test Method 8.7																																																																																																		
28	0.000	100		<p style="text-align: center;"><b>SUMMATION :</b></p> <table style="margin-left: auto; margin-right: auto;"> <tr> <td>GRAVEL</td> <td>% :</td> <td>0</td> </tr> <tr> <td>SAND</td> <td>% :</td> <td>17</td> </tr> <tr> <td>SILT</td> <td>% :</td> <td>37</td> </tr> <tr> <td>CLAY</td> <td>% :</td> <td>46</td> </tr> </table>									GRAVEL	% :	0	SAND	% :	17	SILT	% :	37	CLAY	% :	46																																																																														
GRAVEL	% :	0																																																																																																				
SAND	% :	17																																																																																																				
SILT	% :	37																																																																																																				
CLAY	% :	46																																																																																																				
20	0.000	100																																																																																																				
Passing (m <sub>2</sub> )	20	154.575																																																																																																				
Riffled passing (m <sub>3</sub> )	20	154.575																																																																																																				
Wash passing (m <sub>4</sub> )	20	27.645																																																																																																				
	14	0.000	100																																																																																																			
	10	0.000	100																																																																																																			
	6.3	0.000	100																																																																																																			
Passing (m <sub>5</sub> )	6.3	27.645																																																																																																				
Riffled passing (m <sub>6</sub> )	6.3	27.645																																																																																																				
	5.0	0.090	100																																																																																																			
	3.35	0.182	100																																																																																																			
	2.00	0.340	100																																																																																																			
	1.18	0.392	99																																																																																																			
	0.600	0.512	99																																																																																																			
	0.425	0.300	99																																																																																																			
	0.300	0.552	98																																																																																																			
	0.212	1.540	97																																																																																																			
	0.150	3.350	95																																																																																																			
	0.063	19.367	83																																																																																																			
Pan (m <sub>7</sub> )		1.020																																																																																																				

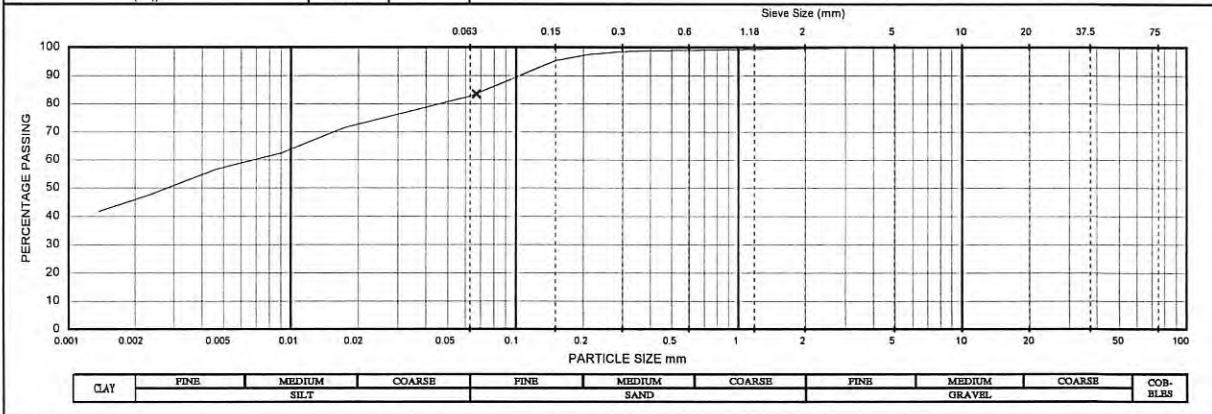
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date :

**20 Feb 2023**
**\*\*End of Report\*\***

Test Report No. : M160554SL230031(2)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

 Client sample No. : C  
 Borehole No. : -  
 Depth (m) From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey


Service/Works Order No. : -

**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments.

 Laboratory sample I.D. : SL230031/3  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) From : Full Mix  
 To : -

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)																																																																																																				
Initial dry mass (m <sub>1</sub> ) g	128.793	Mass retained (g)	Percent passing (%)	Hydrometer Serial No.					3311121																																																																																															
Sieve size mm				Particle density (Assumed)					2.65																																																																																															
100	0.000	100		Initial dry mass*					g : 23.192																																																																																															
75	0.000	100		Mass retained on 63µm					g : 1.289																																																																																															
63	0.000	100		<table border="1"> <thead> <tr> <th>Date</th> <th>Time Started</th> <th>Period min</th> <th>Temp. °C</th> <th>Hydro. Rdg</th> <th>Hydro. Rdg #</th> <th>Particle dia. mm</th> <th>K %</th> <th>K* %</th> </tr> </thead> <tbody> <tr> <td>14-02-2023</td> <td>9:20</td> <td>0.5</td> <td>25.00</td> <td>13.5</td> <td>0.5</td> <td>0.068</td> <td>90</td> <td>94</td> </tr> <tr> <td></td> <td></td> <td>1</td> <td>25.00</td> <td>13.0</td> <td>0.5</td> <td>0.049</td> <td>87</td> <td>90</td> </tr> <tr> <td></td> <td></td> <td>2</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.035</td> <td>83</td> <td>86</td> </tr> <tr> <td></td> <td></td> <td>4</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.024</td> <td>83</td> <td>86</td> </tr> <tr> <td></td> <td></td> <td>8</td> <td>25.00</td> <td>12.0</td> <td>0.5</td> <td>0.017</td> <td>80</td> <td>83</td> </tr> <tr> <td></td> <td></td> <td>30</td> <td>25.00</td> <td>10.0</td> <td>0.5</td> <td>0.0092</td> <td>66</td> <td>68</td> </tr> <tr> <td></td> <td></td> <td>120</td> <td>25.00</td> <td>9.0</td> <td>0.5</td> <td>0.0047</td> <td>59</td> <td>61</td> </tr> <tr> <td></td> <td></td> <td>480</td> <td>25.00</td> <td>8.0</td> <td>0.5</td> <td>0.0024</td> <td>52</td> <td>54</td> </tr> <tr> <td></td> <td></td> <td>1440</td> <td>25.00</td> <td>6.5</td> <td>0.5</td> <td>0.0014</td> <td>42</td> <td>43</td> </tr> </tbody> </table>									Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %	14-02-2023	9:20	0.5	25.00	13.5	0.5	0.068	90	94			1	25.00	13.0	0.5	0.049	87	90			2	25.00	12.5	0.5	0.035	83	86			4	25.00	12.5	0.5	0.024	83	86			8	25.00	12.0	0.5	0.017	80	83			30	25.00	10.0	0.5	0.0092	66	68			120	25.00	9.0	0.5	0.0047	59	61			480	25.00	8.0	0.5	0.0024	52	54			1440	25.00	6.5	0.5	0.0014	42	43		
Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %																																																																																																
14-02-2023	9:20	0.5	25.00	13.5	0.5	0.068	90	94																																																																																																
		1	25.00	13.0	0.5	0.049	87	90																																																																																																
		2	25.00	12.5	0.5	0.035	83	86																																																																																																
		4	25.00	12.5	0.5	0.024	83	86																																																																																																
		8	25.00	12.0	0.5	0.017	80	83																																																																																																
		30	25.00	10.0	0.5	0.0092	66	68																																																																																																
		120	25.00	9.0	0.5	0.0047	59	61																																																																																																
		480	25.00	8.0	0.5	0.0024	52	54																																																																																																
		1440	25.00	6.5	0.5	0.0014	42	43																																																																																																
50	0.000	100		# Hydrometer reading in solution only (R <sub>0</sub> )																																																																																																				
37.5	0.000	100		K* modified according to Geospec 3 (November 2001) Test Method 8.7																																																																																																				
28	0.000	100		<p style="text-align: center;"><b>SUMMATION :</b></p> <p style="text-align: center;">GRAVEL % : 2</p> <p style="text-align: center;">SAND % : 5</p> <p style="text-align: center;">SILT % : 43</p> <p style="text-align: center;">CLAY % : 50</p>																																																																																																				
20	0.000	100																																																																																																						
Passing (m <sub>2</sub> )	20	128.793																																																																																																						
Riffled passing (m <sub>3</sub> )	20	128.793																																																																																																						
Wash passing (m <sub>4</sub> )	20	9.941																																																																																																						
	14	0.000	100																																																																																																					
	10	0.000	100																																																																																																					
	6.3	0.000	100																																																																																																					
Passing (m <sub>5</sub> )	6.3	9.941																																																																																																						
Riffled passing (m <sub>6</sub> )	6.3	9.941																																																																																																						
	5.0	0.480	100																																																																																																					
	3.35	0.442	99																																																																																																					
	2.00	1.260	98																																																																																																					
	1.18	0.893	98																																																																																																					
	0.600	0.683	97																																																																																																					
	0.425	0.250	97																																																																																																					
	0.300	0.290	97																																																																																																					
	0.212	0.360	96																																																																																																					
	0.150	0.430	96																																																																																																					
	0.063	4.403	93																																																																																																					
Pan (m <sub>7</sub> )		0.450																																																																																																						

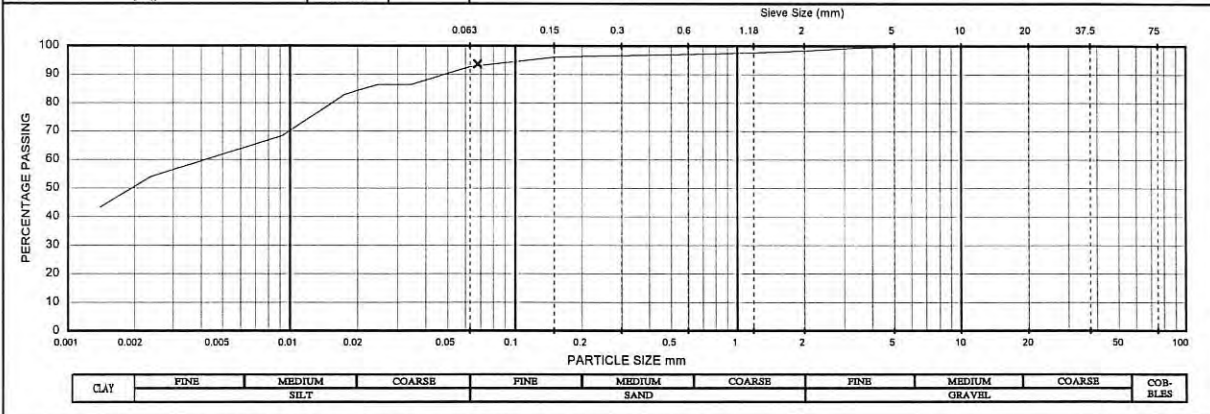
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory : Au Yeung Wai Kit - Laboratory Manager Date : 20 Feb 2023

**\*\*End of Report\*\***

Test Report No. : M160554SL230031(3)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

 Client sample No. : D  
 Borehole No. : -  
 Depth (m) From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. : -

**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments.

 Laboratory sample I.D. : SL230031/4  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) From : Full Mix  
 To : -

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)								
Initial dry mass (m <sub>1</sub> ) g	: 129.088	Mass retained (g)	Percent passing (%)	Hydrometer Serial No. : 3311121 Particle density (Assumed) : 2.65 Initial dry mass* g : 22.155 Mass retained on 63µm g : 1.066								
Sieve size mm												
	100	0.000	100	Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
	75	0.000	100	14-02-2023	9:10	0.5	25.00	14.0	0.5	0.068	98	94
	63	0.000	100			1	25.00	13.5	0.5	0.048	94	91
	50	0.000	100			2	25.00	13.5	0.5	0.034	94	91
	37.5	0.000	100			4	25.00	13.0	0.5	0.024	91	87
	28	0.000	100			8	25.00	12.5	0.5	0.017	87	84
	20	0.000	100			30	25.00	11.0	0.5	0.0091	76	73
Passing (m <sub>2</sub> )	20	129.088				120	25.00	9.5	0.5	0.0046	65	63
Riffled passing (m <sub>3</sub> )	20	129.088				480	25.00	8.5	0.5	0.0023	58	56
Wash passing (m <sub>4</sub> )	20	8.719				1440	25.00	7.0	0.5	0.0014	47	45
	14	0.000	100	# Hydrometer reading in solution only (R <sub>0</sub> ) K* modified according to Geospec 3 (November 2001) Test Method 8.7  <b>SUMMATION :</b> GRAVEL % : 0 SAND % : 6 SILT % : 42 CLAY % : 52								
	10	0.000	100									
	6.3	0.000	100									
Passing (m <sub>5</sub> )	6.3	8.719										
Riffled passing (m <sub>6</sub> )	6.3	8.719										
	5.0	0.000	100									
	3.35	0.120	100									
	2.00	0.482	100									
	1.18	0.834	99									
	0.600	0.750	98									
	0.425	0.230	98									
	0.300	0.292	98									
	0.212	0.380	98									
	0.150	0.550	97									
	0.063	4.671	94									
Pan (m <sub>7</sub> )		0.410										

 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory : Au Yeung Wai Kit - Laboratory Manager Date : 20 Feb 2023

\*\*End of Report\*\*

Test Report No. : M160554SL230031(4)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Client sample No. : E

 Project : Contract No. CM 14/2016 Environmental Team for  
 Operational Environmental Monitoring and Audit for Siu Ho  
 Wan Sewage Treatment Works

 Borehole No. : -  
 Depth (m) From : -  
 To : -

 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. : -

**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY  
 with shell fragments.

 Laboratory sample I.D. : SL230031/5  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation :  
 within original sample (m)  
 From : Full Mix  
 To : -


Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)			
Initial dry mass (m <sub>1</sub> ) g	163.830	Mass retained (g)	Percent passing (%)	Hydrometer Serial No.	3311121		
	Sieve size mm			Particle density (Assumed)	2.65		
	100	0.000	100	Initial dry mass*	27.350		
	75	0.000	100	Mass retained on 63µm	5.265		
	63	0.000	100				
	50	0.000	100				
	37.5	0.000	100				
	28	0.000	100				
	20	0.000	100				
Passing (m <sub>2</sub> )	20	163.830					
Riffling passing (m <sub>3</sub> )	20	163.830					
Wash passing (m <sub>4</sub> )	20	38.836					
	14	0.000	100				
	10	0.000	100				
	6.3	4.050	98				
Passing (m <sub>5</sub> )	6.3	34.786					
Riffling passing (m <sub>6</sub> )	6.3	34.786					
	5.0	0.600	97				
	3.35	2.320	96				
	2.00	2.594	94				
	1.18	4.240	92				
	0.600	5.730	88				
	0.425	1.534	87				
	0.300	1.680	86				
	0.212	2.450	85				
	0.150	2.710	83				
	0.063	10.348	77				
Pan (m <sub>7</sub> )		0.580					

Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %
14-02-2023	9:05	0.5	25.00	14.0	0.5	0.068	79	77
		1	25.00	13.5	0.5	0.048	76	75
		2	25.00	13.0	0.5	0.034	73	72
		4	25.00	12.5	0.5	0.024	70	69
		8	25.00	12.5	0.5	0.017	70	69
		30	25.00	11.0	0.5	0.0091	62	60
		120	25.00	9.5	0.5	0.0046	53	52
		480	25.00	8.0	0.5	0.0024	44	43
		1440	25.00	7.0	0.5	0.0014	38	37

# Hydrometer reading in solution only (R<sub>0</sub>)  
 K\* modified according to Geospec 3 (November 2001) Test Method 8.7

**SUMMATION :** GRAVEL % : 6  
 SAND % : 17  
 SILT % : 36  
 CLAY % : 41


 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

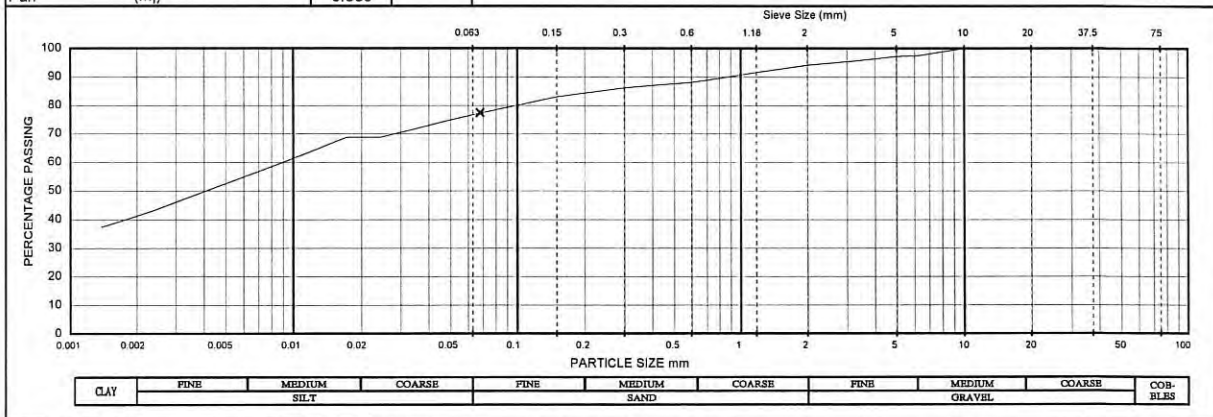 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory : Au Yeung Wai Kit - Laboratory Manager

Date : 20 Feb 2023

\*\*End of Report\*\*



Test Report No. : M160554SL230031(5)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Client sample No. : F

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

 Borehole No. : -  
 Depth (m) : From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey


Service/Works Order No. : -

**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments.

 Laboratory sample I.D. : SL230031/6  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) :  
 From : Full Mix  
 To : -

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)																																																																																																		
Initial dry mass (m <sub>1</sub> ) g	: 132.899	Mass retained (g)	Percent passing (%)	Hydrometer Serial No.					: 3311121																																																																																													
	Sieve size mm			Particle density (Assumed)					: 2.65																																																																																													
	100	0.000	100	Initial dry mass*					g : 24.197																																																																																													
	75	0.000	100	Mass retained on 63µm					g : 2.043																																																																																													
	63	0.000	100	<table border="1"> <thead> <tr> <th>Date</th> <th>Time Started</th> <th>Period min</th> <th>Temp. °C</th> <th>Hydro. Rdg</th> <th>Hydro. Rdg #</th> <th>Particle dia. mm</th> <th>K %</th> <th>K* %</th> </tr> </thead> <tbody> <tr> <td>14-02-2023</td> <td>8:55</td> <td>0.5</td> <td>25.00</td> <td>14.5</td> <td>0.5</td> <td>0.067</td> <td>93</td> <td>91</td> </tr> <tr> <td></td> <td></td> <td>1</td> <td>25.00</td> <td>14.0</td> <td>0.5</td> <td>0.048</td> <td>90</td> <td>88</td> </tr> <tr> <td></td> <td></td> <td>2</td> <td>25.00</td> <td>13.5</td> <td>0.5</td> <td>0.034</td> <td>86</td> <td>84</td> </tr> <tr> <td></td> <td></td> <td>4</td> <td>25.00</td> <td>13.0</td> <td>0.5</td> <td>0.024</td> <td>83</td> <td>81</td> </tr> <tr> <td></td> <td></td> <td>8</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.017</td> <td>80</td> <td>78</td> </tr> <tr> <td></td> <td></td> <td>30</td> <td>25.00</td> <td>11.5</td> <td>0.5</td> <td>0.0090</td> <td>73</td> <td>71</td> </tr> <tr> <td></td> <td></td> <td>120</td> <td>25.00</td> <td>9.5</td> <td>0.5</td> <td>0.0046</td> <td>60</td> <td>58</td> </tr> <tr> <td></td> <td></td> <td>480</td> <td>25.00</td> <td>8.5</td> <td>0.5</td> <td>0.0023</td> <td>53</td> <td>52</td> </tr> <tr> <td></td> <td></td> <td>1440</td> <td>25.00</td> <td>7.0</td> <td>0.5</td> <td>0.0014</td> <td>43</td> <td>42</td> </tr> </tbody> </table>									Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %	14-02-2023	8:55	0.5	25.00	14.5	0.5	0.067	93	91			1	25.00	14.0	0.5	0.048	90	88			2	25.00	13.5	0.5	0.034	86	84			4	25.00	13.0	0.5	0.024	83	81			8	25.00	12.5	0.5	0.017	80	78			30	25.00	11.5	0.5	0.0090	73	71			120	25.00	9.5	0.5	0.0046	60	58			480	25.00	8.5	0.5	0.0023	53	52			1440	25.00	7.0	0.5	0.0014	43	42
Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %																																																																																														
14-02-2023	8:55	0.5	25.00	14.5	0.5	0.067	93	91																																																																																														
		1	25.00	14.0	0.5	0.048	90	88																																																																																														
		2	25.00	13.5	0.5	0.034	86	84																																																																																														
		4	25.00	13.0	0.5	0.024	83	81																																																																																														
		8	25.00	12.5	0.5	0.017	80	78																																																																																														
		30	25.00	11.5	0.5	0.0090	73	71																																																																																														
		120	25.00	9.5	0.5	0.0046	60	58																																																																																														
		480	25.00	8.5	0.5	0.0023	53	52																																																																																														
		1440	25.00	7.0	0.5	0.0014	43	42																																																																																														
	50	0.000	100	# Hydrometer reading in solution only (R <sub>0</sub> )																																																																																																		
	37.5	0.000	100	K* modified according to Geospec 3 (November 2001) Test Method 8.7																																																																																																		
	28	0.000	100	<p style="text-align: center;"><b>SUMMATION :</b></p> <table style="margin-left: auto; margin-right: auto;"> <tr> <td>GRAVEL</td> <td>% :</td> <td>0</td> </tr> <tr> <td>SAND</td> <td>% :</td> <td>10</td> </tr> <tr> <td>SILT</td> <td>% :</td> <td>42</td> </tr> <tr> <td>CLAY</td> <td>% :</td> <td>48</td> </tr> </table>									GRAVEL	% :	0	SAND	% :	10	SILT	% :	42	CLAY	% :	48																																																																														
GRAVEL	% :	0																																																																																																				
SAND	% :	10																																																																																																				
SILT	% :	42																																																																																																				
CLAY	% :	48																																																																																																				
	20	0.000	100																																																																																																			
Passing (m <sub>2</sub> )	20	132.899																																																																																																				
Rifled passing (m <sub>3</sub> )	20	132.899																																																																																																				
Wash passing (m <sub>4</sub> )	20	13.939																																																																																																				
	14	0.000	100																																																																																																			
	10	0.000	100																																																																																																			
	6.3	0.000	100																																																																																																			
Passing (m <sub>5</sub> )	6.3	13.939																																																																																																				
Rifled passing (m <sub>6</sub> )	6.3	13.939																																																																																																				
	5.0	0.160	100																																																																																																			
	3.35	0.160	100																																																																																																			
	2.00	0.320	100																																																																																																			
	1.18	0.563	99																																																																																																			
	0.600	0.750	99																																																																																																			
	0.425	0.412	98																																																																																																			
	0.300	0.510	98																																																																																																			
	0.212	0.810	97																																																																																																			
	0.150	0.980	96																																																																																																			
	0.063	8.244	90																																																																																																			
Pan (m <sub>7</sub> )		1.030																																																																																																				

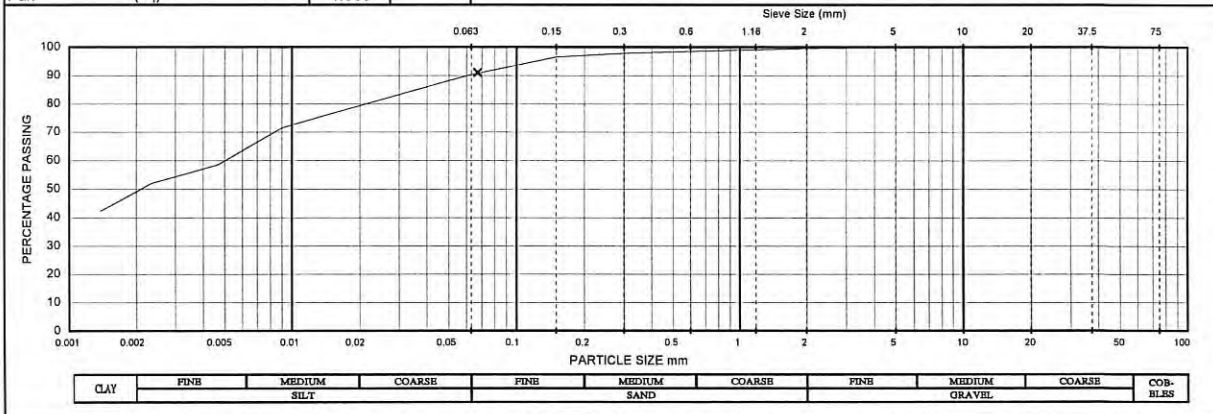
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory :

Au Yeung Wai Kit - Laboratory Manager

Date :

20 Feb 2023

\*\*End of Report\*\*

Test Report No. : M160554SL230031(6)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Client sample No. : G

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

 Borehole No. : -  
 Depth (m) From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. : -


**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments.

 Laboratory sample I.D. : SL230031/7  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) From : Full Mix  
 To : -

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)								
Initial dry mass (m <sub>1</sub> ) g	147.584	Mass retained (g)	Percent passing (%)	Hydrometer Serial No.								
Sieve size mm				Particle density (Assumed)								
100	0.000	100		Initial dry mass*								
75	0.000	100		Mass retained on 63µm								
63	0.000	100										
50	0.000	100										
37.5	0.000	100										
28	0.000	100										
20	0.000	100										
Passing (m <sub>2</sub> )	20	147.584										
Riffled passing (m <sub>3</sub> )	20	147.584										
Wash passing (m <sub>4</sub> )	20	45.982										
	14	0.000	100									
	10	0.000	100									
	6.3	1.950	99									
Passing (m <sub>5</sub> )	6.3	44.032										
Riffled passing (m <sub>6</sub> )	6.3	44.032										
	5.0	0.130	99									
	3.35	0.800	98									
	2.00	1.210	97									
	1.18	1.693	96									
	0.600	2.390	94									
	0.425	1.360	94									
	0.300	2.310	92									
	0.212	7.100	87									
	0.150	11.600	79									
	0.063	14.869	69									
Pan (m <sub>7</sub> )		0.570										

**SUMMATION :** GRAVEL % : 3  
 SAND % : 28  
 SILT % : 29  
 CLAY % : 40

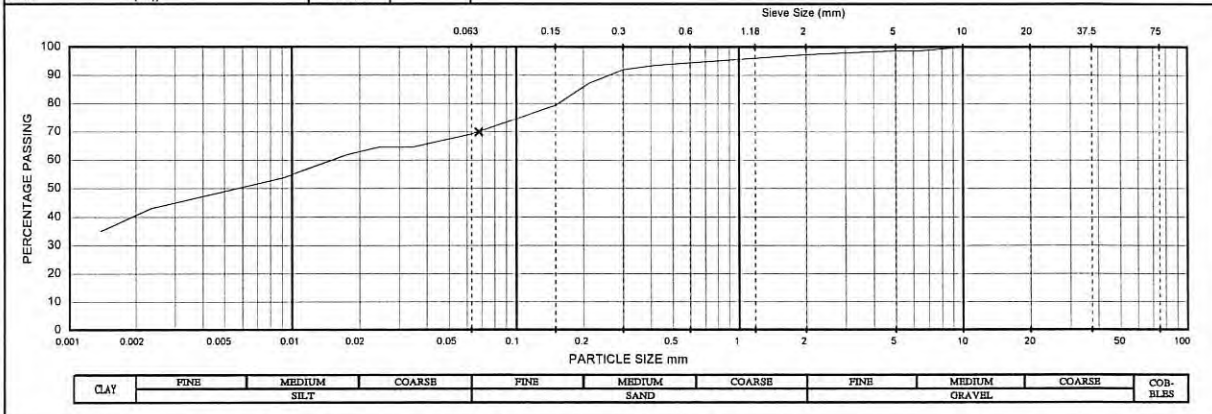
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory : Au Yeung Wai Kit - Laboratory Manager Date : 20 Feb 2023

**\*\*End of Report\*\***

Test Report No. : M160554SL230031(7)

Page 1 of 1

**TEST REPORT ON PARTICLE SIZE DISTRIBUTION OF SOIL**
**Information supplied by Client**

 Client : Fugro Technical Services Limited  
 Client's Address : -


Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

 Client sample No. : H  
 Borehole No. : -  
 Depth (m) From : -  
 To : -  
 Sample origin : -  
 Description : Benthic Survey

Service/Works Order No. : -


**Laboratory Information**

 Date sample received : 08-02-2023  
 Date test commenced : 10-02-2023  
 Date test completed : 15-02-2023  
 Test method used : Geospec 3 (November 2001) Test Method 8.1 & 8.5 & 8.7  
 Method of preparation : Method B  
 Visual description : Moist, dark grey, slightly gravelly, slightly sandy SILT/CLAY with shell fragments.

 Laboratory sample I.D. : SL230031/8  
 Specimen reference : A  
 Sample type : D  
 Location and Orientation within original sample (m) :  
 From : Full Mix  
 To : -

Test Result (Sieve Analysis)				Test Result (Sedimentation Analysis)																																																																																																			
Initial dry mass (m <sub>1</sub> ) g	: 137.211	Mass retained (g)	Percent passing (%)	<table border="1"> <thead> <tr> <th>Date</th> <th>Time Started</th> <th>Period min</th> <th>Temp. °C</th> <th>Hydro. Rdg</th> <th>Hydro. Rdg #</th> <th>Particle dia. mm</th> <th>K %</th> <th>K* %</th> </tr> </thead> <tbody> <tr> <td>14-02-2023</td> <td>8:50</td> <td>0.5</td> <td>25.00</td> <td>14.0</td> <td>0.5</td> <td>0.068</td> <td>89</td> <td>85</td> </tr> <tr> <td></td> <td></td> <td>1</td> <td>25.00</td> <td>13.5</td> <td>0.5</td> <td>0.048</td> <td>86</td> <td>82</td> </tr> <tr> <td></td> <td></td> <td>2</td> <td>25.00</td> <td>13.0</td> <td>0.5</td> <td>0.034</td> <td>83</td> <td>79</td> </tr> <tr> <td></td> <td></td> <td>4</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.024</td> <td>79</td> <td>76</td> </tr> <tr> <td></td> <td></td> <td>8</td> <td>25.00</td> <td>12.5</td> <td>0.5</td> <td>0.017</td> <td>79</td> <td>76</td> </tr> <tr> <td></td> <td></td> <td>30</td> <td>25.00</td> <td>12.0</td> <td>0.5</td> <td>0.0090</td> <td>76</td> <td>72</td> </tr> <tr> <td></td> <td></td> <td>120</td> <td>25.00</td> <td>9.5</td> <td>0.5</td> <td>0.0046</td> <td>59</td> <td>57</td> </tr> <tr> <td></td> <td></td> <td>480</td> <td>25.00</td> <td>8.5</td> <td>0.5</td> <td>0.0023</td> <td>53</td> <td>50</td> </tr> <tr> <td></td> <td></td> <td>1440</td> <td>25.00</td> <td>7.0</td> <td>0.5</td> <td>0.0014</td> <td>43</td> <td>41</td> </tr> </tbody> </table> <p># Hydrometer reading in solution only (R<sub>0</sub>)                      K* modified according to Geospec 3 (November 2001) Test Method 8.7</p>										Date	Time Started	Period min	Temp. °C	Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %	14-02-2023	8:50	0.5	25.00	14.0	0.5	0.068	89	85			1	25.00	13.5	0.5	0.048	86	82			2	25.00	13.0	0.5	0.034	83	79			4	25.00	12.5	0.5	0.024	79	76			8	25.00	12.5	0.5	0.017	79	76			30	25.00	12.0	0.5	0.0090	76	72			120	25.00	9.5	0.5	0.0046	59	57			480	25.00	8.5	0.5	0.0023	53	50			1440	25.00	7.0	0.5	0.0014	43	41
Date	Time Started	Period min	Temp. °C											Hydro. Rdg	Hydro. Rdg #	Particle dia. mm	K %	K* %																																																																																					
14-02-2023	8:50	0.5	25.00											14.0	0.5	0.068	89	85																																																																																					
		1	25.00											13.5	0.5	0.048	86	82																																																																																					
		2	25.00											13.0	0.5	0.034	83	79																																																																																					
		4	25.00											12.5	0.5	0.024	79	76																																																																																					
		8	25.00											12.5	0.5	0.017	79	76																																																																																					
		30	25.00											12.0	0.5	0.0090	76	72																																																																																					
		120	25.00											9.5	0.5	0.0046	59	57																																																																																					
		480	25.00											8.5	0.5	0.0023	53	50																																																																																					
		1440	25.00											7.0	0.5	0.0014	43	41																																																																																					
Sieve size mm																																																																																																							
100		0.000	100																																																																																																				
75		0.000	100																																																																																																				
63		0.000	100																																																																																																				
50		0.000	100																																																																																																				
37.5		0.000	100																																																																																																				
28		0.000	100																																																																																																				
20		0.000	100																																																																																																				
Passing (m <sub>2</sub> )	20	137.211																																																																																																					
Riffled passing (m <sub>3</sub> )	20	137.211																																																																																																					
Wash passing (m <sub>4</sub> )	20	22.190																																																																																																					
	14	0.000	100																																																																																																				
	10	0.000	100																																																																																																				
	6.3	1.060	99																																																																																																				
Passing (m <sub>5</sub> )	6.3	21.130																																																																																																					
Riffled passing (m <sub>6</sub> )	6.3	21.130																																																																																																					
	5.0	0.200	99																																																																																																				
	3.35	1.090	98																																																																																																				
	2.00	1.600	97																																																																																																				
	1.18	1.680	96																																																																																																				
	0.600	2.400	94																																																																																																				
	0.425	1.662	93																																																																																																				
	0.300	2.370	91																																																																																																				
	0.212	3.200	89																																																																																																				
	0.150	2.330	87																																																																																																				
	0.063	4.138	84																																																																																																				
Pan (m <sub>7</sub> )		0.460																																																																																																					

**SUMMATION :** GRAVEL % : 3  
 SAND % : 13  
 SILT % : 37  
 CLAY % : 47

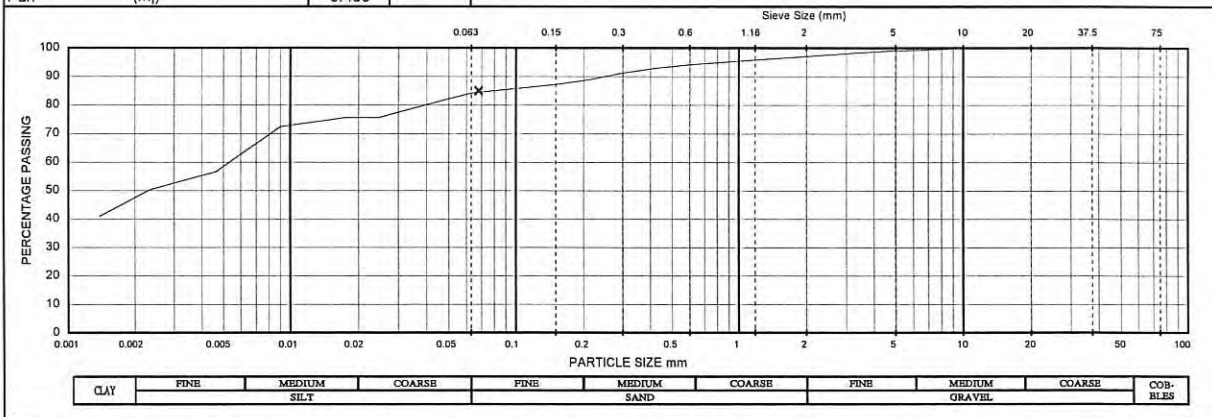
 Abbreviations used : Sample type : U = undisturbed, P = piston, M = mazier, BLK = block, D = disturbed (bulk)  
 Remarks : Point x(s) on graph indicate(s) initial modified hydrometer reading(s) being ignored.  
 Coefficient of Uniformity is undefined.

 Initial dry mass\* : The initial dry mass of the test specimen in the Sedimentation Analysis was not enough according to the requirement of GEOSPEC 3 (2001)  
 - The results apply to the sample as received.

Approved Signatory : Au Yeung Wai Kit - Laboratory Manager

Date : 20 Feb 2023

**\*\*End of Report\*\***

Report No. : 181172EN230440



Page 1 of 2

**Test Report on Analysis of Water and Wastewater****Information Supplied by Client**

Client : Fugro Technical Services Limited

Client's address : Rm 723-726, 7/F, Profit Industrial Building, No.1-15, Kwai Fung Crescent, Kwai Chung, N.T.

Project : Contract No. CM 14/2016 Environmental Team for Operational Environmental Monitoring and Audit for Siu Ho Wan Sewage Treatment Works

Sampling date : 08/02/2023

Sampling location : -

Sample description : Eight sample(s) of Rinsate Blank

Sample identification :  
1. A/Rinsate Blank  
2. B/Rinsate Blank  
3. C/Rinsate Blank  
4. D/Rinsate Blank  
5. E/Rinsate Blank  
6. F/Rinsate Blank  
7. G/Rinsate Blank  
8. H/Rinsate Blank

Test required : Total recoverable metals:  
1. Arsenic content  
2. Cadmium content  
3. Chromium content  
4. Copper content  
5. Lead content  
6. Mercury content  
7. Nickel content  
8. Silver content  
9. Zinc content

**Laboratory Information**

Lab sample ID : EN230440/17-24

Date of receipt of sample : 08/02/2023

Date test completed : 09/02/2023

Test method used : In-house method E-T-189 & E-T-190 (ICP-MS)

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172EN230440


Page 2 of 2

**Results :**

		Client sample ID	A/Rinsate Blank	B/Rinsate Blank	C/Rinsate Blank	D/Rinsate Blank
Item	LOR	Unit				
In-house method E-T-189 & E-T-190 (ICP-MS)						
Arsenic	1	µg/L	<1	<1	<1	<1
Cadmium	0.2	µg/L	<0.2	<0.2	<0.2	<0.2
Chromium	1	µg/L	2	2	2	2
Copper	1	µg/L	3	12	3	3
Lead	1	µg/L	<1	<1	<1	<1
Mercury	0.5	µg/L	<0.5	<0.5	<0.5	<0.5
Nickel	1	µg/L	2	2	2	2
Silver	1	µg/L	<1	<1	<1	<1
Zinc	10	µg/L	20	20	20	20

		Client sample ID	E/Rinsate Blank	F/Rinsate Blank	G/Rinsate Blank	H/Rinsate Blank
Item	LOR	Unit				
In-house method E-T-189 & E-T-190 (ICP-MS)						
Arsenic	1	µg/L	<1	<1	<1	<1
Cadmium	0.2	µg/L	<0.2	<0.2	<0.2	<0.2
Chromium	1	µg/L	2	2	7	2
Copper	1	µg/L	2	3	5	2
Lead	1	µg/L	<1	<1	<1	<1
Mercury	0.5	µg/L	<0.5	<0.5	<0.5	<0.5
Nickel	1	µg/L	2	2	2	2
Silver	1	µg/L	<1	<1	<1	<1
Zinc	10	µg/L	20	20	20	20

- Remark: 1. The sampling procedure for the sample received in this report is outside the scope of accreditation.  
 2. µg/L - microgram per litre

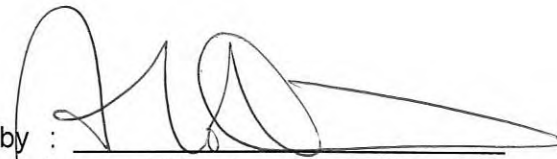Certified by :   
 Approved Signatory: HO Kin Man, John  
 Assistant General Manager – Laboratories

Date : 9/3/2023

**\*\* End of Report \*\***


*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

Report No. : 181172EN230440

**Note**
**Method Blank (MB), Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report**

Heavy metals content, µg/L									
Item	Method Blank (MB) Report		Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Report						
	LOR	Result	Spike Concentration	Spike recovery (%)		Recovery limits (%)		RPD%	
				MS	MSD	Low	High	Value	Control Limited
Arsenic	1	< 0.5	10	103.1	-	75.0%	125.0%	-	-
Cadmium	0.2	< 0.1	10	99.6	-	75.0%	125.0%	-	-
Chromium	1	< 0.5	10	100.4	-	75.0%	125.0%	-	-
Copper	1	< 0.5	10	100.3	-	75.0%	125.0%	-	-
Lead	1	< 0.5	10	91.3	-	75.0%	125.0%	-	-
Mercury	0.5	< 0.25	0.5	97.4	-	75.0%	125.0%	-	-
Nickel	1	< 0.5	10	97.7	-	75.0%	125.0%	-	-
Silver	1	< 0.5	10	97.9	-	75.0%	125.0%	-	-
Zinc	10	< 5	100	98.1	-	75.0%	125.0%	-	-

Certified by :




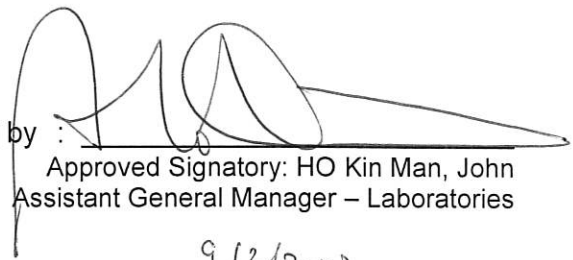

 Approved Signatory: HO Kin Man, John  
 Assistant General Manager – Laboratories

Date :


9/3/2023

*Note : This report refers only to the sample(s) tested and the result(s) applied to the sample(s) as received.*

pH value

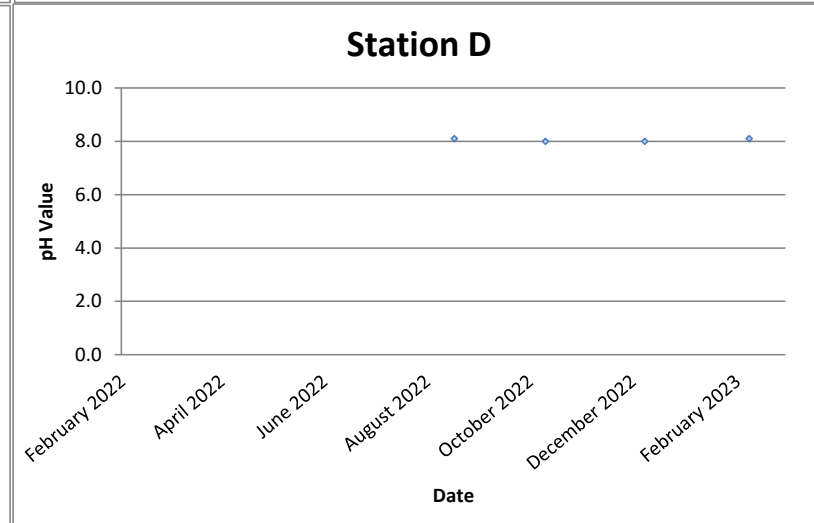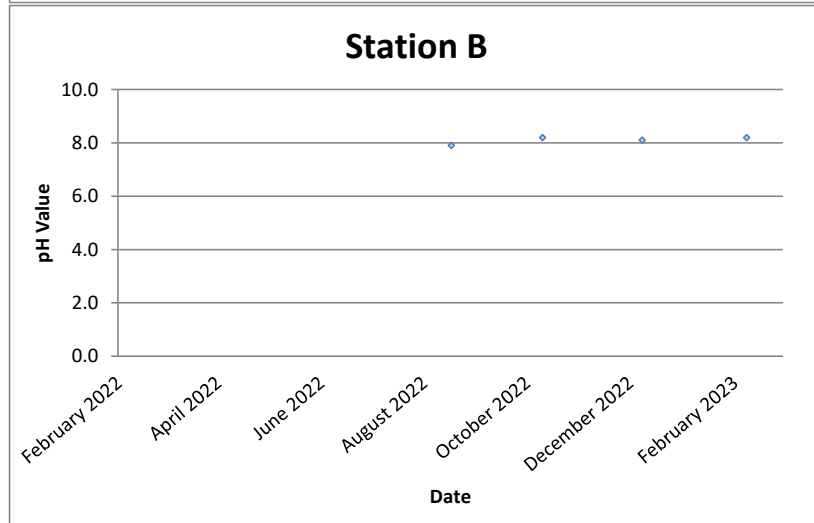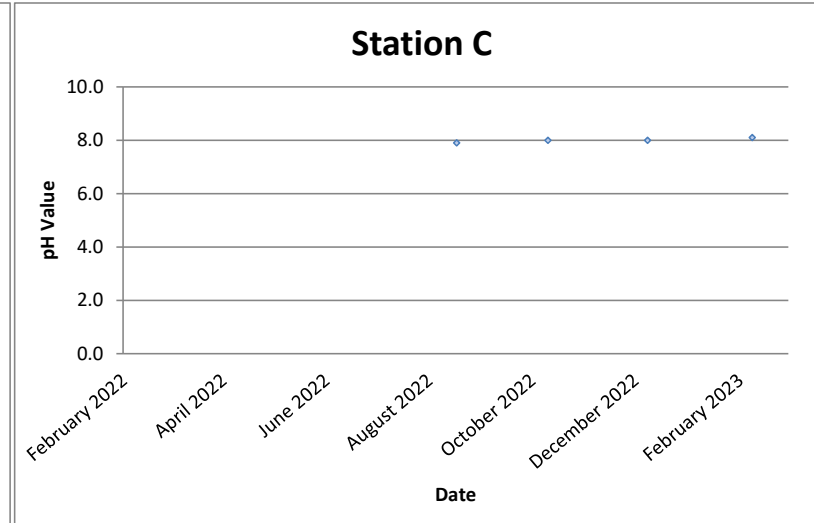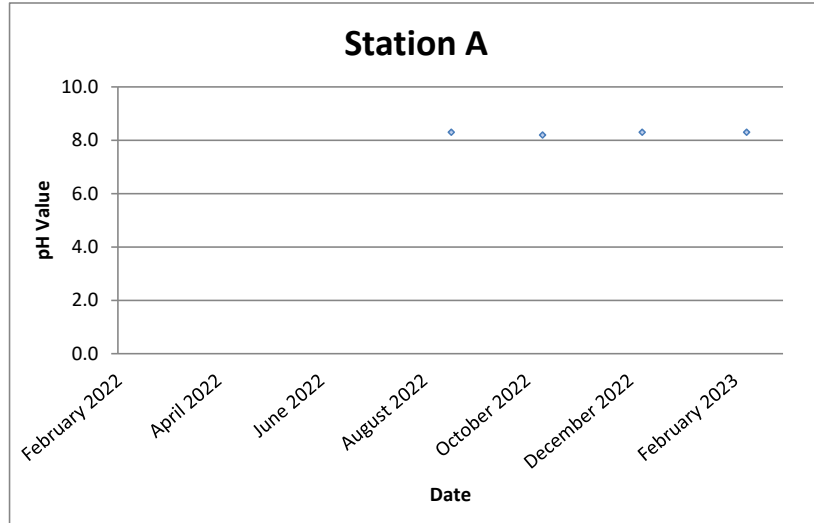


pH value

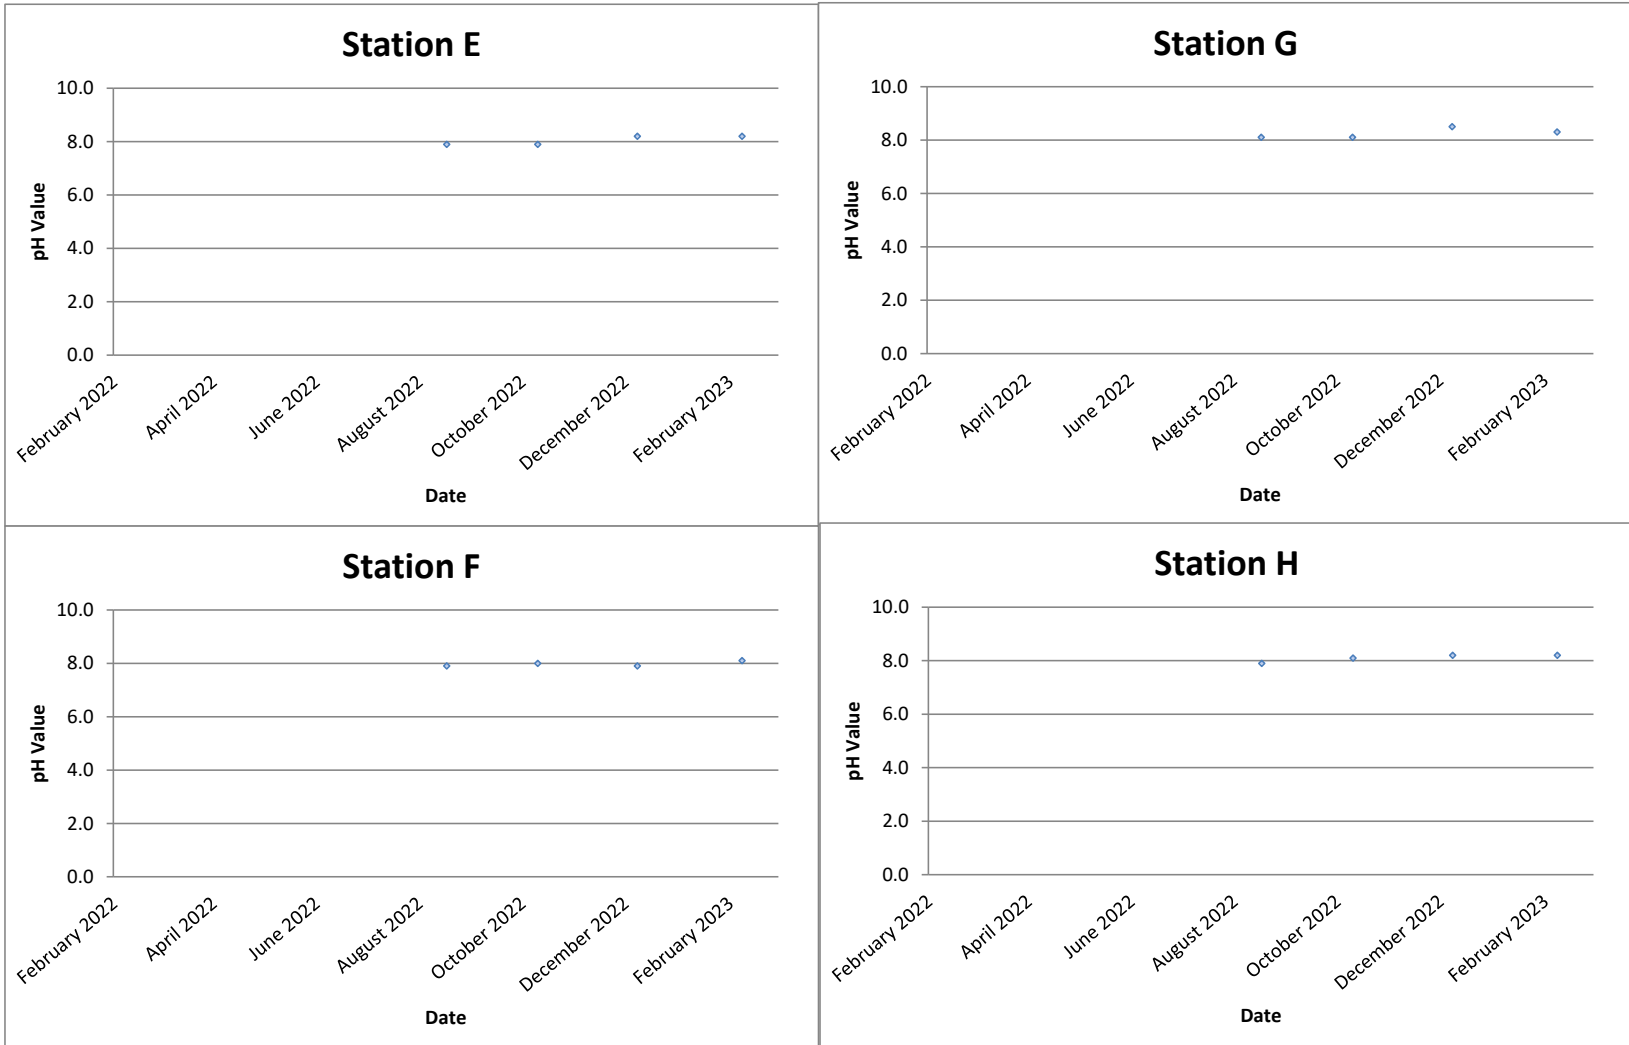





Ammonia Nitrogen (mg-N/kg)

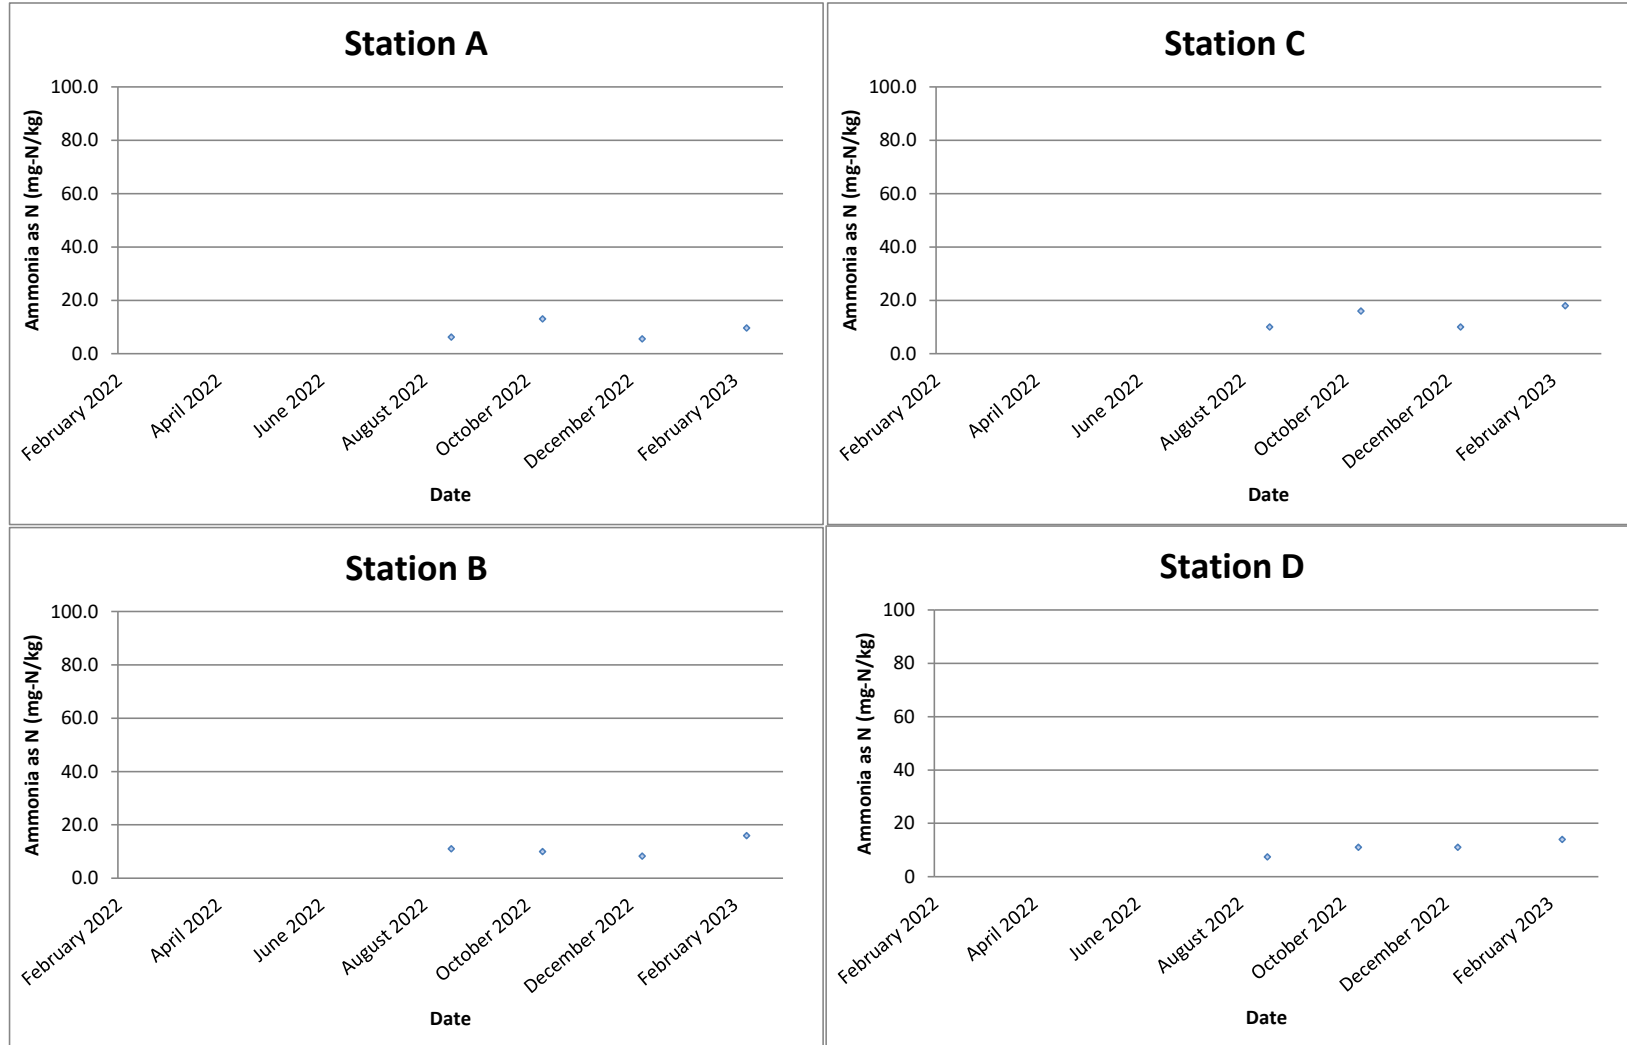


Ammonia Nitrogen (mg-N/kg)

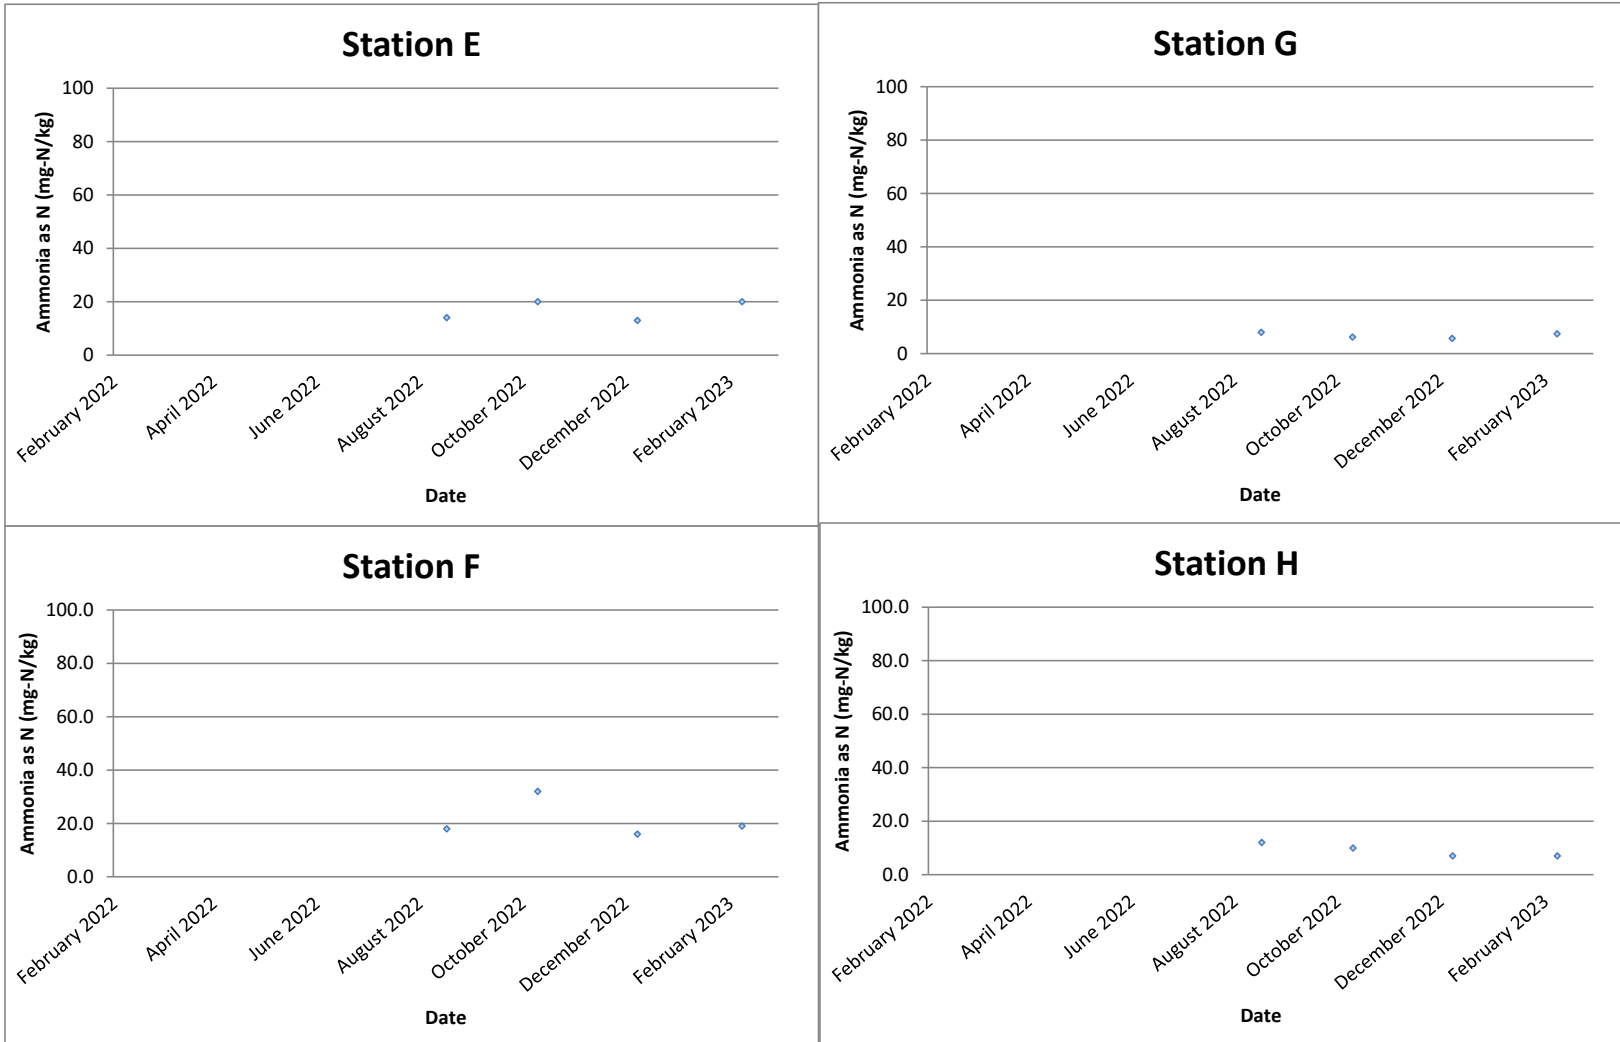


Total Nitrogen (mg-N/kg)

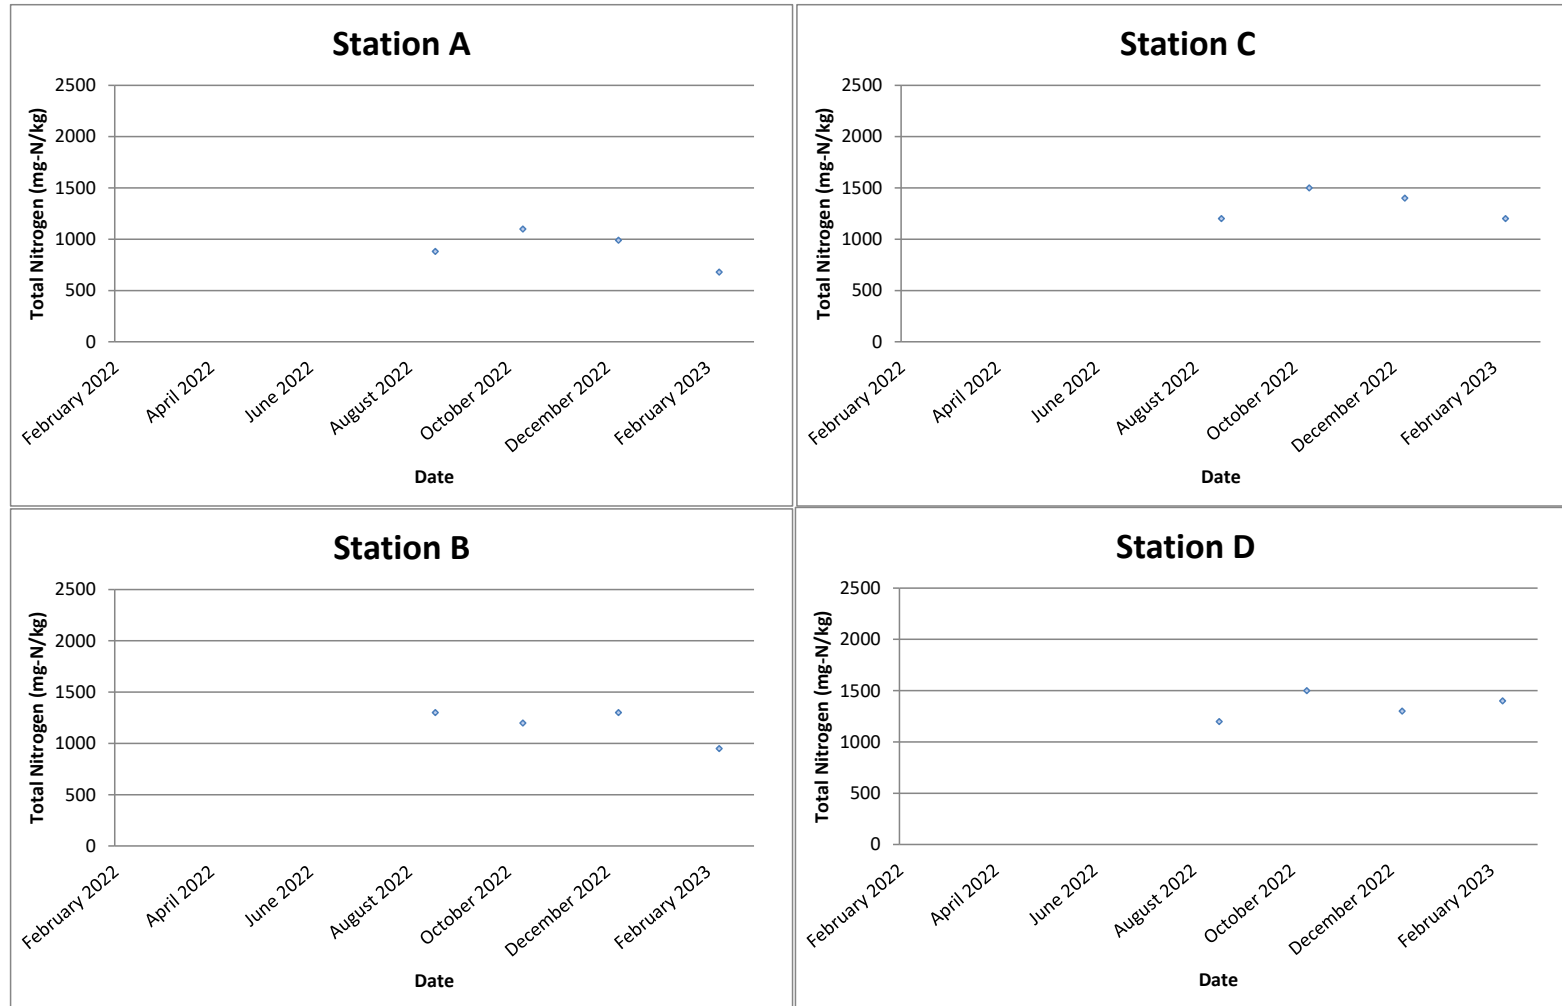


Total Nitrogen (mg-N/kg)

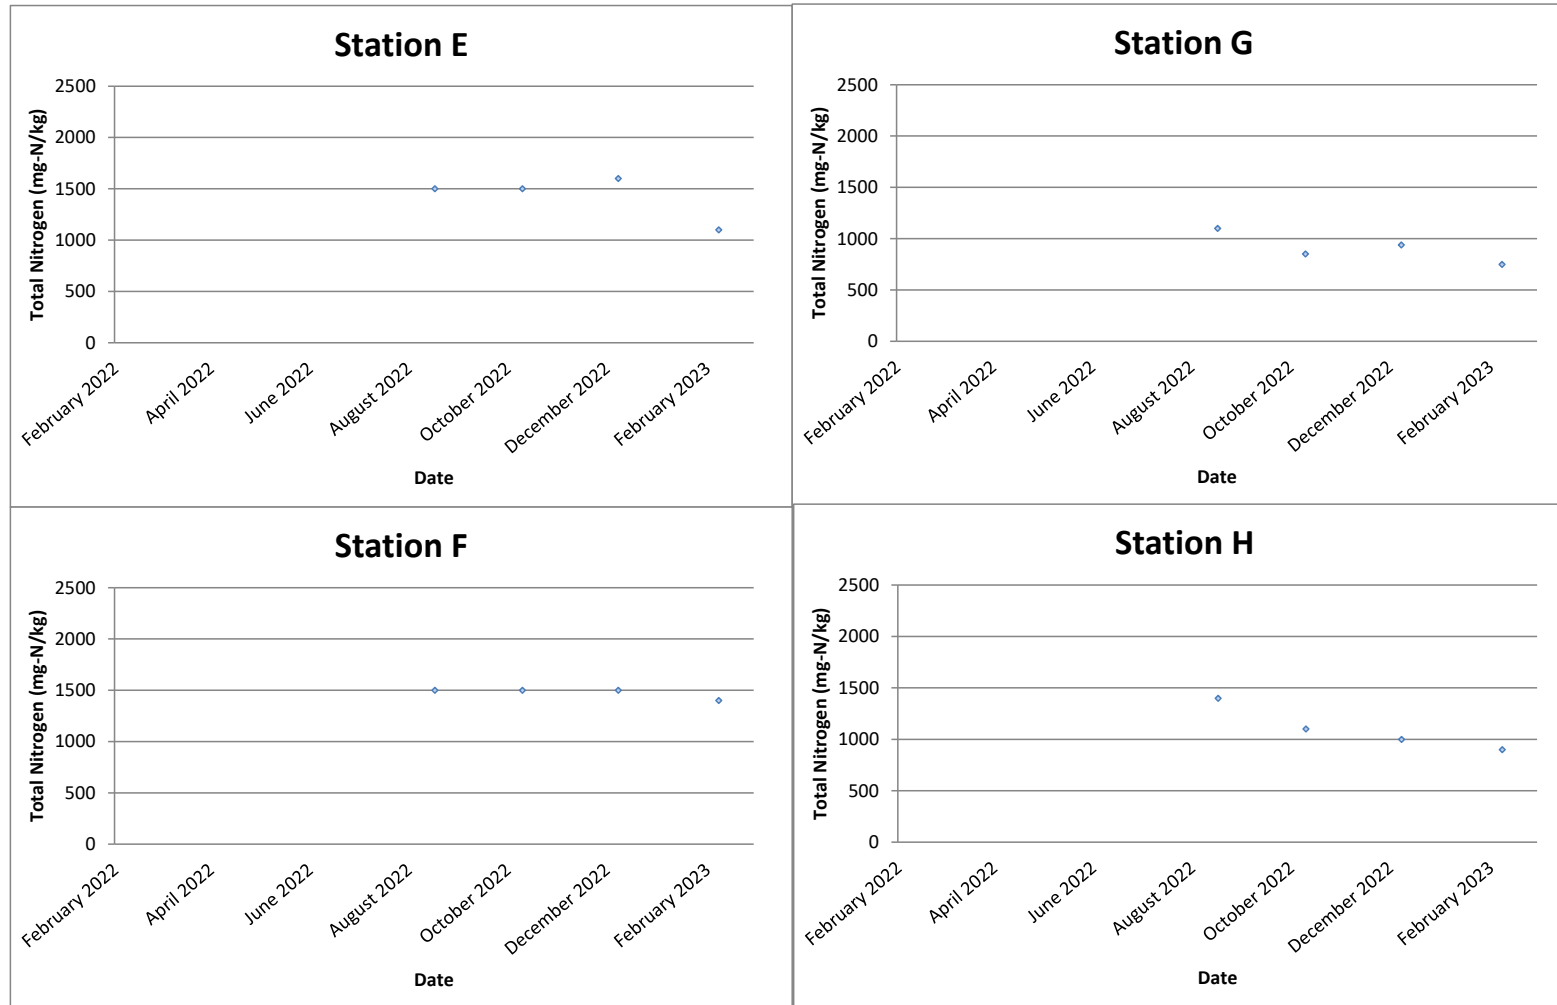


Total Phosphorus (mg-P/kg)

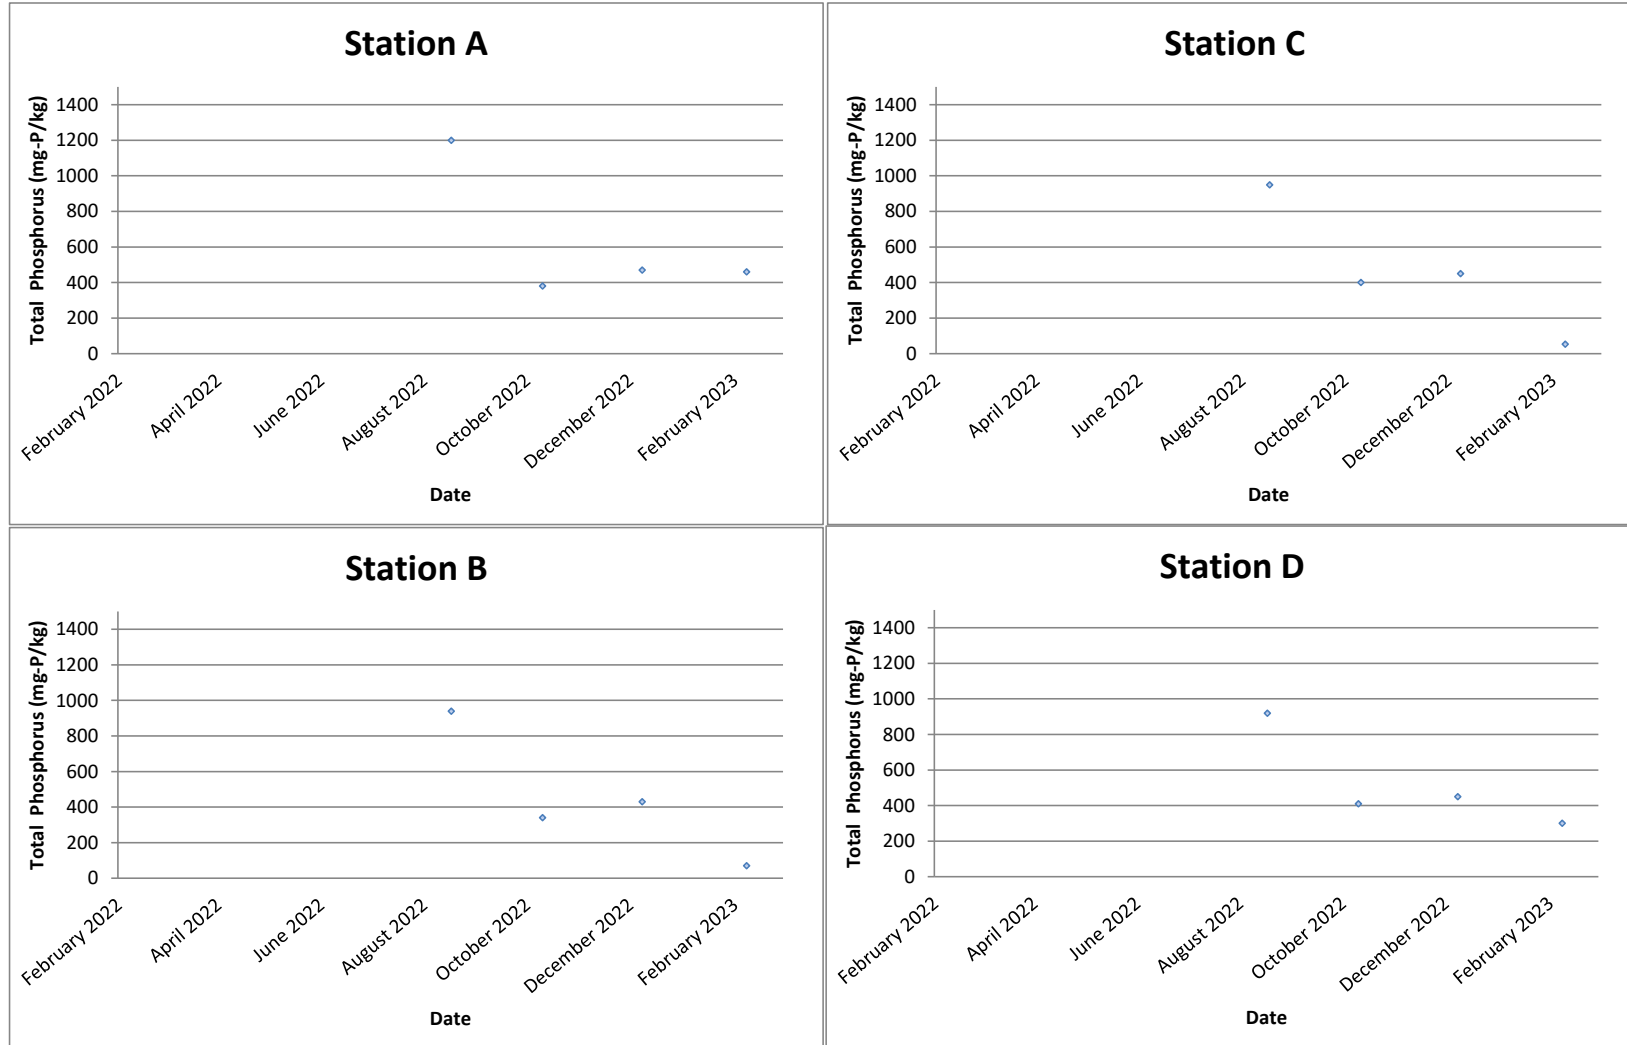

Total Phosphorus (mg-P/kg)

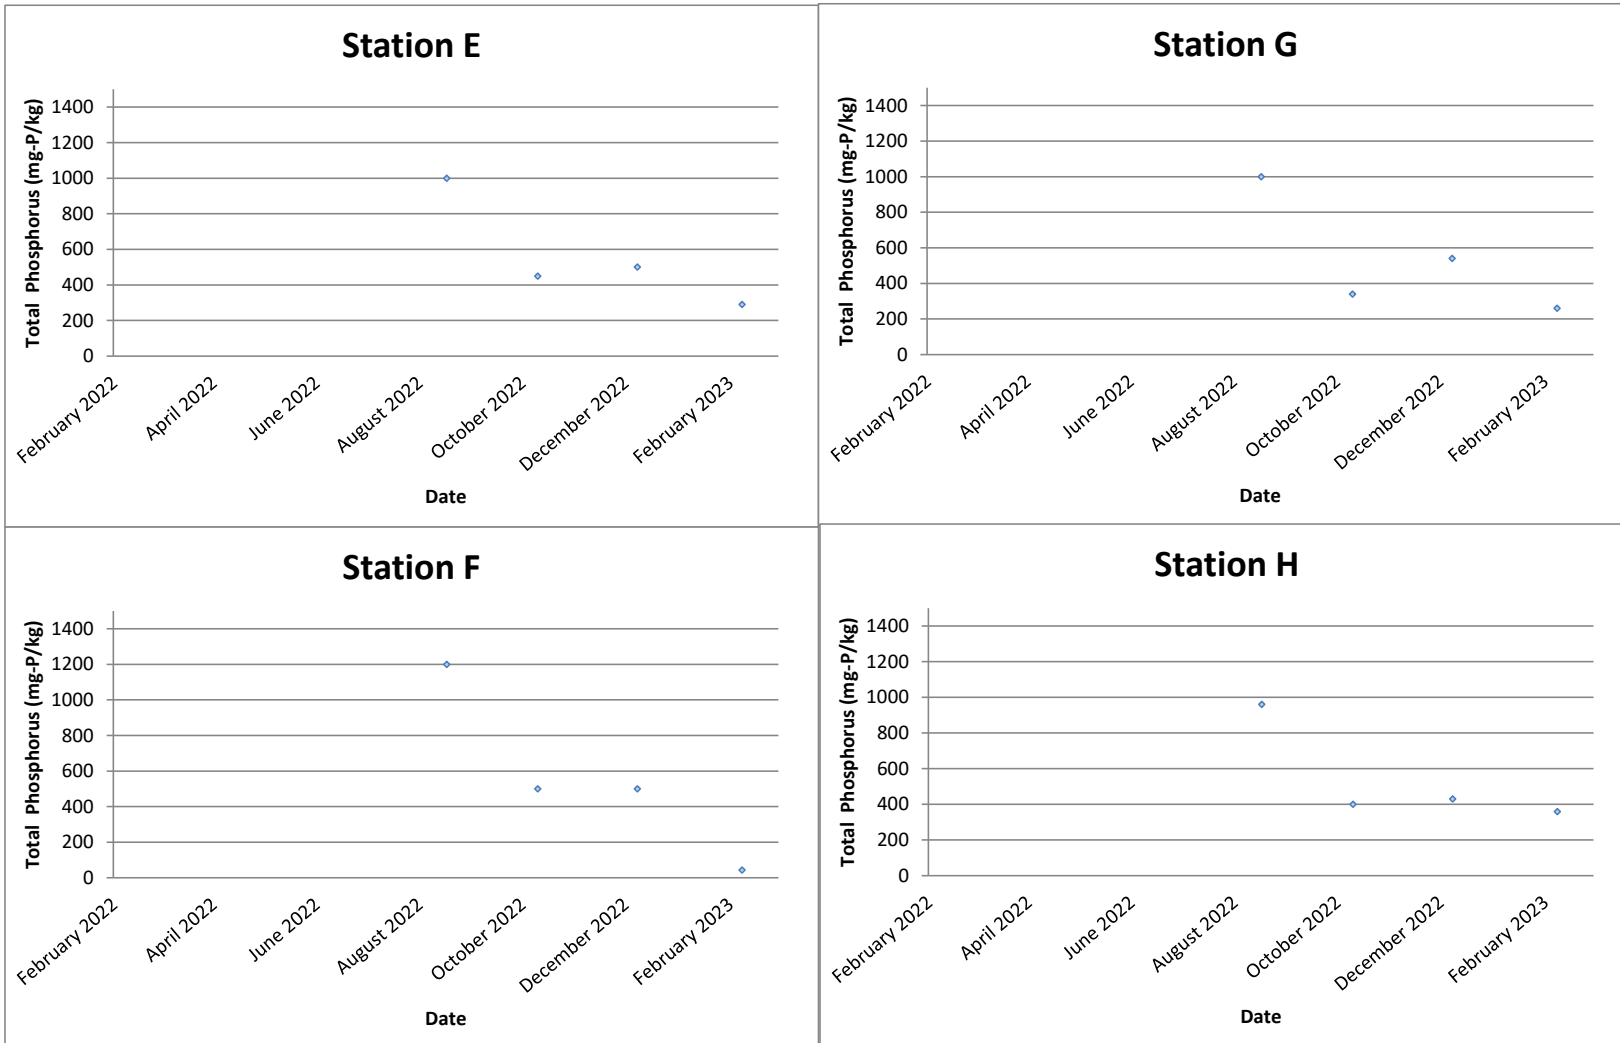


### Cadmium (mg/kg)

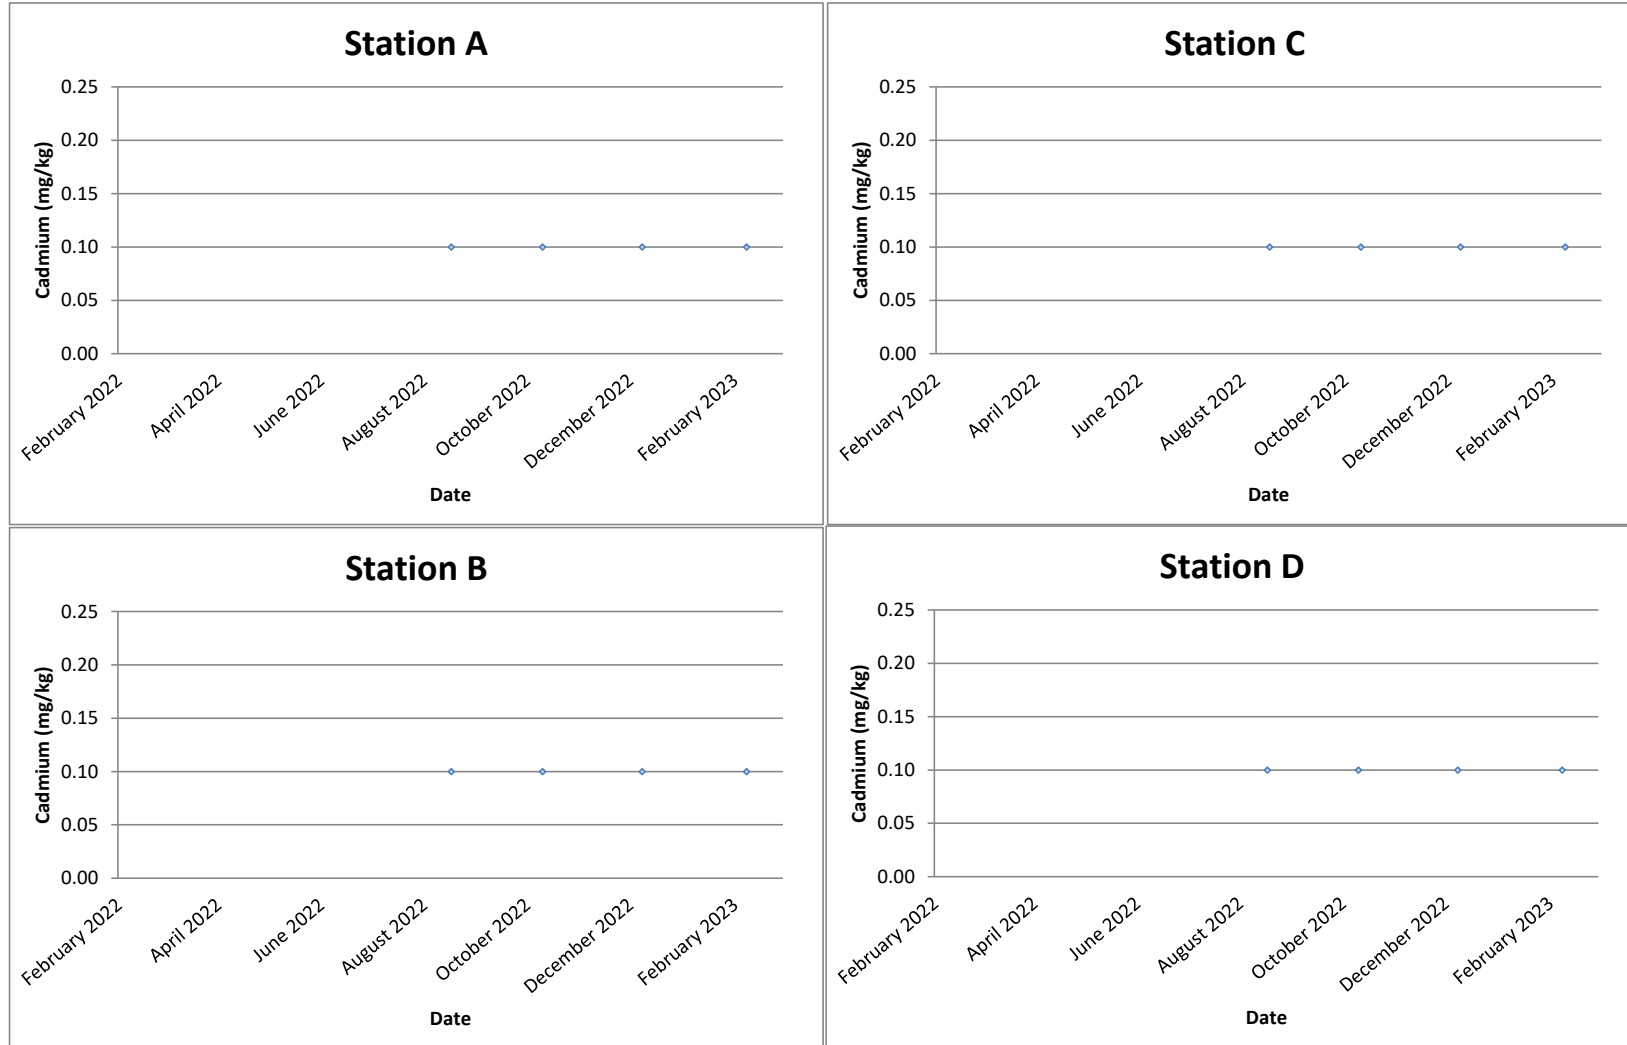

Remark: All below the Limit of Report sample results (<0.1 mg/kg) for Cadmium is regarded as 0.1 mg/kg in graphical presentation.


### Cadmium (mg/kg)

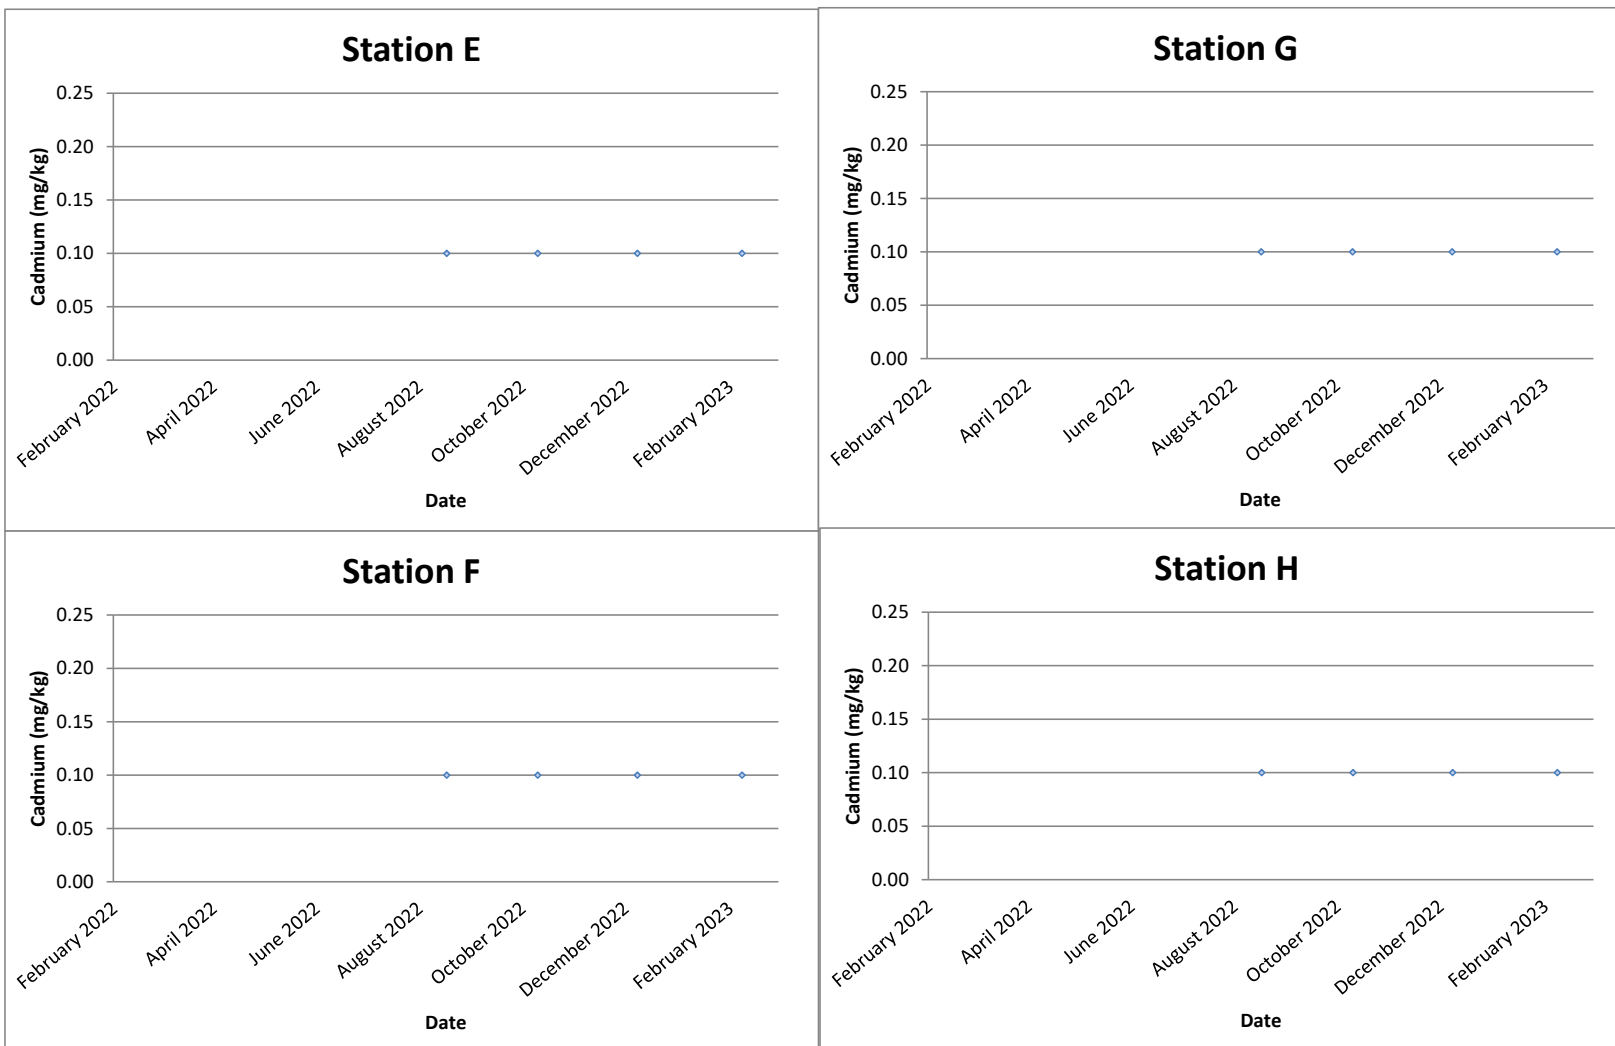


Remark: All below the Limit of Report sample results (<0.1 mg/kg) for Cadmium is regarded as 0.1 mg/kg in graphical presentation.







Chromium (mg/kg)

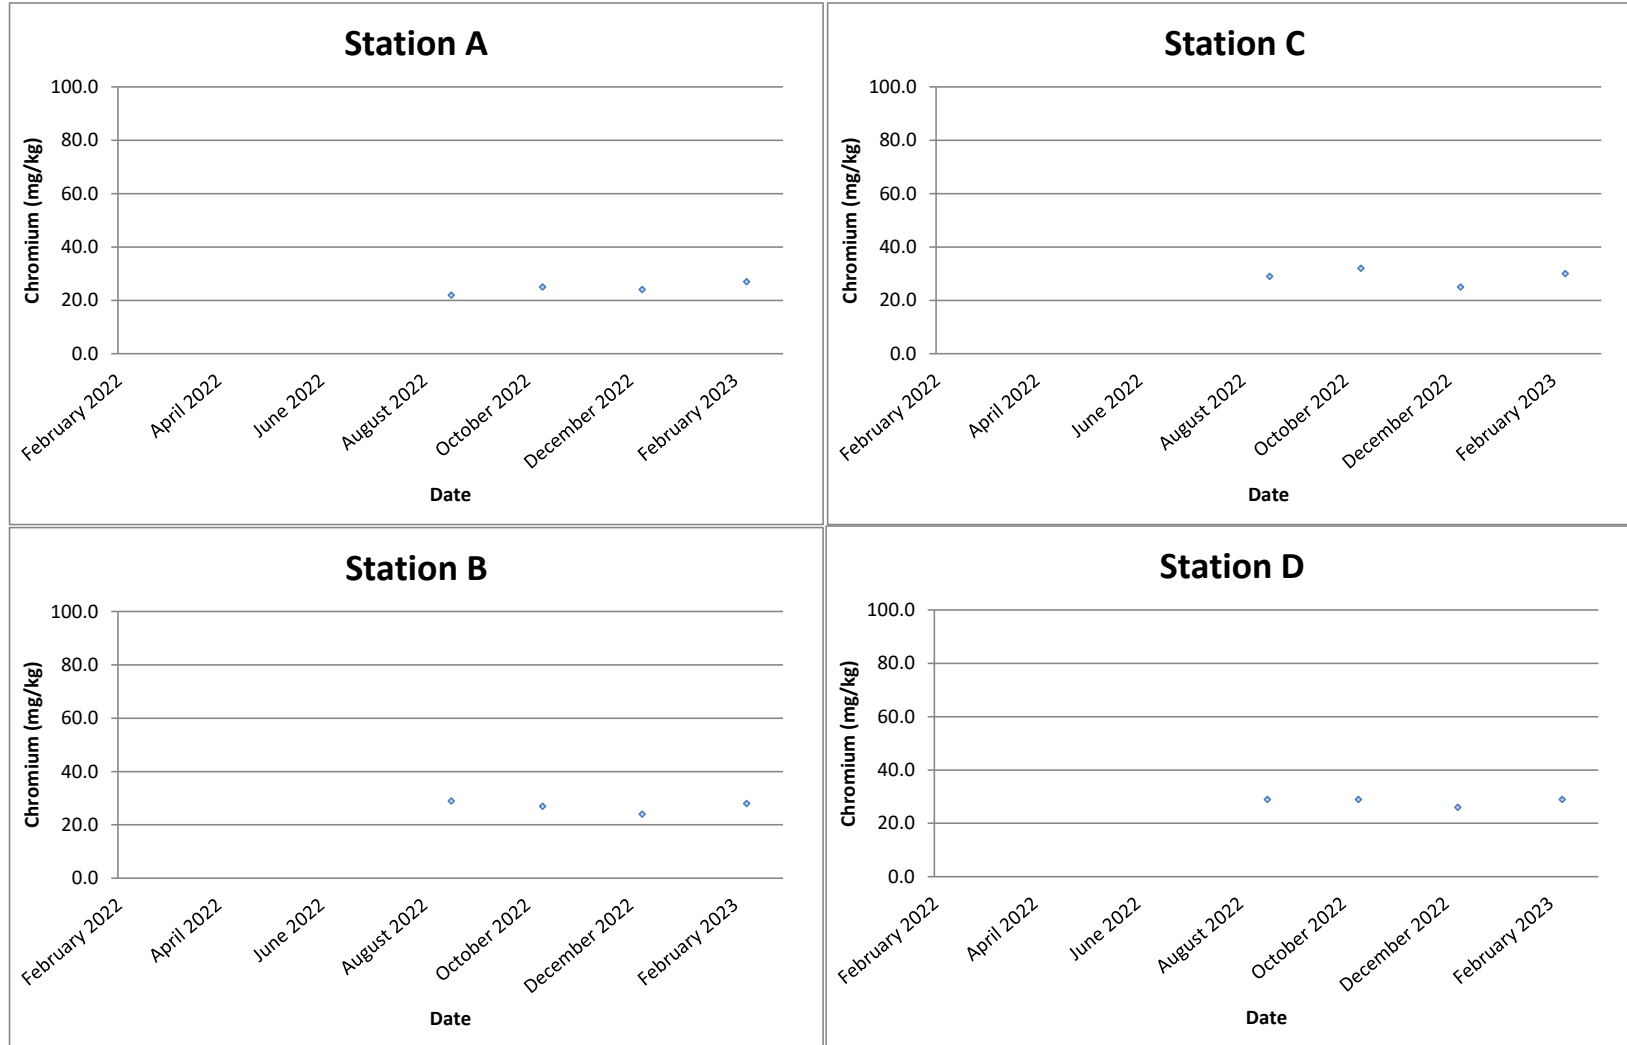


Chromium (mg/kg)

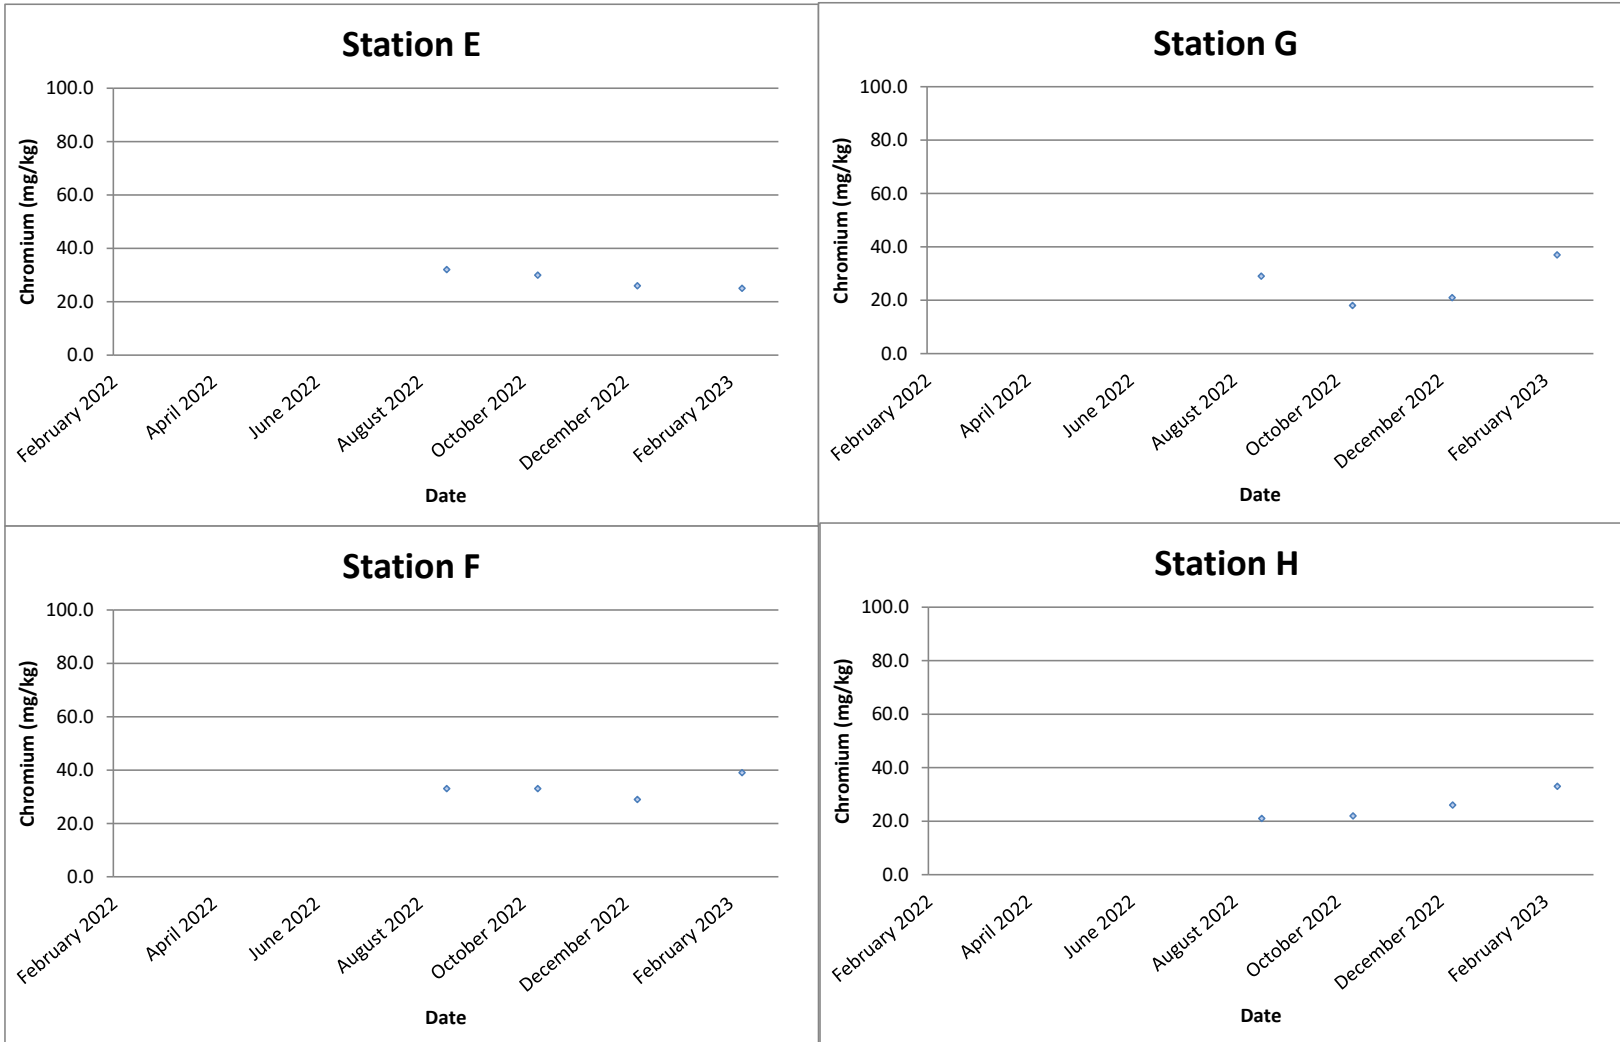





Copper (mg/kg)

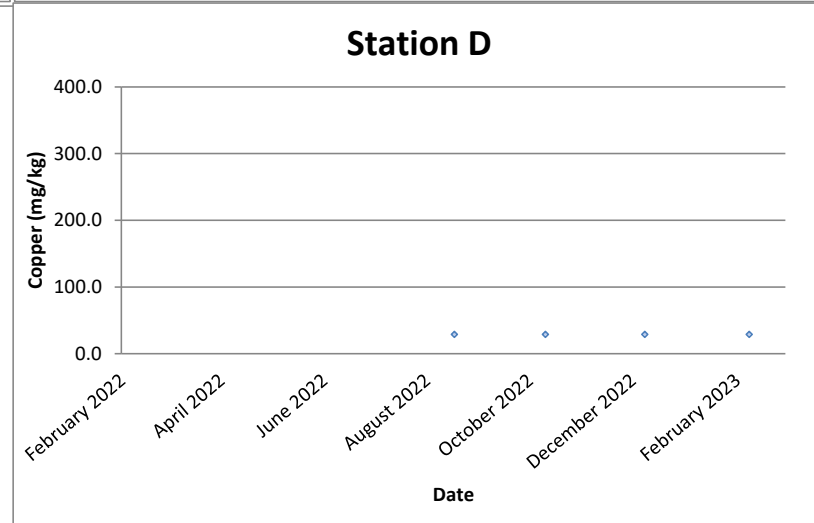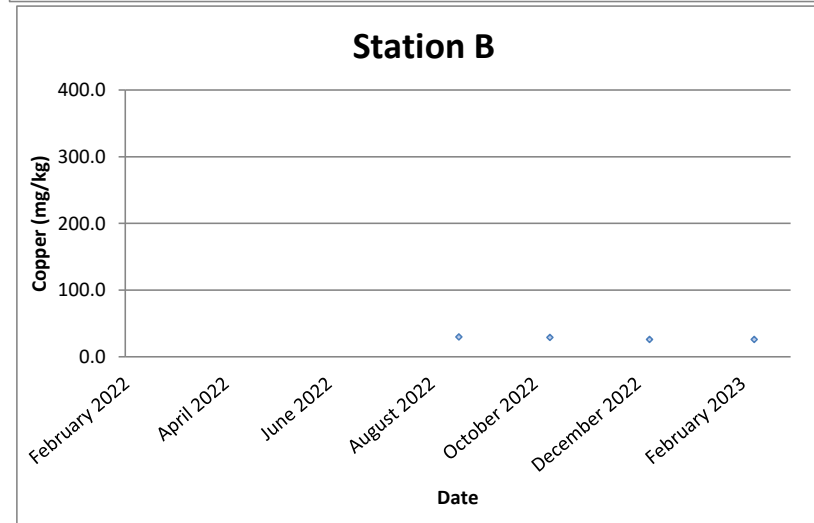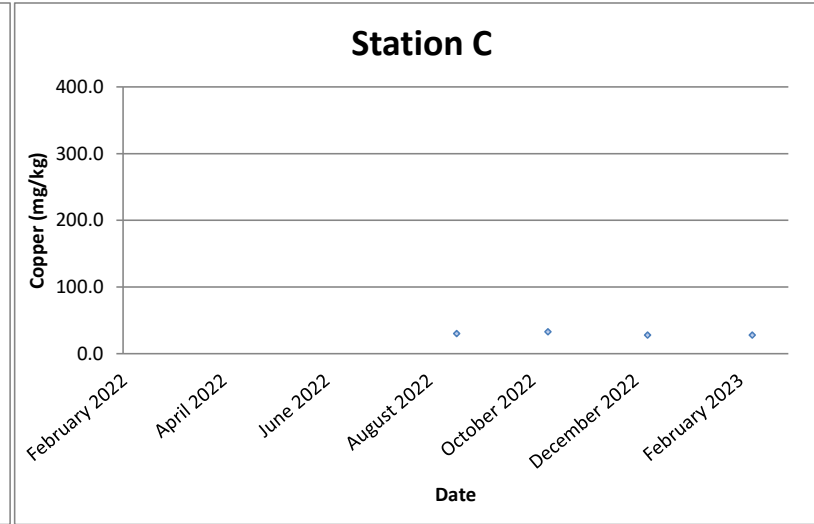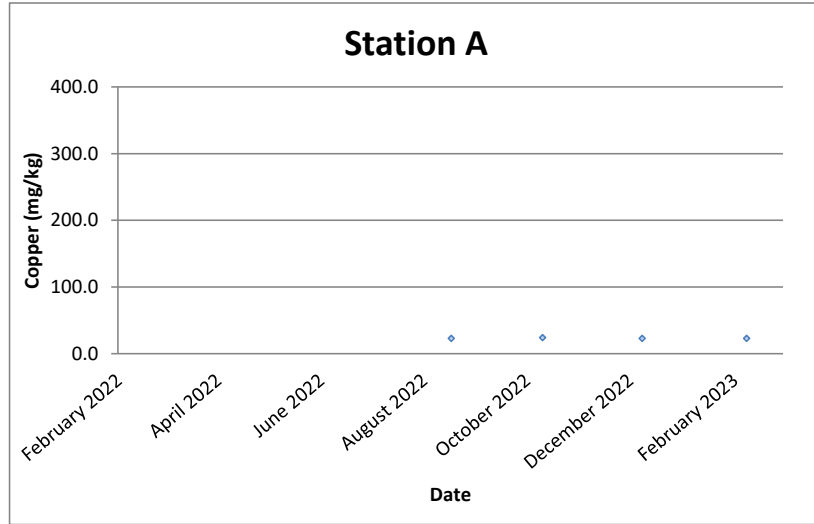


Copper (mg/kg)

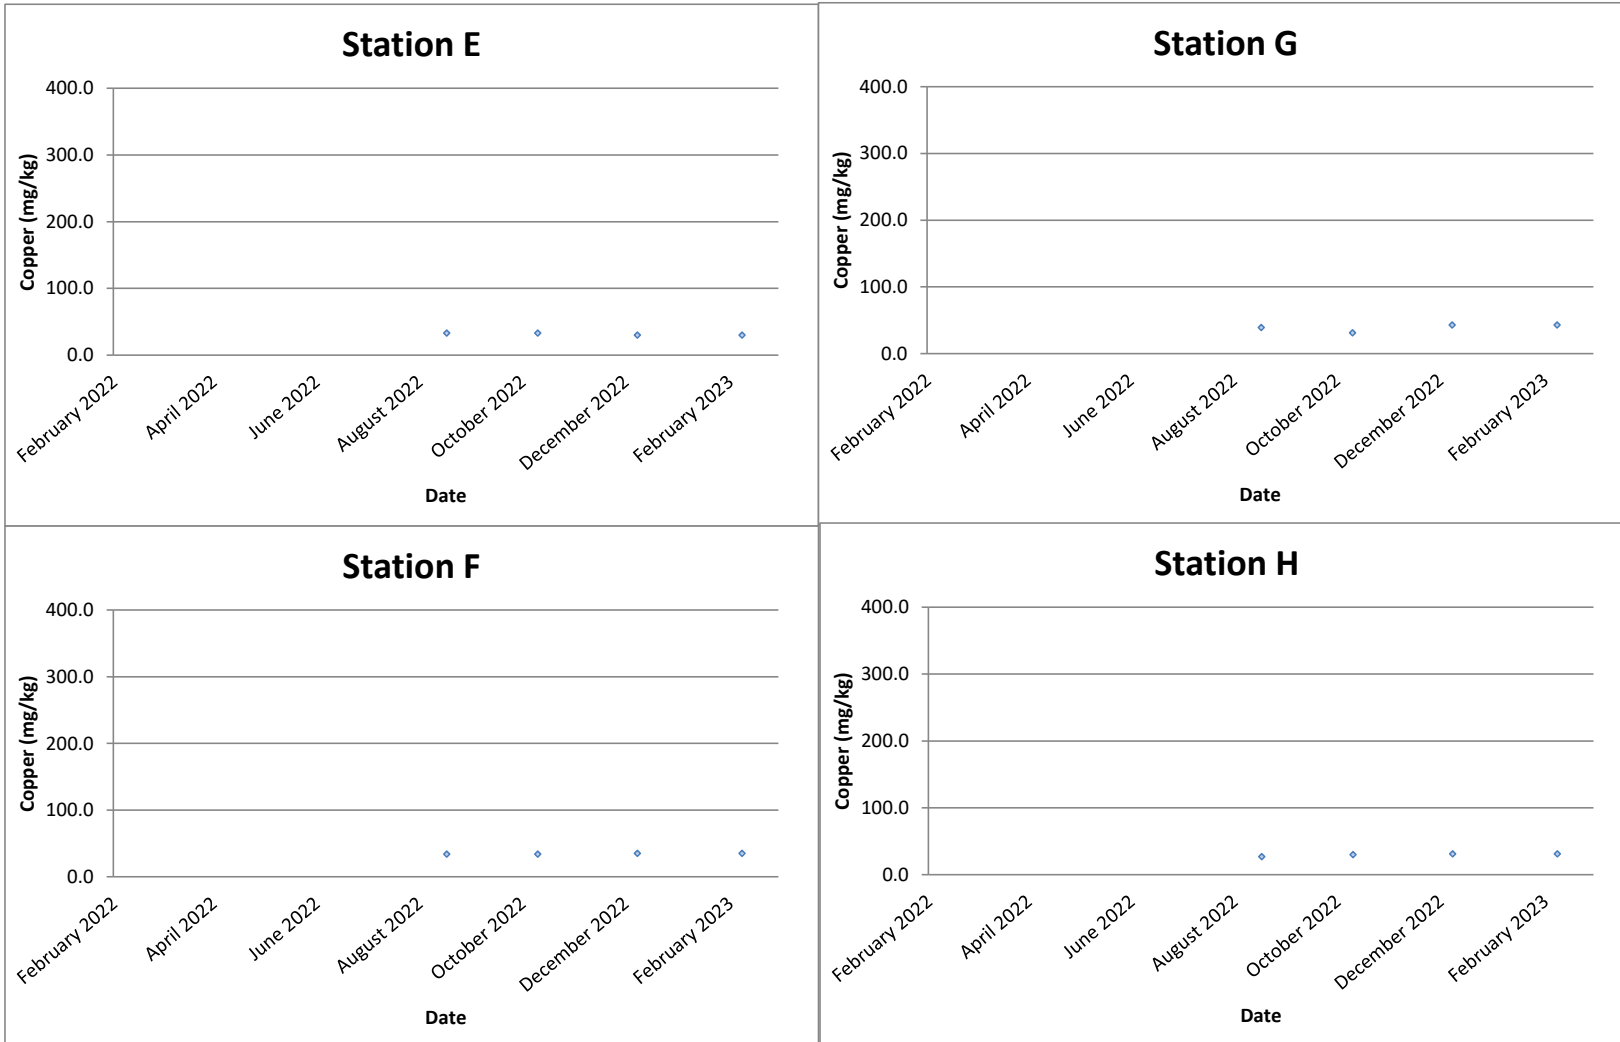


Lead (mg/kg)

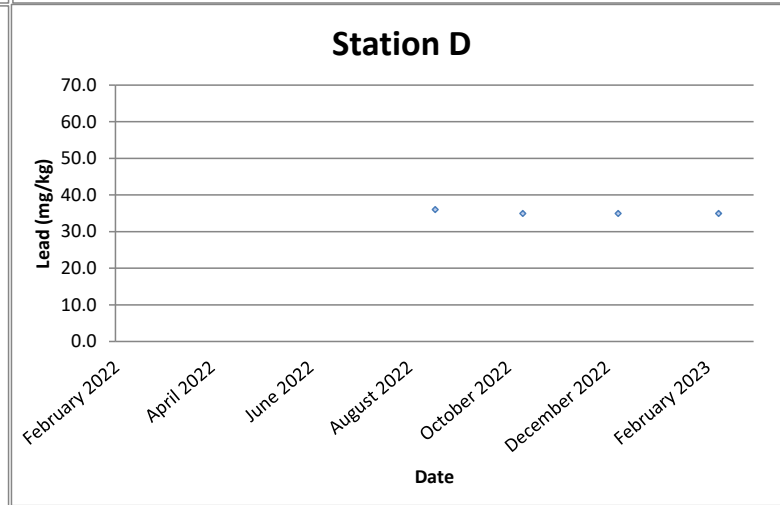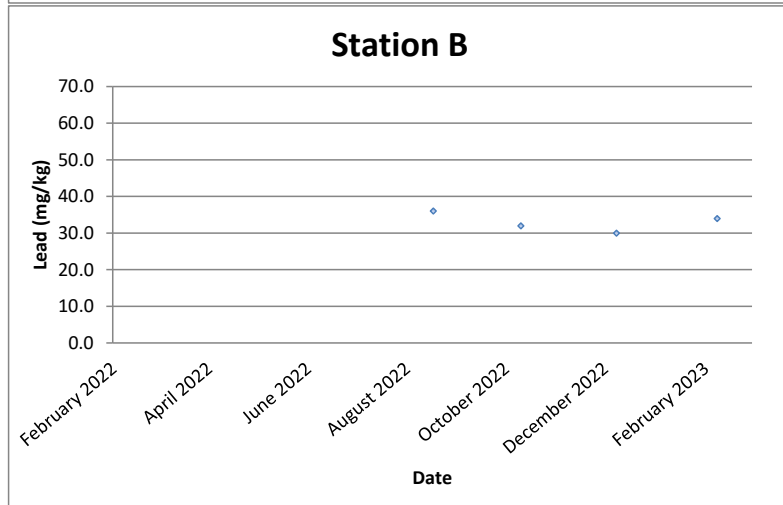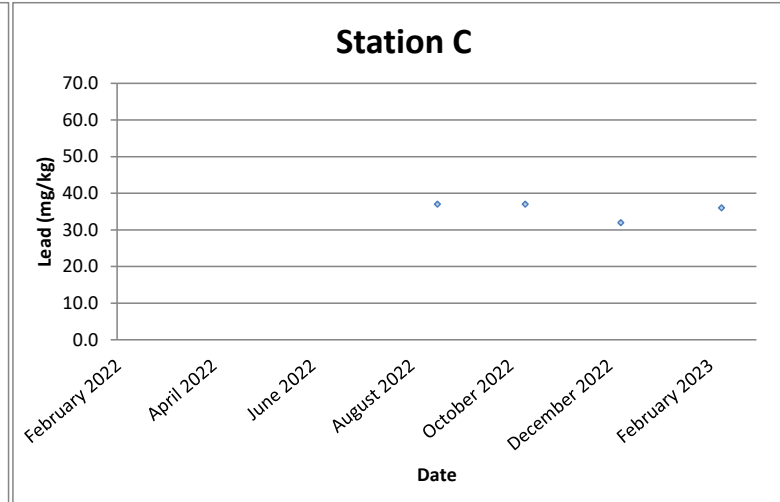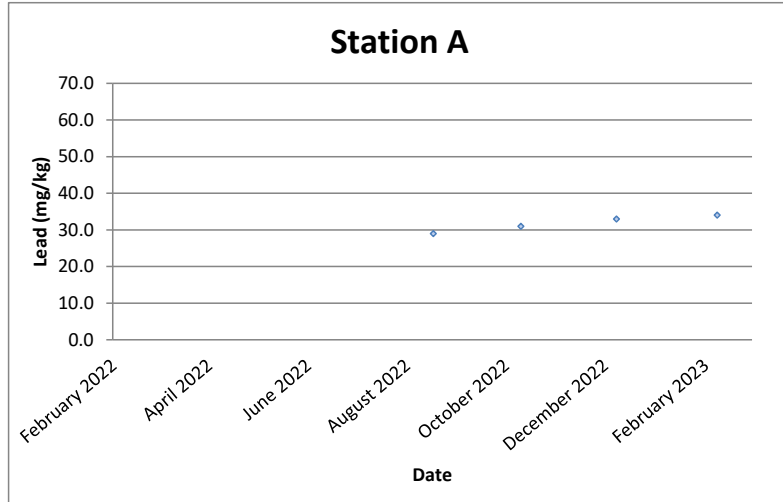


Lead (mg/kg)

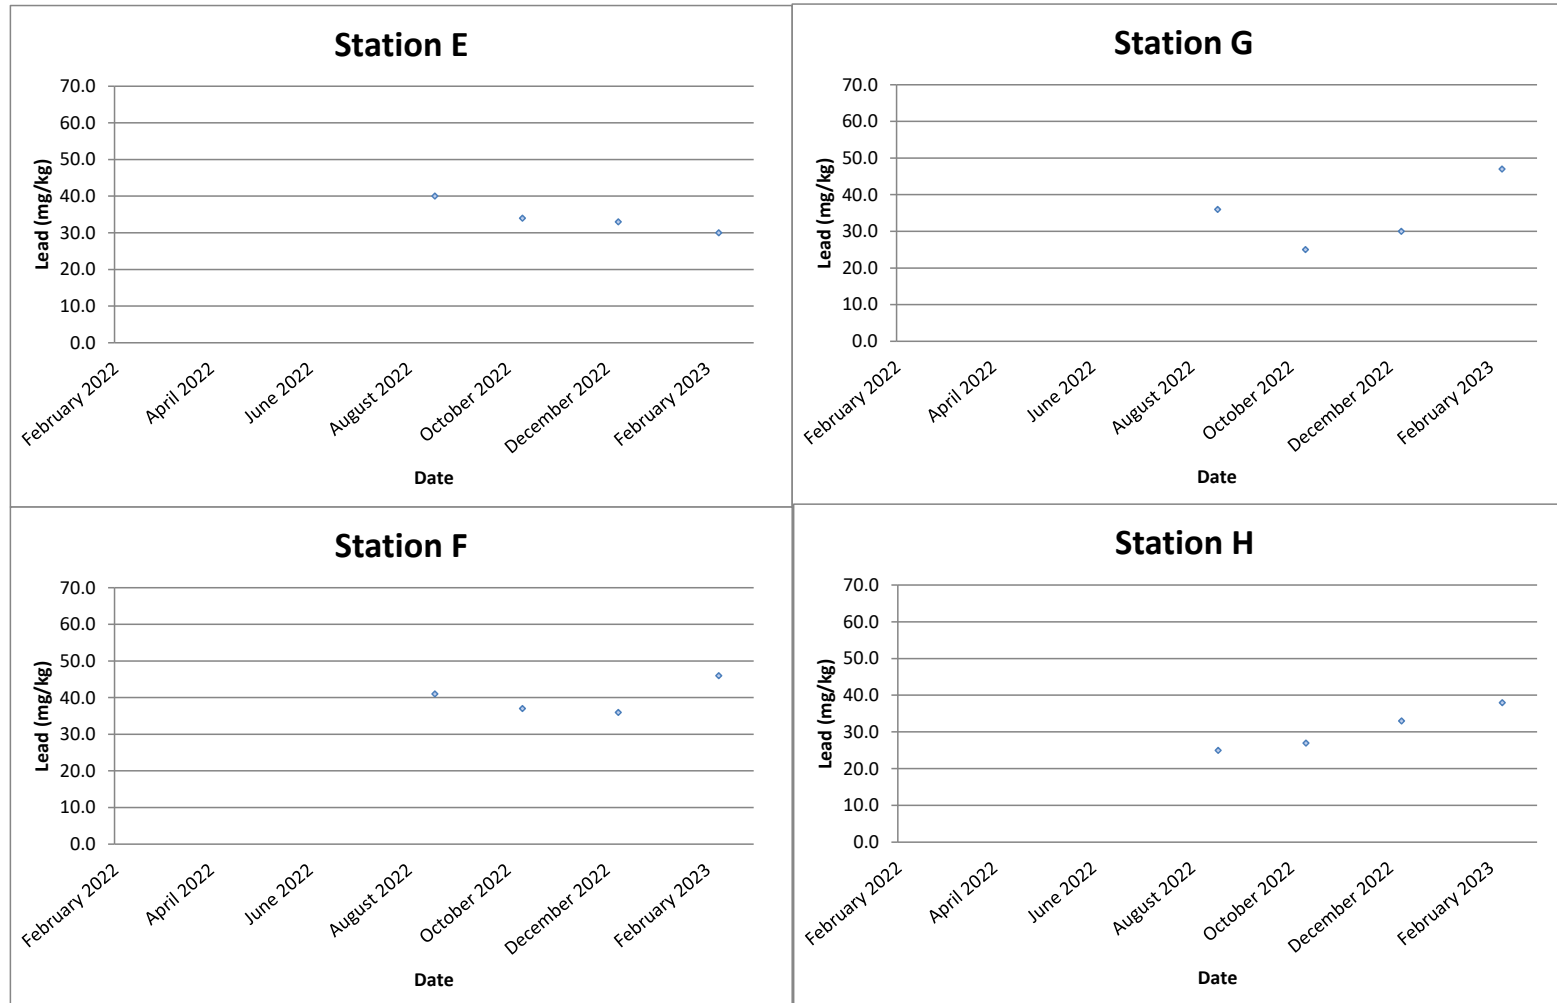

Mercury (mg/kg)




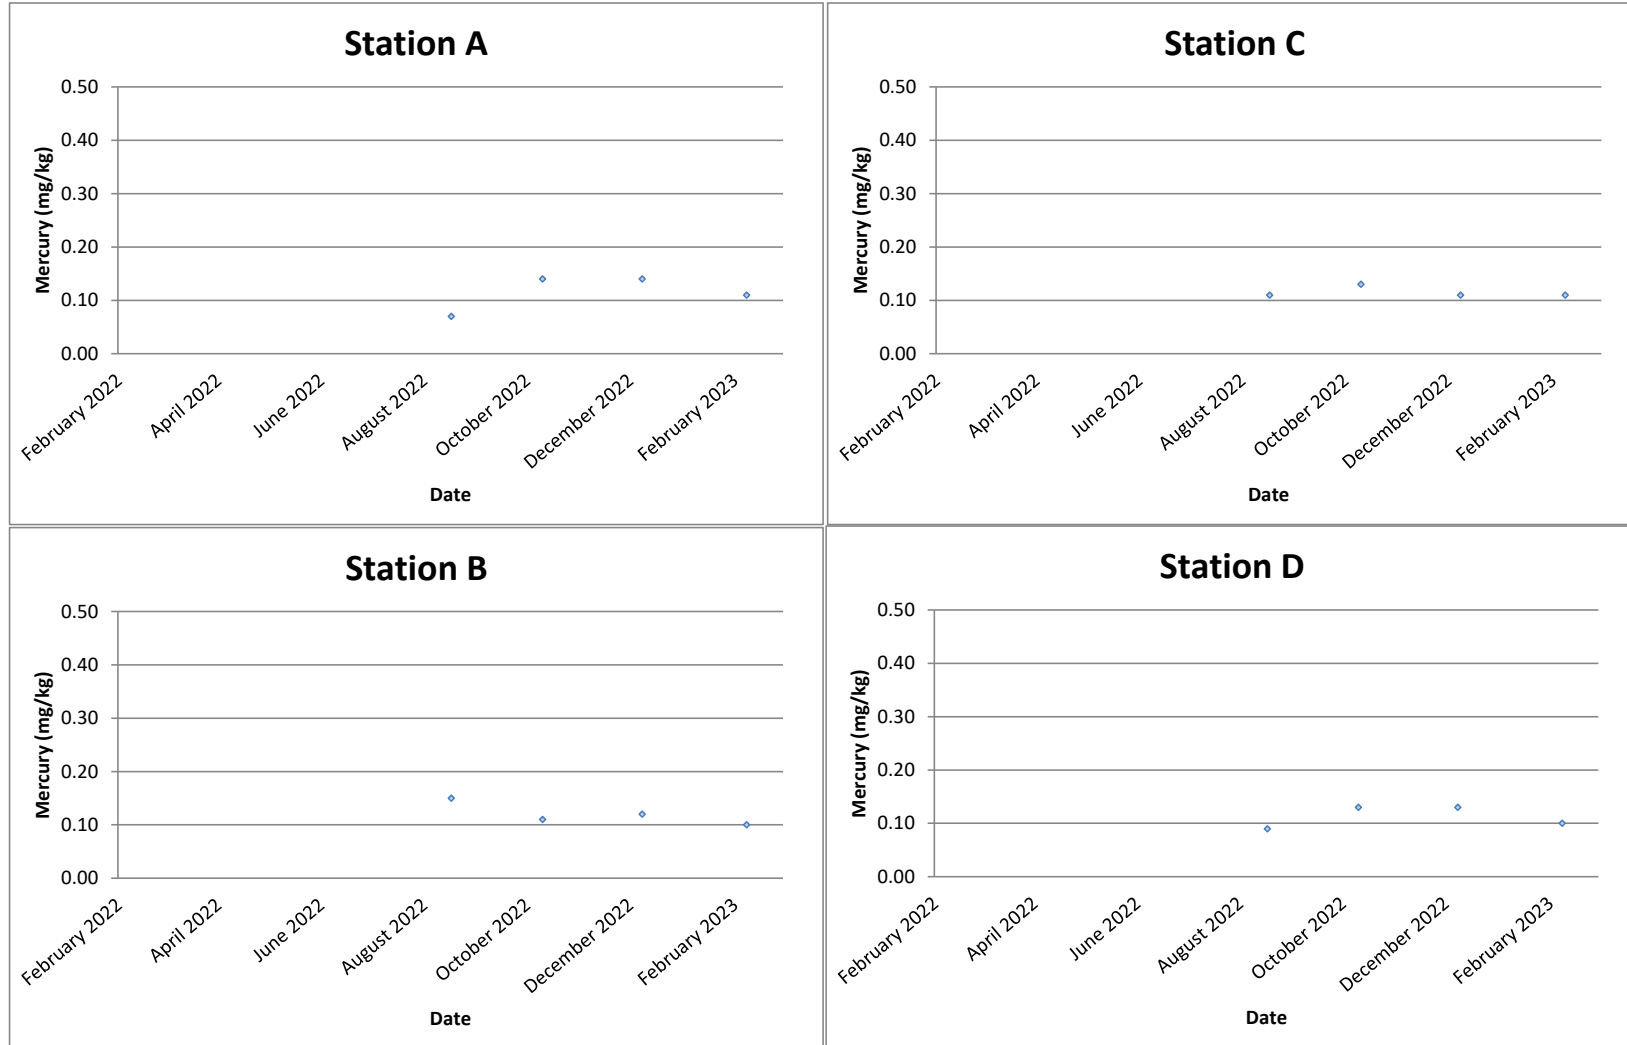


Mercury (mg/kg)

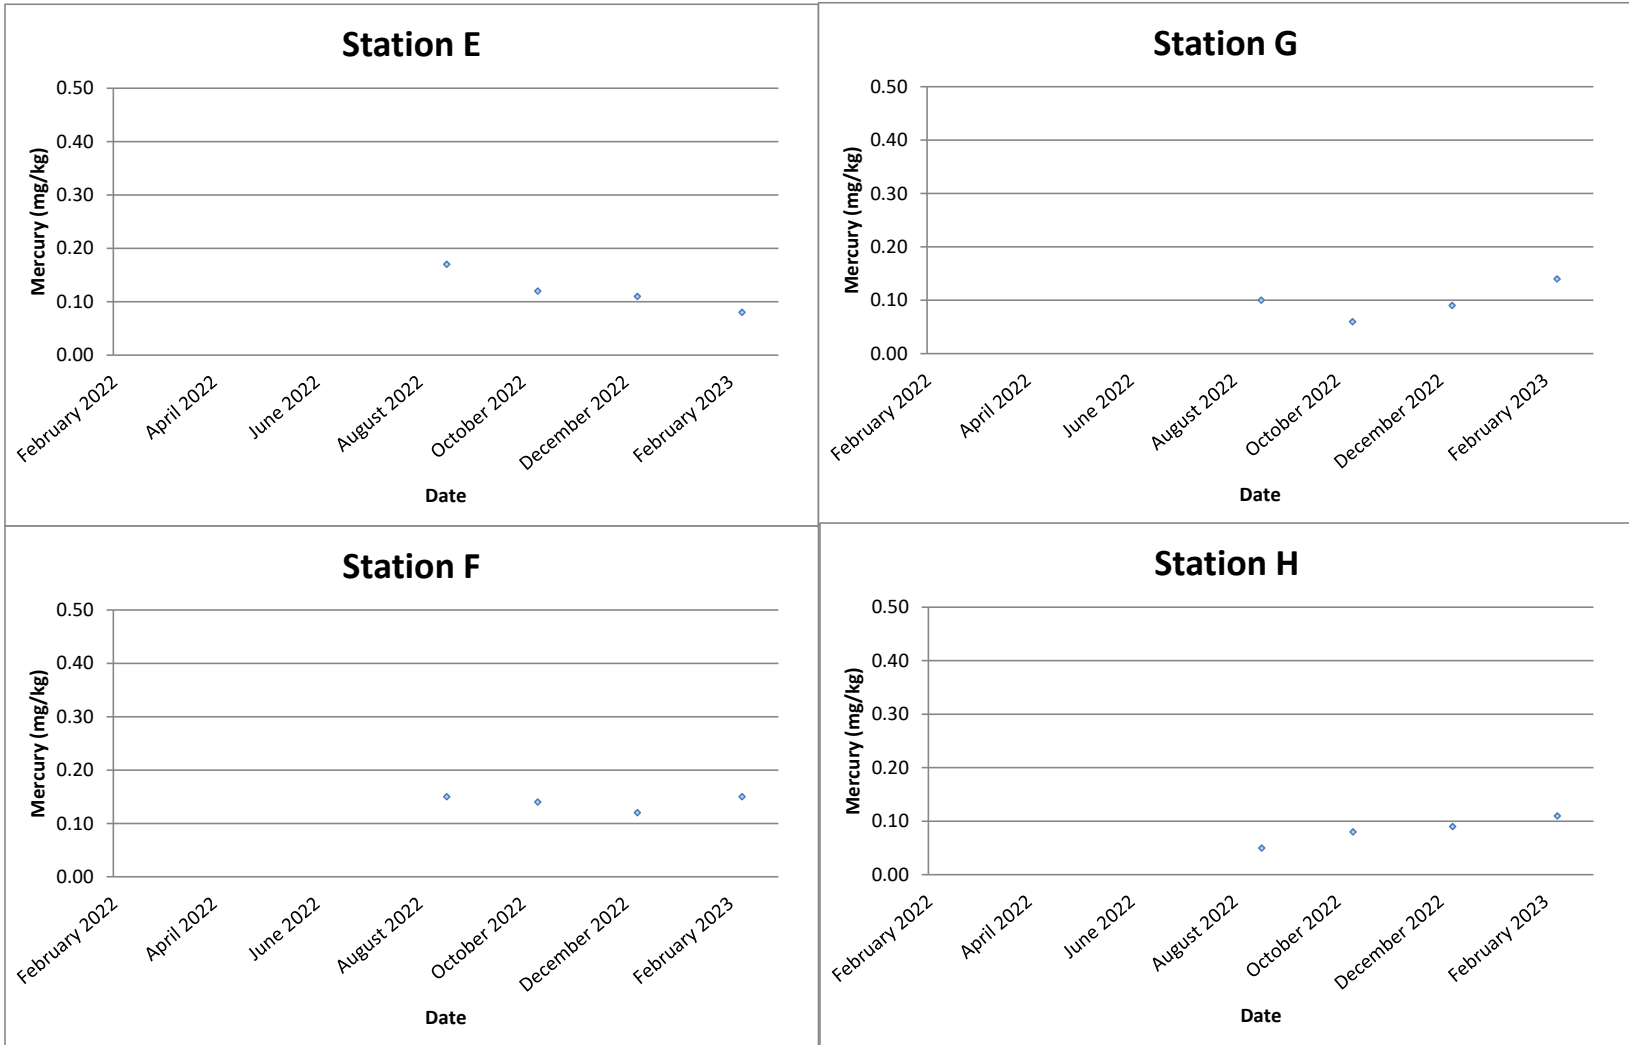





Nickel (mg/kg)

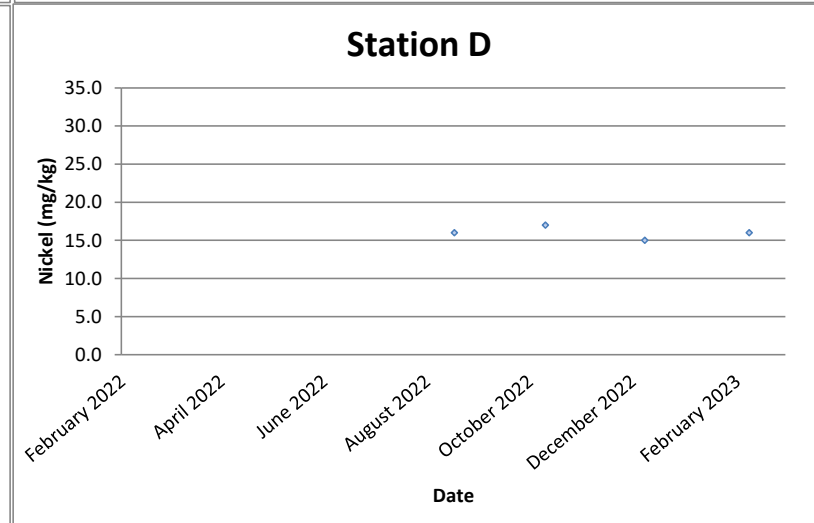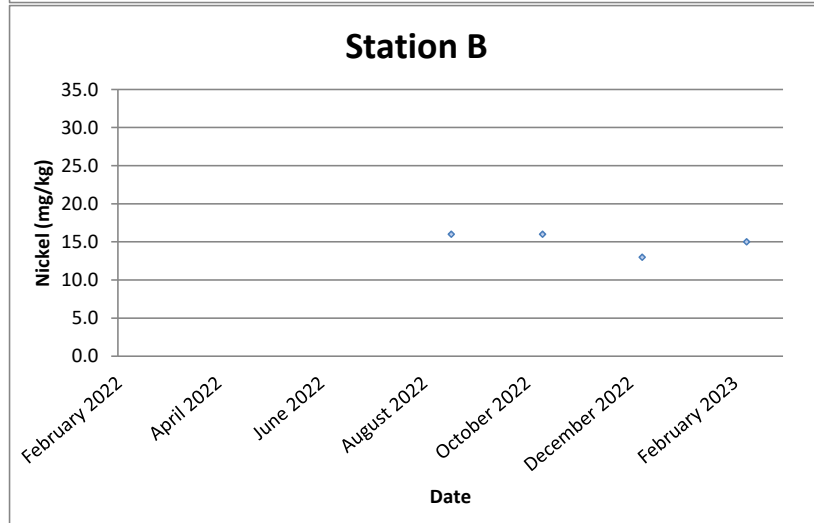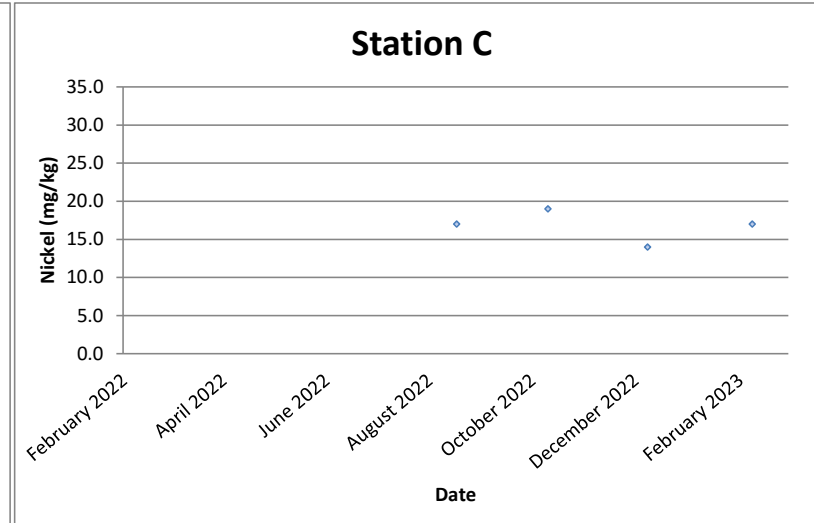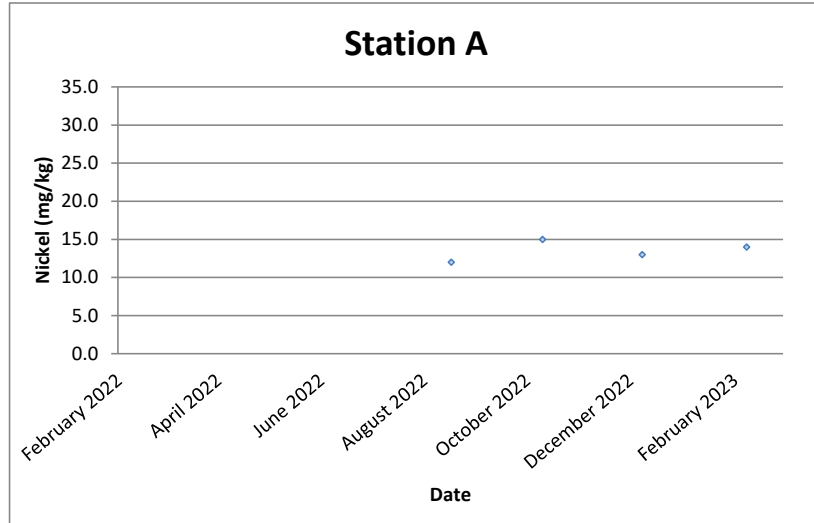


Nickel (mg/kg)

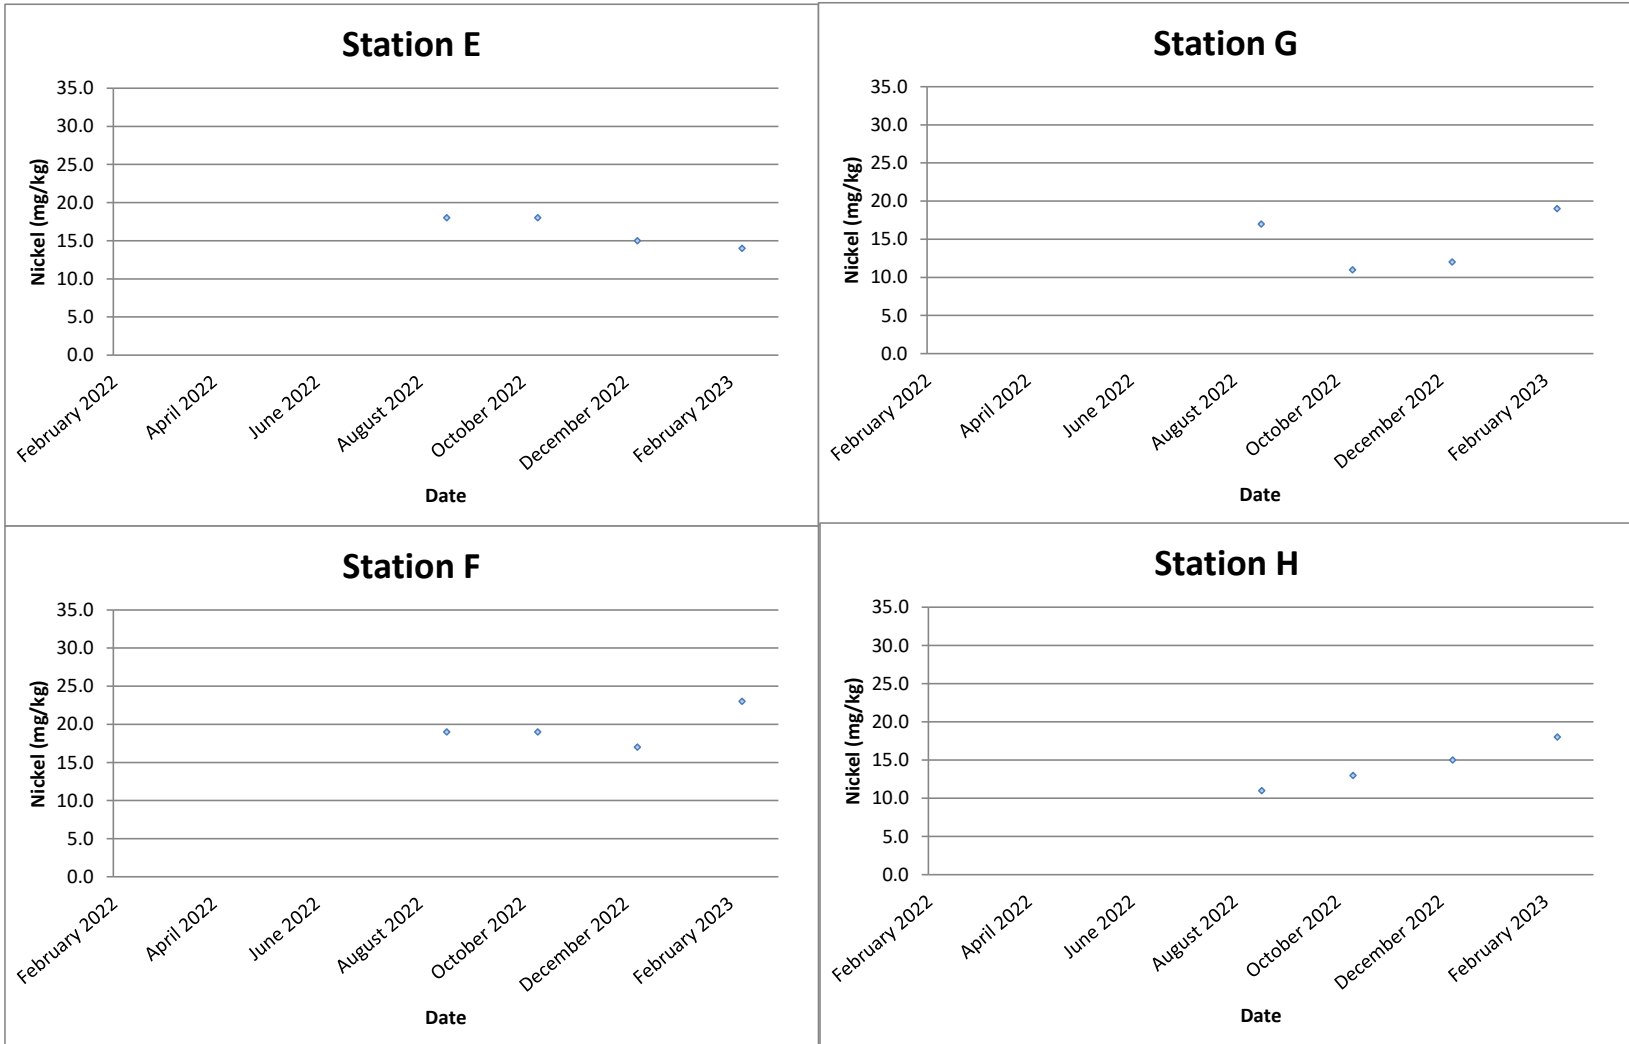


Zinc (mg/kg)

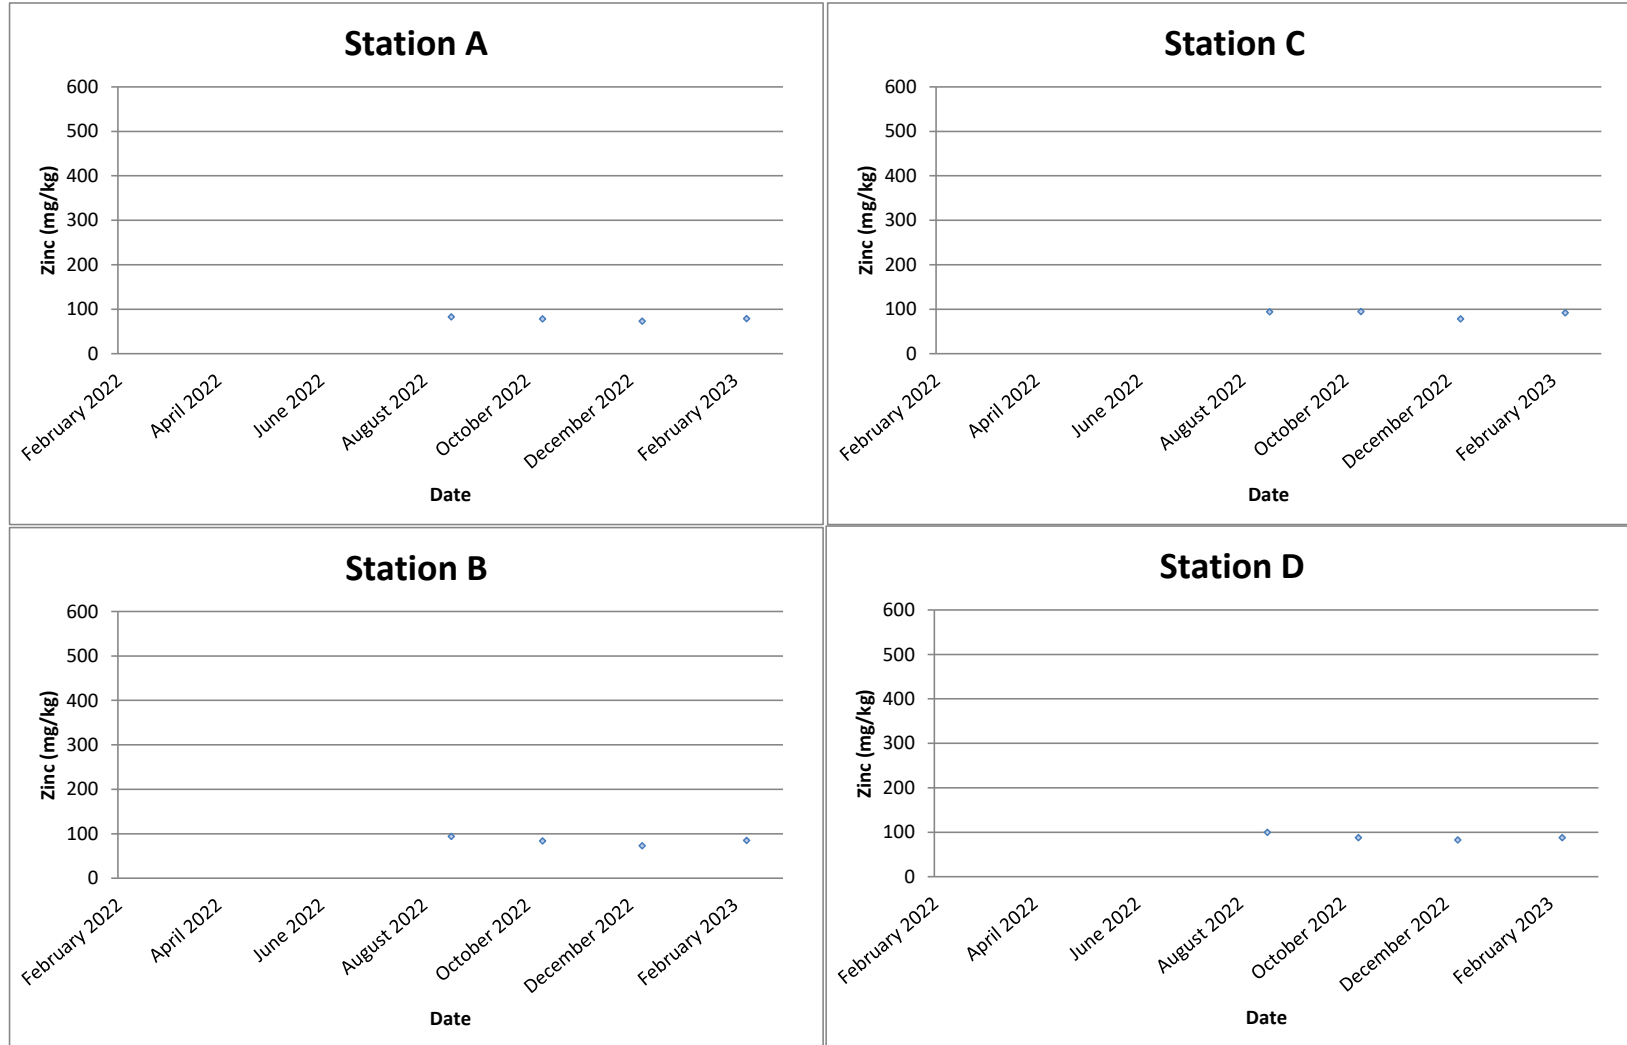


Zinc (mg/kg)

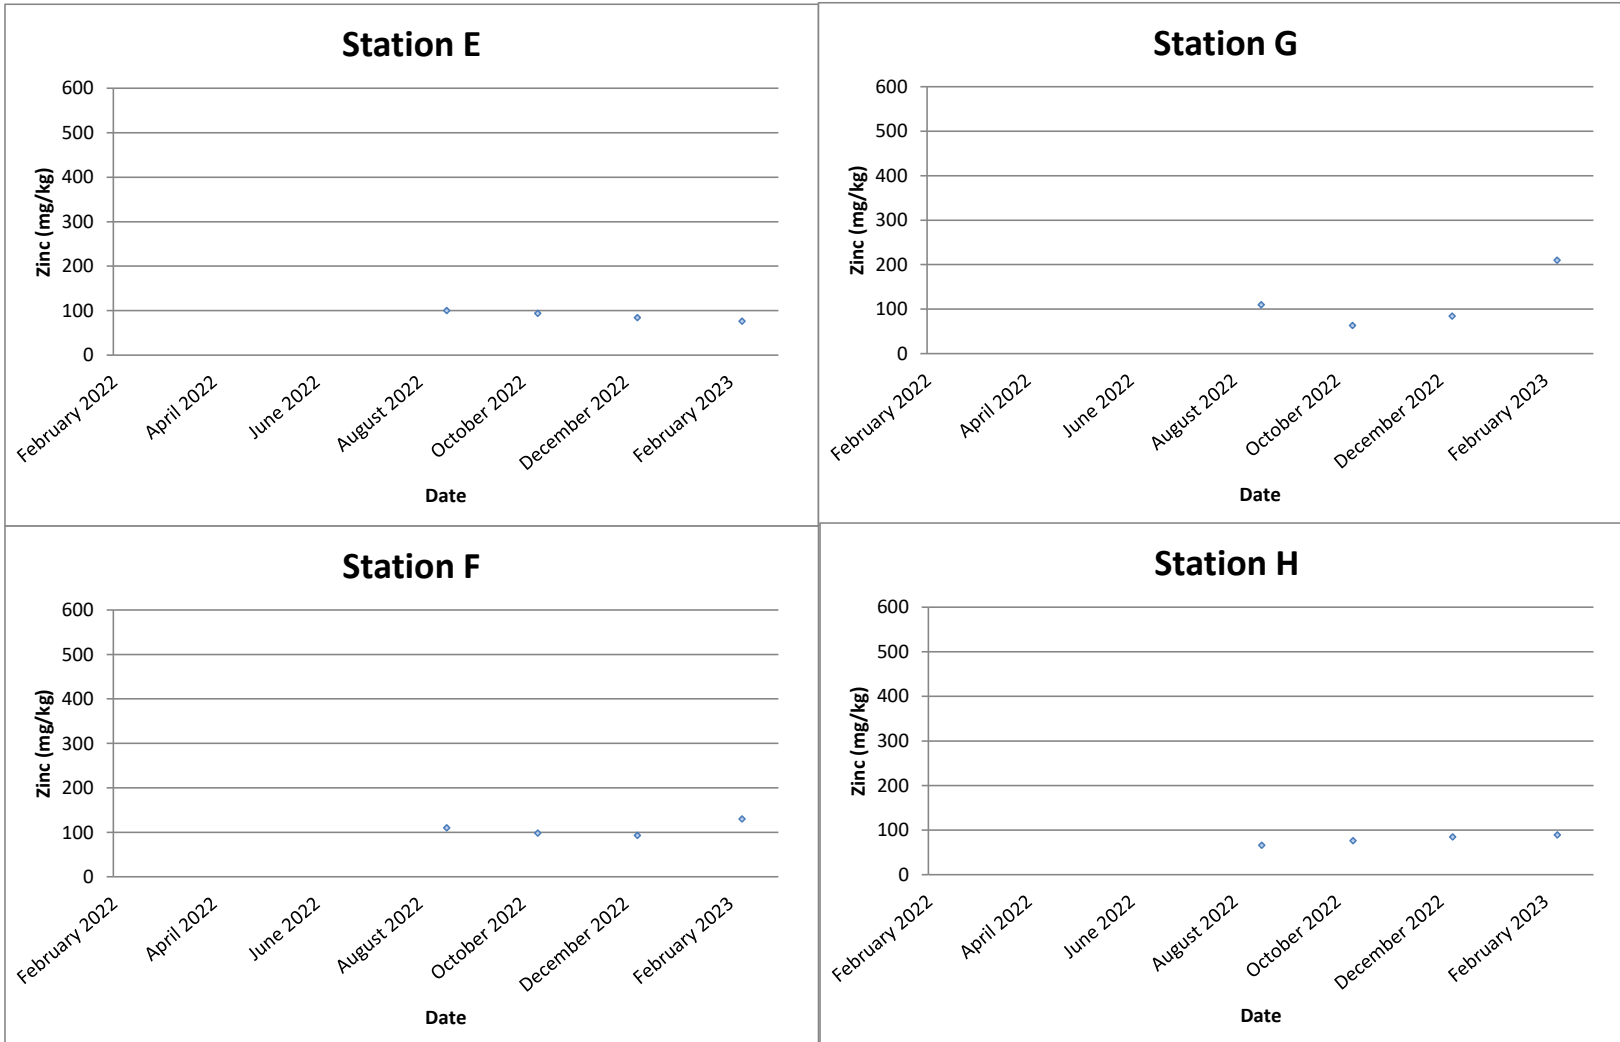


Arsenic (mg/kg)

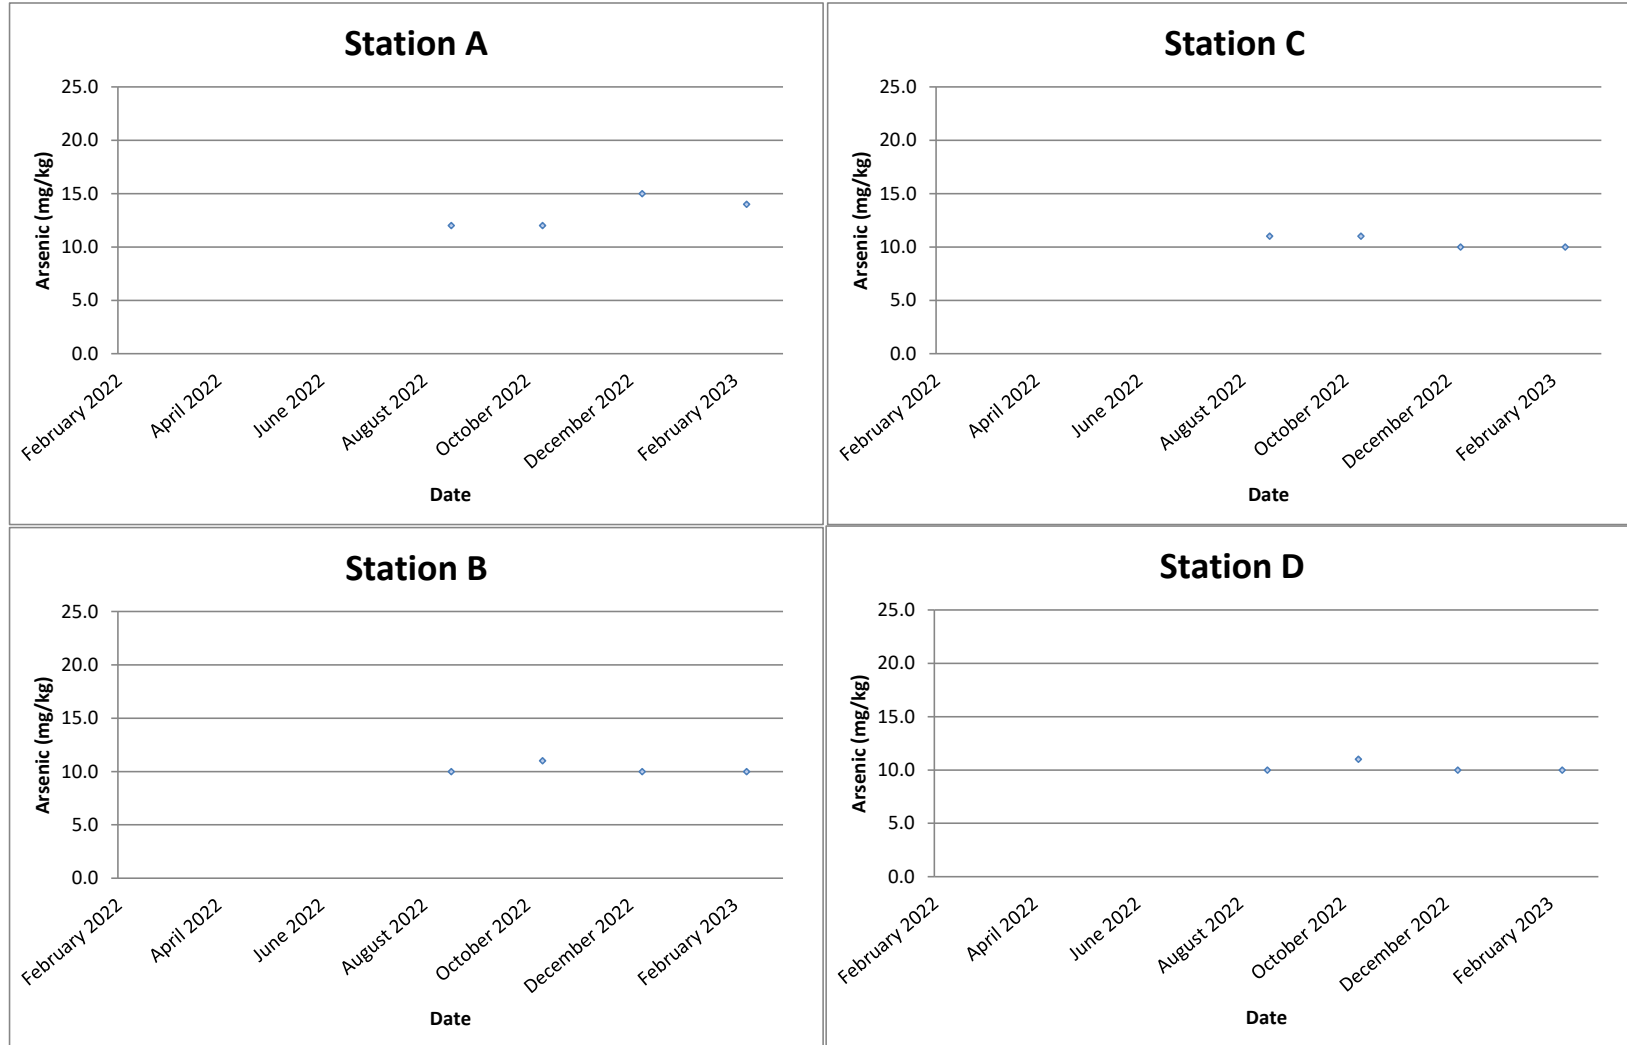


Arsenic (mg/kg)

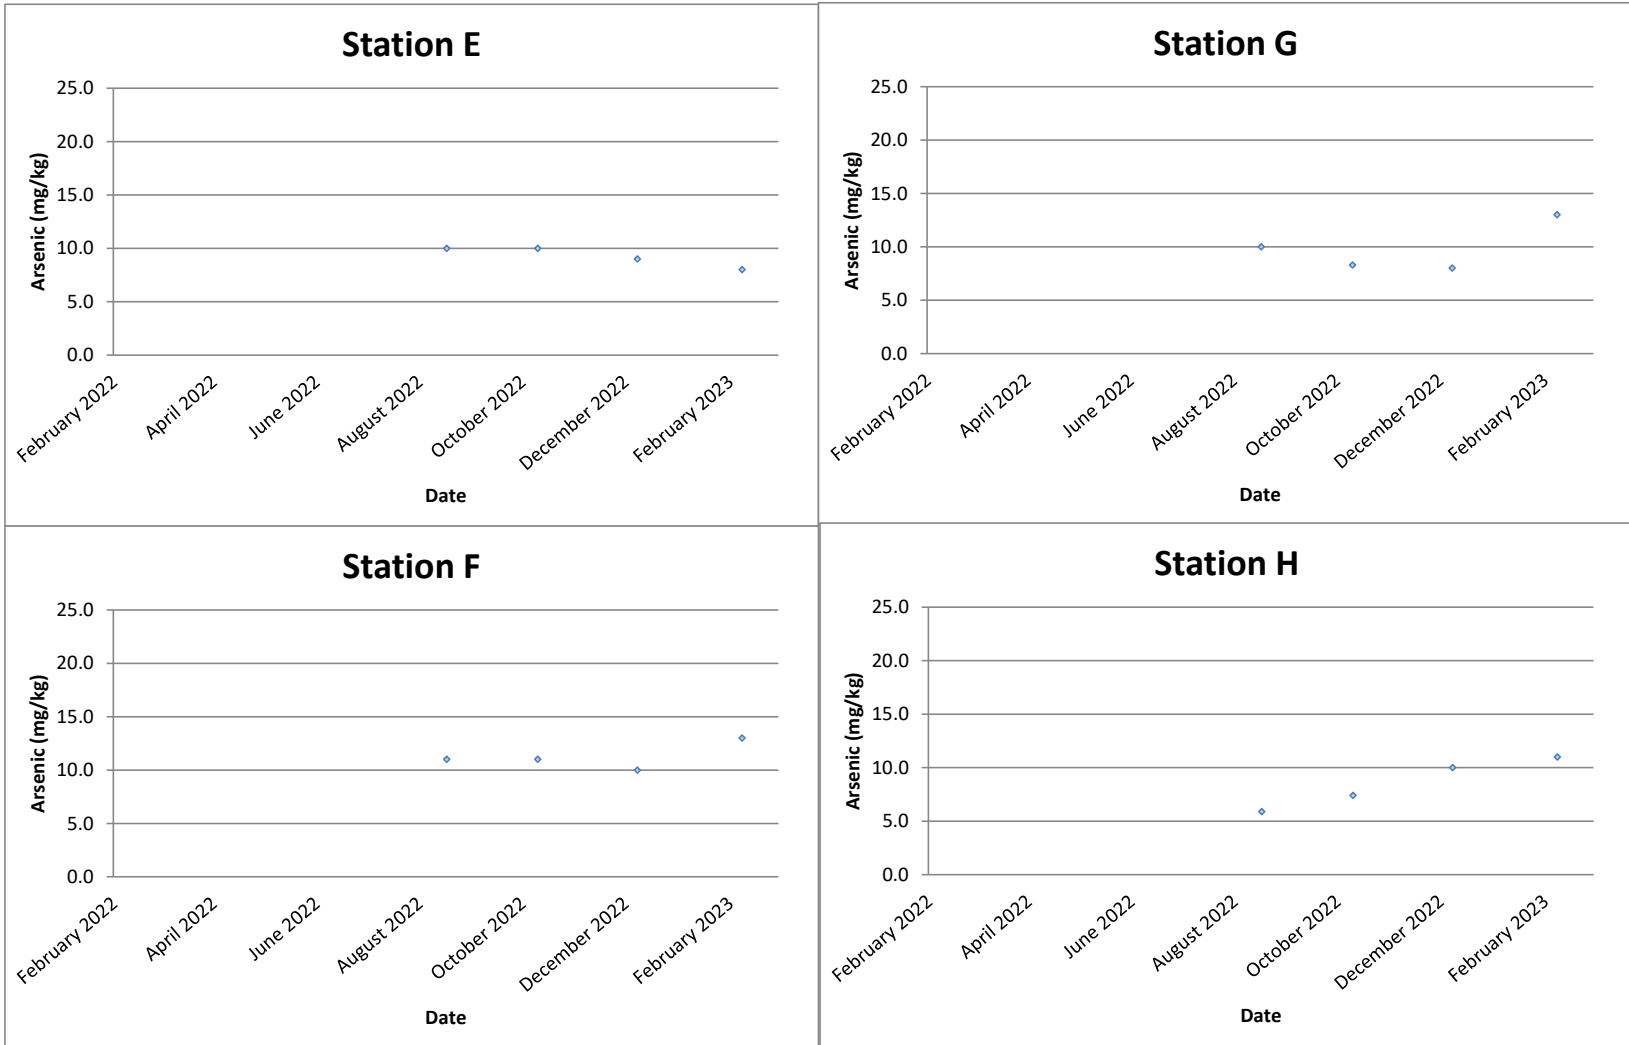

Silver (mg/kg)

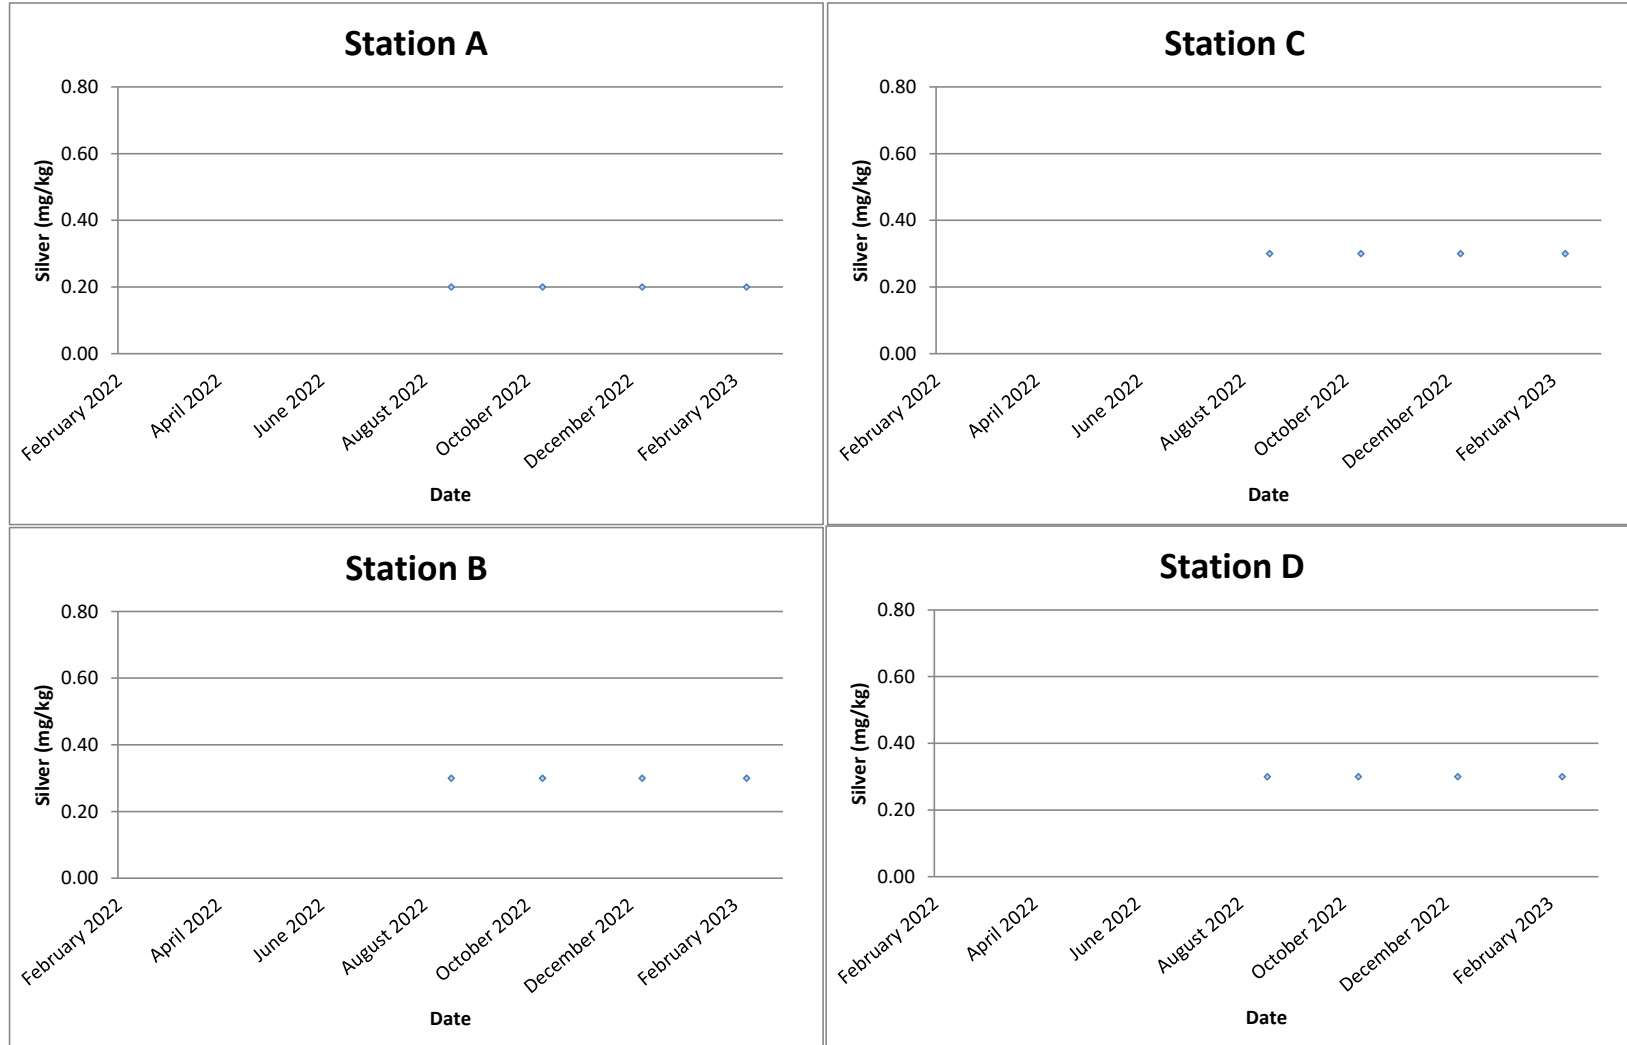

Silver (mg/kg)

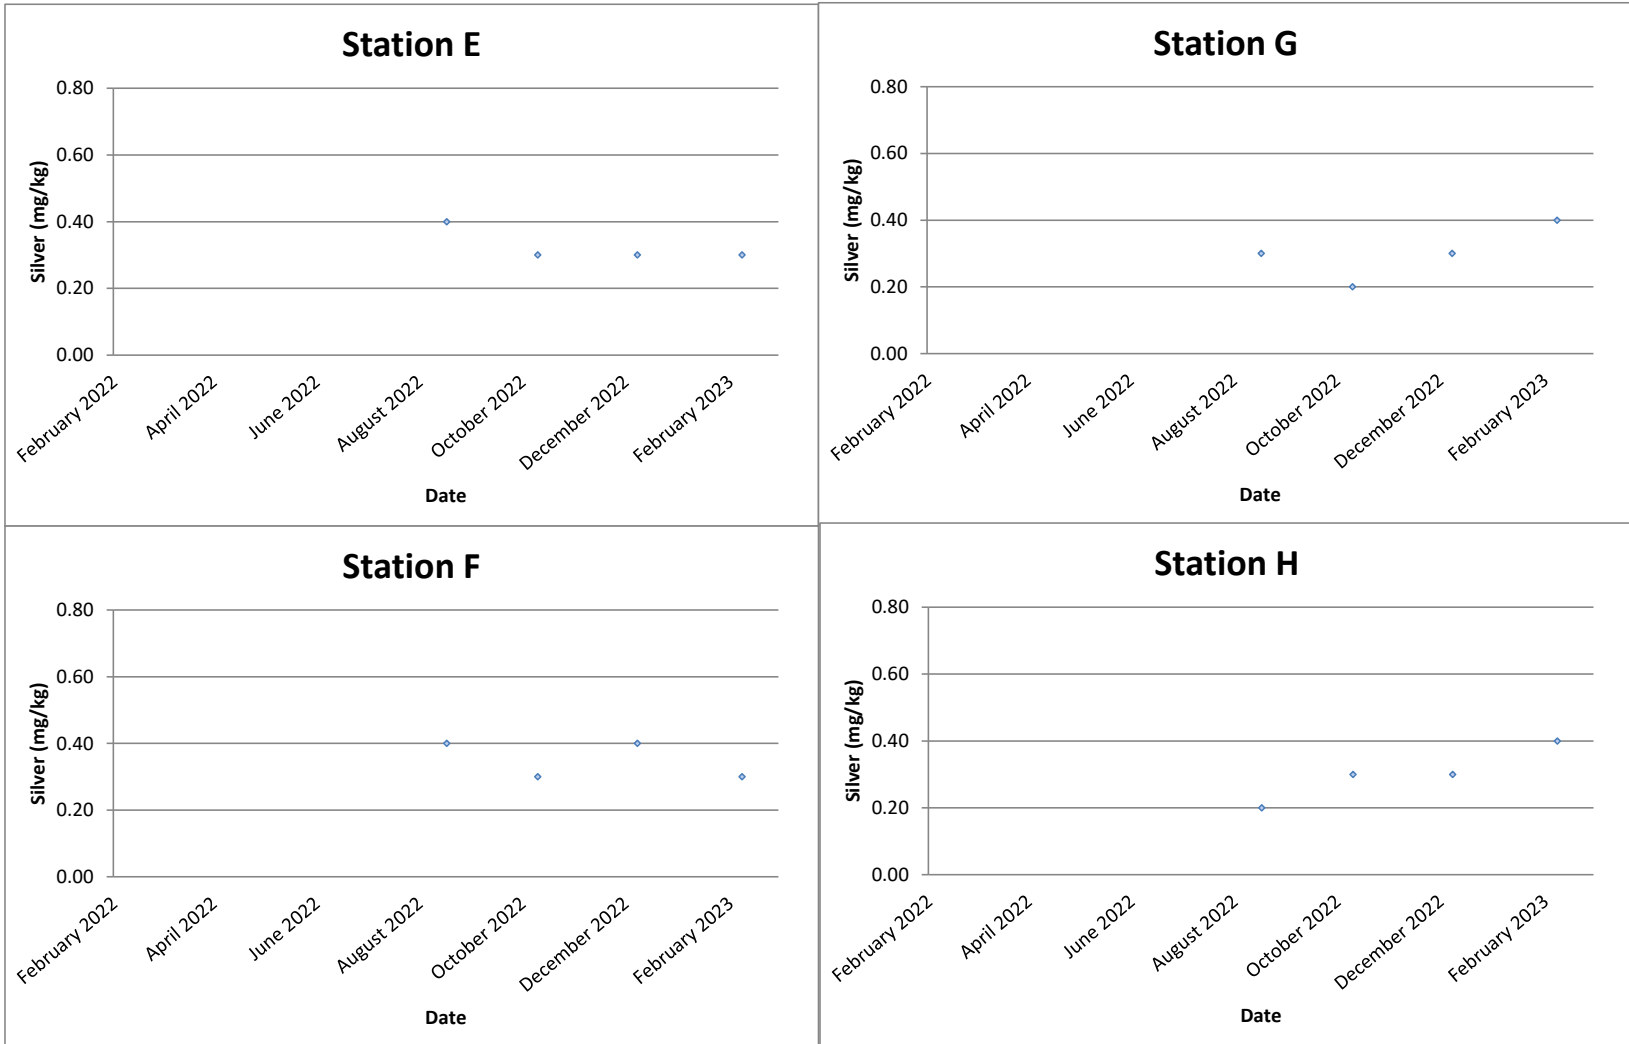



# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix I Benthic Survey Report

# Benthic Survey Report (08 February 2023)

## Abundance

A total of 354 benthic organisms was recorded from the eight monitoring stations during the February 2023 monitoring period. Current monitoring results showed lower total monthly abundance compared to both dry (March 2004) and wet (August 2004) seasons baseline data results (**Figure 1**). Similar with previous monitoring periods, total monthly abundance of benthic organisms exhibits significant seasonal variation (F-value = 4.63; F-crit = 1.5; p-value = 4.82E-12;  $\alpha = 0.05$ ).

In terms of spatial distribution, the lowest abundance of 28 ind. was recorded in the impact station, Station C, while the highest (67 ind.) was noted in reference station, Station F (**Figure 2**). The total macrobenthic abundance as similar with the previous monitoring periods, showed statistically significant different spatial distribution (F-value = 3.81; F-crit = 2.05; P-value = 0.001;  $\alpha = 0.05$ ).

## Biomass

The total wet biomass recorded in the eight monitoring stations was 6.52 g with the highest biomass recorded in the reference station, Station G (2.68 g) while the lowest biomass (0.14 g) was observed in reference station, Station H. Relative to the December 2022 period, a general decrease in biomass was observed during the current monitoring period (**Figure 3**). Most of the current decrease was attributed to the low biomass of *Mytilopsis* in the benthic community.

## Taxonomic Composition

A total of four phyla comprising of 22 families and about 27 genera were identified. During the current monitoring period, the annelids (47.18%) dominated the macrobenthic assemblage, and followed by the arthropods (38.98%) (**Figure 4**). Relative to the December 2022 community assemblage, current results showed that the annelids still maintained their dominance within the benthic community.

The dominance of annelids could be due to the high percentage of silt on all the monitoring areas as shown by the results of sediment particle size distribution analyses for the current monitoring month.

## Diversity

Benthic diversity index ( $H'$ ) in the impact stations ranged from 1.70 to 2.00. Among the reference stations,  $H'$  values ranged from 0.86 to 1.95. Currently, impact station, Station D had the highest diversity value among the different monitoring stations, while the lowest was the reference station, Station H. In terms of evenness index ( $J$ ) values, reference Station B was noted with the highest value among the monitoring stations. Moreover, current monitoring results indicated an overall increase in both diversity and evenness values from the baseline survey condition.

## Summary Tables

Abundance and biomass of macrobenthic organisms are shown in **Tables 1** and **2**, respectively. Data summary for different monitoring periods are presented in **Tables 3** to **7**. Representative photos of assemblages and specimen are shown in the last pages of this benthic survey report.

# Figures

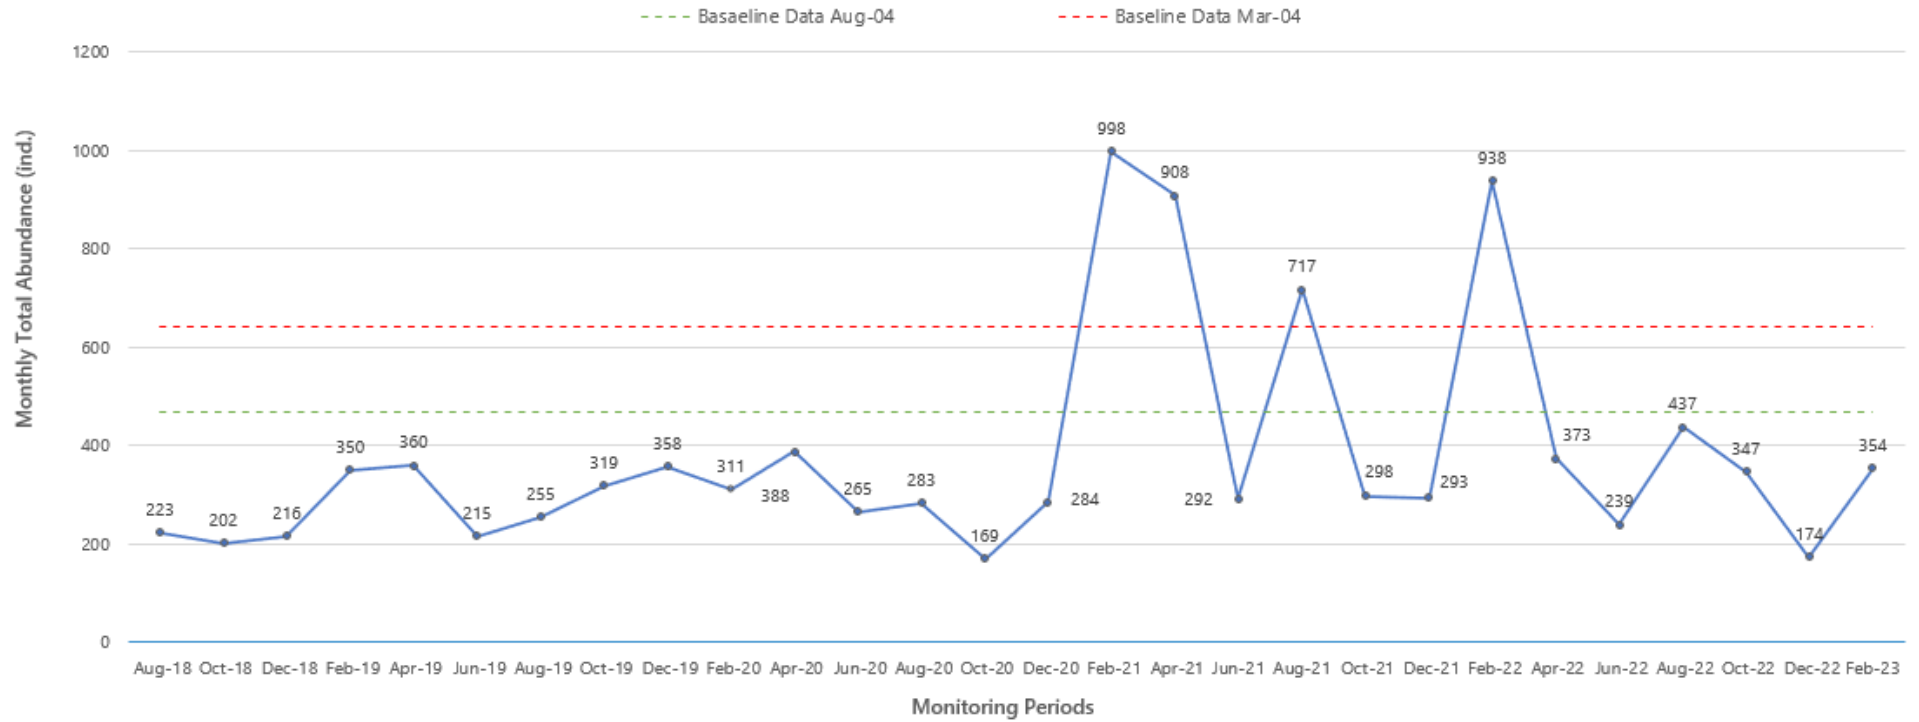


Figure 1: Monthly total abundance (ind.) of benthic organisms across monitoring periods

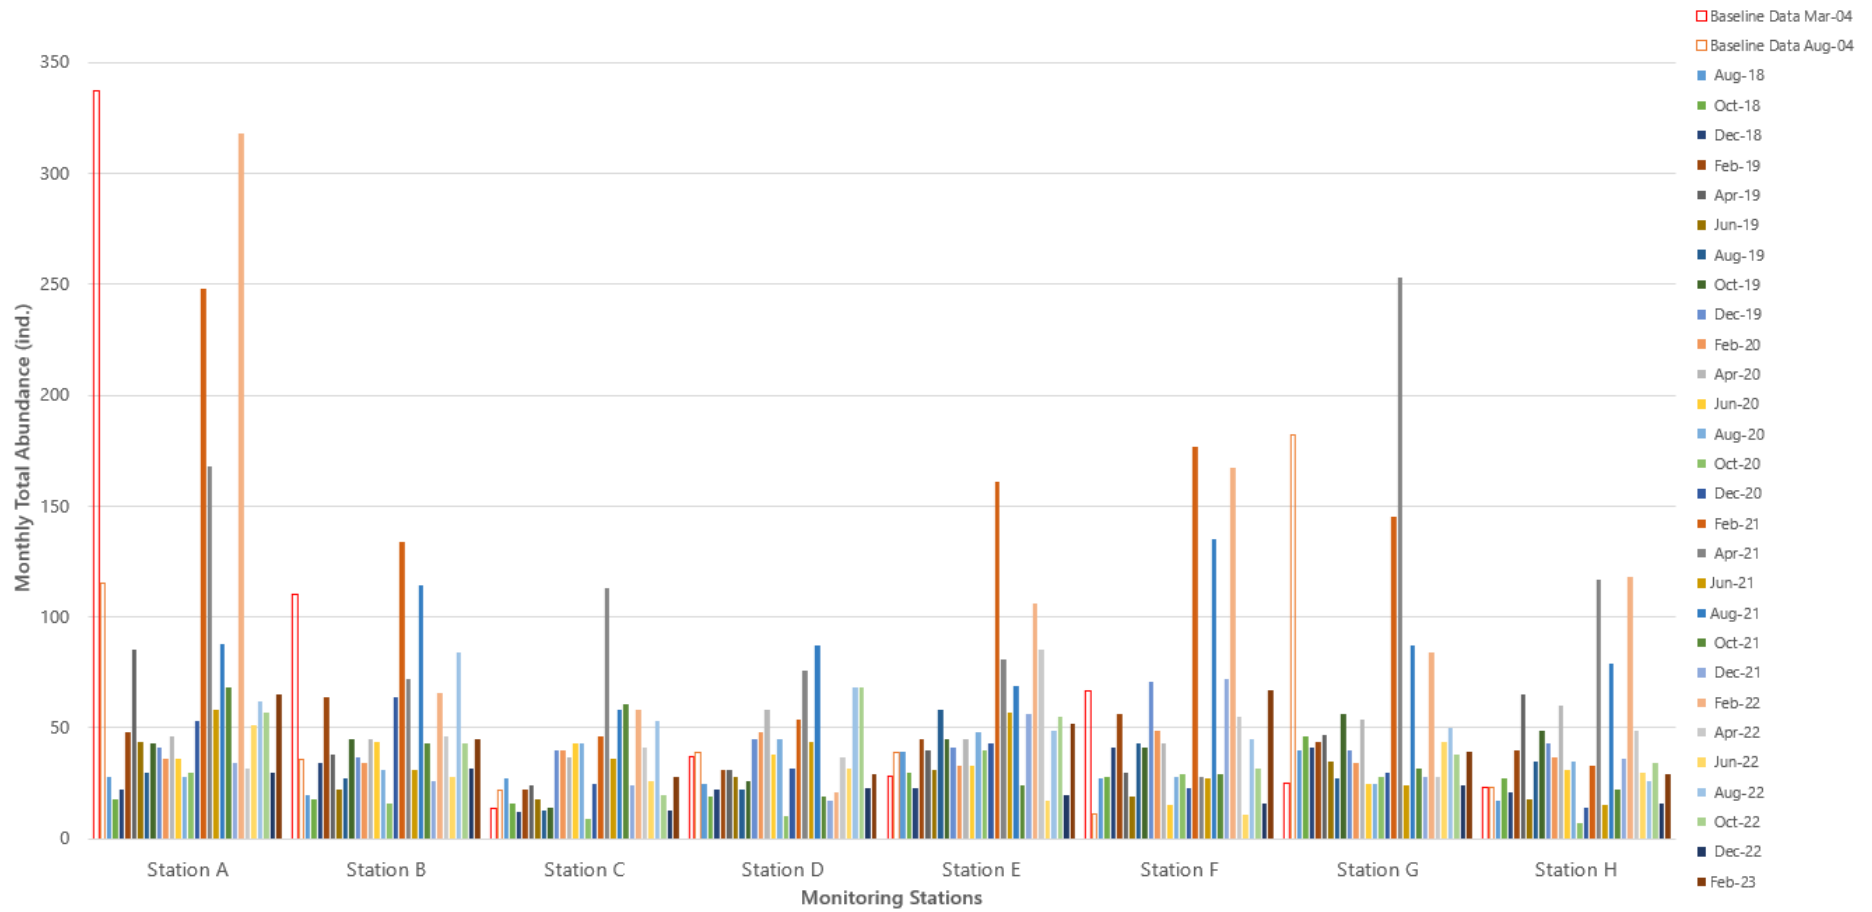


Figure 2: Monthly total abundance (ind.) of benthic organisms across monitoring stations

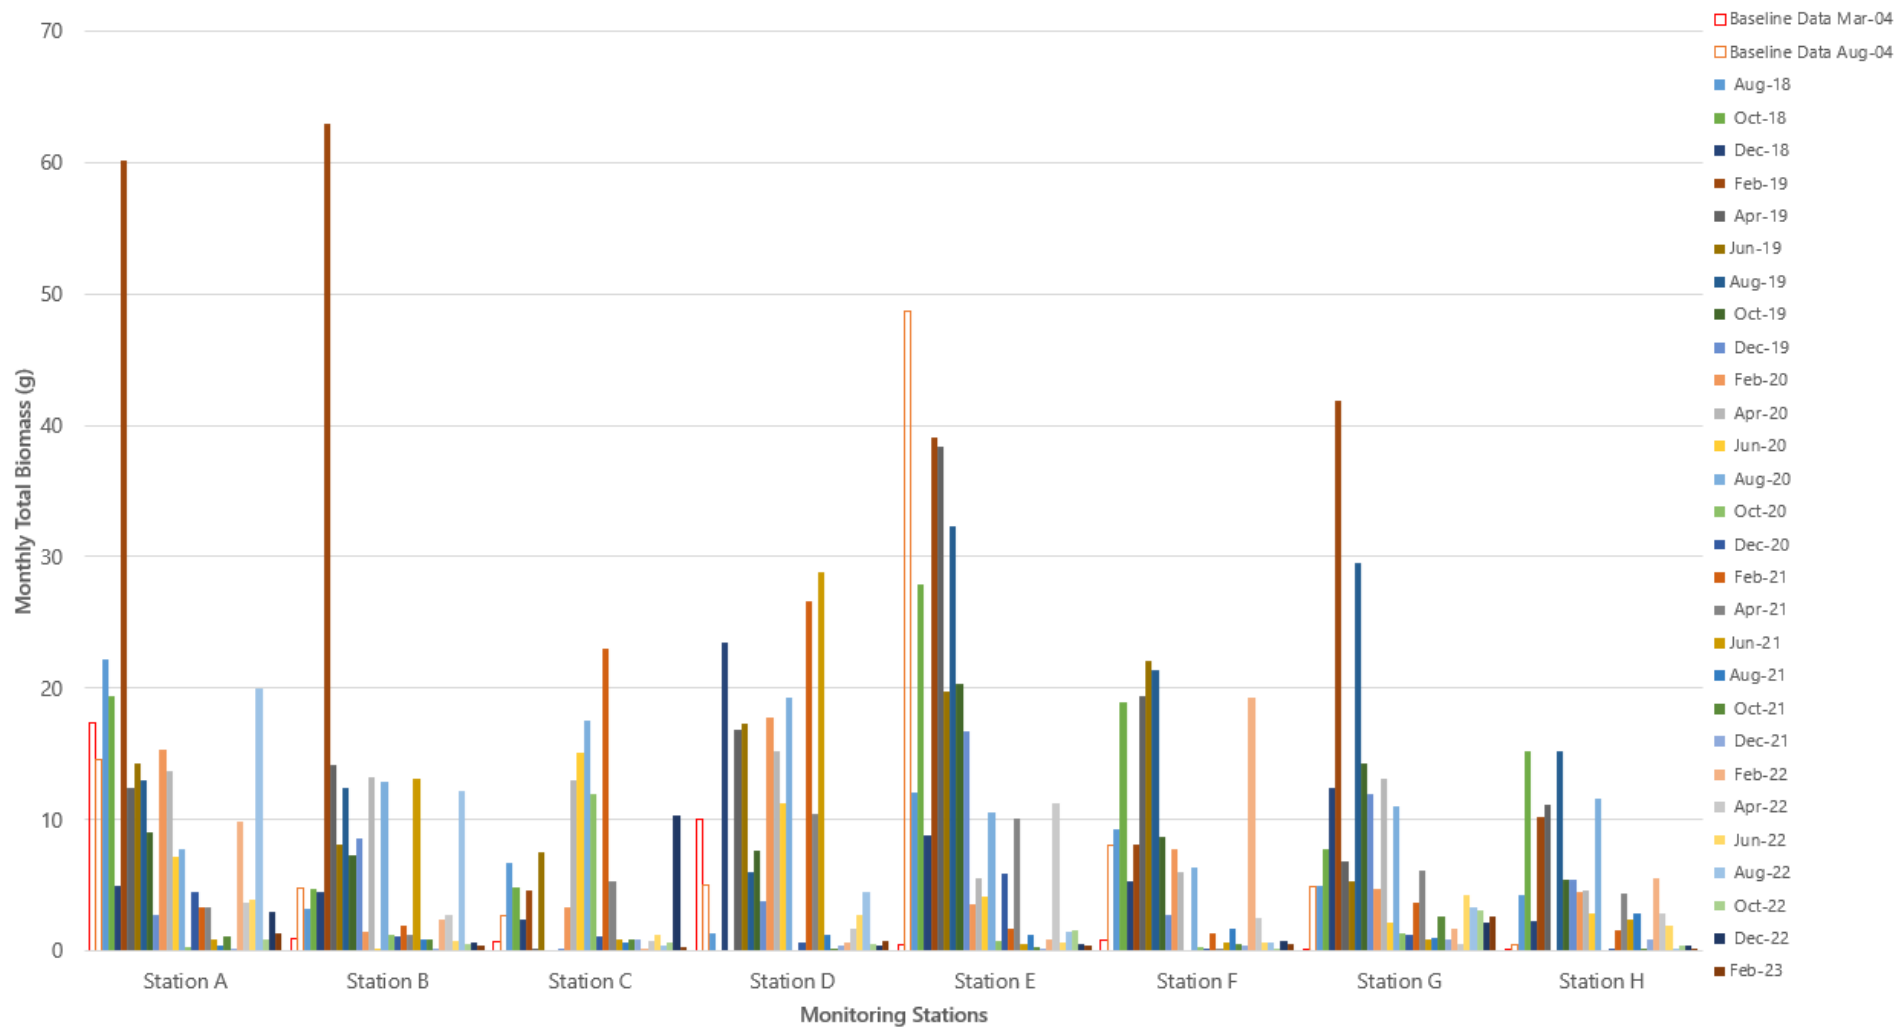


Figure 3: Monthly total biomass (g) of benthic organisms across monitoring stations

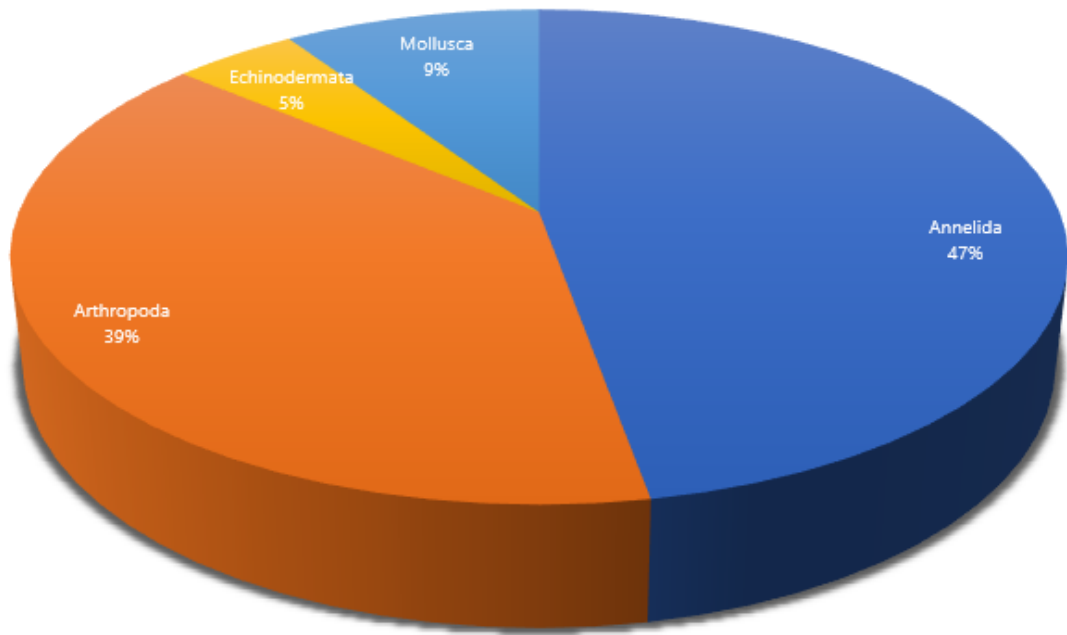


Figure 4: Percent composition of benthic organisms

# Data Summaries

Table 1: Abundance (ind.) of macrobenthic communities in the eight monitoring stations, 08 February 2023

Phylum	Class	Order	Family	Genus	Monitoring Stations								
					A	B	C	D	E	F	G	H	
Annelida	Polychaeta	Phyllodocida	Nereididae	<i>Nereis</i>		4							
Annelida	Polychaeta	Sedentaria	Maldanidae	<i>Maldanella</i>			3						
Annelida	Clitellata	Lumbriculida	Lumbriculidae	<i>Lumbriculus</i>	8	3						4	
Annelida	Polychaeta	Phyllodocida	Glyceridae	<i>Glycera</i>								1	
Annelida	Polychaeta	Phyllodocida	Polynoidae	<i>Lepidonotus</i>									1
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Capitella</i>	5	7	6	4	12	6	21	8	
Annelida	Polychaeta	Phyllodocida	Phyllodocidae	<i>Eteone</i>			7	3	5				
Annelida	Polychaeta	Phyllodocida	Goniadidae	<i>Glycinde</i>	2								
Annelida	Polychaeta	Phyllodocida	Pilargidae	<i>Sigambra</i>	10		8	3	8	5	7	1	
Annelida	Polychaeta	Phyllodocida	Nereididae	<i>Ceratonereis</i>	2								
Annelida	Polychaeta	Sedentaria	Opheliidae	<i>Ophelia</i>		2					1		
Annelida	Polychaeta	Eunicida	Lumbrineridae	<i>Scoletoma</i>		7	1						
Annelida	Polychaeta	Terebellida	Terebellidae	<i>Amaeana</i>								2	
Arthropoda	Malacostraca	Amphipoda	Gammaridae	<i>Gammarus</i>	27	12	1	8	17	48	2	19	
Arthropoda	Crustacea	Decapoda	Penaeidae	<i>Shrimp juvenile</i>	1								
Arthropoda	Malacostraca	Decapoda	Pilumnidae	<i>Typhlocarcinus</i>	2								
Arthropoda	Malacostraca	Cumacea	Diastylidae	<i>Diastylis</i>				1					
Echinodermata	Ophiuroidea	Ophiurida	Amphiuridae	<i>Amphioplus</i>	3	6		5	2				
Mollusca	Bivalvia	Veneroida	Tellinidae	<i>c.f. Angulus</i>	1	4		2			1		
Mollusca	Bivalvia	Veneroida	Veneridae	<i>c.f. Phylloda foliacea</i>			2	2	8	1			
Mollusca	Bivalvia	Cardiida	Cardiidae	<i>Cardium</i>							3		
Mollusca	Bivalvia	Veneroida	Veneridae	<i>Paphia (P. undulata)</i>								1	
Mollusca	Bivalvia	Veneroida	Pharellidae	<i>Sinonovacula</i>	1								
Mollusca	Bivalvia	Galeommatida	Lasaeidae	<i>Pseudopythina</i>	3								
Mollusca	Bivalvia	Venerida	Veneridae	<i>Timoclea</i>				1					
Mollusca	Bivalvia	Cardiida	Tellinidae	<i>Macoma</i>							2		
Mollusca	Bivalvia	Venerida	Veneridae	<i>Ruditapes</i>								1	



Table 2: Biomass (g) of macrobenthic communities in the eight monitoring stations, 08 February 2023

Phylum	Class	Order	Family	Genus	Monitoring Stations								
					A	B	C	D	E	F	G	H	
Annelida	Polychaeta	Phyllodocida	Nereididae	<i>Nereis</i>		0.040							
Annelida	Polychaeta	Sedentaria	Maldanidae	<i>Maldanella</i>			0.040						
Annelida	Clitellata	Lumbriculida	Lumbriculidae	<i>Lumbriculus</i>	0.069	0.035						0.034	
Annelida	Polychaeta	Phyllodocida	Glyceridae	<i>Glycera</i>								0.035	
Annelida	Polychaeta	Phyllodocida	Polynoidae	<i>Lepidonotus</i>									0.023
Annelida	Polychaeta	Capitellida	Capitellidae	<i>Capitella</i>	0.038	0.042	0.013	0.027	0.0484	0.051	0.109	0.054	
Annelida	Polychaeta	Phyllodocida	Phyllodocidae	<i>Eteone</i>			0.015	0.017	0.0329				
Annelida	Polychaeta	Phyllodocida	Goniadidae	<i>Glycinde</i>	0.020								
Annelida	Polychaeta	Phyllodocida	Pilargidae	<i>Sigambra</i>	0.090		0.072	0.049	0.1016	0.061	0.239	0.024	
Annelida	Polychaeta	Phyllodocida	Nereididae	<i>Ceratonereis</i>	0.031								
Annelida	Polychaeta	Sedentaria	Opheliidae	<i>Ophelia</i>		0.084					0.067		
Annelida	Polychaeta	Eunicida	Lumbrineridae	<i>Scoletoma</i>		0.032	0.017						
Annelida	Polychaeta	Terebellida	Terebellidae	<i>Amaeana</i>								0.067	
Arthropoda	Malacostraca	Amphipoda	Gammaridae	<i>Gammarus</i>	0.057	0.033	0.001	0.010	0.0368	0.096	0.013	0.042	
Arthropoda	Crustacea	Decapoda	Penaeidae	<i>Shrimp juvenile</i>	0.288								
Arthropoda	Malacostraca	Decapoda	Pilumnidae	<i>Typhlocarcinus</i>	0.501								
Arthropoda	Malacostraca	Cumacea	Diastylidae	<i>Diastylis</i>				0.001					
Echinodermata	Ophiuroidea	Ophiurida	Amphiuridae	<i>Amphioplus</i>	0.043	0.070		0.065	0.0401				
Mollusca	Bivalvia	Veneroida	Tellinidae	<i>c.f. Angulus</i>	0.033	0.109		0.136		0.069			
Mollusca	Bivalvia	Veneroida	Veneridae	<i>c.f. Phylloda foliacea</i>			0.178	0.088	0.1201	0.093			
Mollusca	Bivalvia	Cardiida	Cardiidae	<i>Cardium</i>						0.067			
Mollusca	Bivalvia	Veneroida	Veneridae	<i>Paphia (P. undulata)</i>								1.862	
Mollusca	Bivalvia	Veneroida	Pharellidae	<i>Sinonovacula</i>	0.020								
Mollusca	Bivalvia	Galeommatida	Lasaeidae	<i>Pseudopythina</i>	0.104								
Mollusca	Bivalvia	Venerida	Veneridae	<i>Timoclea</i>				0.317					
Mollusca	Bivalvia	Cardiida	Tellinidae	<i>Macoma</i>						0.034			
Mollusca	Bivalvia	Venerida	Veneridae	<i>Ruditapes</i>								0.321	

Table 3: Summary of Benthic Survey Data, February 2023

Stations	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	65	1.29	12	1.91	0.77
B	45	0.44	9	1.95	0.89
C*	28	0.34	8	1.70	0.82
D*	29	0.71	10	2.00	0.87
E	52	0.38	8	1.63	0.78
F	67	0.54	8	1.08	0.52
G	39	2.68	8	1.46	0.70
H	29	0.14	7	0.86	0.44

\*impact sites

Table 4: Summary of Benthic Survey Baseline Data, August 2004

Stations	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	115	14.56	24	0.93	0.29
B	36	4.76	14	0.89	0.34
C*	22	2.66	13	0.80	0.31
D*	39	5.07	11	0.62	0.26
E	39	48.69	16	0.89	0.32
F	11	8.07	9	0.68	0.31
G	182	4.91	31	1.10	0.32
H	23	0.49	11	0.81	0.34

\*impact sites

Table 5: Summary of Benthic Survey Baseline Data, March 2004

Stations	Abundance (ind.)	Total Biomass (g)	Number of Taxa	Diversity (H')	Evenness (J)
A	337	17.39	38	0.78	0.21
B	110	0.9	21	0.82	0.27
C*	14	0.7	10	0.69	0.3
D*	37	10.07	20	1.01	0.34
E	28	0.44	11	0.76	0.32
F	67	0.78	16	0.85	0.31
G	25	0.09	9	0.64	0.29
H	23	0.15	11	0.44	0.18

\*impact sites

Table 6: Taxonomic Composition (%) of Benthic Survey

Taxa	Mar-04	Aug-04	Apr-19	Jun-19	Aug-19	Oct-19	Dec-19	Feb-20	Apr-20	Jun-20	Aug-20	Oct-20	Dec-20
Annelida	80.19	73.29	70.28	0.47	64.31	66.14	59.78	60.77	56.44	69.06	63.25	51.48	50.35
Sipuncula	0.78	0.21	0.00	0.00	1.57	1.25	0.00	1.29	0.52	1.13	0.35	1.78	1.06
Arthropoda	11.23	18.80	10.83	4.65	9.80	19.75	14.53	13.83	28.87	8.30	13.43	18.93	20.77
Echinodermata	0.62	3.63	4.72	0.47	5.10	3.13	1.68	1.61	0.77	2.26	3.53	2.96	2.82
Cnidaria	1.72	0.43	0.00	1.86	0.39	0.00	0.84	0.32	0.26	0.75	0.00	1.18	0.00
Mollusca	5.46	3.42	13.33	0.47	17.25	8.15	22.35	19.94	11.60	15.85	15.90	18.93	24.65
Chordata	0.00	0.21	0.56	0.47	1.18	0.94	0.00	0.32	0.52	1.13	1.41	0.00	0.35
Nemertea	0.00	0.00	0.28	98.60	0.39	0.63	0.84	1.93	1.03	1.51	2.12	4.73	0.00

Taxa	Feb-21	Apr-21	Jun-21	Aug-21	Oct-21	Dec-21	Feb-22	Apr-22	Jun-22	Aug-22	Oct-22	Dec-22	Feb-23
Annelida	22.75	31.72	73.63	78.52	64.43	45.05	15.57	33.78	57.32	88.36	76.66	52.30	47.18
Sipuncula	0.70	0.00	0.34	0.00	8.05	0.00	0.00	1.34	6.28	0.00	0.00	3.45	0.00
Arthropoda	70.14	55.95	10.27	9.90	11.41	36.86	78.25	26.54	5.86	1.60	5.48	17.82	38.98
Echinodermata	0.30	1.43	4.11	1.39	4.03	4.10	0.43	0.80	1.26	0.46	6.05	2.87	4.52
Cnidaria	0.00	0.00	0.00	0.00	0.00	0.68	0.00	0.00	0.00	0.00	0.29	0.00	0.00
Mollusca	5.81	10.90	11.64	10.04	11.74	9.22	5.22	37.27	28.87	8.68	10.95	18.39	9.32
Chordata	0.10	0.00	0.00	0.14	0.34	0.00	0.11	0.00	0.42	0.91	0.58	0.57	0.00
Nemertea	0.00	0.00	0.00	0.00	0.00	4.10	0.43	0.27	0.00	0.00	0.00	4.60	0.00

Table 7: Taxonomic Composition (Abundance) of Benthic Survey

Taxa	Mar-04	Aug-04	Apr-19	Jun-19	Aug-19	Oct-19	Dec-19	Feb-20	Apr-20	Jun-20	Aug-20	Oct-20	Dec-20
Annelida	514	343	253	124	164	211	214	189	219	183	179	87	143
Sipuncula	5	1	0	0	4	4	0	4	2	3	1	3	3
Arthropoda	72	88	39	17	25	63	52	43	112	22	38	32	59
Echinodermata	4	17	17	10	13	10	6	5	3	6	10	5	8
Cnidaria	11	2	0	2	1	0	3	1	1	2	0	2	0
Mollusca	35	16	48	59	44	26	80	62	45	42	45	32	70
Chordata	0	1	2	2	3	3	0	1	2	3	4	0	1
Nemertea	0	0	1	1	1	2	3	6	4	4	6	8	0

Taxa	Feb-21	Apr-21	Jun-21	Aug-21	Oct-21	Dec-21	Feb-22	Apr-22	Jun-22	Aug-22	Oct-22	Dec-22	Feb-23
Annelida	227	288	215	563	192	132	146	126	137	387	266	91	167
Sipuncula	7	0	1	0	24	0	0	5	15	0	0	6	0
Arthropoda	700	508	30	71	34	108	734	99	14	7	19	31	138
Echinodermata	3	13	12	10	12	12	4	3	3	2	21	5	16
Cnidaria	0	0	0	0	0	2	0	0	0	0	1	0	0
Mollusca	58	99	34	72	35	27	49	139	69	38	38	32	33
Chordata	1	0	0	1	1	0	1	0	1	4	2	1	0
Nemertea	2	0	0	0	0	12	4	1	0	0	0	8	0

# Photos of Macrobenthic Assemblages



Station A



Station B




Station C



Station D




Station E

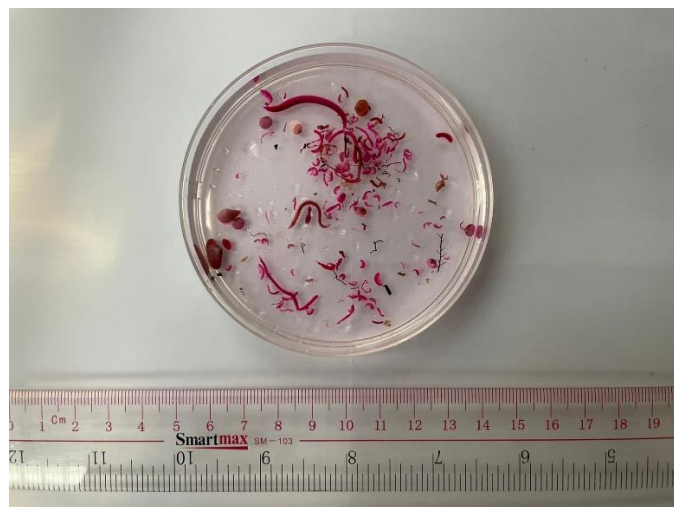

Station F



Station G

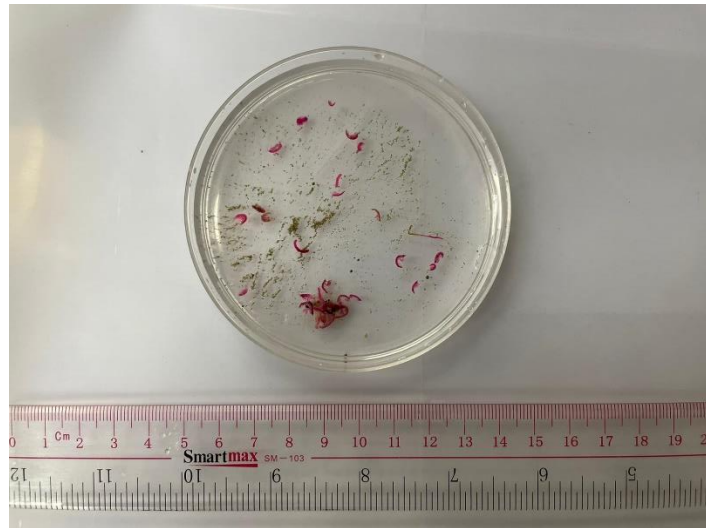


Station H

## Photos of Representative Taxa Identified



Juvenile Shrimp

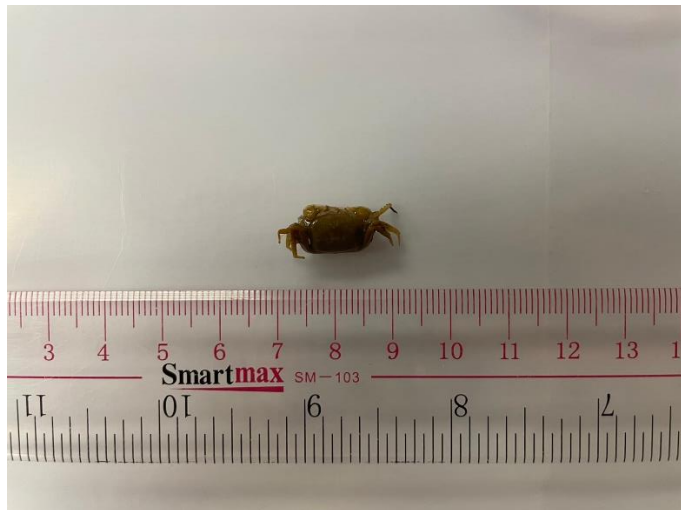

*Typhlocarcinus*



*Timoclea*





*Paphia (P. undulata)*



*Ruditapes*

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix J Photos of Grab Samplers

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

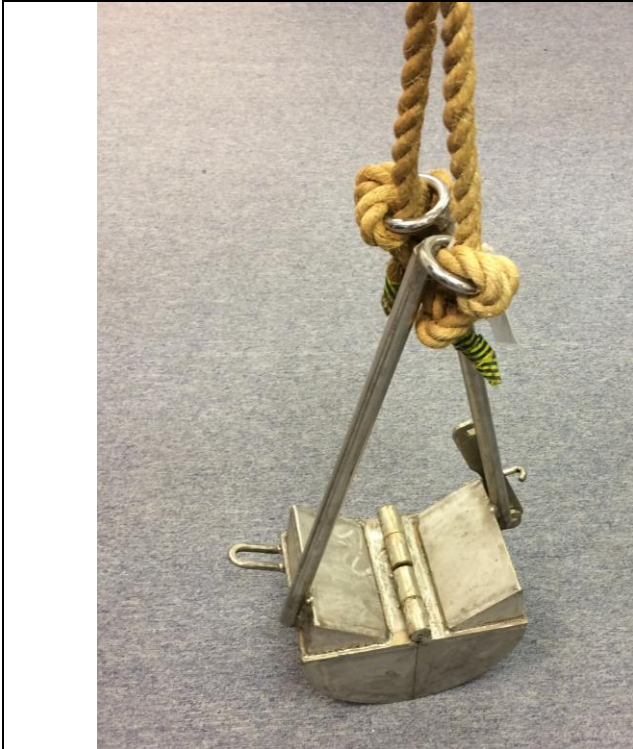


Photo 1. A ponar grab sampler

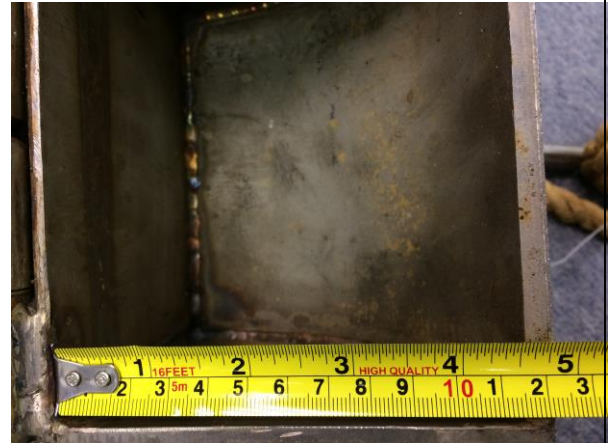


Photo 2. Grab dimension 1



Photo3. Grab dimension 2



Photo4. Grab dimension 3

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

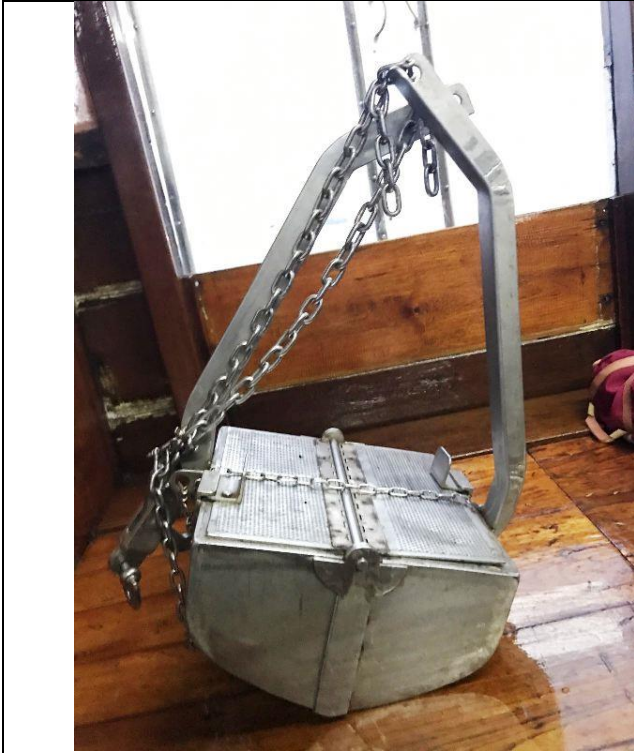


Photo 1. A modified Van Veen grab sampler



Photo 2. Grab dimension 1



Photo3. Grab dimension 2



Photo4. Grab dimension 3

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix K Environmental Complaints Log

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

## Environmental Complaints Log

Complaint Log No.	Date of Complaint	Received From and Received By	Nature of Complaint	Investigation
1	28 November 2019	EPD	According to EPD, a member of public complained that SHWSTW cause a malodour and was smelled as far as the Discovery Bay tunnel portal.	As advised by DSD, the operation of Siu Ho Wan Sewage Treatment Works was properly functioned and there was no special activity on 28 <sup>th</sup> November 2019. Due to the possibility of having unpleasant gases or odours emitted from these non-DSD premises cannot be precluded, the complaint is considered as non-project related.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



---

Report No.: 0041/17/ED/0704A

## Appendix L

### Environmental Mitigation Implementation Schedule (EMIS)

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

EP Ref.	EIA Ref.	WMP Ref.	Environmental Protection Measures	Location of the measures	Implementation Status
<b>Air Quality</b>					
NA	4.5	NA	Odour reduction measures like aeration, chemical dosing system shall be implemented to reduce any odour impacts to an acceptable level.	SHWSTW	Implemented
3.4	4.5	NA	Sewage treatment works including sludge thickening tanks, the sludge pump house and sludge press house shall be completely enclosed.	SHWSTW	Implemented
3.4	4.5	NA	Exhaust air shall be ventilated to an odour scrubber prior to discharge. Ventilating air to a biological treatment unit with 95% odour removal efficiency prior to stack exhaust shall be implemented	SHWSTW	Implemented
<b>Water Quality</b>					
3.3	NA	4.01	To avoid impacts on the marine ecology due to effluent discharge, the disinfection facility as in Part B of the EP shall be equipped with an UV disinfection system capable of removing at least 99.9% of E.coli from the sewage	SHWSTW	Implemented
<b>Waste Management</b>					
3.6	NA	NA	Transportation of sludge shall be carried out in fully enclosed containers, or be placed in sludge skips with tarpaulin covers	SHWSTW	Implemented
NA	NA	5.02	Trip-ticket system mentioned shall be implemented. Trip-ticket is required for each truckload delivered to the landfills facilities according to WBTC No. 31/2004.	SHWSTW	Implemented
NA	NA	5.02	The acceptance criteria for Landfill disposal should be followed, i.e. solid content of sludge waste should be more than 30%.	SHWSTW	Implemented
NA	NA	5.02	The disposal of grit & debris (if any) generated during primary screening works should follow the requirement set in the WMP Section 4.05.	SHWSTW	Implemented
NA	NA	5.03	The wet sludge should be temporarily stored at the sludge buffer tank. It should then be transported to the centrifuge building for dewatering and discharged to the container for disposal. The whole process should be managed by the automatic electronic system and monitored by the operators during operation.	SHWSTW	Implemented
NA	NA	5.04	The other solid waste material such as sediment and grit, refuse containers or collection bags should be temporarily stored in skips at designated area. Operators should ensure sufficient space is identified and provided for temporary storage of waste materials to facilitate collection. Storage of waste material on site will be kept to a minimum to avoid nuisance to local residents.	SHWSTW	Implemented
NA	NA	5.05	Chemical wastes which likely to be generated by activities arise from the maintenance, shall followed the Waste Disposal (Chemical Waste) (General) Regulation, includes Schedule 1 of the Regulation.	SHWSTW	Implemented
NA	NA	5.06	In case of unlikely occurred chemical spillage, procedures should be followed as according to the WMP Section 5.06.	SHWSTW	Implemented

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.



# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

EP Ref.	EIA Ref.	WMP Ref.	Environmental Protection Measures	Location of the measures	Implementation Status
NA	NA	5.07	Temporary storage areas should be identify and provided for the temporary storage of general refuse to facilitate collection	SHWSTW	Implemented
NA	NA	5.07	Domestics wastes refuse generated on-site will be stored in enclosed bins or compaction units separately	SHWSTW	Implemented
NA	NA	5.07	Sufficient dustbins should be provided for domestic waste if required.	SHWSTW	Implemented
NA	NA	5.07	Domestics wastes should be cleared daily and will be disposed off to the nearest licensed landfill or refuse transfer station.	SHWSTW	Implemented
NA	NA	5.07	Spearate labeled bins should be provided to segregate the waste generated by workforce. Waste recycle collector should be employed to collect the segregated waste	SHWSTW	Implemented
NA	NA	5.07	Cardboard and paper packaging (for plant, equipment and materials) should be recovered on site, properly stockpiled in dry condition and covered to prevent cross contamination by other materials.	SHWSTW	Implemented
NA	NA	5.07	Office waste should be minimized through using papers on both sides. Communication by electronic means should be used as far as possible.	SHWSTW	Implemented
NA	NA	5.07	The burning of refuse on-site is prohibited by law and shall not be undertaken	SHWSTW	Implemented
NA	NA	5.07	Toilet wastewater shall be transported to the STW for treatment	SHWSTW	Implemented
NA	NA	5.07	Arrangement for collection of recyclable materials by recycling contractors should be followed as according to the WMP Section 5.07.	SHWSTW	Implemented
NA	NA	5.08	All recycling materials removed by the recycling contractors should be properly recorded before the removal. The natures and quantities of the recycling materials, the date of removal and the name of the recycling contractor should be recorded.	SHWSTW	Implemented
NA	NA	5.09	To maintain the site in a clean and tidy condition during the operation, general measures specified in the WMP should be implemented on site at all times. Regular site inspections shall be undertaken by the management team to ensure the measures are implemented.	SHWSTW	Implemented
NA	NA	5.10	Daily cleaning should be performed daily after work within the plant and the public areas immediately next to the site.	SHWSTW	Implemented
NA	NA	5.11	The work officer in charge of the corresponding area should perform daily inspection on the items mentioned in the WMP Section 5.10. If observations were discovered, the work officer should record the result of the inspection on an inspection checklist with photos taken and submitted to the inspectors or Chief Technical Officer for review on the following day. Any deficiency should be rectified promptly.	SHWSTW	Implemented
NA	NA	5.12	Weekly tidying should be performed weekly within the site.	SHWSTW	Implemented
NA	NA	5.13	The inspector should perform Weekly Inspection on the items mentioned in the WMP Section 5.12. If observations were discovered, the work officer should record the result on an inspection checklist	SHWSTW	Implemented

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

# FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,  
5 Lok Yi Street, Tai Lam,  
Tuen Mun, N.T.,  
Hong Kong.

Tel : +852 2450 8233  
Fax : +852 2450 6138  
E-mail : matlab@fugro.com  
Website : www.fugro.com



Report No.: 0041/17/ED/0704A

EP Ref.	EIA Ref.	WMP Ref.	Environmental Protection Measures	Location of the measures	Implementation Status
			and submitted to the Chief Technical Officer for review on the following day. Any deficiency should be rectified promptly.		
NA	NA	5.14	All wastes generated through the operational phase will be managed in accordance with the protocols set out in the WMP Section 5.14.	SHWSTW	Implemented

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.