

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



9th CONSOLIDATED QUARTERLY EM&A REPORT

January 2019 – March 2019

Client : Civil Engineering and Development Department, HKSAR

EP No. : EP-337/2009 –
New Distributor Roads Serving the Planned Kai Tak
Development Area

Contract No. : KLN/2016/05 –
Independent Environmental Checker for
Contract No. KL/2015/02 Kai Tak Development –
Stage 5A Infrastructure at Former North Apron Area

Report No. : 0087/16/ED/0954

Prepared by : Wingo So

Reviewed by : Calvin Leung

Certified by : 
Colin Yung
Independent Environmental Checker
Fugro Technical Services Limited

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



TABLE OF CONTENTS

| | |
|--|-----------|
| EXECUTIVE SUMMARY | I |
| 1. INTRODUCTION | 1 |
| 2. ENVIRONMENTAL MONITORING & AUDIT | 5 |
| 3. ENVIRONMENTAL SITE INSPECTION AND AUDIT | 7 |
| 4. ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE | 8 |
| 5. IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES | 9 |
| 6. CONCLUSIONS | 10 |

LIST OF APPENDICES

| | |
|------------|---|
| Appendix A | Monthly EM&A Report For Contract No. KL/2012/03 Kai Tak Development - Stage 4 Infrastructure at North Apron Area |
| Appendix B | Monthly EM&A Report For Contract No. KL/2014/01 Kai Tak Development - Stage 2 Infrastructure works for Developments at Southern Part of the Former Runway |
| Appendix C | Monthly EM&A Report For Contract No. KL/2014/03 Kai Tak Development - Stage 3 Infrastructure Works for Developments at the Southern Part of the Former Runway |
| Appendix D | Monthly EM&A Report For Contract No. KL/2015/02 Kai Tak Development - Stage 5A Infrastructure at Former North Apron Area |

**EXECUTIVE SUMMARY**

- i. This is the 9th Consolidated Quarterly EM&A Report which summaries the quarterly EM&A works undertaken by respective contracts under the EP-337/2009 within the reporting period between January 2019 and March 2019.

Construction Activities for the Reporting Period

- ii. The major construction activities undertaken are summarized as follow:

Contract No. KL/2012/03:

- Daily Cleaning;
- Finishing works, E&M work and Landscape Works in PS2;
- Site clearance works in DCS;
- Maintenance platform in DCS;
- Site clearance works, landscape works at Sung Wong Toi Road;
- Finishing works, Landscape works and E&M works in Portion 4 (NPS & Sewerage);
- E&M work and Landscape Works in NPS; and
- Removal of excavated material in Portion 6.

Contract No. KL/2014/01:

- TTA implementation, junction improvement works at Shing Fung Road, Wang Chiu Road / Kai Cheung Road;
- Construction of box culvert and underpass;
- Construction of utilities trough at Kai Tak Bridge;
- Construction of pile caps, noise barrier footings and outfalls;
- Laying of sewer, drainage and pavement;
- Erection of noise barrier steel structure and panels;
- Construction of Architectural features on Open Space

Contract No. KL/2014/03:

December 2018

- Excavation and laying of drainage pipe and manhole;
- Excavation and ELS construction.
- Construction of SUS structure; and
- Construction of District Cooling System.

January 2019

- Excavation and laying of drainage pipe and manhole;
- Excavation and ELS construction.
- Construction of SUS structure; and
- Construction of District Cooling System.

February 2019

- Excavation and laying of drainage pipe and manhole;
- Excavation and ELS construction.
- Construction of SUS structure; and
- Construction of District Cooling System.

**Contract No. KL/2015/02:**

January 2019

- Excavate with ELS works for subway construction at PERE
- Structural works and backfilling works for subway SW6 from CH0 to CH34 and Staircase ST3
- Demolish the existing K73 parapet for temporary slip road (Stage 4)
- Remedial / outstanding work for drainage and sewerage at Portion 2&3
- Construction of subsoil drain at retaining wall S15
- Reinstatement of chain-link fence for handover of Site
- Drainage and sewerage works in portion 4
- DCS works in Road D1 of Portion 6 & Portion 1
- DCS works in Road L7 of Portion 1

February 2019

- Structural works and backfilling works for subway SW6 from CH0 to CH45 and Staircase ST3
- Fabricate the underpinning frames
- Demolish the K73 parapet wall for slip road of stage 4
- Construction of chain-link fence for land sale sites
- Filling work for slip road S15
- Drainage works at slip road S15
- DCS works at Road D1 of Portion 1 and Portion 6
- DCS works at Road L7 of Portion 1
- Sewerage works at Portion 4

March 2019

- Structural works and backfilling works for subway construction at PERE
- Backfilling works for subway SW6 from CH0 to CH45 and Staircase ST3
- Erection of underpinning frame at the existing Bridge K72
- Sheet piling works at SKLR playground (Stage 4)
- Construction of chain-link fence for land sale sites
- Filling work for slip road S15
- Drainage works at slip road S15
- DCS Works in Road D1, road L7, Portion 6, Portion 1
- Water mains laying works in Portion 4



Breaches of Action and Limit Levels for Air Quality

- iii. No Action or Limit Level Exceedance of 1-hr TSP monitoring was recorded in the reporting period.
- iv. No Action or Limit Level Exceedance of 24hr TSP monitoring was recorded in the reporting period.

Breaches of Action and Limit Levels for Noise

- v. No Action or Limit Level Exceedance of Construction Noise monitoring was recorded in the reporting period.

Complaint, Notifications of Summons and Successful Prosecutions

- vi. No environmental complaint was received during the reporting period.
- vii. No notification of summons or prosecution was received in the reporting period.



1. INTRODUCTION

1.1 Background

- 1.1.1 The Kai Tak Development is located in the south-eastern part of Kowloon Peninsula of the HKSAR, comprising the apron and runway areas of the former Kai Tak Airport and existing waterfront areas at To Kwa Wan, Ma Tau Kok, Kowloon Bay, Kwun Tong and Cha Kwo Ling.
- 1.1.2 A study of environmental impact assessment (EIA) was undertaken to consider the key issues of air quality, noise, water quality, waste, land contamination, cultural heritage and landscape and visual impact, and identify possible mitigation measures associated with the works. EIA Report (Register No. AEIAR-130/2009) was approved by the Environmental Protection Department (EPD) on 4 March 2009.
- 1.1.3 The EP-337/2009 was issued on 23 April 2009 for the new distributor roads serving the planned Kai Tak Development to the following scale and slope:
 - a) Road D1 – a dual 2-lane carriageway of approximately 1.3 km long.
 - b) Road D2 – a dual 3-lane carriageway of approximately 1.1 km long.
 - c) Road D3 – a dual 2-lane carriageway of approximately 2.3 km long.
 - d) Road D4 – a dual 2-lane carriageway of approximately 0.9 km long.
- 1.1.4 The Civil Engineering and Development Department HKSAR (CEDD) has appointed Fugro Technical Services Limited (FTS) to undertake the role of Independent Environmental Checker (IEC) for the Contract No. KL/2015/02.
- 1.1.5 This is the 9th Consolidated Quarterly EM&A Report which summaries the quarterly EM&A works undertaken by respective contracts under the EP-337/2009 within the reporting period between January 2019 and March 2019.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



1.2 Summary of relevant Contract Information of Key Personnel

| Party | Position | Name | Telephone | Fax |
|-----------------------------------|---|--------------------|---------------------|-----------|
| Contract No. KL/2012/03: | | | | |
| Project Proponent (CEDD) | Senior Engineer | Mr. C. K. Choi | 2301 1174 | 2301 1277 |
| Engineer's Representative (AECOM) | SRE | Mr. John Yam | 2798 0771 | 3013 8864 |
| | RE | Mr. Stanley Chan | | |
| IEC (AnewR) | IEC | Mr. Adi Lee | 2618 2831 | 3007 8648 |
| ET (Cinotech) | ET Leader | Dr. Priscilla Choy | 2151 2089 | 3107 1388 |
| | Project Coordinator and Audit Team Leader | Ms. Ivy Tam | 2151 2090 | |
| ET (Wellab) | ET Leader | Dr. Priscilla Choy | 2151 2089 | 2898 7076 |
| | Project Coordinator and Audit Team Leader | Ms. Ivy Tam | 2151 2090 | |
| Main Contractor (Kwan On) | Site Agent | Mr. Albert Ng | 3689 7752 | 3689 7726 |
| | | | 6146 6761 (Hotline) | |
| Contract No. KL/2014/01: | | | | |
| Project Proponent (CEDD) | Senior Engineer | Mr. Keith Chu | 3579 2450 | 3579 4516 |
| | Engineer | Ms. Adonia Yung | 3579 2124 | |
| Engineer's Representative (AECOM) | CRE | Mr. Clive Cheng | 3746 1801 | 2798 0783 |
| IEC (KSMC) | IEC | Dr. C. F. Ng | 2618 2166 | 2120 7752 |
| ET (Cinotech) | ET Leader | Mr. K S Lee | 2151 2091 | 3107 1388 |
| | Audit Team Leader | Ms. Betty Choi | 2151 2072 | |
| Main Contractor (CCJV) | EO | Mr. Dennis Ho | 2960 1398 | 2960 1399 |
| Contract No. KL/2014/03: | | | | |
| Project Proponent (CEDD) | Co-ordinator | Ms. Amy Chu | 3106 3172 | 2369 4980 |
| Engineer's Representative (HMJV) | CRE | Mr. Chris Wong | 3742 3803 | 3742 3899 |
| IEC (Ramboll Hong Kong Limited) | IEC | Mr. F. C. Tsang | 3465 2851 | 3465 2899 |
| ET (MCL) | ET Leader | Mr. Colin Yung | 3565 4114 | 3565 4160 |
| Main Contractor (CRBC) | Site Agent | Mr. Dickey Yau | 5699 4503 | 2283 1689 |
| | EO | Mr. Kola Lam | 5545 4625 | |
| Contract No. KL/2015/02: | | | | |
| Project Proponent (CEDD) | Senior Engineer | Mr. Ricky CHAN | 2116 3753 | 2116 0714 |
| Engineer's Representative (AECOM) | SRE | Mr. Vincent Lee | 2798 0771 | 2210 6110 |
| IEC (FTS) | IEC | Mr. Colin Yung | 3565 4114 | 2450 8032 |
| ET (Cinotech) | ET Leader | Mr. K.S Lee | 2151 2091 | 3107 1388 |
| | Audit Team Leader | Ms. Betty Choi | 2151 2072 | |
| Main Contractor (PWHJV) | Site Agent | Mr. W. M. Wong | 6386 3535 | 2398 8301 |

1.3 Summary of Construction Programme and Activities

1.3.1 The construction programme of each Contract is summarized in the appendices of the corresponding Quarterly EM&A.

1.4 Works undertaken in reporting period

1.4.1 The major construction activities undertaken are summarized as follow:

Contract No. KL/2012/03:

- Daily Cleaning;
- Finishing works, E&M work and Landscape Works in PS2;
- Site clearance works in DCS;
- Maintenance platform in DCS;
- Site clearance works, landscape works at Sung Wong Toi Road;
- Finishing works, Landscape works and E&M works in Portion 4 (NPS & Sewerage);
- E&M work and Landscape Works in NPS; and
- Removal of excavated material in Portion 6.

Contract No. KL/2014/01:

- TTA implementation, junction improvement works at Shing Fung Road, Wang Chiu Road / Kai Cheung Road;
- Construction of box culvert and underpass;
- Construction of utilities trough at Kai Tak Bridge;
- Construction of pile caps, noise barrier footings and outfalls;
- Laying of sewer, drainage and pavement;
- Erection of noise barrier steel structure and panels;
- Construction of Architectural features on Open Space

Contract No. KL/2014/03:

December 2018

- Excavation and laying of drainage pipe and manhole;
- Excavation and ELS construction.
- Construction of SUS structure; and
- Construction of District Cooling System.

January 2019

- Excavation and laying of drainage pipe and manhole;
- Excavation and ELS construction.
- Construction of SUS structure; and
- Construction of District Cooling System.

February 2019

- Excavation and laying of drainage pipe and manhole;
- Excavation and ELS construction.
- Construction of SUS structure; and
- Construction of District Cooling System.

**Contract No. KL/2015/02:**

January 2019

- Excavate with ELS works for subway construction at PERE
- Structural works and backfilling works for subway SW6 from CH0 to CH34 and Staircase ST3
- Demolish the existing K73 parapet for temporary slip road (Stage 4)
- Remedial / outstanding work for drainage and sewerage at Portion 2&3
- Construction of subsoil drain at retaining wall S15
- Reinstatement of chain-link fence for handover of Site
- Drainage and sewerage works in portion 4
- DCS works in Road D1 of Portion 6 & Portion 1
- DCS works in Road L7 of Portion 1

February 2019

- Structural works and backfilling works for subway SW6 from CH0 to CH45 and Staircase ST3
- Fabricate the underpinning frames
- Demolish the K73 parapet wall for slip road of stage 4
- Construction of chain-link fence for land sale sites
- Filling work for slip road S15
- Drainage works at slip road S15
- DCS works at Road D1 of Portion 1 and Portion 6
- DCS works at Road L7 of Portion 1
- Sewerage works at Portion 4

March 2019

- Structural works and backfilling works for subway construction at PERE
- Backfilling works for subway SW6 from CH0 to CH45 and Staircase ST3
- Erection of underpinning frame at the existing Bridge K72
- Sheet piling works at SKLR playground (Stage 4)
- Construction of chain-link fence for land sale sites
- Filling work for slip road S15
- Drainage works at slip road S15
- DCS Works in Road D1, road L7, Portion 6, Portion 1
- Water mains laying works in Portion 4



2. ENVIRONMENTAL MONITORING & AUDIT

2.1 Results and Observations

2.1.1 Contract No. KL/2012/03:

Air Quality

1-hour TSP Monitoring

- No Action/Limit Level exceedance was recorded

24-hour TSP Monitoring

- No Action/Limit Level exceedance was recorded.

Construction Noise

- The construction noise monitoring at Station M8 – Po Leung Kok Ngan Po Ling College was cancelled on 12th October 2018, 30th October 2018 and 15th November 2018. The college principal rejected our application for permission on 12th November 2018.
- The noise monitoring at alternative station M8(A) – Po Leung Kok Ngan Po Ling College (Site Boundary) was commenced on 21st November 2018. The proposal for alternative station will be submitted to Environmental Protection Department (EPD) for approval. The noise monitoring results were adopted to present in the EM&A Report temporarily. No Action/Limit Level exceedance was recorded.

Landscape and Visual

- Site audits were carried out on a weekly basis to monitor and audit the timely implementation of landscape and visual mitigation measures of this project. No non-compliance of the landscape and visual impact was recorded in the reporting quarter.

2.1.2 Contract No. KL/2014/01:

Air Quality and Construction Noise

- No monitoring for air quality and noise impact is required under the Project.

Landscape and Visual

- No non-compliance of the landscape and visual impact was recorded in the reporting quarter.

2.1.3 Contract No. KL/2014/03:

- No Action and Limit Level exceedance for 24-hr TSP was recorded in the reporting period at all monitoring stations.

- No Action / Limit Level exceedance for construction noise was recorded in the reporting period at all monitoring stations.

2.1.4 Contract No. KL/2015/02:

Air Quality

- No Action/ Limit Level exceedance was recorded in the reporting period.

Construction Noise

- No Action/ Limit Level exceedance was recorded in the reporting period.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Landscape and Visual

- No non-compliance of the landscape and visual impact was recorded in the reporting period.

2.1.5 Summary of exceedances and graphical presentations are presented in the appendices of the corresponding Quarterly EM&A reports.



3. ENVIRONMENTAL SITE INSPECTION AND AUDIT

3.1 Site Inspection

3.1.1 Site inspections were carried out weekly to monitor the implementation of proper environmental pollution control and mitigation measures for the Project. The site inspection of each Contract are summarized as follow:

Contract No. KL/2012/03:

During site inspections in the reporting period, no non-conformance was identified.

Contract No. KL/2014/01:

During site inspections in the reporting period, no non-conformance was identified.

Contract No. KL/2014/03:

No outstanding issues were reported during the reporting period.

Contract No. KL/2015/02:

During site inspections in the reporting period, no non-conformance was identified.

3.1.2 Detailed of observation, recommendation of site inspections and summary of the mitigation measures implementation schedule is provided in the appendices of the corresponding Quarterly EM&A Reports.



4. ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE

4.1 Complaints, Notification of Summons and Prosecution

4.1.1 The summary of complaints, notification of summons and prosecution in the reporting month is shown as **Table 4.1**. Detailed records are presented in the appendices of the corresponding Quarterly EM&A Reports.

Table 4.1 Summary of Complaints, Notification of Summons and Prosecution

| Event | No. of Event(s) This Reporting Period | Remark |
|--|---------------------------------------|--------|
| Contract No. KL/2012/03: | | |
| Complaint received | 0 | NA |
| Notifications of any summons & prosecutions received | 0 | NA |
| Contract No. KL/2014/01: | | |
| Complaint received | 0 | NA |
| Notifications of any summons & prosecutions received | 0 | NA |
| Contract No. KL/2014/03: | | |
| Complaint received | 0 | NA |
| Notifications of any summons & prosecutions received | 0 | NA |
| Contract No. KL/2015/02: | | |
| Complaint received | 0 | NA |
| Notifications of any summons & prosecutions received | 0 | NA |

4.1.2 No environmental complaint was received during the reporting period.

4.1.3 No notification of summons or prosecution was received in the reporting period.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



5. IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES

5.1 Implementation Status

The Contractor has implemented environmental mitigation measures and requirements as stated in the EIA Reports, the EP and the EM&A Manuals. The implementation status of the mitigation measures during the reporting month are presented in the appendices of the corresponding Quarterly EM&A Reports.

5.2 Waste Management

The amount of wastes generated of relevant Contracts is shown in the appendices of the corresponding Quarterly EM&A Reports.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



6. CONCLUSIONS

- 6.1.1 No Action or Limit Level Exceedance of 1-hr TSP monitoring was recorded in the reporting period.
- 6.1.2 No Action or Limit Level Exceedance of 24hr TSP monitoring was recorded in the reporting period.
- 6.1.3 No Action or Limit Level Exceedance of Construction Noise monitoring was recorded in the reporting period.
- 6.1.4 No environmental complaint was received during the reporting period.
- 6.1.5 No notification of summons or prosecution was received in the reporting period.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix A

**Monthly EM&A Report
For
Contract No. KL/2012/03
Kai Tak Development - Stage 4 Infrastructure at North Apron Area**

Civil Engineering and Development Department


EP-344/2009 – New Sewage Pumping Stations Serving KTD and
EP-337/2009 – New Distributor Roads Serving the Planned KTD

Contract No. KL/2012/03
Kai Tak Development – Stage 4 Infrastructure at
Former North Apron Area

Quarterly EM&A Summary Report

December 2018 – February 2019

(Version 1.0)

Approved By 
(Environmental Team Leader)

REMARKS:

The information supplied and contained within this report is, to the best of our knowledge, correct at the time of printing.

WELLAB accepts no responsibility for changes made to this report by third parties

WELLAB LTD
Room 1701, Technology Park,
18 On Lai Street,
Shatin, NT, Hong Kong
Tel: (852) 2898 7388 Fax: (852) 2898 7076
Website: www.wellab.com.hk



AECOM
8/F, Grand Central Plaza, Tower 2
138 Shatin Rural Committee Road
Shatin
New Territories
Hong Kong

Your reference:

Our reference: HKCEDD11/50/105646

Date: 26 March 2019

Attention: Mr Mickey Lee

BY EMAIL & POST
(email: RE3@ktd-5a.com)

Dear Sirs

Agreement No. EDO 08/2018
Independent Environmental Checker (IEC) for CEDD Contract No. KL/2012/03
Kai Tak Development – Stage 4 infrastructure at former north apron area
Verification of Quarterly EM&A Report (December 18 - February 19)

We refer to emails of 21 and 25 March 2019 attaching a Quarterly EM&A Report (December 18 - February 19) prepared by the ET.

We have no further comment and hereby verify the Report in accordance with Clause 3.3 of the Environmental Permit nos. EP-337/2009 and EP-344/2009.

Please do not hesitate to contact the undersigned or our Ms Hazel Chan on 2618 2831 should you have any queries.

Yours faithfully
ANEWR CONSULTING LIMITED



Adi Lee

Independent Environmental Checker

LYMA/CYYH/lhnh

cc CEDD – Mr C K Choi (email: ckchoi@cedd.gov.hk)
Wellab – Dr Priscilla Choy (email: priscilla.choy@wellab.com.hk)

TABLE OF CONTENTS

| | Page |
|---|----------|
| EXECUTIVE SUMMARY | 1 |
| Introduction..... | 1 |
| Environmental Monitoring Works..... | 1 |
| Key Information in the Reporting Quarter..... | 2 |
| 1. INTRODUCTION | 3 |
| Background..... | 3 |
| Project Organizations..... | 3 |
| 2. ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS | 5 |
| Monitoring Parameters and Monitoring Locations..... | 5 |
| Environmental Quality Performance Limits (Action and Limit Levels) | 5 |
| Implementation Status of Environmental Mitigation Measures | 5 |
| Site Audit Summary..... | 5 |
| Status of Waste Management | 5 |
| 3. MONITORING RESULTS AND NON-COMPLIANCE (EXCEEDANCES) OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS (ACTION AND LIMIT LEVELS) | 6 |
| Weather Conditions | 6 |
| Air Quality | 6 |
| Construction Noise | 6 |
| Landscape and Visual | 6 |
| Influencing Factors on the Monitoring Results | 6 |
| Comparison of EM&A results with EIA predictions..... | 7 |
| 4. COMMENTS, CONCLUSIONS AND RECOMMENDATIONS | 9 |
| Review of the Reasons for and the Implications of Non-compliance..... | 9 |
| Effectiveness of Mitigation Measures | 9 |

LIST OF TABLE

| | |
|-----------|--|
| Table I | Summary Table for Non-compliance Recorded in the Reporting Quarter |
| Table II | Summary Table for Key Information in the Reporting Quarter |
| Table 1.1 | Key Project Contacts |
| Table 3.1 | Major Dust Sources during the Monitoring in the Reporting Period |
| Table 3.2 | Major Noise Sources during the Monitoring in the Reporting Period |

LIST OF FIGURES

| | |
|----------|---|
| Figure 1 | Layout Plan of the Project |
| Figure 2 | Locations of Air Quality Monitoring Stations |
| Figure 3 | Locations of Construction Noise Monitoring Stations |

LIST OF APPENDICES

| | |
|---|--|
| A | Monitoring Requirements |
| B | Action and Limit Levels for Air Quality and Noise |
| C | Graphical Presentation of Air Quality Monitoring Results |
| D | Graphical Presentation of Noise Monitoring Results |
| E | Environmental Mitigation Implementation Schedule (EMIS) |
| F | Site Audit Summary |
| G | Monthly Summary Waste Flow Table |
| H | Summary of Exceedances |

LIST OF ANNEXES

| | |
|---------|---|
| Annex I | Comparison of EM&A Data and EIA Predictions |
|---------|---|

EXECUTIVE SUMMARY

Introduction

1. This is the 21th Quarterly Environmental Monitoring and Audit Report prepared by Wellab Ltd. for “Contract No. KL/2012/03 - Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area” (Hereafter referred to as “the Project”). This summary report presents the EM&A works performed in the period from December 2018 to February 2019.

Environmental Monitoring Works

2. Environmental monitoring for the Project was performed in accordance with the EM&A Manual and the monitoring results were checked and reviewed. Site Inspections/Audits were conducted once per week. The implementation of the environmental mitigation measures, Event Action Plans and environmental complaint handling procedures were also checked.
3. Summary of the non-compliance in the reporting quarter for the Project is tabulated in Table I.

Table I Non-compliance Record for the Project in the Reporting Quarter

| Parameter | No. of Exceedance | | Action Taken |
|---------------|-------------------|-------------|--------------|
| | Action Level | Limit Level | |
| December 2018 | | | |
| 1-hr TSP | 0 | 0 | N/A |
| 24-hr TSP | 0 | 0 | N/A |
| Noise | 0 | 0 | N/A |
| January 2019 | | | |
| 1-hr TSP | 0 | 0 | N/A |
| 24-hr TSP | 0 | 0 | N/A |
| Noise | 0 | 0 | N/A |
| February 2019 | | | |
| 1-hr TSP | 0 | 0 | N/A |
| 24-hr TSP | 0 | 0 | N/A |
| Noise | 0 | 0 | N/A |

4. No exceedance was recorded at air quality station during the reporting period.

Key Information in the Reporting Quarter

5. Summary of key information in the reporting quarter is tabulated in Table II.

Table II Summary Table for Key Information in the Reporting Quarter

| Event | Event Details | | Action Taken | Status | Remark |
|--|---------------|--------|--------------|--------|--------|
| | Number | Nature | | | |
| Complaint received | 0 | --- | N/A | N/A | --- |
| Reporting Changes | 0 | --- | N/A | N/A | --- |
| Notifications of any summons & prosecutions received | 0 | --- | N/A | N/A | --- |

6. Environmental monitoring works for the Project are considered effective and are generating data to categorically identify the environmental impacts from the works and influencing factors in the vicinity of monitoring stations.

1. INTRODUCTION

Background

- 1.1 The Kai Tak Development (KTD) is located in the south-eastern part of Kowloon Peninsula, comprising the apron and runway areas of the former Kai Tak Airport and existing waterfront areas at To Kwa Wan, Ma Tau Kok, Kowloon Bay, Kwun Tong and Cha Kwo Ling. It covers a land area of about 328 hectares. Stage 4 Infrastructure at Former North Apron Area is one of the construction stages of KTD. The general layout of the Project is shown in **Figure 1**.
- 1.2 The construction activities undertaken in the reporting quarter were:
- Daily Cleaning;
 - Finishing works, E&M work and Landscape Works in PS2;
 - Site clearance works in DCS;
 - Maintenance platform in DCS;
 - Site clearance works, landscape works at Sung Wong Toi Road;
 - Finishing works, Landscape works and E&M works in Portion 4 (NPS & Sewerage);
 - E&M work and Landscape Works in NPS; and
 - Removal of excavated material in Portion 6.
- 1.3 Wellab Limited (Wellab) was commissioned by Kwan On Construction Co., Ltd. (the Contractor) on 1st January 2019 to undertake the role of the Environmental Team (ET) for the Contract No. KL/2012/03 - Stage 4 Infrastructure at Former North Apron Area. The construction work under KL/2012/03 comprises the construction of Road D2 & Sewage Pumping Station PS2 and PS NPS which forms a part of the works under two EPs (EP-337/2009 and EP-344/2009).
- 1.4 The construction commencement of this Contract was on 1st December 2013 for Road D2, Sewage Pumping Station PS2 and PS NPS. This summary report presents the EM&A works performed in the period from December 2018 to February 2019.

Project Organizations

- 1.5 Different parties with different levels of involvement in the project organization include:
- Project Proponent – Civil Engineering and Development Department (CEDD).
 - The Engineer and the Engineer's Representative (ER) – AECOM.
 - Environmental Team (ET) – Cinotech Consultants Limited (CCL) (ET service completed on 31st December 2018).
 - Environmental Team (ET) – Wellab Limited (Wellab) (Responsible for ET service since 1st January 2019).
 - Independent Environmental Checker (ANewR) – ANewR Consulting Limited. (ANewR)
 - Contractor – Kwan On Construction Co., Ltd. (Kwan On).

1.6 The key contacts of the Project are shown in **Table 1.1**.

Table 1.1 Key Project Contacts

| Party | Role | Contact Person | Position | Phone No. | Fax No. |
|----------|-----------------------------------|--------------------|---|--------------------------------------|-----------|
| CEDD | Project Proponent | Mr. C. K. Choi | Senior Engineer | 2301 1174 | 2301 1277 |
| AECOM | Engineer's Representative | Mr. John Yam | SRE | 2798 0771 | 3013 8864 |
| | | Mr. Stanley Chan | RE | | |
| Cinotech | Environmental Team | Dr. Priscilla Choy | Environmental Team Leader | 2151 2089 | 3107 1388 |
| | | Ms. Ivy Tam | Project Coordinator and Audit Team Leader | 2151 2090 | |
| Wellab | Environmental Team | Dr. Priscilla Choy | Environmental Team Leader | 2151 2089 | 2898 7076 |
| | | Ms. Ivy Tam | Project Coordinator and Audit Team Leader | 2151 2090 | |
| ANewR | Independent Environmental Checker | Mr. Adi Lee | Independent Environmental Checker | 2618 2831 | 3007 8648 |
| Kwan On | Contractor | Mr. Albert Ng | Site Agent | 3689 7752 | 3689 7726 |
| | | | | 6146 6761 (Hotline telephone number) | |

2. ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS

Monitoring Parameters and Monitoring Locations

- 2.1 The EM&A Manual designates locations for the ET to monitor environmental impacts in terms of air quality, noise, landscape and visual due to the Project. The Project area and monitoring locations are depicted in **Figures 2 and 3**. **Appendix A** gives details of monitoring requirements.

Environmental Quality Performance Limits (Action and Limit Levels)

- 2.2 The environmental quality performance limits, i.e. Action and Limit Levels were derived from the baseline monitoring results. Should the measured environmental quality parameters exceed the Action/Limit Levels, the respective action plans would be implemented. The Action/Limit Levels for each environmental parameter are given in **Appendix B**.

Implementation Status of Environmental Mitigation Measures

- 2.3 Relevant mitigation measures as recommended in the project EIA report have been stipulated in the EM&A Manual for the Contractor to implement. The implementation status of environmental mitigation measures (EMIS) is given in **Appendix E**.

Site Audit Summary

- 2.4 During site inspections in the reporting period, no non-conformance was identified. The observations and recommendations made during the reporting period are summarized in **Appendix F**.

Status of Waste Management

- 2.5 The amount of wastes generated by the major site activities of this Project during the reporting quarter is shown in **Appendix G**.

3. MONITORING RESULTS AND NON-COMPLIANCE (EXCEEDANCES) OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS (ACTION AND LIMIT LEVELS)

3.1 Environmental monitoring works were performed in the reporting period and all monitoring results were checked and reviewed. A summary of exceedances is attached in **Appendix H**.

Weather Conditions

3.2 The detail of weather conditions for each individual monitoring session was presented in monthly EM&A report.

Air Quality

1-hour TSP Monitoring

3.3 1-hour TSP monitoring was conducted as scheduled in the reporting quarter. No Action/Limit Level exceedance was recorded.

24-hour TSP Monitoring

3.4 24-hour TSP monitoring was conducted as scheduled in the reporting quarter. No Action/Limit Level exceedance was recorded.

3.5 The graphical presentations of the air quality monitoring results are shown in Appendix C.

Construction Noise

3.6 The construction noise monitoring at Station M8 – Po Leung Kok Ngan Po Ling College was cancelled on 12th October 2018, 30th October 2018 and 15th November 2018. The college principal rejected our application for permission on 12th November 2018.

3.7 The noise monitoring at alternative station M8(A) – Po Leung Kok Ngan Po Ling College (Site Boundary) was commenced on 21st November 2018. The proposal for alternative station was submitted to Environmental Protection Department (EPD) for approval. The noise monitoring results were adopted to present in the EM&A Report temporarily. No Action/Limit Level exceedance was recorded.

3.8 The graphical presentations of the noise monitoring results are shown in **Appendix D**.

Landscape and Visual

3.9 Site audits were carried out on a weekly basis to monitor and audit the timely implementation of landscape and visual mitigation measures of this project. No non-compliance of the landscape and visual impact was recorded in the reporting quarter.

Influencing Factors on the Monitoring Results

3.10 During the reporting period, the major dust and noise sources identified at the designated monitoring stations are as follows:

Table 3.1 Major Dust Sources in the Reporting Period

| Station | Major Dust Source |
|--|---|
| AM2 – Lee Kau Yan Memorial School | Road traffic dust Exposed site area and open stockpiles Site vehicle movement |
| AM2(A) – Ng Wah Catholic Secondary School | Road Traffic Dust Exposed site area and open stockpiles Excavation works Site vehicle movement |
| AM3(A) – Holy Trinity Bradbury Centre | Road traffic dust Exposed site area Excavation works Site vehicle movement |
| AM3(B) – Family Planning Association of Hong Kong | Road Traffic Dust Exposed site area Excavation works Site vehicle movement |
| AM4(C) – New Pumping Station under Contract No. KL/2012/03 | Site vehicle movement |
| ^AM5 – CCC Kei To Secondary School | Site vehicle movement |

(^)AM5(A) – Po Leung Kuk Ngan Po Ling College was cancelled because no permission was granted from the premise. Air quality monitoring was carried out at AM5 – CCC Kei To Secondary School.

Table 3.2 Major Noise Sources during the Monitoring in the Reporting Period

| Monitoring Stations | Locations | Major Noise Source |
|---------------------|---|---|
| M6(A) | Oblate Primary School | Road and marine traffic noise |
| M7 | CCC Kei To Secondary School | Road and marine traffic noise |
| *M8(A) | Po Leung Kuk Ngan Po Ling College (Site Boundary) (Temporary) | Excavation works at the site (Contract No.: 1/WSD/14(K)) facing Po Leung Kuk Ngan Po Ling College |
| M9 | Tak Long Estate | Road paving and asphalt paving works |

(*) Noise monitoring at M8 – Po Leung Kuk Ngan Po Ling College was cancelled due to no permission was granted from the premise. Noise monitoring was carried out at M8(A) – Po Leung Kuk Ngan Po Ling College (Site Boundary) temporarily from 21st November 2018..

Comparison of EM&A results with EIA predictions

- 3.11 According to Section 16.7.1 (viii) of the EM&A Manual, the EM&A data are compared with the EIA predictions and summarized in **Annex I**.
- 3.12 The average 1-hour concentrations in the reporting period were generally well below the prediction in the approved Environmental Impact Assessment (EIA) Report. No Action/Limit Level exceedance was recorded.
- 3.13 The noise monitoring at alternative station M8(A) – Po Leung Kok Ngan Po Ling College (Site Boundary) was commenced on 21st November 2018. The proposal for alternative

station was submitted to Environmental Protection Department (EPD) for approval. No Action/Limit Level exceedance was recorded.

- 3.14 The range of noise level monitoring at station M7 in the reporting month was slightly above the prediction in the approved Environmental Impact Assessment (EIA) Report. The range of noise level monitoring at stations M8/8(A) in the reporting month was slightly below the prediction in the approved Environmental Impact Assessment (EIA) Report.

4. COMMENTS, CONCLUSIONS AND RECOMMENDATIONS


Review of the Reasons for and the Implications of Non-compliance

- 4.1 No project related Action/Limit Level exceedance was recorded at all air quality and noise monitoring stations in the reporting quarter.

Effectiveness of Mitigation Measures

- 4.2 The mitigation measures recommended in the EIA report are considered effective in minimizing environmental impacts.
- 4.3 The Contractor has implemented the recommended mitigation measures.
- 4.4 Environmental monitoring works performed in the reporting quarter and all monitoring results were checked and reviewed. No non-compliance (exceedances) of Action/Limit Level was recorded.
- 4.5 No environmental complaints and environmental prosecution were received in the reporting quarter.
- 4.6 The effectiveness of environmental management is satisfactory given that the recommendations given in the site inspections performed in the reporting period (as shown in **Appendix F**) are met.


FIGURES

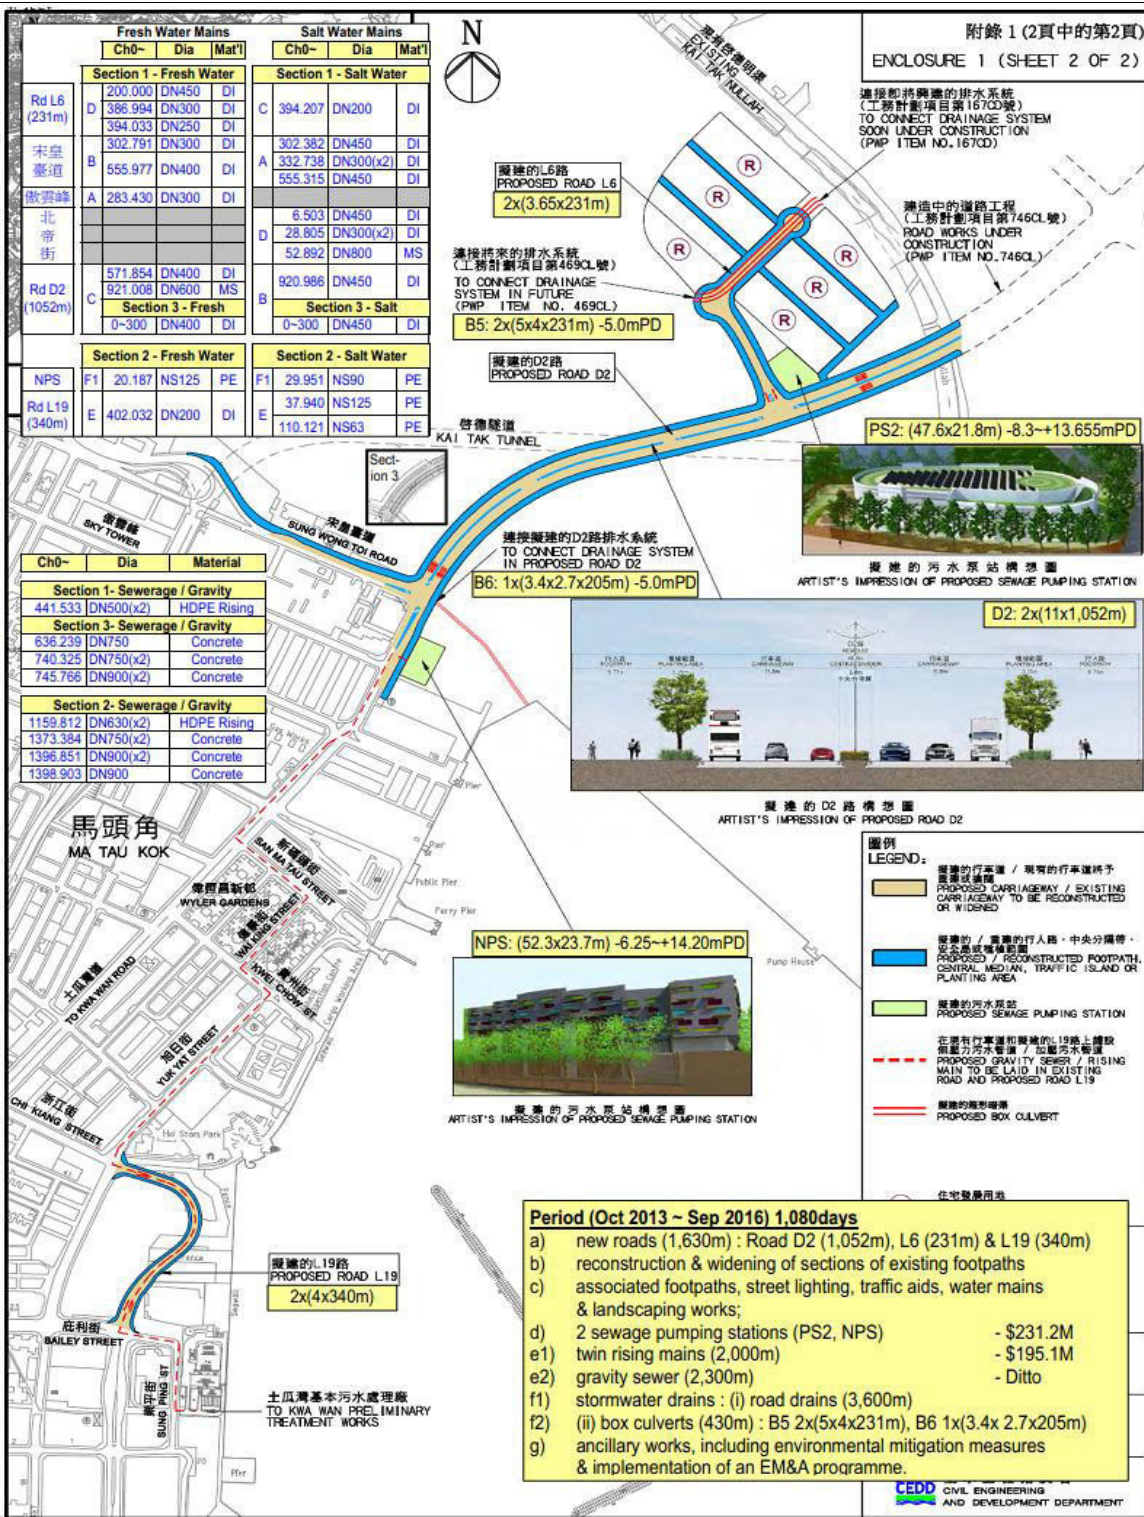

附錄 1 (2頁中的第2頁)
ENCLOSURE 1 (SHEET 2 OF 2)


| | | | | | |
|-------|--|-------|--------|-------------|---------|
| Title | KL/2012/03 - Kai Tak Development - Stage 4 Infrastructure at Former North Apron Area | Scale | N.T.S | Project No. | MA13056 |
| | Site Layout Plan | Date | Sep-13 | Figure | 1 |



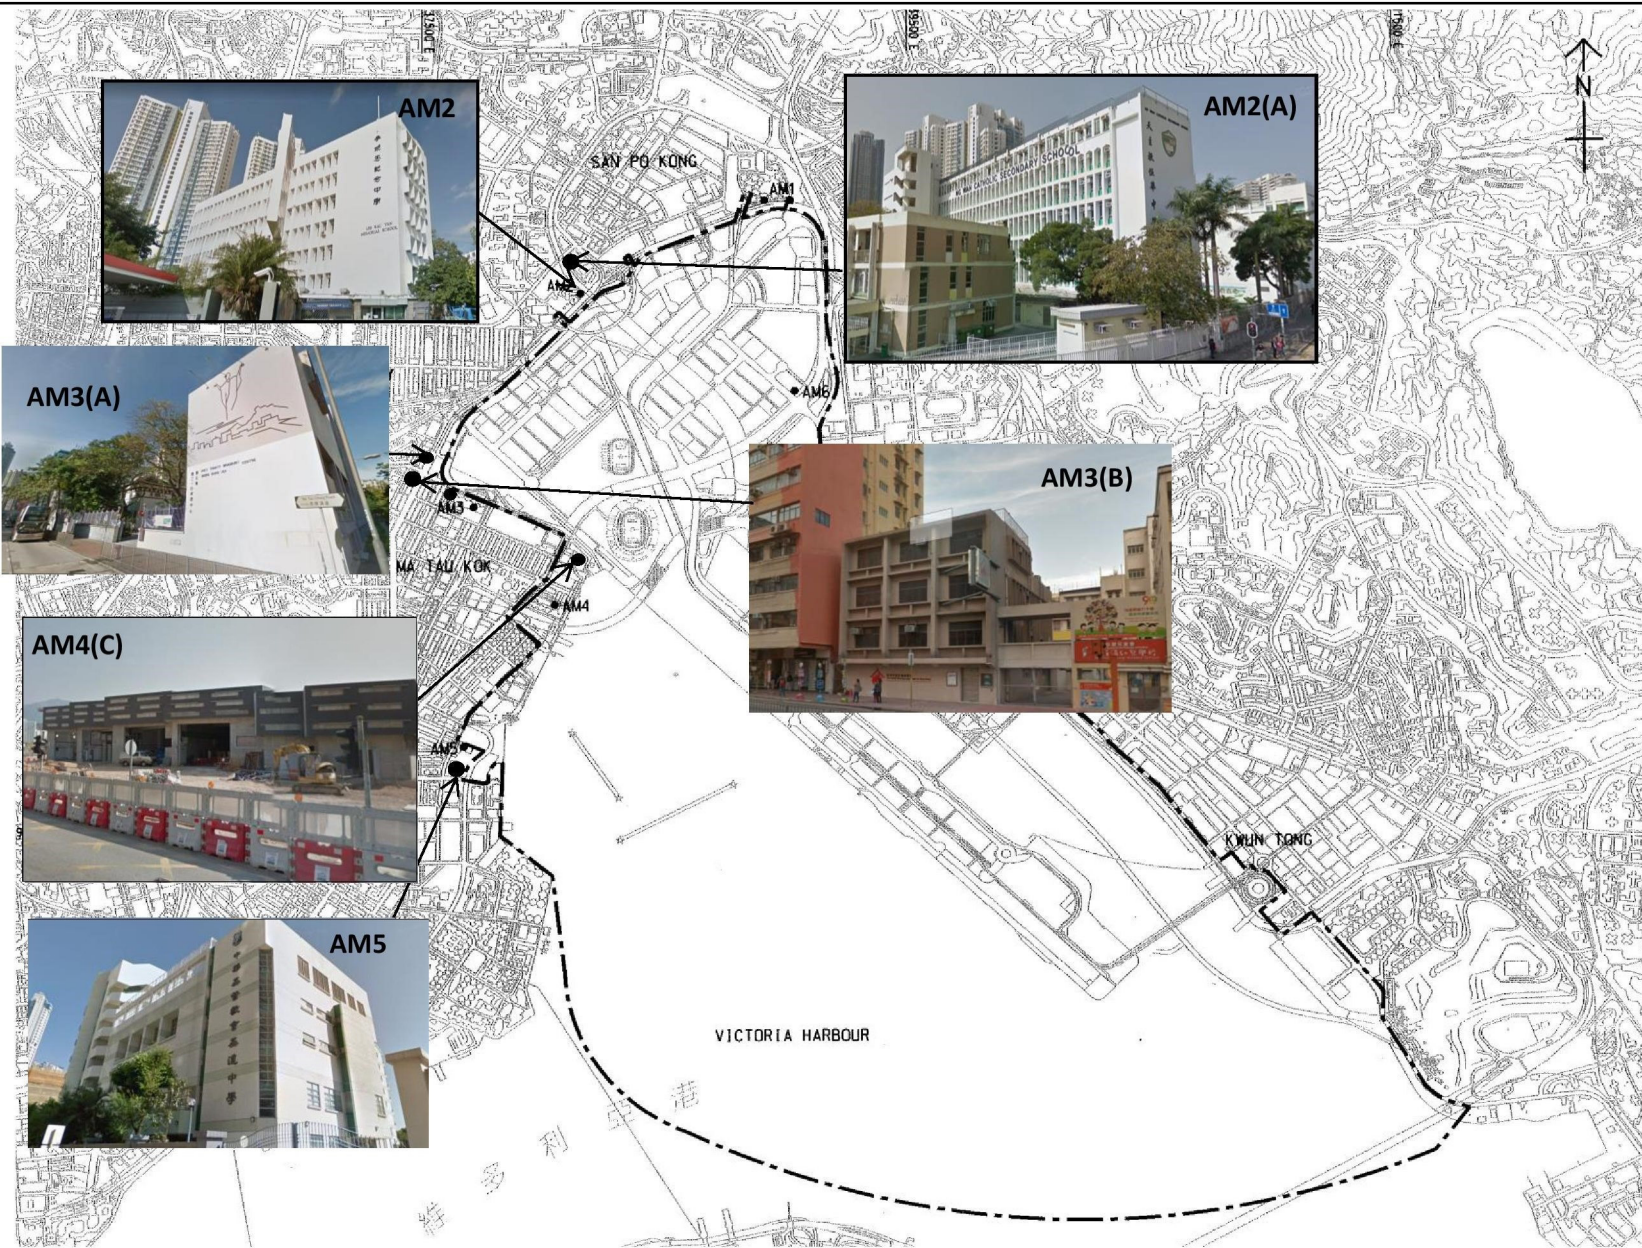

Title Contract No. KL/2012/03
 Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area
 Air Quality Monitoring Stations under this Project

| | | | |
|-------|--------|-------------|---------|
| Scale | N.T.S | Project No. | MA13056 |
| Date | Dec-17 | Figure | 2 |

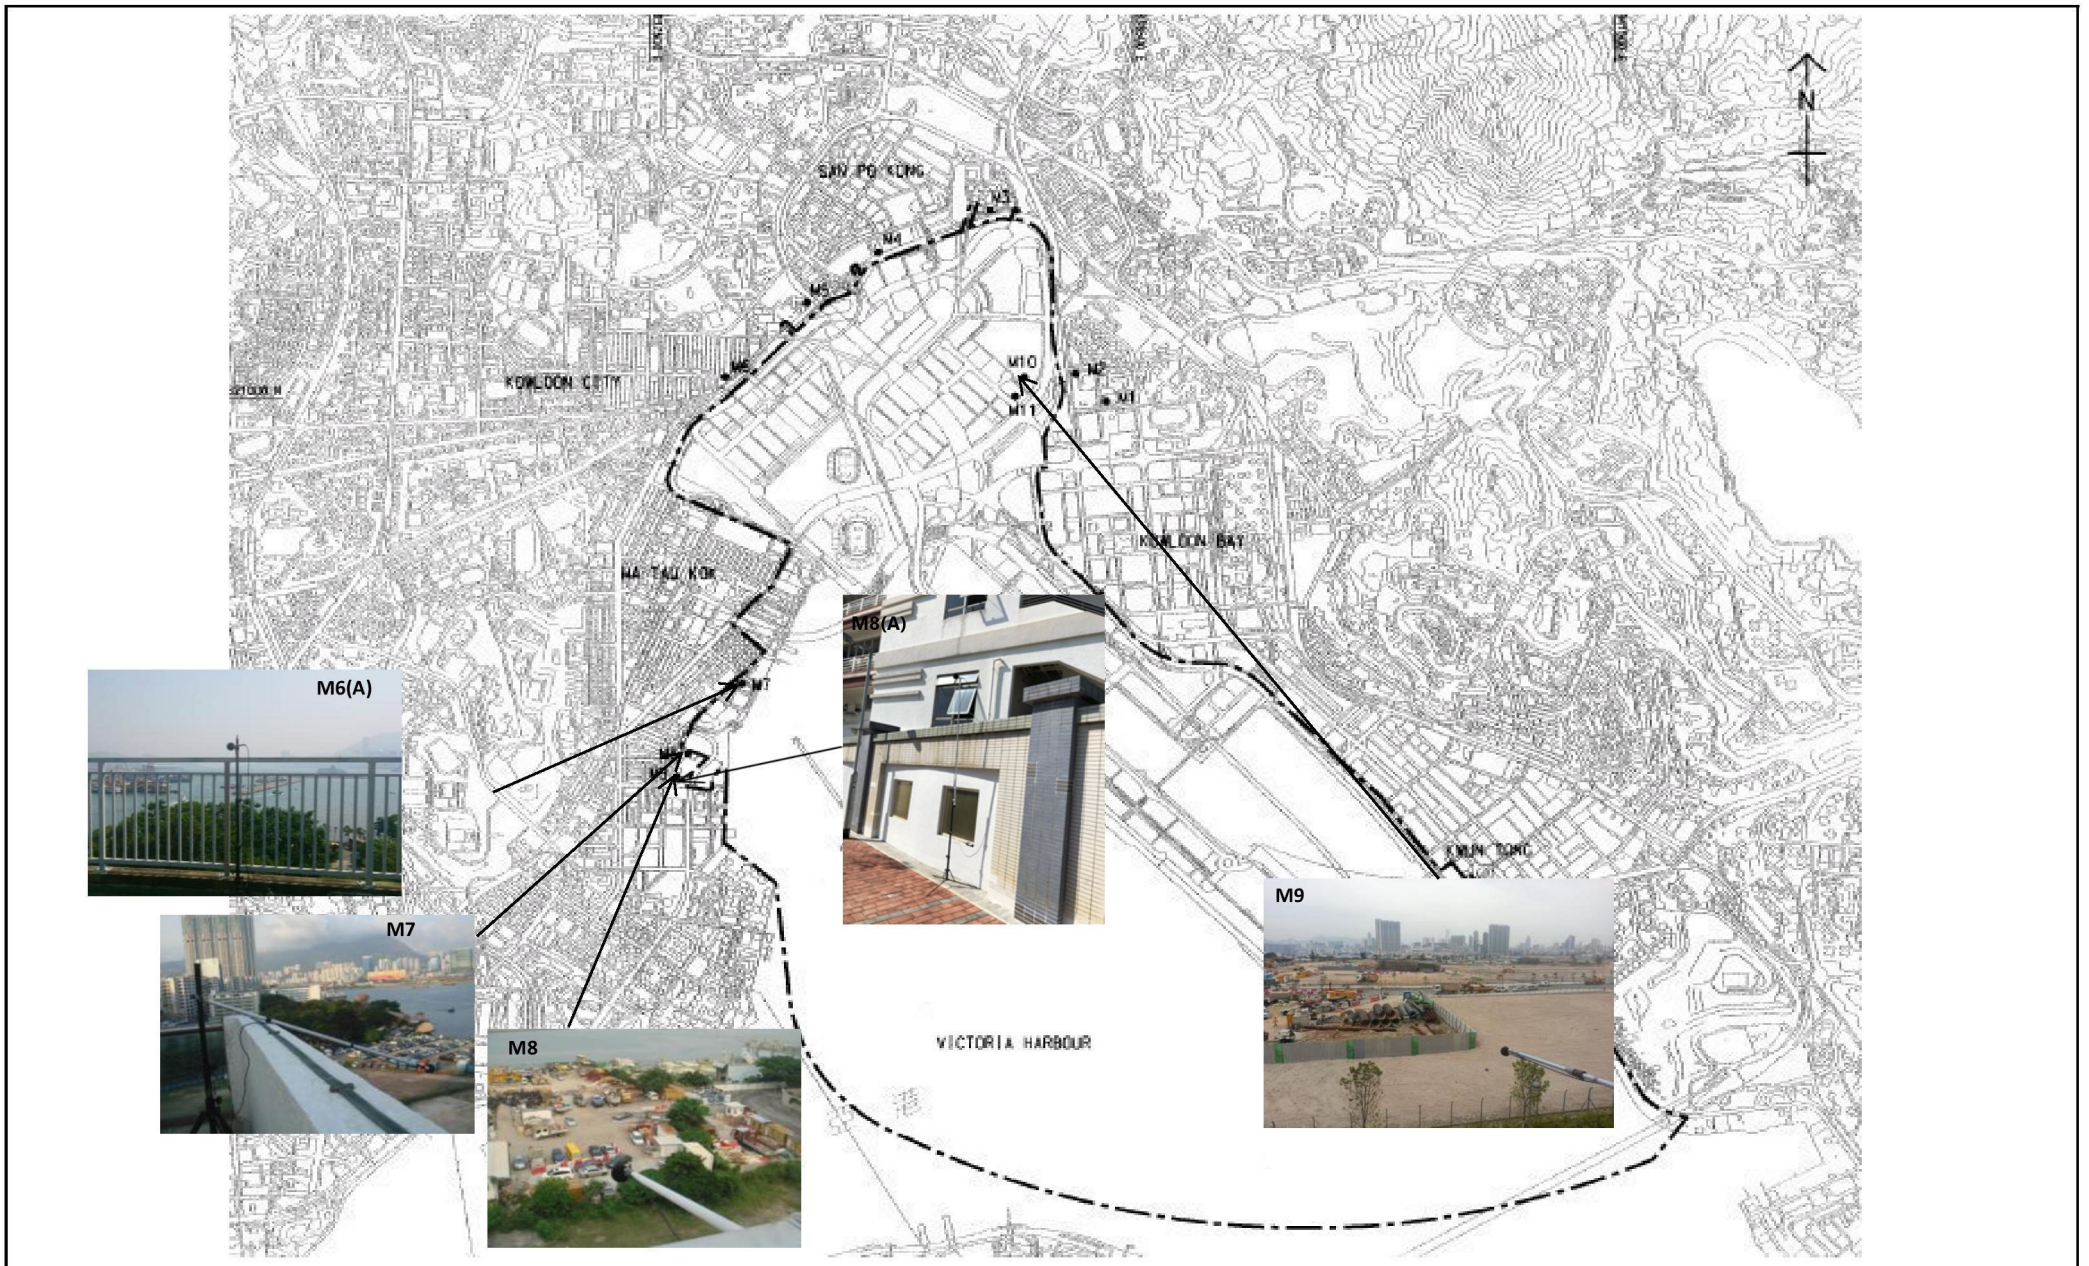

| | | | | |
|-------|--|--|--------|-------------|
| Title | Contract No. KL/2012/03 | | Scale | Project |
| | Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area | | N.T.S | No. MA13056 |
| | Noise Monitoring Stations under this Project | | Date | Figure |
| | | | Dec-16 | 3 |

**APPENDIX A
MONITORING REQUIREMENTS**

Appendix A - Environmental Impact Monitoring Requirements

| Type of Monitoring | Parameter | Frequency | Location | Measurement Conditions |
|--------------------|-------------|----------------------|--|--|
| Air Quality | 1 hour TSP | Three times / 6 days | <ul style="list-style-type: none"> • AM2 – Lee Kau Yan Memorial School • AM2(A) Ng Wah Catholic Secondary School • AM3(A) – Holy Trinity Bradbury Centre • AM3(B) – Family Planning Association of Hong Kong • AM4(A) – EMSD Workshop • AM5 –CCC Kei To Secondary School • #AM6 – PA 15 | <ul style="list-style-type: none"> • AM2 – Rooftop (about 8/F) Area • AM2(A) – Rooftop (about 8/F) Area • AM3(A) - Rooftop (about 8/F) Area • AM3(B) - Rooftop (about 4/F) Area • AM4(A) - Rooftop (about 6/F) Area • AM5 - Rooftop (about 10/F) Area • #AM6 – Site 1B4 (Planned) |
| | 24 hour TSP | Once / 6 days | | |

Remarks: # The impact monitoring at these locations will only be carried out until existence of the sensitive receiver at the building.

| Type of Monitoring | Parameter | Frequency | Location | Measurement Conditions |
|--------------------|---|---------------|---|---|
| Construction Noise | L _{eq} , L ₉₀ & L ₁₀ at 30 minute intervals during (0700 to 1900 on normal weekdays) | Once per week | <ul style="list-style-type: none"> • M6(A) - Oblate Primary School • M7 – CCC Kei To Secondary School • *M8(A) – Po Leung Kuk Ngan Po Ling College (Site Boundary) (Temporary) • M9 – Tak Long Estate (from April 2014 onward) • #M10 (Site 1B4 (Planned)) | <ul style="list-style-type: none"> • M6(A) – Free-field measurement at Rooftop (about 7/F) Area • M7 - Facade measurement at Rooftop (about 8/F) Area • M8(A) – Free-field measurement at ground level (Microphone set higher than the wall) • M9 – Façade measurement at 2/F Podium • #M10 (Site 1B4 (Planned)) |

Remarks: # The impact monitoring at these locations will only be carried out until existence of the sensitive receiver at the building.

*The permission of noise monitoring at M8 was rejected by premises owner on 12th November 2018, the noise monitoring was carried out at alternative station M8(A) temporarily from 21st November 2018.

**APPENDIX B
ACTION AND LIMIT LEVELS FOR AIR
QUALITY AND NOISE**

Appendix B - Action and Limit Levels

Table B-1 Action and Limit Levels for 1-Hour TSP

| Location | Action Level, $\mu\text{g}/\text{m}^3$ | Limit Level, $\mu\text{g}/\text{m}^3$ |
|----------|--|---------------------------------------|
| AM2 | 346 | 500 |
| AM3(A) | 351 | |
| AM4(C) | 371 | |
| AM5 | 345 | |

Table B-2 Action and Limit Levels for 24-Hour TSP

| Location | Action Level, $\mu\text{g}/\text{m}^3$ | Limit Level, $\mu\text{g}/\text{m}^3$ |
|----------|--|---------------------------------------|
| AM2(A) | 157 | 260 |
| AM3(B) | 167 | |
| AM4(C) | 187 | |
| AM5 | 156 | |



Table B-3 Action and Limit Levels for Construction Noise

| Time Period | Action Level | Limit Level |
|----------------------------------|---|------------------------------|
| 0700-1900 hrs on normal weekdays | When one documented complaint is received | 75 dB(A) 70dB(A)/65dB(A)* |

Remarks: If works are to be carried out during restricted hours, the conditions stipulated in the Construction Noise Permit (CNP) issued by the Noise Control Authority have to be followed. *70dB(A) and 65dB(A) for schools during normal teaching periods and school examination periods, respectively.

**APPENDIX C
GRAPHICAL PRESENTATION OF AIR
QUALITY MONITORING RESULTS**



1-hr TSP Concentration Levels

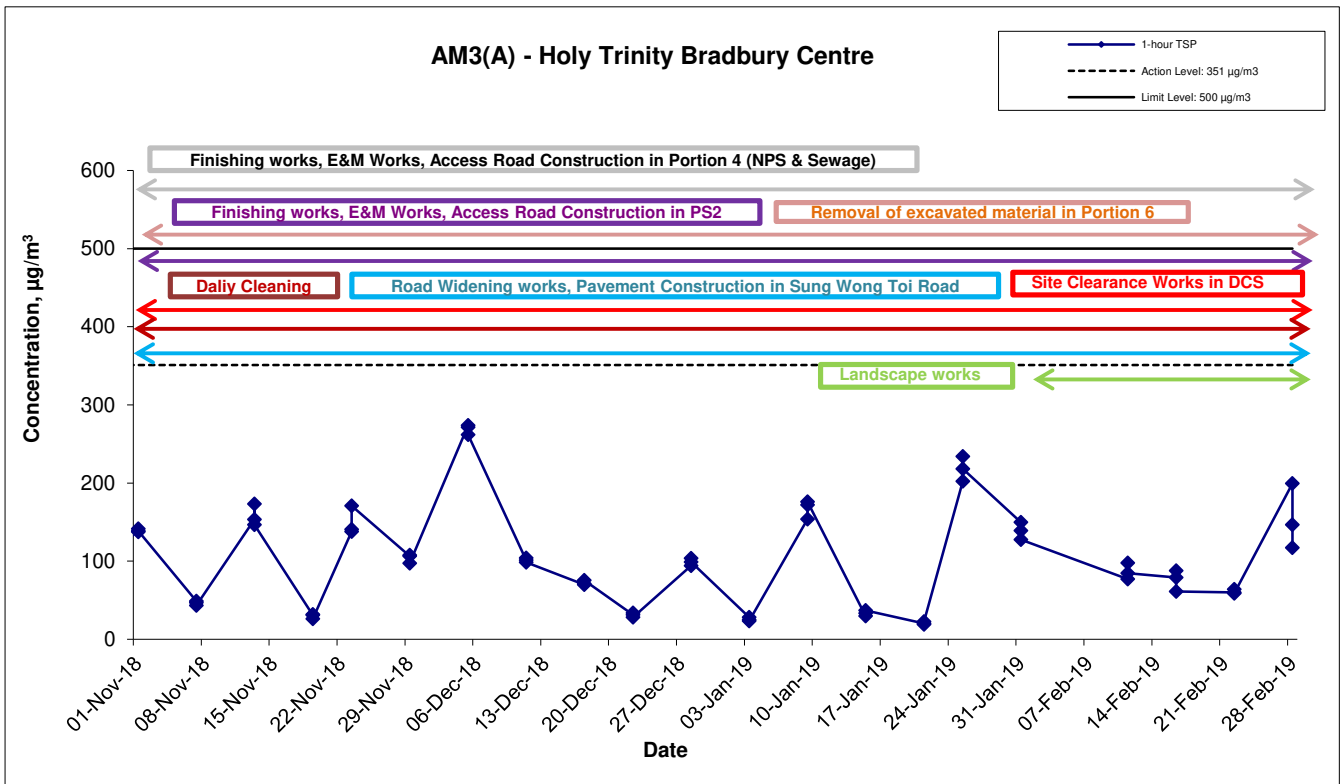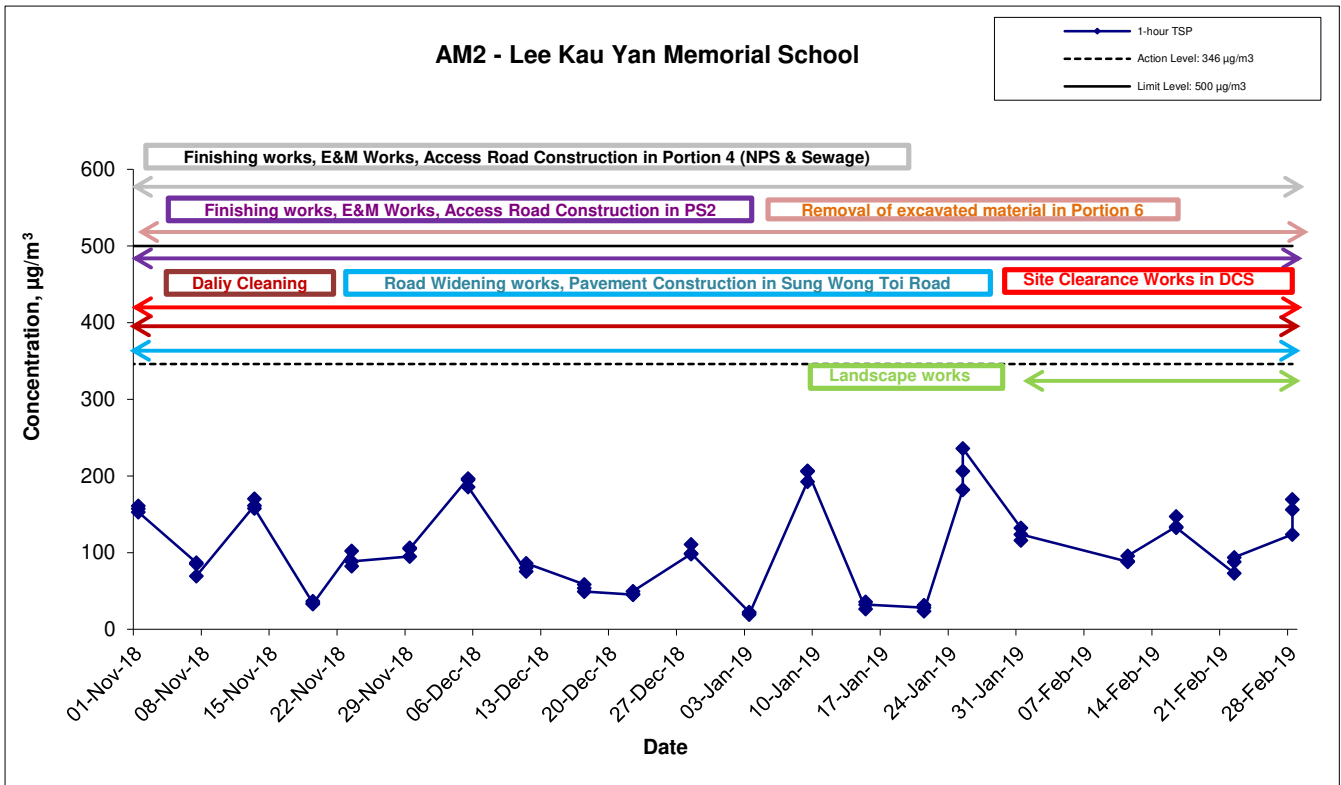

| | | | |
|---|--|--------|-------------|
| Title | Contract No. KL/2012/03 | Scale | Project |
| | Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area | N.T.S | No. MA13056 |
| Graphical Presentation of 1-hour TSP Monitoring Results | | Date | Appendix |
| | | Feb 19 | C |





1-hr TSP Concentration Levels

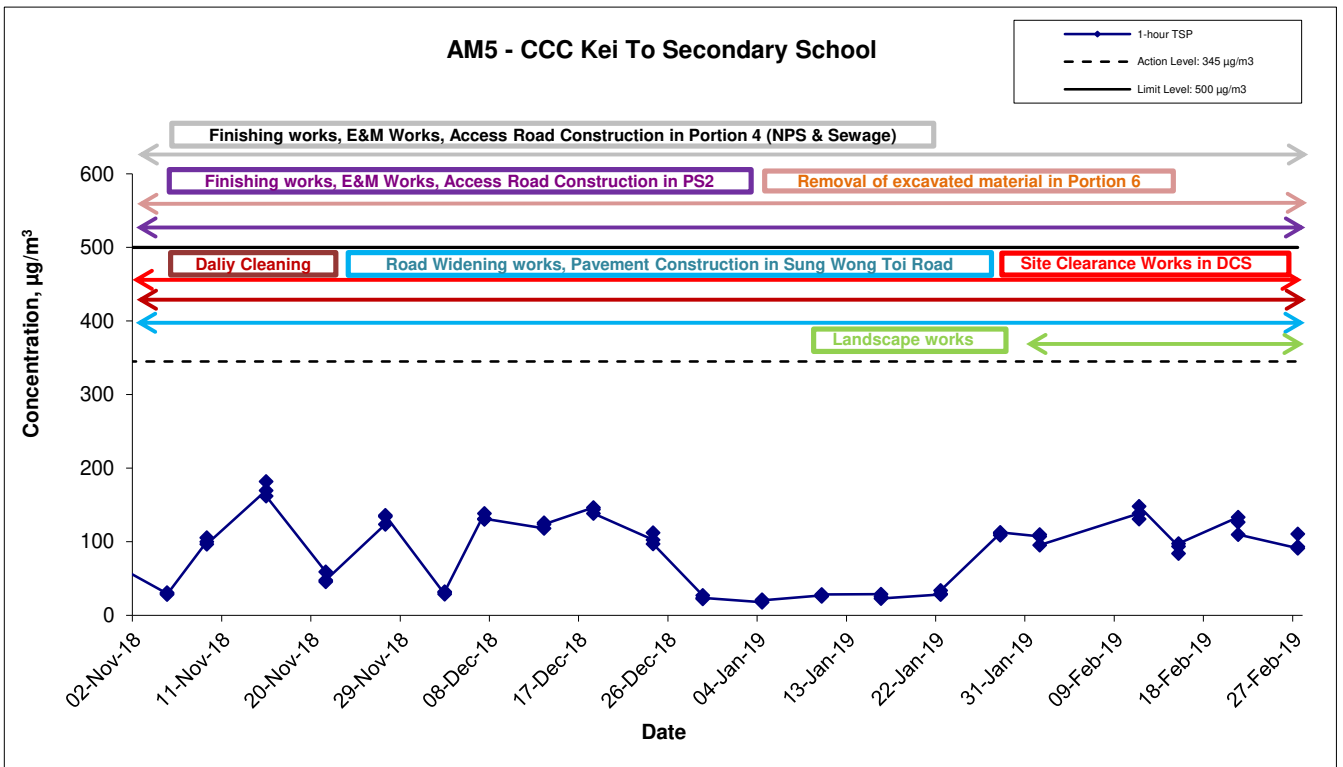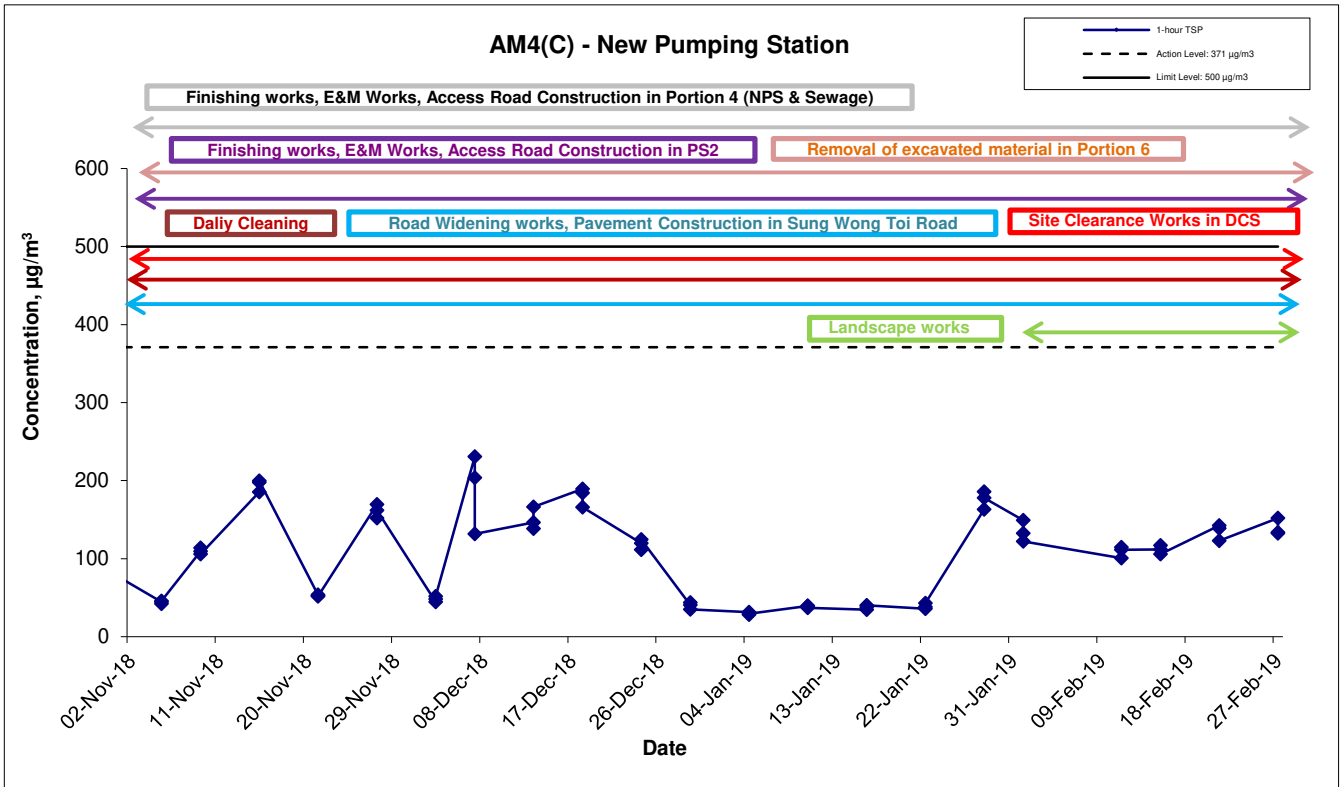



| | | | | |
|---|--|--------|-------------|--|
| Title | Contract No. KL/2012/03 | Scale | Project | |
| | Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area | N.T.S | No. MA13056 | |
| Graphical Presentation of 1-hour TSP Monitoring Results | | Date | Appendix | |
| | | Feb 19 | C | |


24-hr TSP Concentration Levels

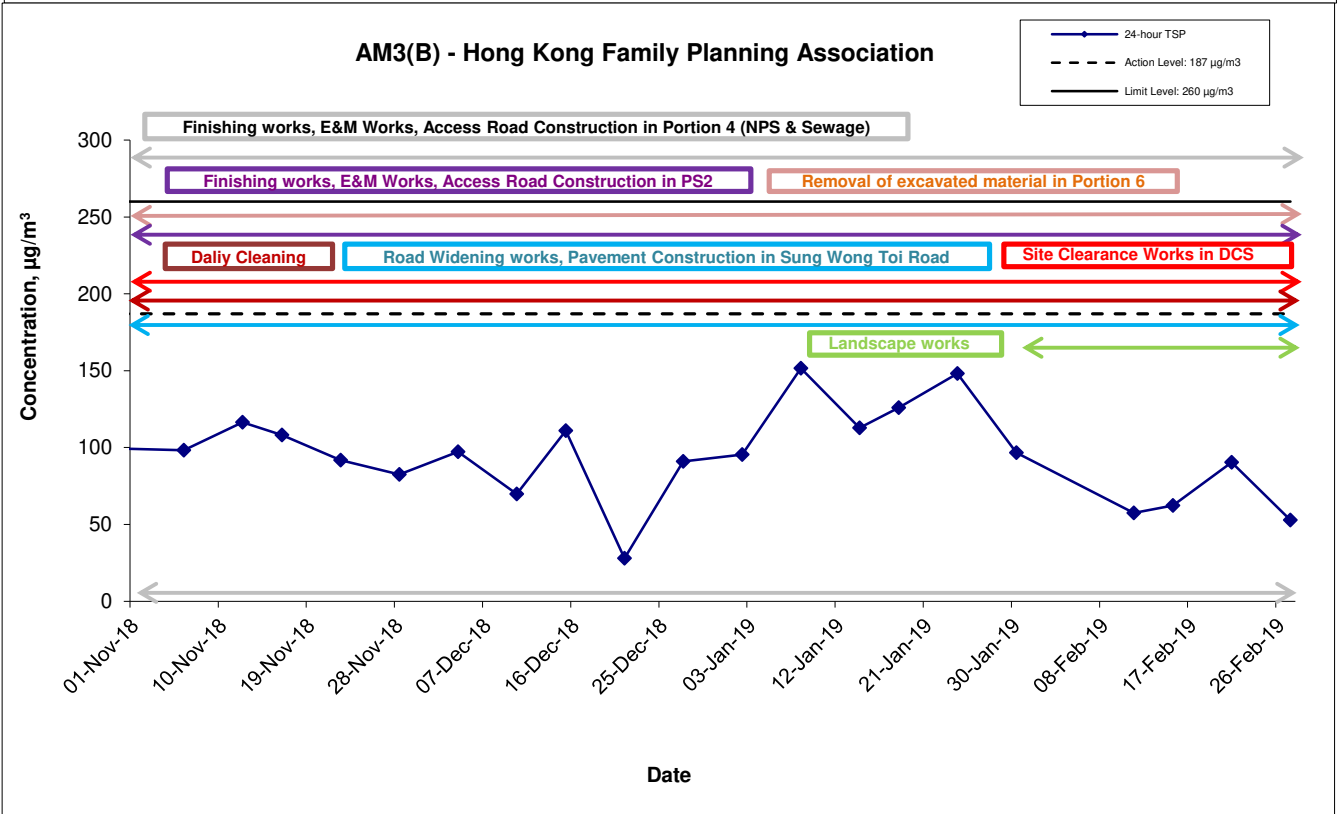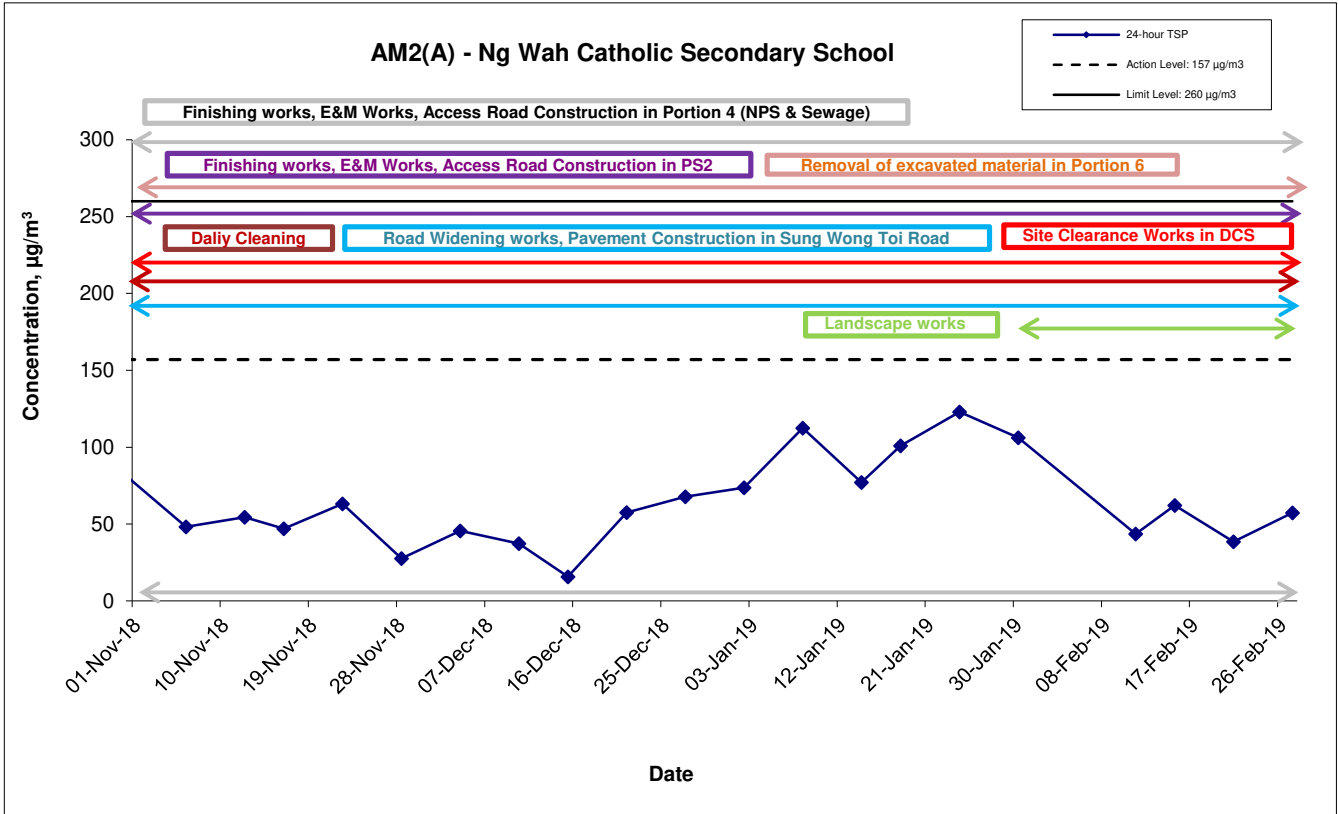

| | | | |
|--|----------------------------------|---|---------------------------------------|
| Title Contract No. KL/2012/03 Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area Graphical Presentation of 24-hour TSP Monitoring Results | Scale N.T.S Date Feb 19 | Project No. MA13056 Appendix C | 匯力 consulting . testing . research |
|--|----------------------------------|---|---------------------------------------|



24-hr TSP Concentration Levels

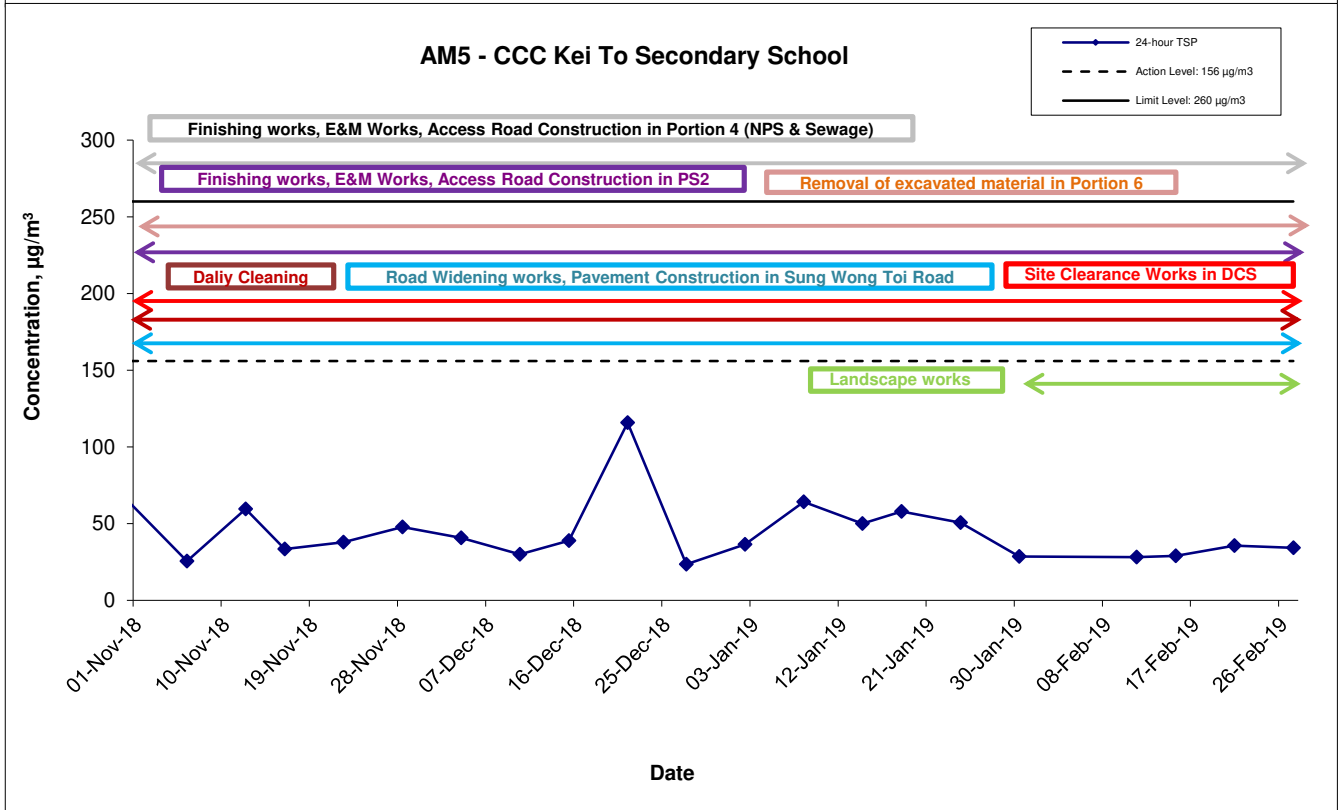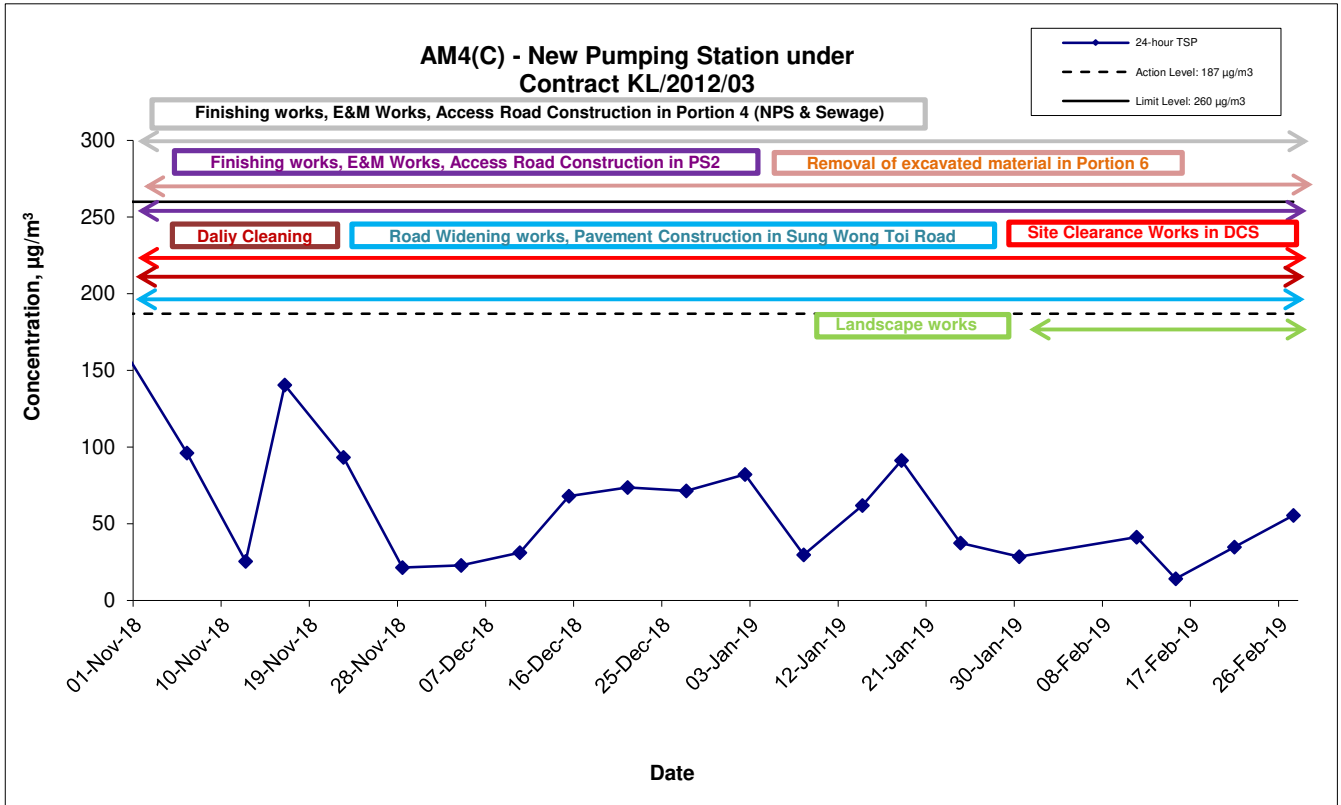

| | | | |
|--|----------------|------------------------|--|
| Title Contract No. KL/2012/03 Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area Graphical Presentation of 24-hour TSP Monitoring Results | Scale N.T.S | Project No. MA13056 |  consulting . testing . research |
| | Date Feb 19 | Appendix C | |

**APPENDIX D
GRAPHICAL PRESENTATION OF
NOISE MONITORING RESULTS**



Noise Levels

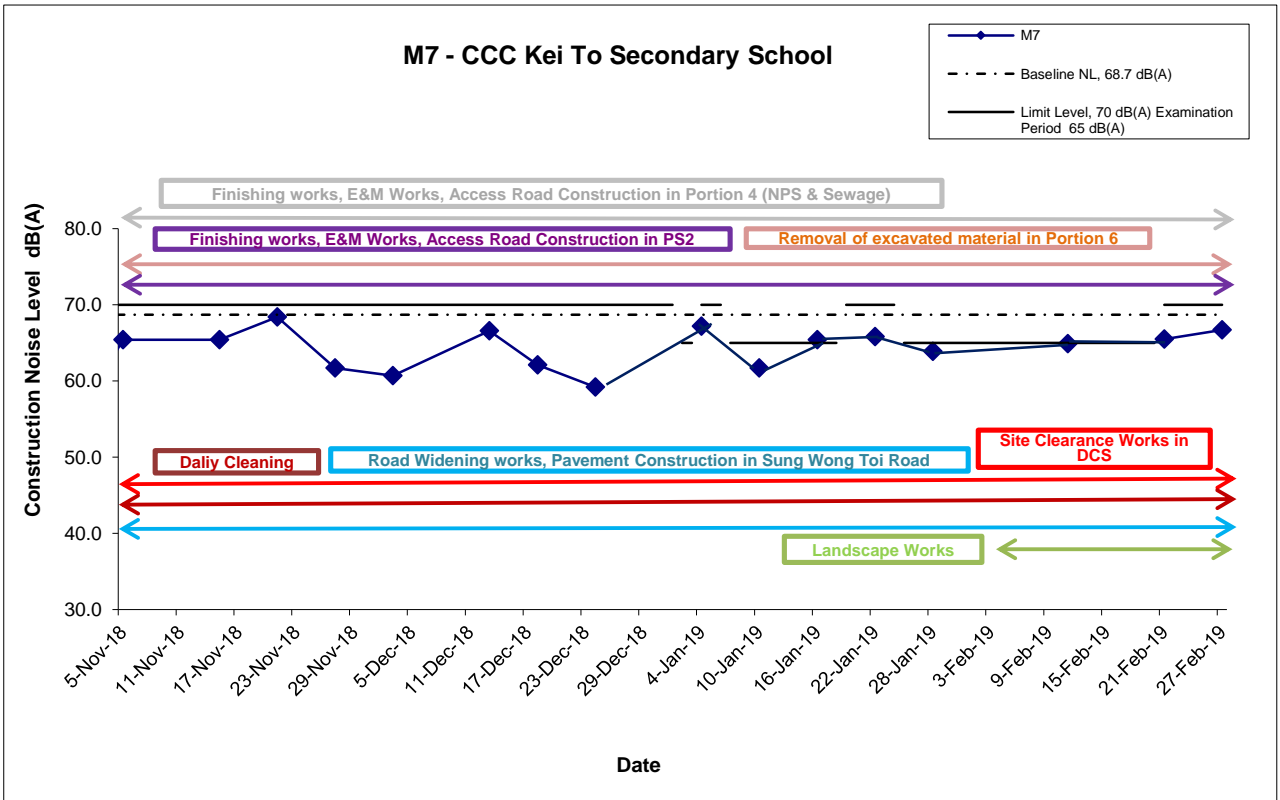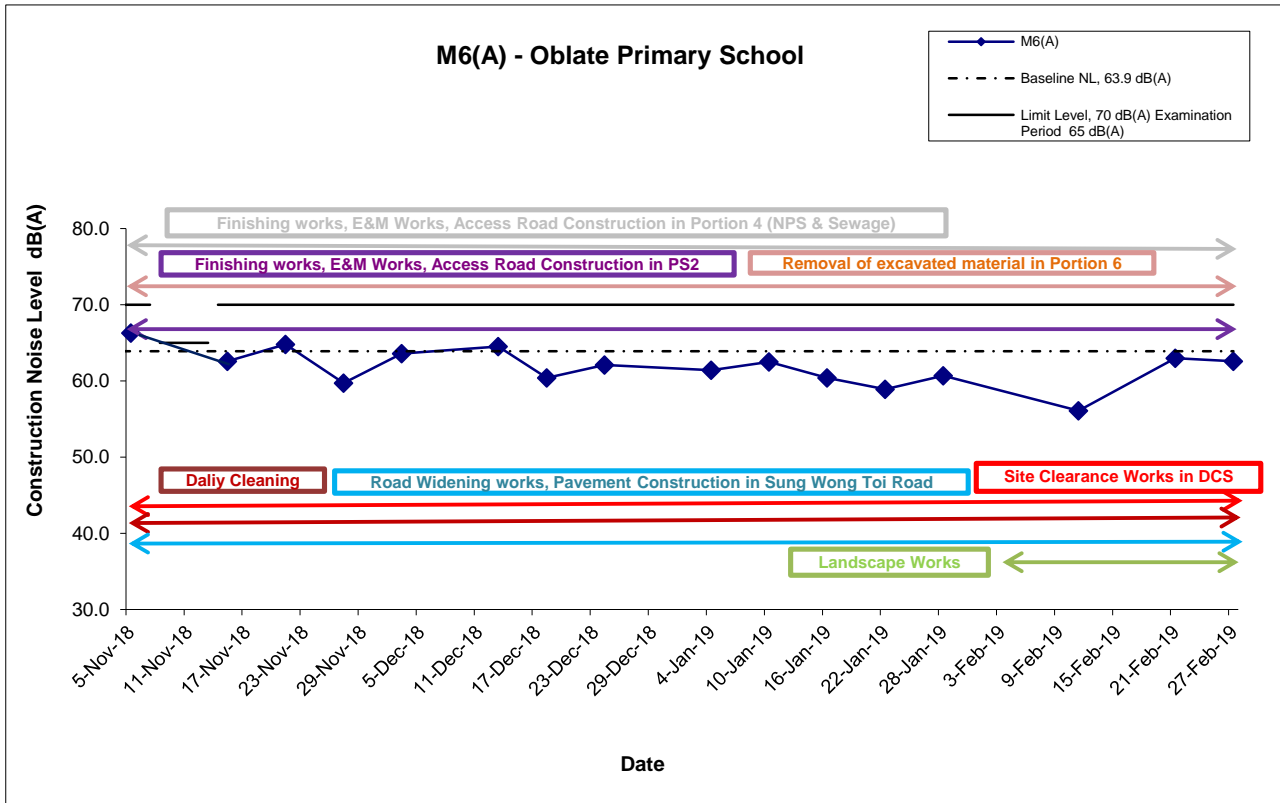

Remarks: The construction noise levels in the Tables in Appendix G were adopted for plotting the graphs

| | | | |
|---|----------------|------------------------|--|
| Title Contract No. KL/2012/03 Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area Graphical Presentation of Construction Noise Monitoring Results | Scale N.T.S | Project No. MA13056 | |
| | Date Feb 19 | Appendix D | |

Noise Levels

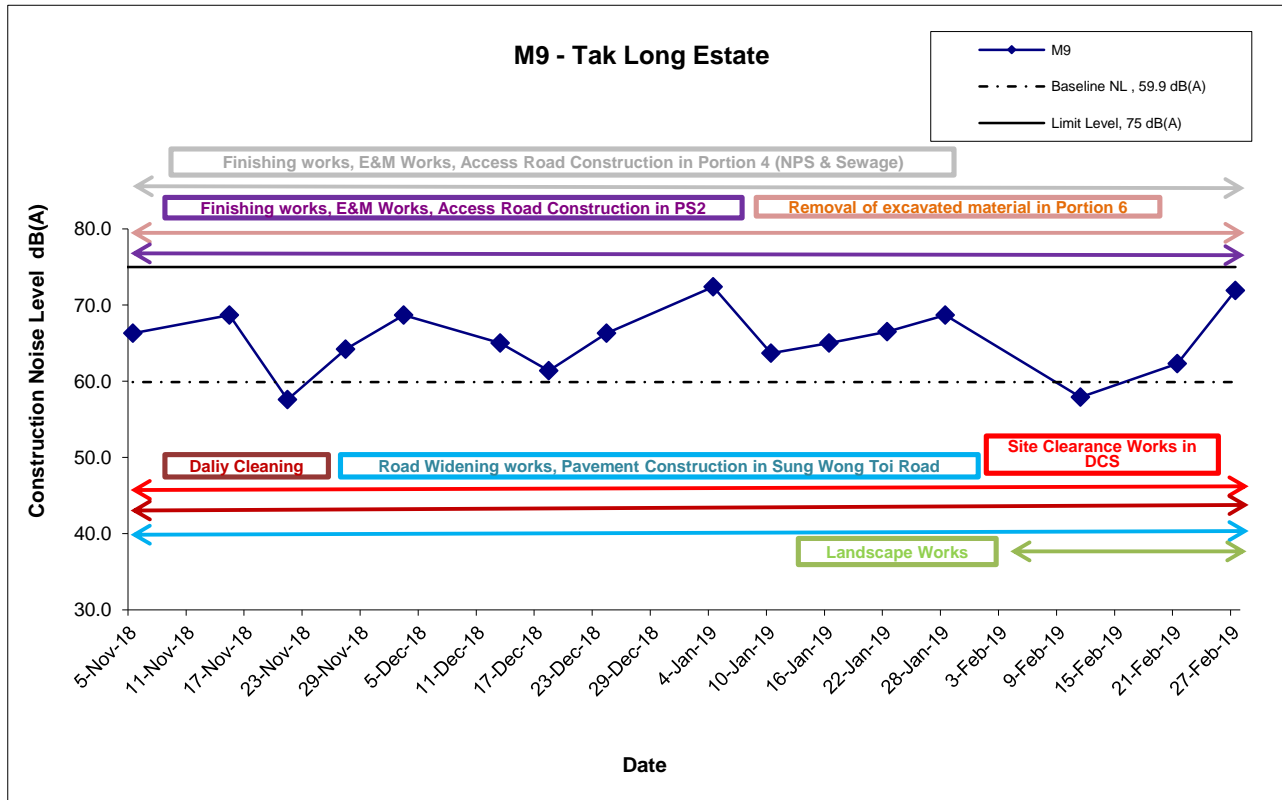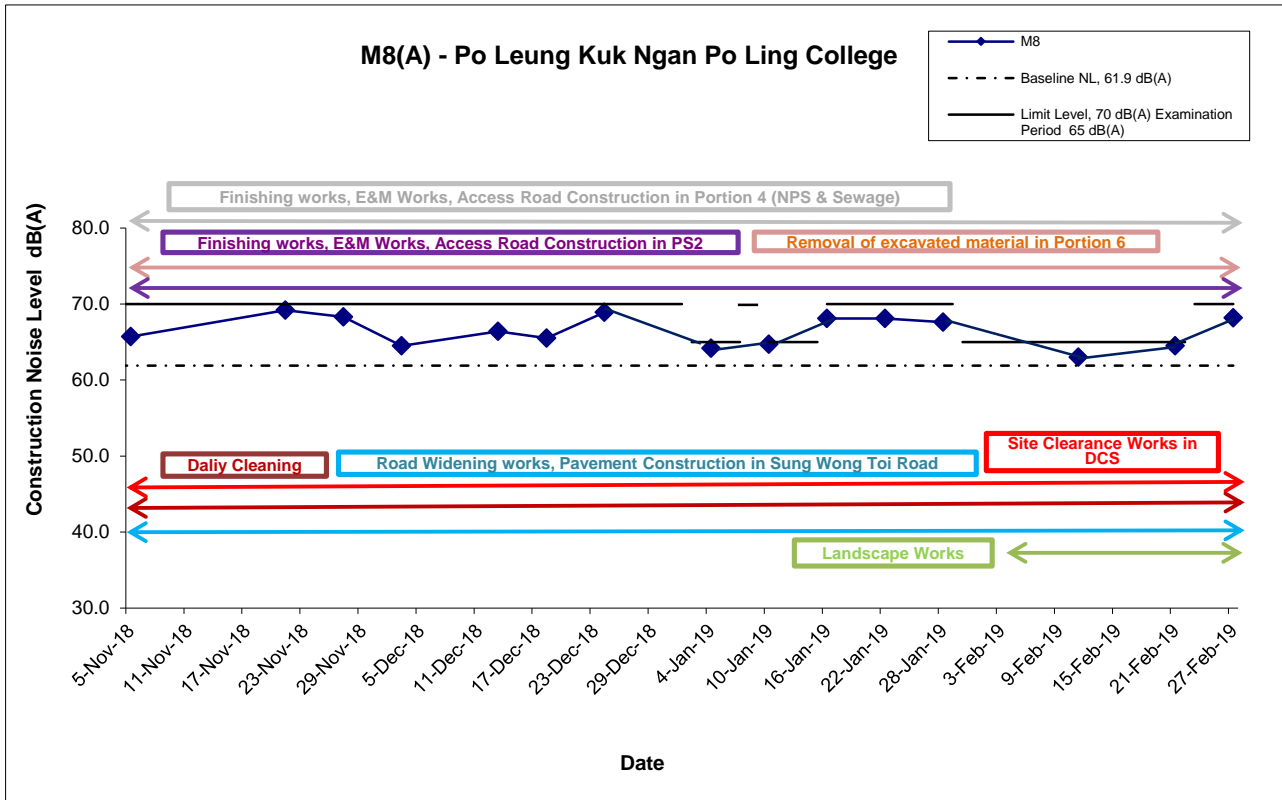

Remarks: The construction noise levels in the Tables in Appendix G were adopted for plotting the graphs

| | | | |
|---|----------------------------------|---|-------------------------------------|
| Title Contract No. KL/2012/03 Kai Tak Development –Stage 4 Infrastructure at Former North Apron Area Graphical Presentation of Construction Noise Monitoring Results | Scale N.T.S Date Feb 19 | Project No. MA13056 Appendix D | consulting . testing . research |
|---|----------------------------------|---|-------------------------------------|

APPENDIX E
ENVIRONMENTAL MITIGATION
IMPLEMENTATION SCHEDULE (EMIS)

Appendix E - Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| Types of Impacts | Mitigation Measures | Status |
|--|--|-------------------------|
| <p align="center">Construction Dust</p> | <p>8 times daily watering of the work site with active dust emitting activities.</p> | <p align="center">*</p> |
| | <p>Implementation of dust suppression measures stipulated in Air Pollution Control (Construction Dust) Regulation. The following mitigation measures, good site practices and a comprehensive dust monitoring and audit programme are recommended to minimize cumulative dust impacts.</p> | |
| | <ul style="list-style-type: none"> • Stockpiling site(s) should be lined with impermeable sheeting and banded. Stockpiles should be fully covered by impermeable sheeting to reduce dust emission. | <p align="center">*</p> |
| | <ul style="list-style-type: none"> • Misting for the dusty material should be carried out before being loaded into the vehicle. | <p align="center">^</p> |
| | <ul style="list-style-type: none"> • Any vehicle with an open load carrying area should have properly fitted side and tail boards. | <p align="center">^</p> |
| | <ul style="list-style-type: none"> • Material having the potential to create dust should not be loaded from a level higher than the side and tail boards and should be dampened and covered by a clean tarpaulin. | <p align="center">^</p> |
| | <ul style="list-style-type: none"> • The tarpaulin should be properly secured and should extend at least 300 mm over the edges of the sides and tailboards. The material should also be dampened if necessary before transportation. | <p align="center">^</p> |
| | <ul style="list-style-type: none"> • The vehicles should be restricted to maximum speed of 10 km per hour and confined haulage and delivery vehicle to designated roadways insider the site. On-site unpaved roads should be compacted and kept free of lose materials. | <p align="center">^</p> |
| | <ul style="list-style-type: none"> • Vehicle washing facilities should be provided at every vehicle exit point. | <p align="center">^</p> |
| | <ul style="list-style-type: none"> • The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores. | <p align="center">^</p> |
| <ul style="list-style-type: none"> • Every main haul road should be scaled with concrete and kept clear of dusty materials or sprayed with water so as to maintain the entire road surface wet. | <p align="center">^</p> | |
| <ul style="list-style-type: none"> • Every stock of more than 20 bags of cement should be covered entirely by impervious sheeting placed in an area sheltered on the top and the three sides. | <p align="center">^</p> | |
| <ul style="list-style-type: none"> • Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving the construction sites. | <p align="center">^</p> | |

| | | |
|---|---|--------|
| Construction Noise | Use of quiet PME, movable barriers barrier for Asphalt Paver, Breaker, Excavator and Hand-held breaker and full enclosure for Air Compressor, Bar Bender, Concrete Pump, Generator and Water Pump | ^ |
| | Good Site Practice: | ^ |
| | • Only well-maintained plant should be operated on-site and plant should be serviced regularly during the construction program. | N/A(1) |
| | • Silencers or mufflers on construction equipment should be utilized and should be properly maintained during the construction program. | ^ |
| | • Mobile plant, if any, should be sited as far away from NSRs as possible. | ^ |
| | • Machines and plant (such as trucks) that may be in intermittent use should be shut down between works periods or should be throttled down to a minimum. | ^ |
| | • Plant known to emit noise strongly in one direction should, wherever possible, be orientated so that the noise is directed away from the nearby NSRs. | ^ |
| | • Material stockpiles and other structures should be effectively utilized, wherever practicable, in screening noise from on-site construction activities. | ^ |
| | Scheduling of Construction Works during School Examination Period | ^ |
| | (i) Provision of low noise surfacing in a section of Road L2; and | N/A |
| | (ii) Provision of structural fins | N/A |
| | (i) Avoid the sensitive façade of class room facing Road L2 and L4; and | N/A |
| | (ii) Provision of low noise surfacing in a section of Road L2 & L4 | N/A |
| | (i) Provision of low noise surfacing in a section of Road L4 before occupation of Site 111; and | N/A |
| (ii) Setback of building about 5m from site boundary. | N/A | |
| Setback of building about 35m to the northwest direction at 1L3 and 5m at Site 1L2. | N/A | |
| (i) avoid any sensitive façades with openable window facing the existing Kowloon City Road network; and | N/A | |
| (ii) for the sensitive facades facing the To Kwa Wan direction, either setback the facades by about 5m to the northeast direction or do not provide the facades with openable window. | N/A | |

| | | |
|--|---|--|
| | <p>(i) avoid any sensitive facades with openable window facing the existing To Kwa Wan Road or</p> <p>(ii) provision of 17.5m high noise tolerant building fronting To Kwa Wan Road and restrict the height of the residential block(s) located at less than 55m away from To Kwa Wan Road to no more than 25m above ground.</p> <p>(i) avoid any sensitive facades with openable window facing the slip road connecting Prince Edward Road East and San Po Kong or other alternative mitigation measures and at-source mitigation measures for the surrounding new local roads to minimise the potential traffic noise impacts from the slip road</p> | <p>N/A</p> <p>N/A</p> <p>N/A</p> |
| | <p>All the ventilation fans installed in the below will be provided with silencers or acoustics treatment.</p> <p>(i) SPS</p> <p>(ii) ESS</p> <p>(iii) Tunnel Ventilation Shaft</p> <p>(iv) EFTS depot</p> <p>Installation of retractable roof or other equivalent measures</p> | <p>N/A</p> <p>N/A</p> <p>N/A</p> <p>N/A</p> <p>N/A</p> |
| <p>Construction Water Quality</p> | <p>The following mitigation measures are proposed to be incorporated in the design of the SPS at KTD, including:</p> <ul style="list-style-type: none"> • Dual power supply or emergency generator should be provided at all the SPSs to secure electrical power supply; • Standby pumps should be provided at all SPSs to ensure smooth operation of the SPS during maintenance of the duty pumps; • An alarm should be installed to signal emergency high water level in the wet well at all SPSs; and • For all unmanned SPSs, a remote monitor system connecting SPSs with the control station through telemetry system should be provided so that swift actions could be taken in case of malfunction of unmanned facilities. <p><u>Land-based Construction</u></p> <p><i>Construction Runoff</i></p> <p>Exposed soil areas should be minimised to reduce the potential for increased siltation, contamination of runoff, and erosion. Construction runoff related impacts associated with the above ground construction activities can be readily controlled through the use of appropriate mitigation measures which include:</p> <ul style="list-style-type: none"> • use of sediment traps • adequate maintenance of drainage systems to prevent flooding and overflow | <p>N/A</p> <p>N/A</p> <p>N/A</p> <p>N/A</p> <p>^</p> <p>^</p> <p>^</p> |

| | | |
|--|--|--|
| | <p>Construction site should be provided with adequately designed perimeter channel and pre-treatment facilities and proper maintenance. The boundaries of critical areas of earthworks should be marked and surrounded by dykes or embankments for flood protection. Temporary ditches should be provided to facilitate runoff discharge into the appropriate watercourses, via a silt retention pond. Permanent drainage channels should incorporate sediment basins or traps and baffles to enhance deposition rates. The design of efficient silt removal facilities should be based on the guidelines in Appendix A1 of ProPECC PN 1/94.</p> <p>Ideally, construction works should be programmed to minimise surface excavation works during the rainy season (April to September). All exposed earth areas should be completed as soon as possible after earthworks have been completed, or alternatively, within 14 days of the cessation of earthworks where practicable. If excavation of soil cannot be avoided during the rainy season, or at any time of year when rainstorms are likely, exposed slope surfaces should be covered by tarpaulin or other means.</p> <p>Sediment tanks of sufficient capacity, constructed from pre-formed individual cells of approximately 6 to 8 m³ capacity, are recommended as a general mitigation measure which can be used for settling surface runoff prior to disposal. The system capacity is flexible and able to handle multiple inputs from a variety of sources and particularly suited to applications where the influent is pumped.</p> <p>Open stockpiles of construction materials (for examples, aggregates, sand and fill material) of more than 50 m³ should be covered with tarpaulin or similar fabric during rainstorms. Measures should be taken to prevent the washing away of construction materials, soil, silt or debris into any drainage system.</p> <p>Manholes (including newly constructed ones) should always be adequately covered and temporarily sealed so as to prevent silt, construction materials or debris being washed into the drainage system and storm runoff being directed into foul sewers.</p> <p>Precautions to be taken at any time of year when rainstorms are likely, actions to be taken when a rainstorm is imminent or forecast, and actions to be taken during or after rainstorms are summarised in Appendix A2 of ProPECC PN 1/94. Particular attention should be paid to the control of silty surface runoff during storm events.</p> <p>Oil interceptors should be provided in the drainage system and regularly cleaned to prevent the release of oils and grease into the storm water drainage system after accidental spillages. The interceptor should have a bypass to prevent flushing during periods of heavy rain.</p> | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |
|--|--|--|

| | | |
|--|--|---|
| | <p>All vehicles and plant should be cleaned before leaving a construction site to ensure no earth, mud, debris and the like is deposited by them on roads. An adequately designed and located wheel washing bay should be provided at every site exit, and wash-water should have sand and silt settled out and removed at least on a weekly basis to ensure the continued efficiency of the process. The section of access road leading to, and exiting from, the wheel-wash bay to the public road should be paved with sufficient backfall toward the wheel-wash bay to prevent vehicle tracking of soil and silty water to public roads and drains.</p> <p><i>Drainage</i></p> <p>It is recommended that on-site drainage system should be installed prior to the commencement of other construction activities. Sediment traps should be installed in order to minimise the sediment loading of the effluent prior to discharge into foul sewers. There should be no direct discharge of effluent from the site into the sea.</p> <p>All temporary and permanent drainage pipes and culverts provided to facilitate runoff discharge should be adequately designed for the controlled release of storm flows. All sediment control measures should be regularly inspected and maintained to ensure proper and efficient operation at all times and particularly following rain storms. The temporarily diverted drainage should be reinstated to its original condition when the construction work has finished or the temporary diversion is no longer required.</p> <p>All fuel tanks and storage areas should be provided with locks and be located on sealed areas, within bunds of a capacity equal to 110% of the storage capacity of the largest tank, to prevent spilled fuel oils from reaching the coastal waters of the Victoria Harbour WCZ.</p> <p><i>Sewage Effluent</i></p> <p>Construction work force sewage discharges on site are expected to be connected to the existing trunk sewer or sewage treatment facilities. The construction sewage may need to be handled by portable chemical toilets prior to the commission of the on-site sewer system. Appropriate numbers of portable toilets should be provided by a licensed contractor to serve the large number of construction workers over the construction site. The Contractor should also be responsible for waste disposal and maintenance practices.</p> <p><i>Stormwater Discharges</i></p> <p>Minimum distances of 100 m should be maintained between the existing or planned stormwater discharges and the existing or planned seawater intakes</p> | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>N/A</p> |
|--|--|---|

| | | |
|--|---|---|
| | <p><i>Debris and Litter</i></p> <p>In order to maintain water quality in acceptable conditions with regard to aesthetic quality, contractors should be required, under conditions of contract, to ensure that site management is optimised and that disposal of any solid materials. litter or wastes to marine waters does not occur</p> <p><i>Construction Works at or in Close Proximity of Storm Culvert or Seafront</i></p> <p>The proposed works should preferably be carried out within the dry season where the flow in the drainage channel /storm culvert/ nullah is low.</p> <p>The use of less or smaller construction plants may be specified to reduce the disturbance to the bottom sediment at the drainage channel /storm culvert / nullah.</p> <p>Temporary storage of materials (e.g. equipment, filling materials, chemicals and fuel) and temporary stockpile of construction materials should be located well away from any water courses during carrying out of the construction works.</p> <p>Stockpiling of construction materials and dusty materials should be covered and located away from any water courses.</p> <p>Construction debris and spoil should be covered up and/or disposed of as soon as possible to avoid being washed into the nearby water receivers.</p> <hr/> <p>Construction activities, which generate large amount of wastewater, should be carried out in a distance away from the waterfront, where practicable.</p> <hr/> <p>Mitigation measures to control site runoff from entering the nearby water environment should be implemented to minimize water quality impacts. Surface channels should be provided along the edge of the waterfront within the work sites to intercept the runoff.</p> <p>Construction effluent, site run-off and sewage should be properly collected and/or treated.</p> <p>Any works site inside the storm water courses should be temporarily isolated, such as by placing of sandbags or silt curtains with lead edge at bottom and properly supported props to prevent adverse impact on the storm water quality.</p> <p>Silt curtain may be installed around the construction activities at the seafront to minimize the potential impacts due to accidental spillage of construction materials.</p> <p>Proper shoring may need to be erected in order to prevent soil/mud from slipping into the storm culvert/drainage channel/sea.</p> | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |
|--|---|---|

| | | |
|--|--|---|
| | <p>Supervisory staff should be assigned to station on site to closely supervise and monitor the works</p> <p>Marine water quality monitoring and audit programme shall be implemented for the proposed sediment treatment operation.</p> <p>Good Site Practices It is not anticipated that adverse waste management related impacts would arise, provided that good site practices are adhered to. Recommendations for good site practices during construction activities include:</p> <ul style="list-style-type: none"> • Nomination of an approved person, such as a site manager, to be responsible for good site practices, arrangements for collection and effective disposal to an appropriate facility, of all wastes generated at the site • Training of site personnel in proper waste management and chemical waste handling procedures • Provision of sufficient waste disposal points and regular collection for disposal • Appropriate measures to minimise windblown litter and dust during transportation of waste by either covering trucks or by transporting wastes in enclosed containers • A recording system for the amount of wastes generated, recycled and disposed of (including the disposal sites) <p>Waste Reduction Measures Good management and control can prevent the generation of a significant amount of waste. Waste reduction is best achieved at the planning and design stage, as well as by ensuring the implementation of good site practices. Recommendations to achieve waste reduction include:</p> <ul style="list-style-type: none"> • Sort C&D waste from demolition of the remaining structures to recover recyclable portions such as metals • Segregation and storage of different types of waste in different containers, skips or stockpiles to enhance reuse or recycling of materials and their proper disposal • Encourage collection of aluminium cans, PET bottles and paper by providing separate labelled bins to enable these wastes to be segregated from other general refuse generated by the work force • Any unused chemicals or those with remaining functional capacity should be recycled • Proper storage and site practices to minimise the potential for damage or contamination of construction materials | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |
|--|--|---|

| | |
|---|---|
| <p>Construction and Demolition Material</p> <p>Mitigation measures and good site practices should be incorporated into contract document to control potential environmental impact from handling and transportation of C&D material. The mitigation measures include:</p> <ul style="list-style-type: none"> • Where it is unavoidable to have transient stockpiles of C&D material within the Project work site pending collection for disposal, the transient stockpiles should be located away from waterfront or storm drains as far as possible • Open stockpiles of construction materials or construction wastes on-site should be covered with tarpaulin or similar fabric • Skip hoist for material transport should be totally enclosed by impervious sheeting • Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving a construction site • The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores • The load of dusty materials carried by vehicle leaving a construction site should be covered entirely by clean impervious sheeting to ensure dust materials do not leak from the vehicle • All dusty materials should be sprayed with water prior to any loading, unloading or transfer operation so as to maintain the dusty materials wet • The height from which excavated materials are dropped should be controlled to a minimum practical height to limit fugitive dust generation from unloading <p>When delivering inert C&D material to public fill reception facilities, the material should consist entirely of inert construction waste and of size less than 250mm or other sizes as agreed with the Secretary of the Public Fill Committee. In order to monitor the disposal of the surplus C&D material at the designed public fill reception facility and to control fly tipping, a trip-ticket system as stipulated in the ETWB TCW No. 31/2004 "Trip Ticket System for Disposal of Construction and Demolition Materials" should be included as one of the contractual requirements and implemented by an Environmental Team undertaking the Environmental Monitoring and Audit work. An Independent Environmental Checker should be responsible for auditing the results of the system.</p> <p>Chemical Waste</p> <p>After use, chemical wastes (for example, cleaning fluids, solvents, lubrication oil and fuel) should be handled according to the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes. Spent chemicals should be collected by a licensed collector for disposal at the CWTF or other licensed facility, in accordance with the <i>Waste Disposal (Chemical Waste) (General) Regulation</i></p> | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>*</p> |
|---|---|

| | | |
|-----------------------------|--|-----|
| | <p>General Refuse</p> <p>General refuse should be stored in enclosed bins or compaction units separate from C&D material. A licensed waste collector should be employed by the contractor to remove general refuse from the site, separately from C&D material. Effective collection and storage methods (including enclosed and covered area) of site wastes would be required to prevent waste materials from being blown around by wind, wastewater discharge by flushing or leaching into the marine environment, or creating odour nuisance or pest and vermin problem</p> | * |
| Landscape and Visual | <p>CM1 All existing trees should be carefully protected during construction.</p> | ^ |
| | <p>CM2 Trees unavoidably affected by the works should be transplanted where practical. Detailed transplanting proposal will be submitted to relevant government departments for approval in accordance with ETWBC 2/2004 and 3/2006. Final locations of transplanted trees should be agreed prior to commencement of the work.</p> | N/A |
| | <p>CM3 Control of night-time lighting.</p> | ^ |
| | <p>CM4 Erection of decorative screen hoarding.</p> | ^ |

| | |
|----------|---|
| Remarks: | ^ Compliance of mitigation measure; |
| | X Non-compliance of mitigation measure; |
| | N/A Not Applicable at this stage; |
| | N/A(1) Not observed; |
| | • Non-compliance but rectified by the contractor; |
| | * Recommendation was made during site audit but improved/rectified by the contractor. |

APPENDIX F
SITE AUDIT SUMMARY

Appendix F Summary of Observation and Recommendation Made during Site Inspection

Summary of Observation and Recommendation Made during Site Inspection in December 2018

Observations and Recommendations of Site Inspections for EP-337/2009

| Parameters | Date | Observations and Recommendations | Follow-up |
|----------------------------------|------|----------------------------------|-----------|
| <i>Water Quality</i> | -- | -- | -- |
| <i>Air Quality</i> | -- | -- | -- |
| <i>Noise</i> | -- | -- | -- |
| <i>Waste/Chemical Management</i> | -- | -- | -- |
| <i>Landscape and Visual</i> | -- | -- | -- |
| <i>Permits /Licences</i> | -- | -- | -- |

Observations and Recommendations of Site Inspections for EP-344/2009

| Parameters | Date | Observations and Recommendations | Follow-up |
|----------------------------------|--------------------------------|---|---|
| <i>Water Quality</i> | -- | -- | -- |
| <i>Air Quality</i> | -- | -- | -- |
| <i>Noise</i> | -- | -- | -- |
| <i>Waste/Chemical Management</i> | 7 th December 2018 | <u>Reminder:</u> C&D waste should be collected and disposed properly. | The C&D waste was removed on 14 th December 2018. |
| | 19 th December 2018 | <u>Reminder:</u> Chemical containers should be stored properly in drip tray or designated area to avoid leakage. (NPS) | The containers were stored properly in the designated area on 28 th December 2018. |
| <i>Landscape and Visual</i> | -- | -- | -- |
| <i>Permits /Licences</i> | -- | -- | -- |

Summary of Observation and Recommendation Made during Site Inspection in January 2019

Observations and Recommendations of Site Inspections for EP-337/2009

| Parameters | Date | Observations and Recommendations | Follow-up |
|----------------------------------|-------------|---|------------------|
| <i>Water Quality</i> | -- | -- | -- |
| <i>Air Quality</i> | -- | -- | -- |
| <i>Noise</i> | -- | -- | -- |
| <i>Waste/Chemical Management</i> | -- | -- | -- |
| <i>Landscape and Visual</i> | -- | -- | -- |
| <i>Permits /Licences</i> | -- | -- | -- |

Observations and Recommendations of Site Inspections for EP-344/2009

| Parameters | Date | Observations and Recommendations | Follow-up |
|----------------------------------|-------------------------------|--|---|
| <i>Water Quality</i> | -- | -- | -- |
| <i>Air Quality</i> | 11 th January 2019 | <u>Reminder:</u> Dusty stockpiles should be covered properly with impervious material near PS2. | The dusty stockpile was covered on 16 th January 2019 |
| | 16 th January 2019 | <u>Reminder:</u> Dusty stockpiles should be covered properly with impervious material near PS2. | The stockpile was covered properly on 25 th January 2019 |
| | 31 st January 2019 | <u>Reminder:</u> NRMM label should be provided at conspicuous position of generator. | The NRMM label was provided at the conspicuous position on 8 th February 2019. |
| <i>Noise</i> | -- | -- | -- |
| <i>Waste/Chemical Management</i> | 11 th January 2019 | <u>Reminder:</u> General refuse should be cleared properly near NPS to avoid accumulation. | The general refuse was removed on 16 th January 2019. |
| | 16 th January 2019 | <u>Reminder:</u> Chemical container should be labeled clearly and stored with drip tray to avoid leakage. (PS2) | The chemical container was removed on 25 th January 2019. |
| | 25 th January 2019 | <u>Reminder:</u> Watering should be provided for dry area to avoid dust generation. (NPS) | Watering was provided on 31 st January 2019. |
| | 31 st January 2019 | <u>Reminder:</u> General refuse should be extracted from C&D material and disposed properly. | The general refuse was extracted and disposed properly on 8 th February 2019. |
| <i>Landscape and Visual</i> | -- | -- | -- |
| <i>Permits /Licences</i> | -- | -- | -- |

Summary of Observation and Recommendation Made during Site Inspection in February 2019

Observations and Recommendations of Site Inspections for EP-337/2009

| Parameters | Date | Observations and Recommendations | Follow-up |
|----------------------------------|-------------|---|------------------|
| <i>Water Quality</i> | -- | -- | -- |
| <i>Air Quality</i> | -- | -- | -- |
| <i>Noise</i> | -- | -- | -- |
| <i>Waste/Chemical Management</i> | -- | -- | -- |
| <i>Landscape and Visual</i> | -- | -- | -- |
| <i>Permits /Licences</i> | -- | -- | -- |

Observations and Recommendations of Site Inspections for EP-344/2009

| Parameters | Date | Observations and Recommendations | Follow-up |
|----------------------------------|-------------|---|------------------|
| <i>Water Quality</i> | -- | -- | -- |
| <i>Air Quality</i> | -- | -- | -- |
| <i>Noise</i> | -- | -- | -- |
| <i>Waste/Chemical Management</i> | -- | -- | -- |
| <i>Landscape and Visual</i> | -- | -- | -- |
| <i>Permits /Licences</i> | -- | -- | -- |

**APPENDIX G
MONTHLY SUMMARY
WASTE FLOW TABLE**

APPENDIX IV
Monthly Summary Waste Flow Table
(PS Clause 1.86)

Name of Department: CEDD

Contract No. : KL/2012/03

Monthly Summary Waste Flow Table for December 2018 (year) (in tons)

| Month | Total Disposal Loads | Total Quantity Generated | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | Actual Quantities of C&D Wastes Generated Monthly | | | | |
|----------------------------|----------------------|--------------------------|--|------------------------|--------------------------|-------------------------|-----------------|---|----------------------------|-----------------------|-----------------|-----------------------------|
| | (No.s) | (in tons) | Hard Rock & Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 3) | Chemicals Waste | Others, e.g. general refuse |
| | | | 0 | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) |
| 2013 (Oct - Dec) Sub-Total | 108 | 463.69 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 463.69 |
| 2014 (Jan – Dec) Sub-Total | 24 | 16925.7 | 0 | 0 | 16798.93 | 83.66 | 1804.27 | 0 | 0 | 0 | 0 | 43.11 |
| 2015 (Jan – Dec) Sub-Total | 284 | 81859.97 | 0 | 0 | 38291.91 | 43457.21 | 19920 | 0 | 0 | 0 | 0 | 310.26 |
| 2016 (Jan – Dec) Sub-Total | 3369 | 50762.64 | 0 | 0 | 0 | 49894.67 | 4020 | 0 | 0 | 0 | 0 | 867.95 |
| 2017 (Jan – Dec) Sub-Total | 2737 | 39615.16 | 0 | 0 | 0 | 38996.26 | 0 | 0 | 0 | 0 | 0 | 603.11 |
| Jan-18 | 48 | 575.23 | 0 | 0 | 0 | 497.91 | 0 | 0 | 0 | 0 | 0 | 77.32 |
| Feb-18 | 10 | 81.78 | 0 | 0 | 0 | 30.34 | 0 | 0 | 0 | 0 | 0 | 51.44 |
| Mar-18 | 59 | 869.93 | 0 | 0 | 0 | 817.87 | 0 | 0 | 0 | 0 | 0 | 52.06 |
| Apr-18 | 14 | 136.71 | 0 | 0 | 0 | 91.67 | 0 | 0 | 0 | 0 | 0 | 45.04 |
| May-18 | 327 | 5176.05 | 0 | 0 | 0 | 5125.76 | 0 | 0 | 0 | 0 | 0 | 50.29 |
| Jun-18 | 14 | 141.28 | 0 | 0 | 0 | 104.01 | 0 | 0 | 0 | 0 | 0 | 37.27 |
| Jul-18 | 22 | 188.88 | 0 | 0 | 0 | 121.23 | 0 | 0 | 0 | 0 | 0 | 67.65 |
| Aug-18 | 15 | 94.82 | 0 | 0 | 0 | 14.78 | 0 | 0 | 0 | 0 | 0 | 80.04 |
| Sep-18 | 5 | 25.46 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 25.46 |
| Oct-18 | 9 | 37.96 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 37.96 |
| Nov-18 | 24 | 70.64 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 70.64 |
| Dec-18 | 19 | 84.83 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 84.83 |
| Total | 7088 | 197110.73 | 0 | 0 | 55090.84 | 139235.4 | 25744.27 | 0 | 0 | 0 | 0 | 2968.12 |

APPENDIX IV
Monthly Summary Waste Flow Table
 (PS Clause 1.86)

Name of Department: CEDD

Contract No. : KL/2012/03

Monthly Summary Waste Flow Table for February 2019 (year) (in tons)

| Month | Total Disposal Loads | Total Quantity Generated | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | Actual Quantities of C&D Wastes Generated Monthly | | | | |
|----------------------------|----------------------|--------------------------|--|------------------------|--------------------------|-------------------------|-----------------|---|----------------------------|-----------------------|-----------------|-----------------------------|
| | (No.s) | (in tons) | Hard Rock & Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 3) | Chemicals Waste | Others, e.g. general refuse |
| | | | 0 | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) | (in tons) |
| 2013 (Oct - Dec) Sub-Total | 108 | 463.69 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 463.69 |
| 2014 (Jan – Dec) Sub-Total | 24 | 16925.7 | 0 | 0 | 16798.93 | 83.66 | 1804.27 | 0 | 0 | 0 | 0 | 43.11 |
| 2015 (Jan – Dec) Sub-Total | 284 | 81859.97 | 0 | 0 | 38291.91 | 43457.21 | 19920 | 0 | 0 | 0 | 0 | 310.26 |
| 2016 (Jan – Dec) Sub-Total | 3369 | 50762.64 | 0 | 0 | 0 | 49894.67 | 4020 | 0 | 0 | 0 | 0 | 867.95 |
| 2017 (Jan – Dec) Sub-Total | 2737 | 39615.16 | 0 | 0 | 0 | 38996.26 | 0 | 0 | 0 | 0 | 0 | 603.11 |
| 2018 (Jan – Dec) Sub-Total | 566 | 7483.57 | 0 | 0 | 0 | 6803.57 | 0 | 0 | 0 | 0 | 0 | 680 |
| Jan-19 | 27 | 237.51 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 237.51 |
| Feb-19 | 8 | 23.03 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 23.03 |
| Mar-19 | | | | | | | | | | | | |
| Apr-19 | | | | | | | | | | | | |
| May-19 | | | | | | | | | | | | |
| Jun-19 | | | | | | | | | | | | |
| Total | 7123 | 197371.27 | 0 | 0 | 55090.84 | 139235.4 | 25744.27 | 0 | 0 | 0 | 0 | 3228.66 |

APPENDIX H
SUMMARY OF EXCEEDANCES

Contract No. KL/2012/03

Kai Tak Development – Stage 4 Infrastructure at Former North Apron Area

Appendix H – Summary of Exceedance

Exceedance Report for Contract No. KL/2012/03

(A) Exceedance Report for Air Quality
(NIL in the reporting period)

(B) Exceedance Report for Construction Noise
(NIL in the reporting period)

(C) Exceedance Report for Landscape and Visual
(NIL in the reporting period)

**ANNEX I
COMPARISON OF EM&A DATA AND
EIA PREDICTIONS**

Annex I – Comparison of EM&A Data and EIA Predictions

Comparison of 1-hr TSP data with EIA predictions

| Station | Predicted 1-hr TSP conc. | | | | | | | |
|--|---|--|--|--------------|--|--------------|--|---------------|
| | Scenario1 (Mid 2009 to Mid 2013), µg/m ³ | Scenario2 (Mid 2013 to Late 2016), µg/m ³ | Reporting Month (Dec 18), µg/m ³ | | Reporting Month (Jan 19), µg/m ³ | | Reporting Month (Feb 19), µg/m ³ | |
| | | | Average | Range | Average | Range | Average | Range |
| AM2 – Lee Kau Yan Memorial School | 290 | 312 | 95.3 | 45.0 – 196.5 | 102.4 | 19.1 – 236.1 | 115.9 | 73.1 – 169.6 |
| AM3(A) - Holy Trinity Bradbury Centre (Alternative station for Sky Tower) | 217 | 247 | 114.5 | 28.2 – 273.8 | 100.6 | 19.1 – 233.9 | 94.4 | 58.9 – 199.3 |
| AM4(C) – New Pumping Station | N/A | N/A | 120.9 | 34.9 – 230.7 | 64.1 | 28.2 – 185.8 | 125.9 | 100.6 – 151.9 |
| AM5 – CCC Kei To Secondary School | 159 | 221 | 93.0 | 22.5 – 146.6 | 42.8 | 18.0 – 112.9 | 111.4 | 84.2 – 148.0 |

Comparison of 24-hr TSP data with EIA predictions

| Station | Predicted 24-hr TSP conc. | | | | | | | |
|--|---|--|---|--------------|--|--------------|--|-------------|
| | Scenario1 (Mid 2009 to Mid 2013), µg/m ³ | Scenario2 (Mid 2013 to Late 2016), µg/m ³ | Reporting Month (Dec 18), µg/m ³ | | Reporting Month (Jan 19), µg/m ³ | | Reporting Month (Feb 19), µg/m ³ | |
| | | | Average | Range | Average | Range | Average | Range |
| AM2(A) – Ng Wah Catholic Secondary School (Alternative station for Lee Kau Yan Memorial School) | 145 | 169 | 44.8 | 15.7 - 67.8 | 98.8 | 73.6 – 122.9 | 50.3 | 38.4 – 62.1 |
| AM3(B) – Family Planning Association of Hong Kong | N/A | N/A | 79.4 | 28.0 - 111.0 | 121.7 | 95.4 – 151.6 | 65.7 | 52.8 – 90.4 |
| AM4(C) – New Pumping Station | N/A | N/A | 53.5 | 22.8 - 73.7 | 55.3 | 28.6 – 91.4 | 36.5 | 14.3 – 55.5 |
| AM5 – CCC Kei To Secondary School | 103 | 128 | 49.8 | 23.6 - 115.8 | 48.0 | 28.6 – 64.2 | 31.8 | 28.2 – 35.7 |

Comparison of Noise Monitoring Data with EIA predictions

| Stations | Predicted Mitigated Construction Noise Levels during Normal Working Hour (Leq (30min) dB(A)) | Reporting Month (Dec 18), Leq (30min) dB(A) | Reporting Month (Jan 19), Leq (30min) dB(A) | Reporting Month (Feb 19), Leq (30min) dB(A) |
|--|---|---|--|---|
| M6(A) - Oblate Primary School ^ | N/A | 60.4 – 64.5 | 58.9 – 62.5 | 56.1 – 66.5 |
| M7 - CCC Kei To Secondary School | 45 – 68 | 59.2 – 66.6 | 61.7 – 67.2 | 64.9 – 66.7 |
| M8 - Po Leung Kuk Ngan Po Ling College *M8(A) - Po Leung Kuk Ngan Po Ling College (Site Boundary) | 44 – 70 | 64.5 – 68.9 | 64.2 – 68.1 | 65.5 – 69.1 |
| M9 - Tak Long Estate | Not predicted in EIA Report | 61.4 – 68.7 | 63.7 – 72.4 | 57.9 – 72.2 |

(^) Construction noise monitoring at Station M6 – Holy Carpenter Primary School was carried out on 3rd and 8th October 2014 as it was rejected by the premise owner afterwards. An alternative noise monitoring station – M6(A) – Oblate Primary School replaced M6 – Holy Carpenter Primary School from 10th October 2014 onwards.

(*) Noise monitoring at M8(A) – Po Leung Kuk Ngan Po Ling College was cancelled due to no permission was granted from the premise. Noise monitoring was carried out at M8(A) – Po Leung Kuk Ngan Po Ling College (Site Boundary) temporarily from 21st November 2018.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix B

**Monthly EM&A Report
For
Contract No. KL/2014/01
Kai Tak Development - Stage 2 Infrastructure works for Developments at Southern
Part of the Former Runway**

Civil Engineering and Development Department

EP-337/2009 & EP-445/2013/A


Contract No. KL/2014/01

**Kai Tak Development –
Stage 2 Infrastructure works for Developments at
Southern Part of the Former Runway**

Quarterly EM&A Report

January 2019 to March 2019

(Version 1.0)

| | |
|-------------|---|
| Approved By |  (Environmental Team Leader) |
|-------------|---|

REMARKS:

The information supplied and contained within this report is, to the best of our knowledge, correct at the time of printing.

CINOTECH accepts no responsibility for changes made to this report by third parties

CINOTECH CONSULTANTS LTD

Room 1710, Technology Park,
18 On Lai Street,
Shatin, NT, Hong Kong
Tel: (852) 2151 2083 Fax: (852) 3107 1388
Email: info@cinotech.com.hk

嘉誠管理顧問有限公司

Ka Shing management consultant Limited



Our ref: 10-4-2019

10-4-2019

By email: clive.cheng@aecom-ktd.com and By hand

Supervising Officer Representative

Aecom Asia Co Ltd.

8/F Grand Central Plaza Tower 2

138 Shatin Rural Committee Road

Sha Tin, N.T. Hong Kong

(Attn: Mr. Cheng Chi Hung)

Dear Mr. Cheng,

Re: Contract No. KL/2014/01 (Environmental Permit Nos. EP-337/2009 and EP-445/2013/A)

Kai Tak Development –Stage 2 Infrastructure Works for Developments at Southern Part of the Former Runway

Quarterly EM&A report for Jan -March 2019

Reference is made to the Environmental Team's submission of the draft Quarterly EM&A Report (version 1.0) for Jan -March 2019 provided to Independent Environmental Checker (IEC) via email dated on 8 th April 2019 for review and comment.

Please be informed that IEC has no adverse comment on the captioned submission. IEC writes to verify the captioned submission in accordance with Specific Condition 2.2 of the Environmental Permit No. 337/2009 and 445/2013/A.

Thank you very much for your attention and please feel free to contact the undersigned should you require further information.

Yours faithfully,

For and on behalf of

Ka Shing Management Consultant Limited

Dr. C.F. Ng

Independent Environmental Checker

| | | | |
|------|----------|-------------------------|--|
| c.c. | CEDD | Mr. CHU Chi Hong, Keith | (By email: keithchchu@cedd.gov.hk) |
| | AECOM | Mr. Anthony Lok | (By email: anthony.lok@aecom-ktd.com) |
| | CEC-CCC | Mr. Eric Fong | (By email: eric-cs-fong@continental-engineering.com) |
| | Cinotech | Mr K.S Lee | (By email: ks.lee@cinotech.com.hk) |

Unit 2, 13/F Kai Yue Commercial Building, 2C Argyle St, Mong Kok, Kowloon
九龍吐角亞皆老街 2C 號啟如商業大廈 13 樓 2 室
Tel: (852) 2618 2166 Fax: (852) 2120 7752 Web Site: www.ka-shing.net
電話: (852) 2618 2166 傳真: (852) 2120 7752 網站: www.ka-shing.net



TABLE OF CONTENTS

| | Page |
|--|----------|
| EXECUTIVE SUMMARY | 1 |
| Introduction | 1 |
| Environmental Monitoring Works | 1 |
| Environmental Licenses and Permits | 2 |
| Key Information in the Reporting Quarter | 2 |
| 1. INTRODUCTION | 3 |
| Background | 3 |
| Project Organizations | 4 |
| 2. ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS | 5 |
| Monitoring Parameters and Monitoring Locations | 5 |
| Monitoring Methodology | 5 |
| Environmental Quality Performance Limits (Action and Limit Levels) | 5 |
| Implementation Status of Environmental Mitigation Measures | 5 |
| Site Audit Summary | 5 |
| Status of Waste Management | 5 |
| 3. MONITORING RESULTS | 6 |
| Air Quality and Construction Noise | 6 |
| Landscape and Visual | 6 |
| 4. NON-COMPLIANCE (EXCEEDANCES) OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS (ACTION AND LIMIT LEVELS) | 7 |
| Summary of Exceedances | 7 |
| Review of the Reasons for and the Implications of Non-compliance | 7 |
| Summary of Environmental Complaints and Prosecutions | 7 |
| 5. COMMENTS, CONCLUSIONS AND RECOMMENDATIONS | 8 |
| Effectiveness of Mitigation Measures | 8 |

LIST OF TABLE

| | |
|-----------|--|
| Table I | Summary Table for Non-compliance Recorded in the Reporting Quarter |
| Table II | Summary Table for Key Information in the Reporting Quarter |
| Table 1.1 | Key Project Contacts |

LIST OF FIGURES

| | |
|----------|----------------------------|
| Figure 1 | Layout Plan of the Project |
|----------|----------------------------|

LIST OF APPENDICES

| | |
|---|---|
| A | Action and Limit Levels |
| B | Environmental Mitigation Implementation Schedule (EMIS) |
| C | Site Audit Summary |
| D | Waste Generated Quantity |
| E | Summary of Exceedances |

EXECUTIVE SUMMARY

Introduction

1. This is the 12th Quarterly Environmental Monitoring and Audit (EM&A) Report prepared by Cinotech Consultants Limited for the “Contract No. KL/2014/01 - Kai Tak Development – Stage 2 Infrastructure Works for Developments at the Southern Part of the Former Runway” (Hereafter referred to as “the Project”). This contract work comprises two Schedule 2 designated project (DP), namely the new distributor road D4 (part) and roads D3A & D4A serving the planned KTD. The DPs are part of the designated projects under Environmental Permits (EP) No.: EP-337/2009 (“New distributor roads serving the planned Kai Tak Development”) and EP-445/2013/A (“Kai Tak Development – Roads D3A & D4A”) respectively. This summary report presents the EM&A works performed in the period between 1 January 2019 and 31 March 2019.
2. With reference to the same principle of EIA report of the Project, no air quality monitoring station within 500m and noise monitoring station within 300m from the boundary of this Project are considered as relevant monitoring locations. In such regard, no relevant air quality and noise monitoring location are required for monitoring under the Project. The monitoring works for recommended monitoring stations in EM&A Manual of the DPs are conducted by Kai Tak Development (KTD) Schedule 3 Project, which is on-going starting from December 2010.
3. The construction activities undertaken in the reporting quarter were:
 - TTA implementation, junction improvement works at Shing Fung Road, Wang Chiu Road / Kai Cheung Road;
 - Construction of box culvert and underpass;
 - Construction of utilities trough at Kai Tak Bridge;
 - Construction of pile caps, noise barrier footings and outfalls;
 - Laying of sewer, drainage and pavement;
 - Erection of noise barrier steel structure and panels;
 - Construction of Architectural features on Open Space

Environmental Monitoring Works

4. Environmental monitoring for the Project was performed in accordance with the EM&A Manual and the monitoring results were checked and reviewed. Site Inspections/Audits were conducted once per week. The implementation of the environmental mitigation measures, Event Action Plans and environmental complaint handling procedures were also checked.
5. Summary of the non-compliance in the reporting quarter for the Project is tabulated in Table I.

Table I Non-compliance Record for the Project in the Reporting Quarter

| Parameter | No. of Exceedance | | Action Taken |
|---------------|-------------------|-------------|--------------|
| | Action Level | Limit Level | |
| January 2019 | | | |
| Noise | 0 | 0 | N/A |
| February 2019 | | | |
| Noise | 0 | 0 | N/A |
| March 2019 | | | |
| Noise | 0 | 0 | N/A |

6. No monitoring for air quality and construction noise is required. No Action/Limit Level exceedance was recorded.

Environmental Licenses and Permits

7. Licenses/Permits granted to the Project include the Environmental Permits (EP) for the Project, EP-337/2009 issued on 23 April 2009 and EP-445/2013 issued on 3 May 2013 (Amended Environmental Permit (No.: EP-445/2013/A) issued on 13 August 2014).
8. Billing Account for Disposal of Construction Waste (A/C No. 7024073)
9. Registration of Chemical Waste Producer (License: 5213-247-C4004-01).
10. Water Discharge License (License No.: WT00023634-2016).
11. Construction Noise Permit (License No.: GW-RE0646-18, GW-RE0801-18, GW-RE0875-18 & GW-RE0186-19).

Key Information in the Reporting Quarter

12. Summary of key information in the reporting quarter is tabulated in Table II.

Table II Summary Table for Key Information in the Reporting Quarter

| Event | Event Details | | Action Taken | Status | Remark |
|--|---------------|--------|--------------|--------|--------|
| | Number | Nature | | | |
| Complaint received | 0 | --- | N/A | N/A | --- |
| Reporting Changes | 0 | --- | N/A | N/A | --- |
| Notifications of any summons & prosecutions received | 0 | --- | N/A | N/A | --- |

13. Environmental monitoring works for the Project are considered effective and are generating data to categorically identify the environmental impacts from the works and influencing factors in the vicinity of monitoring stations.

1. INTRODUCTION

Background

- 1.1 The Kai Tak Development (KTD) is located in the south-eastern part of Kowloon Peninsula, comprising the apron and runway areas of the former Kai Tak Airport and existing waterfront areas at To Kwa Wan, Ma Tau Kok, Kowloon Bay, Kwun Tong and Cha Kwo Ling. It covers a land area of about 328 hectares. Stage 2 Infrastructure Works for Developments for Southern Part of the Former Runway is one of the construction stages of KTD. It contains two Schedule 2 DPs including new distributor roads serving the planned KTD and KTD Roads D3A & D4A. The general layout of the Project is shown in **Figure 1**.
- 1.2 One Environmental Permit (EP) No.: EP-337/2009 was issued on 23 April 2009 for new distributor roads serving the planned KTD and one Environmental Permit No.: EP-445/2013 was issued on 3 May 2013 for Kai Tak Development Roads D3A & D4A to Civil Engineering and Development Department (CEDD) as the Permit Holder. Pursuant to Section 13 of the EIAO, the Director of Environmental Protection amended the Environmental Permit No.: EP-445/2013 based on the Application No. VEP-449/2014 and the Environmental Permit (No.: EP-445/2013/A) was issued on 13 August 2014.
- 1.3 A study of environmental impact assessment (EIA) was undertaken to consider the key issues of air quality, noise, water quality, waste, land contamination, cultural heritage and landscape and visual impact, and identify possible mitigation measures associated with the works. EIA Reports (Register No. AEIAR-130/2009 and AEIAR-170/2013) were approved by the Environmental Protection Department (EPD) on 4 March 2009 and 3 May 2013 respectively.
- 1.4 Cinotech Consultants Limited (Cinotech) was commissioned by Civil Engineering and Development Department (CEDD) to undertake the role of the Environmental Team (ET) for the Contract No. KL/2014/01 – Stage 2 Infrastructure Works for Developments at the Southern Part of the Former Runway. The construction work under KL/2014/01 comprises the construction of part of the Road D4 under the EP (EP-337/2009) and the construction of Roads D3A & D4A under the EP (EP-445/2013/A).
- 1.5 Cinotech Consultants Limited was commissioned by Civil Engineering and Development Department (CEDD) to undertake the Environmental Monitoring and Audit (EM&A) works for the Project. The construction commencement of this Contract is on 13 April 2016. This summary report presents the EM&A works performed in the period between 1 January 2019 and 31 March 2019.

Project Organizations

- 1.6 Different parties with different levels of involvement in the project organization include:
- Project Proponent – Civil Engineering and Development Department (CEDD).
 - The Supervising Officer and the Supervising Officer’s Representative (SO) – AECOM Asia Co. Ltd. (AECOM).
 - Environmental Team (ET) – Cinotech Consultants Limited (CCL).
 - Independent Environmental Checker (IEC) – Ka Shing Management Consultant Ltd. (KSMC).
 - Contractor – Continental Engineering Corp. and Chit Cheung Construction Co. Ltd. Joint Venture (CCJV).
- 1.7 The key contacts of the Project are shown in **Table 1.1**.

Table 1.1 Key Project Contacts

| Party | Role | Contact Person | Position | Phone No. | Fax No. |
|----------|-----------------------------------|-----------------|---------------------------|-----------|-----------|
| CEDD | Project Proponent | Mr. Keith Chu | Senior Engineer | 3579 2450 | 3579 4516 |
| | | Ms. Adonia Yung | Engineer | 3579 2124 | |
| AECOM | Supervising Officer | Mr. Clive Cheng | CRE | 3746 1801 | 2798 0783 |
| Cinotech | Environmental Team | Mr. K S Lee | Environmental Team Leader | 2151 2091 | 3107 1388 |
| | | Ms. Betty Choi | Audit Team Leader | 2151 2072 | |
| KSMC | Independent Environmental Checker | Dr. C. F. Ng | IEC | 2618 2166 | 2120 7752 |
| CCJV | Contractor | Mr. Dennis Ho | Environmental Officer | 2960 1398 | 2960 1399 |

2. ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS

Monitoring Parameters and Monitoring Locations

- 2.1 With reference to the same principle of EIA report of the Project, air quality monitoring station should be provided at the Air Sensitive Receivers (ASR) within 500 m from the boundary of this Project while construction noise monitoring station should be provided at the Noise Sensitive Receivers (NSR) within 300 m from the boundary of this Project. Since the opening of the Centre of Excellence in Paediatrics (Children's Hospital) on 18 December 2019, the hospital is considered as the only relevant monitoring location and therefore the monitoring is required.

Monitoring Methodology

- 2.2 Monitoring works/equipments were conducted/calibrated regularly in accordance with the EM&A Manual.

Environmental Quality Performance Limits (Action and Limit Levels)

- 2.3 Should the environmental quality parameters exceed the Action/Limit Levels, the respective action plans would be implemented. The Action/Limit Levels for each environmental parameter are given in **Appendix A**.

Implementation Status of Environmental Mitigation Measures

- 2.4 Relevant mitigation measures as recommended in the project EIA report have been stipulated in the EM&A Manual for the Contractor to implement. The implementation status of environmental mitigation measures (EMIS) is given in **Appendix B**.

Site Audit Summary

- 2.5 Site audits were carried out on a weekly basis. During site inspections in the reporting period, no non-conformance was identified. The observations and recommendations made during the reporting period are summarized in **Appendix C**.

Status of Waste Management

- 2.6 The amount of wastes generated by the major site activities of this Project during the reporting month is shown in **Appendix D**.

3. MONITORING RESULTS

Air Quality and Construction Noise

- 3.1 As the monitoring works for the hospital is covered by the Contract KL/2014/03 (Kai Tak Development Stage 3 Infrastructure Works for Developments at the Southern Part of the Former Runway) at the monitoring station (KTD1a), the corresponding monitoring results for January - March 2019 should be accessed in the EM&A report for the reporting month. **Appendix A** shows the established Action and Limit Levels for the environmental monitoring works.
- 3.2 No monitoring for air quality and construction noise are required for this report.
- 3.3 Site audits were carried out to monitor and audit the timely implementation of air quality and noise mitigation measures under the Project on a weekly basis. No non-compliance of the air quality impact and noise impact was recorded in the reporting quarter.

Landscape and Visual

- 3.4 Site audits were carried out on a weekly basis to monitor and audit the timely implementation of landscape and visual mitigation measures under the Project. No non-compliance of the landscape and visual impact was recorded in the reporting quarter.

4. NON-COMPLIANCE (EXCEEDANCES) OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS (ACTION AND LIMIT LEVELS)

Summary of Exceedances

- 4.1 A summary of exceedances is attached in **Appendix E**. The details of each exceedance were attached in the Monthly EM&A Reports.

Air Quality and Construction Noise

- 4.2 No monitoring for air quality and noise impact is required under the Project. No Action/ Limit Level exceedance was recorded in the reporting quarter.

Landscape and Visual

- 4.3 No non-compliance of the landscape and visual impact was recorded in the reporting quarter.

Review of the Reasons for and the Implications of Non-compliance

- 4.4 There was no non-compliance from the site audits in the reporting quarter. The observations and recommendations made in each individual site audit session were attached in the **Appendix C**.

Summary of Environmental Complaints and Prosecutions


- 4.5 No environmental complaint was received during the reporting quarter.
- 4.6 No warning, summon and notification of successful prosecution was received in the reporting period.
- 4.7 There were no environmental complaints, warnings, summons and successful prosecutions received since the commencement of the Project.

5. COMMENTS, CONCLUSIONS AND RECOMMENDATIONS

Effectiveness of Mitigation Measures

- 5.1 The mitigation measures recommended in the EIA report are considered effective in minimizing environmental impacts.
- 5.2 The Contractor has implemented the recommended mitigation measures except those mitigation measures not applicable at this stage.
- 5.3 Environmental monitoring works were performed in the reporting quarter and all monitoring results were checked and reviewed. No non-compliance (exceedances) of Action/Limit Level was recorded.
- 5.4 No environmental complaints and environmental prosecution were received in the reporting quarter.

FIGURE(S)

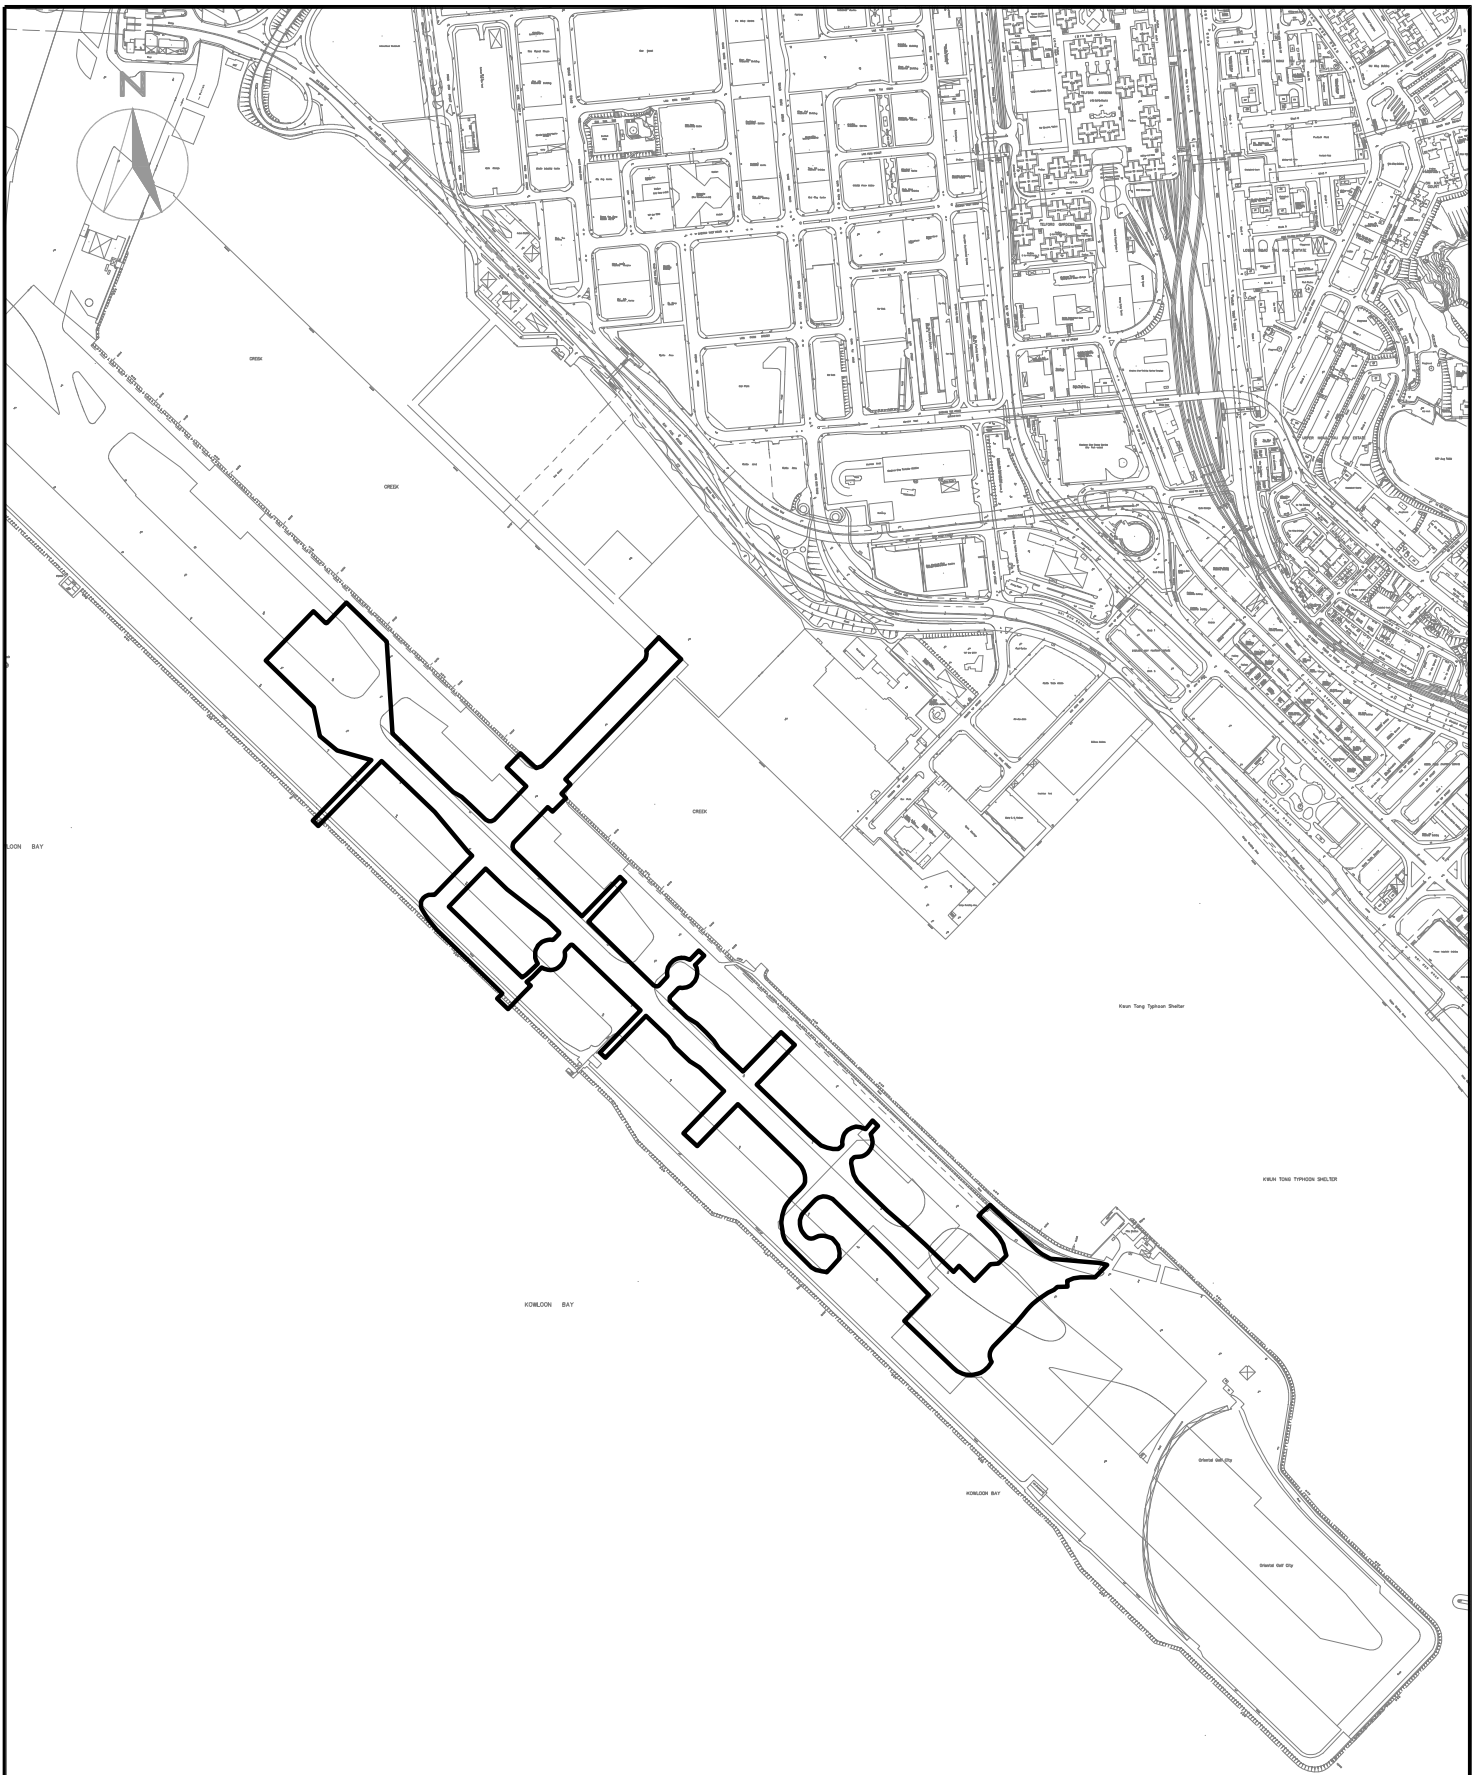

LEGEND:

SITE BOUNDARY

CINOTECH
Cinotech Consultants Limited

KL/2014/01 KAI TAK DEVELOPMENT - STAGE 2
INFRASTRUCTURE WORKS FOR DEVELOPMENT AT
SOUTHERN PART OF THE FORMER RUNWAY

SITE LAYOUT PLAN

| | | | |
|---------|-----------|------------|----------|
| SCALE | 1:1000@A4 | DATE | MAY 2016 |
| CHECK | JL | DRAWN | JW |
| JOB No. | MA15046 | FIGURE NO. | 1 |
| | | REV | - |

**APPENDIX A
ACTION AND LIMIT LEVELS**

Appendix A - Action and Limit Levels

Table A-1 Action and Limit Levels for Air Quality Monitoring

| Monitoring Station | Parameter | Action Level ($\mu\text{g}/\text{m}^3$) | Limit Level ⁽¹⁾⁽²⁾ ($\mu\text{g}/\text{m}^3$) |
|--------------------|-----------|--|---|
| KTD1a | 24-hr TSP | 177 | 260 |
| KTD1a* | 1-hr TSP | 285 | 500 |

* 1-hr TSP monitoring should be required in case of complaints.

Table A-2 Action and Limit Levels for Construction Noise Monitoring

| Time Period | Action Level | Limit Level ⁽¹⁾⁽²⁾ |
|----------------------------------|---|-------------------------------|
| 0700-1900 hrs on normal weekdays | When one documented complaint is received | 75 dB(A) 70dB(A)/65dB(A)* |

Remarks: (1) If works are to be carried out during restricted hours, the conditions stipulated in the Construction Noise Permit (CNP) issued by the Noise Control Authority have to be followed.
 (2) No regular noise impact monitoring station for this Contract. It is subject to the noise sensitive receiver(s) and additional monitoring work.
 (*) 70dB(A) and 65dB(A) for schools during normal teaching periods and school examination periods respectively.

**APPENDIX B
ENVIRONMENTAL MITIGATION
IMPLEMENTATION SCHEDULE (EMIS)**

Appendix B - Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| EIA Ref. | Mitigation Measures | Status |
|---|---|--|
| Construction Air Quality | | |
| S3.2 (AEIAR-130/2009) | 8 times daily watering of the work site with active dust emitting activities. | ^ |
| S4.8 (AEIAR-170/2013) | Control measures stipulated in the approved KTD Schedule 3 EIA Report should be strictly followed. | ^ |
| S3.2 (AEIAR-130/2009) and S4.8 (AEIAR-170/2013) | <p>Implementation of dust suppression measures stipulated in Air Pollution Control (Construction Dust) Regulation. The following mitigation measures, good site practices and a comprehensive dust monitoring and audit programme are recommended to minimize cumulative dust impacts.</p> <ul style="list-style-type: none"> ● Stockpiling site(s) should be lined with impermeable sheeting and bunded. Stockpiles should be fully covered by impermeable sheeting to reduce dust emission. ● Misting for the dusty material should be carried out before being loaded into the vehicle. ● Any vehicle with an open load carrying area should have properly fitted side and tail boards. ● Material having the potential to create dust should not be loaded from a level higher than the side and tail boards and should be dampened and covered by a clean tarpaulin. ● The tarpaulin should be properly secured and should extent at least 300 mm over the edges of the sides and tailboards. The material should also be dampened if necessary before transportation. ● The vehicles should be restricted to maximum speed of 10 km per hour and confined haulage and delivery vehicle to designated roadways insider the site. Onsite unpaved roads should be compacted and kept free of lose materials. ● Vehicle washing facilities should be provided at every vehicle exit point. | <p>*</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |

| EIA Ref. | Mitigation Measures | Status |
|---------------------------|--|--|
| | <ul style="list-style-type: none"> ● The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores. ● Every main haul road should be scaled with concrete and kept clear of dusty materials or sprayed with water so as to maintain the entire road surface wet. ● Every stock of more than 20 bags of cement should be covered entirely by impervious sheeting placed in an area sheltered on the top and the three sides; and ● Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving the construction sites. | <p>^</p> <p>*</p> <p>^</p> <p>^</p> |
| Construction Noise | | |
| S3.3 (AEIAR-130/2009) | Use of quiet PME, movable barriers barrier for Asphalt Paver, Breaker, Excavator and Hand-held breaker and full enclosure for Air Compressor, Bar Bender, Concrete Pump, Generator and Water Pump. | ^ |
| S3.3 (AEIAR-130/2009) | <p>Good Site Practice:</p> <ul style="list-style-type: none"> ● Only well-maintained plant should be operated on-site and plant should be serviced regularly during the construction program. ● Silencers or mufflers on construction equipment should be utilized and should be properly maintained during the construction program. ● Mobile plant, if any, should be sited as far away from NSRs as possible. ● Machines and plant (such as trucks) that may be in intermittent use should be shut down between works periods or should be throttled down to a minimum. ● Plant known to emit noise strongly in one direction should, wherever possible, be orientated so that the noise is directed away from the nearby NSRs. ● Material stockpiles and other structures should be effectively utilized, wherever | <p>^</p> <p>N/A(1)</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |

| EIA Ref. | Mitigation Measures | Status |
|---|--|-------------------|
| | practicable, in screening noise from on-site construction activities. | |
| S3.3 (AEIAR-130/2009) | Scheduling of Construction Works during School Examination Period | N/A |
| S3.8 (AEIAR-170/2013) | Provision of a landscaped deck along Roads D3A & D4A. | N/A |
| S3.8 (AEIAR-170/2013) | <ul style="list-style-type: none"> ● Provision of about 1090 m length of vertical noise barrier (connected to the deck) at Roads D3A & D4A; ● Provision of about 60 m length of overhang vertical noise barrier (connected to the deck) at Road D4A; and ● Provision of staircases with noise barriers next to Sites 4A1 and 4B1 <p>It should be noted that the exact length of the mitigation measures would be subject to minor refinement during the detailed design stage.</p> | N/A N/A N/A |
| S3.8 (AEIAR-170/2013) | Non-noise sensitive use areas within Sites 4A1 and 4B1. | N/A |
| S3.8 (AEIAR-170/2013) | Avoid sensitive façade with openable window facing Road D3A. | N/A |
| Construction Water Quality | | |
| S3.4 (AEIAR-130/2009) and S5.8 (AEIAR-170/2013) | <p><u>Construction Runoff</u></p> <p>Exposed soil areas should be minimised to reduce the potential for increased siltation, contamination of runoff, and erosion. Construction runoff related impacts associated with the above ground construction activities can be readily controlled through the use of appropriate mitigation measures which include:</p> <ul style="list-style-type: none"> ● use of sediment traps ● adequate maintenance of drainage systems to prevent flooding and overflow | ^ ^ |

| EIA Ref. | Mitigation Measures | Status |
|--------------------------|---|--------|
| | Construction site should be provided with adequately designed perimeter channel and pre-treatment facilities and proper maintenance. The boundaries of critical areas of earthworks should be marked and surrounded by dykes or embankments for flood protection. Temporary ditches should be provided to facilitate runoff discharge into the appropriate watercourses, via a silt retention pond. Permanent drainage channels should incorporate sediment basins or traps and baffles to enhance deposition rates. The design of efficient silt removal facilities should be based on the guidelines in Appendix A1 of ProPECC PN 1/94. | ^ |
| | Ideally, construction works should be programmed to minimise surface excavation works during the rainy season (April to September). All exposed earth areas should be completed as soon as possible after earthworks have been completed, or alternatively, within 14 days of the cessation of earthworks where practicable. If excavation of soil cannot be avoided during the rainy season, or at any time of year when rainstorms are likely, exposed slope surfaces should be covered by tarpaulin or other means. | ^ |
| S5.8 (AEIAR-170/2013) | Earthworks final surfaces should be well compacted and the subsequent permanent work or surface protection should be carried out immediately after the final surfaces are formed to prevent erosion caused by rainstorms. Appropriate drainage like intercepting channels should be provided where necessary. | ^ |
| | Measures should be taken to minimize the ingress of rainwater into trenches. If excavation of trenches in wet seasons is necessary, they should be dug and backfilled in short sections. Rainwater pumped out from trenches or foundation excavations should be discharged into storm drains via silt removal facilities. | * |
| S3.4 (AEIAR-130/2009) | Sediment tanks of sufficient capacity, constructed from pre-formed individual cells of approximately 6 to 8 m ³ capacity, are recommended as a general mitigation measure | ^ |

| EIA Ref. | Mitigation Measures | Status |
|---|---|--------|
| | which can be used for settling surface runoff prior to disposal. The system capacity is flexible and able to handle multiple inputs from a variety of sources and particularly suited to applications where the influent is pumped. | |
| S3.4 (AEIAR-130/2009) and S5.8 (AEIAR-170/2013) | Open stockpiles of construction materials (for examples, aggregates, sand and fill material) of more than 50 m ³ should be covered with tarpaulin or similar fabric during rainstorms. Measures should be taken to prevent the washing away of construction materials, soil, silt or debris into any drainage system. | ^ |
| | Manholes (including newly constructed ones) should always be adequately covered and temporarily sealed so as to prevent silt, construction materials or debris being washed into the drainage system and storm runoff being directed into foul sewers. | ^ |
| S3.4 (AEIAR-130/2009) | Precautions to be taken at any time of year when rainstorms are likely, actions to be taken when a rainstorm is imminent or forecast, and actions to be taken during or after rainstorms are summarised in Appendix A2 of ProPECC PN 1/94. Particular attention should be paid to the control of silty surface runoff during storm events. | ^ |
| | Oil interceptors should be provided in the drainage system and regularly cleaned to prevent the release of oils and grease into the storm water drainage system after accidental spillages. The interceptor should have a bypass to prevent flushing during periods of heavy rain. | ^ |
| S3.4 (AEIAR-130/2009) and S5.8 (AEIAR-170/2013) | All vehicles and plant should be cleaned before leaving a construction site to ensure no earth, mud, debris and the like is deposited by them on roads. An adequately designed and located wheel washing bay should be provided at every site exit, and wash-water should have sand and silt settled out and removed at least on a weekly basis to ensure the continued efficiency of the process. The section of access road leading to, and exiting | ^ |

| EIA Ref. | Mitigation Measures | Status |
|--------------------------|--|--------|
| | from, the wheel-wash bay to the public road should be paved with sufficient backfall toward the wheel-wash bay to prevent vehicle tracking of soil and silty water to public roads and drains. | |
| S5.8 (AEIAR-170/2013) | <p><u>Boring and Drilling Water</u> Water used in ground boring and drilling for site investigation or rock / soil anchoring should as far as practicable be re-circulated after sedimentation. When there is a need for final disposal, the wastewater should be discharged into storm drains via silt removal facilities.</p> | ^ |
| | <p><u>Acid Cleaning, Etching and Pickling Wastewater</u> Acidic wastewater generated from acid cleaning, etching, pickling and similar activities should be neutralized to within the pH range of 6 to 10 before discharging into foul sewers</p> | ^ |
| S3.4 (AEIAR-130/2009) | <p><u>Drainage</u> It is recommended that on-site drainage system should be installed prior to the commencement of other construction activities. Sediment traps should be installed in order to minimise the sediment loading of the effluent prior to discharge into foul sewers. There should be no direct discharge of effluent from the site into the sea.</p> | ^ |
| S3.4 (AEIAR-130/2009) | All temporary and permanent drainage pipes and culverts provided to facilitate runoff discharge should be adequately designed for the controlled release of storm flows. All sediment control measures should be regularly inspected and maintained to ensure proper and efficient operation at all times and particularly following rain storms. The temporarily diverted drainage should be reinstated to its original condition when the construction work has finished or the temporary diversion is no longer required. | ^ |

| EIA Ref. | Mitigation Measures | Status |
|---|--|--------|
| S3.4 (AEIAR-130/2009) | All fuel tanks and storage areas should be provided with locks and be located on sealed areas, within bunds of a capacity equal to 110% of the storage capacity of the largest tank, to prevent spilled fuel oils from reaching the coastal waters of the Victoria Harbour WCZ. | ^ |
| S5.8 (AEIAR-170/2013) | There is a need to apply to EPD for a discharge licence for discharge of effluent from the construction site under the WPCO. The discharge quality must meet the requirements specified in the discharge licence. All the runoff and wastewater generated from the works areas should be treated so that it satisfies all the standards listed in the TM-DSS. Minimum distance of 100 m should be maintained between the discharge points of construction site effluent and the existing seawater intakes and the planned WSR mentioned in S5.3.1 as appropriate. The beneficial uses of the treated effluent for other on-site activities such as dust suppression, wheel washing and general cleaning etc., can minimise water consumption and reduce the effluent discharge volume. If monitoring of the treated effluent quality from the works areas is required during the construction phase of the Project, the monitoring should be carried out in accordance with the relevant WPCO licence which is under the ambit of regional office (RO) of EPD. | ^ |
| S3.4 (AEIAR-130/2009) and S5.8 (AEIAR-170/2013) | <u>Sewage Effluent</u> Construction work force sewage discharges on site are expected to be connected to the existing trunk sewer or sewage treatment facilities. The construction sewage may need to be handled by portable chemical toilets prior to the commission of the on-site sewer system. Appropriate numbers of portable toilets should be provided by a licensed contractor to serve the large number of construction workers over the construction site. The Contractor should also be responsible for waste disposal and maintenance practices. | ^ |
| S5.8 | Notices should be posted at conspicuous locations to remind the workers not to discharge | ^ |

| EIA Ref. | Mitigation Measures | Status |
|---|--|--------|
| (AEIAR-170/2013) | any sewage or wastewater into the surrounding environment. Regular environmental audit of the construction site will provide an effective control of any malpractices and can encourage continual improvement of environmental performance on site. It is anticipated that sewage generation during the construction phase of the project would not cause water pollution problem after undertaking all required measures. | |
| S3.4 (AEIAR-130/2009) and S5.8 (AEIAR-170/2013) | <u>Stormwater Discharges</u> Minimum distances of 100 m should be maintained between the existing or planned stormwater discharges and the existing or planned seawater intakes. | ^ |
| | <u>Debris and Litter</u> In order to maintain water quality in acceptable conditions with regard to aesthetic quality, contractors should be required, under conditions of contract, to ensure that site management is optimised and that disposal of any solid materials, litter or wastes to marine waters does not occur. | ^ |
| S5.8 (AEIAR-170/2013) | <u>Accidental Spillage</u> Contractor must register as a chemical waste producer if chemical wastes would be produced from the construction activities. The Waste Disposal Ordinance (Cap 354) and its subsidiary regulations in particular the Waste Disposal (Chemical Waste) (General) Regulation, should be observed and complied with for control of chemical wastes. Any service shop and maintenance facilities should be located on hard standings within a bunded area, and sumps and oil interceptors should be provided. Maintenance of vehicles and equipment involving activities with potential for leakage and spillage should only be undertaken within the areas appropriately equipped to control these discharges. | ^ |

| EIA Ref. | Mitigation Measures | Status |
|--|--|-------------------------------------|
| | <p>Disposal of chemical wastes should be carried out in compliance with the Waste Disposal Ordinance. The Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes published under the Waste Disposal Ordinance details the requirements to deal with chemical wastes. General requirements are given as follows:</p> <ul style="list-style-type: none"> ● Suitable containers should be used to hold the chemical wastes to avoid leakage or spillage during storage, handling and transport. ● Chemical waste containers should be suitably labelled, to notify and warn the personnel who are handling the wastes, to avoid accidents. ● Storage area should be selected at a safe location on site and adequate space should be allocated to the storage area. | <p>^</p> <p>^</p> <p>^</p> <p>^</p> |
| Construction Waste Management | | |
| <p>S6.7 (AEIAR-170/2013)</p> | <p>Prepare a Waste Management Plan, which becomes a part of the Environmental Management Plan, in accordance with the requirements stipulated in ETWB TC(W) No. 19/2005, approved by the Engineer/Supervising Officer of the Project based on current practices on construction sites.</p> | <p>^</p> |
| <p>S3.5 (AEIAR-130/2009) and S6.7 (AEIAR-170/2013)</p> | <p>Good Site Practices It is not anticipated that adverse waste management related impacts would arise, provided that good site practices are adhered to. Recommendations for good site practices during construction activities include:</p> <ul style="list-style-type: none"> ● Nomination of an approved person, such as a site manager, to be responsible for good site practices, arrangements for collection and effective disposal to an appropriate facility, of all wastes generated at the site ● Training of site personnel in proper waste management and chemical waste handling procedures ● Provision of sufficient waste disposal points and regular collection for disposal | <p>^</p> <p>^</p> |

| EIA Ref. | Mitigation Measures | Status |
|----------|--|--|
| | <ul style="list-style-type: none"> ● Appropriate measures to minimise windblown litter and dust during transportation of waste by either covering trucks or by transporting wastes in enclosed containers ● A recording system for the amount of wastes generated, recycled and disposed of (including the disposal sites) ● Regular cleaning and maintenance systems, sumps and oil interceptors ● Separation of chemical wastes for special handling and appropriate treatment | <p>^</p> <p>^</p> <p>^</p> <p>^</p> |
| | <p>Waste Reduction Measures</p> <p>Good management and control can prevent the generation of a significant amount of waste. Waste reduction is best achieved at the planning and design stage, as well as by ensuring the implementation of good site practices. Recommendations to achieve waste reduction include:</p> <ul style="list-style-type: none"> ● Sort C&D waste from demolition of the remaining structures to recover recyclable portions such as metals ● Segregation and storage of different types of waste in different containers, skips or stockpiles to enhance reuse or recycling of materials and their proper disposal ● Encourage collection of aluminium cans, PET bottles and paper by providing separate labelled bins to enable these wastes to be segregated from other general refuse generated by the work force ● Any unused chemicals or those with remaining functional capacity should be recycled ● Proper storage and site practices to minimise the potential for damage or contamination of construction materials ● Plan and stock construction materials carefully to minimize amount of waste generated and avoid unnecessary generation of waste ● Training should be provided to workers about the concepts of site cleanliness and appropriate waste management procedures, including waste reduction, reuse and recycle. | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |

| EIA Ref. | Mitigation Measures | Status |
|----------------------------------|---|--|
| <p>S3.5 (AEIAR-130/2009)</p> | <p>Construction and Demolition Materials</p> <p>Mitigation measures and good site practices should be incorporated in the contract document to control potential environmental impact from handling and transportation of C&D material. The mitigation measures include:</p> <ul style="list-style-type: none"> ● Where it is unavoidable to have transient stockpiles of C&D material within the Project work site pending collection for disposal, the transient stockpiles shall be located away from waterfront or storm drains as far as possible. ● Open stockpiles of construction materials or construction wastes on-site should be covered with tarpaulin or similar fabric. ● Skip hoist for material transport should be totally enclosed by impervious sheeting. ● Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving a construction site. ● The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores. ● The load of dusty materials carried by vehicle leaving a construction site should be covered entirely by clean impervious sheeting to ensure dust materials do not leak from the vehicle. ● All dusty materials should be sprayed with water prior to any loading, unloading or transfer operation so as to maintain the dusty materials wet. ● The height from which excavated materials are dropped should be controlled to a minimum practical height to limit fugitive dust generation from unloading. <p>When delivering inert C&D material to public fill reception facilities, the material should consist entirely of inert construction waste and of size less than 250mm or other sizes as agreed with the Secretary of the Public Fill Committee. In order to monitor the disposal of the surplus C&D material at the designed public fill reception facility and to control fly tipping, a trip-ticket system as stipulated in the ETWB TCW No. 31/2004 “Trip Ticket</p> | <p>^</p> <p>*</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |

| EIA Ref. | Mitigation Measures | Status |
|--|---|--|
| | System for Disposal of Construction and Demolition Materials” should be included as one of the contractual requirement sand implemented by an Environmental Team undertaking the Environmental Monitoring and Audit work. An Independent Environmental Checker should be responsible for auditing the results of the system. | |
| S3.5 (AEIAR-130/2009) | <p>General Refuse</p> <p>General refuse should be stored in enclosed bins or compaction units separate from C&D material. A licensed waste collector should be employed by the contractor to remove general refuse from the site, separately from C&D material. Effective collection and storage methods (including enclosed and covered area) of site wastes would be required to prevent waste materials from being blown around by wind, wastewater discharge by flushing or leaching into the marine environment, or creating odour nuisance or pest and vermin problem</p> | * |
| Construction Landscape and Visual | | |
| S3.8.12 (AEIAR-130/2009) and S7.9 (AEIAR-170/2013) | <ul style="list-style-type: none"> ● Minimized construction area and contractor’s temporary works areas. ● All existing trees should be carefully protected during construction. ● Trees unavoidably affected by the works should be transplanted where practical. Detailed transplanting proposal will be submitted to relevant government departments for approval in accordance with ETWBC 2/2004 and 3/2006. Final locations of transplanted trees should be agreed prior to commencement of the work. ● Control of night-time lighting. ● Erection of decorative screen hoarding. ● Reduction of construction period to practical minimum. ● Limitation of / Ensuring no run-off into surrounding landscape and adjacent seawater areas. ● Temporary or advance landscape should be provided along the temporary access roads to the Cruise Terminal until such time as road D3 is open. | <p>^</p> <p>^</p> <p>^</p> <p>N/A(1)</p> <p>^</p> <p>^</p> <p>^</p> <p>N/A</p> |

| | | |
|---|---|---|
| Remarks: | EIA Report (AEIAR-130/2009) – Kai Tak Development | |
| | EIA Report (AEIAR-170/2013) – Kai Tak Development – Roads D3A & D4A | |
| | ^ Compliance of mitigation measure; | X Non-compliance of mitigation measure; |
| | N/A Not Applicable at this stage; N/A(1) Not observed; | • Non-compliance but rectified by the contractor; |
| * Recommendation was made during site audit but improved/rectified by the contractor. | | |

APPENDIX C
SITE AUDIT SUMMARY

Appendix C Summary of Observation and Recommendation Made during Site Inspection

Summary of Observation and Recommendation Made during Site Inspection in January–March 2019

| Parameters | Date | Observations and Recommendations | Follow-up |
|-----------------------------------|------------------|---|---|
| <i>Water Quality</i> | 27 February 2019 | <u>Reminder:</u> Ponding within landscape deck at Urban Room B should be checked regularly. | The condition was observed to be improved/rectified by the contractor during the audit session on 6 March 2019. |
| <i>Air Quality</i> | 24 January 2019 | <u>Reminder:</u> To properly cover the dusty material at Urban Room C. | The condition was observed to be improved/rectified by the contractor during the audit session on 30 January 2019. |
| | 13 February 2019 | <u>Reminder:</u> Proper labels should be displayed on NRMMS. | The condition was observed to be improved/rectified by the contractor during the audit session on 20 February 2019. |
| | 20 February 2019 | <u>Reminder:</u> The contractor should cover the stockpile at Outfall A. | The condition was observed to be improved/rectified by the contractor during the audit session on 27 February 2019. |
| | 20 March 2019 | <u>Reminder:</u> The stockpile should be completely covered by impervious materials. | The condition was observed to be improved/rectified by the contractor during the audit session on 27 March 2019. |
| | 20 March 2019 | <u>Reminder:</u> Proper labels should be displayed on NRMMS. | The condition was observed to be improved/rectified by the contractor during the audit session on 27 March 2019. |
| <i>Noise</i> | -- | -- | -- |
| <i>Waste/ Chemical Management</i> | 13 February 2019 | <u>Reminder:</u> General refuse accumulation should be avoided. | The condition was observed to be improved/rectified by the contractor during the audit session on 20 February 2019. |
| | 27 February 2019 | <u>Reminder:</u> The accumulation of general refuse near site office and T junction should be avoided. | The condition was observed to be improved/rectified by the contractor during the audit session on 6 March 2019. |
| <i>Landscape and Visual</i> | -- | -- | -- |
| <i>Permits/ Licences</i> | -- | -- | -- |

APPENDIX D
WASTE GENERATED QUANTITY

APPENDIX E
SUMMARY OF EXCEEDANCES

Contract No. KL/2014/01

Kai Tak Development –Stage 2 Infrastructure Works for Developments at the Southern Part of the Former Runway

Appendix E – Summary of Exceedance

Exceedance Record for Contract No. KL/2014/01

Report period: January 2019 to March 2019

(A) Exceedance Record for Construction Noise

(NIL in the reporting period)

(B) Exceedance Record for Landscape and Visual

(NIL in the reporting period)

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix C

Monthly EM&A Report

For

Contract No. KL/2014/03

**Kai Tak Development - Stage 3 Infrastructure Works for Developments at the
Southern Part of the Former Runway**

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



QUARTERLY EM&A REPORT

December 2018 – February 2019

Client : Civil Engineering and Development
Department, HKSAR

Contract No. : KLN/2015/07

Contract Name : Environmental Monitoring Works for
Contract KL/2014/03 – Kai Tak Development
– Stage 3 Infrastructure Works for Developments
at the Southern Part of the Former Runway

Report No. : 0405/15/ED/1167A

EP-337/2009 New Distributor Roads Serving the Planned Kai Tak
Development Area

EP-339/2009/A Decommissioning of the Remaining Parts (Ex-GFS
Building, Radar Station and Hong Kong Aviation Club)
of the former Kai Tak Airport

EP-451/2013 Trunk Road T2

Prepared by : Toby K. H. Wan

Reviewed by : Alfred Y. S. Lam

Certified by : 
Colin K. L. Yung
Environmental Team Leader
Fugro Technical Services Limited

Ref.: CEDKTDS3EM00_0_0375L.19

25 March 2019

Hyder-Meinhardt Joint Venture
17/F, Two Harbour Square,
180 Wai Yip Street, Kwun Tong
Kowloon, Hong Kong

By Post and Email

Attention: Mr. Wong W K, Chris

Dear Mr. Wong,

Re: Contract No. KL/2014/03 – Kai Tak Development – Stage 3 Infrastructure Works for Developments at the Southern Part of the Former Runway Quarterly EM&A Report for December 2018 to February 2019

Reference is made to the Environmental Team's submission of the Quarterly EM&A Report for December 2018 to February 2019 (Report No. 0405/15/ED/1167A) we received by e-mail on 25 March 2019.

Please be informed that we have no adverse comment on the captioned report.

Thank you for your attention. Please do not hesitate to contact us should you have any queries.

Yours sincerely,
For and on behalf of
Ramboll Hong Kong Limited



F. C. Tsang
Independent Environmental Checker

c.c. CEDD
Fugro
CRBC

Attn.: Ms. Amy Chu
Attn.: Mr. Colin K. L. Yung
Attn.: Mr. Dickey Yau

Fax: 2369 4980
By email
Fax: 2283 1689

Q:\Projects\CEDKTDS3EM00\02_Proj_Mgt\02_Corr\CEDKTDS3EM00_0_0375L.19.docx

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



TABLE OF CONTENTS

| | |
|--|-----------|
| EXECUTIVE SUMMARY | 1 |
| 1. INTRODUCTION | 2 |
| 2. SUMMARY OF EM&A REQUIREMENTS AND MONITORING RESULTS | 4 |
| 3. LANDSCAPE AND VISUAL | 6 |
| 4. WASTE MANAGEMENT | 7 |
| 5. SITE INSPECTION | 8 |
| 6. ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE | 10 |
| 7. IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES | 12 |
| 8. CONCLUSIONS | 13 |

FIGURES

| | |
|----------|------------------------------------|
| Figure 1 | Project General Layout |
| Figure 2 | Air and Noise Monitoring Locations |

LIST OF APPENDICES

| | |
|------------|---|
| Appendix A | Construction Programme |
| Appendix B | Project Organization Chart |
| Appendix C | Action and Limit Levels for Air Quality and Noise |
| Appendix D | Graphical Presentation of Monitoring Data |
| Appendix E | Waste Flow Table |
| Appendix F | Environmental Mitigation Implementation Schedule (EMIS) |

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



EXECUTIVE SUMMARY

- i. The Civil Engineering and Development Department HKSAR has appointed Fugro Technical Services Limited (FTS) to undertake the Environmental Team services for the Project and implement the EM&A works.
- ii. This is the twelfth Quarterly EM&A Report presents the environmental monitoring and audit works for the period between 1 December 2018 and 28 February 2019. As informed by the Contractor, major activities in the reporting period included:

| December 2018 | January 2019 | February 2019 |
|--|--|--|
| <ul style="list-style-type: none">• Excavation and laying of drainage pipe and manhole;• Excavation and ELS construction.• Construction of SUS structure; and• Construction of District Cooling System. | <ul style="list-style-type: none">• Excavation and laying of drainage pipe and manhole;• Excavation and ELS construction.• Construction of SUS structure; and• Construction of District Cooling System. | <ul style="list-style-type: none">• Excavation and laying of drainage pipe and manhole;• Excavation and ELS construction.• Construction of SUS structure; and• Construction of District Cooling System. |

Breaches of the Action and Limit Levels

- iii. No Action and Limit Level exceedance for 24-hr TSP and noise was recorded in the reporting period at all monitoring stations.

Complaint, Notification of Summons and Successful Prosecution

- iv. No environmental complaint and no notification of summons and successful prosecution were received in the reporting period.



1. INTRODUCTION

1.1 Background

1.1.1 The Kai Tak Development is located in the south-eastern part of Kowloon Peninsula of the HKSAR, comprising the apron and runway areas of the former Kai Tak Airport and existing waterfront areas at To Kwa Wan, Ma Tau Kok, Kowloon Bay, Kwun Tong and Cha Kwo Ling.

1.1.2 Contract No. KL/2014/03 is the works package to construct an approximately 420m long supporting underground structure (SUS) underneath Shing Cheong Road and Cheung Yip Street. The EM&A programme under this Contract is governed by three EPs (EP-337/2009, EP-339/2009/A and EP-451/2013) and two EM&A Manuals (AEIAR-130/2009 and AEIAR-174/2013). The Works to be executed under this Contract and corresponding EPs include but not be limited to the following main items:

EP-451/2013 – Trunk Road T2

(i) Construction of approximately 420m long supporting underground structure (SUS) including diaphragm walls, barrettes, piled foundation, top and bottom slabs, end wall and adits underneath Shing Cheong Road and Cheung Yip Street;

EP-337/2009 – New Distributor Roads Serving the Planned Kai Tak Development

- (ii) Widening and re-alignment of Cheung Yip Street of approximately 330m long and associated footpaths;
- (iii) Demolition, reconstruction and widening of Shing Cheong Road of approximately 410m long and associated footpaths;
- (iv) Construction of drainage outfall and modification of existing seawall;
- (v) Construction of ancillary works including surface drainage, sewerage, water, fire fighting, street lighting, street furniture, road marking, road signage, utilities and services, irrigation and landscape works.

EP-339/2009/A – Decommissioning of the Remaining Parts (Ex-GFS Building, Radar Station and Hong Kong Aviation Club) of the former Kai Tak Airport

(vi) Demolition of RADAR Tower and guard house;

Other works not covered by any EP

- (vii) Construction of two subways between Phase II of New Acute Hospital (Site A) and Hong Kong Children's Hospital (Site C), and between Phase I of New Acute Hospital (Site B) and Site C;
- (viii) Construction of District Cooling System (DCS) along Cheung Yip Street and Shing Cheong Road

1.1.3 The location and boundary of the site is shown in **Figure 1**.

1.1.4 This Quarterly EM&A report is required under Section 16.1.2 and 16.7.1 of the EM&A Manual AEIAR-130/2009. It is to report the results and findings of the EM&A programme required in the EM&A Manual.

1.1.5 This is the twelfth Quarterly EM&A Report which summaries the impact monitoring results and audit findings for the Project within the period between 1 December 2018 and 28 February 2019.



1.2 Project Organization

1.2.1 The project proponent was the Civil Engineering and Development Department, HKSAR (CEDD). Hyder Meinhardt Joint Venture (HMJV) was commissioned by CEDD as the Engineer for the Project. Ramboll Hong Kong Limited was commissioned as the Independent Environmental Checker (IEC). China Road and Bridge Corporation (Hong Kong) (CRBC) was appointed as the main contractor for the construction works under the contract KL/2014/03. Fugro Technical Services Limited (FTS) was appointed as the Environmental Team (ET) by CEDD to implement the EM&A programme for the Project.

1.2.2 The organization structure is shown in **Appendix B**. The key personnel contact names and numbers for the Project are summarized in **Table 1.1**.

Table 1.1 Contact Information of Key Personnel

| Party | Position | Name | Telephone | Fax |
|----------------------------------|-----------------------------------|--------------------------|-----------|-----------|
| Project Proponent (CEDD) | Co-ordinator | Ms. Amy Chu | 3106 3172 | 2369 4980 |
| Engineer's Representative (HMJV) | Chief Resident Engineer | Mr. W. K., Chris Wong | 3742 3803 | 3742 3899 |
| IEC (Ramboll Hong Kong Limited) | Independent Environmental Checker | Mr. F. C. Tsang | 3465 2851 | 3465 2899 |
| Main Contractor (CRBC) | Site Agent | Mr. Yau Kwok Kiu, Dickey | 5699 4503 | 2283 1689 |
| | Environmental Officer | Mr. Kola Lam | 55454625 | 2283 1689 |
| ET (FTS) | Environmental Team Leader | Mr. Colin Yung | 3565 4114 | 3565 4160 |

1.3 Construction Programme and Activities

1.3.1 The construction of the Project commenced in February 2016 and is expected to complete in 2020. The construction programme is shown in **Appendix A**. A summary of the major construction activities undertaken in the reporting period were:

| December 2018 | January 2019 | February 2019 |
|---|---|---|
| <ul style="list-style-type: none"> • Excavation and laying of drainage pipe and manhole; • Excavation and ELS construction. • Construction of SUS structure; and • Construction of District Cooling System. | <ul style="list-style-type: none"> • Excavation and laying of drainage pipe and manhole; • Excavation and ELS construction. • Construction of SUS structure; and • Construction of District Cooling System. | <ul style="list-style-type: none"> • Excavation and laying of drainage pipe and manhole; • Excavation and ELS construction. • Construction of SUS structure; and • Construction of District Cooling System. |



2. SUMMARY OF EM&A REQUIREMENTS AND MONITORING RESULTS

2.1 Monitoring Requirement

In accordance with the approved EM&A Manuals, 24-hour Total Suspended Particulates (TSP) level and Leq (30min) at the designated monitoring stations is required. Impact 24-hour TSP monitoring should be carried out at least once every 6 days. In case of complaints, 1-hour TSP monitoring should be carried out at least 3 times per 6 days when the highest dust impacts are likely to occur. Leq (30min) monitoring is conducted for at least once a week during the construction phase between 0700 and 1900 on normal weekdays. The Action and Limit Levels of the air quality monitoring and noise monitoring are given in **Appendix C**

2.2 Monitoring Locations

- 2.2.1 According to the EM&A Manual, three monitoring locations for air quality monitoring and noise monitoring, namely KTD1, KTD2 and KER1, are covered by this Contract within the South Apron Area of Former Kai Tak Airport. The other two air quality monitoring locations and two noise monitoring locations which are identified in Cha Kwo Ling area, are farther than 500m and 300m away from the site boundary respectively and thus not covered by this Contract. The monitoring works in Cha Kwo Ling area are covered by other Contract(s) respectively.
- 2.2.2 According to the approved alternative baseline air quality and noise monitoring locations (EPD reference: () in EP2/K19/A/21 pt.5), the original monitoring locations (KTD1, KTD2 and KER1) are proposed to be replaced by alternative monitoring locations (KTD1a, KTD2a and KER1a).
- 2.2.3 According to the approved relocation of monitoring location KER1a (EPD reference: () in EP2/K19/A/21 pt.5), the monitoring location KER1a are proposed to be relocated by alternative monitoring locations KER1b.
- 2.2.4 According to the approved relocation of monitoring location KTD2a (EPD reference: () in EP2/K19/A/21 Pt.6), the monitoring location KTD2a are proposed to be relocated by alternative monitoring locations KTD2b.
- 2.2.5 The most updated locations are summarized in **Table 2.1** and shown in **Figure 2**.

Table 2.1 Location of Air Quality Monitoring and Noise Monitoring Station

| Monitoring Station | Location |
|--------------------|---|
| KTD1a | Centre of Excellence in Paediatrics (Children’s Hospital) |
| KTD2b | G/IC Zone next to Kwun Tong Bypass (Next to the site of the New Acute Hospital) |
| KER1b | Site Boundary at Cheung Yip Street |

2.3 Results and Observations

- 2.3.1 No Action and Limit Level exceedance for 24-hr TSP was recorded in the reporting period at all monitoring stations.
- 2.3.2 No Action / Limit Level exceedance for construction noise was recorded in the reporting period at all monitoring stations.
- 2.3.3 No raining and wind with speed over 5 m/s was observed during noise monitoring according to the onsite observation.



2.3.4 During the reporting period, major dust sources including loading and unloading of C&D wastes, vehicles movement were observed in the site. Major noise sources including noise emission from plant & PME and some other construction activities, travel of vehicles, loading and unloading of C&D waste were observed in the site. Non-project related construction activities at the nearby construction site and road traffic along Shing Cheong Road, Cheung Yip Street and the Kwun Tong By-pass were observed. The above factors may affect the monitoring results.

2.3.5 Graphical presentation of the monitoring data in the reporting period is presented in **Appendix D**.

2.4 Comparison of Monitoring Results with EIA Predictions

2.4.1 The monitoring data was compared with the EIA predictions as summarized in **Table 2.2** and **Table 2.3**.

Table 2.2 Comparison of 24-hr TSP data with EIA predictions

| Monitoring Station | Receiver Reference | Predicted Maximum 24-hour TSP Concentration (µg/m ³) | 24-hour TSP concentration in Reporting Period (µg/ m ³) | | | Average 24-hour TSP concentration in Reporting Period (µg/ m ³) | | |
|--------------------|--------------------|--|---|----------|----------|---|----------|----------|
| | | | Dec 2018 | Jan 2019 | Feb 2019 | Dec 2018 | Jan 2019 | Feb 2019 |
| KTD1a | KTD3 | 126 | 34 - 88 | 38 - 113 | 52 - 97 | 58 | 63 | 83 |
| KTD2b | - | - | 46 - 115 | 53 - 113 | 40 - 103 | 92 | 83 | 72 |
| KER1b | KTD6 | 169 | 48 - 132 | 9 - 83 | 48 - 146 | 88 | 53 | 78 |

Note:

For KTD2b, there was no receiver reference in the EIA report, EIAR-174/2013.

Predicted Maximum TSP Concentration extracted from Table 4.14 of EIA Report, EIAR-174/2013.

Table 2.3 Comparison of Noise Monitoring data with EIA predictions

| Monitoring Station | Receiver Reference | Maximum Predicted Mitigated Construction Noise Level, dB(A) | Leq (30min) dB(A) in Reporting Period | | |
|--------------------|--------------------|---|---------------------------------------|----------|----------|
| | | | Dec 2018 | Jan 2019 | Feb 2019 |
| KTD1a | KTD1 | 74 | 65 - 71 | 69 - 74 | 57 - 71 |
| KTD2b | KTD2 | 75 | 68 - 71 | 66 - 74 | 61 - 75 |
| KER1b | KER1 | 75 | 69 - 70 | 69 - 75 | 64 - 71 |

Note:

Maximum Predicted Mitigated Construction Noise Level extracted from Table 5.13 of EIA Report, EIAR-174/2013.

2.4.2 The 24-hour TSP monitoring results at KTD1a and KER1b in the reporting months did not exceed the Predicted Maximum 24-hour TSP Concentration in the approved Environmental Impact Assessment (EIA) Report and no Action / Limit Level exceedance was recorded in the reporting period.

2.4.3 The noise monitoring results in the reporting months did not exceed the Maximum Predicted Mitigated Construction Noise Level in the approved Environmental Impact Assessment (EIA) Report and no Action / Limit Level exceedance was recorded in the reporting period.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



3. LANDSCAPE AND VISUAL

3.1 Results and Observations

- 3.1.1 To monitor and audit the implementation of landscape and visual mitigation measures, 13 weekly Landscape and Visual Site audits were carried out and 7 of them were carried out by a Registered Landscape Architect. The weekly Landscape and Visual Impact reports were counter-signed by IEC as according to the requirement of EM&A Manual (AEIAR-130/2009).
- 3.1.2 No non-compliance was recorded in the weekly Landscape and Visual Site audits in the reporting period.
- 3.1.3 Observations and recommendations during site audits are summarized in **Table 5.1**.



4. WASTE MANAGEMENT

4.1 Results and Observations

- 4.1.1 C&D materials and wastes sorting were carried out on site. Receptacles were available for C&D wastes and general refuse collection.
- 4.1.2 The amount of wastes generated by the site activities in the reporting period is shown in **Appendix E**.
- 4.1.3 The Contractor is advised to properly maintain on site C&D materials and wastes collection, sorting and recording system and maximize reuse / recycle of C&D materials and wastes. The Contractor is reminded to properly maintain the site tidiness and dispose of the wastes accumulated on site regularly and properly.
- 4.1.4 The Contractor is reminded that chemical waste containers should be properly treated and stored temporarily in designated chemical waste storage area on site in accordance with the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes.



5. SITE INSPECTION

5.1 Site Inspection

- 5.1.1 Site inspections were carried out weekly to monitor the implementation of proper environmental pollution control and mitigation measures for the Project. A summary of the mitigation measures implementation schedule is provided in **Appendix F**.
- 5.1.2 In the reporting quarter, 13 site inspections were carried out. 6 of them were the joint inspections with the IEC, ER, the Contractor and the ET.
- 5.1.3 No outstanding issues were reported during the reporting period.
- 5.1.4 All the follow-up actions requested by Contractor’s ET and IEC during the site inspections were undertaken as reported by the Contractor and confirmed in the following weekly site inspection conducted during the reporting month.
- 5.1.5 Details of observations recorded during the site inspections are presented in **Table 5.1**.

Table 5.1 Observations and Recommendations of Site Audit

| Parameters | Date | Observations and Recommendations | Follow-up |
|-------------|------------------|--|---|
| Air Quality | 5 December 2018 | Reminder: Water spray shall be provided during breaking. (Zone 3) | NA |
| | 12 December 2018 | Observation: Dust suppression measures should be applied at haul road. (Zone 1) | The item was rectified by the Contractor and inspected on 19 December 2018. |
| | 19 December 2018 | Reminder: Exposed area should be sprayed with water frequently. | NA |
| | 9 January 2019 | Observation: Muddy trail should be sprayed with water and cleaned up regularly. (Portion I) | The item was rectified by the Contractor and inspected on 16 January 2019. |
| | 23 January 2019 | Reminder: Vehicle washing facilities should be provided at exit point. (Zone 4) | NA |
| | 8 February 2019 | Reminder: Open stockpiles should be avoided or covered. (Zone 4) | NA |

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| Parameters | Date | Observations and Recommendations | Follow-up |
|-------------------------------|------------------|--|-----------|
| | 13 February 2019 | Reminder: The exposed area should be sprayed with fine misting of water frequently. (Zone 4) | NA |
| Noise | 5 December 2018 | Reminder: Noise mitigation measures shall be provided during breaking. (Zone 3) | NA |
| | 9 January 2019 | Reminder: Acoustic fabric should be provided during breaking. (Zone 3&4) | NA |
| | 20 February 2019 | Reminder: Noise mitigation measure should be provided during breaking. (Zone 4) | NA |
| Water Quality | 20 February 2019 | Reminder: Stagnant water inside the U channel should be cleaned regularly. (Zone 2) | NA |
| Chemical and Waste Management | 12 December 2018 | Reminder: Waste should be cleaned up regularly. (zone 1) | NA |
| Land Contamination | | NA | |
| Landscape and Visual Impact | | NA | |
| General | | NA | |



6. ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE

6.1 Environmental Exceedance

6.1.1 No Action and Limit Level exceedance for 24-hr TSP and noise was recorded in the reporting period at all monitoring stations. Number of exceedance in the reporting period was summarized in **Table 6.1**.

Table 6.1 Summary of Exceedance in Reporting Period

| Monitoring Station | | Number of exceedance in the reporting period | | | | | | Total |
|--------------------|----|--|----------|----------|-------------------|----------|----------|-------|
| | | 24hr TSP $\mu\text{g}/\text{m}^3$ | | | Leq (30min) dB(A) | | | |
| | | Dec 2018 | Jan 2019 | Feb 2019 | Dec 2018 | Jan 2019 | Feb 2019 | |
| KTD1a | AL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | LL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| KTD2b | AL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | LL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| KER1b | AL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | LL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Total | AL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | LL | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

6.2 Complaints, Notification of Summons and Prosecution

6.2.1 No inspection notice, notification of summons or prosecution was received in this reporting period. Cumulative complaint log, summaries of complaints, notification of summons and successful prosecutions are presented in **Table 6.2, 6.3 and 6.4**.

Table 6.2 Environmental Complaints Log

| Reference No. | Date of Complaint Received | Received From | Received By | Nature of Complaint | Date of Investigation | Outcome | Date of Reply |
|----------------------|----------------------------|---------------|------------------|---------------------|-----------------------|---------------------|---------------|
| 20161207_complaint_c | 7 Dec 2016 | EPD | Andy Choy (CRBC) | Air | 13 Feb 2017 | Project-related | 13 Feb 2017 |
| 20170209_complaint_c | 9 Feb 2017 | EPD | Andy Choy (CRBC) | Air | 22 Feb 2017 | Not Project-related | 7 Mar 2017 |
| 20170502_complaint_c | 2 May 2017 | CEDD | Andy Choy (CRBC) | Noise | 4 May 2017 | Not Valid | 22 May 2017 |
| 20170716_complaint_a | 16 Jul 2017 | CEDD | HMJV | Water Quality | 4 Aug 2017 | Not Project-related | 4 Aug 2017 |
| 20180530_complaint | 30 May 2018 | EPD | CRBC | Air | 9 June 2018 | Not Valid | 20 Jun 2018 |



Table 6.3 Cumulative Statistics on Complaints

| Environmental Parameters | Cumulative No. Brought Forward | No. of Complaints in the Reporting Period | | | Cumulative Project-to-Date |
|--------------------------|--------------------------------|---|--------------|---------------|----------------------------|
| | | December 2018 | January 2019 | February 2019 | |
| Air | 3 | 0 | 0 | 0 | 3 |
| Noise | 1 | 0 | 0 | 0 | 1 |
| Water | 1 | 0 | 0 | 0 | 1 |
| Waste | 0 | 0 | 0 | 0 | 0 |
| Total | 0 | 0 | 0 | 0 | 0 |

Table 6.4 Cumulative Statistics on Successful Prosecutions

| Environmental Parameters | Cumulative No. Brought Forward | No. of Complaints This Reporting Period | | | Cumulative Project-to-Date |
|--------------------------|--------------------------------|---|--------------|---------------|----------------------------|
| | | December 2018 | January 2019 | February 2019 | |
| Air | 0 | 0 | 0 | 0 | 0 |
| Noise | 0 | 0 | 0 | 0 | 0 |
| Water | 0 | 0 | 0 | 0 | 0 |
| Waste | 0 | 0 | 0 | 0 | 0 |
| Total | 0 | 0 | 0 | 0 | 0 |

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



7. IMPLEMENTATION STATUS OF ENVIRONMENTAL MITIGATION MEASURES

7.1 Implementation Status

7.1.1 The Contractor has implemented environmental mitigation measures and requirements as stated in the EIA Reports, the EP and the EM&A Manuals. The implementation status of the mitigation measures during the reporting period is summarized in **Appendix F**.



8. CONCLUSIONS

- 8.1.1 No Action and Limit Level exceedance for 24-hr TSP and noise was recorded in the reporting period at all monitoring stations.
- 8.1.2 No complaint of air quality was received. Therefore, no impact 1-hour TSP monitoring was conducted in the reporting period.
- 8.1.3 13 weekly environmental site inspections were carried out in the reporting period. Recommendations on mitigation measures on air quality, noise quality, water quality, chemical and waste management were given to the Contractor for remediating the deficiencies identified during the site inspections.
- 8.1.4 13 weekly Landscape and Visual Site audits were carried out on in the reporting period and 7 of them were carried out by a Registered Landscape Architect in the reporting period. The weekly Landscape and Visual Impact reports were counter-signed by IEC as according to the requirement of EM&A Manual (AEIAR-130/2009). No non-compliance was recorded in the weekly Landscape and Visual Site audits in the reporting period.
- 8.1.5 Referring to the Contractor's information, no notification of summons and successful prosecution was received in the reporting period.

8.2 Comment and Recommendations

- 8.2.1 The recommended environmental mitigation measures, as proposed in the EIA reports and EM&A Manuals shall be effectively implemented to minimize the potential environmental impacts from the Project. The EM&A programme would effectively monitor the environmental impacts generated from the construction activities and ensure the proper implementation of mitigation measures.
- 8.2.2 According to the environmental audit performed in the reporting period, the following recommendations were made:

Air Quality Impact

- Water Spray shall be provided during breaking.
- Dust suppression measures should be applied at haul road.
- Exposed area should be sprayed with water frequently.
- Muddy trail should be sprayed with water and cleaned up regularly.
- Vehicle washing facilities should be provided at exit point.
- Open stockpiles should be avoided or covered.

Construction Noise Impact

- Noise mitigation measures shall be provided during breaking.
- Acoustic fabric should be provided during breaking.

Water Quality Impact

- Stagnant water inside the U channel should be cleaned regularly.

Chemical and Waste Management

- Waste should be cleaned up regularly.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Land Contamination

- No specific observation was identified in the reporting period.

Landscape and Visual Impact

- No specific observation was identified in the reporting period.

General Condition

- No specific observation was identified in the reporting period.

Permit / Licenses

- No specific observation was identified in the reporting period.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Figure 1

Project General Layout



- LEGENDS:**
- SITE BOUNDARY
 - HOSPITAL SITE BOUNDARY
 - PROPOSED SUPPORTING UNDERGROUND STRUCTURE
 - PROPOSED SUBWAYS
 - PROPOSED ROADWORKS
 - PROPOSED DISTRICT COOLING SYSTEM
 - DEMOLITION OF RADAR TOWER

| Rev. | Date | Drawn | Description | Checked | Approved |
|------|------|-------|-------------|---------|----------|
| | | | | | |



CLIENT



土木工程拓展署
Civil Engineering and
Development Department
九龍拓展處
Kowloon Development Office

PROJECT

CONTRACT NO. KL/2014/03
KAI TAK DEVELOPMENT - STAGE 3
INFRASTRUCTURE WORKS FOR
DEVELOPMENTS AT THE SOUTHERN PART OF
THE FORMER RUNWAY


TITLE

GENERAL LAYOUT PLAN

| | | | |
|-------------|--------|--------------|--|
| DESIGNED | | ENG. CHECK | |
| DRAWN | | COORDINATION | |
| DWG. CHECK | | APPROVED | |
| SCALE AT A1 | STATUS | REV | |
| 1 : 1000 | | A | |

Drawing No. **FIGURE 1.0**

© Copyright reserved

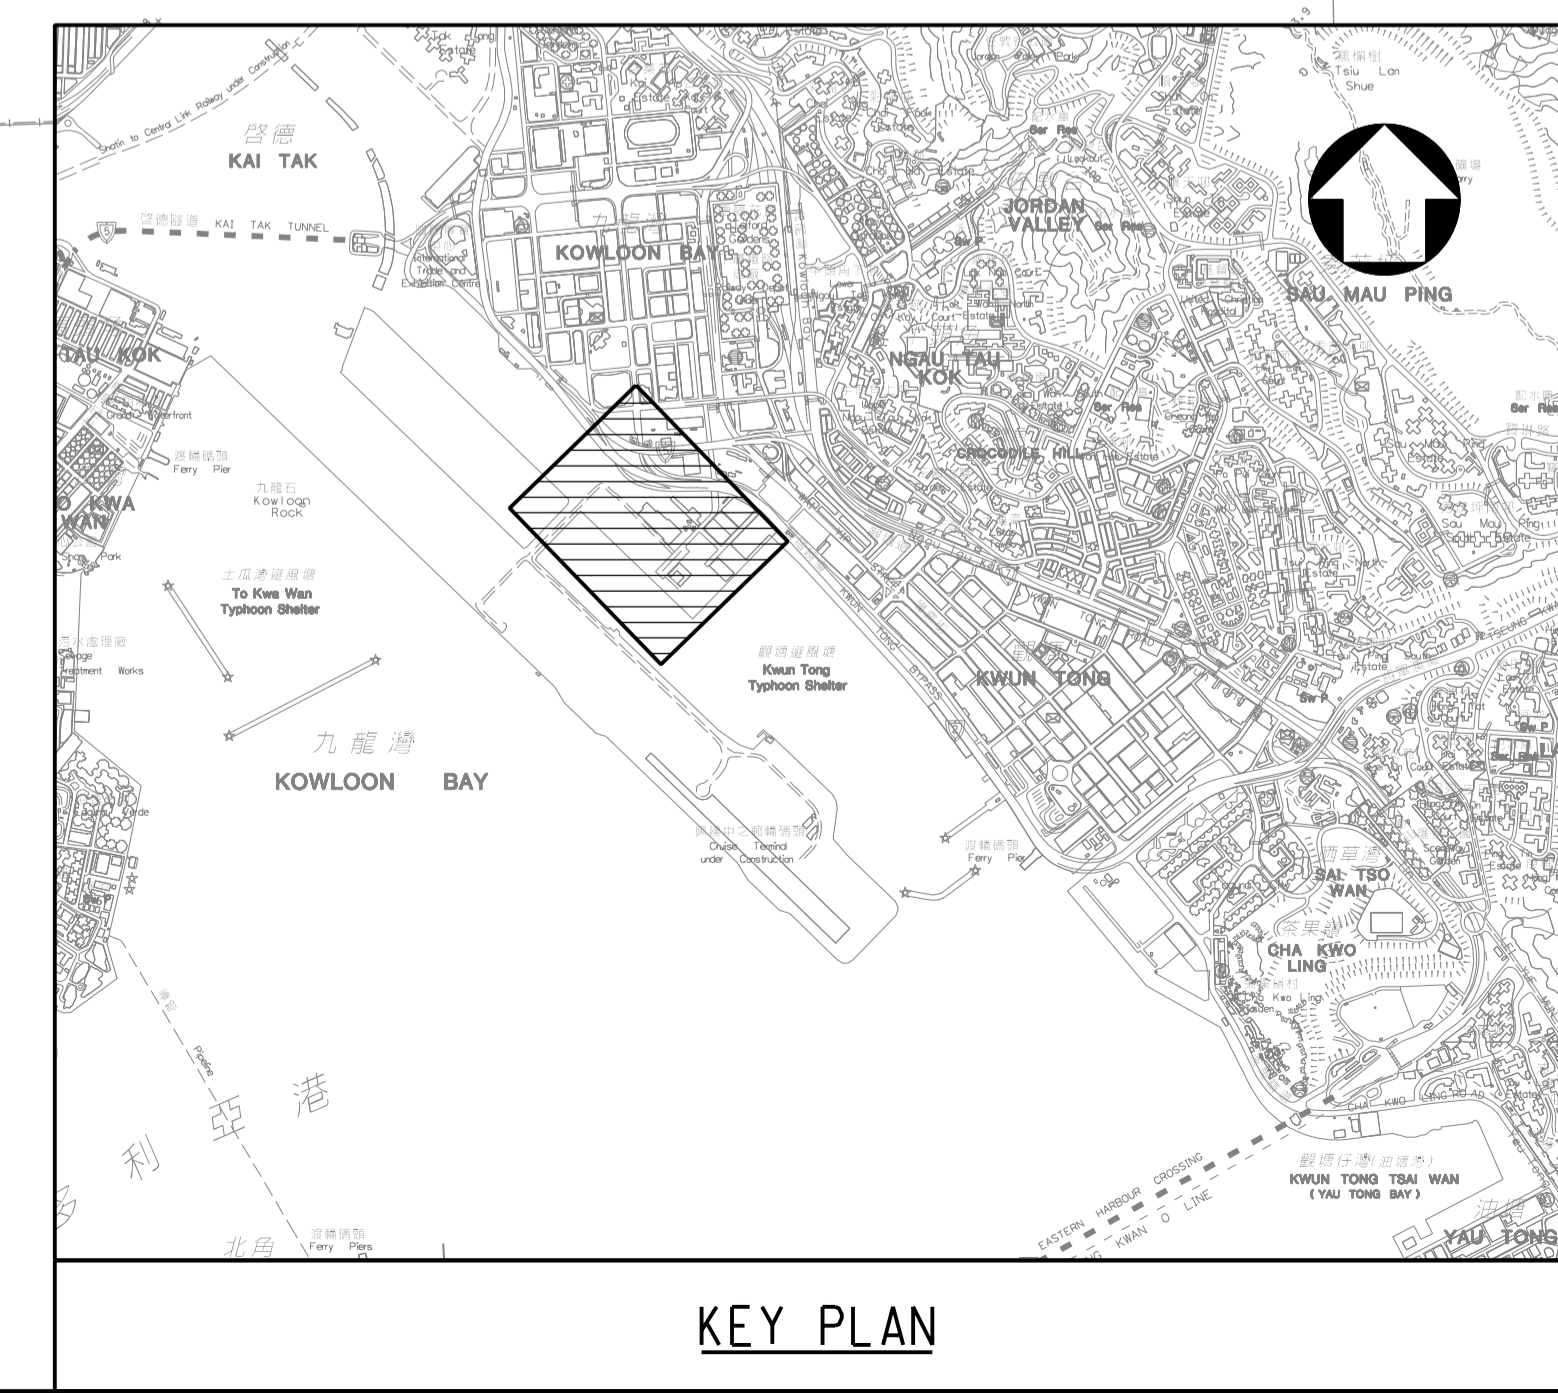

KEY PLAN

PRINTED BY: kitchan 18/2/2015 13:00:43
FILENAME: K:\91164 Trunk Road T2\Tender Drawing (Contract I)\Figure 1.dgn

FUGRO TECHNICAL SERVICES LIMITED


Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Figure 2

Air and Noise Monitoring Locations

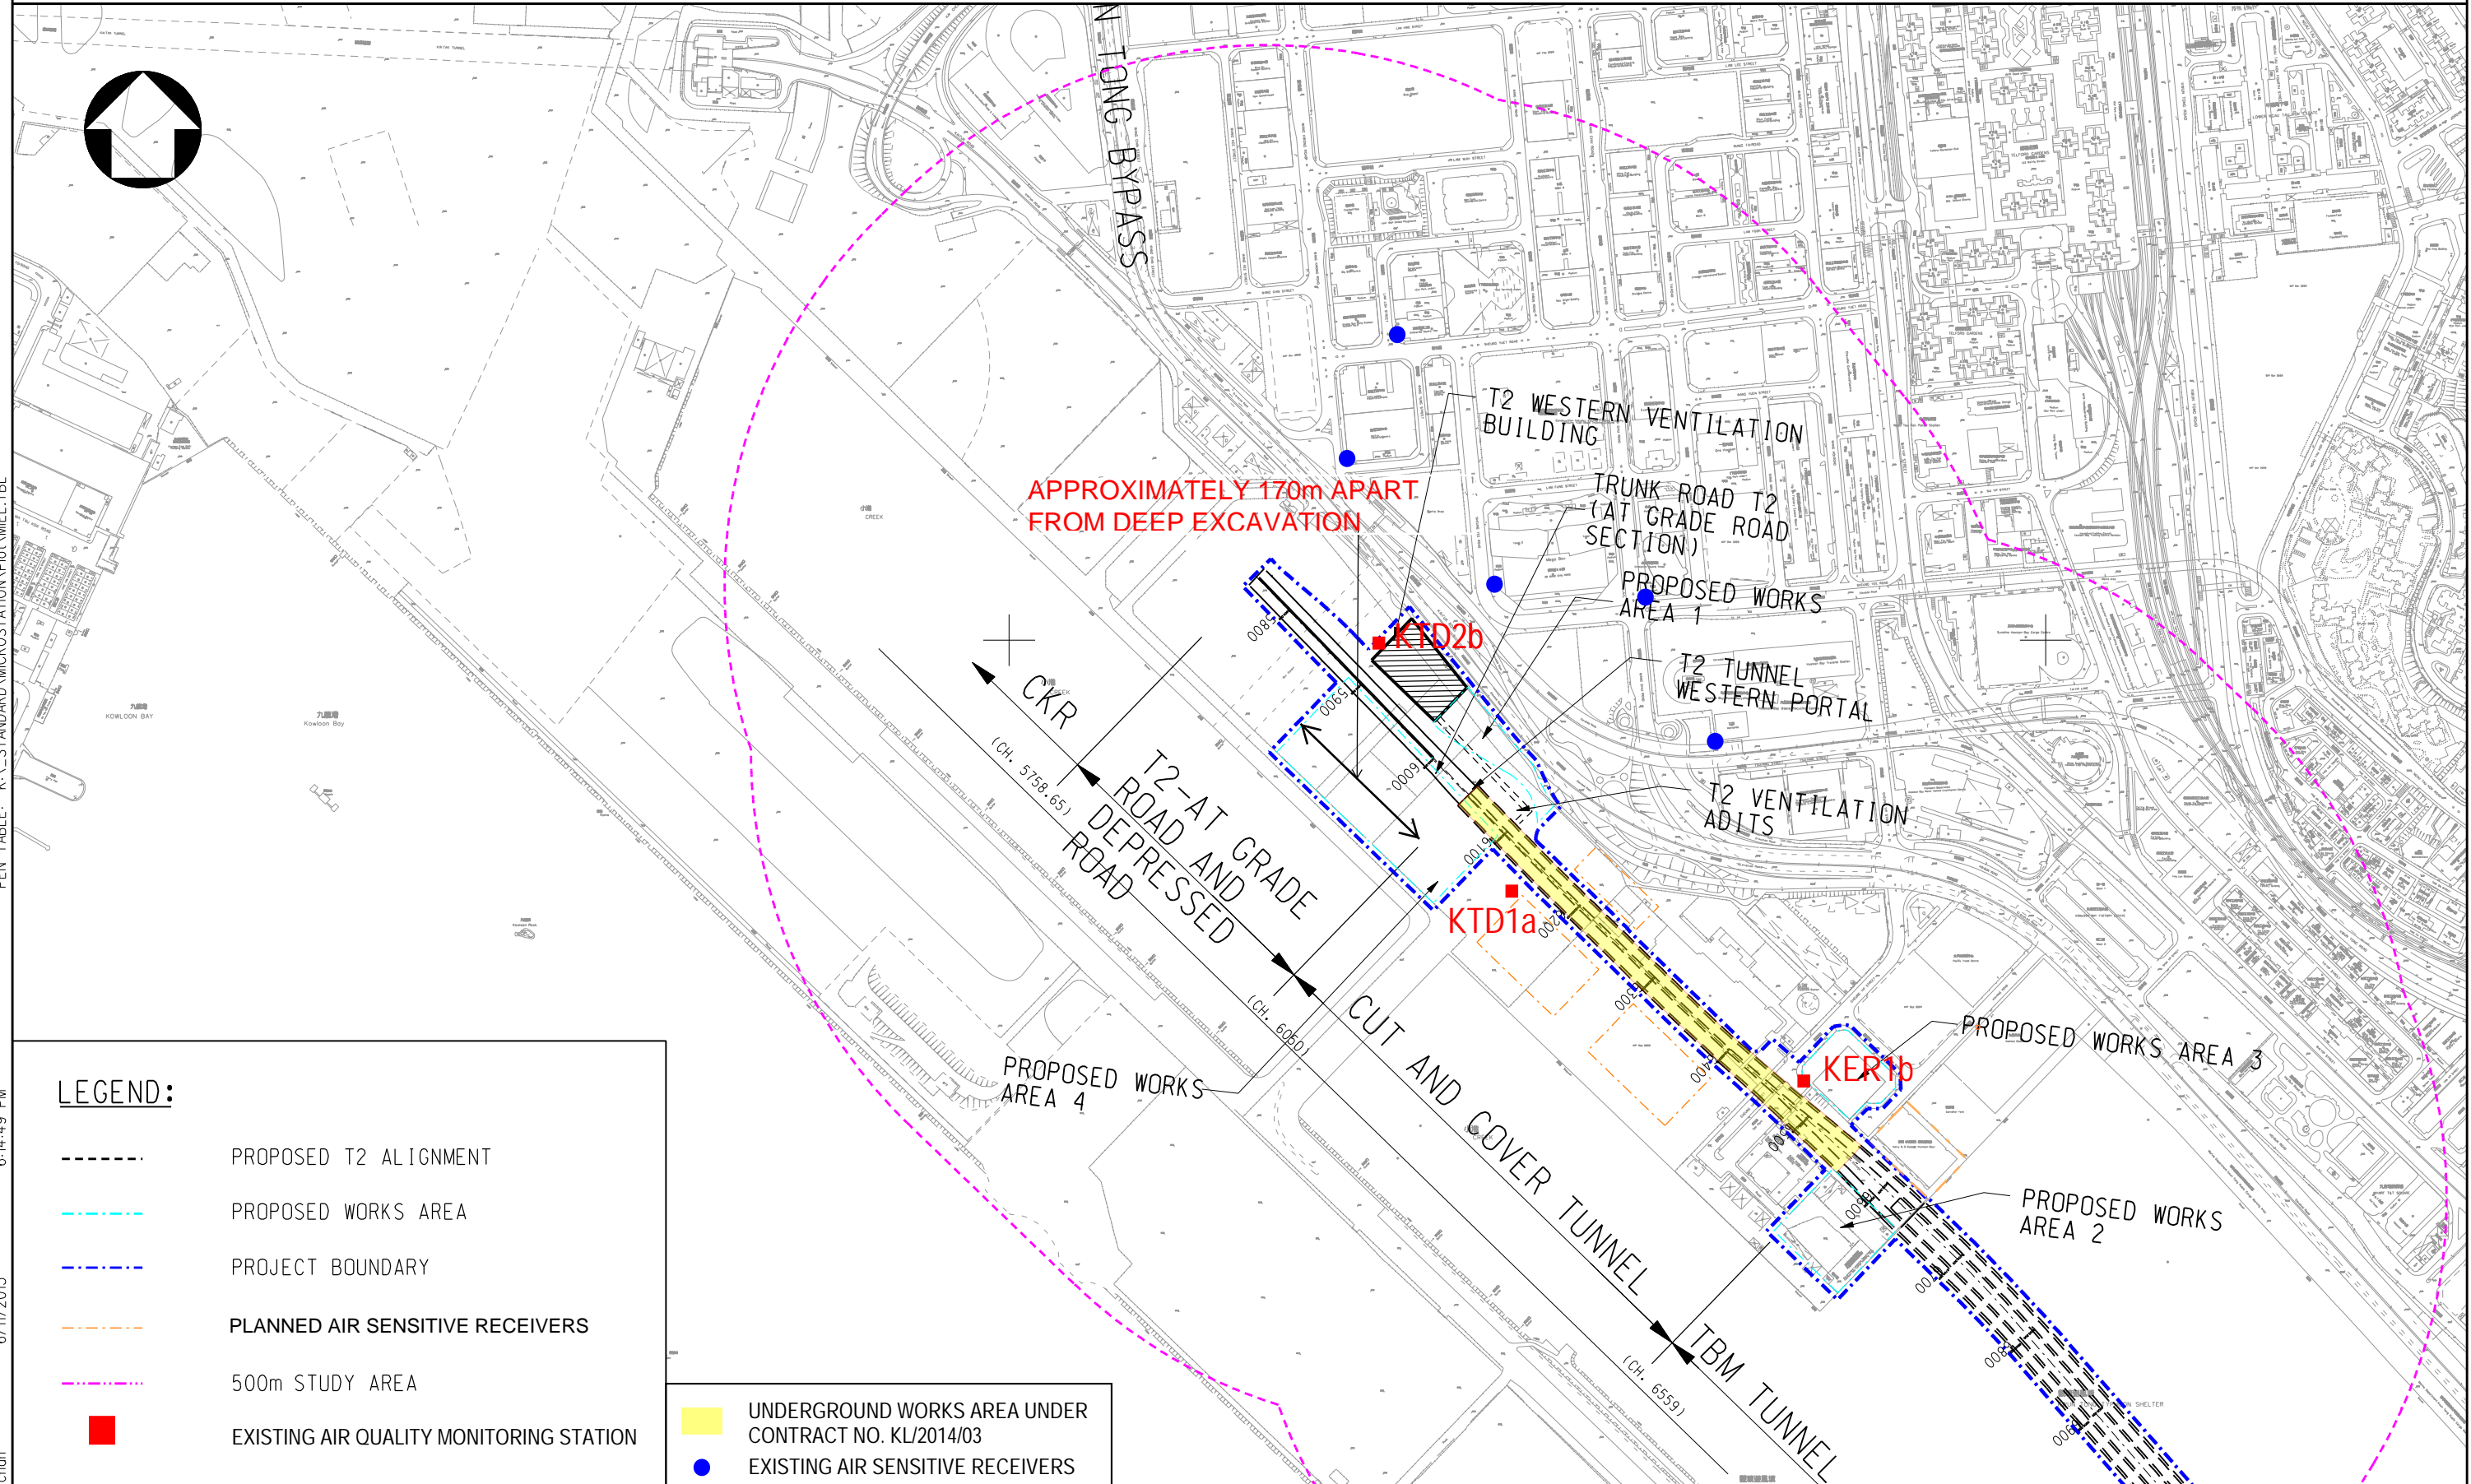

LEGEND:

- PROPOSED T2 ALIGNMENT
- PROPOSED WORKS AREA
- PROJECT BOUNDARY
- PLANNED AIR SENSITIVE RECEIVERS
- 500m STUDY AREA
- EXISTING AIR QUALITY MONITORING STATION
- UNDERGROUND WORKS AREA UNDER CONTRACT NO. KL/2014/03
- EXISTING AIR SENSITIVE RECEIVERS

Drawing title

IDENTIFIED DUST MONITORING STATIONS AT SOUTH APRON OF FORMER KAI TAK AIRPORT

Original Size

A3

Scale 1 : 6000

Date 30/01/2012

File name

© Copyright reserved

Drawing No.


FIGURE 2.1a(revised)

Rev.

--

| Rev. | Description | Date |
|------|-------------|------|
| | | |

PRINTER NAME: PDFCreator
 PLOT_DRV: k:\91164 Trunk Road T2\Cad Admin\A3_colour.plt
 PRINTED BY: kitchen
 PEN_TABLE: K:_STANDARD\MICROSTATION\Plot\MEL.TBL
 6/11/2013 6:14:49 PM

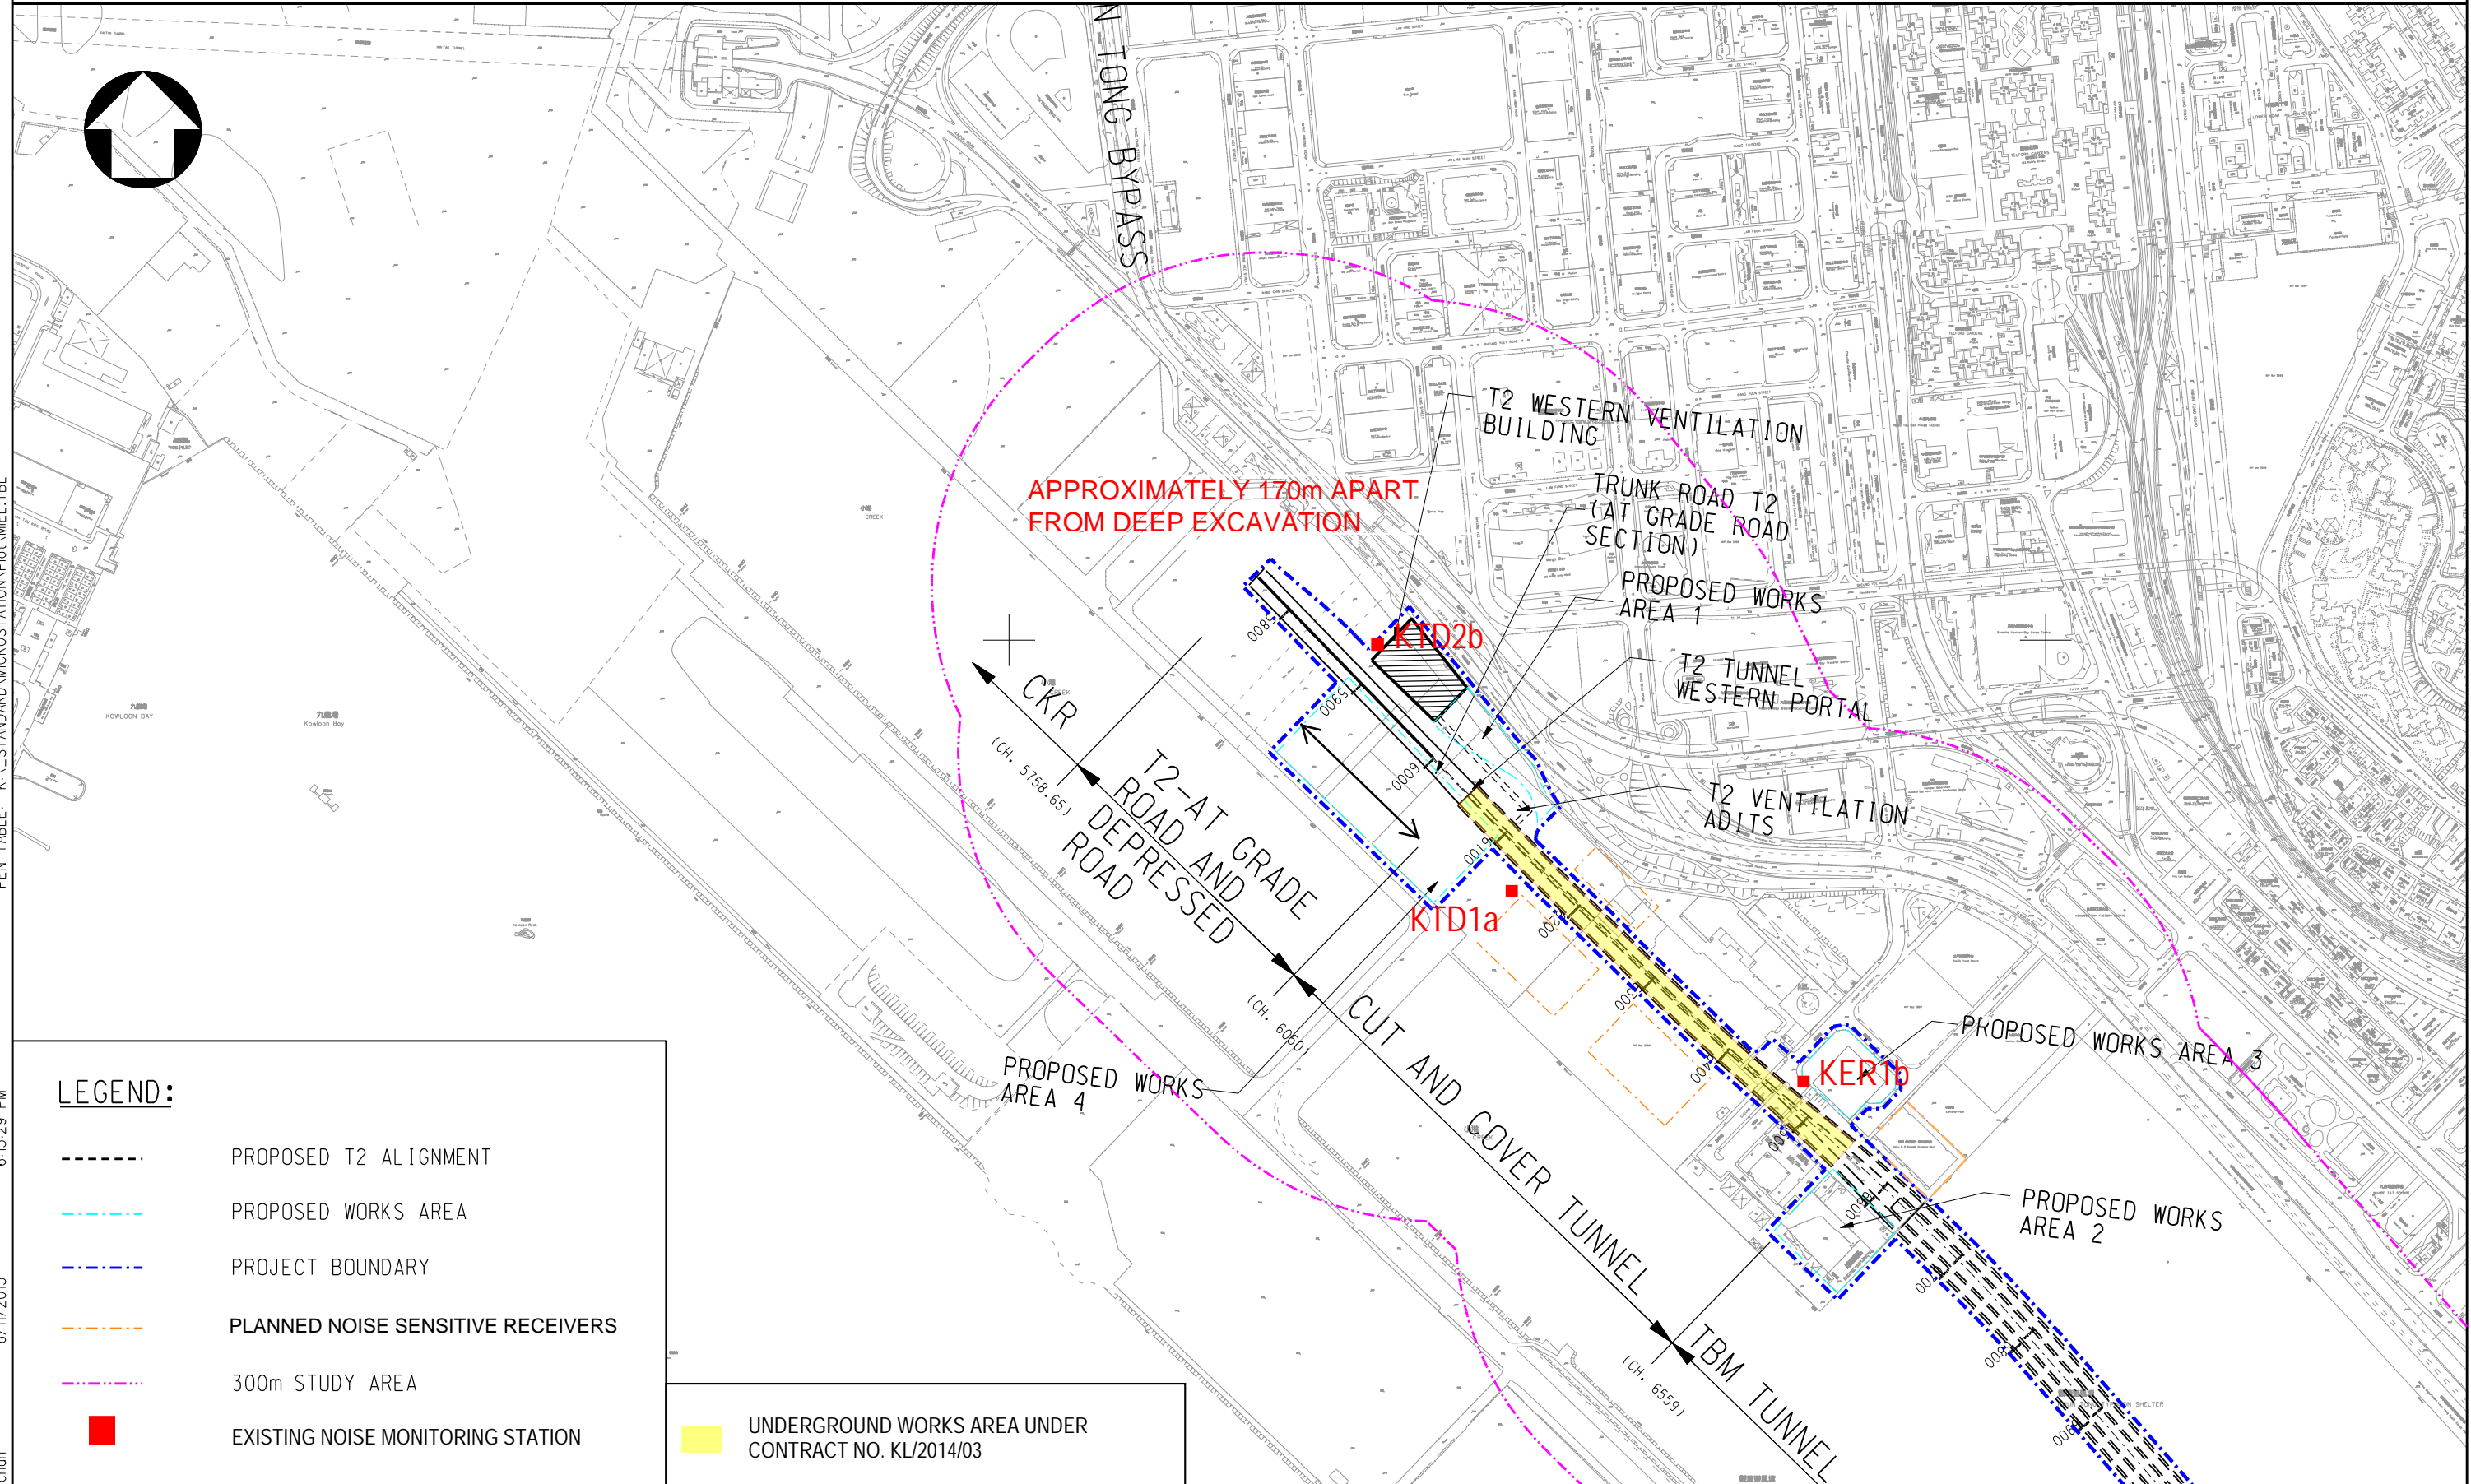

LEGEND:

- PROPOSED T2 ALIGNMENT
- PROPOSED WORKS AREA
- PROJECT BOUNDARY
- PLANNED NOISE SENSITIVE RECEIVERS
- 300m STUDY AREA
- EXISTING NOISE MONITORING STATION

UNDERGROUND WORKS AREA UNDER CONTRACT NO. KL/2014/03

Drawing title

IDENTIFIED NOISE MONITORING STATIONS AT SOUTH APRON OF FORMER KAI TAK AIRPORT

Original Size

A3

Scale

1 : 6000

Date

30/01/2012

File name

© Copyright reserved

Drawing No.

FIGURE 2.2 a (revised)

Rev.

--

| Rev. | Description | Date |
|------|-------------|------|
| | | |

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix A

Construction Programme

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | January | | | | February | | | | March |
|---|---|---------|-------------|------------|----------|----|----|----|----|----------|----|----|----|---------|----|----|----|----------|----|----|---|-------|
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 |
| KL/2014/03-Stage 3 Infrastructure Works for Developments at the Southern Part of the Former Runway | | | | | | | | | | | | | | | | | | | | | | |
| Project Key Dates | | | | | | | | | | | | | | | | | | | | | | |
| Project Completion Date | | | | | | | | | | | | | | | | | | | | | | |
| K-PK-PCD-1400 | Section 4A - Construction of Subway A | 0 | | 31-Jan-19* | | | | | | | | | | | | | | | | | ◆ Section 4A - Construction of Subway A | |
| K-PK-PCD-1500 | Section 4B - Construction of Subway B | 0 | | 03-Jan-19* | | | | | | | | | | | | | | | | | ◆ Section 4B - Construction of Subway B | |
| Site Handover Date | | | | | | | | | | | | | | | | | | | | | | |
| K-PK-SHD-1100 | Portion B | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion B | |
| K-PK-SHD-1200 | Portion B1 | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion B1 | |
| K-PK-SHD-1300 | Portion C | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion C | |
| K-PK-SHD-1400 | Portion D | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion D | |
| K-PK-SHD-1500 | Portion E | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion E | |
| K-PK-SHD-1600 | Portion F | 0 | | 06-Dec-18* | | | | | | | | | | | | | | | | | ◆ Portion F | |
| K-PK-SHD-1700 | Portion H | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion H | |
| K-PK-SHD-1900 | Portion K | 0 | | 31-Dec-18* | | | | | | | | | | | | | | | | | ◆ Portion K | |
| K-PK-SHD-2200 | Portion O | 0 | | 31-Dec-18* | | | | | | | | | | | | | | | | | ◆ Portion O | |
| K-PK-SHD-2300 | Portion P | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion P | |
| K-PK-SHD-2500 | Portion R | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | ◆ Portion R | |
| General Submission | | | | | | | | | | | | | | | | | | | | | | |
| Major Construction Works Method Statement | | | | | | | | | | | | | | | | | | | | | | |
| K-PA-GSP-7455 | Engineer's comments and approval | 7 | 23-Oct-17 A | 06-Dec-18 | | | | | | | | | | | | | | | | | Engineer's comments and approval | |
| K-PA-GSP-7460 | Method statement for Construction of subway A (Bay 1&5) | 3 | 16-Aug-18 A | 02-Dec-18 | | | | | | | | | | | | | | | | | Method statement for Construction of subway A (Bay 1&5) | |
| K-PA-GSP-7465 | Engineer's comments and approval | 28 | 03-Dec-18 | 30-Dec-18 | | | | | | | | | | | | | | | | | Engineer's comments and approval | |
| Temporary Utility Diversion Works | | | | | | | | | | | | | | | | | | | | | | |
| <i>Temporary Diversion for CLP Cable at CH6+560</i> | | | | | | | | | | | | | | | | | | | | | | |
| K-PA-TUD-4100 | Removal of Temporary Support to Utilities at Zone 4 | 15 | 11-Jan-19 | 25-Jan-19 | | | | | | | | | | | | | | | | | Removal of Temporary Support to Utilities at | |
| Temporary Traffic Management | | | | | | | | | | | | | | | | | | | | | | |
| <i>Temp Traffic Arrangement Schemes</i> | | | | | | | | | | | | | | | | | | | | | | |
| K-PA-TTA-8950 | Submission and approval of TTA schemes-TTA stage 4 for re-construction of Shing Cheong Road | 90 | 30-Nov-18 | 27-Feb-19 | | | | | | | | | | | | | | | | | Subm | |
| Materials Procurement (Major Materials) | | | | | | | | | | | | | | | | | | | | | | |
| Water Works | | | | | | | | | | | | | | | | | | | | | | |
| K-PA-MP-1050 | Manufacturing & delivery to site | 45 | 20-Aug-18 A | 13-Jan-19 | | | | | | | | | | | | | | | | | Manufacturing & delivery to site | |

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | | January | | | | | February | | | | | March |
|--|--|---------|-------------|-----------|---|----|----|----|----|----------|----|----|----|----|---------|----|----|----|----|----------|----|----|----|--|-------|
| | | | | | 41 | | | | | 42 | | | | | 43 | | | | | 44 | | | | | 45 |
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 | 03 | | |
| Preliminaries | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-DR-PRE-1800 | Submission of time-lapsed photographs and video | 331 | 20-Feb-16 A | 26-Oct-19 | | | | | | | | | | | | | | | | | | | | | |
| Barge Loading Facilities | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-DR-PRE-1485 | Demolition of the barging point | 13 | 14-Dec-18 | 31-Dec-18 | Demolition of the barging point | | | | | | | | | | | | | | | | | | | | |
| Instrumentation and Monitoring | | | | | | | | | | | | | | | | | | | | | | | | | |
| Tilt Monitoring Tile Plates | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-IM-TMT-1000 | Tilt Monitoring near PWCL | 72 | 25-Apr-16 A | 09-Feb-19 | Tilt Monitoring near PWCL | | | | | | | | | | | | | | | | | | | | |
| Section 1 of the Works-Remainder of the Works | | | | | | | | | | | | | | | | | | | | | | | | | |
| Roadwork and Drainage Works | | | | | | | | | | | | | | | | | | | | | | | | | |
| Road D4-3 (Ching Shung Road) | | | | | | | | | | | | | | | | | | | | | | | | | |
| <i>Zone 2 R & D Works (Stage 1) CH410-CH340</i> | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1030 | DCS at Zone 2 Bay 2 to Bay 4 (CH35 - CH110) | 25 | 14-Dec-18 | 15-Jan-19 | DCS at Zone 2 Bay 2 to Bay 4 (CH35 - CH110) | | | | | | | | | | | | | | | | | | | | |
| SCR1040 | DN250 sewerage (HKCH - FMH24-1E - FMH24-1G) | 21 | 08-Jan-19 | 31-Jan-19 | DN250 sewerage (HKCH - FMH24- | | | | | | | | | | | | | | | | | | | | |
| SCR1043 | DN375 sewerage (FMH-E to FMH-D) | 21 | 08-Jan-19 | 31-Jan-19 | DN375 sewerage (FMH-E to FMH-D) | | | | | | | | | | | | | | | | | | | | |
| SCR1045 | Lay 300mm dia. salt watermain (westbound) | 21 | 08-Jan-19 | 31-Jan-19 | Lay 300mm dia. salt watermain (west | | | | | | | | | | | | | | | | | | | | |
| SCR1050 | Proposed drainage (westbound) SMH14-13 to M111c | 18 | 16-Jan-19 | 08-Feb-19 | Proposed drainage (westbound) | | | | | | | | | | | | | | | | | | | | |
| SCR1060 | Gully Construction | 6 | 09-Feb-19 | 15-Feb-19 | Gully Construction | | | | | | | | | | | | | | | | | | | | |
| SCR1080 | Removal of crane platform | 6 | 16-Feb-19 | 22-Feb-19 | Removal of | | | | | | | | | | | | | | | | | | | | |
| SCR1085 | Laying of New Utilities at Roundabout | 13 | 09-Feb-19 | 23-Feb-19 | Laying of | | | | | | | | | | | | | | | | | | | | |
| SCR1090 | Backfill to level approx. +4.5 mPD | 7 | 16-Feb-19 | 23-Feb-19 | Backfill to | | | | | | | | | | | | | | | | | | | | |
| SCR1100 | Trim formation, lay subbase and kerb | 11 | 25-Feb-19 | 08-Mar-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR1120 | DN250 sewerage (FMH24-1G - FMH24-1F) | 12 | 20-Dec-18 | 05-Jan-19 | DN250 sewerage (FMH24-1G - FMH24-1F) | | | | | | | | | | | | | | | | | | | | |
| SCR1130 | DN350x3 Rising main (from Subway B - FMH24-1B) phase 1 near EB Dwall | 12 | 20-Dec-18 | 05-Jan-19 | DN350x3 Rising main (from Subway B - FMH24-1B) phase 1 near | | | | | | | | | | | | | | | | | | | | |
| SCR1132 | DN375 Sewerage (FMH-E to FMH24-B) | 11 | 07-Jan-19 | 18-Jan-19 | DN375 Sewerage (FMH-E to FMH24-B) | | | | | | | | | | | | | | | | | | | | |
| SCR1133 | Construct and divert temporary footpath | 6 | 19-Jan-19 | 25-Jan-19 | Construct and divert temporary footpath | | | | | | | | | | | | | | | | | | | | |
| SCR1135 | Sewerage (from FMH24-1F - FMH24-1B - FMH24-1C) | 44 | 26-Jan-19 | 21-Mar-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR1139 | Lay fresh watermain (eastbound) | 27 | 14-Dec-18 | 17-Jan-19 | Lay fresh watermain (eastbound) | | | | | | | | | | | | | | | | | | | | |
| SCR1140 | Proposed drainage M112 to M110 (eastbound) | 23 | 31-Dec-18 | 26-Jan-19 | Proposed drainage M112 to M110 (eastbound) | | | | | | | | | | | | | | | | | | | | |
| SCR1160 | Proposed drainage M110c to M110 (eastbound) | 8 | 28-Jan-19 | 08-Feb-19 | Proposed drainage M110c to | | | | | | | | | | | | | | | | | | | | |
| SCR1170 | Gully Construction | 8 | 09-Feb-19 | 18-Feb-19 | Gully Construct | | | | | | | | | | | | | | | | | | | | |
| SCR1180 | Laying of New Utilities at Roundabout | 13 | 09-Feb-19 | 23-Feb-19 | Laying of | | | | | | | | | | | | | | | | | | | | |

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | | January | | | | | February | | | | | March | | | | | | |
|---|---|---------|-------------|-------------|----------|----|----|----|----|----------|----|----|----|----|---------|----|----|----|----|----------|----|----|----|--|-------|--|--|--|--|--|--|
| | | | | | 41 | | | | | 42 | | | | | 43 | | | | | 44 | | | | | 45 | | | | | | |
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 | 03 | | | | | | | | |
| SCR1182 | Backfill to level approx. +4.5 mPD | 5 | 19-Feb-19 | 23-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1190 | Trim formation, lay subbase and kerb | 12 | 25-Feb-19 | 09-Mar-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Shing Fung Road R & D Works (Stage 1) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1250 | Subway B construction (Bay 4) | 0 | | 23-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1260 | DCS at Zone 2 Bay 1 (CH20 - CH35) | 44 | 10-Dec-18 | 01-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1262 | Backfill to level approx. +3.0 mPD | 5 | 02-Feb-19 | 11-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1265 | Sewerage (FMH-B to FMH-D) | 23 | 12-Feb-19 | 09-Mar-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1270 | Lay fresh and salt watermains | 28 | 12-Feb-19 | 15-Mar-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1280 | DN350x3 Rising main (from Subway B - FMH24-1B & FMH24-1B to FMH2.0) | 23 | 12-Feb-19 | 09-Mar-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Zone 3 R & D Works (Stage 1) CH340 to CH270 - For shifting of gate no. 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1500 | Zone 3 DCS (3 x 900) south of Gate 1 bridge (CH140 - CH190) | 0 | 31-Oct-18 A | 26-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1502 | Trim W/B D-Wall | 0 | 17-Nov-18 A | 28-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1505 | Backfill to Formation | 0 | 03-Nov-18 A | 30-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1507 | Lay 300mm dia. salt watermain (westbound) | 0 | 17-Nov-18 A | 20-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1510 | Drainage (westbound) SMH14-9A to SMH14-8 | 0 | 21-Nov-18 A | 28-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1520 | Gully Construction | 0 | 27-Nov-18 A | 30-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1546 | Lay 600mm dia. fresh watermain (eastbound) | 0 | 22-Nov-18 A | 29-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1560 | Proposed drainage M109c to M109 (eastbound) and 750.dia | 0 | 07-Nov-18 A | 22-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1570 | Gully Construction | 0 | 20-Nov-18 A | 27-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1577 | Trim formation, lay subbase and kerb | 5 | 28-Nov-18 A | 05-Dec-18 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1579 | Road Pavement Works | 5 | 06-Dec-18 | 11-Dec-18 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1610 | TTA Setup and Diversion of Gate No.1 Access Road (Permanent Road) to HKCH | 5 | 12-Dec-18 | 17-Dec-18 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1615 | Diversion of Gate No.1 Access Road (Permanent Road) to HKCH | 0 | 18-Dec-18 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1620 | Remove temporary bridge no. 1 to HKCH | 11 | 18-Dec-18 | 02-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1630 | Backfill to level approx. +3.0 mPD (CH110 - CH140) | 9 | 03-Jan-19 | 12-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1640 | Zone 3 DCS (3 x 900) westbound (CH110 - CH140) | 11 | 14-Jan-19 | 25-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1645 | Backfilling to Formation | 4 | 26-Jan-19 | 30-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1650 | Drainage (westbound) SMH14-9A to M111c | 5 | 31-Jan-19 | 08-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1655 | Gully Construction | 5 | 09-Feb-19 | 14-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1660 | Lay 300mm dia. salt watermain (westbound) | 5 | 09-Feb-19 | 14-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1670 | Lay new UU across Gate 1 | 20 | 14-Jan-19 | 08-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | | January | | | | | February | | | | | March | |
|--|--|---------|-------------|-------------|----------|----|----|----|----|----------|----|----|----|----|---------|----|----|----|----|----------|----|----|----|--|-------|---|
| | | | | | 41 | | | | | 42 | | | | | 43 | | | | | 44 | | | | | 45 | |
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 | 03 | | | |
| SCR1680 | Proposed drainage M110 to M109 (eastbound) | 11 | 14-Jan-19 | 25-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Proposed drainage M110 to M109 (eastbound) |
| SCR1685 | Backfilling to Formation | 4 | 26-Jan-19 | 30-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Backfilling to Formation |
| SCR1690 | Proposed drainage M109d to M109c (eastbound) | 6 | 31-Jan-19 | 09-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Proposed drainage M109d |
| SCR1695 | Gully Construction | 5 | 11-Feb-19 | 15-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Gully Construction |
| SCR1700 | Lay 600mm dia. fresh watermain (eastbound) | 6 | 11-Feb-19 | 16-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Lay 600mm dia. fr |
| SCR1702 | Trim formation, lay subbase and kerb | 6 | 18-Feb-19 | 23-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Trim form |
| SCR1705 | Lay bituminous pavement | 9 | 25-Feb-19 | 06-Mar-19 | | | | | | | | | | | | | | | | | | | | | | |
| Zone 3 R & D Works (Stage 2) CH270 to 190 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1730 | Bckfilling to Level approx. +3.0 mPD (Phase 2) | 0 | | 10-Dec-18 | | | | | | | | | | | | | | | | | | | | | | ◆ Bckfilling to Level approx. +3.0 mPD (Phase 2) |
| SCR1740 | Zone 3 DCS (3 x 900) westbound (CH190 - CH270) | 23 | 10-Dec-18 | 08-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Zone 3 DCS (3 x 900) westbound (CH190 - CH270) |
| SCR1750 | Drainage (westbound) SMH14-8 to SMH14-5 | 10 | 03-Jan-19 | 14-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Drainage (westbound) SMH14-8 to SMH14-5 |
| SCR1760 | Gully Construction | 9 | 15-Jan-19 | 24-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Gully Construction |
| SCR1770 | Lay 300mm dia. salt watermain (westbound) | 9 | 15-Jan-19 | 24-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Lay 300mm dia. salt watermain (westbound) |
| SCR1780 | Proposed drainage M107 to M108 (eastbound) | 16 | 10-Dec-18 | 29-Dec-18 | | | | | | | | | | | | | | | | | | | | | | Proposed drainage M107 to M108 (eastbound) |
| SCR1790 | Lay 600mm dia. fresh watermain (eastbound) | 11 | 31-Dec-18 | 12-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Lay 600mm dia. fresh watermain (eastbound) |
| SCR1800 | Proposed drainage M107e to M107b (eastbound) | 11 | 31-Dec-18 | 12-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Proposed drainage M107e to M107b (eastbound) |
| SCR1810 | Gully Construction | 9 | 14-Jan-19 | 23-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Gully Construction |
| SCR1820 | Backfill to level approx. +4.5 mPD to formation level | 8 | 24-Jan-19 | 01-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Backfill to level approx. +4.5 mPD to |
| SCR1830 | Trim formation, lay subbase and kerb | 16 | 02-Feb-19 | 23-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Trim form |
| SCR1840 | Lay bituminous pavement | 17 | 25-Feb-19 | 15-Mar-19 | | | | | | | | | | | | | | | | | | | | | | |
| Zone 4 SUS | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1880 | Dismantling of Struts_S3 - 1 to 10 for Subway A | 0 | | 20-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | ◆ Dismantling of Struts_S3 - 1 to 10 for Subway A |
| SCR1890 | Backfill to level approx. -2.3 mPD for DCS | 33 | 12-Dec-18 | 22-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Backfill to level approx. -2.3 mPD for DCS |
| SCR1900 | Backfill to level approx. +1.0 mPD for drainage and sewerage | 23 | 23-Jan-19 | 21-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Backfill to l |
| Zone 4 R & D Works | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1980 | Construction of DCS Valve Pit | 50 | 10-Aug-18 A | 30-Jan-19 | | | | | | | | | | | | | | | | | | | | | | Construction of DCS Valve Pit |
| SCR1990 | ELS for DCS (Outside of SUS) | 48 | 14-Dec-18 | 14-Feb-19 | | | | | | | | | | | | | | | | | | | | | | ELS for DCS (Outsid |
| SCR2000 | Form wall opening for DCS CYS Section | 16 | 23-Jan-19 | 13-Feb-19 | | | | | | | | | | | | | | | | | | | | | | Form wall opening for |
| SCR2010 | Zone 4 DCS Works (CH270 - CH330 & CYS Section) | 61 | 31-Jan-19 | 16-Apr-19 | | | | | | | | | | | | | | | | | | | | | | |
| SCR2020 | Storm drainage M107 to M105/M204 to M201/SMH14-5 to M105A | 43 | 22-Feb-19 | 13-Apr-19 | | | | | | | | | | | | | | | | | | | | | | |
| SCR2040 | Sewerage FMH23-4 to FMH23-3 and FMH23-1 to FMH23-2 | 43 | 22-Feb-19 | 13-Apr-19 | | | | | | | | | | | | | | | | | | | | | | |

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | | January | | | | | February | | | | | March | | | | | |
|--|--|---------|-------------|-------------|----------|----|----|----|----|----------|----|----|----|----|---------|----|----|----|----|----------|----|----|----|--|-------|--|--|--|--|--|
| | | | | | 41 | | | | | 42 | | | | | 43 | | | | | 44 | | | | | 45 | | | | | |
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 | 03 | | | | | | | |
| SCR2050 | Lay fresh and salt watermains | 72 | 21-Feb-19 | 22-May-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Road D4-4 (Cheung Yip Street) | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <i>CH100 to CH150 Cheung Yip Street Cul de Sac</i> | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Cheung Yip Street Cul de Sac | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2570 | SRT for half of cul de sac near HKCH | 0 | 12-Oct-18 A | 30-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2580 | Excavation Works and PVC Pipe Laying for Utilities | 0 | 12-Nov-18 A | 16-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2590 | Trim formation, lay subbase and kerb (half of cul de sac) | 7 | 17-Nov-18 A | 07-Dec-18 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2600 | Laying of Bituminous Pavement(half of cul de sac) | 4 | 08-Dec-18 | 12-Dec-18 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2610 | TTA Setup and Diversion of Permanent Road to HKCH | 5 | 13-Dec-18 | 18-Dec-18* | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2620 | Storm drainage M103 to M105/M104 to M201/M104a to M104 | 48 | 20-Dec-18 | 20-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2630 | Lay bituminous pavement | 22 | 21-Feb-19 | 18-Mar-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| <i>CH220 - CH420 Southbound</i> | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Part 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Road Works | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1076 | Road Base and Pavement Works | 0 | 13-Nov-18 A | 22-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1077 | Temporary Road Construction for TTA stage 3 - phase 2 | 0 | 24-Nov-18 A | 26-Nov-18 A | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Part 2 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Sewerage Works | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1050 | Excavation of Sewerage Pipe and FMH23-16A to FMH23-17 (Part 3) | 10 | 07-Dec-18 | 18-Dec-18 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1050 | Laying Sewerage Pipe and Construction of FMH23-17 (Part 3) | 18 | 19-Dec-18 | 11-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1051 | Backfilling Sewerage Pipe and FMH23-17 (Part 3) | 9 | 12-Jan-19 | 22-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Water Works | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1060 | Laying of Fresh Watermain Pipe | 5 | 23-Jan-19 | 28-Jan-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1098 | Laying of Salt Watermain Pipe | 5 | 29-Jan-19 | 02-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Road Works | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1078 | Construction of Subgrade Works and Subbase Works | 7 | 04-Feb-19 | 14-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1079 | Road Base and Pavement Works | 5 | 15-Feb-19 | 20-Feb-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-01-RWS-1080 | Temporary Road Construction for TTA stage 3 - phase 3 | 10 | 19-Feb-19 | 01-Mar-19 | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Section 1A of the Works -Construction of Supporting Underground Structure | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SUS and Ventilation Adits from CH6+150 to CH6+220 in Zone 1 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Construction of Tunnel Box Structure | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | January | | | | February | | | | March | | |
|--|--|---------|-------------|-------------|--|----|----|----|----|----------|----|----|----|---------|----|----|----|----------|----|----|----|-------|----|--|
| | | | | | 41 | | | | | 42 | | | | 43 | | | | 44 | | | | 45 | | |
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 | 03 | |
| Backfilling Works | | | | | | | | | | | | | | | | | | | | | | | | |
| K-1A-SV1-6900 | Backfilling (bay 1 to bay 2) (to +3.7m) | 6 | 23-Apr-18 A | 06-Dec-18 | Backfilling (bay 1 to bay 2) (to +3.7m) | | | | | | | | | | | | | | | | | | | |
| SUS and Ventilation Adits from CH6+220 to CH6+291 in Zone 2 | | | | | | | | | | | | | | | | | | | | | | | | |
| Construction of SUS Structure at Zone 2 | | | | | | | | | | | | | | | | | | | | | | | | |
| Scaffolding / Falseworks | | | | | | | | | | | | | | | | | | | | | | | | |
| Bay 1 | | | | | | | | | | | | | | | | | | | | | | | | |
| A2500 | Dismantling of Struts_S1B - 1 to 5 | 0 | 16-Nov-18 A | 20-Nov-18 A | Dismantling of Struts_S1B - 1 to 5 | | | | | | | | | | | | | | | | | | | |
| A2510 | Waterproofing Works (1440 m2) and Screeding Works (108 m3) | 4 | 29-Nov-18 A | 03-Dec-18 | Waterproofing Works (1440 m2) and Screeding Works (108 m3) | | | | | | | | | | | | | | | | | | | |
| A2515 | Backfilling Works for Bay 1 to +2mPD (950m3) | 10 | 04-Dec-18 | 13-Dec-18 | Backfilling Works for Bay 1 to +2mPD (950m3) | | | | | | | | | | | | | | | | | | | |
| A2520 | Demolition of Dwall (96mL) | 10 | 14-Dec-18 | 23-Dec-18 | Demolition of Dwall (96mL) | | | | | | | | | | | | | | | | | | | |
| Bay 2 | | | | | | | | | | | | | | | | | | | | | | | | |
| A2552 | Backfilling Works to S1B (950m3) | 9 | 20-Oct-18 A | 08-Dec-18 | Backfilling Works to S1B (950m3) | | | | | | | | | | | | | | | | | | | |
| A2560 | Demolition of Dwall (142mL) | 15 | 14-Dec-18 | 28-Dec-18 | Demolition of Dwall (142mL) | | | | | | | | | | | | | | | | | | | |
| SUS Structure from CH6+291 to 6+467 in Zone 3 | | | | | | | | | | | | | | | | | | | | | | | | |
| Construction of SUS Structure at Zone 3 | | | | | | | | | | | | | | | | | | | | | | | | |
| System Formworks - SUS Construction Works at Zone 3 | | | | | | | | | | | | | | | | | | | | | | | | |
| Bay 5 to 7 | | | | | | | | | | | | | | | | | | | | | | | | |
| A2610 | Demolition of Dwall (105mL) | 0 | 17-Nov-18 A | 28-Nov-18 A | Demolition of Dwall (105mL) | | | | | | | | | | | | | | | | | | | |
| Bay 8 to 10 | | | | | | | | | | | | | | | | | | | | | | | | |
| A2630 | Waterproofing Works (1540 m2) | 0 | 31-Oct-18 A | 03-Nov-18 A | Waterproofing Works (1540 m2) | | | | | | | | | | | | | | | | | | | |
| A2645 | Dismantling of Struts_S2A - 1 to 8 | 0 | 07-Nov-18 A | 15-Nov-18 A | Dismantling of Struts_S2A - 1 to 8 | | | | | | | | | | | | | | | | | | | |
| A2649 | Backfilling Works to S1 (6350m3) @400m3 (B) | 10 | 08-Nov-18 A | 09-Dec-18 | Backfilling Works to S1 (6350m3) @400m3 (B) | | | | | | | | | | | | | | | | | | | |
| A2650 | Dismantling of Struts_S1 - 1 to 7 | 7 | 11-Nov-18 A | 15-Dec-18 | Dismantling of Struts_S1 - 1 to 7 | | | | | | | | | | | | | | | | | | | |
| A2660 | Demolition of Dwall (110mL) | 11 | 13-Dec-18 | 23-Dec-18 | Demolition of Dwall (110mL) | | | | | | | | | | | | | | | | | | | |
| SUS Structure from CH6+467 to 6+568 in Zone 4 | | | | | | | | | | | | | | | | | | | | | | | | |
| System Works - Construction of SUS Structure at Zone 4 | | | | | | | | | | | | | | | | | | | | | | | | |
| Bay 11 to 13 (Top Slab) | | | | | | | | | | | | | | | | | | | | | | | | |
| A2700 | Waterproofing Works (1900 m2) | 0 | 07-Nov-18 A | 11-Nov-18 A | Waterproofing Works (1900 m2) | | | | | | | | | | | | | | | | | | | |
| A2710 | Screeding Works (145 m3) | 0 | 12-Nov-18 A | 13-Nov-18 A | Screeding Works (145 m3) | | | | | | | | | | | | | | | | | | | |
| A2720 | Backfilling Works to S3 (8760m3) @400m3 (C) | 0 | 07-Nov-18 A | 14-Nov-18 A | Backfilling Works to S3 (8760m3) @400m3 (C) | | | | | | | | | | | | | | | | | | | |
| A2730 | Dismantling of Struts_S3 - 1 to 10 | 0 | 15-Nov-18 A | 20-Nov-18 A | Dismantling of Struts_S3 - 1 to 10 | | | | | | | | | | | | | | | | | | | |

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | | January | | | | | February | | | | | March |
|--|---|---------|-------------|-------------|----------|----|----|----|----|----------|----|----|----|----|---------|----|----|----|----|----------|----|----|----|--|-------|
| | | | | | 41 | | | | | 42 | | | | | 43 | | | | | 44 | | | | | 45 |
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 | 03 | | |
| A2740 | Backfilling Works to S2 (3230m3) @400m3 (D) | 3 | 21-Nov-18 A | 02-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| A2750 | Dismantling of Struts_S2 - 1 to 5 | 5 | 02-Dec-18 | 06-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| A2752 | Backfilling Works to S1 (7730m3) @400m3 (E) | 20 | 07-Dec-18 | 26-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| A2755 | Dismantling of Struts_S1 - 8 to 18 | 11 | 26-Dec-18 | 05-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| A2760 | Demolition of Dwall (120mL) | 12 | 06-Jan-19 | 17-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| Bay 14 (Top Slab) | | | | | | | | | | | | | | | | | | | | | | | | | |
| A2490 | Top slab_Bay 14 | 0 | 26-Oct-18 A | 26-Nov-18 A | | | | | | | | | | | | | | | | | | | | | |
| A2770 | Dismantling of Struts_S4 - 26 to 28 & DS1-4 | 0 | 21-Nov-18 A | 27-Nov-18 A | | | | | | | | | | | | | | | | | | | | | |
| A2780 | Waterproofing Works (1350 m2) | 3 | 07-Dec-18 | 09-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| A2790 | Screeding Works (100 m3) | 2 | 10-Dec-18 | 11-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| A2800 | Backfilling Works to S3 (5670m3) @400m3 (F) | 15 | 12-Dec-18 | 26-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| A2810 | Dismantling of Struts_S3 - 11 to 14 | 8 | 27-Dec-18 | 03-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| A2830 | Backfilling Works to S2 (6040m3) @400m3 (G) | 16 | 04-Jan-19 | 19-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| A2840 | Dismantling of Struts_S2 - 10 to 14 | 8 | 19-Jan-19 | 26-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| A2850 | Backfilling Works to S1 (3370m3) @400m3 (H) | 9 | 27-Jan-19 | 04-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| A2860 | Dismantling of Struts_S1 - 21 to 22 & DS1 to 4 | 6 | 04-Feb-19 | 09-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| A2870 | Demolition of Dwall (100mL) | 10 | 10-Feb-19 | 19-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| Miscellaneous Works | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-1A-MWS-1000 | Miscellaneous works - Removal of SUS Flasework and Formwork | 60 | 20-Feb-19 | 20-Apr-19 | | | | | | | | | | | | | | | | | | | | | |
| Section 3 of the Works- Construction of District Cooling System (Subject to Excision) | | | | | | | | | | | | | | | | | | | | | | | | | |
| Construction of District Cooling System | | | | | | | | | | | | | | | | | | | | | | | | | |
| Construction of DCS Works at Zone 2 | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2760 | DCS at Zone 2 Bay 2 to Bay 4 (CH35 - CH110) | 25 | 14-Dec-18 | 15-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR2770 | DCS at Zone 2 Bay 1 (CH20 - CH35) | 44 | 10-Dec-18 | 01-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| Construction of DCS Works at Zone 3 | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2730 | Zone 3 DCS (3 x 900) south of Gate 1 bridge (CH140 - CH190) | 0 | 31-Oct-18 A | 26-Nov-18 A | | | | | | | | | | | | | | | | | | | | | |
| SCR2740 | Zone 3 DCS (3 x 900) westbound (CH110 - CH140) | 0 | 12-Nov-18 A | 29-Nov-18 A | | | | | | | | | | | | | | | | | | | | | |
| SCR2750 | Zone 3 DCS (3 x 900) westbound (CH190 - CH270) | 23 | 10-Dec-18 | 08-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| Construction of DCS Works at Zone 4 | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR2321 | Construction of DCS Valve Pit | 50 | 10-Aug-18 A | 30-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR2323 | ELS for DCS (Outside of SUS) | 48 | 14-Dec-18 | 14-Feb-19 | | | | | | | | | | | | | | | | | | | | | |

| Activity ID | Activity Name | Rem Dur | Start | Finish | November | | | | | December | | | | | January | | | | | February | | | | | March |
|--|--|---------|-------------|------------|----------|----|----|----|----|----------|----|----|----|----|---------|----|----|----|----|----------|----|----|----|--|-------|
| | | | | | 28 | 04 | 11 | 18 | 25 | 02 | 09 | 16 | 23 | 30 | 06 | 13 | 20 | 27 | 03 | 10 | 17 | 24 | 03 | | |
| SCR2325 | Form wall opening for DCS CYS Section | 16 | 23-Jan-19 | 13-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR2327 | Zone 4 DCS Works (CH270 - CH330 & CYS Section) | 61 | 31-Jan-19 | 16-Apr-19 | | | | | | | | | | | | | | | | | | | | | |
| Section 4A of the Works-Construction of Subway A (Subject to Excision) | | | | | | | | | | | | | | | | | | | | | | | | | |
| Bay 1 to Bay 3 | | | | | | | | | | | | | | | | | | | | | | | | | |
| SCR1910 | ELS for Subway A Bay 1 (west of D-wall) | 30 | 30-Nov-18 | 07-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR1920 | Form wall opening for Subway A | 27 | 08-Jan-19 | 11-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR1930 | Construction of Subway A Bay 1 (west of D-wall) | 67 | 12-Feb-19 | 06-May-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR1940 | ELS for Subway A Bay 3 (east of D-wall) | 20 | 15-Nov-18 A | 22-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| SCR1950 | Form wall opening for Subway A | 32 | 24-Dec-18 | 01-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR1960 | Construction of Subway A Bay 3 (east of D-wall) | 67 | 02-Feb-19 | 29-Apr-19 | | | | | | | | | | | | | | | | | | | | | |
| SCR1970 | Construction of Subway A Bay 2 (within SUS) | 66 | 30-Nov-18 | 21-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| Section 4B of the Works- Construction of Subway B (Subject to Excision) | | | | | | | | | | | | | | | | | | | | | | | | | |
| Bay 1 & 2 | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-4B-BAY-3100 | Handover of Portion B | 0 | | 30-Nov-18* | | | | | | | | | | | | | | | | | | | | | |
| Bay 3 & 4 | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-4B-BAY-3335 | Excavation and Lateral Support works for Bay 4 (Stage 2) | 5 | 01-Nov-18 A | 05-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| K-4B-BAY-3340 | Casting Blinding Layer for Bay 4 | 5 | 06-Dec-18 | 11-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| K-4B-BAY-3350 | Construction of Base Slab at Bay 4 | 12 | 12-Dec-18 | 27-Dec-18 | | | | | | | | | | | | | | | | | | | | | |
| K-4B-BAY-3360 | Construction of Wall and Top Slab at Bay 4 | 17 | 28-Dec-18 | 17-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| K-4B-BAY-3370 | Backfilling Works (Bay 4) | 5 | 18-Jan-19 | 23-Jan-19 | | | | | | | | | | | | | | | | | | | | | |
| K-4B-BAY-3380 | Miscellaneous works of Subway B (internal remedial works) | 70 | 24-Jan-19 | 23-Apr-19 | | | | | | | | | | | | | | | | | | | | | |
| Section 5 of the Works-Completion of All Landscape Softworks | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-05-LCS-1000 | Procurement of plant species | 90 | 30-Nov-18 | 27-Feb-19 | | | | | | | | | | | | | | | | | | | | | |
| Section 7 of the Works-Preservation and Protection of Existing Trees | | | | | | | | | | | | | | | | | | | | | | | | | |
| K-07-001-1000 | Section 7 of the Works-Preservation and Protection of Existing Trees | 330 | 04-Jan-16 A | 25-Oct-19 | | | | | | | | | | | | | | | | | | | | | |

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com





Appendix B

Project Organization Chart

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com

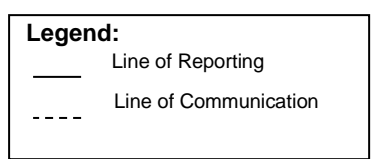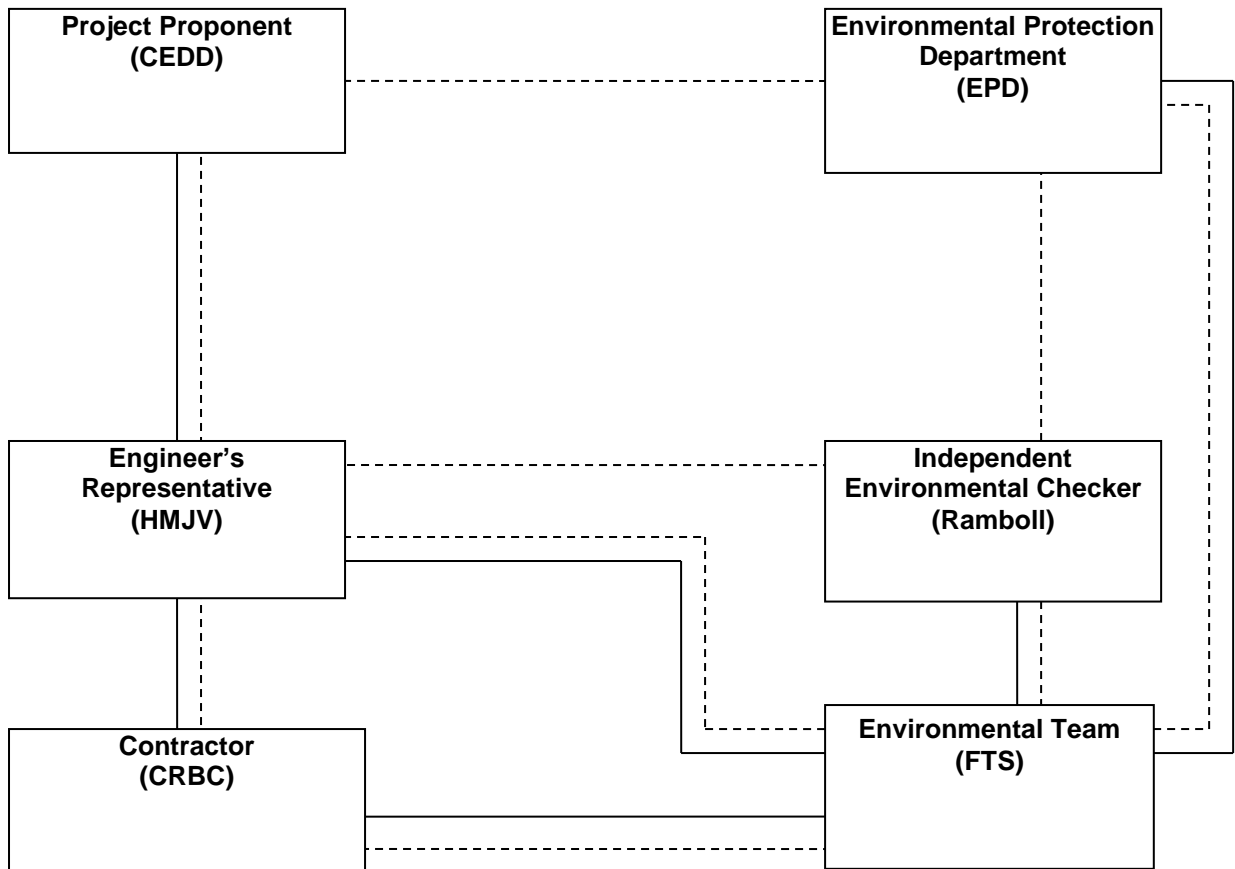

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix C

Action and Limit Levels for Air Quality and Noise

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Action and Limit Levels for 24-hr TSP and 1-hr TSP

| Parameter | Monitoring Station | Action Level ($\mu\text{g}/\text{m}^3$) | Limit Level ($\mu\text{g}/\text{m}^3$) |
|--|--------------------|---|--|
| 24-hr TSP ($\mu\text{g}/\text{m}^3$) | KTD1a | 177 | 260 |
| | KTD2b | 157 | |
| | KER1b | 172 | |
| *1-hr TSP ($\mu\text{g}/\text{m}^3$) | KTD1a | 285 | 500 |
| | KTD2b | 279 | |
| | KER1b | 295 | |

Note:

1-hr TSP monitoring should be required in case of complaints.

Action and Limit Levels for Construction Noise, Leq (30min), dB(A)

| Time Period | Location | Action | Limit |
|----------------------------------|-------------------------|---|----------|
| 0700-1900 hrs on normal weekdays | KTD1a KTD2b KER1b | When one documented complaint is received | 75 dB(A) |

FUGRO TECHNICAL SERVICES LIMITED




Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com






Appendix D

Graphical Presentation of Monitoring Data

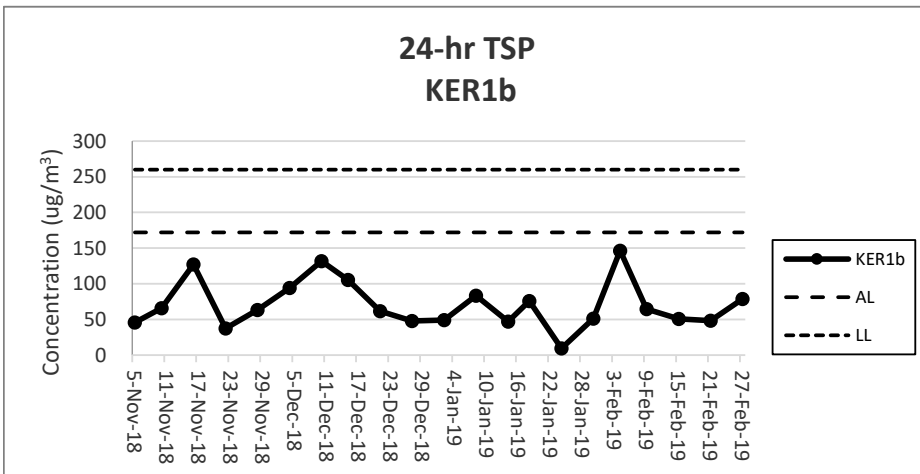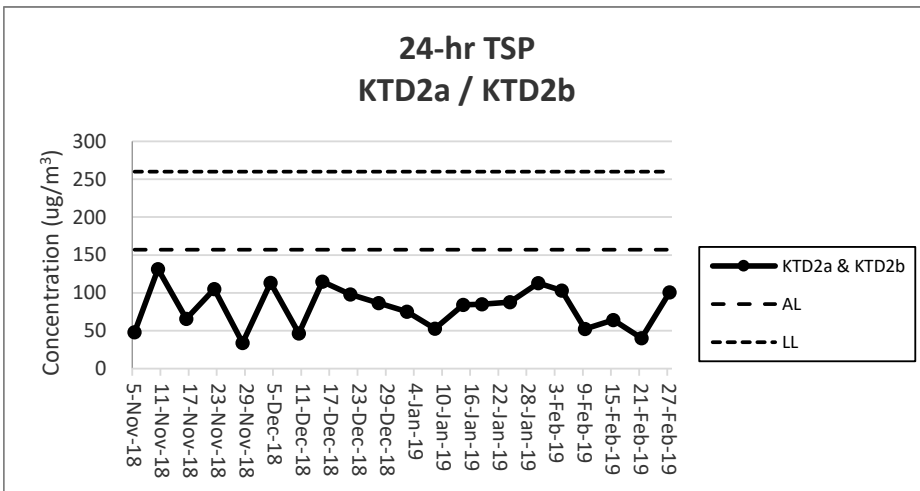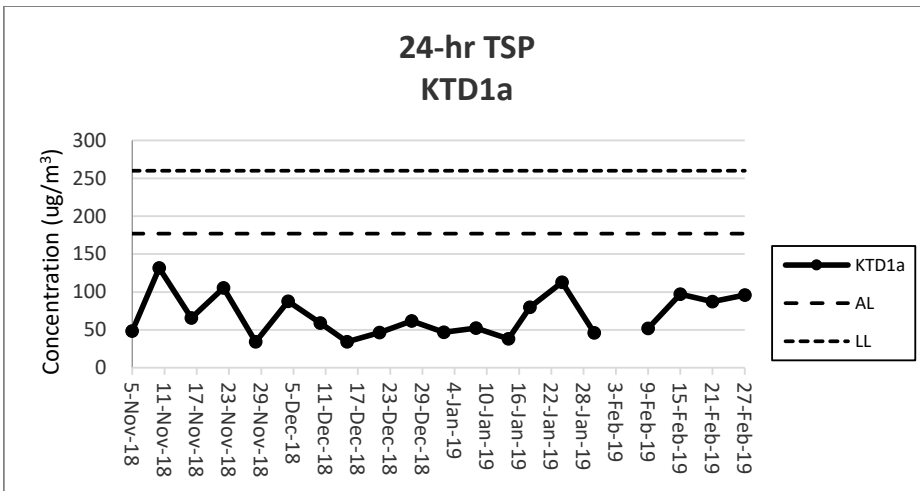

Note:

- 1) The major activities being carried out on site during the reporting period can be referred to Section 1.3.1.
- 2) The weather conditions during monitoring in the reporting period was range from cloudy and fine.
- 3) Any other factors which might affect the monitoing results can be referred to Section 2.3.4.
- 4) Impact air monitoring was not conducted at KTD1a due to the site was closed on 4 February 2019.

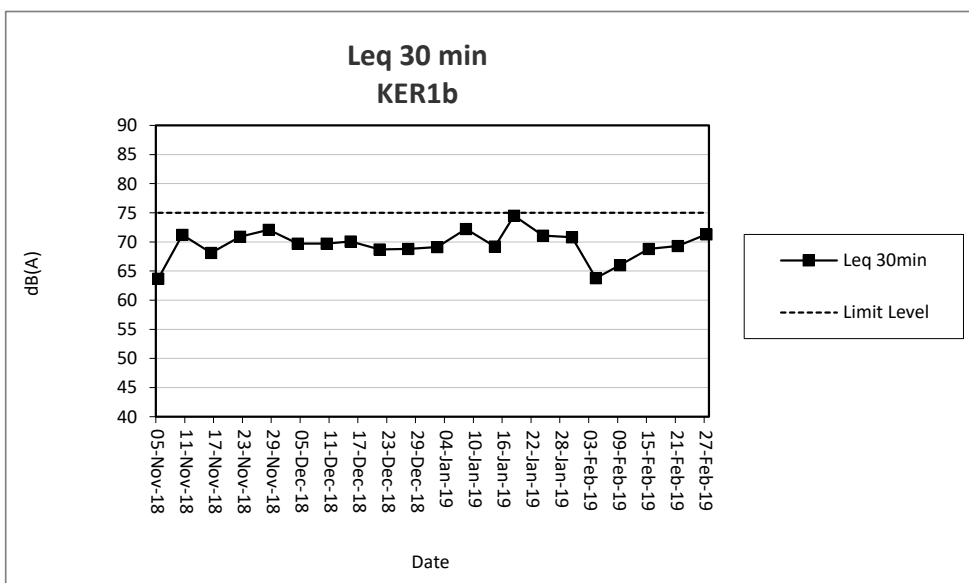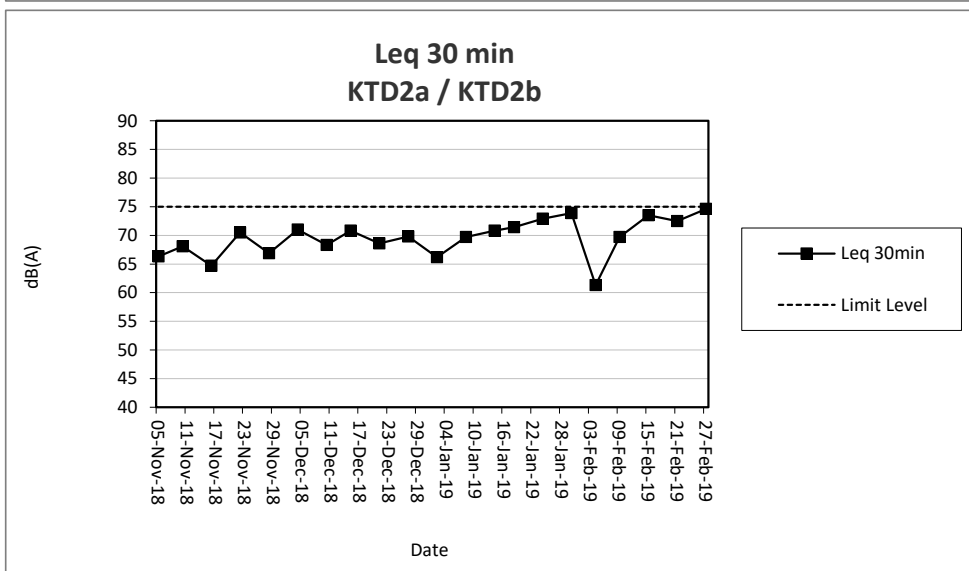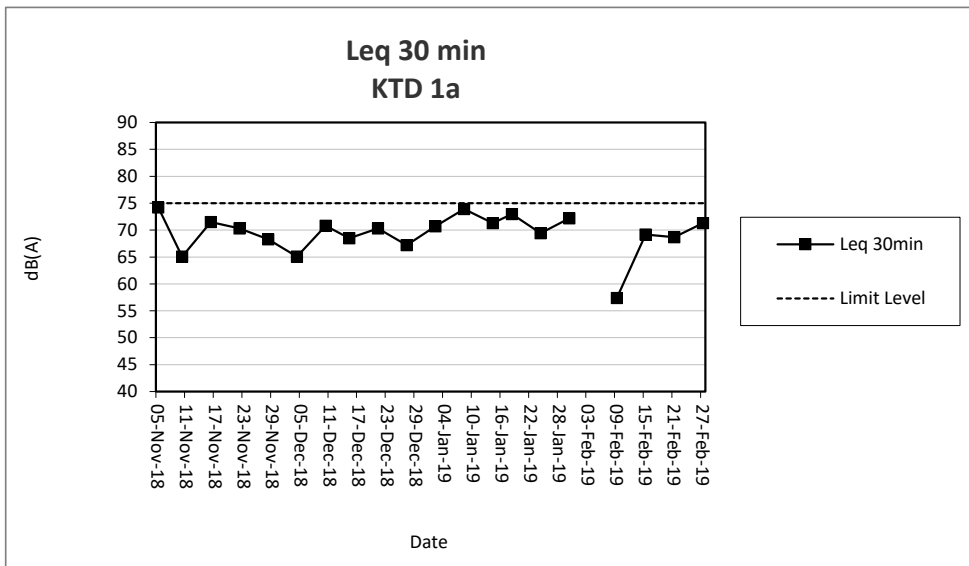

Note:

- 1) The major activities being carried out on site during the reporting period can be referred to Section 1.3.1.
- 2) The weather conditions during monitoring in the reporting period was ranged from cloudy and fine.
No raining or wind with speed over 5 m/s was observed during monitoring in the reporting period.
- 3) Any other factors which might affect the monitoring results can be referred to Section 2.3.4.
- 4) Impact air monitoring was not conducted at KTD1a due to the site was closed on 4 February 2019.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix E

Waste Flow Table

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Waste Flow Table for Year 2016

| Months | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of Non-inert C&D Wastes Generated Monthly | | | | |
|--------------|--|-------------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|---|----------------------------|-----------------------|----------------|-----------------------------|
| | Total Quantity Generated (Inert C&D) | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 2) | Chemical Waste | Others, e.g. general refuse |
| | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000 kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000m ³) |
| 2016 Jan | 0.159 | 0.101 | 0.058 | Nil | Nil | Nil | Nil | 0.023 | 0.00002 | 0.0158 | 0.0335 |
| 2016 Feb | 0.291 | 0.050 | 0.241 | Nil | Nil | Nil | 1.34 | 0.023 | 0.00002 | 0.0158 | 0.0335 |
| 2016 Mar | 2.7389 | 0.0407 | 0.0662 | Nil | 2.632 | Nil | 5.92 | 0.023 | 0.00002 | 0.0158 | 0.0571 |
| 2016 Apr | 4.1718 | 0.0578 | 0.462 | Nil | 3.652 | Nil | 12.5 | 0.023 | 0.00002 | 0.0158 | 0.0426 |
| 2016 May | 3.592 | Nil | 0.299 | Nil | 3.293 | Nil | 5.23 | 0.023 | 0.00002 | 0.0158 | 0.0621 |
| 2016 June | 4.6035 | Nil | 0.8555 | Nil | 3.748 | Nil | Nil | 0.023 | 0.00002 | 0.0158 | 0.0619 |
| 2016 July | 6.155 | 0.153 | 0.015 | Nil | 5.987 | Nil | 7.84 | 0.023 | 0.00002 | 0.0158 | 0.0433 |
| 2016 Aug | 5.1155 | Nil | Nil | Nil | 5.1155 | Nil | 19.93 | 0.023 | Nil | Nil | 0.0147 |
| 2016 Sept | 7.2267 | Nil | Nil | Nil | 7.2267 | Nil | 33.65 | 0.023 | Nil | Nil | 0.0103 |
| 2016 Oct | 4.6448 | Nil | Nil | Nil | 4.6448 | Nil | 13.30 | 0.023 | Nil | Nil | 0.0385 |
| 2016 Nov | 6.1626 | Nil | Nil | Nil | 6.1626 | Nil | 27.06 | 0.023 | Nil | Nil | 0.0192 |
| 2016 Dec | 6.3522 | Nil | Nil | Nil | 6.3522 | Nil | 13.30 | 0.023 | Nil | Nil | 0.0121 |
| Total | 51.213 | 0.4025 | 1.9967 | Nil | 48.8138 | Nil | 140.07 | 0.276 | 0.00014 | 0.1106 | 0.4288 |

Note:

- 1) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- 2) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging materials.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| Waste Flow Table for Year 2017 | | | | | | | | | | | |
|--------------------------------|--|-------------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|---|----------------------------|-----------------------|----------------|-----------------------------|
| Months | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of Non-inert C&D Wastes Generated Monthly | | | | |
| | Total Quantity Generated (Inert C&D) | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 2) | Chemical Waste | Others, e.g. general refuse |
| | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000 kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000m ³) |
| 2017 Jan | 4.2300 | Nil | Nil | Nil | 4.2300 | Nil | 0.015 | 0.023 | Nil | Nil | 0.0109 |
| 2017 Feb | 3.2128 | Nil | Nil | Nil | 3.2128 | Nil | 0.015 | 0.023 | Nil | Nil | 0.0096 |
| 2017 Mar | 9.4759 | Nil | Nil | Nil | 9.4759 | Nil | 0.034 | 0.023 | Nil | Nil | 0.0162 |
| 2017 Apr | 4.8827 | Nil | Nil | Nil | 4.8827 | Nil | 0.016 | 0.023 | Nil | Nil | 0.0062 |
| 2017 May | 3.0366 | Nil | Nil | Nil | 3.0366 | Nil | 0.022 | 0.023 | Nil | Nil | 0.0282 |
| 2017 Jun | 2.5656 | Nil | Nil | Nil | 2.5656 | Nil | 41.25 | Nil | Nil | Nil | 0.0357 |
| 2017 Jul | 5.5267 | Nil | 0.7851 | Nil | 4.7416 | Nil | 4.01 | 0.4515 | Nil | 0.25 | 0.0364 |
| 2017 Aug | 11.4734 | Nil | 0.0276 | Nil | 11.4458 | Nil | 7.4 | Nil | Nil | Nil | 0.0196 |
| 2017 Sep | 23.9373 | Nil | 2.6167 | Nil | 21.3206 | Nil | 3.52 | Nil | Nil | Nil | 0.0333 |
| 2017 Oct | 17.8261 | Nil | 0.4069 | Nil | 17.4192 | Nil | Nil | Nil | Nil | Nil | 0.0156 |
| 2017 Nov | 5.8834 | Nil | 0.6664 | Nil | 5.217 | Nil | Nil | Nil | Nil | Nil | 0.023 |
| 2017 Dec | 21.3554 | Nil | 0.4763 | Nil | 20.8791 | Nil | 29.13 | Nil | Nil | Nil | 0.022 |
| Total | 113.4059 | Nil | 4.9790 | Nil | 108.4269 | Nil | 85.412 | 0.5665 | Nil | 0.25 | 0.2567 |

Note:

- 1) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- 2) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging materials.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| Waste Flow Table for Year 2018 | | | | | | | | | | | |
|--------------------------------|--|-------------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|---|----------------------------|-----------------------|----------------|-----------------------------|
| Months | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of Non-inert C&D Wastes Generated Monthly | | | | |
| | Total Quantity Generated (Inert C&D) | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 2) | Chemical Waste | Others, e.g. general refuse |
| | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000 kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000m ³) |
| 2018 Jan | 10.2340 | Nil | Nil | Nil | 10.2340 | Nil | 32.39 | Nil | Nil | Nil | 0.0161 |
| 2018 Feb | 6.5256 | Nil | Nil | Nil | 6.5256 | Nil | Nil | Nil | Nil | Nil | 0.0235 |
| 2018 Mar | 28.1995 | Nil | Nil | Nil | 28.1995 | Nil | 54.54 | Nil | Nil | Nil | 0.0190 |
| 2018 Apr | 11.2165 | Nil | Nil | Nil | 11.2165 | Nil | Nil | Nil | Nil | Nil | 0.0270 |
| 2018 May | 5.6011 | Nil | Nil | Nil | 5.6011 | Nil | Nil | Nil | Nil | Nil | 0.0140 |
| 2018 Jun | 5.8072 | Nil | Nil | Nil | 5.8072 | Nil | 93.3 | Nil | Nil | Nil | 0.0235 |
| 2018 Jul | 7.4206 | Nil | Nil | Nil | 7.4206 | Nil | Nil | Nil | Nil | Nil | 0.0383 |
| 2018 Aug | 2.0815 | Nil | Nil | Nil | 2.0815 | Nil | Nil | Nil | Nil | Nil | 0.0665 |
| 2018 Sep | 0.3710 | Nil | Nil | Nil | 0.3710 | Nil | Nil | Nil | Nil | Nil | 0.0436 |
| 2018 Oct | 0.9087 | Nil | Nil | Nil | 0.9620 | 0.0533 | Nil | Nil | Nil | Nil | 0.0444 |
| 2018 Nov | 0.7291 | Nil | Nil | Nil | 0.7733 | 0.0589 | Nil | Nil | Nil | Nil | 0.0225 |
| 2018 Dec | -0.0931 | Nil | Nil | Nil | 0.3860 | 0.4791 | Nil | Nil | Nil | Nil | 0.0228 |
| Total | 79.0017 | Nil | Nil | Nil | 79.5783 | 0.5913 | 180.23 | Nil | Nil | Nil | 0.3614 |

Note:

- 1) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- 2) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging materials.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Waste Flow Table for Year 2019

| Monthly Ending | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | | Actual Quantities of Non-inert C&D Wastes Generated Monthly | | | | |
|----------------|--|-------------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|---|----------------------------|-----------------------|----------------|-----------------------------|
| | Total Quantity Generated (Inert C&D) | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ cardboard packaging | Plastics (see Note 2) | Chemical Waste | Others, e.g. general refuse |
| | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000 kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000m ³) |
| 2019 Jan | 0.2485 | Nil | Nil | Nil | 0.7063 | 0.45774 | Nil | Nil | Nil | Nil | 0.0100 |
| 2019 Feb | 0.2790 | Nil | Nil | Nil | 0.2790 | Nil | Nil | Nil | Nil | Nil | 0.0076 |
| 2019 Mar | | | | | | | | | | | |
| 2019 Apr | | | | | | | | | | | |
| 2019 May | | | | | | | | | | | |
| 2019 Jun | | | | | | | | | | | |
| 2019 Jul | | | | | | | | | | | |
| 2019 Aug | | | | | | | | | | | |
| 2019 Sep | | | | | | | | | | | |
| 2019 Oct | | | | | | | | | | | |
| 2019 Nov | | | | | | | | | | | |
| 2019 Dec | | | | | | | | | | | |
| Total | 0.5275 | 0 | 0 | 0 | 0.9853 | 0.45774 | 0 | 0 | 0 | 0 | 0.0176 |

Note:

- 1) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- 2) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging materials.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix F

Environmental Mitigation Implementation Schedule (EMIS)

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|--|--|---|------------------------------|------------------------|---|
| <u>Air Quality Measures</u> | | | | | |
| New Distributor Roads Serving the Planned KTD | | | | | |
| AEIAR-130/2009 S3.2 | AEIAR 130/2009 EM&A Manual S2.2 | 8 times daily watering of the work site with active dust emitting activities. | Contractor | All relevant worksites | Implemented |
| Decommissioning of the Radar Station of the former Kai Tak Airport | | | | | |
| AEIAR-130/2009 S5.2.19 | AEIAR 130/2009 EM&A Manual S4.2.4 | The excavation area should be limited to as small in size as possible and backfilled with clean and/or treated soil shortly after excavation work. The exposed excavated area should be covered by the tarpaulin during night time. The top layer soils should be sprayed with fine misting of water immediately before the excavation. | Contractor | All relevant worksites | Not Applicable |
| Trunk Road T2 | | | | | |
| AEIAR-174/2013 S4.9.2.1 | AEIAR-174/2013 EM&A Manual S2.3.1.1 | Watering of the construction areas 12 times per day to reduce dust emissions by 91.7%, with reference to the "Control of Open Fugitive Dust Sources" (USEPA AP-42). The amount of water to be applied would be 0.91L/m ² for the respective watering frequency. | Contractor | All relevant worksites | Implemented |
| | | Dust enclosures with watering would be provided along the loading ramps and conveyor belts for unloading the C&D materials to the barge for dust suppression. | Contractor | All relevant worksites | Not Applicable |
| | | 8 km per hour is the recommended limit of the speed for vehicles on unpaved site roads. | Contractor | All relevant worksites | Implemented |
| <u>Good Site Practices</u> | | | | | |
| AEIAR-130/2009 S3.2, S5.2.19, AEIAR-174/2013 S4.9.2.2 | AEIAR 130/2009 EM&A Manual S2.2, S4.2, AEIAR 174/2013 EM&A Manual S2.3.1.2 | Stockpiling site(s) should be lined with impermeable sheeting and banded. Stockpiles should be fully covered by impermeable sheeting to reduce dust emission. | Contractor | All relevant worksites | Implemented |
| | | Use of regular watering to reduce dust emissions from exposed site surfaces and unpaved roads, particularly during dry weather. Use of frequent watering for particularly dusty construction areas and areas close to ASRs. | Contractor | All relevant worksites | Implemented |
| | | Misting for the dusty material should be carried out before being loaded into the vehicle. Any vehicle with an open load carrying area should have properly fitted side and tail boards. | Contractor | All relevant worksites | Implemented |
| | | Material having the potential to create dust should not be loaded from a level higher than the side and tail boards and should be dampened and covered by a clean tarpaulin. | Contractor | All relevant worksites | Implemented |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|---------|----------|---|------------------------------|------------------------|---|
| | | Tarpaulin covering of all dusty vehicle loads transported to, from and between site locations; The tarpaulin should be properly secured and should extent at least 300 mm over the edges of the sides and tailboards. The material should also be dampened if necessary before transportation. | Contractor | All relevant worksites | Implemented |
| | | The vehicles should be restricted to maximum speed of 10 km per hour. Confined haulage and delivery vehicle to designated roadways inside the site. Onsite unpaved roads should be compacted and kept free of loose materials. | Contractor | All relevant worksites | Implemented |
| | | Vehicle washing facilities should be provided at every vehicle exit point. Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving the construction sites. The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores. | Contractor | All relevant worksites | Implemented |
| | | Every main haul road should be scaled with concrete and kept clear of dusty materials or sprayed with water so as to maintain the entire road surface wet. | Contractor | All relevant worksites | Partially Implemented |
| | | Every stock of more than 20 bags of cement or dry pulverised fuel ash (PFA) should be covered entirely by impervious sheeting or placed in an area sheltered on the top and the 3 sides. | Contractor | All relevant worksites | Implemented |
| | | Cement or dry PFA delivered in bulk should be stored in a closed silo fitted with an audible high level alarm which is interlocked with the material filling line and no overfilling is allowed. | Contractor | All relevant worksites | Implemented |
| | | Loading, unloading, transfer, handling or storage of bulk cement or dry PFA should be carried out in a totally enclosed system or facility, and any vent or exhaust should be fitted with an effective fabric filter or equivalent air pollution control system. | Contractor | All relevant worksites | Implemented |
| | | Side enclosure and covering of any aggregate or dusty material storage piles to reduce emissions. Where this is not practicable owing to frequent usage, watering shall be applied to aggregate fines. | Contractor | All relevant worksites | Implemented |
| | | Open stockpiles shall be avoided or covered. Prevent placing dusty material storage piles near ASRs. | Contractor | All relevant worksites | Implemented |
| | | Routing of vehicles and position of construction plant should be at the maximum possible distance from ASRs. | Contractor | All relevant worksites | Implemented |
| | | <u>Dark smoke</u> | | | |
| | | Dark smoke emission shall be control in accordance with the Air Pollution Control (Smoke) | Contractor | All relevant | Implemented |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|---|---|---|------------------------------|------------------------|---|
| | | Regulation and ETWB TCW 19/2005. | | worksites | |
| | | Plant and equipment should be well maintained to prevent dark smoke emission. | Contractor | All relevant worksites | Implemented |
| Noise Measures | | | | | |
| Trunk Road T2 | | | | | |
| AEIAR-174/2013 S5.9.2.1 | AEIAR-174/2013 EM&A Manual S3.4.1.1 | The use of quieter plant, including Quality Powered Mechanical Equipment (QPME) is specified for the list of equipment: <ul style="list-style-type: none"> • Concrete lorry mixer • Dump Truck, 5.5 tonne < gross vehicle weight <= 38 tonne • Generator, Super Silenced, 70 dB(A) at 7m • Poker, vibratory, Hand-held (electric) • Water Pump, Submersible (Electric) • Mobile Crane - KOBELCO CKS900 • Excavator, wheeled/tracked - HYUNDAI R80CR-9 | Contractor | All relevant worksites | Implemented |
| | | Use of temporary or fixed noise barriers with a surface density of at least 10kg/m ² to screen noise from movable and stationary plant. | Contractor | All relevant worksites | Implemented |
| | | Use of enclosures with covers at top and three sides and a surface density of at least 10kg/m ² to screen noise from generally static noisy plant such as air compressors. | Contractor | All relevant worksites | Implemented |
| | | Use of acoustic fabric for the silent piling system, drill rigs, rock drills etc. | Contractor | All relevant worksites | Implemented |
| <u>Good Site Practices</u> | | | | | |
| AEIAR-130/2009 S3.3, S5.3.10, AEIAR-174/2013 S5.9.2.1 | AEIAR 130/2009 EM&A Manual S2.3, S4.3.2, AEIAR-174/2013 EM&A Manual S3.4.1.1 | Only well-maintained plant should be operated on-site and plant shall be serviced regularly during the construction/ decommissioning program. | Contractor | All relevant worksites | Implemented |
| | | Silencers or mufflers on construction equipment should be utilized and shall be properly maintained during the construction/ decommissioning program. | Contractor | All relevant worksites | Implemented |
| | | Mobile plant, if any, should be sited as far away from NSRs as possible. | Contractor | All relevant worksites | Implemented |
| | | Machines and plant (such as trucks) that may be in intermittent use shall be shut down between works periods or should be throttled down to a minimum. | Contractor | All relevant worksites | Implemented |
| | | Plant known to emit noise strongly in one direction shall, wherever possible, be orientated so that the noise is directed away from the nearby NSRs. | Contractor | All relevant worksites | Implemented |
| Material stockpiles and other structures should be effectively utilized, wherever practicable, in | Contractor | All relevant | Implemented | | |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|-------------------------------|---|--|------------------------------|------------------------|---|
| | | screening noise from on-site construction/ decommissioning activities. | | worksites | |
| | | Use of site hoarding as a noise barrier to screen noise at low level NSRs. | Contractor | All relevant worksites | Implemented |
| | | For the use of hand held percussive breakers (with mass of above 10kg) and portable air compressors (supply air at 500 kPa or above), the noise level of such PME shall comply with a stringent noise emission standard and a noise emission label shall be obtained from the DEP before use at any time in construction site. | Contractor | All relevant worksites | Implemented |
| | | Quiet powered mechanical equipment (PME) shall be used for the construction of the Project. | Contractor | All relevant worksites | Implemented |
| | | Full enclosures shall be used to screen noise from relatively static PMEs (including air compressor, bar bender, concrete pump, generator and water pump) from sensitive receiver(s). | Contractor | All relevant worksites | Implemented |
| | | Movable cantilevered noise barriers shall be used to screen noise from mobile PMEs (including asphalt paver, breaker, excavator and hand-held breaker) from sensitive receiver(s). These movable cantilevered noise barriers shall be located close to the mobile PMEs and shall be moved/adjusted iteratively in step with each movement of the corresponding mobile PMEs in order to maximize their noise reduction effects. | Contractor | All relevant worksites | Implemented |
| | | Only approved or exempted Non-road Mobile Machineries (NRMMS) including regulated machines and non-road vehicles with proper labels are allowed to be used in specified activities on-site. | Contractor | All relevant worksites | Implemented |
| Water Quality Measures | | | | | |
| Trunk Road T2 | | | | | |
| | | Accidental Spillage | | | |
| AEIAR-174/2013 S6.4.8.5 | AEIAR-174/2013 EM&A Manual S4.2.1.1 | All bentonite slurry should be stored in a container that resistant to corrosion, maintained in good conditions and securely closed; The container should be labelled in English and Chinese and note that the container is for storage of bentonite slurry only. | Contractor | All relevant worksites | Implemented |
| | | The storage container should be placed on an area of impermeable flooring and bunded with capacity to accommodate 110% of the volume of the container size or 20% by volume stored in the area and enclosed with at least 3 sides. | Contractor | All relevant worksites | Implemented |
| | | The storage container should be sufficiently covered to prevent rainfall entering the container or bunded area (water collected within the bund must be tested and disposed of as chemical waste, if necessary). An emergency clean up kit shall be readily available where bentonite fluid will be stored or used. | Contractor | All relevant worksites | Implemented |

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|---|---|--|------------------------------|------------------------|---|
| | | The handling and disposal of bentonite slurries should be undertaken in accordance within ProPECC PN 1/94. Surplus bentonite slurries used in construction works shall be reconditioned and reused wherever practicable. Residual bentonite slurry shall be disposed of from the site as soon as possible as stipulated in Clause 8.56 of the General Specification for Civil Engineering Works. The Contractor should explore alternative disposal outlets for the residual bentonite slurry (dewatered bentonite slurry to be disposed to a public filling area and liquid bentonite slurry, if mixed with inert fill material, to be disposed to a public filling area) and disposal at landfill should be the last resort. | Contractor | All relevant worksites | Implemented |
| AEIAR-174/2013 S6.4.8.8 | AEIAR-174/2013 EM&A Manual S4.2.1.1 | In order to protect against impacts to the surrounding marine waters of the KTTS and Victoria Harbour in the event of an accidental spillage of fuel or oil, the Contractor will be required to prepare a spill response plan to the satisfaction of AFCD, EPD, FSD, Police, TD and WSD to define procedures for the control, containment and clean-up of any spillage that could occur on the construction site. | Contractor | All relevant worksites | Implemented |
| | | <u>Dredging, Reclamation and Filling</u> | | | |
| | | No dredging, reclamation or filling in the marine environment shall be carried out. | Contractor | All relevant worksites | Implemented |
| Decommissioning of the Radar Station of the former Kai Tak Airport | | | | | |
| | | <u>Building Demolition</u> | | | |
| AEIAR-130/2009 S5.4 | AEIAR 130/2009 EM&A Manual S4.4 | The site practices outlined in ProPECC PN 1/94 "Construction Site Drainage" should be followed as far as practicable in order to minimise surface runoff and the chance of erosion. | Contractor | All relevant worksites | Not Applicable |
| | | There is a need to apply to EPD for a discharge licence under the WPCO for discharging effluent from the construction site. The discharge quality is required to meet the requirements specified in the discharge licence. All the runoff, wastewater or extracted groundwater generated from the works areas should be treated so that it satisfies all the standards listed in the TM-DSS. It is anticipated that the wastewater generated from the works areas would be of small quantity. Monitoring of the treated effluent quality from the works areas should be carried out in accordance with the WPCO license which is under the ambit of regional office (RO) of EPD. | Contractor | All relevant worksites | Not Applicable |
| | | <u>General Construction Works</u> | | | |
| | | <u>Construction Runoff</u> | | | |
| AEIAR-130/2009 S3.4, | AEIAR 130/2009 EM&A Manual | Exposed soil areas should be minimised to reduce the potential for increased siltation, contamination of runoff, and erosion. Construction runoff related impacts associated with the | Contractor | All relevant worksites | Implemented |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|----------------------------------|---|---|------------------------------|------------------------|---|
| S5.4/ AEIAR-174/2013 S6.4.8.1 | S2.4, S4.4/ AEIAR-174/2013 EM&A Manual S4.2.1.1 | above ground construction activities can be readily controlled through the use of appropriate mitigation measures which include the use of sediment traps and adequate maintenance of drainage systems to prevent flooding and overflow. | | | |
| | | Construction site should be provided with adequately designed perimeter channel and pre-treatment facilities and proper maintenance. The boundaries of critical areas of earthworks should be marked and surrounded by dykes or embankments for flood protection. Temporary ditches should be provided to facilitate runoff discharge into the appropriate watercourses, via a silt retention pond. Permanent drainage channels should incorporate sediment basins or traps and baffles to enhance deposition rates. The design of efficient silt removal facilities should be based on the guidelines in Appendix A1 of ProPECC PN 1/94. | Contractor | All relevant worksites | Implemented |
| | | Ideally, construction works should be programmed to minimise surface excavation works during the rainy season (April to September). All exposed earth areas should be completed as soon as possible after earthworks have been completed, or alternatively, within 14 days of the cessation of earthworks where practicable. If excavation of soil cannot be avoided during the rainy season, or at any time of year when rainstorms are likely, exposed slope surfaces should be covered by tarpaulin or other means. | Contractor | All relevant worksites | Implemented |
| | | Sediment tanks of sufficient capacity, constructed from pre-formed individual cells of approximately 6 to 8 m ³ capacity, are recommended as a general mitigation measure which can be used for settling surface runoff prior to disposal. The system capacity is flexible and able to handle multiple inputs from a variety of sources and particularly suited to applications where the influent is pumped. | Contractor | All relevant worksites | Implemented |
| | | Open stockpiles of construction materials (for examples, aggregates, sand and fill material) of more than 50 m ³ should be covered with tarpaulin or similar fabric during rainstorms. Measures should be taken to prevent the washing away of construction materials, soil, silt or debris into any drainage system. | Contractor | All relevant worksites | Implemented |
| | | Manholes (including newly constructed ones) should always be adequately covered and temporarily sealed so as to prevent silt, construction materials or debris being washed into the drainage system and storm runoff being directed into foul sewers. | Contractor | All relevant worksites | Implemented |
| | | Precautions to be taken at any time of year when rainstorms are likely, actions to be taken when a rainstorm is imminent or forecast, and actions to be taken during or after rainstorms are summarised in Appendix A2 of ProPECC PN 1/94. Particular attention should be paid to the control of silty surface runoff during storm events. | Contractor | All relevant worksites | Implemented |

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|---------|----------|---|------------------------------|------------------------|---|
| | | Oil interceptors should be provided in the drainage system and regularly cleaned to prevent the release of oils and grease into the storm water drainage system after accidental spillages. The interceptor should have a bypass to prevent flushing during periods of heavy rain. | Contractor | All relevant worksites | Implemented |
| | | An adequately designed and located wheel washing bay should be provided at every site exit, and wash-water should have sand and silt settled out and removed at least on a weekly basis to ensure the continued efficiency of the process. The section of access road leading to, and exiting from, the wheel-wash bay to the public road should be paved with sufficient backfall toward the wheel-wash bay to prevent vehicle tracking of soil and silty water to public roads and drains. | Contractor | All relevant worksites | Implemented |
| | | <u>Drainage</u> | | | |
| | | It is recommended that on-site drainage system should be installed prior to the commencement of other construction activities. Sediment traps should be installed in order to minimise the sediment loading of the effluent prior to discharge into foul sewers. There should be no direct discharge of effluent from the site into the sea. | Contractor | All relevant worksites | Implemented |
| | | All temporary and permanent drainage pipes and culverts provided to facilitate runoff discharge should be adequately designed for the controlled release of storm flows. All sediment control measures should be regularly inspected and maintained to ensure proper and efficient operation at all times and particularly following rain storms. The temporarily diverted drainage should be reinstated to its original condition when the construction work has finished or the temporary diversion is no longer required. | Contractor | All relevant worksites | Implemented |
| | | <u>Stormwater Discharges</u> | | | |
| | | Minimum distances of 100 m should be maintained between the existing or planned stormwater discharges and the existing or planned seawater intakes. | Contractor | All relevant worksites | Implemented |
| | | <u>Sewage Effluent</u> | | | |
| | | Construction work force sewage discharges on site are expected to be connected to the existing trunk sewer or sewage treatment facilities. The construction sewage may need to be handled by portable chemical toilets prior to the commission of the on-site sewer system. Appropriate numbers of portable toilets should be provided by a licensed contractor to serve the large number of construction workers over the construction site. The Contractor should also be responsible for waste disposal and maintenance practices. | Contractor | All relevant worksites | Implemented |
| | | <u>Debris and Litter</u> | | | |
| | | In order to maintain water quality in acceptable conditions with regard to aesthetic quality, | Contractor | All relevant | Implemented |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|----------------------------------|---|---|------------------------------|------------------------|---|
| | | contractors should be required, under conditions of contract, to ensure that site management is optimised and that disposal of any solid materials, litter or wastes to marine waters does not occur. Debris and refuse generated on-site should be collected, handled and disposed of properly to avoid entering into the adjacent harbour waters. Stockpiles of cement and other construction materials should be kept covered when not being used. | | worksites | |
| | | <u>Accidental Spillage</u> | | | |
| | | Oils and fuels should only be used and stored in designated areas which have pollution prevention facilities. To prevent spillage of fuels and solvents to the nearby harbour waters, all fuel tanks and storage areas should be provided with locks and be sited on sealed areas, within bunds of a capacity equal to 110% of the storage capacity of the largest tank, to prevent spilled fuel oils from reaching the coastal waters of the Victoria Harbour WCZ. The bund should be drained of rainwater after a rain event. | Contractor | All relevant worksites | Implemented |
| <u>Waste Management Measures</u> | | | | | |
| | | <u>Waste Management Plan</u> | | | |
| AEIAR-174/2013 S11.4.8.1 | AEIAR-174/2013 EM&A Manual S9.2.1.2 | Contractor should be requested to submit an outline Waste Management Plan (WMP) prior to the commencement of construction work, in accordance with the ETWB TC(W) No.19/2005 so as to provide an overall framework of waste management and reduction. | Contractor | All relevant worksites | Implemented |
| | | <u>Good Site Practices</u> | | | |
| AEIAR-130/2009 S3.5, S5.5 | AEIAR 130/2009 EM&A Manual S2.5, S4.5 | Nomination of an approved person, such as a site manager, to be responsible for good site practices, arrangements for collection and effective disposal to an appropriate facility, of all wastes generated at the site. | Contractor | All relevant worksites | Implemented |
| | | Training of site personnel in proper waste management and chemical waste handling procedures. | Contractor | All relevant worksites | Implemented |
| | | Provision of sufficient waste disposal points and regular collection for disposal. | Contractor | All relevant worksites | Implemented |
| | | Appropriate measures to minimize windblown litter and dust during transportation of waste by either covering trucks or by transporting wastes in enclosed containers. | Contractor | All relevant worksites | Implemented |
| | | A recording system for the amount of wastes generated, recycled and disposed of (including the disposal sites). | Contractor | All relevant worksites | Implemented |
| | | <u>Waste Reduction Measures</u> | | | |
| | | Sort C&D waste from demolition of the remaining structures to recover recyclable portions such as metals. | Contractor | All relevant worksites | Implemented |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase |
|---------|----------|--|------------------------------|------------------------|-----------------------|
| | | | | | Implementation Status |
| | | Segregation and storage of different types of waste in different containers, skips or stockpiles to enhance reuse or recycling of materials and their proper disposal. | Contractor | All relevant worksites | Implemented |
| | | Encourage collection of aluminum cans, PET bottles and paper by providing separate labelled bins to enable these wastes to be segregated from other general refuse generated by the work force. | Contractor | All relevant worksites | Implemented |
| | | Any unused chemicals or those with remaining functional capacity should be recycled. | Contractor | All relevant worksites | Implemented |
| | | Proper storage and site practices to minimize the potential for damage or contamination of construction materials. | Contractor | All relevant worksites | Implemented |
| | | <u>Construction and Demolition Materials</u> | | | |
| | | Where it is unavoidable to have transient stockpiles of C&D material within the work site pending collection for disposal, the transient stockpiles shall be located away from waterfront or storm drains as far as possible. | Contractor | All relevant worksites | Implemented |
| | | Open stockpiles of construction materials or construction wastes on-site should be covered with tarpaulin or similar fabric. | Contractor | All relevant worksites | Implemented |
| | | Skip hoist for material transport should be totally enclosed by impervious sheeting. | Contractor | All relevant worksites | Implemented |
| | | Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving a construction site. | Contractor | All relevant worksites | Implemented |
| | | The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores. | Contractor | All relevant worksites | Implemented |
| | | The load of dusty materials carried by vehicle leaving a construction site should be covered entirely by clean impervious sheeting to ensure dust materials do not leak from the vehicle. | Contractor | All relevant worksites | Implemented |
| | | All dusty materials should be sprayed with water prior to any loading, unloading or transfer operation so as to maintain the dusty materials wet. | Contractor | All relevant worksites | Implemented |
| | | The height from which excavated materials are dropped should be controlled to a minimum practical height to limit fugitive dust generation from unloading. | Contractor | All relevant worksites | Implemented |
| | | When delivering inert C&D material to public fill reception facilities, the material should consist entirely of inert construction waste and of size less than 250mm or other sizes as agreed with the Secretary of the Public Fill Committee. In order to monitor the disposal of the surplus C&D material at the designed public fill reception facility and to control fly tipping, a trip-ticket system as stipulated in the ETWB TCW No. 31/2004 "Trip Ticket System for Disposal of Construction | Contractor | All relevant worksites | Implemented |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|--|---------------------------------------|---|------------------------------|------------------------|---|
| | | and Demolition Materials” should be included as one of the contractual requirements and implemented by an Environmental Team undertaking the Environmental Monitoring and Audit work. An Independent Environmental Checker should be responsible for auditing the results of the system. | | | |
| | | <u>Chemical Waste</u> | | | |
| | | After use, chemical wastes (for example, cleaning fluids, solvents, lubrication oil and fuel) should be handled according to the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes. Spent chemicals should be collected by a licensed collector for disposal at the CWTF or other licensed facility, in accordance with the Waste Disposal (Chemical Waste) (General) Regulation. | Contractor | All relevant worksites | Implemented |
| | | <u>General Refuse</u> | | | |
| | | General refuse should be stored in enclosed bins or compaction units separate from C&D material. A licensed waste collector should be employed by the contractor to remove general refuse from the site, separately from C&D material. Effective collection and storage methods (including enclosed and covered area) of site wastes would be required to prevent waste materials from being blown around by wind, wastewater discharge by flushing or leaching into the marine environment, or creating odour nuisance or pest and vermin problem. | Contractor | All relevant worksites | Implemented |
| Land Contamination Measures | | | | | |
| | | For any excavation works conducted at Radar Station | | | |
| AEIAR-130/2009 S3.6.57 | AEIAR 130/2009 EM&A Manual S4.6 | As the risk due to dermal contact with groundwater by site workers is uncertain, it is recommended that personnel protective equipment (PPE) be used by site workers as a mitigation measure. | Contractor | All relevant worksites | Not Applicable |
| Landscape and Visual Impact | | | | | |
| New Distributor Roads Serving the Planned KTD | | | | | |
| | | <u>Construction Phase</u> | | | |
| AEIAR-130/2009 S3.8.12 | AEIAR 130/2009 EM&A Manual S2.8 | All existing trees should be carefully protected during construction. | Contractor | All relevant worksites | Not Applicable |
| | | Trees unavoidably affected by the works should be transplanted where practical. Detailed transplanting proposal will be submitted to relevant government departments for approval in accordance with ETWBC 2/2004 and 3/2006. Final locations of transplanted trees should be agreed prior to commencement of the work. | Contractor | All relevant worksites | Not Applicable |
| | | Control of night-time lighting. | Contractor | All relevant | Not Applicable |

The copyright of this document is owned by Fugro Technical Services Limited. It may not be reproduced except with prior written approval from the Company.

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



| EIA Ref | EM&A Ref | Environmental Protection Measures / Mitigation Measures | Who to implement the measure | Location / Timing | Construction Phase Implementation Status |
|----------------------------|---|---|------------------------------|-------------------------------------|---|
| | | Erection of decorative screen hoarding. | Contractor | worksites All relevant worksites | Implemented |
| Trunk Road T2 | | | | | |
| | | <u>Construction Phase</u> | | | |
| AEIAR-174/2013 S9.9.1.1 | AEIAR-174/2013 EM&A Manual S7.2.1.2 | All works shall be carefully designed to minimize impacts on existing landscape resources and visually sensitive receivers. Existing trees within works area shall be retained and protected. | Contractor | All relevant worksites | Not Applicable |
| | | Existing trees of good quality and condition that are unavoidably affected by the works should be transplanted. | Contractor | All relevant worksites | Not Applicable |
| | | Large temporary stockpiles of excavated material shall be covered with unobtrusive sheeting to prevent dust and dirt spreading to adjacent landscape areas and vegetation, and to create a neat and tidy visual appearance. | Contractor | All relevant worksites | Implemented |
| | | Construction plant and building material shall be orderly and carefully stored in order to create a neat and tidy visual appearance. | Contractor | All relevant worksites | Implemented |
| | | Erection of decorative screen hoarding should be designed to be compatible with the existing urban context. | Contractor | All relevant worksites | Implemented |
| | | All lighting in construction site shall be carefully controlled to minimize light pollution and night-time glare to nearby residences and GIC user. The contractor shall consider other security measures, which shall minimize the visual impacts. | Contractor | All relevant worksites | Not Applicable |
| <u>General Condition</u> | | | | | |
| | | The Permit Holder shall display conspicuously a copy of this Permit on the Project site(s) at all vehicular site entrances/exits or at a convenient location for public's information at all times. The Permit Holder shall ensure that the most updated information about the Permit, including any amended Permit, is displayed at such locations. If the Permit Holder surrenders a part or the whole of the Permit, the notice he sends to the Director shall also be displayed at the same locations as the original Permit. The suspended, varied or cancelled Permit shall be removed from display at the Project site(s). | Contractor | All relevant worksites | Implemented |

Implementation status: Implemented / Partially Implemented / Not Implemented / Not Applicable

FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T.,
Hong Kong.

Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com



Appendix D

**Monthly EM&A Report
For
Contract No. KL/2015/02
Kai Tak Development - Stage 5A Infrastructure at Former North Apron Area**


Civil Engineering and Development Department

**Contract No. KLN/2016/04
Environmental Monitoring Works for
Contract No. KL/2015/02
Kai Tak Development – Stage 5A Infrastructure
at Former North Apron Area**

Quarterly EM&A Report

January to March 2019

(Version 1.1)

Approved By 
(Environmental Team Leader)

REMARKS:

The information supplied and contained within this report is, to the best of our knowledge, correct at the time of printing.

CINOTECH accepts no responsibility for changes made to this report by third parties

CINOTECH CONSULTANTS LTD
Room 1710, Technology Park,
18 On Lai Street,
Shatin, NT, Hong Kong
Tel: (852) 2151 2083 Fax: (852) 3107 1388
Email: info@cinotech.com.hk



FUGRO TECHNICAL SERVICES LIMITED

Fugro Development Centre,
5 Lok Yi Street, Tai Lam,
Tuen Mun, N.T., Hong Kong.
Tel : +852 2450 8233
Fax : +852 2450 6138
E-mail : matlab@fugro.com
Website : www.fugro.com

Date 11 April 2019

Our Ref. MCL/ED/0198/2019/C

Cinotech Consultants Limited
Rm 1710, Technology Park,
18 On Lai Street, Shatin,
New Territories,
Hong Kong

BY EMAIL

Attn.: Mr. K.S Lee

Dear Sir,

Contract No. KL/2015/02
Kai Tak Development –Stage 5A Infrastructure at Former North Apron
Verification of Quarterly EM&A Report – January 2019 to March 2019

We refer to your emails dated 8 and 10 April 2019 regarding the Quarterly EM&A Report (January 2019 to March 2019) for the captioned project prepared by the ET.

We have no further comment and hereby verify the captioned report.

Should you require further information, please do not hesitate to contact Mr. Wingo So at 3565 4374 or the undersigned on 3565 4114.

Assuring you of our best attention at all times.

Yours faithfully,
For and on behalf of
FUGRO TECHNICAL SERVICES LIMITED

Colin K. L. Yung
Independent Environmental Checker

CY/ws

c.c. CEDD –
AECOM –

Attn.: Mr. Ricky Chan
Attn.: Mr. Jeremy Yuen
Attn.: Mr. Vincent Lee
Attn.: Mr. Teddy Shih

TABLE OF CONTENTS

| | Page |
|---|-----------|
| EXECUTIVE SUMMARY | 1 |
| Introduction | 1 |
| Environmental Monitoring Works | 2 |
| Environmental Licenses and Permits | 3 |
| Key Information in the Reporting Period..... | 4 |
| 1. INTRODUCTION | 5 |
| Background | 5 |
| Project Organizations | 5 |
| 2. ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS..... | 7 |
| Monitoring Parameters and Monitoring Locations | 7 |
| Monitoring Methodology and Calibration Details | 7 |
| Environmental Quality Performance Limits (Action and Limit Levels) | 7 |
| Implementation Status of Environmental Mitigation Measures | 7 |
| Site Audit Summary | 7 |
| Status of Waste Management..... | 7 |
| 3. MONITORING RESULTS | 8 |
| Weather Conditions..... | 8 |
| Air Quality | 8 |
| Construction Noise..... | 8 |
| Landscape and Visual | 8 |
| Influencing Factors on the Monitoring Results..... | 8 |
| Comparison of EM&A results with EIA predictions..... | 9 |
| 4. NON-COMPLIANCE (EXCEEDANCES) OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS (ACTION AND LIMIT LEVELS)..... | 10 |
| Summary of Exceedances | 10 |
| Review of the Reasons for and the Implications of Non-compliance..... | 10 |
| Summary of Environmental Complaints and Prosecutions | 10 |
| 5. COMMENTS, CONCLUSIONS AND RECOMMENDATIONS | 11 |
| Effectiveness of Mitigation Measures..... | 11 |

LIST OF TABLE

| | |
|-----------|---|
| Table I | Air Quality and Noise Monitoring Stations for this Project |
| Table II | Summary Table for Non-compliance Recorded in the Reporting period |
| Table III | Summary of Environmental Licensing and Permit Status |
| Table IV | Summary Table for Key Information in the Reporting period |
| Table 1.1 | Key Project Contacts |

LIST OF FIGURES

| | |
|----------|---|
| Figure 1 | Layout Plan of the Project |
| Figure 2 | Locations of Air Quality Monitoring Stations |
| Figure 3 | Locations of Construction Noise Monitoring Stations |

LIST OF APPENDICES

| | |
|---|--|
| A | Monitoring Requirements |
| B | Action and Limit Levels for Air Quality and Noise |
| C | Graphical Presentation of Air Quality Monitoring Results |
| D | Graphical Presentation of Noise Monitoring Results |
| E | Environmental Mitigation Implementation Schedule (EMIS) |
| F | Site Audit Summary |
| G | Waste Generated Quantity |
| H | Summary of Exceedances |
| I | Comparison of EM&A Data and EIA Predictions |

EXECUTIVE SUMMARY

Introduction

1. This is the 9th Quarterly Environmental Monitoring and Audit (EM&A) Report prepared by Cinotech Consultants Limited for the “Contract No. KL/2015/02 - Kai Tak Development – Stage 5A Infrastructure at Former North Apron Area” (hereinafter called “the Project”). This contract comprises one Schedule 2 designated project (DP), namely the new distributor Road D1 serving the planned KTD. The DP is part of the designated project under Environmental Permit (EP) No.: EP-337/2009 (“New distributor roads serving the planned Kai Tak Development”) respectively. This summary report presents the EM&A works performed in the period between January 2019 and March 2019.
2. With reference to the same principle of EIA report of the Project, air quality monitoring stations within 500m and noise monitoring stations within 300m from the boundary of this Project are considered as relevant monitoring locations. In such regard, the relevant air quality and noise monitoring locations are tabulated in **Table I** (see **Figure 2** and **3** for their locations).

Table I – Air Quality and Noise Monitoring Stations for this Project

| Locations | Monitoring Stations In accordance with EM&A Manual | Alternative Monitoring Stations |
|--|--|---|
| Air Quality Monitoring Stations | | |
| AM2 - Lee Kau Yan Memorial School | Yes (1-hour TSP) | N/A |
| | No (24-hour TSP) | AM2(A) – Ng Wah Catholic Secondary School |
| Noise Monitoring Stations | | |
| M3 - Cognitio College | Yes | N/A |
| M4 - Lee Kau Yan Memorial School | Yes | N/A |
| M5 – Nam Yuen | No | M5(C) – Mercy Grace’s Home |

3. The construction activities undertaken in the reporting period were:

January 2019

- Excavate with ELS works for subway construction at PERE
- Structural works and backfilling works for subway SW6 from CH0 to CH34 and Staircase ST3
- Demolish the existing K73 parapet for temporary slip road (Stage 4)
- Remedial / outstanding work for drainage and sewerage at Portion 2&3
- Construction of subsoil drain at retaining wall S15
- Reinstatement of chain-link fence for handover of Site
- Drainage and sewerage works in portion 4
- DCS works in Road D1 of Portion 6 & Portion 1
- DCS works in Road L7 of Portion 1

February 2019

- Structural works and backfilling works for subway SW6 from CH0 to CH45 and Staircase ST3
- Fabricate the underpinning frames
- Demolish the K73 parapet wall for slip road of stage 4
- Construction of chain-link fence for land sale sites
- Filling work for slip road S15
- Drainage works at slip road S15
- DCS works at Road D1 of Portion 1 and Portion 6
- DCS works at Road L7 of Portion 1
- Sewerage works at Portion 4

March 2019

- Structural works and backfilling works for subway construction at PERE
- Backfilling works for subway SW6 from CH0 to CH45 and Staircase ST3
- Erection of underpinning frame at the existing Bridge K72
- Sheet piling works at SKLR playground (Stage 4)
- Construction of chain-link fence for land sale sites
- Filling work for slip road S15
- Drainage works at slip road S15
- DCS Works in Road D1, road L7, Portion 6, Portion 1
- Water mains laying works in Portion 4

Environmental Monitoring Works

4. Environmental monitoring for the Project was performed in accordance with the EM&A Manual and the monitoring results were checked and reviewed. Site Inspections/Audits were conducted once per week. The implementation of the environmental mitigation measures, Event Action Plans and environmental complaint handling procedures were also checked.

5. Summary of the non-compliance in the reporting period for the Project is tabulated in **Table II**.

Table II Non-compliance Record for the Project in the Reporting Period

| Parameter | No. of Exceedance | | Action Taken |
|---------------|-------------------|-------------|--------------|
| | Action Level | Limit Level | |
| January 2019 | | | |
| 1-hr TSP | 0 | 0 | N/A |
| 24-hr TSP | 0 | 0 | N/A |
| Noise | 0 | 0 | N/A |
| February 2019 | | | |
| 1-hr TSP | 0 | 0 | N/A |
| 24-hr TSP | 0 | 0 | N/A |
| Noise | 0 | 0 | N/A |
| March 2019 | | | |
| 1-hr TSP | 0 | 0 | N/A |
| 24-hr TSP | 0 | 0 | N/A |
| Noise | 0 | 0 | N/A |

1-hour & 24-hour TSP Monitoring

6. All 1-hour & 24-hour TSP monitoring was conducted as scheduled in the reporting period. No Action/Limit Level exceedance was recorded.

Construction Noise

7. All construction noise monitoring was conducted as scheduled in the reporting period. No Action/Limit Level exceedance was recorded.

Environmental Licenses and Permits

8. All permit/licenses obtained for the Project are summarized in **Table III**.

Table III Summary of Environmental Licensing and Permit Status

| Permit No. | Valid Period | | Status |
|--|--------------|----------|--------|
| | From | To | |
| Environmental Permit (EP) | | | |
| EP-337/2009 | 23/04/09 | N/A | Valid |
| Effluent Discharge License | | | |
| WT00027495-2017 | 28/03/17 | 31/03/22 | Valid |
| Billing Account for Construction Waste Disposal | | | |
| A/C# 7026164 | 20/10/16 | N/A | Valid |
| Registration of Chemical Waste Producer | | | |
| WPN5213-229-P3271-01 | 14/08/17 | N/A | Valid |
| Construction Noise Permit (CNP) | | | |
| - | - | - | - |

Key Information in the Reporting Period

9. Summary of key information in the reporting period is tabulated in **Table IV**.

Table IV Summary Table for Key Information in the Reporting Period

| Event | Event Details | | Action Taken | Status | Remark |
|--|---------------|--------|--------------|--------|--------|
| | Number | Nature | | | |
| Complaint received | 0 | --- | N/A | N/A | --- |
| Reporting Changes | 0 | --- | N/A | N/A | --- |
| Notifications of any summons & prosecutions received | 0 | --- | N/A | N/A | --- |

10. Environmental monitoring works for the Project are considered effective and is generating data to categorically identify the environmental impacts from the works and influencing factors in the vicinity of monitoring stations.

1. INTRODUCTION

Background

- 1.1 The Kai Tak Development (KTD) is located in the south-eastern part of Kowloon Peninsula, comprising the apron and runway areas of the former Kai Tak Airport and existing waterfront areas at To Kwa Wan, Ma Tau Kok, Kowloon Bay, Kwun Tong and Cha Kwo Ling. It covers a land area of about 328 hectares. Stage 5A Infrastructure at Former North Apron Area is one of the construction stages of KTD. It contains one Schedule 2 DP including new distributor roads serving the planned KTD. The general layout of the Project is shown in **Figure 1**.
- 1.2 One Environmental Permit (EP) No. EP-337/2009 was also issued on 23 April 2009 for new distributor roads serving the planned KTD to Civil Engineering and Development Department as the Permit Holder.
- 1.3 A study of environmental impact assessment (EIA) was undertaken to consider the key issues of air quality, noise, water quality, waste, land contamination, cultural heritage and landscape and visual impact, and identify possible mitigation measures associated with the works. An EIA Report (Register No. AEIAR-130/2009) was approved by the Environmental Protection Department (EPD) on 4 April 2009.
- 1.4 Cinotech Consultants Limited (Cinotech) was commissioned by Civil Engineering and Development Department (CEDD) to undertake the role of the Environmental Team (ET) for the Contract No. KL/2015/02 – Stage 5A Infrastructure at Former North Apron Area. The construction work under KL/2015/02 comprises the construction of part of the Road D1 under the EP (EP-337/2009).
- 1.5 Cinotech Consultants Limited was commissioned by Civil Engineering and Development Department (CEDD) to undertake the Environmental Monitoring and Audit (EM&A) works for the Project. The commencement date of construction of Road D1 (part) under this Contract was on 16 January 2017. This summary report presents the EM&A works performed in the period between January 2019 and March 2019.

Project Organizations

- 1.5 Different parties with different levels of involvement in the project organization include:
- Project Proponent – Civil Engineering and Development Department (CEDD).
 - The Engineer and the Engineer's Representative (ER) – AECOM Asia Co. Ltd (AECOM).
 - Environmental Team (ET) – Cinotech Consultants Limited (CCL).
 - Independent Environmental Checker (IEC) – Fugro Technical Services Limited (FTS).
 - Contractor – Peako - Wo Hing Joint Venture (PWHJV).
- 1.6 The key contacts of the Project are shown in **Table 1.1**.

Table 1.1 Key Project Contacts

| Party | Role | Contact Person | Position | Phone No. | Fax No. |
|--------------|-----------------------------------|----------------------------|-----------------------------------|------------------|----------------|
| CEDD | Project Proponent | Mr. CHAN Wai Kit, Ricky | Senior Engineer | 2116 3753 | 2116 0714 |
| AECOM | Engineer's Representative | Mr. Vincent Lee | SRE | 2798 0771 | 2210 6110 |
| Cinotech | Environmental Team | Mr. K.S Lee | Environmental Team Leader | 2151 2091 | 3107 1388 |
| | | Ms. Betty Choi | Audit Team Leader | 2151 2072 | |
| FTS | Independent Environmental Checker | Mr. Colin Yung | Independent Environmental Checker | 3565 4114 | 2450 8032 |
| PWHJV | Contractor | Mr. W.M. Wong | Site Agent | 6386 3535 | 2398 8301 |

2. ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS

Monitoring Parameters and Monitoring Locations

- 2.1 The EM&A Manual designates locations for the ET to monitor environmental impacts in terms of air quality, noise, landscape and visual due to the Project. The Project area and monitoring locations are depicted in **Figures 2 and 3**. **Appendix A** gives details of monitoring requirements.

Monitoring Methodology and Calibration Details

- 2.2 Monitoring works/equipments were conducted/calibrated regularly in accordance with the EM&A Manual. Copies of calibration certificates are attached in the appendices of the Monthly EM&A Reports.

Environmental Quality Performance Limits (Action and Limit Levels)

- 2.3 The environmental quality performance limits, i.e. Action and Limit Levels were derived from the baseline monitoring results. Should the measured environmental quality parameters exceed the Action/Limit Levels, the respective action plans would be implemented. The Action/Limit Levels for each environmental parameter are given in **Appendix B**.

Implementation Status of Environmental Mitigation Measures

- 2.4 Relevant mitigation measures as recommended in the project EIA report have been stipulated in the EM&A Manual for the Contractor to implement. The implementation status of environmental mitigation measures (EMIS) is given in **Appendix E**.

Site Audit Summary

- 2.5 During site inspections in the reporting period, no non-conformance was identified. The observations and recommendations made during the reporting period are summarized in **Appendix F**.

Status of Waste Management

- 2.6 The amount of wastes generated by the major site activities of this Project during the reporting month is shown in **Appendix G**.

3. MONITORING RESULTS

Weather Conditions

- 3.1 The weather conditions was generally sunny and cloudy during the monitoring sessions of this reporting period. The detail of weather conditions for each individual monitoring session was presented in monthly EM&A report.

Air Quality

1-hour TSP Monitoring

- 3.2 1-hour TSP monitoring at monitoring station, AM2 - Lee Kau Yan Memorial School, was conducted as schedule in the reporting period. No Action/Limit Level exceedance was recorded for 1-hr TSP monitoring in the reporting period.

24-hour TSP Monitoring

- 3.3 24-hr TSP monitoring at monitoring station, AM2(A) – Ng Wah Catholic Secondary School Lee Kau Yan Memorial School was conducted as schedule in the reporting period. No Action/Limit Level exceedance was recorded for 24-hr TSP monitoring in the reporting period.

- 3.4 The graphical presentations of the air quality monitoring results are shown in **Appendix C**.

Construction Noise

- 3.5 Noise monitoring at 3 monitoring stations, M3 – Cognito College, M4 – Lee Kau Yan Memorial College and M5(C) – Mercy Grace’s Home, was conducted as schedule in the reporting period. No Action/Limit Level exceedance was recorded for construction noise monitoring in the reporting period.

- 3.6 The graphical presentations of the noise monitoring results are shown in **Appendix D**.

Landscape and Visual

- 3.7 Site audits were carried out on a weekly basis to monitor and audit the timely implementation of landscape and visual mitigation measures within KTD. No non-compliance of the landscape and visual impact was recorded in the reporting period.

Influencing Factors on the Monitoring Results

- 3.8 During the reporting period, the major dust and noise sources identified at the designated monitoring stations are as follows:
- AM2 – Lee Kau Yan Memorial School –
 - Road Traffic Dust
 - Exposed site area and open stockpiles
 - Excavation works
 - Site vehicle movement

- AM2(A) – Ng Wah Catholic Secondary School –
- Road Traffic Dust
- Exposed site area and open stockpiles
- Excavation works
- Site vehicle movement

- M3 – Cognito College –
- Daily school activities
- Traffic Noise

- M4 – Lee Kau Yan Memorial School –
- Daily school activities
- Traffic Noise
- Site vehicle movement
- Excavation works
- Piling works

- M5(C) – Mercy Grace’s Home –
- Site vehicle movement
- Traffic Noise

Comparison of EM&A results with EIA predictions

- 3.9 The EM&A data was compared with the EIA predictions and summarized in **Appendix I**.
- 3.10 The 1-hour and 24-hour average TSP concentration in the reporting period were below the prediction of the approved Environmental Impact Assessment (EIA) Report and no Action/Limit Level exceedance was recorded in the reporting period.
- 3.11 Mitigated construction noise levels at M5(C) were not predicted in EIA Report.
- 3.12 The noise monitoring results in the reporting month at M3 and M4 were outside the range of the predicted mitigated construction noise levels in the EIA Report.
- 3.13 Road traffic noise from Prince Edward Road East recorded during the monitoring period was considered to be the reason behind the discrepancy between the EM&A data and EIA predictions.

4. NON-COMPLIANCE (EXCEEDANCES) OF THE ENVIRONMENTAL QUALITY PERFORMANCE LIMITS (ACTION AND LIMIT LEVELS)

Summary of Exceedances

4.1 Environmental monitoring works were performed in the reporting period and all monitoring results were checked and reviewed. A summary of exceedances is attached in **Appendix H**. The details of each exceedance were attached in the Monthly EM&A Reports.

Air Quality

4.2 No Action/ Limit Level exceedance was recorded in the reporting period.

Construction Noise

4.3 No Action/ Limit Level exceedance was recorded in the reporting period.

Landscape and Visual

4.4 No non-compliance of the landscape and visual impact was recorded in the reporting period.

Review of the Reasons for and the Implications of Non-compliance

4.5 There was no non-compliance from the site audits in the reporting period. The observations and recommendations made in each individual site audit session were attached in the **Appendix F**.

Summary of Environmental Complaints and Prosecutions

4.6 No environmental complaints was received during the reporting period.

4.7 No environmental prosecution was received during the reporting period.

4.8 No warning, summon and notification of successful prosecution was received in the reporting period.


4.9 There were no warnings, summons and successful prosecutions received since the commencement of the Project.

5. COMMENTS, CONCLUSIONS AND RECOMMENDATIONS

Effectiveness of Mitigation Measures

- 5.1 The mitigation measures recommended in the EIA report are considered effective in minimizing environmental impacts.
- 5.2 The Contractor has implemented the recommended mitigation measures except those mitigation measures not applicable at this stage.
- 5.3 Environmental monitoring works were performed in the reporting period and all monitoring results were checked and reviewed. No non-compliance (exceedances) of Action/Limit Level was recorded.
- 5.4 No environmental complaint was received in the reporting period.
- 5.5 No environmental prosecution was received in the reporting period.

FIGURES

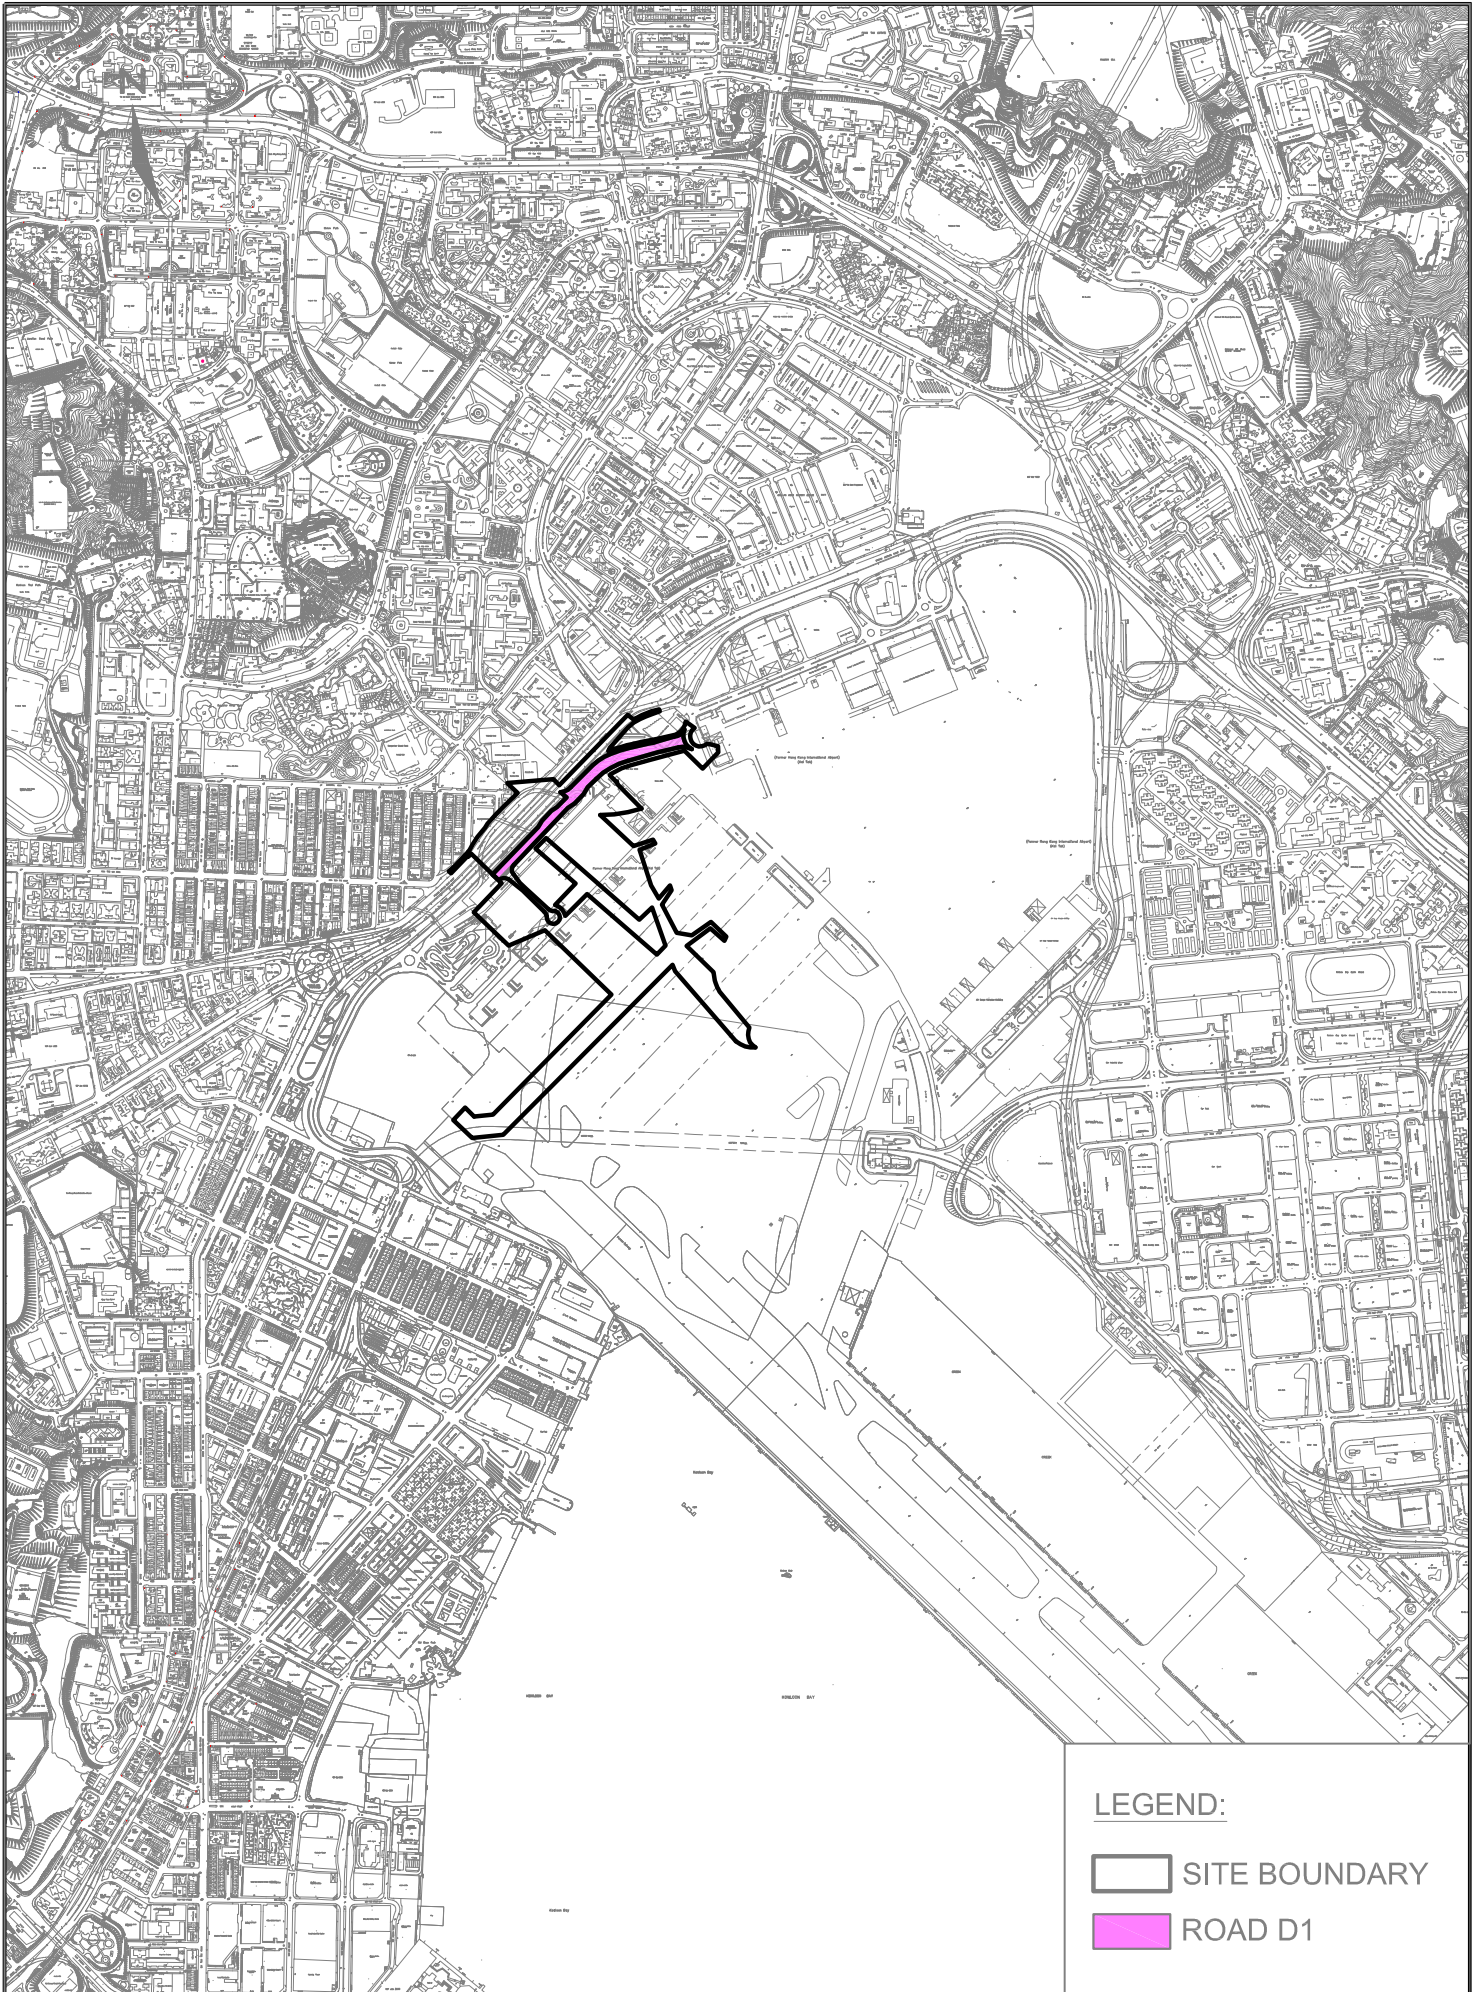

LEGEND:

 SITE BOUNDARY


 ROAD D1




KL/2015/02 KAI TAK - STAGE 5A INFRASTRUCTURE
AT FORMER NORTH APRON AREA

SITE LAYOUT PLAN

| | | | |
|---------|-----------|------------|----------|
| SCALE | 1:1500@A4 | DATE | DEC 2016 |
| CHECK | KC | DRAWN | JW |
| JOB No. | MA16043 | FIGURE NO. | 1 |
| | | REV | - |

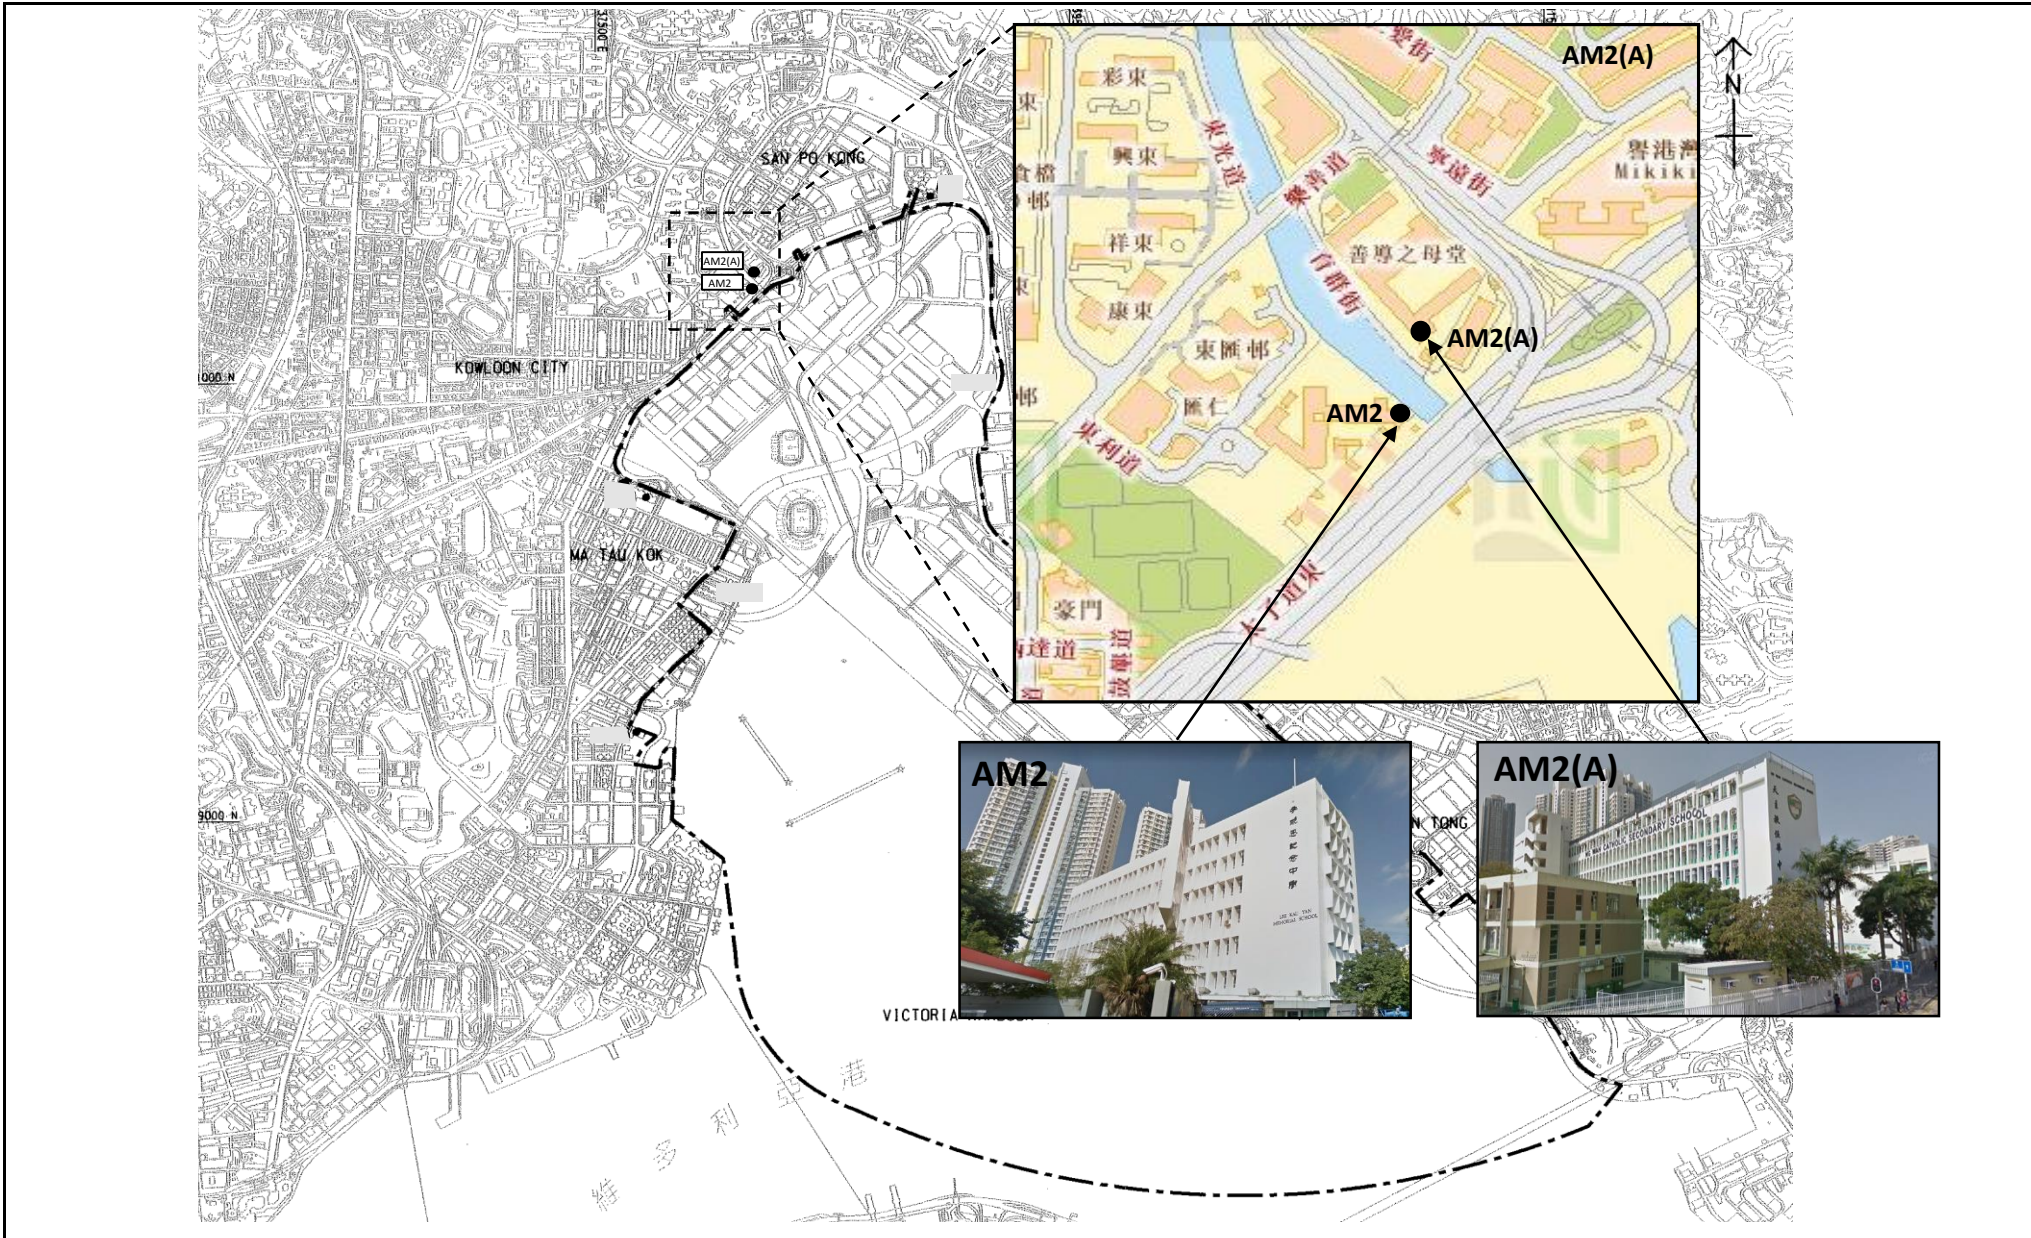

| | | | | | |
|--|--|--|--------|-------------|----------|
| Title | Contract No. KLN/2016/04 | | Scale | Project | CINOTECH |
| | Environmental Monitoring Works for Contract No. KL/2015/02 | | N.T.S | No. MA16043 | |
| Kai Tak Development – Stage 5A Infrastructure at Former North Apron Area | | | Date | Figure | |
| Location of Air Quality Monitoring Stations | | | Aug-17 | 2 | |

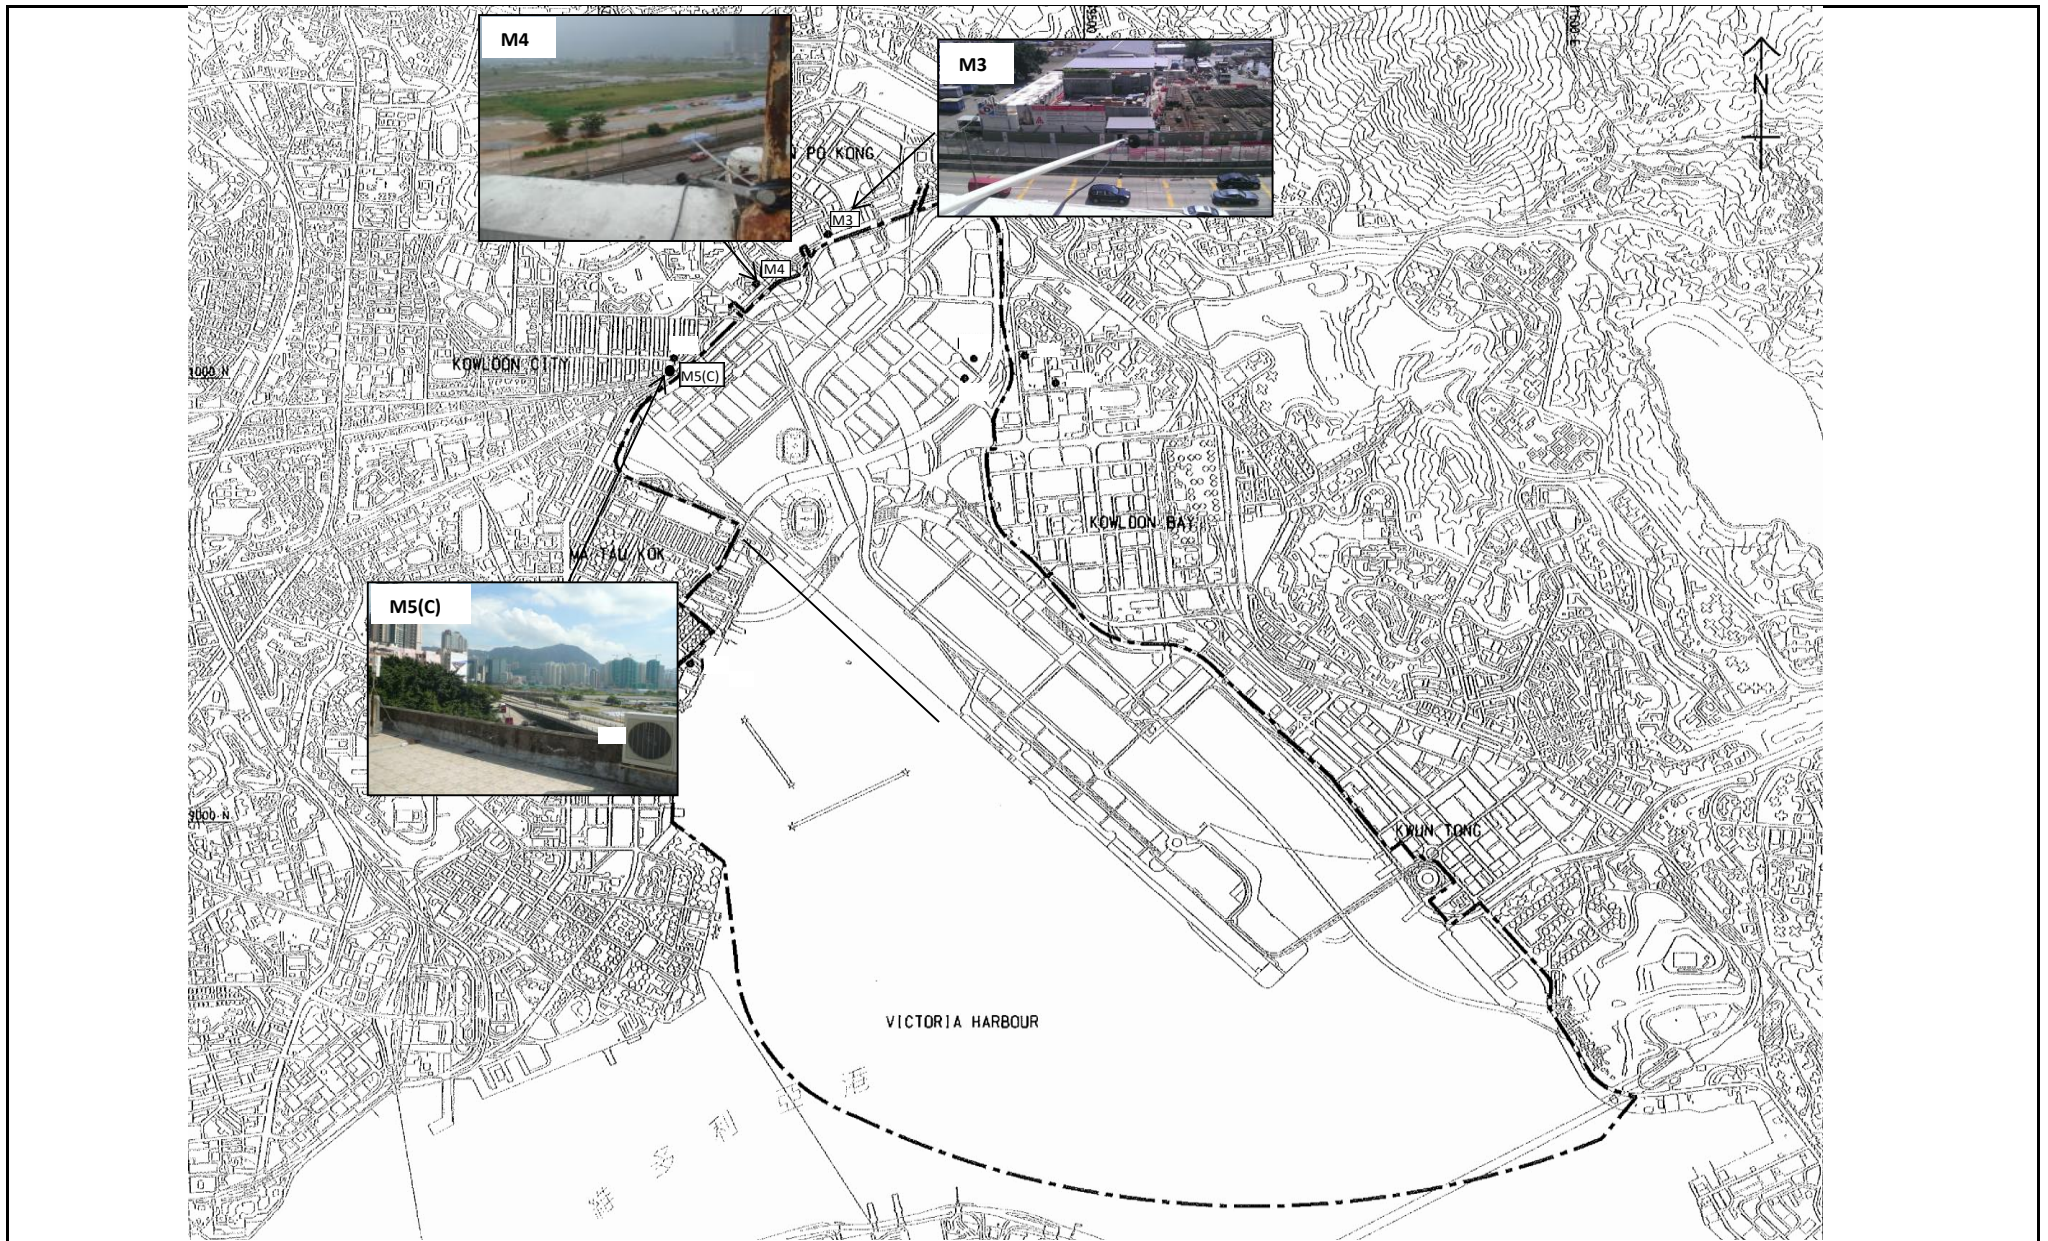

| | | | | |
|-------|---|--|--------|-------------|
| Title | Contract No. KLN/2016/04 | | Scale | Project |
| | Environmental Monitoring Works for Contract No. KL/2015/02 | | N.T.S | No. MA16043 |
| | Kai Tak Development –Stage 5A Infrastructure at Former North Apron Area | | Date | Figure |
| | Noise Monitoring Stations under Contract No.: KLN/2013/16 and KLN/2016/09 | | Mar-17 | 3 |



**APPENDIX A
MONITORING REQUIREMENTS**

Appendix A - Environmental Impact Monitoring Requirements

| Type of Monitoring | Parameter | Frequency | Location | Measurement Conditions |
|--------------------|-------------|----------------------|---|---|
| Air Quality | 1 hour TSP | Three times / 6 days | <ul style="list-style-type: none"> • AM2 – Lee Kau Yan Memorial School (1 hour TSP) • AM2(A) – Ng Wah Catholic Secondary School (24 hour TSP) | <ul style="list-style-type: none"> • AM2 – Rooftop (about 8/F) Area • AM2(A) – Rooftop (about 8/F) Area |
| | 24 hour TSP | Once / 6 days | | |

| Type of Monitoring | Parameter | Frequency | Location | Measurement Conditions |
|--------------------|---|---------------|---|--|
| Construction Noise | L _{eq} , L ₉₀ & L ₁₀ at 30 minute intervals during (0700 to 1900 on normal weekdays) | Once per week | <ul style="list-style-type: none"> • M3 (Cognitio College) • M4 (Lee Kau Yan Memorial School) • M5(C) (Mercy Grace's Home) | <ul style="list-style-type: none"> • M3 - Facade measurement at Rooftop (about 6/F) Area • M4 - Facade measurement at Rooftop (about 7/F) Area • M5(C) – Façade measurement at Rooftop (about 5/F) Area |

**APPENDIX B
ACTION AND LIMIT LEVELS FOR AIR
QUALITY AND NOISE**

Appendix B - Action and Limit Levels

Table B-1 Action and Limit Levels for 1-Hour TSP

| Location | Action Level, $\mu\text{g}/\text{m}^3$ | Limit Level, $\mu\text{g}/\text{m}^3$ |
|----------|--|---------------------------------------|
| AM2 | 346 | 500 |

Table B-2 Action and Limit Levels for 24-Hour TSP

| Location | Action Level, $\mu\text{g}/\text{m}^3$ | Limit Level, $\mu\text{g}/\text{m}^3$ |
|----------|--|---------------------------------------|
| AM2(A) | 157 | 260 |

Table B-3 Action and Limit Levels for Construction Noise


| Time Period | Action Level | Limit Level |
|----------------------------------|---|------------------------------|
| 0700-1900 hrs on normal weekdays | When one documented complaint is received | 75 dB(A) 70dB(A)/65dB(A)* |

Remarks: If works are to be carried out during restricted hours, the conditions stipulated in the Construction Noise Permit (CNP) issued by the Noise Control Authority have to be followed. *70dB(A) and 65dB(A) for schools during normal teaching periods and school examination periods, respectively.


**APPENDIX C
GRAPHICAL PRESENTATION OF AIR
QUALITY MONITORING RESULTS**

Appendix C – Graphical Representation of Air Quality Monitoring Results

1-hr TSP Concentration Levels

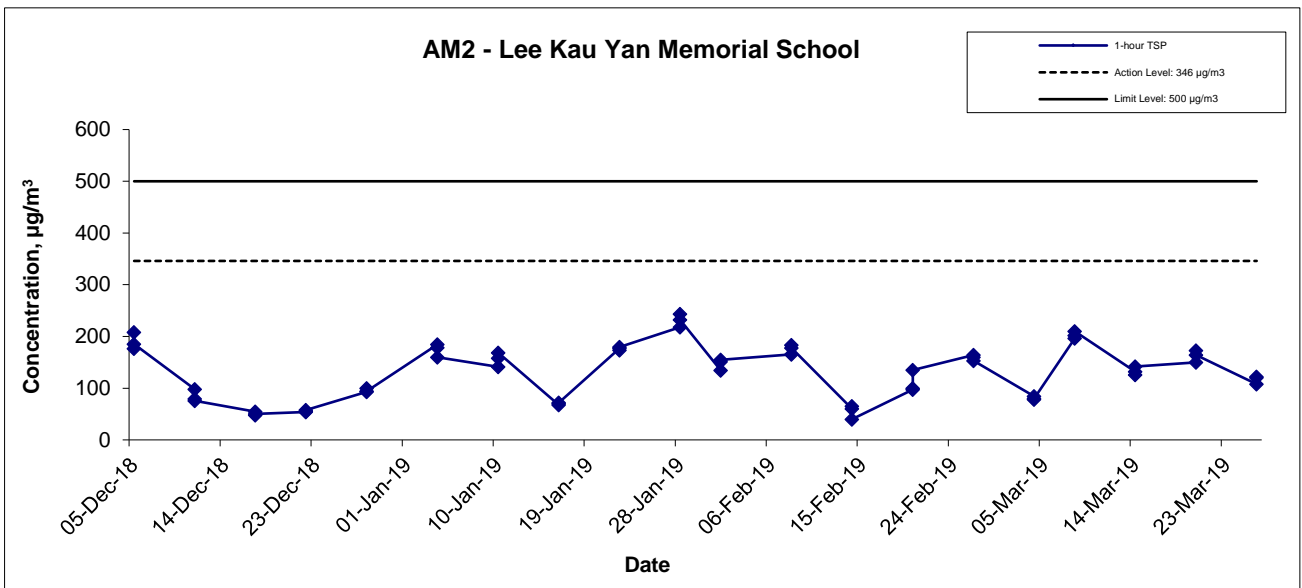

24-hr TSP Concentration Levels



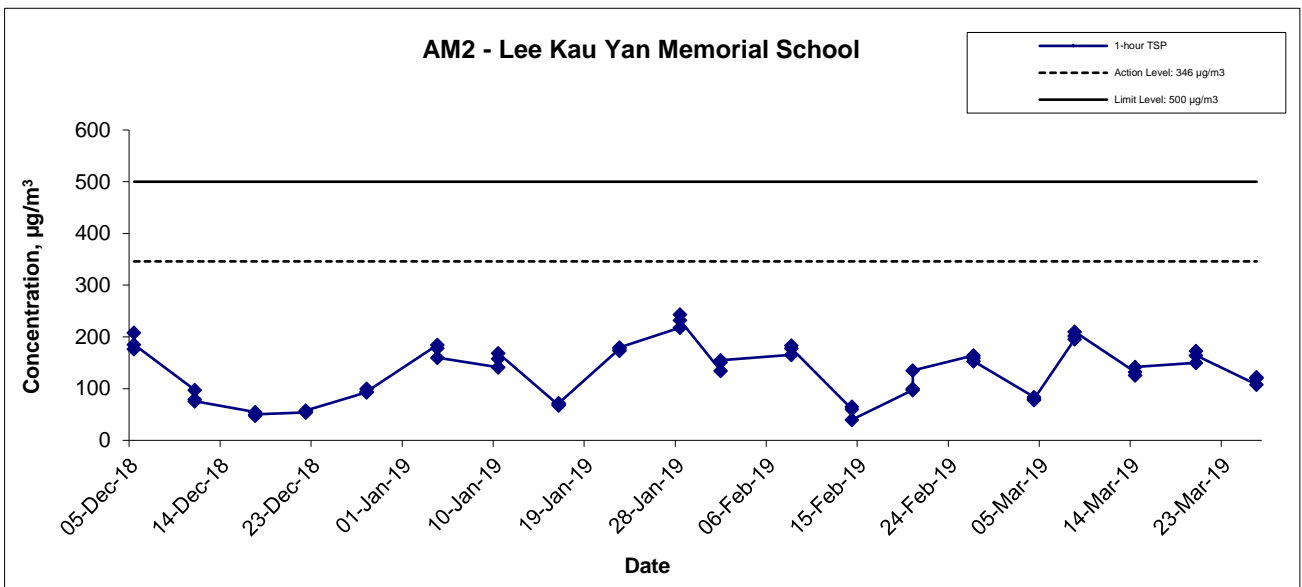


| | | | |
|---|----------------|------------------------|--|
| Title Contract No. KLN/2016/04 Environmental Monitoring Works for Contract No. KL/2015/02 Kai Tak Development –Stage 5A Infrastructure at Former North Apron Area Graphical Presentation of 1-hr & 24 hr TSP Monitoring Results | Scale N.T.S | Project No. MA16043 | |
| | Date Mar 19 | Appendix C | |

**APPENDIX D
GRAPHICAL PRESENTATION OF
NOISE MONITORING RESULTS**

Appendix D – Graphical Representation of Noise Quality Monitoring Results

Noise Levels

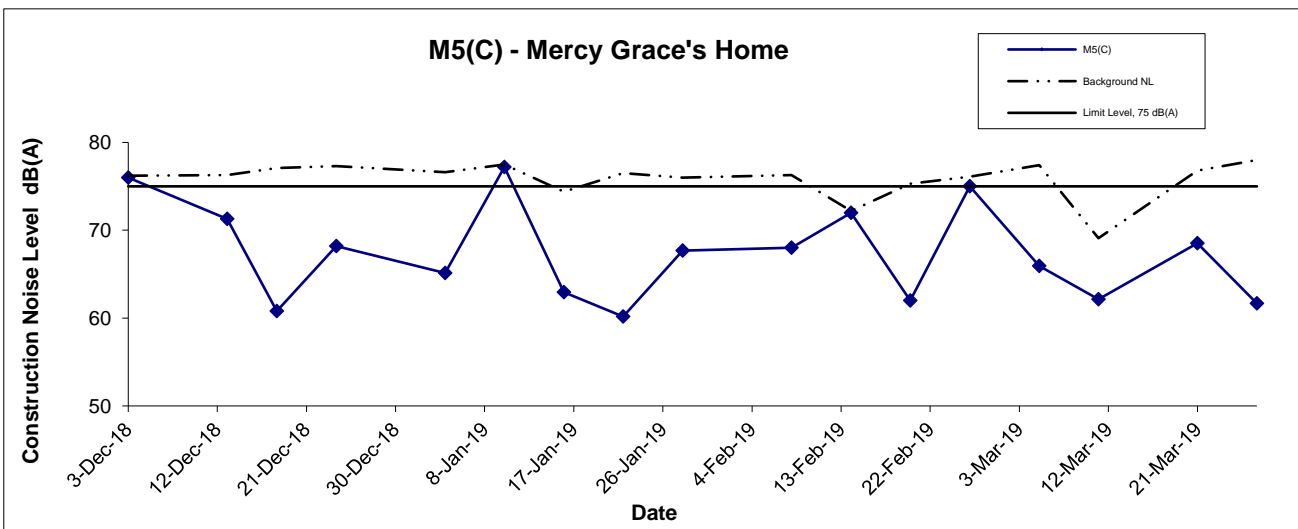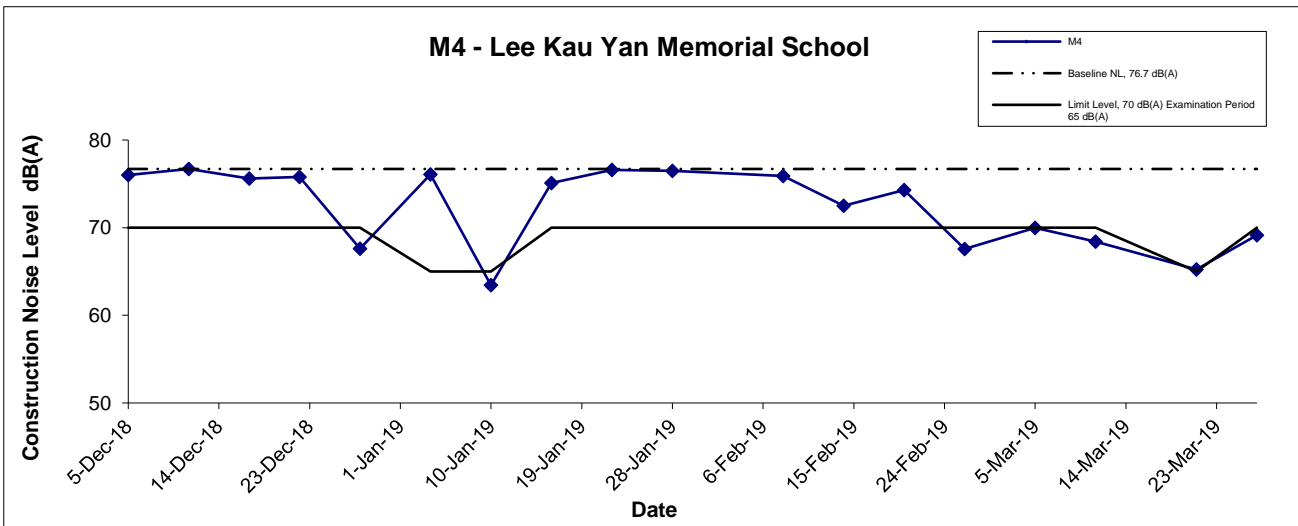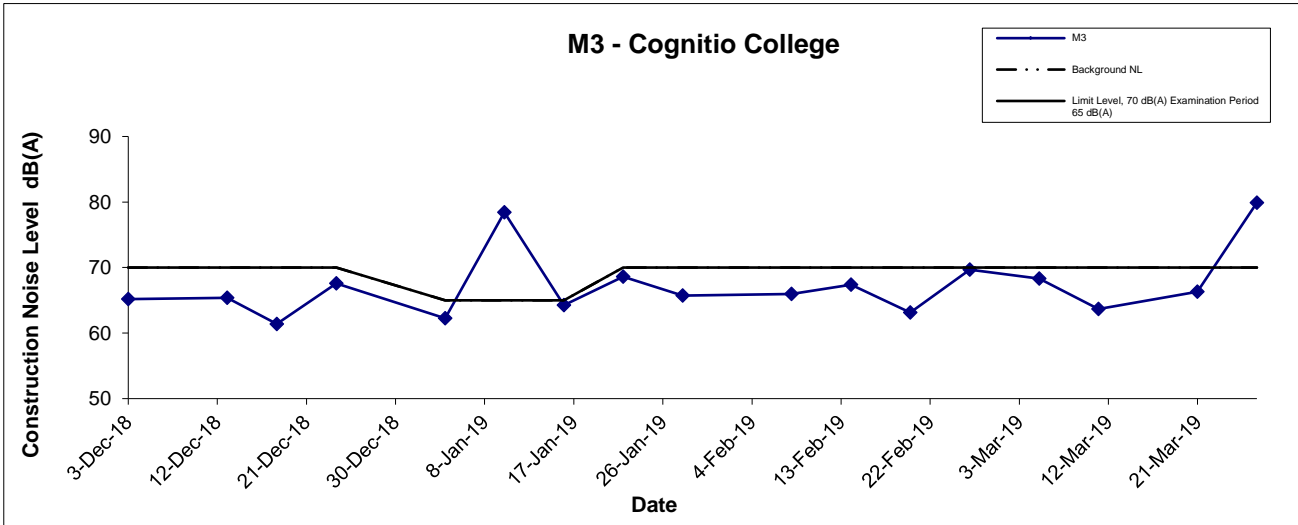

| | | | |
|---|----------------|------------------------|--|
| Title Contract No. KLN/2016/04 Environmental Monitoring Works for Contract No. KL/2015/02 Kai Tak Development – Stage 5A Infrastructure at Former North Apron Area Graphical Presentation of Noise Monitoring Results | Scale N.T.S | Project No. MA16043 | |
| | Date Mar 19 | Appendix D | |

**APPENDIX E
ENVIRONMENTAL MITIGATION
IMPLEMENTATION SCHEDULE (EMIS)**

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| EIA Ref. | Recommended Mitigation Measures | Implementation Status |
|--|--|--|
| <i>Construction Air Quality</i> | | |
| S6.5 | 8 times daily watering of the work site with active dust emitting activities. | ^ |
| S6.8 | <p>Implementation of dust suppression measures stipulated in Air Pollution Control (Construction Dust) Regulation. The following mitigation measures, good site practices and a comprehensive dust monitoring and audit programme are recommended to minimize cumulative dust impacts.</p> <ul style="list-style-type: none"> • Stockpiling site(s) should be lined with impermeable sheeting and banded. Stockpiles should be fully covered by impermeable sheeting to reduce dust emission. • Misting for the dusty material should be carried out before being loaded into the vehicle. Any vehicle with an open load carrying area should have properly fitted side and tail boards. • Material having the potential to create dust should not be loaded from a level higher than the side and tail boards and should be dampened and covered by a clean tarpaulin. • The tarpaulin should be properly secured and should extent at least 300 mm over the edges of the sides and tailboards. The material should also be dampened if necessary before transportation. • The vehicles should be restricted to maximum speed of 10 km per hour and confined haulage and delivery vehicle to designated roadways insider the site. Onsite unpaved roads should be compacted and kept free of lose materials. • Vehicle washing facilities should be provided at every vehicle exit point. • The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores. • Every main haul road should be scaled with concrete and kept clear of dusty materials or sprayed with water so as to maintain the entire road surface wet. • Every stock of more than 20 bags of cement should be covered entirely by impervious sheeting placed in an area sheltered on the top and the three sides. • Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving the construction sites. | <p>*</p> <p>^</p> <p>^</p> <p>^</p> <p>*</p> <p>^</p> <p>^</p> <p>^</p> <p>*</p> <p>^</p> <p>^</p> |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|-------------|--|---|
| <p>S6.8</p> | <ul style="list-style-type: none"> <li data-bbox="324 215 1585 526"> <p>• <u>DWFI compound for JVBC:</u> A DWFI compound is proposed at the downstream of JVC to contain pollution in drainage systems entering the KTAC and KTTS by interception facilities until the ultimate removal of the pollution sources. Tidal barriers and desilting facilities will form part of the compounds to prevent any accumulation of sediment within the downstream section of JVBC and hence fully mitigate the potential odour emissions from the headspace of JVBC near the existing discharge locations. The odour generating operations within the proposed desilting compound will be fully enclosed and the odorous air will be collected and treated by high efficiency deodorizers before discharge to the atmosphere.</p> <li data-bbox="324 550 1585 861"> <p>• <u>Desilting compound for KTN:</u> Two desilting compounds are proposed for KTN (at Site 1D6 and Site 1P1) to contain pollution in drainage systems entering the KTAC and KTTS by interception facilities until the ultimate removal of the pollution sources. Tidal barriers and desilting facilities will form part of the compounds to prevent any accumulation of sediment within the downstream section of KTN and hence fully mitigate the potential odour emissions from the headspace of KTN near the existing discharge locations. The odour generating operations within the proposed desilting compound will be fully enclosed and the odorous air will be collected and treated by high efficiency deodorizers before discharge to the atmosphere.</p> <li data-bbox="324 885 1585 1109"> <p>• <u>Decking or reconstruction of KTN within apron area:</u> It is proposed to deck the KTN or reconstruct the KTN within the former Apron area into Kai Tak River from the south of Road D1 to the north of Road D2 along the existing alignment of KTN. The Kai Tak River will compose of a number of channels flowing with nonodorous fresh water and THEES effluent. The channel flowing with THEES effluent will be designed with the width of water surface of not more than 16m.</p> <li data-bbox="324 1133 1585 1436"> <p>• <u>Localised maintenance dredging:</u> Localised maintenance dredging should be conducted to provide water depth of not less than 3.5m over the whole of KTAC and KTTS. With reference to the water depth data recorded during the odour survey, only some of the areas in the northern part of KTAC (i.e. to the north of taxiway bridge) including the area near the northern edge of KTAC, the area near western bank of KTAC, and the area near the JVC discharge have water depths shallower than 3.5m. The area involved would be about 40% of the northern KTAC and the dredging depth required would be from about 2.7m to less than 1m. The maintenance dredging to be carried out prior to the occupation of any new development in the immediate vicinity of KTAC to avoid potential localized odour impacts at the future ASRs during the maintenance</p> | <p>N/A</p> <p>N/A</p> <p>N/A</p> <p>N/A</p> |
|-------------|--|---|

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|---------------------------|--|----------------------------|
| | <p>dredging operation.</p> <ul style="list-style-type: none"> • <u>Improvement of water circulation in KTAC and KTTS:</u> 600m gap opening at the northern part of the former Kai Tak runway, the water circulation in KTAC and KTTS would be substantially improved. Together with the improvement in water circulation, the DO level in KTAC and KTTS would also be increased. • <u>In-situ sediment treatment by bioremediation:</u> Bioremediation would be applied to the entire KTAC and KTTS. | N/A |
| Construction Noise | | |
| S7.8 | Use of quiet PME, movable barriers barrier for Asphalt Paver, Breaker, Excavator and Hand-held breaker and full enclosure for Air Compressor, Bar Bender, Concrete Pump, Generator and Water Pump. | ^ |
| S7.9 | <p>Good Site Practice:</p> <ul style="list-style-type: none"> • Only well-maintained plant should be operated on-site and plant should be serviced regularly during the construction program. • Silencers or mufflers on construction equipment should be utilized and should be properly maintained during the construction program. • Mobile plant, if any, should be sited as far away from NSRs as possible. • Machines and plant (such as trucks) that may be in intermittent use should be shut down between works periods or should be throttled down to a minimum. • Plant known to emit noise strongly in one direction should, wherever possible, be orientated so that the noise is directed away from the nearby NSRs. • Material stockpiles and other structures should be effectively utilized, wherever practicable, in screening noise from on-site construction activities. | ^ ^ ^ ^ ^ ^ |
| S7.9 | Scheduling of Construction Works during School Examination Period | ^ |
| S7.8 | (i) Provision of low noise surfacing in a section of Road L2; and | N/A |
| | (ii) Provision of structural fins | N/A |
| S7.8 | (i) Avoid the sensitive façade of class room facing Road L2 and L4; and | N/A |
| | (ii) Provision of low noise surfacing in a section of Road L2 & L4 | N/A |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|--|--|--------------------------|
| S7.8 | (i) Provision of low noise surfacing in a section of Road L4 before occupation of Site 111; and (ii) Setback of building about 5m from site boundary. | N/A N/A |
| S7.8 | Setback of building about 35m to the northwest direction at 1L3 and 5m at Site 1L2. | N/A |
| S7.8 | (i) avoid any sensitive façades with openable window facing the existing Kowloon City Road network; and Avoid the sensitive façade of class room facing Road L2 and L4; and (ii) for the sensitive facades facing the To Kwa Wan direction, either setback the facades by about 5m to the northeast direction or do not provide the facades with openable window. | N/A N/A |
| S7.8 | (i) avoid any sensitive facades with openable window facing the existing To Kwa Wan Road or (ii) provision of 17.5m high noise tolerant building fronting To Kwa Wan Road and restrict the height of the residential block(s) located at less than 55m away from To Kwa Wan Road to no more than 25m above ground | N/A N/A |
| S7.8 | (i) avoid any sensitive facades with openable window facing the slip road connecting Prince Edward Road East and San Po Kong or other alternative mitigation measures and at-source mitigation measures for the surrounding new local roads to minimise the potential traffic noise impacts from the slip road | ^ |
| S7.8 | All the ventilation fans installed in the below will be provided with silencers or acoustics treatment. (i) SPS (ii) ESS (iii) Tunnel Ventilation Shaft (iv) EFTS depot | N/A N/A N/A N/A |
| S7.8 | Installation of retractable roof or other equivalent measures | N/A |
| <i>Construction Water Quality</i> | | |
| S8.8 | The following mitigation measures are proposed to be incorporated in the design of the SPS at KTD, including: <ul style="list-style-type: none"> • Dual power supply or emergency generator should be provided at all the SPSs to secure electrical power supply; • Standby pumps should be provided at all SPSs to ensure smooth operation of the SPS during maintenance of the duty pumps; • An alarm should be installed to signal emergency high water level in the wet well at all SPSs; and • For all unmanned SPSs, a remote monitor system connecting SPSs with the control station through telemetry system should be provided so that swift actions could be taken in case of malfunction of unmanned facilities | N/A N/A N/A N/A |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|------|---|-----|
| S8.8 | <p>Construction Phase</p> <p><u>Marine-based Construction</u></p> <p><i>Capital and Maintenance Dredging for Cruise Terminal</i></p> <p>Mitigation measures for construction of the proposed cruise terminal should follow those recommended in the approved EIA for CT Dredging.</p> | N/A |
| S8.8 | <p><i>Fireboat Berth, Runway Opening and Road T2</i></p> <p>Silt curtains should be deployed around the close grab dredger to minimize release of sediment and other contaminants for any dredging and filling activities in open water.</p> | N/A |
| S8.8 | <p>Dredging at and near the seawall area for construction of the public landing steps cum fireboat berth should be carried out at a maximum production rate of 1,000m³ per day using one grab dredger.</p> | N/A |
| S8.8 | <p>The proposed construction method for runway opening should adopt an approach where the existing seawall at the runway will not be removed until completion of all excavation and dredging works for demolition of the runway. Thus, excavation of bulk fill and majority of the dredging works will be carried out behind the existing seawall, and the sediment plume can be effectively contained within the works area. As there is likely some accumulation of sediments alongside the runway, there will be a need to dredge the existing seabed after completion of all the demolition works. Dredging alongside the 600m opening should be carried out at a maximum production rate of 2,000m³ per day using one grab dredger.</p> | N/A |
| 8.8 | <p>Dredging for Road T2 should be conducted at a maximum rate of 8,000m³ per day (using four grab dredgers) whereas the sand filling should be conducted at a maximum rate of 2,000m³ per day (using two grab dredgers).</p> | N/A |
| 8.8 | <p>Silt screens shall be applied to seawater intakes at WSD seawater intake.</p> | N/A |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|------|---|-------------------|
| S8.8 | <p><u>Land-based Construction</u></p> <p><i>Construction Runoff</i></p> <p>Exposed soil areas should be minimised to reduce the potential for increased siltation, contamination of runoff, and erosion. Construction runoff related impacts associated with the above ground construction activities can be readily controlled through the use of appropriate mitigation measures which include:</p> <ul style="list-style-type: none"> • use of sediment traps • adequate maintenance of drainage systems to prevent flooding and overflow | <p>^</p> <p>^</p> |
| S8.8 | Ideally, construction works should be programmed to minimise surface excavation works during the rainy season (April to September). All exposed earth areas should be completed as soon as possible after earthworks have been completed, or alternatively, within 14 days of the cessation of earthworks where practicable. If excavation of soil cannot be avoided during the rainy season, or at any time of year when rainstorms are likely, exposed slope surfaces should be covered by tarpaulin or other means. | ^ |
| S8.8 | Construction site should be provided with adequately designed perimeter channel and pre-treatment facilities and proper maintenance. The boundaries of critical areas of earthworks should be marked and surrounded by dykes or embankments for flood protection. Temporary ditches should be provided to facilitate runoff discharge into the appropriate watercourses, via a silt retention pond. Permanent drainage channels should incorporate sediment basins or traps and baffles to enhance deposition rates. The design of efficient silt removal facilities should be based on the guidelines in Appendix A1 of ProPECC PN 1/94. | ^ |
| S8.8 | Sediment tanks of sufficient capacity, constructed from pre-formed individual cells of approximately 6 to 8 m ³ capacity, are recommended as a general mitigation measure which can be used for settling surface runoff prior to disposal. The system capacity is flexible and able to handle multiple inputs from a variety of sources and particularly suited to applications where the influent is pumped. | * |
| S8.8 | Open stockpiles of construction materials (for examples, aggregates, sand and fill material) of more than 50 m ³ should be covered with tarpaulin or similar fabric during rainstorms. Measures should be taken to prevent the washing away of construction materials, soil, silt or debris into any drainage system. | ^ |
| S8.8 | Manholes (including newly constructed ones) should always be adequately covered and temporarily sealed so as to prevent silt, construction materials or debris being washed into the drainage system and storm runoff being directed into foul sewers. | ^ |
| S8.8 | Precautions to be taken at any time of year when rainstorms are likely, actions to be taken when a rainstorm is imminent or forecast, and actions to be taken during or after rainstorms are summarised in Appendix A2 of ProPECC PN 1/94. Particular attention should be paid to the control of silty | ^ |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|------|--|--------|
| | surface runoff during storm events. | |
| S8.8 | Oil interceptors should be provided in the drainage system and regularly cleaned to prevent the release of oils and grease into the storm water drainage system after accidental spillages. The interceptor should have a bypass to prevent flushing during periods of heavy rain. | N/A(1) |
| S8.8 | All vehicles and plant should be cleaned before leaving a construction site to ensure no earth, mud, debris and the like is deposited by them on roads. An adequately designed and located wheel washing bay should be provided at every site exit, and wash-water should have sand and silt settled out and removed at least on a weekly basis to ensure the continued efficiency of the process. The section of access road leading to, and exiting from, the wheel-wash bay to the public road should be paved with sufficient backfall toward the wheel-wash bay to prevent vehicle tracking of soil and silty water to public roads and drains. | ^ |
| S8.8 | <i>Drainage</i> It is recommended that on-site drainage system should be installed prior to the commencement of other construction activities. Sediment traps should be installed in order to minimise the sediment loading of the effluent prior to discharge into foul sewers. There should be no direct discharge of effluent from the site into the sea | ^ |
| S8.8 | All temporary and permanent drainage pipes and culverts provided to facilitate runoff discharge should be adequately designed for the controlled release of storm flows. All sediment control measures should be regularly inspected and maintained to ensure proper and efficient operation at all times and particularly following rain storms. The temporarily diverted drainage should be reinstated to its original condition when the construction work has finished or the temporary diversion is no longer required. | ^ |
| S8.8 | All fuel tanks and storage areas should be provided with locks and be located on sealed areas, within bunds of a capacity equal to 110% of the storage capacity of the largest tank, to prevent spilled fuel oils from reaching the coastal waters of the Victoria Harbour WCZ. | ^ |
| S8.8 | <i>Sewage Effluent</i> Construction work force sewage discharges on site are expected to be connected to the existing trunk sewer or sewage treatment facilities. The construction sewage may need to be handled by portable chemical toilets prior to the commission of the on-site sewer system. Appropriate numbers of portable toilets should be provided by a licensed contractor to serve the large number of construction workers over the construction site. The Contractor should also be responsible for waste disposal and maintenance practices. | ^ |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|------|--|-----|
| S8.8 | <i>Stormwater Discharges</i> Minimum distances of 100 m should be maintained between the existing or planned stormwater discharges and the existing or planned seawater intakes | ^ |
| S8.8 | <i>Debris and Litter</i> In order to maintain water quality in acceptable conditions with regard to aesthetic quality, contractors should be required, under conditions of contract, to ensure that site management is optimised and that disposal of any solid materials, litter or wastes to marine waters does not occur | ^ |
| S8.8 | <i>Construction Works at or in Close Proximity of Storm Culvert or Seafront</i> The proposed works should preferably be carried out within the dry season where the flow in the drainage channel /storm culvert/ nullah is low. | ^ |
| S8.8 | The use of less or smaller construction plants may be specified to reduce the disturbance to the bottom sediment at the drainage channel /storm culvert / nullah. | ^ |
| S8.8 | Temporary storage of materials (e.g. equipment, filling materials, chemicals and fuel) and temporary stockpile of construction materials should be located well away from any water courses during carrying out of the construction works | ^ |
| S8.8 | Stockpiling of construction materials and dusty materials should be covered and located away from any water courses. | ^ |
| S8.8 | Construction debris and spoil should be covered up and/or disposed of as soon as possible to avoid being washed into the nearby water receivers. | ^ |
| S8.8 | Construction activities, which generate large amount of wastewater, should be carried out in a distance away from the waterfront, where practicable. | ^ |
| S8.8 | Mitigation measures to control site runoff from entering the nearby water environment should be implemented to minimize water quality impacts. Surface channels should be provided along the edge of the waterfront within the work sites to intercept the runoff. | ^ |
| S8.8 | Construction effluent, site run-off and sewage should be properly collected and/or treated. | ^ |
| S8.8 | Any works site inside the storm water courses should be temporarily isolated, such as by placing of sandbags or silt curtains with lead edge at bottom and properly supported props to prevent adverse impact on the storm water quality. | N/A |
| S8.8 | Silt curtain may be installed around the construction activities at the seafront to minimize the potential impacts due to accidental spillage of construction materials. | N/A |
| S8.8 | Proper shoring may need to be erected in order to prevent soil/mud from slipping into the storm culvert/drainage channel/sea. | N/A |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|---|---|--|
| S8.8 | Supervisory staff should be assigned to station on site to closely supervise and monitor the works | ^ |
| S8.8 | Marine water quality monitoring and audit programme shall be implemented for the proposed sediment treatment operation. | N/A |
| <i>Construction Waste Management</i> | | |
| S9.5 | <p>Good Site Practices</p> <p>It is not anticipated that adverse waste management related impacts would arise, provided that good site practices are adhered to. Recommendations for good site practices during the dredging activities include:</p> <ul style="list-style-type: none"> • Nomination of an approved person, such as a site manager, be responsible for good site practices, arrangements for collection and effective disposal to an appropriate facility, of all wastes generated at the site. • Training of site personnel in proper waste management and chemical waste handling procedures. • Provision of sufficient waste disposal points and regular collection for disposal. • Appropriate measure to minimize windblown litter and dust during transportation of waste by either covering trucks or by transporting wastes in enclosed containers. • A recording system for the amount of wastes generated, recycled and disposed of (including the disposal sites). | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |
| S9.5 | <p>Waste Reduction Measures</p> <p>Good management and control can prevent the generation of a significant amount of waste. Waste reduction is best achieved at the planning and design stage, as well as by ensuring the implementation of good site practices. Recommendations to achieve waste reduction include:</p> <ul style="list-style-type: none"> • Sort C&D waste from demolition of the remaining structures to recover recyclable portions such as metals • Segregation and storage of different types of waste in different containers, skips or stockpiles to enhance reuse or recycling of materials and their proper disposal • Encourage collection of aluminium cans, PET bottles and paper by providing separate labelled bins to enable these wastes to be segregated from other general refuse generated by the work force • Any unused chemicals or those with remaining functional capacity should be recycled • Proper storage and site practices to minimise the potential for damage or contamination of construction materials | <p>^</p> <p>^</p> <p>^</p> <p>^</p> |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|------|--|----------------------------------|
| S9.5 | <p>Dredged Marine Sediment</p> <p>The basic requirements and procedures for dredged mud disposal are specified under the ETWB TCW No. 34/2002. The management of the dredging, use and disposal of marine mud is monitored by the MFC, while the licensing of marine dumping is required under the Dumping at Sea Ordinance and is the responsibility of the Director of Environmental Protection (DEP)</p> | N/A |
| S9.5 | <p>The dredged marine sediments would be loaded onto barges and transported to the designated disposal sites allocated by the MFC depending on their level of contamination. Sediment classified as Category L would be suitable for Type 1 - Open Sea Disposal. Contaminated sediment would require either Type 1 – Open Sea Disposal (Dedicated Sites), Type 2 - Confined Marine Disposal, or Type 3 – Special Treatment / Disposal and must be dredged and transported with great care in accordance with ETWB TCW No. 34/2002. Subject to the final allocation of the disposal sites by MFC, the dredged contaminated sediment must be effectively isolated from the environment and disposed properly at the designated disposal site</p> | N/A |
| S9.5 | <p>It will be the responsibility of the contractor to satisfy the appropriate authorities that the contamination levels of the marine sediment to be dredged have been analysed and recorded. According to the ETWB TCW No. 34/2002, this will involve the submission of a formal Sediment Quality Report to the DEP, prior to the dredging contract being tendered. The contractor for the dredging works should apply for allocation of marine disposal sites and all necessary permits from relevant authorities for the disposal of dredged sediment. During transportation and disposal of the dredged marine sediments requiring Type 1, Type 2, or Type 3 disposal, the following measures should be taken to minimise potential impacts on water quality:</p> <ul style="list-style-type: none"> • Bottom opening of barges should be fitted with tight fitting seals to prevent leakage of material. Excess material should be cleaned from the decks and exposed fittings of barges and hopper dredgers before the vessel is moved • Monitoring of the barge loading should be conducted to ensure that loss of material does not take place during transportation. Transport barges or vessels should be equipped with automatic selfmonitoring devices as required under the Dumping at Sea Ordinance and as specified by the DEP • Barges or hopper barges should not be filled to a level that would cause the overflow of materials or sediment laden water during loading or transportation | <p>N/A</p> <p>N/A</p> <p>N/A</p> |
| S9.5 | <p>Construction and Demolition Material</p> <p>Mitigation measures and good site practices should be incorporated into contract document to control potential environmental impact from handling and transportation of C&D material. The mitigation measures include:</p> <ul style="list-style-type: none"> • Where it is unavoidable to have transient stockpiles of C&D material within the Project work site pending collection for disposal, the | ^ |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|------|---|---|
| | <p>transient stockpiles should be located away from waterfront or storm drains as far as possible</p> <ul style="list-style-type: none"> • Open stockpiles of construction materials or construction wastes on-site should be covered with tarpaulin or similar fabric • Skip hoist for material transport should be totally enclosed by impervious sheeting • Every vehicle should be washed to remove any dusty materials from its body and wheels before leaving a construction site • The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcores • The load of dusty materials carried by vehicle leaving a construction site should be covered entirely by clean impervious sheeting to ensure dust materials do not leak from the vehicle • All dusty materials should be sprayed with water prior to any loading, unloading or transfer operation so as to maintain the dusty materials wet • The height from which excavated materials are dropped should be controlled to a minimum practical height to limit fugitive dust generation from unloading <p>When delivering inert C&D material to public fill reception facilities, the material should consist entirely of inert construction waste and of size less than 250mm or other sizes as agreed with the Secretary of the Public Fill Committee. In order to monitor the disposal of the surplus C&D material at the designed public fill reception facility and to control fly tipping, a trip-ticket system as stipulated in the ETWB TCW No. 31/2004 “Trip Ticket System for Disposal of Construction and Demolition Materials” should be included as one of the contractual requirements and implemented by an Environmental Team undertaking the Environmental Monitoring and Audit work. An Independent Environmental Checker should be responsible for auditing the results of the system.</p> | <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> <p>^</p> |
| S9.5 | <p>Chemical Waste</p> <p>After use, chemical wastes (for example, cleaning fluids, solvents, lubrication oil and fuel) should be handled according to the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes. Spent chemicals should be collected by a licensed collector for disposal at the CWTF or other licensed facility, in accordance with the <i>Waste Disposal (Chemical Waste) (General) Regulation</i></p> | <p>^</p> |

Appendix K – Summary of Implementation Schedule of Mitigation Measures for Construction Phase

| | | |
|---|---|--|
| S9.5 | <p>General Refuse</p> <p>General refuse should be stored in enclosed bins or compaction units separate from C&D material. A licensed waste collector should be employed by the contractor to remove general refuse from the site, separately from C&D material. Effective collection and storage methods (including enclosed and covered area) of site wastes would be required to prevent waste materials from being blown around by wind, wastewater discharge by flushing or leaching into the marine environment, or creating odour nuisance or pest and vermin problem</p> | * |
| <i>Construction Landscape and Visual</i> | | |
| S13.9 | <p>CM1 All existing trees should be carefully protected during construction.</p> <p>CM2 Trees unavoidably affected by the works should be transplanted where practical. Detailed transplanting proposal will be submitted to relevant government departments for approval in accordance with ETWBC 2/2004 and 3/2006. Final locations of transplanted trees should be agreed prior to commencement of the work.</p> <p>CM3 Control of night-time lighting.</p> <p>CM4 Erection of decorative screen hoarding.</p> | <p>^</p> <p>^</p> <p>N/A(1)</p> <p>^</p> |

Remarks:

| | |
|--------|--|
| ^ | Compliance of mitigation measure |
| * | Recommendations were made during site audits but improved/rectified by the Contractor |
| # | Recommendations were made during site audits but has not yet been improved/rectified by the Contractor |
| ● | Non-compliance but rectified by the Contractor |
| X | Non-compliance of mitigation measure |
| N/A | Not Applicable at this stage |
| N/A(1) | Not observed |

APPENDIX F
SITE AUDIT SUMMARY

Appendix F – Summary of Site Audit

January 2019

| Parameters | Ref No. | Date | Observations and Recommendations | Follow-up |
|-----------------------------------|-----------|-----------------|---|---|
| <i>Water Quality</i> | 190116-R1 | 16 January 2019 | Provide a cleaning schedule & record for all sedimentation tank to show that weekly cleaning is provided and post the record on the tank/make available for inspection. | Rectification/improvement was observed during the follow-up audit session on 22 January 2019. |
| <i>Air Quality</i> | N/A | N/A | -- | -- |
| <i>Noise</i> | N/A | N/A | -- | -- |
| <i>Waste/ Chemical Management</i> | N/A | N/A | -- | -- |
| <i>Landscape and Visual</i> | N/A | N/A | -- | -- |
| <i>Permits/ Licenses</i> | N/A | N/A | -- | -- |

February 2019

| Parameters | Ref No. | Date | Observations and Recommendations | Follow-up |
|-----------------------------------|-----------|----------------------|---|--|
| <i>Water Quality</i> | N/A | N/A | -- | -- |
| <i>Air Quality</i> | N/A | N/A | -- | -- |
| <i>Noise</i> | N/A | N/A | -- | -- |
| <i>Waste/ Chemical Management</i> | 190220-R1 | 20 -25 February 2019 | The drip tray for generator in portion 6 should be cleaned regularly and maintain clear most of time. | <u>25th Feb 2019:</u> The drip tray for generator in portion 6 should be cleaned regularly and placed on flat surface. The drip tray was suggested to be replaced with a larger drip tray. |
| <i>Landscape and Visual</i> | N/A | N/A | -- | -- |
| <i>Permits/ Licenses</i> | N/A | N/A | -- | -- |

Appendix F – Summary of Site Audit

March 2019

| Parameters | Ref No. | Date | Observations and Recommendations | Follow-up/ |
|---|----------------|------------------|--|---|
| <i>Water Quality</i> | N/A | N/A | -- | -- |
| <i>Air Quality</i> | N/A | N/A | -- | -- |
| <i>Noise</i> | N/A | N/A | -- | -- |
| <i>Waste/ Chemical Management</i> | 190220-R1 | 4 March 2019 | -- | Rectification/improvement was observed during the follow-up audit session on 4 March 2019 |
| | 190318-R1 | 18 March 2019 | Rubbish or general waste accumulating in portion 6 should be cleaned up. | <u>25th Mar 19</u> Contractor should clean up the rubbish in portion 6. |
| <i>Landscape and Visual</i> | N/A | N/A | -- | -- |
| <i>Permits/ Licenses</i> | N/A | N/A | -- | -- |

APPENDIX G
WASTE GENERATED QUANTITY

Department: CEDD
 Contract No.: KL/2015/02
 Project : Kai Tak Development - Stage 5A Infrastructure at Former North Apron Area



Peako - Wo Hing Joint Venture

Monthly Summary Waste Flow Table for 2019

As at 1 April 2019

| Month | Quantities of Inert C & D Materials Generated Monthly | | | | | | Quantities of C & D Wastes Generated Monthly | | | | |
|------------------|---|----------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--|----------------------------|-----------------------|----------------|-----------------------------|
| | Total Quantity Generated | Hard Rock and Large Broken | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ Cardboard packaging | Plastics (see Note 3) | Chemical Waste | Others, e.g. general refuse |
| | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000m ³) |
| Jan | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0.154 |
| Feb | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0.035 |
| Mar | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0.035 |
| Apr | - | - | - | - | - | - | - | - | - | - | - |
| May | - | - | - | - | - | - | - | - | - | - | - |
| June | - | - | - | - | - | - | - | - | - | - | - |
| Sub-total | 66.537 | 0 | 0 | 0 | 66.537 | 0 | 0 | 0 | 0 | 0 | 1.456 |
| July | - | - | - | - | - | - | - | - | - | - | - |
| Aug | - | - | - | - | - | - | - | - | - | - | - |
| Sept | - | - | - | - | - | - | - | - | - | - | - |
| Oct | - | - | - | - | - | - | - | - | - | - | - |
| Nov | - | - | - | - | - | - | - | - | - | - | - |
| Dec | - | - | - | - | - | - | - | - | - | - | - |
| Total | 66.537 | 0 | 0 | 0 | 66.537 | 0 | 0 | 0 | 0 | 0 | 1.456 |

| Forecast of Total Quantities of C&D Materials to be Generated from the Contract* | | | | | | | | | | |
|--|-------------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------------|----------------------------|-----------------------|----------------|-----------------------------|
| Total Quantity Generated | Hard Rock and Large Broken Concrete | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill | Metals | Paper/ Cardboard packaging | Plastics (see Note 3) | Chemical Waste | Others, e.g. general refuse |
| (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000m ³) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000kg) | (in '000m ³) |
| 63000 | 0 | 0 | 0 | 67 | 0 | 0 | 0 | 0 | 0 | 2 |

- Notes:
- (1) The performance targets are given in PS clause 6(14).
 - (2) The waste flow table shall also include C & D materials that are specified in the Contract to be imported for use at the Site.
 - (3) Plastics refer to plastic bottles/ containers, plastic sheets/ foam from packaging material.
 - (4) The Contractor shall also submit the latest forecast of the total amount of C&D materials expected to be generated from the Works, together with a breakdown of the nature where the total amount of C&D materials expected to be generated from the Works is equal to or exceeding 5,000 m³.
 - (5) The total general refuse generated before Jan 2019 is 1232 m³ for this project and this value accounts for the sub-total and total general refuse as shown in this (PS Clause 25.02A(7) refers).

APPENDIX H
SUMMARY OF EXCEEDANCES

Appendix H – Summary of Exceedance

Exceedance Report for Contract No. KL/2015/02

- (A) Exceedance Report for Air Quality**
(NIL in the reporting period)

- (B) Exceedance Report for Construction Noise**
(NIL in the reporting period)

- (C) Exceedance Report for Landscape and Visual**
(NIL in the reporting period)

**APPENDIX I
COMPARISON OF EM&A DATA AND
EIA PREDICTIONS**

Annex I – Comparison of EM&A Data and EIA Predictions

Comparison of 1-hr TSP data with EIA predictions

| Station | Predicted 1-hr TSP conc. | | Measured 1-hr TSP conc. | | | | | |
|-----------------------------------|--|---|--|----------|---|----------|--|----------|
| | Scenario1 (Mid 2009 to Mid 2013), $\mu\text{g}/\text{m}^3$ | Scenario2 (Mid 2013 to Late 2016), $\mu\text{g}/\text{m}^3$ | Reporting Month (January 2019), $\mu\text{g}/\text{m}^3$ | | Reporting Month (February 2019), $\mu\text{g}/\text{m}^3$ | | Reporting Month (March 2019), $\mu\text{g}/\text{m}^3$ | |
| | | | Average | Range | Average | Range | Average | Range |
| AM2 – Lee Kau Yan Memorial School | 290 | 312 | 162 | 70 – 243 | 129 | 40 – 183 | 139 | 78 – 210 |

Comparison of 24-hr TSP data with EIA predictions

| Station | Predicted 24-hr TSP conc. | | Measured 24-hr TSP conc. | | | | | |
|---|--|---|--|----------|---|---------|--|---------|
| | Scenario1 (Mid 2009 to Mid 2013), $\mu\text{g}/\text{m}^3$ | Scenario2 (Mid 2013 to Late 2016), $\mu\text{g}/\text{m}^3$ | Reporting Month (January 2019), $\mu\text{g}/\text{m}^3$ | | Reporting Month (February 2019), $\mu\text{g}/\text{m}^3$ | | Reporting Month (March 2019), $\mu\text{g}/\text{m}^3$ | |
| | | | Average | Range | Average | Range | Average | Range |
| AM2(A) – Ng Wah Catholic Secondary School | 145 | 169 | 75 | 47 - 113 | 42 | 11 - 92 | 40 | 27 - 73 |

Annex I – Comparison of EM&A Data and EIA Predictions

Comparison of Noise Monitoring Data with EIA predictions

| Stations | Predicted Mitigated Construction Noise Levels during Normal Working Hour ($L_{eq(30min)}$ dB(A)) | Reporting Month (January 2019), $L_{eq(30min)}$ dB(A) | Reporting Month (February 2019), $L_{eq(30min)}$ dB(A) | Reporting Month (March 2019), $L_{eq(30min)}$ dB(A) |
|----------------------------------|--|---|--|---|
| M3- Cognito College | 47 – 75 | 62 – 78 ⁽²⁾ | 63 – 70 | 64 – 80 ⁽²⁾ |
| M4 - Lee Kau Yan Memorial School | 47 – 74 | 63 – 77 ⁽¹⁾ | 68 – 76 ⁽²⁾ | 65 – 70 |
| M5(C) – Mercy Grace’s Home | Not Predicted in EIA Report | 60 – 77 ⁽²⁾ | 62 – 75 | 62 – 69 |

Remarks:

- (1) Since the background noise level recorded during 12:00 to 13:00 was higher than those recorded during the construction period, the recorded noise levels were considered non-valid exceedance of Noise Limit Level.
- (2) Since the baseline noise level was higher than those recorded during the construction period, the recorded noise levels were considered non-valid exceedance of Noise Limit Level.