

Demolition Works  
Central Police Station Compound at No. 10, Hollywood Road  
Method Statement for Vibration Monitoring

---

**Method Statement for**  
**Vibration Monitoring for**  
**Demolition Works at**  
**Central Police Station Compound at**  
**No. 10, Hollywood Road**  
**(Revision 1)**

**Demolition Works  
Central Police Station Compound at No. 10, Hollywood Road  
Method Statement for Vibration Monitoring**

Method Statement

1. The Works Contractor should assign an experienced site staff to use the apparatus to carry out the vibration monitoring as shown in the location plan (Appendix 1).
2. The exact location of vibration monitoring shall be determined by the Engineer on site;
3. The vibration monitoring will be recorded in the following format of table:

Date	Time	Location of Check Points	Result (Max. Point) (mm/s)	Monitoring Duration (Mins)	Location of Demolition Work

Phases/Stages of Vibration Monitoring

4. There are five phases/stages of vibration monitoring to be carried out, namely Initial Reading Phase, Monitoring Stage 1, Monitoring Stage 2, Stage 3, and Stage 4.

The details are as follows.

Stage	Buildings / Structures to be demolished	Locations of Vibration Check Points to be Monitored
1	E, F, G, H, N, R, 8a, 18 Old Bailey Street Wall, Revetment Wall	VM1, VM4 ~ VM10
2	J, K, 16	VM1, VM11 ~ VM15
	B, C, D, L, M, P Spiral staircase	VM3, VM5, VM6, VM8, VM9, VM16~VM19
3	A	VM1 ~ VM2
4	5	VM1, VM16 ~ VM19

**Demolition Works**  
**Central Police Station Compound at No. 10, Hollywood Road**  
**Method Statement for Vibration Monitoring**

Initial Reading Phase

5. A set of initial readings shall be recorded three days prior to commencement of each stage of demolition works as the example below:

Date	Time	Location of Check Points	Result (Max. Point) (mm/s)	Monitoring Duration (Mins)	Location of Demolition Work
20 Dec. 2011 (tentative)	Start at 10:00AM	VM4	?	<u>5 mins.</u>	Prior to any demolition
		VM5	?	<u>5 mins.</u>	
		VM6	?	<u>5 mins.</u>	
		VM7	?	<u>5 mins.</u>	
		VM8	?	<u>5 mins.</u>	
		VM9	?	<u>5 mins.</u>	
		VM10	?	<u>5 mins.</u>	

Monitoring Stage 1 Demolition

6. The vibration monitoring will be carried out daily for each check point at the following frequency during demolition of stage 1 buildings

Date	Time	Location of Check Points	Result (Max. Point) (mm/s)	Monitoring Duration (Mins)	Location of Demolition Work
Commencement Day 1	Start at 10:00AM	VM4	?	<u>5 mins.</u>	Stage 1 Demolition Area
		VM5	?	<u>5 mins.</u>	
		VM6	?	<u>5 mins.</u>	
		VM7	?	<u>5 mins.</u>	
		VM8	?	<u>5 mins.</u>	
		VM9	?	<u>5 mins.</u>	
		VM10	?	<u>5 mins.</u>	
Day 2	...	...	...	...	...
Day 3	...	...	...	...	...
.....	...	...	...	...	...
Sunday / Public Holiday / Non Working Day/ Day without demolition	N/A	N/A	N/A	N/A	N/A
Day n	Start at 10:00AM	VM4	?	<u>5 mins.</u>	Stage 1 Demolition Area
		VM5	?	<u>5 mins.</u>	
		VM6	?	<u>5 mins.</u>	
		VM7	?	<u>5 mins.</u>	
		VM8	?	<u>5 mins.</u>	

**Demolition Works**  
**Central Police Station Compound at No. 10, Hollywood Road**  
**Method Statement for Vibration Monitoring**

		VM9 VM10	? ?	<u>5 mins.</u> <u>5 mins.</u>	
Footnote: Vibration monitoring will only be carried out on the days with demolition works.					

Reporting:

- The Works Contractor shall email the daily monitoring record to the Management Contractor within 24 hours after taking the daily readings.
- The Alert, Action and Alarm (AAA) Levels are to be implemented during the vibration monitoring as follows:

Instrument Type	Item Monitored	Alert Level	Action Level	Alarm Level
Vibration Monitoring	Horizontal Movement	2.0 mm/s	2.5 mm/s	3.0 mm/s
Tasks to do by the Works Contractor		Notify Management Contractor	Notify AP/RSE	Cease Works and submit mitigation measures to AP/RSE

\*Repeat the above steps for stages 2, 3 and 4 demolition works.

**Demolition Works  
Central Police Station Compound at No. 10, Hollywood Road  
Method Statement for Vibration Monitoring**

---

The information of the vibration monitoring apparatus to be used is as follows:

Apparatus Description	Vibration Monitor
Manufacturer	Instantel
Model No.	Blastmate III
Serial No.	BA 100992
Calibration Certificate No.	15143
Date of Calibration Test	2 September 2011

9. The Specification of the model Blastmate III is attached in Appendix 2.
10. The Calibration Certificate is attached in Appendix 3.


**Demolition Works  
Central Police Station Compound at No. 10, Hollywood Road  
Method Statement for Vibration Monitoring**

---

# Appendix 1

Location Plan  
of Vibration Check Points



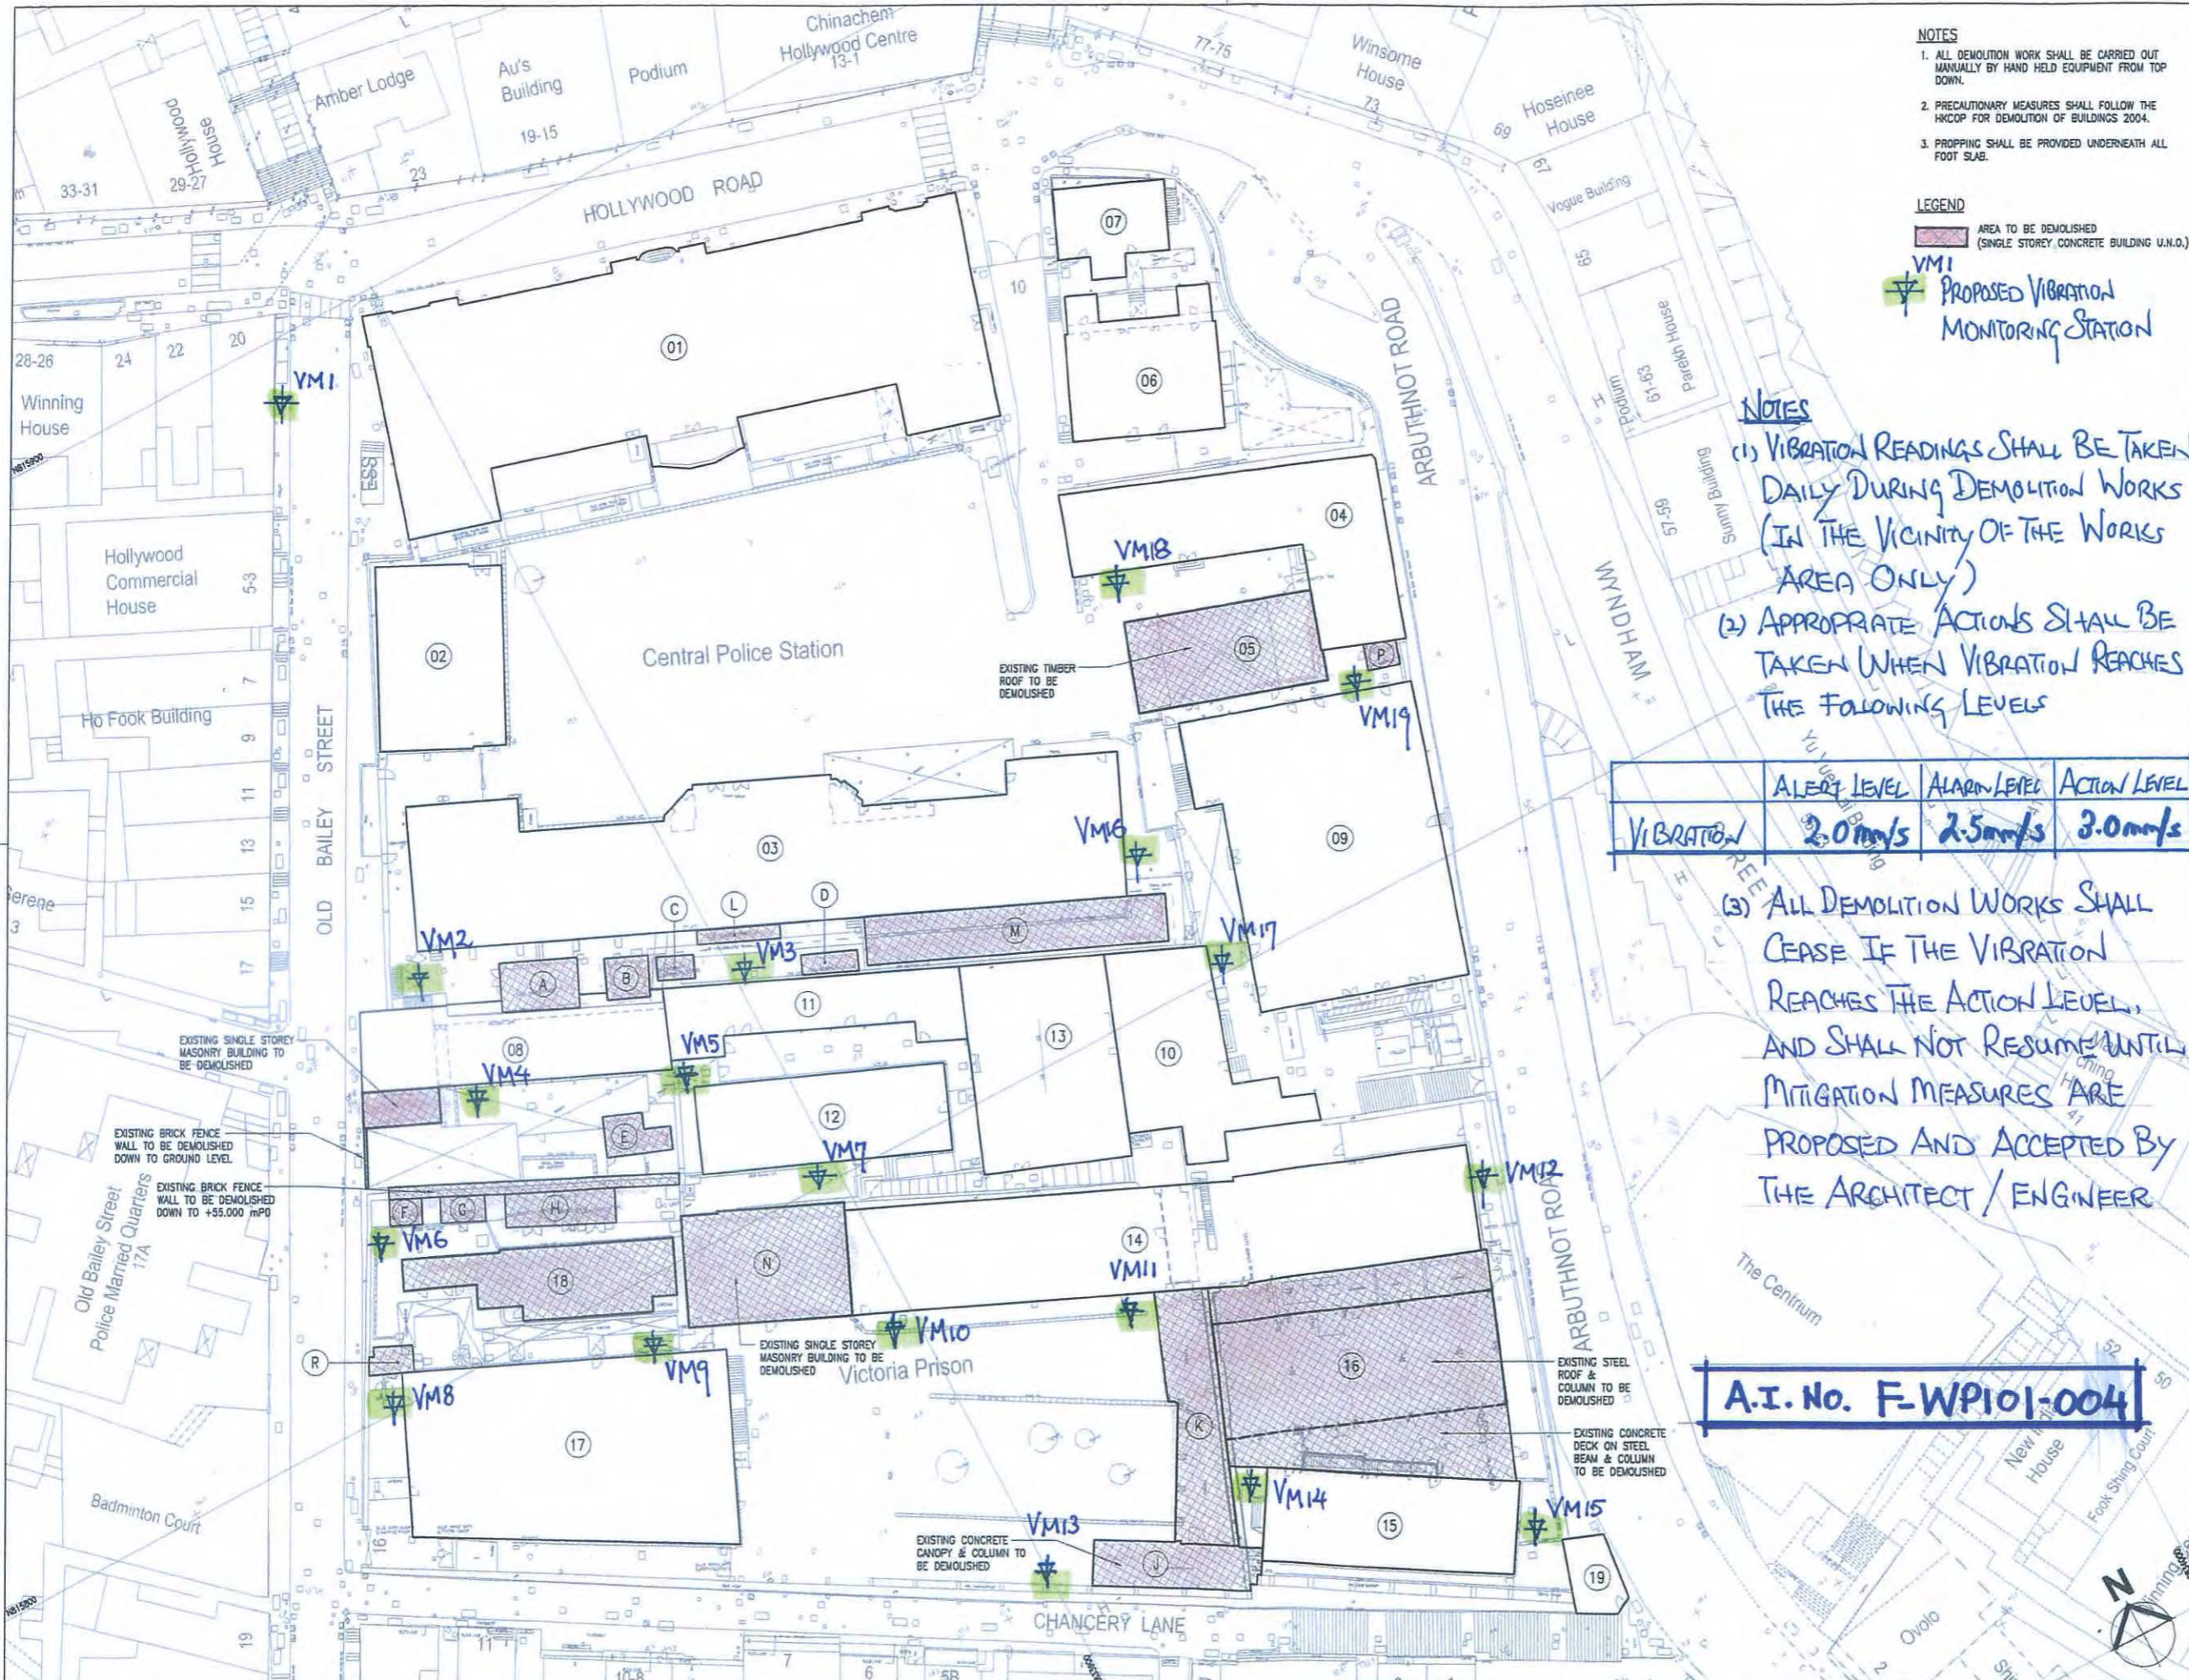

- NOTES**
1. ALL DEMOLITION WORK SHALL BE CARRIED OUT MANUALLY BY HAND HELD EQUIPMENT FROM TOP DOWN.
  2. PRECAUTIONARY MEASURES SHALL FOLLOW THE HKCOP FOR DEMOLITION OF BUILDINGS 2004.
  3. PROPPING SHALL BE PROVIDED UNDERNEATH ALL FOOT SLAB.

**LEGEND**

AREA TO BE DEMOLISHED  
(SINGLE STOREY CONCRETE BUILDING U.N.O.)

VMI  
PROPOSED VIBRATION MONITORING STATION

- NOTES**
- (1) VIBRATION READINGS SHALL BE TAKEN DAILY DURING DEMOLITION WORKS (IN THE VICINITY OF THE WORKS AREA ONLY)
  - (2) APPROPRIATE ACTIONS SHALL BE TAKEN WHEN VIBRATION REACHES THE FOLLOWING LEVELS

VIBRATION	ALERT LEVEL	ALARM LEVEL	ACTION LEVEL
	2.0mm/s	2.5mm/s	3.0mm/s

- (3) ALL DEMOLITION WORKS SHALL CEASE IF THE VIBRATION REACHES THE ACTION LEVEL, AND SHALL NOT RESUME UNTIL MITIGATION MEASURES ARE PROPOSED AND ACCEPTED BY THE ARCHITECT / ENGINEER

**A.I. No. F-WP101-004**

B.D. Ref. No. 建築署樓宇編號  
22-1/3096, 10 (4)

F.S.D. Ref. No. 消防處樓宇編號

Revision/Submission 修改/提交

No. 編號	Description 說明	Date 日期	Approved 審批
01	TENDER	08/11	T.H.
02	BD SUBMISSION	08/11	T.H.



**BD SUBMISSION**  
Drawing Status 製圖狀況

This drawing and the contents herein are the copyright of relevant consultants.  
本圖紙及其內容均為有關顧問公司所有

- No part of the drawing and the design contained herein may be reproduced without the prior written consent of relevant consultants.  
未經有關顧問公司書面同意，不得複製此圖紙內任何內容或設計。
- Do not take measurements directly from this drawing.  
切勿直接從圖紙上量度尺寸。
- Check and verify all dimensions on site.  
所有尺寸必須在工地現場核實及校核。
- Read this drawing in conjunction with the specifications and all other related drawings.  
此圖紙必須與規格說明書及其他有關圖紙一併閱讀。
- Notify the relevant consultants immediately of any discrepancy found hereon.  
如發現圖紙內有任何錯誤之處，應立即通知有關顧問公司。

Client 業主  
香港賽馬會慈善信託基金  
The Hong Kong Jockey Club Charities Trust

Design Consultant  
HERZOG & DE MEURON

Conservation Architect  
羅敏申建築師有限公司

Architect / AP  
ROCCO 許李

Structural Engineer / RSE  
E & M Engineer  
ARUP JRP

Project 項目  
CENTRAL POLICE STATION  
CONSERVATION AND REVITALISATION

Drawing Title 圖名  
DEMOLITION SITE PLAN  
(OVERALL)  
VIBRATION MONITORING

Scale 比例  
1:300@A1

Drawn 繪圖  
P.C.

Checked 校對  
T.H.

Drawing No. 圖號  
DE-OAP209674-L-100 02


Revision 修改版

11 NOV 2011

Cad File : DC-OAP209674-L-100.dwg



# Demolition Phasing Plan

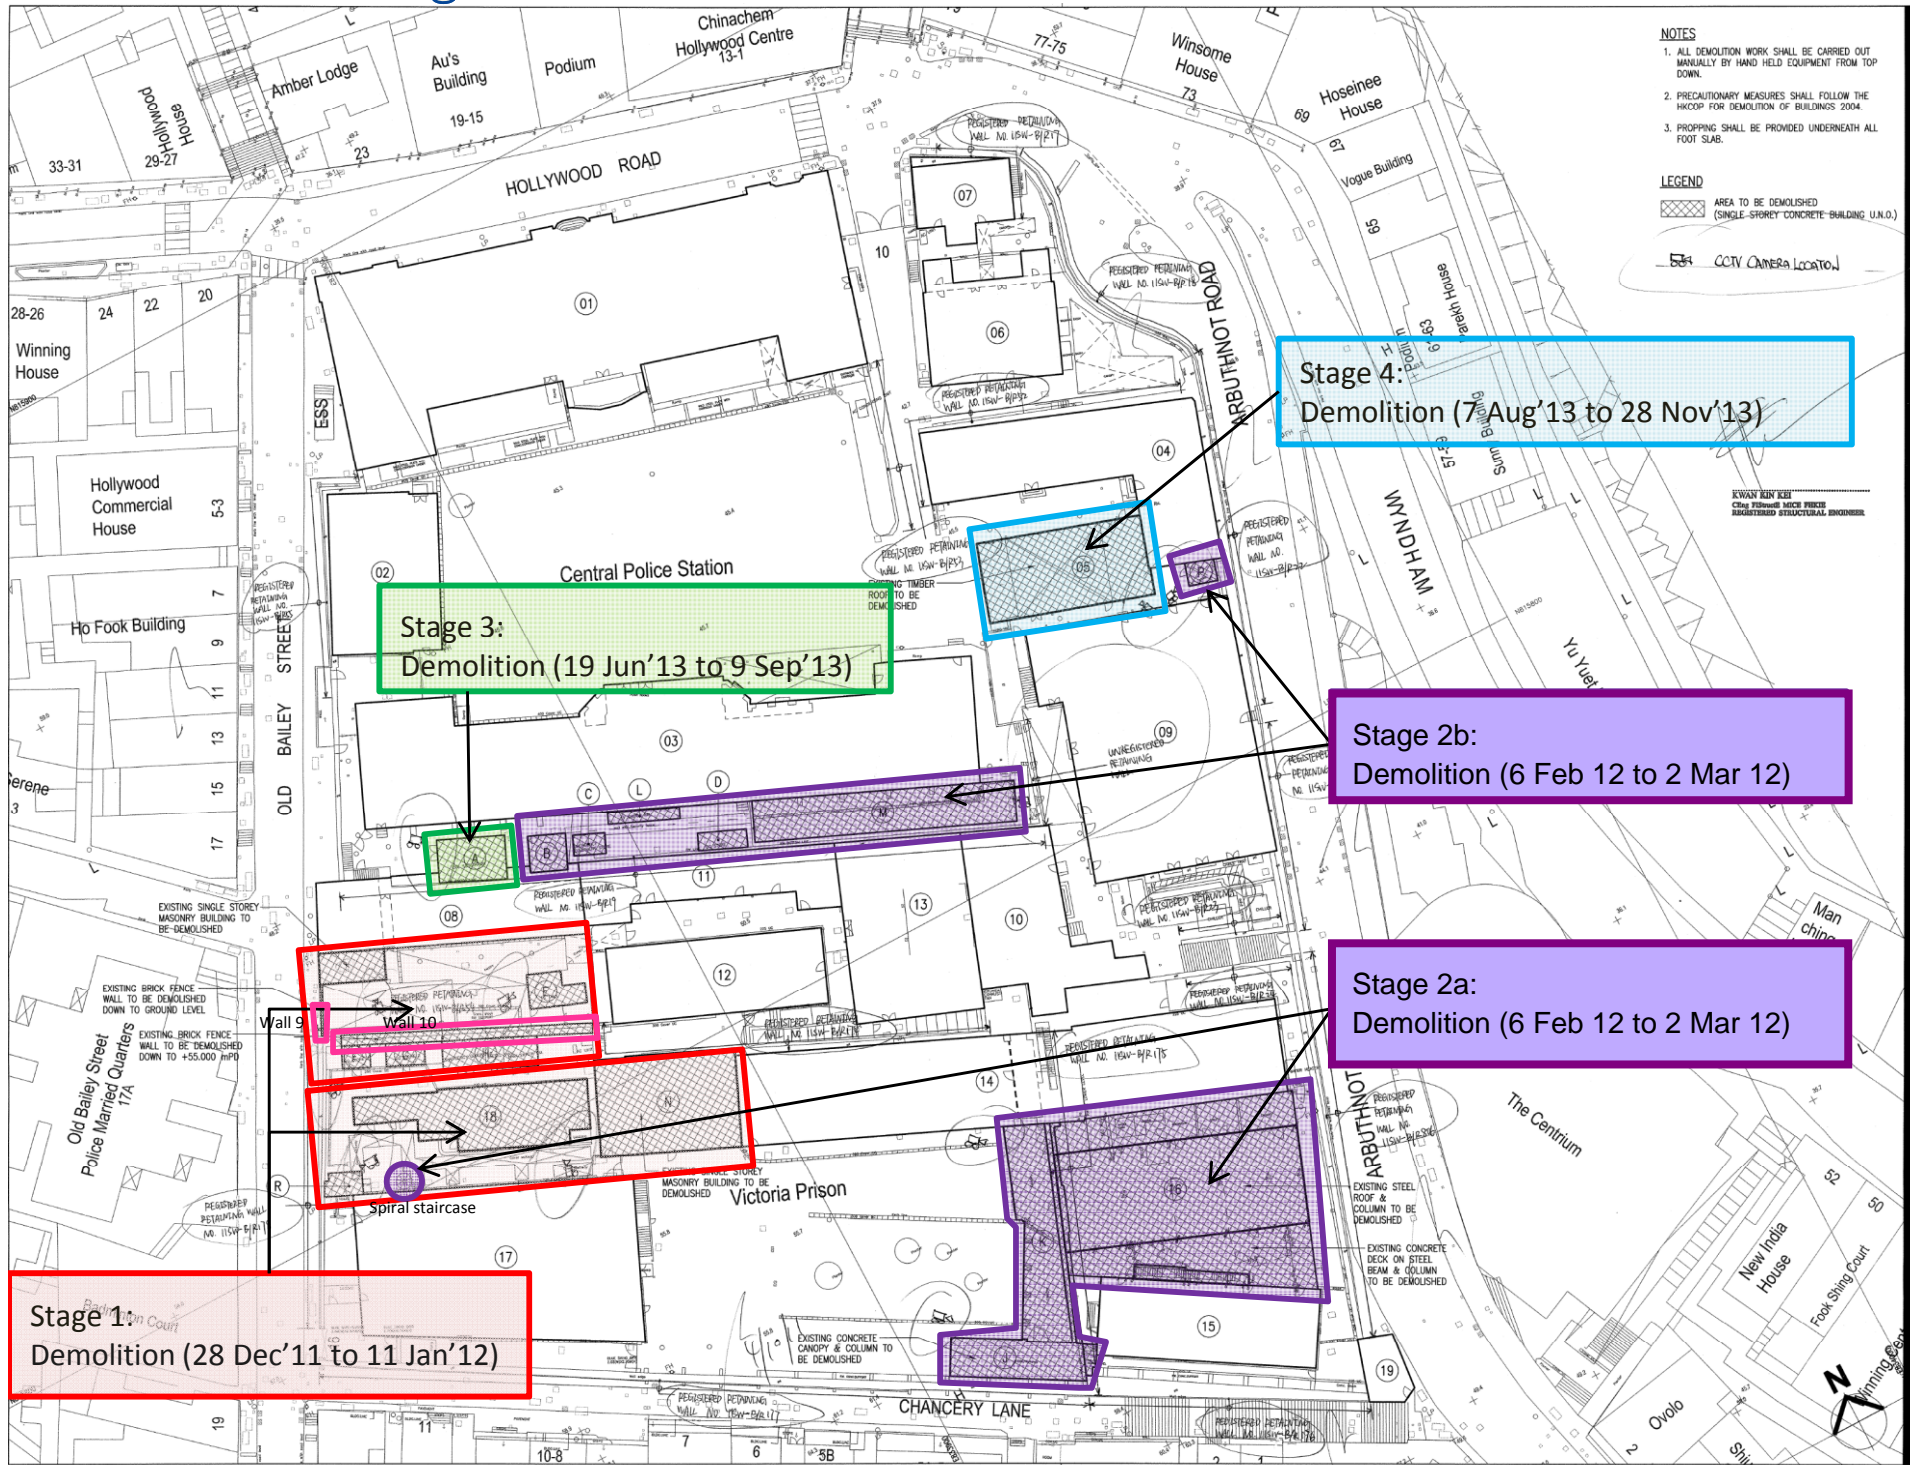

**Stage 1:**  
Demolition (28 Dec'11 to 11 Jan'12)

**Stage 3:**  
Demolition (19 Jun'13 to 9 Sep'13)

**Stage 4:**  
Demolition (7 Aug'13 to 28 Nov'13)

**Stage 2b:**  
Demolition (6 Feb 12 to 2 Mar 12)

**Stage 2a:**  
Demolition (6 Feb 12 to 2 Mar 12)

**NOTES**

- ALL DEMOLITION WORK SHALL BE CARRIED OUT MANUALLY BY HAND HELD EQUIPMENT FROM TOP DOWN.
- PRECAUTIONARY MEASURES SHALL FOLLOW THE HKOCP FOR DEMOLITION OF BUILDINGS 2004.
- PROPPING SHALL BE PROVIDED UNDERNEATH ALL FOOT SLAB.

**LEGEND**

- AREA TO BE DEMOLISHED (SINGLE-STORY CONCRETE-BUILDING U.N.O.)
- CCTV CAMERA LOCATION

R.D. Ref. No. 屋宇署圖則編號  
22-1/3066/10(D4)  
F.S.D. Ref. No. 消防處圖則編號

Revision/Submission 修改版/提交	Description 說明	Date 日期	Approved 批准
01	TENDER	05/11	T.H.
02	BD SUBMISSION	05/11	T.H.

Plan Approved  
*Chan Yuen-ming*  
CHAN Yuen-ming, Mary  
Senior Building Surveyor  
for BUILDING AUTHORITY  
- 6 OCT 2011

Key Plan 索引圖

BD SUBMISSION  
Drawing Status 製圖狀況

This drawing and its contents herein are the copyright of relevant consultants.  
本圖紙及其內容的版權屬有關顧問公司所有。  
No part of the drawing and the design contained herein may be reproduced without the prior written consent of relevant consultants.  
未經有關顧問公司書面同意，不得複製此圖紙內任何內容或設計。  
Do not take measurements directly from this drawing. 切勿直接從圖紙上量取尺寸。  
Check and verify all dimensions on site. 所有尺寸必須在工地現場核實及量取。  
Read this drawing in conjunction with the specifications and all other related drawings. 此圖紙必須與規格說明書及其他有關圖紙一併閱讀。  
Notify the relevant consultants immediately of any discrepancy found herein. 如發現內容有任何錯誤之處，應立即通知有關顧問公司。

Client 業主  
香港賽馬會慈善信託基金  
The Hong Kong Jockey Club Charities Trust

Design Consultant  
HERZOG & DE MEURON

Conservation Architect  
ARUP

Architect / AP  
ROCCO 許宇

Structural Engineer / RSE  
E & M Engineer  
JRP


Project 項目  
CENTRAL POLICE STATION  
CONSERVATION AND REVITALISATION

Drawing Title 圖名  
DEMOLITION SITE PLAN  
(OVERALL)

Scale 比例  
1:300/9A1  
Drawing No. 圖號  
DE-OAP209674-1-100  
Drawn 繪圖  
P.C.  
Checked 校對  
T.H.  
Revision 修改版  
02

Old file : DE-OAP209674-1-100.dwg



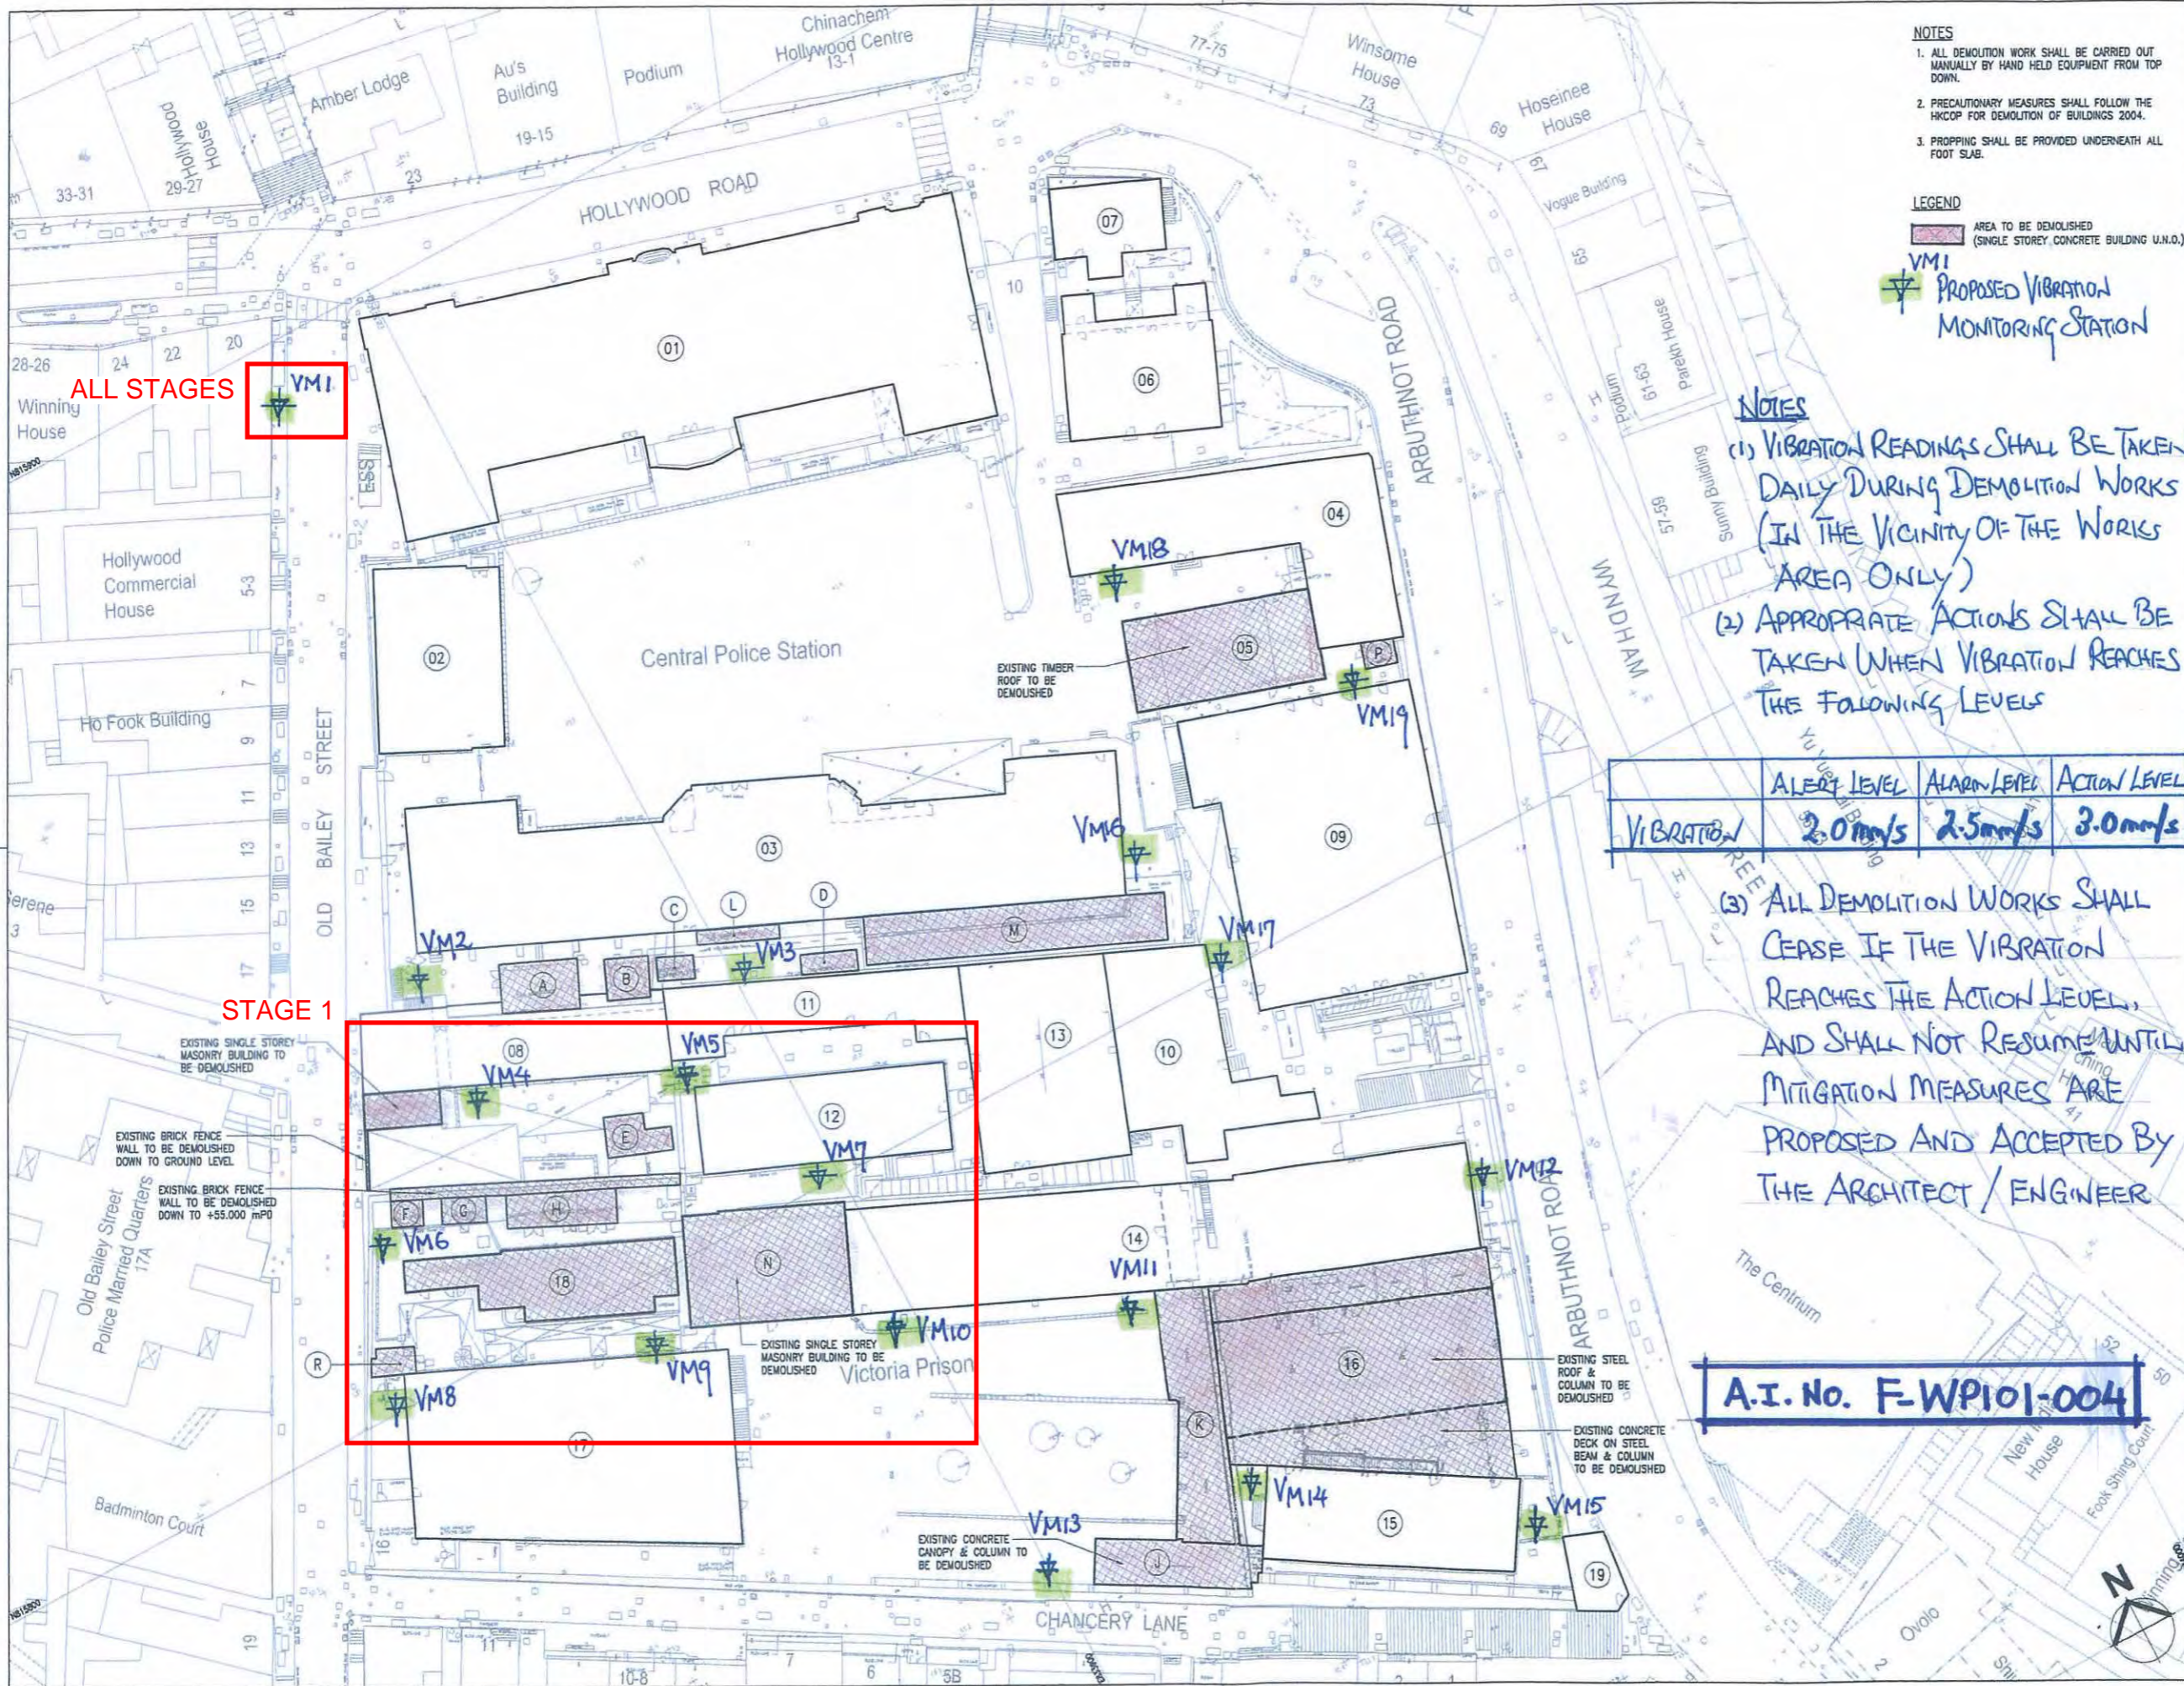

**NOTES**

1. ALL DEMOLITION WORK SHALL BE CARRIED OUT MANUALLY BY HAND HELD EQUIPMENT FROM TOP DOWN.
2. PRECAUTIONARY MEASURES SHALL FOLLOW THE HKCOP FOR DEMOLITION OF BUILDINGS 2004.
3. PROPPING SHALL BE PROVIDED UNDERNEATH ALL FOOT SUB.

**LEGEND**

■ AREA TO BE DEMOLISHED (SINGLE STOREY CONCRETE BUILDING U.N.O.)

VM1 PROPOSED VIBRATION MONITORING STATION

**NOTES**

(1) VIBRATION READINGS SHALL BE TAKEN DAILY DURING DEMOLITION WORKS (IN THE VICINITY OF THE WORKS AREA ONLY)

(2) APPROPRIATE ACTIONS SHALL BE TAKEN WHEN VIBRATION REACHES THE FOLLOWING LEVELS

VIBRATION	ALERT LEVEL	ALARM LEVEL	ACTION LEVEL
	2.0mm/s	2.5mm/s	3.0mm/s

(3) ALL DEMOLITION WORKS SHALL CEASE IF THE VIBRATION REACHES THE ACTION LEVEL, AND SHALL NOT RESUME UNTIL MITIGATION MEASURES ARE PROPOSED AND ACCEPTED BY THE ARCHITECT / ENGINEER

**A.I. No. F-WP101-004**

B.D. Ref. No. 樓宇維修編號  
22-1/3056/10 (H)

Rev. No. 修改/增修編號

No. 編號	Description 說明	Date 日期	Approved 審批
01	TENDER	08/11	T.H.
02	BD SUBMISSION	08/11	T.H.



BD SUBMISSION  
Drawing Status 製圖狀況

This drawing and the contents herein are the copyright of relevant consultants.  
本圖紙及其內容均屬有關顧問公司所有。

No part of the drawing and the design contained herein may be reproduced without the prior written consent of relevant consultants.  
未經有關顧問公司書面同意，不得複製或重印任何內容或設計。

Do not take measurements directly from this drawing.  
切勿直接從圖紙上量度尺寸。

Check and verify all dimensions on site.  
所有尺寸必須在工地現場核實及量度。

Read this drawing in conjunction with the specifications and all other related drawings.  
本圖紙必須與規格說明書及其他有關圖紙一併閱讀。

Notify the relevant consultants immediately of any discrepancy found herein.  
如發現任何有誤之處，應立即通知有關顧問公司。

Client 業主  
The Hong Kong Jockey Club Charities Trust

Design Consultant  
HERZOG & DE MEURON

Conservation Architect  
Rocco Yick

Architect / AP  
ARUP

Structural Engineer / RSE  
E & M Engineer  
ARUP

Project 項目  
CENTRAL POLICE STATION  
CONSERVATION AND REVITALISATION

Drawing Title 圖名  
DEMOLITION SITE PLAN  
(OVERALL)

**VIBRATION MONITORING**

Scale 比例  
1:3000A1

Drawn 繪圖  
P.C.

Checked 校對  
T.H.


Drawing No. 圖號  
DE-OAP209674-L-100

Revision 修改  
02

11 NOV 2011

Cad file : DE-OAP209674-L-100.dwg



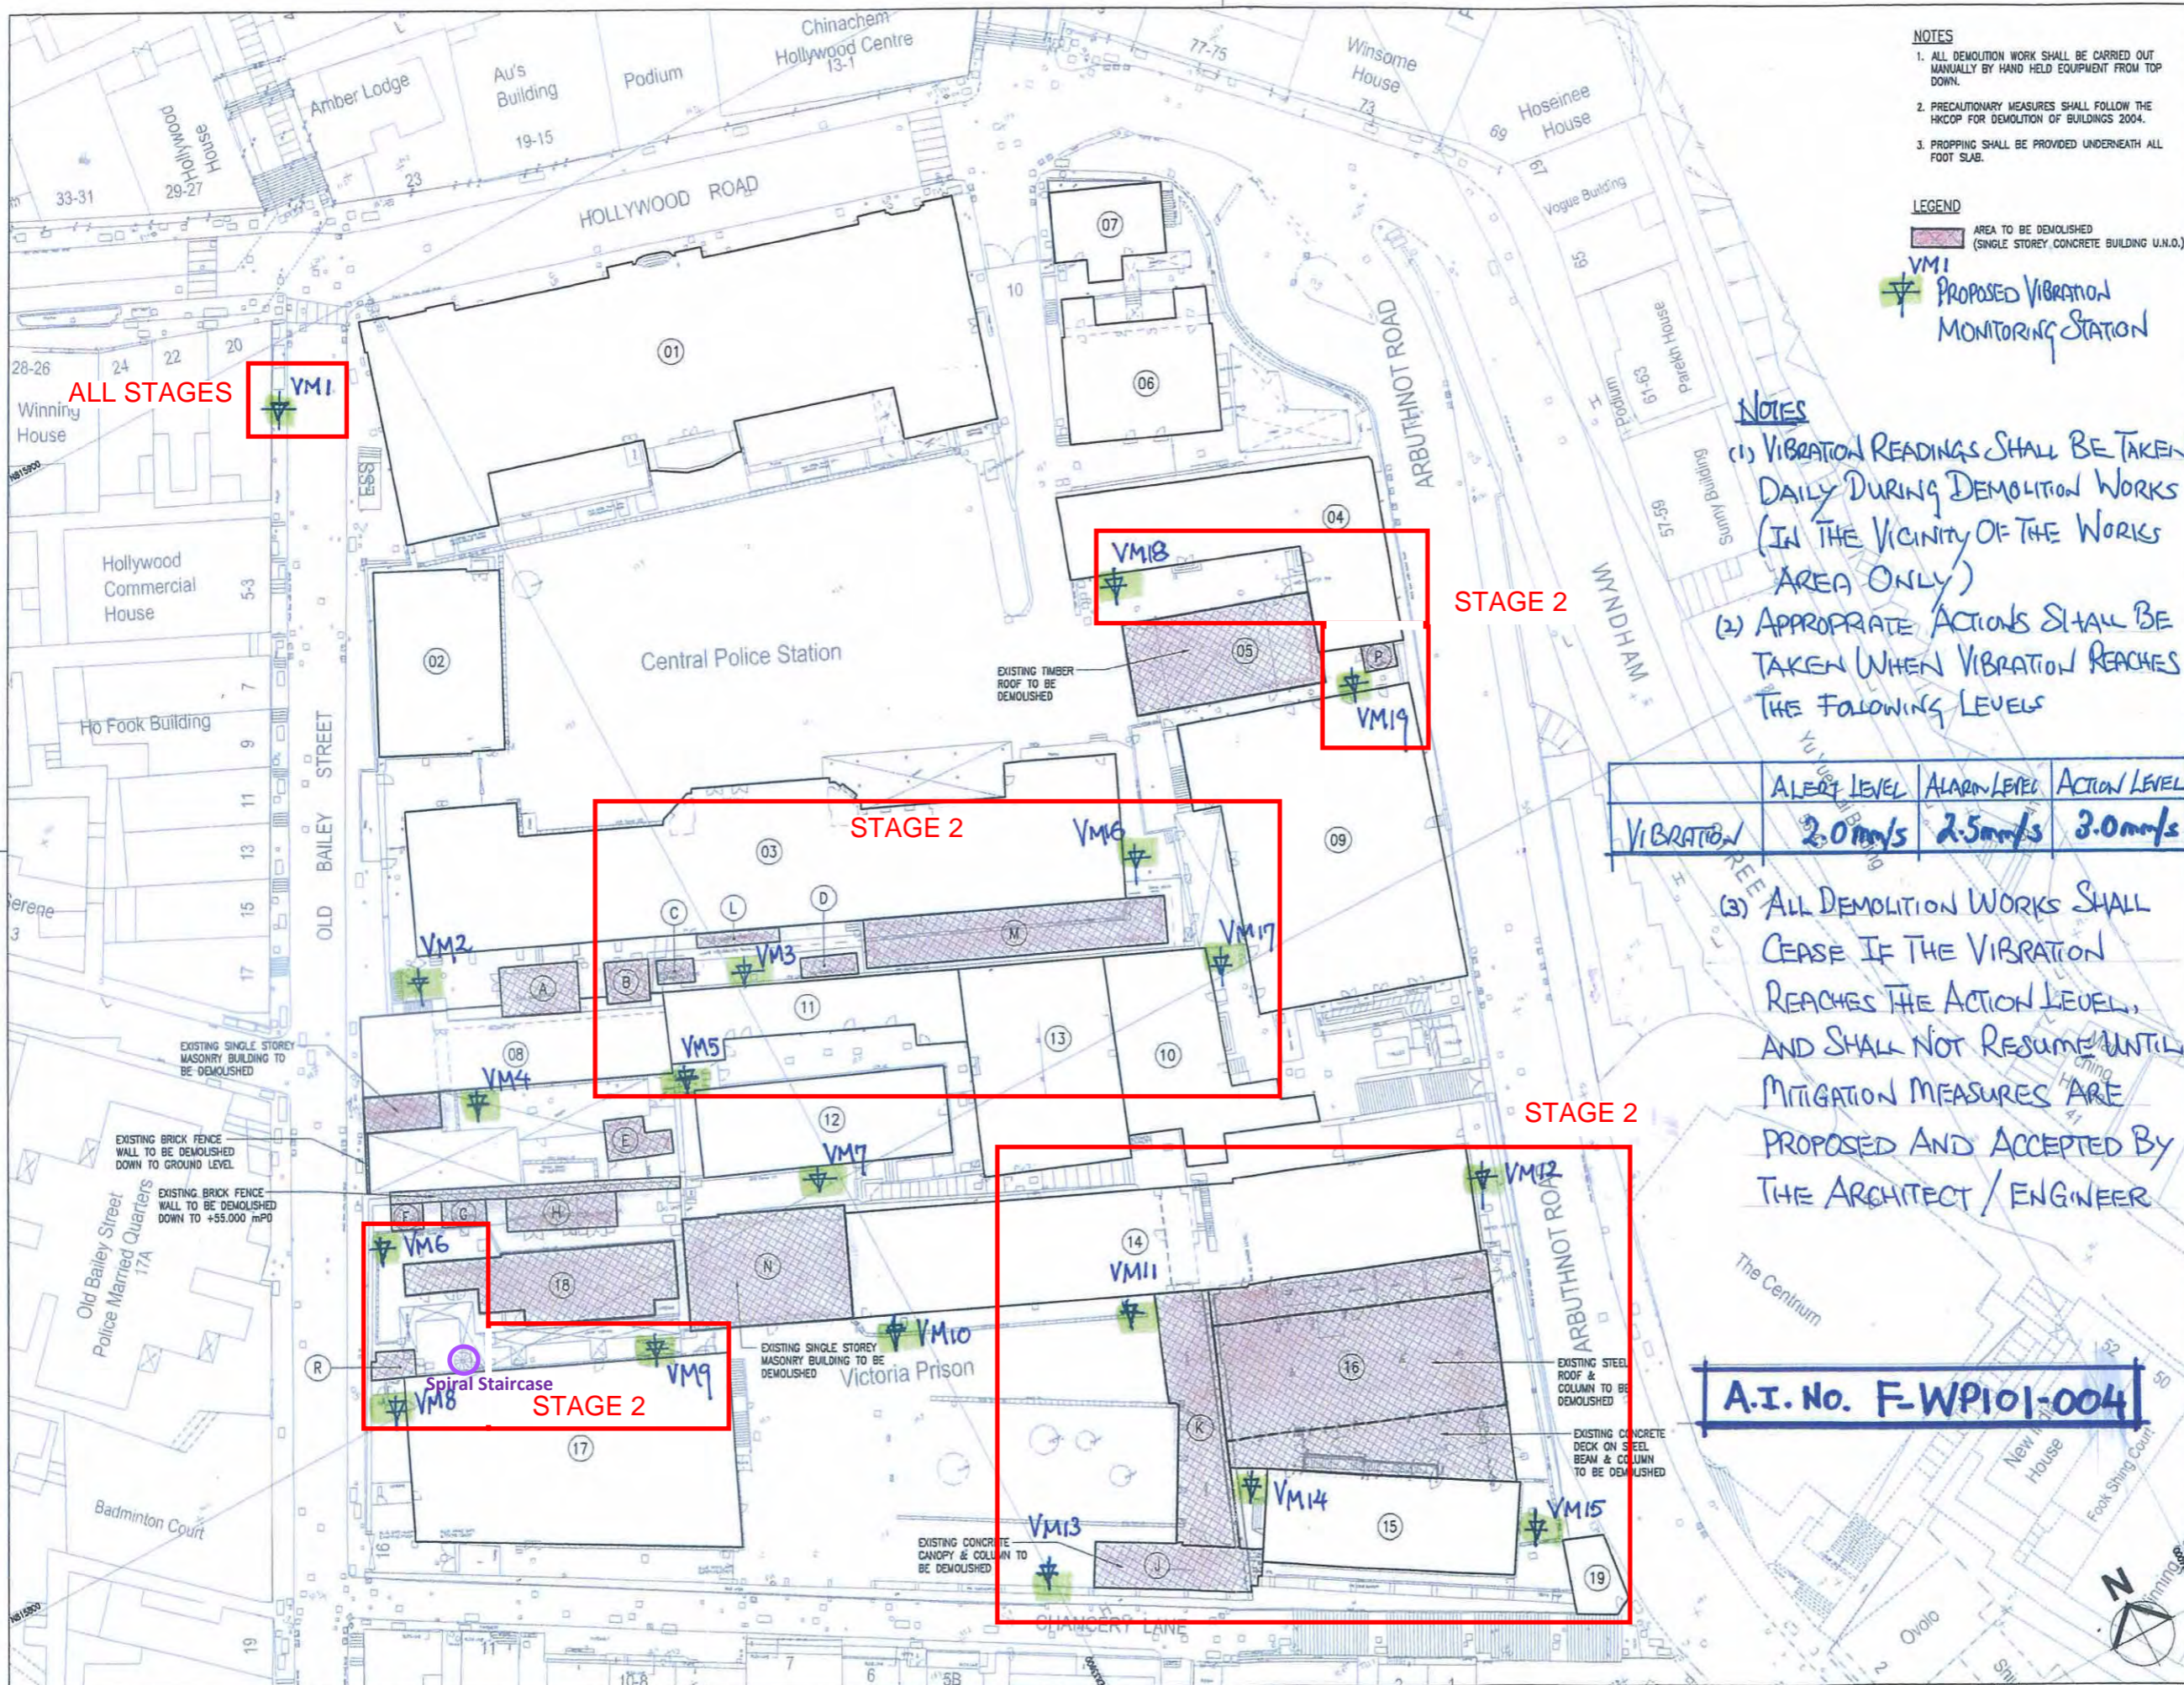

**NOTES**

1. ALL DEMOLITION WORK SHALL BE CARRIED OUT MANUALLY BY HAND HELD EQUIPMENT FROM TOP DOWN.
2. PRECAUTIONARY MEASURES SHALL FOLLOW THE HKCOP FOR DEMOLITION OF BUILDINGS 2004.
3. PROPPING SHALL BE PROVIDED UNDERNEATH ALL FOOT SUB.

**LEGEND**

■ AREA TO BE DEMOLISHED (SINGLE STOREY CONCRETE BUILDING U.N.O.)

⚡ VM1 PROPOSED VIBRATION MONITORING STATION

**NOTES**

(1) VIBRATION READINGS SHALL BE TAKEN DAILY DURING DEMOLITION WORKS (IN THE VICINITY OF THE WORKS AREA ONLY)

(2) APPROPRIATE ACTIONS SHALL BE TAKEN WHEN VIBRATION REACHES THE FOLLOWING LEVELS

VIBRATION	ALERT LEVEL	ALARM LEVEL	ACTION LEVEL
	2.0mm/s	2.5mm/s	3.0mm/s

(3) ALL DEMOLITION WORKS SHALL CEASE IF THE VIBRATION REACHES THE ACTION LEVEL, AND SHALL NOT RESUME UNTIL MITIGATION MEASURES ARE PROPOSED AND ACCEPTED BY THE ARCHITECT / ENGINEER

**A.I. No. F-WP101-004**

B.D. Ref. No. 樓宇樓宇編號  
22-1/3056/10 (H)

Rev. No. 修改/修改編號

No. 編號	Description 說明	Date 日期	Approved 審批
01	TENDER	08/11	T.H.
02	BD SUBMISSION	08/11	T.H.



BD SUBMISSION  
Drawing Status 製圖狀況

This drawing and the contents herein are the copyright of relevant consultants.  
本圖紙及其內容均屬有關顧問公司所有。  
- No part of the drawing and the design contained herein may be reproduced without the prior written consent of relevant consultants.  
- 未經有關顧問公司書面同意，不得複製或重印任何內容或設計。  
- Do not take measurements directly from this drawing.  
- 切勿直接從圖紙上量度尺寸。  
- Check and verify all dimensions on site.  
- 所有尺寸必須在工地現場核實及量度。  
- Read this drawing in conjunction with the specifications and all other related drawings.  
- 本圖紙必須與規格說明書及其他有關圖紙一併閱讀。  
- Notify the relevant consultants immediately of any discrepancy found herein.  
- 如發現內容有任何錯誤之處，應立即通知有關顧問公司。

Client 業主  
香港賽馬會慈善信託基金  
The Hong Kong Jockey Club Charities Trust

Design Consultant  
HERZOG & DE MEURON

Conservation Architect  
羅國輝建築師樓

Architect / AP  
ROCCO 許榮

Structural Engineer / RSE  
ARUP

E & M Engineer  
JRP

Project 項目  
CENTRAL POLICE STATION  
CONSERVATION AND REVITALISATION

Drawing Title 圖名  
DEMOLITION SITE PLAN  
(OVERALL)  
VIBRATION MONITORING

Scale 比例  
1:3000A1

Drawn 繪圖  
P.C.


Checked 校對  
T.H.

Drawing No. 圖號  
DE-OAP209674-L-100

Revision 修改  
02

11 NOV 2011  
Cod file : DE-OAP209674-L-100.dwg



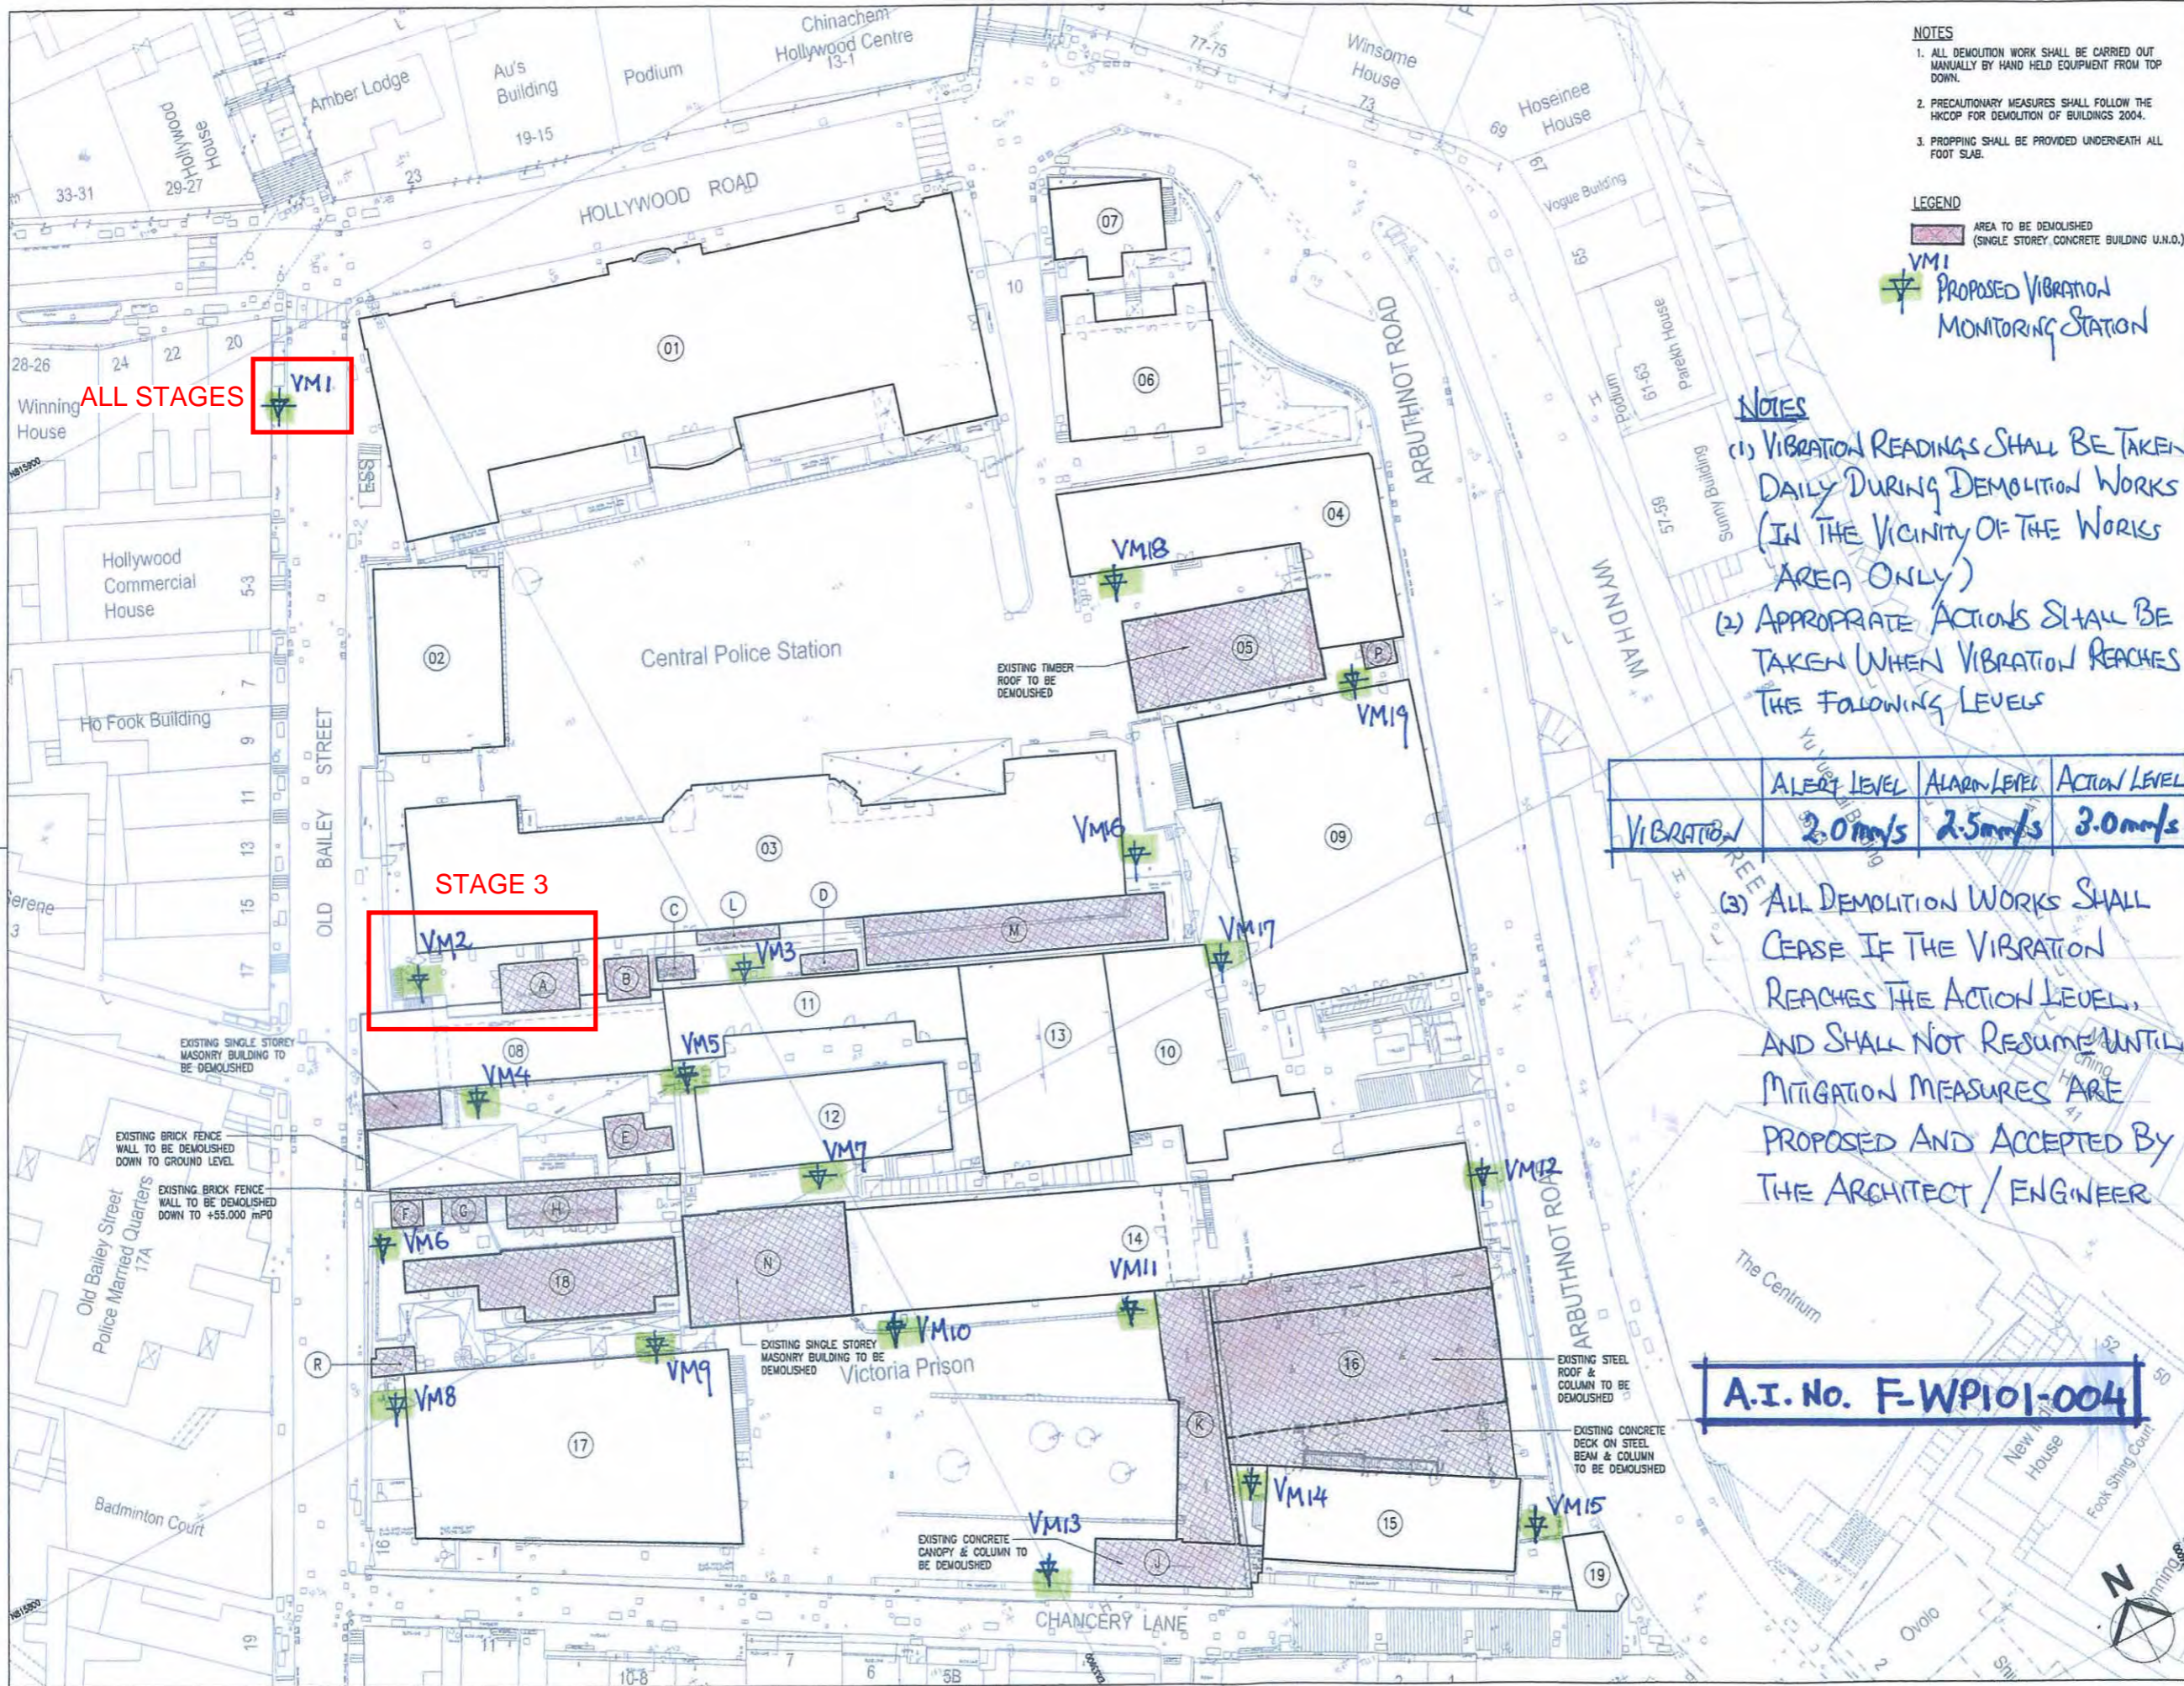

**NOTES**

1. ALL DEMOLITION WORK SHALL BE CARRIED OUT MANUALLY BY HAND HELD EQUIPMENT FROM TOP DOWN.
2. PRECAUTIONARY MEASURES SHALL FOLLOW THE HKCOP FOR DEMOLITION OF BUILDINGS 2004.
3. PROPPING SHALL BE PROVIDED UNDERNEATH ALL FOOT SUB.

**LEGEND**

■ AREA TO BE DEMOLISHED (SINGLE STOREY CONCRETE BUILDING U.N.O.)

VM1 PROPOSED VIBRATION MONITORING STATION

**NOTES**

(1) VIBRATION READINGS SHALL BE TAKEN DAILY DURING DEMOLITION WORKS (IN THE VICINITY OF THE WORKS AREA ONLY)

(2) APPROPRIATE ACTIONS SHALL BE TAKEN WHEN VIBRATION REACHES THE FOLLOWING LEVELS

VIBRATION	ALERT LEVEL	ALARM LEVEL	ACTION LEVEL
	2.0mm/s	2.5mm/s	3.0mm/s

(3) ALL DEMOLITION WORKS SHALL CEASE IF THE VIBRATION REACHES THE ACTION LEVEL, AND SHALL NOT RESUME UNTIL MITIGATION MEASURES ARE PROPOSED AND ACCEPTED BY THE ARCHITECT / ENGINEER

**A.I. No. F-WP101-004**

B.D. Ref. No. 22-1/3056/10 (H)

Rev. No. / Submission 修改版 / 編號

No. 編號	Description 說明	Date 日期	Approved 審批
01	TENDER	08/11	T.H.
02	BD SUBMISSION	08/11	T.H.



BD SUBMISSION  
Drawing Status 製圖狀況

This drawing and the contents herein are the copyright of relevant consultants.  
本圖紙及其內容的版權屬有關顧問公司所有。

No part of the drawing and the design contained herein may be reproduced without the prior written consent of relevant consultants.  
未經有關顧問公司書面同意，不得複製或重印任何內容或設計。

Do not take measurements directly from this drawing.  
切勿直接從圖紙上量度尺寸。

Check and verify all dimensions on site.  
所有尺寸必須在工地現場核實及量度。

Read this drawing in conjunction with the specifications and all other related drawings.  
本圖紙必須與規格說明書及其他有關圖紙一併閱讀。

Notify the relevant consultants immediately of any discrepancy found herein.  
如發現任何有誤之處，應立即通知有關顧問公司。

Client 業主  
The Hong Kong Jockey Club Charities Trust

Design Consultant  
HERZOG & DE MEURON

Conservation Architect  
ARUP

Architect / AP  
ROCCO

Structural Engineer / RSE  
ARUP

E & M Engineer  
ARUP

Project 項目  
CENTRAL POLICE STATION  
CONSERVATION AND REVITALISATION

Drawing Title 圖名  
DEMOLITION SITE PLAN  
(OVERALL)

VIBRATION MONITORING

Scale 比例  
1:3000A1

Drawn 繪圖  
P.C.

Checked 校對  
T.H.


Drawing No. 圖號  
DE-OAP209674-L-100

Revision 修改版  
02

11 NOV 2011

Cad file : DE-OAP209674-L-100.dwg



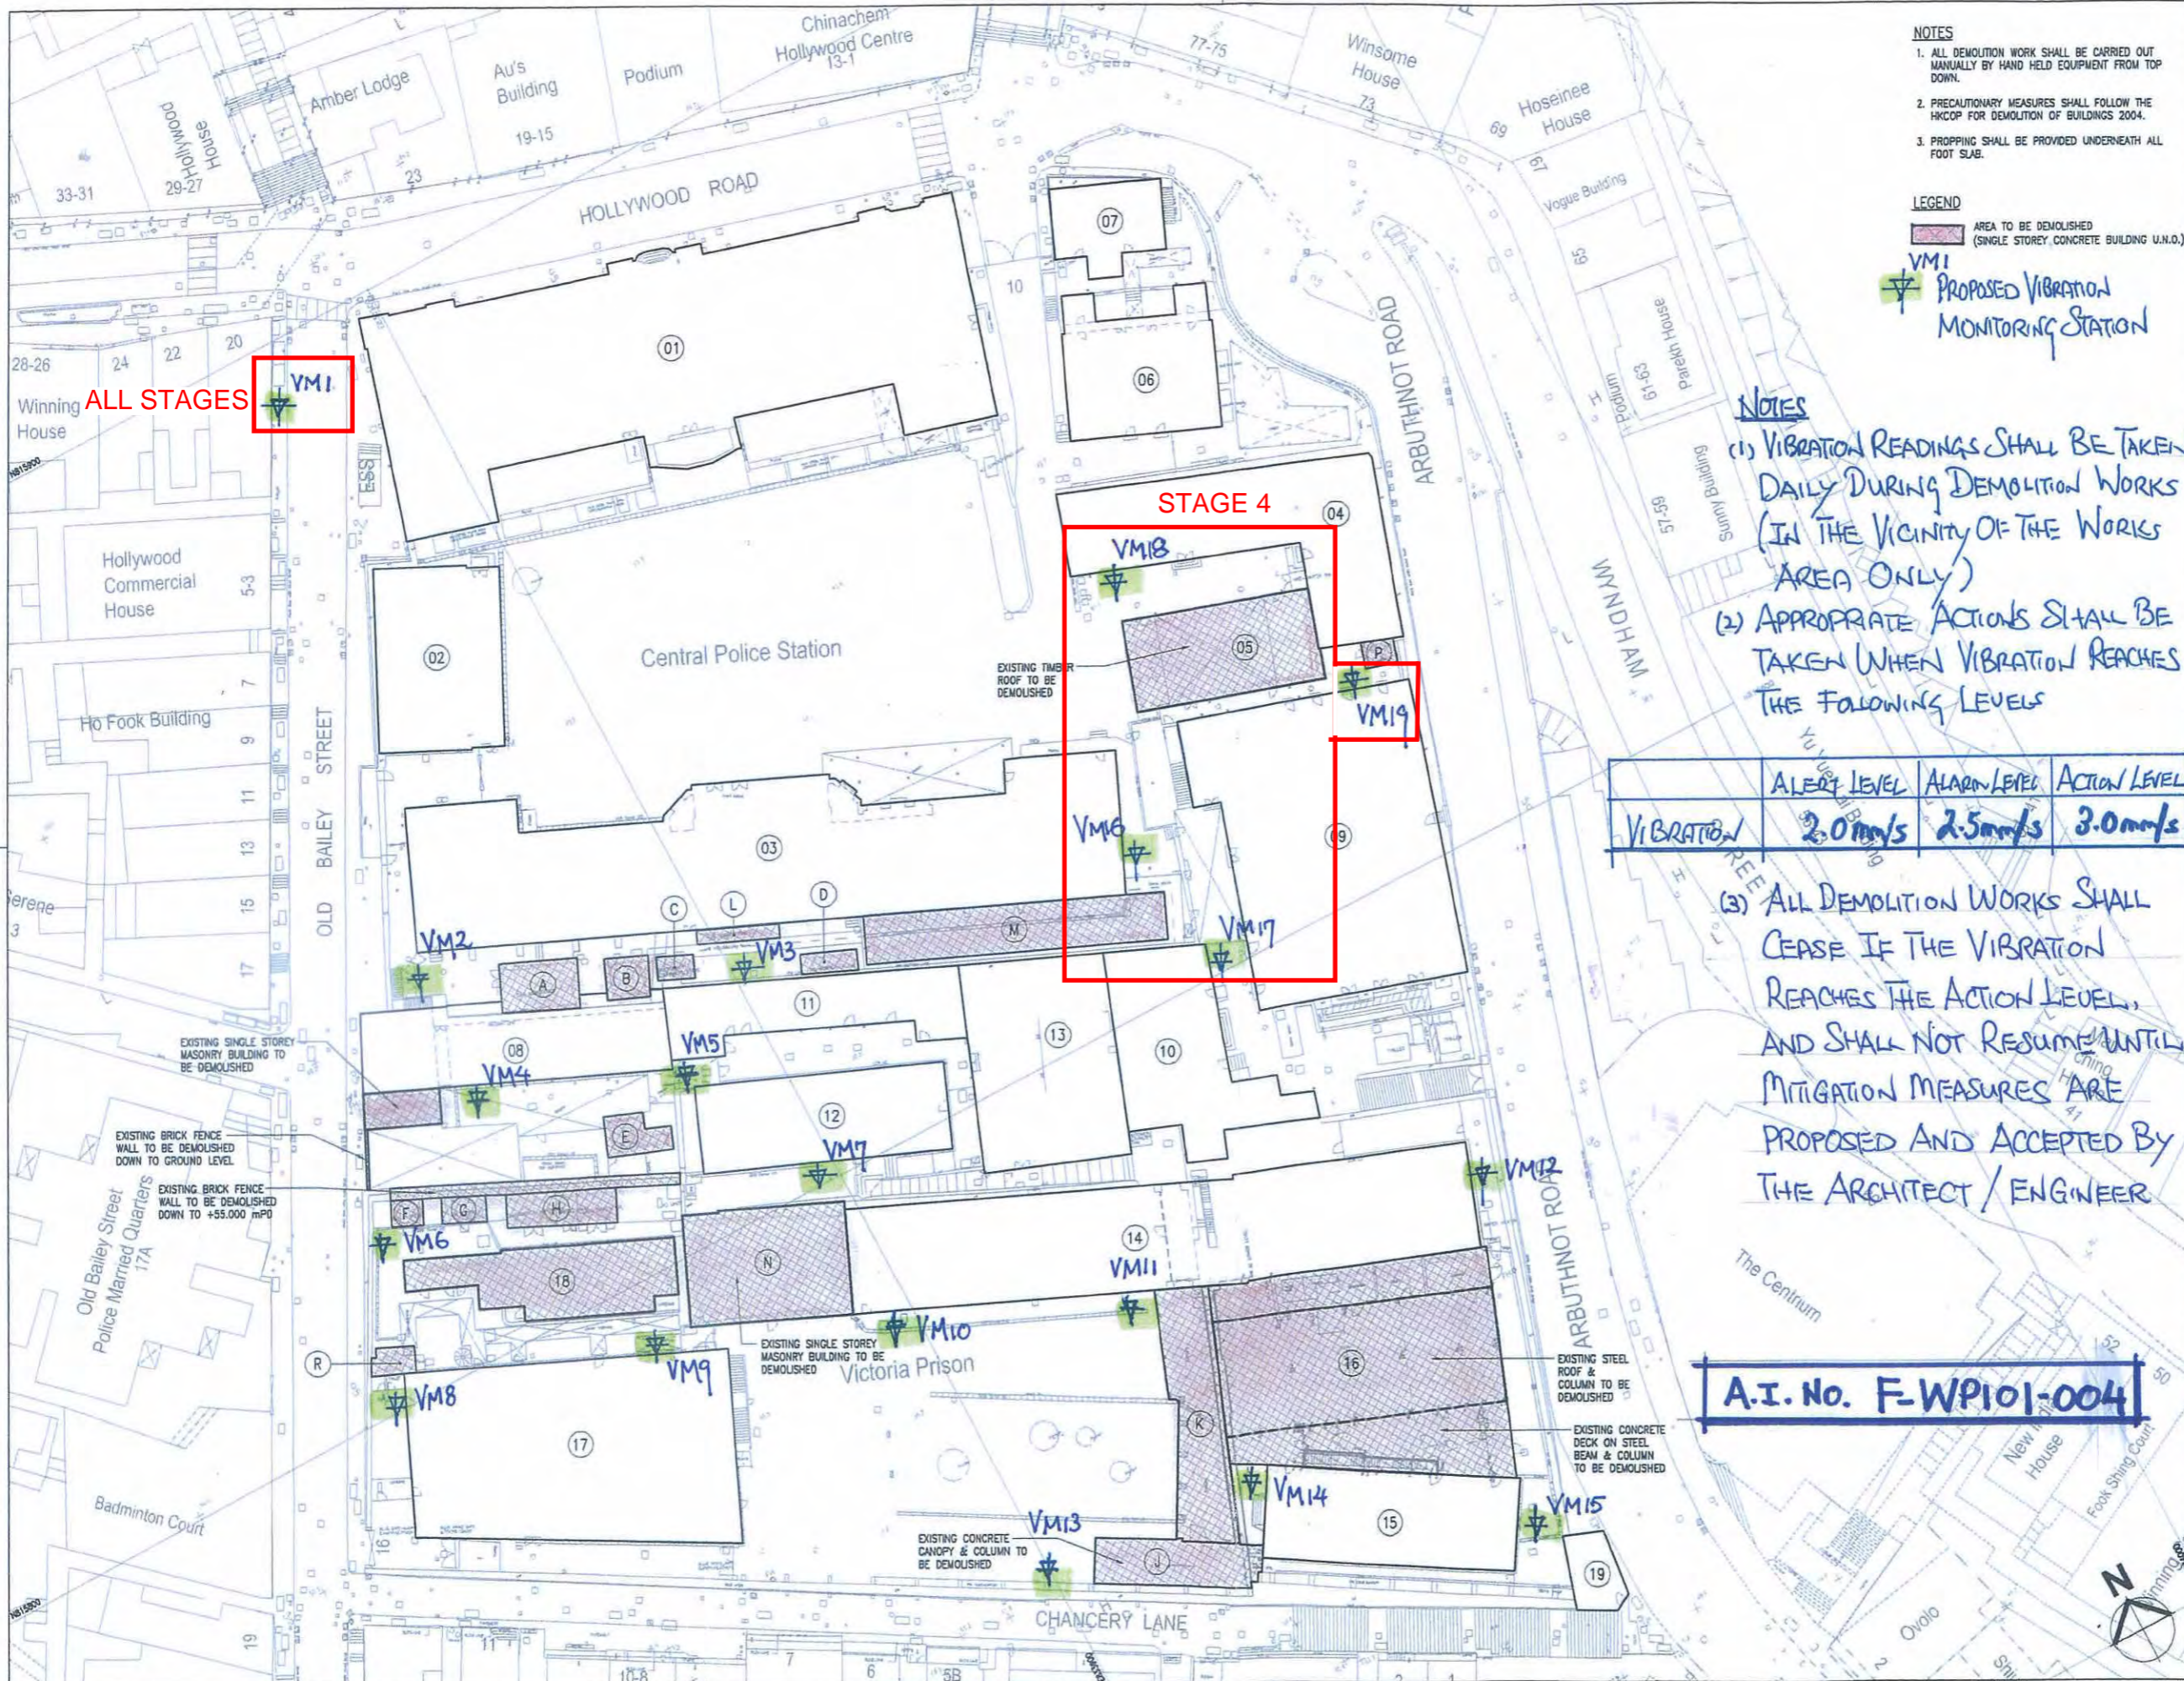

**NOTES**

1. ALL DEMOLITION WORK SHALL BE CARRIED OUT MANUALLY BY HAND HELD EQUIPMENT FROM TOP DOWN.
2. PRECAUTIONARY MEASURES SHALL FOLLOW THE HKCOP FOR DEMOLITION OF BUILDINGS 2004.
3. PROPPING SHALL BE PROVIDED UNDERNEATH ALL FOOT SUB.

**LEGEND**

■ AREA TO BE DEMOLISHED (SINGLE STOREY CONCRETE BUILDING U.N.O.)

VM1 PROPOSED VIBRATION MONITORING STATION

**NOTES**

(1) VIBRATION READINGS SHALL BE TAKEN DAILY DURING DEMOLITION WORKS (IN THE VICINITY OF THE WORKS AREA ONLY)

(2) APPROPRIATE ACTIONS SHALL BE TAKEN WHEN VIBRATION REACHES THE FOLLOWING LEVELS

VIBRATION	ALERT LEVEL	ALARM LEVEL	ACTION LEVEL
	2.0mm/s	2.5mm/s	3.0mm/s

(3) ALL DEMOLITION WORKS SHALL CEASE IF THE VIBRATION REACHES THE ACTION LEVEL, AND SHALL NOT RESUME UNTIL MITIGATION MEASURES ARE PROPOSED AND ACCEPTED BY THE ARCHITECT / ENGINEER

**A.I. No. F-WP101-004**

B.D. Ref. No. 樓宇樓宇編號  
22-1/3056/10 (H)

Rev. No. 修改/修改編號

No. 編號	Description 說明	Date 日期	Approved 審批
01	TENDER	08/11	T.H.
02	BD SUBMISSION	08/11	T.H.



BD SUBMISSION  
Drawing Status 製圖狀況

This drawing and the contents herein are the copyright of relevant consultants.  
本圖紙及其內容均屬有關顧問公司所有。

No part of the drawing and the design contained herein may be reproduced without the prior written consent of relevant consultants.  
未經有關顧問公司書面同意，不得複製或重印任何內容或設計。

Do not take measurements directly from this drawing.  
切勿直接從圖紙上量度尺寸。

Check and verify all dimensions on site.  
所有尺寸必須在工地現場核實及量度。

Read this drawing in conjunction with the specifications and all other related drawings.  
本圖紙必須與規格說明書及其他有關圖紙一併閱讀。

Notify the relevant consultants immediately of any discrepancy found herein.  
如發現任何有誤之處，應立即通知有關顧問公司。

Client 業主  
香港賽馬會慈善信託基金  
The Hong Kong Jockey Club Charities Trust

Design Consultant  
HERZOG & DE MEURON

Conservation Architect  
羅國輝建築師樓

Architect / AP  
ROCCO 許榮

Structural Engineer / RSE  
ARUP E & M Engineer

Project 項目  
CENTRAL POLICE STATION  
CONSERVATION AND REVITALISATION

Drawing Title 圖名  
DEMOLITION SITE PLAN  
(OVERALL)

VIBRATION MONITORING

Scale 比例  
1:3000A1  
Drawing No. 圖號  
DE-OAP209674-L-100 02

11 NOV 2011  
Cod file : DE-OAP209674-L-100.dwg



**Demolition Works  
Central Police Station Compound at No. 10, Hollywood Road  
Method Statement for Vibration Monitoring**

---

## Appendix 2

Specification of the model Blastmate III

# Blastmate III™

## Full-Featured, Advanced Vibration and Overpressure Monitor

### Range of Applications:

- Blast-monitoring for compliance
- Near-field blast analysis
- Pile driving
- Construction activity
- Demolition activity
- Heavy transportation
- Bridge monitoring
- Structural analysis
- Underwater blast monitoring
- 4 or 8 channel data acquisition
- Remote monitoring - Auto Call Home™

Consultants, engineers and contractors the world over recognize the **Instantel® Blastmate III™** vibration and overpressure monitor as the most versatile and most reliable full featured monitor available. It provides all of the industry-leading features of the **Instantel Minimate Plus™** monitor, conveniently packaged with a full keyboard and a high-resolution printer. This allows you to setup, add notes and print complete event reports in the field, without a computer.

### Versatile

With standard features like the **Instantel Histogram Combo™** monitoring mode, zero dead-time between events, and flexible sample rates up to 65,536 S/s, the **Blastmate III** system provides you with control and confidence to monitor reliably in any situation. For added versatility, you have the option to add 4 more channels and extra memory, providing two complete standard monitors in a single package.

For more demanding monitoring applications, the **Instantel Blastware® Advanced Module** software provides the capability to monitor a broad selection of vibration and overpressure sensors, as well as sensors for related structural and environmental measurements. Monitor vibration, ambient environmental conditions, and the movement of structural cracks, all at the same time, all using the same **Blastmate III** monitor.

### Easy to use

The features and versatility of the **Blastmate III** monitor set it apart, but the fact that it is also easy to use makes it truly revolutionary. The dedicated single use function keys, backlit LCD and simple menu-driven operation make setup and operation quick and easy, even for inexperienced personnel.

### Tough

The **Blastmate III** monitor has been built to survive, with a fully sealed top panel, non-corrosive industrial grade connectors and sealed electronics, all packed in a rugged, water-resistant case.

**Blastmate III** - Reliability and versatility for any monitoring application.



### Key Features

- Fast high-resolution thermal printer for event reports in the field without the need for a computer.
- Full keyboard simplifies entry of job-specific notes and information.
- Dedicated function keys and intuitive menu-driven operation enable quick and easy setup.
- **Histogram Combo** mode allows capture of full waveform records while recording in histogram mode.
- Sample rates from 1,024 to 16,384 S/s per channel - up to 65,536 S/s available on a single channel.
- Available 8-channel option allows for 2 standard triaxial geophones and 2 microphones to be used on a single **Blastmate III** monitor.
- Continuous monitoring means zero dead time, even while the unit is processing.
- Any channel can be matched to a wide variety of sensors - geophones, accelerometers, or hydrophones.



# Blastmate III™

## General Specifications

## Blastmate III

Channels	Microphone and Triaxial Geophone or 4 independent user-configurable channels (two Microphones and two Triaxial Geophones or 8 independent channels with optional 8-channel upgrade)
Vibration Monitoring (with Standard Triaxial Geophone)	
Range	Up to 254 mm/s (10 in/s)
Resolution	0.127 mm/s (0.005 in/s) or 0.0159 mm/s (0.000625 in/s) with built-in preamp
Accuracy (ISEE / DIN)	+/- 5% or 0.5 mm/s (0.02 in/s), whichever is larger, between 4 and 125 Hz / DIN 45669-1 standard
Transducer Density	2.13 g/cc (133 lbs/ft <sup>3</sup> )
Frequency Range (ISEE / DIN)	2 to 250 Hz, within zero to -3 dB of an ideal flat response / 1 to 315 Hz
Maximum Cable Length (ISEE / DIN)	75 m (250 ft) / 1,000 m (3,280 ft)
Air Overpressure Monitoring	
Weighting Scales	Linear or A-weight
Linear Range	88 to 148 dB (500 Pa (0.072 PSI) Peak)
Linear Resolution	0.25 Pa (0.0000363 PSI)
Linear Accuracy	+/- 10% or +/- 1 dB, whichever is larger, between 4 and 125 Hz
Linear Frequency Response	2 to 250 Hz between -3 dB roll off points
A-weight Range	50 to 110 dBA
A-weight Resolution	0.1 dBA

## Waveform Recording

Record Modes	Manual, Single-shot, Continuous
Seismic Trigger	0.125 to 254 mm/s (0.005 to 10 in/s)
Acoustic Triggers	
Linear	100 to 148 dB
A-weight	55 to 110 dBA
Sample Rate	1,024 to 16,384 S/s per channel (independent of record time), up to 65,536 S/s in single-channel mode with advanced software (maximum 8,192 S/s per channel for 8 channels)
Record Stop Mode	Fixed record time, <b>Instantel® AutoRecord™</b> record stop mode
Record Time	1 to 100 seconds (programmable in one-second steps) or 500 seconds plus 0.25 seconds pre-trigger
<b>AutoRecord</b> Time	Auto window programmable from 1 to 9 seconds, plus a 0.25 second pre-trigger. Event is recorded until activity remains below trigger level for duration of auto window, or until available memory is filled. Recording uninterrupted by event processing - No dead time
Cycle Time	
Storage Capacity	
Full Waveform Events	300 one-second events at 1,024 S/s sample rate (1,500 event capacity with optional memory upgrade)
Event Summaries	1,750 (8,750 event capacity with optional memory upgrade)

## Histogram Recording

Record Modes	Histogram and <b>Instantel Histogram Combo™</b> (monitor captures triggered waveforms while recording in Histogram mode)
Recording Interval	2, 5 or 15 seconds; 1, 5 or 15 minutes
Storage Capacity	46,656 intervals - 3 days at 5-second intervals or 102 days at 15 minute intervals (with memory upgrade - 15 days at 5-second intervals or 540 days at 15 minute intervals)

## Physical Specifications

Dimensions	269 x 355 x 165 mm (10.6 x 14.0 x 6.5 in)
Weight	6.4 kg (14 lbs)
Battery	Rechargeable 6 V sealed gel cell - capacity for 30 days of continuous monitoring
User Interface	63 domed tactile keys including full keyboard and dedicated keys for common functions
Display	4-line x 20 character, high contrast, backlit LCD with online help
Printer	High resolution thermal plotter
PC Interface	RS-232
Auxillary Inputs and Outputs	External Trigger, Remote Alarm, coordinate download from GPS
Environmental	
Printer/LCD Operating Temperature	-10 to 50°C (14 to 122°F)
Electronics Operating Temperature	-20 to 60°C (-4 to 140°F)
Remote Communications	Compatible with Telephone, GSM, Cellular, RF, Satellite, Short-haul modems, and Ethernet® device servers. Automatically transfers events when they occur through <b>Instantel Auto Call Home™</b> feature.
Additional Features	Monitor start/stop timer

**Corporate Office:**  
309 Legget Drive,  
Ottawa, Ontario K2K 3A3  
Canada

**US Office:**  
808 Commerce Park Drive,  
Ogdensburg, New York 13669  
USA

Toll Free: (800) 267 9111  
Telephone: (613) 592 4642  
Facsimile: (613) 592 4296  
Email: sales@instantel.com



© 2009 Xmark Corporation. Instantel, the Instantel logo, Auto Call Home, AutoRecord, Blastmate, Blastware, Histogram Combo and Minimate, are trademarks of The Stanley Works or its affiliates.



714B0053 Rev 07 - Product Specifications are Subject to Change

The World's Most Trusted Vibration Monitors

**Demolition Works  
Central Police Station Compound at No. 10, Hollywood Road  
Method Statement for Vibration Monitoring**

---

## Appendix 3

Calibration Certificate of Blastmate III



# Calibration Certificate

Certificate No. **15143**

Page 1 of 3 Pages

**Customer :** YSK2 Engineering Co. Ltd.

**Address :** 15/F., Kai Yue Comm. Building 2C Argyle Street, Kowloon.

**Order No. :** Q12110

**Date of receipt :** 29-Aug-11

## Item Tested

**Description :** Vibration Monitor

**Manufacturer :** Instatel

**Model :** Blastmate III

**Serial No. :** BA100992

## Test Conditions

**Date of Test :** 2-Sep-11

**Supply Voltage :** --

**Ambient Temperature :** (23 ± 3)°C

**Relative Humidity :** (50 ± 25) %

## Test Specifications

Calibration check.

Ref. Document/Procedure: M41.

## Test Results

All results were within the manufacturer's specification.

The results are shown in the attached page(s).

Main Test equipment used:

<u>Equipment No.</u>	<u>Description</u>	<u>Cert. No.</u>	<u>Traceable to</u>
S012	Function Generator	07280	SCL-HKSAR
S187A	Std. Vibration Meter	07446	NIM-PRC
S187B	Std. Accelerometer	07447	NIST-USA

The values given in this Calibration Certificate only relate to the values measured at the time of the test and any uncertainties quoted will not include allowance for the equipment long term drift, variations with environmental changes, vibration and shock during transportation, overloading, mis-handling, or the capability of any other laboratory to repeat the measurement. Hong Kong Calibration Ltd. shall not be liable for any loss or damage resulting from the use of the equipment.


The test equipment used for calibration are traceable to International System of Units (SI).

The test results apply to the above Unit-Under-Test only

**Calibrated by :**

  
Steve Kwan

**Approved by :**

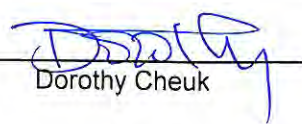  
Dorothy Cheuk

**Date:** 5-Sep-11

This Certificate is issued by:

Hong Kong Calibration Ltd

Unit 8B, 24/F, Well Fung Industrial Centre, No 58-76, Ta Chuen Ping Street, Kwai Chung, NT, Hong Kong

Tel: 2425 8801 Fax: 2425 8646

The copyright of this certificate is owned by Hong Kong Calibration Ltd. It may not be reproduced except in full.





# Calibration Certificate

Certificate No. 15143

Page 2 of 3 Pages

Results :

## 1. CH1 (Transversal)

### 1.1 Vibration Accuracy (15 Hz, Peak)

Applied Value (mm/s)	UUT Reading (mm/s)	Mfr's Spec.
5.00	5.10	± 5 % or 0.5 mm/s, whichever is greater, (4 ~ 125 Hz) (DIN 45669-1)
10.00	10.1	
15.00	15.1	
20.00	20.1	
25.00	25.0	

### 1.2 Frequency Response

Frequency (Hz)	UUT Reading (mm/s)	Variation (mm/s)	Mfr's Spec.
3	10.8	+0.8	± 5 % or ± 0.5 mm/s, whichever is greater. (4 ~ 125 Hz)
5	9.9	-0.1	
10 (Ref.)	10.0 (Ref.)	--	
20	9.8	-0.2	
50	9.3	-0.7	

## 2. CH2 (Vertical)

### 2.1 Vibration Accuracy (15 Hz, Peak)

Applied Value (mm/s)	UUT Reading (mm/s)	Mfr's Spec.
5.00	5.05	± 5 % or 0.5 mm/s, whichever is greater, between (4 ~ 125 Hz) (DIN 45669-1)
10.00	10.0	
15.00	15.1	
20.00	20.1	
25.00	25.1	

### 2.2 Frequency Response

Frequency (Hz)	UUT Reading (mm/s)	Variation (mm/s)	Mfr's Spec.
3	10.0	0.0	± 5 % or ± 0.5 mm/s, whichever is greater. (4 ~ 125 Hz)
5	9.7	-0.3	
10 (Ref.)	10.0 (Ref.)	--	
20	10.1	+0.1	
50	9.7	-0.3	



# Calibration Certificate

Certificate No. 15143

Page 3 of 3 Pages

## 3. CH3 (Longitudinal)

### 3.1 Vibration Accuracy (15 Hz, Peak)

Applied Value (mm/s)	UUT Reading (mm/s)	Mfr's Spec.
5.00	5.08	± 5 % or ± 0.5 mm/s, whichever is greater. (4 ~ 125 Hz) (DIN 45669-1)
10.00	10.1	
15.00	15.1	
20.00	20.1	
25.00	25.2	

### 3.2 Frequency Response

Frequency (Hz)	UUT Reading (mm/s)	Variation (mm/s)	Mfr's Spec.
3	10.9	+0.9	0 to -3 dB
5	10.0	0.0	± 5 % or ± 0.5 mm/s, whichever is greater. (4 ~ 125 Hz)
10 (Ref.)	10.0 (Ref.)	--	
20	10.0	0.0	
50	9.6	-0.4	

## 4. Calculated Parameters Accuracy Check

### 4.1 Acceleration (Peak) (15Hz)

$$\begin{aligned} \text{Applied Value} &= 1.962 \text{ m/s}^2 \\ &= 0.20 \text{ g} \\ \text{UUT Reading} &= 0.21 \text{ g} \end{aligned}$$

### 4.2 Displacement (Peak) (15Hz)

$$\begin{aligned} \text{Applied Value} &= 0.36 \text{ mm} \\ \text{UUT Reading} &= 0.36 \text{ mm} \end{aligned}$$

Remark : 1. UUT : Unit-Under-Test

2. Uncertainty : ± 2 %, for a confidence probability of not less than 95%.

3. UUT was equipped with Transducer S/N: BG 10183

4. The -3 dB Frequency Response covers the bandwidth of 2~250 Hz.

----- END -----