



CONTRACT NO: SD 6/2020

**CONSTRUCTION OF SAN SHEK WAN SEWAGE TREATMENT WORKS
ASSOCIATED SUBMARINE OUTFALL AND PUI O SEWERAGE WORKS**

UNDER ENVIRONMENTAL PERMIT NO. EP-538/2017

MONTHLY ENVIRONMENTAL MONITORING & AUDIT REPORT

**AUGUST 2022
REVISION 3**

CLIENTS:

Drainage Services Department

PREPARED BY:

Lam Environmental Services Limited

19/F, Remex Centre,
42 Wong Chuk Hang Road,
Hong Kong

Telephone: (852) 2882-3939
Facsimile: (852) 2882-3331
E-mail: info@lamenviro.com
Website: <http://www.lamenviro.com>

CERTIFIED BY:

Derek Lo
Environmental Team Leader

DATE:

14 September 2022



Member of the Surbana Jurong Group

local people
global experience

Our ref: 7076811/L29027/AW/KL/TK/rw

14 September 2022

Drainage Services Department
Sewage Services Branch
Special Duty Division Group 3
42/F Revenue Tower
5 Gloucester Road
Wan Chai, Hong Kong

By Email and Post
(kschan04@dsd.gov.hk)

Attention: Mr. Silas CHAN

Dear Sir

**Contract No. SD 7/2020
Independent Environmental Checker ("IEC") for Environmental Monitoring Work for
South Lantau Sewerage Works
Verification of Monthly EM&A Report (August 2022)**

With reference to the Monthly EM&A Report (August 2022) Revision 3 dated and certified by the ET Leader on 14 September 2022, please note that we have no adverse comments on the captioned and we hereby verify the captioned in accordance with Condition 3.4 of the Environmental Permit No. EP-538/2017.

Should you have questions please do not hesitate to contact the undersigned at tel. 3995-8140 or by email to kitty.lee@smec.com.

Yours faithfully

Kitty LEE
Independent Environmental Checker

cc	Binnies	-	Mr. Clarence CHAK	by email
	Lam	-	Mr. Derek LO / Mr Raymond DAI	by email
	KLCW-JV	-	Mr. Charles TSE	by email

SMEC ASIA LIMITED
27/F Ford Glory Plaza, 37-39 Wing Hong Street
Cheung Sha Wan, Kowloon, Hong Kong
T +852 3995 8100
F +852 3995 8101
E hongkong@smec.com
W www.smec.com



TABLE OF CONTENTS

1	Introduction	6
1.1	Scope of the Report.....	6
1.2	Structure of the Report.....	6
2	Basic project Information and Environmental Status	8
2.1	Basic Project Information.....	8
2.2	Construction Programme.....	8
2.3	Works undertaken during the month.....	9
2.4	Drawing showing the project area, environmental sensitive receivers and monitoring locations.....	9
3	Implementation Status	9
3.1	Advice on the implementation status of environmental protection and pollution control/mitigation measures	9
3.2	Environmental Mitigation Measures.....	9
3.3	Environmental monitoring requirements and contractual requirements	10
3.4	Site Inspection and Audit Reports	11
4	Monitoring Results	13
4.1	Noise Monitoring	13
4.2	Water Quality Monitoring	16
4.3	Ecology	22
4.4	Waste Management	23
5	Complaints, Notification of Summons and Prosecution.....	25
6	Future Key Issues	26
7	Conclusion	27
7.1	Noise Monitoring	27
7.2	Water Quality Monitoring	27
7.3	Ecological Impact Monitoring	27
7.4	Review of the Reasons for and the Implications of Non-compliance	28
7.5	Summary of action taken in the event of and follow-up on non-compliance	28

LIST OF TABLES

Table 3.1	Summary of submission status under EP-538/2017
Table 3.2	Summary of the current status on licences and/or permits on environmental protection pertinent to the Project
Table 3.3	Summary of Environmental Inspections
Table 4.1	Noise Monitoring Equipment
Table 4.2	Noise Monitoring Station
Table 4.3	Water Quality Monitoring Equipment
Table 4.4	Marine Water Quality Stations for Water Quality Monitoring
Table 4.5	Action and Limit Levels of Water Quality
Table 4.6	Summary of Marine Water Quality Exceedances (EM&A manual)
Table 4.7	Review of Exceedances in Turbidity and SS (proposed “and” approach)
Table 4.8	Summary of Quantities of Waste Material
Table 5.1	Cumulative Statistics on Complaints
Table 5.2	Cumulative Statistics on Successful Prosecutions
Table 6.1	Construction Activities and Recommended Mitigation Measures in Coming Reporting 3 Months

LIST OF FIGURES

- [Figure 2.1 Master Layout Plan](#)
- [Figure 2.2 Contract Layout Plan](#)
- [Figure 2.3 Locations of Noise Monitoring Station](#)
- [Figure 2.4 Locations of Water Quality Monitoring Stations](#)
- [Figure 2.5 Mark up Figure 5.4i extracted from approved EIA Report \(AEIAR-210/2017\)](#)
- [Figure 2.6 Location Plan for Temporary Holding Nursery](#)

LIST OF APPENDICES

- [Appendix 4.1 Copies of Calibration Certificates](#)
- [Appendix 4.2 Impact Monitoring Schedule for Reporting Month and Next Month](#)
- [Appendix 4.3 Noise Monitoring Results and Graphical Presentations](#)
- [Appendix 4.4 Marine Water Quality Monitoring Results and Graphical Presentations](#)
- [Appendix 4.5 Monthly Summary Waste Flow Table](#)
- [Appendix 6.1 3 Months Rolling Programme – September 2022 to November 2022](#)

EXECUTIVE SUMMARY

- i. This is the Monthly Environmental Monitoring and Audit (EM&A) Report – **August 2022** for the Outlying Islands Sewerage Stage 2 – South Lantau Sewerage Works under Environmental Permit No. EP-538/2017 (Hereafter as “the Project”). The construction works of the Project was commenced on **3 November 2021** and the tentative completion date is **Q1 2026**. This Monthly EM&A Report presents the environmental monitoring findings and information recorded during the period of **1 to 31 August 2022**. The cut-off date of reporting is at the end of each reporting month.
- ii. In the reporting period, the principal work activities undertaken are as follows:
 - **Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen**
 - **Excavation and site formation at San Shek Wan Sewage Treatment Works (SSWSTW) and Pui O Sewage Pumping Station (POSPS)**
 - **Excavation at South Lantau Road**
 - **SSWSTW and HDD works**
 - **Site formation works at POSPS**
 - **ELS works at POSPS**

Exceedances of Action/Limit LevelsNoise Monitoring

- iii. Noise monitoring was conducted at **seven (7)** noise monitoring stations (*N12a, N12b, N13, N14, N16a, N16b and N17*) once per week in the reporting period.
- iv. **No examination was taken place at N17 – Bui O Public School in the reporting period.**
- v. **No Action/Limit Level exceedances were recorded in this reporting period.**

Water Quality Monitoring

- vi. **Water quality monitoring had been commenced on 12 April 2022 the designated monitoring stations three days per week with respect to marine-based construction works commenced on 19 April 2022. HDD casing works commenced on 30 May 2022.**
- vii. **Water quality monitoring on 9 August 2022 and flood tide on 24 August 2022 was cancelled due to adverse weather.**
- viii. **Refer to the Section 3.4 of Environmental Permit, the monthly EM&A report will be submitted within 2 weeks after end of the reporting month, since liaison with HOKLAS Laboratory (ALS), the WQM result for Suspended Solids (SS) on 31 August 2022 could not be issued before the report due date, as such, the cut-off day for WQM for this report would be 30 August 2022. The WQM result for 31 August 2022 would be presented in next monthly EM&A report i.e. September 2022.**

- ix. In accordance with the EM&A Manual, 19 action level and 0 limit level exceedances on DO, 27 action level and 16 limit level exceedances on turbidity, 13 action level and 30 limit level exceedances on SS were recorded in the reporting month.
- x. Action Level exceedances were recorded on 11 August 2022 on DO, reviewed the overall work situation with no marine works and sea condition, it can be concluded that the DO exceedances were possibly due to Tropical Storm MULAN during 9 – 10 August 2022.
- xi. Overall exceedances on turbidity and SS (i.e. SR4, SR15 downstream to the construction site during mid-ebb, SR5, SR6, SR9, SR10 and SR12 exceedances downstream to the construction site during mid-flood,) in the reporting month were referred to the 20% / 30% of control station criteria only whereas there were no exceedance as referred to 95%-ile / 99%-ile criteria, indicating that the exceedance is due to the localized water quality better than baseline range were captured at the control station whereas the impact station are still within the baseline ranges.
- xii. Co-related the monitoring dates with those days with recorded marine works activities, no marine dredging works were active during the reporting month. Majority of recorded marine works activities were maintenance on working barge not in contact with water, except casing installation for marine HDD works between 2 - 6 and 15 -19 August 2022 within the replaced fully enclosed silt curtain. Reviewed the overall work situation with limited marine works, it can be concluded that all the turbidity and SS exceedances were possibly due to natural runoff from streams to the sea as a result of frequent rainfall as recorded in the reporting month (tropical cyclone warning signals recorded on 3 - 4, 9 - 10 and 23 – 25 August 2022. There was also typhoon no. 8 on 24 – 25 August 2022).
- xiii. Reviewing the “and” approach, no exceedance in turbidity and SS would be recorded on adopting the ‘and’ criteria in the Action and Limit Level as proposed in submitted Baseline Monitoring Report.

Ecological Impact Monitoring

- xiv. Transplanting of the trees of *Aquilaris sinensis* was completed on 26 April 2022. Maintenance works for trees in holding nursery have commenced.
- xv. As per latest version of PTP, four tree found (1 no. of *Aquilaria sinensis* and 3 nos. of *Gmelina chinensis*) within the site of SSWSTW which are considered to be the plant species with conservative importance for temporarily transplanted to the nursery at Kam Tin and eventually be transplanted to Pui O Pumping Station.
- xvi. The weekly site audit was carried out by ET include checking whether good site practices are being properly implemented by the Contractor.
- xvii. The extent of the work site boundaries was checked by the ET during the weekly site audit.

Complaint log

- xviii. No environmental complaint regarding the construction works was recorded in the reporting period.

Notifications of Any Summons and Successful Prosecutions

- xix. No environmental notification of any summons and successful prosecution regarding the construction works was recorded in the reporting period.

Reporting Changes

- xx. There are no particular reporting changes.

Future Key Issues

- xxi. In coming reporting 3 months, the scheduled construction activities are listed as follows:

- Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen
- Construction of trunk sewers and rising mains
- SSWSTW and HDD works
- Site formation works for POSPS
- Drilling works
- Excavation works
- ELS works
- Piling Works
- Superstructure RC Words

- xxii. Key construction activities for the next three months with the recommended mitigation measures to be implemented are presented as follows:

Key Construction Works	Recommended Mitigation Measures
<ul style="list-style-type: none"> • Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen • Construction of trunk sewers and rising mains • SSWSTW and HDD works • Site formation works for POSPS • Drilling works • Excavation works • ELS works • Piling Works • Superstructure RC Words 	<ul style="list-style-type: none"> • Implementation of noise pollution control in accordance with Construction Noise Mitigation Plan; • Dust control during dust generating works; • Adopt surface drainage and sediment control facilities for sewage installation in village and public roads; • Adopt temporary drainage and sediment control facilities on Site; • Vehicle wheel-washing and body washing facilities should be provided at the site entrance; • Regular water spraying on drilling and excavation works for dust control; and • Proper waste handling, recycling and storage.

Introduction

1.1 Scope of the Report

- 1.1.1. Lam Environmental Services Limited (LES) has been appointed to work as the Environmental Team (ET) under Environmental Permit (EP) No. EP-538/2017 to implement the Environmental Monitoring and Audit (EM&A) programme as stipulated in the EM&A Manual of the approved Environmental Impact Assessment (EIA) Report for the Outlying Islands Sewerage Stage 2 – South Lantau Sewerage Works (Register No.: AEIAR-210/2017).
- 1.1.2. In accordance with Clause 3.4 stated in EP-538/2017, 4 hard copies and 1 electronic copy of Monthly EM&A Report shall be submitted to the Director within 2 weeks after the end of each reporting month.
- 1.1.3. According to Section 12.2 of the Project EM&A Manual, the Monthly EM&A Report should be submitted within 10 working days of the end of each reporting month, with the first report due in the month after construction commences.

1.2 Structure of the Report

Section 1 *Introduction* – details the scope and structure of the report.

Section 2 *Basic project Information and Environmental Status* – summarizes project organization and key personnel contact, construction programme and works undertaken for the month. Construction programme, works undertaken during the month with illustrations, drawing showing the project area, environmental sensitive receivers and monitoring locations.

Section 3 *Implementation Status* – advice on the implementation status of environmental protection and pollution control/mitigation measures, as recommended in the EIA Report and summarised in the updated implementation schedule.

Section 4 *Monitoring Results* – summarizes the monitoring results obtained in the reporting period, including monitoring methodology, name of laboratory and equipment used and calibration details, parameters monitored, monitoring locations (and depth), monitoring date, frequency, and duration.

Section 5 *Report on Complaints, Notification of Summons and Successful Prosecutions* – summarizes:

Record of all complaints received (written or verbal) for each media, including locations and nature of complaints investigation, liaison and consultation undertaken, actions and follow-up procedures taken, results and summary;
Record of notifications of summons and successful prosecutions for breaches of the current environmental protection/pollution control legislations, including locations and nature of the breaches, investigation, follow-up actions taken,

results and summary;

Review of the reasons for and the implications of non-compliance, complaints, summons and prosecutions including review of pollution sources and working procedures; and

Description of the actions taken in the event of non-compliance and deficiency reporting and any follow-up procedures related to non-compliance.

Section 6 ***Future Key Issues*** – An account of the future key issues as reviewed from the works programme and work method statements.

Section 7 ***Conclusion***

2 Basic project Information and Environmental Status

2.1 Basic Project Information

2.1.1. Drainage Services Department is the overall project controllers for the Project. For the construction phase of the Project, Contractor(s), Environmental Team and Independent Environmental Checker are appointed to manage and control environmental issues. Key personnel and contact particulars are summarized in **Table 2.1**:

Table 2.1 Contact Details of Key Personnel

Party	Role	Post	Name	Contact No.	Contact Fax
Drainage Services Department (DSD)	The Engineer for the Contract	Engineer	Mr. Silas Chan	2594 7272	3104 6426
Binnies Hong Kong Limited	Engineer's Representative	Resident Engineer	Mr. Clarence Chak	6428 5532	-
Kwan Lee – Chun Wo Joint Venture	Contractor	Site Agent	Mr. Charles Tse	9270 3384	2744 6937
		Environmental Officer	Ms. Shirley Kong	5162 5933	
SMEC Hong Kong	Independent Environmental Checker (IEC)	Independent Environmental Checker (IEC)	Ms. Kitty Lee	3995 8140	3995 8101
Lam Environmental Services Limited	Environmental Team (ET)	Environmental Team Leader (ETL)	Mr. Derek Lo	2882 3939	2882 3331

2.2 Construction Programme

2.2.1. The proposed sewerage works will collect the sewage generated from the unsewered areas of Shui Hau, Tong Fuk, Cheung Sha, San Shek Wan, Pui O and Ham Tin in South Lantau (i.e. within the Project Catchment Area) and convey it to a proposed sewage treatment works at San Shek Wan for treatment and disposal into outer bay of Pui O/ Chi Ma Wan via a submarine outfall.

2.2.2. The entire Project are divided into three contracts. Contract No. DC/2020/20 (the Contract) would have the following implementations as demonstrated in [Figure 2.1](#).

2.2.3. The major components of the Contract under Environmental Permit (EP) (EP No. EP-538/2017) comprises: (i) construction of sewage treatment works at San Shek Wan (SSWSTW) and associated submarine outfall; (ii) construction of sewage pumping station at Pui O (POSPS); (iii) village sewage works at Pui O; and (iv) trunk sewers and rising mains on carriageways.

2.2.4. The performance of the environmental management system of the reporting period was generally satisfied. Mitigation measures according to the environmental mitigation implementation schedule and the EIA were generally implemented by the Contractor. Hence, the EM&A programme was considered effective and shall be maintained.

2.3 Works undertaken during the month

2.3.1. In the reporting month, the principal work activities conducted are as follow:

- Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen
- Excavation and site formation at SSWSTW and POSPS
- Excavation at South Lantau Road
- SSWSTW and HDD works
- Site formation works at POSPS
- ELS works at POSPS

The locations of works are shown in [Figure 2.2](#).

2.4 Drawing showing the project area, environmental sensitive receivers and monitoring locations

2.4.1. Noise and water monitoring location plans with sensitive receivers are shown in [Figure 2.3](#) and [Figure 2.4](#).

3 Implementation Status

3.1 Advice on the implementation status of environmental protection and pollution control/mitigation measures

3.1.1. Mitigation measures according to the environmental mitigation implementation schedule in Annex A of EM&A Manual were generally implemented by the Contractor. Hence, the EM&A programme was considered effective and shall be maintained.

3.2 Environmental Mitigation Measures

3.2.1. Environmental mitigation measures mentioned the EIA Report were weekly reviewed and recorded in Weekly Environmental Site Audit Checklist. Also, a summary of the current status on submissions and measures mentioned in Environmental Permit (EP-538/2017) are shown in **Table 3.1**.

Table 3.1 Summary of submission status under EP-538/2017

EP Condition	Submission	Date of Latest Submission to EPD^ / EPD Approval#
Condition 2.10	Waste Management Plan (Rev. 5) (electronic copy)	4 April 2022#
Condition 2.11	Submission of Preservation and/or Transplantation Plan for Plant Species of Conservation Importance (Rev. 23)	31 August 2022^
Condition 2.12	Submission of Compensatory Woodland Planting Plan (Rev. 12)	8 August 2022^
Condition 2.13	Silt Curtain Deployment Plan (Rev. 14)	5 August 2022^
Condition 2.14	Landscape Mitigation Plan	To be confirmed
Condition 2.15	Construction Noise Mitigation Plan (Rev. 20)	4 August 2022#

3.3 Environmental monitoring requirements and contractual requirements

3.3.1. A summary of the current status on licences and/or permits on environmental protection pertinent to the Project is shown in **Table 3.2**.

Table 3.2 Summary of the current status on licences and/or permits on environmental protection pertinent to the Project

Permits and/or Licences	Permit. No. / Account No.	Issued Date	Valid Period & Expiry Date	Status
Notification of Works Under APCO	466408	14 Apr 2021	N/A	Valid
Discharge Licence	POPS: WT00039820-2021	31 Dec 2021	31-12-2021 to 31-12-2026	Valid
	SSWSTW: WT00039636-2021	30 Dec 2021	30-12-2021 to 31-12-2026	
Billing account under Waste Disposal Ordinance	Account No.: 7040411	05 May 2021	N/A	Valid
Registration as a Chemical Waste Producer	0000-931-K3428-01	13 May 2021	N/A	Valid
Construction Noise Permit	GW-RS0428-22	26 May 2022	29-05-2022 to 28-11-2022	Cancelled
	GW-RS0642-22	3 Aug 2022	05-08-2022 to 02-02-2023	Valid

Note: Only include those valid or under application; fill in "N/A" for non-applicable item(s).

3.4 Site Inspection and Audit Reports

- 3.4.1. Within this reporting month, weekly environmental site inspections were conducted on 02, 09, 15, 23 and 30 August 2022. IEC attended the SSEMC meeting held on 15 August 2022. Holding nursery visit for transplanted trees on 15 August 2022.
- 3.4.2. No non-compliance was found during the site inspection while reminders on environmental measures were recommended. Results and findings of these inspections in this reporting month are listed below in **Table 3.3**.

Table 3.3 Summary of Environmental Inspections

Inspection Date	Reminder and Recommendations	Close-out Date / Status
2 August 2022	1. No particular finding	N/A
9 August 2022	1. No particular finding	N/A
15 August 2022	<p><u>Pui O Sewage Pumping Station</u></p> <ol style="list-style-type: none"> 1. Damaged cover should be replaced to prevent the soil and sand dispersion 2. Contractor is reminded to segregating and sorting different types of waste into different recycle bins 3. Contractor is requested to clear the stagnant water in the drip tray regularly 4. Electric cable should be removed from the tree. 5. <u>Transplant trees in holding nursery</u> <p>The Contractor was reminded to remove other herbaceous plant species from the plant species of conservation importance, <i>Gmelina chinensis</i> (T742)</p>	22 August 2022
23 August 2022	<p><u>San Shek Wan Sewage Treatment Works</u></p> <ol style="list-style-type: none"> 1. Open pipe ends shall be placed inside collection pit to avoid accidental spill of untreated water on slope 	27 August 2022
30 August 2022	<p><u>Pui O Sewage Pumping Station</u></p> <ol style="list-style-type: none"> 1. The exposed roots of retained tree within the construction site should be protected properly <p><u>Village sewers works (Lo Uk Tsuen)</u></p> <ol style="list-style-type: none"> 2. The generator shall be sited as far away from Noise Sensitive Receivers(NSRs) as possible or provided moveable noise barrier to reduce noise nuisance to NSRs <p><u>San Shek Wan Sewage Treatment Works</u></p> <ol style="list-style-type: none"> 3. Oil stain was observed, contractor was requested to remove the contaminated soil as chemical waste properly 	1 September 2022

4 Monitoring Results

4.1 Noise Monitoring

MONITORING METHODOLOGY

4.1.1 Monitoring Procedure

- (a) The impact noise monitoring should be carried out at all the designated monitoring stations when there are project-related construction activities undertaken within a radius of 300m from the monitoring stations.
- (b) The monitoring station shall normally be at a point 1m from the exterior of the sensitive receiver's building façade and be at a position 1.2m above the ground.
- (c) Façade measurements were made at the monitoring locations. For free-field measurement, a correction factor of +3 dB (A) would be applied.
- (d) The battery condition was checked to ensure the correct functioning of the meter.
- (e) Parameters such as frequency weighting, the time weighting and the measurement time were set as follows:
- (f) Frequency weighting: A, Time weighting: Fast, Measurement time set: continuous 5 mins
- (g) Prior and after to the noise measurement, the meter was checked using the acoustic calibrator for 94dB (A) at 1000 Hz. If the difference in the calibration level before and after measurement was more than ± 1.0 dB (A), the measurement would be considered invalid and repeat of noise measurement would be required after re-calibration or repair of the equipment.
- (h) Noise measurements will be made in accordance with standard acoustical principles and shall not be made in fog, rain, wind with a steady speed exceeding 5m/s or wind with gusts exceeding 10m/s. The wind speed shall be checked with a portable wind speed meter capable of measuring the wind speed in m/s.

NAME OF LABORATORY AND EQUIPMENT USED AND CALIBRATION DETAILS

4.1.2 Noise monitoring was performed using sound level meter at the designated monitoring locations. The sound level meters shall comply with the International Electrotechnical Commission Publications 651:1979 (Type 1) and 804:1985 (Type 1) specifications. Acoustic calibrator shall be deployed to check the sound level meters at a known sound pressure level. Brand and model of the equipment is given in **Table 4.1**.

Table 4.1 Noise Monitoring Equipment

Equipment	Brand and Model	Series Number
Integrated Sound Level Meter	Larson Davis LxT1	0006346
Acoustic Calibrator	Honglim HLES-02	2016611465

4.1.3 The calibration certificates of the noise monitoring equipment are attached in [Appendix 4.1](#).

4.1.4 Calibration Details

- (a) The microphone head of the sound level meter was cleaned with soft cloth at regular intervals.
- (b) The sound level meter and calibrator were calibrated at yearly intervals.

PARAMETERS MONITORED

4.1.5 The construction noise level shall be measured in terms of the A-weighted equivalent continuous sound pressure level (L_{eq}). $L_{eq(30min)}$ should be used as the monitoring parameter. Supplementary information for data auditing, statistical results such as L10 and L90 shall also be obtained for reference.

4.1.6 For impact monitoring for construction of village sewers / rising main, noise monitoring should be undertaken on weekly basis. One set of $L_{eq(30min)}$ noise level as six consecutive $L_{eq(5min)}$ between 07:00-19:00 hours on normal weekdays.

MONITORING STATIONS

4.1.7 The noise monitoring stations for the Project are listed and shown in **Table 4.2**, impact noise monitoring was conducted at **Seven (7)** noise monitoring stations N12a, N12b, N13, N14, N16a, N16b and N17 once per week in the reporting month.

Table 4.2 Noise Monitoring Station

Monitoring Station ID ⁽¹⁾	Monitoring Location	Measurement Type	Level (in terms of no. of floor)
N01a	Shui Hau Village	Free-Field	G/F
N01c	Shui Hau Village	Free-Field	G/F
N03a	Tong Fuk Village	Free-Field	G/F
N05a	Residences at Cheung Fu Street	Free-Field	G/F
N07	Government Holiday Bungalows	Free-Field	G/F
N08	Cheung Sha Ha Tsuen	Free-Field	G/F
N10	Cheung Sha Sheung Tsuen	Façade	G/F
N11b	San Shek Wan – Ming Garden	Free-Field	G/F
N12a	Lo Uk Tsuen	Free-Field	G/F
N12b	Lo Uk Tsuen	Façade	G/F
N13	Pui O San Wai Tsuen	Façade	G/F
N14	South Lantau Community Centre	Free-Field	G/F
N15b	Pui O Lo Wai Tsuen	Façade	G/F
N16a	Residences at Ham Tin	Free-Field	G/F

Monitoring Station ID ⁽¹⁾	Monitoring Location	Measurement Type	Level (in terms of no. of floor)
N16b	Residences at Ham Tin	Free-Field	G/F
N17	Bui O Public School	Façade	R/F

Remarks (1): Fine adjustment of noise monitoring stations at all locations was proposed as per EP Condition 3.1.

MONITORING DATE, TIME, FREQUENCY AND DURATION

- 4.1.8 For daytime construction work on normal weekdays, monitoring of $L_{eq(30min)}$ should be carried out at each station at 0700-1900 hours on normal weekdays at a frequency of once a week. Impact monitoring schedule can be referred to [Appendix 4.2](#).

NOISE MONITORING RESULTS

- 4.1.9 Noise monitoring results measured in this reporting period are reviewed and summarized. Details of noise monitoring results and graphical presentation can be referred in [Appendix 4.3](#).
- 4.1.10 **No examination was taken place at N17 – Bui O Public School in the reporting period.**
- 4.1.11 No action or limit level exceedance was recorded in construction noise level in this reporting period.

4.2 Water Quality Monitoring

MONITORING METHODOLOGY

4.2.1 Monitoring Procedure

- (a) The condition near the monitoring stations shall be observed and recorded on the data log sheet.
- (b) Check of sensors and electrodes with certified standard solutions before each use.
- (c) Wet bulb calibration for a DO meter should be carried out before measurement.
- (d) Water depth should be recorded by detector before sampling.
- (e) Sample would be taken using bucket sampler at surface level.
- (f) Transfer the sampled water carefully into cleaned water bottles (2x 1000ml) provided by the laboratory at the spot after the collection of the water sample for the subsequent laboratory Suspended Solid testing.
- (g) Transfer the sampled water from the bucket sampler to the rinsed water container for in-situ measurement (In case of the in-situ measurement cannot be carried at spot due to safety and adverse weather condition, sampled water from the bucket sampler will be transfer to cleaned water bottles provided by laboratory. Then, In-situ measurement will be conducted at a safe location which sampled water inside cleaned water bottle will be transfer to the rinsed water container for in-situ measurement) In-situ measurement shall be measured in duplicate.
- (h) Parameters including Water Temperature (°C), pH (units), Salinity (ppt), DO (mg/L), DO saturation (%) will be measured by the Multifunctional Meter and Turbidity (NTU) will be measured by turbid meter. (Water Temperature and Salinity will be measured as reference parameters)
- (i) Record the result on the data log sheet and record any special finding during / after in-situ measurement.
- (j) The water sample bottles will be stored in a cool box (at cooled to 4°C without being frozen), which shall be delivered to HOKLAS laboratory (ALS Technichem (HK) Pty Ltd) for further testing to determine the level of SS.

NAME OF LABORATORY AND EQUIPMENT USED AND CALIBRATION DETAILS

LABORATORY MEASUREMENT / ANALYSIS

- 4.2.2 Analysis of suspended solids will be carried out in a HOKLAS accredited laboratory, which is ALS Technichem (HK) Pty Ltd.

EQUIPMENT USED

Dissolved Oxygen, pH And Temperature Measuring Equipment

- 4.2.3 Multifunctional Meter and Turbid Meter are used at each designated monitoring station. They are capable of measuring:

- (a) a dissolved oxygen level in the range of 0-20mg/L and 0-200% saturation (Detection

Limit: 0.1mg/L)

- (b) a temperature of 0-45 degree Celsius (Detection Limit: 0.1 degree Celsius)
- (c) turbidity level between 0-1000NTU (Detection Limit: 0.1NTU)
- (d) salinity in the range of 0-40ppt (Detection Limit: 0.1ppt)
- (e) pH value in range of 0.0 – 14.0 (Detection Limit: 0.1units)

Other monitoring equipment namely water depth meter, water current meter, dGPS positioning device, water sampler listed below were also deployed,

- (a) Water depth meter (Range: 0.6 -100m, Resolution: 0.1m)
- (b) Water current meter (Range: 0-360°, Detection Limit: 1mm/s)
- (c) dGPS positioning device (Resolution: Horizontal: 0.25m; Vertical: 0.50 m)
- (d) Water sampler (Horizontal discrete type, Capacity: 2.2L)

Sampler Container and Storage

- 4.2.4 A water sampler, Water samples for suspended solids measurement should be collected in high-density polythene bottles, packed in ice (cooled to 4°C without being frozen), and delivered to ALS Technichem (HK) Pty Ltd. as soon as possible after collection for analysis.

Water Depth Detector

- 4.2.5 A portable, battery-operated echo sounder shall be used for the determination of water depth at each designated monitoring station. This unit can either be handheld or affixed to the bottom of the workboat, if the same vessel is to be used throughout the monitoring programme.

CALIBRATION DETAILS

- 4.2.6 Maintenance and Calibration

- (a) The responses of sensors and electrodes of the water quality monitoring equipment were cleaned and checked at regular intervals.
- (b) DO meter (Multifunctional Meter) and turbid meter was certified by a laboratory accredited under HOKLAS or any other international accreditation scheme, and subsequently re-calibrated at three monthly intervals.

- 4.2.7 Brand and model of the equipment are given in **Table 4.3**.

Table 4.3 Water Quality Monitoring Equipment

Equipment	Brand and model	Series Number
Multifunctional Meter	Sonde YSI Professional Plus	19H100656/14E101065
Turbid meter	Xin Rui WGZ-3B	1807073

Calibration certificates of the water quality monitoring equipment are attached in [Appendix 4.1](#).

PARAMETERS MONITORED

4.2.8 In construction phase, the levels of dissolved oxygen (DO), temperature, turbidity and salinity should be measured in situ while suspended solids (SS) is determined by laboratory analysis.

MONITORING STATIONS

4.2.9 Water quality monitoring involves 9 monitoring stations. The locations of water quality monitoring station are shown in **Table 4.4**.

Table 4.4 Marine Water Quality Stations for Water Quality Monitoring

Station	Description	Easting	Northing
CE	Upstream control station at ebb tide	810838	807538
CF	Upstream control station at flood tide	815886	808081
SR4 ⁽¹⁾	Ecological Sensitive Receiver (Coral Communities) at Pui O Wan	814938	810975
SR5	Ecological Sensitive Receiver (Coral Communities) at Pui O Wan	814326	810540
SR6	Gazetted Bathing Beach at Lower Cheung Sha	810553	810475
SR9 ⁽¹⁾	Ecological Important Stream at Tong Fuk	811325	809787
SR10	Secondary Contact Recreational Zones at South Lantau	810561	809494
SR12 ⁽¹⁾	Proposed Special Site of Scientific Interest (SSSI) at Shui Hau Wan	810359	808989
SR15	Gazetted Bathing Beach at Pui O and Ecologically Important Stream at Pui O	816037	810722

Remarks (1): Fine adjustment of water quality monitoring stations at SR4, SR9 and SR12 was proposed as per EP Condition 3.1, and baseline monitoring was conducted at corresponding fine adjusted locations.

MONITORING DATE, TIME, FREQUENCY AND DURATION

4.2.10 Water quality monitoring had been commenced on 12 April 2022 the designated monitoring stations three days per week with respect to marine-based construction works commenced on 19 April 2022. HDD casing works commenced on 30 May 2022.

4.2.11 Water quality monitoring on 9 August 2022 and flood tide on 24 August 2022 was cancelled due to adverse weather. No substitution would be arranged for such cancellation since it is impossible to maintain the monitoring frequency as three times a week for the event of marine water quality monitoring cancellation in between time with respect to the fact that not less than 36 hours interval shall be followed for two monitoring days as required by the EM&A Manual Clause 5.1.6 (b) for the project.

4.2.12 Refer to the Section 3.4 of Environmental Permit, the monthly EM&A report will be submitted within 2 weeks after end of the reporting month, since liaison with HOKLAS Laboratory (ALS), the WQM result for Suspended Solids (SS) on 31 August 2022 could not be issued before the

report due date, as such, the cut-off day for WQM for this report would be 30 August 2022. The WQM result for 31 August 2022 would be presented in next monthly EM&A report i.e. September 2022.

- 4.2.13 The levels of dissolved oxygen (DO), temperature, turbidity and salinity were measured in situ while suspended solids (SS) is determined by laboratory analysis at all the monitoring stations in **Table 4.4** three times a week. Impact monitoring schedule can be referred to [Appendix 4.2](#).
- 4.2.14 In association with the water quality parameters, other relevant data shall also be recorded, such as monitoring location / position, time, water temperature, DO saturation, weather conditions, and any special phenomena underway near the monitoring station.
- 4.2.15 Impact Monitoring shall be carried out three days per week, at mid-flood and mid-ebb tides (within ± 1.75 hour of the predicted time). The interval between two sets of monitoring shall not be less than 36 hours. The monitoring period should avoid concurrent marine project in the vicinity.
- 4.2.16 The sampling frequency of at least three days per week should be undertaken. Upon completion of the construction works, the monitoring exercise at the designated monitoring locations should be continued for four weeks in the same manner as the impact monitoring. In case exceedance of Action/Limit Level is recorded, the frequency shall be increased as per the Event and Action Plan.
- 4.2.17 To ensure the robustness of in-situ measurement, parameters shall be measured in duplicate. In case the difference between duplicates is larger than 25%, a third set of measurement shall be carried out.

MONITORING RESULTS

- 4.2.18 Marine water quality monitoring results measured in this reporting period are reviewed and summarized. Details of marine water quality monitoring results and graphical presentation can be referred in [Appendix 4.4](#)
- 4.2.19 Water quality monitoring is evaluated against Action and Limit Levels. Note that derived Action and Limit Level was proposed in Baseline Monitoring Report for approval. Action and Limit Levels of marine water quality monitoring have been set with reference to the EM&A Manual criteria and derived criteria as shown in **Table 4.5** below.

Table 4.5 Action and Limit Levels of Water Quality

Parameters	Action Level	Limit Level
<i>Construction Phase Marine Water Monitoring - EM&A Manual criteria</i>		
DO in mg/L	Surface and Middle: 5.8 mg/L Bottom: 5.9 mg/L	Surface and Middle: 4 mg/L Bottom: 2 mg/L
Turbidity in NTU (Depth-averaged ^A) ^c	14.4 NTU, or 20% exceedance of value at any impact station compared with corresponding data from control station	23.5 NTU, or 30% exceedance of value at any impact station compared with corresponding data from control station

Parameters	Action Level	Limit Level
SS in mg/L (Depth-averaged ^A) ^C	13.1 mg/L, or 20% exceedance of value at any impact station compared with corresponding data from control station	30.4 mg/L, or 30% exceedance of value at any impact station compared with corresponding data from control station
<i>Construction Phase Marine Water Monitoring - derived criteria</i>		
DO in mg/L ^B	Surface and Middle: 5.8 mg/L Bottom: 5.9 mg/L	Surface and Middle: 4 mg/L Bottom: 2 mg/L
Turbidity in NTU (Depth-averaged A) ^C	14.4 NTU and 20% exceedance of value at any impact station compared with corresponding data from control station ^D	23.5 NTU and 30% exceedance of value at any impact station compared with corresponding data from control station ^D
SS in mg/L (Depth-averaged ^A) ^C	13.1 mg/L and 20% exceedance of value at any impact station compared with corresponding data from control station ^D	30.4 mg/L and 30% exceedance of value at any impact station compared with corresponding data from control station ^D

Notes (with proposed amendments in AL/LL in underlined text):

- A. "Depth-averaged" is calculated by taking the arithmetic means of reading of all three depths.
- B. For DO, non-compliance of the water quality limits occurs when monitoring result is lower than the limits.
- C. For SS and turbidity, non-compliance of the water quality limits occurs when monitoring result is higher than the limits.
- D. Action Level and Limit Level with 95%-ile / 99%-ile derived from baseline data "and" 20% / 30% exceedance of control station proposed in Baseline Monitoring Report.

4.2.20 Number of exceedances recorded - during the reporting month are summarized in **Table 4.6**.

Table 4.6 Summary of Marine Water Quality Exceedances (EM&A manual)

Station	Parameter	DO (S&M)		DO (Bottom)		Turbidity		SS		Exceedance count	
		Mid Ebb	Mid Flood	Mid Ebb	Mid Flood	Mid Ebb	Mid Flood	Mid Ebb	Mid Flood	Mid Ebb	Mid Flood
SR4	Action	11/8/2022	11/8/2022	11/8/2022	/	4/8/2022 11/8/2022 26/8/2022	2/8/2022	13/8/2022 26/8/2022	/	7	2
	Limit	/	/	/	/	24/8/2022	13/8/2022 19/8/2022	2/8/2022 4/8/2022 17/8/2022 19/8/2022 24/8/2022	22/8/2022	6	3
SR5	Action	11/8/2022	11/8/2022	11/8/2022	11/8/2022	11/8/2022 26/8/2022 29/8/2022	11/8/2022	4/8/2022 26/8/2022	/	7	3
	Limit	/	/	/	/	13/8/2022 22/8/2022	13/8/2022 17/8/2022	13/8/2022 17/8/2022 19/8/2022 22/8/2022	/	6	2
SR6	Action	11/8/2022	11/8/2022	/	/	11/8/2022 13/8/2022 26/8/2022	11/8/2022	26/8/2022	/	5	2
	Limit	/	/	/	/	22/8/2022	/	2/8/2022 22/8/2022 29/8/2022	26/8/2022	4	1
SR9	Action	11/8/2022	11/8/2022	11/8/2022	11/8/2022	11/8/2022 22/8/2022 26/8/2022	17/8/2022 26/8/2022	22/8/2022 26/8/2022	2/8/2022	7	5
	Limit	/	/	/	/	/	/	2/8/2022 24/8/2022	26/8/2022	2	1
SR10	Action	11/8/2022	11/8/2022	/	/	2/8/2022 11/8/2022 17/8/2022 26/8/2022	/	2/8/2022	/	6	1
	Limit	/	/	/	/	24/8/2022	6/8/2022 17/8/2022	4/8/2022 24/8/2022	2/8/2022 26/8/2022	3	4
SR12	Action	11/8/2022	11/8/2022	/	/	11/8/2022 26/8/2022	11/8/2022	2/8/2022	4/8/2022	4	4
	Limit	/	/	/	/	13/8/2022	17/8/2022	4/8/2022	22/8/2022 26/8/2022	2	3
SR15	Action	11/8/2022	11/8/2022	/	/	11/8/2022 26/8/2022	17/8/2022	/	26/8/2022	3	3

Station	Parameter	DO (S&M)		DO (Bottom)		Turbidity		SS		Exceedance count	
		Mid Ebb	Mid Flood	Mid Ebb	Mid Flood	Mid Ebb	Mid Flood	Mid Ebb	Mid Flood	Mid Ebb	Mid Flood
	Level exceeded	/	/	/	/	4/8/2022 13/8/2022	13/8/2022	2/8/2022 4/8/2022 24/8/2022	15/8/2022 22/8/2022 29/8/2022	5	4
	Limit	/	/	/	/						
Total	Action	7	7	3	2	20	7	9	4	59	
	Limit	0	0	0	0	8	8	20	10	46	

- 4.2.21 In accordance with the EM&A Manual, 19 action level and 0 limit level exceedances on DO, 27 action level and 16 limit level exceedances on turbidity, 13 action level and 30 limit level exceedances on SS were recorded in the reporting month.
- 4.2.22 SR4 and SR15 located at upstream of construction site during mid-flood such that the Action and Limit Level exceedances on turbidity and SS along these stations in general were contributed by upstream sources before entering the submarine outfall construction location. Similarly, SR5, SR6, SR9, SR10 and SR12 located at upstream of construction site during mid-ebb, such that the Action and Limit Level exceedances on turbidity and SS along these stations in general were contributed by upstream sources before entering the submarine outfall construction location.
- 4.2.23 Checked with contractor and RSS on the marine works activities in the reporting month on the scheduled WQM dates, the following activities were recorded:
- 11, 13, 22 - 31/8/2022 - No activity
 - 2 - 6, 15 - 19/8/2022 - Appliance maintenance on working barge and casing installation for marine HDD works
- 4.2.24 Action Level exceedances were recorded on 11 August 2022 on DO, reviewed the overall work situation with no marine works and sea condition, it can be concluded that the DO exceedances were possibly due to Tropical Storm MULAN during 9 – 10 August 2022.
- 4.2.25 Overall exceedances on turbidity and SS (i.e. SR4, SR15 downstream to the construction site during mid-ebb, SR5, SR6, SR9, SR10 and SR12 exceedances downstream to the construction site during mid-flood,) in the reporting month were referred to the 20% / 30% of control station criteria only whereas there were no exceedance as referred to 95%-ile / 99%-ile criteria, indicating that the exceedance is due to the localized water quality better than baseline range were captured at the control station whereas the impact station are still within the baseline ranges.
- 4.2.26 Co-related the monitoring dates with those days with recorded marine works activities, no marine dredging works were active during the reporting month. Majority of recorded marine works activities were maintenance on working barge not in contact with water, except casing installation for marine HDD works between 2 – 6 and 15-19 August 2022 within the replaced fully enclosed silt curtain. Reviewed the overall work situation with limited marine works, it can be concluded that all the turbidity and SS exceedances were possibly due to natural runoff

from streams to the sea as a result of frequent rainfall as recorded in the reporting month (tropical cyclone warning signals recorded on 3 - 4, 9 - 10 and 23 – 25 August 2022. There was also typhoon no. 8 on 24 – 25 August 2022).

4.2.27 Reviewing the “and” approach, no exceedance in turbidity and SS would be recorded on adopting the ‘and’ criteria in the Action and Limit Level as proposed in submitted Baseline Monitoring Report as presented in **Table 4.7**. Majority of the exceedance were considered to be false alarm with review of the “and” approach for counteracting the over-sensitivity of control station criteria as proposed in the baseline report.

Table 4.7 Review of Exceedances in Turbidity and SS (proposed “and” approach)

Station	Parameter	Turbidity		SS		Exceedance count	
		Level exceeded	Mid Ebb	Mid Flood	Mid Ebb	Mid Flood	Mid Ebb
SR4	Action	-	-	-	-	0	0
	Limit	-	-	-	-	0	0
SR5	Action	-	-	-	-	0	0
	Limit	-	-	-	-	0	0
SR6	Action	-	-	-	-	0	0
	Limit	-	-	-	-	0	0
SR9	Action	-	-	-	-	0	0
	Limit	-	-	-	-	0	0
SR10	Action	-	-	-	-	0	0
	Limit	-	-	-	-	0	0
SR12	Action	-	-	-	-	0	0
	Limit	-	-	-	-	0	0
SR15	Action	-	-	-	-	0	0
	Limit	-	-	-	-	0	0
Total	Action	0	0	0	0	0	0
	Limit	0	0	0	0	0	0

4.3 Ecology

MONITORING METHODOLOGY

4.3.1 The weekly site audit to be carried out by the ET should include checking whether good site practices are being properly implemented by the Contractor.

4.3.2 Impact monitoring of the transplanted *Aquilaris sinensis* at holding nursery and one retain tree of *Aquilaris sinensis* in SSWSTW Project Site, establishment and after-establishment caring measures of the compensatory mixed woodland to ensure the affected tree would not be affected by any unacceptable construction works. The trees would be treated with establishment works immediately after transplanting.

PARAMETERS MONITORED

4.3.3 The extent of the work site boundaries should be checked by the ET during the weekly site audit. Any disturbance by the Contractor outside the works area especially any damage to the vegetation and surrounding habitats outside the Project area shall be reported to ER and IEC.

- 4.3.4 To identify any unacceptable construction works for the trees of *Aquilaris sinensis* during transplanting, establishment and after-establishment caring measures of the compensatory mixed woodland.

MONITORING LOCATION

- 4.3.5 As per latest version of PTP, four tree found (1 no. of *Aquilaria sinensis* and 3 nos. of *Gmelina chinensis*) within the site of SSWSTW ([Figure 2.5](#)) which are considered to be the plant species with conservative importance for temporarily transplanted to the nursery ([Figure 2.6](#)) at Kam Tin and eventually be transplanted to Pui O Pumping Station.

MONITORING DATE, TIME, FREQUENCY AND DURATION

- 4.3.6 The recommended good site practices to be audited once every week as part of the site audit programme. The weekly site audit to be carried out by the ET includes checking whether good site practices are being properly implemented by the Contractor. Results are recorded in Weekly Environmental Site Audit Checklist.
- 4.3.7 Monitoring programme for post-transplantation will be conducted once per month ([15 August 2022](#)).

MONITORING RESULTS

- 4.3.8 The weekly site audit was carried out by ET include checking whether good site practices are being properly implemented by the Contractor.
- 4.3.9 The extent of the work site boundaries was checked by the ET during the weekly site audit.
- 4.3.10 Results and findings of site audit in this reporting month are listed in **Table 3.3**.

4.4 Waste Management

- 4.4.1 The quantities of waste for disposal in the Reporting Period are summarized in **Table 4.8**. The Monthly Summary Waste Flow Table is shown in [Appendix 4.5](#).

Table 4.8 Summary of Quantities of Waste Material

Waste Type	Quantity this month	Quantity (the end of last month)	Cumulative Quantity-to-Date
Hard Rock and Large Broken Concrete (Inert) (in '000m ³)	0	0	0
Reused in this Contract (Inert)	0	0	0



Waste Type	Quantity this month	Quantity (the end of last month)	Cumulative Quantity-to-Date
(in '000m ³)			
Reused in other Projects (Inert) (in '000m ³)	0	0	0
Disposal as Public Fill (Inert) (in '000m ³)	0.09705	0.01537	6.70848
Metals (in '000kg)	0.00300	0	1.56800
Paper / Cardboard Packing (in '000kg)	0.04410	0	0.18158
Plastics (in '000kg)	0.00710	0	0.02116
Chemical Wastes (in '000kg)	0	0	0
General Refuses (in '000kg)	18.25460 [#]	17.34	363.0246

*: Further breakdown into sub-group if considered applicable;

[#]: 4.6 kg of glass were recycled, and courted in general refuse.

5 Complaints, Notification of Summons and Prosecution

- 5.1.1 No environmental complaint, notification of summons and successful prosecution regarding construction works was recorded in the reporting period.
- 5.1.2 No notification of summons and successful prosecution regarding construction works were recorded in the reporting period.
- 5.1.3 Cumulative statistic on complaints and successful prosecutions are summarized in **Table 5.1** and **Table 5.2** respectively.

Table 5.1 Cumulative Statistics on Complaints

Reporting Period	No. of Complaints
August 2022	0
Project commencement to the end of last reporting month	1
Total	1

Table 5.2 Cumulative Statistics on Successful Prosecutions

Environmental Parameters	Cumulative No. Brought Forward	No. of Successful Prosecutions this month (Offence Date)	Cumulative No. Project-to-Date
Air	-	0	0
Noise	-	0	0
Water	-	0	0
Waste	-	0	0
Other	-	0	0
Total	-	0	0

6 Future Key Issues

6.1.1 In coming reporting 3 months, the scheduled construction activities are listed as follows:

- Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen
- Construction of trunk sewers and rising mains
- SSWSTW and HDD works
- Site formation works for POSPS
- Drilling works
- Excavation works
- ELS works
- Piling Works
- Superstructure RC Works

6.1.2 The scheduled construction activities and the recommended mitigation measures for the coming 3 months are listed in **Table 6.1**. The major construction activities for the next 3 months are summarized in Three Months Rolling Programme - [September 2022 to November 2022](#) in [Appendix 6.1](#).

Table 6.1 Construction Activities and Recommended Mitigation Measures in Coming Reporting 3 Months

Key Construction Works	Recommended Mitigation Measures
<ul style="list-style-type: none"> • Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen • Construction of trunk sewers and rising mains • SSWSTW and HDD works • Site formation works for POSPS • Drilling works • Excavation works • ELS works • Piling Works • Superstructure RC Works 	<ul style="list-style-type: none"> • Implementation of noise pollution control in accordance with Construction Noise Mitigation Plan; • Dust control during dust generating works; • Adopt surface drainage and sediment control facilities for sewage installation in village and public roads; • Adopt temporary drainage and sediment control facilities on Site; • Vehicle wheel-washing and body washing facilities should be provided at the site entrance; • Regular water spraying on drilling and excavation works for dust control; and • Proper waste handling, recycling and storage.

7 Conclusion

7.1 Noise Monitoring

7.1.1 No examination was taken place at N17 – Bui O Public School in the reporting period.

7.1.2 No action or limit level exceedance was recorded in construction noise level in this reporting period.

7.2 Water Quality Monitoring

7.2.1 Marine-based construction works commenced on 19 April 2022, HDD casing works commenced on 30 May 2022.

7.2.2 Water quality monitoring on 9 August 2022 and flood tide on 24 August 2022 was cancelled due to adverse weather.

7.2.3 Refer to the Section 3.4 of Environmental Permit, the monthly EM&A report will be submitted within 2 weeks after end of the reporting month, since liaison with HOKLAS Laboratory (ALS), the WQM result for Suspended Solids (SS) on 31 August 2022 could not be issued before the report due date, as such, the cut-off day for WQM for this report would be 30 August 2022. The WQM result for 31 August 2022 would be presented in next monthly EM&A report i.e. September 2022.

7.2.4 In accordance with the EM&A Manual, 19 action level and 0 limit level exceedances on DO, 27 action level and 16 limit level exceedances on turbidity, 13 action level and 30 limit level exceedances on SS were recorded in the reporting month. No exceedance in turbidity and SS would be recorded on adopting the “and” criteria in the Action and Limit Level as proposed in the Baseline Monitoring Report.

7.3 Ecological Impact Monitoring

7.3.1 Transplanting of the trees of *Aquilaris sinensis* was completed on 26 April 2022. Maintenance works for trees in holding nursery have commenced.

7.3.2 As per latest version of PTP, four tree found (1 no. of *Aquilaria sinensis* and 3 nos. of *Gmelina chinensis*) within the site of SSWSTW which are considered to be the plant species with conservative importance for temporarily transplanted to the nursery at Kam Tin and eventually be transplanted to Pui O Pumping Station.

7.3.3 The weekly site audit was carried out by ET include checking whether good site practices are being properly implemented by the Contractor.

7.3.4 The extent of the work site boundaries was checked by the ET during the weekly site audit.

7.3.5 Within this reporting period, holding nursery visit for transplanted trees on 15 August 2022.

7.3.6 No non-compliance was found during the site inspection while reminders on environmental measures were recommended. Results and findings of these inspections in this reporting period are listed below in **Table 7.1**.

Table 7.1 Summary of Ecological Impact Monitoring

Inspection Date	Reminder and Recommendations	Close-out Date / Status
15 August 2022	1. The Contractor was reminded to remove other herbaceous plant species from the plant species of conservation importance, <i>Gmelina chinensis</i> (T742)	22 August 2022

7.4 Review of the Reasons for and the Implications of Non-compliance

7.4.1 No environmental non-compliance was recorded in the reporting month.



7.5 Summary of action taken in the event of and follow-up on non-compliance

7.5.1 There was no particular action taken since no non-compliance was recorded in the reporting period.



Figure 2.1

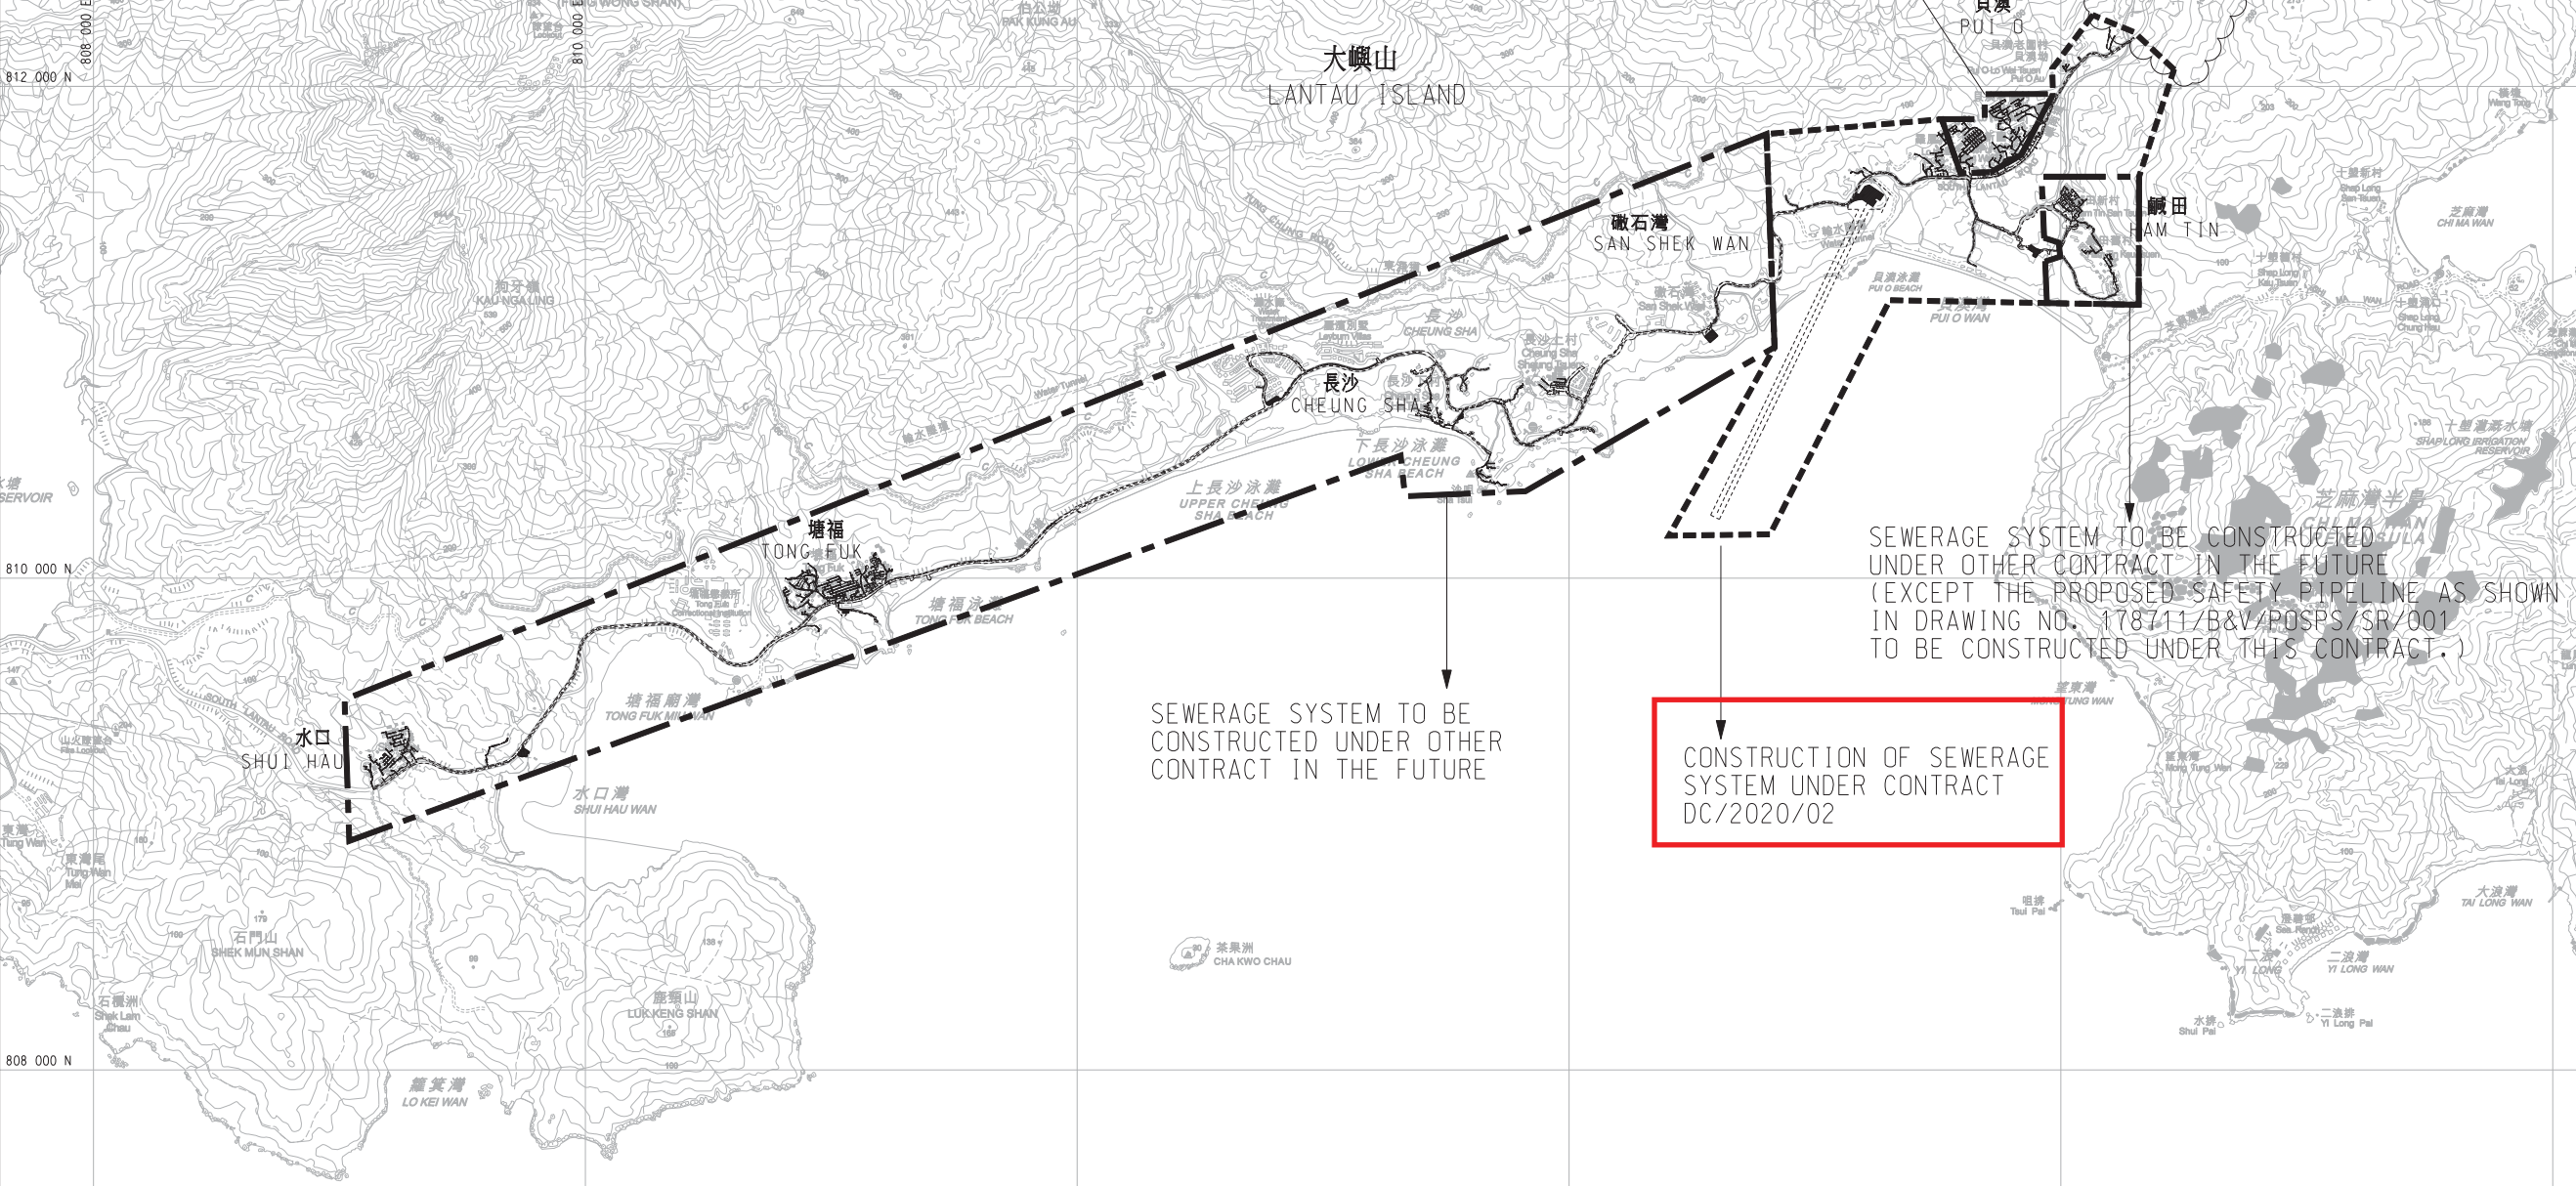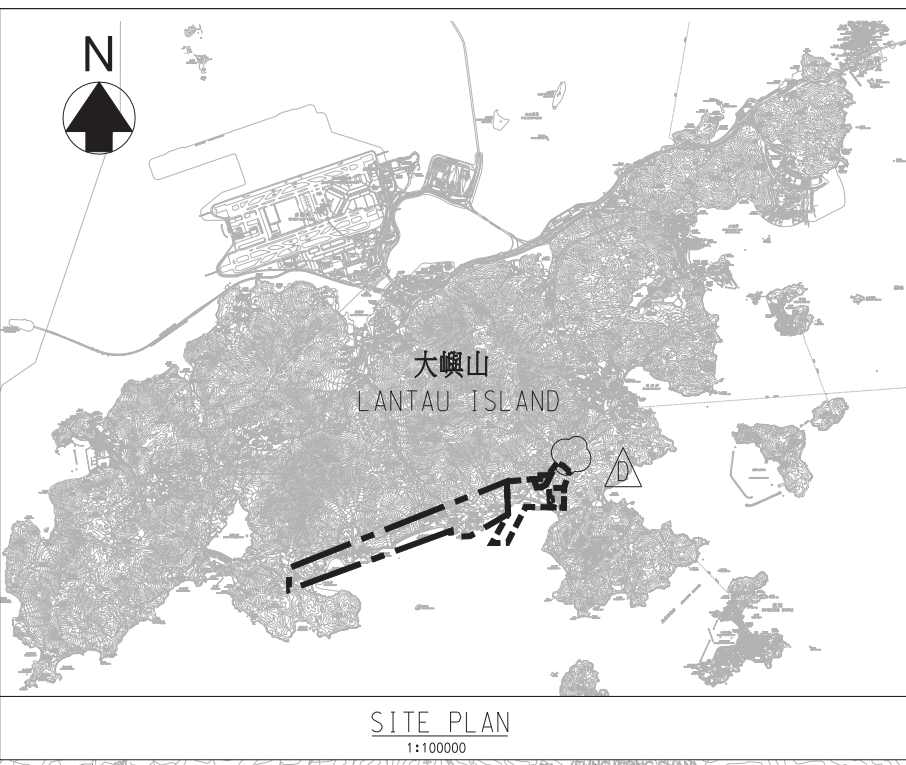Master Layout Plan



Revision	Date	Description	Initial
D	11/20	TENDER ADDENDUM NO.6	BL
C	11/20	TENDER ADDENDUM NO.5	BL
B	11/20	TENDER ADDENDUM NO.4	BL
A	09/20	TENDER ADDENDUM NO.2	TFL
Initial	Designed	Checked	Drawn
	TFL	BL	SZ
Date	04/20	04/20	04/20

Approved
Christina

Contract no.
DC/2020/02

Contract title
CONSTRUCTION OF SAN SHEK WAN SEWAGE TREATMENT WORKS, ASSOCIATED SUBMARINE OUTFALL AND PUI O SEWERAGE WORKS

Drawing title
SOUTH LANTAU SEWERAGE WORKS - MASTER LAYOUT PLAN

Drawing no. 178711/B&V/GN/001	Revision D
----------------------------------	---------------

Scale
1 : 15000







Figure 2.2
Contract Layout Plan

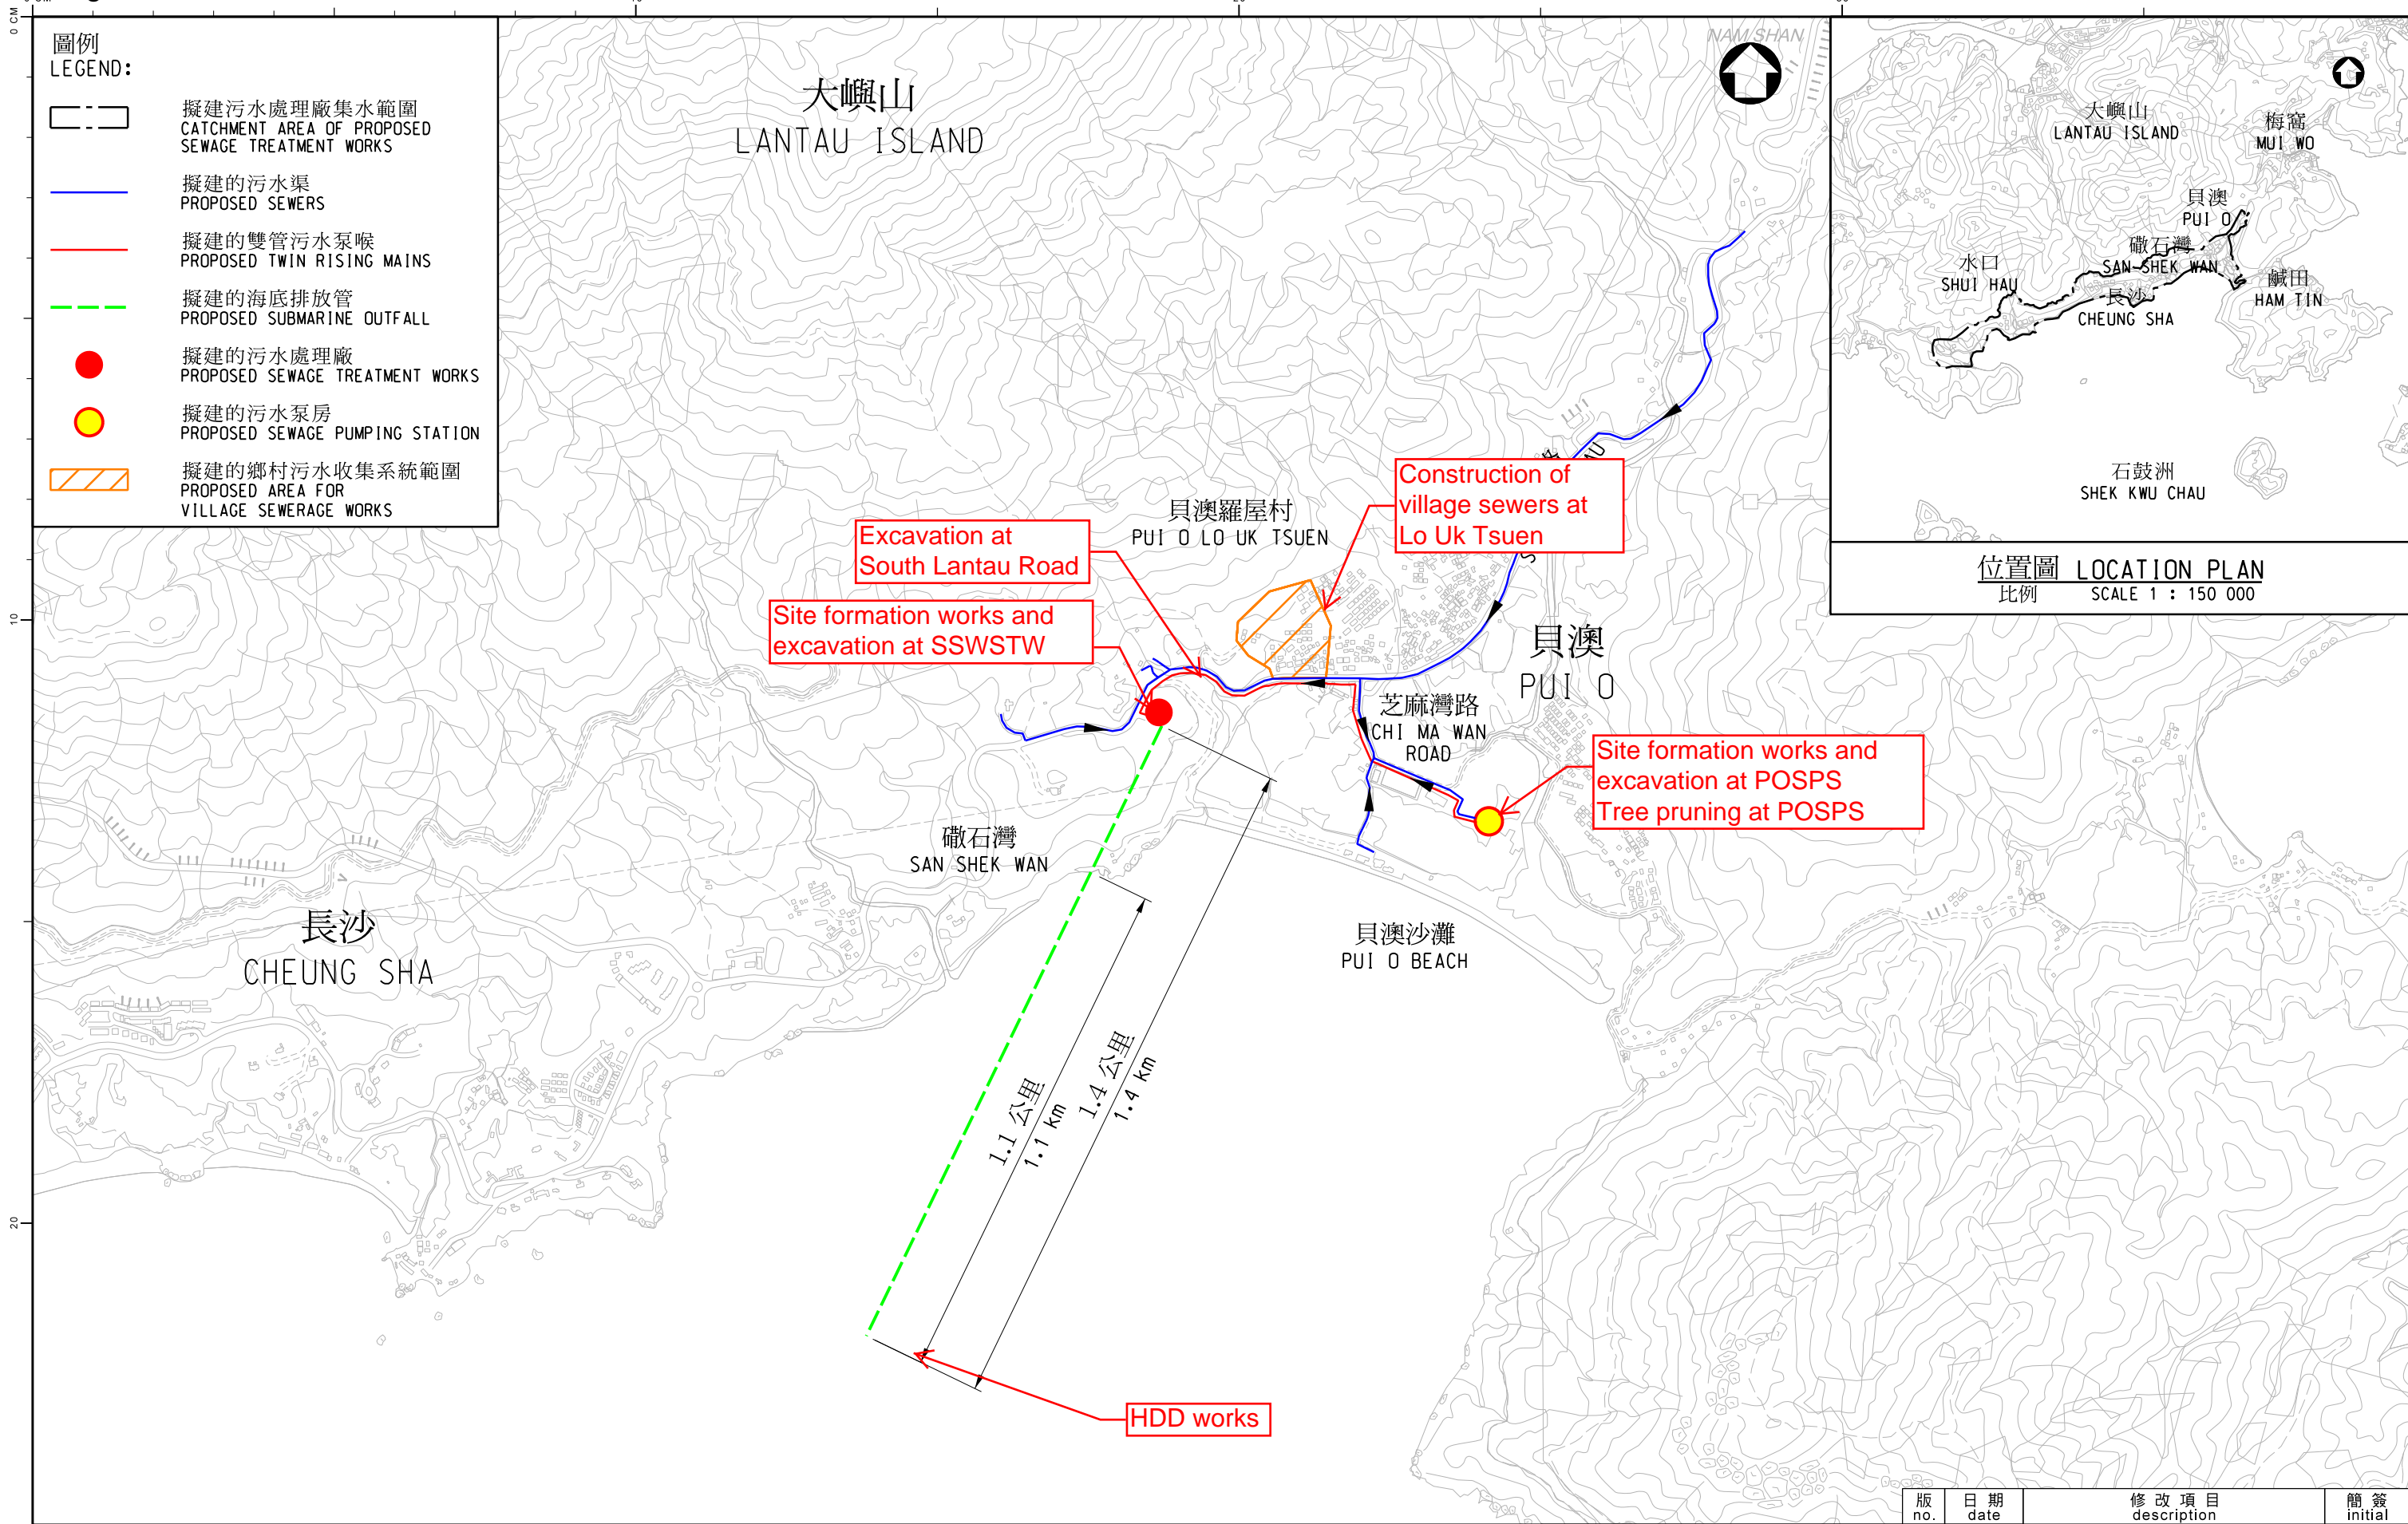Figure 2.2



圖則名稱 drawing title
 工務工程計劃編號331DS - 離島污水收集系統第2階段
 - 南大嶼山污水收集系統工程
 PWP ITEM NO.331DS - OUTLYING ISLANDS SEWERAGE, STAGE 2
 - SOUTH LANTAU SEWERAGE WORKS







繪畫 drawn	SIGNED W. H. CHAN	日期 date	27 APR 2020	修改項目 description	簡簽 initial
核對 checked	SIGNED Ir K. S. CHAN	日期 date	27 APR 2020	圖則編號 drawing no.	比例 scale
批核 approved	SIGNED Ir L. CHEN	日期 date	27 APR 2020	DVD/2020/001	1:12 500
部門 office	特別職務部 SPECIAL DUTY DIVISION			保留版權 COPYRIGHT RESERVED	
				香港特別行政區政府渠務署 DRAINAGE SERVICES DEPARTMENT GOVERNMENT OF THE HONG KONG SPECIAL ADMINISTRATIVE REGION	





Figure 2.3

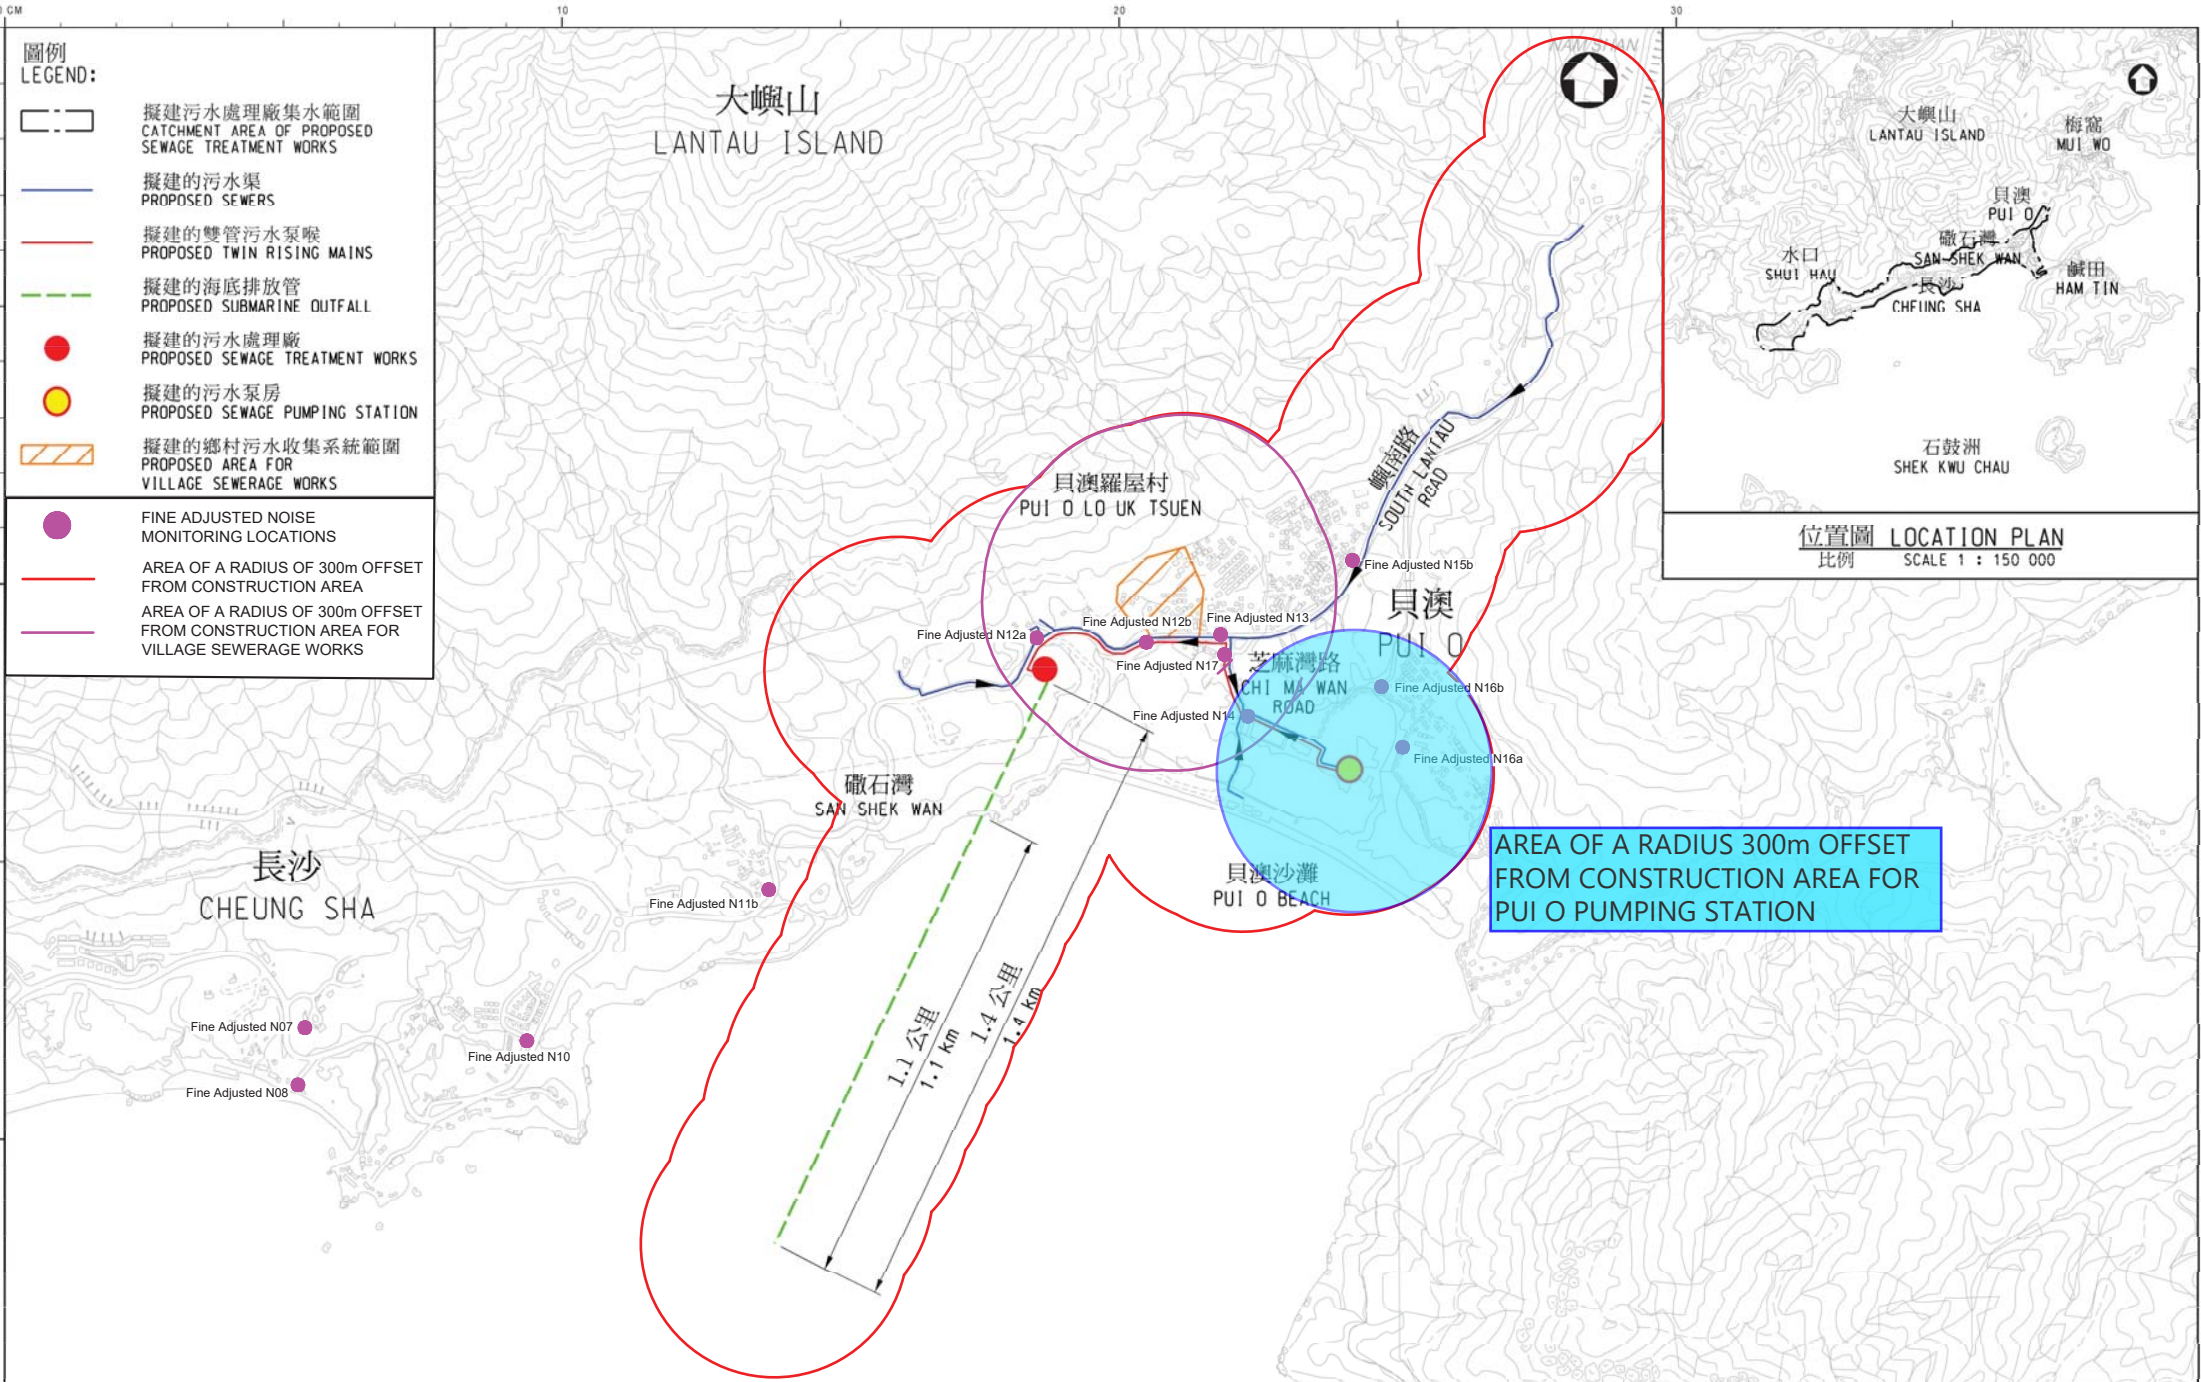
Locations of Noise Monitoring Station

圖例 LEGEND:

-  擬建污水處理廠集水範圍
CATCHMENT AREA OF PROPOSED SEWAGE TREATMENT WORKS
-  擬建的污水渠
PROPOSED SEWERS
-  擬建的雙管污水泵喉
PROPOSED TWIN RISING MAINS
-  擬建的海底排放管
PROPOSED SUBMARINE OUTFALL
-  擬建的污水處理廠
PROPOSED SEWAGE TREATMENT WORKS
-  擬建的污水泵房
PROPOSED SEWAGE PUMPING STATION
-  擬建的鄉村污水收集系統範圍
PROPOSED AREA FOR VILLAGE SEWERAGE WORKS

-  FINE ADJUSTED NOISE MONITORING LOCATIONS
-  AREA OF A RADIUS OF 300m OFFSET FROM CONSTRUCTION AREA
-  AREA OF A RADIUS OF 300m OFFSET FROM CONSTRUCTION AREA FOR VILLAGE SEWERAGE WORKS

位置圖 LOCATION PLAN
比例 SCALE 1 : 150 000



AREA OF A RADIUS 300m OFFSET FROM CONSTRUCTION AREA FOR PUI O PUMPING STATION

1.1 公里
1.1 km


1.4 公里
1.4 km

1.4 公里
1.4 km



Figure 2.4

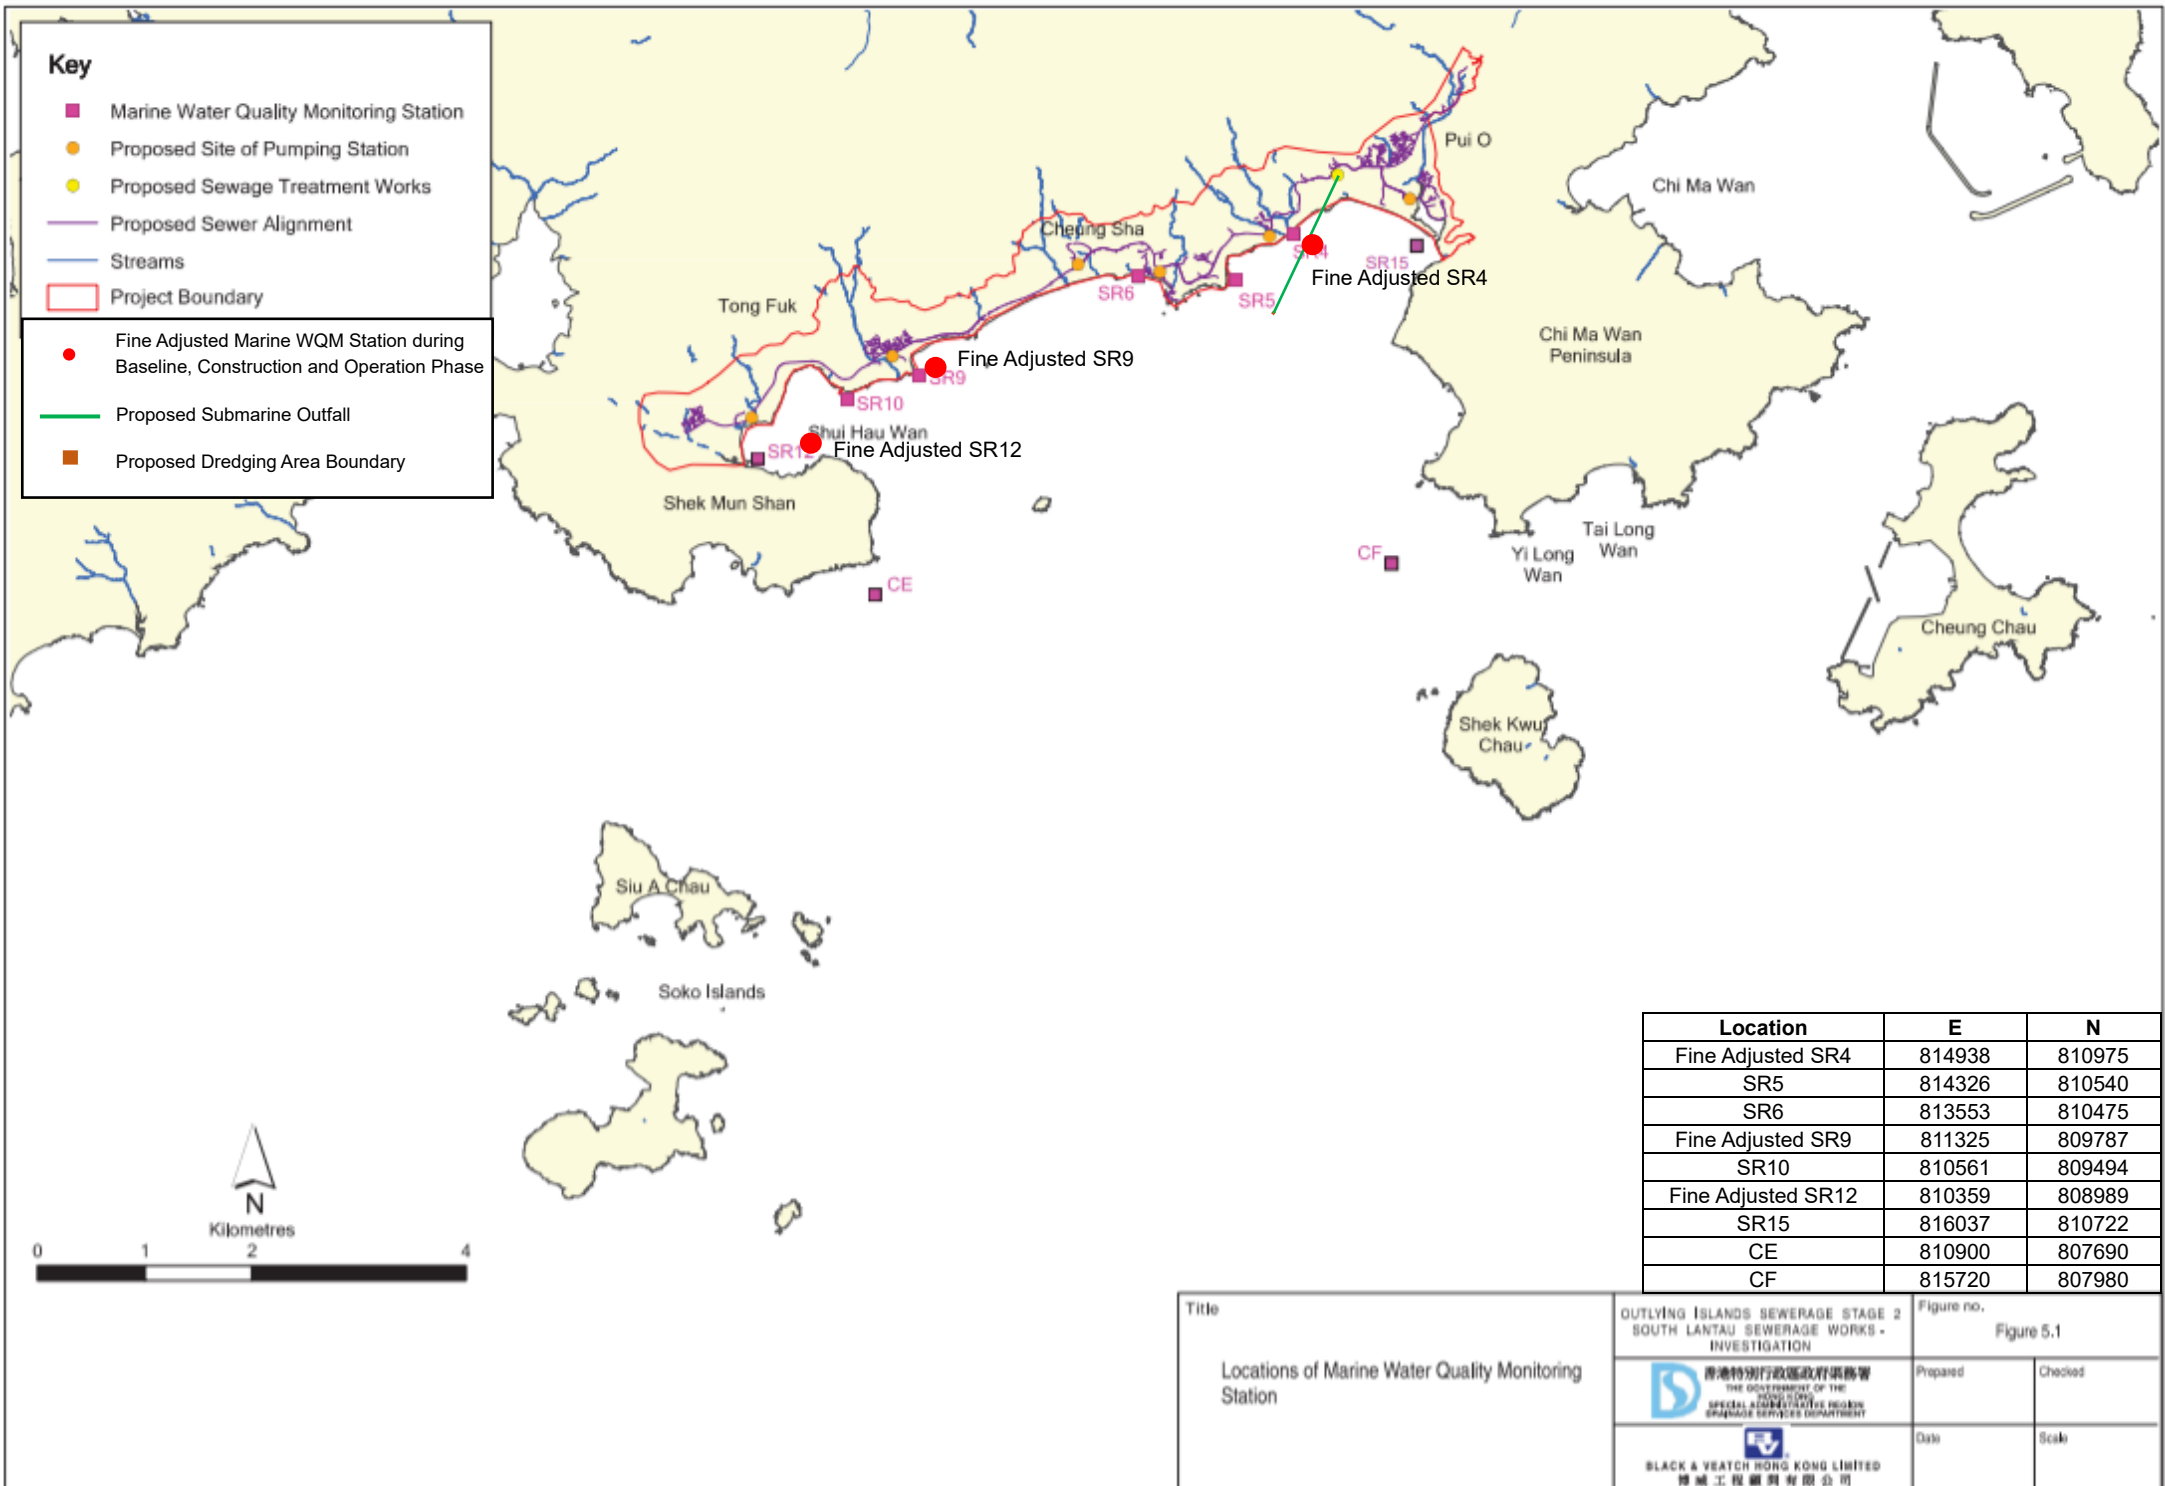Locations of Water Quality Monitoring Stations



Key	
■	Marine Water Quality Monitoring Station
●	Proposed Site of Pumping Station
●	Proposed Sewage Treatment Works
—	Proposed Sewer Alignment
—	Streams
	Project Boundary
●	Fine Adjusted Marine WQM Station during Baseline, Construction and Operation Phase
—	Proposed Submarine Outfall
■	Proposed Dredging Area Boundary

Location	E	N
Fine Adjusted SR4	814938	810975
SR5	814326	810540
SR6	813553	810475
Fine Adjusted SR9	811325	809787
SR10	810561	809494
Fine Adjusted SR12	810359	808989
SR15	816037	810722
CE	810900	807690
CF	815720	807980

Title Locations of Marine Water Quality Monitoring Station	OUTLYING ISLANDS SEWERAGE STAGE 2 SOUTH LANTAU SEWERAGE WORKS - INVESTIGATION		Figure no. Figure 5.1	
			Prepared	Checked
			Date	Scale



Figure 2.5

Mark up Figure 5.4i extracted from approved EIA Report (AEIAR-210/2017)

Figure 2.5 - Mark up Figure 5.4i extracted from approved EIA Report (AEIAR-210/2017)

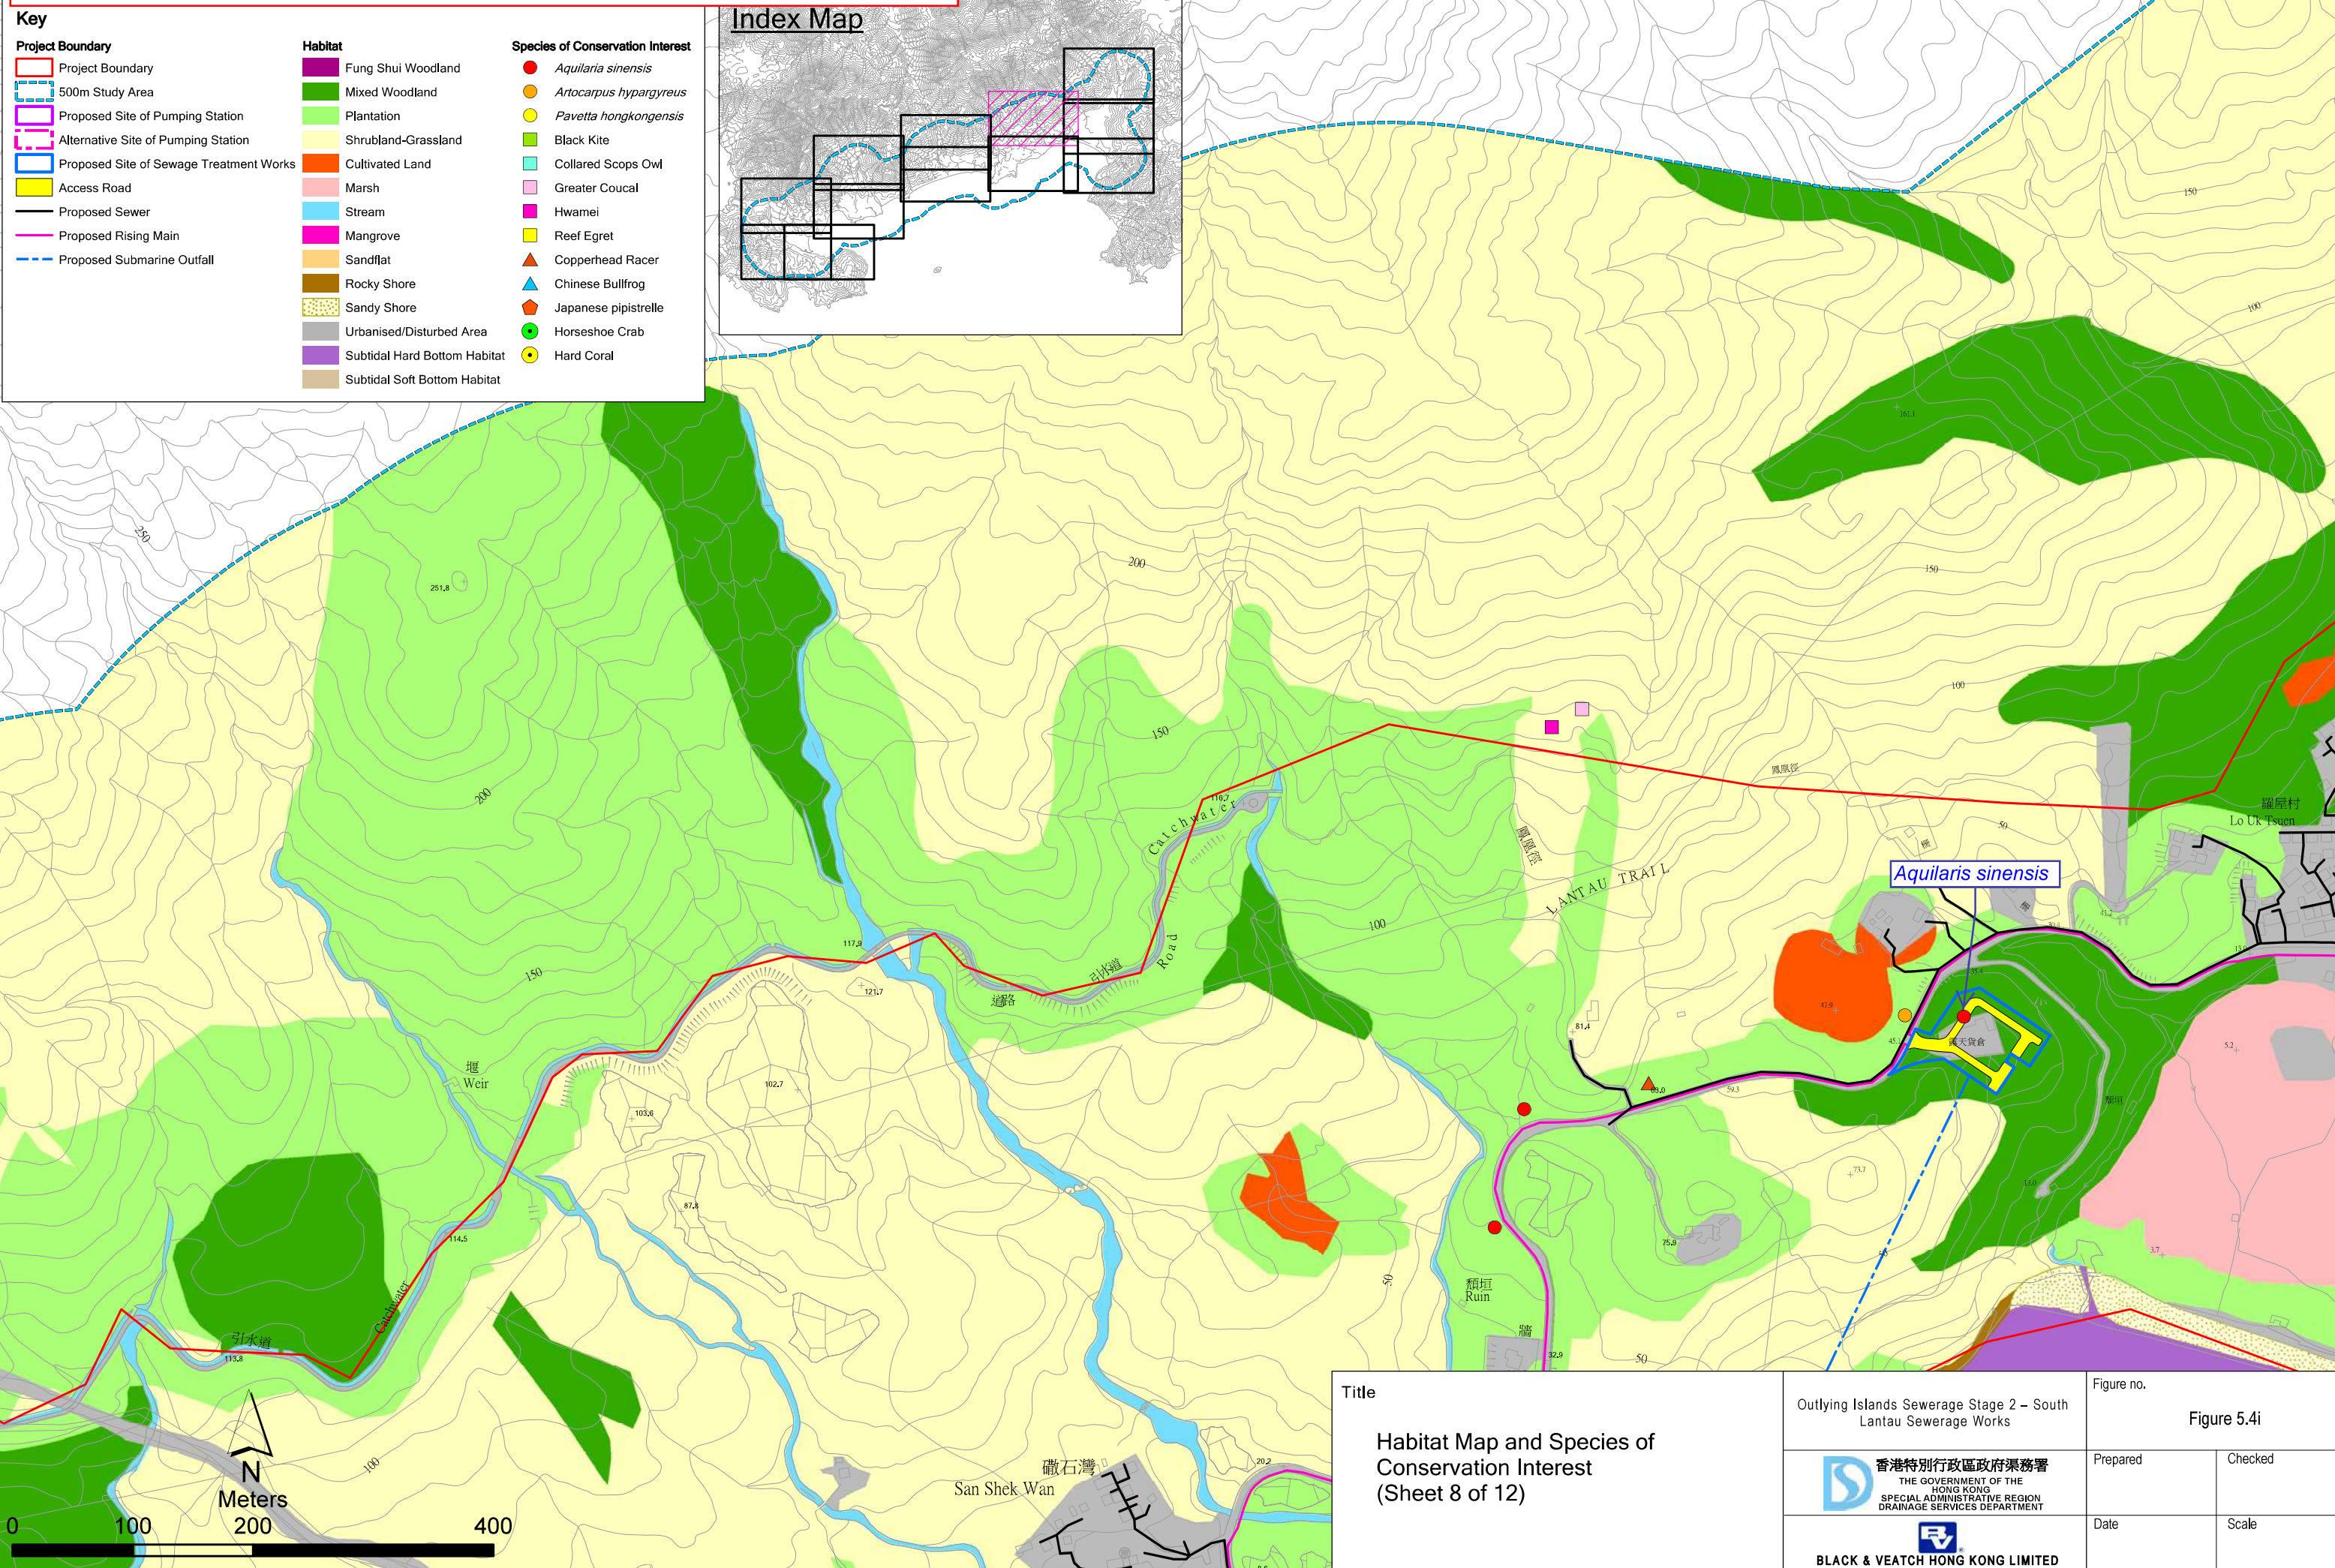


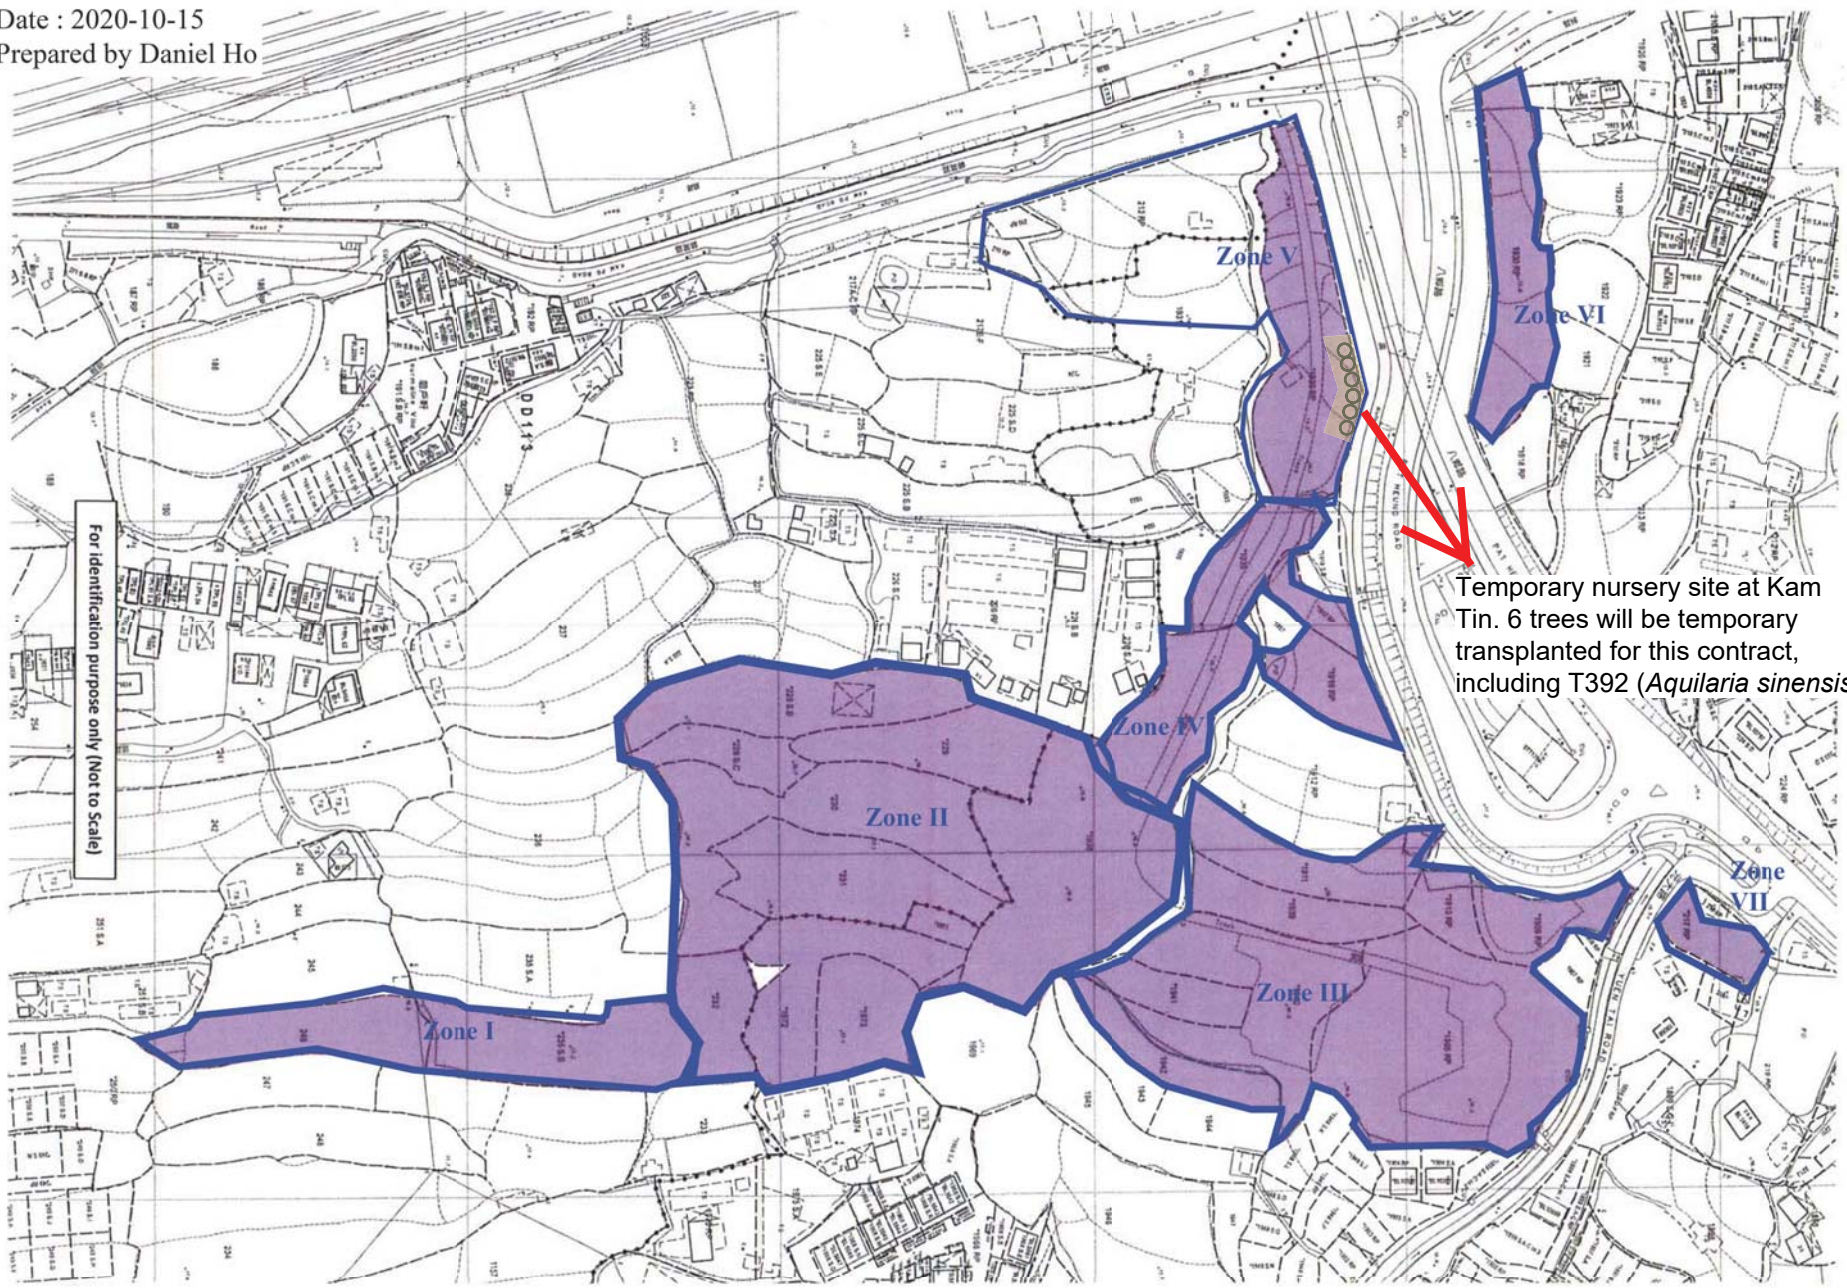


Figure 2.6

Location Plan for Temporary Holding Nursery


Figure 2.6

Date : 2020-10-15
Prepared by Daniel Ho



COPY RIGHT®

Project : Contract No.: DC/2020/02
Construction of San Shek Wan Sewage Treatment Works,
Associated Submarine Outfall and Pui O Sewerage Works

 **Toyo Greenland Co., Ltd.**

Drawing Title : Location Plan for 6 nos. Trees on Kam Tin Nursery

Check : Ho Tat Pui, Daniel

Scale : N.T.S.

Rev.

Ref: C3109/22/TGD0164

Date : 10 January 2022

00



Appendix 4.1

Copies of Calibration Certificates



CERTIFICATE OF CALIBRATION

Certificate No.: 22CA0412 03

Page 1 of 2

Item tested

Description:	Sound Level Meter (Class 1)	Microphone	Preamp
Manufacturer:	Larson Davis	PCB	PCB
Type/Model No.:	LxT1	377B02	PRMLxT1L
Serial/Equipment No.:	0006346	326425	069995
Adaptors used:	-	-	-

Item submitted by

Customer Name: Lam Environmental Services Limited
Address of Customer: -
Request No.: -
Date of receipt: 12-Apr-2022

Date of test: 17-Apr-2022

Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Multi function sound calibrator	B&K 4226	2288444	23-Aug-2022	CIGISMEC
Signal generator	DS 360	33873	27-May-2022	CEPREI

Ambient conditions

Temperature: 22 ± 1 °C
Relative humidity: 55 ± 10 %
Air pressure: 1005 ± 5 hPa

Test specifications

- 1, The Sound Level Meter has been calibrated in accordance with the requirements as specified in BS 7580: Part 1: 1997 and the lab calibration procedure SMTP004-CA-152.
- 2, The electrical tests were performed using an electrical signal substituted for the microphone which was removed and replaced by an equivalent capacitance within a tolerance of $\pm 20\%$.
- 3, The acoustic calibration was performed using an B&K 4226 sound calibrator and corrections was applied for the difference between the free-field and pressure responses of the Sound Level Meter.


Test results

This is to certify that the Sound Level Meter conforms to BS 7580: Part 1: 1997 for the conditions under which the test was performed.

Details of the performed measurements are presented on page 2 of this certificate.

Actual Measurement data are documented on worksheets.

Approved Signatory:



Feng Junqi

Date: 19-Apr-2022

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument. The results apply to the item as received.



CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 22CA0412 03 Page 2 of 2

1, Electrical Tests

The electrical tests were performed using an equivalent capacitance substituted for the microphone. The results are given in below with test status and the estimated uncertainties. The "Pass" means the result of the test is inside the tolerances stated in the test specifications. The "-" means the result of test is outside these tolerances.

Test:	Subtest:	Status:	Expanded Uncertainty (dB)	Coverage Factor
Self-generated noise	A	Pass	0.3	
	C	Pass	0.8	2.1
	Lin	Pass	1.6	2.2
Linearity range for Leq	At reference range , Step 5 dB at 4 kHz	Pass	0.3	
	Reference SPL on all other ranges	Pass	0.3	
	2 dB below upper limit of each range	Pass	0.3	
	2 dB above lower limit of each range	Pass	0.3	
Linearity range for SPL	At reference range , Step 5 dB at 4 kHz	Pass	0.3	
	Frequency weightings			
Time weightings	A	Pass	0.3	
	C	Pass	0.3	
	Lin	Pass	0.3	
Peak response	Single Burst Fast	Pass	0.3	
	Single Burst Slow	Pass	0.3	
R.M.S. accuracy	Single 100µs rectangular pulse	Pass	0.3	
	Crest factor of 3	Pass	0.3	
Time weighting I	Single burst 5 ms at 2000 Hz	Pass	0.3	
	Repeated at frequency of 100 Hz	Pass	0.3	
Time averaging	1 ms burst duty factor 1/10 ³ at 4kHz	Pass	0.3	
	1 ms burst duty factor 1/10 ⁴ at 4kHz	Pass	0.3	
Pulse range	Single burst 10 ms at 4 kHz	Pass	0.4	
Sound exposure level	Single burst 10 ms at 4 kHz	Pass	0.4	
Overload indication	SPL	Pass	0.3	
	Leq	Pass	0.4	

2, Acoustic tests

The complete sound level meter was calibrated on the reference range using a B&K 4226 acoustic calibrator with 1000Hz and SPL 94 dB. The sensitivity of the sound level meter was adjusted. The test result at 125 Hz and 8000 Hz are given in below with test status and the estimated uncertainties.

Test:	Subtest	Status	Expanded Uncertainty (dB)	Coverage Factor
Acoustic response	Weighting A at 125 Hz	Pass	0.3	
	Weighting A at 8000 Hz	Pass	0.5	

3, Response to associated sound calibrator

N/A

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

Calibrated by:

Date: 17-Apr-2022

Fung Chi Yip

- End -

Checked by:

Date: 19-Apr-2022

Chan Yuk Yiu

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.



Test Data for Sound Level Meter

Page 1 of 5

Sound level meter type:	LxT1	Serial No.	0006346	Date	17-Apr-2022
Microphone type:	377B02	Serial No.	326425		
Preamp type:	PRMLxT1L	Serial No.	069995	Report:	22CA0412 03

SELF GENERATED NOISE TEST

The noise test is performed in the most sensitive range of the SLM with the microphone replaced by an equivalent impedance.

Noise level in A weighting	9.3	dB
Noise level in C weighting	12.5	dB
Noise level in Lin	19.1	dB

LINEARITY TEST

The linearity is tested relative to the reference sound pressure level using a continuous sinusoidal signal of frequency 4 kHz. The measurement is made on the reference range for indications at 5 dB intervals starting from the 94 dB reference sound pressure level. And until within 5 dB of the upper and lower limits of the reference range, the measurements shall be made at 1 dB intervals. (SLM set to LEQ/SPL)

Reference/Expected level	Actual level		Tolerance	Deviation	
	non-integrated	integrated		non-integrated	integrated
dB	dB	dB	+/- dB	dB	dB
94.0	94.0	94.0	0.7	0.0	0.0
99.0	99.0	99.0	0.7	0.0	0.0
104.0	104.0	104.0	0.7	0.0	0.0
109.0	109.0	109.0	0.7	0.0	0.0
114.0	114.0	114.0	0.7	0.0	0.0
115.0	115.0	115.0	0.7	0.0	0.0
116.0	116.0	116.0	0.7	0.0	0.0
117.0	117.0	117.0	0.7	0.0	0.0
118.0	118.0	118.0	0.7	0.0	0.0
119.0	119.0	119.0	0.7	0.0	0.0
120.0	120.0	120.0	0.7	0.0	0.0
89.0	89.0	89.0	0.7	0.0	0.0
84.0	84.0	84.0	0.7	0.0	0.0
79.0	79.0	79.0	0.7	0.0	0.0
74.0	74.0	74.0	0.7	0.0	0.0
69.0	69.0	69.0	0.7	0.0	0.0
64.0	64.0	64.0	0.7	0.0	0.0
59.0	59.0	59.0	0.7	0.0	0.0
54.0	54.0	54.0	0.7	0.0	0.0
49.0	48.9	48.9	0.7	-0.1	-0.1
44.0	44.0	44.0	0.7	0.0	0.0
39.0	39.0	39.0	0.7	0.0	0.0
34.0	34.0	34.0	0.7	0.0	0.0
33.0	33.0	33.0	0.7	0.0	0.0



Test Data for Sound Level Meter

Page 2 of 5

Sound level meter type: LxT1 Serial No. 0006346 Date 17-Apr-2022
Microphone type: 377B02 Serial No. 326425
Preamp type: PRMLxT1L Serial No. 069995 Report: 22CA0412 03

32.0	31.9	31.9	0.7	-0.1	-0.1
31.0	30.9	30.9	0.7	-0.1	-0.1
30.0	29.9	29.9	0.7	-0.1	-0.1

Measurements for an indication of the reference SPL on all other ranges which include it

Other ranges	Expected level	Actual level	Tolerance	Deviation
dB	dB	dB	+/- dB	dB
20-120	94.0	94.0	0.7	0.0

Measurements on all level ranges for indications 2 dB below the upper limit and 2 dB above the lower limit

Ranges	Reference/Expected level	Actual level	Tolerance	Deviation
dB	dB	dB	+/- dB	dB
20-120	30.0	29.9	0.7	-0.1
	118.0	118.0	0.7	0.0

FREQUENCY WEIGHTING TEST

The frequency response of the weighting networks are tested at octave intervals over the frequency ranges 31.5 Hz to 12500 Hz. The signal level at 1000 Hz is set to give an indication of the reference SPL.

Frequency weighting A:

Frequency Hz	Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
				+	-	
1000.0	94.0	94.0	94.0	0.0	0.0	0.0
31.6	94.0	54.6	54.6	1.5	1.5	0.0
63.1	94.0	67.8	67.8	1.5	1.5	0.0
125.9	94.0	77.9	77.9	1.0	1.0	0.0
251.2	94.0	85.4	85.4	1.0	1.0	0.0
501.2	94.0	90.8	90.8	1.0	1.0	0.0
1995.0	94.0	95.2	95.2	1.0	1.0	0.0
3981.0	94.0	95.0	95.0	1.0	1.0	0.0
7943.0	94.0	92.9	92.9	1.5	3.0	0.0
12590.0	94.0	89.7	89.7	3.0	6.0	0.0

Frequency weighting C:

Frequency Hz	Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
				+	-	
1000.0	94.0	94.0	94.0	0.0	0.0	0.0
31.6	94.0	91.0	91.0	1.5	1.5	0.0
63.1	94.0	93.2	93.2	1.5	1.5	0.0
125.9	94.0	93.8	93.8	1.0	1.0	0.0
251.2	94.0	94.0	94.0	1.0	1.0	0.0
501.2	94.0	94.0	94.0	1.0	1.0	0.0



Test Data for Sound Level Meter

Page 3 of 5

Sound level meter type: LxT1 Serial No. 0006346 Date 17-Apr-2022
Microphone type: 377B02 Serial No. 326425
Preamp type: PRMLxT1L Serial No. 069995 Report: 22CA0412 03

1995.0	94.0	93.8	93.9	1.0	1.0	0.1
3981.0	94.0	93.2	93.3	1.0	1.0	0.1
7943.0	94.0	91.0	91.0	1.5	3.0	0.0
12590.0	94.0	87.8	87.8	3.0	6.0	0.0

Frequency weighting Lin:

Frequency Hz	Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
				+	-	
1000.0	94.0	94.0	94.0	0.0	0.0	0.0
31.6	94.0	94.0	94.0	1.5	1.5	0.0
63.1	94.0	94.0	94.0	1.5	1.5	0.0
125.9	94.0	94.0	94.0	1.0	1.0	0.0
251.2	94.0	94.0	94.0	1.0	1.0	0.0
501.2	94.0	94.0	94.0	1.0	1.0	0.0
1995.0	94.0	94.0	94.0	1.0	1.0	0.0
3981.0	94.0	94.0	94.0	1.0	1.0	0.0
7943.0	94.0	94.0	94.1	1.5	3.0	0.1
12590.0	94.0	94.0	94.0	3.0	6.0	0.0

TIME WEIGHTING FAST TEST

Time weighting F is tested on the reference range with a single sinusoidal burst of duration 200 ms at a frequency 2000 Hz and an amplitude which produces an indication 4 dB below the upper limit of the primary indicator range when the signal is continuous. (Weight A, Maximum hold)

Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
			+	-	
116.0	115.0	114.9	1.0	1.0	-0.1

TIME WEIGHTING SLOW TEST

Time weighting S is tested on the reference range with a single sinusoidal burst of duration 500 ms at a frequency 2000 Hz and an amplitude which produces an indication 4 dB below the upper limit of the primary indicator range when the signal is continuous. (Weight A, Maximum hold)

Ref. level dB	Expected level dB	Actual level dB	Tolerance(dB)		Deviation dB
			+	-	
116.0	111.9	111.8	1.0	1.0	-0.1

PEAK RESPONSE TEST

The onset time of the peak detector is tested on the reference range by comparing the response to a 100 us rectangular test pulse with the response to a 10 ms reference pulse of the same amplitude. The amplitude of the 10 ms reference pulse is such as to produce an indication 1 dB below the upper limit of the primary indicator range.

Positive polarities: (Weighting Z, set the generator signal to single, Lzpeak)

Ref. level dB	Response to 10 ms dB	Response to 100 us dB	Tolerance +/- dB	Deviation dB



Test Data for Sound Level Meter

Page 4 of 5

Sound level meter type: LxT1 Serial No. 0006346 Date 17-Apr-2022
 Microphone type: 377B02 Serial No. 326425
 Preamp type: PRMLxT1L Serial No. 069995 Report: 22CA0412 03

Negative polarities:

Ref. level	Response to 10 ms	Response to 100 us	Tolerance	Deviation
dB	dB	dB	+/- dB	dB
119.0	119.0	119.3	2.0	0.3

RMS ACCURACY TEST

The RMS detector accuracy is tested on the reference range for a crest factor of 3.

Test frequency: 2000 Hz
 Amplitude: 2 dB below the upper limit of the primary indicator range.
 Burst repetition frequency: 40 Hz
 Tone burst signal: 11 cycles of a sine wave of frequency 2000 Hz. (Set to INT)

Time weighting	Ref. Level	Expected level	Tone burst signal	Tolerance	Deviation
	dB	dB	indication(dB)	+/- dB	dB
Slow	114.0+6.6	114.0	113.9	0.5	-0.1

TIME WEIGHTING IMPULSE TEST

Time weighting I is tested on the reference range (Set the SLM to LAImax)

Test frequency: 2000 Hz
 Amplitude: The upper limit of the primary indicator range.

Single sinusoidal burst of duration 5 ms:

Ref. Level	Single burst indication		Tolerance	Deviation
dB	Expected (dB)	Actual (dB)	+/- dB	dB
120.0	111.2	111.1	2.0	-0.1

Repeated at 100 Hz

Ref. Level	Repeated burst indication		Tolerance	Deviation
dB	Expected (dB)	Actual (dB)	+/- dB	dB
120.0	117.3	117.1	1.0	-0.2

TIME AVERAGING TEST

This test compares the SLM reading for continuous sine signals with readings obtained from a sine tone burst sequence having the same RMS level. The test level is 30 dB below the upper limit of the linearity range and repeated for Type 1 SLM with 40 dB below the upper limit of the linearity.

Frequency of tone burst: 4000 Hz

Duration of tone burst: 1 ms

Repetition Time	Level of tone burst	Expected Leq	Actual Leq	Tolerance	Deviation	Remarks
msec	dB	dB	dB	+/- dB	dB	
1000	90.0	90.0	89.9	1.0	-0.1	60s integ.
10000	80.0	80.0	79.9	1.0	-0.1	6min. integ.

PULSE RANGE AND SOUND EXPOSURE LEVEL TEST

The test tone burst signal is superimposed on a baseline signal corresponding to the lower limit of reference range

Test frequency: 4000 Hz

Integration time: 10 sec



Test Data for Sound Level Meter

Page 5 of 5

Sound level meter type: LxT1 Serial No. 0006346 Date 17-Apr-2022
Microphone type: 377B02 Serial No. 326425
Preamp type: PRMLxT1L Serial No. 069995 Report: 22CA0412 03

The integrating sound level meter set to Leq:

Duration	Rms level of	Expected	Actual	Tolerance	Deviation
msec	tone burst (dB)	dB	dB	+/- dB	dB
10	90.0	60.0	60.0	1.7	0.0

The integrating sound level meter set to SEL:

Duration	Rms level of	Expected	Actual	Tolerance	Deviation
msec	tone burst (dB)	dB	dB	+/- dB	dB
10.0	90.0	70.0	70.0	1.7	0.0

OVERLOAD INDICATION TEST

For SLM capable of operating in a non-integrating mode.

Test frequency: 2000 Hz
Amplitude: 2 dB below the upper limit of the primary indicator range.
Burst repetition frequency: 40 Hz
Tone burst signal: 11 cycles of a sine wave of frequency 2000 Hz.

Level	Level reduced by	Further reduced	Difference	Tolerance	Deviation
at overload (dB)	1 dB	3 dB	dB	dB	dB
114.2	113.2	110.2	3.0	1.0	0.0

For integrating SLM, with the instrument indicating Leq.

For integrating SLM, with the instrument indicating Leq and set to the reference range. The test signal as following:
The test tone burst signal is superimposed on a baseline signal corresponding to the lower limit of reference range
Test frequency: 4000 Hz
Integration time: 10 sec
Single burst duration: 1 msec

Rms level	Level reduced by	Expected level	Actual level	Tolerance	Deviation
at overload (dB)	1 dB	dB	dB	dB	dB
120.9	119.9	79.9	79.9	2.2	0.0

ACOUSTIC TEST

The acoustic test of the complete SLM is tested at the frequency 125 Hz and 8000 Hz using a B&K type 4226 Multifunction Acoustic Calibrator. The test is performed in A weighting.

Frequency	Expected level	Actual level	Tolerance (dB)		Deviation
			+	-	
Hz	dB	Measured (dB)			dB
1000	94.0	94.0	0.0	0.0	0.0
125	77.9	77.9	1.0	1.0	0.0
8000	92.9	90.8	1.5	3.0	-2.1

-----END-----



CERTIFICATE OF CALIBRATION

Certificate No.: 21CA1021 05-01

Page: 1 of 2

Item tested

Description: Acoustical Calibrator (Class 1)
Manufacturer: Honglim Co., Ltd.
Type/Model No.: HLES-02
Serial/Equipment No.: 2016611465
Adaptors used: -

Item submitted by

Customer: Lam Environmental Services Limited.
Address of Customer: -
Request No.: -
Date of receipt: 21-Oct-2021

Date of test: 25-Oct-2021

Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Lab standard microphone	B&K 4180	2341427	04-May-2022	SCL
Preamplifier	B&K 2673	2239857	31-May-2022	CEPREI
Measuring amplifier	B&K 2610	2346941	01-Jun-2022	CEPREI
Signal generator	DS 360	33873	27-May-2022	CEPREI
Digital multi-meter	34401A	US36087050	27-May-2022	CEPREI
Audio analyzer	8903B	GB41300350	28-May-2022	CEPREI
Universal counter	53132A	MY40003662	02-Jun-2022	CEPREI

Ambient conditions

Temperature: 22 ± 1 °C
Relative humidity: 55 ± 10 %
Air pressure: 1005 ± 5 hPa

Test specifications


- The Sound Calibrator has been calibrated in accordance with the requirements as specified in IEC 60942 1997 Annex B and the lab calibration procedure SMTP004-CA-156.
- The calibrator was tested with its axis vertical facing downwards at the specific frequency using insert voltage technique.
- The results are rounded to the nearest 0.01 dB and 0.1 Hz and have not been corrected for variations from a reference pressure of 1013.25 hectoPascals as the maker's information indicates that the instrument is insensitive to pressure changes.

Test results

This is to certify that the sound calibrator conforms to the requirements of annex B of IEC 60942: 1997 for the conditions under which the test was performed. This does not imply that the sound calibrator meets IEC 60942 under any other conditions.

Details of the performed measurements are presented on page 2 of this certificate.

Approved Signatory:


Feng Junqi

Date: 26-Oct-2021

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument. The results apply to the item as received.



CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 21CA1021 05-01

Page: 2 of 2

1, Measured Sound Pressure Level

The output Sound Pressure Level in the calibrator head was measured at the setting and frequency shown using a calibrated laboratory standard microphone and insert voltage technique. The results are given in below with the estimated uncertainties.

Frequency Shown Hz	Output Sound Pressure Level Setting dB	Measured Output Sound Pressure Level dB	(Output level in dB re 20 μ Pa)
			Estimated Expanded Uncertainty dB
1000	94.00	94.01	0.10

2, Sound Pressure Level Stability - Short Term Fluctuations

The Short Term Fluctuations was determined by measuring the maximum and minimum of the fast weighted DC output of the B&K 2610 measuring amplifier over a 20 second time interval as required in the standard. The Short Term Fluctuation was found to be:

At 1000 Hz STF = 0.017 dB

Estimated expanded uncertainty 0.005 dB

3, Actual Output Frequency

The determination of actual output frequency was made using a B&K 4180 microphone together with a B&K 2673 preamplifier connected to a B&K 2610 measuring amplifier. The AC output of the B&K 2610 was taken to an universal counter which was used to determine the frequency averaged over 20 second of operation as required by the standard. The actual output frequency at 1 KHz was:

At 1000 Hz Actual Frequency = 1003.7 Hz

Estimated expanded uncertainty 0.1 Hz Coverage factor k = 2.2

4, Total Noise and Distortion

For the Total Noise and Distortion measurement, the unfiltered AC output of the B&K 2610 measuring amplifier was connected to an Agilent Type 8903 B distortion analyser. The TND result at 1 KHz was:

At 1000 Hz TND = 1.5 %

Estimated expanded uncertainty 0.7 %

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

Calibrated by:

Date:

Fung Chi Yip
25-Oct-2021

- End -

Checked by:

Date:

Chan Yuk Yiu
26-Oct-2021

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.



CERTIFICATE OF CALIBRATION

Certificate No.: 21CA1021 05-02

Page: 1 of 2

Item tested

Description: Acoustical Calibrator (Class 1)
Manufacturer: Honglim Co., Ltd.
Type/Model No.: HLES-02
Serial/Equipment No.: 2019612534
Adaptors used: -

Item submitted by

Customer: Lam Environmental Services Limited
Address of Customer: -
Request No.: -
Date of receipt: 21-Oct-2021

Date of test: 25-Oct-2021

Reference equipment used in the calibration

Description:	Model:	Serial No.	Expiry Date:	Traceable to:
Lab standard microphone	B&K 4180	2341427	04-May-2022	SCL
Preamplifier	B&K 2673	2239857	31-May-2022	CEPREI
Measuring amplifier	B&K 2610	2346941	01-Jun-2022	CEPREI
Signal generator	DS 360	33873	27-May-2022	CEPREI
Digital multi-meter	34401A	US36087050	27-May-2022	CEPREI
Audio analyzer	8903B	GB41300350	28-May-2022	CEPREI
Universal counter	53132A	MY40003662	02-Jun-2022	CEPREI

Ambient conditions

Temperature: 22 ± 1 °C
Relative humidity: 55 ± 10 %
Air pressure: 1005 ± 5 hPa

Test specifications

- The Sound Calibrator has been calibrated in accordance with the requirements as specified in IEC 60942 1997 Annex B and the lab calibration procedure SMTP004-CA-156.
- The calibrator was tested with its axis vertical facing downwards at the specific frequency using insert voltage technique.
- The results are rounded to the nearest 0.01 dB and 0.1 Hz and have not been corrected for variations from a reference pressure of 1013.25 hectoPascals as the maker's information indicates that the instrument is insensitive to pressure changes.

Test results

This is to certify that the sound calibrator conforms to the requirements of annex B of IEC 60942: 1997 for the conditions under which the test was performed. This does not imply that the sound calibrator meets IEC 60942 under any other conditions.

Details of the performed measurements are presented on **page 2** of this certificate.

Approved Signatory:


Feng Junqi

Date: 26-Oct-2021

Company Chop:



Comments: The results reported in this certificate refer to the condition of the instrument on the date of calibration and carry no implication regarding the long-term stability of the instrument. The results apply to the item as received.



CERTIFICATE OF CALIBRATION

(Continuation Page)

Certificate No.: 21CA1021 05-02

Page: 2 of 2

1, Measured Sound Pressure Level

The output Sound Pressure Level in the calibrator head was measured at the setting and frequency shown using a calibrated laboratory standard microphone and insert voltage technique. The results are given in below with the estimated uncertainties.

Frequency Shown Hz	Output Sound Pressure Level Setting dB	Measured Output Sound Pressure Level dB	(Output level in dB re 20 μ Pa)
			Estimated Expanded Uncertainty dB
1000	94.00	94.02	0.10

2, Sound Pressure Level Stability - Short Term Fluctuations

The Short Term Fluctuations was determined by measuring the maximum and minimum of the fast weighted DC output of the B&K 2610 measuring amplifier over a 20 second time interval as required in the standard. The Short Term Fluctuation was found to be:

At 1000 Hz STF = 0.011 dB
Estimated expanded uncertainty 0.005 dB

3, Actual Output Frequency

The determination of actual output frequency was made using a B&K 4180 microphone together with a B&K 2673 preamplifier connected to a B&K 2610 measuring amplifier. The AC output of the B&K 2610 was taken to an universal counter which was used to determine the frequency averaged over 20 second of operation as required by the standard. The actual output frequency at 1 KHz was:

At 1000 Hz Actual Frequency = 998.27 Hz
Estimated expanded uncertainty 0.1 Hz Coverage factor k = 2.2

4, Total Noise and Distortion

For the Total Noise and Distortion measurement, the unfiltered AC output of the B&K 2610 measuring amplifier was connected to an Agilent Type 8903 B distortion analyser. The TND result at 1 KHz was:

At 1000 Hz TND = 0.4 %
Estimated expanded uncertainty 0.7 %

The expanded uncertainties have been calculated in accordance with the ISO Publication "Guide to the expression of uncertainty in measurement", and gives an interval estimated to have a level of confidence of 95%. A coverage factor of 2 is assumed unless explicitly stated.

Calibrated by:

Fung Chi Yip

Date: 25-Oct-2021

- End -

Checked by:

Chan Yuk Yiu

Date: 26-Oct-2021

The standard(s) and equipment used in the calibration are traceable to national or international recognised standards and are calibrated on a schedule to maintain the required accuracy level.



REPORT OF EQUIPMENT PERFORMANCE CHECK / CALIBRATION

Information supplied by customer:

CONTACT: MR. DEREK LO **JOB REFERENCE NO.:** 22777053-G15C3001
CLIENT: LAM ENVIRONMENTAL SERVICES LTD.
DATE RECEIVED: 15/07/2022
DATE OF ISSUE: 18/07/2022
ADDRESS: 19/F, REMAX CENTRE, 42 WONG CHUK HANG ROAD,
HONG KONG
PROJECT: ---

METHOD OF PERFORMANCE CHECK/ CALIBRATION:

Ref: APHA22nd ed 2130B

COMMENTS

It is certified that the item under performance check/calibration has been calibrated/checked by corresponding calibrated equipment in the laboratory.


Maximum Tolerance and calibration frequency stated in the report, unless otherwise stated, the internal acceptance criteria of FT Laboratories Ltd will be followed.

Scope of Test:	Turbidity
Equipment Type:	Turbidimeter
Brand Name:	Xin Rui
Model No.:	WGZ-3B
Serial No.:	1807073
Equipment No.:	---
Date of Calibration:	18/07/2022

Remarks:

This is the Final Report. Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

Certified By:


WONG Chi Wai Sanjo
Senior Chemist

Issue Date:

18/07/2022

This report may not be reproduced except with prior written approval from FT Laboratories Ltd.

Form No.: HG022-002 Rev 0 20190101

Page 1 of 2



REPORT OF EQUIPMENT PERFORMANCE CHECK / CALIBRATION

WORK ORDER: 22777053-G15C3001
DATE OF ISSUE: 18/07/2022
CLIENT: LAM ENVIRONMENTAL SERVICES LTD.

Equipment Type:	Turbidimeter
Brand Name:	Xin Rui
Model No.:	WGZ-3B
Serial No.:	1807073
Equipment No.:	---
Date of Calibration:	18/07/2022
Date of next Calibration:	18/10/2022
Lab I.D.:	H220037-01

Parameters:

Turbidity

Method Ref: APHA 22nd ed. 2130B

Expected Reading (NTU)	Display Reading (NTU)	Tolerance
0	0.00	---
4	3.99	-0.2%
10	9.99	-0.1%
40	39.99	0.0%
100	99.90	-0.1%
400	400	0.0%
1000	1000	0.0%
	Tolerance Limit (±)	10%

Remark: "Displayed Reading" presents the figures shown on item under calibration/checking regardless of equipment precision or significant figures.



REPORT OF EQUIPMENT PERFORMANCE CHECK/CALIBRATION

CONTACT: DEREK LO
CLIENT: LAM ENVIRONMENTAL SERVICES LTD
ADDRESS: 19/F, REMEX CENTRE,
42 WONG CHUK HANG ROAD,
HONG KONG

WORK ORDER: HK2228586
SUB- BATCH: 0
LABORATORY: HONG KONG
DATE RECEIVED: 22-Jul-2022
DATE OF ISSUE: 28-Jul-2022

SPECIFIC COMMENTS

Equipment information (Brand name, Model No., Serial No. and Equipment No.) is provided by client. The performance of the equipment stated in this report is checked with independent reference material and results compared against a calibrated secondary source. The "Tolerance Limit" quoted is the acceptance criteria applicable for similar equipment used by the laboratory or quoted from relevant international standards. The "Next Calibration Date" is recommended according to best practice principle as practised by the laboratory or quoted from relevant international standards. The validity of equipment/ meter performance only applies to the result(s) stated in the report.

Equipment Type: Multifunctional Meter
Service Nature: Performance Check
Scope: Dissolved Oxygen, pH Value, Salinity and Temperature
Brand Name/ Model No.: [YSI]/ [Professional Plus]
Serial No./ Equipment No.: [19H100656/14E101065]/ [N/A]
Date of Calibration: 26-July-2022

GENERAL COMMENTS

This report superseded any previous report(s) with same work order number.

Mr Chan Siu Ming, Vico
Manager - Inorganics

This report may not be reproduced except with prior written approval from ALS Technichem (HK) Pty Ltd.

REPORT OF EQUIPMENT PERFORMANCE CHECK/CALIBRATION



WORK ORDER: HK2228586
SUB- BATCH: 0
DATE OF ISSUE: 28-Jul-2022
CLIENT: LAM ENVIRONMENTAL SERVICES LTD

Equipment Type: Multifunctional Meter
Brand Name/ Model No.: [YSI]/ [Professional Plus]
Serial No./ Equipment No.: [19H100656/14E101065]/ [N/A]
Date of Calibration: 26-July-2022 Date of Next Calibration: 26-October-2022

PARAMETERS:

Dissolved Oxygen Method Ref: APHA (21st edition), 4500O: G

Expected Reading (mg/L)	Displayed Reading (mg/L)	Tolerance (mg/L)
3.38	3.20	-0.18
4.97	4.91	-0.06
7.67	7.67	+0.00
	Tolerance Limit (mg/L)	±0.20

pH Value Method Ref: APHA (21st edition), 4500H: B

Expected Reading (pH unit)	Displayed Reading (pH unit)	Tolerance (pH unit)
4.0	4.00	+0.00
7.0	7.10	+0.10
10.0	9.93	-0.07
	Tolerance Limit (pH unit)	±0.20

Salinity Method Ref: APHA (21st edition), 2520B

Expected Reading (ppt)	Displayed Reading (ppt)	Tolerance (%)
0	0.00	--
10	9.86	-1.4
20	19.71	-1.5
30	29.24	-2.5
	Tolerance Limit (%)	±10.0

Remark: "Displayed Reading" presents the figures shown on item under calibration / checking regardless of equipment precision or significant figures.

Mr Chan Siu Ming, Vico
Manager - Inorganics

REPORT OF EQUIPMENT PERFORMANCE CHECK/CALIBRATION



WORK ORDER: HK2228586
SUB- BATCH: 0
DATE OF ISSUE: 28-Jul-2022
CLIENT: LAM ENVIRONMENTAL SERVICES LTD

Equipment Type: Multifunctional Meter
Brand Name/ Model No.: [YSI]/ [Professional Plus]
Serial No./ Equipment No.: [19H100656/14E101065]/ [N/A]
Date of Calibration: 26-July-2022 Date of Next Calibration: 26-October-2022

PARAMETERS:

Temperature

Method Ref: Section 6 of International Accreditation New Zealand Technical Guide No. 3 Second edition March 2008: Working Thermometer Calibration Procedure.

Expected Reading (°C)	Displayed Reading (°C)	Tolerance (°C)
7.0	7.1	+0.1
25.0	24.2	-0.8
43.5	43.2	-0.3
	Tolerance Limit (°C)	±2.0

Remark: "Displayed Reading" presents the figures shown on item under calibration / checking regardless of equipment precision or significant figures.

Mr Chan Siu Ming, Vico
Manager - Inorganics



Appendix 4.2

Impact Monitoring Schedule for Reporting Month and Next Month



CONTRACT NO: SD 6/2020
Construction of San Shek Wan Sewage Treatment Works
ASSOCIATED SUBMARINE OUTFALL AND PUI O SEWERAGE WORKS
Impact Marine Water Quality Monitoring Schedule
Aug 2022

Note:

*Mid-tide time during daylight period of the ebb/flood tide is scheduled in consideration of navigation safety and to capture major marine works operat

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
31 Jul	01 Aug	02 Aug	03 Aug	04 Aug	05 Aug	06 Aug
		Mid-Ebb 15:06 Mid-Flood 8:26		Mid-Ebb 16:17 Mid-Flood 9:58		Mid-Ebb 18:45 Mid-Flood 13:17
07 Aug	08 Aug	09 Aug	10 Aug	11 Aug	12 Aug	13 Aug
		WQM cancelled due to adverse weather both Mid-Ebb & Mid-Flood Mid-Ebb 9:52 Mid-Flood 17:43		Mid-Ebb 11:38 Mid-Flood 19:09		Mid-Ebb 13:16 Mid-Flood 6:26
14 Aug	15 Aug	16 Aug	17 Aug	18 Aug	19 Aug	20 Aug
	Mid-Flood 8:05 Mid-Ebb 14:38		Mid-Flood 9:40 Mid-Ebb 15:51		Mid-Flood 12:00 Mid-Ebb 17:15	
21 Aug	22 Aug	23 Aug	24 Aug	25 Aug	26 Aug	27 Aug
	Mid-Ebb 9:25 Mid-Flood* 17:43		WQM for Mid-Flood was cancelled due to adverse weather Mid-Ebb 11:24 Mid-Flood 18:46		Mid-Ebb 12:32 Mid-Flood 19:23	
28 Aug	29 Aug	30 Aug	31 Aug	01 Sep	02 Sep	03 Sep
	Mid-Flood 7:04 Mid-Ebb 13:38		Mid-Flood 8:29 Mid-Ebb 14:47			



CONTRACT NO: SD 6/2020
Construction of San Shek Wan Sewage Treatment Works
ASSOCIATED SUBMARINE OUTFALL AND PUI O SEWERAGE WORKS
Tentative Impact Marine Water Quality Monitoring Schedule
Sep 2022

Note:

*Mid-tide time during daylight period of the ebb/flood tide is scheduled in consideration of navigation safety and to capture major marine works operation.

Sunday	Monday	Tuesday	Wednesday	Thursday	Friday	Saturday
28 Aug	29 Aug	30 Aug	31 Aug	01 Sep	02 Sep	03 Sep
					Mid-Flood 10:17 Mid-Ebb 16:13	
04 Sep	05 Sep	06 Sep	07 Sep	08 Sep	09 Sep	10 Sep
	Mid-Ebb 7:15 Mid-Flood 19:55		Mid-Ebb 9:43 Mid-Flood 17:35		Mid-Ebb 11:28 Mid-Flood 18:40	
11 Sep	12 Sep	13 Sep	14 Sep	15 Sep	16 Sep	17 Sep
	Mid-Flood 7:11 Mid-Ebb 13:34		Mid-Flood 8:40 Mid-Ebb 14:43		Mid-Flood 10:21 Mid-Ebb 15:35	
18 Sep	19 Sep	20 Sep	21 Sep	22 Sep	23 Sep	24 Sep
	Mid-Ebb 7:30 Mid-Flood* 16:08		Mid-Ebb 9:27 Mid-Flood* 17:49		Mid-Ebb 10:54 Mid-Flood 18:02	
25 Sep	26 Sep	27 Sep	28 Sep	29 Sep	30 Sep	01 Oct
	Mid-Ebb 12:39 Mid-Flood 18:52		Mid-Flood 7:44 Mid-Ebb 13:52		Mid-Flood 9:24 Mid-Ebb 15:12	










Appendix 4.3

Noise Monitoring Results and Graphical Presentations



Graphic Presentation of Noise Monitoring Result

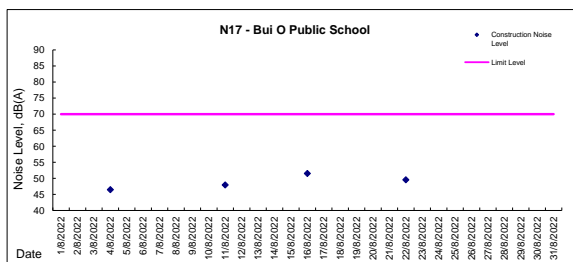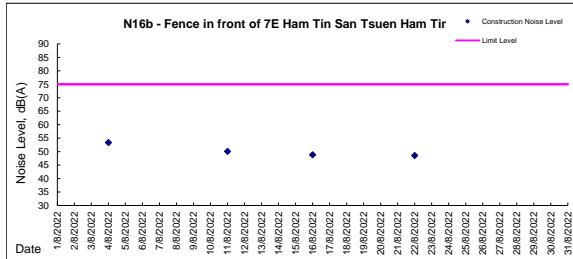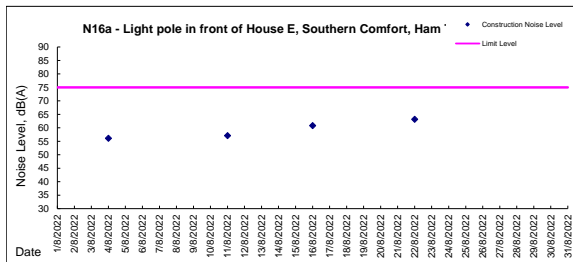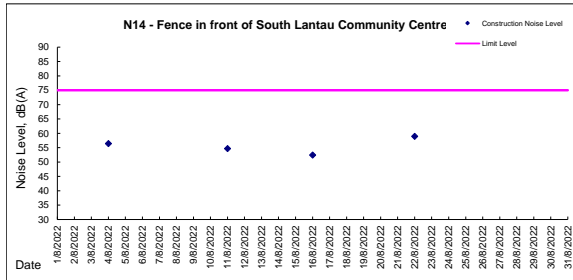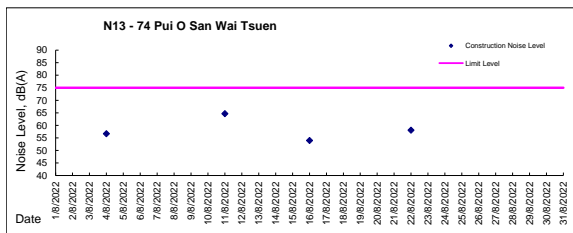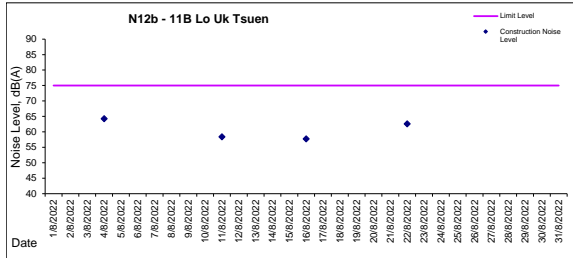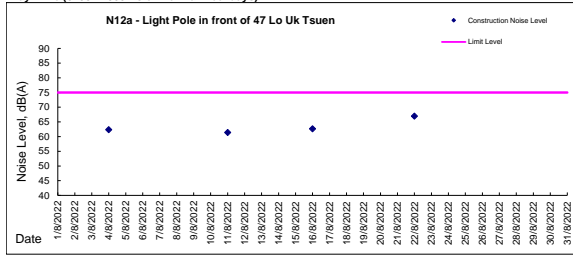Day Time (0700 - 1900hrs on normal weekdays)





Noise Monitoring Result

Day Time (0700 - 1900hrs on normal weekdays)

Location: N12a - Light Pole in front of 47 Lo Uk Tsuen

Date	Weather	Wind Speed	Calibration Check	Time	Measurement Noise Level			Average Noise Level	Baseline Level	Construction Noise Level	Action Level	Major Construction Noise Source(s)	Other Noise Source(s)
					Leq	L10	L90						
					Unit: dB(A), (5-min)								
4 Aug 2022	Cloudy	0.8	93.3	16:00	66.4	70.1	55.6	62.4	73.3	<Baseline Level	75	N/A	Traffic
				16:05	63.2	66.4	54.3						
				16:10	61.0	65.2	55.0						
				16:15	57.3	60.3	56.1						
				16:20	59.6	62.1	56.3						
				16:25	60.7	64.4	53.2						
11 Aug 2022	Cloudy	1.2	93.3	14:30	58.7	61.5	49.6	61.4	73.3	<Baseline Level	75	blower	Traffic
				14:35	57.6	60.8	48.7						
				14:40	63.4	66.6	52.3						
				14:45	59.8	62.7	49.9						
				14:50	65.4	68.8	55.5						
				14:55	55.3	59.0	47.2						
16 Aug 2022	Sunny	1.2	93.3	15:45	67.7	71.1	65.0	62.6	73.3	<Baseline Level	75	N/A	Traffic
				15:50	53.6	57.2	51.3						
				15:55	59.7	63.3	57.0						
				16:00	58.6	62.0	56.0						
				16:05	61.3	64.5	58.7						
				16:10	62.8	66.3	60.1						
22 Aug 2022	Sunny	0.0	93.3	15:45	68.3	71.5	54.6	67.0	73.3	<Baseline Level	75	N/A	Traffic
				15:50	67.4	70.7	54.1						
				15:55	65.2	68.8	52.2						
				16:00	67.9	71.6	54.8						
				16:05	65.7	69.1	52.9						
				16:10	66.4	69.8	53.3						



Noise Monitoring Result

Day Time (0700 - 1900hrs on normal weekdays)

Location: N12b - 11B Lo Uk Tsuen

Date	Weather	Wind Speed	Calibration Check	Time	Measurement Noise Level			Average Noise Level Leq	Baseline Level Leq	Construction Noise Level Leq	Action Level Leq	Major Construction Noise Source(s)	Other Noise Source(s)
					Leq	L10	L90						
					Unit: dB(A), (5-min)								
4 Aug 2022	Cloudy	0.6	93.3	15:15	58.6	61.5	52.3	64.3	76.8	<Baseline Level	75	N/A	Traffic
				15:20	57.4	61.3	51.9						
				15:25	62.1	65.8	52.2						
				15:30	68.8	71.9	52.6						
				15:35	67.2	70.8	53.1						
11 Aug 2022	Cloudy	1.3	93.3	15:40	54.6	58.0	51.9	58.4	76.8	<Baseline Level	75	N/A	Traffic
				13:50	59.6	64.1	45.4						
				13:55	50.2	63.8	48.2						
				14:00	58.7	62.8	46.7						
				14:05	59.3	63.6	46.2						
16 Aug 2022	Sunny	1.0	93.3	14:10	57.9	64.3	47.8	57.7	76.8	<Baseline Level	75	Village sewer works, generator	Traffic
				14:15	59.7	63.5	46.6						
				15:00	55.7	59.6	50.9						
				15:05	56.0	59.2	51.1						
				15:10	57.8	60.3	52.3						
22 Aug 2022	Sunny	0.0	93.3	15:15	55.6	59.8	50.7	62.6	76.8	<Baseline Level	75	N/A	Traffic
				15:20	59.8	62.7	53.9						
				15:25	59.4	62.5	53.7						
				15:00	60.3	63.5	49.6						
				15:05	62.4	65.7	48.7						



Noise Monitoring Result

Day Time (0700 - 1900hrs on normal weekdays)

Location: N13 - 74 Pui O San Wai Tsuen

Date	Weather	Wind Speed	Calibration Check	Time	Measurement Noise Level			Average Noise Level Leq	Baseline Level Leq	Construction Noise Level Leq	Action Level Leq	Major Construction Noise Source(s)	Other Noise Source(s)
					Leq	L10	L90						
					Unit: dB(A), (5-min)								
4 Aug 2022	Cloudy	0.3	93.3	14:30	54.8	57.5	52.4	56.7	73.6	<Baseline Level	75	Excavation, grinding	Traffic
				14:35	53.6	56.4	51.6						
				14:40	56.3	59.0	53.3						
				14:45	56.8	59.9	53.8						
				14:50	55.2	58.3	52.9						
				14:55	60.1	63.2	53.8						
11 Aug 2022	Cloudy	0.7	93.3	11:15	63.5	66.6	57.9	64.7	73.6	<Baseline Level	75	N/A	Traffic
				11:20	62.4	65.1	56.2						
				11:25	66.7	69.6	59.2						
				11:30	62.9	65.8	56.6						
				11:35	65.7	68.3	57.2						
				11:40	65.3	68.3	59.3						
16 Aug 2022	Sunny	0.4	93.3	14:25	51.8	55.0	48.7	54.0	73.6	<Baseline Level	75	N/A	Traffic
				14:30	54.9	58.1	51.0						
				14:35	55.6	58.6	52.6						
				14:40	51.2	54.1	48.0						
				14:45	52.8	55.9	50.0						
				14:50	55.5	57.8	52.3						
22 Aug 2022	Sunny	0.6	93.3	14:25	57.8	61.0	48.3	58.1	73.6	<Baseline Level	75	N/A	Traffic
				14:30	56.9	60.1	48.0						
				14:35	58.3	61.5	48.8						
				14:40	58.4	61.4	48.9						
				14:45	57.6	60.8	47.6						
				14:50	59.3	62.3	47.9						



Noise Monitoring Result

Day Time (0700 - 1900hrs on normal weekdays)

Location: N14 - South Lantau Community Centre

Date	Weather	Wind Speed	Calibration Check	Time	Measurement Noise Level			Average Noise Level	Baseline Level	Construction Noise Level	Action Level	Major Construction Noise	Other Noise Source(s)
					Leq	L10	L90	Leq	Leq	Leq	Leq		
					Unit: dB(A), (5-min)			Unit: dB(A), (30-min)					
4 Aug 2022	Cloudy	0.5	93.3	13:10	54.3	57.1	52.2	56.4	62.2	<Baseline Level	75	Trial pit	Traffic
				13:15	51.2	53.2	49.8						
				13:20	53.3	56.0	50.3						
				13:25	57.9	60.0	55.7						
				13:30	60.2	62.8	57.2						
				13:35	55.6	58.8	51.0						
11 Aug 2022	Cloudy	0.7	93.3	10:30	51.3	54.6	49.3	54.7	62.2	<Baseline Level	75	N/A	Traffic
				10:35	54.6	57.5	51.3						
				10:40	55.9	58.6	52.3						
				10:45	53.3	56.9	51.2						
				10:50	56.8	59.8	52.9						
				10:55	54.3	57.0	50.8						
16 Aug 2022	Sunny	0.6	93.3	13:40	51.6	54.4	48.7	52.5	62.2	<Baseline Level	75	N/A	Traffic
				13:45	52.1	54.8	49.0						
				13:50	52.2	55.0	49.6						
				13:55	54.8	57.3	51.8						
				14:00	51.3	54.0	48.5						
				14:05	51.8	54.6	48.5						
22 Aug 2022	Sunny	0.3	93.3	13:40	55.3	58.6	48.6	59.0	62.2	<Baseline Level	75	N/A	Traffic
				13:45	56.8	59.7	49.3						
				13:50	60.4	63.6	53.5						
				13:55	62.3	65.5	55.7						
				14:00	55.6	58.6	48.5						
				14:05	58.9	61.3	47.6						



Noise Monitoring Result

Day Time (0700 - 1900hrs on normal weekdays)

Location: N16a - Light pole in front of House E, Southern Comfort, Ham Tin

Date	Weather	Wind Speed	Calibration Check	Time	Measurement Noise Level			Average Noise Level	Baseline Level	Construction Noise Level	Action Level	Major Construction Noise Source(s)	Other Noise Source(s)
					Leq	L10	L90						
					Unit: dB(A), (5-min)								
4 Aug 2022	Cloudy	1.3	93.3	10:55	57.7	60.1	50.1	56.2	68.1	<Baseline Level	75	Sheetpiling	Traffic
				11:00	56.6	59.6	49.8						
				11:05	54.4	58.0	47.3						
				11:10	57.3	59.9	48.6						
				11:15	56.2	58.7	47.8						
				11:20	53.0	56.1	46.9						
8 Aug 2022	Cloudy	0.0	93.3	15:00	58.8	61.3	49.6	57.1	68.1	<Baseline Level	75	Sheetpiling	Traffic
				15:05	56.0	59.3	50.2						
				15:10	55.5	56.3	53.6						
				15:15	58.1	59.0	53.9						
				15:20	57.2	58.3	53.6						
				15:25	56.0	58.9	52.8						
16 Aug 2022	Sunny	0.7	93.3	10:30	55.7	58.1	49.8	60.9	68.1	<Baseline Level	75	N/A	Traffic
				10:35	58.2	60.4	52.3						
				10:40	63.7	66.0	57.8						
				10:45	63.1	65.3	57.5						
				10:50	59.8	62.2	54.3						
				10:55	59.7	61.8	54.0						
22 Aug 2022	Sunny	0.4	93.3	10:30	60.3	63.5	52.3	63.2	68.1	<Baseline Level	75	N/A	Traffic
				10:35	62.8	65.9	52.6						
				10:40	64.5	67.6	53.4						
				10:45	61.3	64.3	51.9						
				10:50	65.1	68.2	53.8						
				10:55	63.2	66.5	52.6						



Noise Monitoring Result

Day Time (0700 - 1900hrs on normal weekdays)

Location: N16b - Fence in front of 7E Ham Tin San Tsuen, Ham Tin

Date	Weather	Wind Speed	Calibration Check	Time	Measurement Noise Level			Average Noise Level	Baseline Level	Construction Noise Level	Action Level	Major Construction Noise	Other Noise Source(s)
					Leq	L10	L90						
					Unit: dB(A), (5-min)								
4 Aug 2022	Cloudy	1.8	93.3	11:30	51.8	54.7	48.3	53.4	68.5	<Baseline Level	75	N/A	Traffic
				11:35	53.4	56.5	50.4						
				11:40	52.1	56.6	49.3						
				11:45	55.6	58.4	51.3						
				11:50	54.2	57.3	50.1						
				11:55	51.8	54.2	47.6						
8 Aug 2022	Cloudy	0.2	93.3	15:42	48.0	49.5	45.3	50.1	68.5	<Baseline Level	75	N/A	Traffic
				15:47	49.9	52.8	45.3						
				15:52	48.8	51.8	43.9						
				15:57	48.5	51.6	44.0						
				16:02	51.1	53.5	45.5						
				16:07	52.4	54.0	45.8						
16 Aug 2022	Sunny	0.8	93.3	11:15	49.0	51.1	46.0	48.8	68.5	<Baseline Level	75	N/A	Traffic
				11:20	47.3	49.2	44.0						
				11:25	49.2	51.1	45.3						
				11:30	50.3	51.8	47.8						
				11:35	48.8	49.6	45.9						
				11:40	47.6	49.2	44.8						
22 Aug 2022	Sunny	0.0	93.3	11:15	48.9	51.3	46.6	48.5	68.5	<Baseline Level	75	N/A	Traffic
				11:20	47.6	50.6	45.9						
				11:25	49.3	51.5	47.1						
				11:30	49.4	51.6	47.0						
				11:35	47.5	49.9	46.2						
				11:40	48.2	50.5	46.1						



Noise Monitoring Result

Day Time (0700 - 1900hrs on normal weekdays)

Location: N17 - Bui O Public School

Date	Weather	Wind Speed	Calibration Check	Time	Measurement Noise Level			Average Noise Level	Baseline Level	Construction Noise Level	Limit Level	Major Construction Noise Source(s)	Other Noise Source(s)
					Leq	L10	L90						
					Unit: dB(A), (5-min)			Unit: dB(A), (30-min)					
4 Aug 2022	Cloudy	0.5	93.3	13:50	45.2	47.6	44.0	46.5	62.3	<Baseline Level	70	N/A	Traffic
				13:55	46.3	48.8	43.6						
				14:00	47.2	49.9	45.3						
				14:05	44.9	47.5	43.1						
				14:10	48.0	50.1	45.1						
11 Aug 2022	Cloudy	0.6	93.3	13:00	46.2	47.9	43.3	48.0	62.3	<Baseline Level	70	N/A	Traffic
				13:05	48.7	52.0	44.0						
				13:10	49.3	51.6	45.4						
				13:15	47.7	59.5	43.5						
				13:20	46.9	49.3	44.6						
16 Aug 2022	Sunny	0.7	93.3	13:25	48.2	50.9	43.5	51.5	62.3	<Baseline Level	70	N/A	Traffic
				13:00	51.0	53.7	47.5						
				13:05	51.7	52.7	48.1						
				13:10	51.1	52.5	49.1						
				13:15	51.6	52.9	48.7						
22 Aug 2022	Sunny	0.5	93.3	13:20	52.0	53.9	49.3	49.5	62.3	<Baseline Level	70	N/A	Traffic
				13:25	51.7	52.3	48.0						
				13:00	50.2	53.3	46.7						
				13:05	50.3	52.2	47.5						
				13:10	48.4	50.1	46.4						






Appendix 4.4

Marine Water Quality Monitoring Results and Graphical Presentations






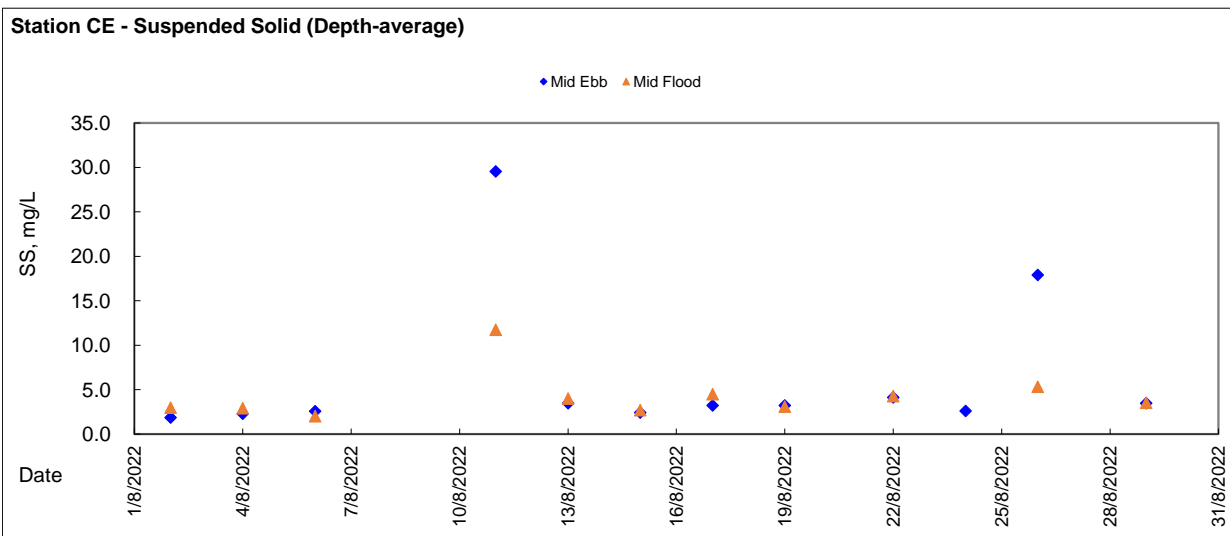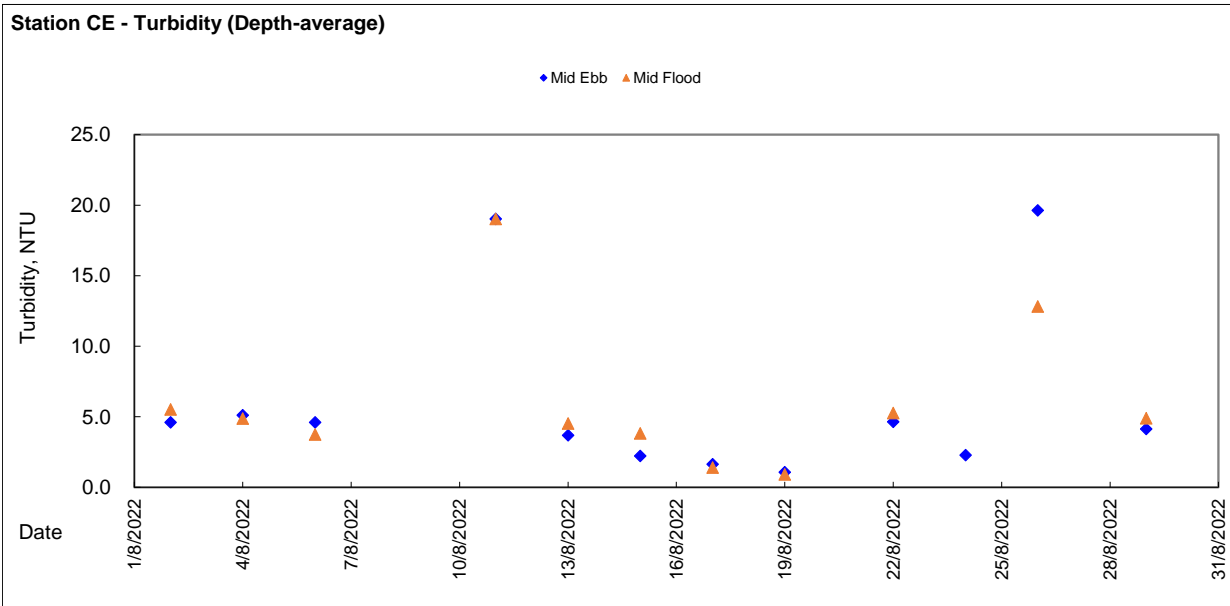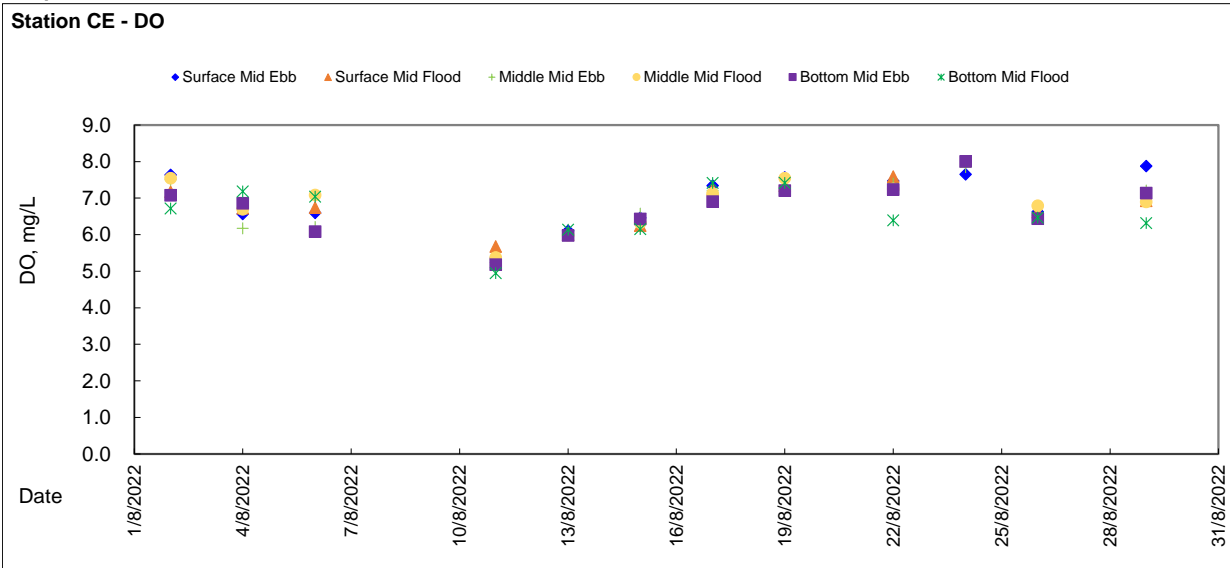Graphic Presentation of WQM Result








Graphic Presentation of WQM Result

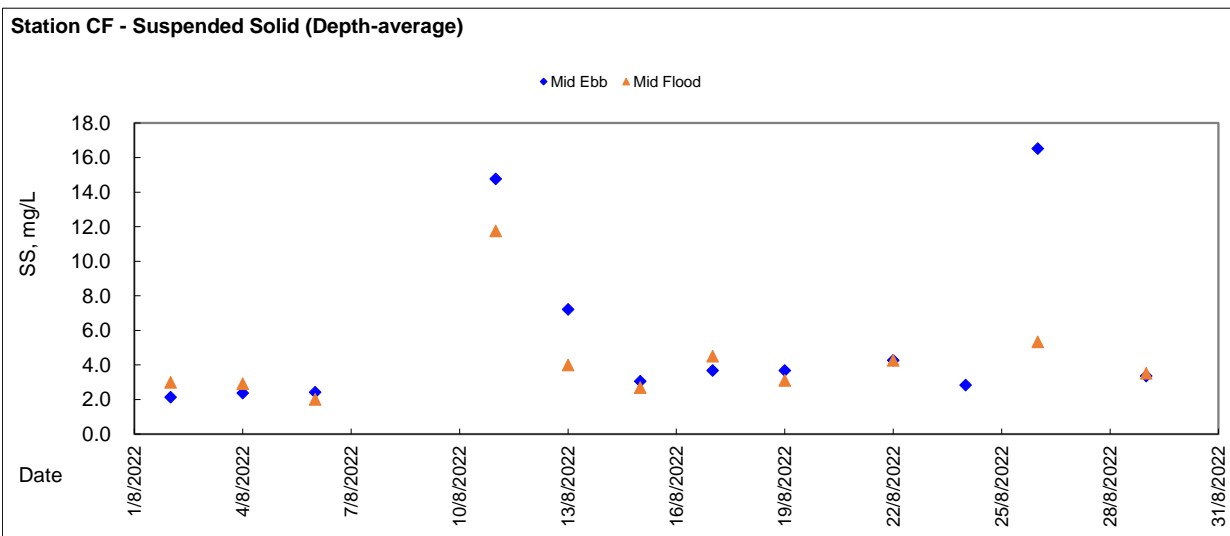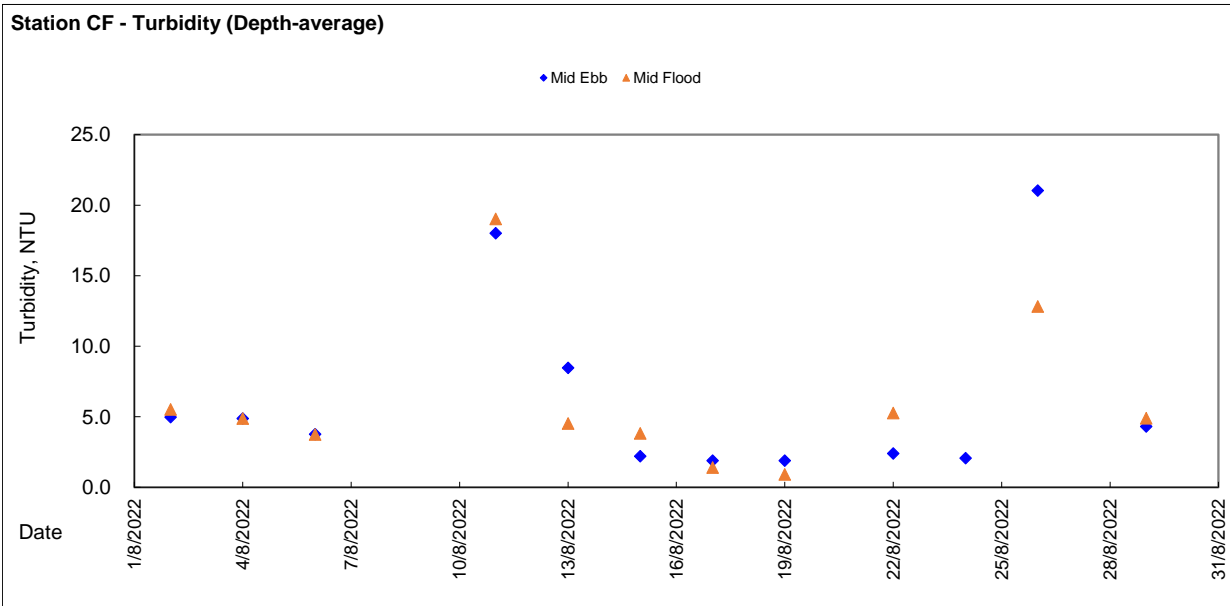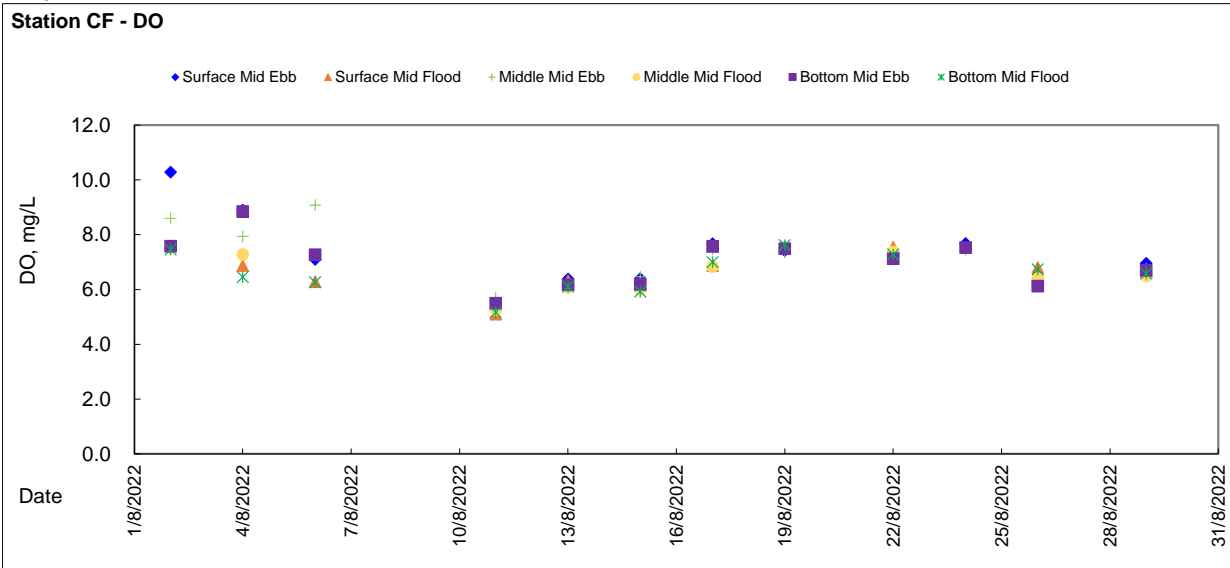






Graphic Presentation of WQM Result

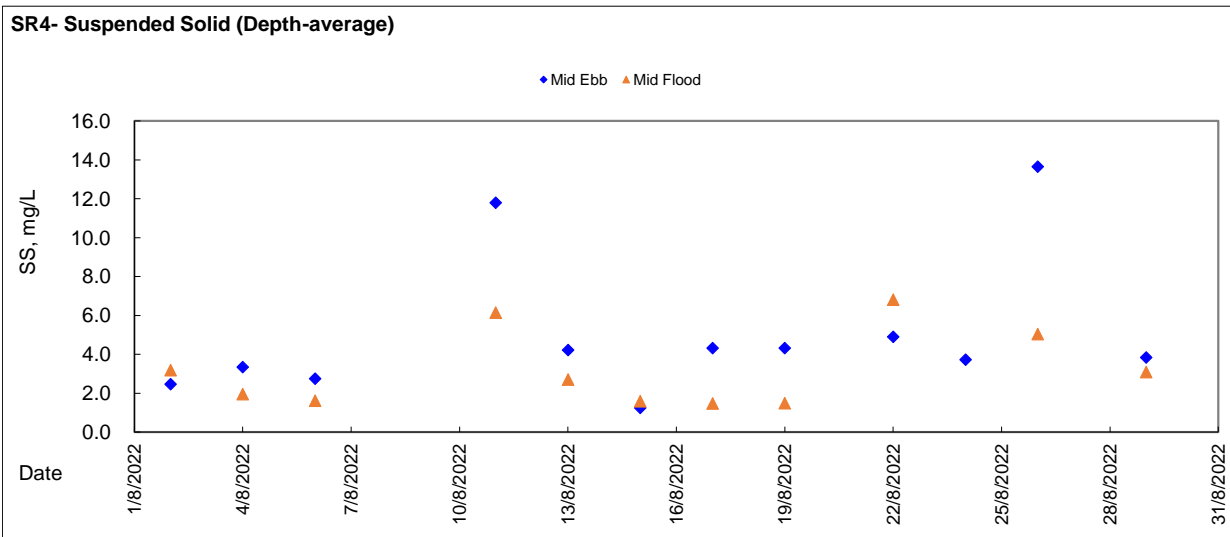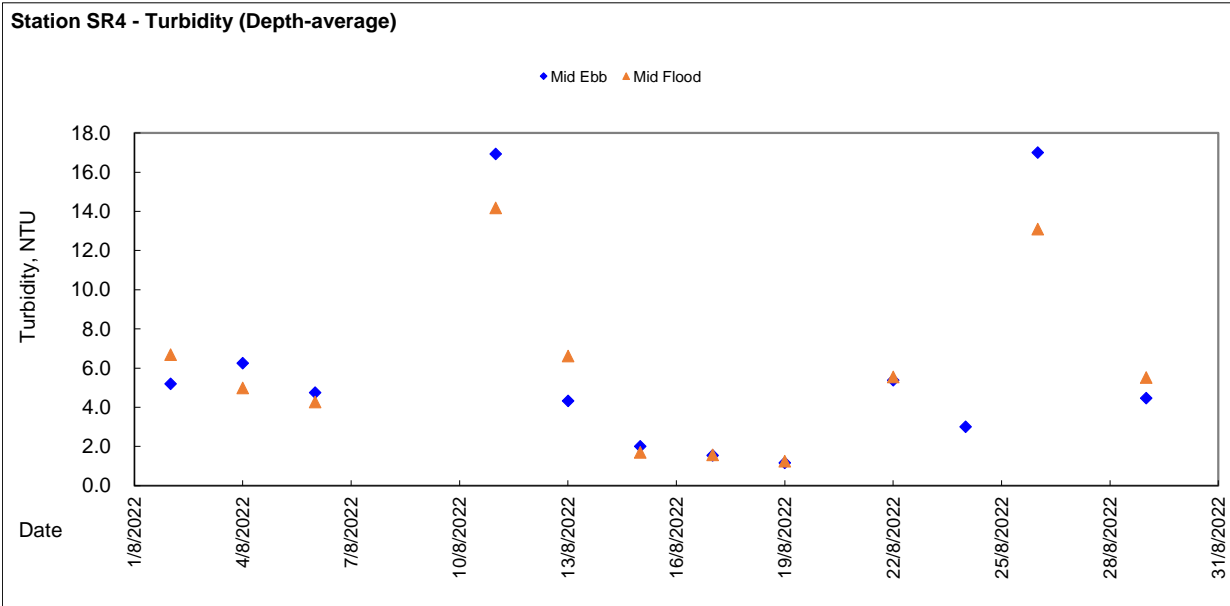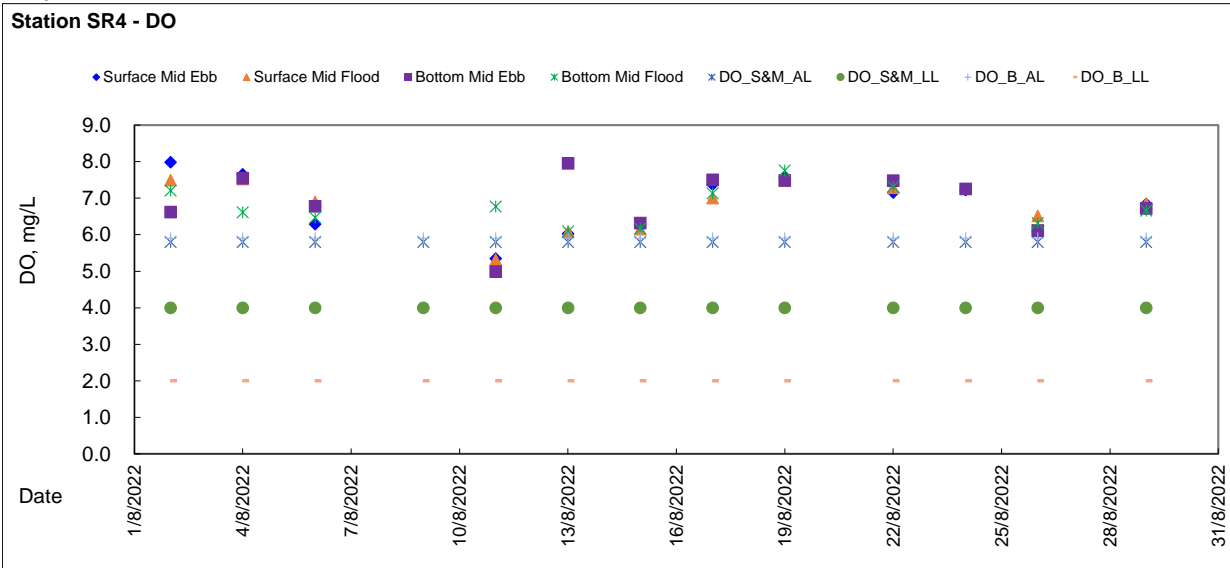






Graphic Presentation of WQM Result

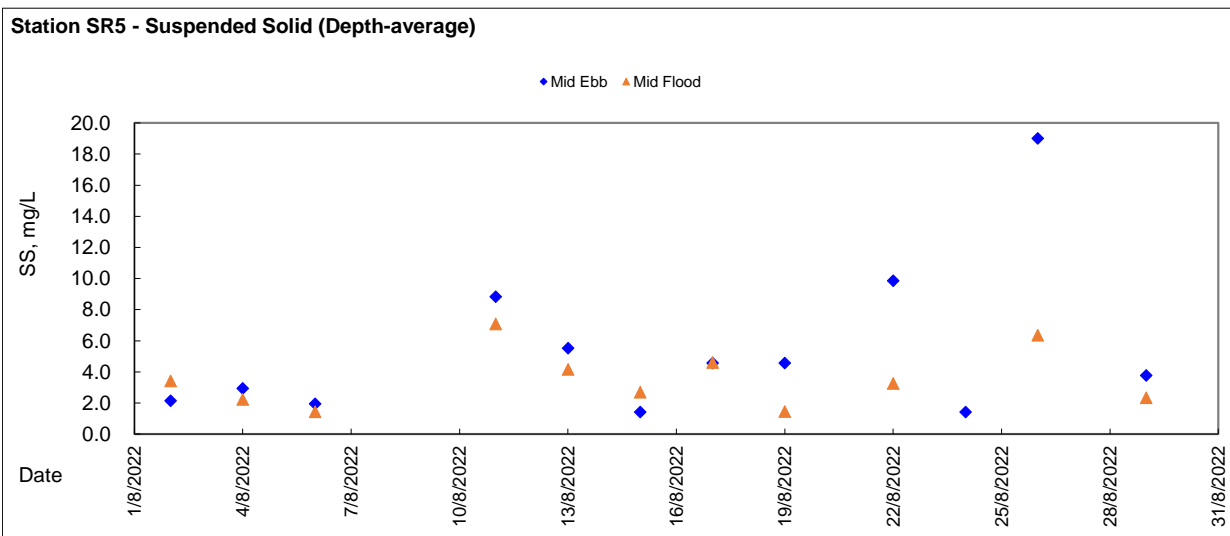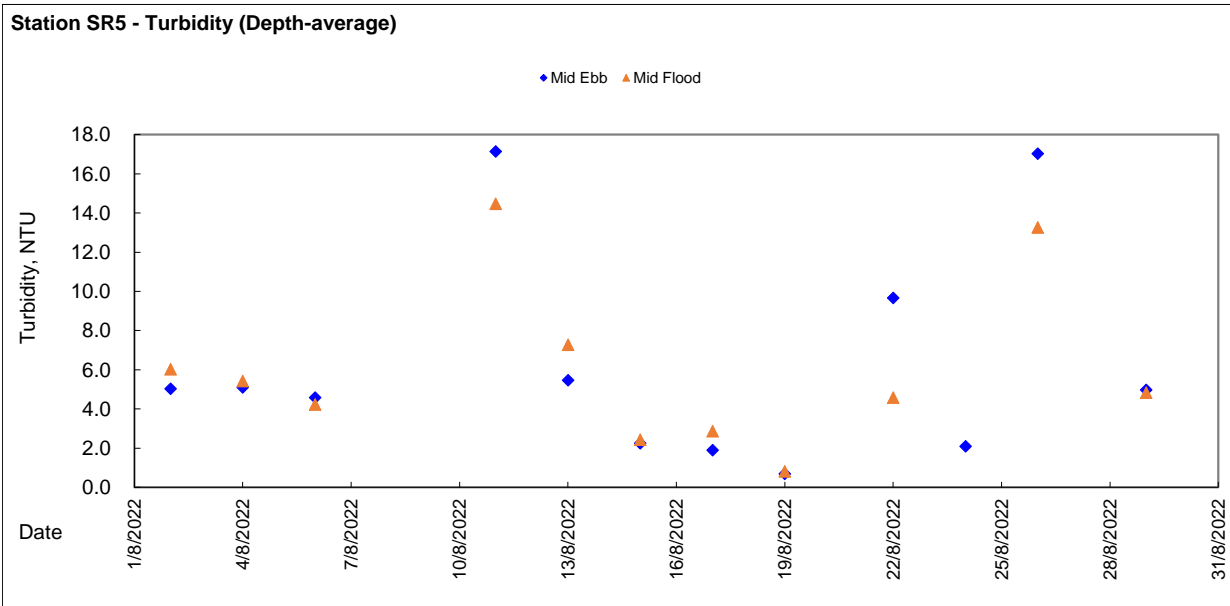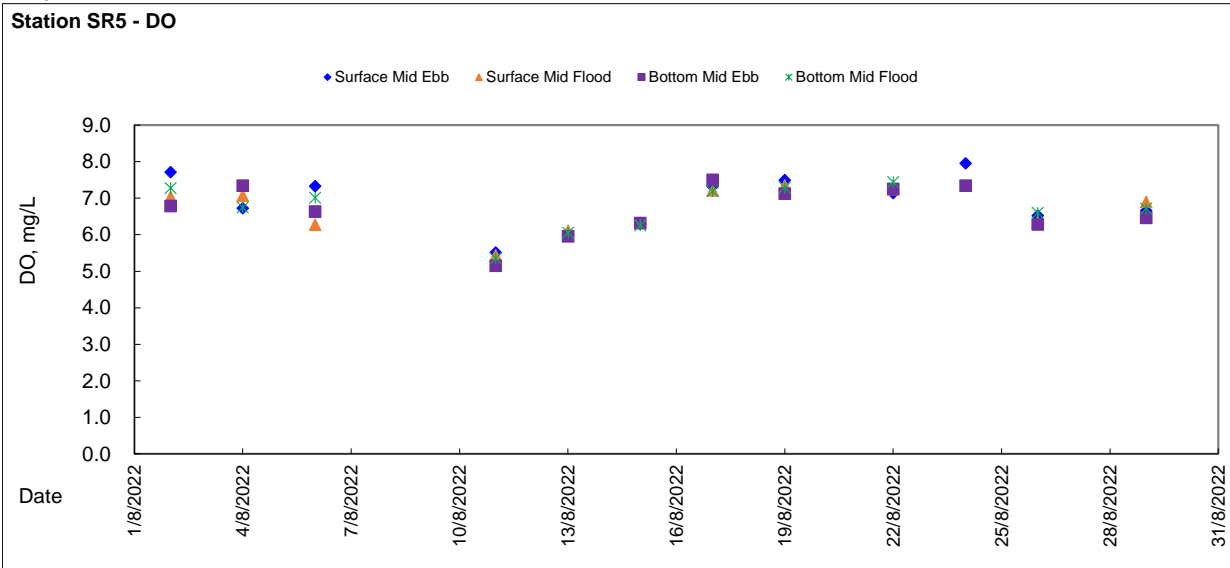






Graphic Presentation of WQM Result

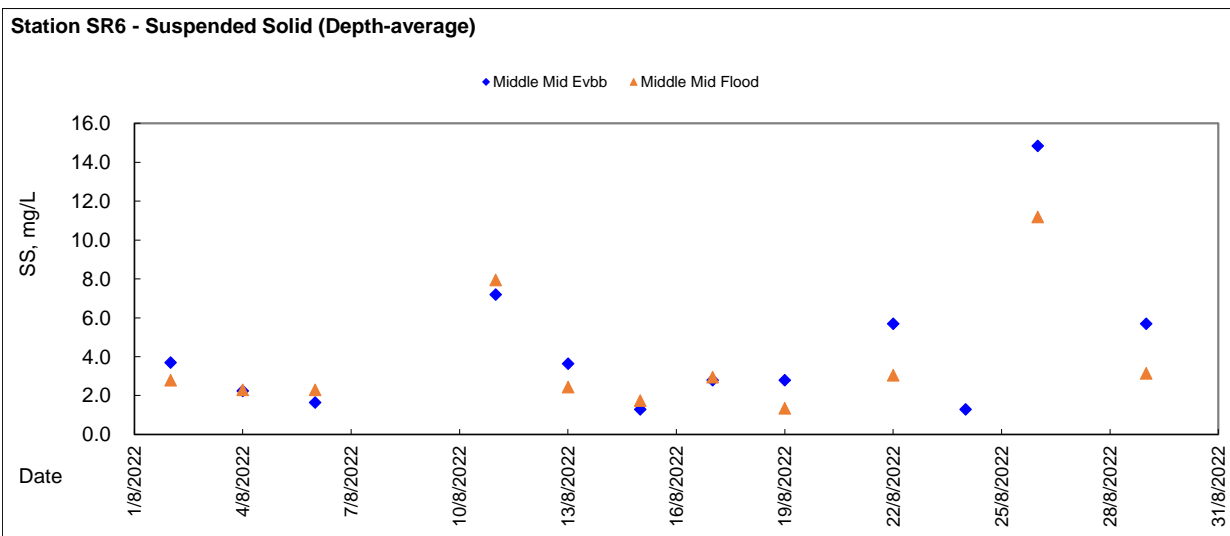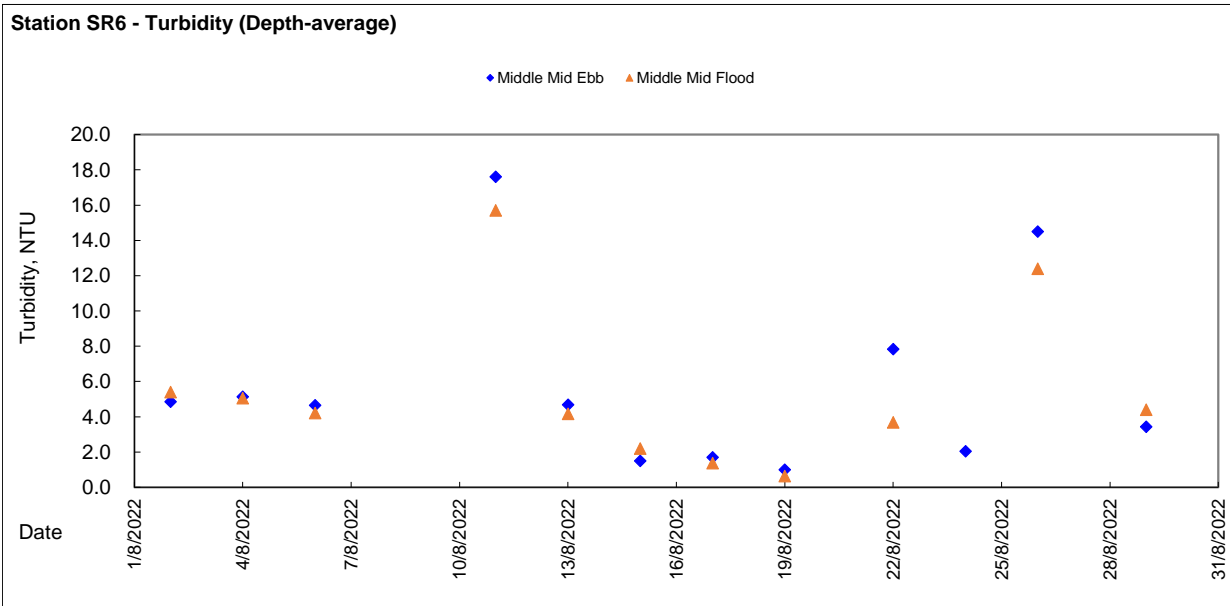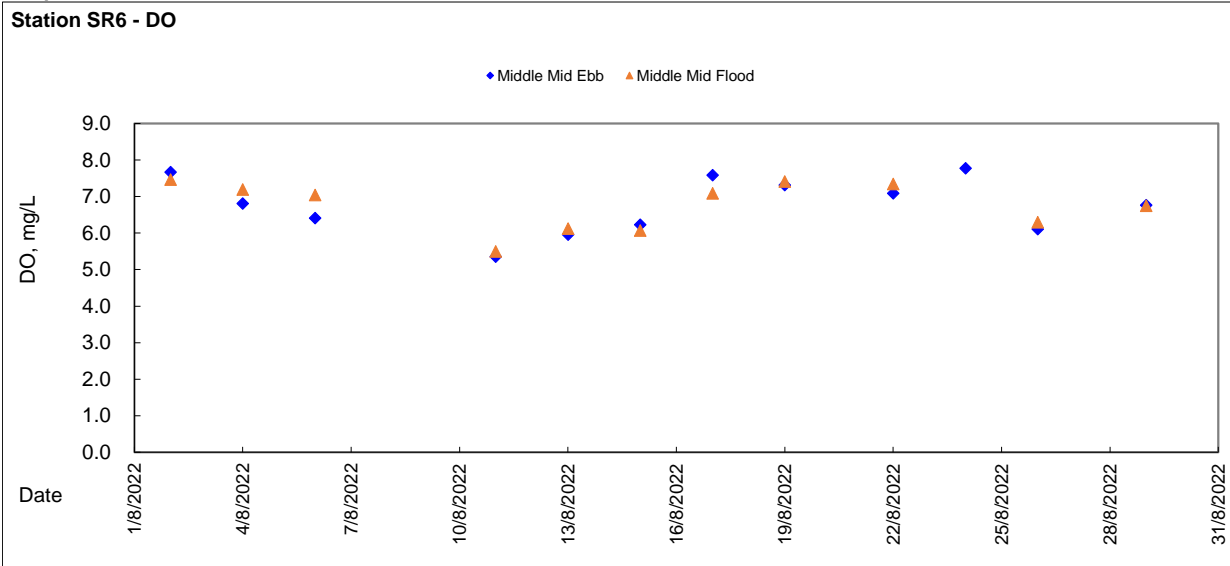






Graphic Presentation of WQM Result

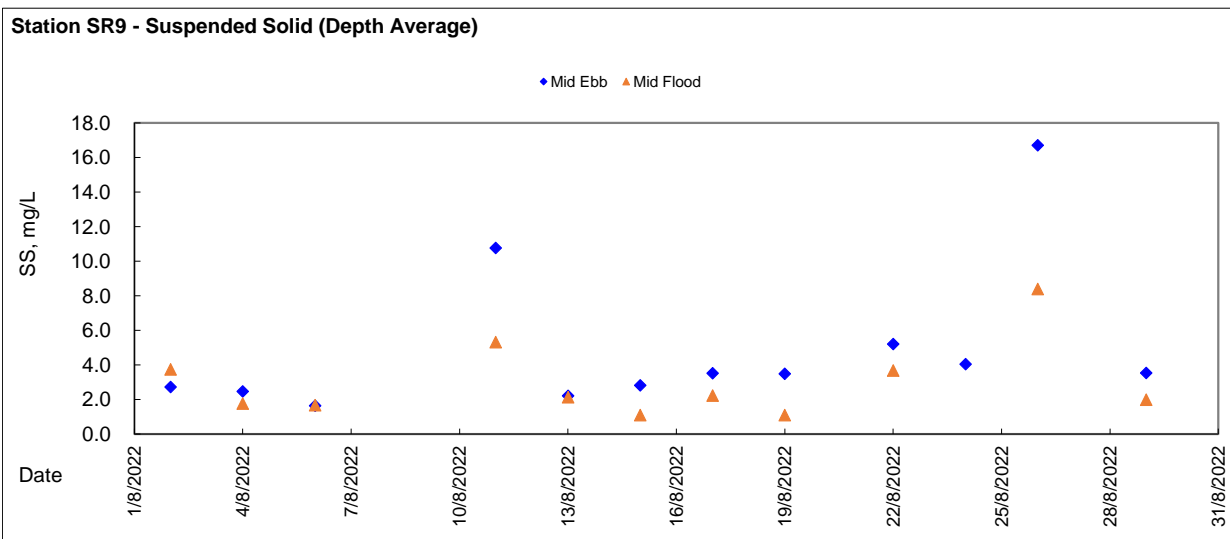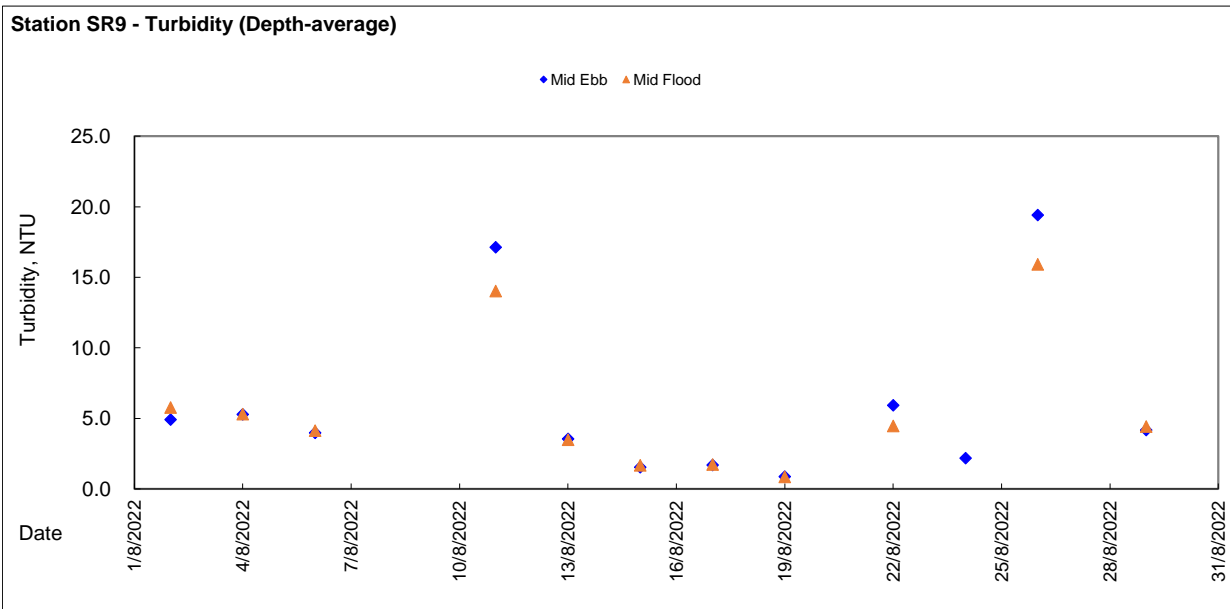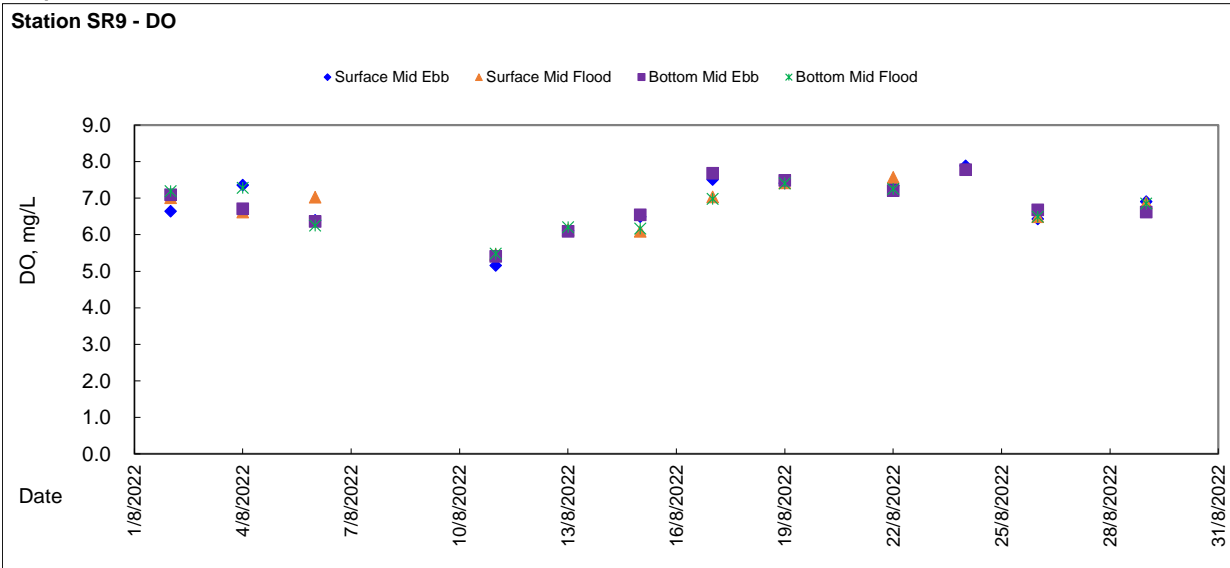






Graphic Presentation of WQM Result

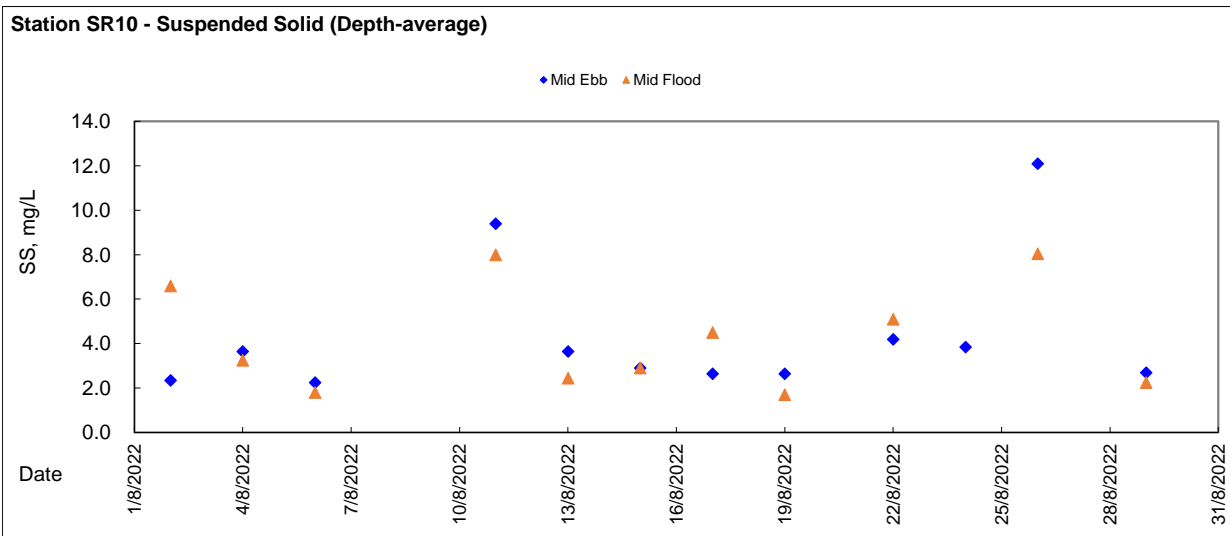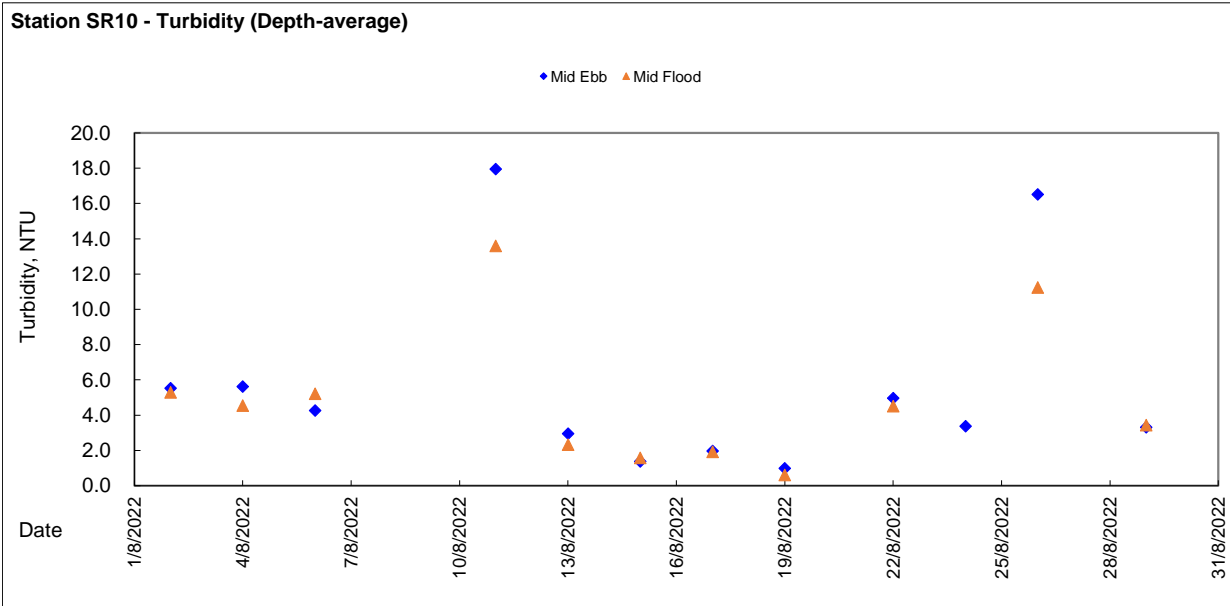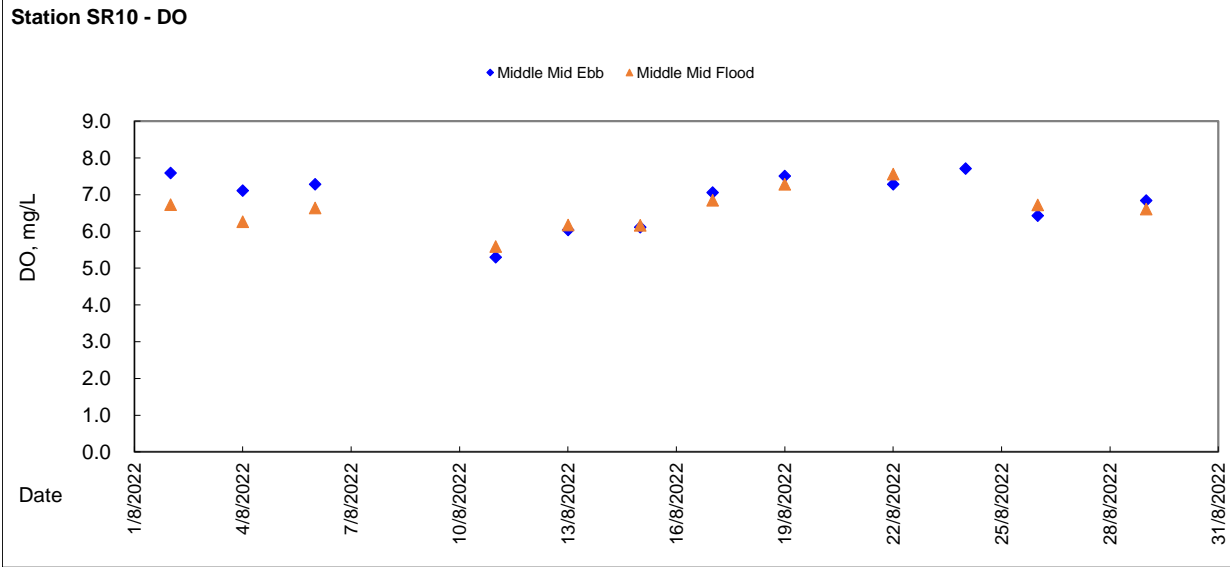






Graphic Presentation of WQM Result

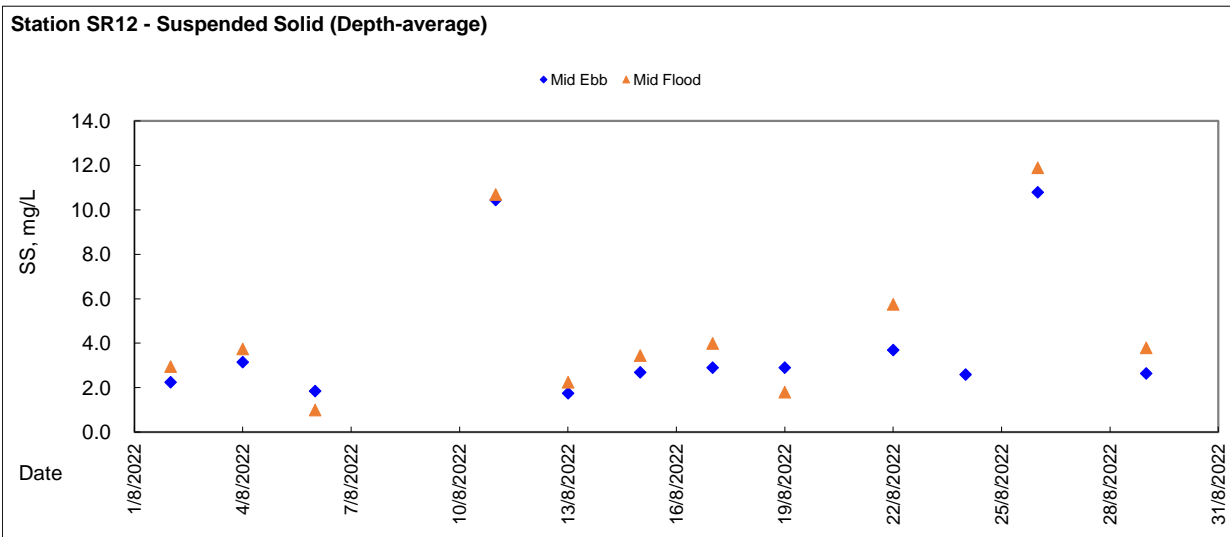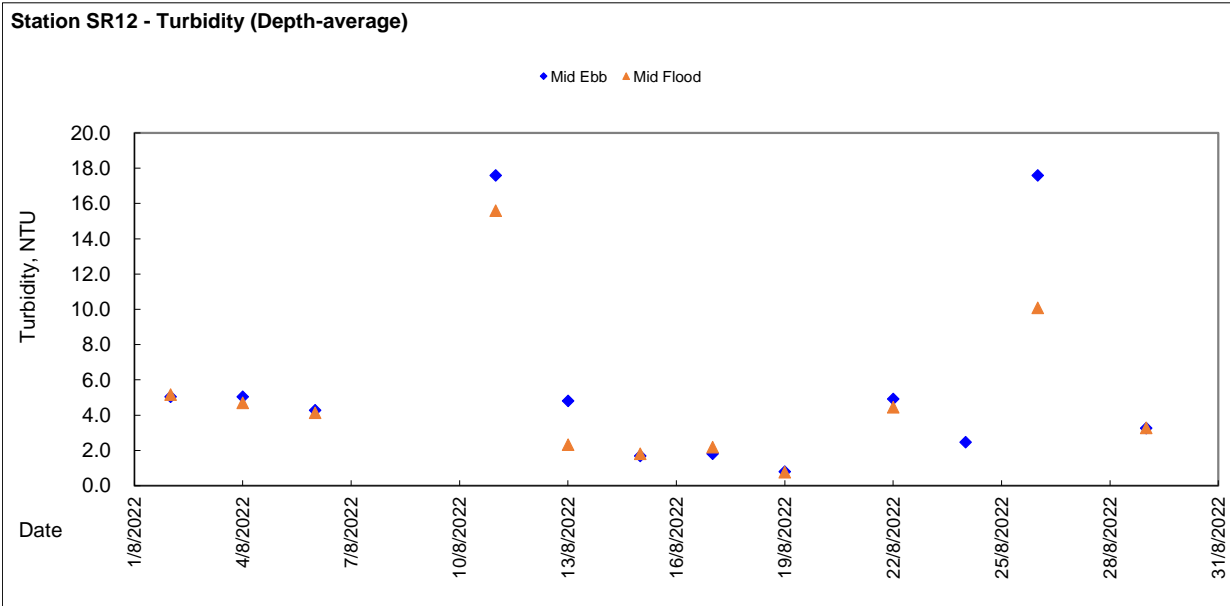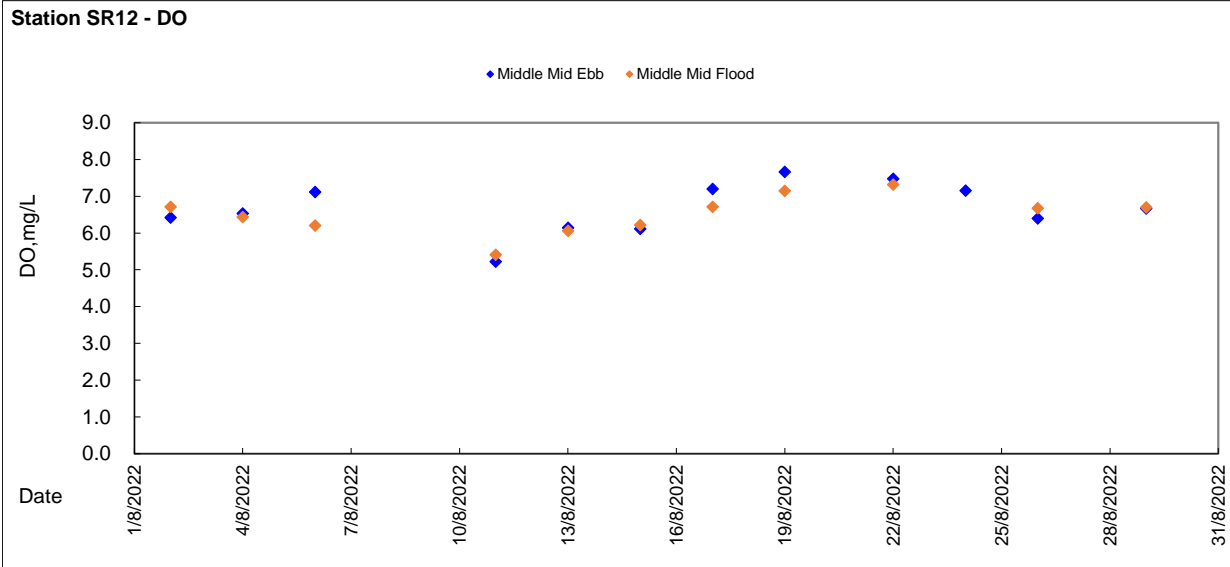



Graphic Presentation of WQM Result

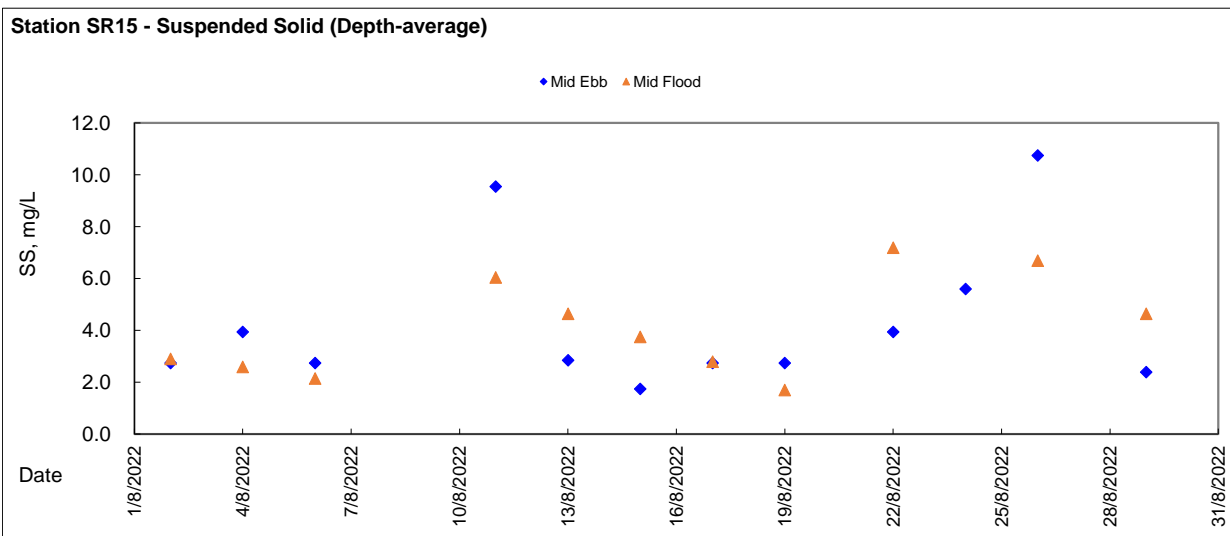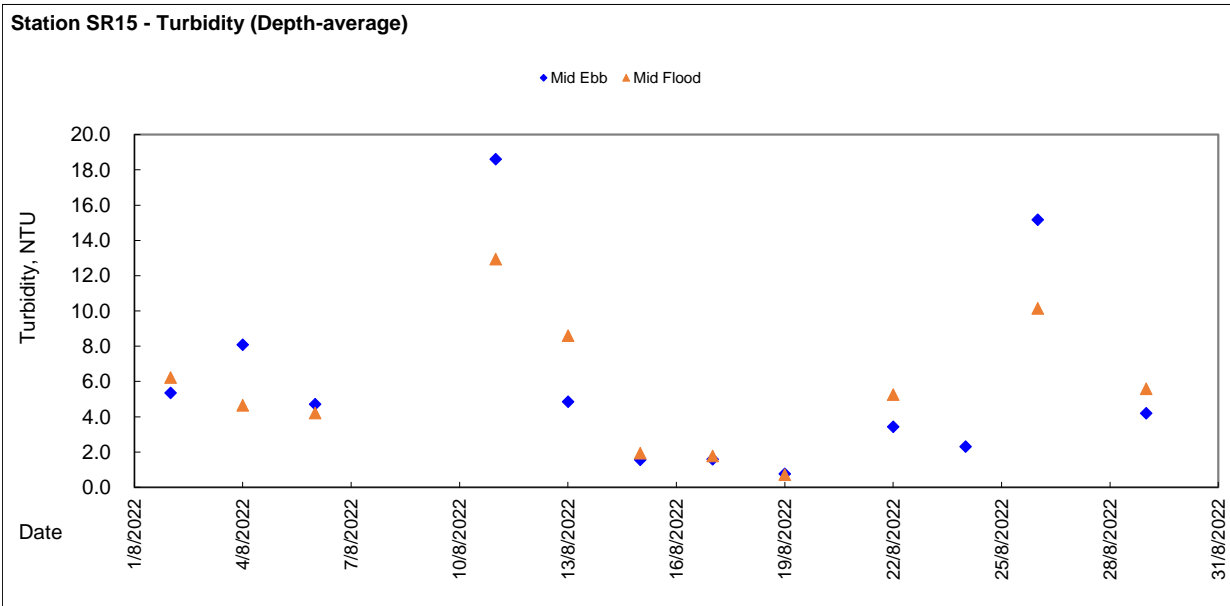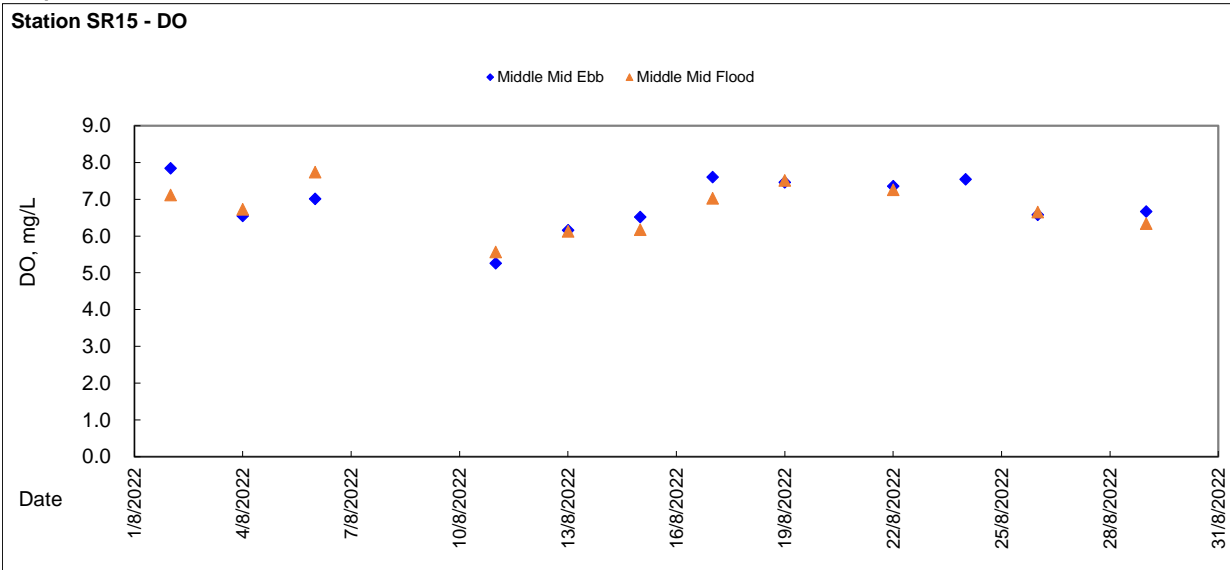



Impact Water Quality Monitoring at Station SR4 (surface) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						2/8/2022	Sunny	9:14	3.7	1.0	29.34	29.38	9.23	9.23	25.84	26.09	121.40	120.68	8.05	7.99	6.45
4/8/2022	Rainy	9:15	3.7	1.0	29.42	28.06	9.22	9.20	26.34	25.60	119.96	121.90	7.92	8.26	5.03	6.20	2.5	2.8			
		10:27	3.7	1.0	28.05	28.05	9.70	9.69	25.68	25.64	104.00	104.00	7.05	7.05	4.64	4.64	2.6	2.6			
6/8/2022	Cloudy	9:12	3.3	1.0	28.19	28.21	9.49	9.38	25.70	25.37	93.80	92.95	6.34	6.29	4.08	4.07	2.4	2.5			
		9:13	3.3	1.0	28.22	28.22	9.27	9.27	25.04	25.04	92.10	92.10	6.23	6.23	4.06	4.06	2.6	2.6			
9/8/2022	T3	Sampling was cancelled due to adverse weather																			
11/8/2022	Rainy	9:45	2.8	1.0	27.00	27.00	8.33	8.27	29.25	29.27	84.20	81.70	5.52	5.35	17.77	17.80	13.6	13.8			
		9:46	2.8	1.0	27.00	27.00	8.21	8.21	29.28	29.28	79.20	79.20	5.17	5.17	17.82	17.82	14.0	14.0			
13/8/2022	Sunny	9:35	4.0	1.0	27.40	27.35	8.03	8.04	30.08	30.03	86.60	87.20	6.05	6.03	3.58	3.42	5.7	5.5			
		9:36	4.0	1.0	27.30	27.30	8.04	8.04	29.98	29.98	87.80	87.80	6.00	6.00	3.26	3.26	5.2	5.2			
15/8/2022	Sunny	12:45	4.2	1.0	29.40	29.50	8.15	8.16	28.60	28.63	95.30	94.50	6.37	6.30	1.72	1.70	1.6	1.5			
		12:46	4.2	1.0	29.60	29.50	8.16	8.16	28.66	28.66	93.70	93.70	6.22	6.22	1.68	1.68	1.4	1.4			
17/8/2022	Cloudy	12:55	3.7	1.0	29.50	29.50	8.46	8.47	28.89	28.89	111.20	112.40	7.30	7.49	1.72	1.67	4.6	4.8			
		12:56	3.7	1.0	29.50	29.50	8.47	8.47	28.89	28.89	113.60	113.60	7.49	7.38	1.62	1.62	5.0	5.0			
19/8/2022	Cloudy	12:54	3.5	1.0	28.60	29.65	8.48	8.48	28.86	28.87	115.10	116.35	7.57	7.57	0.73	0.76	4.6	4.8			
		12:55	3.5	1.0	29.70	29.65	8.48	8.48	28.87	28.87	117.60	117.60	7.56	7.56	0.79	0.79	5.0	5.0			
22/8/2022	Sunny	9:03	3.4	1.0	29.30	29.30	8.20	8.22	28.61	28.46	109.80	109.20	7.22	7.16	4.85	4.74	4.4	4.2			
		9:04	3.4	1.0	29.30	29.30	8.23	8.23	28.30	28.30	108.60	108.60	7.09	7.09	4.63	4.63	4.0	4.0			
24/8/2022	Cloudy	9:00	3.7	1.0	30.50	30.50	8.28	8.28	28.15	28.27	111.10	111.05	7.23	7.22	3.29	3.27	4.8	4.7			
		9:01	3.7	1.0	30.50	30.50	8.28	8.28	28.38	28.38	111.00	111.00	7.21	7.21	3.25	3.25	4.6	4.6			
26/8/2022	Cloudy	9:05	3.8	1.0	28.00	28.05	7.91	7.92	30.33	30.32	87.70	87.20	6.08	6.08	17.59	17.59	12.8	12.6			
		9:06	3.8	1.0	28.10	28.05	7.92	7.92	30.31	30.31	86.70	86.70	6.07	6.07	17.59	17.59	12.4	12.4			
29/8/2022	Sunny	9:48	3.6	1.0	29.30	29.30	8.17	8.19	29.69	29.70	103.80	103.20	6.91	6.84	4.42	4.40	3.1	3.3			
		9:49	3.6	1.0	29.30	29.30	8.20	8.20	29.71	29.71	102.60	102.60	6.76	6.76	4.37	4.37	3.5	3.5			
29/8/2022	Sunny	12:52	0.0	1.0	30.00	30.05	8.29	8.32	29.75	29.74	113.70	112.85	7.34	7.29	2.60	2.64	-	-			
		12:53	0.0	1.0	30.10	30.05	8.35	8.35	29.72	29.72	112.00	112.00	7.23	7.23	2.68	2.68	-	-			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR4 (surface) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						2/8/2022	Sunny	12:51	4.0	1.0	29.97	29.94	9.43	9.38	26.04	26.18	116.20	114.35	7.62	7.50	6.84
4/8/2022	Rainy	12:52	4.0	1.0	29.91	28.35	9.33	9.85	26.32	25.47	112.50	111.50	7.37	7.53	6.17	5.01	2.8	2.7			
		12:53	3.8	1.0	28.33	28.35	9.83	9.85	25.70	25.59	113.70	111.50	7.68	7.53	5.42	5.01	2.5	2.7			
6/8/2022	Cloudy	12:51	3.4	1.0	28.23	28.24	9.18	9.15	23.91	23.98	89.00	101.10	6.07	6.90	4.29	4.23	2.2	2.2			
		12:52	3.4	1.0	28.24	28.24	9.12	9.12	24.05	24.05	113.20	113.20	7.72	7.72	4.16	4.16	2.2	2.2			
9/8/2022	T3	Sampling was cancelled due to adverse weather																			
11/8/2022	Rainy	12:52	3.6	1.0	27.10	27.05	8.25	8.26	29.40	29.35	77.60	78.05	5.28	5.32	12.77	12.74	7.9	7.8			
		12:53	3.6	1.0	27.00	27.05	8.26	8.26	29.29	29.35	78.50	78.50	5.35	5.35	12.71	12.71	7.6	7.6			
13/8/2022	Sunny	12:46	3.8	1.0	28.20	28.15	8.15	8.15	29.95	29.96	88.10	89.25	6.00	6.08	7.71	7.90	5.2	5.0			
		12:47	3.8	1.0	28.10	28.15	8.15	8.15	29.96	29.96	90.40	90.40	6.15	6.15	8.08	8.08	4.8	4.8			
15/8/2022	Sunny	9:03	3.9	1.0	28.50	28.50	7.95	7.96	28.86	28.88	91.10	91.55	6.17	6.15	1.63	1.64	2.5	2.7			
		9:04	3.9	1.0	28.50	28.50	7.96	7.96	28.89	28.88	92.00	92.00	6.13	6.13	1.65	1.65	2.8	2.8			
17/8/2022	Cloudy	9:07	3.4	1.0	28.60	28.65	8.14	8.15	28.93	28.91	102.30	104.25	6.90	7.00	1.50	1.57	1.6	1.7			
		9:08	3.4	1.0	28.70	28.65	8.15	8.15	28.89	28.91	106.20	106.20	7.10	7.10	1.63	1.63	1.8	1.8			
19/8/2022	Cloudy	9:14	3.3	1.0	29.60	29.55	8.34	8.33	29.00	29.05	115.10	113.35	7.62	7.48	1.93	1.44	1.9	1.8			
		9:15	3.3	1.0	29.50	29.55	8.31	8.31	29.09	29.09	111.60	111.60	7.34	7.34	0.94	0.94	1.7	1.7			
22/8/2022	Sunny	12:53	3.2	1.0	30.60	30.60	8.44	8.45	28.20	28.20	113.90	112.50	7.37	7.29	4.73	4.79	5.5	5.7			
		12:54	3.2	1.0	30.60	30.60	8.45	8.45	28.20	28.20	111.10	111.10	7.20	7.20	4.85	4.85	5.8	5.8			
24/8/2022	T3	Sampling was cancelled due to adverse weather																			
26/8/2022	Cloudy	12:55	3.6	1.0	28.50	28.55	8.06	8.08	30.17	30.17	99.20	96.75	6.72	6.52	10.62	10.61	5.3	5.5			
		12:56	3.6	1.0	28.60	28.55	8.09	8.09	30.17	30.17	94.30	94.30	6.31	6.31	10.59	10.59	5.7	5.7			
29/8/2022	Sunny	8:58	3.6	1.0	28.70	28.70	7.83	7.84	29.84	29.84	98.40	99.75	6.75	6.85	5.81	5.81	5.6	5.4			
		9:00	3.6	1.0	28.70	28.70	7.85	7.85	29.83	29.83	101.10	101.10	6.95	6.95	5.80	5.80	5.2	5.2			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR4 (Bottom) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
SR4	2/8/2022	Sunny	9:16	3.7	2.7	29.44	29.47	9.23	9.25	26.38	26.37	101.70	100.35	6.71	6.62	4.55	4.66	2.4	2.3		
			9:17	3.7	2.7	29.50	29.47	9.27	9.25	26.35	26.37	99.00	100.35	6.53	6.62	4.76	4.66	2.1	2.3		
	4/8/2022	Rainy	10:28	3.7	2.7	27.99	27.96	9.71	9.70	25.67	25.73	119.50	111.20	8.11	7.55	7.26	7.08	4.1	4.0		
			10:29	3.7	2.7	27.92	27.96	9.69	9.70	25.79	25.73	102.90	111.20	6.98	7.55	6.80	7.08	3.8	4.0		
	6/8/2022	Cloudy	9:14	3.3	2.3	28.24	28.24	9.59	9.49	25.67	25.76	109.90	100.30	7.43	6.78	5.81	5.41	2.9	3.0		
			9:15	3.3	2.3	28.23	28.24	9.39	9.49	25.84	25.76	90.70	100.30	6.13	6.78	5.00	5.41	3.1	3.0		
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	9:46	2.8	1.8	26.80	26.80	8.23	8.24	29.26	29.27	76.50	74.80	5.11	5.00	16.05	16.07	9.6	9.8		
			9:47	2.8	1.8	26.80	26.80	8.24	8.24	29.28	29.27	73.10	74.80	4.88	5.00	16.08	16.07	10.0	9.8		
	13/8/2022	Sunny	9:38	4.0	3.0	27.40	27.45	8.05	8.06	30.20	30.17	84.00	84.95	5.94	7.96	5.52	5.24	2.8	3.0		
			9:39	4.0	3.0	27.50	27.45	8.07	8.06	30.13	30.17	85.90	84.95	9.97	7.96	4.95	5.24	3.2	3.0		
	15/8/2022	Sunny	12:48	3.7	3.2	28.60	28.60	8.17	8.18	29.24	29.23	94.50	94.75	6.29	6.32	2.20	2.30	<1.0	1.0		
			12:49	4.2	3.2	28.60	28.60	8.19	8.18	29.21	29.23	95.00	94.75	6.35	6.32	2.40	2.30	<1.0	1.0		
	17/8/2022	Cloudy	12:57	3.7	2.7	29.50	29.45	8.48	8.48	28.86	28.88	115.70	115.30	7.55	7.50	1.35	1.42	3.8	3.9		
			12:58	3.7	2.7	29.40	29.45	8.49	8.48	28.90	28.88	114.90	115.30	7.49	7.50	1.49	1.42	3.5	3.9		
	19/8/2022	Cloudy	12:56	3.5	2.5	29.30	29.25	8.47	8.47	29.09	29.09	115.10	116.35	7.55	7.49	1.49	1.56	3.8	3.9		
			12:57	3.5	2.5	29.20	29.25	8.46	8.47	29.09	29.09	117.60	116.35	7.42	7.49	1.63	1.56	3.9	3.9		
	22/8/2022	Sunny	9:05	3.4	2.4	29.30	29.30	8.23	8.23	28.32	28.37	109.60	110.40	7.41	7.48	6.03	6.02	5.8	5.6		
			9:06	3.4	2.4	29.30	29.30	8.23	8.23	28.41	28.37	111.20	110.40	7.55	7.48	6.01	6.02	5.4	5.6		
	24/8/2022	Cloudy	9:02	3.7	2.7	30.90	30.90	8.32	8.34	27.42	27.41	110.30	110.90	7.20	7.26	2.73	2.73	2.6	2.8		
			9:03	3.7	2.7	30.90	30.90	8.35	8.34	27.40	27.41	111.50	110.90	7.31	7.26	2.73	2.73	2.9	2.8		
	26/8/2022	Cloudy	9:07	3.8	2.8	28.20	28.20	7.94	7.95	30.06	30.09	88.60	89.55	6.06	6.12	16.41	16.39	15.0	14.7		
			9:08	3.8	2.8	28.20	28.20	7.95	7.95	30.12	30.09	90.50	89.55	6.17	6.12	16.36	16.39	14.4	14.7		
	29/8/2022	Sunny	9:50	3.6	2.6	29.00	29.00	8.17	8.17	29.88	29.88	100.50	100.00	6.68	6.72	4.61	4.52	4.5	4.4		
			9:51	3.6	2.6	29.00	29.00	8.16	8.17	29.88	29.88	99.50	100.00	6.75	6.72	4.42	4.52	4.3	4.4		
	29/8/2022	Sunny	12:54	0.0	2.6	29.90	29.85	8.33	8.34	29.83	29.84	111.50	110.75	7.28	7.24	3.80	3.58	-	-		
			12:55	0.0	2.6	29.80	29.85	8.34	8.34	29.85	29.84	110.00	110.75	7.19	7.24	3.36	3.58	-	-		

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR4 (Bottom) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
SR4	2/8/2022	Sunny	12:54	4.0	3.0	29.82	29.83	9.42	9.36	26.35	26.36	112.60	109.95	7.39	7.21	6.92	6.52	2.8	3.0		
			12:55	4.0	3.0	29.83	29.83	9.29	9.36	26.36	26.36	107.30	109.95	7.03	7.21	6.11	6.52	3.1	3.0		
	4/8/2022	Rainy	12:54	3.8	2.8	28.36	28.35	9.92	9.86	25.67	25.69	100.80	97.95	6.80	6.61	5.31	4.96	3.4	3.3		
			12:55	3.8	2.8	28.34	28.35	9.79	9.86	25.70	25.69	95.10	97.95	6.42	6.61	4.61	4.96	3.1	3.3		
	6/8/2022	Cloudy	12:53	3.4	2.4	28.37	28.37	9.24	9.19	24.00	24.08	98.80	95.05	6.73	6.47	4.51	4.30	2.6	2.7		
			12:54	3.4	2.4	28.37	28.37	9.14	9.19	24.15	24.08	91.30	95.05	6.21	6.47	4.08	4.30	2.7	2.7		
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:54	3.6	2.6	28.80	28.80	8.27	8.27	28.77	29.55	75.10	76.45	8.18	6.77	15.59	15.60	10.9	10.7		
			12:55	3.6	2.6	28.80	28.80	8.27	8.27	29.32	29.55	77.80	76.45	5.36	6.77	15.60	15.60	10.5	10.7		
	13/8/2022	Sunny	12:48	3.8	2.8	27.60	27.55	8.16	8.17	30.17	30.19	86.10	87.80	6.07	6.09	5.69	5.33	3.3	3.2		
			12:49	3.8	2.8	27.50	27.55	8.17	8.17	30.20	30.19	89.50	87.80	6.11	6.09	4.96	5.33	3.0	3.2		
	15/8/2022	Sunny	9:05	3.9	2.9	28.70	28.75	7.98	7.99	29.02	28.99	88.50	90.50	6.11	6.17	1.75	1.75	2.2	2.2		
			9:06	3.9	2.9	28.80	28.75	7.99	7.99	28.95	28.99	92.50	90.50	6.22	6.17	1.75	1.75	2.1	2.2		
	17/8/2022	Cloudy	9:09	3.4	2.4	28.60	28.49	8.16	8.17	28.98	28.97	105.10	105.15	7.18	7.14	1.64	1.57	2.9	2.8		
			9:10	3.4	2.4	28.37	28.49	8.17	8.17	28.96	28.97	105.20	105.15	7.09	7.14	1.49	1.57	2.6	2.8		
	19/8/2022	Cloudy	9:16	3.3	2.3	29.50	29.45	8.32	8.32	29.08	29.09	116.50	117.90	7.68	7.76	1.05	1.06	2.8	2.7		
			9:17	3.3	2.3	29.40	29.45	8.32	8.32	29.09	29.09	119.30	117.90	7.84	7.76	1.07	1.06	2.6	2.7		
	22/8/2022	Sunny	12:55	3.2	2.2	30.00	30.00	8.41	8.41	28.62	28.56	113.40	112.30	7.41	7.32	6.30	6.30	15.0	14.8		
			12:56	3.2	2.2	30.00	30.00	8.41	8.41	28.50	28.56	111.20	112.30	7.22	7.32	6.29	6.30	14.6	14.8		
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:57	3.6	2.6	28.14	28.17	8.09	8.09	30.20	30.23	95.00	91.85	6.42	6.32	15.59	15.59	9.6	9.7		
			12:58	3.6	2.6	28.20	28.17	8.09	8.09	30.26	30.23	88.70	91.85	6.21	6.32	15.58	15.59	9.7	9.7		
	29/8/2022	Sunny	9:01	3.6	2.6	28.70	28.70	7.97	7.97	29.90	29.89	98.00	96.45	6.72	6.66	5.22	5.22	4.0	3.9		
			9:02	3.6	2.6	28.70	28.70	7.88	7.88	29.87	29.89	94.90	96.45	6.59	6.66	5.21	5.22	3.8	3.9		

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR5 (surface) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
SR5	2/8/2022	Sunny	9:26	4.6	1.0	29.60	29.64	9.30	9.24	26.39	26.45	117.90	117.35	7.76	7.72	5.56	5.27	1.8	1.7		
			9:27	4.6	1.0	29.68		9.17		26.50		116.80		7.67		4.97		1.6			
	4/8/2022	Rainy	10:35	4.1	1.0	28.05	28.07	9.66	9.67	25.68	25.81	99.30	99.30	6.73	6.73	6.18	5.64	2.4	2.3		
			10:36	4.1	1.0	28.09		9.67		25.93		99.30		6.72		5.10		2.1			
	6/8/2022	Cloudy	9:26	3.9	1.0	28.54	28.62	9.26	9.33	24.37	25.50	115.70	108.45	7.53	7.33	4.78	4.50	1.1	1.2		
			9:27	3.9	1.0	28.70		9.39		26.62		101.20		6.83		4.22		1.2			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	9:57	4.8	1.0	26.80	26.75	8.23	8.23	29.28	29.28	69.00	76.65	5.49	5.52	17.88	17.75	7.5	7.7		
			9:58	4.8	1.0	26.70		8.23		29.28		84.30		5.54		17.62		7.9			
	13/8/2022	Sunny	9:48	5.2	1.0	27.40	27.40	8.04	8.06	30.09	30.10	83.10	85.10	5.94	6.01	5.08	5.10	4.6	4.8		
			9:49	5.2	1.0	27.40		8.07		30.11		87.10		6.07		5.11		5.0			
	15/8/2022	Sunny	12:36	4.7	1.0	28.90	28.95	8.15	8.16	29.31	29.30	93.90	93.70	6.29	6.31	2.29	2.21	1.3	1.2		
			12:37	5.0	1.0	29.00		8.16		29.28		93.50		6.32		2.13		1.1			
	17/8/2022	Cloudy	12:46	4.7	1.0	29.60	29.65	8.42	8.42	28.78	28.78	110.00	111.60	7.25	7.32	2.19	2.12	4.1	4.0		
			12:47	4.7	1.0	29.70		8.42		28.78		113.20		7.39		2.05		3.8			
	19/8/2022	Cloudy	12:44	4.5	1.0	29.70	29.75	8.48	8.48	28.75	28.81	114.60	113.95	7.58	7.50	0.49	0.49	4.1	4.0		
			12:45	4.5	1.0	29.80		8.48		28.87		113.30		7.43		0.49		3.8			
	22/8/2022	Sunny	9:17	4.0	1.0	29.70	29.70	8.20	8.23	28.85	28.91	106.60	107.45	7.09	7.14	6.99	7.00	6.7	6.5		
			9:18	4.0	1.0	29.70		8.26		28.96		108.30		7.19		7.00		6.3			
	24/8/2022	Cloudy	9:16	4.6	1.0	30.70	30.70	8.33	8.35	28.17	27.68	121.60	121.25	8.03	7.96	1.75	1.82	1.4	1.4		
			9:17	4.6	1.0	30.70		8.37		27.19		120.90		7.88		1.89		1.3			
	26/8/2022	Cloudy	9:24	4.8	1.0	27.90	27.90	7.95	7.95	30.23	30.23	94.80	94.45	6.55	6.52	16.50	16.48	17.2	17.5		
			9:25	4.8	1.0	27.90		7.95		30.23		94.10		6.49		16.45		17.7			
	29/8/2022	Sunny	12:53	4.8	1.0	29.00	29.05	8.10	8.11	29.85	29.85	96.30	99.15	6.50	6.66	4.61	4.60	3.2	3.1		
12:54			4.8	1.0	29.10		8.11		29.84		102.00		6.81		4.59		3.0				
29/8/2022	Sunny	12:41	0.0	1.0	29.80	29.85	8.31	8.32	29.75	29.74	111.80	112.05	7.25	7.27	3.17	3.24	-	-			
		12:42	0.0	1.0	29.90		8.33		29.72		112.30		7.28		3.30		-				

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR5 (surface) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L		
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	
						Sampling was cancelled due to adverse weather														
SR5	2/8/2022	Sunny	12:43	4.9	1.0	30.36	30.36	9.33	9.32	25.76	25.92	112.70	107.95	7.35	7.04	6.39	6.09	3.2	3.0	
			12:44	4.9	1.0	30.36		9.30		26.07		103.20		6.72		5.78		2.5		
	4/8/2022	Rainy	12:42	4.7	1.0	28.30	28.29	9.90	9.91	25.64	25.87	96.70	104.85	6.53	7.07	6.10	5.77	3.0	2.9	
			12:43	4.7	1.0	28.28		9.92		26.10		113.00		7.61		5.43		2.8		
	6/8/2022	Cloudy	12:40	4.2	1.0	28.24	28.21	9.11	9.11	23.13	23.19	90.40	91.50	6.19	6.28	5.26	4.62	2.5	2.6	
			12:41	4.2	1.0	28.18		9.10		23.25		92.60		6.36		3.97		2.7		
	9/8/2022	T3	Sampling was cancelled due to adverse weather																	
	11/8/2022	Rainy	12:41	4.5	1.0	27.10	27.15	8.21	8.23	29.31	29.28	79.90	79.50	5.48	5.44	13.45	13.34	8.0	7.8	
			12:42	4.5	1.0	27.20		8.24		29.25		79.10		5.40		13.23		7.6		
	13/8/2022	Sunny	12:36	5.0	1.0	28.20	28.25	8.11	8.12	29.93	29.92	88.80	89.70	6.09	6.11	6.96	7.09	3.6	3.5	
			12:37	5.0	1.0	28.30		8.12		29.91		90.60		6.12		7.22		3.4		
	15/8/2022	Sunny	9:17	4.8	1.0	29.00	29.00	7.97	7.99	29.00	29.01	93.00	93.75	6.29	6.33	2.61	2.62	2.6	2.8	
			9:18	4.8	1.0	29.00		8.00		29.02		94.50		6.36		2.62		3.0		
	17/8/2022	Cloudy	9:20	3.9	1.0	29.20	29.25	8.19	8.21	28.91	28.80	108.20	109.15	7.17	7.22	2.15	2.14	4.6	4.8	
			9:21	3.9	1.0	29.30		8.22		28.69		110.10		7.26		2.12		4.9		
	19/8/2022	Cloudy	9:26	3.7	1.0	29.70	29.70	8.34	8.35	28.46	28.37	112.50	111.20	7.42	7.35	0.93	0.94	1.9	1.9	
			9:27	3.7	1.0	29.70		8.36		28.28		109.90		7.28		0.94		1.8		
	22/8/2022	Sunny	23:45	3.7	1.0	30.40	30.40	8.36	8.37	28.12	28.13	107.00	108.40	7.24	7.25	4.48	4.49	5.8	5.6	
			23:46	3.7	1.0	30.40		8.38		28.13		109.80		7.25		4.50		5.4		
	24/8/2022	T3	Sampling was cancelled due to adverse weather																	
	26/8/2022	Cloudy	12:44	4.6	1.0	28.70	28.70	8.09	8.10	30.23	30.24	91.70	92.95	6.31	6.36	13.25	13.25	8.6	8.5	
			12:45	4.6	1.0	28.70		8.10		30.25		94.20		6.41		13.25		8.3		
	29/8/2022	Sunny	9:12	4.8	1.0	29.90	29.45	7.94	7.95	29.50	29.52	99.00	100.50	6.90	6.90	4.88	4.81	3.9	4.0	
			9:13	4.8	1.0	29.00		7.96		29.54		102.00		6.90		4.73		4.0		

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR5 (Bottom) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						-															
SR5	2/8/2022	Sunny	9:29	4.6	3.6	29.67	29.69	9.19	9.20	26.52	26.62	104.60	103.40	6.87	6.79	5.11	4.79	2.7	2.6		
			9:30	4.6	3.6	29.70		9.21		26.71		102.20		6.70		4.47		2.5			
	4/8/2022	Rainy	10:38	4.1	3.1	28.13	28.10	9.77	9.76	25.77	25.83	117.40	108.45	7.96	7.35	4.47	4.55	3.4	3.7		
			10:39	4.1	3.1	28.06		9.75		25.89		99.50		6.74		4.62		3.9			
	6/8/2022	Cloudy	9:28	3.9	2.9	28.70	28.73	9.48	9.39	24.48	24.56	97.00	98.30	6.55	6.64	5.05	4.66	3.0	2.8		
			9:29	3.9	2.9	28.75		9.29		24.64		99.60		6.72		4.26		2.5			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	10:00	4.8	3.8	26.70	26.70	8.24	8.24	29.31	29.29	75.40	77.30	5.01	5.15	16.51	16.51	9.8	10.0		
			10:01	4.8	3.8	26.70		8.24		29.27		79.20		5.29		16.51		10.2			
	13/8/2022	Sunny	9:52	5.2	4.2	27.40	27.40	8.09	8.10	30.19	30.20	85.30	83.40	6.12	5.96	5.84	5.82	6.4	6.3		
			9:53	5.2	4.0	27.40		8.10		30.20		81.50		5.79		5.80		6.1			
	15/8/2022	Sunny	12:40	4.7	4.0	28.90	28.90	8.16	8.16	29.34	29.34	93.50	93.50	6.28	6.32	2.24	2.28	1.7	1.7		
			12:41	5.0	4.0	28.90		8.16		29.34		93.50		6.36		2.32		1.6			
	17/8/2022	Cloudy	12:49	4.7	3.7	29.50	29.50	8.42	8.42	28.85	28.87	114.10	114.40	7.48	7.50	1.66	1.65	5.4	5.2		
			12:50	4.7	3.7	29.50		8.42		28.89		114.70		7.52		1.64		5.0			
	19/8/2022	Cloudy	12:47	4.5	3.5	29.80	29.80	8.47	8.47	28.80	28.80	107.20	109.00	7.03	7.13	0.81	0.87	5.4	5.2		
			12:48	4.5	3.5	29.80		8.47		28.80		110.80		7.22		0.93		5.0			
	22/8/2022	Sunny	9:20	4.0	3.0	29.50	29.55	8.26	8.26	29.04	29.06	110.80	110.35	7.27	7.25	12.33	12.33	13.0	13.3		
			9:21	4.0	3.0	29.60		8.26		29.04		109.90		7.23		12.33		13.5			
	24/8/2022	Cloudy	9:19	4.6	3.6	30.80	30.80	8.38	8.39	27.45	27.34	113.50	111.10	7.57	7.34	2.48	2.36	1.6	1.5		
			9:20	4.6	3.6	30.80		8.39		27.23		108.70		7.11		2.24		1.4			
	26/8/2022	Cloudy	9:27	4.8	3.8	27.90	27.90	7.9+8	7.99	30.26	30.26	91.40	90.75	6.32	6.28	17.55	17.57	20.8	20.6		
			9:28	4.8	3.8	27.90		7.99		30.26		90.10		6.24		17.58		20.4			
	29/8/2022	Sunny	12:56	4.8	3.8	28.90	28.95	8.11	8.11	29.93	29.89	94.70	95.70	6.41	6.46	5.33	5.33	4.6	4.5		
			12:57	4.8	3.8	29.00		8.11		29.85		96.70		6.51		5.32		4.3			
	29/8/2022	Sunny	12:41	0.0	0.8	29.50	29.50	8.27	8.26	30.05	30.05	103.40	102.55	6.88	6.82	4.85	4.87	-	-		
			12:42	0.0	0.8	29.50		8.24		30.04		101.70		6.76		4.89		-			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR5 (Bottom) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						-															
SR5	2/8/2022	Sunny	12:46	4.9	3.9	30.19	30.16	9.43	9.39	26.43	26.45	115.10	111.60	7.50	7.28	6.70	5.97	4.0	3.9		
			12:47	4.9	3.9	30.12		9.34		26.48		108.10		7.05		5.23		3.7			
	4/8/2022	Rainy	12:45	4.7	3.7	28.33	28.32	9.94	9.92	25.84	25.86	100.40	100.10	6.77	6.75	5.25	5.07	3.6	3.8		
			12:46	4.7	3.7	28.30		9.90		25.88		99.80		6.73		4.89		4.0			
	6/8/2022	Cloudy	12:43	4.2	3.2	28.08	28.08	9.25	9.17	23.57	23.71	95.00	102.30	6.52	7.01	3.96	3.84	1.8	1.8		
			12:44	4.2	3.2	28.07		9.08		23.84		109.60		7.50		3.71		1.7			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:44	4.5	3.5	27.00	27.00	8.27	8.27	28.30	29.35	79.40	78.40	5.43	5.36	15.58	15.58	13.7	13.5		
			12:45	4.5	3.5	27.00		8.27		29.39		77.40		5.29		15.58		13.2			
	13/8/2022	Sunny	12:40	5.0	4.0	28.20	28.25	8.13	8.13	29.93	29.92	88.90	88.30	6.15	6.06	7.60	7.44	9.2	9.0		
			12:41	5.0	4.0	28.20		8.13		29.90		87.70		5.96		7.28		8.8			
	15/8/2022	Sunny	9:20	4.8	3.8	28.60	28.60	8.02	8.03	29.17	29.16	93.40	92.50	6.29	6.26	2.25	2.22	5.4	5.3		
			9:21	4.8	3.8	28.60		8.03		29.14		91.60		6.22		2.19		5.2			
	17/8/2022	Cloudy	9:22	3.9	2.9	29.30	29.40	8.24	8.25	28.71	28.69	108.10	109.15	7.13	7.19	3.60	3.59	8.9	9.1		
			9:23	3.9	2.9	29.50		8.25		28.66		110.20		7.25		3.58		9.3			
	19/8/2022	Cloudy	9:28	3.7	2.7	29.70	29.65	8.36	8.37	28.82	28.85	114.90	111.10	7.52	7.29	0.62	0.68	2.4	2.6		
			9:29	3.7	2.7	29.60		8.38		28.88		107.30		7.06		0.74		2.7			
	22/8/2022	Sunny	23:47	3.7	2.7	30.10	30.05	8.42	8.43	28.34	28.34	112.30	113.75	7.35	7.44	4.73	4.67	4.0	4.2		
			23:48	3.7	2.7	30.00		8.44		28.33		115.20		7.53		4.61		4.4			
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:47	4.6	3.6	28.80	28.80	8.10	8.10	30.25	30.25	97.40	97.75	6.53	6.60	13.25	13.25	10.9	10.7		
			12:48	4.6	3.6	28.80		8.10		30.26		98.10		6.67		13.25		10.4			
	29/8/2022	Sunny	9:15	4.8	3.8	28.80	28.80	7.97	7.98	29.69	29.71	99.40	98.35	6.69	6.72	5.08	4.85	3.3	3.1		
			9:16	4.8	3.8	28.80		7.98		29.72		97.30		6.75		4.61		2.9			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR6 (Middle) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						-															
SR6	2/8/2022	Sunny	9:35	2.9	1.5	30.10															
			9:36	2.9	1.5	30.12	30.11	9.28	9.29	25.21	25.45	115.00	109.25	7.62	7.67	5.06	4.85	3.9	3.7		
	4/8/2022	Rainy	10:46	2.6	1.3	27.89	27.85	9.29	9.75	25.68	25.94	102.50	100.20	7.72	6.81	4.64	4.85	3.5	2.3		
			10:47	2.6	1.3	27.80		9.76		25.86		98.90		6.72		5.37		2.1			
	6/8/2022	Cloudy	9:36	2.6	1.3	28.85	28.85	9.38	9.32	24.22	24.39	99.80	95.05	6.73	6.41	4.82	4.65	1.5	1.7		
			9:37	2.6	1.3	28.85		9.25		24.56		90.30		6.08		4.48		1.8			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	10:08	2.8	1.4	26.80	26.75	8.23	8.23	29.24	29.25	82.30	80.55	5.45	5.36	17.59	17.60	7.4	7.2		
			10:09	2.8	1.4	26.70		8.23		29.26		78.80		5.26		17.61		7.0			
	13/8/2022	Sunny	11:02	2.8	1.4	28.00	28.05	8.11	8.11	30.09	30.14	87.60	85.20	6.06	5.96	4.73	4.67	3.8	3.7		
			11:03	2.8	1.5	28.10		8.11		30.18		82.80		5.86		4.61		3.5			
	15/8/2022	Sunny	12:28	2.8	1.5	29.20	29.20	8.15	8.14	28.55	28.57	94.60	93.70	6.28	6.23	1.63	1.49	1.2	1.3		
			12:29	2.9	1.5	29.20		8.13		28.58		92.80		6.18		1.35		1.4			
	17/8/2022	Cloudy	12:34	2.8	1.4	29.20	29.20	8.45	8.45	28.69	28.67	113.80	115.20	7.49	7.59	1.63	1.69	2.8	2.8		
			12:35	2.8	1.4	29.20		8.45		28.65		116.60		7.49		1.75		2.8			
	19/8/2022	Cloudy	12:36	2.7	1.4	29.10	29.10	8.47	8.47	28.88	28.86	111.00	110.40	7.94	7.32	1.00	0.99	2.8	2.8		
			12:37	2.7	1.4	29.10		8.46		28.85		109.20		7.29		0.98		2.8			
	22/8/2022	Sunny	10:01	2.6	1.3	29.80	29.85	8.26	8.27	29.08	29.06	109.30	108.30	7.13	7.09	7.85	7.84	5.9	5.7		
			10:02	2.6	1.3	29.90		8.27		29.04		107.30		7.04		7.82		5.5			
	24/8/2022	Cloudy	9:27	2.7	1.4	30.90	30.95	8.39	8.40	27.21	27.20	118.60	118.55	7.75	7.78	2.05	2.05	1.4	1.3		
			9:28	2.7	1.4	31.00		8.40		27.19		118.50		7.80		2.04		1.2			
	26/8/2022	Cloudy	9:37	2.7	1.4	28.60	28.65	7.99	8.00	30.22	30.25	91.00	89.25	6.13	6.11	14.50	14.50	15.1	14.9		
			9:38	2.7	1.4	28.70		8.00		30.27		87.50		6.08		14.50		14.6			
	29/8/2022	Sunny	12:42	2.8	1.4	29.50	29.50	8.12	8.13	29.68	29.69	98.00	100.05	6.58	6.76	3.44	3.43	5.6	5.7		
			12:43	2.8	1.4	29.50		8.13		29.69		102.10		6.94		3.42		5.8			
	29/8/2022	Sunny	12:34	0.0	13.5	30.30	30.30	8.33	8.33	29.63	29.64	110.50	110.05	7.14	7.11	2.61	2.67	-	-		
			12:35	0.0	13.5	30.30		8.33		29.65		109.60		7.08		2.73		-			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR6 (Middle) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						-															
SR6	2/8/2022	Sunny	12:34	2.7	1.4	30.16	30.15	9.40	9.37	26.48	26.59	116.60	114.55	7.60	7.47	6.10	5.40	2.6	2.8		
			12:35	2.7	1.4	30.14		9.33		26.69		112.50		7.33		4.69		3.0			
	4/8/2022	Rainy	12:33	2.7	1.4	28.35	28.32	9.88	9.90	25.80	25.79	99.70	106.65	6.72	7.19	5.17	5.06	2.2	2.3		
			12:34	2.7	1.4	28.29		9.91		25.77		113.60		7.66		4.94		2.4			
	6/8/2022	Cloudy	12:35	2.7	1.4	28.58	28.58	9.25	9.21	22.83	22.97	94.70	103.15	6.47	7.04	4.38	4.21	2.2	2.3		
			12:36	2.7	1.4	28.57		9.16		23.10		111.60		7.61		4.03		2.4			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:36	2.7	1.4	26.90	26.90	8.27	8.28	28.76	28.54	76.90	79.10	5.32	5.50	16.48	15.69	8.1	8.0		
			12:37	2.7	1.4	26.90		8.28		28.32		81.30		5.67		14.90		7.5			
	13/8/2022	Sunny	12:29	2.7	1.4	27.50	27.90	8.15	8.15	29.99	29.98	87.00	87.05	6.09	6.12	4.28	4.16	2.3	2.5		
			12:30	2.7	1.4	28.30		8.15		29.97		87.10		6.15		4.03		2.6			
	15/8/2022	Sunny	9:30	2.8	1.4	28.90	28.95	8.04	8.05	29.12	29.11	88.10	88.30	6.08	6.07	2.19	2.20	1.7	1.8		
			9:31	2.8	1.4	29.00		8.05		29.10		88.50		6.06		2.20		1.8			
	17/8/2022	Cloudy	9:32	2.5	1.3	29.60	29.70	8.25	8.26	28.74	28.73	108.60	108.35	7.13	7.09	1.35	1.36	2.9	3.0		
			9:33	2.5	1.3	29.80		8.26		28.71		108.10		7.05		1.37		3.0			
	19/8/2022	Cloudy	9:39	2.5	1.3	29.60	29.60	8.40	8.40	28.86	28.86	111.20	110.90	7.49	7.41	0.63	0.63	1.2	1.4		
			9:40	2.5	1.3	29.60		8.40		28.86		110.60		7.33		0.63		1.5			
	22/8/2022	Sunny	12:37	2.5	1.3	30.10	30.15	8.37	8.37	28.51	28.51	115.20	111.70	7.54	7.34	3.74	3.67	3.2	3.1		
			12:38	2.5	1.3	30.20		8.37		28.51		108.20		7.14		3.60		2.9			
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	13:38	2.6	1.3	28.30	28.30	8.10	8.10	30.23	30.24	93.20	92.75	6.30	6.30	12.49	12.39	11.4	11.2		
			13:39	2.6	1.3	28.30		8.09		30.24		92.20		6.29		12.34		11.0			
	29/8/2022	Sunny	9:27	2.7	1.4	28.80	28.80	8.00	8.01	29.63	29.63	101.10	97.70	6.59	6.75	4.42	4.40	3.0	3.2		
			9:28	2.7	1.4	28.80		8.01		29.63		94.30		6.51		4.37		3.3			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR9 (surface) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling cancelled due to adverse weather															
SR9	2/8/2022	Sunny	9:48	4.8	1.0	29.60		9.29		26.49		102.40		6.74		5.27		3.8		4.0	
			9:49	4.8	1.0	29.55	29.58	9.29	9.26	26.49	26.63	102.40	100.95	6.74	6.64	4.92	5.10	4.1			
	4/8/2022	Rainy	10:58	4.6	1.0	28.12	28.16	9.78	9.80	25.62	25.74	113.90	108.75	7.71	7.36	5.63	5.60	2.6		2.8	
			10:59	4.6	1.0	28.19		9.82		25.86		103.60		7.00		5.56		2.9			
	6/8/2022	Cloudy	9:49	3.9	1.0	28.45	28.46	9.19	9.17	23.21	23.32	96.30	93.70	6.57	6.39	4.62	4.01	<1.0		1.0	
			9:50	3.9	1.0	28.46		9.14		23.42		91.10		6.21		3.50		<1.0			
	9/8/2022	T3	Sampling cancelled due to adverse weather																		
	11/8/2022	Rainy	10:21	4.9	1.0	27.00	27.00	8.18	8.20	29.41	27.46	75.10	75.05	5.14	5.16	18.67	18.68	12.1		12.0	
			10:22	4.9	1.0	27.00		8.21		25.51		75.00		5.18		18.68		11.8			
	13/8/2022	Sunny	10:15	5.4	1.0	27.70	27.65	8.07	8.08	29.96	29.92	90.90	88.25	6.26	6.11	2.94	2.91	1.8		1.8	
			10:16	5.4	1.0	27.60		8.09		29.87		85.60		5.96		2.87		1.7			
	15/8/2022	Sunny	21:21	4.6	1.0	29.40	29.35	8.11	8.12	28.63	28.60	98.70	97.80	6.47	6.49	1.19	1.17	2.4		2.3	
	17/8/2022	Cloudy	21:22	5.1	1.0	29.30		8.13		28.56		96.90		6.51		1.14		2.2			
			12:22	4.6	1.0	29.50	29.50	8.38	8.39	28.65	28.65	113.20	114.85	7.43	7.51	2.20	1.98	3.9		4.0	
	19/8/2022	Cloudy	12:23	4.6	1.0	29.50		8.40		28.65		116.50		7.58		1.75		4.1			
			12:23	4.4	1.0	29.70	29.75	8.41	8.42	28.80	28.82	114.10	113.40	7.45	7.41	0.63	0.70	3.9		4.0	
	22/8/2022	Sunny	9:40	4.2	1.0	29.70	29.70	8.27	8.29	29.09	29.09	113.60	112.25	7.44	7.34	6.01	5.96	6.8		7.0	
			9:41	4.2	1.0	29.70		8.31		29.08		110.90		7.24		5.91		7.2			
	24/8/2022	Cloudy	9:44	4.6	1.0	30.20		8.35		28.34		113.10		7.97		2.03		4.9		4.7	
			9:45	4.6	1.0	30.00	30.10	8.39	8.37	28.34	28.34	119.50	116.30	7.80	7.89	2.17	2.10	4.5			
	26/8/2022	Cloudy	9:50	4.8	1.0	28.10	28.10	7.97	7.98	30.31	30.29	97.30	95.30	6.57	6.43	20.47	20.20	15.7		15.5	
			9:51	4.8	1.0	28.10		7.99		30.26		93.30		6.29		19.93		15.3			
	29/8/2022	Sunny	12:23	4.5	1.0	29.50	29.50	8.09	8.10	29.67	29.68	105.00	102.65	6.99	6.91	3.84	3.80	2.3		2.5	
			12:24	4.5	1.0	29.50		8.10		29.69		100.30		6.82		3.76		2.6			
29/8/2022	Sunny	12:22	0.0	1.0	30.20	30.15	8.20	8.25	29.22	29.44	111.90	111.45	7.18	7.19	2.48	2.48	-		-		
		12:23	0.0	1.0	30.10		8.29		29.66		111.00		7.20		2.47		-				

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR9 (surface) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						Sampling cancelled due to adverse weather															
SR9	2/8/2022	Sunny	12:21	4.8	1.0	30.66	30.64	9.24	9.26	26.23	26.27	114.10	108.25	7.39	7.01	6.08	5.77	3.8		4.0	
			12:22	4.8	1.0	30.61		9.28		26.31		102.40		6.63		5.46		4.2			
	4/8/2022	Rainy	12:22	4.8	1.0	28.29	28.33	9.84	9.88	25.70	25.92	101.30	98.20	6.84	6.62	6.50	5.81	2.1		2.3	
			12:23	4.8	1.0	28.36		9.92		26.14		95.10		6.40		5.11		2.4			
	6/8/2022	Cloudy	12:22	4.0	1.0	28.66	28.65	9.19	9.28	23.08	23.08	93.40	103.15	6.36	7.03	4.75	4.41	2.1		2.2	
			12:23	4.0	1.0	28.63		9.36		23.08		112.90		7.69		4.06		2.3			
	9/8/2022	T3	Sampling cancelled due to adverse weather																		
	11/8/2022	Rainy	12:23	4.6	1.0	27.00	27.00	8.27	8.27	29.05	28.33	79.80	79.15	5.53	5.46	13.70	13.48	9.5		9.3	
			12:24	4.6	1.0	27.00		8.27		27.60		78.50		5.39		13.25		9.0			
	13/8/2022	Sunny	12:20	5.1	1.0	27.60	27.60	8.10	8.11	30.05	30.01	92.70	89.70	6.27	6.14	3.81	3.86	2.4		2.6	
			12:21	5.1	1.0	27.60		8.12		29.97		86.70		6.01		3.91		2.8			
	15/8/2022	Sunny	9:40	4.9	1.0	28.70	28.70	8.05	8.06	29.23	29.23	91.20	90.05	6.17	6.10	1.80	1.72	1.2		1.1	
			9:41	4.9	1.0	28.70		8.07		29.23		88.90		6.02		1.63		1.0			
	17/8/2022	Cloudy	9:44	4.3	1.0	29.40	29.40	8.26	8.26	28.69	28.68	105.40	106.40	6.98	7.04	1.75	1.72	3.6		3.8	
			9:45	4.3	1.0	29.40		8.26		28.67		107.40		7.09		1.68		4.0			
	19/8/2022	Cloudy	9:50	4.0	1.0	29.40	29.40	8.37	8.38	28.88	28.88	113.50	112.85	7.47	7.42	0.72	0.74	<1.0		1.0	
			9:51	4.0	1.0	29.40		8.39		28.88		112.20		7.37		0.76		<1.0			
	22/8/2022	Sunny	12:24	4.0	1.0	30.40	30.40	8.29	8.31	28.47	28.50	117.50	116.15	7.65	7.57	4.01	3.93	4.2		4.4	
			12:25	4.0	1.0	30.40		8.32		28.53		114.80		7.49		3.85		4.6			
	24/8/2022	T3	Sampling cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:28	4.7	1.0	28.10	28.10	8.03	8.04	30.23	30.24	96.10	95.15	6.53	6.49	15.58	15.59	11.6		11.4	
			12:29	4.7	1.0	28.10		8.05		30.25		94.20		6.45		15.59		11.2			
	29/8/2022	Sunny	9:40	4.6	1.0	29.30	29.30	7.98	8.01	29.56	29.57	104.40	103.60	6.94	6.88	4.61	4.61	3.5		3.4	
			9:41	4.6	1.0	29.30		8.03		29.57		102.80		6.81		4.60		3.2			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR9 (Bottom) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						-															
SR9	2/8/2022	Sunny	9:51	4.8	3.8	29.39	29.40	9.32	9.33	26.67	26.75	116.10	107.60	7.86	7.10	5.05	4.71	1.4	1.5		
			9:52	4.8	3.8	29.40														9.33	26.67
	4/8/2022	Rainy	11:01	4.6	3.6	28.29	28.27	9.84	9.56	25.98	25.96	101.50	99.50	6.84	6.71	5.13	4.98	2.1	2.2		
			11:02	4.6	3.6	28.25														9.27	25.94
	6/8/2022	Cloudy	9:51	3.9	2.9	28.49	28.54	9.30	9.26	23.47	23.47	93.10	93.40	6.35	6.36	4.08	3.93	2.2	2.3		
			9:52	3.9	2.9	28.58														9.22	23.46
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	10:24	4.9	3.9	26.60	26.55	8.25	8.26	28.79	28.77	77.40	77.65	5.39	5.41	15.58	15.56	9.8	9.6		
			10:25	4.9	3.9	26.50														8.26	28.74
	13/8/2022	Sunny	10:19	5.4	4.4	27.70	27.75	8.10	8.11	30.00	30.02	87.70	87.90	6.07	6.10	4.15	4.20	2.6	2.7		
			10:20	5.4	4.1	27.80														8.11	30.03
	15/8/2022	Sunny	21:25	4.6	4.1	29.30	29.30	8.14	8.14	28.60	28.61	99.40	98.05	6.65	6.55	1.89	1.90	3.2	3.4		
			21:26	5.1	4.1	29.30														8.14	28.62
	17/8/2022	Cloudy	12:25	4.6	3.6	29.40	29.45	8.42	8.43	28.70	28.68	118.30	117.25	7.76	7.69	1.35	1.42	2.9	3.1		
			12:26	4.6	3.6	29.50														8.43	28.66
	19/8/2022	Cloudy	12:26	4.4	3.4	29.80	29.75	8.44	8.45	28.83	28.83	117.70	114.75	7.29	7.49	1.05	1.05	3.2	3.1		
			12:27	4.4	3.4	29.70														8.45	28.83
	22/8/2022	Sunny	9:43	4.2	3.2	29.40	29.40	8.30	8.30	29.16	29.15	107.30	108.10	7.15	7.21	5.91	5.90	3.7	3.5		
			9:44	4.2	3.2	29.40														8.29	29.13
	24/8/2022	Cloudy	9:47	4.6	3.6	29.90	29.95	8.39	8.40	28.69	28.54	118.50	119.85	7.70	7.78	2.36	2.27	3.2	3.4		
			9:48	4.6	3.6	30.00														8.41	28.39
	26/8/2022	Cloudy	9:53	4.8	3.8	28.10	28.10	8.02	8.03	30.27	30.26	99.40	98.85	6.74	6.68	18.67	18.62	17.8	18.0		
			9:54	4.8	3.8	28.10														8.03	30.25
	29/8/2022	Sunny	12:26	4.5	3.5	29.40	29.45	8.11	8.12	29.76	29.73	101.60	100.50	6.66	6.62	4.63	4.55	4.5	4.7		
			12:27	4.5	3.5	29.50														8.12	29.69
	29/8/2022	Sunny	12:21	0.0	-1.0	30.10	30.10	8.32	8.32	29.66	29.65	109.50	110.55	7.09	7.14	2.32	2.32	-	-		
			12:22	0.0	-1.0	30.10														8.32	29.63

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR9 (Bottom) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						-															
SR9	2/8/2022	Sunny	12:24	4.8	3.8	30.20	30.18	9.46	9.40	26.60	26.66	114.60	110.55	7.46	7.20	6.51	5.77	3.2	3.5		
			12:25	4.8	3.8	30.15														9.34	26.71
	4/8/2022	Rainy	12:25	4.8	3.8	28.44	28.41	9.86	9.85	25.89	26.02	103.30	108.30	6.95	7.29	4.75	4.81	3.0	3.1		
			12:26	4.8	3.8	28.38														9.83	25.89
	6/8/2022	Cloudy	12:25	4.0	3.0	28.60	28.50	9.32	9.24	22.71	22.84	94.80	91.55	6.47	6.25	3.97	3.87	2.7	2.9		
			12:26	4.0	3.0	28.57														9.16	22.97
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:26	4.6	3.6	27.00	27.00	8.27	8.28	28.24	28.92	89.90	79.85	5.55	5.48	14.62	14.56	6.5	6.8		
	12:27	4.6	3.6	27.00	8.28	28.60														28.92	78.80
	13/8/2022	Sunny	12:24	5.1	4.1	27.40	27.45	8.14	8.15	30.05	30.01	91.20	91.00	6.24	6.21	3.17	3.10	3.7	3.9		
			12:25	5.1	4.1	27.50														8.15	29.97
	15/8/2022	Sunny	9:43	4.9	3.9	28.60	28.60	8.09	8.10	29.24	29.24	92.80	92.00	6.23	6.17	1.63	1.64	2.1	2.2		
			9:44	4.9	3.9	28.60														8.10	29.24
	17/8/2022	Cloudy	9:47	4.3	3.3	29.30	29.30	8.29	8.30	28.63	28.62	104.40	105.65	6.95	6.98	1.64	1.75	2.8	2.9		
			9:48	4.3	3.3	29.30														8.30	28.60
	19/8/2022	Cloudy	9:53	4.0	3.0	29.30	29.30	8.41	8.42	28.88	28.88	110.20	112.10	7.27	7.41	0.93	0.94	2.2	2.3		
			9:54	4.0	3.0	29.30														8.42	28.88
	22/8/2022	Sunny	12:27	4.0	3.0	30.30	30.35	8.34	8.35	28.70	28.60	111.80	110.60	7.31	7.25	4.93	4.99	6.4	6.7		
			12:28	4.0	3.0	30.40														8.35	28.50
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:31	4.7	3.7	28.10	28.15	8.06	8.07	30.27	30.24	89.30	93.55	6.25	6.49	16.36	16.25	13.6	13.8		
			12:32	4.7	3.7	28.20														8.07	30.24
	29/8/2022	Sunny	9:43	4.6	3.6	29.20	29.20	8.05	8.06	29.59	29.58	101.10	103.00	6.74	6.86	4.25	4.25	2.7	2.7		
			9:44	4.6	3.6	29.20														8.06	29.56

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR10 (Middle) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						-															
SR10	2/8/2022	Sunny	9:59	2.8	1.4	29.35	29.35	9.30	9.32	26.42	26.65	115.40	115.05	7.82	7.59	5.99	5.53	2.2	2.4		
			10:00	2.8	1.4	29.34														9.30	26.88
	4/8/2022	Rainy	11:07	2.6	1.3	28.31	28.30	9.69	9.67	26.46	26.53	114.70	105.80	7.71	7.11	5.81	5.62	3.8	3.7		
			11:08	2.6	1.3	28.29														9.66	26.59
	6/8/2022	Cloudy	9:59	2.3	1.2	28.38	28.42	9.18	9.23	22.25	22.43	115.10	106.15	7.91	7.28	4.61	4.25	2.2	2.3		
			10:00	2.3	1.2	28.45														9.28	22.61
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	10:32	2.8	1.4	26.90	26.90	8.22	8.24	29.53	29.53	74.00	75.65	5.16	5.30	17.59	17.94	9.6	9.4		
			10:33	2.8	1.4	26.90														8.26	29.52
	13/8/2022	Sunny	10:28	2.9	1.5	27.50	27.45	8.12	8.13	29.97	29.97	85.60	85.05	5.98	6.04	3.17	2.95	3.5	3.7		
			10:29	2.9	1.5	27.40														8.14	29.96
	15/8/2022	Sunny	12:17	2.8	1.5	29.70	29.65	8.08	8.09	29.29	29.27	93.30	92.25	6.15	6.12	1.35	1.37	3.0	2.9		
			12:18	2.9	1.5	29.60														8.10	29.25
	17/8/2022	Cloudy	12:17	2.8	1.4	29.90	29.90	8.28	8.30	28.67	28.67	106.30	107.95	6.94	7.06	1.88	1.97	2.5	2.7		
			12:18	2.8	1.4	29.80														8.31	28.67
	19/8/2022	Cloudy	12:17	2.7	1.4	29.60	29.55	8.46	8.46	28.87	28.86	114.40	114.50	7.47	7.51	1.03	0.98	2.5	2.7		
			12:18	2.7	1.4	29.50														8.46	28.85
	22/8/2022	Sunny	9:55	2.7	1.4	29.20	29.25	8.30	8.32	29.10	29.12	108.20	109.75	7.18	7.28	5.06	4.96	4.4	4.2		
			9:56	2.7	1.4	29.30														8.34	29.13
	24/8/2022	Cloudy	9:59	2.7	1.4	30.50	30.50	8.41	8.42	28.48	28.48	117.60	118.50	7.74	7.71	3.38	3.36	3.7	3.9		
			10:00	2.7	1.4	30.50														8.43	28.48
	26/8/2022	Cloudy	10:05	2.7	1.4	29.00	29.00	8.05	8.06	29.68	29.64	96.10	95.40	6.37	6.43	16.50	16.51	12.2	12.1		
			10:06	2.7	1.4	29.00														8.06	29.59
	29/8/2022	Sunny	12:16	2.8	1.4	29.40	29.45	8.12	8.13	29.56	29.56	103.50	102.20	6.93	6.84	3.30	3.30	2.8	2.7		
			12:17	2.8	1.4	29.50														8.13	29.56
	29/8/2022	Sunny	12:17	0.0	1.4	29.60	29.60	8.23	8.23	29.76	29.77	107.50	108.10	7.03	7.07	3.17	3.18	-	-		
			12:18	0.0	1.4	29.60														8.23	29.77

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR10 (Middle) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						-															
SR10	2/8/2022	Sunny	12:16	2.9	1.5	30.03	30.11	9.40	9.41	27.18	27.25	104.90	103.60	6.83	6.73	5.60	5.29	6.8	6.6		
			12:17	2.9	1.5	30.19														9.42	27.31
	4/8/2022	Rainy	12:17	2.7	1.4	27.75	27.74	9.84	9.82	26.27	26.30	90.00	92.15	6.11	6.26	4.42	4.54	3.4	3.3		
			12:18	2.7	1.4	27.72														9.80	26.32
	6/8/2022	Cloudy	12:17	2.5	1.3	28.92	28.93	9.06	9.13	22.39	22.53	94.60	97.70	6.43	6.64	4.80	5.21	1.7	1.8		
			12:18	2.5	1.3	28.94														9.19	22.66
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:17	2.7	1.4	27.00	27.00	8.26	8.27	28.31	28.42	81.10	81.40	5.57	5.59	13.93	13.59	8.2	8.0		
			12:18	2.7	1.4	27.00														8.27	28.52
	13/8/2022	Sunny	12:15	2.8	1.4	30.70	30.70	8.13	8.13	29.89	29.88	93.60	95.60	6.12	6.17	2.31	2.33	2.4	2.5		
			12:16	2.8	1.4	30.70														8.13	29.89
	15/8/2022	Sunny	9:56	2.8	1.4	29.10	29.05	8.11	8.12	29.24	29.24	91.50	91.35	6.18	6.17	1.64	1.57	3.0	2.9		
			9:57	2.8	1.4	29.00														8.12	29.24
	17/8/2022	Cloudy	9:58	2.5	1.3	29.60	29.75	8.29	8.30	28.63	28.62	104.40	104.00	6.91	6.85	1.89	1.92	4.6	4.5		
			9:59	2.5	1.3	29.90														8.31	28.60
	19/8/2022	Cloudy	10:04	2.6	1.3	29.70	29.70	8.41	8.42	28.89	28.88	110.10	110.35	7.27	7.29	0.63	0.60	1.8	1.7		
			10:05	2.6	1.3	29.70														8.43	28.86
	22/8/2022	Sunny	12:16	2.6	1.3	29.50	29.50	8.37	8.37	29.12	29.14	112.10	113.60	7.44	7.56	4.47	4.51	5.0	5.1		
			12:17	2.6	1.3	29.50														8.37	29.15
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:21	2.7	1.4	29.00	29.00	8.05	8.05	30.04	30.04	96.00	94.35	6.58	6.72	11.24	11.24	8.0	8.1		
			12:22	2.7	1.4	29.00														8.05	30.03
	29/8/2022	Sunny	9:52	2.7	1.4	29.20	29.25	8.06	8.07	29.59	29.59	100.30	100.40	6.60	6.61	3.43	3.43	2.1	2.3		
			9:53	2.7	1.4	29.30														8.08	29.59

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR12 (Middle) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
SR12	2/8/2022	Sunny	10:05	2.8	1.4	29.44	29.49	9.26	9.35	26.97	26.99	98.00	97.70	6.45	6.42	5.15	5.04	2.3	2.3		
			10:06	2.9	1.4	29.54		9.26		27.01		97.40		6.39		4.92		2.2			
	4/8/2022	Rainy	11:13	2.7	1.4	28.28	28.26	9.62	9.64	26.41	26.40	98.60	97.10	6.63	6.53	5.00	5.03	3.0	3.2		
			11:14	2.7	1.4	28.24		9.66		26.39		96.60		6.43		5.06		3.3			
	6/8/2022	Cloudy	10:04	2.4	1.2	28.67	28.70	9.22	9.21	22.18	22.36	113.80	104.20	7.78	7.12	4.31	4.28	1.9	1.9		
			10:05	2.4	1.2	28.73		9.19		22.54		94.60		6.45		4.24		1.8			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	10:36	2.9	1.5	26.90	26.80	8.23	8.24	29.45	29.48	77.20	75.05	5.34	5.22	17.59	17.59	10.6	10.5		
			10:37	2.9	1.5	26.70		8.24		29.51		72.90		5.10		17.59		10.3			
	13/8/2022	Sunny	10:37	2.8	1.4	27.50	27.50	8.12	8.13	29.80	29.78	87.70	87.85	6.21	6.14	1.88	4.81	1.7	1.8		
			10:38	2.8	1.5	27.50		8.14		29.76		88.00		6.07		7.73		1.8			
	15/8/2022	Sunny	12:14	2.9	1.5	29.90	30.05	8.10	8.10	29.17	29.17	93.10	93.05	6.13	6.12	1.68	1.68	2.6	2.7		
			12:15	3.0	1.5	30.20		8.09		29.16		93.00		6.10		1.67		2.8			
	17/8/2022	Cloudy	12:15	2.9	1.5	29.50	29.50	8.32	8.33	28.68	28.68	109.10	109.35	7.18	7.20	1.86	1.81	2.7	2.9		
			12:16	2.9	1.5	29.50		8.33		28.67		109.60		7.22		1.75		3.1			
	19/8/2022	Cloudy	12:13	2.6	1.3	29.60	29.55	8.46	8.47	28.87	28.87	116.90	115.95	7.67	7.66	0.77	0.79	2.7	2.9		
			12:14	2.6	1.3	29.50		8.47		28.87		115.00		7.65		0.80		3.1			
	22/8/2022	Sunny	9:59	2.6	1.3	29.30	29.30	8.35	8.36	29.12	29.13	113.30	112.65	7.54	7.48	4.90	4.91	3.6	3.7		
			10:00	2.6	1.3	29.30		8.36		29.13		112.00		7.41		4.91		3.8			
	24/8/2022	Cloudy	10:06	2.6	1.3	30.50	30.55	8.44	8.45	28.46	28.46	107.80	109.95	7.05	7.16	2.31	2.46	2.5	2.6		
			10:07	2.6	1.3	30.60		8.45		28.46		112.10		7.26		2.61		2.7			
	26/8/2022	Cloudy	10:08	2.6	1.3	29.10	29.15	8.07	8.07	29.62	29.61	92.90	92.60	6.47	6.40	17.59	17.59	10.7	10.8		
			10:09	2.6	1.3	29.20		8.07		29.60		92.30		6.33		17.59		10.9			
	29/8/2022	Sunny	12:12	2.7	1.4	29.30	29.35	8.12	8.13	29.58	29.58	101.60	99.85	6.79	6.67	3.24	3.26	2.6	2.7		
			12:13	2.7	1.4	29.40		8.13		29.57		98.10		6.54		3.27		2.7			
	29/8/2022	Sunny	12:13	0.0	1.3	29.50	29.55	8.24	8.24	29.79	29.78	108.70	107.95	7.14	7.10	3.44	3.52	-	-		
			12:14	0.0	1.3	29.60		8.24		29.76		107.20		7.05		3.59		-			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR12 (Middle) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						Sampling was cancelled due to adverse weather															
SR12	2/8/2022	Sunny	12:11	2.9	1.5	30.36	30.40	9.95	9.73	26.94	27.01	103.00	103.65	6.67	6.71	5.60	5.16	3.0	3.0		
			12:12	2.9	1.5	30.43		9.50		27.07		104.30		6.75		4.71		2.9			
	4/8/2022	Rainy	12:12	2.8	1.4	28.02	28.01	6.69	8.22	26.59	26.57	97.00	95.35	6.54	6.44	5.04	4.69	3.6	3.8		
			12:13	2.8	1.4	27.99		9.74		26.54		93.70		6.33		4.33		3.9			
	6/8/2022	Cloudy	12:13	2.5	1.3	28.95	28.95	9.19	9.24	22.69	22.70	90.70	91.30	6.16	6.20	4.18	4.13	<1.0	1.0		
			12:14	2.5	1.3	28.94		9.28		22.70		91.90		6.24		4.07		<1.0			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:14	2.8	1.4	26.90	26.90	8.24	8.24	28.00	28.18	78.40	79.05	5.37	5.41	15.58	15.59	10.6	10.7		
			12:15	2.8	1.4	26.90		8.24		28.35		79.70		5.45		15.59		10.8			
	13/8/2022	Sunny	12:13	2.7	1.4	29.90	30.05	8.15	8.15	29.76	29.77	89.50	90.05	6.02	6.06	2.31	2.33	2.3	2.3		
			12:14	2.7	1.4	30.20		8.14		29.78		90.60		6.10		2.34		2.2			
	15/8/2022	Sunny	10:03	2.9	1.5	29.80	29.95	8.08	8.08	29.17	29.16	94.70	93.45	6.27	6.22	1.75	1.80	3.3	3.5		
			10:04	2.9	1.5	30.10		8.08		29.15		92.20		6.16		1.85		3.6			
	17/8/2022	Cloudy	10:05	2.6	1.3	30.00	30.00	8.31	8.31	28.61	28.61	106.40	101.90	7.03	6.72	2.19	2.18	3.8	4.0		
			10:06	2.6	1.3	30.00		8.31		28.61		97.40		6.40		2.17		4.2			
	19/8/2022	Cloudy	10:10	2.5	1.3	29.30	29.35	8.44	8.45	28.88	28.88	111.90	109.60	7.29	7.15	0.77	0.76	1.9	1.8		
			10:11	2.5	1.3	29.40		8.45		28.87		107.30		7.00		0.75		1.7			
	22/8/2022	Sunny	12:12	2.4	1.2	29.50	29.50	8.38	8.37	29.14	29.14	109.90	111.00	7.23	7.32	4.40	4.44	5.5	5.8		
			12:13	2.4	1.2	29.50		8.36		29.14		112.10		7.41		4.47		6.0			
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:16	2.5	1.3	29.00	29.00	8.06	8.06	30.02	30.02	97.70	96.15	6.80	6.68	10.10	10.08	11.8	11.9		
			12:17	2.5	1.3	29.00		8.06		30.02		94.60		6.85		10.06		12.0			
	29/8/2022	Sunny	9:58	2.6	1.3	29.40	29.35	8.10	8.10	29.58	29.58	102.20	100.45	6.84	6.70	3.24	3.27	3.6	3.8		
			9:59	2.6	1.3	29.30		8.10		29.57		98.70		6.56		3.29		4.0			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR15 (Middle) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						2/8/2022	Sunny	9:07	2.8	1.4	29.33	29.35	9.19	9.20	26.17	26.34	114.10	118.70	7.55	7.85	5.82
4/8/2022	Rainy	9:08	2.8	1.4	29.36	27.97	9.21	9.60	26.51	26.19	123.30	99.00	8.14	6.55	4.86	8.09	4.1	4.0			
		10:22	2.6	1.3	27.96	27.99	9.59	9.60	26.18	26.19	99.00	96.70	6.70	6.55	8.61	7.56	4.1	3.8			
6/8/2022	Cloudy	9:07	2.6	1.3	28.16	28.16	9.26	9.29	25.54	25.55	118.00	103.65	7.99	7.02	5.07	4.71	2.6	2.8			
		9:08	2.6	1.3	28.16	28.16	9.32	9.29	25.55	25.55	89.30	103.65	6.04	7.02	4.34	4.71	2.9	2.8			
9/8/2022	T3																				
Sampling was cancelled due to adverse weather																					
11/8/2022	Rainy	9:40	2.9	1.5	26.90	26.95	8.23	8.23	29.11	29.19	78.40	81.60	5.11	5.26	18.66	18.61	9.7	9.6			
		9:41	2.9	1.5	27.00	27.00	8.23	8.23	29.26	29.19	84.80	81.60	5.41	5.26	18.55	18.61	9.4	9.6			
13/8/2022	Sunny	9:28	2.9	1.5	27.00	27.05	7.91	7.94	30.11	30.12	86.70	90.15	6.04	6.16	4.85	4.86	2.7	2.9			
		9:29	2.9	1.5	27.10	27.10	7.97	7.97	30.12	30.12	93.60	90.15	6.28	6.16	4.86	4.86	3.0	2.9			
15/8/2022	Sunny	12:56	2.9	1.5	29.10	29.15	8.19	8.19	28.65	28.65	96.20	97.35	6.46	6.52	1.49	1.56	1.8	1.8			
		12:57	2.9	1.5	29.20	29.15	8.19	8.19	28.65	28.65	98.50	97.35	6.58	6.52	1.63	1.56	1.7	1.8			
17/8/2022	Cloudy	13:06	2.7	1.4	29.50	29.55	8.49	8.50	28.90	28.90	117.20	116.20	7.67	7.61	1.63	1.58	2.9	2.8			
		13:07	2.7	1.4	29.60	29.60	8.50	8.50	28.89	28.89	115.20	116.20	7.54	7.61	1.53	1.58	2.5	2.8			
19/8/2022	Cloudy	13:04	2.7	1.4	29.60	29.60	8.48	8.48	28.83	28.85	112.10	113.55	7.37	7.47	0.77	0.77	2.9	2.8			
		13:05	2.7	1.4	29.60	29.60	8.48	8.48	28.86	28.85	115.00	113.55	7.56	7.47	0.76	0.77	2.6	2.8			
22/8/2022	Sunny	8:56	2.7	1.4	29.30	29.30	8.14	8.17	28.21	28.22	109.40	110.60	7.27	7.36	3.43	3.43	3.8	4.0			
		8:57	2.7	1.4	29.30	29.30	8.19	8.17	28.22	28.22	111.80	110.60	7.45	7.36	3.43	3.43	4.1	4.0			
24/8/2022	Cloudy	8:50	2.8	1.4	30.70	30.70	8.21	8.24	27.43	27.44	115.70	115.90	7.47	7.54	2.31	2.30	5.8	5.6			
		8:51	2.8	1.4	30.70	30.70	8.27	8.24	27.44	27.44	116.10	115.90	7.61	7.54	2.29	2.30	5.4	5.6			
26/8/2022	Cloudy	8:58	2.6	1.3	28.00	28.00	7.83	7.86	30.10	30.10	100.00	95.35	7.00	6.68	15.18	15.16	12.1	10.8			
		8:59	2.6	1.3	28.00	28.00	7.88	7.86	30.09	30.10	90.70	95.35	6.15	6.68	15.14	15.16	9.4	10.8			
29/8/2022	Sunny	13:03	2.7	1.4	29.30	29.30	8.20	8.21	29.70	29.71	103.40	101.60	6.77	6.67	4.12	4.19	2.5	2.4			
		13:04	2.7	1.4	29.30	29.30	8.22	8.21	29.71	29.71	99.80	101.60	6.57	6.67	4.25	4.19	2.3	2.4			
29/8/2022	Sunny	13:02	0.0	1.4	30.30	30.25	8.36	8.36	29.71	29.72	111.90	113.20	7.23	7.29	2.61	2.67	-	-			
		13:03	0.0	1.4	30.20	30.25	8.35	8.36	29.72	29.72	114.50	113.20	7.34	7.29	2.73	2.67	-	-			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station SR15 (Middle) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L	
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						2/8/2022	Sunny	12:59	2.7	1.4	29.95	29.96	9.39	9.39	26.19	26.33	110.10	108.70	7.22
4/8/2022	Rainy	13:00	2.7	1.4	29.96	28.32	9.38	9.83	26.46	25.66	107.30	99.65	7.01	6.73	5.67	4.65	3.0	2.6	
		13:02	2.8	1.4	28.29	28.32	9.86	9.83	25.46	25.66	96.20	99.65	6.50	6.73	4.47	4.65	2.5	2.6	
6/8/2022	Cloudy	12:58	2.7	1.4	28.25	28.23	9.13	9.26	24.06	23.95	113.40	113.30	7.74	7.74	3.76	4.21	2.1	2.2	
		12:59	2.7	1.4	28.21	28.23	9.39	9.26	23.84	23.95	113.20	113.30	7.74	7.74	4.65	4.21	2.2	2.2	
9/8/2022	T3																		
Sampling was cancelled due to adverse weather																			
11/8/2022	Rainy	15:59	2.7	1.4	26.90	26.85	8.27	8.27	29.40	29.35	79.30	80.60	5.45	5.57	12.92	12.94	6.2	6.1	
		16:00	2.7	1.4	26.80	26.85	8.27	8.27	29.30	29.35	81.90	80.60	5.68	5.57	12.95	12.94	5.9	6.1	
13/8/2022	Sunny	12:57	2.7	1.4	28.20	28.20	8.11	8.14	29.96	29.97	91.40	91.90	6.17	6.13	8.64	8.60	4.5	4.7	
		12:58	2.7	1.4	28.20	28.20	8.17	8.14	29.97	29.97	92.40	91.90	6.08	6.13	8.56	8.60	4.8	4.7	
15/8/2022	Sunny	8:57	2.8	1.4	28.40	28.40	7.86	7.88	28.73	28.71	90.10	91.05	6.14	6.17	1.91	1.93	3.9	3.8	
		8:58	2.8	1.4	28.40	28.40	7.90	7.88	28.68	28.71	92.00	91.05	6.20	6.17	1.95	1.93	3.6	3.8	
17/8/2022	Cloudy	8:59	2.6	1.3	28.60	28.65	8.10	8.11	28.86	28.87	103.30	104.75	6.98	7.03	1.80	1.78	2.8	2.8	
		9:00	2.6	1.3	28.70	28.65	8.11	8.11	28.87	28.87	106.20	104.75	7.08	7.03	1.75	1.78	2.8	2.8	
19/8/2022	Cloudy	9:10	2.5	1.3	29.50	29.60	8.26	8.29	29.01	29.50	112.80	114.35	7.39	7.51	0.66	0.72	1.6	1.7	
		9:11	2.5	1.3	29.70	29.60	8.32	8.29	29.98	29.50	115.90	114.35	7.63	7.51	0.77	0.72	1.8	1.7	
22/8/2022	Sunny	13:01	2.4	1.2	30.50	30.55	8.42	8.43	28.21	28.22	109.90	110.85	7.20	7.26	5.27	5.26	7.1	7.2	
		13:02	2.4	1.2	30.60	30.55	8.44	8.43	28.22	28.22	111.80	110.85	7.32	7.26	5.25	5.26	7.3	7.2	
24/8/2022	T3																		
Sampling was cancelled due to adverse weather																			
26/8/2022	Cloudy	13:05	2.5	1.3	28.60	28.60	8.10	8.11	30.16	30.17	98.20	97.85	6.75	6.66	10.22	10.14	6.5	6.7	
		13:06	2.5	1.3	28.60	28.60	8.11	8.11	30.18	30.17	97.50	97.85	6.56	6.66	10.06	10.14	6.9	6.7	
29/8/2022	Sunny	8:54	2.6	1.3	28.70	28.70	7.75	7.80	29.81	29.83	94.20	93.80	6.41	6.34	5.57	5.58	4.8	4.7	
		8:55	2.6	1.3	28.70	28.70	7.85	7.80	29.84	29.83	93.40	93.80	6.26	6.34	5.58	5.58	4.5	4.7	

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CE (surface) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
CE	2/8/2022	Sunny	10:15	8.7	1.0	29.10	29.23	9.36	9.27	26.40	26.66	116.50	115.45	7.72	7.64	5.47	5.09	4.70	2.4	2.4	
			10:16	8.7	1.0	29.27		9.17		26.83		114.40		7.55		4.70		2.4			
	4/8/2022	Rainy	11:21	8.7	1.0	28.26	28.26	9.62	9.63	26.11	26.21	100.80	97.55	6.79	6.57	5.40	5.12	4.84	1.7	1.7	
			11:22	8.7	1.0	28.25		9.64		26.30		94.30		6.35		4.84		1.6			
	6/8/2022	Cloudy	10:18	8.4	1.0	28.45	28.39	9.32	9.30	23.55	23.65	95.10	96.70	6.48	6.60	4.86	4.39	2.6	2.5	2.5	
			10:19	8.4	1.0	28.32		9.28		23.74		98.30		6.71		3.92		2.3			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	10:47	8.9	1.0	26.20	26.30	8.21	8.23	28.10	28.41	77.80	77.35	5.30	5.36	20.71	20.79	10.5	10.4	10.4	10.4
			10:48	8.9	1.0	26.40		8.24		28.72		76.90		5.42		20.86		10.3			
	13/8/2022	Sunny	10:47	8.9	1.0	28.00	28.00	8.13	8.14	30.15	30.09	88.60	88.30	6.14	6.11	2.05	2.06	2.8	2.6	2.7	2.7
			10:48	8.9	1.0	28.00		8.14		30.04		88.00		6.07		2.06		2.6			
	15/8/2022	Sunny	12:01	9.0	1.0	28.80	28.70	8.12	8.13	28.92	28.95	96.00	96.20	6.35	6.46	1.78	1.84	3.2	3.3	3.3	3.3
			12:02	9.0	1.0	28.60		8.14		28.97		95.40		6.57		1.89		3.4			
	17/8/2022	Cloudy	12:01	8.9	1.0	29.10	29.15	8.36	8.37	28.96	28.87	110.90	110.90	7.28	7.34	1.66	1.71	2.3	2.2	2.2	2.2
			12:02	8.9	1.0	29.20		8.38		28.87		12.30		7.40		1.76		2.1			
	19/8/2022	Cloudy	12:01	8.7	1.0	29.40	29.40	8.43	8.44	28.84	28.84	117.80	115.00	7.73	7.57	0.63	0.64	2.3	2.2	2.2	2.2
			12:02	8.7	1.0	29.40		8.45		28.84		112.20		7.40		0.65		2.1			
	22/8/2022	Sunny	10:01	8.6	1.0	30.20	30.25	8.39	8.40	28.83	28.83	115.00	114.85	7.45	7.47	4.88	4.98	3.4	3.6	3.6	3.6
			10:02	8.6	1.0	30.30		8.41		28.83		114.70		7.49		5.07		3.8			
	24/8/2022	Cloudy	10:14	8.6	1.0	30.40	30.40	8.44	8.46	27.84	27.85	118.20	117.70	7.66	7.66	2.73	2.74	1.6	1.6	1.6	1.6
			10:15	8.6	1.0	30.40		8.47		27.85		117.20		7.65		2.74		1.5			
	26/8/2022	Cloudy	10:19	8.7	1.0	28.00	28.00	8.07	8.08	30.40	30.39	95.70	94.80	6.78	6.63	9.10	9.07	9.4	9.3	9.3	9.3
			10:20	8.7	1.0	28.00		8.08		30.37		93.90		6.47		9.03		9.1			
	29/8/2022	Sunny	12:01	8.9	1.0	29.10	29.10	8.11	8.13	29.50	29.52	124.30	119.35	8.11	7.88	3.92	3.89	2.9	2.8	2.8	2.8
			12:02	8.9	1.0	29.10		8.14		29.54		114.40		7.65		3.86		2.6			
	29/8/2022	Sunny	12:01	0.0	1.0	29.30	29.40	8.15	8.16	29.64	29.64	111.00	108.90	7.27	7.15	3.40	3.35	-	-	-	-
			12:02	0.0	1.0	29.50		8.17		29.64		106.80		7.02		3.29		-			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CE (surface) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						Sampling was cancelled due to adverse weather															
CE	2/8/2022	Sunny	12:00	8.8	1.0	30.08	30.19	5.59	7.60	25.97	26.20	108.80	110.85	6.99	7.18	5.35	5.06	2.8	2.7	2.7	
			12:01	8.8	1.0	30.28		9.80		26.43		112.90		7.37		4.77		2.5			
	4/8/2022	Rainy	12:01	8.9	1.0	28.40	28.41	9.71	9.69	26.56	26.52	95.20	100.25	6.39	6.73	5.16	4.69	3.2	3.1	3.1	
			12:02	8.8	1.0	28.41		9.67		26.47		105.30		7.06		4.22		2.9			
	6/8/2022	Cloudy	12:01	8.3	1.0	28.46	28.44	9.18	9.16	23.17	23.23	97.30	98.70	6.64	6.74	4.84	4.44	2.1	2.0	2.0	
			12:02	8.3	1.0	28.42		9.13		23.28		100.10		6.84		4.04		1.8			
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:01	8.8	1.0	26.10	26.10	8.26	8.26	28.16	28.38	83.20	81.10	5.88	5.68	20.70	20.77	10.6	10.5	10.5	10.5
			12:02	8.8	1.0	26.10		8.26		28.59		79.00		5.48		20.83		10.3			
	13/8/2022	Sunny	12:01	8.7	1.0	29.60	28.55	8.10	8.12	30.45	30.42	88.30	88.30	6.06	6.01	7.35	7.32	3.2	3.2	3.2	3.2
			12:02	8.7	1.0	27.50		8.13		30.38		86.60		5.95		7.29		3.1			
	15/8/2022	Sunny	10:14	8.9	1.0	28.40	28.40	8.12	8.13	26.68	27.67	90.50	90.85	6.23	6.25	1.64	1.64	1.6	1.6	1.6	1.6
			10:15	8.9	1.0	28.40		8.13		26.65		91.20		6.27		1.63		1.5			
	17/8/2022	Cloudy	10:17	8.6	1.0	28.70	28.75	8.37	8.38	28.90	28.90	111.03	109.42	7.34	7.24	1.36	1.36	3.7	3.5	3.5	3.5
			10:18	8.6	1.0	28.80		8.38		28.89		107.80		7.13		1.35		3.3			
	19/8/2022	Cloudy	10:20	8.5	1.0	29.30	29.35	8.43	8.45	28.80	28.82	115.70	113.70	7.26	7.35	0.77	0.77	3.2	3.1	3.1	3.1
			10:21	8.5	1.0	29.40		8.46		28.84		111.70		7.43		0.77		2.9			
	22/8/2022	Sunny	12:02	8.4	1.0	29.90	29.70	8.31	8.34	28.51	28.75	113.70	116.05	7.42	7.59	4.73	4.79	3.9	4.1	4.1	4.1
			12:03	8.4	1.0	29.50		8.36		28.99		118.40		7.76		4.85		4.2			
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:01	8.6	1.0	28.00	28.10	8.05	8.06	30.12	30.12	90.60	93.30	6.64	6.62	13.18	13.22	9.5	9.7	9.7	9.7
			12:02	8.6	1.0	28.20		8.07		30.11		96.00		6.60		13.25		9.9			
	29/8/2022	Sunny	10:08	8.7	1.0	29.30	29.30	8.17	8.18	29.33	29.35	103.20	102.75	6.97	6.93	2.88	2.88	2.1	2.3	2.3	2.3
			10:09	8.7	1.0	29.30		8.19		29.36		102.30		6.88		2.87		2.4			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CE (Middle) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
CE	2/8/2022	Sunny	10:19	8.7	4.4	29.31	29.37	9.43	9.36	26.99	27.06	114.30	114.00	7.53	7.50	4.94	4.57	1.9	1.8		
			10:20	8.7	4.4	29.43	29.37	9.29	9.36	27.12	27.06	113.30	114.00	7.47	7.50	4.20	4.57	1.7	1.8		
	4/8/2022	Rainy	11:25	8.7	4.4	28.27	28.27	9.79	9.69	26.35	26.33	92.70	91.75	6.29	6.18	4.69	4.59	2.2	2.4		
			11:26	8.7	4.4	28.27	28.27	9.65	9.69	26.30	26.33	90.80	91.75	6.11	6.18	4.49	4.59	2.5	2.4		
	6/8/2022	Cloudy	10:22	8.4	4.2	28.28	28.28	9.32	9.33	23.91	23.95	88.20	91.05	6.02	6.21	4.13	4.05	2.7	2.9		
			10:23	8.4	4.2	28.27	28.28	9.33	9.33	23.99	23.95	93.90	91.05	6.40	6.21	3.97	4.05	3.0	2.9		
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	10:51	8.9	4.5	26.30	26.25	8.27	8.27	28.89	29.10	73.10	75.30	5.06	5.24	16.43	16.34	118.0	64.7		
			10:52	8.9	4.5	26.20	26.25	8.27	8.27	29.31	29.10	77.50	75.30	5.41	5.24	16.25	16.34	11.3	64.7		
	13/8/2022	Sunny	10:51	8.9	4.5	28.10	28.05	8.15	8.15	30.08	30.10	89.40	88.80	6.11	6.06	4.12	4.12	3.6	3.5		
			10:52	8.9	4.5	28.00	28.05	8.15	8.15	30.12	30.10	88.20	88.80	6.00	6.06	4.11	4.12	3.4	3.5		
	15/8/2022	Sunny	12:05	9.0	4.5	28.80	28.80	8.15	8.16	29.22	29.22	94.40	96.80	6.37	6.58	2.21	2.42	2.2	2.4		
			12:06	9.0	4.5	28.80	28.80	8.16	8.16	29.21	29.21	99.20	96.80	6.78	6.58	2.62	2.42	2.5	2.4		
	17/8/2022	Cloudy	12:05	8.9	4.5	29.10	29.05	8.39	8.39	28.88	28.89	108.60	109.05	7.16	7.21	1.49	1.56	3.4	3.3		
			12:06	8.9	4.5	29.00	29.05	8.39	8.39	28.89	28.89	109.50	109.05	7.25	7.21	1.63	1.56	3.1	3.3		
	19/8/2022	Cloudy	12:05	8.7	4.4	29.30	29.25	8.46	8.46	28.88	28.85	110.80	110.40	7.34	7.31	0.93	0.93	3.4	3.3		
			12:06	8.7	4.4	29.20	29.25	8.47	8.47	28.84	28.85	110.00	110.40	7.27	7.31	0.93	0.93	3.1	3.3		
	22/8/2022	Sunny	10:05	8.6	4.3	29.80	29.85	8.41	8.41	29.01	29.00	111.20	112.05	7.39	7.41	3.24	3.12	4.2	4.2		
			10:06	8.6	4.3	29.90	29.85	8.41	8.41	28.98	29.00	112.90	112.05	7.42	7.41	3.00	3.12	4.1	4.2		
	24/8/2022	Cloudy	10:18	8.6	4.3	30.10	30.10	8.48	8.40	27.91	27.91	120.00	119.75	7.86	7.85	2.19	2.25	2.7	2.9		
			10:19	8.6	4.3	30.10	30.10	8.49	8.40	27.90	27.91	119.50	119.75	7.83	7.85	2.31	2.25	3.0	2.9		
	26/8/2022	Cloudy	10:23	8.7	4.4	27.90	27.90	8.08	8.09	30.47	30.47	88.90	89.40	6.42	6.52	18.67	18.69	19.8	20.0		
			10:24	8.7	4.4	27.90	27.90	8.09	8.09	30.46	30.47	89.90	89.40	6.62	6.52	18.70	18.69	20.2	20.0		
	29/8/2022	Sunny	12:05	8.9	4.5	29.10	29.15	8.16	8.17	29.54	29.58	100.10	102.80	7.28	7.21	4.32	4.32	3.3	3.5		
			12:06	8.9	4.5	29.20	29.15	8.17	8.17	29.61	29.61	105.50	105.50	7.14	7.14	4.31	4.31	3.7	3.5		
	29/8/2022	Sunny	12:05	0.0	4.4	29.60	29.65	8.17	8.18	29.67	29.66	105.40	107.60	6.99	7.11	3.93	3.93	-	-		
			12:06	0.0	4.4	29.70	29.65	8.18	8.18	29.65	29.65	109.80	107.60	7.22	7.11	3.93	3.93	-	-		

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CE (Middle) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						Sampling was cancelled due to adverse weather															
CE	2/8/2022	Sunny	12:04	8.8	4.4	30.27	30.00	9.31	9.39	26.42	26.87	118.00	115.70	7.88	7.55	5.91	5.56	2.3	2.3		
			12:05	8.8	4.4	29.72	30.00	9.47	9.39	27.31	27.13	113.40	115.70	7.41	7.55	5.21	5.21	2.2	2.3		
	4/8/2022	Rainy	12:05	8.9	4.4	28.23	28.22	9.77	9.74	27.13	27.21	90.30	99.95	6.05	6.70	4.09	4.24	2.6	2.5		
			12:06	8.8	4.4	28.20	28.22	9.71	9.74	27.28	27.21	109.60	99.95	7.34	6.70	4.39	4.24	2.3	2.5		
	6/8/2022	Cloudy	12:05	8.3	4.2	28.10	28.09	9.22	9.21	26.05	26.21	113.40	105.00	7.66	7.09	4.75	4.86	1.8	1.5		
			12:06	8.3	4.2	28.08	28.09	9.19	9.21	26.36	26.21	96.60	105.00	6.52	7.09	4.97	4.86	1.2	1.5		
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	12:05	8.8	4.4	26.30	26.30	8.26	8.24	29.33	29.12	75.30	76.65	5.30	5.38	16.40	16.32	14.7	14.9		
			12:06	8.8	4.4	26.30	26.30	8.21	8.24	28.91	29.12	78.00	76.65	5.46	5.38	16.23	16.32	15.0	14.9		
	13/8/2022	Sunny	12:05	8.7	4.4	27.50	27.55	8.14	8.15	30.41	30.40	86.70	85.00	6.04	5.99	7.49	7.55	4.6	4.5		
			12:06	8.7	4.4	27.60	27.55	8.15	8.15	30.39	30.40	83.30	85.00	5.93	5.99	7.60	7.55	4.4	4.5		
	15/8/2022	Sunny	10:18	8.9	4.5	28.50	28.50	8.15	8.16	29.00	29.02	94.10	93.25	6.37	6.33	1.28	1.24	1.8	1.8		
			10:19	8.9	4.5	28.50	28.50	8.16	8.16	29.04	29.02	92.40	93.25	6.28	6.33	1.20	1.24	1.8	1.8		
	17/8/2022	Cloudy	10:21	8.6	4.3	28.80	28.80	8.39	8.40	28.39	28.63	107.10	107.40	7.09	7.14	1.20	1.19	2.6	2.8		
			10:22	8.6	4.3	28.80	28.80	8.40	8.40	28.96	28.63	107.70	107.40	7.18	7.14	1.18	1.19	3.0	2.8		
	19/8/2022	Cloudy	10:24	8.5	4.3	29.30	29.30	8.46	8.46	28.85	28.86	113.20	114.40	7.46	7.55	0.82	0.74	3.7	3.7		
			10:25	8.5	4.3	29.30	29.30	8.46	8.46	28.87	28.86	115.60	114.40	7.63	7.55	0.86	0.74	3.6	3.7		
	22/8/2022	Sunny	12:06	8.4	4.2	29.40	29.20	8.38	8.36	29.06	29.03	113.00	108.65	7.42	7.25	5.83	5.89	4.6	4.8		
			12:07	8.4	4.2	29.00	29.20	8.33	8.36	29.00	29.03	104.30	108.65	7.08	7.25	5.95	5.89	4.9	4.8		
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	12:05	8.6	4.3	27.90	27.90	8.08	8.09	30.39	30.41	93.10	94.30	6.81	6.79	13.25	13.25	10.8	11.0		
			12:06	8.6	4.3	27.90	27.90	8.09	8.09	30.42	30.41	95.50	94.30	6.77	6.79	13.25	13.25	11.2	11.0		
	29/8/2022	Sunny	10:12	8.7	4.4	29.30	29.20	8.18	8.17	29.39	29.50	105.60	103.40	6.97	6.90	2.77	3.19	2.6	2.8		
			10:13	8.7	4.4	29.10	29.20	8.16	8.17	29.61	29.50	101.20	103.40	6.82	6.90	3.61	3.19	3.0	2.8		

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CE (Bottom) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						2/8/2022	Sunny	10:22	8.7	7.7	29.05	29.13	9.89	9.57	27.58	26.59	101.40	107.15	6.89	7.08	3.88
4/8/2022	Rainy	10:23	8.7	7.7	29.21	28.23	9.24	9.61	25.59	27.07	112.90	102.30	7.47	6.86	4.36	5.58	1.4	3.0			
		11:28	8.7	7.7	28.24	28.23	9.65	9.61	26.82	27.07	91.20	102.30	6.19	6.86	6.94	5.58	2.8	3.1			
6/8/2022	Cloudy	10:25	8.4	7.4	28.23	28.25	9.71	9.65	29.25	28.26	90.80	90.85	6.09	6.09	5.99	5.37	3.3	2.5			
		10:26	8.4	7.4	28.27	28.25	9.59	9.59	27.26	28.26	90.90	90.85	6.08	6.09	4.74	5.37	1.7	1.7			
9/8/2022	T3	Sampling was cancelled due to adverse weather																			
11/8/2022	Rainy	10:54	8.9	7.9	26.30	26.30	8.26	8.26	29.87	29.83	74.10	74.05	5.18	5.18	19.90	19.91	13.4	13.6			
		10:55	8.9	7.9	26.30	26.30	8.25	8.25	29.79	29.83	74.00	74.05	5.18	5.18	19.92	19.91	13.8	13.6			
13/8/2022	Sunny	10:54	8.9	7.9	28.30	28.35	8.15	8.16	30.27	30.26	85.90	86.55	5.91	5.98	4.85	4.85	4.5	4.3			
		10:55	8.9	7.9	28.40	28.35	8.16	8.16	30.24	30.26	87.20	86.55	6.05	5.98	4.84	4.85	4.1	4.3			
15/8/2022	Sunny	12:09	9.0	8.0	28.80	28.80	8.16	8.16	29.49	29.49	95.50	95.20	6.49	6.43	2.20	2.40	1.6	1.7			
		12:10	9.0	8.0	28.80	28.80	8.16	8.16	29.49	29.49	94.90	95.20	6.37	6.43	2.60	2.40	1.7	1.7			
17/8/2022	Cloudy	12:08	8.9	7.9	29.00	29.05	8.39	8.40	28.89	28.89	104.40	104.45	6.90	6.91	1.63	1.63	4.4	4.3			
		12:09	8.9	7.9	29.00	29.05	8.40	8.40	28.88	28.89	104.50	104.45	6.91	6.91	1.62	1.63	4.2	4.3			
19/8/2022	Cloudy	12:08	8.7	7.7	29.00	29.00	8.46	8.46	29.05	29.02	109.70	109.40	7.22	7.21	1.63	1.63	4.4	4.3			
		12:09	8.7	7.7	29.00	29.00	8.46	8.46	28.99	29.02	109.10	109.40	7.19	7.21	1.63	1.63	4.2	4.3			
22/8/2022	Sunny	10:08	8.6	7.6	29.30	29.35	8.34	8.32	29.56	29.53	107.00	106.85	7.30	7.24	5.84	5.83	4.8	4.7			
		10:09	8.6	7.6	29.40	29.35	8.29	8.32	29.50	29.53	106.70	106.85	7.18	7.24	5.81	5.83	4.6	4.7			
24/8/2022	Cloudy	10:21	8.6	7.6	30.00	30.00	8.50	8.51	27.85	27.84	123.40	122.35	8.05	8.01	1.75	1.83	4.1	3.5			
		10:22	8.6	7.6	30.00	30.00	8.51	8.51	27.83	27.84	121.30	122.35	7.96	8.01	1.90	1.83	2.8	3.5			
26/8/2022	Cloudy	10:26	8.7	7.7	27.90	27.95	8.09	8.10	30.53	30.53	91.20	90.95	6.58	6.44	31.85	31.15	24.2	24.5			
		10:27	8.7	7.7	28.00	27.95	8.10	8.10	30.52	30.53	90.70	90.95	6.30	6.44	30.44	31.15	24.8	24.5			
29/8/2022	Sunny	12:08	8.9	7.9	29.20	29.25	8.16	8.17	29.61	29.63	107.00	108.50	7.09	7.14	4.25	4.20	4.4	4.3			
		12:09	8.9	7.9	29.30	29.25	8.17	8.17	29.65	29.63	110.00	108.50	7.19	7.14	4.14	4.20	4.1	4.3			
29/8/2022	Sunny	12:08	0.0	7.7	30.00	30.10	8.18	8.19	29.90	29.93	109.50	105.65	7.14	6.94	3.17	3.23	-	-			
		12:09	0.0	7.7	30.20	30.10	8.19	8.19	29.95	29.93	101.80	105.65	6.74	6.94	3.29	3.23	-	-			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CE (Bottom) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						2/8/2022	Sunny	12:07	8.8	7.8	29.36	29.33	9.64	9.37	23.02	24.10	99.50	102.25	6.54	6.72	3.72
4/8/2022	Rainy	12:08	8.8	7.8	29.30	28.15	9.09	9.71	25.17	26.81	105.00	106.85	6.89	7.19	3.65	4.48	1.9	2.2			
		12:08	8.8	7.8	28.14	28.15	9.76	9.71	26.81	26.81	100.10	106.85	6.73	7.19	4.62	4.48	2.2	2.2			
6/8/2022	Cloudy	12:08	8.3	7.3	28.01	28.01	9.15	9.20	26.39	26.47	113.10	104.25	7.64	7.04	3.99	4.27	1.4	1.3			
		12:09	8.3	7.3	28.00	28.01	9.25	9.20	26.54	26.47	95.40	104.25	6.44	7.04	4.54	4.27	1.2	1.3			
9/8/2022	T3	Sampling was cancelled due to adverse weather																			
11/8/2022	Rainy	12:08	8.8	7.8	26.20	26.20	8.25	8.25	29.85	29.87	67.80	69.00	4.89	4.95	19.86	19.88	31.6	31.5			
		12:09	8.8	7.8	26.20	26.20	8.25	8.25	29.88	29.87	70.20	69.00	5.00	4.95	19.90	19.88	31.3	31.5			
13/8/2022	Sunny	12:08	8.7	7.7	27.70	27.75	8.16	8.16	30.38	30.39	89.00	88.50	6.18	6.14	7.13	7.15	5.6	5.5			
		12:09	8.7	7.7	27.80	27.75	8.16	8.16	30.39	30.39	88.00	88.50	6.09	6.14	7.17	7.15	5.3	5.5			
15/8/2022	Sunny	10:21	8.9	7.9	28.40	28.40	8.16	8.16	29.54	27.55	92.30	94.30	6.22	6.16	2.19	2.23	2.2	2.3			
		10:22	8.9	7.9	28.40	28.40	8.15	8.16	25.56	27.55	96.30	94.30	6.09	6.16	2.27	2.23	2.4	2.3			
17/8/2022	Cloudy	10:24	8.6	7.6	28.70	28.70	8.39	8.39	28.90	28.88	110.60	111.30	7.36	7.42	1.63	1.63	2.2	2.4			
		10:25	8.6	7.6	28.70	28.70	8.39	8.39	28.85	28.88	112.00	111.30	7.48	7.42	1.63	1.63	2.5	2.4			
19/8/2022	Cloudy	10:27	8.5	7.5	29.10	29.05	8.45	8.45	29.09	29.08	111.20	111.65	7.37	7.42	0.77	0.78	4.4	4.6			
		10:28	8.5	7.5	29.00	29.05	8.44	8.45	29.06	29.08	112.10	111.65	7.47	7.42	0.79	0.78	4.7	4.6			
22/8/2022	Sunny	12:09	8.4	7.4	28.90	28.90	8.22	8.22	29.76	29.75	93.20	92.75	6.45	6.40	8.45	8.38	5.5	5.7			
		12:10	8.4	7.4	28.90	28.90	8.21	8.22	29.73	29.75	92.30	92.75	6.34	6.40	8.31	8.38	5.8	5.7			
24/8/2022	T3	Sampling was cancelled due to adverse weather																			
26/8/2022	Cloudy	12:08	8.6	7.6	28.00	28.00	8.09	8.10	30.49	30.42	90.60	90.85	6.64	6.47	21.93	21.92	14.0	13.8			
		12:09	8.6	7.6	28.00	28.00	8.10	8.10	30.35	30.42	91.10	90.85	6.30	6.47	21.91	21.92	13.5	13.8			
29/8/2022	Sunny	10:15	8.7	7.7	28.90	28.90	8.13	8.13	30.02	30.02	92.70	94.15	6.22	6.32	4.47	4.54	3.5	3.4			
		10:16	8.7	7.7	28.90	28.90	8.12	8.13	30.01	30.02	95.60	94.15	6.41	6.32	4.60	4.54	3.2	3.4			

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CF (surface) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L							
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG				
						Sampling was cancelled due to adverse weather																			
CF	2/8/2022	Sunny	8:50	8.8	1.0	29.54	29.53	8.88	9.00	25.37	25.48	159.90	155.30	10.89	10.28	5.32	5.09	4.86	2.8						
			8:51	8.8	1.0	29.51		9.19		25.59		150.70		9.97		4.86									
			10:06	8.6	1.0	28.00		9.50		25.48		121.80		8.27		5.16									
	4/8/2022	Rainy	10:07	8.6	1.0	27.92	27.96	9.51	9.51	25.76	25.62	140.30	131.05	8.90	8.90	5.11	5.14	3.0	3.3						
			8:50	8.5	1.0	28.25		9.20		25.64		110.90		7.49		4.22									
			8:51	8.5	1.0	28.13		9.11		26.87		99.80		6.71		3.86									
	9/8/2022	T3	Sampling was cancelled due to adverse weather																						
	11/8/2022	Rainy	9:25	9.8	1.0	27.80	27.80	8.01	7.96	29.89	29.96	76.30	77.85	5.12	5.31	15.58	15.56	15.6	15.8						
			9:26	9.8	1.0	27.80		7.90		30.03		79.40		5.50		15.54									
			9:02	9.9	1.0	27.20		7.40		30.11		87.80		6.49		6.76									
	13/8/2022	Sunny	9:03	9.9	1.0	27.60	27.40	7.25	7.15	30.17	30.14	85.80	86.80	6.39	6.39	6.74	6.74	5.5	5.5						
			13:12	9.1	1.0	29.00		8.16		8.17		28.79		28.81		96.00		96.20		6.33	6.40	1.07	1.06	2.3	2.3
			13:13	9.1	1.0	29.10		8.17		8.17		28.82		28.82		96.40		96.40		6.46	6.46	1.04	1.04	2.2	2.2
	17/8/2022	Cloudy	13:18	8.9	1.0	28.90	28.90	8.45	8.46	28.82	28.83	115.30	115.85	7.69	7.67	1.76	1.76	2.9	3.1						
			13:19	8.9	1.0	28.90		8.46		28.84		115.40		7.65		1.76									
			13:17	8.7	1.0	29.60		8.41		29.14		115.00		7.54		1.19									
	19/8/2022	Cloudy	13:18	8.7	1.0	29.70	29.65	8.44	8.43	29.11	29.13	108.90	111.95	7.29	7.42	1.19	1.19	2.9	3.1						
			8:20	8.8	1.0	28.90		7.22		29.29		111.20		7.43		1.58									
			8:21	8.8	1.0	29.00		7.45		28.92		109.30		7.33		1.53									
	22/8/2022	Sunny	8:34	9.2	1.0	30.30	30.35	7.69	7.77	27.05	27.06	117.80	117.70	7.73	7.69	1.37	1.36	2.9	2.9						
			8:35	9.2	1.0	30.40		7.84		27.06		117.60		7.64		1.35									
			8:39	8.8	1.0	27.80		7.80		30.44		91.20		6.26		6.34									
	26/8/2022	Cloudy	8:40	8.8	1.0	27.80	27.80	7.58	7.54	30.45	30.45	93.60	92.40	6.42	6.42	10.52	10.61	9.6	9.3						
			13:16	8.7	1.0	29.50		8.21		29.45		107.50		7.09		6.96									
			13:17	8.7	1.0	29.60		8.23		29.47		104.70		6.82		4.24									
	29/8/2022	Sunny	13:15	0.0	1.0	29.30	29.35	8.26	8.27	30.16	30.13	109.10	109.25	7.13	7.17	4.61	4.52	-	-						
			13:16	0.0	1.0	29.40		8.27		30.09		109.40		7.20		4.43									
			13:16	0.0	1.0	29.40		8.27		30.09		109.40		7.20		4.43									

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CF (surface) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG		
						Sampling was cancelled due to adverse weather															
CF	2/8/2022	Sunny	13:14	8.6	1.0	29.86	29.83	9.39	9.29	26.61	26.28	110.70	115.40	7.28	7.59	6.67	6.10	2.6	2.5		
			13:15	8.6	1.0	29.80		9.19		25.94		120.10		7.90		5.53					
			13:15	8.6	1.0	28.50		9.80		25.19		106.00		7.15		5.54					
	4/8/2022	Rainy	13:16	8.8	1.0	28.48	28.49	9.89	9.90	25.30	25.25	97.90	101.95	6.60	6.88	4.50	5.02	3.7	3.6		
			13:17	8.6	1.0	28.22		9.26		23.70		93.20		6.37		4.24					
			13:18	8.6	1.0	28.21		9.25		23.78		90.60		6.19		3.95					
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	13:15	8.8	1.0	26.80	26.85	8.17	8.21	30.28	30.21	74.20	74.35	5.07	5.10	20.77	20.81	12.0	12.2		
			13:16	8.8	1.0	26.90		8.24		30.13		74.50		5.13		20.85					
			13:17	9.5	1.0	27.60		8.15		30.04		92.90		6.36		3.74					
	13/8/2022	Sunny	13:18	9.5	1.0	27.70	27.65	8.16	8.16	29.95	30.00	92.60	92.75	6.29	6.33	3.61	3.68	3.5	3.4		
			8:32	9.2	1.0	27.90		7.90		29.79		29.80		91.10		6.24		6.16			
			8:33	9.2	1.0	27.90		7.33		29.81		85.00		6.07		3.45					
	17/8/2022	Cloudy	8:34	8.4	1.0	28.70	28.65	7.70	7.75	28.83	28.84	103.30	101.85	6.94	6.88	2.05	1.40	5.3	5.2		
			8:35	8.4	1.0	28.60		7.79		28.85		100.40		6.82		0.75					
			8:38	8.6	1.0	29.00		7.70		29.00		114.30		7.54		1.63					
	19/8/2022	Cloudy	8:39	8.6	1.0	29.1	29.00	7.87	7.79	29.01	29.01	113.90	114.10	7.59	7.57	1.76	1.70	2.2	2.4		
			13:14	8.4	1.0	29.90		8.45		26.98		113.10		7.46		2.97					
			13:15	8.4	1.0	29.90		8.47		26.88		115.50		7.65		3.01					
	22/8/2022	Sunny	Sampling was cancelled due to adverse weather																		
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
			26/8/2022	Cloudy	13:16	8.6	1.0	28.00	28.00	8.11	8.12	30.47	30.47	97.30	98.50	6.74	6.81	19.67	19.80	6.4	6.6
					13:17	8.6	1.0	28.00		8.12		30.47		99.70		6.88		19.92			
	8:32	8.8			1.0	28.50	7.17	29.46		99.20		6.80		4.63							
	29/8/2022	Sunny	8:33	8.8	1.0	28.50	28.50	7.29	7.23	29.46	29.46	95.70	97.45	6.46	6.63	4.61	4.62	2.8	3.0		
			8:33	8.8	1.0	28.50		7.29		29.46		95.70		6.46		4.61					
			8:33	8.8	1.0	28.50		7.29		29.46		95.70		6.46		4.61					

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CF (Middle) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
CF	2/8/2022	Sunny	8:54	8.8	4.4	29.46	29.45	9.12	9.17	25.88	25.75	145.50	129.80	9.30	8.60	5.02	4.89	2.5	2.4		
			8:55	8.8	4.4	29.43		9.22	25.81	119.10	7.89	4.76	2.2								
	4/8/2022	Rainy	10:10	8.6	4.3	27.89	27.85	9.54	9.53	25.70	25.84	106.50	116.90	7.29	7.94	5.28	5.03	2.4	2.3		
			10:11	8.6	4.3	27.81		9.52	25.97	127.30	8.65	4.78	2.2								
	6/8/2022	Cloudy	8:54	8.5	4.3	28.21	28.19	9.28	9.21	26.56	26.63	136.20	134.85	9.17	9.08	3.66	3.71	2.2	2.4		
			8:55	8.5	4.3	28.17		9.13	26.70	133.50	8.98	3.75	2.6								
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	9:29	9.8	4.9	27.90	27.50	8.03	8.10	30.10	30.42	85.10	84.40	5.90	5.69	21.93	21.94	15.1	14.9		
			9:30	9.8	4.9	27.10		8.16	30.73	83.70	5.48	21.94	14.6								
	13/8/2022	Sunny	9:06	9.9	5.0	27.60	27.70	7.35	7.35	30.36	30.36	84.60	85.60	6.03	6.15	9.19	9.18	6.4	6.6		
			9:07	9.9	5.0	27.80		7.35	30.36	86.60	6.26	9.17	6.8								
	15/8/2022	Sunny	13:16	9.1	4.6	28.80	28.85	8.18	8.19	29.03	28.99	96.90	96.10	6.51	6.47	1.93	1.85	3.0	3.2		
			13:17	9.1	4.6	28.90		8.19	28.94	95.30	6.43	1.77	3.4								
	17/8/2022	Cloudy	13:22	8.9	4.5	28.90	28.85	8.47	8.47	28.88	28.88	112.50	113.05	7.44	7.47	1.85	1.88	3.5	3.7		
			13:23	8.9	4.5	29.60		8.47	28.97	113.60	7.50	1.90	3.5								
	19/8/2022	Cloudy	13:21	8.7	4.4	29.60	29.65	8.43	8.43	29.27	29.25	110.60	112.95	7.20	7.36	2.31	2.26	3.5	3.7		
			13:22	8.7	4.4	29.70		8.43	29.22	115.30	7.52	2.20	3.8								
	22/8/2022	Sunny	8:24	8.8	4.4	29.20	29.15	7.60	7.67	28.09	28.72	108.70	106.60	7.23	7.19	3.60	3.67	4.2	4.3		
			8:25	8.8	4.4	29.10		7.74	29.35	104.50	7.15	3.74	4.3								
	24/8/2022	Cloudy	8:38	9.2	4.6	30.40	30.40	7.92	7.96	27.15	27.12	114.00	112.40	7.48	7.45	2.31	2.27	2.2	2.3		
			8:39	9.2	4.6	30.40		7.99	27.08	110.80	7.42	2.22	2.4								
	26/8/2022	Cloudy	8:43	8.8	4.4	27.70	27.70	7.63	7.66	30.82	30.81	86.20	85.15	6.20	6.16	25.73	25.75	18.8	19.0		
			8:44	8.8	4.4	27.70		7.69	30.79	84.10	6.11	25.77	19.2								
	29/8/2022	Sunny	13:20	8.7	4.4	28.90	28.85	98.20	53.20	29.89	29.90	102.10	102.15	6.71	6.76	4.47	4.41	3.5	3.4		
			13:21	8.7	4.4	28.80		8.19	29.91	102.20	6.81	4.36	3.3								
	29/8/2022	Sunny	13:19	0.0	4.5	29.20	29.25	8.25	8.25	30.23	30.20	107.50	106.80	7.10	7.08	3.67	3.56	-	-		
			13:20	0.0	4.5	29.30		8.25	30.17	106.10	7.05	3.45	-								

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CF (Middle) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
CF	2/8/2022	Sunny	13:18	8.6	4.3	29.54	29.53	9.29	9.27	26.20	26.22	115.00	113.95	7.59	7.52	5.33	5.38	2.8	3.0		
			13:19	8.6	4.3	29.52		9.24	26.23	112.90	7.45	5.42	3.2								
	4/8/2022	Rainy	13:19	8.9	4.4	28.53	28.52	9.95	9.93	25.17	25.30	113.30	107.95	7.64	7.28	5.07	4.83	2.9	2.9		
			13:20	8.8	4.4	28.50		9.90	25.42	102.60	6.91	4.59	2.5								
	6/8/2022	Cloudy	13:21	8.6	4.3	28.21	28.19	9.29	9.31	23.80	23.92	113.60	106.40	7.76	7.27	3.48	3.52	2.4	2.3		
			13:22	8.6	4.3	28.17		9.32	24.04	99.20	6.77	3.56	2.1								
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	13:19	8.8	4.4	26.80	26.80	8.25	8.26	30.38	30.27	77.10	76.55	5.33	5.26	16.39	16.33	11.0	11.2		
			13:20	8.8	4.4	26.80		8.26	30.16	76.00	5.19	16.26	11.4								
	13/8/2022	Sunny	13:21	9.5	4.8	27.50	27.50	8.17	8.17	30.26	30.20	88.60	89.45	6.05	6.08	5.10	5.05	3.8	4.0		
			13:22	9.5	4.8	27.50		8.17	30.14	90.30	6.10	5.00	4.2								
	15/8/2022	Sunny	8:36	9.2	4.6	27.90	27.80	7.43	7.47	30.14	30.02	86.80	86.20	6.00	6.02	3.93	3.89	2.8	2.7		
			8:37	9.2	4.6	27.70		7.51	29.89	85.60	6.03	3.84	2.6								
	17/8/2022	Cloudy	8:38	8.4	4.2	28.60	28.60	7.86	7.90	28.85	28.85	100.10	101.65	6.75	6.84	1.11	1.14	4.7	4.6		
			8:39	8.4	4.2	28.60		7.93	28.85	103.20	6.92	1.17	4.4								
	19/8/2022	Cloudy	8:42	8.6	4.3	29.00	29.05	7.99	8.03	29.02	29.01	113.10	113.15	7.52	7.53	0.63	0.62	2.8	2.9		
			8:43	8.6	4.3	29.10		8.06	28.99	113.20	7.53	0.60	3.0								
	22/8/2022	Sunny	13:18	8.4	4.2	29.70	29.70	8.44	8.44	27.98	27.93	112.20	111.30	7.44	7.37	5.09	5.02	4.4	4.6		
			13:19	8.4	4.2	29.70		8.44	27.88	110.40	7.29	4.95	4.8								
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	13:20	8.6	4.3	27.80	27.80	8.14	8.15	30.77	30.71	95.30	93.55	6.56	6.40	10.79	11.02	5.1	5.0		
			13:21	8.6	4.3	27.80		8.15	30.64	91.80	6.24	11.24	4.9								
	29/8/2022	Sunny	8:36	8.8	4.4	28.50	28.50	7.38	7.42	29.57	29.57	98.70	95.70	6.67	6.51	5.25	5.17	3.7	3.6		
			8:37	8.8	4.4	28.50		7.45	29.56	92.70	6.34	5.08	3.4								

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CF (Bottom) - Ebb Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
CF	2/8/2022	Sunny	8:57	8.8	7.8	29.43	29.43	9.21	9.24	25.92	25.94	112.30	114.65	7.43	7.59	5.04	4.94	1.4	1.4		
			8:58	8.8	7.8	29.43	29.43	9.21	9.24	25.95	25.94	117.00	114.65	7.74	7.59	4.84	4.94	1.3	1.4		
	4/8/2022	Rainy	10:13	8.6	7.6	27.72	27.65	9.58	9.59	26.29	26.41	131.90	130.25	8.96	8.85	4.38	4.43	1.5	1.6		
			10:14	8.6	7.6	27.58	27.65	9.59	9.59	26.52	26.41	128.60	130.25	8.74	8.85	4.48	4.43	1.7	1.6		
	6/8/2022	Cloudy	8:57	8.5	7.5	28.02	27.98	9.15	9.19	27.26	27.29	116.90	108.00	7.86	7.27	3.67	3.54	3.2	3.4		
			8:58	8.5	7.5	27.93	27.98	9.22	9.19	27.31	27.29	99.10	108.00	6.67	7.27	3.41	3.54	3.5	3.4		
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	9:33	9.8	8.8	27.10	27.10	8.17	8.18	30.94	30.92	82.40	78.75	5.83	5.50	16.51	16.51	13.8	13.7		
			9:34	9.8	8.8	27.10	27.10	8.18	8.18	30.89	30.92	75.10	78.75	5.17	5.50	16.50	16.51	13.5	13.7		
	13/8/2022	Sunny	9:10	9.9	8.9	27.80	27.80	7.61	7.64	30.45	30.39	83.90	84.15	6.26	6.18	9.41	9.46	9.4	9.6		
			9:11	9.9	8.9	27.80	27.80	7.67	7.64	30.33	30.39	84.40	84.15	6.09	6.18	9.51	9.46	9.8	9.6		
	15/8/2022	Sunny	13:20	9.1	8.1	28.30	28.25	8.18	8.18	29.63	29.64	93.10	91.90	6.27	6.18	3.74	3.68	3.6	3.8		
			13:21	9.1	8.1	28.20	28.25	8.18	8.18	29.65	29.65	90.70	91.90	6.09	6.18	3.61	3.68	3.9	3.8		
	17/8/2022	Cloudy	13:25	8.9	7.9	28.70	28.80	8.47	8.47	28.82	28.83	115.60	114.45	7.86	7.58	2.05	2.01	4.5	4.4		
			13:26	8.9	7.9	28.90	28.80	8.47	8.47	28.84	28.83	113.30	114.45	7.49	7.58	1.97	2.01	4.2	4.4		
	19/8/2022	Cloudy	13:24	8.7	7.7	29.80	29.85	8.42	8.41	29.24	29.37	113.30	113.95	7.43	7.50	2.20	2.21	4.5	4.4		
			13:25	8.7	7.7	29.90	29.85	8.40	8.41	29.50	29.37	114.60	113.95	7.56	7.50	2.22	2.21	4.2	4.4		
	22/8/2022	Sunny	8:27	8.8	7.8	28.90	28.90	7.80	7.83	29.35	29.37	122.90	114.00	7.21	7.13	1.91	1.97	4.8	5.0		
			8:28	8.8	7.8	28.90	28.90	7.86	7.83	29.39	29.37	105.10	114.00	7.05	7.13	2.02	1.97	5.1	5.0		
	24/8/2022	Cloudy	8:42	9.2	8.2	30.00	30.20	7.99	8.03	28.73	28.29	117.00	115.30	7.68	7.54	2.50	2.56	3.4	3.4		
			8:43	9.2	8.2	30.40	30.20	8.06	8.03	27.85	28.29	113.60	115.30	7.39	7.54	2.62	2.56	3.3	3.4		
	26/8/2022	Cloudy	8:46	8.8	7.8	27.70	27.70	7.73	7.75	30.88	30.88	89.14	85.87	6.17	6.13	26.44	26.74	21.5	21.3		
			8:47	8.8	7.8	27.70	27.70	7.76	7.75	30.87	30.88	82.60	85.87	6.08	6.13	27.03	26.74	21.1	21.3		
	29/8/2022	Sunny	13:23	8.7	7.7	29.10	29.10	8.20	8.21	29.73	29.74	100.70	101.25	6.65	6.70	4.25	4.26	3.7	4.0		
			13:24	8.7	7.7	29.10	29.10	8.21	8.21	29.75	29.74	101.80	101.25	6.74	6.70	4.26	4.26	4.2	4.0		
	29/8/2022	Sunny	13:23	0.0	8.0	29.30	29.35	8.24	8.24	30.22	30.22	97.90	101.20	6.59	6.79	3.11	3.19	-	-		
			13:24	0.0	8.0	29.40	29.35	8.23	8.24	30.21	30.22	104.50	101.20	6.99	6.79	3.26	3.19	-	-		

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Impact Water Quality Monitoring at Station CF (Bottom) - Flood Tide

Station Reference	Sampling Date	Weather	Sampling Time	Water Depth m	Sampling Depth m	Temperature °C		pH		Salinity ppt		DO Saturation %		DO mg/L		Turbidity NTU		SS mg/L			
						Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG	Value	AVG
						Sampling was cancelled due to adverse weather															
CF	2/8/2022	Sunny	13:21	8.6	7.6	29.30	29.31	9.25	9.17	26.87	26.81	113.30	113.10	7.47	7.46	5.55	5.07	3.7	3.6		
			13:22	8.6	7.6	29.31	29.31	9.09	9.17	26.74	26.81	112.90	113.10	7.45	7.46	4.59	5.07	3.4	3.6		
	4/8/2022	Rainy	13:22	8.8	7.8	28.36	28.34	9.91	9.84	26.23	26.38	100.30	96.00	6.75	6.46	4.83	4.77	2.2	2.3		
			13:23	8.8	7.8	28.32	28.34	9.77	9.84	26.53	26.38	91.70	96.00	6.16	6.46	4.70	4.77	2.4	2.3		
	6/8/2022	Cloudy	13:24	8.6	7.6	28.04	28.01	9.35	9.32	25.21	25.34	94.80	92.05	6.45	6.26	3.77	3.63	2.7	2.6		
			13:25	8.6	7.6	27.98	28.01	9.29	9.32	25.46	25.34	89.30	92.05	6.07	6.26	3.48	3.63	2.5	2.6		
	9/8/2022	T3	Sampling was cancelled due to adverse weather																		
	11/8/2022	Rainy	13:22	8.8	7.8	26.80	26.80	8.26	8.26	30.79	30.77	75.60	74.95	5.11	5.17	19.92	19.93	10.3	12.0		
			13:23	8.8	7.8	26.80	26.80	8.26	8.26	30.74	30.77	74.30	74.95	5.23	5.17	19.93	19.93	13.6	13.6		
	13/8/2022	Sunny	13:25	9.5	8.5	27.40	27.40	8.18	8.18	30.24	30.25	87.70	87.95	6.08	6.10	4.95	4.84	4.4	4.7		
			13:26	9.5	8.5	27.40	27.40	8.18	8.18	30.25	30.25	88.20	87.95	6.12	6.10	4.73	4.84	4.9	4.7		
	15/8/2022	Sunny	8:40	9.2	8.2	27.70	27.70	7.57	7.60	30.75	30.81	79.50	81.30	5.94	5.92	4.00	4.06	3.2	3.1		
			8:41	9.2	8.2	27.70	27.70	7.63	7.60	30.87	30.81	83.10	81.30	5.90	5.92	4.12	4.06	3.0	3.1		
	17/8/2022	Cloudy	8:41	8.4	7.4	28.70	28.70	7.96	7.98	28.86	28.86	104.00	103.70	7.05	7.00	1.75	1.62	3.6	3.8		
			8:42	8.4	7.4	28.70	28.70	7.99	7.98	28.86	28.86	103.40	103.70	6.94	7.00	1.49	1.62	4.0	3.8		
	19/8/2022	Cloudy	8:45	8.6	7.6	28.90	28.95	8.12	8.13	29.04	29.02	116.00	115.10	7.68	7.62	0.41	0.39	3.9	4.1		
			8:46	8.6	7.6	29.00	28.95	8.14	8.13	29.00	29.02	114.20	115.10	7.56	7.62	0.37	0.39	4.3	4.1		
	22/8/2022	Sunny	13:21	8.4	7.4	29.60	29.60	8.43	8.43	28.16	28.30	112.20	109.30	7.41	7.28	7.90	7.75	5.4	5.5		
			13:22	8.4	7.4	29.60	29.60	8.42	8.43	28.44	28.30	106.40	109.30	7.15	7.28	7.60	7.75	5.6	5.5		
	24/8/2022	T3	Sampling was cancelled due to adverse weather																		
	26/8/2022	Cloudy	13:23	8.6	7.6	27.70	27.70	8.15	8.16	30.80	30.80	98.00	97.00	6.76	6.74	7.70	7.65	4.3	4.5		
			13:24	8.6	7.6	27.70	27.70	8.16	8.16	30.80	30.80	96.00	97.00	6.72	6.74	7.59	7.65	4.7	4.5		
	29/8/2022	Sunny	8:39	8.8	7.8	28.50	28.50	7.54	7.56	29.64	29.62	99.60	96.20	6.75	6.59	4.85	4.90	4.2	4.1		
			8:40	8.8	7.8	28.50	28.50	7.58	7.56	29.59	29.62	92.80	96.20	6.43	6.59	4.95	4.90	4.0	4.1		

General Note: For calculation of average concentration of SS, the minimum value for "NOT DETECTED" is treated as 1.0mg/L according to reporting limit.



Appendix 4.5

Monthly Summary Waste Flow Table

Drainage Services Department
Contract No. DC/2020/02
Construction of San Shek Wan Sewage Treatment Works,
Associated Submarine Outfall and Pui O Sewerage Works

Monthly Summary Waste Flow Table for 2022

Month	Actual Quantities of Inert C&D Material Generated Monthly						Actual Quantities of C&D Wastes Generated Monthly				
	Total Quantity Generated (a) (in '000m ³)	Hard Rocks and Large Broken Concrete (b) (in '000m ³)	Reused in the Contract (c) (in '000m ³)	Reused in other Projects (d) (in '000m ³)	Disposed as Public Fill (a-b-c-d) (in '000m ³)	Imported Fill (in '000m ³)	Metals (in '000kg)	Paper/card-board packaging (in '000kg)	Plastics [see Note 3] (in '000kg)	Chemical waste (in '000kg)	Others. e.g. general refuse (in '000kg)
Jan	0.02	0.00	0.00	0.00	0.02	0.00	0.00	0.01	0.00	0.00	58.35
Feb	2.37	0.00	0.00	0.00	2.37	0.00	0.00	0.00	0.00	0.00	52.60
Mar	2.51	0.00	0.00	0.00	2.51	0.00	1.55	0.00	0.00	0.00	34.82
Apr	0.62	0.00	0.00	0.00	0.62	0.00	0.00	0.05	0.00	0.00	9.74
May	0.21	0.00	0.00	0.00	0.21	0.00	0.00	0.00	0.00	0.00	17.38
Jun	0.01	0.00	0.00	0.00	0.01	0.00	0.00	0.07	0.00	0.00	33.94
Sub-total	5.74	0.00	0.00	0.00	5.74	0.00	1.56	0.13	0.01	0.00	206.83
July	0.02	0.00	0.00	0.00	0.02	0.00	0.00	0.00	0.00	0.00	17.34
Aug	0.10	0.00	0.00	0.00	0.10	0.00	0.00	0.04	0.01	0.00	18.25
Sept											
Oct											
Nov											
Dec											
Total	5.86	0.00	0.00	0.00	5.86	0.00	1.56	0.17	0.02	0.00	242.42

Notes:

- (1) The inert C&D material except slurry and bentonite are disposed at Mui Wo Temporary Public Fill Bank (MW-PFRF)
- (2) The slurry and bentonite are disposed at Tseung Kwan O Area 137 Fill Bank (TKO137FB)
- (3) The non-inert waste is disposed at NENT or Outlying Islands Transfer Facilities
- (4) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (5) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material
- (6) Assume the density of fill material is 2 tonne/m³.



Appendix 6.1

Three Months Rolling Programme – September 2022 to November 2022

KL-CW JV

Tentative Three Months Construction Rolling Program Contract No.: DC/2020/02 Construction of San Shek Wan Sewage Treatment Works, Associated Submarine Outfall and Pui O Sewerage Works	Reference No. : DC/2020/02 Revision No. : -
--	--

Construction Activities for the reporting period

Item	Construction Activities
1	Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen
2	Excavation and site formation at SSWSTW and POSPS
3	Excavation at South Lantau Road
4	SSWSTW and HDD works
5	Site formation works at POSPS
6	ELS works at POSPS

KL-CW JV

Tentative Three Months Construction Rolling Program Contract No.: DC/2020/02 Construction of San Shek Wan Sewage Treatment Works, Associated Submarine Outfall and Pui O Sewerage Works	Reference No. : DC/2020/02 Revision No. : -
--	--

Tentative Three Months (September, October and November 2022) Construction Rolling Program

Item	Construction Activities
1	Excavation, sewer laying, construction of manhole at Pui O Lo Uk Tsuen
2	Construction of trunk sewers and rising mains
3	SSWSTW and HDD works
4	Site formation works for POSPS
5	Drilling works
6	Excavation works
7	ELS works
8	Piling Works
9	Superstructure RC Works