

香港電燈有限公司
The Hongkong Electric Co., Ltd.



Re-provision of Open Cycle Gas Turbines at Lamma Power Station

Decommissioning/ Demolition & Construction Phases

Monthly Environmental Monitoring & Audit Report

July 2023

香港電燈有限公司
The Hongkong Electric Co., Ltd.



ENVIRONMENTAL IMPACT ASSESSMENT (EIA) ORDINANCE, CAP. 499

ENVIRONMENTAL PERMIT NO. EP-600/2022

**RE-PROVISION OF OPEN CYCLE GAS TURBINES
AT LAMMA POWER STATION**



Title	<u>Monthly EM&A Report (July 2023)</u>
Date	<u>14 August 2023</u>
Certified by	 <u>(Mr. Kenneth Fung, Environmental Team Leader)</u>
Verified by	 <u>Mr. Y. W. Fung (AECOM Asia Company Limited, Independent Environmental Checker)</u>

TABLE OF CONTENT

EXECUTIVE SUMMARY

1.	INTRODUCTION	1
1.1	Background	1
1.2	Project Organization	1
1.3	Key Construction Works Undertaken during the Reporting Month	1
1.4	Summary of EM&A Requirements	4
2.	ENVIRONMENTAL AUDIT	5
2.1	Site Inspection	5
2.2	Status of Environmental Licensing and Permitting	5
2.3	Waste Management	6
2.4	Implementation Status of Land Contamination Assessment	6
2.5	Implementation Status of Environmental Mitigation Measures	6
3.	REPORT ON COMPLAINTS, NOTIFICATION OF SUMMONS AND SUCCESSFUL PROSECUTIONS	7
3.1	Implementation Status of Environmental Complaint Handling Procedures	7
3.2	Environmental Summon and Successful Prosecution	7
4.	FUTURE KEY ISSUES	8
4.1	Construction Program for the Coming Month	8
4.2	Key Issues for the Coming Month	8
5.	CONCLUSION	10

LIST OF TABLES

Table 1.1	Construction Activities and Corresponding Environmental Mitigation Measures
Table 2.1	Status of Environmental Licensing and Permitting
Table 2.2	Estimated Quantities of Waste Generated in July 2023
Table 3.1	Environmental Complaints Received in July 2023
Table 3.2	Outstanding Environmental Complaints Carried Over
Table 3.3	Notifications of Summon or Successful Prosecution Received in July 2023
Table 3.4	Notifications of Summon or Successful Prosecution Carried Over

LIST OF FIGURES

Figure 1.1	The Project Area
Figure 1.2	Decommissioning and Construction Phasing Schedule
Figure 1.3	Locations of Air Sensitive Receivers
Figure 1.4	Locations of Noise Sensitive Receivers
Figure 1.5	Locations of Water Sensitive Receivers

APPENDICES

Appendix A	Organization Chart
Appendix B	Tentative Decommissioning and Construction Programme
Appendix C	Summary of EMIS
Appendix D	Summary of Site Audit Findings
Appendix E	Monthly Waste Flow Table for July 2023

EXECUTIVE SUMMARY

In April 2022, an Environmental Permit (EP-600/2022) was granted to the Hongkong Electric Co., Ltd. (HK Electric) for the decommissioning/ demolition, construction and operation of the Project entitled “Re-provision of Open Cycle Gas Turbines at Lamma Power Station”. This report, prepared by the Environmental Team, presents the Environmental Monitoring and Audit (EM&A) findings for the Project in July 2023 and is the 13th Monthly EM&A Report for the decommissioning/ demolition and construction phases of the Project.

Key Construction Activities Undertaken

The construction activities undertaken in the reporting month are as follows:

- Trenching works;
- Hoarding and Propping erection works;
- Scraped material removal works;
- Lifting and cut;
- Operation of crawler crane;
- Operation of cherry picker;
- Take down the equipment and steel frame; and
- Oil discharge.

Environmental Monitoring

According to the EM&A Manual, no environmental monitoring was necessary in view of the anticipated insignificant environmental impact.

Site Environmental Audit and Implementation of Mitigation Measure

Independent Environmental Checker (IEC) conducted a site inspection on 21/7/2023. The site conditions were generally satisfactory.

Weekly site audits were carried out to monitor environmental issues on the construction site. The site conditions were generally satisfactory. All recommended environmental mitigation measures were properly implemented. No environmental non-compliance was recorded in the reporting month.

Environmental Licensing and Permitting

License/Permit	Ref. No.	Valid Period		Authority/Holder	Date Issued
		From	To		
Environmental Permit	EP-600/2022	01/04/2022	-	EPD / HK Electric	01/04/2022
Waste Disposal Billing Account	Account No.: 7044319	27/06/2022	-	EPD / Civil Contractor	27/06/2022
Registration of Chemical Waste Producer	5213-912-P2781-22	22/02/2016	-	EPD / Civil Contractor	22/02/2016
EPD Notification (Dust) Construction, Air Pollution Control	481782	07/07/2022	-	EPD / Civil Contractor	07/07/2022

License/Permit	Ref. No.	Valid Period		Authority/Holder	Date Issued
		From	To		
(Construction Dust) Regulation					
Construction Noise Permit	GW-RS0547-23	05/07/2023	03/01/2024	EPD / Civil Contractor	03/07/2023
Waste Disposal Billing Account	Account No.: 7045179	28/09/2022	-	EPD / E&M Contractor	28/09/2022
Registration of Chemical Waste Producer	5517-912-K2931-02	05/12/2022	-	EPD / E&M Contractor	05/12/2022
Construction Noise Permit	GW-RS0258-23	14/04/2023	13/10/2023	EPD / E&M Contractor	24/03/2023

Environmental Complaints / Summons/ Prosecutions

No complaint in relation to the environmental impact of the construction activities was received in the reporting month. There was also no notification of summon and successful prosecution for breaches of relevant environmental legislations received in the reporting month.

Future Key Issues

The construction activities scheduled for the coming month are mainly trenching works, GTAB plant equipment demolition, Heat Recovery Steam Generator (HRSG) 5 and Heat Recovery Steam Generator (HRSG) 7 demolition, GT5 and GT7 power train removal works, operation of crawler crane, operation of cherry picker and oil discharge.

The future key issues to be considered in the coming month are as follows:

- Relevant environmental legislations should be observed.
- Relevant environmental licenses/permits should be obtained, if required.
- Required environmental mitigation measures should be properly implemented.
- Good site practices should be adopted to minimize environmental impacts.
- Dust suppression measures should be implemented for the construction activities.
- Works conducted during restricted hours should comply with the valid CNP.
- Wastewater from site facilities should be properly collected and stored within the site area.
- Generation of waste should be minimized.
- Waste generated should be properly stored and disposed of.

Reporting Changes

There was no reporting change in the reporting month.

Concluding Remarks

The environmental performance of the Project was generally satisfactory.

1. INTRODUCTION

1.1 Background

In April 2022, an Environmental Permit (EP-600/2022) was granted to HK Electric for the decommissioning/ demolition, construction and operation of the Project entitled “Re-provision of Open Cycle Gas Turbines at Lamma Power Station”. An Environmental Team was then formed to implement the Environmental Monitoring and Audit (EM&A) programme in accordance with the EM&A Manual for the Project.

The key components of the Project are outlined as follows:

- Decommissioning and demolition of four oil-fired open cycle gas turbine units (GT2, GT3, GT4 and GT6) and one gas-fired combined cycle gas turbine unit (GT57), and auxiliary equipment including the black start gas turbine (BSGT), the miscellaneous storage shed, and the lube oil storage tank near GT5;
- Construction of four new oil-fired open cycle gas turbine units (GT8, GT9, GT 10 and GT11), and installation of the new BSGT and Battery Energy Storage System (BESS);
- Construction of new cable trenches, staircase and lift, and reconstruction of the GT57 Auxiliary Building (GTAB) to a new 132kV Switching Station; and
- Operation of four new oil-fired open cycle gas turbine units (GT8, GT9, GT10 and GT11).

The EM&A programme was commenced on 1 July 2022. This is the 13th monthly EM&A report which summarizes the environmental monitoring and audit work for the Project for the month of July 2023.

1.2 Project Organization

The management structure to oversee the Project includes the following:

- Project Proponent (HK Electric);
- Environmental Protection Department (EPD);
- Independent Environmental Checker (IEC);
- Environmental Team (ET); and
- Contractor.

The project organisation chart for the EM&A programme is shown in [Appendix A](#).

1.3 Key Construction Works Undertaken during the Reporting Month

The Project area is shown in [Figure 1.1](#), and the tentative decommissioning and construction phasing schedule is shown in [Figure 1.2](#).

The locations of air, noise and water sensitive receivers are shown in [Figure 1.3](#), [Figure 1.4](#) and [Figure 1.5](#) respectively.

The main construction activities carried out during the reporting month and the corresponding environmental mitigation measures are summarized in [Table 1.1](#). The implementation status of the major mitigation measures in the reporting month can be found in [Appendix C](#).

Table 1.1 Construction Activities and Corresponding Environmental Mitigation Measures

Item	Activities	Environmental Mitigation Measures
Civil Works - General		
1.	Trenching works	<p><i>Air</i></p> <ul style="list-style-type: none"> - All regulated machine attached with valid exception/ approval NRMM labels. - Water spraying for concrete breaking works. - Excavated material stockpile will be temporary covered with canvas or transferred to temporary storage location for backfill later. <p><i>Noise</i></p> <ul style="list-style-type: none"> - Noise emission label was provided for air compressor. - Works conducted during restricted hours should comply with the valid CNP. <p><i>Wastewater</i></p> <ul style="list-style-type: none"> - No wastewater is required to be discharged at this moment. - Sand bag barriers was set up as preventive measures. <p><i>Waste Management</i></p> <ul style="list-style-type: none"> - Excavated material was temporary stored for backfilling later. - Scrape metal will be recycled. - Chemical waste should be collected by licensed collector.
2.	Hoarding and Propping erection works	<p><i>Air</i></p> <ul style="list-style-type: none"> - All regulated machine attached with valid exception/ approval NRMM labels. <p><i>Wastewater</i></p> <ul style="list-style-type: none"> - No wastewater is required to be discharged at this moment. <p><i>Noise</i></p> <ul style="list-style-type: none"> - Works conducted during restricted hours should comply with the valid CNP. <p><i>Waste Management</i></p> <ul style="list-style-type: none"> - Scrape metal will be recycled.
E&M Works - General		
3.	Scraped material removal works	<p><i>Air</i></p> <ul style="list-style-type: none"> - All regulated machine attached with exception/ approval NRMM labels <p><i>Noise</i></p> <ul style="list-style-type: none"> - Works conducted during restricted hours should comply with the valid CNP. <p><i>Wastewater</i></p> <ul style="list-style-type: none"> - No wastewater is required to be discharged for this moment. <p><i>Waste Management</i></p>

Item	Activities	Environmental Mitigation Measures
		<ul style="list-style-type: none"> - Scrap metal will be recycled.
4.	Lifting and cut	<p><i>Air</i></p> <ul style="list-style-type: none"> - Fence off the working area to avoid dust emission. <p><i>Noise</i></p> <ul style="list-style-type: none"> - Works conducted during restricted hours should comply with the valid CNP. <p><i>Wastewater</i></p> <ul style="list-style-type: none"> - No wastewater is required to be discharge for this works. <p><i>Waste Management</i></p> <ul style="list-style-type: none"> - Scrap metal will be recycled.
5.	Operation of crawler crane	<p><i>Air</i></p> <ul style="list-style-type: none"> - All regulated machine attached with valid exception/ approval NRMM labels. <p><i>Noise</i></p> <ul style="list-style-type: none"> - Works conducted during restricted hours should comply with the valid CNP. <p><i>Wastewater</i></p> <ul style="list-style-type: none"> - No wastewater is required to be discharged for this works. <p><i>Waste Management</i></p> <ul style="list-style-type: none"> - No waste will be generated.
6.	Operation of cherry picker	<p><i>Air</i></p> <ul style="list-style-type: none"> - All regulated machine attached with exception/ approval NRMM labels. <p><i>Wastewater</i></p> <ul style="list-style-type: none"> - No wastewater is required to be discharged for this works. <p><i>Noise</i></p> <ul style="list-style-type: none"> - No works will be conducted during restricted hours at this moment. <p><i>Waste Management</i></p> <ul style="list-style-type: none"> - No waste will be generated.
7.	Take down the equipment and steel frame	<p><i>Air</i></p> <ul style="list-style-type: none"> - Fence off the working area to avoid dust emission. <p><i>Noise</i></p> <ul style="list-style-type: none"> - Works conducted during restricted hours should comply with the valid CNP.

Item	Activities	Environmental Mitigation Measures
		<p><i>Wastewater</i></p> <ul style="list-style-type: none"> - No wastewater is required to be discharge for this works. <p><i>Waste Management</i></p> <ul style="list-style-type: none"> - Scrap metal will be recycled.
8.	Oil discharge	<p><i>Air</i></p> <ul style="list-style-type: none"> - Fence off the working area to avoid dust emission <p><i>Noise</i></p> <ul style="list-style-type: none"> - Works conducted during restricted hours should comply with the valid CNP. <p><i>Wastewater</i></p> <ul style="list-style-type: none"> - Nylon sheet are set on the ground. <p><i>Waste Management</i></p> <ul style="list-style-type: none"> - Oil would be handled by a specific chemical waste disposal company.

1.4 Summary of EM&A Requirements

Impact Monitoring

According to the EM&A Manual, no routine impact monitoring for air quality, noise and water quality is necessary in view of the anticipated insignificant environmental impact.

Environmental Audit

Regular environmental audits on air quality, noise, water quality, waste management, and land contamination are required. Details of the audits are summarized in [Section 2](#) of this report.

Report on complaints, notification of summons and successful prosecutions are given in [Section 3](#) of this report.

Future key issues are given in [Section 4](#) of this report.

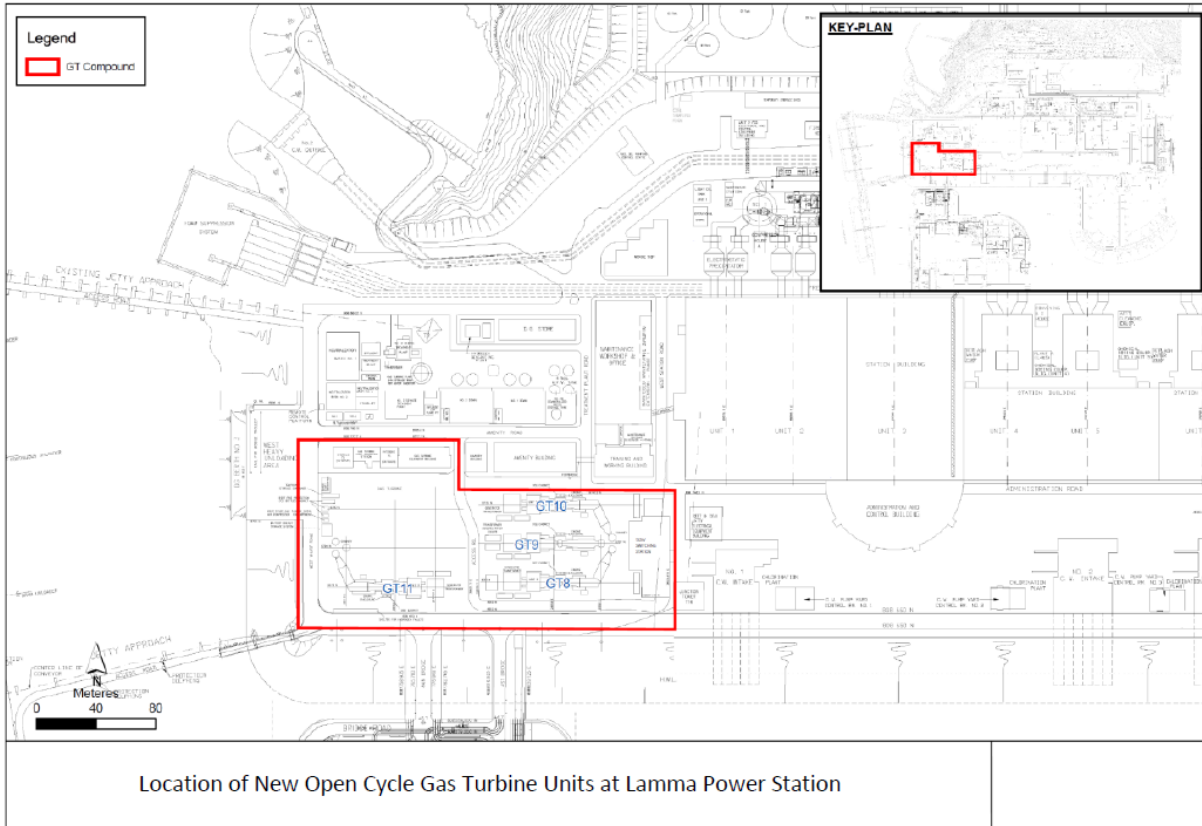
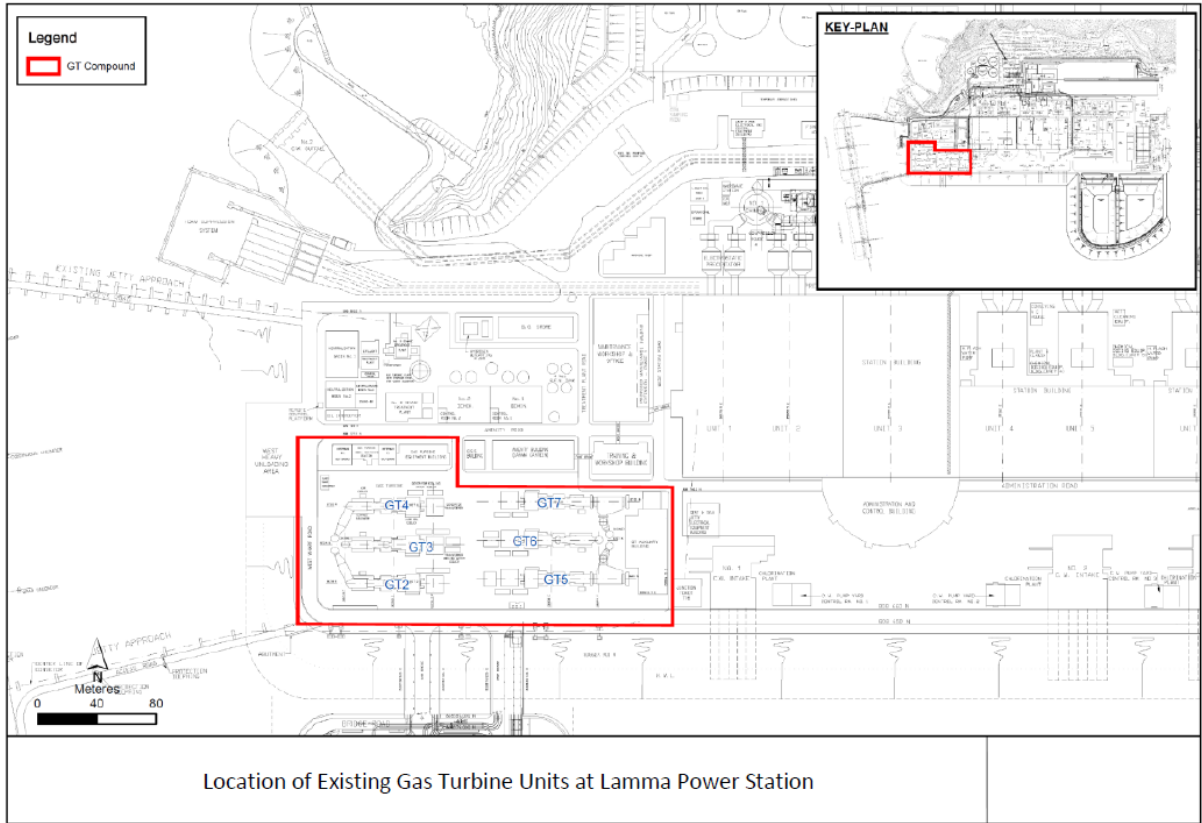


Figure 1.1 The Project Area

		Q1 2022	Q2 2022	Q3 2022	Q4 2022	Q1 2023	Q2 2023	Q3 2023	Q4 2023	Q1 2024	Q2 2024	Q3 2024	Q4 2024	Q1 2025	Q2 2025	Q3 2025	Q4 2025	Q1 2026	Q2 2026	Q3 2026	Q4 2026
GT57	Decommissioning of GT57																				
Demolition of GT7	Demolition of E&M equipment in GTAB																				
	Demolition of HRSG Demolition of gas turbine, generator, generator transformer and auxiliary equipment																				
GT10	Anchor bolt replacement																				
	Stack refurbishment																				
	Construction of gas turbine, generator, generator transformer and auxiliary equipment																				
	Testing and Commissioning																				
Demolition of GT5	Demolition of HRSG Demolition of gas turbine, generator, generator transformer and auxiliary equipment																				
	Anchor bolt replacement Construction of gas turbine, generator, generator transformer and auxiliary equipment																				
GT8	Anchor bolt replacement																				
	Construction of gas turbine, generator, generator transformer and auxiliary equipment																				
	Testing and Commissioning																				
Demolition of GT6	Decommissioning Demolition of gas turbine, generator, generator transformer and auxiliary equipment																				
	Anchor bolt replacement Construction of gas turbine, generator, generator transformer and auxiliary equipment																				
GT9	Anchor bolt replacement																				
	Construction of gas turbine, generator, generator transformer and auxiliary equipment																				
	Testing and Commissioning																				
GT2	Decommissioning	To be advised																			
	Demolition																				
GT3	Decommissioning																				
	Demolition																				
GT4	Decommissioning																				
	Demolition																				
GT11	Construction																				
	Testing and Commissioning																				

Figure 1.2 Decommissioning and Construction Phasing Schedule

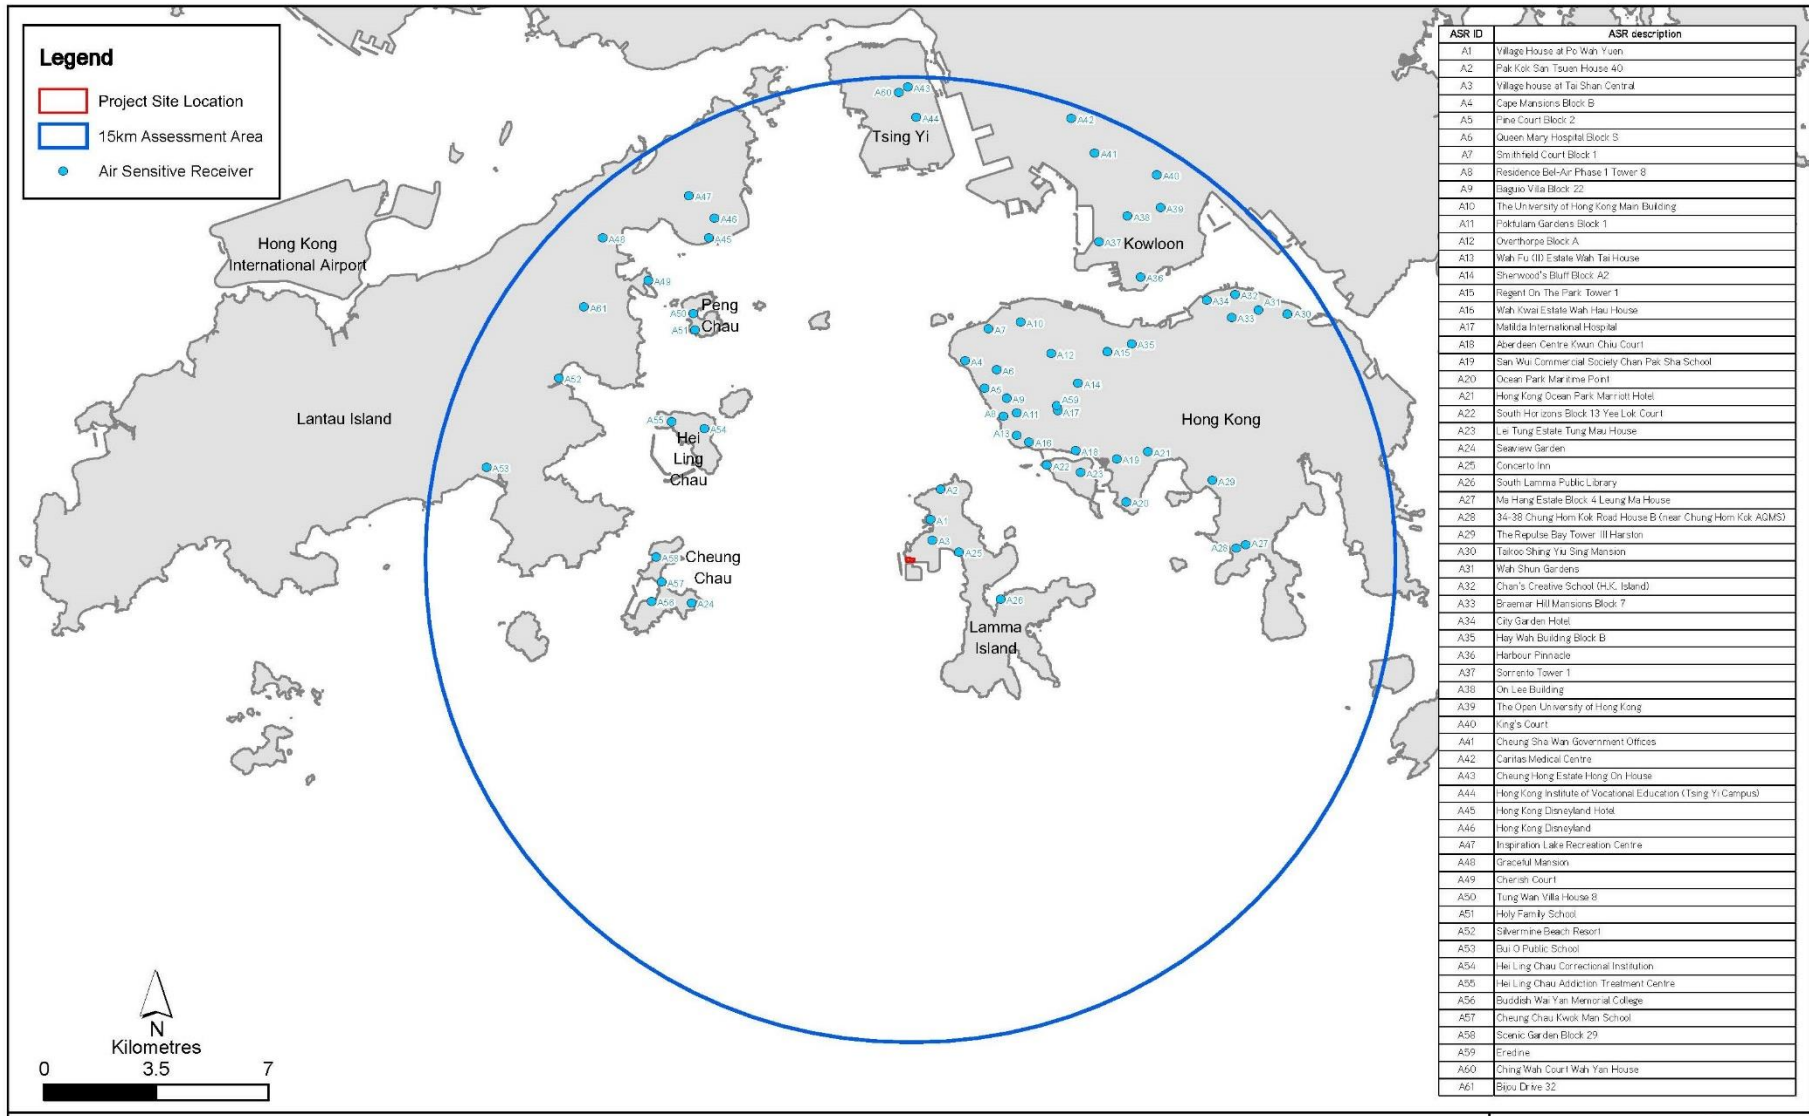


Figure 1.3 Locations of Air Sensitive Receivers within the 15km Assessment Area



Figure 1.4 Locations of Noise Sensitive Receivers

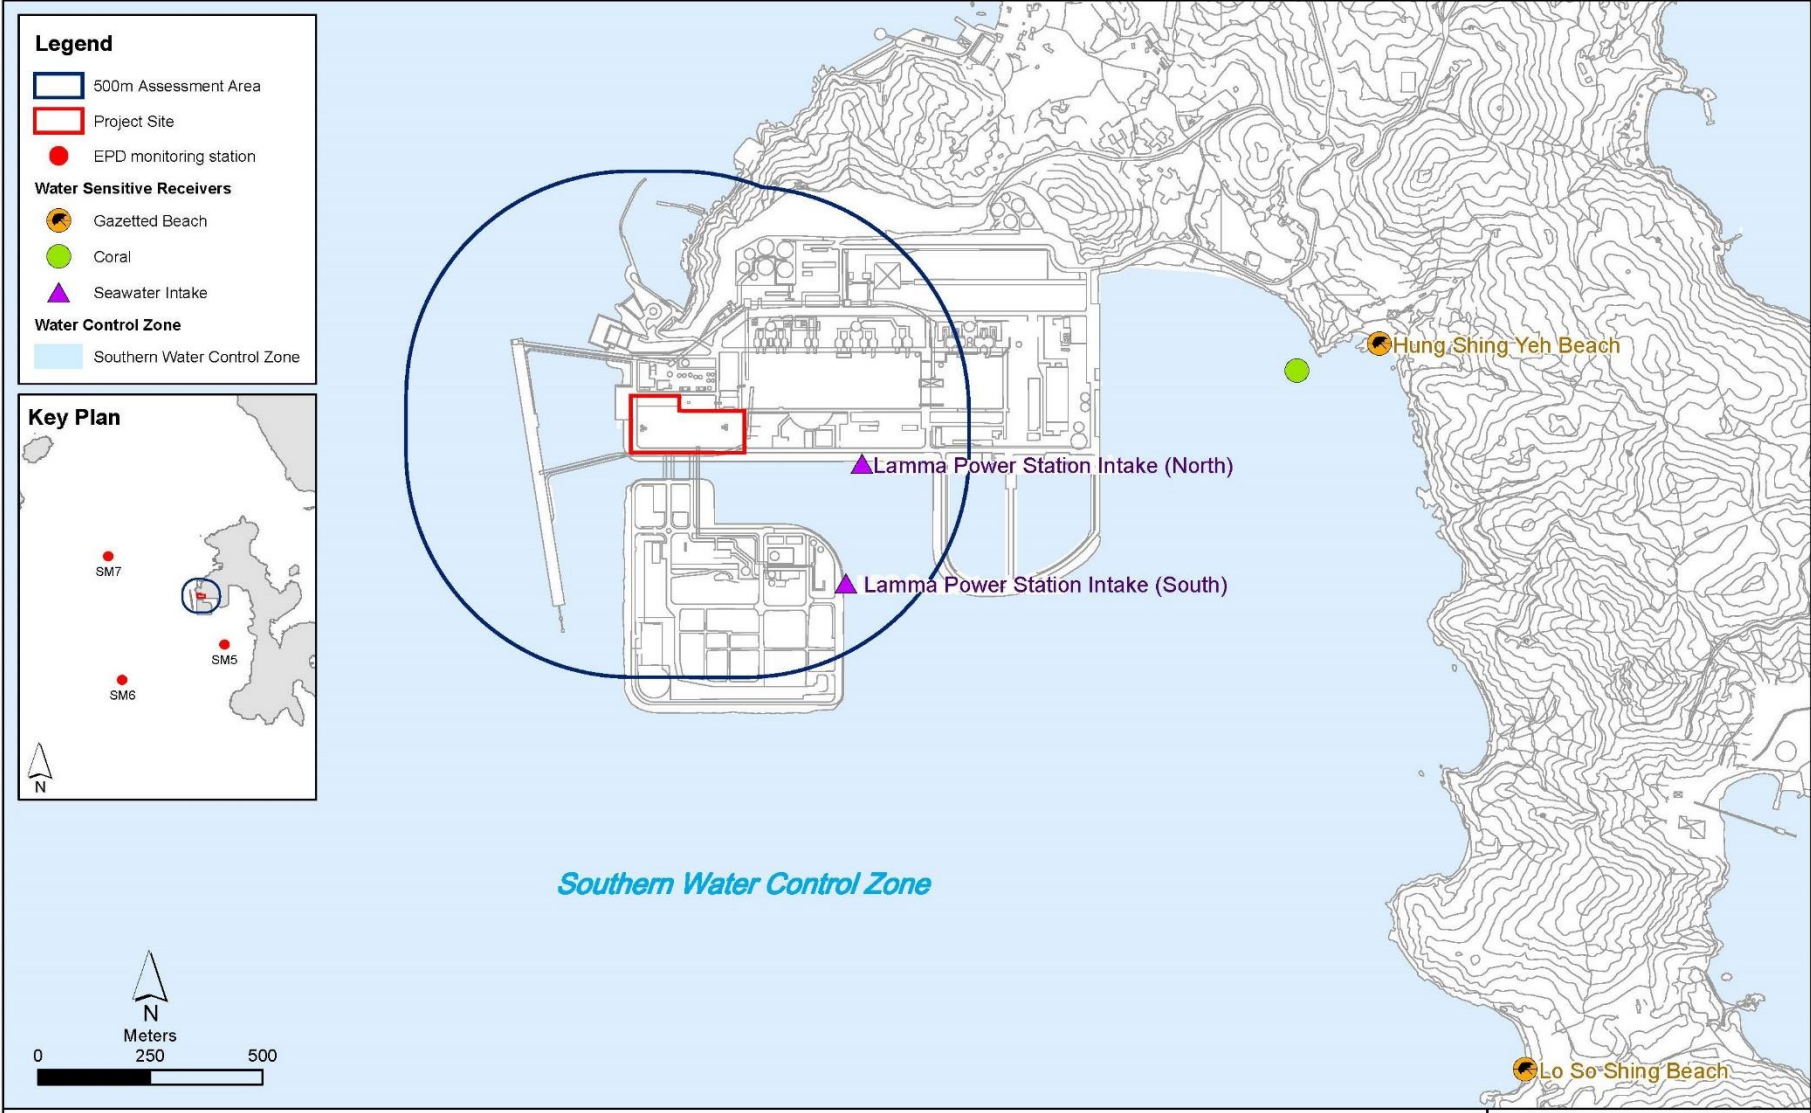


Figure 1.5 Locations of Water Sensitive Receivers

2. ENVIRONMENTAL AUDIT

2.1 Site Inspection

Independent Environmental Checker (IEC) conducted a site inspection on 21/7/2023. The site conditions were generally satisfactory.

Weekly site audits were carried out by the Environmental Team in the reporting month to ensure compliance with relevant legislations and other requirements. The site audit findings or recommendations in the reporting month are summarized in [Appendix D](#). The site conditions were generally satisfactory. No non-compliance was recorded during the site inspection. All recommended mitigation measures were properly implemented.

2.2 Status of Environmental Licensing and Permitting

The licenses/permits obtained for the Project as of end July 2023 are summarised in [Table 2.1](#).

Table 2.1 Status of Environmental Licensing and Permitting

License/Permit	Ref. No.	Valid Period		Description	Status
		From	To		
Environmental Permit	EP-600/2022	01/04/2022	-	For the decommissioning/ demolition, construction and operation of the Project	Valid
Waste Disposal Billing Account	Account No.: 7044319	27/06/2022	-	Civil Work	Valid
Registration of Chemical Waste Producer	5213-912-P2781-22	22/02/2016	-	Civil Work	Valid
EPD Notification (Dust) Construction, Air Pollution Control (Construction Dust) Regulation	481782	07/07/2022	-	Civil Work	Valid
Construction Noise Permit	GW-RS0547-23	05/07/2023	03/01/2024	Civil Work Operation of PME during restricted hours	Valid
Waste Disposal Billing Account	Account No.: 7045179	28/09/2022	-	E&M Work	Valid
Registration of Chemical Waste Producer	5517-912-K2931-02	05/12/2022	-	E&M Work	Valid
Construction Noise Permit	GW-RS0258-23	14/04/2023	13/10/2023	E&M Work Operation of PME during restricted hours	Valid

2.3 Waste Management

All wastes produced were managed in accordance with the Waste Management Plan, good waste management practices, and statutory regulations and requirements.

The estimated quantities of wastes generated in July 2023 are summarized in [Table 2.2](#).

Table 2.2 Estimated Quantities of Waste Generated in July 2023

Total Inert C&D Waste Materials	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste
0 Tonnes	0 Tonnes	231.89 Tonnes	13.65 Tonnes

The monthly waste flow tables prepared by the contractors are attached in [Appendix E](#).

2.4 Implementation Status of Land Contamination Assessment

The EIA study has recommended to conduct site investigation and sampling at five hotspot locations (i.e. 4 boreholes and 1 trial pit) to assess the potential land contamination impacts within the Project site in accordance with the Contaminated Assessment Plan (CAP). Site investigation and soil and groundwater sampling will be undertaken in accordance with the CAP under the supervision of a Land Contamination Specialist when the proposed sampling locations are made available after the demolition of the existing units and structures. The updated CAP was submitted to EPD in December 2022 for approval. EPD's comments on the CAP were received on 20/12/2022 and a revised CAP was submitted to EPD on 13/1/2023. EPD's approval for the CAP was granted on 2/3/2023.

Site investigation work on Lube Oil Tank area (BH1) was started on 22/5/2023 and the samples obtained had been delivered to laboratory for further analysis. Laboratory test result has been received on 26/7/2023 and the corresponding Contamination Assessment Report is under preparation.

2.5 Implementation Status of Environmental Mitigation Measures

Mitigation measures detailed in the Environmental Permit and the EM&A Manual are required to be implemented. A summary of the Environmental Mitigation Implementation Schedule (EMIS) is presented in [Appendix C](#).

3. REPORT ON COMPLAINTS, NOTIFICATION OF SUMMONS AND SUCCESSFUL PROSECUTIONS

3.1 Implementation Status of Environmental Complaint Handling Procedures

No complaint in relation to the environmental impact of the construction activities was received in the reporting month.

Table 3.1 Environmental Complaints Received in July 2023

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions /Actions Taken	Conclusion / Status
Nil	N/A	N/A

Table 3.2 Outstanding Environmental Complaints Carried Over

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions /Actions Taken	Conclusion / Status
Nil	N/A	N/A

3.2 Environmental Summon and Successful Prosecution

No notification of summon or successful prosecution was received in the reporting month.

Table 3.3 Notifications of Summon or Successful Prosecution Received in July 2023

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions /Actions Taken	Conclusion / Status
Nil	N/A	N/A

Table 3.4 Notifications of Summon or Successful Prosecution Carried Over

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions /Actions Taken	Conclusion / Status
Nil	N/A	N/A

4. FUTURE KEY ISSUES

4.1 Construction Program for the Coming Month

The construction activities scheduled for the coming month are mainly trenching works, GTAB plant equipment demolition, Heat Recovery Steam Generator (HRSG) 5 and Heat Recovery Steam Generator (HRSG) 7 demolition, GT5 and GT7 power train removal works, operation of crawler crane, operation of cherry picker and oil discharge. (see [Appendix B](#)).

4.2 Key Issues for the Coming Month

Key issues to be considered and recommended in the coming month include:

Civil Works

General

- Relevant environmental legislations should be observed.
- Relevant environmental licenses/permits should be obtained, if required.
- Required environmental mitigation measures should be properly implemented.

Air

- Dust suppression measures should be implemented for the construction activities.

Noise

- General noise mitigation measures should be employed at work site.
- Works conducted during restricted hours should comply with the valid CNP.

Water

- Wastewater from site facilities should be properly collected and stored within the site area.
- Good site practices should be adopted.

Waste

- Waste Management Plan submitted should be implemented
- Good site practices should be adopted.

Land Contamination

- Good site practices should be adopted.

E&M Works

General

- Relevant environmental legislations should be observed.
- Relevant environmental licenses/permits should be obtained, if required.
- Required environmental mitigation measures should be properly implemented.

Air

- Dust suppression measures should be implemented for the construction activities.

Noise

- General noise mitigation measures should be employed at work site.
- Works conducted during restricted hours should comply with the valid CNP.

Water

- Wastewater from site facilities should be properly collected and stored within the site area.
- Good site practices should be adopted.

Waste

- Waste Management Plan submitted should be implemented
- Good site practices should be adopted.

Land Contamination

- Good site practices should be adopted.

5. CONCLUSION


According to the EM&A Manual, environmental monitoring was not necessary in view of the anticipated insignificant environmental impact. Environmental audits were performed in accordance with the EM&A Manual.

All recommended environmental mitigation measures were properly implemented. No complaint in relation to the environmental impact of the construction activities was received in the reporting month. There was also no notification of summon and successful prosecution for breaches of relevant environmental legislations received in the reporting month.


No non-compliance was recorded in the reporting month.

The environmental performance of the Project was generally satisfactory.

Appendix A Organization Chart

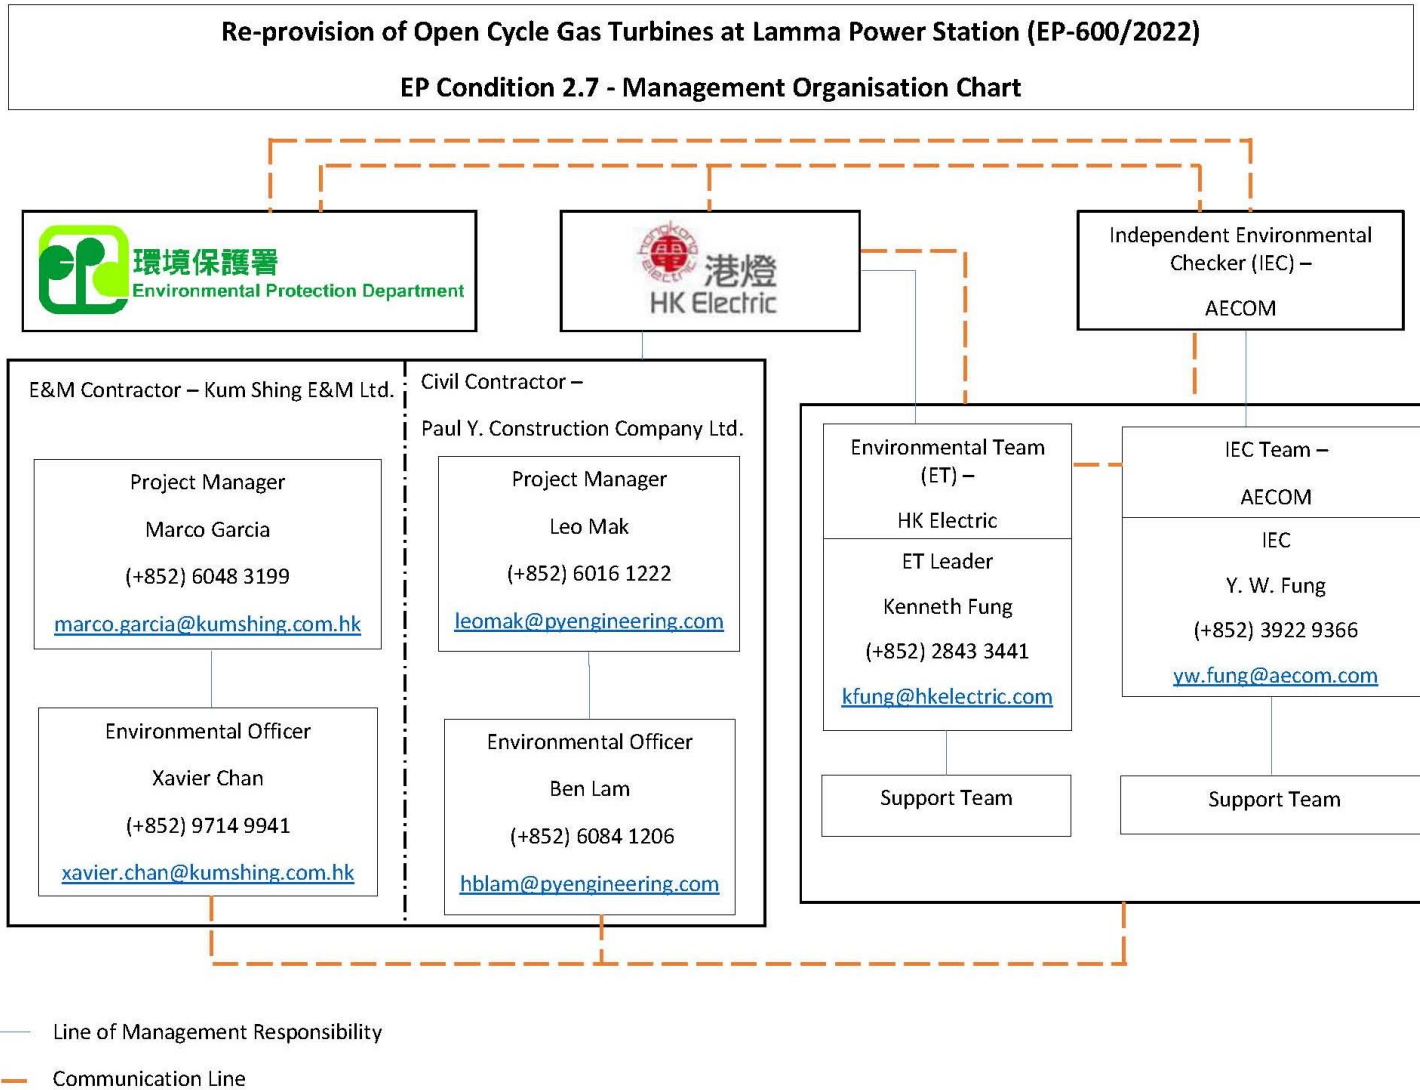


Appendix B1 Tentative Decommissioning and Construction Programme (Civil Contractor)

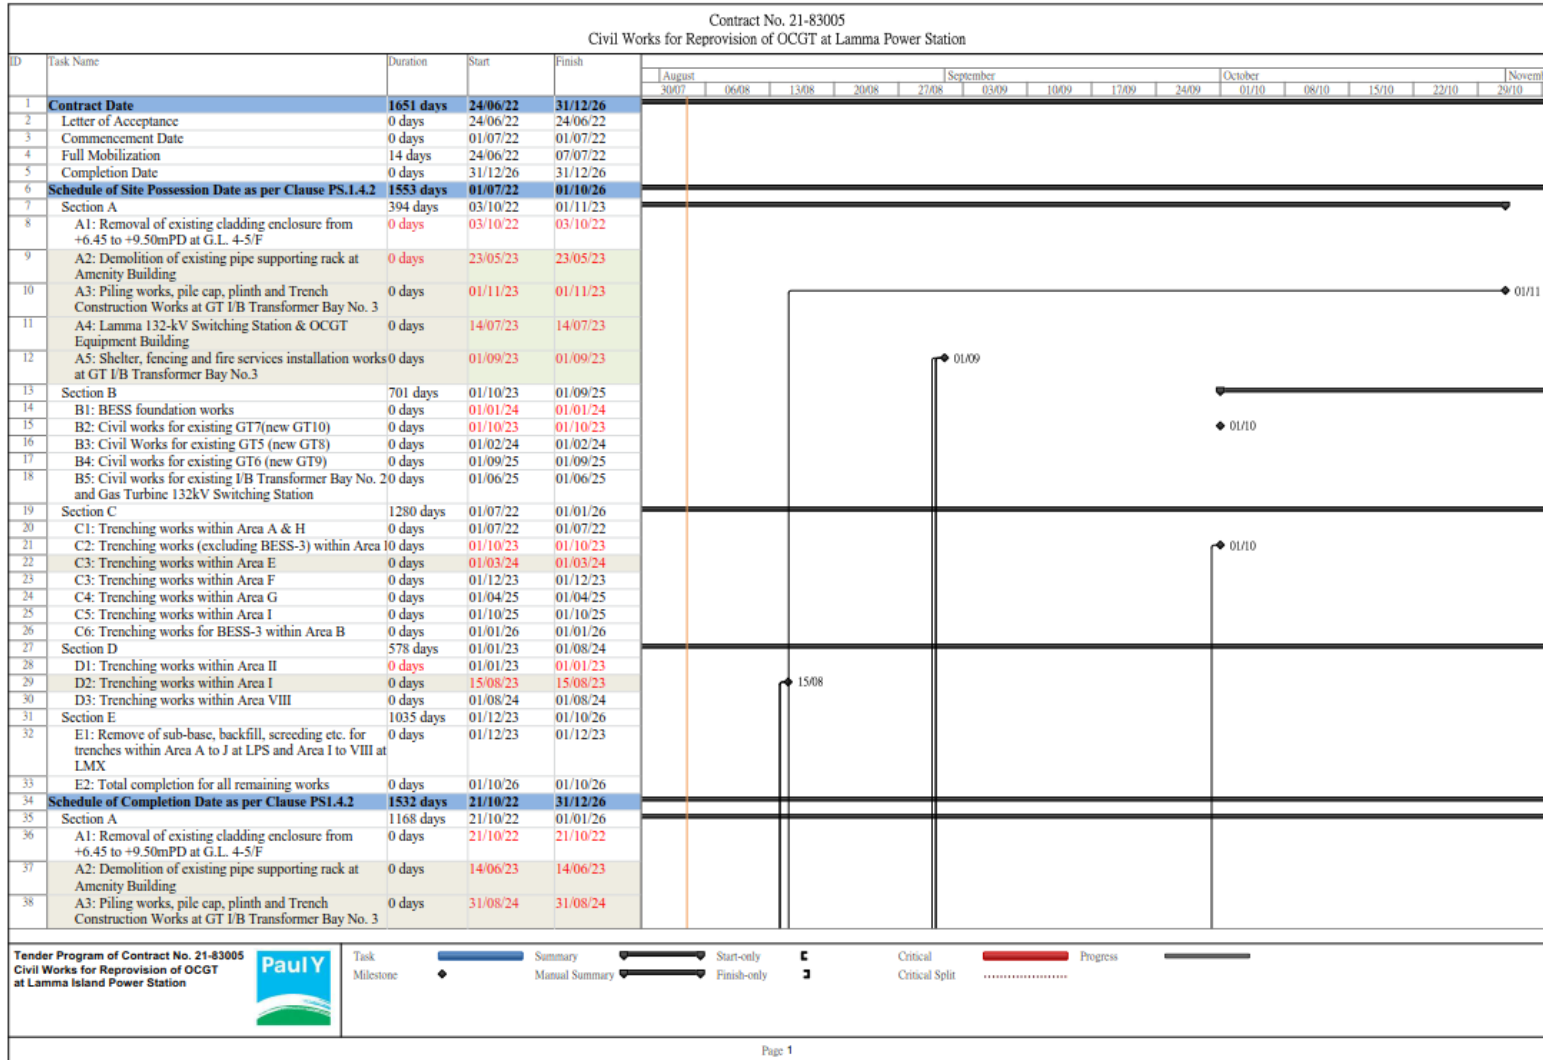

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

		Contract No. 21-83005 Civil Works for Re-provision of OCGT at Lamma Power Station																		
ID	Task Name	Duration	Start	Finish	August					September					October					November
					30/07	06/08	13/08	20/08	27/08	03/09	10/09	17/09	24/09	01/10	08/10	15/10	22/10	29/10		
39	A4: Lamma 132-kV Switching Station & OCGT Equipment Building	0 days	01/11/24	01/11/24																
40	A5: Shelter, fencing and fire services installation works at GT I/B Transformer Bay No.3	0 days	01/01/26	01/01/26																
41	Section B	669 days	30/04/24	28/02/26																
42	B1: BESS foundation works	0 days	30/06/24	30/06/24																
43	B2: Civil works for existing GT7(new GT10)	0 days	30/04/24	30/04/24																
44	B3: Civil Works for existing GT5 (new GT8)	0 days	31/07/24	31/07/24																
45	B4: Civil works for existing GT6 (new GT9)	0 days	28/02/26	28/02/26																
46	B5: Civil works for existing I/B Transformer Bay No. 2 and Gas Turbine 132kV Switching Station	20 days	28/02/26	28/02/26																
47	Section C (LPS)	1080 days	16/07/23	30/06/26																
48	C1: Trenching works within Area A & H	0 days	16/07/23	16/07/23																
49	C2: Trenching works (excluding BESS-3) within Area	10 days	31/05/24	31/05/24																
50	C3: Trenching works within Area E & F	0 days	31/08/24	31/08/24																
51	C4: Trenching works within Area G	0 days	30/09/25	30/09/25																
52	C5: Trenching works within Area I	0 days	31/03/26	31/03/26																
53	C6: Trenching works for BESS-3 within Area B	0 days	30/06/26	30/06/26																
54	Section D (LMX)	519 days	30/06/23	30/11/24																
55	D1: Trenching works within Area II	0 days	30/06/23	30/06/23																
56	D2: Trenching works within Area I	0 days	15/01/24	15/01/24																
57	D3: Trenching works within Area VIII	0 days	30/11/24	30/11/24																
58	Section E (LPS & LMX)	0 days	31/12/26	31/12/26																
59	E1: Remove of sub-base, backfill, screeding etc. for trenches within Area A to J at LPS and Area I to VIII at LMX	0 days	31/12/26	31/12/26																
60	E2: Total completion for all remaining works	0 days	31/12/26	31/12/26																
61	Schedule of Anchor Bolt Installation by Employer's Specialist Contractor as per Clause PS1.4.3 (Section B2 to	0 days	01/10/23	01/10/23																◆ 01/10
62	Section B2 - Anchor Bolt installation	46 days	01/02/24	17/03/24																
63	Section B3 - Anchor Bolt installation	45 days	01/06/24	15/07/24																
64	Section B4 - Anchor Bolt installation	46 days	01/01/26	15/02/26																
65	Schedule of Final concreting works	1081 days	16/03/23	28/02/26																
66	Section B2 - Final Concreting Works	15 days	16/03/23	30/03/23																
67	Section B3 - Final Concreting Works	16 days	16/07/24	31/07/24																
68	Section B4 - Final Concreting Works	13 days	16/02/26	28/02/26																
69	Transformer works by Employer's Specialist Contractor as per Clause PS1.4.3 (Section B5)	122 days	01/09/25	31/12/25																
70	Section B5 - Transformer Works	122 days	01/09/25	31/12/25																
71	General Preliminary and Technical Submission and Approval	940 days	24/06/22	18/01/25																
72	Method Statement and Materials: Preparation and Submission (Section A1 & Section A2)	7 days	24/06/22	30/06/22																
73	Method Statement and Materials: Engineer's Review and Approval (Section A1 & Section A2)	7 days	24/06/22	30/06/22																
74	Method Statement and Materials: Preparation and Submission (Other Major Works)	28 days	01/07/22	28/07/22																
75	Method Statement and Materials: Engineer's Review and Approval (Other Major Works)	28 days	29/07/22	25/08/22																
76	Quality Plan - Preparation & Submission	28 days	24/06/22	21/07/22																

Tender Program of Contract No. 21-83005
Civil Works for Re-provision of OCGT at Lamma Island Power Station




Task Summary Start-only Finish-only Critical Progress Critical Split


Milestone Manual Summary

Page 2

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

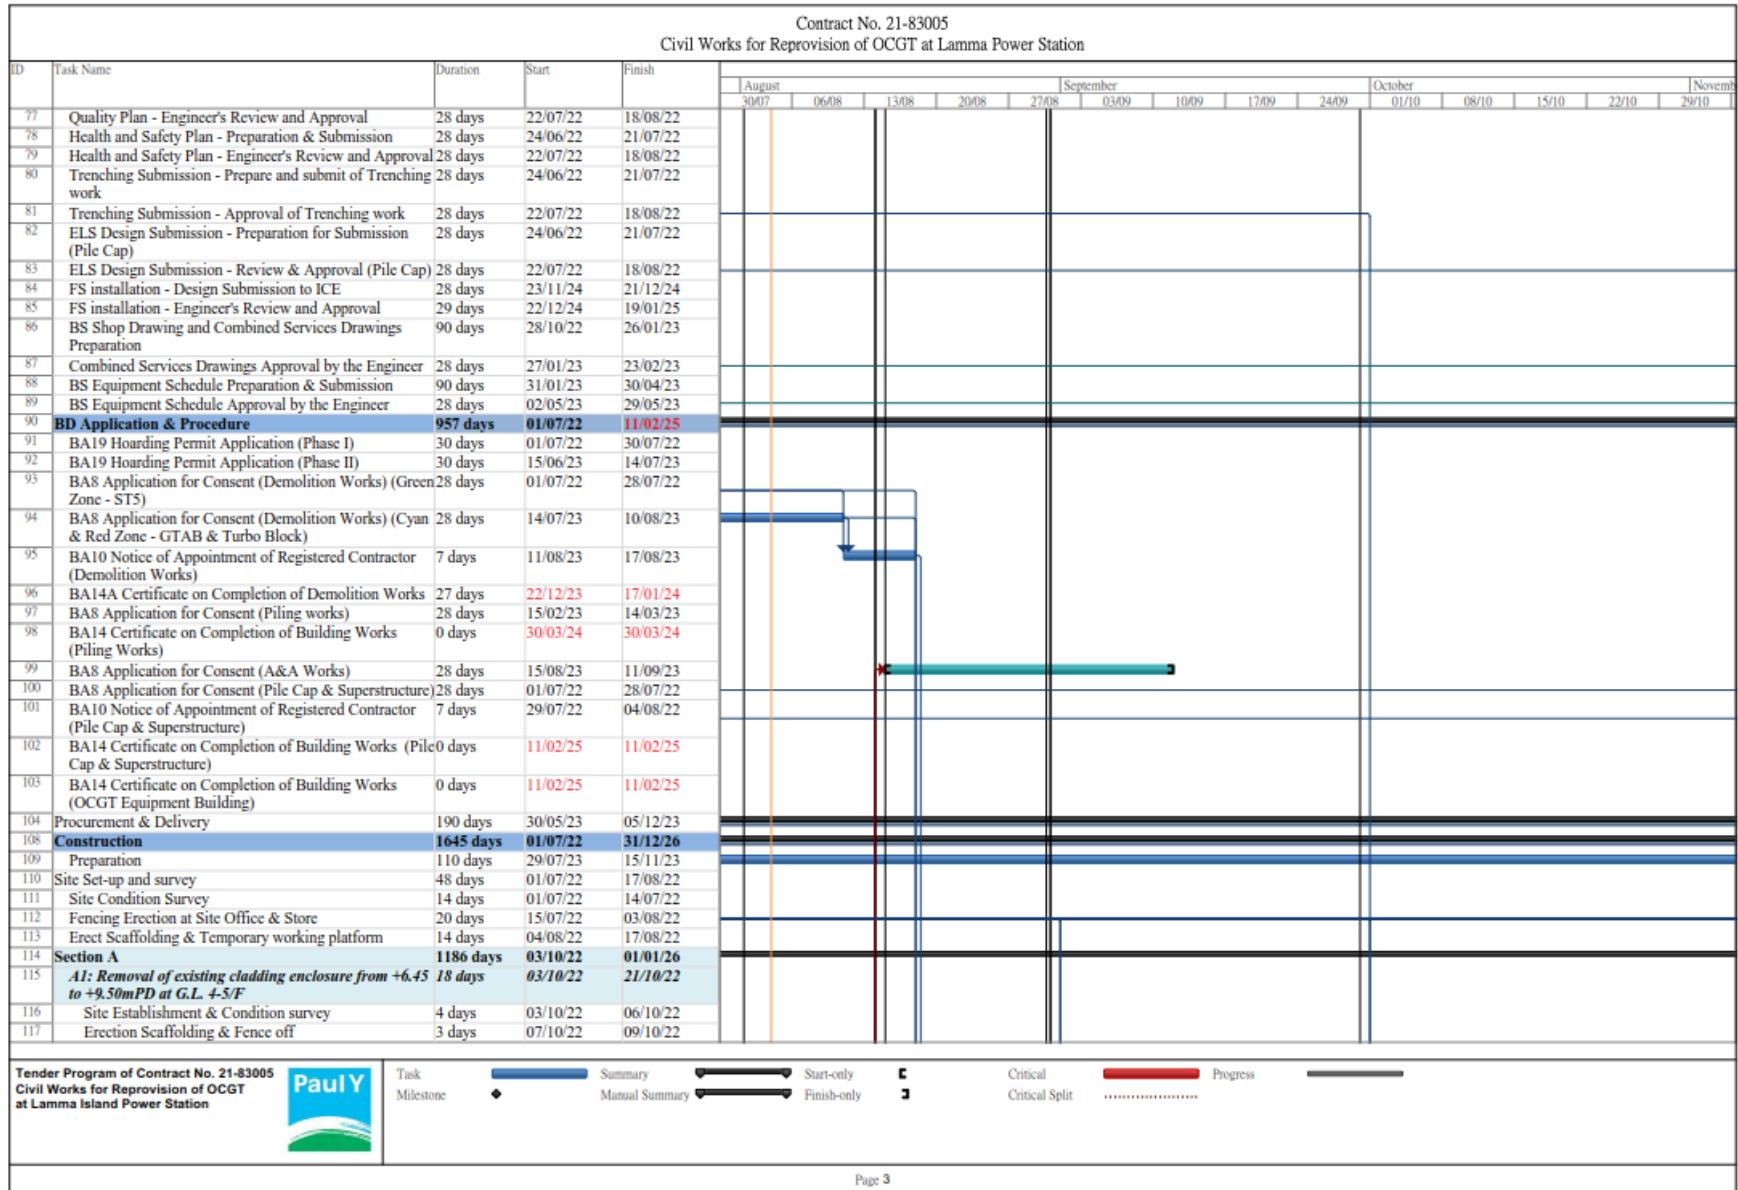

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

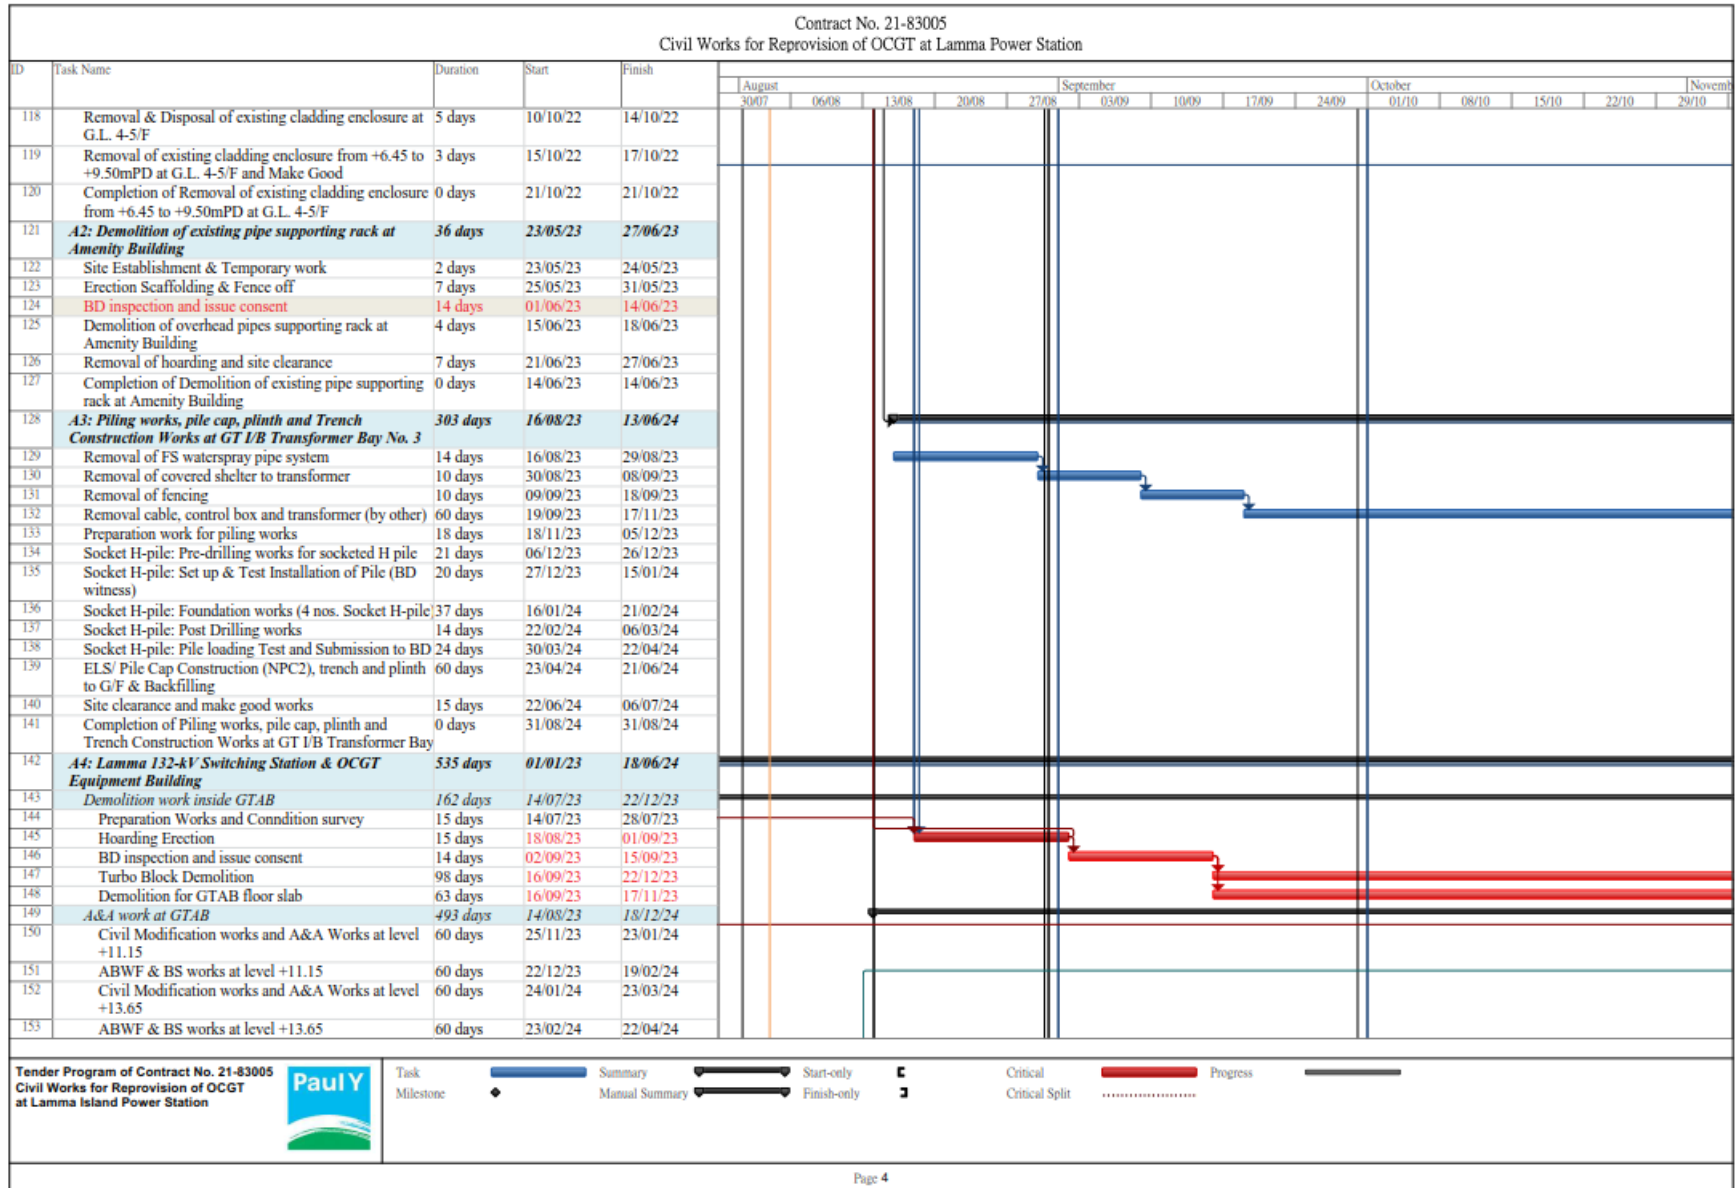

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

		Contract No. 21-83005 Civil Works for Re-provision of OCGT at Lamma Power Station																
ID	Task Name	Duration	Start	Finish	August				September				October				November	
					30/07	06/08	13/08	20/08	27/08	03/09	10/09	17/09	24/09	01/10	08/10	15/10	22/10	29/10
154	Civil Modification works and A&A Works at level +19.65	60 days	24/03/24	22/05/24														
155	ABWF & BS works at level +19.65	60 days	24/04/24	22/06/24														
156	Civil Modification works and A&A Works at level +25.15	60 days	23/05/24	21/07/24														
157	ABWF & BS works at level +25.15	60 days	23/06/24	21/08/24														
158	Re-construction of three internal floors	60 days	22/07/24	19/09/24														
159	ABWF & BS works at three new internal floors	90 days	20/09/24	18/12/24														
160	Civil Modification works and A&A Works at level +6.15 & +7.00	160 days	15/12/23	22/05/24														
161	ABWF & BS works at level +6.15 & +7.00	90 days	23/05/24	20/08/24														
162	Other Building Works	479 days	14/08/23	04/12/24														
163	Replacement of the existing windows and translucent sheets by metal cladding	90 days	22/02/24	21/05/24														
164	Installation of new fibreglass F.S. water tank to replace the existing fibreglass tank on flat roof	20 days	22/05/24	10/06/24														
165	Application of new waterproofing system to flat roof	20 days	11/05/24	30/05/24														
166	Application of fire protection system to the existing indoor structural steelworks of the	50 days	22/07/24	09/09/24														
167	Fire services installation	300 days	21/01/24	15/11/24														
168	Partition wall construction for new plant/equipment rooms	200 days	14/08/23	29/02/24														
169	Procurement & Delivery	180 days	02/11/23	29/04/24														
170	Replacement of the existing doors, roller shutters and folding shutters	45 days	01/03/24	14/04/24														
171	Drainage Works	90 days	01/09/23	29/11/23														
172	Procurement & Delivery	180 days	10/01/24	08/07/24														
173	Mechanical ventilation and air conditioning installation	90 days	08/07/24	05/10/24														
174	T&C	60 days	06/10/24	04/12/24														
175	Construction of New Staircase ST-5	464 days	13/08/23	18/11/24														
176	Preparation Work	18 days	13/08/23	30/08/23														
177	Modification Work for Existing Inlet Culvert	68 days	31/08/23	06/11/23														
178	Socket H-pile: Pre-drilling works for socketed H pile	21 days	07/11/23	27/11/23														
179	Socket H-pile: Set up & Test Installation of Pile (BD witness)	20 days	28/11/23	17/12/23														
180	Socket H-pile: Foundation works (7 nos. Socket H-pile)	67 days	18/12/23	22/02/24														
181	Socket H-pile: Post Drilling works	14 days	23/02/24	07/03/24														
182	Socket H-pile: Pile loading Test and Submission to BD	24 days	30/03/24	22/04/24														
183	ELS/ File Cap Construction (NPC1) to G/F	35 days	23/04/24	27/05/24														
184	Construction of New Staircase 4 above NPC1	65 days	28/05/24	31/07/24														
185	Construction of new cladding enclosure for Staircase 4 at flat roof	65 days	01/08/24	04/10/24														
186	Lift Procurement	180 days	13/02/24	11/08/24														
187	Fireman's lift installation at OCGT Equipment Building	70 days	11/08/24	19/10/24														
188	T&C	30 days	20/10/24	18/11/24														

Tender Program of Contract No. 21-83005
 Civil Works for Re-provision of OCGT
 at Lamma Island Power Station



Task Summary Start-only Finish-only Critical Progress Critical Split
 Milestone Manual Summary

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

		Contract No. 21-83005 Civil Works for Re-provision of OCGT at Lamma Power Station																							
ID	Task Name	Duration	Start	Finish	August					September					October					November					
					30/07	06/08	13/08	20/08	27/08	03/09	10/09	17/09	24/09	01/10	08/10	15/10	22/10	29/10							
189	EMSD	35 days	18/11/24	23/12/24																					
190	Submit Form 5 for Lift inspection	0 days	18/11/24	18/11/24																					
191	Lift inspection by EMSD	14 days	19/11/24	02/12/24																					
192	Issue of Lift Certificate (Form 6) by EMSD	21 days	03/12/24	23/12/24																					
193	WSD inspection	45 days	21/08/24	04/10/24																					
194	Form WWO Part IV Submission	0 days	21/08/24	21/08/24																					
195	WSD inspection	15 days	21/08/24	04/09/24																					
196	WSD collection of Water sample	15 days	05/09/24	19/09/24																					
197	Issuance of water certificate	15 days	20/09/24	04/10/24																					
198	FSD inspection	50 days	23/12/24	11/02/25																					
199	Form 314 & 501 submission	0 days	23/12/24	23/12/24																					
200	FS inspection (FS system)	15 days	24/12/24	07/01/25																					
201	FS re-inspection	7 days	08/01/25	14/01/25																					
202	FSD - Form 172 (Fire Certificate)	28 days	15/01/25	11/02/25																					
203	BD inspection for OP	27 days	11/02/25	10/03/25																					
204	Form 314 & 501 submission	0 days	11/02/25	11/02/25																					
205	BD inspection	13 days	12/02/25	24/02/25																					
206	BD rectification and re-inspection	14 days	25/02/25	10/03/25																					
207	Completion of Lamma 132-kV Switching Station & OCGT Equipment Building	0 days	10/03/25	10/03/25																					
208	A5: Shelter, fencing and fire services installation works at GT I/B Transformer Bay No.3	853 days	01/09/23	01/01/26																					
209	Construction of shelter and fencing works at GT Interbus (I/B) Transformer Bay No. 3	90 days	01/09/23	29/11/23																					
210	Completion of Shelter, fencing and fire services installation works at GT I/B Transformer Bay No.3	0 days	01/01/26	01/01/26																					
211	Section B	882 days	01/10/23	28/02/26																					
238	Section C	1461 days	01/07/22	30/06/26																					
239	C1: Trenching works within Area A	395 days	01/07/22	30/07/23																					
240	Area A	395 days	01/07/22	30/07/23																					
241	Preparation Works (UU checking/ Condition survey/ Fence off)	20 days	01/07/22	20/07/22																					
242	Excavation (ELS)/ UU Diversion (if any)	75 days	21/07/22	03/10/22																					
243	Trench construction	270 days	19/09/22	15/06/23																					
244	Procurement & Delivery of Precast Trench Cover	60 days	16/04/23	15/06/23																					
245	Lay & compact sub-base & Install Precast Trench Covers	45 days	16/06/23	30/07/23																					
246	Completion of Trenching works within Area A	0 days	30/07/23	30/07/23																					
247	C2: Trenching works (excluding BESS-3) within Area B	515 days	04/08/22	31/12/23																					
248	Area B (BESS-2a)	150 days	01/10/23	27/02/24																					
249	Preparation Works (UU checking/ Condition survey/ Fence off)	20 days	01/10/23	20/10/23																					
250	Excavation (ELS)	40 days	21/10/23	29/11/23																					
251	Trench construction & Install Precast Trench Covers	55 days	30/11/23	23/01/24																					
252	Lay & compact sub-base (Temporary Ground Finishes)	35 days	24/01/24	27/02/24																					
253	Area B (excluding BESS-3)	243 days	01/10/23	31/05/24																					

Tender Program of Contract No. 21-83005
 Civil Works for Re-provision of OCGT
 at Lamma Island Power Station



Task Milestone Summary Manual Summary Start-only Finish-only Critical Critical Split Progress

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

Contract No. 21-83005 Civil Works for Reprovision of OCGT at Lamma Power Station																			
ID	Task Name	Duration	Start	Finish	August				September				October				November		
					30/07	06/08	13/08	20/08	27/08	03/09	10/09	17/09	24/09	01/10	08/10	15/10	22/10	29/10	
254	Preparation Works (UU checking/ Condition survey/ Fence off)	25 days	01/10/23	25/10/23															
255	Excavation (ELS)/ UU Diversion (if any)	60 days	26/10/23	24/12/23															
256	Trench construction	99 days	05/12/23	12/03/24															
257	Procurement & Delivery of Precast Trench Cover	60 days	12/01/24	12/03/24															
258	Lay & compact sub-base & Install Precast Trench Covers	50 days	13/03/24	01/05/24															
259	Completion of Trenching works (excluding BESS-3) within Area B	0 days	31/05/24	31/05/24															
260	C3: Trenching works within Area E & F	365 days	02/06/23	31/05/24															
261	Area E	183 days	01/03/24	30/08/24															
262	Preparation Works (UU checking/ Condition survey/ Fence off)	25 days	01/03/24	25/03/24															
263	Excavation (ELS)/ UU Diversion (if any)	60 days	26/03/24	24/05/24															
264	Trench construction	77 days	05/05/24	20/07/24															
265	Procurement & Delivery of Precast Trench Cover	60 days	21/05/24	20/07/24															
266	Lay & compact sub-base & Install Precast Trench Covers	41 days	21/07/24	30/08/24															
267	Area F	183 days	01/12/23	31/05/24															
268	Preparation Works (UU checking/ Condition survey/ Fence off)	25 days	01/12/23	25/12/23															
269	Excavation (ELS)/ UU Diversion (if any)	60 days	26/12/23	23/02/24															
270	Trench construction	77 days	04/02/24	20/04/24															
271	Procurement & Delivery of Precast Trench Cover	60 days	20/02/24	20/04/24															
272	Lay & compact sub-base & Install Precast Trench Co	41 days	21/04/24	31/05/24															
273	Completion of Trenching works within Area E & F	0 days	31/08/24	31/08/24															
274	Area D1	182 days	01/12/23	31/05/24															
275	Preparation Works (UU/ Condition survey)	25 days	01/12/23	25/12/23															
276	Excavation (ELS)/ UU Diversion (if any)	60 days	26/12/23	23/02/24															
277	Trench construction	70 days	04/02/24	13/04/24															
278	Procurement & Delivery of Precast Trench Cover	60 days	13/02/24	13/04/24															
279	Lay & compact sub-base & Install Precast Trench Covers	30 days	14/04/24	13/05/24															
280	Completion of Trenching works within Area D1	0 days	31/05/24	31/05/24															
281	C4: Trenching works within Area G	183 days	01/04/25	30/09/25															
282	Preparation Works (UU checking/ Condition survey/ Fence off)	20 days	01/04/25	20/04/25															
283	Excavation (ELS)/ UU Diversion (if any)	70 days	21/04/25	29/06/25															
284	Trench construction	83 days	10/06/25	31/08/25															
285	Procurement & Delivery of Precast Trench Cover	60 days	02/07/25	31/08/25															
286	Lay & compact sub-base & Install Precast Trench Covers	30 days	01/09/25	30/09/25															
287	Completion of Trenching works within Area G	0 days	30/09/25	30/09/25															
288	C5: Trenching works within Area I	182 days	01/10/25	31/03/26															
289	Preparation Works (UU checking/ Condition survey/ Fence off)	20 days	01/10/25	20/10/25															
290	Excavation (ELS)/ UU Diversion (if any)	60 days	21/10/25	19/12/25															
291	Trench construction	80 days	30/11/25	17/02/26															
292	Procurement & Delivery of Precast Trench Cover	60 days	19/12/25	17/02/26															

Tender Program of Contract No. 21-83005
 Civil Works for Reprovision of OCGT
 at Lamma Island Power Station



Task Summary Start-only Finish-only Critical Progress Critical Split

Milestone Manual Summary

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023


Contract No. 21-83005 Civil Works for Reprovision of OCGT at Lamma Power Station																	
ID	Task Name	Duration	Start	Finish	August				September				October				November
					30/07	06/08	13/08	20/08	27/08	03/09	10/09	17/09	24/09	01/10	08/10	15/10	22/10
293	Lay & compact sub-base & Install Precast Trench Covers	42 days	18/02/26	31/03/26													
294	Completion of Trenching works within Area I	0 days	31/03/26	31/03/26													
295	C6: Trenching works for BESS-3 within Area B	181 days	01/01/26	30/06/26													
296	Preparation Works (UU checking/ Condition survey/ Fence off)	20 days	01/01/26	20/01/26													
297	Excavation (ELS)/ UU Diversion (if any)	60 days	21/01/26	21/03/26													
298	Trench construction	80 days	12/03/26	30/05/26													
299	Procurement & Delivery of Precast Trench Cover	60 days	31/03/26	30/05/26													
300	Lay & compact sub-base & Install Precast Trench Covers	31 days	31/05/26	30/06/26													
301	Completion of Trenching works for BESS-3 within Area B	0 days	30/06/26	30/06/26													
302	Section D	700 days	01/01/23	30/11/24													
303	D1: Trenching works within Area II	181 days	01/01/23	30/06/23													
304	Preparation Works (UU checking/ Condition survey/ Fence off)	30 days	01/01/23	30/01/23													
305	Excavation (ELS)/ UU Diversion (if any)	70 days	31/01/23	10/04/23													
306	Trench construction	71 days	22/03/23	31/05/23													
307	Backfilling & Temporary Paving	30 days	01/06/23	30/06/23													
308	Completion of Trenching works within Area II	0 days	30/06/23	30/06/23													
309	D2: Trenching works within Area I	152 days	15/01/24	14/06/24													
310	Preparation Works (UU checking/ Condition survey/ Fence off)	20 days	15/01/24	03/02/24													
311	Excavation (ELS)/ UU Diversion (if any)	30 days	04/02/24	04/03/24													
312	Trench construction	72 days	05/03/24	15/05/24													
313	Existing Trench wall modification	72 days	05/03/24	15/05/24													
314	Backfilling & Temporary Paving	30 days	16/05/24	14/06/24													
315	Completion of Trenching works within Area I	0 days	14/06/24	14/06/24													
316	D3: Trenching works within Area VIII	122 days	01/08/24	30/11/24													
317	Preparation Works (UU checking/ Condition survey/ Fence off)	20 days	01/08/24	20/08/24													
318	Excavation (ELS)/ UU Diversion (if any)	30 days	21/08/24	19/09/24													
319	Trench construction	62 days	10/09/24	10/11/24													
320	Backfilling & Temporary Paving	20 days	11/11/24	30/11/24													
321	Completion of Trenching works within Area VIII	0 days	30/11/24	30/11/24													
322	Section E	1884 days	01/01/23	27/02/28													
442	Contract Completion	0 days	31/12/26	31/12/26													

Tender Program of Contract No. 21-83005
 Civil Works for Reprovision of OCGT
 at Lamma Island Power Station




Task Milestone Summary Manual Summary Start-only Finish-only Critical Critical Split Progress

Appendix B2 Tentative Decommissioning and Construction Programme (E&M Contractor)

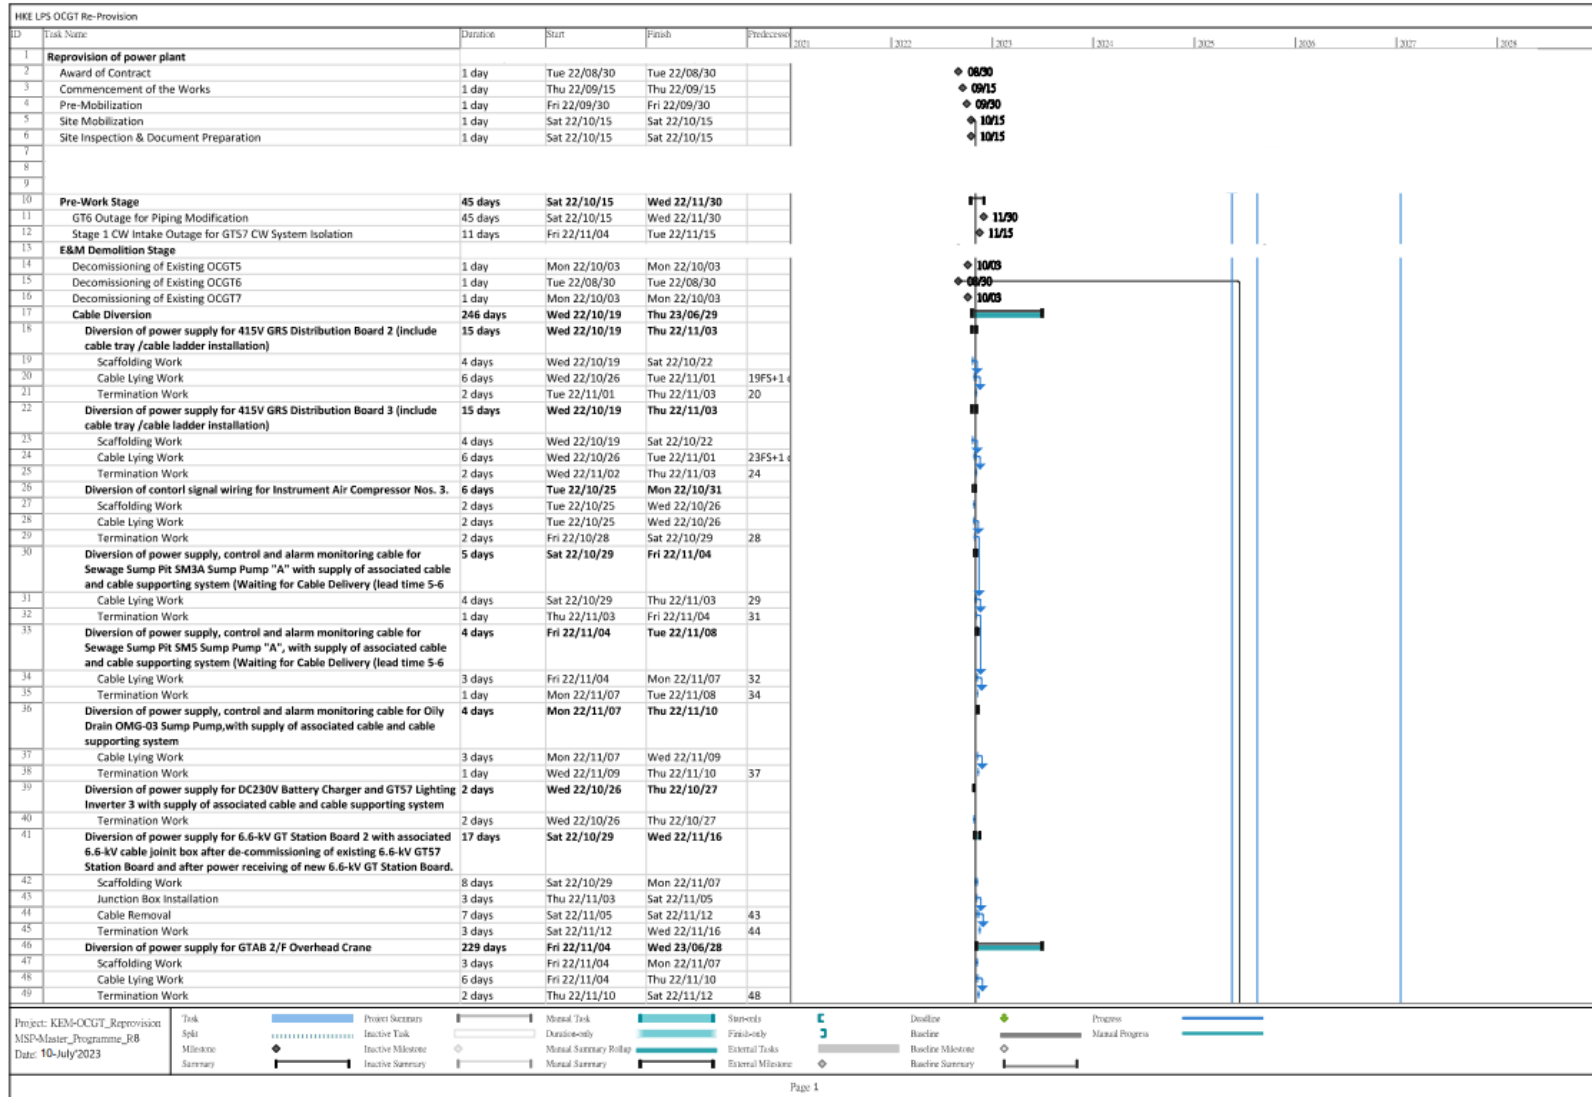


Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

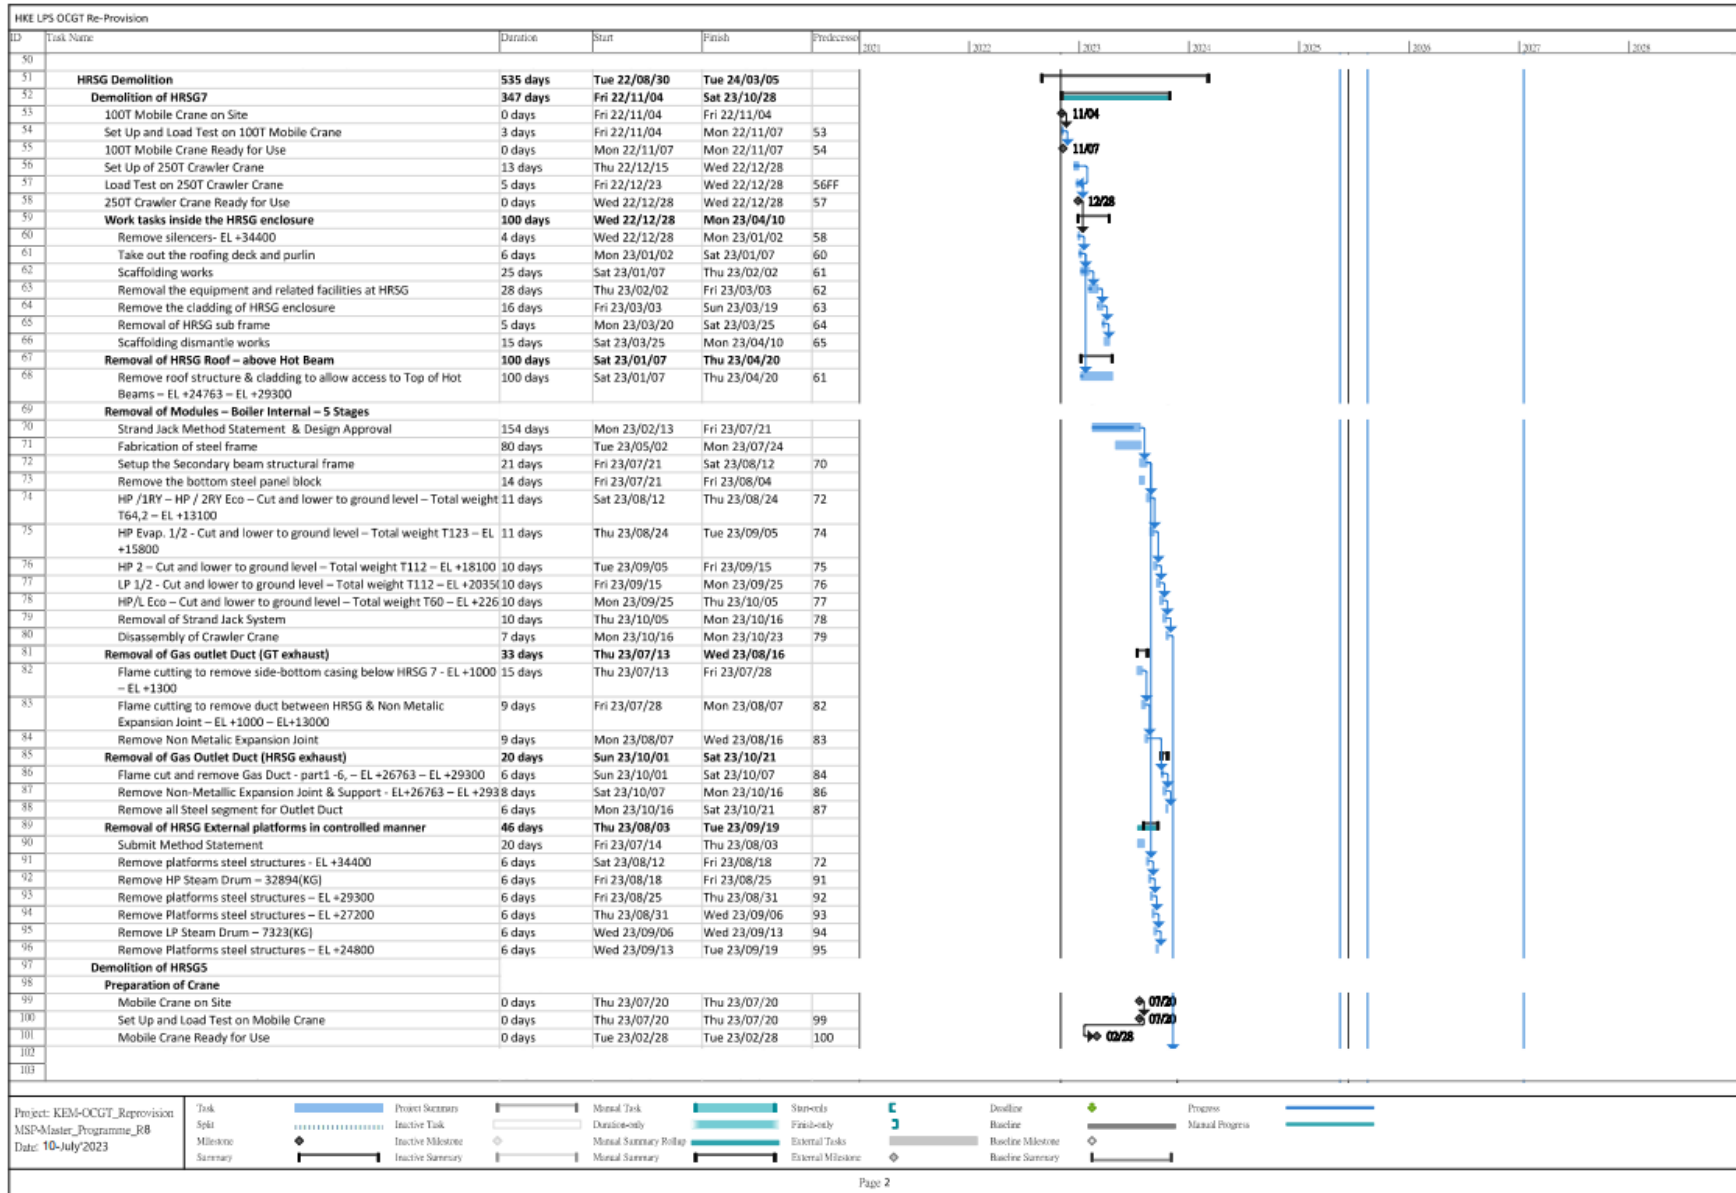

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023


HKE LPS OCGT Re-Provision						Gantt Chart Timeline (2021-2028)											
ID	Task Name	Duration	Start	Finish	Predecessor	2021	2022	2023	2024	2025	2026	2027	2028				
104																	
105																	
106																	
107																	
108																	
109																	
110																	
111																	
112																	
113																	
114																	
115																	
116																	
117																	
118																	
119																	
120																	
121																	
122																	
123	Removal of Gas outlet Duct (GT exhaust)	316 days	Tue 22/08/30	Fri 23/07/21													
124	Flame cutting to remove side-bottom casing below HRSG 5 - EL +1000 - EL +1300	1 day	Tue 22/08/30	Tue 22/08/30													
125	Flame cutting to remove duct between HRSG & Non Metallic Expansion Joint - EL +1000 - EL+13000	2 days	Tue 22/08/30	Thu 22/09/01	124												
126	Remove Non Metallic Expansion Joint	2 days	Thu 23/07/20	Sat 23/07/22	125												
127																	
128																	
129																	
130																	
131																	
132																	
133																	
134																	
135																	
136																	
137																	
138	OCGT Demolition																
139	Demolition of GT7	205 days	Sat 23/02/18	Mon 23/09/18													
140	Set Up and Load Test on 300T Mobile Crane	3 days	Mon 23/02/20	Wed 23/02/22													
141	300T Mobile Crane Ready for Use	0 days	Wed 23/02/22	Wed 23/02/22	140												
142	Dismantle of air cooling fan	11 days	Sat 23/02/18	Wed 23/03/15													
143	Dismantle of inlet air filter and intake air silencer by 300T mobile crane	21 days	Mon 23/03/27	Mon 23/04/17	142												
144	Submission and approval of Gantry crane design + Method Statement	52 days	Mon 23/05/22	Fri 23/07/14	141												
145	Design & Method Statement for Concrete Beam	14 days	Mon 23/07/24	Tue 23/08/08	146												
146	Gantry Crane Concrete Beam Curing + Test Report	10 days	Fri 23/07/14	Mon 23/07/24													
147	Set Up Mobile Gantry Crane	21 days	Mon 23/07/24	Mon 23/08/14	144												
148	Load Test on Gantry Crane	5 days	Mon 23/08/14	Fri 23/08/18	147FF												
149	Gantry Crane Ready for Use	0 days	Fri 23/08/18	Fri 23/08/18	148												
150	Disconnect the Pipe and Associated Equipment from transformer	10 days	Mon 23/07/17	Wed 23/07/26	143												
151	Lift and Move the transformer from GT Foundation to the Transporter	3 days	Wed 23/08/23	Fri 23/08/25													
152	Disconnect the Pipe and Associated Equipment from Generator	12 days	Wed 23/07/26	Tue 23/08/08	150												
153	Lift and Move the Generator from GT Foundation to the Transporter	4 days	Fri 23/08/25	Wed 23/08/30	151												
154	Disconnect the Pipe and Associated Equipment from Gas Turbine	13 days	Wed 23/07/26	Wed 23/08/09	150												
155	Lift and Move the Gas Turbine from GT Foundation to the Transporter	4 days	Wed 23/08/30	Sat 23/09/02	153												
156	Dismantle and Removal of Gantry Crane System	14 days	Sat 23/09/02	Mon 23/09/18	155												
157	Demolition of GT5																
158	Set Up and Load Test on Mobile Crane	3 days	Wed 23/08/23	Fri 23/08/25	148												

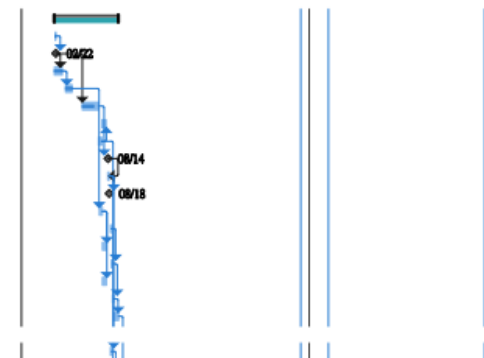


Project: KEV-OCGT_Reprovision
 MSP-Master_Programme_r8
 Date: 10-July-2023

Task	Project Summary	Manual Task	Start-ends	Deadline	Progress
Split	Inactive Task	Duration-only	Final-only	Baseline	Manual Progress
Milestone	Inactive Milestone	Manual Summary Rollup	External Tasks	Baseline Milestone	
Summary	Inactive Summary	Manual Summary	External Milestone	Baseline Summary	


Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

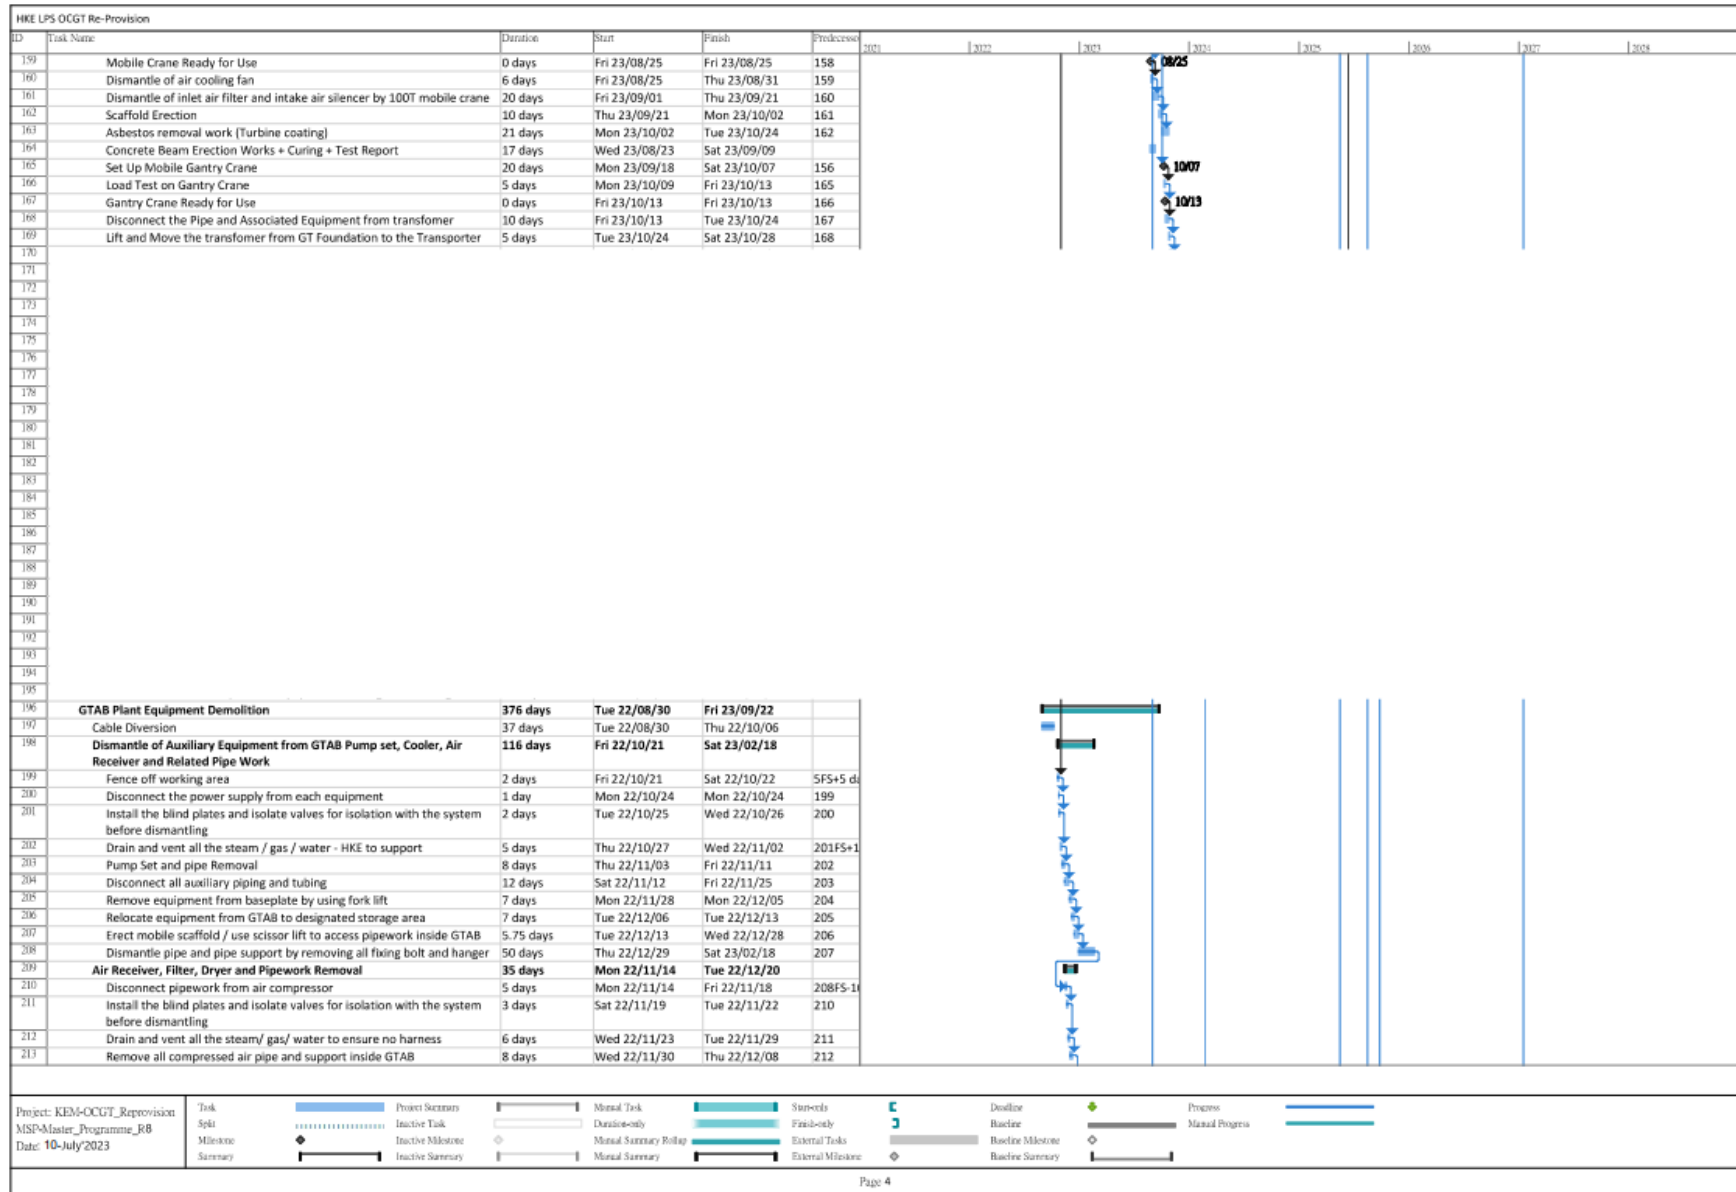

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

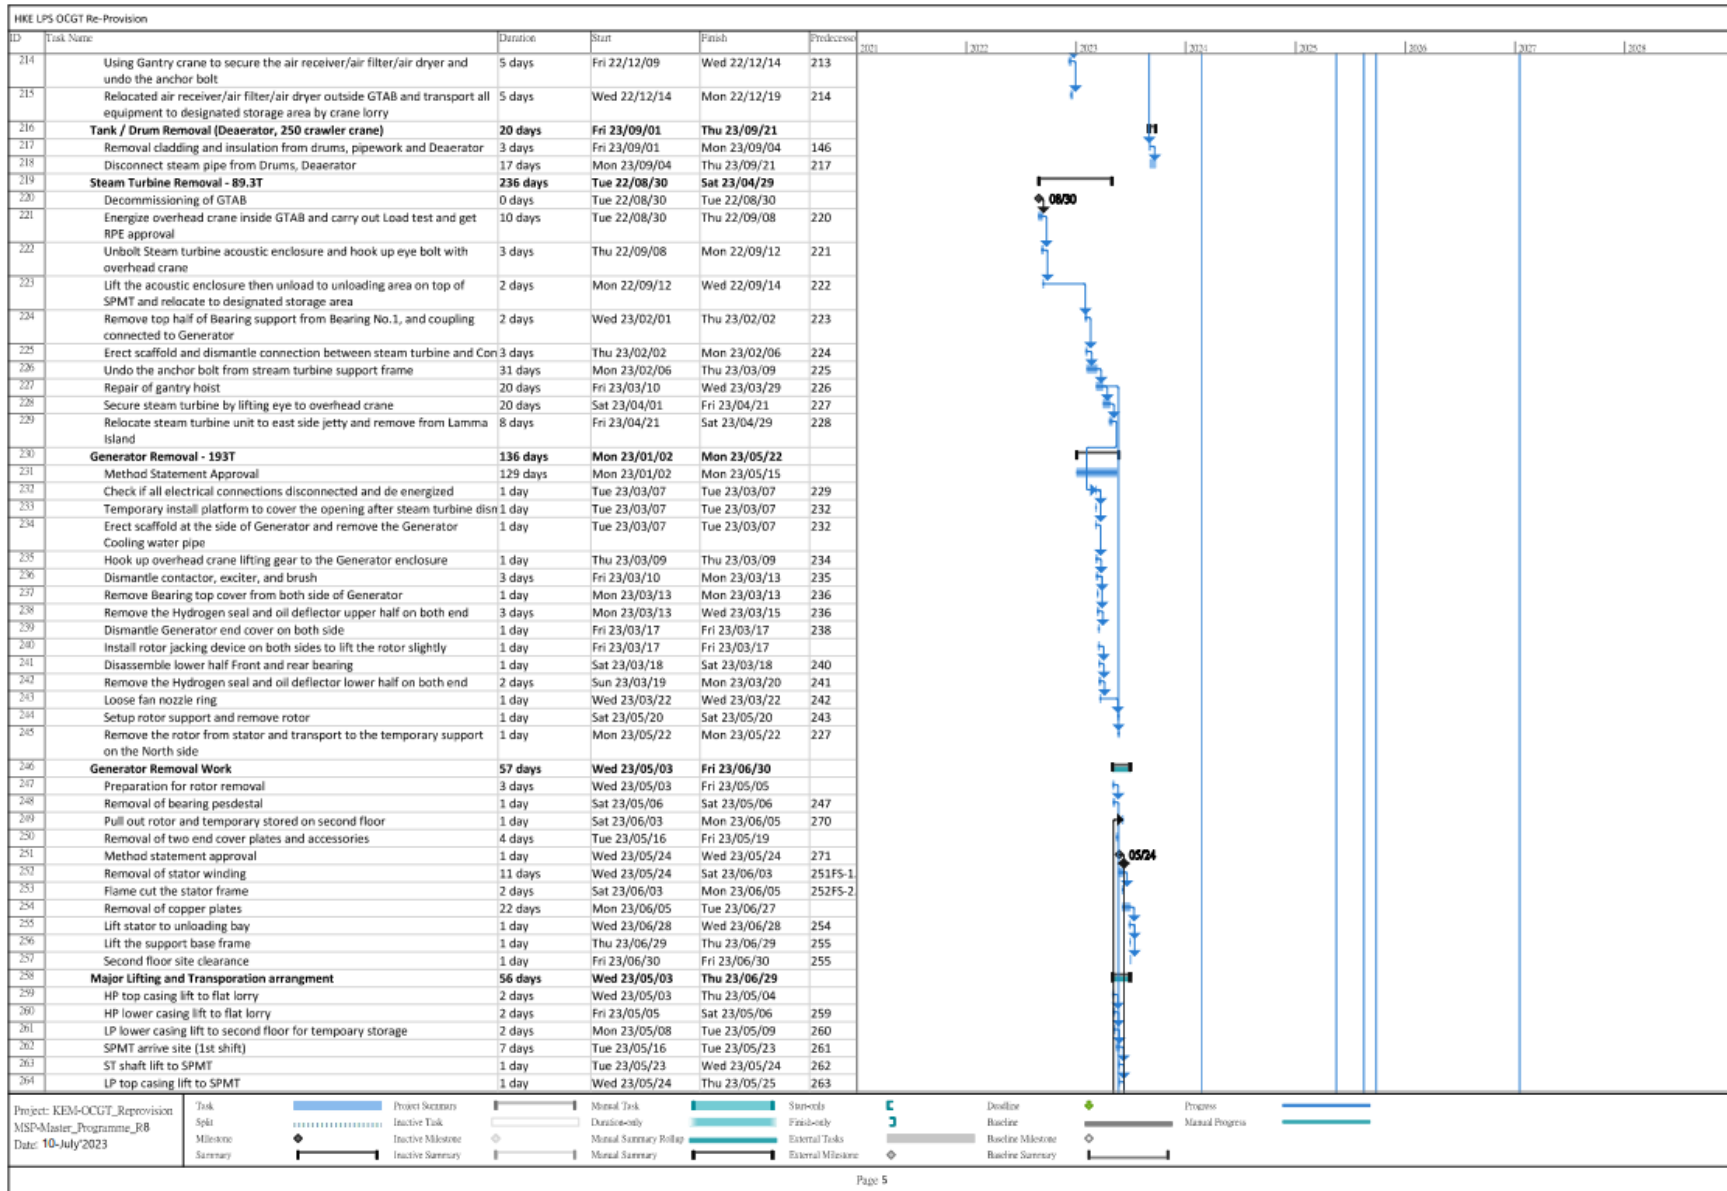

Re-provision of Open Cycle Gas Turbines at Lamma Power Station
 Monthly EM&A Report for July 2023

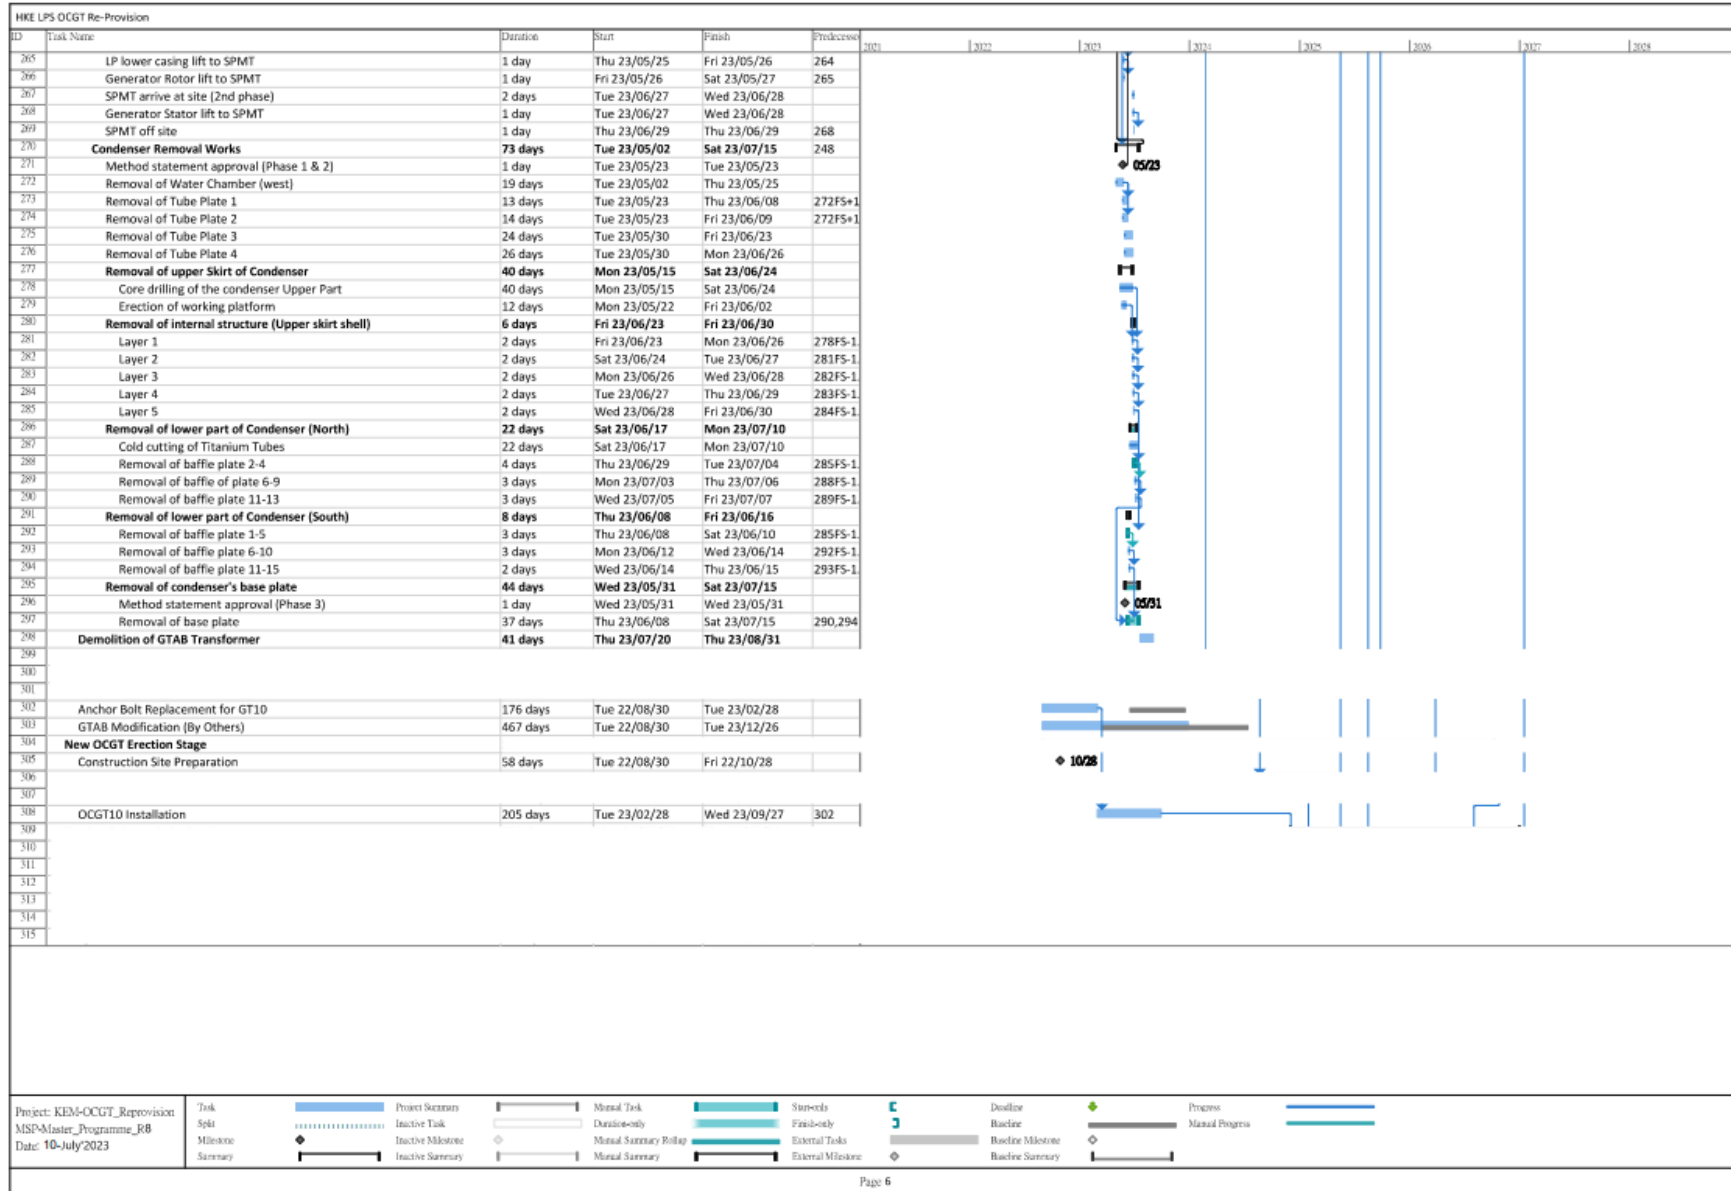

Appendix C Summary of EMIS

Table C.1 Mitigation Measures and their Implementation in the Reporting Month

EM&A Log Ref.	Recommended Mitigation Measures	Implementation Status
	AIR QUALITY	
EM&A: S2	Impervious sheet will be provided for skip hoist for material transport.	Complied
EM&A: S2	The area where dusty work takes place should be sprayed with water or a dust suppression chemical immediately prior to, during and immediately after dusty activities as far as practicable.	Complied
EM&A: S2	All dusty materials should be sprayed with water or a dust suppression chemical immediately prior to any loading, unloading or transfer operation.	Complied
EM&A: S2	Dropping heights for excavated materials should be controlled to a practical height to minimise the fugitive dust arising from unloading.	Complied
EM&A: S2	During transportation by truck, materials should not be loaded to a level higher than the side and tail boards, and should be dampened or covered before transport.	Complied
EM&A: S2	Temporary stockpiles of dusty materials will be either covered entirely by impervious sheets or sprayed with water to maintain the entire surface wet all the time.	Complied
EM&A: S2	Stockpiles of more than 20 bags of cement, dry pulverised fuel ash and dusty construction materials will be covered entirely by impervious sheeting sheltered on top and 3-sides.	Complied
EM&A: S2	All exposed areas will be kept wet always to minimise dust emission.	Complied
EM&A: S2	Ultra-low-sulphur diesel (ULSD) will be used for all construction plant on-site, as defined as diesel fuel containing not more than 0.005% sulphur by weight) as stipulated in Environment, Transport and Works Bureau Technical Circular (ETWB-TC(W)) No 19/2005 on Environmental Management on Construction Sites.	Complied
EM&A: S2	The engine of the construction equipment during idling will be switched off.	Complied
EM&A: S2	Regular maintenance of construction equipment deployed on-site will be conducted to prevent black smoke emission.	Complied
EM&A: S2	All marine vessels fuelled in Hong Kong will operate using marine light diesel with Sulphur content lower than 0.05%.	Complied
EM&A: S2	NRMMs, e.g. mobile generator and air compressor, will comply with the prescribed emission standards with a proper label approved by EPD.	Complied
EM&A: S2	Electric power supply for on-site machinery will be provided as far as practicable for construction activities.	Complied
EM&A: S2	To ensure proper implementation of the recommended dust mitigation measures and good construction site practices during the decommissioning/ demolition/ construction phases, environmental site audits on weekly basis is recommended throughout the construction period.	Complied

EM&A Log Ref.	Recommended Mitigation Measures	Implementation Status
APCO	Every vehicle shall be washed to remove any dusty materials from its body and wheels before leaving construction site.	Complied
	NOISE	
EM&A: S3	Machines and construction plant that may be in intermittent use should be shut down between work periods or should be throttled down to a minimum.	Complied
EM&A: S3	Only well-maintained construction plant should be operated on-site and should be serviced regularly.	Complied
NCO	Valid construction noise permits, if required, are available for inspection.	Complied
NCO	Conditions of construction noise permits, if any, for the relevant part(s) of the works are implemented accordingly.	Complied
NCO	Valid noise emission labels are fixed at air compressors and hand held percussive breakers.	Complied
	WATER QUALITY	
EM&A: S4	Wastewater, chemical waste and effluent from cleaning of existing OCGTs would be collected, stored for proper disposal by licensed contractor.	Not applicable at this stage
EM&A: S4	Silt removal facilities such as silt traps or sedimentation facilities will be provided where necessary to remove silt particles from runoff to meet the requirements of the TM standard under the WPCO. The design of silt removal facilities will be based on the guidelines provided in ProPECC PN 1/94. All drainage facilities and erosion and sediment control structures will be inspected on a regular basis and maintained to confirm proper and efficient operation at all times and particularly during rainstorms. Deposited silt and grit will be removed regularly.	Not applicable at this stage
EM&A: S4	Appropriate surface drainage will be designed and provided, where necessary.	Not applicable at this stage
EM&A: S4	The precautions to be taken at any time of year when rainstorms are likely together with the actions to be taken when a rainstorm is imminent or forecasted and actions to be taken during or after rainstorms are summarised in Appendix A2 of ProPECC PN 1/94.	Not applicable at this stage
EM&A: S4	Oil interceptors will be provided in the drainage system where necessary and regularly emptied to prevent the release of oil and grease into the stormwater drainage system after accidental spillages.	Not applicable at this stage
EM&A: S4	Temporary and permanent drainage pipes and culverts provided to facilitate runoff discharge, if any, will be adequately designed for the controlled release of storm flows.	Not applicable at this stage
EM&A: S4	The temporary diverted drainage, if any, will be reinstated to the original condition when the construction work has finished or when the temporary diversion is no longer required.	Not applicable at this stage
EM&A: S4	Appropriate numbers of portable toilets shall be provided by a licensed contractor where necessary to serve the construction workers over the construction site to prevent direct disposal of sewage into the water environment.	Complied
EM&A: S4	To ensure proper implementation of the recommended water quality mitigation measures and good construction site practices during the decommissioning/ demolition, and construction phases, environmental	Complied

EM&A Log Ref.	Recommended Mitigation Measures	Implementation Status
	site audits on weekly basis is recommended throughout the construction period.	
	WASTE MANAGEMENT	
EM&A: S5	The contractor(s) must ensure that all the necessary waste disposal licences are obtained prior to the commencement of the decommissioning/ demolition and construction works.	Complied
EM&A: S5	The contractor will open a billing account with EPD in accordance with the Waste Disposal (Charges for Disposal of Construction Waste) Regulation for the payment of disposal charges.	Complied
EM&A: S5	A trip-ticket system will be established in accordance with DEVB TC(W) No. 6/2010 to monitor the reuse of surplus excavated materials off-site and disposal of construction waste and general refuse at transfer facilities/ landfills, and to control fly-tipping.	Complied
EM&A: S5	A WMP as stated in the PNAP ADV-19 for the amount of waste generated, recycled and disposed of (including the disposal sites) will be established and implemented during the construction phase as part of the Environmental Management Plan (EMP). The Contractor will be required to prepare the EMP and submits it to the Architect/ Engineer under the Contract for approval prior to implementation.	Complied
EM&A: S5	C&D materials will be segregated on-site into public fill and construction waste and stored in different containers or skips to facilitate reuse of the public fill and proper disposal of the construction waste. Specific areas of the Site will be designated for such segregation and storage if immediate use is not practicable. Prefabrication will be adopted as far as practicable to reduce the construction waste arisings.	Complied
EM&A: S5	The contractor(s) will register as a chemical waste producer with the EPD. Chemical waste will be handled in accordance with the Code of Practice on the Packaging, Handling and Storage of Chemical Wastes.	Complied
EM&A: S5	Containers used for storage of chemical wastes will: <ul style="list-style-type: none"> • Be suitable for the substance they are holding, resistant to corrosion, maintained in a good condition, and securely closed; • Have a capacity of less than 450 L unless the specifications have been approved by the EPD; and • Display a label in English and Chinese in accordance with instructions prescribed in Schedule 2 of the Regulations. 	Complied
EM&A: S5	The storage area for chemical wastes will: <ul style="list-style-type: none"> • Be clearly labelled and used solely for the storage of chemical waste; • Be enclosed on at least 3 sides; • Have an impermeable floor and bunding, of capacity to accommodate 110% of the volume of the largest container or 20% by volume of the chemical waste stored in that area, whichever is the greatest; • Have adequate ventilation; • Be covered to prevent rainfall entering (water collected within the bund must be tested and disposed of as chemical waste, if necessary); and • Be arranged so that incompatible materials are appropriately separated. 	Complied
EM&A: S5	Chemical waste will be disposed of: <ul style="list-style-type: none"> • Via a licensed chemical waste collector; and 	Complied

EM&A Log Ref.	Recommended Mitigation Measures	Implementation Status
	<ul style="list-style-type: none"> To a facility licensed to receive chemical waste, such as the Chemical Waste Treatment Facility which also offers a chemical waste collection service and can supply the necessary storage containers. 	
EM&A: S5	General refuse will be stored in enclosed bins separately from construction and chemical wastes. The general refuse will be delivered separately from construction and chemical wastes for offsite disposal on a daily basis to reduce odour, pest and litter impacts.	Complied
EM&A: S5	Recycling bins will be provided at strategic locations within the Project Site to facilitate recovery of recyclable materials (including aluminium cans, waste papers, glass bottles and plastic bottles, etc.). Materials recovered will be sold for recycling.	Not applicable at this stage
EM&A: S5	To avoid any odour and litter impact, appropriate number of portable toilets will be provided for workers on-site where appropriate.	Not applicable at this stage
EM&A: S5	At the commencement of the decommissioning/demolition and construction works, training will be provided to workers on the concepts of site cleanliness and on appropriate waste management procedures, including waste reduction, reuse and recycling.	Complied
EM&A: S5	General refuse and non-recyclables will be stored in enclosed bins and collected by existing waste management contractor at Lamma Power Station for disposal at the landfills on a daily basis for avoidance of pest and odour nuisance.	Complied
EM&A: S5	Recycling bins for recyclable materials (including aluminium cans, waste papers, glass bottles and plastic bottles) will be placed at the site office and transported off- site for recycling on a regular basis.	Complied
EM&A: S5	It is recommended that weekly audits of the waste management practices be carried out during the decommissioning/demolition, and construction phases to determine if wastes are being managed in accordance with the recommended good site practices and WMP. The audits will investigate all aspects of waste management including waste generation, storage, handling, recycling, transportation and disposal.	Complied
LAND CONTAMINATION		
EM&A: S6	During the demolition stage, a Land Contamination Specialist shall oversee the removal / demolition activities and record any new visual signs of potential contamination such as oil leakage or oil stains. The Land Contamination Specialist shall also review the need of additional sampling to capture potential contamination observed during the demolition stage.	Complied
EM&A: S6	SI and sampling shall be carried out when the proposed sampling locations are available after the demolition stage.	Complied
EM&A: S6	Soil and groundwater sampling works will be supervised by a Land Contamination Specialist.	Complied
EM&A: S6	Prior to commencement of demolition works in the Project site, the leftover diesel or other petroleum products in the equipment to be demolished shall be removed as much as possible. The removed diesel or other petroleum products will be reused as far as practicable. The removed diesel and other petroleum products, which cannot be reused are considered as chemical waste and are controlled under the Waste Disposal (Chemical Waste)(General) Regulation. The demolition contractor who will generate the chemical waste or cause it to be	Complied

EM&A Log Ref.	Recommended Mitigation Measures	Implementation Status
	produced should register with the EPD as a chemical waste producer. Removed diesel and petroleum products shall be labelled and stored in accordance with the requirement stipulated in the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes issued by EPD. The removed petrol and petroleum products are required to be collected by licensed chemical waste collector for disposal. Trip tickets system shall be implemented during the collection and disposal of removed petrol and diesel.	
EM&A: S6	During demolition and construction phases, the following good housekeeping practices shall be implemented to ensure that risk of ground contamination as a result of oil spills or leaks is kept to a practical minimum: <ul style="list-style-type: none"> • Regular visual inspections to detect any early signs of fuel leakage prior to demolition; • Provision of impermeable lining or absorbent materials to contain leaks; • Provision of secondary containment for the temporary storage of removed diesel or petroleum products, demolished structures and pipes; and • Provision of spill control materials and equipment 	Complied
EM&A: S6	To ensure proper implementation of the good housekeeping practices, weekly site inspections should be carried out during the decommissioning/demolition, and construction phases of the Project.	Complied

Remarks:

APCO: Air Pollution Control Ordinance
 EM&A: EM&A Manual
 NCO: Noise Control Ordinance

Appendix D Summary of Site Audit Findings or Recommendation

Civil contractor

Dates of Inspection: 03/07/2023, 11/07/2023, 21/07/2023 and 25/07/2023

Summary of Findings or Recommendation

Air Quality

- No environmental deficiency identified.

Noise

- No environmental deficiency identified.

Water Quality

- No environmental deficiency identified.

Waste Management

- No environmental deficiency identified.

Land Contamination

- No environmental deficiency identified.

E&M contractor

Dates of Inspection: 04/07/2023, 11/07/2023, 18/07/2023, 21/07/2023 and 25/07/2023

Summary of Findings or Recommendation

Air Quality

- No environmental deficiency identified.

Noise

- No environmental deficiency identified.

Water Quality

- No environmental deficiency identified.

Waste Management

- No environmental deficiency identified.

Land Contamination

- No environmental deficiency identified.

Appendix E

Monthly Waste Flow Table for July 2023

Appendix E1 Monthly Waste Flow Table for July 2023 (Civil Contractor)

Monthly Waste Flow Table for July 2023

Project: Civil Works for Re-Provision of Open Cycle Gas Turbine at Lamna Power Station
 Contractor: Paul Y. Construction Company, Limited
 Record by: Ben Lam
 Year of Record: 2022, 2023

MM.YYYY	Actual Quantities of Inert C&D Materials Generated Monthly								Actual Quantities of Non-inert C&D Materials Generated Monthly						
	Excavated Materials				Non-excavated Materials				Metals (steel bar / metal strip) ⁽¹⁾	Metals (aluminum can) ⁽¹⁾	Paper / cardboard packaging ⁽¹⁾	Plastics ^{(1) & (4)}	Chemical waste (wasted lubricant oil/oil container)	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g. Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities							
	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)							
Jul 2022	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Aug 2022	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Sep 2022	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Oct 2022	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Nov 2022	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Dec 2022	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	11.21
Jan 2023	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.72
Feb 2023	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.32
Mar 2023	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.26	0.00	0.00	0.00	0.00	0.00	0.00
Apr 2023	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	7.37
May 2023	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.07
Jun 2023	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.09
Jul 2023	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.87
Total	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.26	0.00	0.00	0.00	0.00	0.00	42.65

Total Inert C&D Waste Materials Generated	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste
0.00 tonnes	6.26 tonnes	42.65 tonnes	0.00 tonnes

- Where (A) Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total, 0.00 tonnes of inert C&D material were generated from the Project, of which 0.00 tonnes were reused in this and other contracts, and the remaining 0.00 tonnes were disposed as public fill to Fill Banks / Sorting Facilities.
- (b) Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse. Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill
- (c) 0 kg of metals 0 kg of papers/ cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.
- (d) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.

- Notes:
- (1) metal, paper & plastic were collected by recycler
 - (2) The performance target of waste recycling are specified in the Contract.
 - (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
 - (4) Plastics refer to plastic bottles/ containers, plastic/ foam from packaging material.
 - (5) Broken concrete for recycling into aggregates.
 - (6) Disposal of inert waste to public fill or sorting facilities will **NOT** be considered as recycled waste.

Appendix E2 Monthly Waste Flow Table for July 2023 (E&M Contractor)

Monthly Waste Flow Table for June 2023

Project: C/N 22 23001 Lamma Repronision of OCGT Demolition & Erection Work
 Contractor: Kum Shing
 Record by: Chris Cheng
 Year of Record: 2023

MM.YYYY	Actual Quantities of Inert C&D Materials Generated Monthly								Actual Quantities of Non-inert C&D Materials Generated Monthly						
	Excavated Materials				Non-excavated Materials				Metals (steel bar/ metal strip)	Metals (aluminum can)	Paper / cardboard packaging	Plastics	Chemical waste (wasted lubricant oil/oil container)	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g. Reused in the Contract / Other Projects)	Broken Concrete or Constructi on Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities							
(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000L)	(in '000kg)	(in '000kg)	
Oct-22	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Nov-22	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Dec-22	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Jan-23	0	0	0	0	0	0	0	0	103.24	0	0	0	36	0	
Feb-23	0	0	0	0	0	0	0	0	0	0	0	0	0	66.53	
Mar-23	0	0	0	0	0	0	0	0	150.45	0	0	0	0	63.12	
Apr-23	0	0	0	0	0	0	0	9.05	26.19	0	0	0	41.8	0	
May-23	0	0	0	0	0	0	0	0	0	0	0	0	30	0	
Jun-23	0	0	0	0	0	0	0	5.8	0	0	0	0	13.4	0	
Jul-23	0	0	0	0	0	0	0	0	0	0	0	0	13.65	226.02	
Total	0	0	0	0	0	0	0	14.85	279.88	0	0	0	121.2	13.65	

Total Inert C&D Waste Materials Generated	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at	Chemical Waste
14.85 tonnes	279.88 tonnes	656.86 tonnes	121.20 kilo litre

Where

- (A) Inert C&D materials include bricks, concrete, building debris, rubble and In total, 14.85 tonnes of inert C&D material were generated from the Project, of which 0.00 tonnes were reused in this and other contracts, and the remaining 14.85 tonnes were disposed as public fill to Fill Banks/Sorting
- (B) Non-inert C&D materials (construction wastes) include matels, paper/cardboard packaging waste, plastics and other wastes such as general refuse. Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fills.
- (C) 279880 kg of metals, 0 kg of papers/cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.
- (D) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals waste were disposed of at landfill.

Notes:

- (1) Metal, paper & plastic were collected by recycler.
- (2) The performance target of waste recycling are specified in
- (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (4) Plastics refer to plastic bottles/containers, plastic/foam from packaging materials.
- (5) Broken concrete for recycling into aggregates.
- (6) Disposal of inert waste to public fill or sorting facilities will NOT be considered as recycled waste.