香港電燈有限公司 The Hongkong Electric Co., Ltd.



Lamma Power Station Extension Construction Phase Monthly Environmental Monitoring & Audit Report

June 2020



ENVIRONMENTAL IMPACT ASSESSMENT (EIA) ORDINANCE, CAP. 499

ENVIRONMENTAL PERMIT NO. EP-071/2000/C

LAMMA POWER STATION EXTENSION ENVIRONMENTAL MONITORING & AUDIT PROGRAMME AT CONSTRUCTION PHASE

Lamma Power Station Extension – Unit L11 & L12 Monthly EM&A Report (June 2020)
13 July 2020
Mr. Y T Tang (AECOM Asia Company Limited, Independent Environmental Checker)

TABLE OF CONTENT

EXECUTIVE SUMMARY

1.	INTRODUCTION	1
1.1	Background	1
1.2	Project Organisation	1
1.3 1.4	Construction Works undertaken during the Reporting Month	1 4
	Summary of EM&A Requirements	
2.	AIR QUALITY	6
2.1	Monitoring Requirements	6
2.2	Monitoring Locations	6
2.3	Monitoring Equipment	6
2.4	Monitoring Parameters, Frequency and Duration	6
2.5	Monitoring Procedures and Calibration Details	7
2.6	Results and Observations	8
3.	NOISE	10
3.1	Monitoring Requirements	10
3.2	Monitoring Locations	10
3.3	Monitoring Equipment	10
3.4	Monitoring Parameters, Frequency and Duration	10
3.5	Monitoring Procedures and Calibration Details	11
3.6	Results and Observations	11
4.	ENVIRONMENTAL AUDIT	13
4.1	Review of Environmental Monitoring Procedures	13
4.2	Assessment of Environmental Monitoring Results	13
4.3	Waste Management	13
4.4	Site Environmental Audit	14
4.5	Status of Environmental Licensing and Permitting	14
4.6	Implementation Status of Environmental Mitigation Measures	15
4.7	Implementation Status of Event/Action Plans	15
4.8	Implementation Status of Environmental Complaint Handling Procedures	15
5.	FUTURE KEY ISSUES	17
5.1	Key Issues for the Coming Month	17
5.2	Monitoring Schedules for the Next 3 Months	18
5.3	Construction Program for the Next 3 Months	18
6	CONCLUSION	19

LIST OF TABLES

Table 1.1	Construction Activities and Their Corresponding Environmental Mitigation
	Measures
Table 2.1	Air Quality Monitoring Locations
Table 2.2	Air Quality Monitoring Equipment
Table 2.3	Air Quality Monitoring Parameter, Duration and Frequency
Table 3.1	Noise Monitoring Equipment
Table 3.2	Noise Monitoring Duration and Parameter
Table 4.1	Summary of AL Level Exceedances on Monitoring Parameters
Table 4.2	Estimated Amounts of Waste in June 2020
Table 4.3	Summary of Environmental Licensing and Permit Status
Table 4.4	Environmental Complaints Received in June 2020
Table 4.5	Outstanding Environmental Complaints Carried Over

LIST OF FIGURES

Figure 1.1	Layout of Work Site
Figure 2.1	Location of Air Quality Monitoring Stations
Figure 3.1	Location of Noise Monitoring Stations

APPENDICES

Appendix A	Organization Chart
Appendix B	Action and Limit Levels for Air Quality and Noise
Appendix C	Environmental Monitoring Schedule
Appendix D	Air Quality Monitoring Results for June 2020
Appendix E	Noise Monitoring Results for June 2020
Appendix F	The QA/QC Procedures and Results
Appendix G	Event/Action Plans
Appendix H	Site Audit Summary
Appendix I	Summary of EMIS
Appendix J	Tentative Construction Programme
Appendix K	Monthly Waste Flow Table for June 2020

EXECUTIVE SUMMARY

This is the 122nd monthly Environmental Monitoring and Audit (EM&A) report for the Project "Construction of Lamma Power Station Extension" prepared by the Environmental Team (ET). This report presents the results of impact monitoring on air quality and noise for the said project in June 2020.

The reclamation and submarine pipeline works were completed with the first gas-fired combined cycle unit (viz. Unit L9) commissioned in October 2006, working currently on base load operation. To cope with the scheduled retirement of the existing units at Lamma Power Station, the second gas-fired combined cycle unit (viz. Unit L10) L10 was commissioned for reliable operation in February 2020. The operational EM&A work for L9 and L10 is recorded in the separate monthly EM&A report for the Project "Operation of Lamma Power Station Extension".

In September 2016, the Government approved HK Electric to construct the third combined cycle gasfired generating unit (L11) to implement the 2020 Fuel Mix Target. L11 is planned for commercial operation in 2022 and the associated construction work commenced in November 2016.

With the Government's approval to build the fourth combined cycle gas-fired generating unit (L12) in July 2018, the associated construction work commenced in April 2019. When L12 is commissioned in 2023, the total gas-fired electricity generation will further rise to reach about 70% of our total output.

Air and noise monitoring were performed. The results were checked against the established Action/Limit (AL) levels. An on-site audit was conducted once per week. The implementation status of the environmental mitigation measures, Event/Action Plan and environmental complaint handling procedures were also checked.

Construction Activities Undertaken

Construction activities for Lamma Extension during the reporting month are tabulated as follows:

Item	Construction Activities
Unit L11 Civil and Building Works	275kV Station Building Extension works, Main Building Station, CW pipe installation, installation of columns and beams, Site formation works and pipe jacking works
Unit L11 Mechanical Erection	Condenser installation, HRSG installation and turbine block installation
Unit L11 Electrical, Instrumentation & Control Erection	Cable installation
Foundation Works for Lamma Power Station Extension Unit L12 and Cable Bridge	Bored Pile Work and Rock-socketed H-piles Work

Environmental Monitoring Works

All monitoring work at designated stations was performed as scheduled satisfactorily.

Air Quality

No exceedance of Action/Limit levels on 1-hour TSP and 24-hour TSP for air quality was recorded in the month.

Noise

Construction work for Lamma Extension was carried out during the restricted hours including evening-time, holidays and night-time under valid Construction Noise Permit. No exceedance of Action and Limit levels for noise arising from the construction of Lamma Extension was recorded in the month.

Site Environmental Audit

Independent Environmental Checker (IEC) conducted a site inspection on 30/6/2020. The site conditions were generally satisfactory.

EPD officials from Regional Office (South) visited Lamma Power Station on 17/6/2020. EPD inspected the Lamma Extension Construction Site. There was no adverse comment from EPD regarding the construction site.

Site audits were carried out on a weekly basis to monitor environmental issues on the construction site. The site conditions were generally satisfactory.

Environmental Licensing and Permitting

Description	Permit No.	Valid Period		Issued To	Date of
		From	To		Issuance
Varied Environmental Permit	EP-071/2000/C	18/05/05	-	HK Electric	18/05/05
Construction Noise Permit	GW-RS0132-20	15/03/20	13/09/20	Contractor	12/03/20
Construction Noise Permit	GW-RS1134-19	01/01/20	30/06/20	Contractor	20/12/19
Construction Noise Permit	GW-RS1064-19	04/12/19	03/06/20	Contractor	26/11/19
Construction Noise Permit	GW-RS0381-20	10/06/20	07/12/20	Contractor	08/06/20
WPCO Discharge Licence	WT00034006-2019	08/08/19	31/08/24	Contractor	22/08/19
WPCO Discharge Licence	WT00034368-2019	11/09/19	30/09/24	Contractor	11/09/19
Registration of Chemical Waste Producer	WPN5213-912- P2781-22	22/02/16	-	Contractor	22/02/16
Registration of Chemical Waste Producer	WPN5517-912- T2007-02	17/03/05		Contractor	17/03/05
Waste Disposal Billing Account	Account No.: 7031135	21/06/18	-	Contractor	21/06/18

Description	Permit No.	Valid Period		Issued To	Date of
		From	To		Issuance
Waste Disposal	Account No.:	24/04/17	-	Contractor	24/04/17
Billing Account	7027672				
Waste Disposal	Account No.:	01/04/19	-	Contractor	01/04/19
Billing Account	7033637				

Implementation Status of Environmental Mitigation Measures

Environmental mitigation measures for the construction activities as recommended in the EM&A manual were implemented in the reporting month.

Environmental Complaints

No complaint against the construction activities was received in the reporting month.

Future Key Issues

The future key issues to be considered in the coming month are as follows:

Unit L11 Civil and Building Works

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary;
- to treat wastewater in sedimentation pit and tanks before discharge and to ensure compliance with the WPCO discharge licence already obtained.

Unit L11 Mechanical Erection

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

Unit L11 Electrical, Instrumentation & Control Erection

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

Unit L12 Foundation Works

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/reviewing the performance;

- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary;

Concluding Remarks

The environmental performance of the project was generally satisfactory.

1. INTRODUCTION

1.1 Background

The Environmental Team (hereinafter called the "ET") was formed within the Hongkong Electric Co. Ltd (HEC) to undertake Environmental Monitoring and Audit for "Construction of Lamma Power Station Extension" (hereinafter called the "Project"). Under the requirements of Section 6 of Environmental Permit EP-071/2000/C, an EM&A programme for impact environmental monitoring set out in the EM&A Manual (Construction Phase) is required to be implemented. In accordance with the EM&A Manual, environmental monitoring of air quality, noise and water quality and regular environmental audits are required for the Project. With the completion of reclamation and submarine pipeline works, no further marine water quality monitoring would be required.

The Project involves the construction of a gas-fired power station employing combined cycled gas turbine technology, forming an extension to the existing Lamma Power Station. The key elements of the Project including the construction activities associated with the transmission system and submarine gas pipeline are outlined as follows.

- dredging and reclamation to form approximately 22 hectares of usable area;
- construction of six 300MW class gas-fired combined cycle units;
- construction of a gas receiving station;
- construction of a transmission system linking the Lamma Extension to load centres on Hong Kong Island;
- laying of a gas pipeline for the supply of natural gas to the new power station

This report summarizes the environmental monitoring and audit work for the Project for the month of June 2020.

1.2 Project Organisation

An Environmental Management Committee (EMC) has been set up in HEC to oversee the Project. The management structure includes the following:

- Environmental Protection Department (The Authority);
- Environmental Manager (The Chairman of the Environmental Management Committee);
- Engineer:
- Independent Environmental Checker (IEC);
- Environmental Team (ET);
- Contractor.

The project organisation chart for the construction EM&A programme is shown in Appendix A.

1.3 Construction Works undertaken during the Reporting Month

Construction activities for Unit L11 civil and building works were, 275kV station building extension works, Main Station Building, CW pipe installation, installation of columns and beams, site formation works and pipe jacking works. Construction activities for Unit L11 mechanical erection were condenser installation, HRSG installation and turbine block installation. Construction activity for Unit L11 electrical, instrumentation & control erection was cable installation. Construction activities for foundation works for Lamma Power Station

Extension Unit L12 and cable bridge were bored pile work and rock-socketed H-piles work. Layout plan for construction site is shown in Figure 1.1.

The main construction activities carried out during the reporting month and the corresponding environmental mitigation measures are summarized in Table 1.1. The implementation of major mitigation measures in the month is provided in Appendix I.

Table 1.1 Construction Activities and Their Corresponding Environmental Mitigation Measures

Item	Construction Activities	Environmental Mitigation Measures		
Unit L11	Civil and Building	Works		
1.	275kV Station Building Extension Works	Air - All regulated machine attached with valid exception/approval NRMM labels. - Wheel washing facility was provided. Noise - Works conducted during holiday should comply with the valid CNP.		
		Wastewater - Wastewater should be treated in desilting pit and tanks for reuse on water spraying. Waste Management - Scrape metal will be recycled. - Timber will be reused as much as possible. - Chemical waste should be collected by licensed collector		
2.	Main Station Building, CW Pipe Installation, Installation of Columns and Beams, Site Formation Works and Pipe Jacking Works (Set up of jacking and receiving pit)	Air - All regulated machine attached with valid exception/approval NRMM labels. - Water truck and water sprinkler system was used. - Water spraying for concrete breaking of pile head. - Excavated slope and soil stock covered with cement or tarpaulin. - Backfilled surface was compacted. - Wheel washing facility was provided. Noise - Works conducted during holiday should comply with the valid CNP.		
		Wastewater - Wastewater should be treated in desilting pit and		

Item	Construction Activities	Environmental Mitigation Measures		
		tanks before discharge. Solution should be added to speed up the sedimentation process. Sediment in pit and tanks must be removed regularly.		
		Waste Management		
		 Excavated soil was temporary stored for backfilling. Scrape metal will be recycled. Timber will be reused as much as possible. 		
Unit L11	Mechanical Erection	on		
3.	Condenser installation	Air		
	HRSG installation	 Dust suppression measures implemented according to the EMP. 		
	Turbine block installation	Noise		
	Installation	 General noise mitigation measures employed at all work sites throughout the construction phase. 		
		Waste Management		
		Waste Management Plan submitted and implemented		
Unit L11	l Electrical, Instrume	entation & Control Erection		
4.	Cable installation	Air		
		 Dust suppression measures implemented according to the EMP. 		
		Noise		
		 General noise mitigation measures employed at all work sites throughout the construction phase. 		
		Waste Management		
		 Waste Management Plan submitted and implemented. 		
Foundati	ion Works for Lamn	na Power Station Extension Unit L12 & Cable Bridge		
5.	Bored Pile Work	Air - Dust suppression in the main haul road. - Using ULSD for PMEs. - Cover dusty stockpile with tarpaulin and water spraying.		
		Noise		
		General noise mitigation measure employed at all		

Item	Construction Activities	Environmental Mitigation Measures
		work sites throughout the construction phase. - Routine checking should be carried out to ensure the requirements as stipulated in the CNP have been fulfilled.
		Wastewater
		 Wastewater should be pumped to the sedimentation ponds for desilting process. After that, waste water will be re-used for construction activities or pumped for storage.
		Waste Management
		Waste Management Plan submitted and implemented
6.	6. Rock-Socketed H-piles Work	Noise - General noise mitigation measure employed at all work sites throughout the construction phase. - Routine checking should be carried out to ensure the requirements as stipulated in the CNP have been fulfilled.
		Wastewater
		 All wastewater will be pumped to the sedimentation ponds for desilting process. After that, wastewater will be re-used for construction activities or pumped for storage.
		Waste Management
		 Waste Management Plan submitted and implemented.

1.4 Summary of EM&A Requirements

The detailed EM&A monitoring work for air quality and noise are described in Sections 2 and 3 respectively. Regular environmental site audits for air quality, noise, water quality and waste management were carried out.

The following environmental audits are summarized in Section 4 of this report:

- Environmental monitoring results;
- Waste Management Records;
- Weekly site audit results;
- The status of environmental licensing and permits for the Project;
- The implementation status of environmental protection and pollution control/ mitigation measures.

Future key issues will be reported in Section 5 of this report.

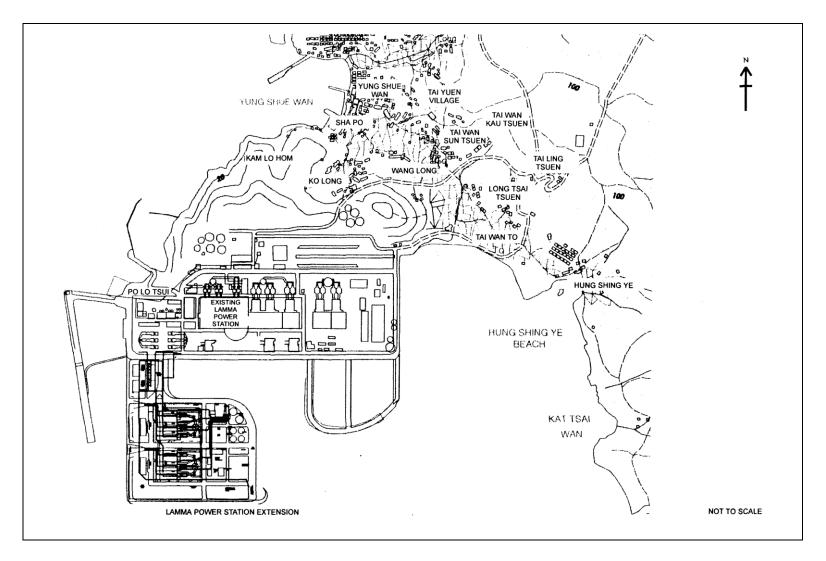


Figure 1.1 Layout of Work Site

2. AIR QUALITY

2.1 Monitoring Requirements

1-hour and 24-hour TSP monitoring at agreed frequencies were conducted to monitor air quality. The impact monitoring data were checked against the Action/Limit Levels as determined in the Baseline Monitoring Report (Construction Phase). Appendix B shows the established Action/Limit Levels for Air Quality.

2.2 Monitoring Locations

Three dust monitoring locations were selected for 1-hour TSP sampling (AM1, AM2 & AM3) while four monitoring locations were selected for 24-hour TSP sampling (AM1, AM2, AM3 and AM4). Table 2.1 tabulates the monitoring stations. The locations of the monitoring stations are shown in Figure 2.1.

Table 2.1 Air Quality Monitoring Locations

Location I.D.	Description
AM1	Reservoir
AM2	East Gate
AM3	Ash Lagoon
AM4	Tai Yuen Village

2.3 Monitoring Equipment

It is agreed with EPD that continuous 24-hour TSP air quality monitoring would be performed using TEOM continuous dust monitor and the MINIVOL Portable Sampler at AM1,2&3 and AM4 respectively. TEOM continuous dust monitors were used to carry out 1-hour TSP monitoring at AM1, AM2 and AM3. Table 2.2 summarises the equipment used in dust monitoring.

Table 2.2 Air Quality Monitoring Equipment

Equipment	Model and Make
24-hour sampling:	
Continuous TSP Dust Meter	TEOM continuous dust monitor Thermo Scientific
MINIVOL Portable Sampler	AIRMETRICS
1-hour sampling: Continuous TSP Dust Meter	TEOM continuous dust monitor Thermo Scientific

2.4 Monitoring Parameters, Frequency and Duration

Table 2.3 summarises the monitoring parameters, duration and frequency of air quality monitoring. The monitoring schedule for the reporting month is shown in Appendix C.

Table 2.3 Air Quality Monitoring Parameter, Duration and Frequency

Monitoring Stations	Parameter	Duration	Frequency
AM1	1-hour TSP	1	3 hourly samples every 6 days
AIVII	24-hour TSP	24	Once every 6 days
AM2	1-hour TSP	1	3 hourly samples every 6 days
AlVIZ	24-hour TSP	24	Once every 6 days
AM2	1-hour TSP	1	3 hourly samples every 6 days
AM3	24-hour TSP	24	Once every 6 days
AM4	24-hour TSP	24	Once every 6 days

2.5 Monitoring Procedures and Calibration Details

MINIVOL (24- hour TSP Monitoring):

Preparation of Filter Papers

- Visual inspection of filter papers was carried out to ensure that there were no pinholes, tears and creases;
- The filter papers were then labeled before sampling.
- The filter papers were equilibrated at room temperature and relative humidity < 50% for at least 24 hours before weighing.

Field Monitoring

- During collection of the sampled filter paper, the information on the elapse timer was logged. Site observations around the monitoring stations, which might have affected the monitoring results, were also recorded. Major pollution sources, if any, would be identified and reported.
- The post-sampling filter papers were removed carefully from the filter holder and folded to avoid loss of fibres or dust particles from the filter papers;
- The filter holder and its surrounding were cleaned;
- A pre-weighed blank filter paper for the next sampling was put in place and aligned carefully. The filter holder was then tightened firmly to avoid leakage;
- The programmable timer was set for the next 24 hrs sampling period;
- The post-sampling filter papers were equilibrated at room temperature and relative humidity < 50% for at least 24 hours before weighing.

TEOM continuous dust monitor (24- hour TSP and 1- hour TSP Monitoring):

- The following parameters of the TEOM model dust meters are regularly checked to ensure proper functionality:
 - Operation Mode;
 - o Frequency of the tapered element;
 - o Main flow;
 - o Bypass flow.

Maintenance & Calibration

• The monitoring equipment and their accessories are maintained in good working conditions.

• Monitoring equipment is calibrated at monthly intervals. Calibration details are shown in Appendix F.

2.6 Results and Observations

All dust monitoring works were conducted on schedule. All monitoring data and graphical presentation of the monitoring results are provided in Appendix D. Key findings and observations are provided below:

1-hour TSP

No exceedance of 1-hour TSP Action/Limit Level was recorded in the month.

24-hour TSP

No exceedance of 24-hour TSP Action/Limit Level was recorded in the month.

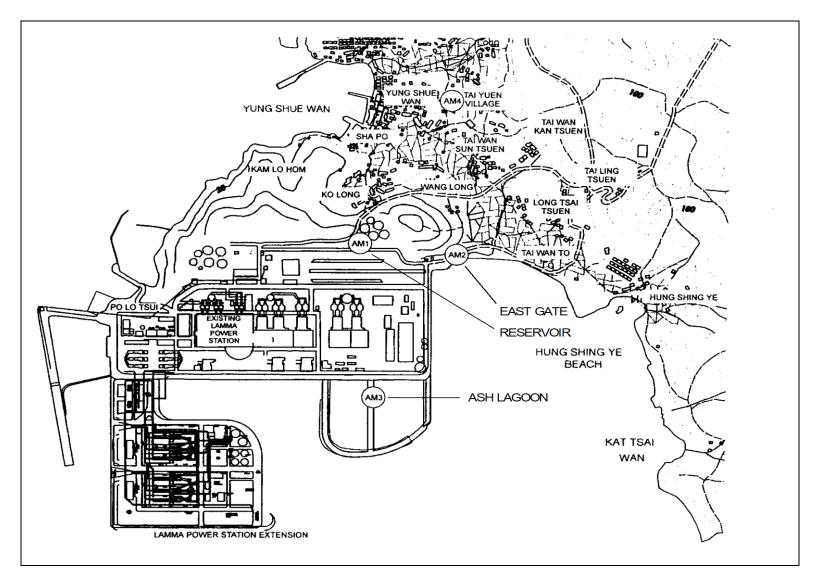


Figure 2.1 Location of Air Quality Monitoring Stations

3. NOISE

3.1 Monitoring Requirements

Continuous noise alarm monitoring at Ash Lagoon/Ching Lam were carried out to calculate the noise contributed by the construction activities at the two critical NSR's, viz. Long Tsai Tsuen/Hung Shing Ye and the school within the village of Tai Wan San Tsuen. The impact monitoring data for construction noise were checked against the limit levels specified in the EM&A Manual. With the availability of the construction noise permits, impact monitoring for the construction work during the restricted hours was also carried out. Section 3 presents the details of the construction noise permits.

The impact noise monitoring data were checked against the limit levels specified in the EM&A Manual. Appendix B shows the established Action/Limit Levels for noise.

3.2 Monitoring Locations

In accordance with the EM&A manual, the identified noise monitoring locations of Ash Lagoon and Ching Lam are shown in Figure 3.1.

3.3 Monitoring Equipment

The sound level meters used for noise monitoring complied with International Electrotechnical Commission Publications 651:1979 (Type 1) and 804:1985 (Type 1). The noise monitoring equipment used is shown in Table 3.1.

Table 3.1 Noise Monitoring Equipment

Equipment	Model
Sound level meters	B&K 2250
Sound level calibrator	B&K 4231

3.4 Monitoring Parameters, Frequency and Duration

Continuous alarm monitoring was carried out at Ash Lagoon and Ching Lam. The measurement duration and parameter of noise monitoring were presented in Table 3.2 as follows:

Table 3.2 Noise Monitoring Duration and Parameter

Location	Time Period	Frequency	Parameter
----------	-------------	-----------	-----------

	Day-time: 0700-1900 hrs on normal weekdays	Day-time: 30 minutes	30-min L _{Aeq}
Ash Lagoon Ching Lam	Evening-time & holidays: 0700-2300 hrs on holidays; and 1900-2300 hrs on all other days	Evening-time & holidays: 5 minutes	5-min L _{Aeq}
	Night-time: 2300-0700 hrs of next day	Night-time: 5 minutes	5-min L _{Aeq}

3.5 Monitoring Procedures and Calibration Details

Monitoring Procedures

Continuous Noise Monitoring for Lamma Extension Construction

The measured noise levels (MNL's) were collected at the noise alarm monitoring stations at Ash Lagoon and Ching Lam. The notional background noise levels (viz. baseline noise data at Ash Lagoon and Ching Lam) were applied to correct the corresponding MNL's in 30-min/5-min L_{Aeq}.

A wind speed sensor was installed at Station Building Rooftop. The wind speed signal was used to determine whether the data from Ash Lagoon and Ching Lam noise alarm monitoring stations were affected. The instantaneous data was discarded in case the instantaneous wind speed exceeded 10 m/s. The 30-min/5-min L_{Aeq} was considered valid only if the amount of valid data was equal to or above 70%.

Equipment Calibration

The sound level meters and calibrators were verified by the manufacturer or accredited laboratory. With the endorsement of the Independent Environmental Checker, the enhancement of calibration of sound level meter at the noise monitoring stations was implemented. The monthly manual on-site calibration using sound level calibrator was replaced by the daily auto charge injection calibration function of the sound level meter. For additional quality assurance, manual on-site calibration would still be conducted for the noise monitoring stations once every 6 months. The manual on-site calibrations for Ching Lam and Ash Lagoon noise monitoring stations were carried out in April and June 2020 respectively. The next calibrations for the two noise monitoring stations were scheduled in October and December 2020.

3.6 Results and Observations

Continuous noise monitoring was conducted at the two monitoring stations at Ash Lagoon and Ching Lam.

All monitoring results and their graphical presentations are provided in Appendix E. No exceedance of noise Action/Limit Level was recorded in the month.

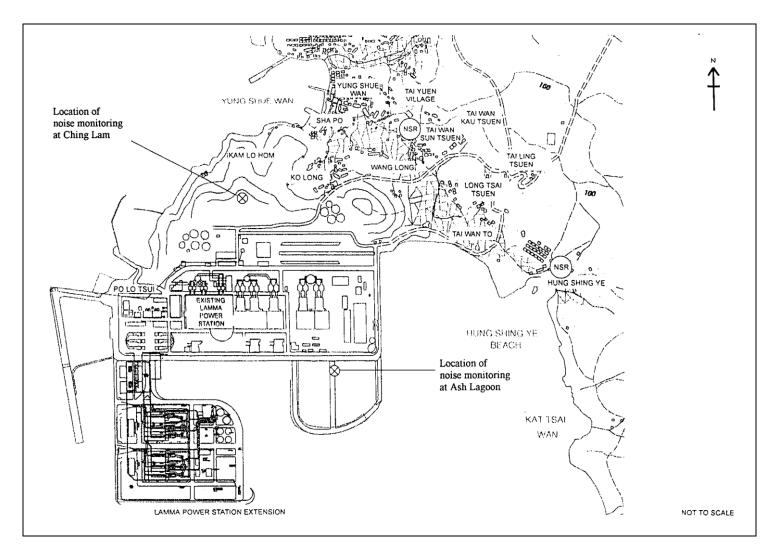


Figure 3.1 Location of Noise Monitoring Stations

4. ENVIRONMENTAL AUDIT

4.1 Review of Environmental Monitoring Procedures

The environmental monitoring procedures were regularly reviewed by the Environmental Team. No modification to the existing monitoring procedures was recommended.

4.2 Assessment of Environmental Monitoring Results

Monitoring results for Air Quality and Noise

The environmental monitoring results for Air Quality and Noise in the reporting month presented in Sections 2 and 3 respectively are summarized in Table 4.1.

Table 4.1 Summary of AL Level Exceedances on Monitoring Parameters

Item	Parameter Monitored	Monitoring Period		. of ances In	Event/Action Plan Implementation Status
			Action Level	Limit Level	and Results
Air					
1	Ambient TSP (24-hour)	01/06/2020- 30/06/2020	0	0	
2	Ambient TSP (1-hour)	01/06/2020- 30/06/2020	0	0	
Noise					
1	Noise level at the critical NSR's predicted by the noise alarm monitoring system	01/06/2020- 30/06/2020	0	0	

4.3 Waste Management

Wastes generated from this Project include inert construction and demolition (C&D) materials and non-inert C&D materials. Inert C&D materials comprise excavated materials and broken concrete. Non-inert C&D materials comprise general refuse, metals and paper/ cardboard packaging, plastics, chemical waste, etc.

Inert C&D material and non-inert C&D material disposed of in June 2020 are shown in Table 4.2.

Table 4.2 Estimated Amounts of Waste in June 2020

	N	on-inert C&D Materia	ls
Total Inert C&D Waste Materials	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste

1,222.31 Tonnes	0 Tonnes	76.58 Tonnes	0 Litres
-----------------	----------	--------------	----------

The monthly waste flow tables prepared by the contractors are attached in Appendix K

4.4 Site Environmental Audit

Independent Environmental Checker (IEC) conducted a site inspection on 30/6/2020. The site conditions were generally satisfactory.

EPD officials from Regional Office (South) visited Lamma Power Station on 17/6/2020. EPD inspected the Lamma Extension Construction Site. There was no adverse comment from EPD regarding the construction site.

Site audits were carried out by ET on a weekly basis to monitor environmental issues at the construction sites to ensure that all mitigation measures were implemented timely and properly. The site audit findings for the reporting month are summarized in Appendix H. The site conditions were generally satisfactory. All required mitigation measures were implemented.

4.5 Status of Environmental Licensing and Permitting

All permits/licenses obtained for the project are summarised in Table 4.3.

Table 4.3 Summary of Environmental Licensing and Permit Status

Description	Permit No.	Valid Period		Highlights	Status
_		From	To]	
Varied Environmental Permit	EP-071/2000/C	18/05/05	-	The whole construction work site	Valid
Construction Noise Permit	GW-RS0132-20	15/03/20	13/09/20	Civil and Building Works for Unit L11. Operation of PME during restricted hours	Valid
Construction Noise Permit	GW-RS1134-19	01/01/20	30/06/20	Power Block Facilities works for Unit L11. Operation of PME during restricted hours	Valid
Construction Noise Permit	GW-RS1064-19	04/12/19	03/06/20	Foundation work for Unit L12 at Station Road. Operation of PME during restricted hours.	Valid up to 3/6/2020
Construction Noise Permit	GW-RS0381-20	10/06/20	07/12/20	Foundation work for Unit L12 at Station Road. Operation of PME during restricted hours.	Valid

Description	escription Permit No. Valid Period		Highlights	Status	
_		From	To		
WPCO	WT00034006-	08/08/19	31/08/24	Civil and Building	Valid
Discharge	2019			Works for Unit	
Licence#				L11	
WPCO	WT00034368-	11/09/19	30/09/24	Foundation Works	Valid
Discharge	2019			for L12	
Licence##					
Registration	WPN5213-912-	22/02/16	-	Civil and Building	Valid
of Chemical	P2781-22			Works	
Waste					
Producer					
Registration	WPN5517-912-	17/03/05		E&M Equipment	Valid
of Chemical	T2007-02			Installation and	
Waste				Maintenance	
Producer					
Waste	Account No.:	21/06/18	-	Civil and Building	Valid
Disposal	7031135			Works for Unit	
Billing				L11	
Account					
Waste	Account No.:	24/04/17	-	E&M Erection of	Valid
Disposal	7027672			Power Block	
Billing				Facilities – L11	
Account					
Waste	Account No.:	01/04/19	-	Foundation works	Valid
Disposal	7033637			for Unit L12	
Billing					
Account					

Notes:

4.6 Implementation Status of Environmental Mitigation Measures

Mitigation measures detailed in the permits and the EM&A Manual (Construction Phase) are required to be implemented. An updated summary of the Environmental Mitigation Implementation Schedule (EMIS) is presented in Appendix I.

4.7 Implementation Status of Event/Action Plans

The Event/Action Plans extracted from the EM&A Manual (Construction Phase) are presented in Appendix G.

4.8 Implementation Status of Environmental Complaint Handling Procedures

In June 2020, no complaint against the construction activities was received.

Table 4.4 Environmental Complaints Received in June 2020

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions / Actions Taken	Conclusion / Status
Nil	N/A	N/A

^{##-} Water quality monitoring was carried out in May 2020 and the result of which had been reported under a separate cover by the contractor.

^{## -} Water quality monitoring was carried out in June 2020 and the result of which had been reported under a separate cover by the contractor.

Table 4.5 Outstanding Environmental Complaints Carried Over

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions / Actions Taken	Conclusion / Status
Nil	N/A	N/A

5. FUTURE KEY ISSUES

5.1 Key Issues for the Coming Month

Key issues to be considered in the coming month include:

Unit L11 Civil and Building Works

Noise Impact

- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/reviewing the noise performance.

Air Impact

• To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

Water Impact

• To treat wastewater in sedimentation pit and tanks before discharge and to ensure compliance in accordance with the WPCO discharge licence already obtained.

Unit L11 Mechanical Erection

Noise Impact

- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/reviewing the noise performance.

Air Impact

• To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

Unit L11 Electrical, Instrumentation & Control Erection

Noise Impact

- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the noise performance.

Air Impact

• To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

Unit L12 Foundation Works

Noise Impact

- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the noise performance.

Air Impact

• To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

5.2 Monitoring Schedules for the Next 3 Months

The tentative environmental monitoring schedules for the next 3 months are shown in Appendix C.

5.3 Construction Program for the Next 3 Months

The tentative construction programs for the next 3 months are shown in Appendix J.

6. CONCLUSION

All monitoring work at designated stations was performed as scheduled satisfactorily. The environmental monitoring works and site inspection were performed as scheduled in the reporting month. All monitoring results were checked and reviewed.

No Action/Limit level exceedance on 1-hour and 24-hour TSP level was recorded in the reporting month.

No Action/Limit level exceedance on noise was recorded in the reporting month.

Environmental mitigation measures recommended in the EM&A manual for the construction activities were implemented in the reporting month. No complaint against the construction activities was received in the reporting month. No prosecution was received for this Project in the reporting period.

The environmental performance of the Project was generally satisfactory.

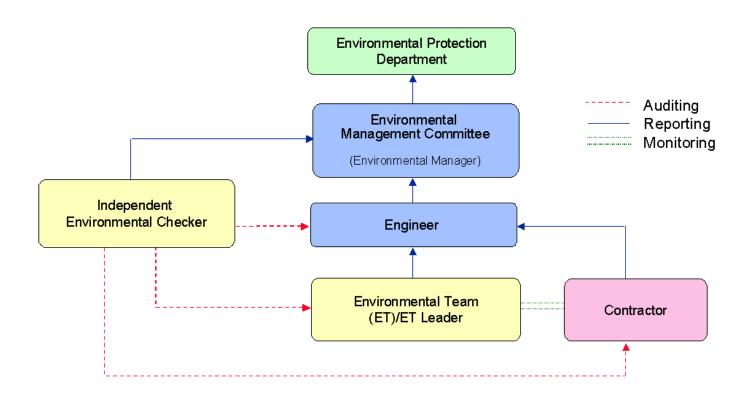


Figure A.1 Organisation of EM&A Programme at Construction Phase

Appendix B Action and Limit Levels for Air Quality and Noise Monitoring

B.1. Air

Table B.1 Action and Limit Levels for 1-hour and 24-hour TSP

	Action Level, μg/m ³	Limit Level, μg/m³
1-hour TSP*	340	500
24-hour TSP	190	260

* No Action/Limit Level for 1-hour TSP is applied to AM4 where no real time dust monitor is installed.

B.2. Noise

Table B.2 AL Levels for Construction Noise (Other than Percussive Piling)

Parameters	Action	Limit	
Noise Levels at the NSR's at Long Tsai Tsuen/Hung Shing Ye and school within the village of Tai Wan San Tsuen predicted by the noise alarm monitoring system Manual noise monitoring at the nearest Pak Kok Tsui residences to cable landing points N4 and N5	When one or more documented complaints are received	 a. 75 dB(A) in L_{Aeq,30 min} (07:00-19:00 hrs on normal weekdays) (Note 1) b. subject to statutory control under the Noise Control Ordinance (07:00-23:00 hrs on holidays and 19:00-23:00 hrs on all other days). Set to 60 dB(A) in L_{Aeq,5 min} c. subject to statutory control under the Noise Control Ordinance (23:00-07:00 hrs on next day). Set to 45 dB(A) in L_{Aeq,5 min} 	on s

Note:

1. For educational institution, the limit level shall be 70 dB(A), reduced to 65 dB(A) during examination periods.

Appendix C Environmental Monitoring Schedule

Table C.1 Monitoring schedule for 24hr and 1hr TSP monitoring for Lamma Extension Construction (June 2020 to September 2020)

24hr TSP Monitoring	1hr TSP Monitoring
5/June/2020	5/June/2020 1500hr to 1800hr
11/June/2020	11/June/2020 1500hr to 1800hr
17/June/2020	17/June/2020 1500hr to 1800hr
23/June/2020	23/June/2020 1500hr to 1800hr
29/June/2020	29/June/2020 1500hr to 1800hr
5/July/2020	5/July/2020 1500hr to 1800hr
11/July/2020	11/June/2020 1500hr to 1800hr
17/July/2020	17/July/2020 1500hr to 1800hr
23/July/2020	23/July/2020 1500hr to 1800hr
29/July/2020	29/July/2020 1500hr to 1800hr
4/August/2020	4/August/2020 1500hr to 1800hr
10/August/2020	10/August/2020 1500hr to 1800hr
16/August/2020	16/August/2020 1500hr to 1800hr
22/August/2020	22/August/2020 1500hr to 1800hr
28/August/2020	28/August/2020 1500hr to 1800hr
3/September/2020	3/September/2020 1500hr to 1800hr
9/September/2020	9/September/2020 1500hr to 1800hr
15/September/2020	15/September/2020 1500hr to 1800hr
21/September/2020	21/September/2020 1500hr to 1800hr
27/September/2020	27/September/2020 1500hr to 1800hr

APPENDIX D AIR QUALITY MONITORING RESULTS

Site: Lamma Power Station Extension

Month: June 2020

24 hour TSP Measurement:-

		TSP concentr	ation (µg/m³)	Weather Information (From Hong Kong Observatory)			
Date	Reservoir (AM1)	East Gate (AM2)	Ash Lagoon (AM3)	Tai Yuen Village (AM4)	Mean Wind Speed (km/hr)	Prevailing Wind Dir. (°)	Mean R.H.
5/6/2020	29	30	22	17	29.6	220	78
11/6/2020	12	13	10	13	10.0	180	76
17/6/2020	20	37	11	24	18.1	200	77
23/6/2020	25	41	29	14	27.4	230	77
29/6/2020	13	15	8	11	9.3	150	74

1 hour TSP Measurement:-


		TSP concentration (µg/m³)					
Date	Time	Reservoir (AM1)	East Gate (AM2)	Ash Lagoon (AM3)			
51612020	15:00 - 15:59	31	56	43			
5/6/2020	16:00 - 16:59	30	49	37			
	17:00 - 17:59	36	40	30			
11/6/2020	15:00 - 15:59	8	10	7			
11/6/2020	16:00 - 16:59	12	8	6			
	17:00 - 17:59	6	11	9			
	15:00 - 15:59	21	22	10			
17/6/2020	16:00 - 16:59	24	21	12			
	17:00 - 17:59	17	20	7			
22/6/2020	15:00 - 15:59	17	52	46			
23/6/2020	16:00 - 16:59	17	50	33			
	17:00 - 17:59	21	48	25			
	15:00 - 15:59	12	24	6			
29/6/2020	16:00 - 16:59	22	29	6			
	17:00 - 17:59	7	17	6			


 $\begin{array}{cccc} & & 1\text{-hr TSP} & 24\text{-hr TSP} \\ & (\mu g/m^3) & (\mu g/m^3) \\ \text{Action Level} & 340 & 190 \\ \text{Limit Level} & 500 & 260 \\ \end{array}$


Calibration: Calibration details are shown in appendix F.


Equipment used:

Location	1-hr TSP	24-hr TSP		
Reservoir, East Gate and Ash Lagoon	TEOM	TEOM		
Tai Yuen Village	-	MINIVOL Portable Sampler		

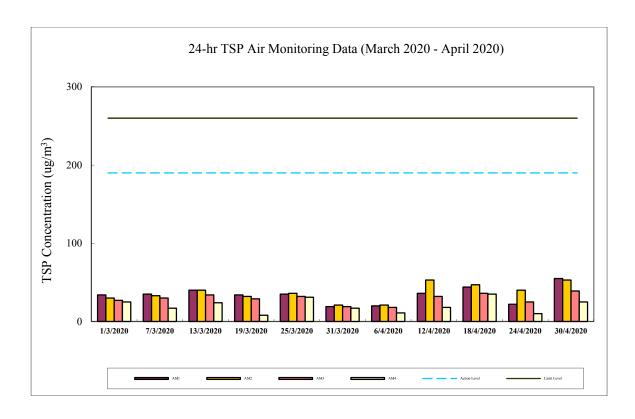

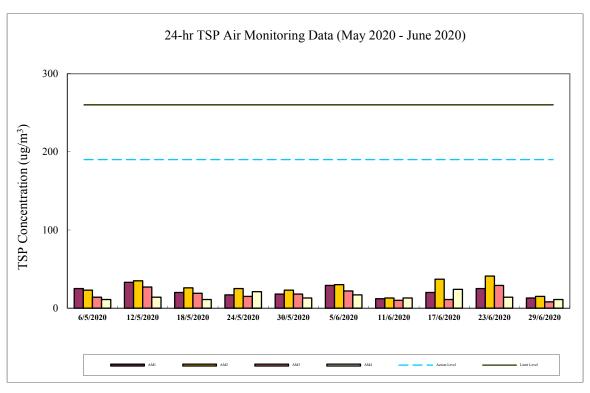

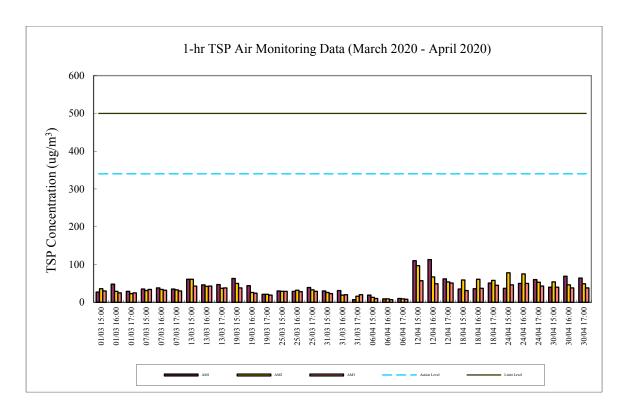

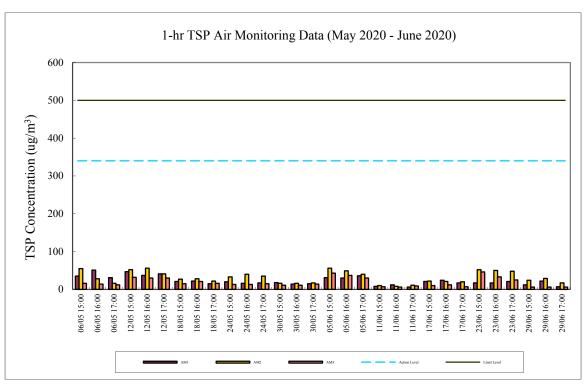

Appendix E Continuous Noise Monitoring Results for June 2020

Site: Lamma Power Station Extension Construction

Measurement Location: Ash Lagoon and Ching Lam

Measurement Parameter: 30-min Leq (07:00-19:00 hrs on normal weekdays)

5-min Leq (07:00-23:00 hrs on holidays and 19:00-23:00 hrs on all other days, and 23:00-

07:00 hrs of next day)

Noise Equipment: B&K 2250 sound level meters and B&K 4231 sound

Level calibrator

Lab. Calibration Date: B&K 2250 sound level meters - 26/08/2018 (Ash Lagoon)

19/08/2019 (Ching Lam)


B&K 4231 calibrator - 02/10/2019


Date	Time	Calculated Noise Level at NSR at Long Tsai Tsuen/Hung Shing Ye (dB(A))		Limit Noise Level (dB(A))	Calculated Noise Level at NSR at the school within Tai Wan San Tsuen (dB(A))		Limit Noise Level (dB(A))
		Max	Avg	-	Max	Avg	-
01/06/2020	07:00-19:00	41	41	75	47	42	70
01/06/2020	19:00-23:00			60	50	39	60
01/06/2020	23:00-07:00	42	40	45	41	34	45
02/06/2020	07:00-19:00	53	52	75	41	35	70
02/06/2020	19:00-23:00			60	42	36	60
02/06/2020	23:00-07:00	45	42	45	44	35	45
03/06/2020	07:00-19:00	43	38	75	39	35	70
03/06/2020	19:00-23:00			60	48	36	60
03/06/2020	23:00-07:00	43	41	45	43	31	45
04/06/2020	07:00-19:00	53	37	75	44	37	70
04/06/2020	19:00-23:00			60	48	42	60
04/06/2020	23:00-07:00	45	41	45	43	33	45
05/06/2020	07:00-19:00	53	47	75	43	35	70
05/06/2020	19:00-23:00	48	45	60	49	42	60
05/06/2020	23:00-07:00	45	38	45	43	35	45
06/06/2020	07:00-19:00	57	49	75	40	34	70
06/06/2020	19:00-23:00	40	40	60	36	33	60
06/06/2020	23:00-07:00	42	32	45	45	36	45
07/06/2020	07:00-23:00	60	45	60	56	39	60
07/06/2020	23:00-07:00	45	39	45	45	39	45
08/06/2020	07:00-19:00	55	51	75	45	40	70
08/06/2020	19:00-23:00			60	47	37	60
08/06/2020	23:00-07:00	42	39	45	42	33	45
09/06/2020	07:00-19:00	54	48	75	46	39	70
09/06/2020	19:00-23:00			60	49	36	60
09/06/2020	23:00-07:00	44	38	45	43	33	45
10/06/2020	07:00-19:00	51	46	75	46	40	70
10/06/2020	19:00-23:00	38	38	60	44	35	60
10/06/2020	23:00-07:00	40	37	45	45	36	45
11/06/2020	07:00-19:00	52	41	75	43	38	70
11/06/2020	19:00-23:00	47	47	60	54	41	60
11/06/2020	23:00-07:00	43	34	45	42	34	45
12/06/2020	07:00-19:00	56	48	75	48	40	70
12/06/2020	19:00-23:00			60	55	40	60
12/06/2020	23:00-07:00	45	37	45	44	36	45
13/06/2020	07:00-19:00	48	48	75	52	44	70


13/06/2020	19:00-23:00	41	38	60	57	41	60
13/06/2020	23:00-07:00			45			45
14/06/2020	07:00-23:00	50	40	60	59	45	60
14/06/2020	23:00-07:00	39	35	45	45	34	45
15/06/2020	07:00-19:00	56	47	75	50	45	70
15/06/2020	19:00-23:00			60	57	43	60
15/06/2020	23:00-07:00	45	39	45	41	36	45
16/06/2020	07:00-19:00	48	45	75	50	44	70
16/06/2020	19:00-23:00	46	34	60	55	39	60
16/06/2020	23:00-07:00	43	39	45	44	36	45
17/06/2020	07:00-19:00	61	55	75	49	45	70
17/06/2020	19:00-23:00			60	52	38	60
17/06/2020	23:00-07:00	45	42	45	45	36	45
18/06/2020	07:00-19:00	57	48	75	50	44	70
18/06/2020	19:00-23:00			60	55	40	60
18/06/2020	23:00-07:00	45	36	45	43	39	45
19/06/2020	07:00-19:00	50	43	75	59	44	70
19/06/2020	19:00-23:00	52	42	60	59	45	60
19/06/2020	23:00-07:00	45	38	45	45	38	45
20/06/2020	07:00-19:00	60	48	75	56	47	70
20/06/2020	19:00-23:00	38	38	60	60	41	60
20/06/2020	23:00-07:00	42	38	45	42	39	45
21/06/2020	07:00-23:00	58	44	60	59	45	60
21/06/2020	23:00-07:00	44	38	45	42	35	45
22/06/2020	07:00-19:00	57	49	75	55	46	70
22/06/2020	19:00-23:00			60	56	48	60
22/06/2020	23:00-07:00	43	42	45	43	32	45
23/06/2020	07:00-19:00	58	53	75	57	49	70
23/06/2020	19:00-23:00	47	39	60	51	35	60
23/06/2020	23:00-07:00	45	41	45	43	34	45
24/06/2020	07:00-19:00	47	46	75	53	46	70
24/06/2020	19:00-23:00	44	44	60	57	41	60
24/06/2020	23:00-07:00	44	36	45	40	35	45
25/06/2020	07:00-23:00	54	42	60	59	43	60
25/06/2020	23:00-07:00	41	39	45	43	35	45
26/06/2020	07:00-19:00	49	46	75	54	43	70
26/06/2020	19:00-23:00	39	39	60	54	39	60
26/06/2020	23:00-07:00	44	43	45	42	33	45
27/06/2020	07:00-19:00	51	51	75	54	44	70
27/06/2020	19:00-23:00	46	35	60	53	39	60
27/06/2020	23:00-07:00	43	41	45	42	38	45
28/06/2020	07:00-23:00	56	45	60	57	40	60
28/06/2020	23:00-07:00	41	36	45	45	38	45
29/06/2020	07:00-19:00	54	51	75	46	40	70
29/06/2020	19:00-23:00			60	51	39	60
29/06/2020	23:00-07:00	45	41	45	42	39	45
30/06/2020	07:00-19:00			75	48	39	70
30/06/2020	19:00-23:00	43	41	60	48	38	60
30/06/2020	23:00-07:00	34	34	45	45	39	45


Note:


- a. "---" represents the measured noise monitoring data lower than the established notional background level/discarded under strong wind.
- b. Continuous noise monitoring was also carried out at holidays & evening-time (07:00-23:00 hrs on holidays and 19:00-23:00 hrs on all other days) and night-time (23:00-07:00 hrs of next day) with construction noise permit.

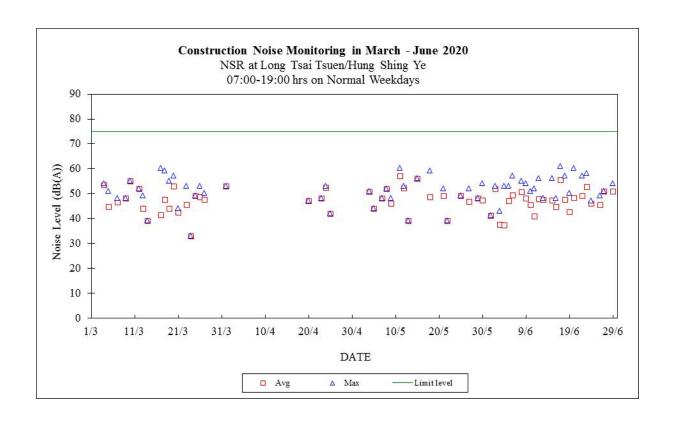


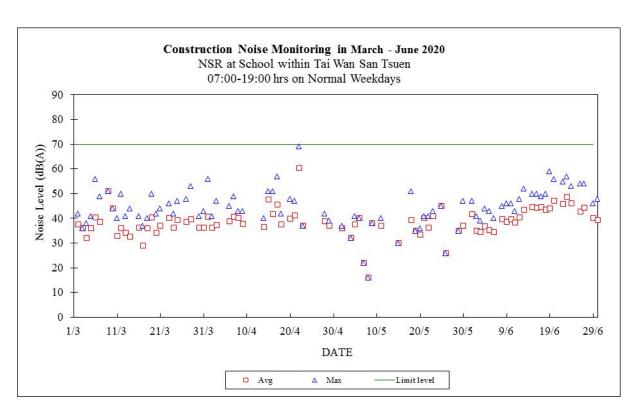

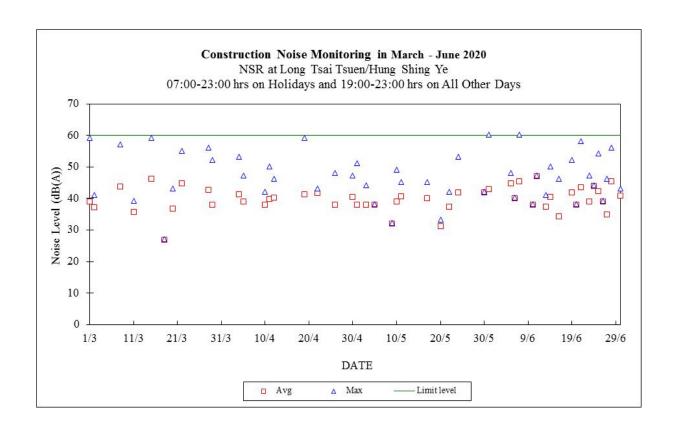

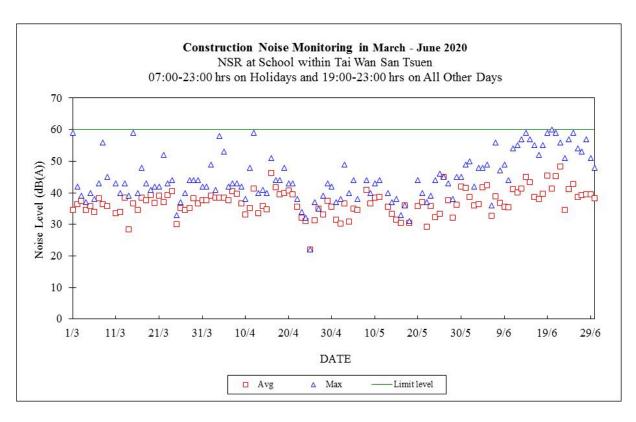

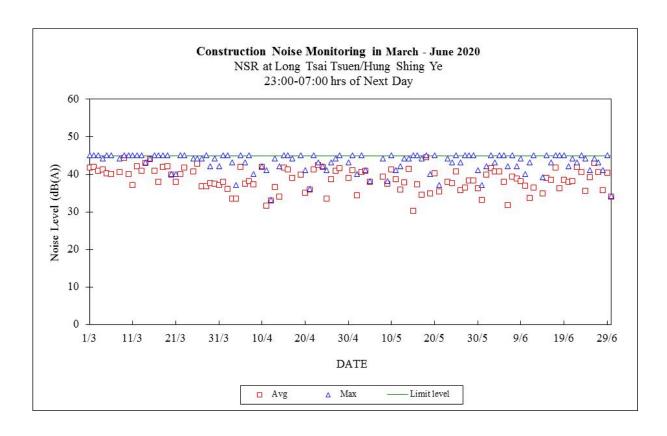

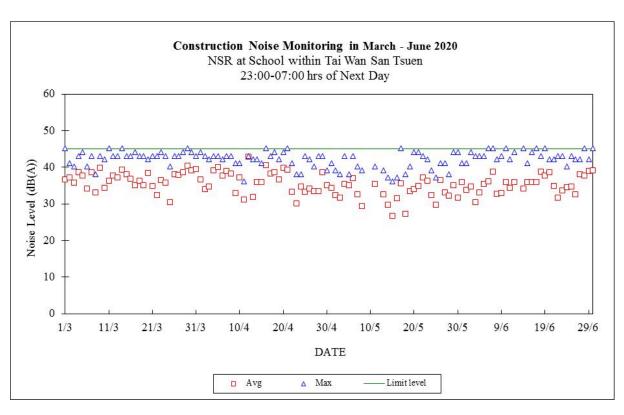

Appendix F

The QA/QC Procedures and Results

The Hongkong Electric Co., Ltd. Lamma Power Station Extension TEOM Continuous Dust Monitor Data Quality Assurance Log Sheet

Month: June Year: 2020

Reservoir (AM1)					
Date	Frequency (Hz) (240 - 275)	Operation Mode (Mode 4)	Main Flow (I/min) (2.70 - 3.30)	Bypass Flow (I/min) (12.30 - 15.04)	
05/06/2020	268.078	4	2.94	13.40	
11/06/2020	267.749	4	2.94	13.38	
17/06/2020	269.054	4	2.94	13.42	
23/06/2020	268.749	4	2.93	13.35	
29/06/2020	268.439	4	2.92	13.32	

East Gate (AM2)				
Date	Frequency (Hz) (240 - 275)	Operation Mode (Mode 4)	Main Flow (I/min) (2.70 - 3.30)	Bypass Flow (I/min) (12.30 - 15.04)
05/06/2020	256.494	4	2.97	13.52
11/06/2020	256.192	4	2.96	13.49
17/06/2020	256.985	4	2.96	13.51
23/06/2020	256.574	4	2.97	13.52
29/06/2020	255.983	4	2.95	13.45

Ash Lagoon (AM3)				
Date	Frequency (Hz) (240 - 275)	Operation Mode (Mode 4)	Main Flow (I/min) (2.70 - 3.30)	Bypass Flow (I/min) (12.30 - 15.04)
05/06/2020	255.892	4	3.00	13.67
11/06/2020	255.658	4	3.00	13.67
17/06/2020	255.499	4.	3.00	13.67
23/06/2020	255.770	4	3.00	13.67
29/06/2020	255.592	4	3.00	13.67

Maintenance Record						
Reservoir East Gate Ash Lagoon						
TEOM Filter Exchange	/	/	/			
Clean TSP Inlet	1	/	1			
Replace flow in-line filter	1	/	√			
Pump Repair						
Leak Check						
Flow audit						
Flow Controller Calibration						
A/C filter cleaning						

Remarks:

Prepared by: Chris Chan

Checked by: HY Chan

The Hongkong Electric Co., Ltd. Lamma Power Station Extension Noise Monitoring Station Daily Calibration Record

Date	Location:	Ching Lam
	Calibration Results	Deviation from Reference (dB)
01/06/2020	Passed	0.02
02/06/2020	Passed	0.01
03/06/2020	Passed	0.02
04/06/2020	Passed	0.01
05/06/2020	Passed	-0.04
06/06/2020	Passed	-0.01
07/06/2020	Passed	0.01
08/06/2020	Passed	0.02
09/06/2020	Passed	0.01
10/06/2020	Passed	0.01
11/06/2020	Passed	0.02
12/06/2020	Passed	0.03
13/06/2020	Passed	0.00
14/06/2020	Passed	0.03
15/06/2020	Passed	-0.03
16/06/2020	Passed	-0.02
17/06/2020	Passed	0.00
18/06/2020	Passed	0.03
19/06/2020	Passed	0.00
20/06/2020	Passed	0.03
21/06/2020	Passed	0.02
22/06/2020	Passed	0.01
23/06/2020	Passed	0.04
24/06/2020	Passed	0.02
25/06/2020	Passed	0.01
26/06/2020	Passed	0.03
27/06/2020	Passed	0.06
28/06/2020	Passed	0.03
29/06/2020	Passed	0.01
30/06/2020	Passed	0.01

Remarks

- 1. The B&K sound level meter at the noise monitoring station has an advanced feature of internal calibration checking (viz. Charge Injection Calibration (CIC)). CIC is a B&K patented method for in situ verification of the integrity of the entire sound measurement chain (including microphone, preamplifier and cabling).
- 2. The acceptance criterion of deviation from reference is \pm 0.5 dB.

The Hongkong Electric Co., Ltd. Lamma Power Station Extension Noise Monitoring Station Site Visit Log Sheet

Location: Ash Lagoon

Date/Time	Staff Attended
4/6/2020 / 15:40	Jing Lui / TL Chu

Equipment	Serial No.
B&K 2250	3009916

1. Calibration

Acoustic calibrator: B&K 4231 (S/N: 3014754)

Noise level measured in calibration: 93.9 (94 ±1.0 dBA)

- 2. Weather Conditions
 - a. Sunny
 - b. Calm
- 3. Beacon

Function normally: Yes

4. Remark/Observation

N/A

Prepared by: <u>Jing Lui</u> Checked by: <u>TL Chu</u>

The Hongkong Electric Co., Ltd. Mini Volume Air Sampler Site Visit Log Sheet

Attendance Log

Date/Time	Staff Name
15/06/2020 / 14:00	WM Tam

Site Name: Tai Yuen Village (AM4)

Equipment / Item

Equipment / Item	Serial No. / No.
MINIVOL	5580
Used filter paper no.	MQ81
New filter paper no.	MQ82

Type of filter: Glass-fibre

Calibration is performed by using Drycal DC-2 Flow Calibrator
 std. L/min set point is recommended

 Before:
 5.03

 After:
 5.03

II. General Services

Clean Rotameter: Yes
 Clean / Replace Pump Valves: No
 Clean / Replace Pump Diaphragms: No
 Clean Impaction Inlet: Yes
 Replace Timer Battery Every 6 months: No
 Replace Inlet Filter: Yes

Remarks

N/A

Conducted by: <u>VMM Tam</u> Checked by: <u>SM Hon</u>

Appendix G Event/Action Plans

Table G.1 Event and Action Plans for Air Quality

Event	Monitoring		Action		
	ET Leader	IEC	Engineer	Contractor	
Action Level					
Exceedance of one sample	Identify source Inform Engineer and IEC verbally Repeat measurement to confirm finding	Check monitoring data submitted by ET and advise Engineer.	Notify Contractor Checking monitoring data and contractor's working methods	Rectify any unacceptable practice amend any working methods if appropriate	
Exceedance of two or more consecutive samples	Identify source Inform Engineer and IEC verbally Repeat measurement to confirm finding Increase monitoring frequency Discuss with Engineer and Contractor on remedial actions required If exceedance continues, arrange meeting with Engineer If exceedance stops, discontinue additional monitoring	Check monitoring data submitted by ET and advise Engineer. Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Confirm receipt of notification of failure in writing Notify contractor Checking monitoring data and contractor's working methods Discuss proposed remedial actions with the ET and Contractor Ensure remedial actions properly implemented	Submit proposals for remedial actions to Engineer within 3 working days of notifications Implement the agreed proposals Amend proposal if appropriate	
Limit level					
Exceedance of one sample	Repeat measurement to confirm finding. Identify the source(s) of the impact. If the exceedance is found to be valid and due to the Construction works, verbally advise the Contractor, Engineer and IEC, and inform the EPD of the exceedance, as soon as practicable. Increase monitoring frequency to daily Assess the effectiveness of the contractor's remedial actions and keep Engineer, IEC and EPD informed of the results	Check monitoring data submitted by ET and advise Engineer Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Confirm receipt of notification of failure in writing Notify Contractor Checking monitoring data and Contractor's working method Discuss with ET and Contractor on remedial actions to be provided Ensure remedial measures properly implemented	Take immediate action to avoid further exceedance Submit proposals for remedial actions to Engineer within 3 working days of notifications Implement the agreed proposals Amend proposal if appropriate	
Exceedance of two or more	Identify source	Provide feedback to the Engineer on the remedial actions proposed by the	Confirm receipt of notification of	Take immediate action to	

Event	Monitoring		Action	
	ET Leader	IEC	Engineer	Contractor
consecutive	If the exceedance is found to be valid	ET / Contractor	failure in writing	avoid further exceedance
samples	and due to the construction works, verbally advise the Contractor, Engineer	Advise Engineer on the effectiveness of the proposed remedial measures	Checking monitoring data and Contractor's working methods	Submit proposals for remediactions to Engineer within 3
	and IEC, and inform the EPD of the exceedance as soon as practicable.	Verify the implementation of the	Notify Contractor	working days of notification
	Repeat measurement to confirm finding	remedial measures	Discuss proposed remedial actions with ET and Contractor	Implement the agreed proposals
	Increase monitoring frequency to daily Carry out analysis of Contractor's		Ensure remedial measures properly implemented	Resubmit proposals if problestill not under control
	working procedures to determine possible mitigation to be implemented		If exceedance continues, consider what portion of the work is	Stop the relevant portion of works as determined by the
	Arrange meeting with Engineer and Contractor to discuss the remedial actions to be taken		responsible and instruct the Contractor to stop the portion of work until the exceedance is abated	Engineer until the exceedan is abated
	If exceedance stops, discontinue additional monitoring			

Table G.2 Event and Action Plans for Construction Noise

Exceedance	ET Leader	IEC	Engineer	Contractor
Action Level	Undertake noise measurement/check monitoring data to establish validity of complaint.	Review the analysed results submitted by the ET.	Notify Contractor of the complaint if proven.	Submit proposals for remedial actions to Engineer.
	If the complaint is valid, inform Engineer and IEC verbally.	Review the remedial measures proposed by the Contractor and advise the Engineer and ET accordingly.	Check Contractor's working methods and advise IEC and ET accordingly.	Amend proposals if required by the Engineer.
	Identify the source(s) of the noise.	Verify the implementation of the remedial measures.	Remind the Contractor of his contractual obligations and discuss remedial actions.	Implement the remedial actions immediately upon instruction from the Engineer.
	Discuss remedial actions required with Contractor and Engineer.		Keep the Contractor informed of the efficacy of remedial actions.	Liaise with the Engineer to optimise the effectiveness of the agreed mitigation.
	Increase manual monitoring frequency to assess efficacy of remedial measures.			
	If exceedance continues, review implementation of appropriate mitigation measures.			
Limit Level	Repeat manual measurement/check monitoring data to confirm findings.	Agree potential remedial actions with Engineer, ET and Contractor.	Notify Contractor of exceedance.	Take immediate action to avoid further exceedance.
	Identify the source(s) of the impact. If the exceedance is found to be valid and due to	Review Contractor's remedial actions / measures to ensure their effectiveness	Check Contractor's working methods and advise IEC and ET accordingly.	Submit proposals for remedial actions to Engineer.
	the Construction works, verbally advise the Contractor, Engineer and IEC, and inform the EPD of the exceedance, as soon as practicable.	accordingly.	Discuss with Contractor the remedial actions to be implemented.	Amend proposals if required by the Engineer.
		Verify the implementation of the remedial measures	Keep the Contractor informed of the efficacy of remedial actions. If the exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop the portion of work until the exceedance is abated	Implement remedial actions immediately
	Discuss remedial actions required with Engineer.			upon instruction from the Engineer.
	Increase manual monitoring frequency to assess efficacy of remedial measures.			If the exceedance continues, consider what portion of the work is responsible and, as instructed by the Engineer, stop the portion of work until the exceedance is abated

Table G.3 Event and Action Plans for Water Quality

Exceedance	ET Leader	IEC	Engineer	Contractor
Action level exceeded on one sampling day Action level exceeded on more than one consecutive sampling day	Verbally inform the Contractor, and IEC. Repeat in-situ measurement to confirm findings; Identify source(s) of impact; Check monitoring data, all plant, equipment and Contractor's working methods; Discuss mitigation measures with Engineer and Contractor; Repeat measurement on next day of exceedance. Repeat in-situ measurements to confirm findings; Identify source(s) of impact; Inform Contractor and IEC; Check monitoring data, all plant, equipment and Contractor's working methods; Discuss mitigation measure with Engineer and Contractor; Ensure mitigation measures are implemented; Prepare to increase the monitoring frequency to daily; Repeat measurement on next day	Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Discuss with Contractor the proposed mitigation measures; Make agreement on the mitigation measures to be implemented; Assess the effectiveness of the implemented mitigation measures. Discuss with ET and Contractor on the proposed mitigation measures; Make agreement on the mitigation measures to be implemented; Assess the effectiveness of the implemented mitigation measures.	Inform the Engineer and confirm notification of the non-compliance in writing; Rectify unacceptable practice; Check all plant and equipment; Consider changes of working methods; Propose and discuss mitigation measures with Engineer; Implement the agreed mitigation measures. Inform the Engineer and confirm notification of the non-compliance in writing; Rectify unacceptable practice; Check all plant and equipment; Consider changes of working methods; Propose mitigation measures to Engineer within 3 working days and discuss with ET and Engineer; Implement the agreed mitigation measures.
Limit level exceeded on one sampling day	of exceedance. Verbally inform the Contractor, IEC and the EPD of the exceedance; Repeat in-situ measurement to confirm findings; Identify source(s) of impact; Check monitoring data, all plant,	Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Discuss with Contractor on the proposed mitigation measures; Request Contractor to critically review the working methods; Make agreement on the mitigation measures to be implemented; Assess the effectiveness of the	Inform the Engineer and confirm notification of the non-compliance in writing; Rectify unacceptable practice; Check all plant and equipment; Consider changes of working methods; Propose mitigation measures to Engineer

Exceedance	ET Leader	IEC	Engineer	Contractor
	equipment and Contractor's working methods;		implemented mitigation measures.	within 3 working days and discuss with Engineer;
	Discuss mitigation measure with Engineer and Contractor;	1		Implement the agreed mitigation measures.
	Ensure mitigation measures are implemented;			
	Increase the monitoring frequency to daily until no exceedance of Limit level.			
Limit level exceeded by more than one	Repeat in-situ measurement to confirm findings; Identify source(s) of impact;	Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor	Discuss with Contractor on the proposed mitigation measures; Request Contractor to critically	Inform the Engineer and confirm notification of the non-compliance in writing;
consecutive	Inform Contractor, IEC and EPD;	Advise Engineer on the effectiveness of the	review the working methods;	Rectify unacceptable practice;
sampling day	Check monitoring data, all plant, equipment and Contractor's	proposed remedial measures Verify the implementation of the remedial	Make agreement on the mitigation measures to be implemented;	Check all plant and equipment; Consider changes of working methods;
	working methods;	measures	Assess the effectiveness of the	Propose mitigation measures to Engineer
	Discuss mitigation measure with Engineer and Contractor;		implemented mitigation measures; Consider and instruct, if necessary,	within 3 working days and discuss with Engineer;
	Ensure mitigation measures are implemented;		stop all or part of the marine works until no exceedance of the Limit Level.	Implement the agreed mitigation measures
	Increase the monitoring frequency to daily until no exceedance of Limit level for two consecutive days.			As directed by the Engineer, to slow down or to stop all or part of the marine work

Appendix H Summary of Site Audit Findings

No environmental deficiency identified.

L11 Civil & Building Superstructure Work
Dates of Inspection: 2/6/2020, 11/6/2020, 16/6/2020, 23/6/2020 and 30/6/2020
Summary of Findings
General
- No environmental deficiency identified.
Air Quality
- No environmental deficiency identified.
Noise
- No environmental deficiency identified.
Water Quality
- No environmental deficiency identified.
Waste Management

L11 Mechanical, Electrical, Instrumentation & Control Erection Work Dates of Inspection: 4/6/2020, 11/6/2020, 18/6/2020, 24/6/2020 and 30/6/2020. Summary of Findings General

- No environmental deficiency identified.

Air Quality

No environmental deficiency identified.

Noise

- No environmental deficiency identified.

Water Quality

- No environmental deficiency identified.

Waste Management

No environmental deficiency identified.

L12 Piling Foundation Work

<u>Dates of Inspection</u>: 2/6/2020, 9/6/2020, 16/6/2020, 23/6/2020 and 30/6/2020.

Summary of Findings

General

No environmental deficiency identified.

Air Quality

No environmental deficiency identified.

Noise

- No environmental deficiency identified.

Water Quality

- No environmental deficiency identified.

Waste Management

- No environmental deficiency identified.

Summary of EMIS

Power Station – (Part B of EIA Report)

Construction Phase Mitigation Measures and their Implementation

EM&A Log Ref.	Mitigation Measures	Implementation Status
	AIR QUALITY	
A1	For general construction works, the dust control measures stipulated under the Air Pollution Control (Construction Dust) Regulation shall be complied with, such as:	
	the haul roads shall be sprayed with water to keep the entire road surface wet.	С
	• the load carried by vehicle shall be covered by impervious sheeting to ensure no leakage of dusty materials from the vehicle.	С
	the heights from which fill materials are dropped shall be controlled to a practical level to minimise the fugitive dust arising from unloading.	С
A2	For the concrete batching plant, the following control measures are recommended:	
	• loading, unloading, handling, transfer or storage or any dusty materials shall be carried out in a totally enclosed system.	С
	The materials which may generate airborne dust emissions shall be wetted by water spray system.	С
	All receiving hoppers shall be enclosed on three sides up to 3m above unloading point.	С
	All conveyor transfer points shall be totally enclosed.	С
	WATER QUALITY	
B1	Silt curtains shall be installed on the eastern, southern and north western sides of the reclamation site during dredging for the reclamation construction. This is a required mitigation measure for the construction works and shall be implemented prior to the commencement of bulk dredging. **	N/A
В3	As a necessary operational constraint combined bulk dredging and sand filling for site formation shall not be permitted at any time. In addition, sand filling for site platform shall take place behind constructed sea walls which pierce the water surface. **	N/A
B4	HEC shall ensure design to divert all storm drains away from Hung Shing Ye Bay. **	N/A
B5	Sand fill for the rubble mound seawalls shall be placed by controlled pumping down the trailer arm. **	N/A
В6	EM&A shall confirm the acceptability of any impacts during construction and should any unacceptable impacts be found then one or more of the following mitigation measures shall be implemented: **	N/A
	 reducing the number of dredgers working at any one time; reducing the rate of working of the dredgers; temporary suspension of operations; phasing of the works so that dredging / filling is only undertaken at certain stages of the tidal cycle. 	

EM&A Log Ref.	Mitigation Measures	Implementation Status
В7	In addition to the above specific measures the following general working procedures shall be adopted. **	
	fully-enclosed or watertight grabs shall be used to minimise loss of sediment during the raising of loaded grabs through the water column;	N/A
	the descent speed of grabs shall be controlled to minimise the seabed impact speed and to reduce the volume of over dredging;	N/A
	barges shall be loaded carefully to avoid splashing of material;	N/A
	all barges used for the transport of dredged materials shall be fitted with tight bottom seals in order to prevent leakage of material during loading and transport;	N/A
	all barges shall be filled to a level which ensures that material does not spill over during loading and transport to the disposal site and that adequate freeboard is maintained to ensure that the decks are not washed by wave action;	N/A
	• the speed of trailer dredgers shall be controlled to prevent propeller wash from stirring up the sea bed sediments;	N/A
	"rainbowing" sand fill from trailer dredgers shall not be permitted; and	N/A
	the works shall cause no visible foam, oil, grease or litter or other objectionable matter to be present in the water within and adjacent to the dredging site and along the route to the disposal site.	N/A
B8	Cumulative impacts shall be assessed through EM&A. Co-ordination with the EM&A consultants for other projects to determine if any exceedances are caused by the other projects or by HEC's activities. Should monitoring results indicate exceedances at sensitive receivers due to HEC's activities, then the above described mitigation measures shall be implemented until impacts reduce to acceptable levels.	N/A
	NOISE	
C1	General noise mitigation measures shall be employed at all work sites throughout the construction phase.	С
C2	Mitigate against general construction noise during Sunday's and public holidays, either at source with portable noise barriers, or by rescheduling of some PMEs to less sensitive time periods.	С
С3	Mitigate against night time noise from dredging equipment, with silencers or mufflers. **	N/A
	LANDSCADE & VISUAL IMDACTS	
D1	LANDSCAPE & VISUAL IMPACTS The following mitigation measures shall be allowed for landscape and visual	
וטו	improvement:	
	Use rubble mound seawall along south and west edges of the reclamation to provide a more natural look.	С
	Break the mass of main buildings by varying the height/division into smaller units.	С
	Plant trees and vegetation for screening.	С
	Adopt colour scheme to blend the buildings into the scenery.	С

EM&A Log Ref.	Mitigation Measures	Implementation Status
	WASTE MANAGEMENT	
E1	HEC to submit a Waste Management Plan for the construction phase to EPD. The Plan shall be verified by the IEC and shall describe the arrangements for avoidance, reuse, recovery and recycling, storage, collection, treatment and disposal of different categories of waste to be generated from the construction activities and shall take into account the recommendations of the EIA report.	С
	Dredging Waste	
E2	All vessels for marine transportation of dredged sediment shall be fitted with tight fitting seals to their bottom openings to prevent leakage of materials. In addition, loading of barges and hoppers shall be controlled to prevent splashing of dredged material into the surrounding water, and barges or hoppers should under no circumstances be filled to a level which shall cause the overflowing of materials or polluted water during loading or transportation**	N/A
	Storage, Collection and Transport of Waste	
E3	Minimise windblown litter and dust during transportation by either covering trucks or transporting wastes in enclosed containers.	С
	Obtain the necessary waste disposal permits from the appropriate authorities, if they are required, in accordance with the Waste Disposal Ordinance (Cap.354), Waste Disposal (Chemical Waste) (General) Regulation (Cap.354), the Crown Land Ordinance (Cap 28), Dumping at Sea Ordinance (Cap 466) and Work Branch Technical Circular No. 22/92, Marine Disposal of Dredged Mud.	С
	Disposal of waste at Licensed sites;	С
	Develop procedures such as a ticketing system to facilitate tracking of marine mud and chemical waste, and to ensure that illegal disposal does not occur;	С
	 Segregate and sort the waste materials into 3 categories: public fill (e.g. concrete and rubble) for re-use on-site or disposal at a public filling area; re-use and/or recycling waste (e.g. steel and other metals); waste which cannot be re-used and/or recycled (e.g. wood, glass and plastic) for landfill disposal. 	С
	The sorting process shall be carefully monitored to avoid missing of the 3 categories. Different types of wastes shall be stockpiled and stored in different containers or skips to enhance re-use or recycling of materials and their proper disposal.	
	Maintain records of the quantities of wastes generated and disposed off-site for each category of waste.	С
E4	Chemical waste that is produced, as defined by Schedule 1 of the Waste Disposal (Chemical Waste) (General) Regulation, shall be handled in accordance with the Code of Practice on the Packaging, Handling and Storage of Chemical Wastes	С
	LAND CONTAMINATION	
F1	No land Contamination mitigation measures are required during the construction phase.	N/A
		•
	MARINE ECOLOGY	

EM&A Log Ref.	Mitigation Measures	Implementation Status
G1	All percussive piling works shall be conducted on reclaimed land to avoid noise impact to marine mammals**	N/A
G2	All construction related vessels shall approach the extension site from the north and via the East Lamma Channel to avoid disturbance to the finless porpoise**	N/A
G3	Rubble mound seawall to the south and west edges of the reclamation to enhance recolonisation of marine organisms**	N/A
G4	Artificial Reefs of a volume not less than 400 m³ shall be deployed in a location to be decided upon consultation with the Director of Agriculture and Fisheries to serve the purpose of an Additional Habitat Enhancement Measure.**	N/A
	FISHERIES	
H1	No Fisheries-specific mitigation measures are required during the construction phase.	N/A
	RISK ASSESSMENT	
I1	No risk mitigation measures are required during the construction phase.	N/A

Remarks:

No dredging and reclamation work would be involved for L11 & L12 construction Compliance with mitigation measure
Non-compliance with mitigation measure
Not Applicable **

C

NC


N/A

Pipe and Cable Rack at south of Middle Road at Area E8 and E19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated of days at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works at Area E9 (A) Section F - 275kV Station Building Extension and associated works at Area E12 Section G - A&A Works at No. 4 C.W. Intake at Area E12 Section H - L11 Steel flue liner at No. 4 Chimney Diagram A milestone Sum 15/9/19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - CA Support Foundation and Pipe Trench and associated works at Area E17 Sectio	ontr	act No. 17/8002 Lamma Power Station Extension Civil and Building Works	TOR Unit L1	1	17-8002	02 Master Prog Rev 3 Refer to CEM dated 26March2
Chies and Middle Works for for that and Austrian Works 177 days 171 (July 1972) 171 (July 1972	D T	ask Name	Duration	Start	Finish	July 2020 August 2020 Sentember 2020
Control Court memorial Data 1.0 doi: 10.0	C	ivil and Building Works for Unit 11 and Assoicated Works	1197 days	Fri 1/6/18	Thu 30/9/21	
Section AS Control feetings with all control and process of the control			1197 days			
Section AL - Common transmission works at Zone 13						
Section A2 Conced transment insulations works at Zame 1	_	•				
Science A1 - Chemic hashings missilations worked at Ann. 5	\perp					
Section A.S. Criminal frameworker at Journal & Journal of the Control of Section AS (1) Criminal frameworker at Journal & Journal & Journal of Section AS (1) Criminal frameworker at Journal & Journa			•			
Section AC 10 - Chowest Incomental autobilitation works at Joine 4 - Stead draws Online	_					
Marcia No. 10 Correct recursive installation works at 7 year 2 - Surphays 0. day Wed 1909.0 Wed 1909.0 Wed 1909.0 Section AG (1) - AAA works for No. 4 CW. Defails at Access 18 0. day Section AG (2) - AAA works for No. 4 CW. Defails at Access 18 0. day Section AG (2) - AAA works for No. 4 CW. Defails at Access 18 0. day Section BG (3) - Access on AG (1) - ACCES						
Section AL (1) : AAA Work for No. 4 CW. On full at Avan F18 Section S1 (1) : AAA Work for No. 4 CW. On full at Avan F18 Section S1 (1) : AAA Work for No. 4 CW. On full at Avan F18 Section S1 (1) : AAA Work for No. 4 CW. On full at Avan F18 Section S1 (1) : AAA Work for No. 4 CW. On full at Avan F18 Section S1 (1) : Aaa work f11 NSF1 and H185 (7 for CH LT eachwards for Section S1 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (7 for CH LT eachwards for Section S1 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (7 for CH LT eachwards for Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) in Section S1 (1) : Aaa work f11 NSF1 and H185 (1) : Aaa		installation				
Section AG (ii) - External works at Area F15 Section B1 (ii) - Expertant works at Area F15 Section B1 (iii) - Stopportune statistics for overland cross of £11 MSB of the Stopportune statistics for overland cross of £11 MSB of the Stopportune statistics for overland cross of £11 MSB of the Stopportune statistics for overland cross of £11 MSB of the Stopportune statistics for overland cross of £11 MSB of the Stopportune statistics for overland cross of £11 MSB of the Stopportune statistics for overland cross of £11 MSB of the Stopportune statistics of £11 MSB of MSB of MSB of Stopportune statistics of £11 MSB of MSB of MSB of Stopportune statistics of £11 MSB of)	filling				
Section SE (1) - Acces and of LLI MSS and MRSS from CRL1+ contends to Compare the CRL MSS and	1		•			
Recipting in Chimmory Roads A Year F1 & F1 2 Section H1 (6) - SSRI (10) Supporting structure for overhead crase of L11 MS1 in Mod 13.52 in Mod			*			
serios B (1) - FSRU Cell words of American econgular for word deferred words. Serios B (1) - FSRU Cell words of American Park Far P22 Serios B (1) - FSRU Cell words of American Park Far P22 Serios B (1) - FSRU Cell words of American Park Far P22 Serios B (1) - FSRU Cell words of American Park Far P22 Serios B (1) - Far words of LLI DNS for and LI PAR Words Indian Medical Park Far P24 Serios B (1) - Far words of LLI DNS for and LI PAR Words and LI PAR P24 Serios B (1) - Far words of LLI DNS for and LI PAR P24 Serios B (1) - Far Words of LI PAR P24 Ser	3	leading to Chimney Road at Area E1 & E2	0 days			
Section 12 - Rotestable Cover D at Area 122	1		0 days	Tue 17/3/20	Tue 17/3/20	$0 \mid \cdot \mid$
Section 12 - Rotestable Cover D at Area 122	5		0 days	Mon 31/5/21	Mon 31/5/21	
Section (1-4 cas south C11 MS Broom C11-19 versionals loading to dispose and its surrounding in Area (1-4 cas south C11 MS Broom C11-19 versionals loading to dispose (1-4 cas south C11 MS Broom C11-19 versionals loading to dispose (1-4 cas south C11 MS Broom C11-19 versionals loading and Area (1-4 cas south C11 MS Broom C11-19 Versionals loading and Area (1-4 cas south C11 MS Broom C11-19 Versionals loading and C11 MS Broom C11-19 Versionals loading and C11-19 Versional loading and C11-19 Versional loading (1-4 cas south C11-19 Versional) (1-4 cas south C11-19 Versional loading (1-4 cas south C11-19 Versional) (1-4 ca						
Section C1 - Area south of L11 MSB from C11.19 we swords leading to Station Read at Area E14, E15 (18) Station read at Area E14, E15 (18) Station read at Area E14, E15 (14) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14, E15 (14) and E15 (18) Station read at Area E14 (18) station read at Are		Section B3 - External works at Area B1, D2 and D4				
Section C2 - (ii) Southern part of L11 HRSG area and its surrounding at Area Section C2 - (iii) L11 Tube Block Foundations heating the L11 MRSB ground Bear specified with the capping and foundations between C6 L11-Fib 11-fl and lines are consistent of foundations between C6 L11-Fib 11-fl and lines are consistent with the capping consistent of the program of the p	1		•	Sun 1/3/20	Sun 1/3/20	
Section C2 - (iii) L11 Unrob Block foundations including the L11 MSB ground floor together with the captignore floundations between Cfl 1-1F to 11-6 for the installation of power generator, air intel duct and lube oil reservoir floar floor to the south of the condition of power generator, air intel duct and lube oil reservoir floar fl)		0 days	Sun 1/12/19	Sun 1/12/19	9
Section C 2 - (iii) Gif of L11 MSB including the Condense (fil .118 to 11 Cand 11-1 to 11-6 for the installation of condenses? Section D - (iii) Remaining northern part of L11 HISB and L11 HISB and all to 11 HISB and different on the southern & eastern areas mentioned above in Area E3 and E6 Section D - (iii) Remaining northern part of L11 HISB area and its surrounding Unit with all madeyround utilities at Area F4 including C with a surrounding to 11 MSB with all underground utilities at Area E4 including C.W. Inlet and Outlet Culvert except the deferred works such financial C in (iii) Window C i	0	Section C2 - (ii) L11 Turbo Block foundation including the L11 MSB ground floor together with the equipment foundations between GL 11-F to 11-H and 11-1 to 11-6 for the installation of power generator, air inlet duct and lube oil	0 days	Thu 30/4/20	Thu 30/4/20	nent foundations between GL 11-F to 11-H and 11-1 to 11-6 for the installation of power generator, air inlet duct and lube oil reservoir
Section D - (i) Noads and external grounds surrounding L11 MSB and L11		Section C2 - (iii) G/F of L11 MSB including the Condenser Pit, Circulating Water Pipe Pit and equipment foundations between GL 11-B to 11-C and 11-1	0 days	Sun 1/3/20	Sun 1/3/20	
Section D - (ii) Remaining northern part of L11 HRSG area and its surrounding of days Sun 1/3/20 Sun 1/3/20 Sun 1/3/20 Section D - (iii) Whole of L11 MSB including the pipe and cable rack along south fisqued of L11 MSB with all underground utilities at Area F4 including C.W. Inlet and Outlet Culvert except the deferred works Section D - (iv) Link Bridge between L10 and L11 MSB and at the south of L11 MSB including their associated alternations & additions (A&A) Works at L10 MSB Section D - (iv) Capta Det Foundation, Pipe and Cable Rack and associated trench in Area F20 Section D - (iv) Link Bridge and Pipe and Cable Rack connecting L11 MSB to days Sat 1/2/20 Section E1 - (i) Link Bridge and Pipe and Cable Rack connecting L11 MSB to days Sat 1/2/20 Section E1 - (i) Link Bridge and Pipe and Cable Rack connecting L11 MSB to days Sat 1/2/20 Section E1 - (ii) Link Bridge and Pipe and Cable Rack connecting L11 MSB to days Sat 1/2/20 Section E1 - (ii) Link Bridge and Pipe and Cable Rack and associated Captage Section E1 - (iii) Sternation Moves at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E15 C Section E1 - (iii) External Works at Area E15 C Section E1 - (iii) External Works at Area E15 C Section E1 - (iii) External Works at Area E15 C Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Section E1 - (iii) External Works at Area E16 Secti	2	Section D - (i) Roads and external grounds surrounding L11 MSB and L11 HRSG in addition to the southern & eastern areas mentioned above in Area E5	0 days	Tue 31/12/19	Tue 31/12/19	
Section D - (iii) Whole of L1 I MSB including the pipe and cable rack along South Faqued of L1 I MSB with all underground utilities at Area E4 including C.W. Inlet and Outlet Culvert except the deferred works Section D - (iv) Link Bridge between L10 and L11 MSB and at the south of Middle Rack and associated with a L11 MSB and at the south of Middle Rack and associated and L11 MSB and Area E13 C) Section E1 - (ii) Extraction and L11 Gas Receiving Station and L	3	Section D - (ii) Remaining northern part of L11 HRSG area and its surrounding	0 days	Sun 1/3/20	Sun 1/3/20	
Section D - (iv) Link Bridge between L10 and L11 MSB and at the south of L11 MSB including their associated alternations & additions (A&A) Works at L10 MSB Section D - (v) Gas Duct Foundation, Pipe and Cable Rack and associated trench in Area E20 Section B1 - (i) Link Bridge and Pipe and Cable Rack connecting L11 MSB to the western area of L11 MSB at Area E3 Section E1 - (ii) Link Bridge and Pipe and Cable Rack connecting L11 MSB to the western area of L11 MSB at Area E3 Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station E1 (ii) Gas Receiving Station and L11 Gas Receiving Station E1 (ii) Gas Receiving Station and L11 Gas Receiving Station and L11 Gas Receiving Station E1 (ii) Gas Receiving Station and L11 Gas Receiving Station E1 (ii) Gas Receiving Station and L11 Gas Receiving Station E1 (ii) Gas Receiving Station and L11 Gas Receiving Station E1 (ii) Gas Receiving Station and L11 Gas Receiving Station E1 (ii) Gas Receiving Station E1 (ii) Gas Receiving Station E1 (iii) Gas Receiving	4	Section D - (iii) Whole of L11 MSB including the pipe and cable rack along south façade of L11 MSB with all underground utilities at Area E4 including	0 days	Thu 30/4/20	Thu 30/4/20	all underground utilities at Area E4 including C.W. Inlet and Outlet Culvert except the deferred works
trench in Area E20 Section E1 - (i) Link Brldge and Pipe and Cable Rack connecting L11 MSB to 0 days Mon 28/9/20 Mon 28/9/20 the western area of 1.11 MSB at Area E3 Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station E1 - (iii) Gas Receiving Station and L11 Gas Receiving Station E2 - (iii) External Works at Area E15 (C) Section E1 - (iii) External Works at Area E15 (C) Section E2 - Pipe and Cable Rack at south of Middle Road at Area E8 and E19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A) Section F3 - 275kV Station Building Extension and associated works at Area E12 Section F4 - 275kV Station Building Extension and associated works at Area E12 Section F4 - L11 Steel flue liner at No. 4 C.W. Intake at Area E12 Section F4 - L11 Steel flue liner at No. 4 Chimney Summary Summary Summary Summary Summary	5	Section D - (iv) Link Bridge between L10 and L11 MSB and at the south of L11 MSB including their associated alternations & additions (A&A) Works at	0 days	Thu 30/4/20	Thu 30/4/20	0 lated alternations & additions (A&A) Works at L10 MSB
Section E1 - (i) Link BrIdge and Pipe and Cable Rack connecting L11 MSB to the western area of L11 MSB at Area E3 Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station Equipment Room (GRS) Area Extension at Area E16 Section E2 - Pipe and Cable Rack and trench at west of Chimney Road and Pipe and Cable Rack at south of Middle Road at Area E8 and E19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB to Area E9(A) Section F4 - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E17 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and associated works at Area E12 Section F - 275kV Station Building Extension and E17 MSB at Area E16 (B) Section F - 275kV Station Building Extension and E17 MSB at Area E16 (B) Section F - 275kV Station Building Extension and E17 MSB at Area E16 (B) Section F - 275kV Station Building Extension and E17 MSB at Area E16 (B) Section F - 275kV Station Building Extension and E17 MSB at Area E16 (B) Section F - 275kV Station Building Exte	3		0 days	Sat 1/2/20	Sat 1/2/20	
Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station and L11 Gas Receiving Station and L11 Gas Receiving Station at Area E16 Equipment Room (GRS) Area Extension at Area E16 Section E1 - (iii) Stermal Works at Area E15 (C) Section E1 - (iii) Stermal Works at Area E15 (C) Section E1 - (iii) Stermal Works at Area E15 (C) Section E1 - (iii) Gas Receiving Station Equipment Room (GRS) Area Extension at Area E16 Section E1 - (iii) Stermal Works at Area E15 (C) Section E2 - Pipe and Cable Rack and trench at west of Chimney Road and Pipe and Cable Rack at south of Middle Road at Area E8 and E19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A) Section F - 275kV Station Building Extension and associated works at Area E12 Section G - A&A Works at No. 4 C.W. Intake at Area E12 Section H - L11 Steel flue liner at No. 4 Chimney Milestone Summary Summary Summary Summary Summary	7	Section E1 - (i) Link BrIdge and Pipe and Cable Rack connecting L11 MSB to	0 days	Mon 28/9/20	Mon 28/9/20	
Section E1 - (iii) External Works at Area E15 (C) Section E2 - Pipe and Cable Rack and trench at west of Chimney Road and Pipe and Cable Rack at south of Middle Road at Area E8 and E19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A) Section F - 275kV Station Building Extension and associated works at Area E12 Section G - A&A Works at No. 4 C.W. Intake at Area E12 Section H - L11 Steel flue liner at No. 4 Chimney Output Milestone Section Sun 28/2/21 Thu 17/9/20 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Sun 15/9/19 Sun 15/9/19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Sun 15/9/19 Sun 15/9/19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Sun 15/9/19 Sun 15/9/19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Sun 15/9/19 Sun 15/	В	Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station	0 days	Tue 30/6/20	Tue 30/6/20	O Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station Equipment Room (GRS) Area Extension at Area E16
Section E2 - Pipe and Cable Rack and trench at west of Chimney Road and Pipe and Cable Rack at south of Middle Road at Area E8 and E19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A) Section F - 275kV Station Building Extension and associated works at Area E12 Section G - A&A Works at No. 4 C.W. Intake at Area E12 Section H - L11 Steel flue liner at No. 4 Chimney Task Split Milestone Thu 17/9/20 Thu 1		• • • • • • • • • • • • • • • • • • • •	0 days	Sun 28/2/21	Sun 2.8/2/2.1	
Pipe and Cable Rack at south of Middle Road at Area E8 and E19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated of days at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works at Area E9 (A) Section F - 275kV Station Building Extension and associated works at Area E12 Section G - A&A Works at No. 4 C.W. Intake at Area E12 Section H - L11 Steel flue liner at No. 4 Chimney Diagram A milestone Sum 15/9/19 Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated works at Area E14, E15 (A) and E15 (B) Section E3 - CA Support Foundation and Pipe Trench and associated works at Area E17 Sectio			•			
Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B) Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A) Section F - 275kV Station Building Extension and associated works at Area E12 Section G - A&A Works at No. 4 C.W. Intake at Area E12 Section H - L11 Steel flue liner at No. 4 Chimney Tue 30/6/20 Tue 30/6/20 Tue 30/6/20 Tue 30/6/20 Tue 30/6/20 Tue 30/6/20 Sun 15/9/19 Sun 15/9/19 Sun 15/9/19 Sociated works at Area E17 E12 Section H - L11 Steel flue liner at No. 4 Chimney Tue 30/6/20 Tue 30/6/20 Tue 30/6/20 Tue 30/6/20 Tue 30/6/20 Sun 15/9/19 Sun 15/9/19 Sun 15/9/19 Sociated works at Area E17 E12 Section H - L11 Steel flue liner at No. 4 Chimney Tue 30/6/20 Sun 15/9/19 Sun 15/9/19 Sun 31/5/20			o auys	1110 1777/20	1110 1 // // 20	<u> </u>
Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A) Section F - 275kV Station Building Extension and associated works at Area E17 Section G - A&A Works at No. 4 C.W. Intake at Area E12 Section H - L11 Steel flue liner at No. 4 Chimney O2 Master Prog Rev 3 Task Sun 15/9/19 Sun 15/9/1	I	Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated	0 days	Tue 30/6/20	Tue 30/6/20	Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B)
Section F - 275kV Station Building Extension and associated works at Area 0 days Sat 30/5/20 Sat 30/5/20 Section G - A&A Works at No. 4 C.W. Intake at Area E12 0 days Sun 31/5/20 Sun 31/5/20 Section H - L11 Steel flue liner at No. 4 Chimney 0 days Mon 15/7/19 Mon 15/7/19 Ough Master Prog Rev 3 Task Split Milestone ◆ Summary ■ Summary ■ Summary ■	2	Section E4 - 275kV cable trenching works connecting the 275kV Switching	0 days	Sun 15/9/19	Sun 15/9/19	
Section G - A&A Works at No. 4 C.W. Intake at Area E12 0 days Sun 31/5/20 Sun 31/5/20 I to 12 Section H - L11 Steel flue liner at No. 4 Chimney 0 days Mon 15/7/19 Mon 15/7/19 I to 12 002 Master Prog Rev 3 Task Split Milestone ◆ Summary ■	3	Section F - 275kV Station Building Extension and associated works at Area	0 days	Sat 30/5/20	Sat 30/5/20) sociated works at Area E17
Section H - L11 Steel flue liner at No. 4 Chimney 0 days Mon 15/7/19 Mon 15/7/19 Output Double Mon 15/7/19 Mon 15/7/19 Mon 15/7/19 Mon 15/7/19 Output Double Mon 15/7/19 Mon 15/7/19 Mon 15/7/19 Mon 15/7/19			0 days	Sup 21/5/20	Sup 21/5/20	0) E12
002 Master Prog Rev 3 Task Split Milestone ♦ Summary ■	5					
		Section II - L11 Steel flue liner at No. 4 Chilliney	o days	IVIOR 13/ //19	IVIOR 13/ // 19	7
	000	Mostor Prog Day 2 Teel (688888888888888888888	N.A.11 =	one A	C.	Imman/
Page 1 of 8	ōUU.	2 Iviasici Prog Kev 3 Task Split Split	Milesto	one 🛡	Sum	
						Page 1 of 8


act No. 17/8002 Lamma Power Station Extension Civil and Building Works	o ioi oiiit Li	•	17-000	Master Prog Rev 3 Refer to CEM dated 26Mar
ask Name	Duration	Start	Finish	July 2020 August 2020 September 2020
Section I - (i) 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (B)	0 days	Fri 15/5/20	Fri 15/5/20	July 2020 August 2020 September 2020 n Extension and L11 MSB at Area E9 (B)
Section I - (ii) Interconnector 2 Trench Modification Works at Area E10	0 days	Fri 15/5/20	Fri 15/5/20	
Section J - (i) Demolition of Retractable Cover A&B & (ii) Foundation of	0 days		Fri 30/4/21	
LMX Light Oil Storage Tank Nos. 3 & 4 and A&A for Existing Bund Wall at	_			
Section K1 - External works at Area 15 (E) and 15(F)	0 days	Mon 31/5/21	Mon 31/5/21	
Section K2 - Removal of Southern Bund and External Works at Area D5, D6 and D7	0 days	Mon 31/5/21	Mon 31/5/21	
Section K3 - All remaining works shall be completed for reporting completion to BD and ready for OP inspection	0 days	Thu 30/9/21	Thu 30/9/21	
General & Preliminary	318 days		Wed 24/4/19	
Set up Temporary Site Office and Utilities	90 days	Fri 1/6/18	Wed 29/8/18	
Permit Applications & Statuary Submissions	120 days	Thu 30/8/18	Thu 27/12/18	
Existing Utilities scanning & Excavation Permit	45 days		Thu 27/12/18	
Tower Crane erection 2@MSB, 1@ 275	50 days		Wed 24/4/19	
Submission and Approval	<u>554 days</u>		Mon 16/12/19	
Method Statement / Temp Work Submission & Approval from HEC for General Works	240 days	Fri 1/6/18	Sat 26/1/19	
BD Approval & Consent (If required)	120 days		Fri 28/9/18	
BIM Model, CSD & CBWD Submission & Approval from HEC	200 days		Fri 26/4/19	
Structure Steelwork Connection Design Submission & BD Approval	60 days		Tue 27/11/18	
Structure Steelwork Shop Drawing & Approval	60 days		Tue 11/12/18	
Metal Cladding, louvre & windows submission & BD Approval	60 days	Wed 28/11/18		
Metal Cladding, louvre & windows shop drawing submission	60 days	Wed 12/12/18		
Order, Off Site Fabrication and Delivery (S. Steel & Cladding & louvres)	180 days	Sat 27/10/18		
Retractable Cover D BD Submission & Approval	90 days		Mon 20/5/19	
No. 4 C.W. Outfall A&A BD 1st Submission	90 days		Tue 27/11/18	
Sumission & Approval of Steel Flue Assessment Report and Design Drawings Submission and Approval of Steel Flue Design from BD	60 days		Wed 28/11/18 Wed 28/11/18	
Material Fabrication & Delivery for L11 Flue		Mon 15/10/18		
Folding Shutters Shop Drawing Submission & Approval	120 days		Wed 19/6/19	
Fabrication & Delivery of Folding Shutters	150 days		Sat 16/11/19	
Sewage Pump System Design submission & approval	90 days		Wed 19/6/19	
Fabrication & Delivery of Sewage Pump	180 days		Mon 16/12/19	
Other material submission & approval & delivery	300 days	Thu 30/8/18		
Coordination with the Employer's Specialist Contractors	478 days	Mon 20/5/19	Sat 19/9/20	□ 19 S
Installation of Puddle Pipes at C.W. outlet Culvert	7 days	Mon 20/5/19	Sun 26/5/19	
Installation of Puddle Pipes at C.W. Inlet Culvert	7 days		Sat 13/7/19	
Template setting at L11 Turbo Block Foundation	60 days		Mon 9/3/20	
Template setting of holding down bolts at HRSG column base	46 days	Tue 23/7/19		
I-beam / channel base installation on top of transformer foundations at Transformer Area	30 days		Sat 16/5/20	mer Area
Overhead crane erection at turbine hall using access through a temporary opening at L11 MSB roof between GL11-G to 11-H and 11-2 to 11-6	36 days		Tue 7/1/20	
Condenser assembly and erection using access through a temporary façade opening at L11 MSB below 1/F along GL 11-6 from GL11-B to 11-C including a clear space below 1/F between GL 11-B to 11-C	127 days	Sun 1/3/20	Sun 5/7/20	Condenser assembly and erection using access through a temporary façade opening at L11 MSB below 1/F along GL 11-6 from GL11-B to
Installation of power train equipment including air inlet duct using access through a temporary façade opening at L11 MSB below 1/F along GL 11-6 from GL11-F to 11-H including a clear space below 1/F of the above area	142 days	Fri 1/5/20	Sat 19/9/20	- Insta
Installation of embedded materials such as holding down bolts for equipment foundations - Commencement	30 days		Mon 22/7/19	
Section A1 & A2 - Ground treatment at Zone 1A & 1B	92 days		Wed 31/10/18	
Plant establishment for earthworks	7 days		Tue 7/8/18	
Backfilling and compaction from existing ground +4.5mPD to +5.5mPD	45 days		Fri 21/9/18	
Delivery of band drain Plant outsblishment for hand drain (1st rig)	5 days		Sun 2/9/18 Wed 12/9/18	
Plant establishment for band drain (1st rig) Plant establishment for band drain (2nd rig)	10 days		Wed 12/9/18 Wed 26/9/18	
Plant establishment for band drain (2nd rig) Plant establishment for band drain (3rd rig)	7 days 7 days		Wed 26/9/18 Wed 17/10/18	
1 iant establishment for band drain (51d fig)	/ uays	111u 11/10/18	5 WEU 1//10/18	
2 Master Prog Rev 3 Task Split Split				
2 Master Prog Rev 3 Task Split Split Task Split Task Split Task Task Task Task Split Task Tas	Milest	one 👄	Sum	ary 🔻

ontract No. 17/8002 Lamma Power Station Extension Civil and Building Works fo				17-8002 M	J Nev 3	Refer to CEM dated	20 1VI a
[Task Name	Duration	Start	Finish	July 2020	August 2020 September	r 2020
İ	Vert. Band drain installation (1023 nos. x 44m)	45 days	Thu 13/9/18	Sat 27/10/18	July 2020	August 2020 Suprember	2020
	Deposition of surcharge up to +8.3mPD	45 days		Wed 31/10/18			
	Section A3 - Ground treatment installation works at Zone 2		Mon 1/10/18				
	Backfilling and compaction from existing ground +4.5mPD to +5.5mPD	30 days		Tue 30/10/18			
	Delivery of band drain	6 days		Tue 23/10/18			
	Vert. Band drain installation (1787 nos. x 44m)	50 days		8 Wed 12/12/18			
	Deposition of surcharge up to +8.3mPD	60 days		Thu 31/1/19			
	Additional Concrete Blocks + Extra Surcharge	60 days		Sun 17/3/19			
	Section A4 - Ground treatment installation works at Zone 3	131 days		Thu 21/3/19			
	Backfilling and compaction from existing ground +4.5mPD to +5.5mPD	12 days		Mon 12/11/18			
	Vert. Band drain installation	60 days		Mon 7/1/19			
	Deposition of surcharge up to +8.3mPD Possession of Part 1 Defer portion at Zone 3	45 days 0 days	Tue 18/12/18	Wed 20/2/19			
	Vert. Band drain installation	10 days	Wed 20/2/19				
l	Possession of Part 2 Defer portion at Zone 3	0 days	Fri 1/3/19	Fri 1/3/19			
	Vert. Band drain installation	7 days	Fri 1/3/19	Thu 7/3/19			
	Surcharge at deferred portion	14 days	Fri 8/3/19	Thu 21/3/19			
	Section A5 (i) - Ground treatment installation works at Zone 4	83 days		8 Thu 28/3/19			
	Site Preparation for Vertical Band Drain	3 days		Thu 3/1/19			
-	Band drain installation	21 days	Wed 26/12/13				
+	Possession of Defer portion at Zone 4 Vert. Band drain installation	0 days 28 days	Fri 1/3/19 Fri 1/3/19	Fri 1/3/19 Thu 28/3/19			
t	Section A5 (ii) - Surcharge works at Zone 4	30 days		Wed 30/9/20		1 Sep '20	
Ī	Deposition of surcharge up to +8.3mPD	30 days		Wed 30/9/20			
	Section A6 (i) - A&A Works for No. 4 C.W. Outfall at Area E18	493 days		Sat 28/3/20			
T	BD Amendment, resubmission & approval for Jacking Pit	170 days		Mon 29/4/19			
t	Consent for Jacking Pit ELS	28 days	Sat 20/4/19	Fri 17/5/19			
1	Mobilization	0 days		Sat 15/12/18			
	Jacking Pit Sheetpile Installation (incl. Stop work notice + CNY)	60 days	Sun 16/12/18	Sat 23/2/19			
	Protective screen and preventive measure for U9 gas pipeline (VO)	28 days	Sun 24/2/19				
4	Provision of temp support for U10 gas pipeline (VO) upon RMA allow access	28 days	Sun 14/4/19				
+	ELS of jacking pit	30 days		Sun 16/6/19			
+	Pipe Jacking set up & ground strengthing	18 days		Thu 4/7/19			
+	Pipe Jacking	90 days		Sun 8/12/19			
+	Receiving Pit BD Approval Consent for Pipe & Sheet pile	170 days 28 days	Tue 14/5/19	Thu 23/5/19 Mon 10/6/19			
+	Receiving Pit Pipe & Sheet pile installation	30 days		Wed 10/7/19			
†	Consent for Receiving Pit ELS	28 days	Thu 4/7/19	Wed 31/7/19			
	ELS of Receiving pit	40 days	Thu 1/8/19	Mon 9/9/19			
	Allow modify existing outfall manhole for pipe jacking receiving	18 days	Tue 10/9/19	Fri 27/9/19			
	Culvert Pipe Intallation & water test	55 days	Mon 9/12/19	Wed 12/2/20			
Ī	Inspection Manhole at Jacking Pit + backfill (Area E3(A))	18 days	Thu 13/2/20	Sun 1/3/20			
	Manhole extension at Outfall no. 4 + backfill + Reinstate of Outfall Rd	45 days	Thu 13/2/20	Sat 28/3/20			
	Sheetpile for L12 Outlet culvert (Connection to Jacking Pit)	45 days		Wed 28/8/19			
1	Consent + ELS for remaining jacking pit	75 days		Mon 11/11/19			
ŀ	Outlet Culvert pipe installation + Thrust Box (remaining portion at A1 Area)	45 days		Sat 28/12/19			
	Sheet pile for future extension along GRS	60 days		Sun 27/10/19			
	Section A6 (ii) - External works at Area E15(D)	37 days		Sat 15/2/20			
1	Arae possession & Clearance	6 days		Mon 6/1/20			
+	Road & Surface Works	31 days		Sat 15/2/20			
	Section B1 (i) - Area south of L11 MSB and HRSG from GL11-F eastwards leading to Chimney Road at Area E1 & E2	375 days	1 nu 31/1/19	Sun 1/3/20			
-	Area Possession & Clearance	O darra	Thu 21/1/10	Thu 31/1/19			
+		0 days					
+	Excavation for CW Inlet Culvert (South of L11 HRSG)	21 days		Mon 6/5/19			
+	Installation CW Inlet Culvert pipe Construction of Thrust Box & Manholes,etc	30 days		Wed 5/6/19			
+	· · · · · · · · · · · · · · · · · · ·	14 days		Wed 19/6/19			
+	Backfill	21 days		Wed 10/7/19			
+	Install underground utilities Postell and Town course for Condenses Move in (E1)	45 days		Wed 13/11/19			
+	Backfill and Temporary paving for Condensor Move in (E1)	14 days	Mon 17/2/20				
+	Backfill and Temporary paving for Condensor Move in (others)	30 days		Sun 1/3/20			
	Section B1 (ii) - Supporting structures for overhead cranes of L11 MSB	482 days	1 nu 1/11/18	Tue 17/3/20			
+	Area passession & Clearance	O darra	The 1/11/10	Thu 1/11/10			
L	Area possession & Clearance	0 days	1 nu 1/11/18	Thu 1/11/18			

ontract No. 17/8002 Lamma Power Station Extension Civil and Building Works for			17-8002 Master Prog Rev 3			Refer to CEM dated		
ask Name		Start	Finish July 2020			August 2020	Septe	
Backfill and Construction ground beams & trenches	18 days	Sun 28/7/19	Wed 14/8/19			•		
	•							
		Fri 7/2/20	Sun 1/3/20					
HRSG in addition to the southern & eastern areas mentioned above in Area E5	414 days	Thu 1/11/18	Tue 31/12/19					
	1.4 days	Thu 1/11/10	Wod 14/11/19					
	•							
	•							
	<u>375 days</u>	Thu 31/1/19	Sun 1/3/20					
Area Possession & Clearance	0 days							
Excavation & Pits & Pile Caps & Tie Beams (HRSG north Area E6)	45 days	Thu 4/4/19	Sat 18/5/19					
Construction RC foundations	45 days							
1								
				c.D(iii)				
south façade of L11 MSB with all underground utilities at Area E4 including	<u>320 days</u>	<u>1110 1/11/10</u>	1110 30/4/20					
	0 days	Thu 1/11/18	Thu 1/11/18					
	•							
• ,								
	•							
• '								
	150 days							
Construction 1/F RC Slab	14 days	Mon 30/9/19	Sun 13/10/19					
Construction M/F RC Slab	7 days	Mon 14/10/19	Sun 20/10/19					
Construction 2/F RC Slab	14 days	Mon 14/10/19	Sun 27/10/19					
Construction 3/F RC Slab	•			1 :				
Construction 4/F RC Slab								
	-							
	60 days							
ABFW Works from 1/F to 5/F equipment rooms								
Metal Cladding, Windows and Louvres incl. roof feature								
				c D(iv)				
<u></u>					I.			
Master Prog Rev 3 Task Split Split	Milest			mary $lacksquare$				
	Backfill and Construction ground beams & trenches Construction of indoor underground drainage Backfill & construction on-grade slabs Construction Column casting and RC walls Metal Cladding & Louvres for GLB-C/1-6 Mis. Works for plant erection Section D - (ii) Roads and external grounds surrounding L11 MSB and L11 HRSG in addition to the southern & eastern areas mentioned above in Area E5 and E6 Area Possession & Clearance Excavation for Type C1 and open sheet pile Install CW Outlet pipe & connect to prevous Backfill Undeground utilities and trenches Construction of plant drainage, trenches & RC plinths Remaining Undeground utilities & backfill (West of Tx Bay) Section D - (ii) Remaining northern part of L11 HRSG area and its surrounding in Area E6 Area Possession & Clearance Excavation & Pits & Pile Caps & Tie Beams (HRSG north Area E6) Construction RC foundations Construction RC plinths & HRSG Lift Pit & internal drainage Backfill Construction on-grade slabs Construction underground utilities Backfill, Remaining utilities and temporary paving Touch up and site elearance Section D - (iii) Whole of L11 MSB including the pipe and cable rack along south facade of L11 MSB with all underground utilities at Area E4 including C.W. Inlet and Outlet Culvert except the deferred works Area Possession & Clearance Construction of pile caps & tie beams at Transformer Area Excavation & Construction Blow Down Sum pit (Type B) Construction of pile caps & tie beams at SunShadeCover Area Preaparation for S. Steelwork Erection Structural Delivery & Erection (Turhine Hall North fr G.L. 1-3/H->B) Structural Delivery & Erection (Turhine Hall North fr G.L. 1-3/H->B) Structural Delivery & Erection (Turhine Hall South) Fire Coating Application at Joint External Scaffolding Erection Construction JF RC Slab Construction FR C Slab Const	Backfill and Construction ground beams & trenches Construction of indoor underground drainage Backfill & construction on-grade slabs Construction Column casting and RC walls Metal Cladding & Louvres for GLB-C/I-6 Mis. Works for plant ferection 24 days Section D - (i) Roads and external grounds surrounding L11 MSB and L11 HRSG in addition to the southern & eastern areas mentioned above in Area ES and E6 Area Possession & Clearance Eacavation for Type C1 and open sheet pile Install CW Outlet pipe & connect to prevous Backfill Undeground utilities and trenches Construction of plant drainage, trenches & RC plinths Remaining Undeground utilities & backfill (West of Tx Bay) Section D - (ii) Remaining northern part of L11 HRSG area and its surrounding in Area E6 Area Possession & Clearance Excavation & Pits & Pile Caps & Tie Beams (HRSG north Area E6) Area Possession & Clearance Excavation & Pits & Pile Caps & Tie Beams (HRSG north Area E6) Area Possession & Fleatance Excavation RC plinths & HRSG Lift Pit & internal drainage Backfill Construction on-grade slabs Construction RC plinths & HRSG Lift Pit & internal drainage Backfill Construction on-grade slabs Construction of pile caps & tie beams at Transformer Area 60 days Backfill, Remaining utilities and temporary paving Touch up and site clearance Section D - (iii) Whole of L11 MSB including the pipe and cable rack along south facade of L11 MSB with all underground utilities at Area F4 including Structural Delivery & Erection (Equipment Floors) Structural Delivery & Erection (Eq	Backfill and Construction ground beams & trenches Construction of indoor underground drainage 12 days Backfill & construction of grandes albs Construction Column casting and RC walls Metal Cladding & Louvers for Gil-B-C/1-6 Meta Works for plant erection Section D-Gil Roads and external grounds surrounding L11 MSB and L11 HRSG in addition to the southern & eastern areas mentioned above in Area E5 and E6 Area Possession & Clearance 14 days Thu 1/11/18 HRSG in addition to the southern & eastern areas mentioned above in Area E5 and E6 Area Possession & Clearance 14 days Thu 1/11/18 Backfill & coulted pipe & connect to prevous 10 days Touground utilities and trenches Construction of plant drainage, trenches & RC plinths Remaining Undeground utilities & backfill (West of Tx Bay) Section D-Gil Remaining northern part of L11 HRSG area and its surrounding in Area E6 Area Possession & Clearance 10 days Thu 3/11/19 Area Possession & Clearance 10 days Thu 3/11/19 Thu 4/11/19 Thu 4/11/1	Backfill and Construction ground beams & trenches	Backfill and Construction ground beams & trenches 18 days Sun 287/19 Wed 14/8/19	Backfill and Construction ground beams & trenches 18 day 12 day 18	Security 100	

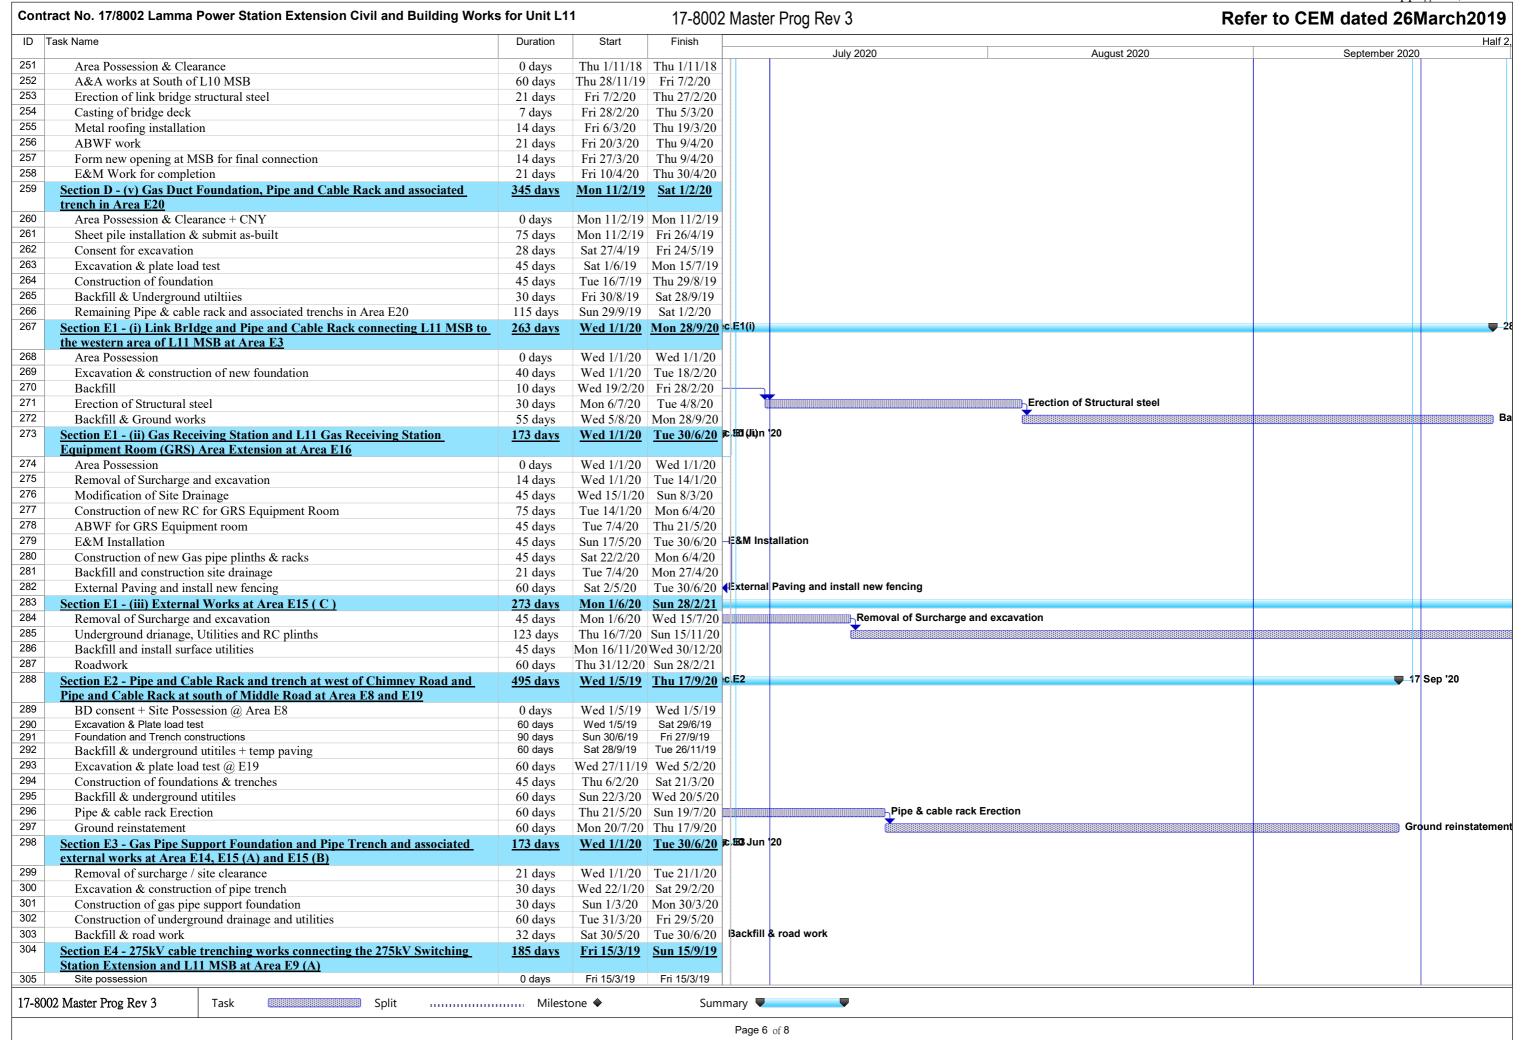

_ `	ct No. 17/8002 Lamma Power Station Extension Civil and Building Works		17 0002 Maddol 1 10g 100 0				
Ta	sk Name	Duration	Start	Finish			
	Obtain Permit to work & Road close permit	10 days	Fri 15/3/19	Sun 24/3/19			
	Excavation & construction new cable trench to 275kV	45 days	Mon 25/3/19	Wed 8/5/19			
E	xcavation & construction new cable trench to L11MSB	130 days	Thu 9/5/19	Sun 15/9/19			
Sec	tion F - 275kV Station Building Extension and associated works at Area E17	709 days	Fri 1/6/18	Sat 30/5/20			
	Installation of ELS for 275kV Switching Station near Staircase ST-3 and ST-6	14 days	Fri 1/6/18	Thu 14/6/18			
	Construction of Staircase ST-3	110 days	Fri 15/6/18	Tue 2/10/18			
	BD Amendment Approval on A&A	0 days		Mon 17/12/18			
	BD Amendment Approval on A&A ST3 & Drainage	0 days	Mon 4/2/19	Mon 4/2/19			
	OP inspection of Staircase ST-3 Consent of New Foundation Works (Stage 1)	14 days 0 days	Mon 11/2/19 Fri 19/10/18	Sun 24/2/19 Fri 19/10/18			
	Consent & BA10 for Demolition of Existing Staircase	0 days	Fri 8/3/19	Fri 8/3/19			
	Demolition of Exisiting Staircase and Submit BA14A	14 days	Sat 9/3/19	Fri 22/3/19			
	BD inspection for BA14A & Issue OP	28 days	Sat 23/3/19	Fri 19/4/19			
	Consent & BA10 for New Foundation Work (Stage 2)	28 days	Sat 13/4/19	Fri 10/5/19			
	Hoarding Modification	7 days	Fri 19/10/18	Thu 25/10/18			
	Pile Cap & Tie Beam Construction (Stage 1) Erection of Tower Crane	98 days 40 days	Fri 26/10/18 Mon 11/2/19	Thu 31/1/19 Fri 22/3/19			
	Pile Cap and Tie Beam (Stage 2)	21 days	Sat 11/5/19	Fri 31/5/19			
	RC Construction up to 1/F (Stage 1)	30 days	Sat 11/5/19	Sun 9/6/19			
	RC Construction up to 1/F (Stage 2)	75 days	Sat 1/6/19	Wed 14/8/19			
	Construction of Staircase ST6	90 days	Sun 15/9/19	Fri 13/12/19			
	Shop Drawing Submission & Approval of Structural Steel	45 days	Wed 27/2/19	Fri 12/4/19			
	Structural Steel fabrication & Delivery Erection of Structural Steel GL 17~18	60 days	Sat 13/4/19	Tue 11/6/19			
	Erection of Structural Steel GL 17~18 Erection of Structural Steel GL 8~17	30 days 60 days	Fri 16/8/19 Sun 15/9/19	Sat 14/9/19 Wed 13/11/19			
	Metal Cladding Delivery	60 days	Wed 7/8/19	Sat 5/10/19			
	Metal Door, Window & Lourve Delivery	45 days	Sun 6/10/19	Tue 19/11/19			
	Erection of Working Platform and Scaffold	150 days		Wed 27/11/19			
	Install Decking	60 days	Wed 9/10/19	Sat 7/12/19			
	RC Walls from 1/F @ GIS Hall	40 days	Thu 31/10/19				
	Construction of 2/F RC slab Construction of R/F RC slab	14 days 21 days	Tue 10/12/19 Tue 24/12/19	Mon 23/12/19 Wed 15/1/20			
	Construction of UR/F RC slab	14 days	Thu 16/1/20	Fri 7/2/20			
	Construction of GIS Hall Floor	60 days	Tue 24/12/19	Tue 3/3/20			
	Installation of Overhead Crane (By JEC)	60 days	Wed 4/3/20	Sat 2/5/20			
	Construction of staircase ST4, ST5, Lift Shaft & Equip Floors	150 days	Sun 15/9/19	Sat 22/2/20			
	Lift Installation	90 days	Sun 23/2/20	Fri 22/5/20			
	Concrete of RC walls, plinths, kerb & parapet walls & New trench for LV Power	30 days	Tue 24/12/19	Sun 2/2/20			
	ABWF Works @ G/F ABWF Works @ 1/F	50 days 50 days	Mon 14/10/19 Wed 13/11/19				
	ABWF Works @ 2/F	75 days	Fri 13/12/19				
	ABWF Works @ R/F	30 days	Tue 14/1/20	Fri 21/2/20			
	ABWF Works @ UR/F	21 days	Mon 3/2/20	Sun 23/2/20			
	Waterproofing Works at R/F & UR/F	45 days	Thu 16/1/20	Mon 9/3/20			
	Building Services E&M Access & Installation & T&C	150 days	Wed 13/11/19				
	Metal Cladding, Windows and Louvres incl. Roof Feature Shutter Erection	90 days 30 days	Tue 24/12/19 Fri 3/4/20	Thu 2/4/20 Sat 2/5/20			
	Removal of External Scaffolding + Tower Crane	35 days	Fri 3/4/20	Thu 7/5/20			
	External Underground Drainage and Utilities	30 days	Fri 17/4/20	Sat 16/5/20			
	Road & Paving Reinstatement	30 days	Fri 1/5/20	Sat 30/5/20			
	Ready for FSD & OP Inspection	0 days	Sat 30/5/20				
	Section G - A&A Works at No. 4 C.W. Intake at Area E12	143 days		Sun 31/5/20			
	Permit to work	0 days		Wed 1/1/20			
	Erection of temp. platform	14 days	Wed 1/1/20	Tue 14/1/20			
	Demolition work	30 days	Wed 15/1/20	Sat 22/2/20			
	Modify existing slab openings	75 days	Sun 23/2/20				
	Curing + Removal of platform	24 days		Sun 31/5/20			
	Section H - L11 Steel flue liner at No. 4 Chimney	186 days		Mon 15/7/19			
	Complete erection of L10 Steel flue	0 days		Tue 1/1/19			
	Modification of erection equipment	21 days		Mon 21/1/19			
	Erection temp. platform and demolition work	30 days	Tue 22/1/19				
	Structural steel delivery & Erection	85 days		Sun 26/5/19			
	Removal of temp. work	5 days	Mon 27/5/19				
	Reinstate G/F louvre wall and access door	45 days		Mon 15/7/19			
	Section I - (i) 275kV cable trenching works connecting the 275kV Switching	232 days	Sun 15/9/19	<u>Fri 15/5/20</u>			
	Station Extension and L11 MSB at Area E9 (B)						
	Obtain Permit to work & Road close permit	0 days		Sun 15/9/19			
_	Excavation & construction new cable trench	160 days	Mon 16/9/19	Wed 4/3/20			
_	Master Prog Rev 3 Task Split Split						
	er Prog Rev 3 Task Split Split	Milest		Sum			

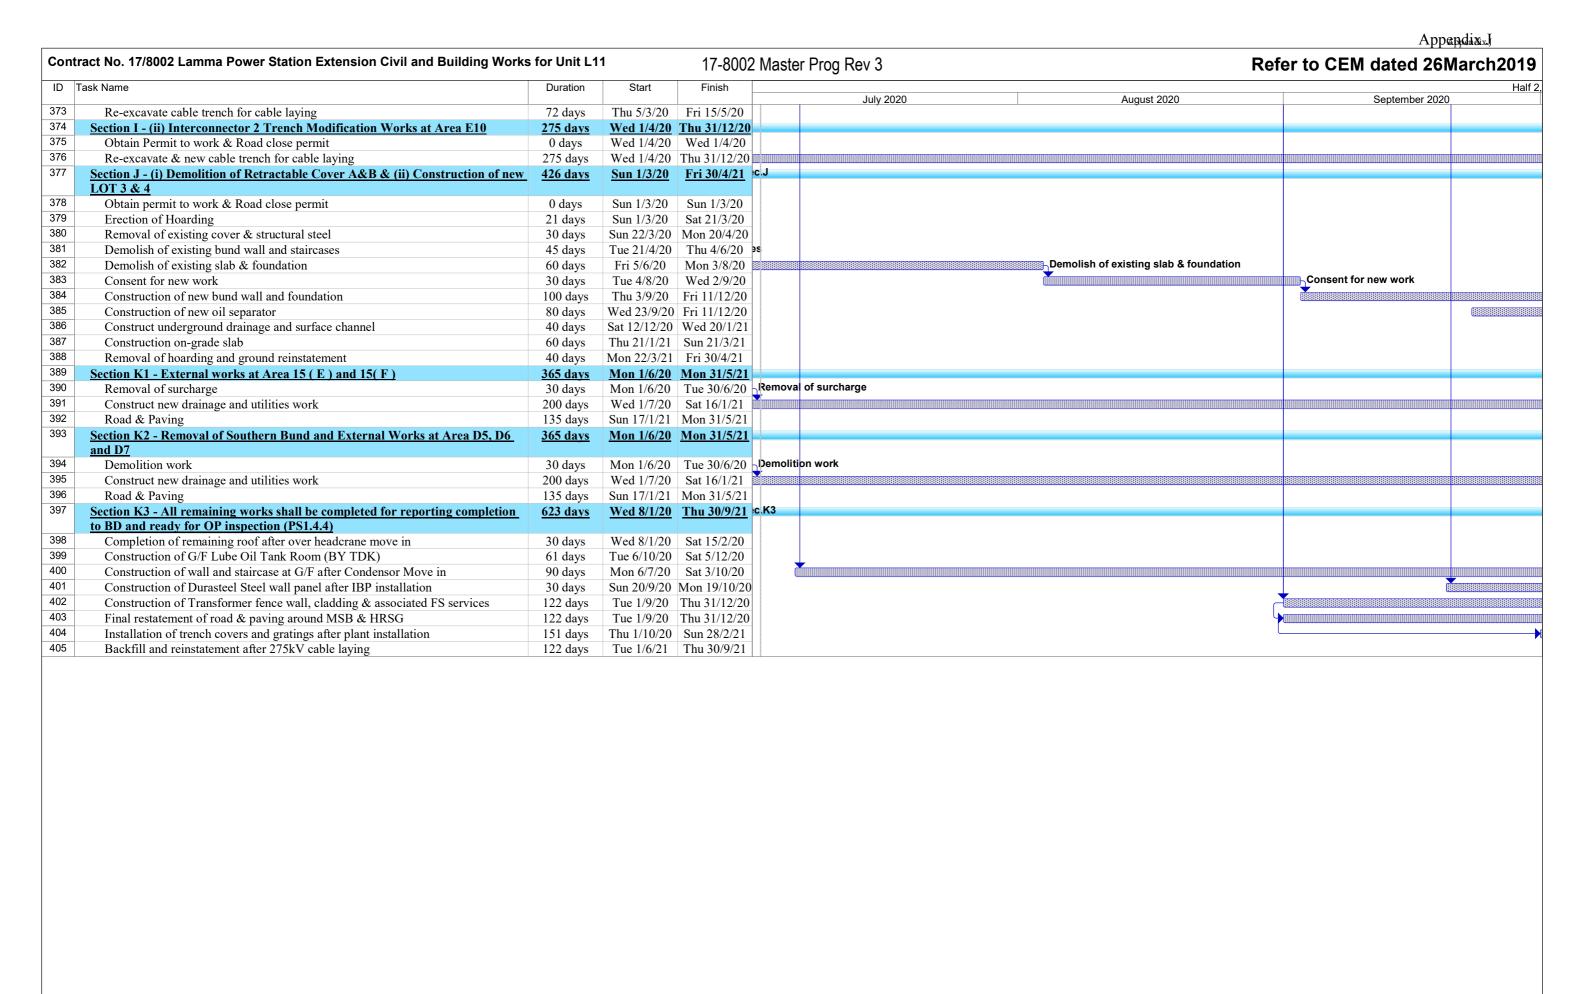

ID .		93.98		
	0			
ī	0	Koy Date		
2	=	H/O HRSG Foundation		
3	m	H/O OHC Installation		
4	103	H/O Condenser foundation		
5		H/O Aux, equipment foundation of HRSG no		
:6	f	H/O HRSG Exhaust duct		
3	1	H/O GT Exhaust duct foundation		
	⊞.	H/O MSB building		
9		H/O Foundation around CCW-Cooler		
10	<u> </u>	Hydrostatic test		
11	=	Receiving Lube oil		
ſŹ	Title 1	Synchronization		
13				
14		HRSG		
75				
76		HRSG Exhaust duct		
18				
92		Over Head Crene		
102				
103		Condenser		
128				
129		GT/ST/Generator		
161				
162		GT Air inlet		
175				
176		Auxiliary Equipment (O/B)		
247				
248		Sea water intake area		
260				
281		Tranceformer area		
269		Building structure		
276				
277		Piping		
285				
286		Crane		
304				
305		Equipment for heavy lifting		

AppendixxJ

	1 2020 STR 1 2020 STR 1 ESTR STR	[月] 2020年09月 第上旬中旬下旬
▶ 07/01		
	_	-
	1	

SUNLEY ENGINEERING & CONSTRUCTION CO., LTD.

Contract No. 18/8004 - Lamma Power Station Extension Foundation Works for Unit L12

Master Programme (Rev.1)

			1	Aaster Progr
ID	Task Name	Duration	Start	Finish
1	Key Date	542 days	Feb 1 '19	Jul 26 '20
2	Commencement date	542 days	Feb 1 '19	Jul 26 '20
3	Softwell Collection and	0.2 00/0		00.20.20
4	Total Contract Period	542 days	Feb 1 '19	Jul 26 '20
5			1.5.5.1.1.1.5.	
6	Preliminaries	21 days	Feb 1 '19	Feb 21 '19
7	Coordination with utility companies	14 days	Feb 1 '19	Feb 14 '19
8	Pre-construction condition survey	14 days	Feb 1 '19	Feb 14 '19
9	Notification of commencement of works to Labour Department	7 days	Feb 1 '19	Feb 7 '19
10	Notification of air pollution control for commencement of works to EPD	7 days	Feb 1 '19	Feb 7 '19
11	Application of water discharge licence from EPD	7 days	Feb 1 '19	Feb 7 '19
12	Application for billing account for disposal of construction waste from EPD	7 days	Feb 1 '19	Feb 7 '19
13	CCTV for existing underground drainage pipe around site boundary	21 days	Feb 1 '19	Feb 21 '19
14	Utility detection for existing underground cables	21 days	Feb 1 '19	Feb 21 '19
15	Site clearance	21 days	Feb 1 '19	Feb 21 '19
16	Set up contractor's site office	21 days	Feb 1 '19	Feb 21 '19
17	Installation of monitoring checkpoints	20 days	Feb 1 '19	Feb 20 '19
18	Submission of BA10 for ELS & foundation works	7 days	Feb 1 '19	Feb 7 '19
19	Cubinission of Brito to EEO a loandation works	, adjo		
20	Predrilling Works for Section of A1 to A3 (Area P1 to P3)	96 days	Feb 1 '19	May 7 '19
21	Drilling rigs mobilization	10 days	Feb 1 '19	Feb 10 '19
22	Predrilling works (46 holes) (8 rigs)	81 days	Feb 11 '19	May 2 '19
23	Submission of predrill logs	71 days	Feb 26 '19	May 7 '19
24	Completion of predrilling works	0 days	May 7 '19	May 7 '19
25	Completion of preaming works	o dayo	may	
26	Plant Mobilization for Bored Pile Construction	151 days	Mar 18 '19	Aug 15 '19
27	Crawler Crane	137 days	Mar 18 '19	Aug 1 '19
28	1st & 2nd set	21 days	Mar 18 '19	Apr 7 '19
29	3rd set	21 days	Apr 1 '19	Apr 21 '19
		21 days	Jun 14 '19	Jul 4 '19
30	4th & 5th set	440,000,000	Jul 12 '19	
31	6th set	21 days		Aug 1 '19
32	Oscillator	137 days	Mar 18 '19	Aug 1 '19
33	1st & 2nd set	21 days	Mar 18 '19	Apr 7 '19
34	3rd set	21 days	Apr 1 '19	Apr 21 '19
35	4th & 5th set	21 days 21 days	Jun 14 '19 Jul 12 '19	Jul 4 '19 Aug 1 '19
36	6th set			
37	RCD	130 days	Apr 8 '19	Aug 15 '19
38	1st & 2nd set	14 days	Apr 8 '19	Apr 21 '19
39	3rd set	14 days	Apr 22 '19	May 5 '19
40	4th & 5th set	14 days	Jul 5 '19	Jul 18 '19
41	6th set	14 days	Aug 2 '19	Aug 15 '19
42	Completion of plant mobilization for bored pile construction	0 days	Aug 15 '19	Aug 15 '19
43				
44	Delivery of Temporary Steel Casing for Bored Pile Construction	151 days	Mar 18 '19	Aug 15 '19
45	Duration for delivery of temporary steel casing	151 days	Mar 18 '19	Aug 15 '19
46	Completion of delivery of temporary steel casing for bored pile construction	0 days	Aug 15 '19	Aug 15 '19
47				12
48	Delivery of Permanent Casing & Double Wall Liner	369 days	Mar 18 '19	Mar 20 '20
	Testing for double wall liner	45 days	Mar 18 '19	May 1 '19
49	Duration for delivery of permanent casing & double wall liner	325 days	May 1 '19	Mar 20 '20
49 50 51				

Page 1

SUNLEY ENGINEERING & CONSTRUCTION CO., LTD.

Contract No. 18/8004 - Lamma Power Station Extension Foundation Works for Unit L12

Master Programme (Rev.1)

D Task Name	Duration	Start	Finish	2019	
	<u> </u>				
2 Section A1	320 days	Mar 18 '19	Jan 31 '20		
Bored Pile Construction at P1 (17 piles)	299 days	Apr 8 '19	Jan 31 '20		
1st set plant - BP1 > BP5 > BP9 > BP26 > BP13 > BP12 > BP8 > BP4 > G2 > G4 > G6	273 days	Apr 8 '19	Jan 5 '20		
5 3rd set plant - G8	45 days	Apr 22 '19	Jun 5 '19		
6 3rd set plant - BPC3 > BPC4 > BPC5 > BPC6 > BPC7	135 days	Aug 30 '19	Jan 11 '20		
7 Interface & sonic test	28 days	Jan 4 '20	Jan 31 '20		
8 Completion of bored pile construction at P1	0 days	Jan 31 '20	Jan 31 '20		
9					
O Sheet Pile at P1	215 days	Jul 1 '19	Jan 31 '20		
1 Delivery of sheet pile material	14 days	Jul 1 '19	Jul 14 '19		
2 Installation of sheet pile (approx. 57 piles) (1 rig)	10 days	Jul 17 '19	Jul 26 '19		
Installation of sheet pile (approx. 254 piles) (1 rig)	38 days	Dec 17 '19	Jan 23 '20		
Prepare & submit as-built record plan	7 days	Jan 24 '20	Jan 30 '20		
5 Submission of BA14	1 day	Jan 31 '20	Jan 31 '20		
6 Completion of sheet pile at P1	0 days	Jan 31 '20	Jan 31 '20		
7					
8 Cone Penetration Test	104 days	Mar 18 '19	Jun 29 '19		
9 Plant mobilization	14 days	Mar 18 '19	Mar 31 '19		
0 Carry out CPTU testing (9 nos.) (1 rig)	90 days	Apr 1 '19	Jun 29 '19		
1 Completion of cone penetration test	0 days	Jun 29 '19	Jun 29 '19		
2 Completion of section A1	0 days	Jan 31 '20	Jan 31 '20		
2 Completion of Section A1	o days	Jan 51 20	Jan 31 20		
4 Section A2	197 days	Apr 8 '19	Oct 21 '19		
		Apr 8 '19	Oct 21 '19		
Bored Pile Construction at P2 (11 piles)	197 days				
6 2nd set plant - BP23 > BP24 > BP27 > BP16 > BP20 > BP17	158 days	Apr 8 '19	Sep 12 '19		
7 3rd set plant - G10 > BP21 > BPC8 > BPC1 > BPC2	135 days	May 12 '19	Sep 23 '19		
8 Interface & sonic test	28 days	Sep 24 '19	Oct 21 '19		
9 Completion of bored pile construction at P2	0 days	Oct 21 '19	Oct 21 '19		
0 Completion of section A2	0 days	Oct 21 '19	Oct 21 '19		
1					
2 Section A3	386 days	May 18 '19	Jun 6 '20		
Bored Pile Construction at P3 (18 piles)	338 days	Jul 5 '19	Jun 6 '20		
4th set plant - G1 > G3 > G5 > G7 > G9	225 days	Jul 5 '19	Feb 14 '20		
5 5th set plant - BP15 > BP19 > BP22 > BP25 > BP3	285 days	Jul 5 '19	Apr 14 '20		
6 6th set plant - BP28 > BP6 > BP7 > BP11 > BP2 > BP18 > BP14 > BP10	264 days	Aug 2 '19	Apr 21 '20		
7 Interface & sonic test	14 days	Apr 22 '20	May 5 '20		
8 Prepare & submit as-built record plan	14 days	May 6 '20	May 19 '20		
9 Submission of BA14	1 day	May 13 '20	May 13 '20		
Allow 14 days for selection of pile for concrete full core test	14 days	May 14 '20	May 27 '20		
1 Concrete full core test	10 days	May 28 '20	Jun 6 '20		
2 Completion of bored pile construction at P3	0 days	Jun 6 '20	Jun 6 '20		
2 Completion of bored pile construction at P3	o days	30110 20	Juli 0 20		
	En douc	May 18 '19	Jul 16 '19		
4 Sheet Pile at P3	60 days				
5 Plant mobilization	7 days	May 25 '19	May 31 '19		
6 Delivery of sheet pile material	14 days	May 18 '19	May 31 '19		
7 Installation of sheet pile (approx. 626 piles) (2 rigs)	46 days	Jun 1 '19	Jul 16 '19		
8 Completion of sheet pile at P3	0 days	Jul 16 '19	Jul 16 '19		
9 Completion of section A3	0 days	Jun 6 '20	Jun 6 '20		
00					
Section B	265 days	Nov 5 '19	Jul 26 '20		
2 Shunt Reactor	144 days	Mar 2 '20	Jul 23 '20		

Master Programme 24 Mar 2020

SUNLEY ENGINEERING & CONSTRUCTION CO., LTD.

Contract No. 18/8004 - Lamma Power Station Extension Foundation Works for Unit L12

Master Programme (Rev.1)

Master Programme (Rev.1)								
ID	Task Name	Duration	Start	Finish	2010			
					2019			
103	Site possession date	0 days	Mar 2 '20	Mar 2 '20				
104	Plant mobilization	4 days	Mar 2 '20	Mar 5 '20				
105	Bored Pile Construction (4 piles)	140 days	Mar 6 '20	Jul 23 '20				
106	BP4>BP3>BP1>BP2	102 days	Mar 6 '20	Jun 15 '20				
107	Interface & sonic test	7 days	Jun 15 '20	Jun 21 '20				
108	Prepare & submit as-built record plan	16 days	Jun 22 '20	Jul 7 '20				
109	Submission of BA14	1 day	Jul 1 '20	Jul 1 '20				
110	Allow 14 days for selection of pile for concrete full core test	14 days	Jul 2 '20	Jul 15 '20				
111	Concrete full core test	8 days	Jul 16 '20	Jul 23 '20				
112	Completion of bored pile construction	0 days	Jul 23 '20	Jul 23 '20				
113	Completion of shunt reactor	0 days	Jul 23 '20	Jul 23 '20				
114								
115	Cable Bridge	265 days	Nov 5 '19	Jul 26 '20				
116	Site possession date	0 days	Nov 18 '19	Nov 18 '19				
117	Predrilling Works for Bored Pile	39 days	Nov 18 '19	Dec 26 '19				
118	Predrilling works (4 holes) (1 rig)	29 days	Nov 18 '19	Dec 16 '19				
119	Submission of predrill logs	10 days	Dec 17 '19	Dec 26 '19				
120	Completion of predrilling works	0 days	Dec 26 '19	Dec 26 '19				
121	Completion of predimining works	o days	00020 10	D00 20 10				
122	Bored Pile Construction (8 piles)	203 days	Nov 18 '19	Jun 7 '20				
123	CP6-7 > CP6-5 > CP6-6 > CP6-8 > CP6-2 > CP6-4 > CP6-1 > CP6-3 (1 set of plant)	155 days	Nov 18 '19	Apr 20 '20				
123	Interface & sonic test	12 days	Apr 21 '20	May 2 '20				
124	Prepare & submit as-built record plan	18 days	May 3 '20	May 20 '20				
		-	May 14 '20	May 14 '20				
126	Submission of BA14	1 day						
127	Allow 14 days for selection of pile for concrete full core test	14 days	May 15 '20	May 28 '20				
128	Concrete full core test	10 days	May 29 '20	Jun 7 '20				
129	Completion of bored pile construction	0 days	Jun 7 '20	Jun 7 '20				
130								
131	Temporary Working Platform for Socketted H-Pile Construction	66 days	Nov 5 '19	Jan 9 '20				
132	Material delivery for temporary working platform erection	28 days	Nov 5 '19	Dec 2 '19				
133	Erection of temporary working platform	53 days	Nov 18 '19	Jan 9 '20				
134	Completion of temporary working platform	0 days	Jan 9 '20	Jan 9 '20				
135								
136	Socketted H-Pile Construction (14 piles)	199 days	Jan 10 '20	Jul 26 '20				
137	Trial pile installation (1 pile)	13 days	Jan 10 '20	Jan 22 '20				
138	Socketted H-pile installation (29 piles) (1 set plant)	77 days	Jan 23 '20	Apr 8 '20				
139	Post drill	14 days	Apr 9 '20	Apr 22 '20				
140	Prepare & submit as-built record plan	14 days	Apr 23 '20	May 6 '20				
141	Submission of BA14	1 day	Apr 30 '20	Apr 30 '20				
142	Allow 14 days for selection of pile for loading test	14 days	May 1 '20	May 14 '20				
143	Set up loading test platform for 1st pile testing	15 days	May 15 '20	May 29 '20				
144	Loading test for 1st pile	4 days	May 30 '20	Jun 2 '20				
145	Set up loading test platform for 2nd pile testing	15 days	Jun 3 '20	Jun 17 '20				
146	Loading test for 2nd pile	4 days	Jun 18 '20	Jun 21 '20				
147	Submission of the report	5 days	Jun 22 '20	Jun 26 '20				
148	Dismantle of the platform	30 days	Jun 27 '20	Jul 26 '20				
149	Completion of socketted H-pile construction	0 days	Jul 26 '20	Jul 26 '20				
150	Completion of cable bridge	0 days	Jul 26 '20	Jul 26 '20				
151	Completion of section B	0 days	Jul 26 '20	Jul 26 '20				
	Contract completion	0 days	Jul 26 '20	Jul 26 '20				

Master Programme 24 Mar 2020

Critical Task ||||||||||||| Milestone

Monthly Waste Flow Table for June 2020

Project: Lamma Power Station Extension - Civil and Building Works for Unit L11

Contractor: Paul Y. Construction Company, Limited

Record by: Ben Lam
Year of Record: 2018, 2019 & 2020

MM.YYYY		Ac	tual Quanti	ties of Inert C	C&D Materia	ls Generated	Monthly		Actual Q	uantities of N	Ion-inert C&I	O Materials	Generated	Monthly
	Exc	avated Mate	erials		Non-	excavated Ma	aterials							
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities	Metals (steel bar / metal strip) (1)	Metals (aluminum can) ⁽¹⁾	Paper / cardboard packaging (1)	Plastics	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000L)	(in '000kg)
Jul 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Aug 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Sep 2018	3160.23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Oct 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Nov 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.87
Dec 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	10.67
Jan 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Feb 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.66	0.00	0.00	0.00	0.60	0.00
Mar 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	19.05	0.00	0.00	0.00	0.00	0.00
Apr 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.08	0.00	0.00	0.00	0.00	19.09
May 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.63	0.00	0.00	0.00	0.00	59.75
Jun 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	14.64
Jul 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.66
Aug 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Sep 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	27.31
Oct 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.109	0.00	0.00	4.76
Nov 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.60	4.87
Dec 2019	0.00	0.00	0.00	0.00	0.00	10226.24	0.00	0.00	0.00	0.00	0.00	0.00	0.00	18.19
Jan 2020	0.00	0.00	0.00	0.00	0.00	7981.09	0.00	0.00	0.00	0.00	0.157	0.00	0.00	26.89
Feb 2020	0.00	0.00	0.00	0.00	0.00	8782.98	0.00	0.00	0.00	0.00	0.000	0.00	0.00	0.00
Mar 2020	0.00	0.00	0.00	0.00	0.00	20252.12	0.00	0.00	0.00	0.00	0.000	0.00	0.00	78.96
Apr 2020	0.00	0.00	0.00	0.00	0.00	12976.86	0.00	0.00	8.30	0.00	0.000	0.00	0.00	68.75
May 2020	0.00	0.00	0.00	0.00	0.00	20203.01	0.00	0.00	0.00	0.00	0.000	0.00	0.00	0.00
Jun 2020	0.00	0.00	0.00	0.00	0.00	28030.33	0.00	0.00	0.00	0.00	0.000	0.00	0.00	58.49
Total	3160.23	0.00	0.00	0.00	0.00	108452.61	0.00	0.00	43.72	0.00	0.266	0.00	1.20	403.90

Total Inert C&D Waste Materials	Non-inert C&D Materials						
Generated	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste				
111612.84 tonnes	43.99 tonnes	403.90 tonnes	1200 Liters				

Where (A) Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total, a were generated from the Project, of which a 108452.61 tonnes were reused in this and other contracts, and the remaining 3160.23 tonnes were disposed as public fill to Fill Banks / Sorting Facilities.

(b) Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse.

Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill.

(c)	0	kg of metals,	0	kg of papers/ cardboard packing and	0	kg of plastics were sent to recyclers
for recycling during the reporting period.					<u></u>	

(d) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.

Notes: (1) metal, paper & plastic were collected by recycler

- (2) The performance target of waste recycling are specified in the Contract.
- (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (4) Plastics refer to plastic bottles/ containers, plastic/ foam from packaging material.
- (5) Broken concrete for recycling into aggregates.
- (6) Disposal of inert waste to public fill or sorting facilities will NOT be considered as recycled waste.

Monthly Waste Flow Table for June 2020
Project: LAMMA POWER STATION EXTENSION – Unit 11 Complete Erection, Inspection, Testing & Commissioning of Power Block Facilities

Contractor: Taihei Dengyo Kaisha, Ltd.

Record by: Stephen Sin Year of Record: 2019, 2020

MM.YYYY		Actua	l Quantities	of Inert C&D	Materials G	Senerated M	lonthly		Actual Quantities of Non-inert C&D Materials Generated Monthly					
	Exc	avated Mate				xcavated M								
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities	Metals (steel bar / metal strip) (1)	Metals (aluminum can) (1)	Paper / cardboard packaging (1)	Plastics	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in L)	(in '000kg)
Nov 2019	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Dec 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jan 2020	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Feb 2020	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Mar 2020	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.35
Apr 2020	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	11.61
May 2020	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	12.39
June 2020	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	13.03
	l													
	l													
														-
	-	-	-				-	-		-				
	-	-	-				-	-		-				
	l										ļ			-
Total	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0	40.38

Total Inert C&D Waste Materials	Non-inert C&D Materials							
Generated	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste					
0.00 topper	0.00 toppoe	40.38 toppor	∩ Liters					

Where	(A)	Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total, 0.00 tonnes of inert C&D mate
		were generated from the Project, of which 0 tonnes were reused in this and other contracts, and the remaining 0.00 tonnes were disposed in Public Fill and Sorting Facilities.
	(b)	Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse. Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill.
	(c)	0 kg of metals, 0 kg of papers' cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.
	(d)	Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.
Notes:		(1) metal, paper & plastic were collected by recycler (2) The performance target of waste recycling are specified in the Contractt. (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site. (4) Plastics refer to plastic bottlee' containers, plastic/ foam from packaging material. (5) Broken concrete for necycling into aggregates. (6) Disposal of inert waste to public fill or sorting facilities will NOT be considered as recycled waste.

Appendix K

Monthly Waste Flow Table for June 2020

Project: Foundation Works for Lamma Power Station Extension Unit L12

Contractor: Sunley Engineering & Construction Co Ltd

Record by: Eric Liu Year of Record: 2019 & 2020

	Actual Quantities of Inert C&D Materials Generated Monthly							Actual Quantities of Non-inert C&D Materials Generated Monthly						
	Е	Excavated Materials			Non-excavated Materials									
MM/YYYY	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	the	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities	Metals (steel bar / metal strip) (1)	Metals (aluminum can) ⁽¹⁾	Paper / cardboard packaging ⁽¹⁾	Plastics	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in tonne)	(in L)	(in tonne)
Apr/2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
May/2019	7417.96	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jun/2019	8470.29	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jul/2019	5056.58	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.29
Aug/2019	9705.48	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	9.51
Sep/2019	5432.32	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	400.00	2.96
Oct/2019	10767.96	0.00	0.00	0.00	0.00	0.00	0.00	0.00	55.79	0.00	0.00	0.00	0.00	0.00
Nov/2019	8646.72	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	400.00	4.75
Dec/2019	11100.84	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jan/2020	2996.78	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.53	0.00	0.00	0.00	0.00	0.00
Feb/2020	5063.82	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	2.73
Mar/2020	4365.99	0.00	0.00	0.00	0.00	0.00	0.00	0.00	11.00	0.00	0.00	0.00	0.00	10.07
Apr/2020	3271.86	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
May/2020	4064.85	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.58
Jun/2020	1222.31	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.06
Total	87583.76	0.00	0.00	0.00	0.00	0.00	0.00	0.00	73.32	0.00	0.00	0.00	800.00	41.95

Total Inert C&D Waste N	Non-inert C&D Materials							
Generated	C&D Materials Recycled		C&D Waste Disposed of at Landfill		Chemical Waste			
87583.76	tonnes	73.32	tonnes	41.95	tonnes	800.00	liter	

Where	(a) Inert C&D materials include bricks, concrete, building debris	Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total,						
	were generated from the Project, of which	0.00	tonnes were reused in this and other	nd the remaining				
	87583.76 tonnes were disposed as public fill to Fill Banks/							

(b) Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse.

Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill.

(c)	0.00	tonne of metals,	0.00	tonne of paper / cardboard packing and	_	0.00	tonne of plastics were sent to recycler
	for recyclin	g during the reportin	g period.	_	_		•

(d) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.

Notes: (1) metal, paper & plastic were collected by recycler

- (2) The performance target of waste recycling are specified in the Contract.
- (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (4) Plastics refer to plastic bottles/ containers, plastic/ foam from packaging material.
- (5) Broken concrete for recycling into aggregates.
- (6) Disposal of inert waste to public fill or sorting facilities will $\underline{\mathsf{NOT}}$ be considered as recycled waste.
- (7) Quantity of metal recycled is revised.