

東業德勤測試顧問有限公司  
ETS-TESTCONSULT LIMITED

8/F, Block B, Veristrong Industrial Centre, 34-36 Au Pui Wan Street, Fotan, Hong Kong  
Tel : 2695 8318 E-mail : etl@ets-testconsult.com  
Fax : 2695 3944 Web site : www.ets-testconsult.com

**TEST REPORT**

**DRAINAGE SEWAGE DEPARTMENT**

**NGONG PING SEWAGE TREATMENT PLANT,  
TRUNK SEWERS AND EFFLUENT EXPORT  
PIPELINE  
OPERATION PHASE  
MONTHLY EM&A REPORT  
FOR  
GROUND WATER MONITORING  
(JANUARY 2007)**

Prepared by:

*Linda Law*

Linda Law  
Senior Environmental Officer

Checked and  
Approved by:

*C. L. Lau*

C. L. Lau  
Environmental Team Leader

Report No.: ENA70049



**CH2MHILL**

西園香港有限公司  
CH2M HILL Hong Kong Limited  
Suite 1801, Harcourt House  
99 Gloucester Road  
Wanchai, Hong Kong  
Tel (852) 2507-2203  
Fax (852) 2507-2293

Our Ref.: DSDSTPOPEM0\_0\_0052

Date: 07 February 2007

Consultants Management Division  
Drainage Services Department  
42/F., Revenue Tower,  
5 Gloucester Road, Wan Chai,  
Hong Kong

By mail and by Fax (2827 8526)

Attention : Mr. Mok Wing Cheong, Ringo

Dear Mr. Mok,

**Re: Environmental Permit 157/2003/A  
Contract No: DC/2003/01 Ngong Ping Sewage Treatment Plant, Truck Sewers and  
Effluent Export Pipeline  
Monthly EM&A Report of Ground Water Monitoring for Jan 2007**

Reference is made to the monthly EM&A Report prepared by ETS for the captioned project (report no. ENA70049). We are pleased to verify that the captioned report complied with the conditions 5.4 and 6.1 of the Environmental Permit.

Thank you very much for your attention and please feel free to contact the undersigned or our Eva Ho if you have any queries.

Yours sincerely,

David Yeung  
Independent Environmental Checker

c.c. Mr. Edwin Lam CE/HKI, DSD  
Mr. C L Lau ETS

By Fax: 2827 6657  
By Fax: 2695 3944



<b>TABLE OF CONTENTS</b>		Page
<b>EXECUTIVE SUMMARY</b>		
<b>1.0</b>	<b>INTRODUCTION</b>	1
<b>2.0</b>	<b>PROJECT INFORMATION</b>	
	2.1 Background	1
	2.2 Site Description	2
	2.3 Milestones of Environmental Protection / Mitigation activities annotated	2
<b>3.0</b>	<b>GROUNDWATER QUALITY MONITORING</b>	
	3.1 Monitoring Locations	2
	3.2 Monitoring Parameters	2
	3.3 Monitoring Frequency	2 – 3
	3.4 Monitoring Methodology and Equipment Used	3
	3.5 Groundwater Monitoring Results	4
<b>4.0</b>	<b>ENVIRONMENTAL NON-CONFORMANCE</b>	
	4.1 Summary of air quality, noise and water quality monitoring	4
	4.2 Summary of Environmental Complaints	4
	4.3 Summary of Notification of Summons and Prosecution	4
<b>5.0</b>	<b>IMPLEMENTATION STATUS</b>	
	5.1 Implementation Status of Environmental Mitigation Measures	4
	5.2 Implementation Status of Environmental Complaint Handling	4
<b>6.0</b>	<b>CONCLUSION</b>	5
<b>7.0</b>	<b>FUTURE KEY ISSUES</b>	5

#### **APPENDIX**

A	Lines of Communication of Project Organization
B	Groundwater Monitoring Results and Photos of Groundwater Monitoring at Boleholes
C	Graphical Plots of Groundwater Monitoring Data
D	General Layout Plan
E	QA/QC Results

#### **FIGURES**

Drawing No. 23400/T/202	Ngong Ping Sewage Treatment Plant Setting out Plan for Structures
Drawing No. 23400/T/074	Effluent Export Pipeline Alignment and Profile (Sheet 5 of 10)
Drawing No. 23400/T/075	Effluent Export Pipeline Alignment and Profile (Sheet 6 of 10)
Drawing No. 23400/R/076	Effluent Export Pipeline Alignment and Profile (Sheet 7 of 10)

#### **TABLES**

2.1	Contact Details of Key Personnel
3.1	Location of Groundwater Quality Monitoring
3.3	The Frequency of the Groundwater Monitoring
3.4	Summary of testing procedures
5.1	Statistical Summary of Environmental Complaints



## **EXECUTIVE SUMMARY**

This monthly EM&A report (No.10) has been prepared by the Environmental Team (ET) of ETS-Testconsult Ltd for groundwater monitoring under the operation phase of "Ngong Ping Sewage Treatment Plant, Trunk Sewers and Effluent Export Pipeline" (the Project) during the reporting period from 01 to 31 January 2007.

EP-157/2003/ATEM&A programme as set out in the EM&A Manual and the EIA Report (Register No.: AEIAR-065/2002) is required to be implemented. In accordance with the EM&A manual and the EIA Report, groundwater monitoring is required for the Project.

### **Environmental Monitoring Progress**

The summary of the monitoring activities in this monitoring month is listed below:

- *Groundwater Monitoring: 1 Occasion at 9 designated boreholes.*

### **Groundwater Monitoring**

Groundwater monitoring was carried out on 11 January 2007. During this monitoring, ground water was found in Borehole WM3 and the other boreholes were dry. According to the results of all testing parameters, it was found that no contamination of groundwater due to the leakage from the NPSTP and Effluent Export Pipeline was detected.

### **Environmental Complaints**

No complaints were received in this reporting month.

### **Notification of summons and successful prosecutions**

There were no notification of summons and prosecutions with respect to environmental issues in this month.

### **Future Key Issues**

Future Key issues to be considered for the prevention of contamination of the water gathering ground are as follows:

- The provision of leakage containment system for the section of pipeline in the close proximity of the reservoir;
- Removing waste in a timely manner and disposing of outside the water gathering ground;
- Locating the chemical storage area at a safe environment with adequate space; and
- Reminding the workers not to discharge any sewage or wastewater into the nearby environment.



## 1.0 INTRODUCTION

The construction works of Ngong Ping Sewage Treatment Works (NPSTW) was certificated completed on 09 March 2006 and the NPSTW was handed over to "Drainage Sewage Department" (DSD) for operation and maintenance from 10 March 2006. "ETS-Testconsult Limited" (ETL) has been commissioned as Environmental Team (ET) to carry out groundwater monitoring at Ngong Ping according to the EM&A Manual.

This monthly EM&A report presents the results of groundwater monitoring during the reporting period from 01 to 31 January 2007.

## 2.0 PROJECT INFORMATION

### 2.1 Background

Master Plan (OI SMP) Study in December 1994 and drew up a SMP for Lantau Island, Cheung Chau, Lamma Island, Peng Chau and other smaller and less populated islands. The SMP comprises provisions for upgrading and expanding the sewerage systems to cover unsewered areas.

This sewerage project is the Stage 1 works under the OI SMP and can be divided into 3 packages as follows:

*Package 1 – Ngong Ping STW with tertiary treatment*

*Package 2 – Ngong Ping main trunk sewer and effluent export pipeline*

*Package 3 – Ngong Ping village sewerage system*

This Project only covers the operation phase of Package 1 and Package 2. The general layout plan of the project is shown in Appendix D (Drawing No. 23400/EN/098).

The existing treatment facilities at Ngong Ping include grease traps and septic tanks, with discharge locally to soakaways. Following the opening of the Statue of Buddha in December 1993, the number of visitors to Ngong Ping increased significantly. Besides, the Cable Car system linking Tung Chung and Ngong Ping was being planned for commissioning in June 2006. It will certainly further increase the number of visitors in Ngong Ping. The existing treatment and disposal facilities were found to be inadequate, with significant quantities of sewage being directly discharged into the local stream. It was under this setting that the recommendation to provide a local sewerage system and a centralised treatment system for Ngong Ping was put forward in the OI SMP in 1994.

The Project was planned, designed, operated and maintained by the DSD. During the operation phase of NPSTW, DSD will follow the environmental monitoring recommendation stated at the M&A Manual that was prepared with reference to the EIA Report (Register No.: AEIAR-065/2002) to avoid the contamination of the water gathering ground.

### 2.2 Site Description

The general layout plan of the project is shown in Appendix D. The groundwater monitoring locations are also shown in the Drawing No. 23400/T/202, 23400/T/074, 23400/T/075 and 23400/T/076.

### 2.3 Project Organization and Management Structure

The line of communication of project organization with respect to the on-site environmental management and monitoring program are shown in Appendix A.

### 2.4 Contact Details of Key Personnel

The key personnel contact names and telephone numbers, and construction programme are shown in table 2.1.



Table 2.1 Contact Details of Key Personnel

Organization	Project Role	Name of Key Staff	Tel. No.	Fax No.
Hong Kong & Islands Division, DSD	Contractor (responsible for Groundwater Monitoring)	Mr. Edwin Lam	2594 7208	2827 6657
Sewage Treatment Division 2, DSD	Contractor (responsible for Odour Control and Water Quality Control except Groundwater Monitoring)	Mr. Zenith Chan	2195 3458	2991 4233
CH2M HILL	Independent Environmental Checker	Mr. David B K Yeung	2507 2203	2507 2293
ETL	Contractor's Environmental Team	Mr. C L Lau (ET Leader)	2946 7791	2695 3944

### 3.0 GROUNDWATER QUALITY MONITORING

#### 3.1 Monitoring Locations

Groundwater quality monitoring was undertaken at nine designated boreholes shown in Table 3.1.

Table 3.1 Locations of Groundwater Quality Monitoring

Borehole No.	Depth from Ground Level to end of standpipe (m)	Location
WM1	3.58	Keung Shan Road (L/P FA0463)
WM2	4.24	Keung Shan Road (L/P FA0458)
WM3	3.57	Keung Shan Road (L/P FA0445)
WM4	2.77	Keung Shan Road (L/P FA0437)
WM5	4.63	Keung Shan Road (L/P FA0428)
WM6	10.46	STP (Ngong Ping)
WM7	96.8	STP (Ngong Ping)
WM8	9.99	STP (Ngong Ping)
WM9	10.69	STP (Ngong Ping)

#### 3.2 Monitoring Parameters

Monitoring of the groundwater monitoring parameters are listed below:

- Biochemical Oxygen Demand (BOD<sub>5</sub>), mg/L;
- Ammonia Nitrogen (NH<sub>4</sub><sup>+</sup>-N), mg/L;
- Nitrate + Nitrite Nitrogen (NO<sub>2</sub><sup>-</sup>+NO<sub>3</sub><sup>-</sup>), mg/L;
- pH value;
- Turbidity, NTU;
- Oil & Grease (O&G), mg/L;
- Total Phosphates (TP), mg/L;
- Synthetic detergents, mg/L;
- E-coli, cfu/100ml.



### 3.3 Monitoring Frequency

The monitoring frequency of the groundwater monitoring is summarized in Table 3.3.

Table 3.3 The frequency of the Groundwater Monitoring

Parameter	Frequency	No. of Boreholes
Biochemical Oxygen Demand	Once per month	9
Ammonia Nitrogen		
Nitrate + Nitrite		
pH value		
Turbidity		
Oil & Grease		
Total Phosphates		
Synthetic detergents		
E-coli		

### 3.4 Monitoring Methodology and Equipment Used

A water sampler comprising a transparent PVC cylinder, with a capacity of not less than 2 liters, was lowered into the water body at the predetermined depth. The opening ends of the sampler were then closed accordingly and water samples were collected.

The sample container, made by high-density polythene / glass, was rinsed with a portion of the water sample. The groundwater sample was then transferred to the container, labeled with a unique sample ID and sealed with a screw cap. The water samples were stored in a cool box maintained at 4°C. The groundwater samples were then delivered to a local HOKLAS-accredited laboratory (Environmental Laboratory, ETS-Testconsult Ltd, HOKLAS Registration No. 022) on the same day for analysis.

In accordance with the requirement of HOKLAS, the laboratory testing of the monitoring parameters were carried out with QA/QC results shown in Appendix E. The summary of testing methods of testing parameters as recommended by EIA or required by EPD were shown in Table 3.4.

Table 3.4 Summary of testing procedures

Laboratory Analysis	Testing Procedure	Detection Limit
Biochemical Oxygen Demand	In house method TPE/001/W or BS 6068 : Section 2.14 : 1990	2.0 mg/L
Ammoniacal Nitrogen	In house method TPE/016/W, refer to APHA 19ed 4500-NH <sub>3</sub> F & G	0.13 mg/L
Nitrate + Nitrite	In house method TPE/023/W, refer to APHA 19ed 4500-NO <sub>3</sub> B	0.004 mg/L
pH (at 25°C)	In house method TPE/003/W, refer to APHA 19ed APHA 4500-H <sup>+</sup> B	Detection range: 4.0-10.0
Turbidity	In house method TPE/005/W, refer to APHA 19ed 2130B	0.5 NTU
Oil & Grease	APHA 19ed 5520 B	5.0 mL
Total Phosphate	In house method base on ASTM D 515-88	0.05 mg/L
Synthetic detergents	In house method based on APHA 19ed 5540 C & D	0.1 mg/L
E-coli	DoE Section 7.8 & 7.9 plus in-site urease test	<1 cfu/100ml



### 3.5 Groundwater Monitoring Results

In this reporting month, groundwater monitoring was carried out on 11 January 2007. During this monitoring, groundwater was found in Borehole No WM3 and the other boreholes were dry. The groundwater quality measurement results are detailed in Appendix B. Graphical presentation of the monitoring parameters for this reporting month is shown in Appendix C.

According to the results of all testing parameters, it was found that no contamination of groundwater due to the leakage from the NPSTP and Effluent Export Pipeline was detected.

## 4.0 ENVIRONMENTAL NON-CONFORMANCE

### 4.1 Summary of Groundwater Quality Monitoring

According to the results of all testing parameters, it was found that no contamination of groundwater due to the leakage from the NPSTP and Effluent Export Pipeline was detected.

### 4.2 Summary of Environmental Complaints

No complaints were received in this reporting month.

### 4.3 Summary of Notification of Summons and Prosecution

There was no notification of summons respect to environmental issues registered in this month.

## 5.0 IMPLEMENTATION STATUS

### 5.1 Implementation Status of Environmental Mitigation Measures

DSD has been implementing the required environmental mitigation measures indicating in Clause 4.5.20 of the EM&A manual.

### 5.2 Implementation Status of Environmental Complaint Handling

No complaints were received in this reporting month. The details of the complaint-log are presented in Table 5.1.

Table 5.1 Statistical Summary of Environmental Complaints

Reporting Month	Complaint Statistics			
	Frequency	Cumulative	Aspect	Investigation Results and Follow up Actions
April 06	0	0	---	---
May 06	0	0	---	---
June 06	0	0	---	---
July 06	0	0	---	---
Aug 06	0	0	---	---
Sept 06	0	0	---	---
Oct 06	0	0	---	---
Nov 06	0	0	---	---
Dec 06	0	0	---	---
Jan 06	0	0	---	---





### **5.3 Implementation Status of Notification of Summons and Prosecution**

There were no notifications of summons respect to environmental issues registered in this reporting month.

### **6.0 CONCLUSION**

In this reporting month, groundwater monitoring was carried out on 11 January 2007. During this monitoring, ground water was found in Borehole WM3 and the other boreholes were dry.

According to the results of all testing parameters, it was found that no contamination of groundwater due to the leakage from the NPSTP and Effluent Export Pipeline was detected.

### **7.0 FUTURE KEY ISSUES**


DSD will continue to carry out operation and maintenance works of NPSTW in the coming month. Future Key issues to be considered for the prevention of contamination of the water gathering ground are as follows:

- The provision of leakage containment system for the section of pipeline in the close proximity of the reservoir;
- Removing waste in a timely manner and disposing of outside the water gathering ground;
- Locating the chemical storage area at a safe environment with adequate space; and
- Reminding the workers not to discharge any sewage or wastewater into the nearby environment.



## **Appendix A**

### **Lines of Communication**

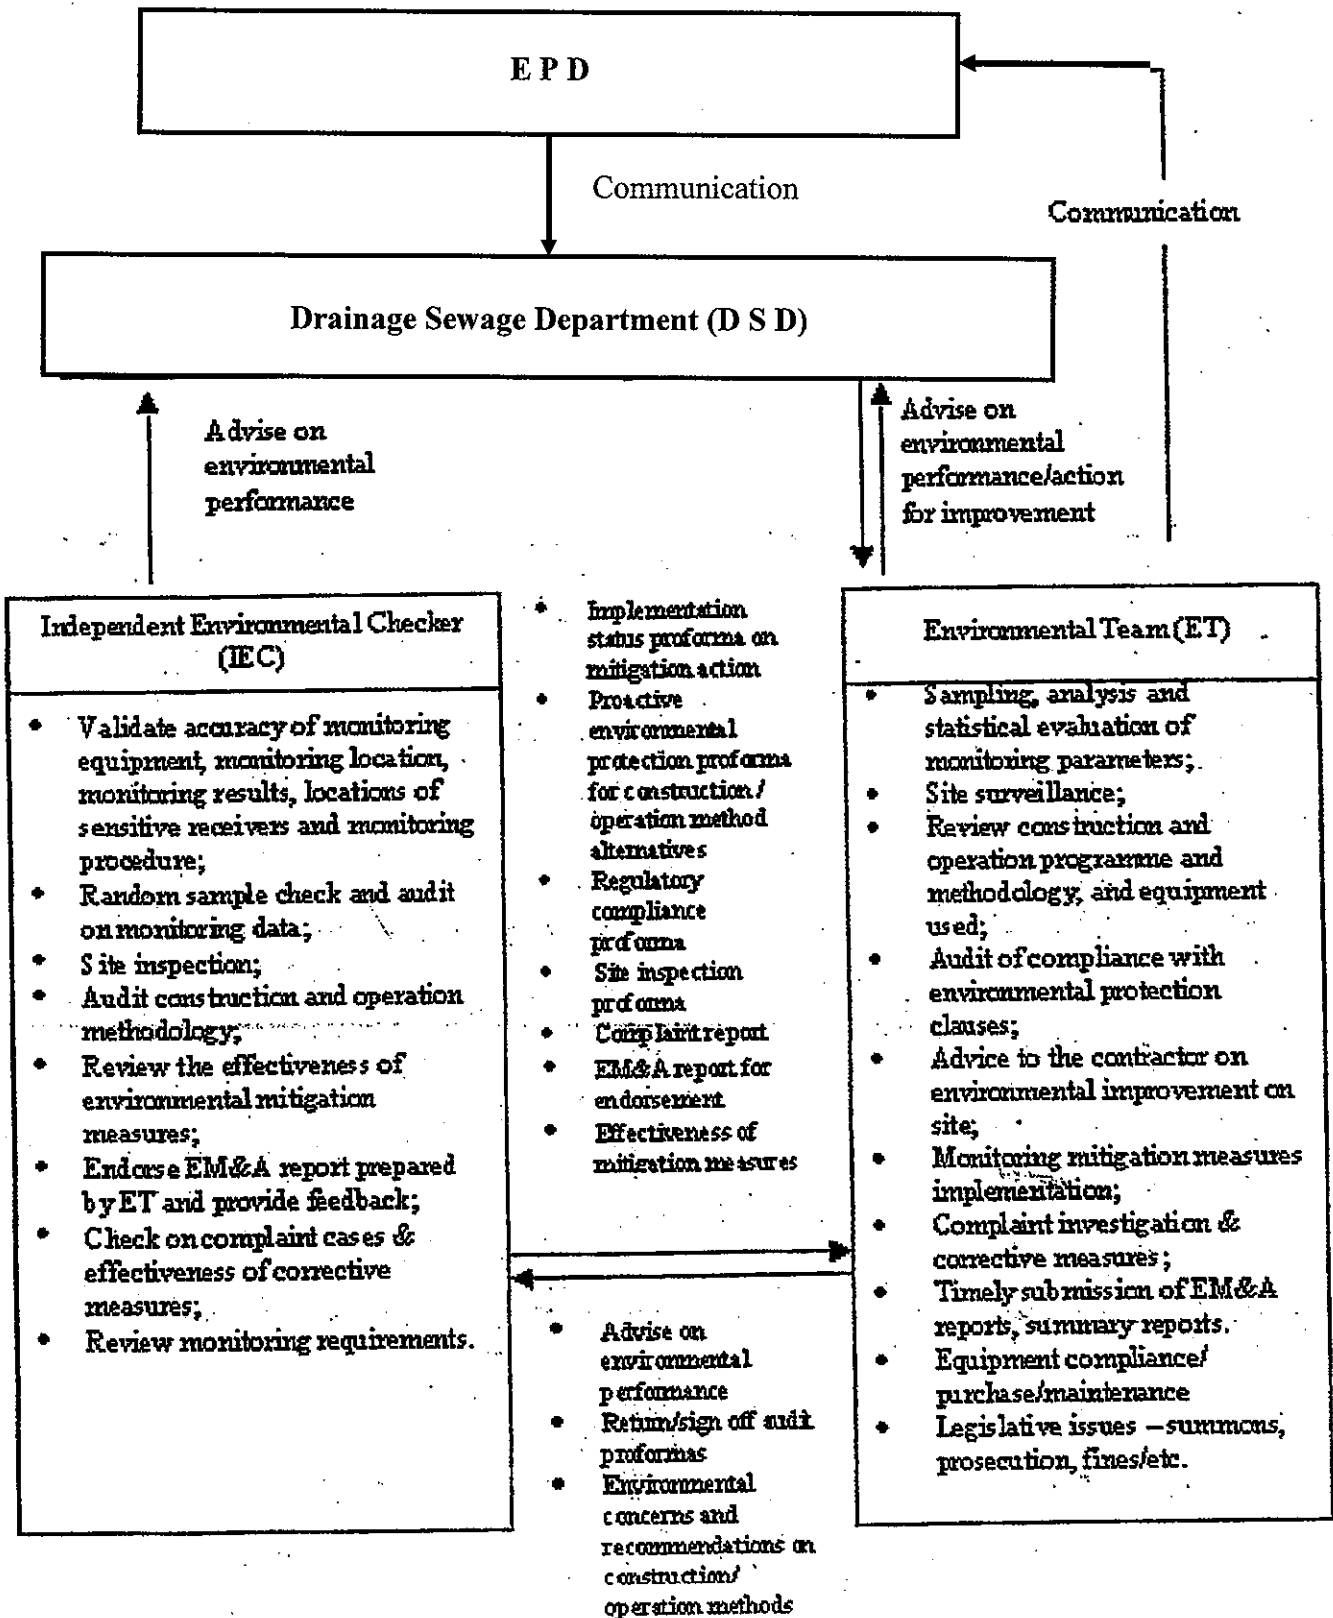



## **Appendix B**

### **Groundwater Monitoring Results**

**and**

### **Photos of Groundwater Monitoring at Boleholes**



東業德勤測試顧問有限公司  
ETS-TESTCONSULT LIMITED

8/F., Block B, Veristrong Industrial Centre, 34-36 Au Pui Wan Street, Fotan, Hong Kong  
Tel : 2695 8318 E-mail : etl@ets-testconsult.com  
Fax : 2695 3944 Web site : www.ets-testconsult.com

**TEST REPORT**

Form : E/EN/R/01/Issue 4 (1/1) [08/02]

**Environmental Testing of Water & Wastewater**

Report No. : ENA70048  
Date of issue : 23 January 2007  
Page No. : 1 of 1

**Information provided by client**

Client name : Paul Y Construction Co. Ltd  
Client address : 31/F Paul Y Centre 51 Hung To Road Kwun Tong Kowloon HK  
Sample Source : DC/2004/09 - Building and Civil Maintenance and Minor Works to DSD Plants and Facilities (2005-2007)  
Sample Type : Groundwater  
Date of sampling : 11 January 2007  
Sample Description : The sample was collected in 100ml glass bottle (for Total Phosphates only), 500ml glass bottle (for Oil & Grease only), 100ml sterilized glass bottle (for E-coli only), 500ml and 1L plastic bottles (for other testing parameters). Sample for Ammonia and Nitrate + Nitrite Nitrogen was preserved by adding conc. H<sub>2</sub>SO<sub>4</sub> to pH<2. Sample for Oil & Grease was preserved by adding conc. HCl to pH<2. All samples were chilled immediately after collection.

**Laboratory information**

Date Received : 11 January 2007

**Result**

Client Sample ID	Lab Ref No	Test	Method Used	Result	Date Tested
WM3	W21180 (01)	Biochemical Oxygen Demand (5-day)	In house method based on APHA 19ed 4500-O G	13 mg/L	11 January 2007 (18:00) to 16 January 2007 (18:00)
		pH Value	In house method TPE/003/W	6.0 (at 25°C)	11 January 2007
		Turbidity	In house method TPE/005/W	140 NTU	11 January 2007
	W21180 (05)	Synthetic Detergents	In house method TPE/005/W	<0.1 mg/L	12 January 2007
	W21180 (02)	Nitrate & Nitrite Nitrogen	In house method TPE/023/W	0.36 mg/L	16 January 2007
		Ammonia	In house method TPE/016/W	0.14 mg/L	15 January 2007
	W21180 (03)	Total Phosphates	In house method TPE/019/W	< 0.01 mg/L	12 January 2007
	W21180 (04)	Oil & Grease	APHA 19ed 5520B	<5.0 mg/L	13 January 2007
W21180 (06)	E-coli *	DoE (1983), section 7.8 & 7.9 plus in-situ urease test	2 cfu/100ml	11-13 January 2007	

Remark (if any) : The tests marked with "\*" indicated the tests were sub-contract to ALS Technichem (HK) Pty Ltd and HOKLAS accredited. Water monitoring was only carried out at Borehole WM3 only since other boreholes were observed to be dry during water monitoring.

Checked by : LAW, Sau Yee  
Senior Chemist

Approved by : LAU, Chi Leung  
Chief Chemist




Project : DC/2004/09 - Building and Civil Maintenance and Minor Works to DSD Plants  
and Facilities (2005-2007)

Date of sampling : 11 January 2007



Report No. : ENA70048

Date of issue : 23 January 2007

**WM1**

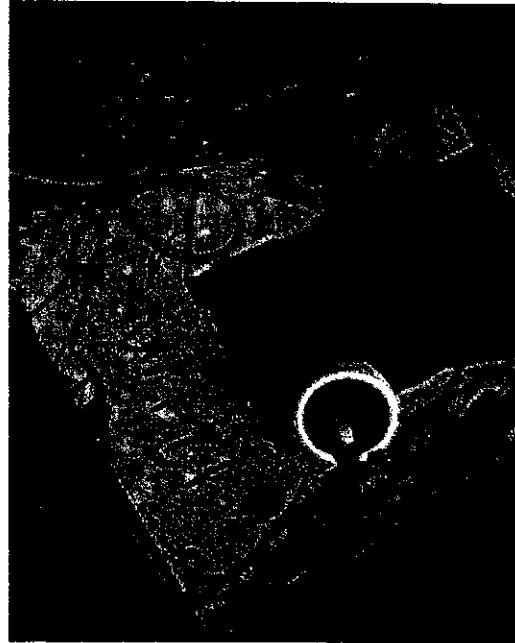

**WM2**

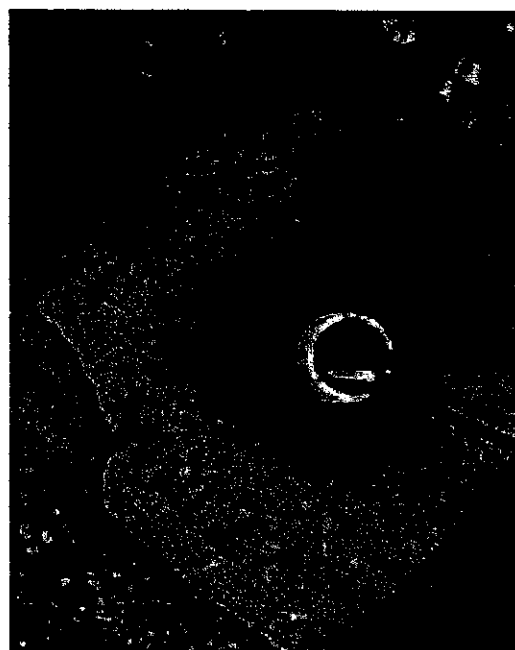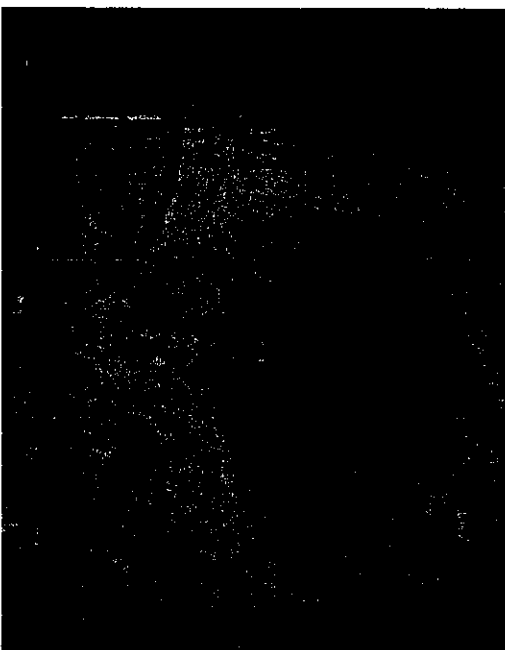




Project : DC/2004/09 - Building and Civil Maintenance and Minor Works to DSD Plants  
and Facilities (2005-2007)

Date of sampling : 11 January 2007



Report No. : ENA70048

Date of issue : 23 January 2007

**WM3**

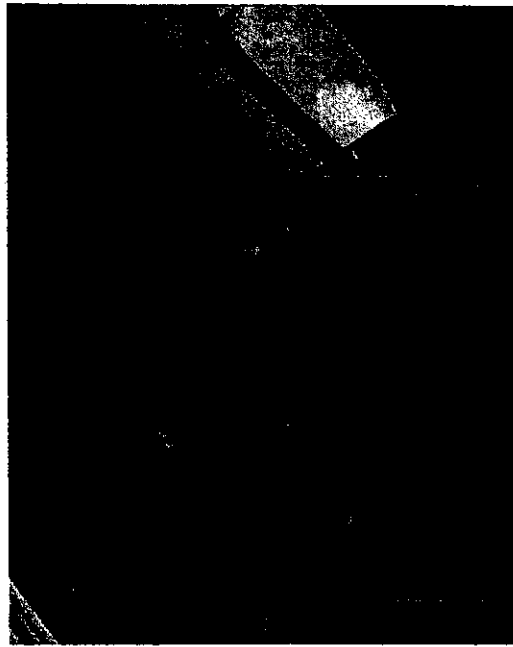

**WM4**

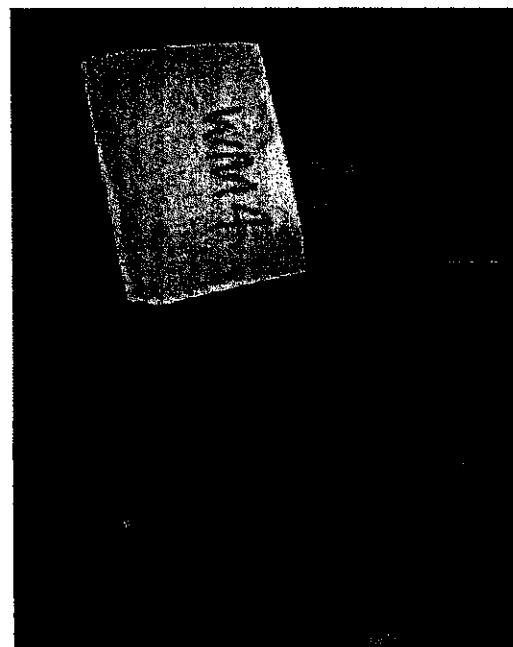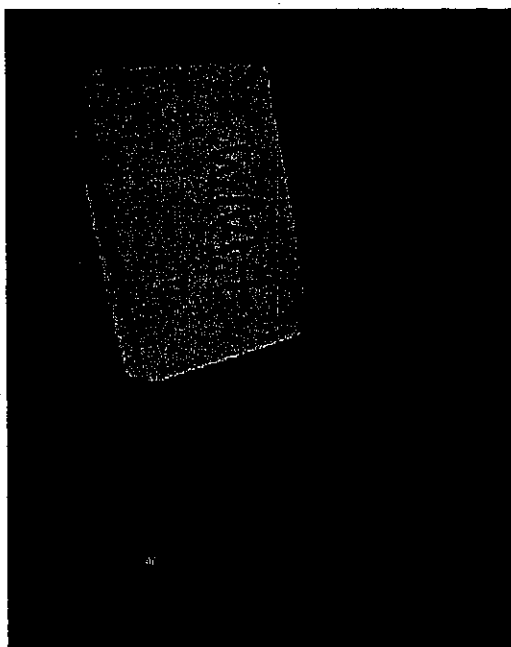



Project : DC/2004/09 - Building and Civil Maintenance and Minor Works to DSD Plants  
and Facilities (2005-2007)

Date of sampling : 11 January 2007



Report No. : ENA70048

Date of issue : 23 January 2007

**WM5**



**WM6**

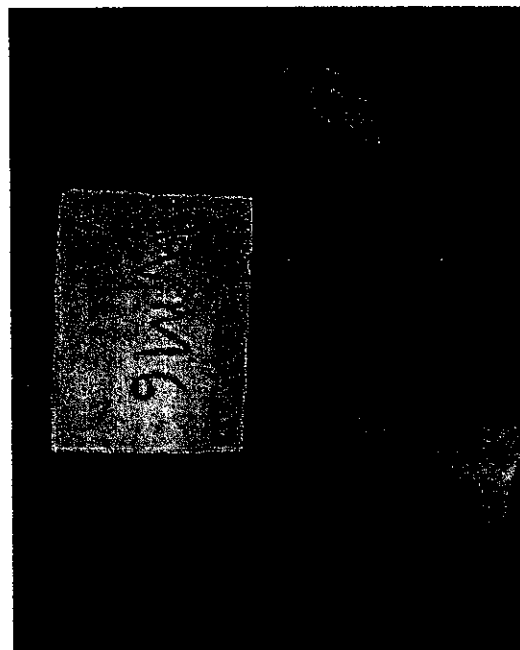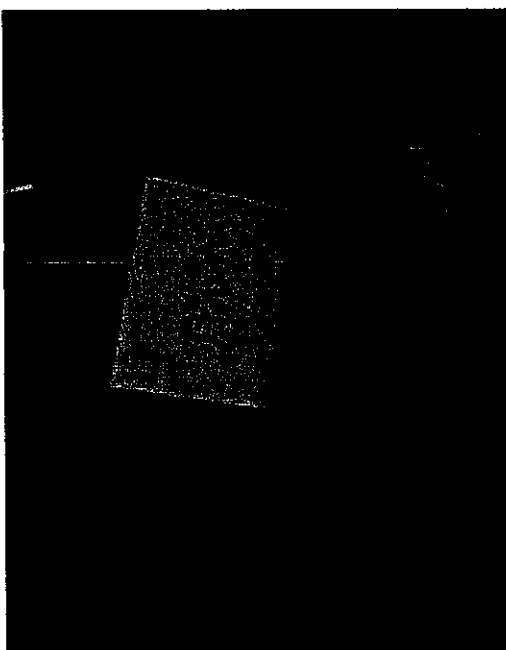







Project : DC/2004/09 - Building and Civil Maintenance and Minor Works to DSD Plants  
and Facilities (2005-2007)

Date of sampling : 11 January 2007



Report No. : ENA70048

Date of issue : 23 January 2007

**WM7**

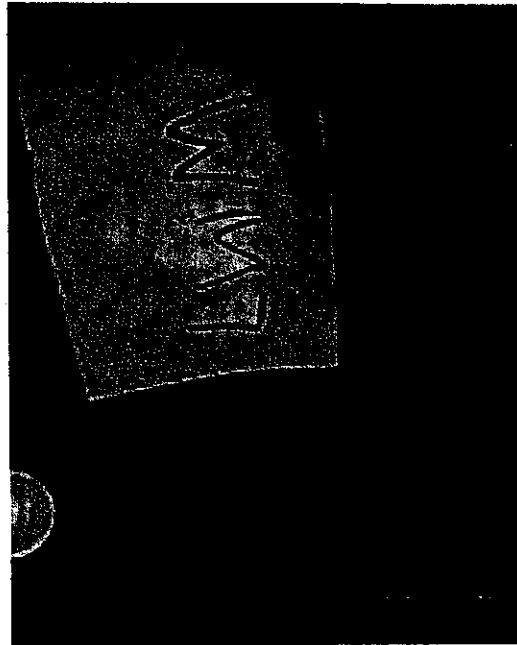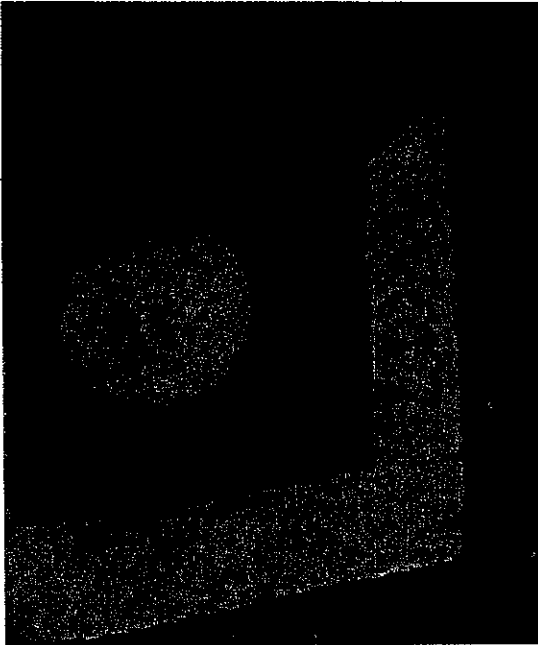

**WM8**

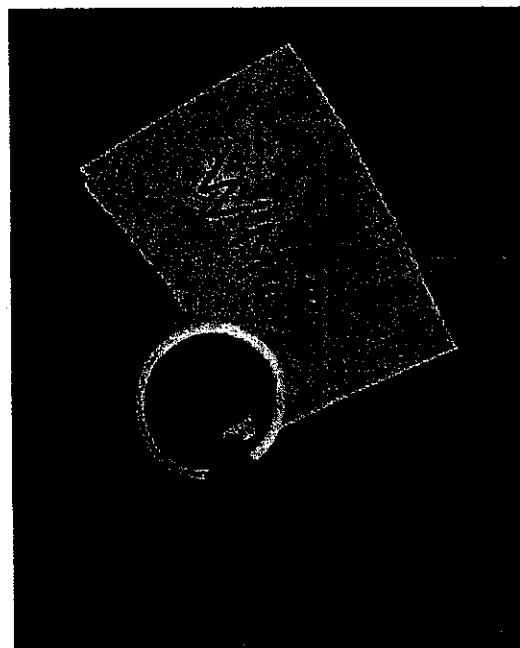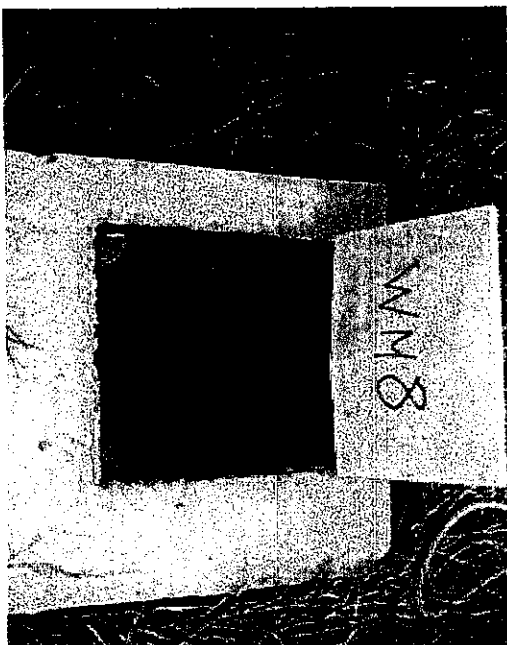





Project : DC/2004/09 - Building and Civil Maintenance and Minor Works to DSD Plants  
and Facilities (2005-2007)

Date of sampling : 11 January 2007

Report No. : ENA70048

Date of issue : 23 January 2007

**WM9**

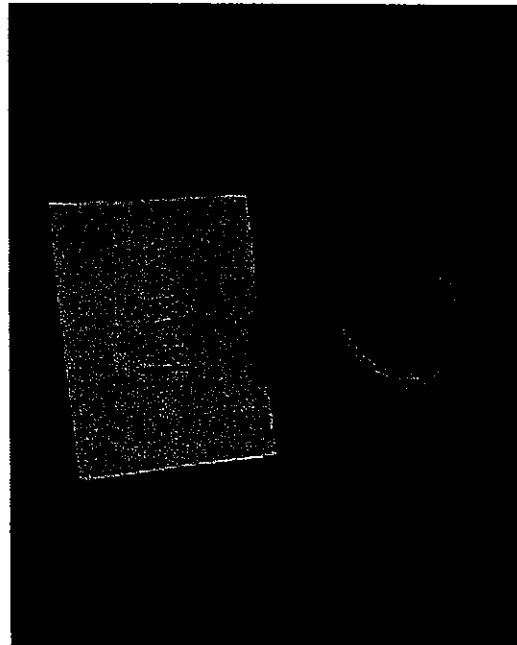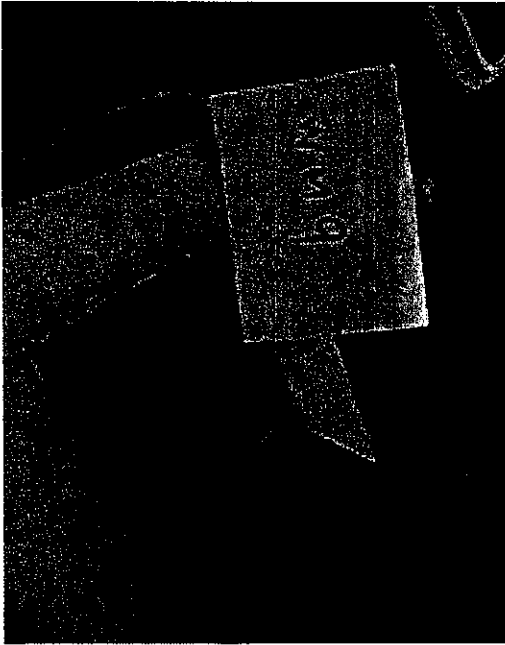




## **Appendix C**


### **Graphical Plots of Groundwater Monitoring Data**




### 5-day Biochemical Oxygen Demand (BOD<sub>5</sub>)

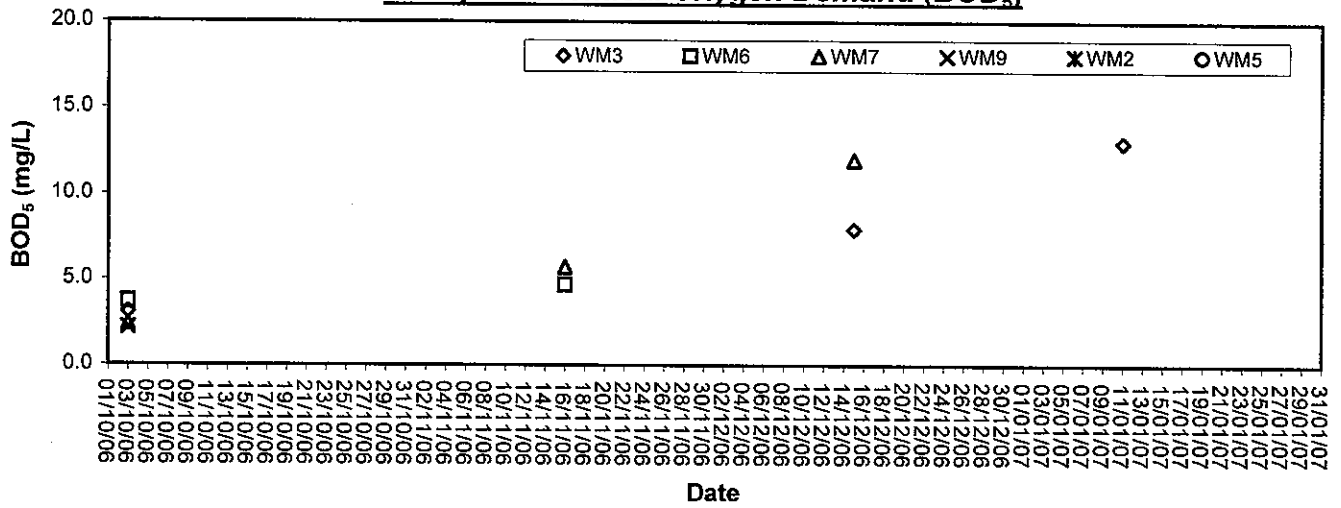

### pH Value

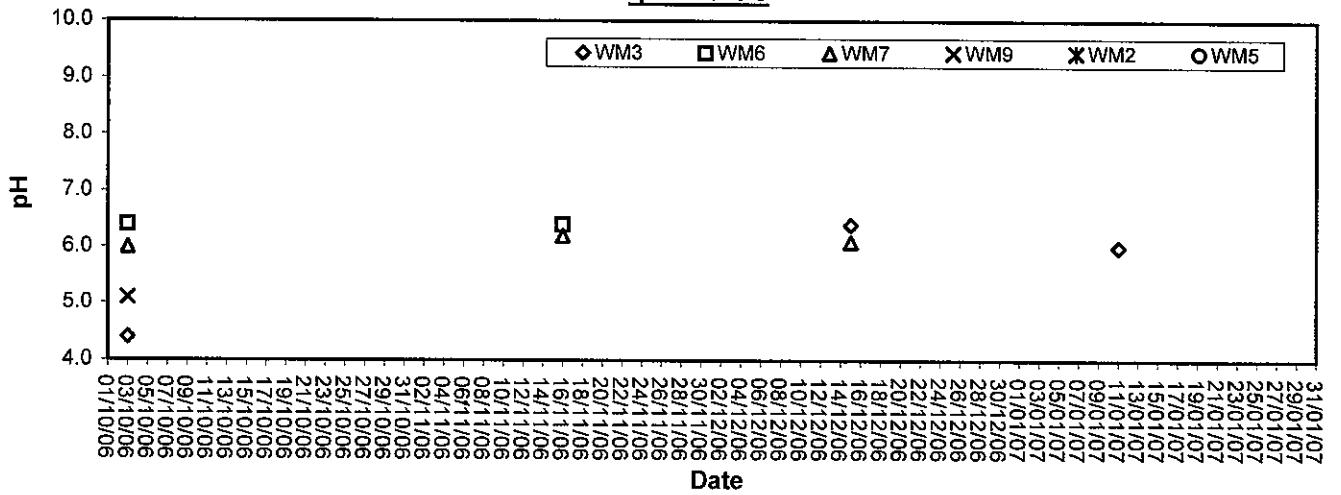


### Turbidity

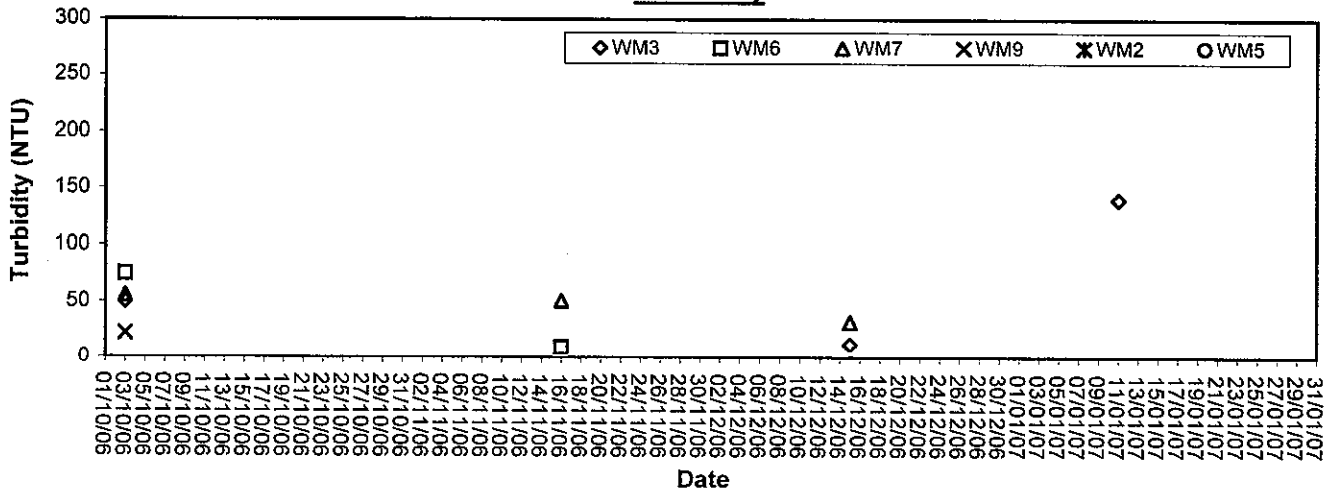





### Synthetic Detergents

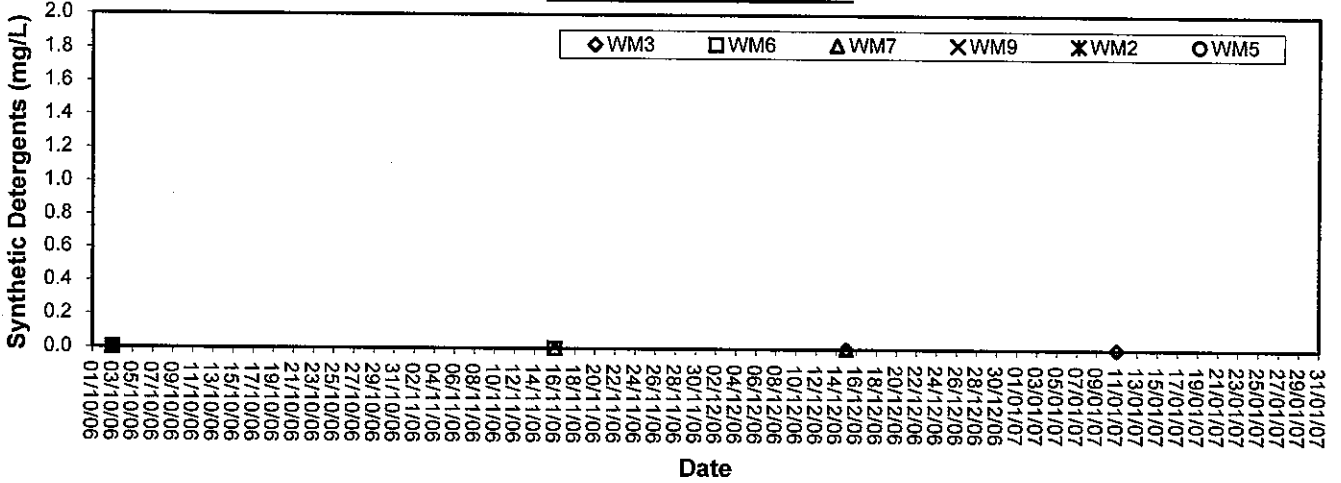

### Nitrate & Nitrite Nitrogen (NO<sub>3</sub><sup>-</sup>+NO<sub>2</sub><sup>-</sup>)

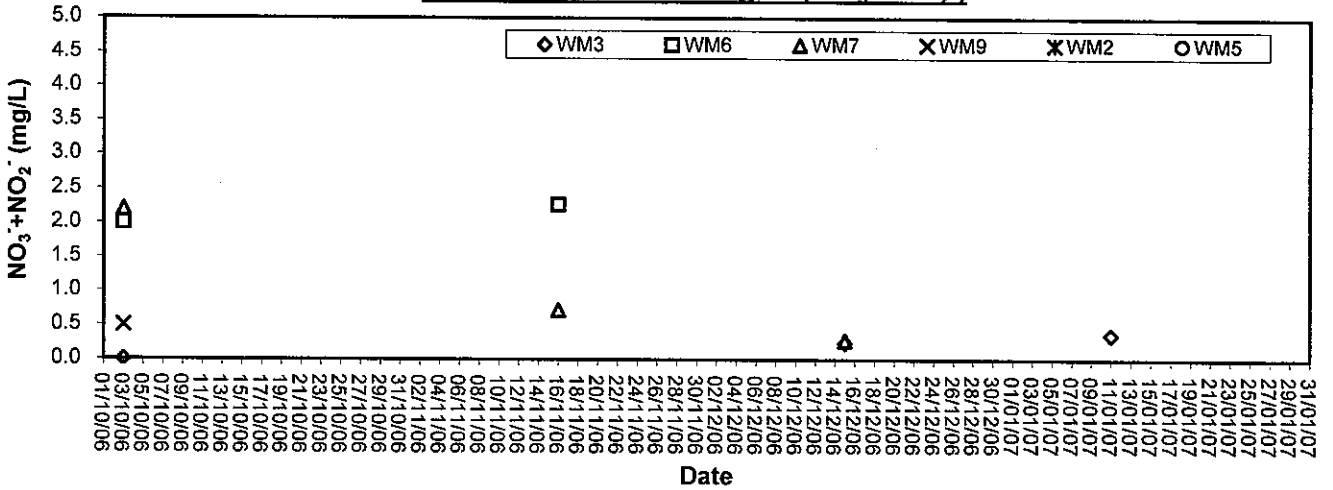

### Ammonia Nitrogen (NH<sub>4</sub><sup>+</sup>-N)

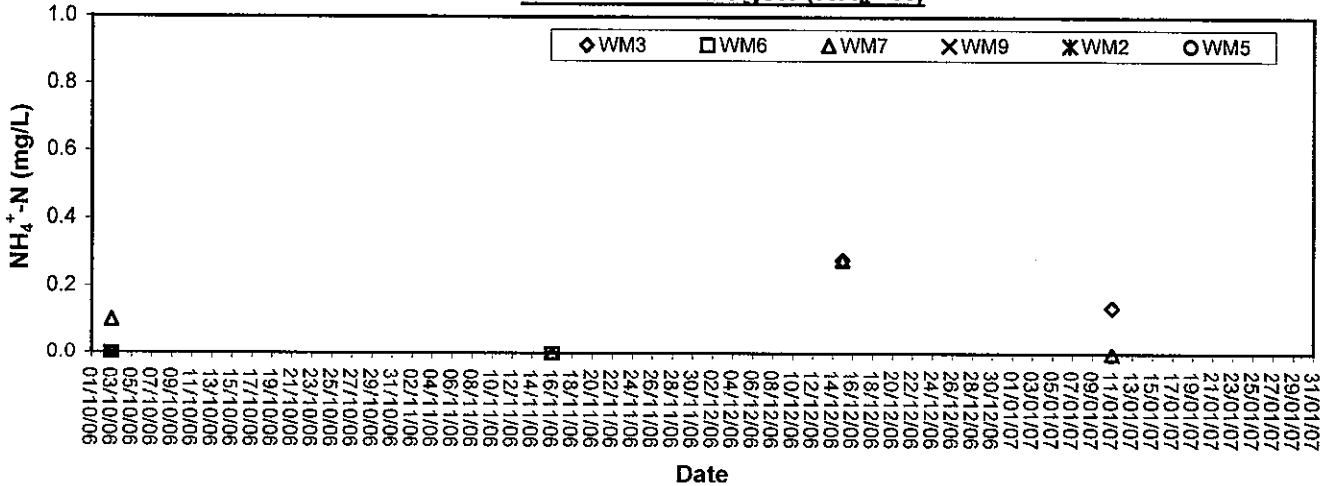







## **Appendix D**

### **General Layout Plan**

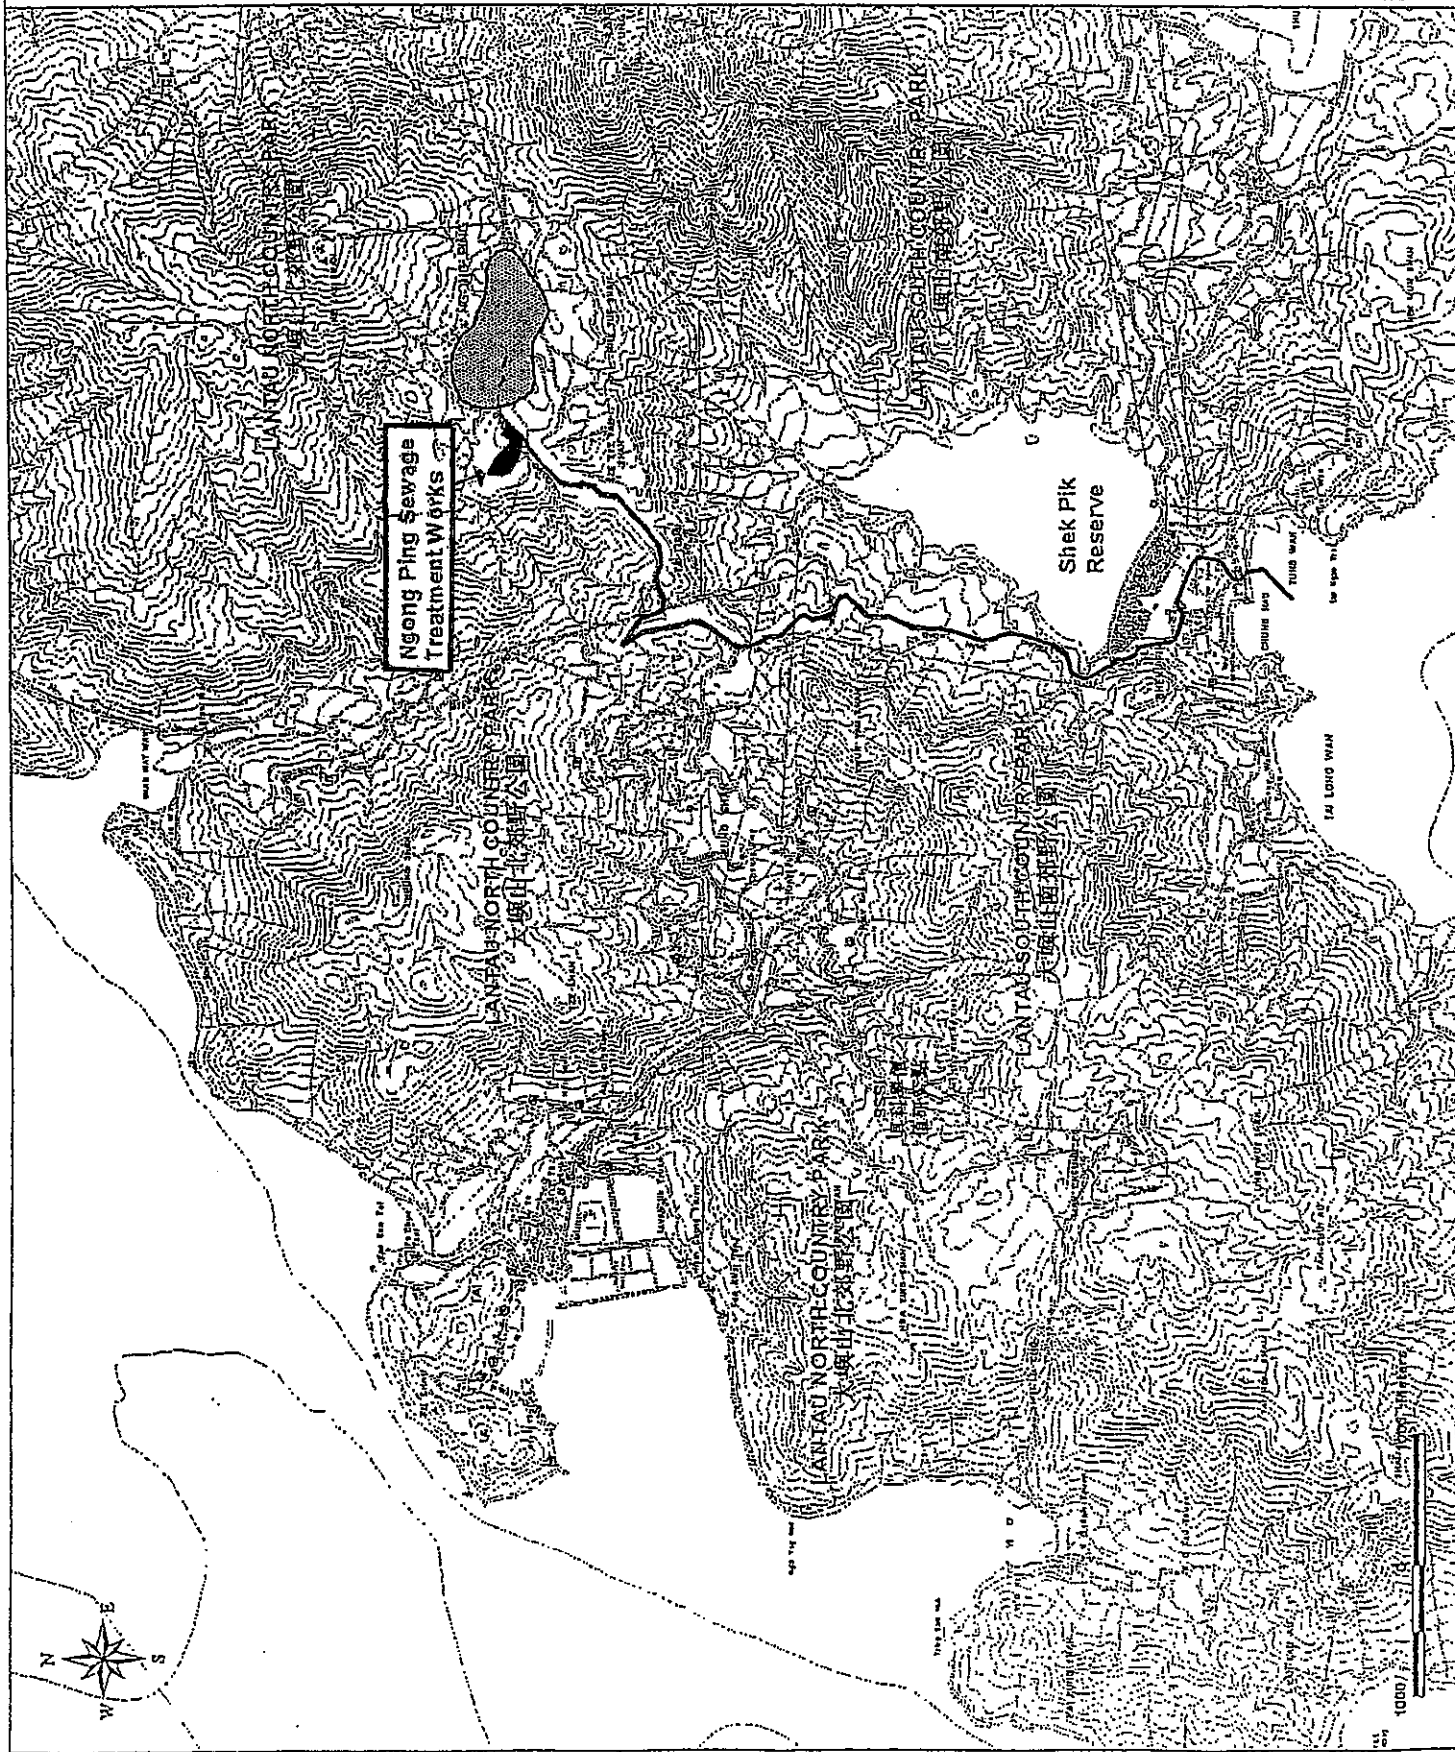

**Legend:**

-  Proposed Effluent Export Pipeline
-  Proposed Trunk Sewer of Ngong Ping Sewerage
-  Ngong Ping Sewerage Catchment Area

Project No.	23400/EN/09/8
Scale	1:20000@A3
Revision	
Author	
Check	
Drawn	
Date	


**ARUP**

AGREEMENT NO. CE 2901  
 OUTLYING ISLANDS STAGE 1 PARSE 1  
 NGONG PING SEWAGE TREATMENT  
 WORKS AND SEWERAGE

Ngong Ping Sewerage Project  
 Scheme - General Layout

Project No.	23400/EN/09/8
Scale	1:20000@A3
Revision	
Author	
Check	
Drawn	
Date	

香港特別行政區環境保護署  
 ENVIRONMENTAL PROTECTION DEPARTMENT  
 OF THE HONG KONG SPECIAL ADMINISTRATIVE REGION







## **Appendix E**

### **QA/QC Results**



## QA/QC Results of Laboratory Analysis of Testing Parameters

Testing Parameter	QC Sample Analysis	Sample Duplicate		Sample Spike	
	% Recovery *	Sample ID	% Error #	Sample ID	% Recovery @
Turbidity	101	WM3	1.4	---	---
Nitrate + Nitrite	95	---	---	---	---
Oil & Grease	101	---	---	---	---
Ammoniacal Nitrogen	99	---	---	---	---
Synthetic detergents	---	---	---	---	---
Biochemical Oxygen Demand (5-day)	103	WM3	3.0	---	---
Total Phosphates	104	---	---	---	---
Testing Parameter	QC Sample Analysis	Sample Duplicate		Sample Spike	
	% Recovery *	Sample ID	Difference between Duplicates +	Sample ID	% Recovery @
pH Value(at 25°C)	---	WM3	0.0 unit	---	---

- Note:
- (\*) % Recovery of QC sample should be between 80% to 120%.
  - (#) % Error of Sample Duplicate should be between -10% to 10%.
  - (@) % Recovery of Sample Spike should be between 80% to 120%.
  - (+) Difference between Duplicates should be less than 0.1 unit for pH value.




## Figures

LEGENDS :

- EFFLUENT PIPELINE ALIGNMENT
- EXISTING GROUND LEVEL
- EFFLUENT PIPELINE PROFILE
- H HATCHBOX CHAMBER
- G GATE VALVES CHAMBER
- V VENTILATION PIPE CHAMBER
- 123 BENDS

NOTE:

1. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
2. USE 1:1000 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
3. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
4. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
5. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
6. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
7. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
8. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
9. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.
10. REFER TO DRAWING NO. DR240001074 FOR THE PROPOSED PIPELINE ALIGNMENT AND PROFILE.

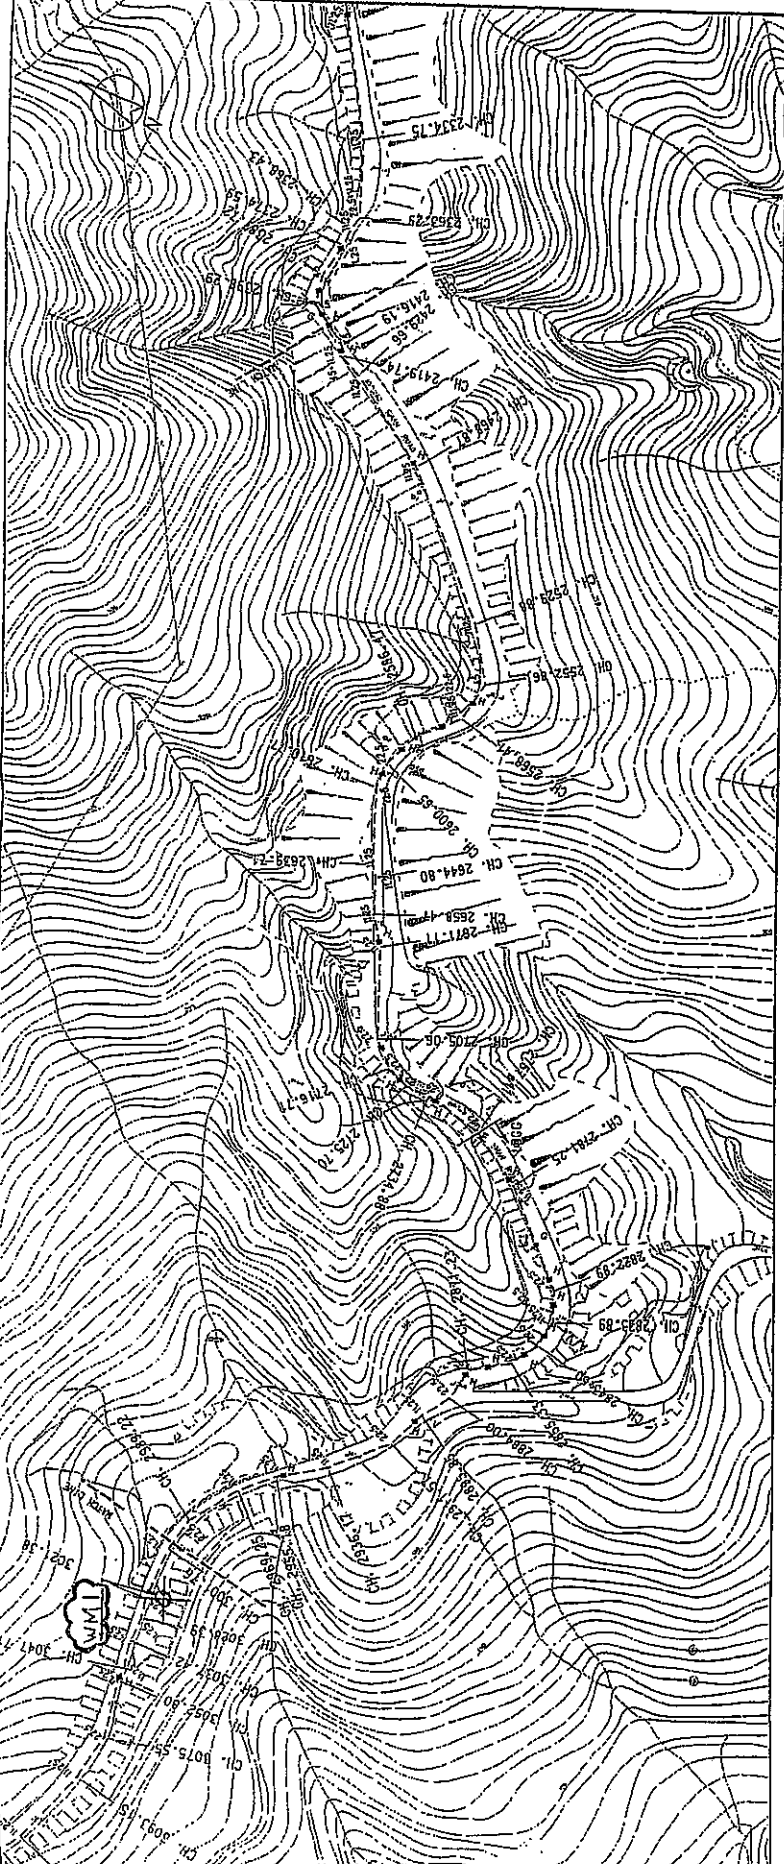

ISSUE FOR CONSTRUCTION	DATE	BY
DESCRIPTION	DATE	BY

ARUP  
One Asia Finance Hong Kong Limited


Project No.  
CONTRACT NO. DC200301  
NGONG PING SEWAGE TREATMENT PLANT, TRUNK SEWERS AND EFFLUENT EXPORT PIPELINE

Drawing No.  
EFFLUENT EXPORT PIPELINE: ALIGNMENT AND PROFILE (SHEET 5 OF 10)

Drawing No. 234001074

DATE: 10/11/03  
SCALE: 1:1000  
DRAWN BY: YIM YIM YIM  
CHECKED BY: YIM YIM YIM  
APPROVED BY: YIM YIM YIM  
COPRIGHT RESERVED

香港特別行政區政府康樂及文化事務署  
DRAINAGE SECTION  
DEPARTMENT OF THE ENVIRONMENT  
HONG KONG  
SPECIAL ADMINISTRATIVE REGION

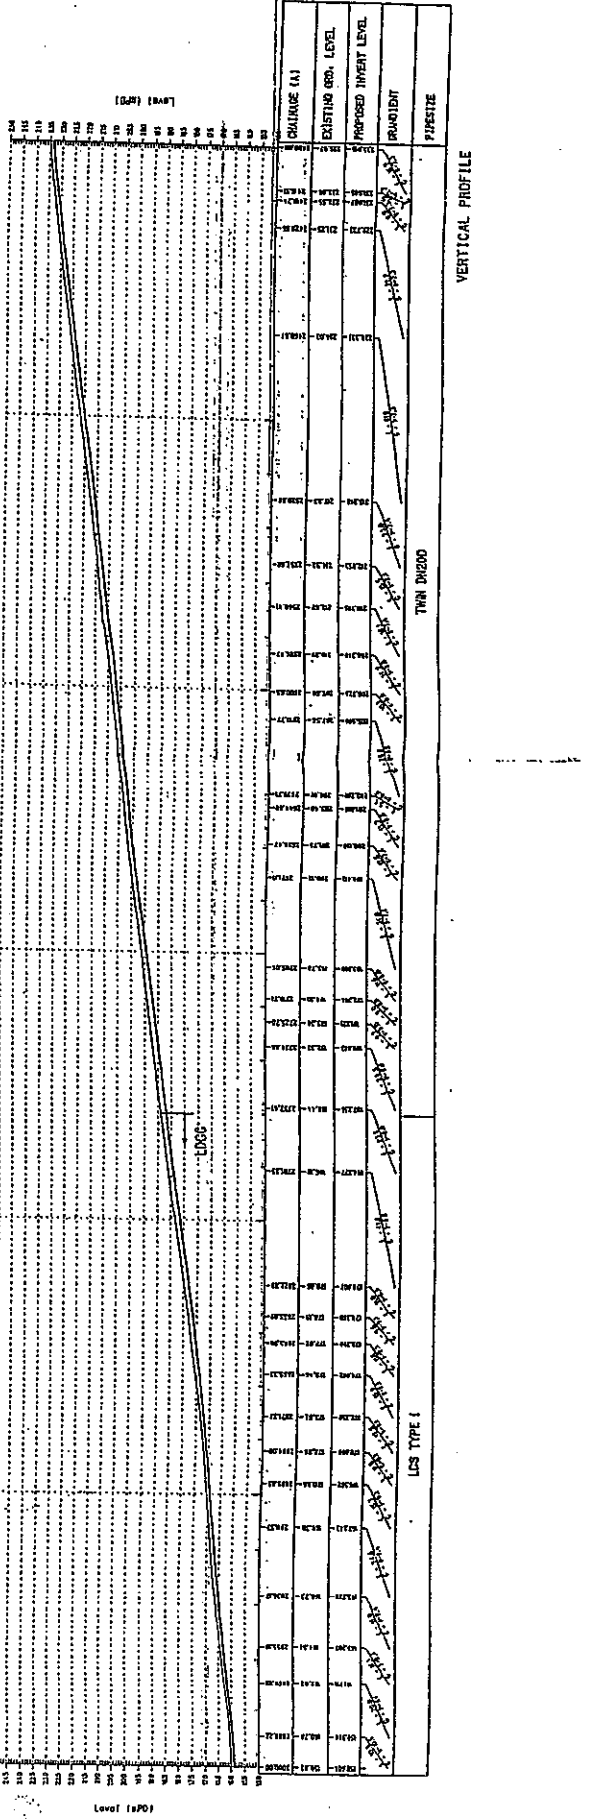


LEGENDS :

- EFFLUENT PIPELINE ALIGNMENT
- EXISTING GROUND LEVEL
- EFFLUENT PIPELINE PROFILE
- HATCHBOX CHAMBER
- GATE VALVES CHAMBER
- ▲ VENTILATION PIPE CHAMBER
- ENDS

NOTE:

1. REFER TO DRAWING NO. 234007/015 FOR GENERAL NOTES
2. ALL CONDUITS SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITIONS OF THE HONG KONG SANITATION BY-LAWS AND THE SPECIFICATIONS OF THE HONG KONG SANITATION AUTHORITY.
3. REFER DRAWING NO. 234007/015 FOR THE DETAILS OF GATE VALVE CHAMBERS.
4. VENTILATION PIPE CHAMBERS TO BE PROVIDED AT REGULAR INTERVALS AS INDICATED BY THE LEGENDS AND THE SPECIFICATIONS OF THE HONG KONG SANITATION AUTHORITY.
5. EXACT LOCATION OF ENDS ARE TO BE DETERMINED AS SET OUT HEREIN.
6. REFER DRAWING NO. 234007/015 FOR THE DETAILS OF THE ENDS.

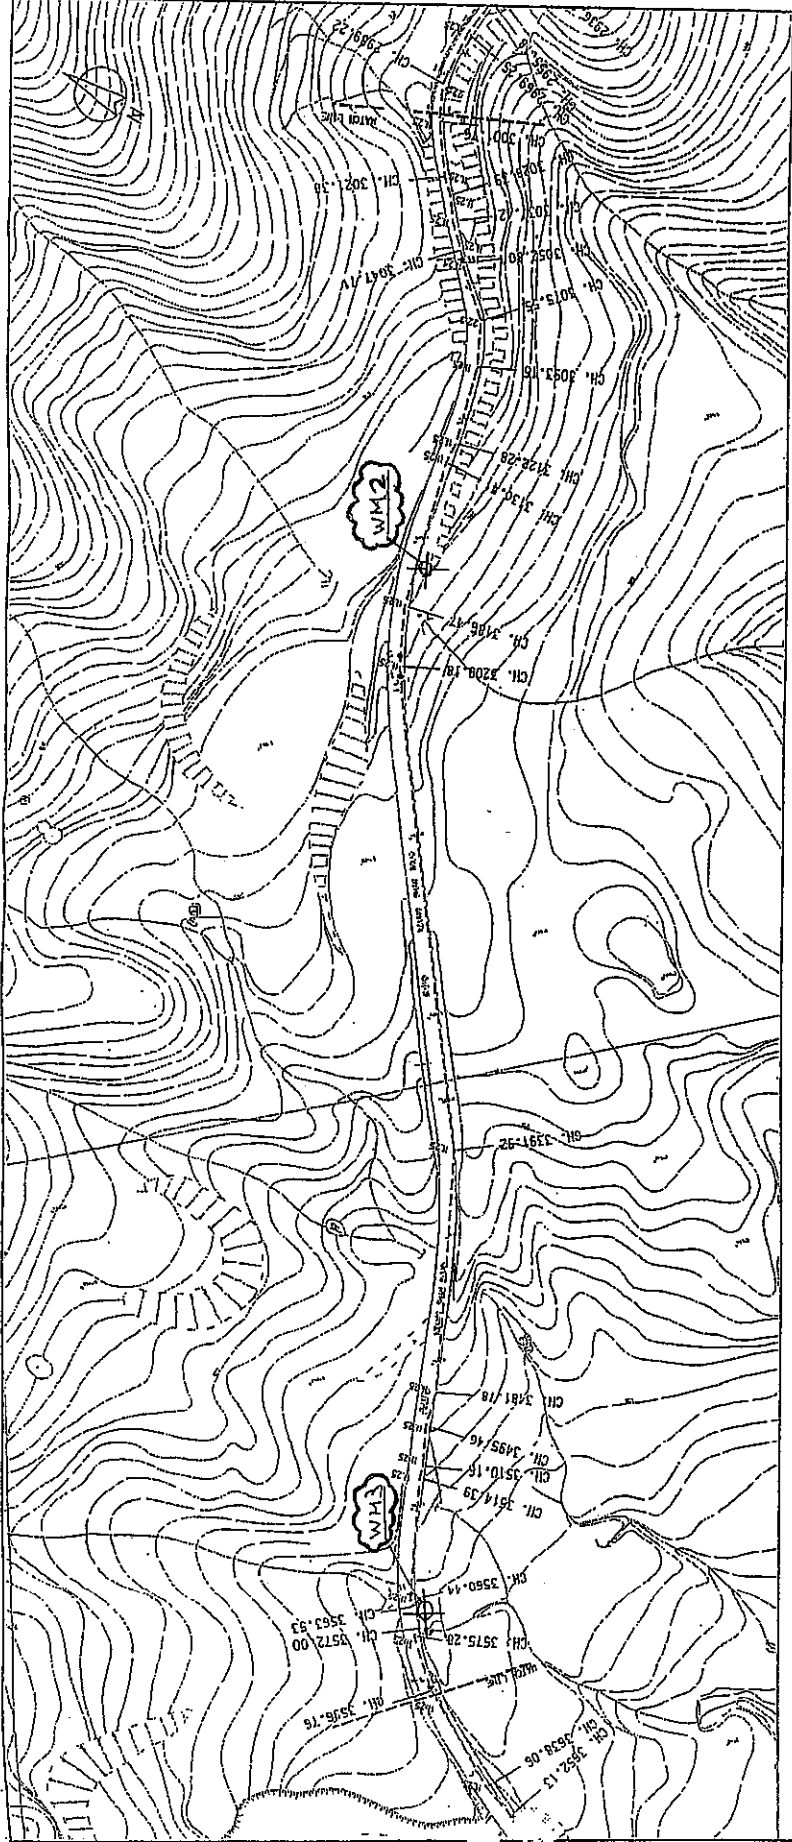

ISSUE FOR CONSTRUCTION	DATE	08/03
Rev. Description	By	DAIS
Drawn/checked		

**ARUP** On Foot Printed King Kong Limited

Project title  
**CONTRACT NO. DC2303009**  
**HONG KONG SEWAGE TREATMENT PLANT, TRUNK SEWERS AND EFFLUENT EXPORT PIPELINE**

Drawing title  
**EFFLUENT EXPORT PIPELINE - ALIGNMENT AND PROFILE (SHEET 6 OF 10)**

Drawn by  
 Checked by  
 Scale  
 Date


Project No. **234007/015**

Site No. **1000**

Sheet No. **6** of **10**

Scale  
 Date

Copyright reserved  
 Government of the Hong Kong  
 Drainage Department  
 Government of the Hong Kong  
 Special Administrative Region

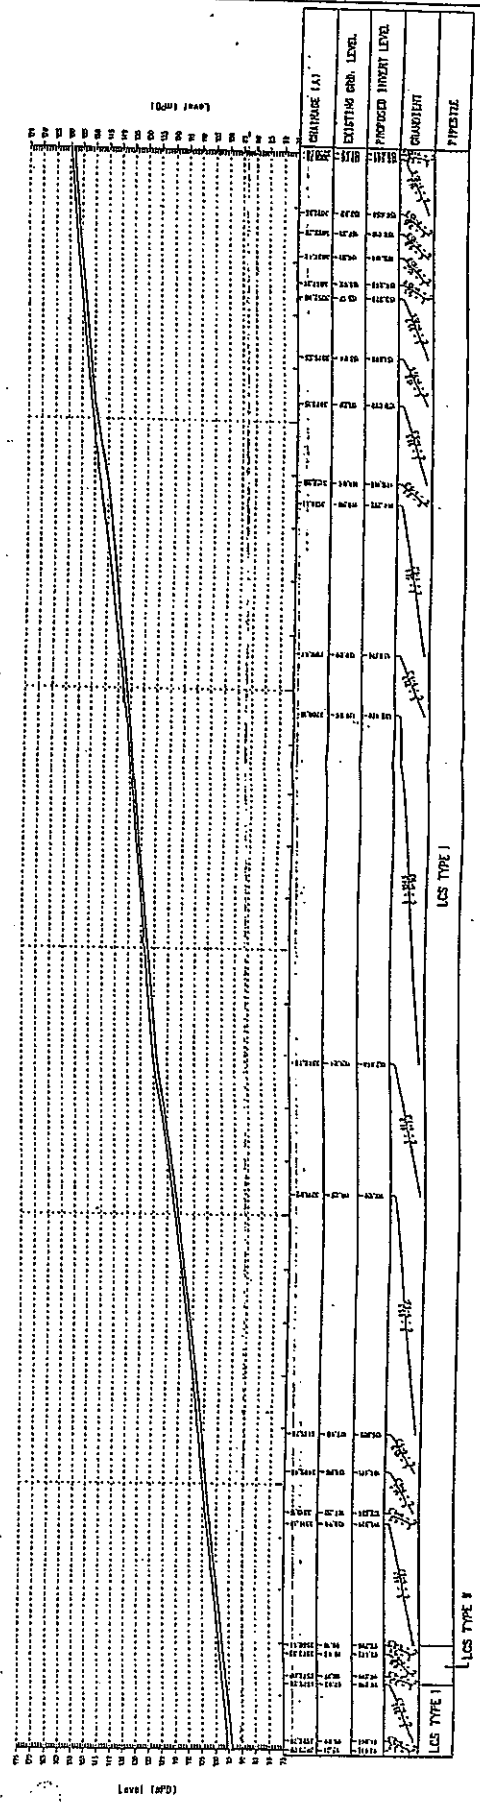

VERTICAL PROFILE

LCS TYPE 1

LCS TYPE 2

LCS TYPE 3

LCS TYPE 4

LCS TYPE 5

LCS TYPE 6

LCS TYPE 7

LCS TYPE 8

LCS TYPE 9

LCS TYPE 10

LCS TYPE 11

LCS TYPE 12

LCS TYPE 13

LCS TYPE 14

LCS TYPE 15

LCS TYPE 16

LCS TYPE 17

LCS TYPE 18

LCS TYPE 19

LCS TYPE 20

LCS TYPE 21

LCS TYPE 22

LCS TYPE 23

LCS TYPE 24

LCS TYPE 25

LCS TYPE 26

LCS TYPE 27

LCS TYPE 28

LCS TYPE 29

LCS TYPE 30

LCS TYPE 31

LCS TYPE 32

LCS TYPE 33

LCS TYPE 34

LCS TYPE 35

LCS TYPE 36

LCS TYPE 37

LCS TYPE 38

LCS TYPE 39

LCS TYPE 40

LCS TYPE 41

LCS TYPE 42

LCS TYPE 43

LCS TYPE 44

LCS TYPE 45

LCS TYPE 46

LCS TYPE 47

LCS TYPE 48

LCS TYPE 49



LCS TYPE 50

LEGENDS :

- EFFLUENT PIPELINE ALIGNMENT
- EXISTING GROUND LEVEL
- EFFLUENT PIPELINE PROFILE
- o HATCHBOX CHANGER
- o GATE VALVES CHAMBER
- v VENTILATION PIPE CHAMBER
- o BENDS

NOTE:

1. REFER TO DRAWING NO. 12/20/2000/01 FOR GENERAL NOTES.
2. THIS DRAWING IS A PART OF THE PROJECT AND IS NOT TO BE USED SEPARATELY.
3. ALL DIMENSIONS ARE IN METERS UNLESS OTHERWISE SPECIFIED.
4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS FROM THE RELEVANT AUTHORITIES.
5. THE CONTRACTOR SHALL MAINTAIN ACCESS TO ALL ADJACENT PROPERTIES AND UTILITIES AT ALL TIMES.
6. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES AND STRUCTURES.
7. THE CONTRACTOR SHALL MAINTAIN A RECORD OF ALL WORK DONE AND SUBMIT IT TO THE ENGINEER UPON COMPLETION.
8. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF ALL WORKERS AND THE PUBLIC.
9. THE CONTRACTOR SHALL MAINTAIN A CLEAN WORK SITE AT ALL TIMES.
10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL ADJACENT PROPERTIES AND UTILITIES.

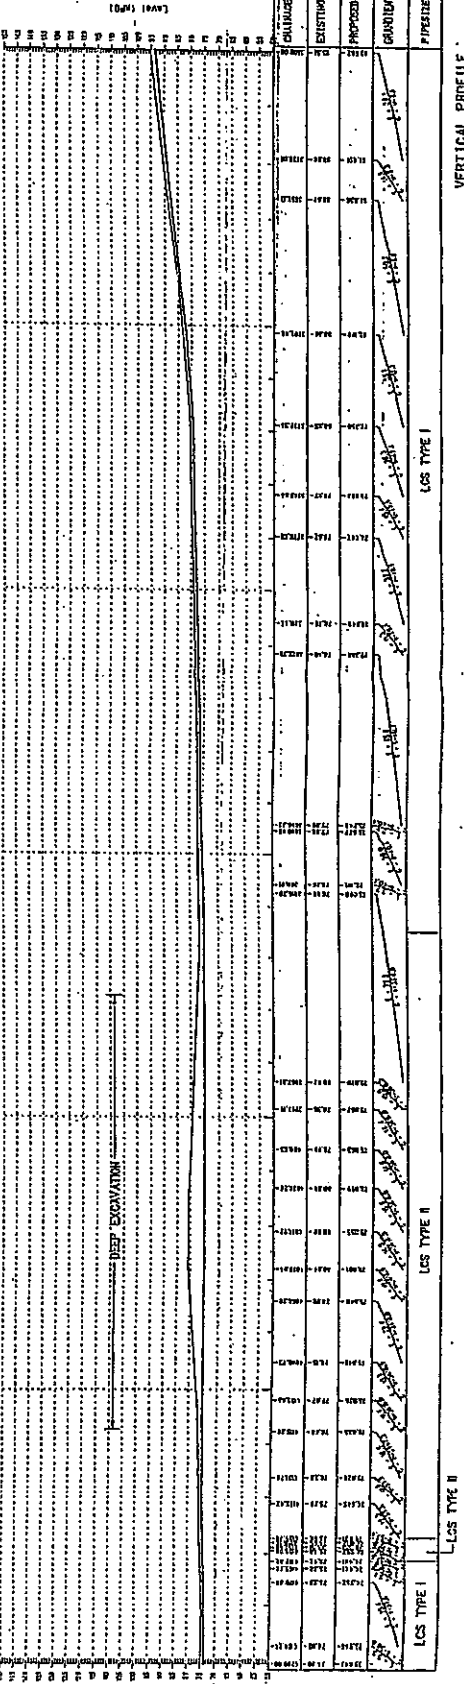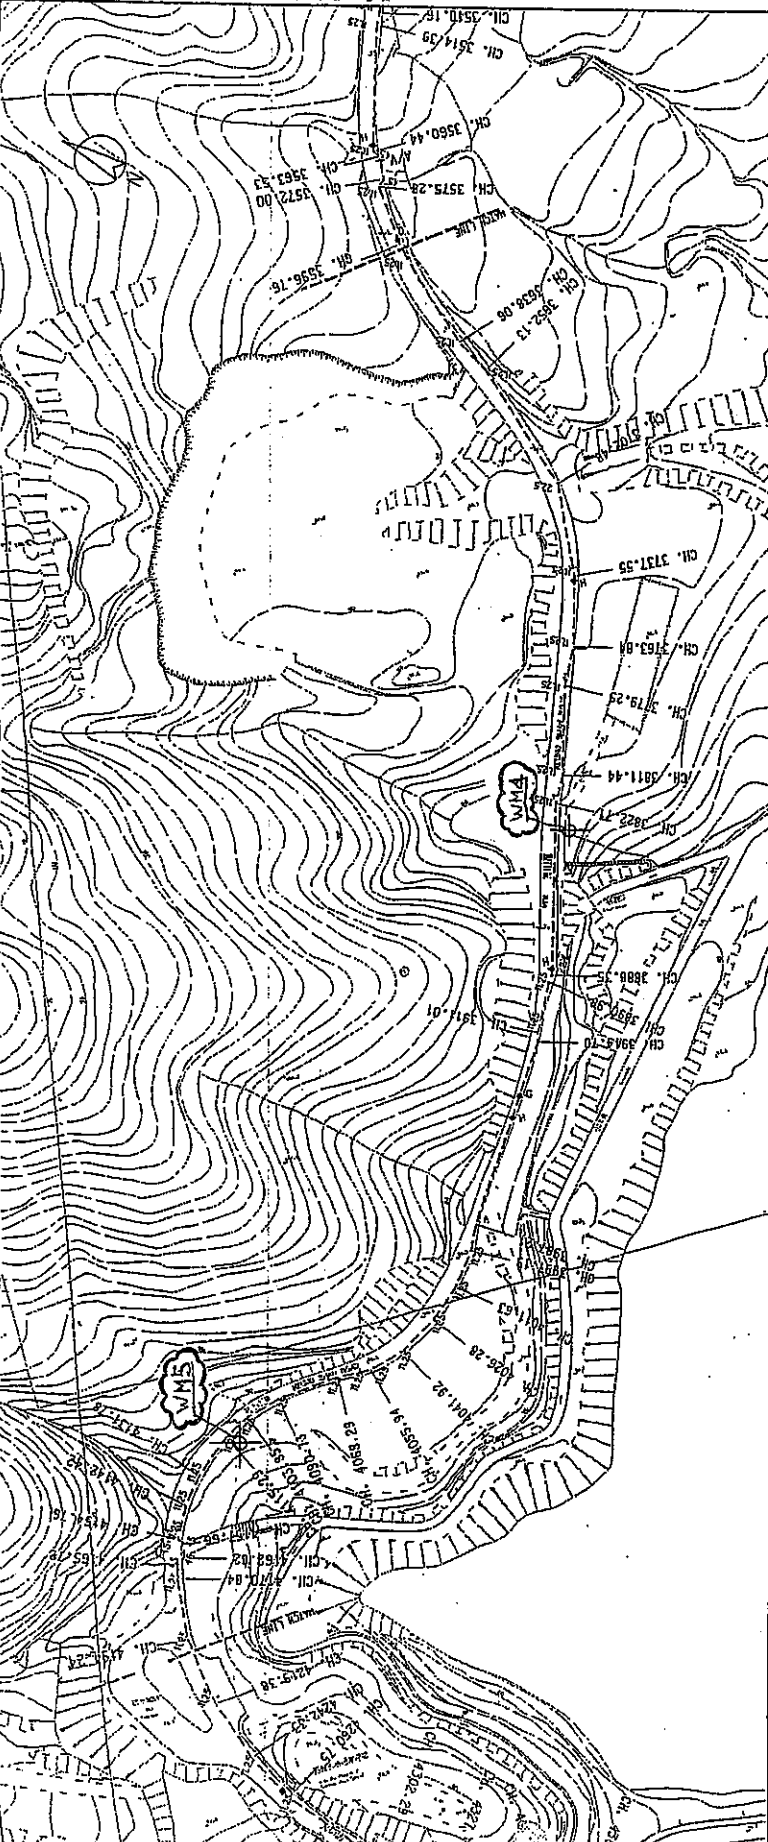

VERTICAL PROFILE

ISSUE FOR CONSTRUCTION	DATE	BY	DATE

PROJECT NAME: One Stop & Parkview Hong Kong Limited

CONTRACT NO. DC/2000/01

AGING PING SEWAGE TREATMENT PLANT, TRUNK SEWERS AND EFFLUENT EXPORT PIPELINE

PROJECT SHEET: 2340007076

SCALE: 1:1000

DATE: 1/10/01

DRYING SHEET: 2340007076

CONTRACT NO. DC/2000/01

AGING PING SEWAGE TREATMENT PLANT, TRUNK SEWERS AND EFFLUENT EXPORT PIPELINE

PROJECT SHEET: 2340007076

SCALE: 1:1000

DATE: 1/10/01

DRYING SHEET: 2340007076

