




| Document Details | | | | | |
|---|------------------------------|--|-------------------------|---------------------|-----------|
| Client Drainage Services Department | | | | | |
| Project Contract No. DC/2007/24 Harbour Area Treatment Scheme Stage 2A Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun | | | | | |
| Document Title Monthly Environmental Monitoring and Audit Report No. 17 Covering the Period from 1 May 2011 to 31 May 2011 | | | | | |
| Document No. EMA/019 | | | | | |
| Distribution | | | | | |
| Copy No. | Issued To | Copy No. | Issued To | | |
| 01-02 | Leighton-LNS JV | 10 | Metcalf & Eddy-AECOM JV | | |
| 03 | Mott MacDonald Hong Kong Ltd | 11 | ACL (Project Office) | | |
| 04-08 | EPD | 12 | ACL (Head Office) | | |
| 09 | DSD | | | | |
| Submission Ref | | | | Controlled Copy No. | |
| SUBM Ref. | | | | | |
| Atkins Ref.(s) | | DC/2007/24/31.20/OG2791/EC/SH/EY | | | |
| | | | | | |
| | | | | | |
| Revision History | | | | | |
| | | | | | |
| C | 23 June 2011 | Submission to IEC and ER for Further Review | Various | Susana Halliday | Eric Chui |
| B | 20 June 2011 | Submission to IEC and ER for Further Review | Various | Susana Halliday | Eric Chui |
| A | 15 June 2011 | Submission to IEC and ER for Review | Various | Susana Halliday | Eric Chui |
| Rev. | Date | Description | Prepared | Checked & Reviewed | Approved |
| | |    Leighton - LNS Joint Venture | | | Rev. C |



Our ref KMY/AFK/FY/TK/T261332/22.01/L-0210
T 2828 5757
E Anne.Kerr@mottmac.com.hk
Your ref -

CE/Harbour Area Treatment Scheme
Drainage Services Department
Sewage Services Branch
Harbour Area Treatment Scheme Division
5/F, Western Magistracy
2A Pokfulam Road, Hong Kong

27 June 2011
By Fax (2833 9162) and Post

Attn: Mr. Danny Tang

Dear Sir,

Agreement No. CE 8/2009(EP)
Harbour Area Treatment Scheme (HATS) Stage 2A
Independent Environmental Checker for Construction Phase – Investigation

Contract No. DC/2007/24
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun
Condition 4.4 – Submission of Monthly EM&A Report for May 2011 (no. 17)

I refer to the Monthly EM&A Report No. 17 (Rev. C) for May 2011 certified by ETL and received on 24 June 2011 via email. Pursuant to Condition 4.4 of Environmental Permit No. EP-322/2008/E, I hereby verify the captioned Report.

Yours faithfully
for MOTT MACDONALD HONG KONG LIMITED

Dr. Anne F Kerr
Independent Environmental Checker

c.c. AECOM
Leighton – LNS JV
Atkins

Mr. Simon Mui
Mr. Stephen Tsang
Ms. Susana Halliday

By email
By email
By email

Contract No. DC/2007/24
Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

Environmental Certification Sheet – 24

Reference Procedure/Document/Plan

| | |
|--|--|
| Document/Plan/Changes/Information to be Certified/ Verified: | Monthly Environmental Monitoring and Audit Report No.17 (EMA/020, Rev C) |
| Date of Report: | 24 June 2011 |
| Date of correspondence to IEC: | 24 June 2011 |
| Date received: | 28 June 2011 |


Reference Condition

Clause 4.4 of EP-322/2008/E:

“Three hard copies and one electronic copy of the monthly EM&A Report shall be submitted to the Director within 10 working days after the end of the reporting month. The EM&A Reports shall include a summary of all non-compliance (exceedances) of the environmental quality performance limits (Action and Limit Levels). The submissions shall be verified by the IEC. Additional copies of the submission shall be provided to the Director upon request by the Director.”

ET Certification

I hereby certify that the above referenced information/document/plan complies with the above referenced condition.

Susana Halliday, Environmental Team Leader, (ACL)  Date: 5 July 2011

**Contract No. DC/2007/24
Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System
From Aberdeen to Sai Ying Pun**

Comments and Responses

Submission Title: Monthly EM&A Report No. 17 (EMA/020) Rev B

| Comments | Designer (Atkins)'s Responses |
|--|-------------------------------|
| Independent Environmental Checker E-mail Date : 21st June 2011 | |
| 1 Section 2.1 | |
| Please amend "edit" to "adit". | Noted and revised |

Contract No. DC/2007/24
Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

Environmental Certification Sheet – 24

Reference Procedure/Document/Plan

| | |
|--|--|
| Document/Plan/Changes/Information to be Certified/ Verified: | Monthly Environmental Monitoring and Audit Report No.17 (EMA/020, Rev C) |
| Date of Report: | 24 June 2011 |
| Date of correspondence to IEC: | 24 June 2011 |
| Date received: | 28 June 2011 |


Reference Condition

Clause 4.4 of EP-322/2008/E:

“Three hard copies and one electronic copy of the monthly EM&A Report shall be submitted to the Director within 10 working days after the end of the reporting month. The EM&A Reports shall include a summary of all non-compliance (exceedances) of the environmental quality performance limits (Action and Limit Levels). The submissions shall be verified by the IEC. Additional copies of the submission shall be provided to the Director upon request by the Director.”

ET Certification

I hereby certify that the above referenced information/document/plan complies with the above referenced condition.

Susana Halliday, Environmental Team Leader, (ACL)  Date: 5 July 2011



Our ref KMY/AFK/FY/TK/T261332/22.01/L-0210
T 2828 5757
E Anne.Kerr@mottmac.com.hk
Your ref -

CE/Harbour Area Treatment Scheme
Drainage Services Department
Sewage Services Branch
Harbour Area Treatment Scheme Division
5/F, Western Magistracy
2A Pokfulam Road, Hong Kong

27 June 2011
By Fax (2833 9162) and Post

Attn: Mr. Danny Tang

Dear Sir,

Agreement No. CE 8/2009(EP)
Harbour Area Treatment Scheme (HATS) Stage 2A
Independent Environmental Checker for Construction Phase – Investigation

Contract No. DC/2007/24
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun
Condition 4.4 – Submission of Monthly EM&A Report for May 2011 (no. 17)

I refer to the Monthly EM&A Report No. 17 (Rev. C) for May 2011 certified by ETL and received on 24 June 2011 via email. Pursuant to Condition 4.4 of Environmental Permit No. EP-322/2008/E, I hereby verify the captioned Report.

Yours faithfully
for MOTT MACDONALD HONG KONG LIMITED

Dr. Anne F Kerr
Independent Environmental Checker

c.c. AECOM
Leighton – LNS JV
Atkins

Mr. Simon Mui
Mr. Stephen Tsang
Ms. Susana Halliday

By email
By email
By email

EXECUTIVE SUMMARY

This is the Seventeenth Monthly Environmental Monitoring and Audit Report prepared by Atkins China Ltd (ACL), for Contract No. DC/2007/24 Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun (hereinafter, the Project), in compliance with the Project EM&A Manual under EP No. EP-322/2008/E. The construction works under the Project was commenced on 23 December 2009. This report summarises the findings and results of the EM&A during the reporting period from 1 May 2011 to 31 May 2011.

Environmental Monitoring and Audit Progress

The monthly EM&A programme has been undertaken in accordance with the Project EM&A Manual. A summary of the monitoring activities carried out during this reporting month is listed below:

Noise and air monitoring at designated monitoring stations was undertaken as below table:

| Parameter | ID | Description | Date |
|--|--------|---|---|
| Noise Monitoring: L_{eq}(30 mins) during normal Daytime | M3 | Kwan Yick Building Phase III | 6, 12, 18, 24 and 30 May 2011 |
| | M5 | Chuk Lam Ming Tong | 3, 9, 19, 25 and 31 May 2011 |
| | M6a | Aegean Terrace | 5, 11, 17 and 23 May 2011 |
| | M7a | Wah Ming House | 5, 11, 17 and 23 May 2011 |
| | M8 | Wah Lai House | 3, 9, 19, 25 and 31 May 2011 |
| Noise Monitoring: L_{eq}(15 mins) during evening time and daytime of Sundays/ public holidays | M5a | Near the entrance of Chuk Lam Ming Tong | Daytime of public holiday: 8 May 2011 |
| | M6a | Aegean Terrace | Daytime of public holiday: 15 May 2011 |
| | M8 | Wah Lai House | Daytime of public holiday: 22 ⁽¹⁾ and 29 May 2011 |
| Noise Monitoring: L_{eq}(15 mins) during night time | M5a | Near the entrance of Chuk Lam Ming Tong | 5 and 19 May 2011 |
| | M6a | Aegean Terrace | 19 and 25 May 2011 |
| Noise Monitoring: L_{eq}(15 mins) during evening time | M3 | Kwan Yick Building Phase III | 9 May 2011 |
| | M5a | Near the entrance of Chuk Lam Ming Tong | 5 May 2011 |
| | M6a | Aegean Terrace | 19 and 25 May 2011 |
| | M8 | Wah Lai House | 25 May ⁽²⁾ 2011 |
| Air Quality Monitoring: 1-hour and 24-hour TSP | CM_FM1 | Western Wholesale Food Market | 1-hour and 24-hour: 5 ⁽³⁾ , 11, 17, 23 and 27 May 2011 |

| | | | |
|-----------------------------|---------|---|--|
| | CM_CB1a | The Arcade, Cyberport | 1-hour: 3, 9, 13, 19, 25 and 31 May 2011 24-hour: 5, 11, 17, 23 and 27 May 2011 |
| | CM_WF1a | Wah Ming House | 1-hour: 5, 11, 17, 23 and 27 May 2011 24-hour: 5, 11, 17, 23 and 27 May 2011 |
| | CM_AB1a | The Hong Kong Ice and Cold Storage, formally known as Dairy Farm Ice and Cold Storage | 1-hour: 3, 9, 13, 19, 25 and 31 May 2011 24-hour: 5, 11, 17, 23 and 27 May 2011 |
| Landscape and Visual | n/a | n/a | 31 May 2011 |
| Hazard to Life | n/a | n/a | On-going |
| Cultural Heritage | n/a | n/a | n/a |

Remark: ⁽¹⁾ The noise monitoring on 22 May 2011 was cancelled due to rainy weather.
⁽²⁾ The noise monitoring on 25 May 2011 was changed location due to no works at Aberdeen.
⁽³⁾ The TSP monitoring on 5 May 2011 was cancelled due to HVS power supply failure

Site inspections were undertaken jointly with the Contractor and Engineer Representative on 3, 11, 17, 24 and 31 May 2011, with Independent Environmental Checker's participation on 24 May 2011.

Breaches of Action and Limit Levels

During the reporting period of this monthly EM&A Report No. 17, five non-project related Limit Level (LL) exceedances in noise criteria were recorded on 5, 9, 19 and 25 May 2011. Two non-project related LL exceedances of noise was recorded during the restricted hours (night time) monitoring at station M5a (near the entrance of Chuk Lam Ming Tong). One non-project related LL exceedance of noise was recorded during the restricted hours (public holiday) monitoring at station M5a (near the entrance of Chuk Lam Ming Tong). And two non-project related LL exceedances of noise was recorded during the restricted hours (night time) monitoring at station M6a (Aegean Terrace). A summary of exceedances is provided in the table below.

| Date of Exceedance | Monitoring Location | Exceedance | Details |
|--------------------|--|---|--|
| 5 May 2011 | M5a, near the entrance of Chuk Lam Ming Tong | Limit Level exceedance 60.7dB(A) during night time | Exceedance was considered to be non-project related. |
| 8 May 2011 | M5a, near the entrance of Chuk Lam Ming Tong | Limit Level exceedance 63.6dB(A) during public holiday | Exceedance was considered to be non-project related. |
| 9 May 2011 | M5a, near the entrance of Chuk Lam Ming Tong | Limit Level exceedance 54.1dB(A) during night time | Exceedance was considered to be non-project related. |

| Date of Exceedance | Monitoring Location | Exceedance | Details |
|--------------------|---------------------|--|--|
| 19 May 2011 | M6a, Aegean Terrace | Limit Level exceedance 60.7dB(A) during night time | Exceedance was considered to be non-project related. |
| 25 May 2011 | M6a, Aegean Terrace | Limit Level exceedance 52.1dB(A) during night time | Exceedance was considered to be non-project related. |

Complaint Log

There were no environmental complaints received during this reporting period.

Notifications of Summons and Prosecutions

There were no notifications of summons or prosecutions received during this reporting period.

Environmental Non-compliance

There were no environmental non-compliances recorded during this reporting period.

Reporting Changes

This report has been developed in compliance with the reporting requirements for the subsequent monthly EM&A report as required by the Project EM&A Manual.

Future Key Issues

Aberdeen

- 1) Blasting Cover installation (implement method statement and standard EMP mitigations).
- 2) Rock Excavation (implement method statement and standard EMP mitigations).
- 3) Shotcrete and Grouting (implement method statement and standard EMP mitigations).

Wah Fu

- 1) Appending for excavation method

Cyberport

- 1) Rock Excavation (implement method statement and standard EMP mitigations).
- 2) Blasting for shaft (implement method statement and standard EMP mitigations).

Sandy Bay

- 1) Rock Excavation (implement method statement and standard EMP mitigations).
- 2) Blasting for Shaft and Adit (implement method statement and standard EMP mitigations).

Sai Ying Pun

- 1) Soil Excavation (implement method statement and standard EMP mitigations).
- 2) Ring beam installation (implement method statement and standard EMP mitigations).
- 3) Shear pin installation (implement method statement and standard EMP mitigations).
- 4) Pumping Test (implement method statement and standard EMP mitigations).

CONTENTS

| | Page |
|---|-----------|
| 1 INTRODUCTION..... | 7 |
| 1.1 Basic Project Information | 7 |
| 1.2 Project Organisation and Contact Details | 7 |
| 1.3 Construction Programme | 7 |
| 1.4 Locations of Monitoring Stations | 7 |
| 2 ENVIRONMENTAL STATUS..... | 8 |
| 2.1 Work undertaken during the Reporting Period | 8 |
| 2.2 Environmental Permit and License | 8 |
| 2.3 Environmental Document Submission | 10 |
| 2.4 Environmental Monitoring Locations | 10 |
| 3 EM&A REQUIREMENTS..... | 12 |
| 3.1 Summary of Impact EM&A Requirements..... | 12 |
| 3.2 Environmental Quality Performance Limits | 12 |
| 3.3 Event Action Plan | 13 |
| 3.4 Environmental Measures and Implementation Status..... | 13 |
| 4 MONITORING RESULTS | 14 |
| 4.1 Monitoring Methodology and QA/QC Procedure | 14 |
| 4.2 Monitoring Equipment..... | 14 |
| 4.3 Equipment Calibration | 15 |
| 4.4 Impact Monitoring Schedule from 1 May 2011 to 31 May 2011 | 15 |
| 4.5 Impact Monitoring Results | 15 |
| 4.6 Weather Condition during Reporting Period | 16 |
| 4.7 Waste Management | 16 |
| 4.8 Landscape and Visual | 16 |
| 4.9 Hazard to Life | 16 |
| 4.10 Cultural Heritage | 17 |
| 5 ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE..... | 18 |
| 5.1 Environmental Exceedance..... | 18 |
| 5.2 Site Inspections and Audit | 18 |
| 5.3 Environmental Complaint and Prosecution | 18 |
| 6 FORECAST AND SCHEDULE | 20 |
| 6.1 Key Issues for the Coming Months | 20 |
| 6.2 Monitoring Schedules for the Next Month | 20 |
| 7 CONCLUSION..... | 21 |

LIST OF TABLES

| | | |
|-----------|---|----|
| Table 2.1 | Summary of Registrations as a Chemical Waste Producer..... | 8 |
| Table 2.2 | Summary of Water Discharge Licences..... | 9 |
| Table 2.3 | Status of Construction Noise Permits..... | 9 |
| Table 2.4 | Summary of Environmental Document Submission..... | 10 |
| Table 3.1 | Summary of Impact EM&A Requirements..... | 12 |
| Table 3.2 | Action and Limit Levels for Impact Noise Monitoring..... | 13 |
| Table 3.3 | Action and Limit Levels for Air Quality Monitoring..... | 13 |
| Table 4.1 | Equipment for Noise Monitoring..... | 14 |
| Table 4.2 | Equipment for Air Quality Monitoring..... | 14 |
| Table 4.3 | Equipment Calibration Frequencies..... | 15 |
| Table 4.4 | Monthly Summary Waste Flow Table during Reporting Period..... | 16 |

LIST OF FIGURES

| | |
|------------|--|
| Figure 1.1 | Overall Layout Plan |
| Figure 2.1 | Construction Noise Monitoring Station at Fung Mat Road Site |
| Figure 2.2 | Construction Noise Monitoring Station at Sandy Bay PTW |
| Figure 2.3 | Construction Noise Monitoring Station at Cyberport PTW |
| Figure 2.4 | Construction Noise Monitoring Station at Wah Fu PTW and Aberdeen PTW |
| Figure 2.5 | Construction Dust Monitoring Station at Fung Mat Road Site |
| Figure 2.6 | Construction Dust Monitoring Station at Cyberport PTW |
| Figure 2.7 | Construction Dust Monitoring Station at Wah Fu PTW and Aberdeen PTW |

APPENDICES

| | |
|------------|---|
| Appendix A | Project Organisation and Contact Details |
| Appendix B | The Contractor's 3-month construction programme |
| Appendix C | Event and Action Plans |
| Appendix D | Mitigation Measures Checklist |
| Appendix E | Weather Conditions during reporting period |
| Appendix F | Calibration Certificates for Noise and Air Quality Monitoring Equipment |
| Appendix G | Monitoring Schedule for the Present and Next Reporting Period |
| Appendix H | Noise Monitoring Results |
| Appendix I | Graphical Presentation of Noise Monitoring Data |
| Appendix J | Air Quality Monitoring Results |
| Appendix K | Graphical Presentation of Air Quality Monitoring Data |
| Appendix L | Landscape and Visual Monitoring Report |
| Appendix M | Environmental Complaint/ Enquiry Form and Notification of Exceedances |
| Appendix N | Summary Records of Site Inspections |

1 INTRODUCTION

1.1 Basic Project Information

The Harbour Area Treatment Scheme (HATS) Stage 2A Sewage Conveyance System is proposed to collect and convey the pre-treated sewage from eight existing Preliminary Treatment Works (PTW), located along the northern and south-western shoreline of Hong Kong Island, to the Stonecutters Island Sewage Treatment Works (SCISTW) for treatment before final disposal into the western harbour via an existing submarine outfall.

The sewerage tunnels to be constructed under Contract No. DC/2007/24 Harbour Area Treatment Scheme Stage 2A Construction of Sewage Conveyance System from Aberdeen to Sai Yin Pun (hereinafter referred as the Project) run from Aberdeen PTW Production/Drop Shaft towards Sai Ying Pun Junction Shaft. The tunnel has a total length of approximately 7.5km and it has various internal sizes. The transitions are located at the junctions with audits connecting to the drop shafts at Aberdeen, Wah Fu, Cyberport, Sandy Bay and Sai Ying Pun. An overall layout plan of the Project is provided in Figure 1.1.

Atkins China Ltd (ACL) was appointed by Leighton-LNS Joint Venture (the Contractor of this Project, hereinafter referred as the Contractor) as the Environmental Team (ET) of this Project, to undertake a Environmental Monitoring and Audit (EM&A) of this Project in accordance with “HATS Stage 2A Environmental Impact Assessment Study – Investigation, Final EM&A Manual” (Register No. AEIAR-121/2008) under Environmental Permit (EP) No. EP-322/2008/E Part D, Condition 4.2.

1.2 Project Organisation and Contact Details

The key parties included:

- Project Proponent – Drainage Services Department
- Contractor – Leighton-LNS JV
- Environmental Authority – Environmental Protection Department
- The Engineer’s Representative (ER) – Metcalf & Eddy-AECOM JV
- Independent Environmental Checker (IEC) - Mott MacDonald Hong Kong Ltd.
- Contractor’s Environmental Team (ET) – Atkins China Ltd.

Project organisation and contact details are shown in Appendix A.

1.3 Construction Programme

The Contractor’s 3-month construction programme is provided in Appendix B.

1.4 Locations of Monitoring Stations

Details of the monitoring stations are provided in Section 3 and relevant figures are shown in Figures 2.1 to 2.7.

2 ENVIRONMENTAL STATUS

2.1 Work undertaken during the Reporting Period

The major construction activities undertaken during this reporting period are summarised below (see Figures 2.1 to 2.7 for the site locations):

Aberdeen

- 1) Excavation Lateral Support (implement method statement and standard EMP mitigations).
- 2) Soil excavation (implement method statement and standard EMP mitigations).
- 3) Grouting (implement method statement and standard EMP mitigations).

Wah Fu

- 1) Appending for excavation method.

Cyberport

- 1) Rock Excavation (implement method statement and standard EMP mitigations).
- 2) Shotcrete, Rock Bolt, Rock Dowel (implement method statement and standard EMP mitigations).
- 3) Blasting for shaft (implement method statement and standard EMP mitigations).

Sandy Bay

- 1) Rock Excavation (implement method statement and standard EMP mitigations).
- 2) Blasting for shaft and adit (implement method statement and standard EMP mitigations).
- 3) Shotcrete, Rock Bolt, Rock Dowel (Implement method statement and standard EMP mitigations).

Sai Ying Pun

- 1) Additional Grouting (implement mitigations stated in the method statement and standard EMP mitigations).
- 2) Pumping test (implement mitigations stated in the method statement and standard EMP mitigations).

2.2 Environmental Permit and License

There were no changes or clarification to the Environmental Permit (EP-322/2008/E) during the reporting period.

Chemical Waste

The Project's registrations as a Chemical Waste Producer are listed in Table 2.1:

Table 2.1 Summary of Registrations as a Chemical Waste Producer

| No. | Location | WPN Number | Issue Date |
|-----|--------------|-------------------|-------------|
| 1 | Cyberport | 5213-171-L2699-01 | 30 Oct 2009 |
| 2 | Sandy Bay | 5213-171-L2699-05 | 30 Oct 2009 |
| 3 | Sai Ying Pun | 5111-112-L2702-01 | 8 Dec 2009 |
| 4 | Wah Fu | 5213-172-L2699-02 | 30 Oct 2009 |

| | | | |
|---|-------------------|-------------------|-------------|
| 5 | Aberdeen PTW | 5213-173-L2699-04 | 30 Oct 2009 |
| 6 | Aberdeen Workshop | 5213-173-L2699-03 | 30 Oct 2009 |

No disposal of chemical waste was carried out in the reporting period.

Water Discharge Licence

Details of water discharge licences for all the Project locations are listed in Table 2.2:

Table 2.2 Summary of Water Discharge Licences

| No. | Location | Licence Number | Issue Date | Validity |
|-----|-------------------|-----------------|------------|-------------|
| 1 | Cyberport | WT00005534-2009 | 3 Dec 2009 | 31 Dec 2014 |
| 2 | Sandy Bay | WT00005533-2009 | 3 Dec 2009 | 31 Dec 2014 |
| 3 | Sai Ying Pun | WT00005489-2009 | 1 Dec 2009 | 30 Nov 2014 |
| 4 | Wah Fu | WT00005532-2009 | 3 Dec 2009 | 31 Dec 2014 |
| 5 | Aberdeen PTW | WT00005535-2009 | 3 Dec 2009 | 31 Dec 2014 |
| 6 | Aberdeen Workshop | WT00005530-2009 | 3 Dec 2009 | 31 Dec 2014 |

Construction Noise Permit

The statuses of Construction Noise Permits for this Project are shown in Table 2.3:

Table 2.3 Status of Construction Noise Permits

| No | Location | Operations | Time | Duration | Remark |
|----|-----------|--|---|-----------------------------|------------------------------|
| 1 | Cyberport | Rock excavation, drilling, welding, grouting for shaft and tunnel | 1900 - 2300 normal day 0700 – 2300 holiday | 3 May 2011 ~ 2 Aug 2011 | Valid with CNP GW-RS 0394-11 |
| 2 | Cyberport | Rock excavation, drilling, welding, grouting for shaft and tunnel | 2300 -0700 normal day 0700 – 2300 holiday | 3 May 2011 ~ 2 Aug 2011 | Valid with CNP GW-RS 0395-11 |
| 3 | Cyberport | Waste water treatment | 1900-2300 normal day 0700-2300 holiday | 9 May 2011 ~ 23 Nov 2011 | Valid with CNP GW-RS 0460-11 |
| 4 | Sandy Bay | Rock excavation, drilling, welding grouting for shaft and tunnel and water treatment | 1900 – 2300 normal day 0700 – 2300 holiday | 3 May 2011 ~ 2 Aug 2011 | Valid with CNP GW-RS 0379-11 |
| 5 | SYP | Rock excavation, drilling, welding grouting for shaft and tunnel | 24 hours | 28 April 2011 ~ 19 Oct 2011 | Valid with CNP GW-RS 0391-11 |
| | | Noise enclosure erection and Soft Excavation | 24 hours | | |
| 6 | Wah Fu | Welding, Grouting and Blower | 1900 – 2300 normal day 0700 – 2300 holiday | 20 May 11 ~ 19 Nov 2011 | Valid with CNP GW-RS 0442-11 |

| | | | | | |
|---|----------|---|---|------------------------------|---------------------------------|
| 7 | Aberdeen | Pumping works | 1900 – 2300 normal day 0700 – 2300 holiday | 16 May 11 ~ 15 November 2011 | Valid with CNP GW-RS 0422-11 |
| 8 | Aberdeen | Water pump, power generator and Aquased | 2300 to 0700 anyday | 21 April 11~ 20 Oct 2011 | Valid with CNP GW-RS0345-11 |

2.3 Environmental Document Submission

A summary of Environmental Certification Sheet submissions within the reporting period under the Project EP is presented in Table 2.4.

Table 2.4 Summary of Environmental Document Submission

| No. | Document Title | Date of Submission | Date of Verification/ Approval |
|-----|--|--------------------|--------------------------------|
| 1 | Monthly Environmental Monitoring and Audit Report No.16, Covering the Period from 1 April 2011 to 30 April 2011 (EMA/019, Rev B) | 30 May 2011 | 1 June 2011 |

2.4 Environmental Monitoring Locations

There are five noise monitoring stations and four air quality monitoring stations designated for the Project and the relevant locations and sensitive receivers are shown on Figures 2.1 to 2.4 and Figures 2.5 to 2.7 respectively. Descriptions of these monitoring stations are provided in Table 2.5.

Table 2.5 Noise and Air Quality Monitoring Stations Descriptions

| Monitoring ID | Description | Uses/ Location of Measurement | Easting | Northing |
|---------------------------------|--|--|---------|----------|
| Noise Monitoring Stations | | | | |
| M3 ⁽¹⁾ | Rooftop (24/F) of Block A, Kwan Yick Building Phase III (Fung Mat Road Site) | Medium-rise domestic premises – private housing estate | 832480 | 816602 |
| M5 | Rooftop (4/F) of Chuk Lam Ming Tong (Sandy Bay PTW) | Hospital and clinics - home for the aged | 830779 | 814609 |
| M5a | Near entrance of Chuk Lam Ming Tong (Sandy Bay PTW) | Hospital and clinics - home for the aged | 830779 | 814609 |
| M6a ^{(2), (3)} | 2m above ground, outside of Aegean Terrace (Cyberport PTW) | Low-rise domestic premises – private housing | 831304 | 813890 |
| M7a ⁽²⁾ | Rooftop (19/F) of Wah Ming House (Wah Fu PTW) | Medium-rise domestic premises – public housing estate | 831940 | 812497 |
| M8 ⁽⁴⁾ | Roof (39/F) of Wah Lai House (Aberdeen PTW) | High-rise domestic premises – public housing estate | 832555 | 812299 |
| Air Quality Monitoring Stations | | | | |
| CM_FM1 ⁽⁵⁾ | Western Wholesale Food Market (Fung Mat Road Site) | Podium | 832341 | 816776 |

| | | | | |
|-----------------------------|---|--|--------|--------|
| CM_CB1a ⁽²⁾ | The Arcade, Cyberport (Cyberport PTW) | Ground level at children playground, adjacent to Project site office | 831298 | 813514 |
| CM_WF1a ⁽²⁾ | Wah Ming House (Wah Fu PTW) | Roof | 831943 | 812497 |
| CM_AB1a ^{(2), (6)} | The Hong Kong Ice and Cold Storage, formally known as Dairy Farm Ice and Cold Storage (Aberdeen PTW) | 1.5m raised platform at car park | 832873 | 812158 |

- Notes:
- (1) Both baseline and impact noise monitoring are conducted by ET of Contract DC/2007/23. The baseline noise monitoring data will be used as a reference and impact noise monitoring data is adopted in this Report.
 - (2) Revision to the original monitoring location in Project EM&A Manual was made and was verified by IEC on 19 November 2009 and subsequently approved by EPD on 27 November 2009.
 - (3) A correction factor of +3dB(A) is added as free field to façade measurement conversion.
 - (4) Both baseline and impact noise quality monitoring was conducted by ET of this Project. The impact noise monitoring data will be adopted by ET of Contract DC/2008/09.
 - (5) Baseline air quality monitoring was conducted by ET of Contract DC/2007/23, whereas impact air quality monitoring was conducted by ET of this Project. The baseline air quality monitoring data will be used as a reference. The impact air quality data will be adopted by ET of Contract DC/2007/23.
 - (6) Both baseline and impact air quality monitoring are conducted by ET of this Project and are adopted by ET of Contract DC/2008/09.

3 EM&A REQUIREMENTS

3.1 Summary of Impact EM&A Requirements

The EM&A for this Project requires quantitative monitoring on noise and air quality (Total Suspended Particulates (TSP)) on regular and ad-hoc basis, in addition to site inspections. A summary of key impact EM&A requirements for this Project is presented in Table 3.1.

Table 3.1 Summary of Impact EM&A Requirements

| Parameter | Description | Frequency |
|----------------------|---|--|
| Noise | Leq(30min) between 07:00 – 19:00 hours on normal weekdays, Leq(15min) for other time periods and L ₁₀ and L ₉₀ (On-site measurement using sound level meter) | Once a week. One set of measurements between 0700 and 1900 hours on normal weekdays. If construction works are extended to include works during the hours of 1900 – 0700 as well as public holidays and Sundays, additional weekly impact monitoring shall be carried out during respective restricted periods. |
| Air Quality | 24-hour TSP (On-site measurement using High Volume Sampler) 1-hour TSP (Measured by direct reading methods which are capable of producing comparable results as that by the high volume sampling method) ⁽¹⁾ ⁽²⁾ | For 24-hour TSP monitoring, the sampling frequency is at least once in every six-days. For 1-hour TSP monitoring, the sampling frequency is at least three times in every six-days. |
| Waste | Routine supervision of construction works | As per site inspection schedule. |
| Landscape and Visual | Survey of full effectuation of mitigation measures | Once per month |
| Hazard to Life | Vibration and ground monitoring along boundary of HKCG Depot Vibration level associated with blasting for Tunnel P, shafts and other construction works | On-going |
| Cultural Heritage | Vibration level at identified historical buildings | On-going |

Notes: ⁽¹⁾ Except at CM_FM1, where HVS is used for the impact monitoring of 1 hour TSP.
⁽²⁾ Laser Particle Photometer (hand held) was used. Relevant specification was submitted to IEC for information on 19 October 2009 under Baseline Environmental Monitoring Plan (GEN/023).

3.2 Environmental Quality Performance Limits

Environmental Quality Performance Limits (Action and Limit levels) for noise and air quality have been developed for the Project Baseline Monitoring Report and are summarised in Table 3.2 and Table 3.3 respectively.

Table 3.2 Action and Limit Levels for Impact Noise Monitoring

| Time Period | Action | Limit |
|---|---|------------------------------|
| 0700-1900 hrs on normal weekdays | When one documented complaint is received | 75dB(A) ⁽¹⁾ |
| 0700-2300 hrs on holidays and 1900-2300 hrs on all other days | | 60/65/70dB(A) ⁽²⁾ |
| 2300-0700 of next day | | 45/50/55dB(A) ⁽²⁾ |

Note: ⁽¹⁾ Between 0700-1900, construction noise limit for school during normal term time is 70dB(A) and 65dB(A) during examination period.

⁽²⁾ To be selected based on Area Sensitivity Rating

Table 3.3 Action and Limit Levels for Air Quality Monitoring

| Monitoring ID | 1-hour TSP Level, µg/m ³ | | 24-hour TSP Level, µg/m ³ | |
|---------------|-------------------------------------|-------|--------------------------------------|-------|
| | Action | Limit | Action | Limit |
| CM_FM1 | 332 ⁽¹⁾ | 500 | 188 ⁽²⁾ | 260 |
| CM_CB1a | 280 ⁽¹⁾ | 500 | 178 ⁽²⁾ | 260 |
| CM_WF1a | 285 ⁽¹⁾ | 500 | 185 ⁽²⁾ | 260 |
| CM_AB1a | 283 ⁽¹⁾ | 500 | 174 ⁽²⁾ | 260 |

Notes: ⁽¹⁾ For Baseline Level ≤ 384 µg/m³, Action Level = (Baseline Level*1.3 + Limit Level)/2;
 For Baseline Level > 384 µg/m³, Action Level = Limit Level

⁽²⁾ For Baseline Level ≤ 200 µg/m³, Action Level = (Baseline Level*1.3 + Limit Level)/2;
 For Baseline Level > 200 µg/m³, Action Level = Limit Level

3.3 Event Action Plan

Event and Action Plans for noise, air quality as well as visual and landscape aspects have been developed as part of the Baseline Monitoring Report for the Project and the details are provided in Appendix C.

3.4 Environmental Measures and Implementation Status

The mitigation measures listed in the Project EIA Report, EM&A Manual and Environmental Permit as well as relevant implementation status are provided in Appendix D. Based on the site inspection findings, it appears that the Contractor has implemented the required mitigation measures during construction works to date.

4 MONITORING RESULTS

4.1 Monitoring Methodology and QA/QC Procedure

Noise Monitoring

Noise monitoring methodology and QA/QC procedure was detailed in Section 4.1 of Monthly EM&A Report No. 1 (GEN/030 Rev B). No change in noise monitoring methodology and QA/QC procedure was made.

Air Quality

Air quality monitoring methodology and QA/QC procedure was detailed in Section 4.1 of Monthly EM&A Report No. 1 (GEN/030 Rev B). No change in air quality monitoring methodology and QA/QC procedure was made.

Landscape and Visual

Monthly site audit is undertaken to check the design, implementation and maintenance of landscape and visual mitigation measures at all Project work sites.

4.2 Monitoring Equipment

Noise

The equipment used for continuous noise monitoring is listed in Table 4.1.

Table 4.1 Equipment for Noise Monitoring

| Equipment | Model |
|-------------------------------|------------------------------|
| Integrated Sound Level Meters | B&K 2238 Serial no. 2684502 |
| Calibrator | B&K 4231, Serial no. 2656516 |

Air Quality

The equipment used for air quality monitoring is listed in Table 4.2.

Table 4.2 Equipment for Air Quality Monitoring

| Parameter Measured | Equipment |
|--|--|
| 1-Hour Sampling for CM_CB1a, CM_WF1a and CM_AB1a | Sibata Laser Dust Monitor Model LD-3B was used for monitoring stations CM_CB1a, CM_WF1a and CM_AB1a. This portable instrument is capable of providing: <ul style="list-style-type: none"> • Real time TSP concentration • Adjustable logging intervals from 6 to 600 seconds • Average concentration over logging interval and maximum and average values for entire logging period |
| 24-Hour Sampling for CM_CB1a, CM_WF1a, CM_AB1a and CM_FM1; and | A High Volume Sampler Model TE-5170, by Tisch Environmental, Inc., was used for monitoring stations CM_CB1a, CM_WF1a and CM_AB1a. This instrument was equipped with: |

| Parameter Measured | Equipment |
|----------------------------|--|
| 1-Hour Sampling for CM_FM1 | <ul style="list-style-type: none"> • Mass flow controller with 20 – 60 SCFM adjustable flow probe • Mechanical timer for recording elapsed-time and 24-hour operation A continuous flow recorder for continuous monitoring |

4.3 Equipment Calibration

The calibration frequencies of the monitoring equipment are provided in Table 4.3.

Table 4.3 Equipment Calibration Frequencies

| Equipment | Calibration Frequency |
|-------------------------------|-----------------------|
| Integrated SLM and Calibrator | Every year |
| High Volume Sampler | Every two months |
| Laser Dust Monitor | Every year |

Copies of the calibration certificates for the equipment are presented in Appendix F.

4.4 Impact Monitoring Schedule from 1 May 2011 to 31 May 2011

The noise and air quality monitoring schedule in reporting period is shown in Appendix G. The visual and landscape monitoring was carried out on 31 May 2011.

Regular site inspections were carried out to assess whether the project's environmental protection and pollution control measures are in compliance with the contract specifications. Inspections were carried out on 3, 11, 17, 24 and 31 May 2011.

4.5 Impact Monitoring Results

Noise Monitoring Results

The noise monitoring results at the monitoring stations are provided in Appendix H. Graphical presentation of the noise monitoring data is shown in Appendix I.

Air Quality Results

The air quality monitoring results at the monitoring stations are presented in Appendix J. Graphical presentation of the air quality monitoring data is provided in Appendix K.

4.6 Weather Condition during Reporting Period

The weather conditions during reporting period are provided in Appendix E.

4.7 Waste Management

A summary of waste flow for May 2011 is outlined in Table 4.4. Inert construction and demolition (C&D) waste (i.e. public fill) was disposed of at Chai Wan Public Fill Barging Point/fill bank at Tseung Kwan O Area 137 (for public fill contains slurry only). Other C&D waste such as paper/ cardboard collected by local waste recycling contractor whilst general refuse was disposed at South East New Territories Landfill.

Table 4.4 Monthly Summary Waste Flow Table during Reporting Period

| Month | Actual Quantities of Inert C&D Materials Generated Monthly | | | | | |
|----------|--|--------------------------------|-------------------------|--------------------------|-----------------------------|---------------|
| | Total Quantity Generated | Broken Concrete ⁽²⁾ | Reused in the Contract | Reused in other Projects | Disposed as Public Fill | Imported Fill |
| | (in '000 m ³) | | | | | |
| May 2011 | 2.132 | 0 | 0 | 0 | 2.132 | 0 |
| Month | Actual Quantities of C&D Wastes Generated Monthly | | | | | |
| | Metals | Paper/ cardboard packaging | Plastics ⁽³⁾ | Chemical Waste | Others, e.g. general refuse | |
| | (in '000 kg) | (in '000 kg) | (in '000 kg) | (in '000 kg) | (in '000 m ³) | |
| May 2011 | 0 | 0.388 | 0 | 0 ⁽⁵⁾ | 0.037 | |

- Notes:
- (1) The waste flow table will also include C&D materials that are specified in the Contract to be imported for use at the Site.
 - (2) Broken concrete for recycling into aggregates.
 - (3) Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material.
 - (4) Assumption: 1m³ of Inert C&D Materials weigh 1.9 tonnes and 1m³ of C&D Wastes weigh 1.6 tonnes
 - (5) There are 22 empty chemical drums were collected by licensed Chemical Waste Collector

4.8 Landscape and Visual

The monthly site audit was undertaken on 31 May 2011 to check the design, implementation and maintenance of landscape and visual mitigation measures, as laid out in the Project EM&A Manual, at work sites in Aberdeen, Wah Fu, Cyberport, Sandy Bay and Sai Ying Pun. The landscape and visual monitoring report is attached in Appendix L.

4.9 Hazard to Life

324 ground settlement markers, 111 structural settlement markers and 72 piezometers were installed for monitoring. No vibration monitoring was carried out at this month.

No structural settlement was found.

4.10 Cultural Heritage

Vibration of historical buildings and structures was not carried out during the reporting period as no tunneling/ blasting works was carried out.

5 ENVIRONMENTAL COMPLAINT AND NON-COMPLIANCE

5.1 Environmental Exceedance

During the reporting period, five non-project related Limit Level (LL) exceedances in noise criteria were recorded on 5, 9, 19 and 25 May 2011. Two non-project related LL exceedances of noise was recorded during the restricted hours (night time) monitoring at station M5a (near the entrance of Chuk Lam Ming Tong). One non-project related LL exceedance of noise was recorded during the restricted hours (public holiday) monitoring at station M5a (near the entrance of Chuk Lam Ming Tong). And two non-project related LL exceedances of noise was recorded during the restricted hours (night time) monitoring at station M6a (Aegean Terrace).

During the reporting period, all landscape and visual mitigation measures listed out in the Project EM&A Manual have been implemented except CM2 and CM3 at Sandy Bay site . Construction materials and debris stored very near to the roots of the retained trees T027(R) and T028(R) were still observed at Sandy Bay that might affect the health condition of the tree. Transplanted trees T004 (T) and T005 (T) were still found to be in very poor health condition or it might be dead since the last five monthly audits. It was also observed that retained trees T036(R), T037(R) and T018(R) were showing poor health condition due to stagnant water formation in the area. Retained trees T036(R), T037(R) and T018(R) were soaked in a muddy and watery soil area of the site due to water leakage of the nearby pipe in Sandy Bay were improved and well maintained.

According to the Contractor's monitoring data, no exceedance in structural settlement monitoring results was recorded during the reporting period.

5.2 Site Inspections and Audit

A joint site inspection with the IEC and the Contractor was undertaken on 24 May 2011. All the works areas were observed to be generally complied with the environmental mitigation requirements and no particular water quality impacts found.

Records of site inspections observations and corrective actions during the reporting period are provided in Appendix N. Following the environmental inspections, the Contractor has undertaken remedial actions to improve the implementation of mitigation measures.

The Contractor has prepared a Waste Management Plan for the project, although it is not an EP requirement. During the site inspection, the Contractor was seen to have implemented good site practices and mitigation measures as stated in the EM&A Manual.

5.3 Environmental Complaint and Prosecution

No complaints were received in relation to environmental impact during the reporting period. The summary of environmental complaints is shown in Table 5.1.

Table 5.1 Summary of Environmental Complaints

| Total No. of Complaints Received | No. of Complaints Received during Reporting Period | No. of Active Complaints | No. of Inactive Closed Complaints |
|----------------------------------|--|--------------------------|-----------------------------------|
| 5 | 0 | 0 | 5 |

No notifications of summons or prosecutions were received in relation to environmental impact during the reporting period (see Table 5.2).

Table 5.2 Summary of Notifications of Summons and Prosecutions

| Total No. of Notifications of Summons / Prosecutions Received | No. of Notifications of Summons / Prosecutions Received during Reporting Period | Status of Notifications of Summons / Prosecutions |
|---|---|---|
| 0 | 0 | N/A |

6 FORECAST AND SCHEDULE

6.1 Key Issues for the Coming Months

The key issues with respect to the works in the forthcoming 2 months include:

Aberdeen

- 1) Blasting Cover (implement method statement and standard EMP mitigations).
- 2) Rock Excavation (implement method statement and standard EMP mitigations).

Wah Fu

- 1) Appending for excavation method.

Cyberport

- 1) Rock Excavation (implement method statement and standard EMP mitigations).
- 2) Shotcrete, Rock Bolt, Rock Dowel (implement method statement and standard EMP mitigations).
- 3) Blasting in Adit and Shaft (implement method statement and standard EMP mitigations).

Sandy Bay

- 1) Rock Excavation (implement method statement and standard EMP mitigations).
- 2) Blasting in Adit and Shaft (implement method statement and standard EMP mitigations).

Sai Ying Pun

- 1) Shear Pin installation (implement mitigations stated in the method statement and standard EMP mitigations).
- 2) Ring Beam Installation (implement mitigations stated in the method statement and standard EMP mitigations).
- 3) Pumping test (implement method statement and standard EMP mitigations).
- 4) Soil excavation (implement method statement and standard EMP mitigations).

6.2 Monitoring Schedules for the Next Month

The proposed schedule for noise monitoring from 1 June 2011 to 30 June 2011 is provided in Appendix G.

7 CONCLUSION

This is the Seventeenth Monthly EM&A Report prepared by Atkins China Ltd (ACL) for Contract No. DC/2007/24 Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun. This Report summarises the results and findings of the EM&A during the reporting period from 1 to 31 May 2011.

During the reporting period five non-project related Limit Level (LL) exceedances in noise criteria were recorded on 5, 9, 19 and 25 May 2011. Two non-project related LL exceedances of noise was recorded during the restricted hours (night time) monitoring at station M5a (near the entrance of Chuk Lam Ming Tong). One non-project related LL exceedance of noise was recorded during the restricted hours (public holiday) monitoring at station M5a (near the entrance of Chuk Lam Ming Tong). And two non-project related LL exceedances of noise was recorded during the restricted hours (night time) monitoring at station M6a (Aegean Terrace).


There was no environmental, non-compliance attributable to the Project works during the reporting period. Also, no environmental complaint, prosecution or summons was received during the reporting period. Mitigation Measures stated in the Project EIA have been implemented.

The landscape and visual site audit was undertaken on 31 May 2011 to check the design, implementation and maintenance of L&V mitigation measures at work sites. All landscape and visual mitigation measures listed out in the Project EM&A Manual have been implemented except CM2 and CM3 at Sandy Bay site.


Overall, environmental impacts arising from the Project construction activities have been controlled and properly rectified.

FIGURES

SEWAGE TUNNEL ALIGNMENT

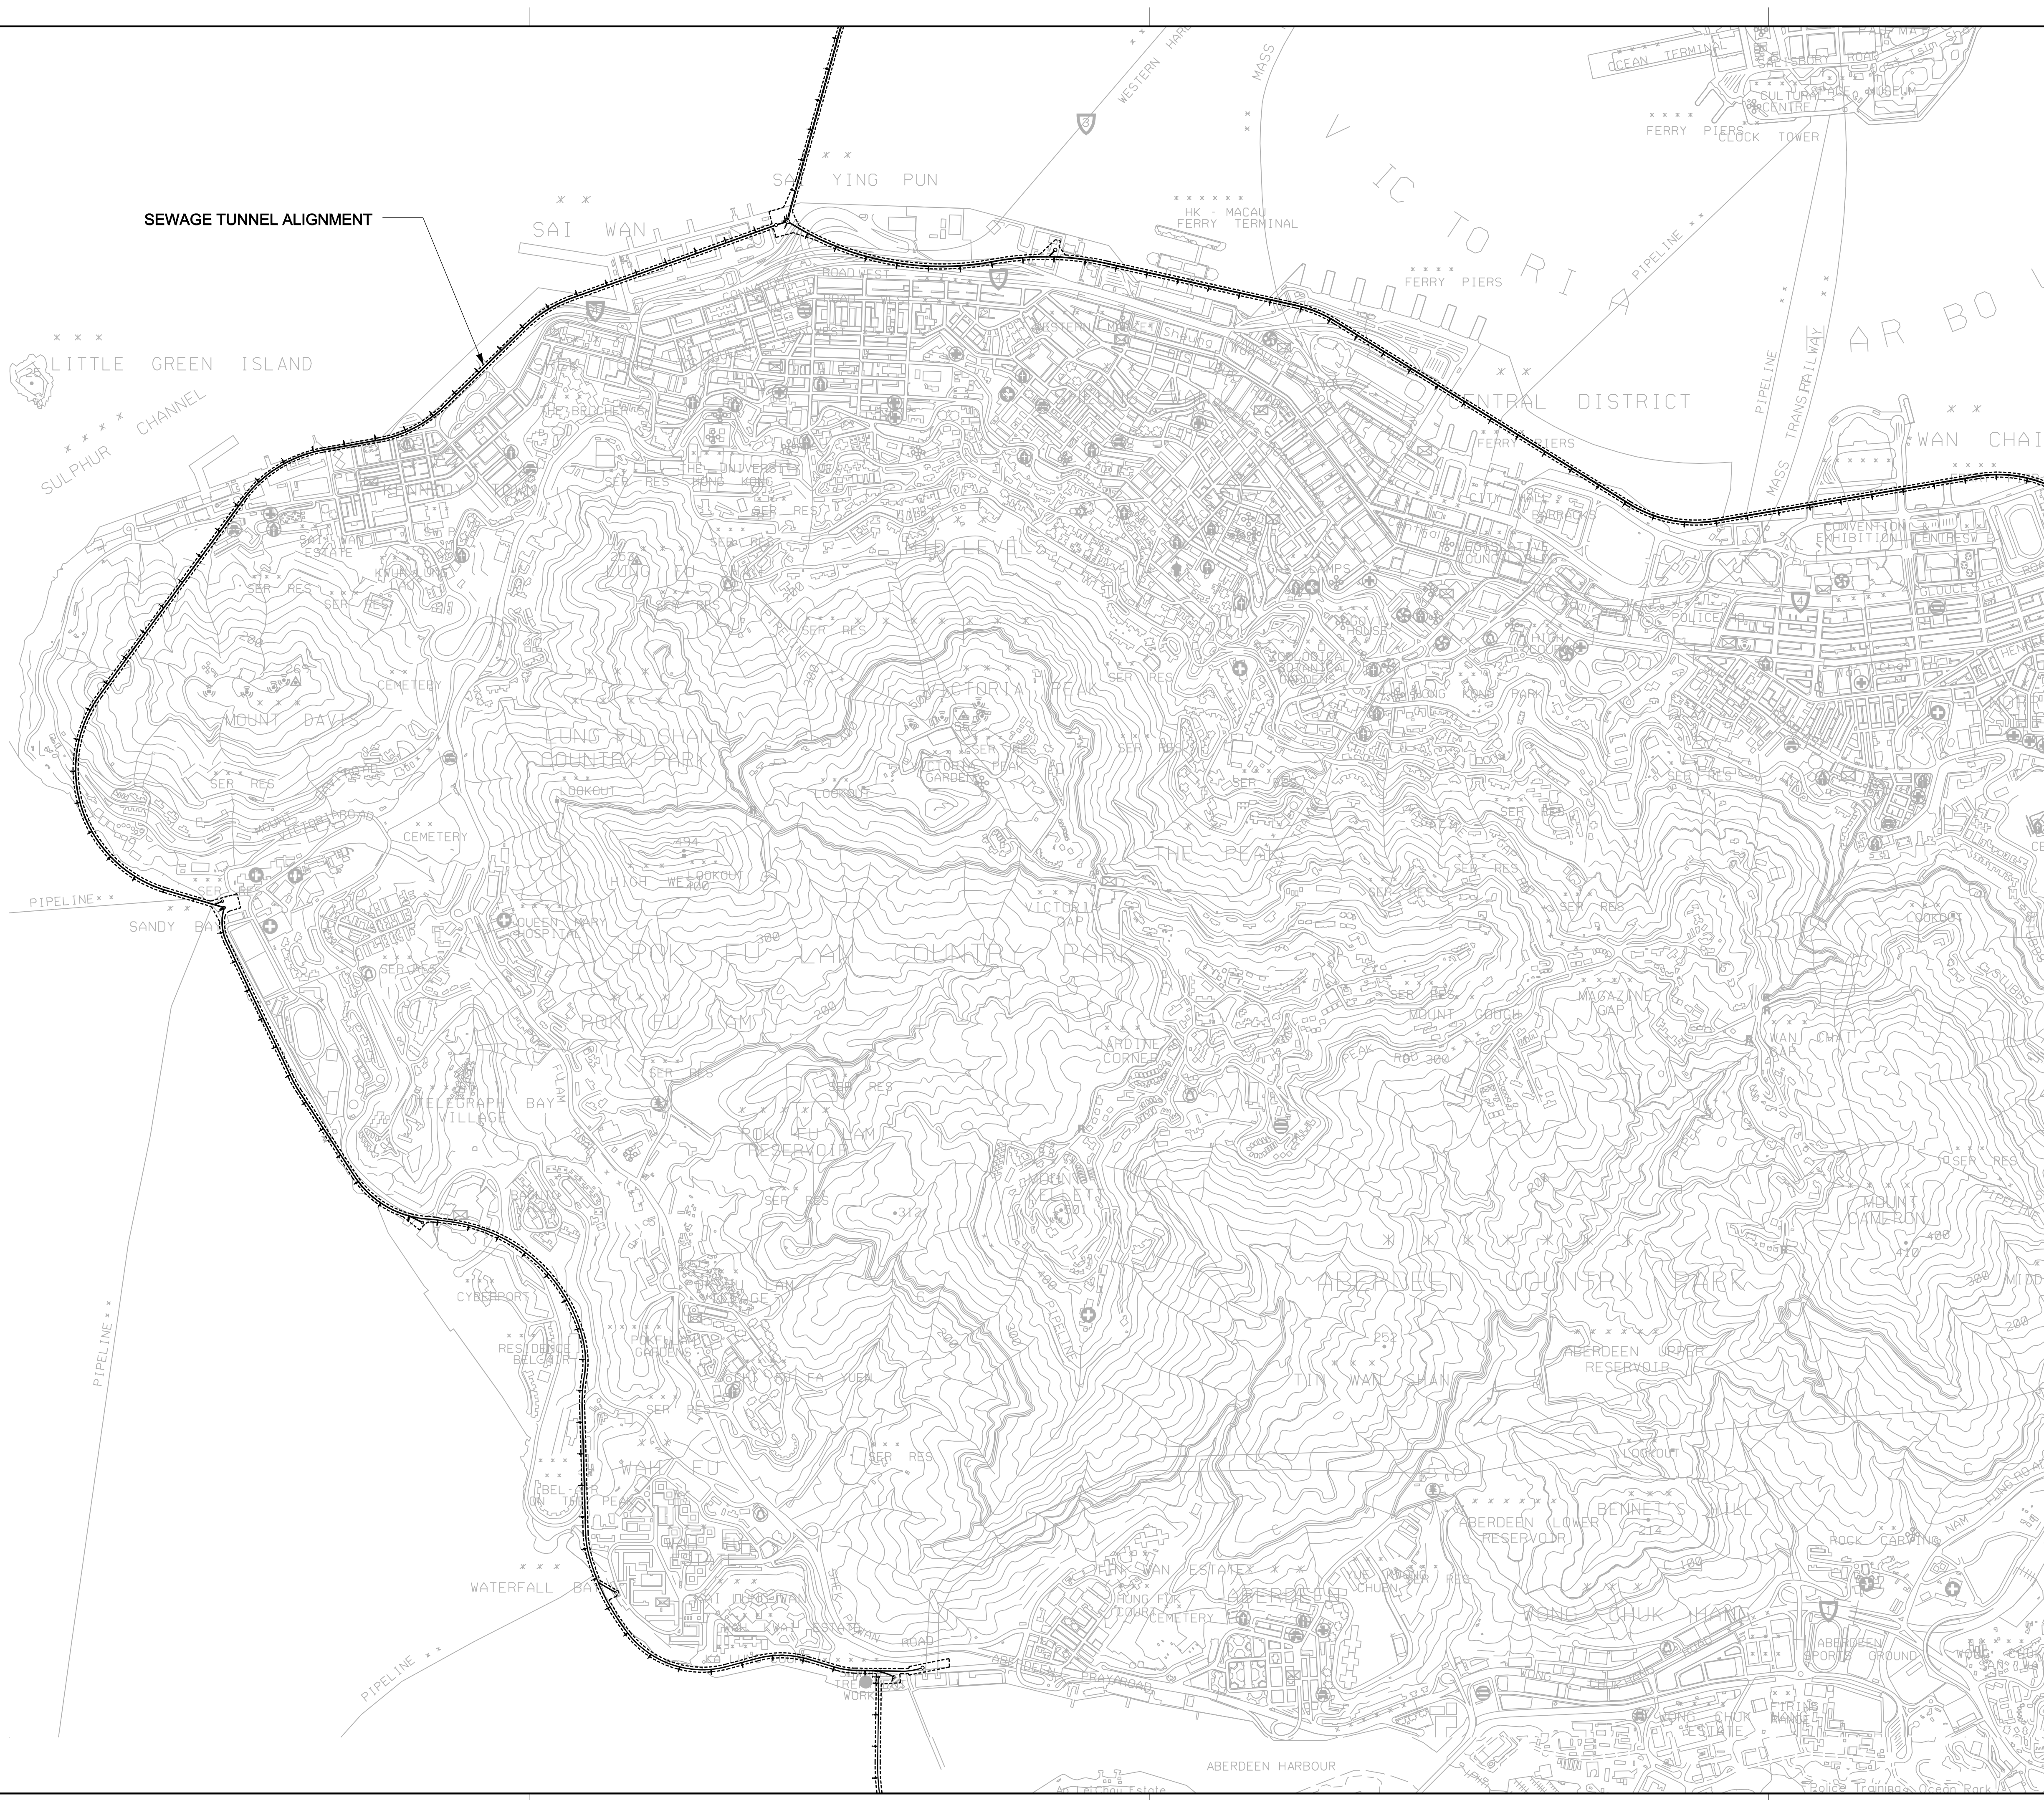



| | | | | | |
|-----|-------------|-------|-----|-----|------|
| Rev | Description | Date | Dgn | Chk | Auth |
| A | FIRST ISSUE | 03/02 | SC | SB | EC |

| | |
|---|--|
|  | 渠務署 DRAINAGE SERVICES DEPARTMENT |
| | HARBOUR AREA TREATMENT SCHEME DIVISION |

| | |
|--|--|
| Project title | |
| CONTRACT NO. DC/2007/24 HARBOUR AREA TREATMENT SCHEME STAGE 2A CONSTRUCTION OF SEWAGE CONVEYANCE SYSTEM FROM ABERDEEN TO SAI YING PUN | |

| | |
|--------------------------------------|--|
| Supervising Officer | |
| AECOM | |
| Metcalf & Eddy – AECOM Joint Venture | |

| | |
|---|---|
| Main Contractor | |
|  |  |
| Leighton - LNS Joint Venture | |


| | |
|----------|--|
| Designer | |
| ATKINS | |

| | |
|---------------------|--|
| Drawing title | |
| OVERALL LAYOUT PLAN | |

| | | | |
|------------|-------------|---------------------|--------|
| Designed | Scale at A3 | Status | N.T.S. |
| SC | | | |
| Drawn | | Figure No. | 1.1 |
| AC | | | |
| Checked | | Rev. | A |
| SB | | | |
| Authorised | | MONTHLY EM&A REPORT | |
| EC | | 4417-EM-F16-1-1.dgn | |

100mm

A1 841mm x 594mm

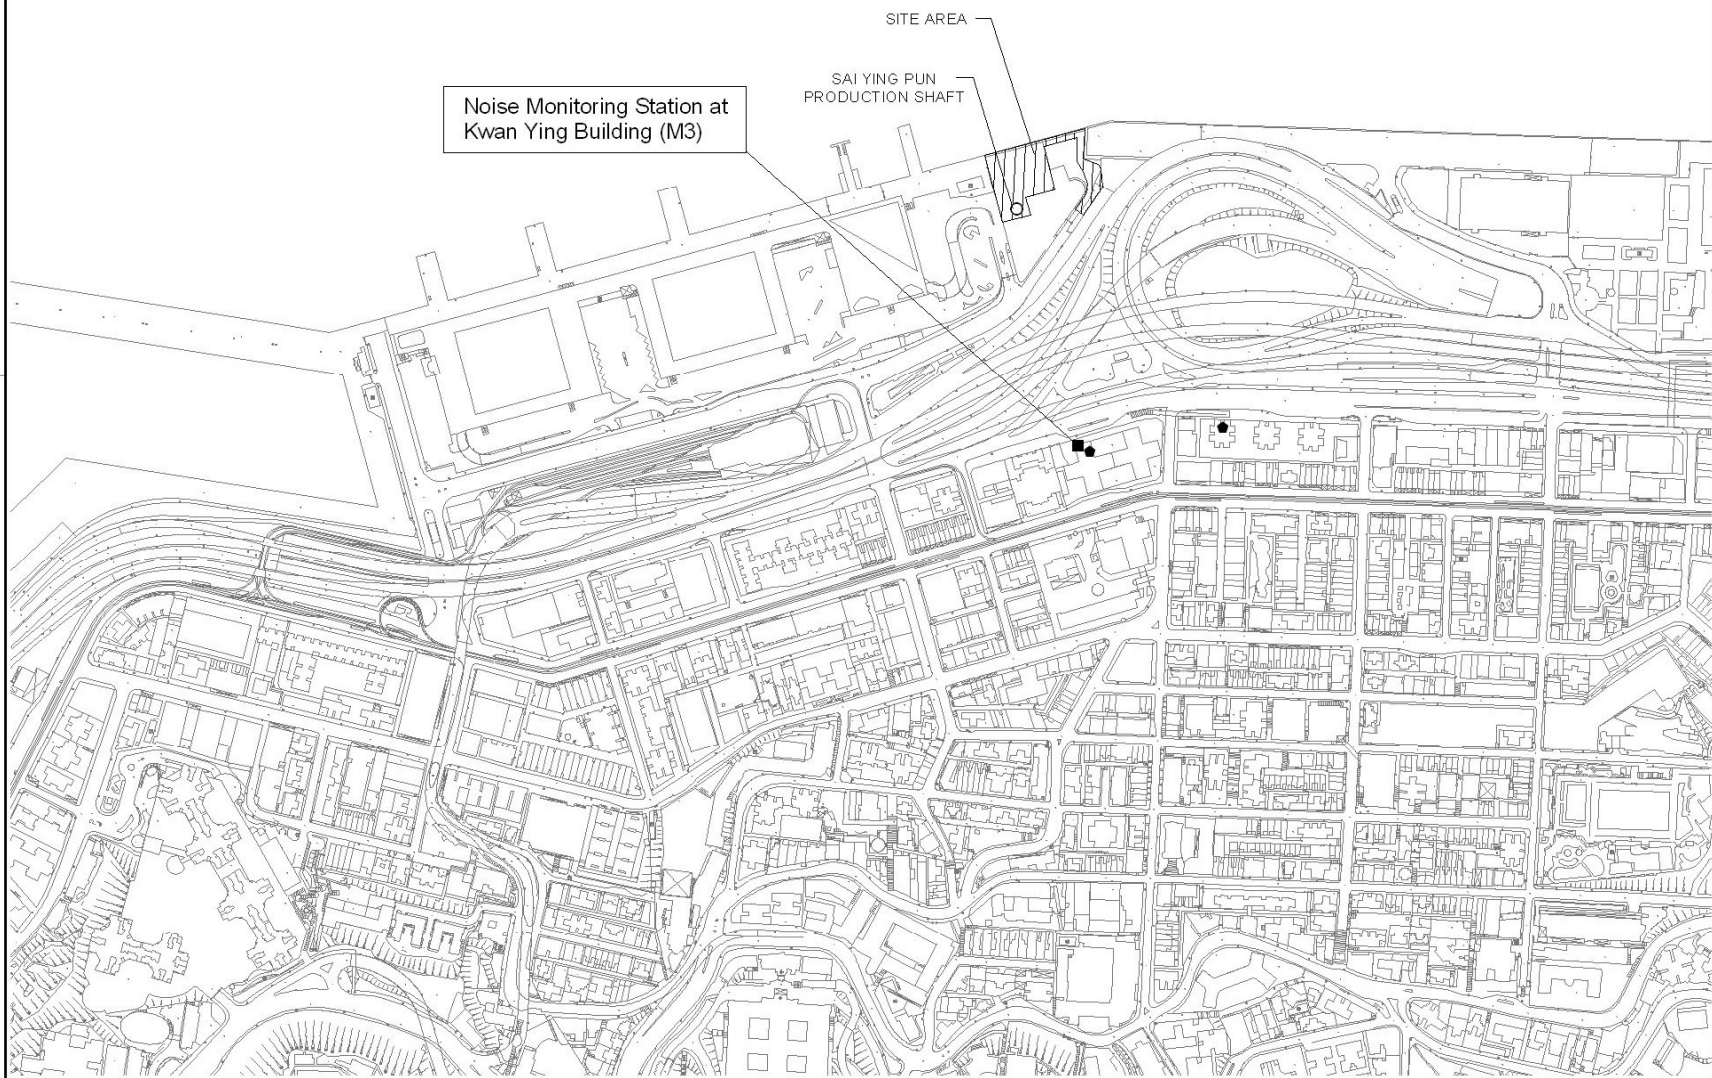

LEGEND

- NOISE MONITORING STATION
- NOISE SENSITIVE RECEIVERS

0 50 100 150 Meters

| No. | Description | Date | Eng. | Chk. | Aut. |
|---|---------------------|------|------|------|------|
| 渠務署 DRAINAGE SERVICES DEPARTMENT HARBOUR AREA TREATMENT SCHEME DIVISION | | | | | |
| Project Title CONTRACT NO. DC/2007/24 HARBOUR AREA TREATMENT SCHEME STAGE 2A CONSTRUCTION OF SEWAGE CONVEYANCE SYSTEM FROM ABERDEEN TO SAI YING PUN | | | | | |
| Supervising Officer <div style="text-align: center;"> AECOM Metcal & Eddy – AECOM Joint Venture </div> | | | | | |
| Main Contractor <div style="display: flex; justify-content: space-around;"> <div style="text-align: center;"> LEIGHTON 禮頓 </div> <div style="text-align: center;"> LNS </div> </div> <div style="text-align: center; margin-top: 5px;"> Leighton - LNS Joint Venture </div> | | | | | |
| Designer <div style="text-align: center;"> ATKINS </div> | | | | | |
| Drawing Title CONSTRUCTION NOISE MONITORING STATION AT FUNG MAT ROAD SITE | | | | | |
| Designed | Scale or 1:1 | | | | |
| Drawn | Status | | | | |
| Checked | MONTHLY EM&A REPORT | | | | |
| Author load | Drawing No. | Rev. | | | |
| CAD ref. | 2.1 | | A | | |



Noise Monitoring Location at Aegean Terrace (M6a)

CYBERPORT
PTW

PRODUCTION SHAFT /
DROP / RISER SHAFT

TEMPORARY CONSTRUCTION SITE
(WITHOUT SURFACE EXCAVATION WORKS)

LEGEND

- NOISE MONITORING STATION
- NOISE SENSITIVE RECEIVERS

0 50 100 150 Meters

| Rev | Description | Date | Dgn | Chk | Auth |
|-----|-------------|------|-----|-----|------|
| | | | | | |

渠務處
DRAINAGE SERVICES DEPARTMENT
HARBOUR AREA TREATMENT SCHEME DIVISION

Project title
**CONTRACT NO. DC/2007/24
HARBOR AREA TREATMENT SCHEME STAGE 2A
CONSTRUCTION OF SEWAGE CONVEYANCE SYSTEM
FROM ABERDEEN TO SAI YING PUN**

Supervising Engineer
AECOM
Metcalf & Eddy – AECOM Joint Venture


Main Contractor

**Leighton - LNS
Joint Venture**

Designer
ATKINS

Drawing title
**CONSTRUCTION NOISE
MONITORING STATION AT
CYBERPORT PTW**

| | |
|------------|--------------------------------|
| Revised | Scale of A1 |
| Drawn | Status |
| Checked | MONTHLY EM&A REPORT |
| Authorised | Drawing No. |
| CAD ref. | 23 |
| Rev. | A |

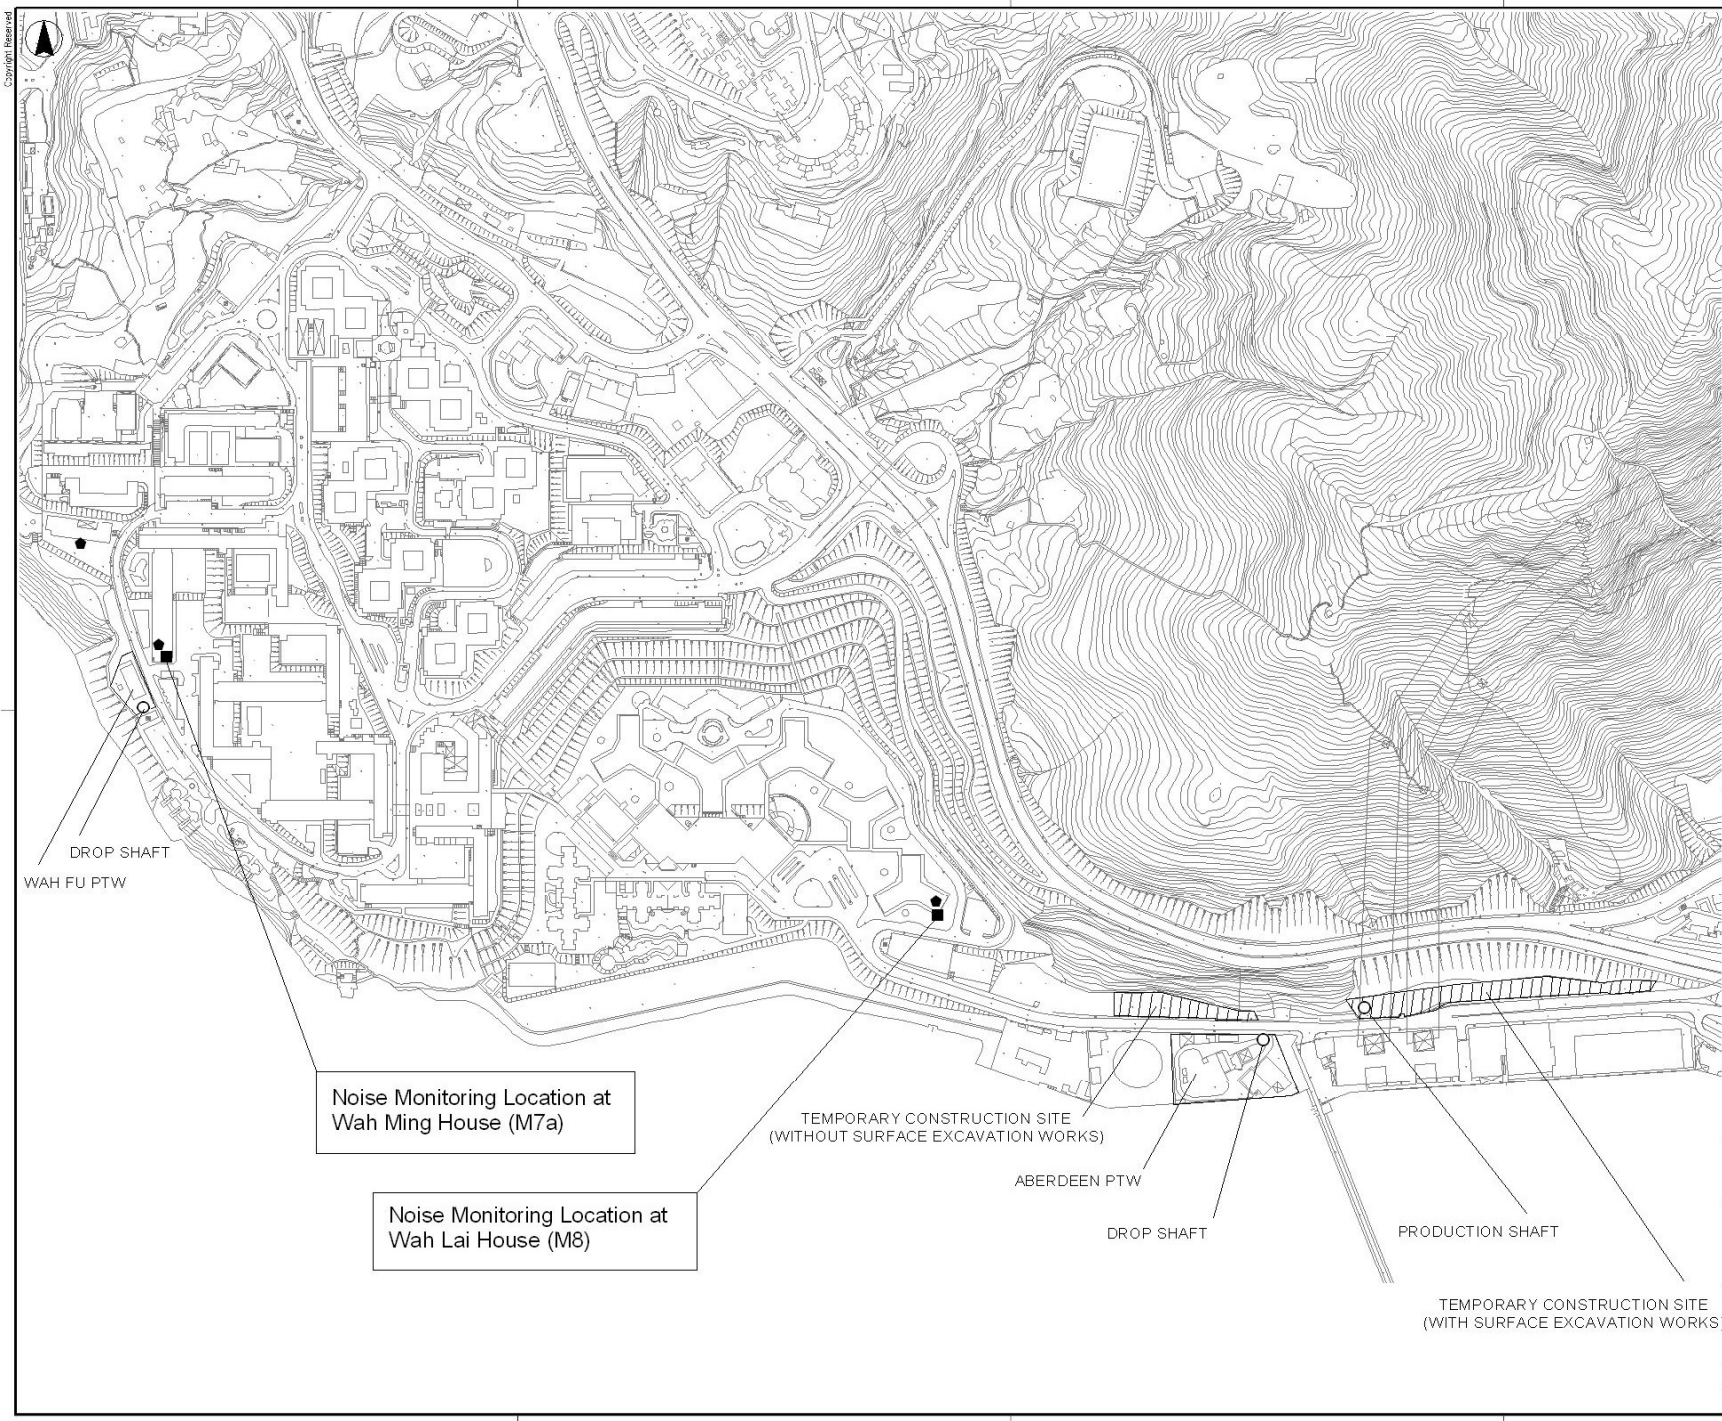

LEGEND

- NOISE MONITORING STATION
- NOISE SENSITIVE RECEIVERS

0 50 100 150 Meters

| Rev | Description | Date | Dgn | Crk | Auth |
|-----|-------------|------|-----|-----|------|
| | | | | | |

DRAINAGE SERVICES DEPARTMENT
HARBOUR AREA TREATMENT SCHEME DIVISION

Project title: **CONTRACT NO. DC/2007/24**
HARBOUR AREA TREATMENT SCHEME STAGE 2A
CONSTRUCTION OF SEWAGE CONVEYANCE SYSTEM
FROM ABERDEEN TO SAI YING PUN


Supervising Engineer: **AECOM**
Metcalf & Eddy – AECOM Joint Venture

Main Contractor: **LEIGHTON** (Leighton) and **LNS** (LNS)
Leighton - LNS Joint Venture

Designer: **ATKINS**

Drawing title: **CONSTRUCTION NOISE MONITORING STATION AT WAH FU AND ABERDEEN PTW**

| | | | |
|------------|-------------|---------------------|--------|
| Revised | Scale of A1 | | |
| Drawn | Status | MONTHLY EM&A REPORT | |
| Checked | | | |
| Authorised | Drawing No. | 24 | Rev. A |
| CAD ref. | | | |

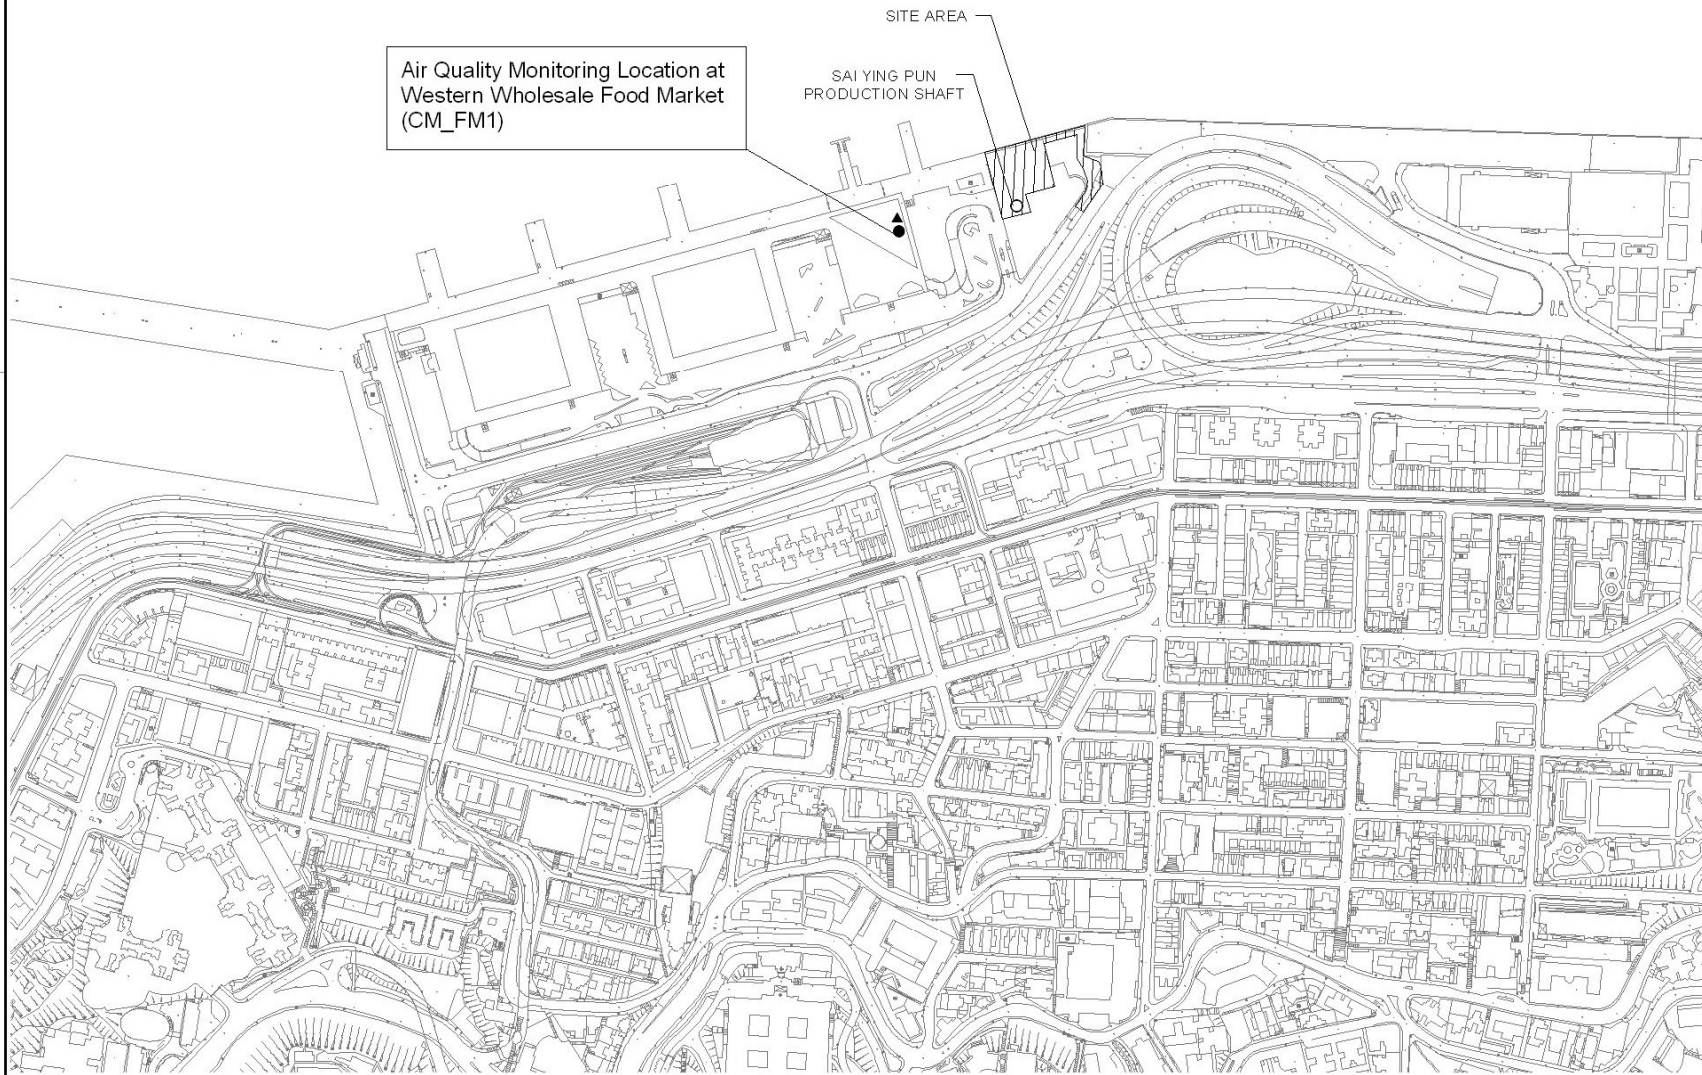

Air Quality Monitoring Location at
Western Wholesale Food Market
(CM_FM1)

SITE AREA
SAI YING PUN
PRODUCTION SHAFT

LEGEND

- ▲ AIR SENSITIVE RECEIVERS
- DUST MONITORING STATION

0 50 100 150 Meters

| Rev | Description | Date | By | Chk | Aut |
|---|---------------------|------|----|-----|-----|
|  渠務署 DRAINAGE SERVICES DEPARTMENT HARBOUR AREA TREATMENT SCHEME DIVISION | | | | | |
| Project title CONTRACT NO. DC/2007/24 HARBOR AREA TREATMENT SCHEME STAGE 2A CONSTRUCTION OF SEWAGE CONVEYANCE SYSTEM FROM ABERDEEN TO SAI YING PUN | | | | | |
| Supervising Officer <div style="text-align: center;">  AECOM Metcal & Eddy – AECOM Joint Venture </div> | | | | | |
| Main Contractor <div style="display: flex; justify-content: space-around; align-items: center;"> <div style="text-align: center;">  LEIGHTON 禮頓 </div> <div style="text-align: center;">  LNS </div> </div> <div style="text-align: center; margin-top: 5px;">  Leighton - LNS Joint Venture </div> | | | | | |
| Designer <div style="text-align: center;">  ATKINS </div> | | | | | |
| Drawing title CONSTRUCTION DUST MONITORING STATION AT FUNG MAT ROAD SITE | | | | | |
| Designed | Scale or 1:1 | | | | |
| Drawn | Status | | | | |
| Checked | MONTHLY EM&A REPORT | | | | |
| Author load | Drawing No. | Rev. | | | |
| CAD ref. | | 25 | | | A |



CYBERPORT
PTW

PRODUCTION SHAFT /
DROP / RISER SHAFT

TEMPORARY CONSTRUCTION SITE
(WITHOUT SURFACE EXCAVATION WORKS)

Air Quality Monitoring Station
at the Arcade, Cyberport (CM_CB1a)

LEGEND

- ▲ AIR SENSITIVE RECEIVERS
- DUST MONITORING STATION

0 50 100 150 Meters

| Rev | Description | Date | Dgn | Chk | Auth |
|-----|-------------|------|-----|-----|------|
| | | | | | |

渠務局
DRAINAGE SERVICES DEPARTMENT
HARBOUR AREA TREATMENT SCHEME DIVISION

Project title
CONTRACT NO. DC/2007/24
HARBOUR AREA TREATMENT SCHEME STAGE 2A
CONSTRUCTION OF SEWAGE CONVEYANCE SYSTEM
FROM ABERDEEN TO SAI YING PUN

Supervising Engineer
AECOM
Metcalf & Eddy – AECOM Joint Venture


Main Contractor

Leighton - LNS
Joint Venture

Designer
ATKINS

Drawing title
CONSTRUCTION DUST
MONITORING STATION AT
CYBERPORT PTW

| Revised | Scale of A1 |
|------------|---------------------|
| | |
| Drawn | Status |
| Checked | MONTHLY EM&A REPORT |
| Authorised | Drawing No. |
| CAD ref. | 26 |
| | Rev. |
| | A |

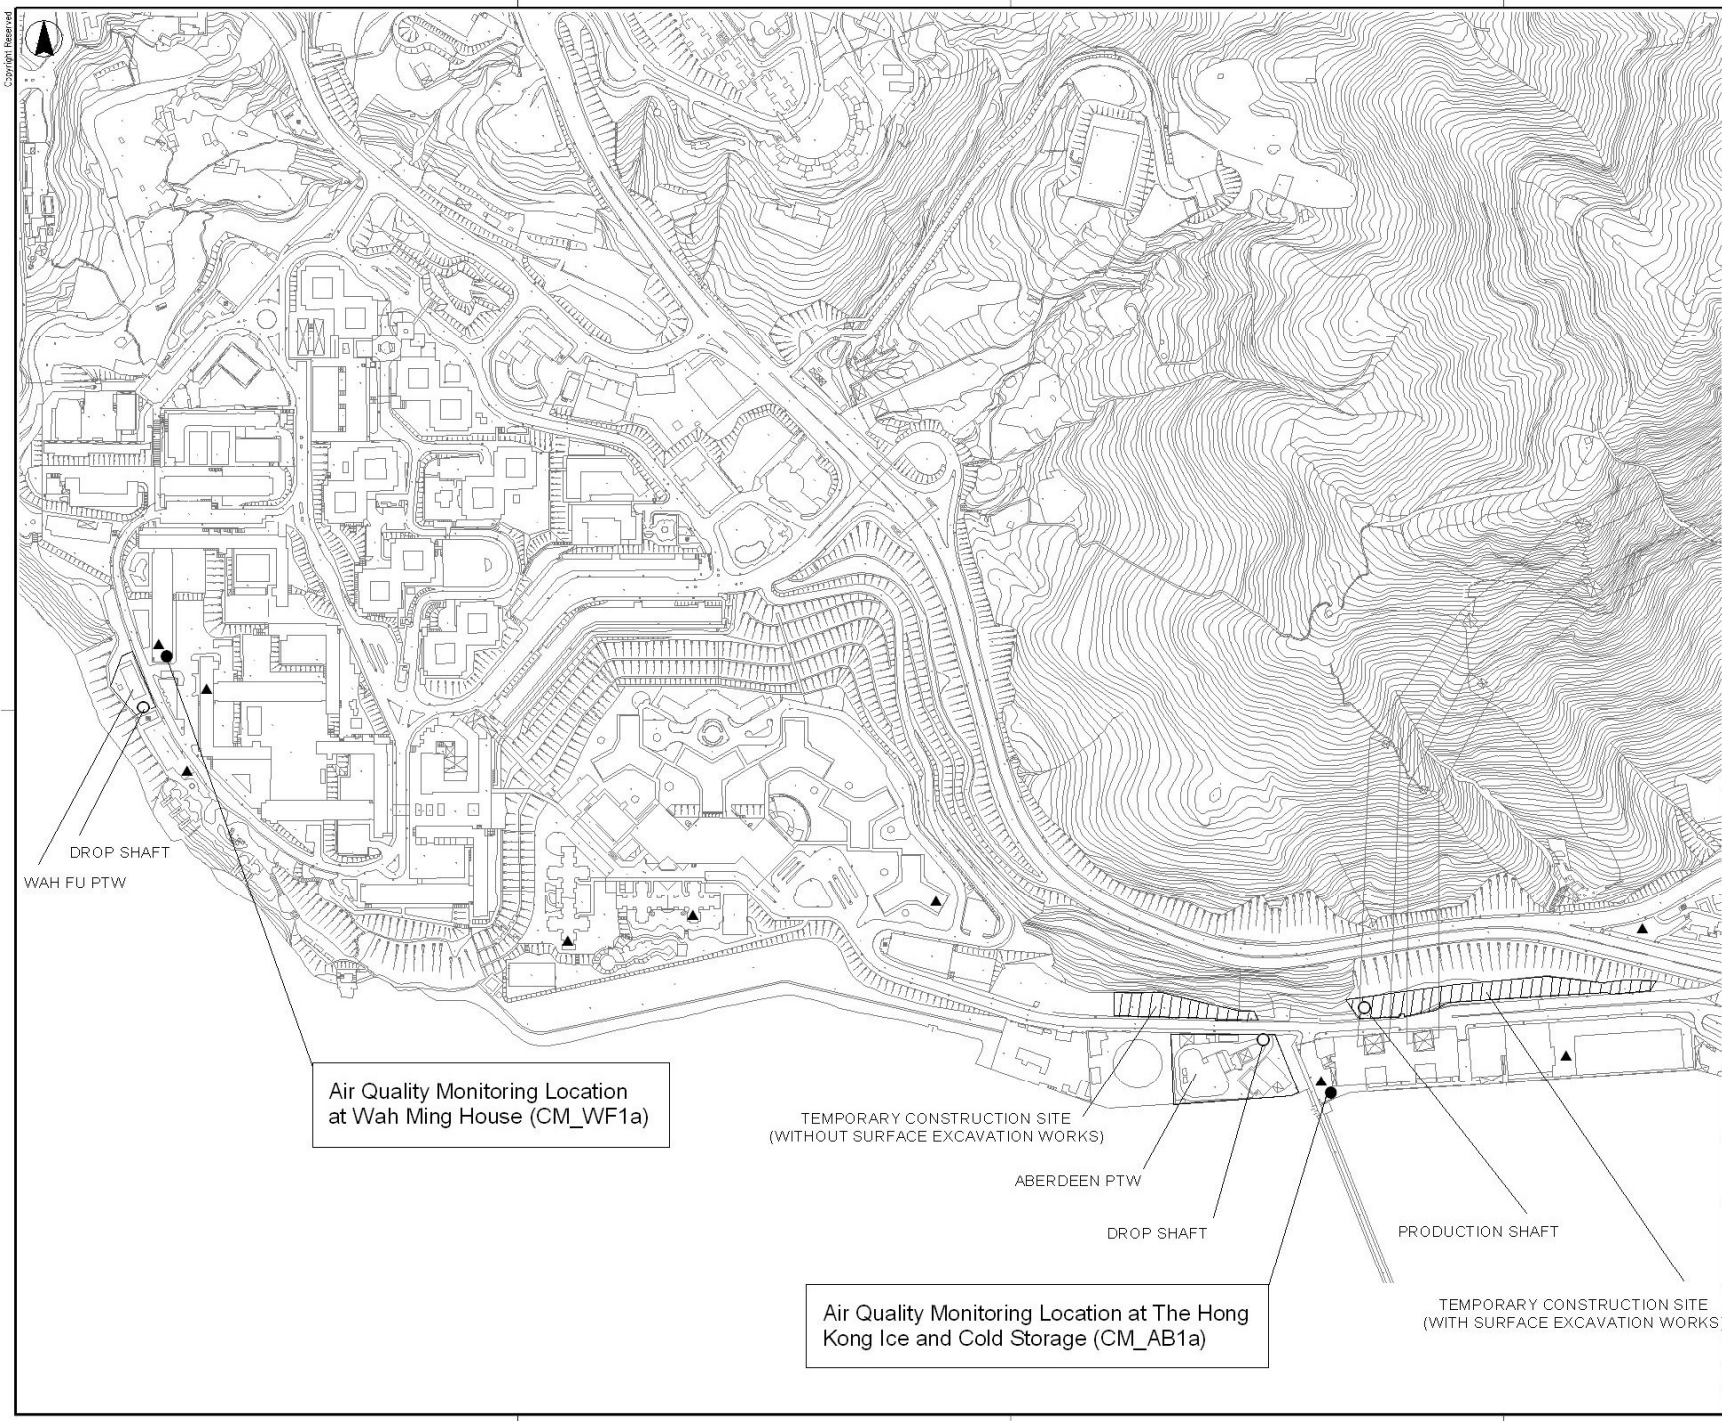

LEGEND

- ▲ AIR SENSITIVE RECEIVERS
- DUST MONITORING STATION

0 50 100 150 Meters

| Rev | Description | Date | Dgn | Crk | Auth |
|-----|-------------|------|-----|-----|------|
| | | | | | |

DRAINAGE SERVICES DEPARTMENT
HARBOUR AREA TREATMENT SCHEME DIVISION

Project title: **CONTRACT NO. DC/2007/24**
HARBOUR AREA TREATMENT SCHEME STAGE 2A
CONSTRUCTION OF SEWAGE CONVEYANCE SYSTEM
FROM ABERDEEN TO SAI YING PUN

Supervising Officer: **AECOM**
Metcal & Eddy – AECOM Joint Venture

Main Contractor: **LEIGHTON 禮頓** **LNS**
Leighton - LNS
Joint Venture

Designer: **ATKINS**


Drawing title: **CONSTRUCTION DUST**
MONITORING STATION
AT WAH FU AND ABERDEEN PTW

| Revised | Scale of A1 |
|------------|---------------------|
| | |
| Drawn | Status |
| Checked | MONTHLY EM&A REPORT |
| Authorised | Drawing No. |
| CAD ref. | Rev. |
| | A2 |
| | A |

APPENDIX A

PROJECT ORGANISATION AND CONTACT DETAILS

Project Organisation

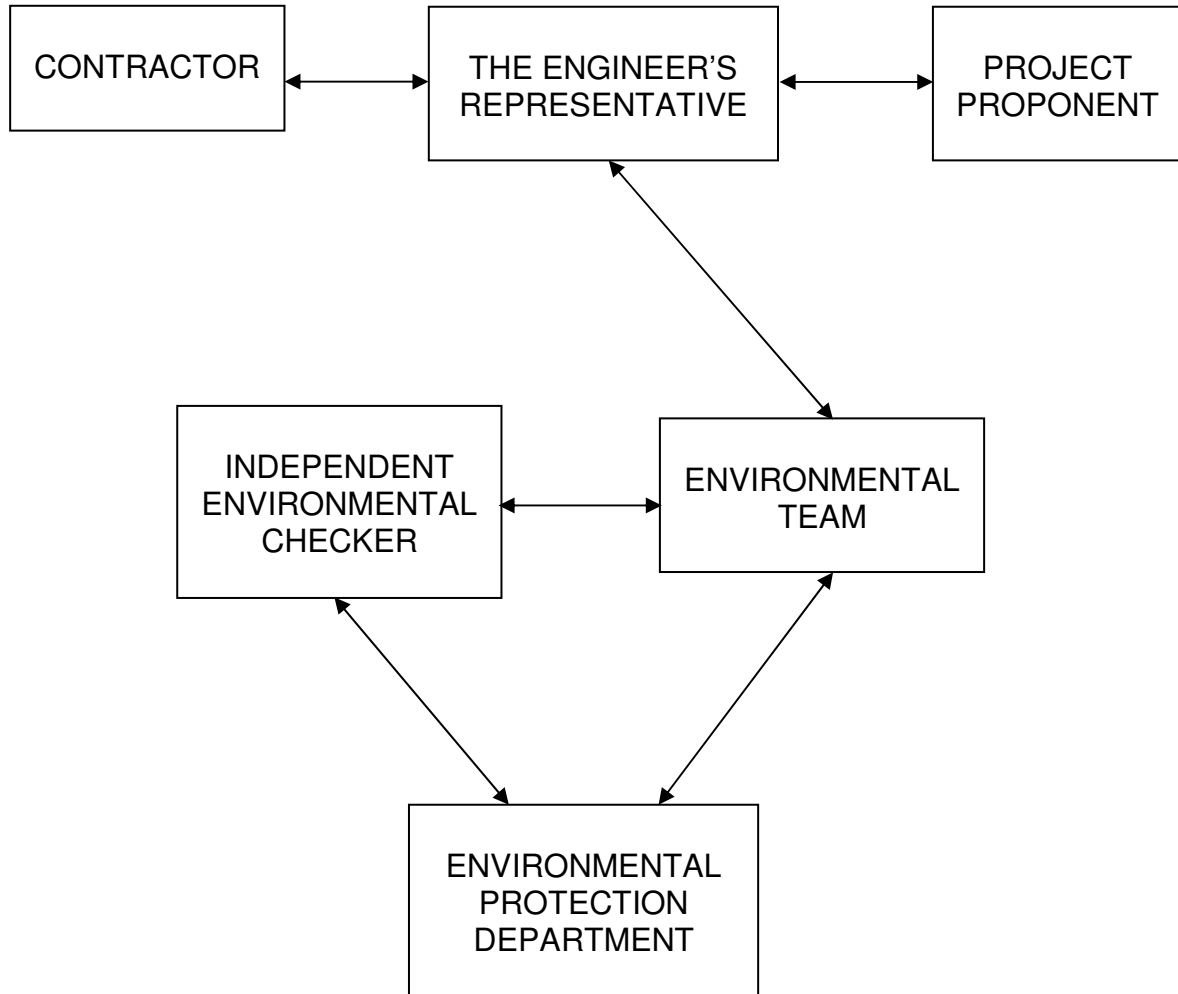

Legend:

↔ Line of communication

Contact Details

Project Proponent, Drainage Services Department

Mr. Raymond Seit
Senior Engineer
Phone: 2159 3404
Fax: 2833 9162
E-mail: kfseit@dsd.gov.hk

Engineer Representative (ER), Metcalf & Eddy-AECOM JV

Mr. Simon Mui
Chief Resident Engineer
Phone: 2980 8111
Fax: 2989 6225
E-mail: simon.mui@hats24-aecom.com

Mr. Sidney Wong
Senior Resident Engineer
Phone: 2980 8122
Fax: 2989 6225
E-mail: sidney.wong@hats24-aecom.com

Mr. Stephen Tam
Resident Engineer
Phone: 2980 9121
Fax: 2989 6225
E-mail: stephen.tam@hats24-aecom.com

Contractor, Leighton-LNS JV

Mr. Johan Nilsson
Project Director
Phone: 3665 3665
Fax: 2989 6033
E-mail: johan.nilsson@leightonasia.com

Mr. Kevin Harman
Quality and Environmental Manager
Phone: 3665 3719
Fax: 2989 6033
E-mail: kevin.harman@leightonasia.com

Ms Lighting Chan
Environmental Manager
Phone: 3665 3722
Fax: 2989 6033
E-mail: lighting.chan@leightonasia.com

Independent Environmental Checker (IEC), Mott MacDonald Hong Kong Ltd.

Dr. Anne Kerr
Independent Environmental Checker
Phone: 2828 5793
Fax: 2827 1823
E-mail: anne.kerr@mottmac.com.hk

Environmental Team Leader (ETL), Atkins China Limited

Ms Susana Halliday
Environmental Team Leader
Phone: 2972 1717
Fax: 2890 6343
E-mail: susana.halliday@atkinsglobal.com

Ms Enid Yung
Senior Consultant
Phone: 2972 1766
Fax: 2890 6343
E-mail: enid.yung@atkinsglobal.com

Environmental Protection Department (EPD)

Regional Office (South)
Dr. Sunny Cheung
Phone: 2516 1872
Fax: 2960 1761
E-mail: sunnycheung@epd.gov.hk

Regional Office (South)
Mr. Lee Tong
Phone: 2516 1809
Fax: 2960 1761
E-mail: leetong@epd.gov.hk

APPENDIX B

THE CONTRACTOR'S 3-MONTH CONSTRUCTION PROGRAMME

THREE MONTH ROLLING PROGRAMME (TM22) STATUS as at 20 May 2011

| Activity ID | Activity Name | Orig Dur | Rem Dur | Forecast Start (20-May-11) | Forecast Finish (20-May-11) | % Compl | Total Float | 2011 | | |
|---|---|----------|---------|----------------------------|-----------------------------|---------|-------------|--|-----|-----|
| | | | | | | | | May | Jun | Jul |
| HATS2A - MONTHLY PROGRESS UPDATE (May 2011) - Rev.C2 | | | | | | | | | | |
| CONTRACT NO. DC/2007/24 | | | | | | | | | | |
| DESIGN WORKS | | | | | | | | | | |
| DESIGN, SUBMISSION and APPROVAL | | | | | | | | | | |
| PROJECT WIDE | | | | | | | | | | |
| Blasting Permit Application and Licenses by Mine Department | | | | | | | | | | |
| Shafts - BAR and Method Statement Application | | | | | | | | | | |
| Aberdeen | | | | | | | | | | |
| Method Statement | | | | | | | | | | |
| 0076 | Abd Shaft - Final Approval of MS / Blasting Permit & Obtain licenses | 0 | 0 | | 20-May-11 | 0% | -27 | ◆ Abd Shaft - Final Approval of MS / Blasting Permit & Obtain licenses | | |
| Sai Ying Pun | | | | | | | | | | |
| BAR | | | | | | | | | | |
| 0056 | SYP Shaft BAR - Submit to Mines Via ER | 21 | 12 | 10-May-11 A | 02-Jun-11 | 43% | -80 | SYP Shaft BAR - Submit to Mines Via ER, SYP Shaft BAR - Submit to Mines Via ER | | |
| 0057 | SYP Shaft BAR - Review and comments by Mines (1st) | 28 | 28 | 03-Jun-11 | 14-Jul-11 | 0% | -67 | SYP Shaft BAR - Review and comments by Mines (1st) | | |
| 0058 | SYP Shaft BAR - Incorporate comments & re-submit to ER (1st) | 28 | 28 | 15-Jul-11 | 16-Aug-11 | 0% | -81 | SYP Shaft BAR - Incorporate comments & re-submit to ER (1st) | | |
| Method Statement | | | | | | | | | | |
| 0065 | SYP Shaft MS - Incorporate comments & re-submit to ER | 15 | 11 | 04-May-11 A | 01-Jun-11 | 27% | -84 | SYP Shaft MS - Incorporate comments & re-submit to ER, SYP Shaft MS - Incorporate comments & re-submit to ER | | |
| 0066 | SYP Shaft MS - Received ER endorsement | 10 | 10 | 02-Jun-11 | 16-Jun-11 | 0% | -70 | SYP Shaft MS - Received ER endorsement | | |
| 0067 | SYP Shaft MS - Submit to Mines with blasting permit application | 6 | 6 | 17-Jun-11 | 23-Jun-11 | 0% | -84 | SYP Shaft MS - Submit to Mines with blasting permit application | | |
| 0068 | SYP Shaft MS - Review & comments by Mines (1st) | 28 | 28 | 24-Jun-11 | 03-Aug-11 | 0% | -70 | SYP Shaft MS - Review & comments by Mines (1st) | | |
| DROP SHAFT - TEMPORARY and PERMANENT WORKS DESIGN | | | | | | | | | | |
| ABERDEEN - Drop Shaft and Production Shaft | | | | | | | | | | |
| Temporary Works - Diaphragm Walls Shaft Excavation | | | | | | | | | | |
| 9550 | Aberd /Temp D-wall - Engineer Consent to Proceed with Construction | 0 | 0 | | 20-May-11 | 0% | 97 | ◆ Aberd /Temp D-wall - Engineer Consent to Proceed with Construction | | |
| Temporary Works - Scum Chamber and Connection Channel Excavation | | | | | | | | | | |
| 9656 | Aberd /Temp S-Chamber - Submit to Client's Engineer | 0 | 0 | | 20-May-11 | 0% | 481 | ◆ Aberd /Temp S-Chamber - Submit to Client's Engineer | | |
| 9591 | Aberd /Temp S-Chamber - Review, comment, & consent by Engineer | 28 | 28 | 20-May-11 | 29-Jun-11 | 0% | 481 | Aberd /Temp S-Chamber - Review, comment, & consent by Engineer | | |
| 9658 | Aberd /Temp S-Chamber - Engineer's consent to proceed with construction | 0 | 0 | | 29-Jun-11 | 0% | 481 | ◆ Aberd /Temp S-Chamber - Engineer's consent to proceed with construction | | |
| Temporary Works - Temporary Support for Rock Excavation | | | | | | | | | | |
| 9655 | Aberd / Temp support - Review, comment, & consent by Engineer | 28 | 2 | 31-Jul-10 A | 21-May-11 | 93% | -60 | Aberd / Temp support - Review, comment, & consent by Engineer, Aberd / Temp support - Review, comment, & consent by Engineer | | |
| 9746 | Aberd / Temp support - Engineer's consent to proceed with construction | 0 | 0 | | 23-May-11 | 0% | -38 | ◆ Aberd / Temp support - Engineer's consent to proceed with construction | | |
| Temporary Works - Shaft Noise Enclosure | | | | | | | | | | |
| 9663 | Aberd /Temp Noise Enclosure - Review, comment, & consent by Engineer | 28 | 2 | 23-Mar-11 A | 21-May-11 | 93% | -67 | Aberd /Temp Noise Enclosure - Review, comment, & consent by Engineer, Aberd /Temp Noise Enclosure - Review, comment, & consent by Engineer | | |
| 9760 | Aberd /Temp Noise Enclosure - Engineer's consent to proceed with construction | 0 | 0 | | 23-May-11 | 0% | -43 | ◆ Aberd /Temp Noise Enclosure - Engineer's consent to proceed with construction | | |
| Permanent Works - Upper Shaft, Scum Chamber & Connection Channel | | | | | | | | | | |
| 9667 | Aberd / Perm Upper Shaft - Prepare design submission | 10 | 10 | 20-May-11 | 02-Jun-11 | 0% | 451 | Aberd / Perm Upper Shaft - Prepare design submission | | |
| 9770 | Aberd / Perm Upper Shaft - Submit formally to ICE | 0 | 0 | | 02-Jun-11 | 0% | 499 | ◆ Aberd / Perm Upper Shaft - Submit formally to ICE | | |
| 9772 | Aberd / Perm Upper Shaft - Submit to Engineer | 0 | 0 | | 02-Jun-11 | 0% | 451 | ◆ Aberd / Perm Upper Shaft - Submit to Engineer | | |
| 9669 | Aberd / Perm Upper Shaft - ICE review and issue check certificate | 10 | 10 | 03-Jun-11 | 17-Jun-11 | 0% | 499 | Aberd / Perm Upper Shaft - ICE review and issue check certificate | | |
| 9671 | Aberd / Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | 90 | 90 | 03-Jun-11 | 31-Aug-11 | 0% | 664 | Aberd / Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | | |
| Permanent Works - Lower Shaft | | | | | | | | | | |
| 9679 | Aberd / Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer | 90 | 30 | 10-Sep-10 A | 18-Jun-11 | 67% | 692 | Aberd / Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer, Aberd / Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer | | |
| 9677 | Aberd / Perm Lower Shaft - ICE review and issue check certificate | 10 | 10 | 02-Oct-10 A | 02-Jun-11 | 0% | 479 | Aberd / Perm Lower Shaft - ICE review and issue check certificate, Aberd / Perm Lower Shaft - ICE review and issue check certificate | | |
| 9788 | Aberd / Perm Lower Shaft - Engineer's consent to proceed with construction | 0 | 0 | | 20-Jun-11 | 0% | 469 | ◆ Aberd / Perm Lower Shaft - Engineer's consent to proceed with construction | | |
| WAH FU - Dropt Shaft | | | | | | | | | | |
| Temporary Works - Connection Channel Excavation | | | | | | | | | | |
| 9561 | Wah Fu / Connecting Channel - Review, Comments & Consent by the Engineer | 28 | 3 | 30-Oct-09 A | 22-May-11 | 90% | 669 | Wah Fu / Connecting Channel - Review, Comments & Consent by the Engineer, Wah Fu / Connecting Channel - Review, Comments & Consent by the Engineer | | |
| 9662 | Wah Fu / Connecting Channel - Engineer Consent to Proceed with Construction | 0 | 0 | | 23-May-11 | 0% | 456 | ◆ Wah Fu / Connecting Channel - Engineer Consent to Proceed with Construction | | |
| Permanent Works - Upper Shaft, Scum Chamber and Connection Channel | | | | | | | | | | |
| 9695 | Wah Fu / Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | 90 | 90 | 20-May-11 | 17-Aug-11 | 0% | 586 | Wah Fu / Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | | |
| Permanent Works - Lower Shaft | | | | | | | | | | |

- ◆ Current Milestone
- ◆ Baseline Milestone
- Actual Work
- Critical Remaining Work
- Remaining Work
- Baseline WPOD

Contract No DC/2007/24
HATS - Harbour Area Treatment Scheme (Stage 2A)
Leighton - LNS Joint Venture



| Date | Revision | Checked | Approved |
|-----------|----------------------------------|---------|----------|
| 20-Oct-10 | Three Months Rolling Prog (TM15) | JC | AGA |
| 20-Nov-10 | Three Months Rolling Prog (TM16) | JC | AGA |
| 20-Dec-10 | Three Months Rolling Prog (TM17) | AT | AGA |
| 20-Jan-11 | Three Months Rolling Prog (TM18) | AT | AGA |
| 20-Feb-11 | Three Months Rolling Prog (TM19) | AT | AGA |
| 20-Mar-11 | Three Months Rolling Prog (TM20) | AT | AGA |
| 20-Apr-11 | Three Months Rolling Prog (TM21) | AT | AGA |
| 20-May-11 | Three Months Rolling Prog (TM22) | AT | AGA |

THREE MONTH ROLLING PROGRAMME (TM22)

STATUS as at 20 May 2011

| Activity ID | Activity Name | Orig Dur | Rem Dur | Forecast Start (20-May-11) | Forecast Finish (20-May-11) | % Compl | Total Float | 2011 | | | |
|---|--|----------|---------|----------------------------|-----------------------------|---------|-------------|------|--|-----|--|
| | | | | | | | | May | Jun | Jul | |
| 9830 | Wah Fu / Perm Lower Shaft - Engineer's consent to proceed with construction | 0 | 0 | | 20-May-11 | 0% | 434 | | Wah Fu / Perm Lower Shaft - Engineer's consent to proceed with construction | | |
| CYBER PORT - Droft Shaft | | | | | | | | | | | |
| Temporary Works - Connection Channel Excavation | | | | | | | | | | | |
| 9836 | Cyberport / Connecting Channel - Engineer Consent to Proceed with Construction | 0 | 0 | | 20-May-11 | 0% | 563 | | Cyberport / Connecting Channel - Engineer Consent to Proceed with Construction | | |
| Temporary Works - Temporary Support for Rock Excavation | | | | | | | | | | | |
| 9842 | Cyberport / Temp Support - Discussion with ICE | 8 | 0 | 19-Nov-09 A | 20-May-11 | 95% | 325 | | Cyberport / Temp Support - Discussion with ICE, Cyberport / Temp Support - Discussion with ICE | | |
| 9844 | Cyberport / Temp Support - Discussion with Client's Engineer | 9 | 9 | 20-May-11 | 01-Jun-11 | 0% | 316 | | Cyberport / Temp Support - Discussion with Client's Engineer | | |
| 9840 | Cyberport / Temp Support - Submit design development to the Engineer | 0 | 0 | 20-May-11 | | 0% | 316 | | Cyberport / Temp Support - Submit design development to the Engineer | | |
| 9715 | Cyberport / Temp Support - ICE review and issue check certificate | 5 | 5 | 02-Jun-11 | 09-Jun-11 | 0% | 316 | | Cyberport / Temp Support - ICE review and issue check certificate | | |
| 9852 | Cyberport / Temp Support - Submit to Client's Engineer | 0 | 0 | | 09-Jun-11 | 0% | 316 | | Cyberport / Temp Support - Submit to Client's Engineer | | |
| 9717 | Cyberport / Temp Support - Review, comment, & consent by Engineer | 28 | 28 | 10-Jun-11 | 07-Jul-11 | 0% | 462 | | Cyberport / Temp Support - Review, comment, & consent by Engineer | | |
| 9854 | Cyberport / Temp Support - Engineer's consent to proceed with construction | 0 | 0 | | 07-Jul-11 | 0% | 315 | | Cyberport / Temp Support - Engineer's consent to proceed with construction | | |
| Permanent Works - Upper Shaft, Scum Chamber and Connection Channel | | | | | | | | | | | |
| 9725 | Cyberport / Perm Upper Shaft - ICE review and issue check certificate | 10 | 5 | 13-Jul-10 A | 26-May-11 | 50% | 448 | | Cyberport / Perm Upper Shaft - ICE review and issue check certificate, Cyberport / Perm Upper Shaft - ICE review and issue check certificate | | |
| 9727 | Cyberport / Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | 90 | 45 | 13-Jul-10 A | 03-Jul-11 | 50% | 621 | | Cyberport / Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | | |
| 9872 | Cyberport / Perm Upper Shaft - Engineer's consent to proceed with construction | 0 | 0 | | 04-Jul-11 | 0% | 424 | | Cyberport / Perm Upper Shaft - Engineer's consent to proceed with construction | | |
| Permanent Works - Lower Shaft | | | | | | | | | | | |
| 9737 | Cyberport / Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer | 90 | 30 | 10-Sep-10 A | 18-Jun-11 | 67% | 558 | | Cyberport / Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer, Cyberport / Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer | | |
| 9886 | Cyberport / Perm Lower Shaft - Submit formally to ICE | 0 | 0 | | 20-May-11 | 0% | 390 | | Cyberport / Perm Lower Shaft - Submit formally to ICE | | |
| 9735 | Cyberport / Perm Lower Shaft - ICE review and issue check certificate | 10 | 10 | 20-May-11 | 02-Jun-11 | 0% | 390 | | Cyberport / Perm Lower Shaft - ICE review and issue check certificate | | |
| 9890 | Cyberport / Perm Lower Shaft - Engineer's consent to proceed with construction | 0 | 0 | | 20-Jun-11 | 0% | 380 | | Cyberport / Perm Lower Shaft - Engineer's consent to proceed with construction | | |
| SANDY BAY - Droft Shaft and Production Shaft | | | | | | | | | | | |
| Permanent Works - Upper Shaft, Scum Chamber & Connection Channel | | | | | | | | | | | |
| 9761 | Sandy Bay /Perm Upper Shaft - ICE review and issue check certificate | 10 | 5 | 13-Jul-10 A | 26-May-11 | 50% | 510 | | Sandy Bay /Perm Upper Shaft - ICE review and issue check certificate, Sandy Bay /Perm Upper Shaft - ICE review and issue check certificate | | |
| 9763 | Sandy Bay /Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | 90 | 55 | 13-Jul-10 A | 13-Jul-11 | 39% | 707 | | Sandy Bay /Perm Upper Shaft - Review, comment, resubmission & appvl by Engineer | | |
| 9942 | Sandy Bay /Perm Upper Shaft - Engineer's consent to proceed with construction | 0 | 0 | | 13-Jul-11 | 0% | 478 | | Sandy Bay /Perm Upper Shaft - Engineer's consent to proceed with construction | | |
| Permanent Works - Lower Shaft | | | | | | | | | | | |
| 9950 | Sandy Bay /Perm Lower Shaft - Discussion with Engineer | 14 | 14 | 20-May-11 | 09-Jun-11 | 0% | 374 | | Sandy Bay /Perm Lower Shaft - Discussion with Engineer | | |
| 9946 | Sandy Bay /Perm Lower Shaft - Submit design development to the Engineer | 0 | 0 | 20-May-11 | | 0% | 374 | | Sandy Bay /Perm Lower Shaft - Submit design development to the Engineer | | |
| 9958 | Sandy Bay /Perm Lower Shaft - Submit to Engineer | 0 | 0 | | 09-Jun-11 | 0% | 374 | | Sandy Bay /Perm Lower Shaft - Submit to Engineer | | |
| 9771 | Sandy Bay /Perm Lower Shaft - ICE review and issue check certificate | 10 | 10 | 10-Jun-11 | 23-Jun-11 | 0% | 424 | | Sandy Bay /Perm Lower Shaft - ICE review and issue check certificate | | |
| 9773 | Sandy Bay /Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer | 90 | 90 | 10-Jun-11 | 07-Sep-11 | 0% | 548 | | Sandy Bay /Perm Lower Shaft - Review, comment, resubmission & appvl by Engineer | | |
| SAI YING PUN - Production Shaft | | | | | | | | | | | |
| Temporary Works - Diaphragm Walls Shaft Excavation | | | | | | | | | | | |
| 9527 | Sai Ying Pun /Temp D-wall - Review, Comments & Consent by the Engineer | 28 | 3 | 13-Oct-09 A | 22-May-11 | 90% | -65 | | Sai Ying Pun /Temp D-wall - Review, Comments & Consent by the Engineer, Sai Ying Pun /Temp D-wall - Review, Comments & Consent by the Engineer | | |
| 9596 | Sai Ying Pun /Temp D-wall - Engineer Consent to Proceed with Construction | 0 | 0 | | 23-May-11 | 0% | -40 | | Sai Ying Pun /Temp D-wall - Engineer Consent to Proceed with Construction | | |
| Temporary Works - Temporary Support for Rock Excavation | | | | | | | | | | | |
| 9781 | Sai Ying Pun /Temp support - Review, comment, & consent by Engineer | 28 | 3 | 02-Nov-09 A | 22-May-11 | 90% | -16 | | Sai Ying Pun /Temp support - Review, comment, & consent by Engineer, Sai Ying Pun /Temp support - Review, comment, & consent by Engineer | | |
| 9974 | Sai Ying Pun /Temp support - Engineer's consent to proceed with construction | 0 | 0 | | 23-May-11 | 0% | -9 | | Sai Ying Pun /Temp support - Engineer's consent to proceed with construction | | |
| E&M - Electrical and Mechanical Works | | | | | | | | | | | |
| Permanent Works - E&M Penstock, Ducts, Cabling & Control | | | | | | | | | | | |
| 9716 | E&M Penstock, Ducts & Cabling - Prepare design development submission | 22 | 22 | 20-May-11 | 21-Jun-11 | 0% | 132 | | E&M Penstock, Ducts & Cabling - Prepare design development submission | | |
| 9791 | E&M Penstock, Ducts & Cabling - Contractor review | 2 | 2 | 22-Jun-11 | 23-Jun-11 | 0% | 158 | | E&M Penstock, Ducts & Cabling - Contractor review | | |
| 9996 | E&M Penstock, Ducts & Cabling - Discussion with Engineer | 15 | 15 | 24-Jun-11 | 15-Jul-11 | 0% | 131 | | E&M Penstock, Ducts & Cabling - Discussion with Engineer | | |
| 9994 | E&M Penstock, Ducts & Cabling - Discussion with ICE | 10 | 10 | 24-Jun-11 | 08-Jul-11 | 0% | 136 | | E&M Penstock, Ducts & Cabling - Discussion with ICE | | |
| 9992 | E&M Penstock, Ducts & Cabling - Submit design development to the Engineer | 0 | 0 | 24-Jun-11 | | 0% | 131 | | E&M Penstock, Ducts & Cabling - Submit design development to the Engineer | | |
| 9998 | E&M Penstock, Ducts & Cabling - Proceed to detailed design | 0 | 0 | 18-Jul-11 | | 0% | 131 | | E&M Penstock, Ducts & Cabling - Proceed to detailed design | | |
| 9793 | E&M Penstock, Ducts & Cabling - Prepare draft detailed design submission | 10 | 10 | 18-Jul-11 | 29-Jul-11 | 0% | 131 | | E&M Penstock, Ducts & Cabling - Prepare draft detailed design submission | | |
| Permanent Works - E&M Interim Deodoriser @ Cyberport (By JEC) | | | | | | | | | | | |
| 9720 | Cyberport / E&M Deodoriser - Prepare design development submission | 21 | 21 | 20-May-11 | 20-Jun-11 | 0% | 433 | | Cyberport / E&M Deodoriser - Prepare design development submission | | |
| 9801 | Cyberport / E&M Deodoriser - Contractor review | 3 | 3 | 21-Jun-11 | 23-Jun-11 | 0% | 513 | | Cyberport / E&M Deodoriser - Contractor review | | |
| 10012 | Cyberport / E&M Deodoriser - Discussion with Engineer | 15 | 15 | 24-Jun-11 | 15-Jul-11 | 0% | 433 | | Cyberport / E&M Deodoriser - Discussion with Engineer | | |
| 10010 | Cyberport / E&M Deodoriser - Discussion with ICE | 10 | 10 | 24-Jun-11 | 08-Jul-11 | 0% | 438 | | Cyberport / E&M Deodoriser - Discussion with ICE | | |
| 10008 | Cyberport / E&M Deodoriser - Submit design development to the Engineer | 0 | 0 | 24-Jun-11 | | 0% | 433 | | Cyberport / E&M Deodoriser - Submit design development to the Engineer | | |

THREE MONTH ROLLING PROGRAMME (TM22)

STATUS as at 20 May 2011

| Activity ID | Activity Name | Orig Dur | Rem Dur | Forecast Start (20-May-11) | Forecast Finish (20-May-11) | % Compl | Total Float | 2011 | | | |
|--|---|----------|---------|----------------------------|-----------------------------|---------|-------------|------|-----|-----|--|
| | | | | | | | | May | Jun | Jul | |
| 10014 | Cyberport / E&M Deodoriser - Proceed to detailed design | 0 | 0 | 18-Jul-11 | | 0% | 433 | | | | ◆ Cyberport |
| 9803 | Cyberport / E&M Deodoriser - Prepare draft detailed design submission | 10 | 10 | 18-Jul-11 | 29-Jul-11 | 0% | 433 | | | | |
| Permanent Works - Misc Multipart Covers, Vortex, Reserve Pipes, Sleeves | | | | | | | | | | | |
| 9722 | Multipart Covers, Vortex, Pipes, Sleeve - Prepare design development submission | 20 | 20 | 20-May-11 | 17-Jun-11 | 0% | 423 | | | | |
| 9811 | Multipart Covers, Vortex, Pipes, Sleeve - Contractor review | 3 | 3 | 18-Jun-11 | 21-Jun-11 | 0% | 501 | | | | |
| 10024 | Multipart Covers, Vortex, Pipes, Sleeve - Submit design development to the Engineer | 0 | 0 | 22-Jun-11 | | 0% | 423 | | | | ◆ Multipart Covers, Vortex, Pipes, Sleeve - Submit design development to the Eng |
| 10028 | Multipart Covers, Vortex, Pipes, Sleeve - Discussion with Engineer | 14 | 14 | 23-Jun-11 | 13-Jul-11 | 0% | 423 | | | | |
| 10026 | Multipart Covers, Vortex, Pipes, Sleeve - Discussion with ICE | 10 | 10 | 23-Jun-11 | 07-Jul-11 | 0% | 427 | | | | |
| 10030 | Multipart Covers, Vortex, Pipes, Sleeve - Proceed to detailed design | 0 | 0 | 14-Jul-11 | | 0% | 423 | | | | ◆ Multipart Covers, Vo |
| 9813 | Multipart Covers, Vortex, Pipes, Sleeve - Prepare draft detailed design submission | 10 | 10 | 14-Jul-11 | 27-Jul-11 | 0% | 423 | | | | |
| MAIN TUNNELS | | | | | | | | | | | |
| Temporary Works - Tunnel M, N, P1 & P2 (Sai Ying Pun to Aberdeen) | | | | | | | | | | | |
| Temporary Works - Rock Bolts, Shotcrete, Grouting, Niches & Refuges | | | | | | | | | | | |
| 9647 | Tunnel /Temp Support (Incl Niches) - Review, comment, & consent by Engineer | 28 | 2 | 21-Aug-10 A | 21-May-11 | 93% | -51 | | | | |
| 10056 | Tunnel /Temp Support (Incl Niches) - Engineer's consent to proceed with construction | 0 | 0 | | 23-May-11 | 0% | -31 | | | | ◆ Tunnel /Temp Support (Incl Niches) - Engineer's consent to proceed with construction |
| Temporary Support - Aberdeen Construction Adit | | | | | | | | | | | |
| 9602 | Aberd Constn Adit /Temp Support - Prepare design development submission | 11 | 11 | 20-May-11 | 03-Jun-11 | 0% | -97 | | | | |
| 9533 | Aberd Constn Adit /Temp Support - Contractor review | 3 | 3 | 04-Jun-11 | 08-Jun-11 | 0% | -112 | | | | |
| 10060 | Aberd Constn Adit /Temp Support - Discussion with Client's Engineer | 10 | 10 | 09-Jun-11 | 22-Jun-11 | 0% | -96 | | | | |
| 10058 | Aberd Constn Adit /Temp Support - Discussion with ICE | 9 | 9 | 09-Jun-11 | 21-Jun-11 | 0% | -95 | | | | |
| 9604 | Aberd Constn Adit /Temp Support - Submit design development to the Engineer | 0 | 0 | 09-Jun-11 | | 0% | -96 | | | | ◆ Aberd Constn Adit /Temp Support - Submit design development to the Engineer |
| 10062 | Aberd Constn Adit /Temp Support - Proceed to detailed design | 0 | 0 | 23-Jun-11 | | 0% | -96 | | | | ◆ Aberd Constn Adit /Temp Support - Proceed to detailed design |
| 9821 | Aberd Constn Adit /Temp Support - Prepare draft detailed design submission | 8 | 8 | 23-Jun-11 | 05-Jul-11 | 0% | -96 | | | | |
| 10064 | Aberd Constn Adit /Temp Support - Contractor review | 5 | 5 | 06-Jul-11 | 11-Jul-11 | 0% | -116 | | | | |
| 9829 | Aberd Constn Adit /Temp Support - Prepare design submission | 6 | 6 | 12-Jul-11 | 19-Jul-11 | 0% | -96 | | | | |
| 10066 | Aberd Constn Adit /Temp Support - Submit formally to ICE | 0 | 0 | | 19-Jul-11 | 0% | -96 | | | | ◆ Aberd |
| Temporary Works - Wah Fu Adit and Shaft Junction | | | | | | | | | | | |
| 10078 | Wah Fu Adit /Temp Support - Contractor review | 5 | 5 | 20-May-11 | 25-May-11 | 0% | 235 | | | | |
| 9837 | Wah Fu Adit /Temp Support - Prepare design submission | 5 | 5 | 26-May-11 | 01-Jun-11 | 0% | 197 | | | | |
| 10080 | Wah Fu Adit /Temp Support - Submit formally to ICE | 0 | 0 | | 01-Jun-11 | 0% | 197 | | | | ◆ Wah Fu Adit /Temp Support - Submit formally to ICE |
| 9839 | Wah Fu Adit /Temp Support - ICE review and issue check certificate | 5 | 5 | 02-Jun-11 | 09-Jun-11 | 0% | 197 | | | | |
| 10082 | Wah Fu Adit /Temp Support - Submit to Engineer | 0 | 0 | | 09-Jun-11 | 0% | 197 | | | | ◆ Wah Fu Adit /Temp Support - Submit to Engineer |
| 9841 | Wah Fu Adit /Temp Support - Review, comment, & consent by Engineer | 28 | 28 | 10-Jun-11 | 07-Jul-11 | 0% | 288 | | | | |
| 10084 | Wah Fu Adit /Temp Support - Engineer's consent to proceed with construction | 0 | 0 | | 07-Jul-11 | 0% | 195 | | | | ◆ Wah Fu Adit /Temp Support - Enginee |
| Temporary Works - Cyberport Adit and Shaft Junction | | | | | | | | | | | |
| 9847 | Cyberport Adit /Temp Support - ICE review and issue check certificate | 5 | 5 | 20-May-11 | 26-May-11 | 0% | -13 | | | | |
| 10096 | Cyberport Adit /Temp Support - Submit to Engineer | 0 | 0 | | 26-May-11 | 0% | -13 | | | | ◆ Cyberport Adit /Temp Support - Submit to Engineer |
| 9849 | Cyberport Adit /Temp Support - Review, comment, & consent by Engin... | 28 | 28 | 27-May-11 | 23-Jun-11 | 0% | -20 | | | | |
| 10098 | Cyberport Adit /Temp Support - Engineer's consent to proceed with construction | 0 | 0 | | 23-Jun-11 | 0% | -13 | | | | ◆ Cyberport Adit /Temp Support - Engineer's consent to proceed with construc |
| Temporary Support - Sandy Bay Construction Adit | | | | | | | | | | | |
| 9855 | Sandy Bay Constn Adit /Temp Support - ICE review and issue check certificate | 5 | 5 | 20-May-11 | 26-May-11 | 0% | 216 | | | | |
| 10114 | Sandy Bay Constn Adit /Temp Support - Submit to Engineer | 0 | 0 | | 26-May-11 | 0% | 216 | | | | ◆ Sandy Bay Constn Adit /Temp Support - Submit to Engineer |
| 9857 | Sandy Bay Constn Adit /Temp Support - Review, comment, & consent by Engineer | 28 | 28 | 27-May-11 | 23-Jun-11 | 0% | 321 | | | | |
| 10116 | Sandy Bay Constn Adit /Temp Support - Engineer's consent to proceed with construction | 0 | 0 | | 23-Jun-11 | 0% | 216 | | | | ◆ Sandy Bay Constn Adit /Temp Support - Engineer's consent to proceed with |
| Temporary Support - Sai Ying Pun Construction Adit | | | | | | | | | | | |
| 9863 | SYP Constn Adit /Temp Support - ICE review and issue check certificate | 4 | 4 | 20-May-11 | 25-May-11 | 0% | 142 | | | | |
| 10132 | SYP Constn Adit /Temp Support - Submit to Engineer | 0 | 0 | | 25-May-11 | 0% | 142 | | | | ◆ SYP Constn Adit /Temp Support - Submit to Engineer |
| 9865 | SYP Constn Adit /Temp Support - Review, comment, & consent by Engineer | 28 | 28 | 26-May-11 | 22-Jun-11 | 0% | 204 | | | | |
| 10134 | SYP Constn Adit /Temp Support - Engineer's consent to proceed with construction | 0 | 0 | | 22-Jun-11 | 0% | 140 | | | | ◆ SYP Constn Adit /Temp Support - Engineer's consent to proceed with construct |
| Permanent Works - Tunnel M, N, P1 & P2 (Sai Ying Pun to Aberdeen) | | | | | | | | | | | |
| Tunnel Permanent Works - Permanent Lining Supports | | | | | | | | | | | |
| 9875 | Tunnel SYP-Aberd /Perm Lining - Review, comment, resubmission & appl by Engineer | 90 | 2 | 02-Jul-10 A | 21-May-11 | 98% | 454 | | | | |

THREE MONTH ROLLING PROGRAMME (TM22)

STATUS as at 20 May 2011

| Activity ID | Activity Name | Orig Dur | Rem Dur | Forecast Start (20-May-11) | Forecast Finish (20-May-11) | % Compl | Total Float | 2011 | | |
|---|--|----------|---------|----------------------------|-----------------------------|---------|-------------|------|-----|-----|
| | | | | | | | | May | Jun | Jul |
| 9873 | Tunnel SYP-Aberd /Perm Lining - ICE review and issue check certificate | 10 | 10 | 20-May-11 | 02-Jun-11 | 0% | 301 | | | |
| 10152 | Tunnel SYP-Aberd /Perm Lining - Engineer's consent to proceed with construction | 0 | 0 | | 02-Jun-11 | 0% | 301 | | | |
| Tunnel Permanent Works - 1st Pass Lining (Sai Ying Pun to Wah Fu) | | | | | | | | | | |
| 9883 | Tunnels SYP-Wah Fu /1st Pass Lining - ICE review and issue check certificate | 10 | 2 | 13-Apr-11 A | 23-May-11 | 80% | 226 | | | |
| 9885 | Tunnels SYP-Wah Fu /1st Pass Lining - Review & appvl by Engineer | 24 | 24 | 20-May-11 | 12-Jun-11 | 0% | 313 | | | |
| 10170 | Tunnels SYP-Wah Fu /1st Pass Lining - Engineer's consent to proceed with constn | 0 | 0 | | 13-Jun-11 | 0% | 213 | | | |
| Tunnel Permanent Works - Adit and Shaft Junction @ Wah Fu | | | | | | | | | | |
| 9893 | Wah Fu Adit & Junction / Perm Works - ICE review and issue check certificate | 10 | 5 | 13-Jul-10 A | 26-May-11 | 50% | 331 | | | |
| 9895 | Wah Fu Adit & Junction / Perm Works - Review, comment, resubmission & appvl by Engr | 90 | 90 | 20-May-11 | 17-Aug-11 | 0% | 401 | | | |
| Tunnel Permanent Works - Adit and Shaft Junction @ Cyberport | | | | | | | | | | |
| 9903 | Cyberport Adit & Junction /Perm Works - ICE review and issue check certificate | 10 | 10 | 20-May-11 | 02-Jun-11 | 0% | 301 | | | |
| 10204 | Cyberport Adit & Junction /Perm Works - Submit to Engineer | 0 | 0 | | 20-May-11 | 0% | 247 | | | |
| 9905 | Cyberport Adit & Junction /Perm Works - Review, comment, resubmission & appvl by Engr | 90 | 90 | 20-May-11 | 17-Aug-11 | 0% | 366 | | | |
| PROCUREMENT | | | | | | | | | | |
| Procurement; Manufacturing; Deliveries | | | | | | | | | | |
| Stainless Steel Resrve Pipes (200 dia) | | | | | | | | | | |
| 1870 | 200dia SS Pipes - Prepare and submit method statement to the Engineer | 30 | 20 | 05-Mar-11 A | 13-Jun-11 | 33% | 107 | | | |
| 1868 | 200dia SS Pipes - Stainless Steel Pipes Design & Drawings Approval | 45 | 45 | 20-May-11 | 25-Jul-11 | 0% | 91 | | | |
| 1871 | 200dia SS Pipes - Review, comments & consent by the Engineer | 30 | 30 | 14-Jun-11 | 26-Jul-11 | 0% | 90 | | | |
| Temporary Radio Communication, CCTV Camera & Flood Control System (by FSD) | | | | | | | | | | |
| 1884 | Radio Comm, CCTV Camera - Prepare and submit method statement to the Engineer | 30 | 30 | 08-Jun-11 | 13-Jul-11 | 0% | 110 | | | |
| 1886 | Radio Comm, CCTV Camera - Submit Design & Drawings Approval | 30 | 30 | 14-Jul-11 | 24-Aug-11 | 0% | 92 | | | |
| 1873 | Radio Comm, CCTV Camera - Review, comments & consent by the Engineer | 30 | 30 | 14-Jul-11 | 24-Aug-11 | 0% | 92 | | | |
| Temporary Water Supply (By FSD) | | | | | | | | | | |
| 1890 | Temp Water Supply to Tunnel - Procure Sub-contractor & Award | 60 | 60 | 21-May-11 | 01-Aug-11 | 0% | 76 | | | |
| Shaft Lining PC Pipes | | | | | | | | | | |
| 1854 | PC Drop Pipes - Procure Sub-contractor | 60 | 60 | 21-May-11 | 01-Aug-11 | 0% | 116 | | | |
| CONSTRUCTION | | | | | | | | | | |
| ABERDEEN | | | | | | | | | | |
| Construction Works | | | | | | | | | | |
| Site Establishment | | | | | | | | | | |
| Geotechnical Monitoring | | | | | | | | | | |
| Tunnel P1 | | | | | | | | | | |
| 1444 | Tunnel P1 - Install Automatic Grd Monitoring Devices (AGMD) & Piezometers | 30 | 30 | 20-May-11 | 24-Jun-11 | 0% | 1 | | | |
| 1393 | Tunnel P1 - Install GSM, UMP and SSM Instruments | 18 | 18 | 25-Jun-11 | 16-Jul-11 | 0% | 1 | | | |
| 1437 | Tunnel P1 - Install Vibration and seismographs | 12 | 12 | 18-Jul-11 | 30-Jul-11 | 0% | 1 | | | |
| Temporary Ventilation System | | | | | | | | | | |
| 1355 | Aberd Ventilation System - Install ventilation ducts for Tunnel P1 | 90 | 90 | 20-May-11 | 03-Sep-11 | 0% | 61 | | | |
| Aberdeen Temporary Works - Production / Dropshaft | | | | | | | | | | |
| Shaft - Excavation of Rock to Tunnel Level | | | | | | | | | | |
| 1018 | Aberd Prod /Drop Shaft - Setup lifting facilities & Test | 12 | 12 | 23-May-11 | 04-Jun-11 | 0% | -25 | | | |
| 1017 | Aberd Prod /Drop Shaft - Setup Noise Barrier | 18 | 18 | 23-May-11 | 13-Jun-11 | 0% | -52 | | | |
| 1298 | Aberd Prod /Drop Shaft - Mines Inspection / Blast Permit Issued | 12 | 12 | 30-May-11 | 13-Jun-11 | 0% | -52 | | | |
| 1021 | Aberd Prod /Drop Shaft - Drill & Split Initial 2m @ 0.1m/day | 21 | 21 | 14-Jun-11 | 08-Jul-11 | 0% | -52 | | | |
| 1019 | Aberd Prod /Drop Shaft - Pre Grouting From Rockhead | 40 | 40 | 02-Jul-11 | 17-Aug-11 | 0% | -46 | | | |
| 1300 | Aberd Prod /Drop Shaft - Drill & Blast - Remaining 59m @ 1.25m/day and Shotcrete Liner | 48 | 48 | 09-Jul-11 | 02-Sep-11 | 0% | -52 | | | |
| 1460 | Aberd Prod /Drop Shaft - Shaft Shotcrete Liner | 46 | 46 | 12-Jul-11 | 02-Sep-11 | 0% | -52 | | | |
| Aberdeen Permanent Works - Production / Dropshaft | | | | | | | | | | |
| Scum Chamber | | | | | | | | | | |
| 1421 | Aberd Scam Chamber - Slurry Wall | 20 | 20 | 30-Jun-11 | 23-Jul-11 | 0% | 571 | | | |
| WAH FU | | | | | | | | | | |
| Construction Works | | | | | | | | | | |
| Site Establishment | | | | | | | | | | |
| Temporary Ventilation System | | | | | | | | | | |
| 1389 | Wah Fu Ventilation System - Install ventilation ducts for Tunnel P2 | 90 | 90 | 20-May-11 | 03-Sep-11 | 0% | 257 | | | |
| Wah Fu Temporary Works - Dropshaft | | | | | | | | | | |
| Site Access to Portion WFPTW-i for the Period of 9 Months | | | | | | | | | | |

THREE MONTH ROLLING PROGRAMME (TM22)

STATUS as at 20 May 2011

| Activity ID | Activity Name | Orig Dur | Rem Dur | Forecast Start (20-May-11) | Forecast Finish (20-May-11) | % Compl | Total Float | 2011 | | |
|---|---|----------|---------|----------------------------|-----------------------------|---------|-------------|------|-----|-----|
| | | | | | | | | May | Jun | Jul |
| 1485 | Wah Fu - Unrestricted Construction Access to Portion WFPTW-i | 270 | 84 | 17-Aug-10 A | 11-Aug-11 | 69% | 449 | | | |
| Wah Fu Dropshaft - Upper Shaft Excav in Rock to Lower Shaft (-16m) | | | | | | | | | | |
| 1618 | Wah Fu Dropshaft - Upper Shaft in Rock @0.1m/day | 27 | 26 | 12-Oct-10 A | 20-Jun-11 | 3% | 472 | | | |
| Wah Fu Dropshaft - Lower Shaft Drill & Blast (-68m) | | | | | | | | | | |
| 1615 | Wah Fu Dropshaft - Install Blast Shield / Mine Inspection / Blast Permit Issued | 21 | 21 | 20-May-11 | 14-Jun-11 | 0% | 477 | | | |
| CYBERPORT | | | | | | | | | | |
| Construction Works | | | | | | | | | | |
| Site Establishment | | | | | | | | | | |
| Geotechnical Monitoring | | | | | | | | | | |
| Tunnel N | | | | | | | | | | |
| 1454 | Tunnel N - Install Automatic Grd Monitoring Devices (AGMD) & Piezometers | 30 | 10 | 06-May-10 A | 31-May-11 | 67% | -26 | | | |
| 1445 | Tunnel N - Install GSM, UMP and SSM Instruments | 18 | 18 | 01-Jun-11 | 22-Jun-11 | 0% | -26 | | | |
| 1447 | Tunnel N - Install Vibration and seismographs | 12 | 12 | 23-Jun-11 | 07-Jul-11 | 0% | -26 | | | |
| Cyberport Temporary Works - Dropshaft | | | | | | | | | | |
| Cyberport - Excavation of rock to tunnel level | | | | | | | | | | |
| 10208 | Cyberport Prod /Drop Shaft - Rock Excavation to tunnel level | 104 | 33 | 20-Sep-10 A | 28-Jun-11 | 68% | 444 | | | |
| SANDY BAY | | | | | | | | | | |
| IPS Interim Payment Schedule Milestones | | | | | | | | | | |
| Sandy Bay PTW - Production Shaft, Except Excavation | | | | | | | | | | |
| MS7.1.6.06 | Sandy Bay - Complete 20% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS7.1.6.07 | Sandy Bay - Complete 40% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS7.1.6.08 | Sandy Bay - Complete 60% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS7.1.6.09 | Sandy Bay - Complete 80% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS7.1.6.10 | Sandy Bay - Complete 100% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| Construction Works | | | | | | | | | | |
| Site Establishment | | | | | | | | | | |
| Geotechnical Monitoring | | | | | | | | | | |
| Tunnel M | | | | | | | | | | |
| 1456 | Tunnel M - Install Automatic Grd Monitoring Devices (AGMD) & Piezometers | 24 | 22 | 06-May-10 A | 15-Jun-11 | 10% | -57 | | | |
| 1449 | Tunnel M - Install GSM, UMP and SSM Instruments | 18 | 18 | 16-Jun-11 | 07-Jul-11 | 0% | -57 | | | |
| 1451 | Tunnel M - Install Vibration and seismographs | 18 | 18 | 08-Jul-11 | 28-Jul-11 | 0% | -57 | | | |
| Temporary Ventilation Fan | | | | | | | | | | |
| 1401 | Sandy Bay Ventilation Syst - Install Equipments, Fan Connection and T&C (Tunnel) | 30 | 30 | 20-May-11 | 24-Jun-11 | 0% | -81 | | | |
| 1403 | Sandy Bay Ventilation Syst - Install ventilation ducts for Tunnel M (L=1987m) | 120 | 120 | 25-Jun-11 | 16-Nov-11 | 0% | -81 | | | |
| Sandy Bay Temporary Works - Production / Dropshaft | | | | | | | | | | |
| Shaft - Excavation of Rock to Tunnel Level | | | | | | | | | | |
| 1037 | Sandy Bay Prod /Drop Shaft - PreGrouting From Rockhead | 60 | 16 | 10-Dec-10 A | 08-Jun-11 | 73% | -60 | | | |
| 1344 | Sandy Bay Prod /Drop Shaft - Prod Shaft Rock Excav (Drill & Blast) 94m @ 1.25m/day and Shotcrete Lining | 74 | 24 | 20-Dec-10 A | 17-Jun-11 | 68% | -60 | | | |
| 1665 | Sandy Bay - Erect & Setup FSD Radio Communication / Remote Control Room & Test | 30 | 30 | 18-Jun-11 | 23-Jul-11 | 0% | 311 | | | |
| 1705 | Sandy Bay - Install (129Lm x 100dia) temp water supply & support @ vertical shaft | 24 | 24 | 18-Jun-11 | 16-Jul-11 | 0% | 306 | | | |
| 1707 | Sandy Bay - Setup 20m3 Reservoir reserve tank adj drop shaft, connect & test | 6 | 6 | 18-Jul-11 | 23-Jul-11 | 0% | 306 | | | |
| Sandy Bay Permanent Works - Production / Dropshaft | | | | | | | | | | |
| Sandy Bay - Scum Chamber | | | | | | | | | | |
| 1598 | Sandy Bay Scum Chamber - Slurry Wall | 20 | 20 | 20-May-11 | 13-Jun-11 | 0% | 605 | | | |
| 1600 | Sandy Bay Scum Chamber - Sheetpile | 6 | 6 | 14-Jun-11 | 20-Jun-11 | 0% | 605 | | | |
| SAI YING PUN | | | | | | | | | | |
| IPS Interim Payment Schedule Milestones | | | | | | | | | | |
| Sai Ying Pun - Production Shaft, Except Excavation | | | | | | | | | | |
| MS8.1.6.06 | Sai Ying Pun - Complete 20% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS8.1.6.07 | Sai Ying Pun - Complete 40% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS8.1.6.08 | Sai Ying Pun - Complete 60% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS8.1.6.09 | Sai Ying Pun - Complete 80% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| MS8.1.6.10 | Sai Ying Pun - Complete 100% lining of total deep of shaft | 0 | 0 | | 20-May-11 | 0% | 1327 | | | |
| Construction Works | | | | | | | | | | |
| Site Establishment | | | | | | | | | | |
| Temporary Ventilation Fan | | | | | | | | | | |
| 1407 | SYP Ventilation System - Setup Main Fan (Containerized) Adjacent to platform | 12 | 12 | 20-May-11 | 02-Jun-11 | 0% | -76 | | | |
| 1413 | SYP Ventilation System - Install Equipments, Fan Connection and T&C (Tunnel) | 30 | 30 | 20-May-11 | 24-Jun-11 | 0% | -8 | | | |
| 1409 | SYP Ventilation System - Install Equipments, Fan Connection and T&C (Drop Shaft) | 30 | 30 | 03-Jun-11 | 09-Jul-11 | 0% | -76 | | | |
| 1439 | SYP Ventilation System - Install ventilation ducts for Tunnel M (L=1710m) | 120 | 120 | 25-Jun-11 | 16-Nov-11 | 0% | -8 | | | |
| 1411 | SYP Ventilation System - Install ventilation ducts for drop shaft | 45 | 45 | 11-Jul-11 | 31-Aug-11 | 0% | -76 | | | |
| Sai Ying Pun Temporary Works - Production Shaft | | | | | | | | | | |

THREE MONTH ROLLING PROGRAMME (TM22) STATUS as at 20 May 2011

| Activity ID | Activity Name | Orig Dur | Rem Dur | Forecast Start (20-May-11) | Forecast Finish (20-May-11) | % Compl | Total Float | 2011 | | |
|---|--|----------|---------|----------------------------|-----------------------------|---------|-------------|--|-----|-----|
| | | | | | | | | May | Jun | Jul |
| Shaft - Diaphragm Walls | | | | | | | | | | |
| 1614 | SYP Production Shaft - Pumping Test | 24 | 13 | 18-Jan-11 A | 03-Jun-11 | 46% | -59 | SYP Production Shaft - Pumping Test, SYP Production Shaft - Pumping Test | | |
| Shaft - Soft Excavation | | | | | | | | | | |
| 1252 | SYP Production Shaft - Excav down to Rockhead level (Soft) 89m @ 2.5/day | 36 | 36 | 04-Jun-11 | 18-Jul-11 | 0% | -59 | SYP Production Shaft - Excav down to Rockhead level (Soft) 89m @ 2.5/day | | |
| Shaft - Excavation of Rock to Tunnel Level | | | | | | | | | | |
| 1041 | SYP Production Shaft - Setup Noise Barrier | 18 | 10 | 04-Jan-11 A | 31-May-11 | 44% | -20 | SYP Production Shaft - Setup Noise Barrier, SYP Production Shaft - Setup Noise Barrier | | |
| 1045 | SYP Production Shaft - Drill & Split Initial 2m @ 0.1m/day | 21 | 21 | 19-Jul-11 | 11-Aug-11 | 0% | -59 | SYP Production Shaft - Drill & Split Initial 2m @ 0.1m/day | | |

APPENDIX C

EVENT AND ACTION PLAN

Event/ Action Plan for Construction Noise

| Event | Action | | | |
|-----------------------------|---|---|--|---|
| | ET | IEC | ER | Contractor |
| Action Level being exceeded | <ol style="list-style-type: none"> 1. Notify ER, IEC and Contractor; 2. Carry out investigation; 3. Report the results of investigation to the IEC, ER and Contractor; 4. Discuss with the IEC and Contractor on remedial measures required; 5. Increase monitoring frequency to check mitigation effectiveness. | <ol style="list-style-type: none"> 1. Review the investigation results submitted by the ET; 2. Review the proposed remedial measures by the Contractor and advise the ER accordingly; 3. Advise the ER on the effectiveness of the proposed remedial measures. | <ol style="list-style-type: none"> 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. In consolidation with the IEC, agree with the Contractor on the remedial measures to be implemented; 4. Supervise the implementation of remedial measures. | <ol style="list-style-type: none"> 1. Submit noise mitigation proposals to IEC and ER; 2. Implement noise mitigation proposals. |
| Limit Level being exceeded | <ol style="list-style-type: none"> 1. Inform IEC, ER, Contractor and EPD; 2. Repeat measurements to confirm findings; 3. Increase monitoring frequency; 4. Identify source and investigate the cause of exceedance; 5. Carry out analysis of Contractor's working procedures; 6. Discuss with the IEC, Contractor and ER on remedial measures required; 7. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results; 8. If exceedance stops, cease additional monitoring. | <ol style="list-style-type: none"> 1. Discuss amongst ER, ET, and Contractor on the potential remedial actions; 2. Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly. | <ol style="list-style-type: none"> 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. In consolidation with the IEC, agree with the Contractor on the remedial measures to be implemented; 4. Supervise the implementation of remedial measures; 5. If exceedance continues, consider stopping the Contractor to continue working on that portion of work which causes the exceedance until the exceedance is abated. | <ol style="list-style-type: none"> 1. Take immediate action to avoid further exceedance; 2. Submit proposals for remedial actions to IEC and ER within 3 working days of notification; 3. Implement the agreed proposals; 4. Submit further proposal if problem still not under control; 5. Stop the relevant portion of works as instructed by the ER until the exceedance is abated. |

Event/ Action Plan for Construction Air Quality

| Event | Action | | | |
|---|--|--|---|---|
| | ET | IEC | ER | Contractor |
| ACTION LEVEL | | | | |
| 1. Exceedance for one sample | 1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Inform IEC and ER; 3. Repeat measurement to confirm finding; 4. Increase monitoring frequency to daily. | 1. Check monitoring data submitted by ET; 2. Check Contractor's working method. | 1. Notify Contractor. | 1. Rectify any unacceptable practice; 2. Amend working methods if appropriate. |
| 2. Exceedance for two or more consecutive samples | 1. Identify source; 2. Inform IEC and ER; 3. Advise the ER on the effectiveness of the proposed remedial measures; 4. Repeat measurements to confirm findings; 5. Increase monitoring frequency to daily; 6. Discuss with IEC and Contractor on remedial actions required; 7. If exceedance continues, arrange meeting with IEC and ER; 8. If exceedance stops, cease additional monitoring. | 1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss with ET and Contractor on possible remedial measures; 4. Advise the ET on the effectiveness of the proposed remedial measures; 5. Supervise Implementation of remedial measures. | 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. Ensure remedial measures properly implemented. | 1. Submit proposals for remedial to ER within 3 working days of notification; 2. Implement the agreed proposals; 3. Amend proposal if appropriate. |
| LIMIT LEVEL | | | | |
| 1. Exceedance for one sample | 1. Identify source, investigate the causes of exceedance and propose remedial measures; 2. Inform ER, Contractor and EPD; 3. Repeat measurement to confirm finding; 4. Increase monitoring frequency to daily; 5. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results. | 1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss with ET and Contractor on possible remedial measures; 4. Advise the ER on the effectiveness of the proposed remedial measures; 5. Supervise implementation of remedial measures. | 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. Ensure remedial measures properly implemented. | 1. Take immediate action to avoid further exceedance; 2. Submit proposals for remedial actions to IEC within 3 working days of notification; 3. Implement the agreed proposals; 4. Amend proposal if appropriate. |
| 2. Exceedance for two or more consecutive samples | 1. Notify IEC, ER, Contractor and EPD; 2. Identify source; 3. Repeat measurement to confirm findings; 4. Increase monitoring frequency to daily; 5. Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented; 6. Arrange meeting with IEC and ER to discuss the remedial actions to be taken; 7. Assess effectiveness of Contractor's remedial actions and keep IEC, EPD and ER informed of the results; 8. If exceedance stops, cease additional monitoring. | 1. Check monitoring data submitted by ET; 2. Check Contractor's working method; 3. Discuss amongst ER, ET, and Contractor on the potential remedial actions; 4. Review Contractor's remedial actions whenever necessary to assure their effectiveness and advise the ER accordingly; 5. Supervise the implementation of remedial measures. | 1. Confirm receipt of notification of failure in writing; 2. Notify Contractor; 3. In consolidation with the IEC, agree with the Contractor on the remedial measures to be implemented; 4. Ensure remedial measures properly implemented; 5. If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop that portion of work until the exceedance is abated. | 1. Take immediate action to avoid further exceedance; 2. Submit proposals for remedial actions to IEC within 3 working days of notification; 3. Implement the agreed proposals; 4. Resubmit proposals if problem still not under control; 5. Stop the relevant portion of works as determined by the ER until the exceedance is abated. |

Event and Action Plan for Landscape and Visual Impact - Construction Phase

| Action Level | Environmental Team Leader (ETL) | Independent Environmental Checker (IEC) | Engineer's Representative (ER) | Contractor |
|--------------------------------|--|---|--|--|
| Non-conformity on one occasion | <ol style="list-style-type: none"> 1. Identify source 2. Inform the IEC and the ER 3. Discuss remedial actions with the IEC, the ER and the Contractor 4. Monitor remedial action until rectification has been completed | <ol style="list-style-type: none"> 1. Check report 2. Check the Contractor's working method 3. Discuss with the ER and the Contractor on possible remedial measures 4. Advise the ER on effectiveness of proposed remedial measures | <ol style="list-style-type: none"> 1. Notify the Contractor 2. Ensure remedial measures are properly implemented | <ol style="list-style-type: none"> 1. Amend working methods 2. Rectify damage and undertake remedial measures or any necessary replacement |
| Repeated Non-conformity | <ol style="list-style-type: none"> 1. Identify source 2. Inform the IEC and the ER 3. Increase monitoring (site audit) frequency 4. Discuss remedial actions with the IEC, the ER and the Contractor 5. Monitor remedial actions until rectification has been completed 6. If exceedance stops, cease additional monitoring (site audit) | <ol style="list-style-type: none"> 1. Check report 2. Check the Contractor's working method 3. Discuss with the ER and the Contractor on possible remedial measures 4. Advise the ER on effectiveness of proposed remedial measures 5. Supervise implementation of remedial measures | <ol style="list-style-type: none"> 1. Notify the Contractor 2. Ensure remedial measures are properly implemented | <ol style="list-style-type: none"> 1. Amend working methods 2. Rectify damage and undertake remedial measures or any necessary replacement |

APPENDIX D

MITIGATION MEASURES CHECKLIST

DC/2007/24 – Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

May11

| EIA Ref. | Final EM&A Manual Ref. | Environmental Aspect | Mitigation Measures | Timing | Compliance Status: √ = compliant; x = non-compliant; N/A = not applicable | |
|----------|------------------------|----------------------|--|----------------------------------|---|---------|
| | | | | | Status | Remarks |
| 3.64 | 2.55 | Air Quality Control | <ul style="list-style-type: none"> Watering twice per day within the worksites at North Point PTW, Wan Chai East PTW, Fung Mat Road Site, Sandy Bay PTW, Wah Fu PTW, Aberdeen PTW and SCS worksite at Aberdeen; Watering 4 times per day within worksites at the Central PTW; Barging points, if any, should be continuous watering throughout the whole unloading process; and Watering 8 times per day within worksites at the SCS works area at Wan Chai East and North Point, SCISTW and the Disinfection Facilities of SCISTW. | During Construction | √ | |
| 3.74 | 2.54 | Air Quality Control | <p>Implementation of dust suppression measures stipulated in Air Pollution Control (Construction Dust) Regulation. The following mitigation measures, good site practices and a comprehensive dust monitoring and audit programme are recommended to minimize cumulative dust impacts.</p> <ul style="list-style-type: none"> Skip hoist for material transport should be totally enclosed by impervious sheeting; Vehicle washing facilities should be provided at every vehicle exit point; The area where vehicle washing takes place and the section of the road between the washing facilities and the exit point should be paved with concrete, bituminous materials or hardcore; Where a site boundary adjoins a road, streets or other areas accessible to the public, hoarding of not less than 2.4 m high from ground level should be provided along the entire length except for a site entrance or exit; Use of regular watering, with complete coverage, to reduce dust emissions from exposed site surfaces and unpaved roads, particularly during dry weather; Side enclosure and covering of any aggregate or dusty material storage piles to reduce emissions. Where this is not practicable owing to frequent usage, watering shall be applied to aggregate fines; Open stockpiles shall be avoided or covered. Where possible, prevent placing dusty material storage piles near ASRs; Tarpaulin covering of all dusty vehicle loads transported to, from and between site locations; Imposition of speed controls for vehicles on unpaved site roads. Ten kilometers per hour is the recommended limit; Every stock of more than 20 bags of cement should be covered entirely by impervious sheeting placed in an area sheltered on the top and the 3 sides; | During Construction | √ | |
| 3.76 | 2.58 | Air Quality Control | <p>Good housekeeping for SCISTW and PTWs listed below should be followed to ameliorate any odour impact from the plant and these standard practices should be included in the plant operator manual.</p> <ul style="list-style-type: none"> Screens should be cleaned regularly to remove any accumulated organic debris Grit and screening transfer systems should be flushed regularly with water to remove organic debris and grit Grit and screened materials should be transferred to closed containers to minimize odour escape Scum and grease collection wells and troughs should be emptied and flushed regularly to prevent putrefaction of accumulated organics Skim and remove floating solids and grease from primary clarifiers regularly Frequent sludge withdrawal from tanks is necessary to prevent the production of gases Sludge cake should be transferred to closed containers Sludge containers should be flushed with water regularly | During Operation | N/A | |
| | 2.57 | Air Quality Control | Fully covered design of the odour sources of the upgraded PTWs and SCISTW and the installation of deodorization system at the exhaust of ventilation system would adequately control potential odour impact. | During Operation | N/A | |
| 3.77 | 2.59 | Air Quality Control | To avoid excessive extraction of the foul air from the drop shafts of the sedimentation tanks and also from the effluent flume structure of SCISTW to deodorization system, the extraction vent(s) of the deodorization system should be located away from the top openings of the drop shafts. | During Design Stage | N/A | |
| 3.80 | 2.6 | Air Quality Control | Commissioning tests for all deodorization system should be included in the Design and Construction Contract Document. | After completion of construction | N/A | |

DC/2007/24 – Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

May11

| EIA Ref. | Final EM&A Manual Ref. | Environmental Aspect | Mitigation Measures | Timing | Compliance Status: √ = compliant; x = non-compliant; N/A = not applicable | |
|---------------|------------------------|-----------------------|---|-----------------------------------|---|---------|
| | | | | | Status | Remarks |
| 4.56-4.61 | 3.21-3.24 | Noise Control | Use of quiet PME, movable barriers and acoustic mats | During Construction | √ | |
| 4.67 | 3.25 | Noise Control | <p>Good Site Practice:</p> <ul style="list-style-type: none"> • Only well-maintained plant shall be operated on-site and plant shall be serviced regularly during the construction program. • Silencers or mufflers on construction equipment shall be utilized and shall be properly maintained during the construction program. • Mobile plant, if any, shall be sited as far away from NSRs as possible. • Machines and plant (such as trucks) that may be in intermittent use shall be shut down between works periods or shall be throttled down to a minimum. • Plant known to emit noise strongly in one direction shall, wherever possible, be orientated so that the noise is directed away from the nearby NSRs. • Material stockpiles and other structures shall be effectively utilized, wherever practicable, in screening noise from on-site construction activities. | During Construction | √ | |
| 4.63 | 3.28 | Noise Control | Use of acoustic louvers for air supply fans/extraction fans of transfer pumping stations and ventilation fans of deodourization unit at Sandy Bay PTW, Cyberport PTW and Wah Fu PTW | During Operation and Design Stage | N/A | |
| 4.64 | | Noise Control | The maximum allowable sound power level (SWL) of each new transformer at Sandy Bay PTW shall be limited to 89 dB(A). | During Operation and Design Stage | N/A | |
| 6.349 - 6.375 | | Water Quality Control | <p>Construction Site Runoff and General Construction Activities</p> <p>The mitigation measures as outlined in the ProPECC PN 1/94 Construction Site Drainage should be adopted where applicable.</p> | During Construction | √ | |
| 6.376 | | Water Quality Control | <p>Effluent Discharge</p> <p>There is a need to apply to EPD for a discharge licence for discharge of effluent from the construction site under the WPCO. The discharge quality must meet the requirements specified in the discharge licence. If monitoring of the treated effluent quality from the works areas is required during the construction phase of the Project, the monitoring should be carried out in accordance with the WPCO license which is under the ambit of regional office (RO) of EPD. Minimum distances of 100 m should be maintained between the discharge points of construction site effluent and the existing saltwater intakes.</p> | During Construction | √ | |
| 6.377 | | Water Quality Control | <p>Accidental Spillage of Chemicals</p> <p>Contractor must register as a chemical waste producer if chemical wastes would be produced from the construction activities. The Waste Disposal Ordinance (Cap 354) and its subsidiary regulations in particular the Waste Disposal (Chemical Waste) (General) Regulation should be observed and complied with for control of chemical wastes.</p> | During Construction | √ | |
| 6.378 | | Water Quality Control | Any service shop and maintenance facilities should be located on hard standings within a bunded area, and sumps and oil interceptors should be provided. Maintenance of vehicles and equipment involving activities with potential for leakage and spillage should only be undertaken within the areas appropriately equipped to control these | During Construction | √ | |

DC/2007/24 – Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

May11

| EIA Ref. | Final EM&A Manual Ref. | Environmental Aspect | Mitigation Measures | Timing | Compliance Status: ✓ = compliant; x = non-compliant; N/A = not applicable | |
|----------|------------------------|-----------------------|--|-----------------------------------|---|---------|
| | | | | | Status | Remarks |
| 6.379 | | Water Quality Control | Disposal of chemical wastes should be carried out in compliance with the Waste Disposal Ordinance. The Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes published under the Waste Disposal Ordinance details the requirements to deal with chemical wastes. General requirements are given as follows: <ul style="list-style-type: none"> • Suitable containers should be used to hold the chemical wastes to avoid leakage or spillage during storage, handling and transport. • Chemical waste containers should be suitably labelled, to notify and warn the personnel who are handling the wastes, to avoid accidents. • Storage area should be selected at a safe location on site and adequate space should be allocated to the storage area. | During Construction | ✓ | |
| 6.380 | | Water Quality Control | Construction Works in Close Proximity of Storm Drains or Seafront To minimize the potential water quality impacts from the construction works located at or near any watercourse, the practices outlined below should be adopted where applicable. <ul style="list-style-type: none"> • The use of less or smaller construction plants may be specified to reduce the disturbance to the storm water courses or marine environment. • Temporary storage of materials (e.g. equipment, filling materials, chemicals and fuel) and temporary stockpile of construction materials should be located well away from any water courses during carrying out of the construction works. • Stockpiling of construction materials and dusty materials should be covered and located away from any water courses. • Construction debris and spoil should be covered up and/or disposed of as soon as possible to avoid being washed into the nearby water receivers. • Construction activities, which generate large amount of wastewater, should be carried out in a distance away from the waterfront, where practicable. | During Construction | ✓ | |
| 6.381 | | Water Quality Control | Temporary Sewage Bypass It is recommended that the temporary sewage bypass required for (i) the modification to the existing pumping station at SCISTW and (ii) the interconnection between the existing main pumping station and the new pumping station on Stonecutters Island, if needed, should be scheduled at the same time as far as practicable in order to minimise the temporary discharge duration. It is also recommended that all the modification and interconnection to the existing facilities (including the modification to the existing NWKPS) should be programmed to avoid temporary sewage bypass in wet or bathing season (March to October) to minimize the potential impacts. Relevant government departments including EPD and LCSD should be informed of the planned sewage bypass prior to any discharge. During the sewage bypass period, water quality monitoring should be carried out at the water sensitive receivers to quantify the water quality impacts and to determine when the baseline water quality conditions are restored. Also, a framework of the response procedures has been formulated to minimize the impact of temporary | During Construction | ✓ | |
| 6.344 | | Water Quality Control | Dual power supply, standby facilities for the main treatment units and standby equipment parts / accessories should be provided as far as possible at the SCISTW to minimize the chance of emergency discharge. | During Operation and Design Stage | N/A | |
| 6.344 | | Water Quality Control | The response procedure and monitoring requirements for emergency discharge as stated in EM&A Manual should be followed. | During Operation | N/A | |
| 6.345 | | Water Quality Control | Standby unit(s) and dual (backup) power supply would be provided at all the Stage 2 PTWs to reduce the risk of equipment breakdown at the PTWs. | During Operation and Design Stage | N/A | |

DC/2007/24 – Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

May11

| EIA Ref. | Final EM&A Manual Ref. | Environmental Aspect | Mitigation Measures | Timing | Compliance Status: √ = compliant; x = non-compliant; N/A = not applicable | |
|----------|------------------------|------------------------------|--|-----------------------------------|---|---------|
| | | | | | Status | Remarks |
| 6.346 | | Water Quality Control | In case of total power outage of the dechlorination plant, the uninterruptible power supply (UPS) system to be provided would switch the power supply of the sodium bisulphite dosing pump to a backup battery almost instantaneously, allowing continuous dosage of sodium bisulphite for at least half an hour so that sufficient time can be provided for shutting down the chlorination plant to avoid the possibility of discharge of chlorinated effluent. | During Operation and Design Stage | N/A | |
| 6.347 | | Water Quality Control | The model predicted that if Stage 2B is not implemented for HATS in 2021 as scheduled, the nutrient contents (both P and N) in the marine water would ultimately increase to exceed the baseline Stage 1 level when the HATS flow is reaching its design capacity of 2.45M m3/day. It is recommended that the future review study for Stage 2B should review the validity of the model predictions provided in this EIA and confirm the need of enhanced nutrient removal for HATS after 2021. | During Operation and Design Stage | N/A | |
| 6.348 | | Water Quality Control | It should be noted that the mixing zone for TIN predicted for Stage 2B was large with an area of about 30 km2 and the area of exceedance would encroach on the nearby water sensitive receivers (e.g. Ma Wan Fish Culture Zone). This is due to the elevated oxidized nitrogen assumed for the proposed nitrification process at Stage 2B as well as the increased HATS effluent flow assumed for Stage 2B. It is recommended that these water quality issues should be further investigated / assessed under the future EIA for Stage 2B. Further mitigation measures / alternative treatment designs should also be considered under the future EIA for Stage 2B to mitigate / minimize the potential TIN exceedances. | Investigation Stage of Stage 2B | N/A | |
| 9.107 | 7.8 | Waste Management | Reusable steel or concrete panel shutters, fencing and hoarding and signboard should be used as a preferred alternative to items made of wood, to minimise wastage of wood. Attention should be paid to WBTC No. 19/2001 - Metallic Site Hoardings and Signboards to reduce the amount of timber used on construction sites. Metallic alternatives to timber are readily available and should be used rather than new timber. Precast concrete units should be adopted wherever feasible to minimize the use of timber formwork. | During Construction | √ | |
| 9.109 | 7.10 | Waste Management Implication | All waste materials should be segregated into categories covering: <ul style="list-style-type: none"> • excavated materials suitable for reuse on-site; • excavated materials suitable for public filling facilities; • remaining C&D waste for landfill; • chemical waste; and • general refuse for landfill. | During Construction | √ | |
| 9.113 | 7.15 | Waste Management Implication | Recommendations to achieve waste reduction include:- <ul style="list-style-type: none"> • Sort C&D waste from demolition of existing facilities to recover recyclable portions such as metals; • Segregation and storage of different types of waste in different containers, skips or stockpiles to enhance reuse or recycling of materials and their proper disposal; • Encourage collection of aluminium cans, PET bottles and paper by providing separate labelled bins to enable these wastes to be segregated from other general refuse generated by the work force; • Any unused chemicals or those with remaining functional capacity shall be recycled; and • Proper storage and site practices to minimise the potential for damage or contamination of construction materials. | During Construction | √ | |
| 9.115 | 7.14 | Waste Management Implication | Recommendations for good site practices during construction activities include:- <ul style="list-style-type: none"> • Nomination of an approved person, such as a site manager, to be responsible for good site practices, arrangements for collection and effective disposal to an appropriate facility, of all wastes generated at the site • Training of site personnel in proper waste management and chemical waste handling procedures • Develop and provide toolbox talk for on-site sorting of C&D materials to enhance worker's awareness in handling, sorting, reuse and recycling of C&D materials. • Provision of sufficient waste disposal points and regular collection of waste • Regular cleaning and maintenance programme for drainage systems, sumps and oil interceptors | During Construction | √ | |

DC/2007/24 – Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

May11

| EIA Ref. | Final EM&A Manual Ref. | Environmental Aspect | Mitigation Measures | Timing | Compliance Status: √ = compliant; x = non-compliant; N/A = not applicable | |
|----------|------------------------|------------------------------|--|---------------------|---|---------|
| | | | | | Status | Remarks |
| 9.125 | 7.14 | Waste Management Implication | Bentonite slurries used in diaphragm wall construction should be reconditioned and reused wherever practicable. The disposal of residual used bentonite slurry should follow the good practice guidelines stated in ProPECC PN 1/94 | During Construction | N/A | |
| 9.131 | 7.26 | Waste Management Implication | Adequate number of portable toilets at temporary works areas or the PTWs to ensure that sewage from site staff would be properly collected. | During Construction | √ | |
| 9.133 | 7.22 | Waste Management Implication | General refuse should be stored in enclosed bins, skips or compaction units separating from C&D material and disposed of at designated landfill. | During Construction | √ | |
| 9.135 | 7.24 | Waste Management Implication | The recyclable component of the municipal waste generated by the workforce, such as aluminium cans, paper and cleansed plastic containers should be separated from other waste. Provision and collection of recycling bins for different types of recyclable waste should be set up by the Contractor. The Contractor should also be responsible for arranging recycling companies to collect these materials. | During Construction | √ | |
| 9.137 | 7.28 | Waste Management Implication | If chemical wastes are produced at the construction site, the Contractor would be required to register with the EPD as a chemical waste producer and to follow the guidelines stated in the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes. Good quality containers compatible with the chemical wastes should be used, and incompatible chemicals should be stored separately. Appropriate labels should be securely attached on each chemical waste container indicating the corresponding chemical characteristics of the chemical waste, such as explosive, flammable, oxidizing, irritant, toxic, harmful, corrosive, etc. The Contractor shall use a licensed collector to transport and dispose of the chemical wastes, to either the approved Chemical Waste Treatment Centre, or another licensed facility, in accordance with the Waste Disposal (Chemical Waste) (General) Regulation. | During Construction | √ | |
| 9.142 | 7.32 ~ 7.33 | Waste Management Implication | Prior to excavation of the marine deposit layer, the deposit should be tested in accordance with the ETWB TC(W) No. 34/2002 and the results should be presented in a Preliminary Sediment Quality Report. The marine deposit should be disposed of at the disposal site designated by the Marine Fill Committee (MFC) or Director of Environmental Protection (DEP) depending on the test results. | During Construction | N/A | |
| 9.148 | 7.36 | Waste Management Implication | The sludge tanks should be air-tighten. Rotating brushes or other alternative devises should be installed at the upper frame of the sludge tank washing facilities to provide better cleaning of the surface around the top loading opening of the sludge tanks. Prior to making such provision, the top covers of the sludge transfer tanks should be water cleaned manually after unloading. | During Construction | N/A | |
| 9.150 | 7.35 | Waste Management Implication | Since the air tightness of tankers highly relies on the effectiveness of rubber seals at the loading openings and unloading doors, odour leakage from tankers are commonly resulted from the aging rubber seals. It is recommended to develop a preventive maintenance programme for rubber seals of loading openings and unloading doors of sludge transfer tanks to ensure the tightness of covers and doors. Rubber seals should be regularly replaced within its design life as specified by suppliers. | During Construction | N/A | |
| 10.92 | | Terrestrial Ecology | All the proposed construction activities would be confined to developed area and wasteland of very low ecological value. | Design stage | √ | |
| 10.93 | | Terrestrial Ecology | To implement effective noise mitigation recommended in Section 4. | During Construction | √ | |
| 10.94 | | Terrestrial Ecology | Dust control practices such as regular watering, complete coverage of any aggregate or dusty material storage piles, and re-schedule of dusty activities during high-wind conditions as well as other measures recommended in Section 3, should be implemented. | During Construction | √ | |
| 10.95 | | Terrestrial Ecology | Fences/hoardings should be erected and installed along the boundary of the works areas. | During Construction | √ | |

DC/2007/24 – Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

May11

| EIA Ref. | Final EM&A Manual Ref. | Environmental Aspect | Mitigation Measures | Timing | Compliance Status: √ = compliant; x = non-compliant; N/A = not applicable | |
|-------------------|------------------------|---------------------------|--|--------------------------------------|---|---------|
| | | | | | Status | Remarks |
| 10.96 | | Terrestrial Ecology | Standard good site practices as suggested in Section 10 should be implemented. | During Construction | √ | |
| 10.97 | | Terrestrial Ecology | Provision of proper drainage system and runoff control measures such as use of sand/silt traps, oil/grease separators, sedimentation tanks, etc. | During Construction | √ | |
| 10.98 | | Terrestrial Ecology | Provision of compensatory planting of similar native tree species in no less than 1:1 compensatory ratio in terms of quality and quantity. | During Construction | N/A | |
| 11.135 | | Marine Ecology | To minimize the potential indirect impacts on water quality from construction site runoff and various construction activities, the practices outlined in ProPECC PN 1/94 Construction Site Drainage should be adopted. | During Construction | √ | |
| 11.136 | | Marine Ecology | To avoid/minimize the impact to corals, it is proposed that they are translocated to the eastern end of the existing seawall, which has similar hydrographic parameters and supports healthy growth of the same species and is thus considered as a suitable recipient site (Figure 11.13). Coral translocation should be carried out during the winter season (November- March) in order to avoid disturbance to the transplanted colonies during the spawning period (i.e. July to October). | Pre-construction | N/A | |
| 11.137 | | Marine Ecology | Dredging works will not be carried out and sheet piles or silt curtains will be used to contain filling material used during demolition/re-construction of the seawall. Water quality modelling predicts that no adverse impact on water quality at the proposed recipient (Figure 11.13) site would occur during construction works. Following this, no construction phase monitoring on translocated coral would be required. However, post-translocation monitoring is suggested to be carried out every 3 months for one year. This would be carried out by a marine ecological specialist that is approved by the Director. Translocation plan for corals will be submitted to the Director for approval prior to the commencement of construction works. | Pre-construction | N/A | |
| 11.139 | | Marine Ecology | It is recommended that temporary sewage bypass should be programmed to avoid temporary sewage bypass in wet or bathing season (March to October) in order to minimize the potential impacts. Relevant government departments including EPD and LCSD should be informed of the planned sewage bypass prior to any discharge. During the sewage bypass period, water quality monitoring should be carried out at the water sensitive receivers to quantify the water quality impacts and to determine when the baseline water quality conditions are restored. Also, a framework of the response procedures has been formulated to minimize the impact of temporary discharges. Details are provided in the standalone EM&A Manual. | During Construction and Design stage | √ | |
| Table 13.7 | | Landscape & Visual Impact | <ul style="list-style-type: none"> • Topsoil, where identified, should be stripped and stored for re-use in the construction of the soft landscape works, where practical. • Existing trees to be retained on site should be carefully protected during construction. • Trees unavoidably affected by the works should be transplanted where practical. • Compensatory tree planting should be provided to compensate for felled trees. • Control of night-time lighting. • Erection of decorative screen hoarding the surrounding setting. | Pre-construction | N/A | |
| Table 13.8 | | Landscape & Visual Impact | <ul style="list-style-type: none"> • Aesthetic design of the façade of PTW and associated structures to harmonize with the surrounding settings. • Shrub and Climbing Plants to soften proposed structures / Roof Greening. • Buffer Tree and Shrub Planting to screen proposed associated structures. • Reinstated of disturbed area | Pre-construction | N/A | |
| 14A.198 & 14A.203 | | Hazard to Life | Limiting magnitude of ground settlement associated with shafts & tunnels construction, excavation and seawall demolition to 13mm and subject to requirements from relevant authorities. | During Construction | √ | |

DC/2007/24 – Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun

May11


| EIA Ref. | Final EM&A Manual Ref. | Environmental Aspect | Mitigation Measures | Timing | Compliance Status: √ = compliant; x = non-compliant; N/A = not applicable | |
|---------------------|------------------------|----------------------|--|---|---|---------|
| | | | | | Status | Remarks |
| 14A.199 & 14A.204 | | Hazard to Life | Limiting of the vibration levels associated with the blasting programme for the Tunnel P, shafts and other construction works (including demolition & reconstruction of seawall, excavation for seawater pump house at the Aberdeen PTW) at the PTW sites to a peak particle velocity of 5mm/s and subject to requirements from relevant authorities. Moving array of sensors will be used as the tunnel is advanced. | During Construction | N/A | |
| 14A.201 | | Hazard to Life | Limiting use of cranes in terms of locations, lifting height, swing angle and setting up safety zone. | During Construction | √ | |
| 14A.206 | | Hazard to Life | Establish emergency plan and procedures | During Construction | √ | |
| 14.C78 | | Hazard to Life | Ensuring Quality of Chemical Supplier <ul style="list-style-type: none"> • Only appoint chemical suppliers with satisfactory quality system. • Request the chemical supplier to employ an independent checker to audit the quality and safety management system of the supplier • The chemical supplied to SCISTW can only be produced in designated chemical production plants and delivered directly from designated locations. This measure will be included in the chemical supply contract. | During Construction | √ | |
| Tables 15.8 - 15.11 | | Cultural Heritage | The construction vibration control limit (ppv of 25mm/s) shall be strictly followed. | During Blasting for tunnel, shafts, effluent conveyance system and disinfection facilities in the vicinity of the buildings/ structures | √ | |
| 15.7 | | Cultural Heritage | Monitoring of vibration limits shall be conducted and reported as a requirement of EM&A programme | During Blasting for tunnel, shafts, effluent conveyance system and disinfection facilities in the vicinity of the buildings/ structures | √ | |

APPENDIX E

WEATHER CONDITION DURING REPORTING PERIOD


Weather Conditions at Green Island Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 1 日 23 時 40 分更新) (Updated at 23:40H on 1 May 2011) (km/h)

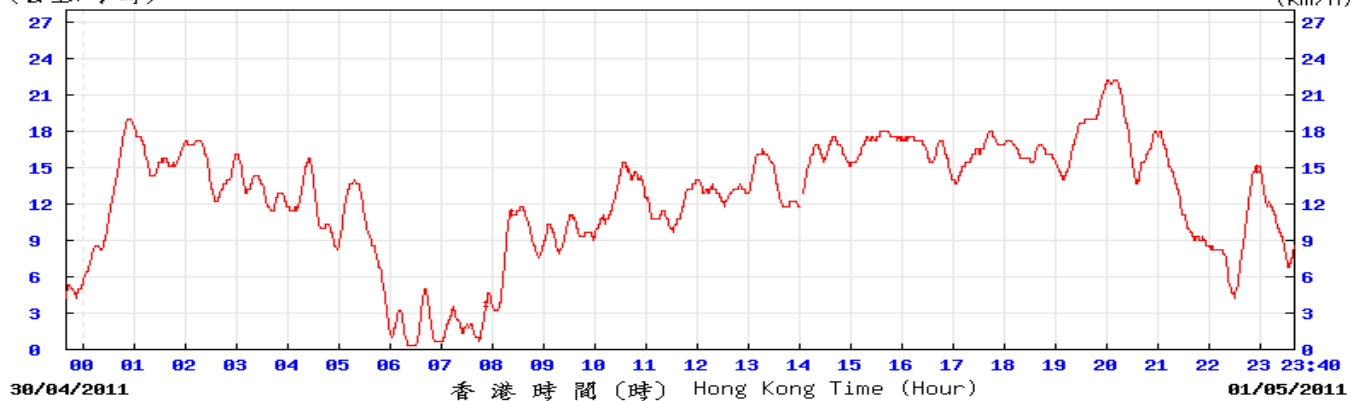


GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 2 日 23 時 50 分更新) (Updated at 23:50H on 2 May 2011) (km/h)

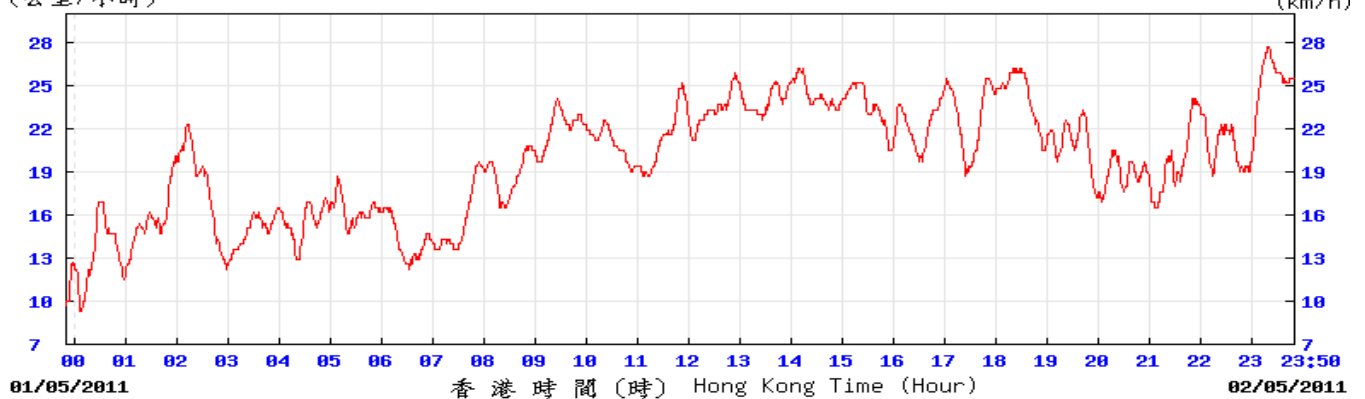

GIC © 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 3 日 23 時 50 分更新) (Updated at 23:50H on 3 May 2011) (km/h)

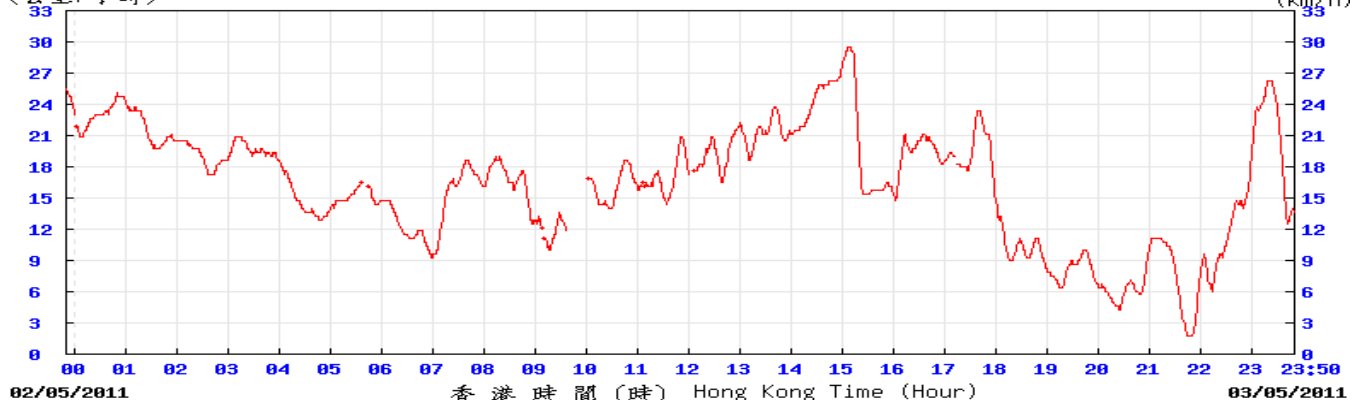


GIC © 香港天文台 Hong Kong Observatory

Weather Conditions at Green Island Weather Station during Monitoring Period


(公里/小時) (於香港時間 2011 年 5 月 4 日 23 時 50 分更新) (Updated at 23:50H on 4 May 2011) (km/h)

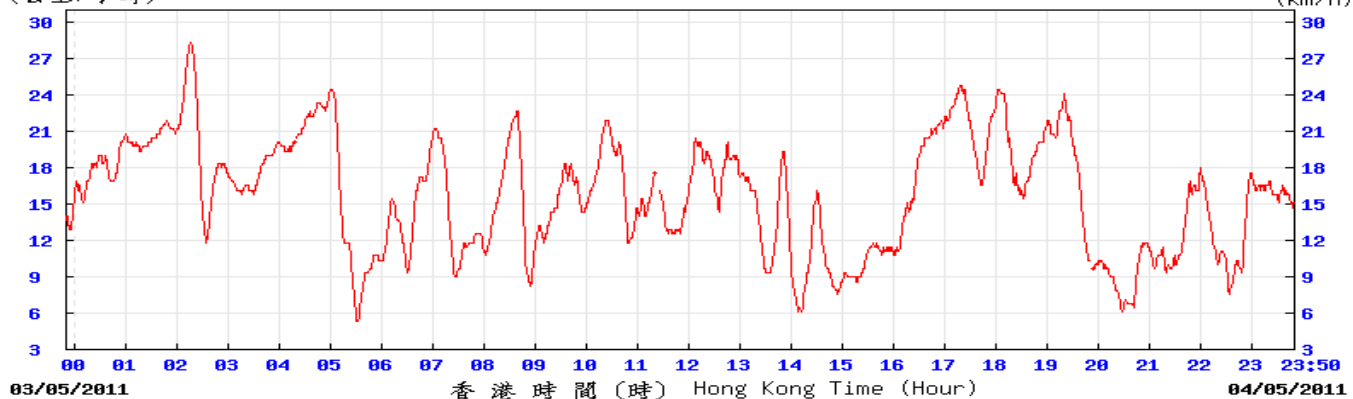




(公里/小時) (於香港時間 2011 年 5 月 5 日 23 時 50 分更新) (Updated at 23:50H on 5 May 2011) (km/h)

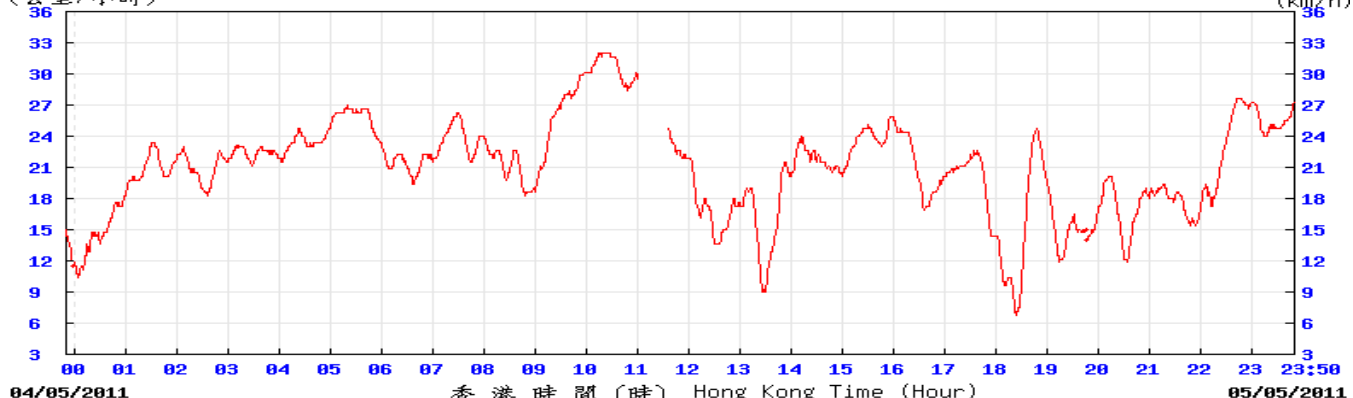

(公里/小時) (於香港時間 2011 年 5 月 6 日 23 時 50 分更新) (Updated at 23:50H on 6 May 2011) (km/h)

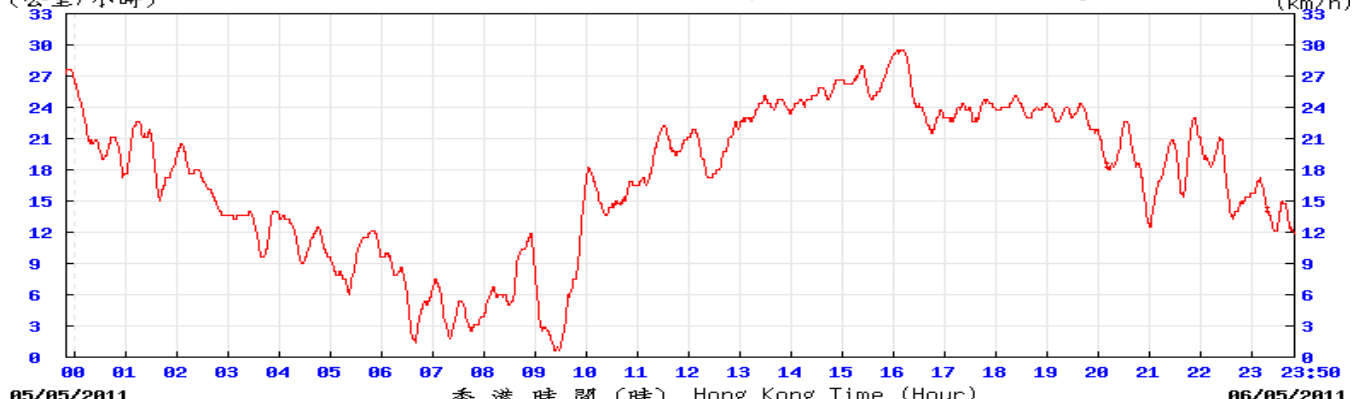


Weather Conditions at Green Island Weather Station during Monitoring Period

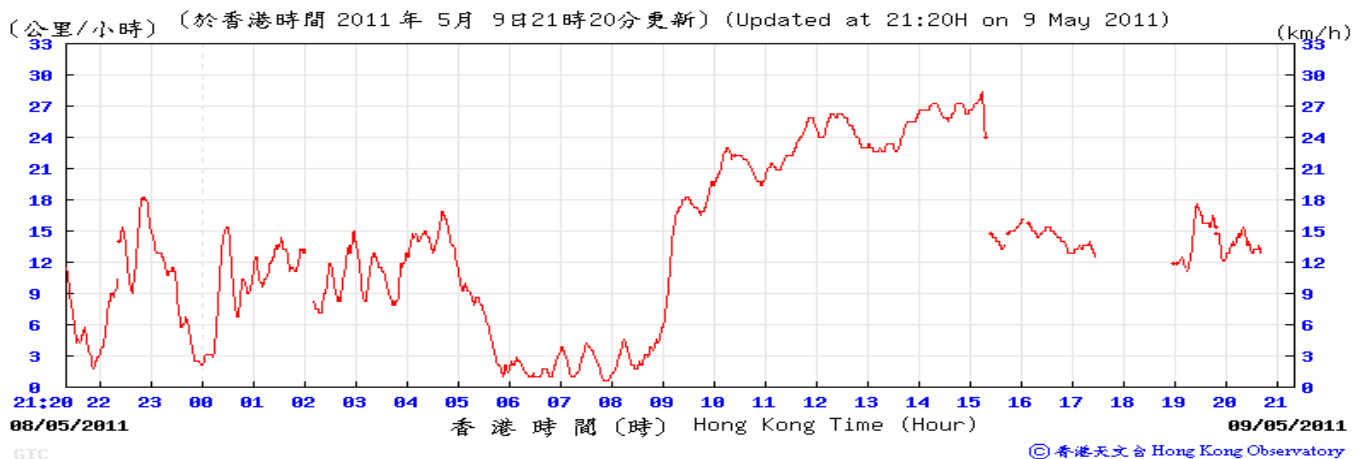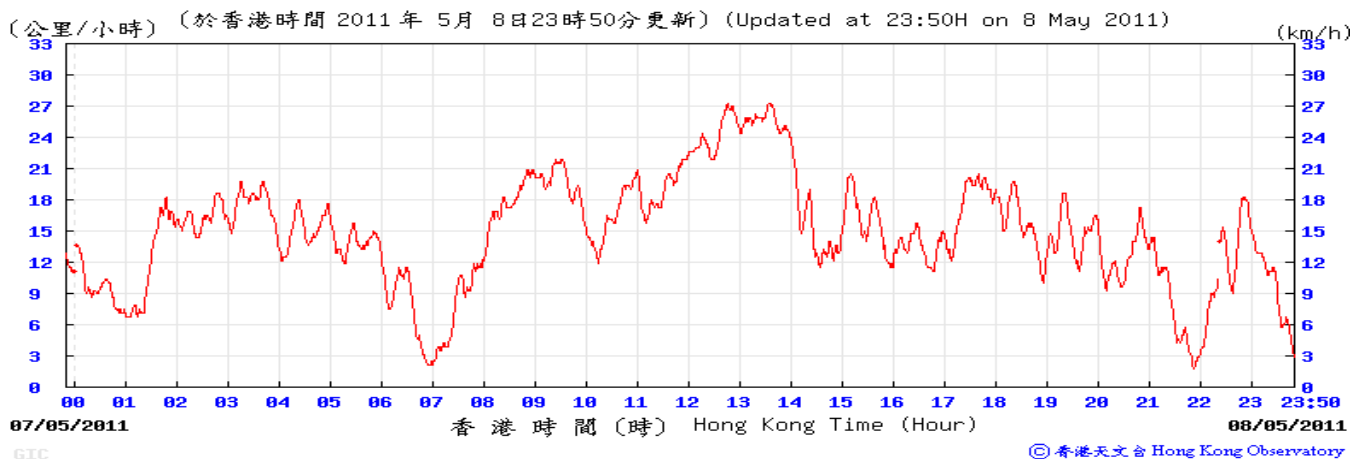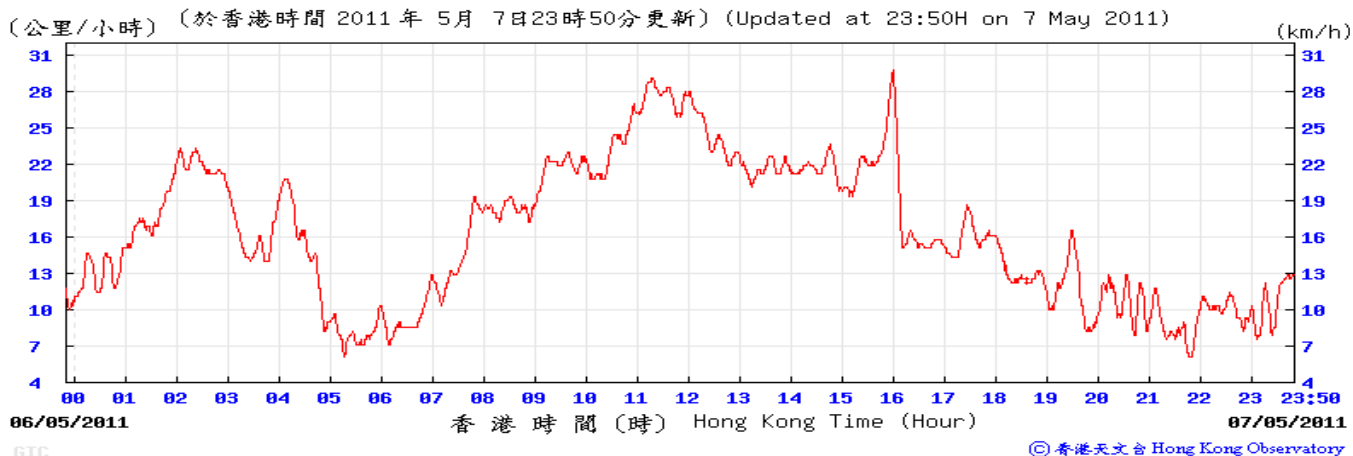


Weather Conditions at Green Island Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 10 日 23 時 50 分更新) (Updated at 23:50H on 10 May 2011) (km/h)

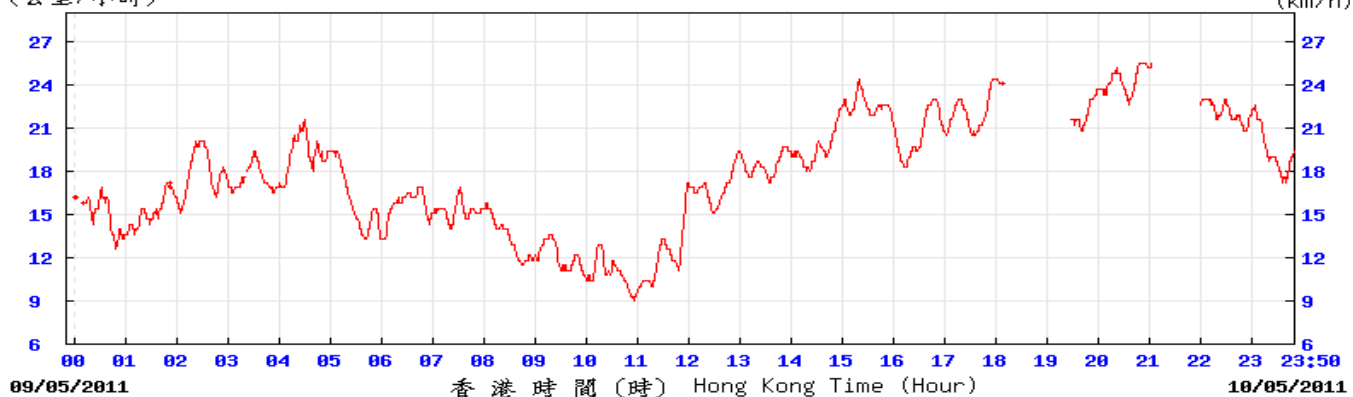


GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 11 日 23 時 50 分更新) (Updated at 23:50H on 11 May 2011) (km/h)

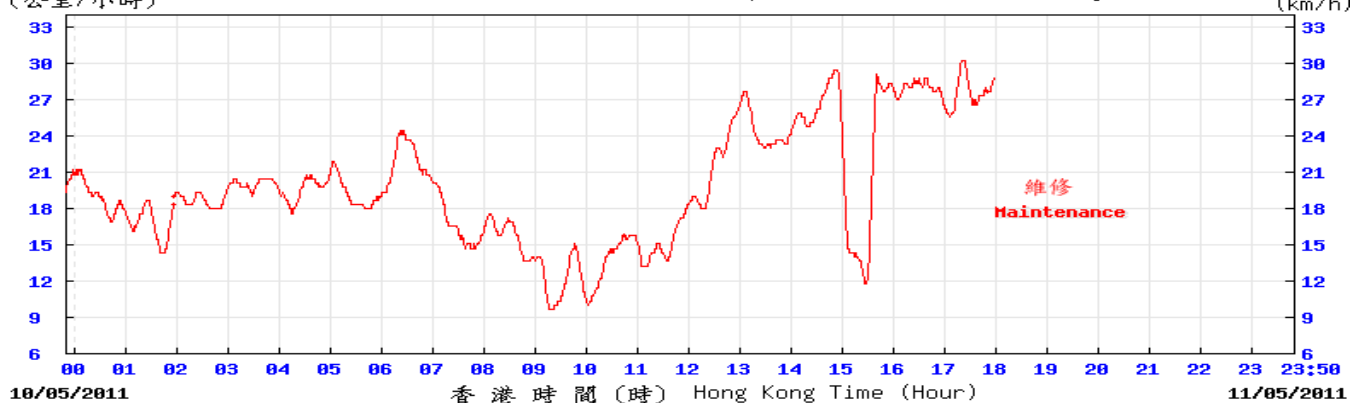

GIC © 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 12 日 23 時 50 分更新) (Updated at 23:50H on 12 May 2011) (km/h)

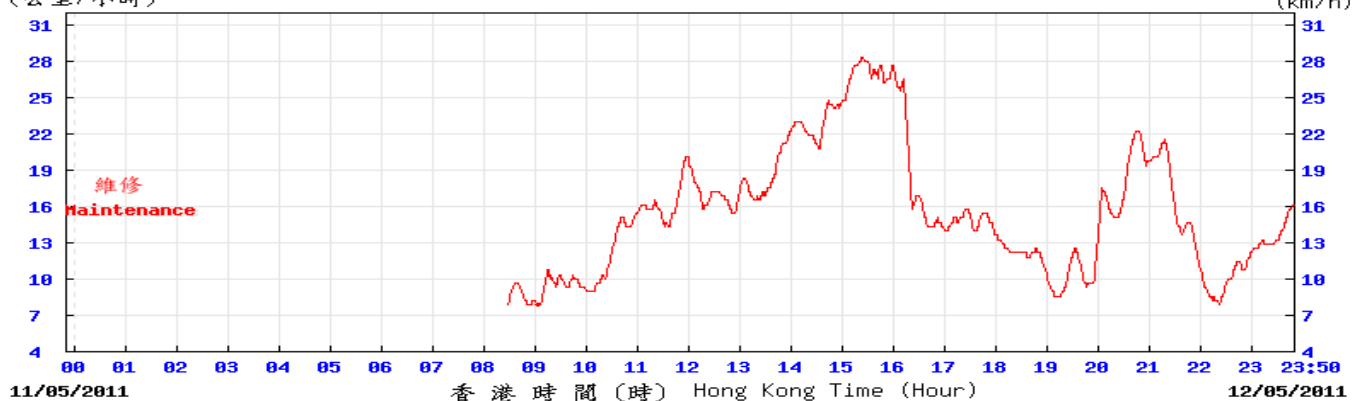

GIC © 香港天文台 Hong Kong Observatory


Weather Conditions at Green Island Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 13 日 23 時 50 分更新) (Updated at 23:50H on 13 May 2011) (km/h)

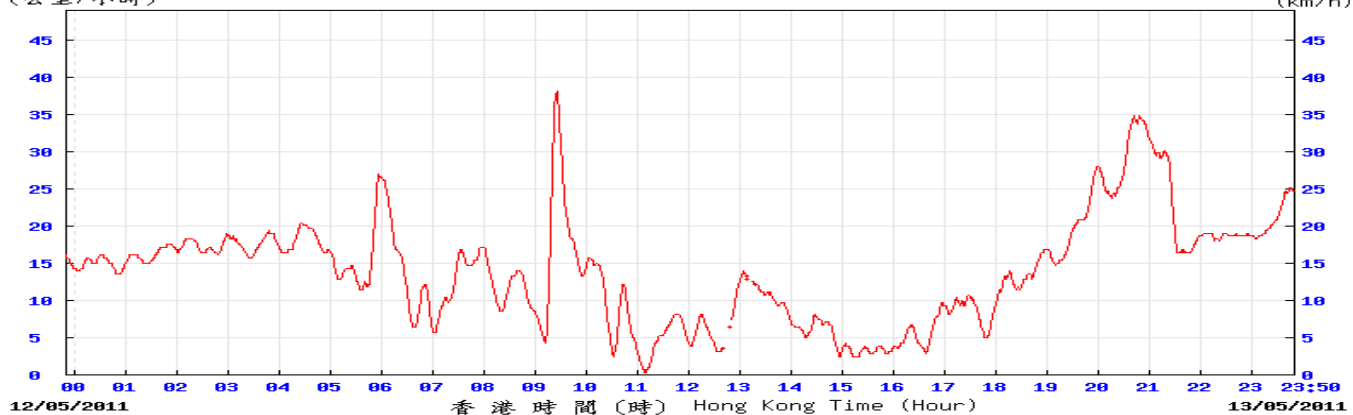


© 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 14 日 23 時 50 分更新) (Updated at 23:50H on 14 May 2011) (km/h)

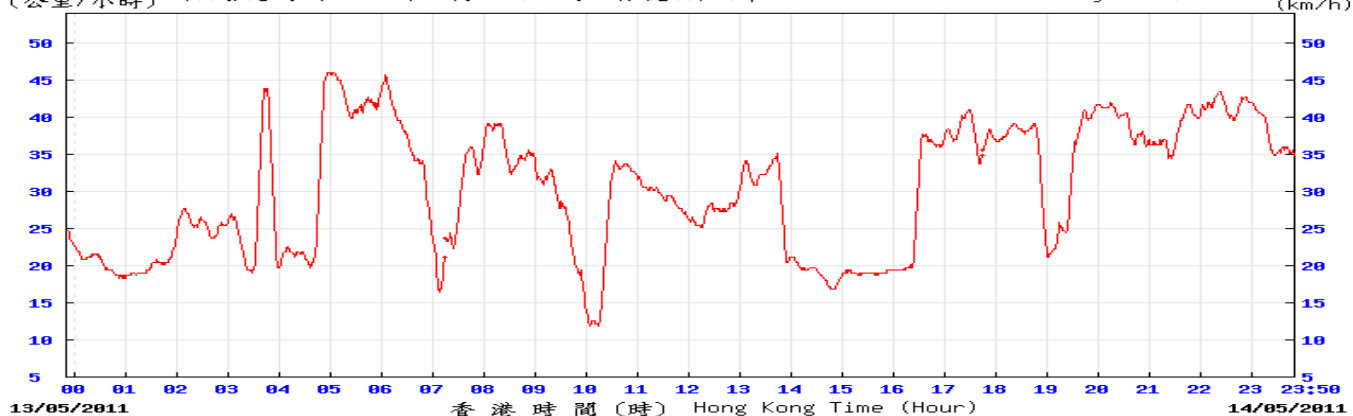

© 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 15 日 23 時 50 分更新) (Updated at 23:50H on 15 May 2011) (km/h)

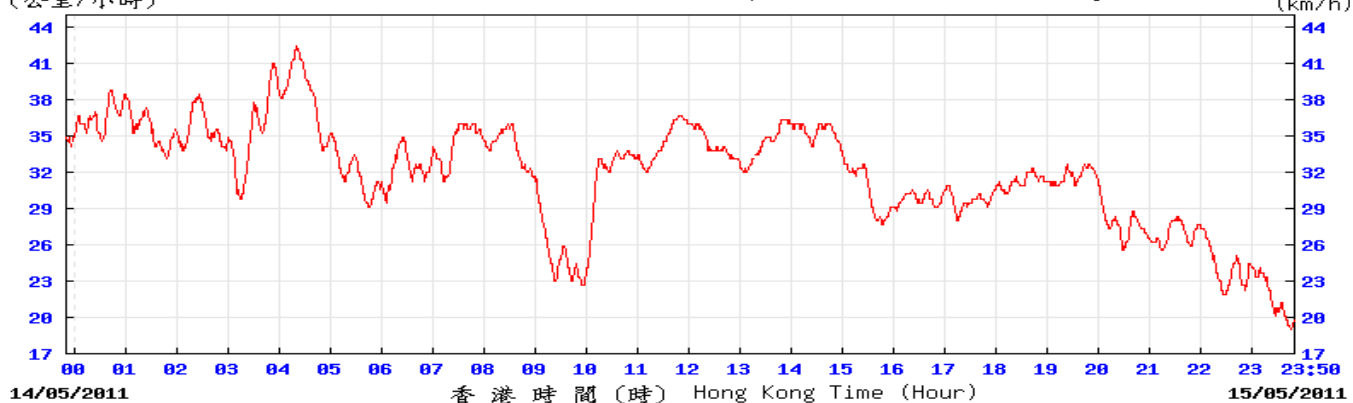

© 香港天文台 Hong Kong Observatory


Weather Conditions at Green Island Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 16 日 23 時 50 分更新) (Updated at 23:50H on 16 May 2011) (km/h)

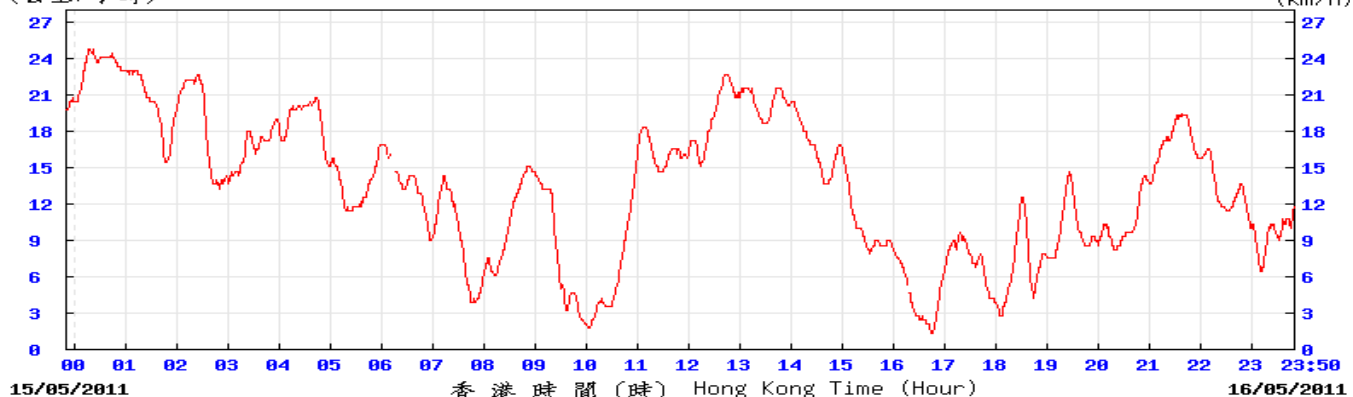


GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 17 日 23 時 50 分更新) (Updated at 23:50H on 17 May 2011) (km/h)

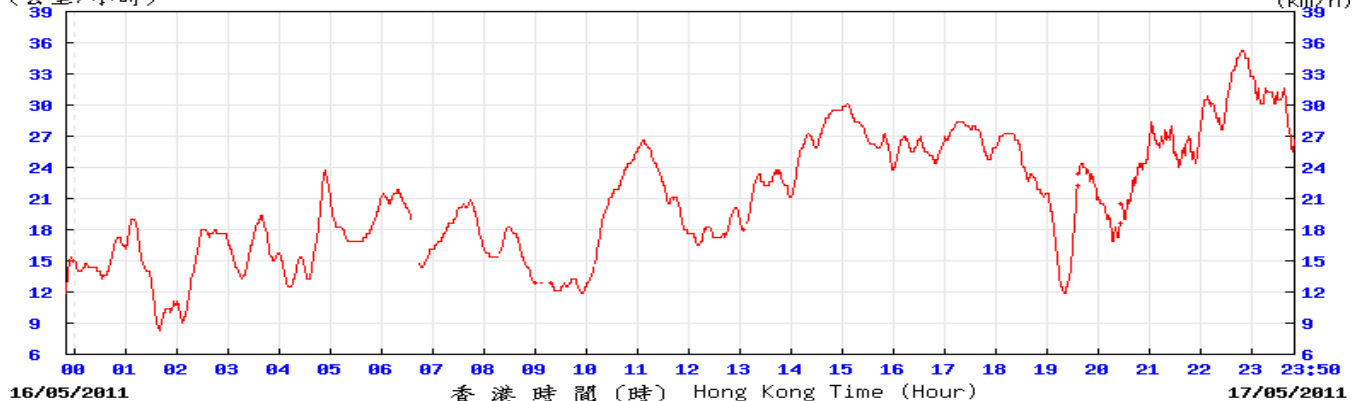

GIC © 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 18 日 23 時 50 分更新) (Updated at 23:50H on 18 May 2011) (km/h)

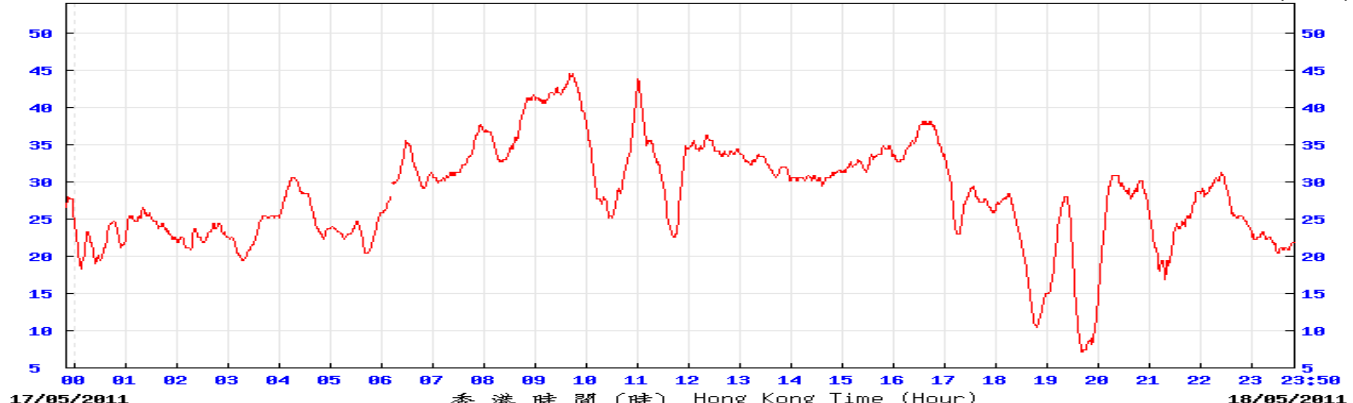

GIC © 香港天文台 Hong Kong Observatory


Weather Conditions at Green Island Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 19 日 23 時 50 分更新) (Updated at 23:50H on 19 May 2011) (km/h)

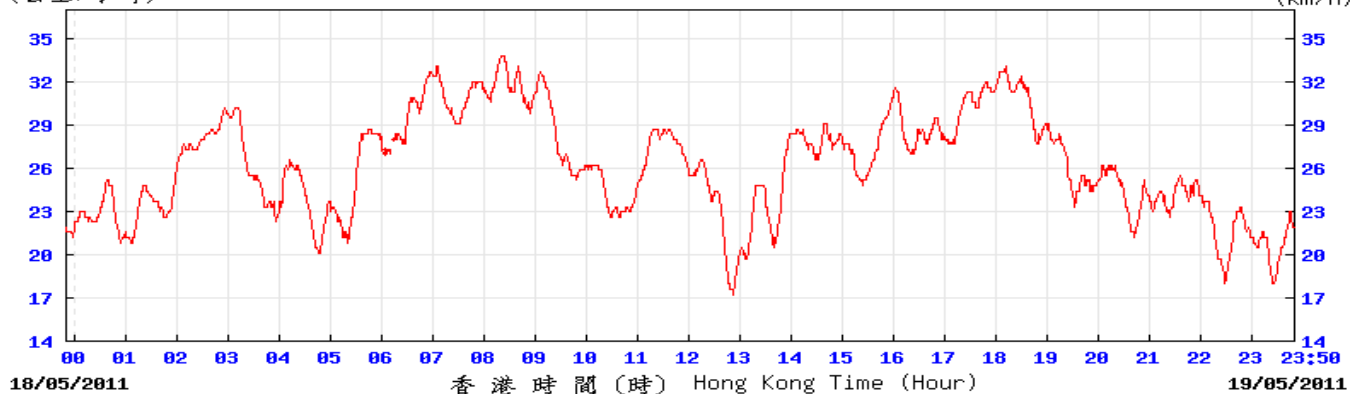


GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 20 日 23 時 50 分更新) (Updated at 23:50H on 20 May 2011) (km/h)

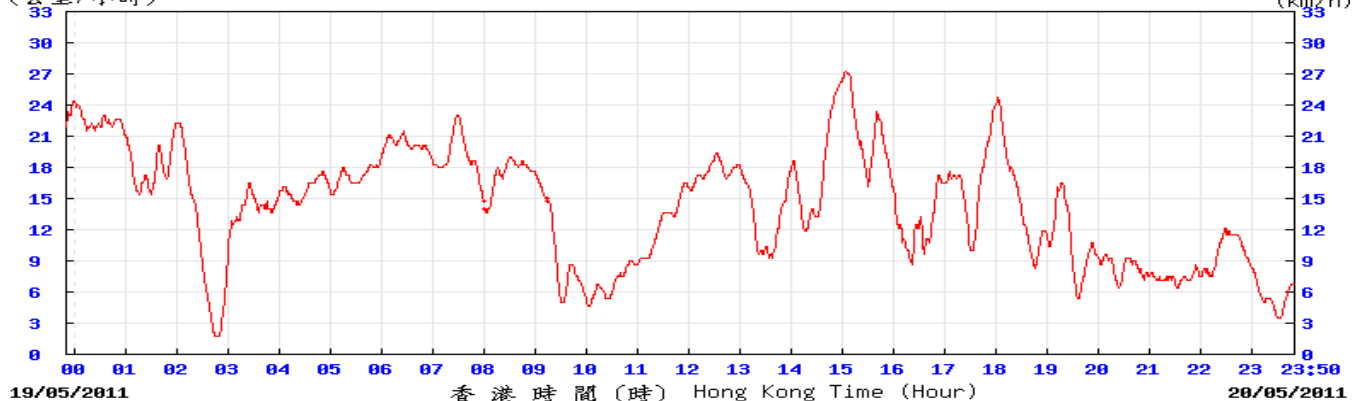

GIC © 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 21 日 23 時 50 分更新) (Updated at 23:50H on 21 May 2011) (km/h)

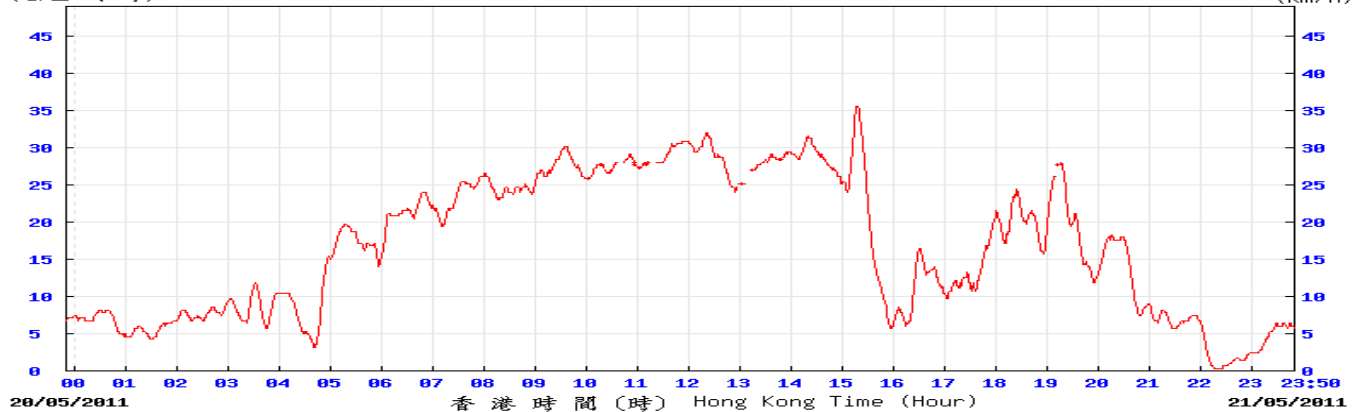


GIC © 香港天文台 Hong Kong Observatory

Weather Conditions at Green Island Weather Station during Monitoring Period


(公里/小時) (於香港時間 2011 年 5月22日23時50分更新) (Updated at 23:50H on 22 May 2011) (km/h)

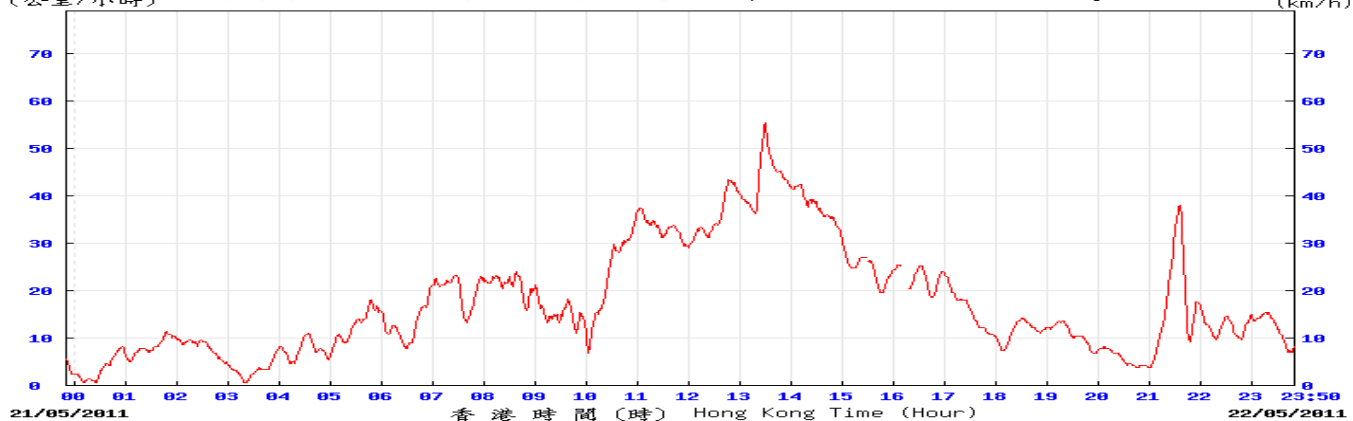

(公里/小時) (於香港時間 2011 年 5月23日23時50分更新) (Updated at 23:50H on 23 May 2011) (km/h)

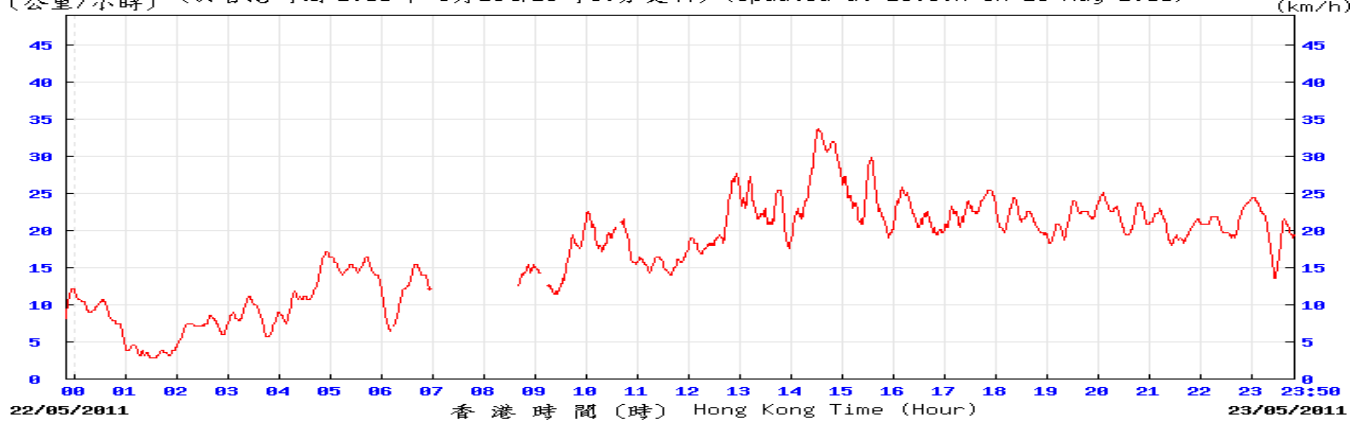


(公里/小時) (於香港時間 2011 年 5月24日23時50分更新) (Updated at 23:50H on 24 May 2011) (km/h)

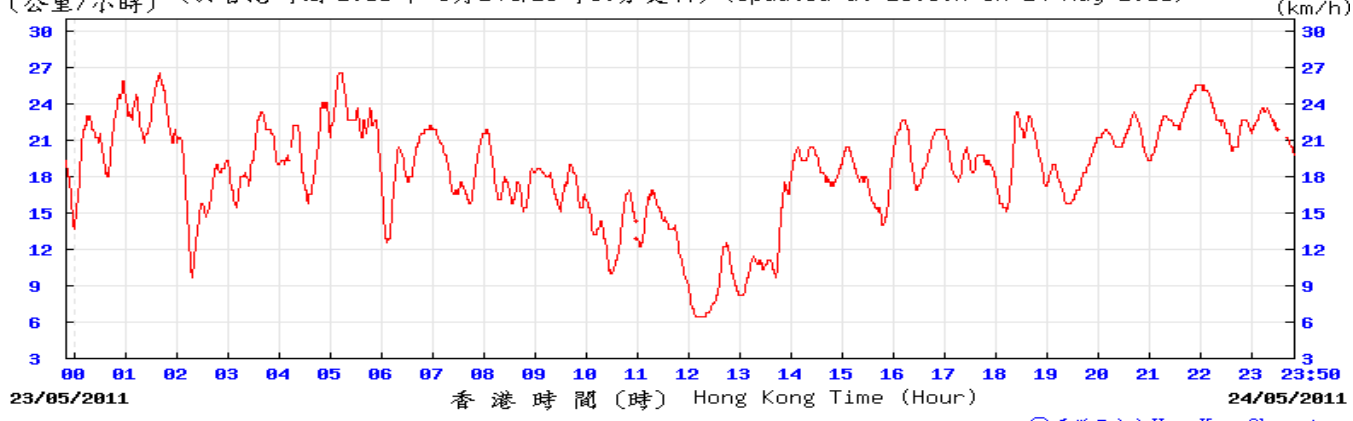


Weather Conditions at Green Island Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5月25日23時50分更新) (Updated at 23:50H on 25 May 2011) (km/h)

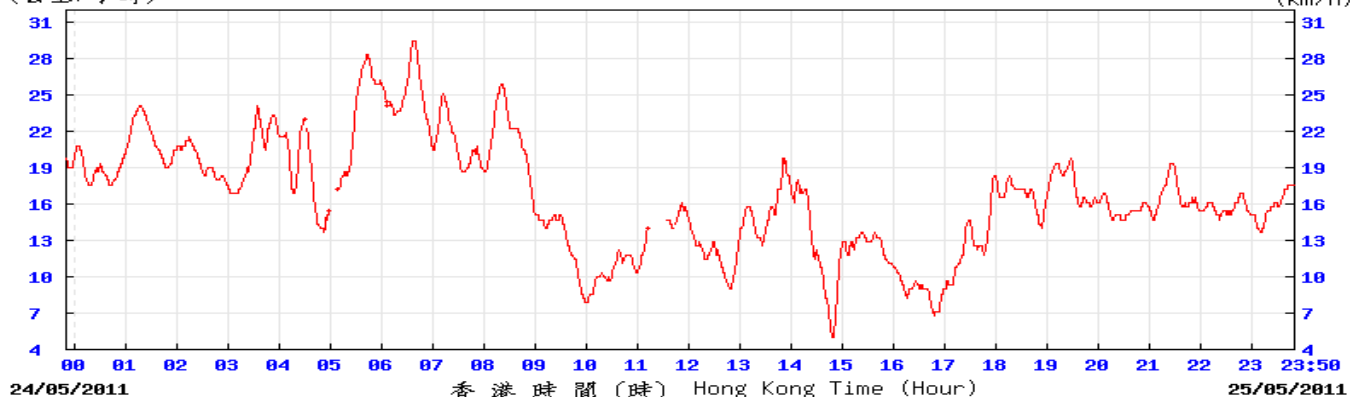


GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5月26日23時50分更新) (Updated at 23:50H on 26 May 2011) (km/h)

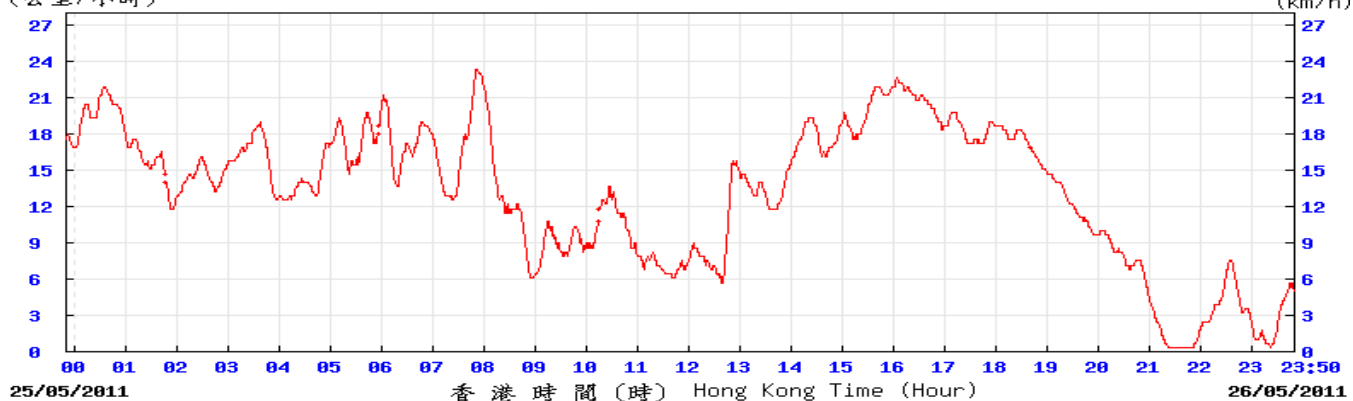

GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5月27日23時50分更新) (Updated at 23:50H on 27 May 2011) (km/h)

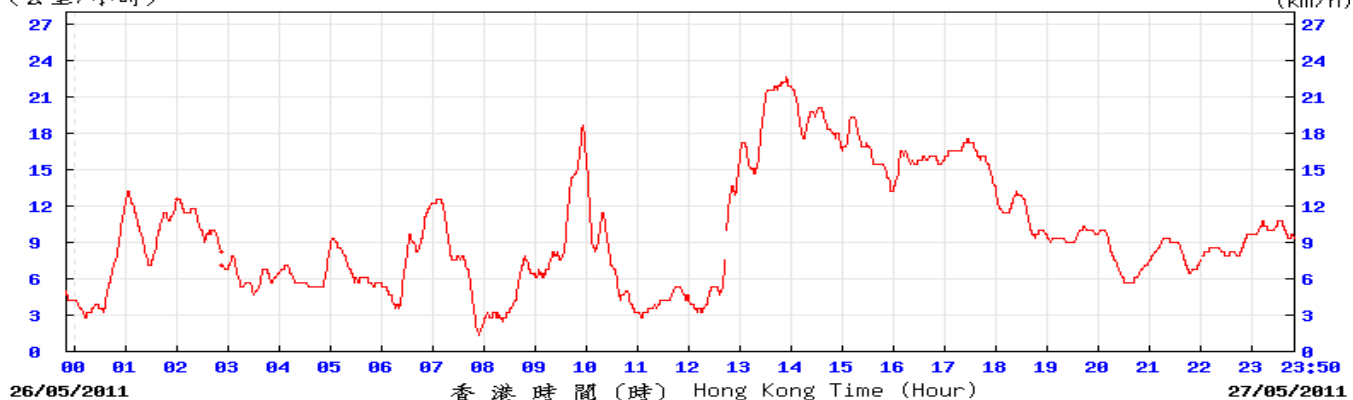

GIC © 香港天文台 Hong Kong Observatory


Weather Conditions at Green Island Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 28 日 23 時 50 分更新) (Updated at 23:50H on 28 May 2011) (km/h)




GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 29 日 23 時 50 分更新) (Updated at 23:50H on 29 May 2011) (km/h)

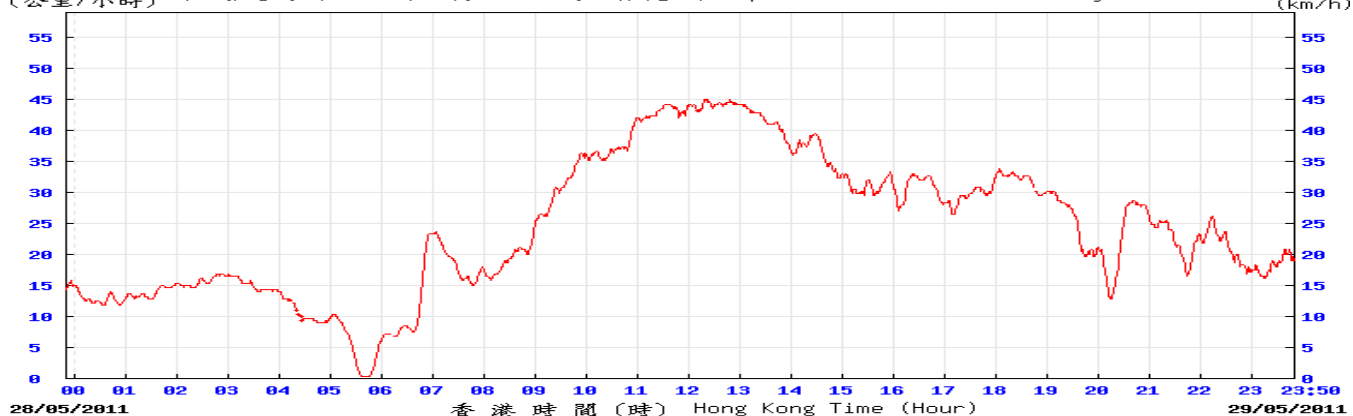


GIC © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 30 日 23 時 50 分更新) (Updated at 23:50H on 30 May 2011) (km/h)

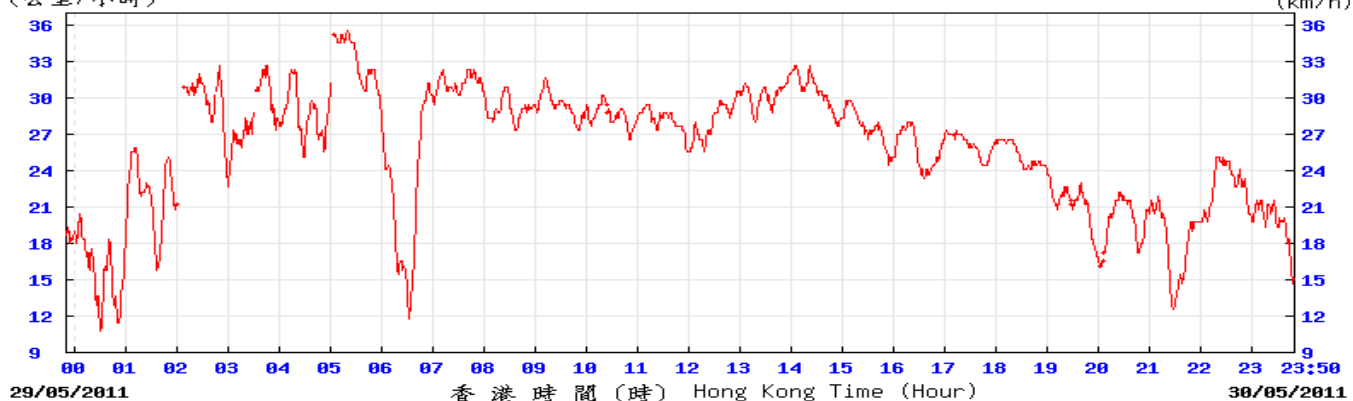


GIC © 香港天文台 Hong Kong Observatory


Weather Conditions at Green Island Weather Station during Monitoring Period

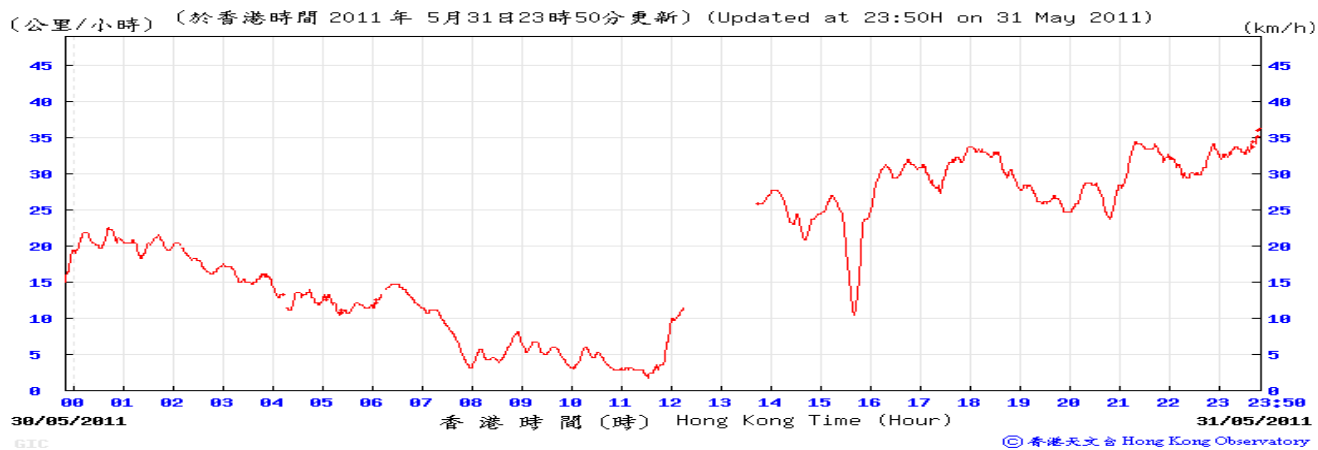


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

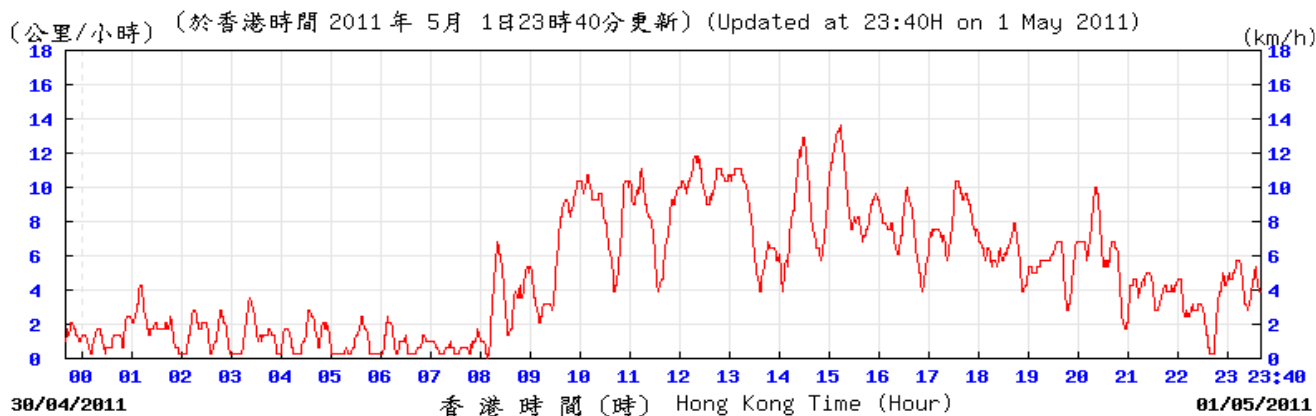

HKS © 香港天文台 Hong Kong Observatory

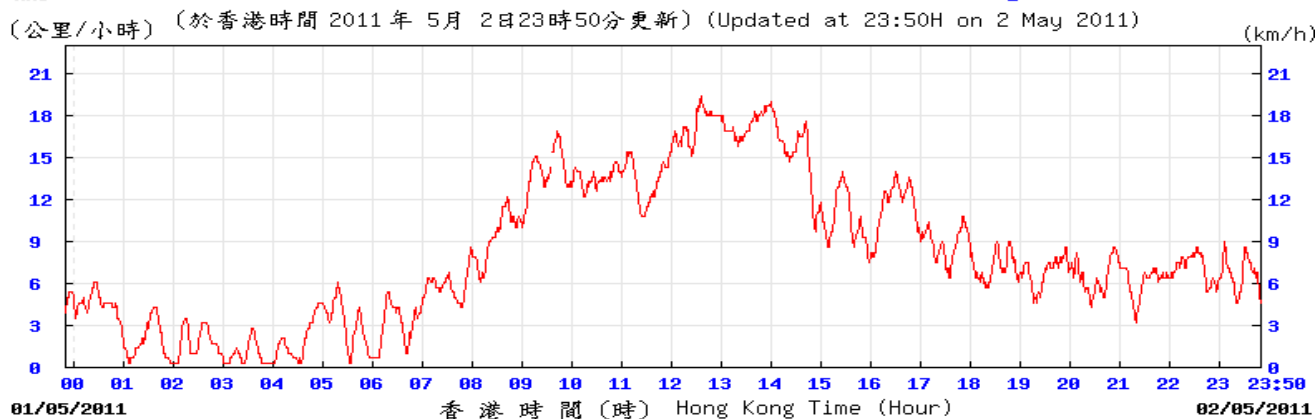


HKS © 香港天文台 Hong Kong Observatory

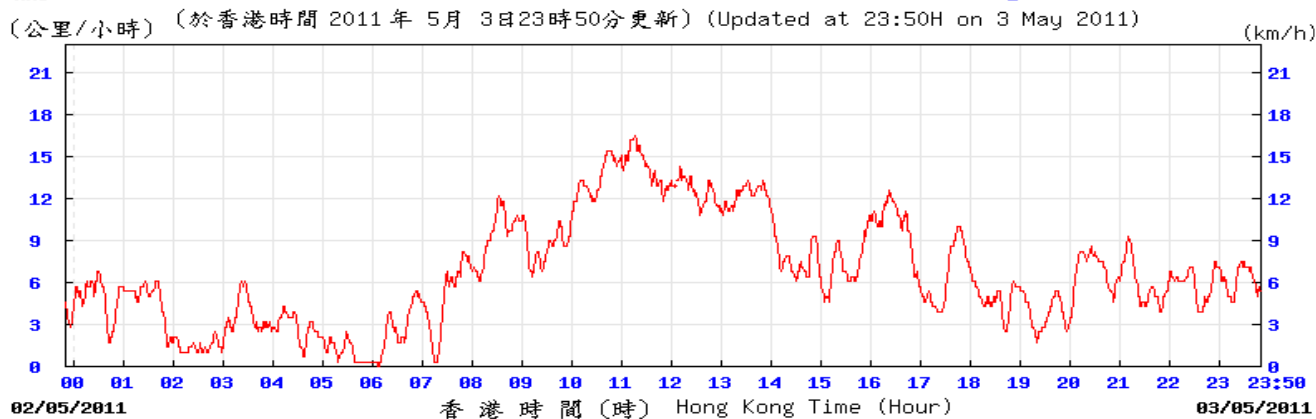

HKS © 香港天文台 Hong Kong Observatory


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 4 日 23 時 50 分更新) (Updated at 23:50H on 4 May 2011) (km/h)

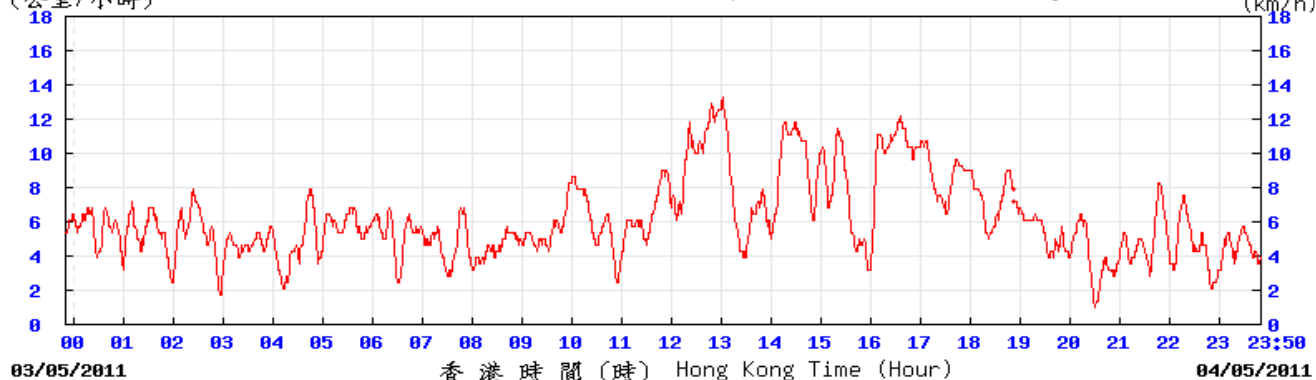


HKS © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 5 日 23 時 50 分更新) (Updated at 23:50H on 5 May 2011) (km/h)

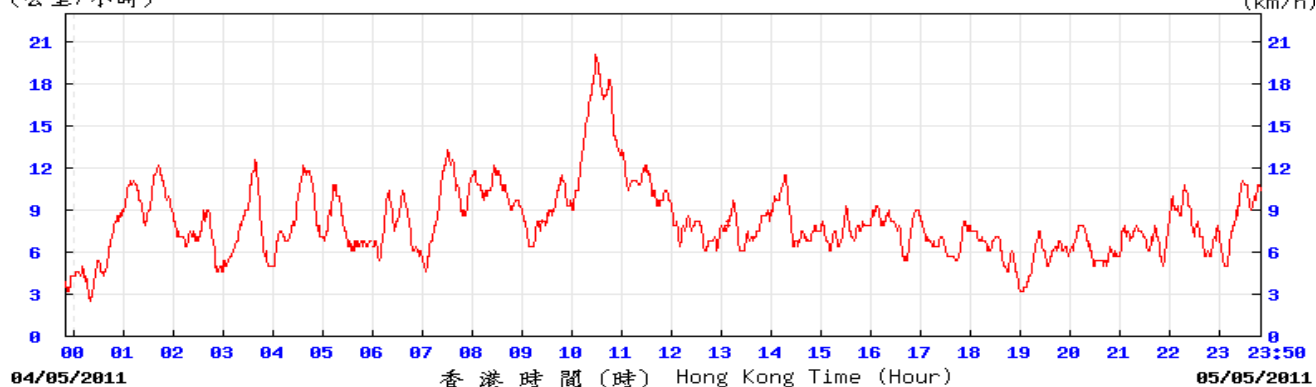

HKS © 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 6 日 23 時 50 分更新) (Updated at 23:50H on 6 May 2011) (km/h)

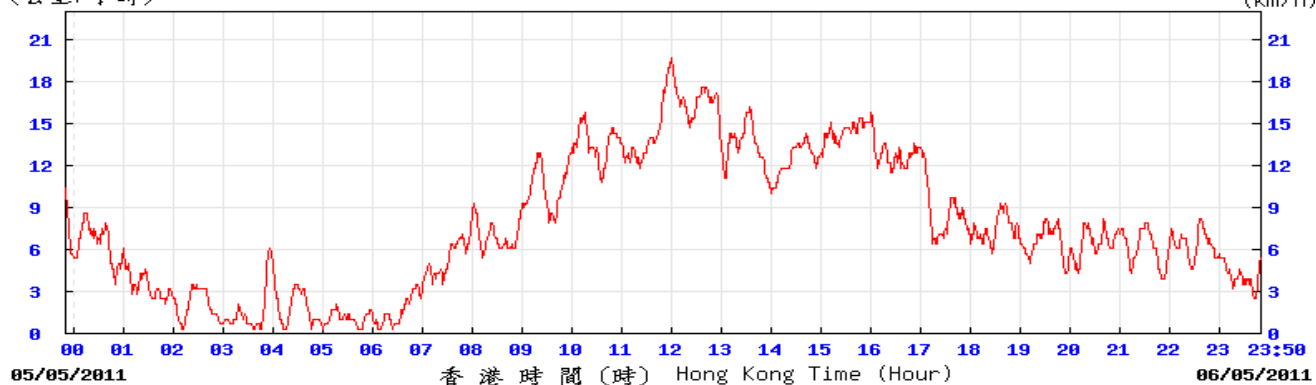


HKS © 香港天文台 Hong Kong Observatory

Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period


(公里/小時) (於香港時間 2011 年 5 月 7 日 23 時 50 分更新) (Updated at 23:50H on 7 May 2011) (km/h)

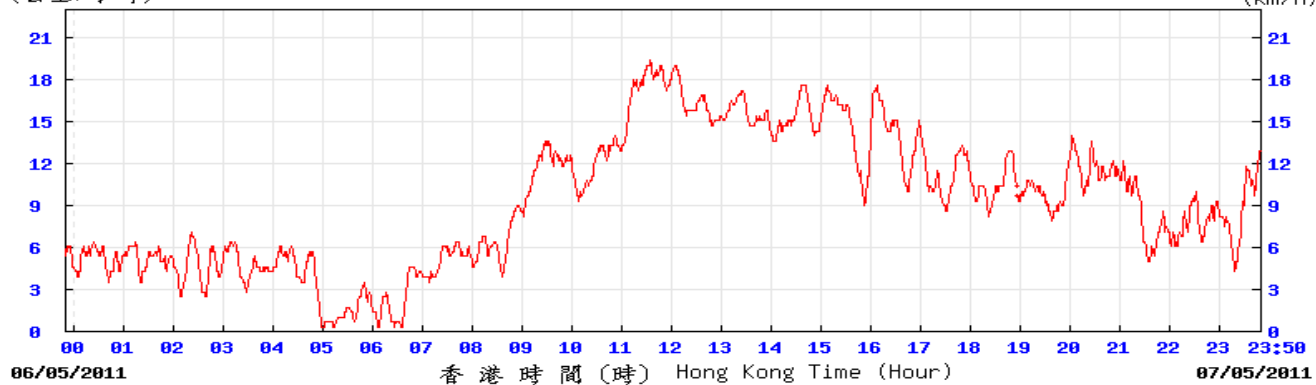

(公里/小時) (於香港時間 2011 年 5 月 8 日 23 時 50 分更新) (Updated at 23:50H on 8 May 2011) (km/h)

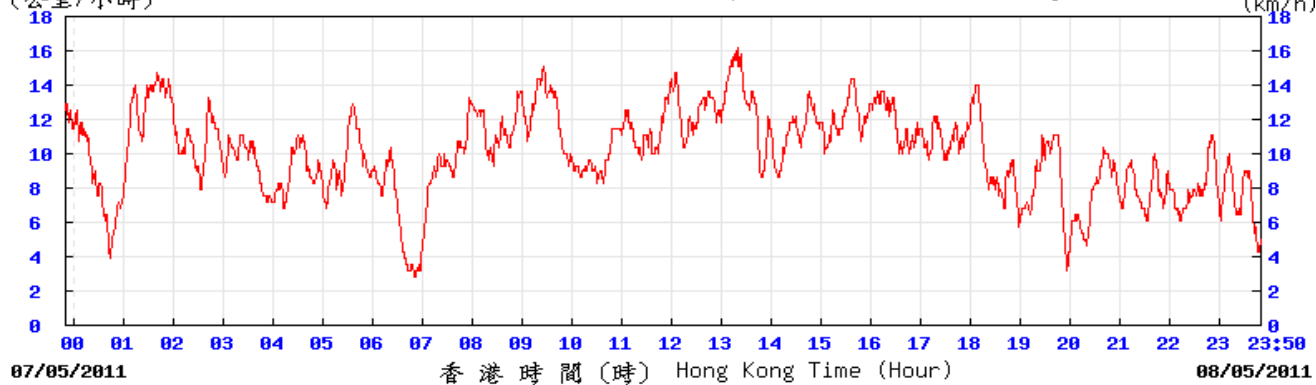


(公里/小時) (於香港時間 2011 年 5 月 9 日 21 時 20 分更新) (Updated at 21:20H on 9 May 2011) (km/h)

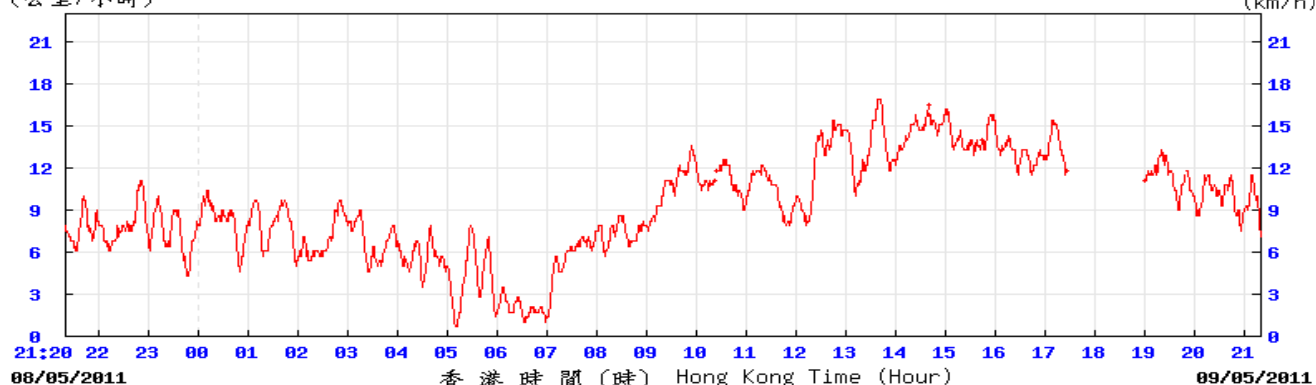


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 10 日 23 時 50 分更新) (Updated at 23:50H on 10 May 2011) (km/h)

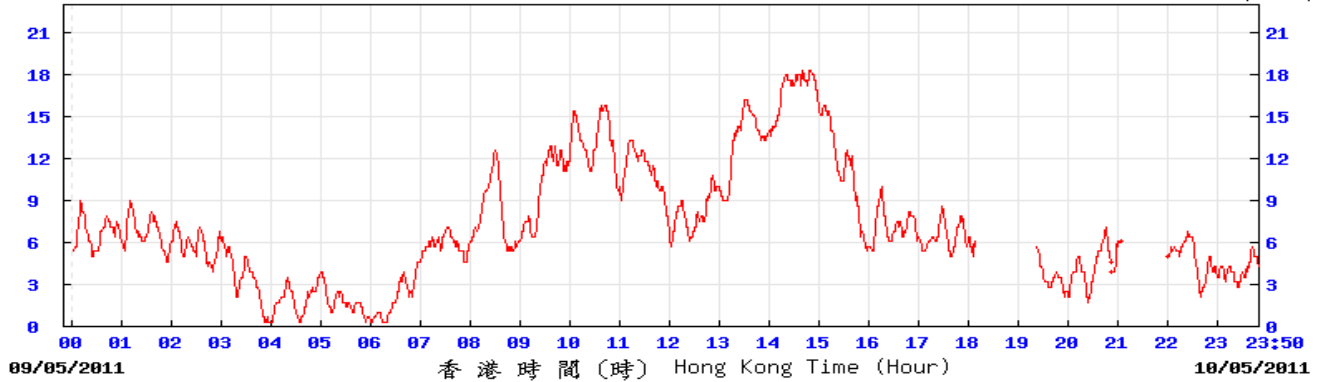


HKS © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 11 日 23 時 50 分更新) (Updated at 23:50H on 11 May 2011) (km/h)

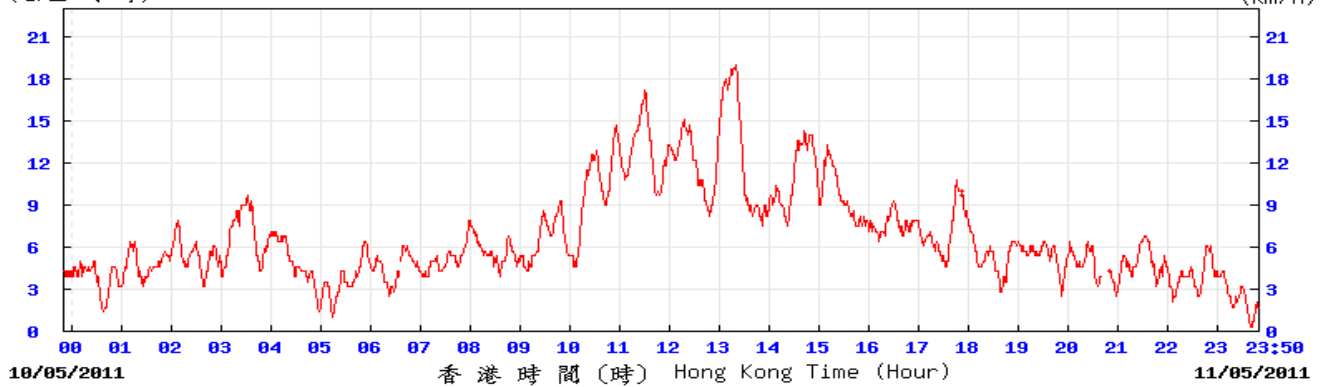

HKS © 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 12 日 23 時 50 分更新) (Updated at 23:50H on 12 May 2011) (km/h)

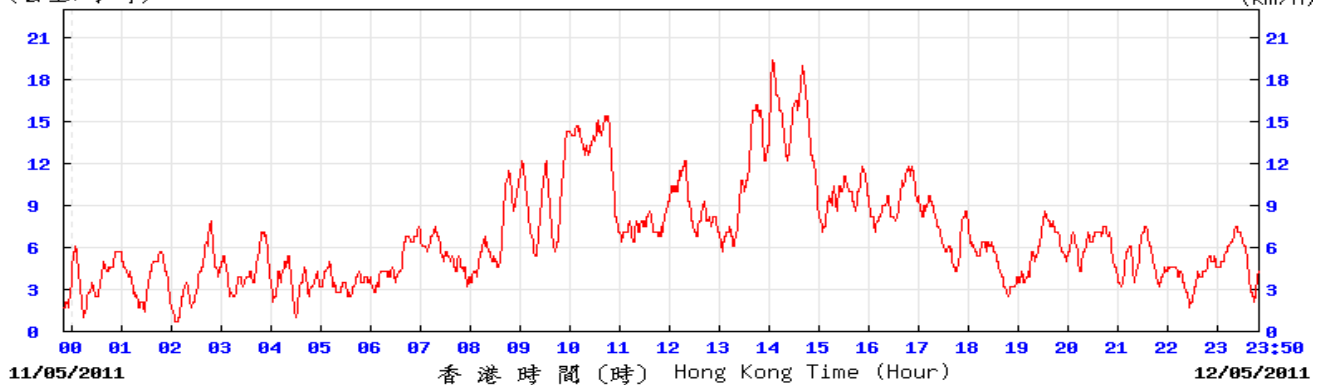

HKS © 香港天文台 Hong Kong Observatory


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 13 日 23 時 50 分更新) (Updated at 23:50H on 13 May 2011) (km/h)

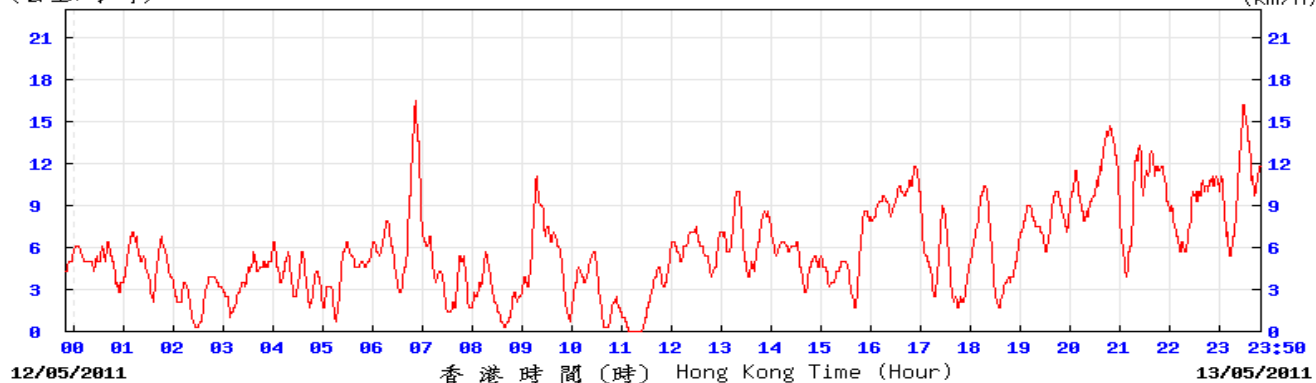


HKS © 香港天文台 Hong Kong Observatory

(公里/小時) (於香港時間 2011 年 5 月 14 日 23 時 50 分更新) (Updated at 23:50H on 14 May 2011) (km/h)

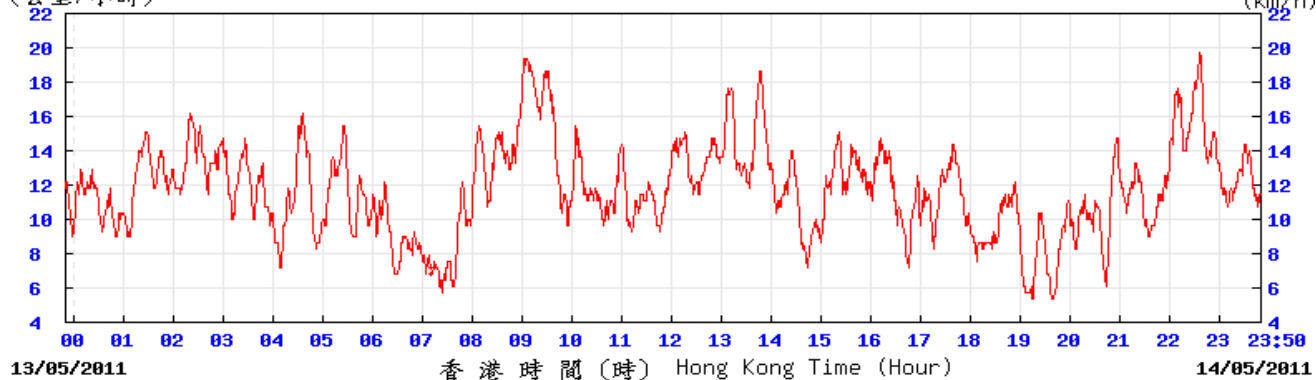

HKS © 香港天文台 Hong Kong Observatory


(公里/小時) (於香港時間 2011 年 5 月 15 日 23 時 50 分更新) (Updated at 23:50H on 15 May 2011) (km/h)

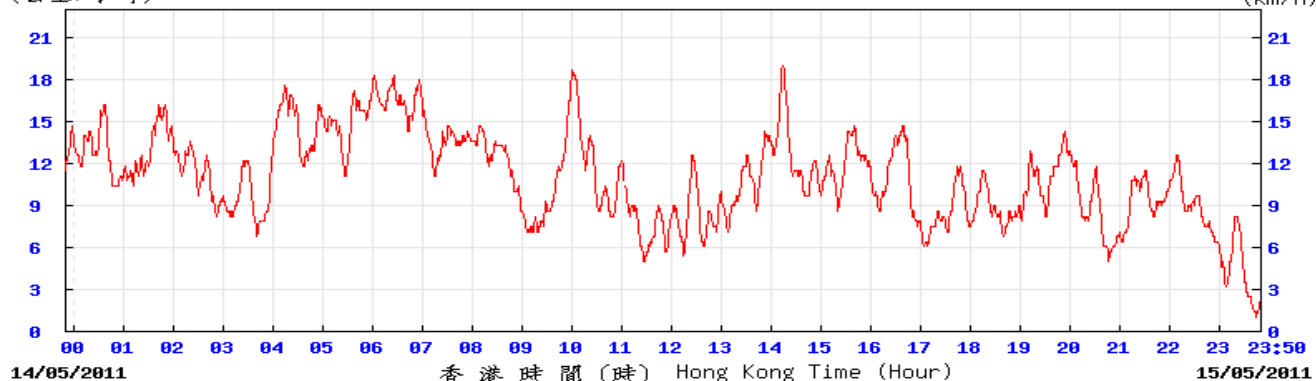


HKS © 香港天文台 Hong Kong Observatory

Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period


(公里/小時) (於香港時間 2011 年 5 月 16 日 23 時 50 分更新) (Updated at 23:50H on 16 May 2011) (km/h)

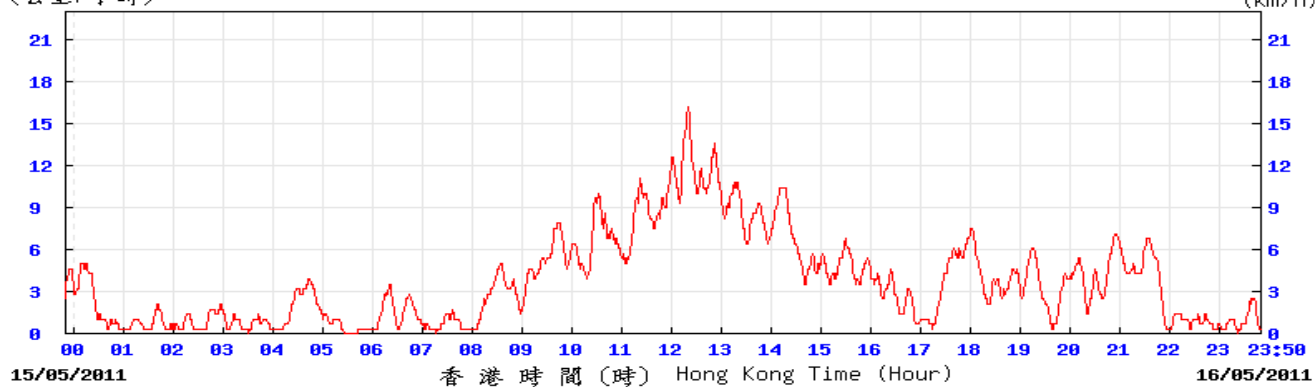

(公里/小時) (於香港時間 2011 年 5 月 17 日 23 時 50 分更新) (Updated at 23:50H on 17 May 2011) (km/h)

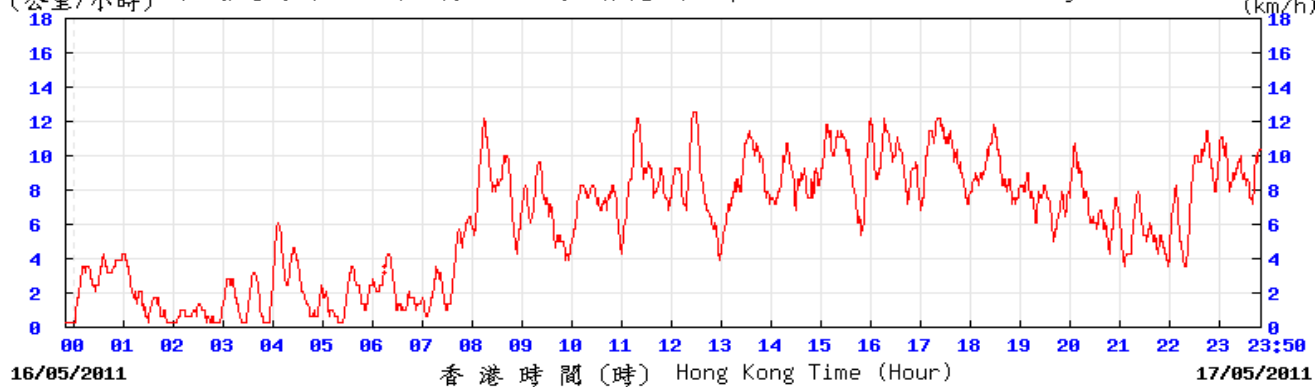


(公里/小時) (於香港時間 2011 年 5 月 18 日 23 時 50 分更新) (Updated at 23:50H on 18 May 2011) (km/h)

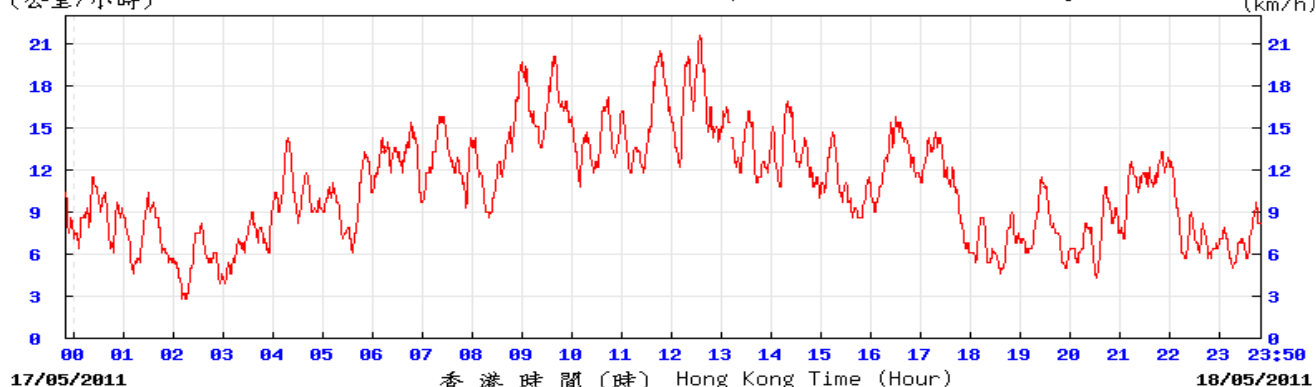


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period


(公里/小時) (於香港時間 2011 年 5 月 19 日 23 時 50 分更新) (Updated at 23:50H on 19 May 2011) (km/h)

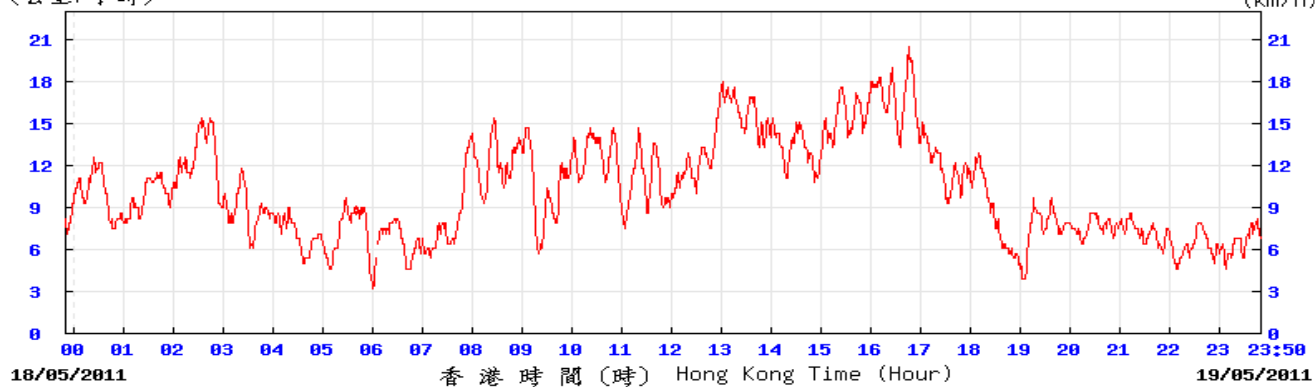




(公里/小時) (於香港時間 2011 年 5 月 20 日 23 時 50 分更新) (Updated at 23:50H on 20 May 2011) (km/h)

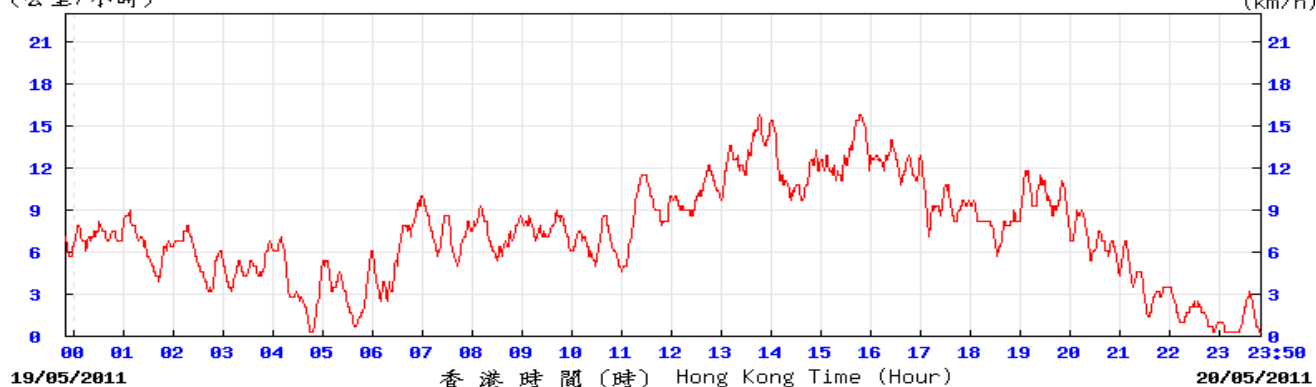


(公里/小時) (於香港時間 2011 年 5 月 21 日 23 時 50 分更新) (Updated at 23:50H on 21 May 2011) (km/h)

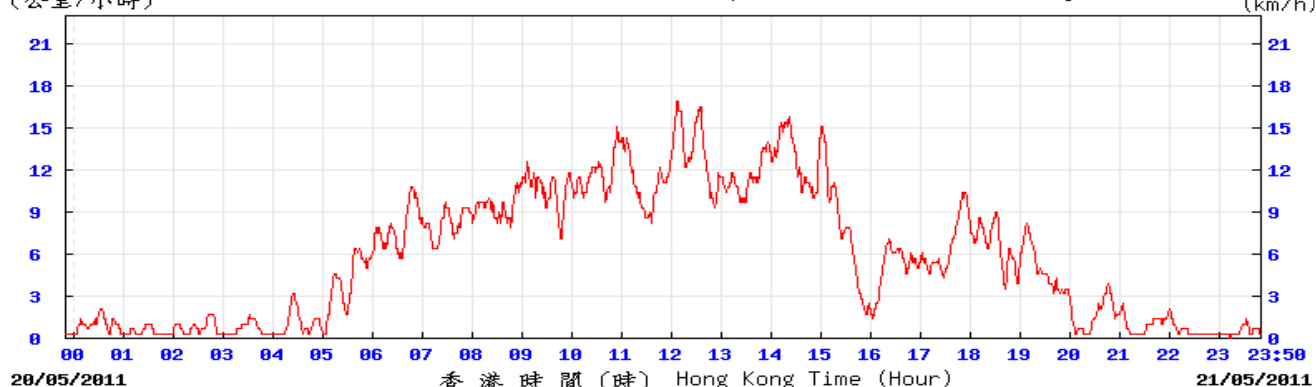


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

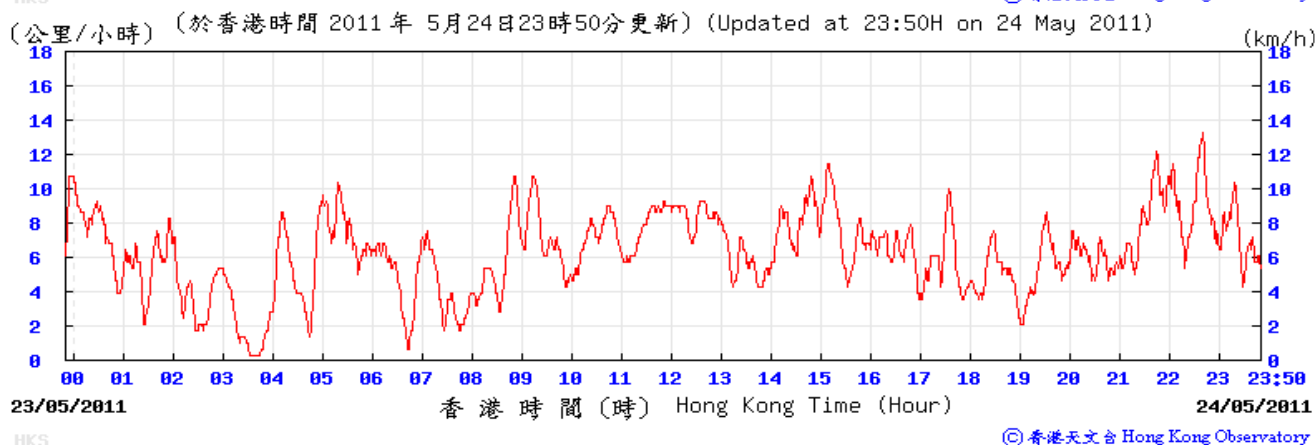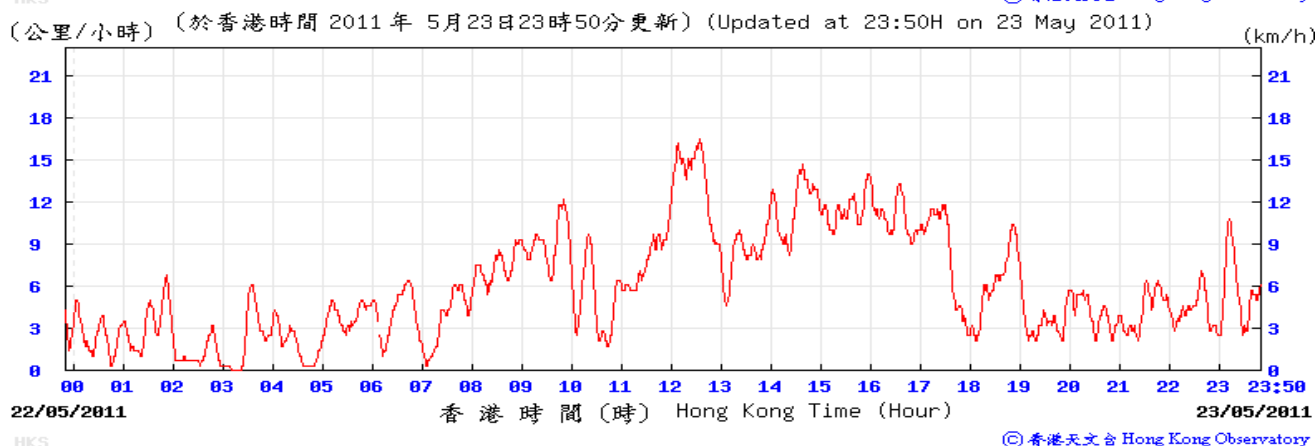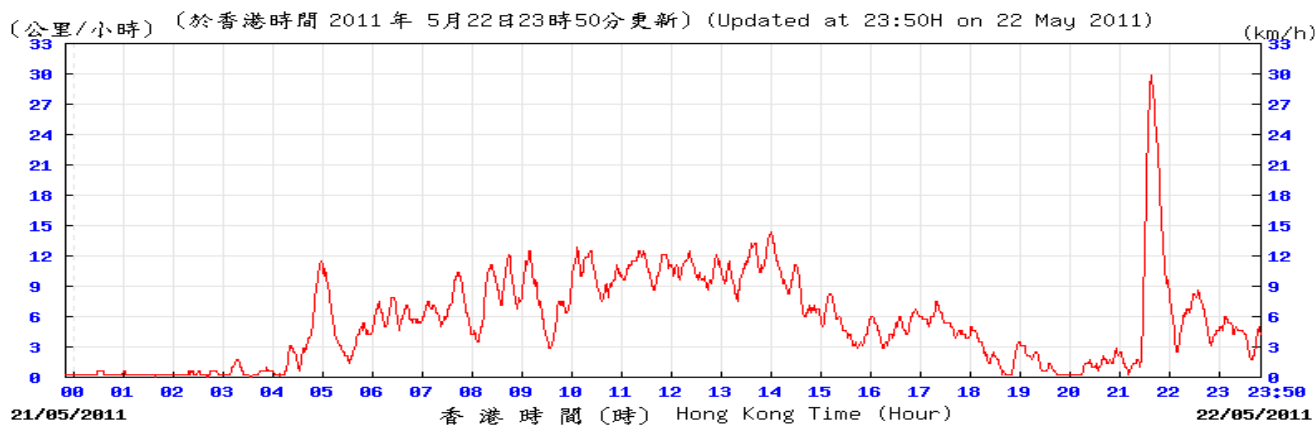


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

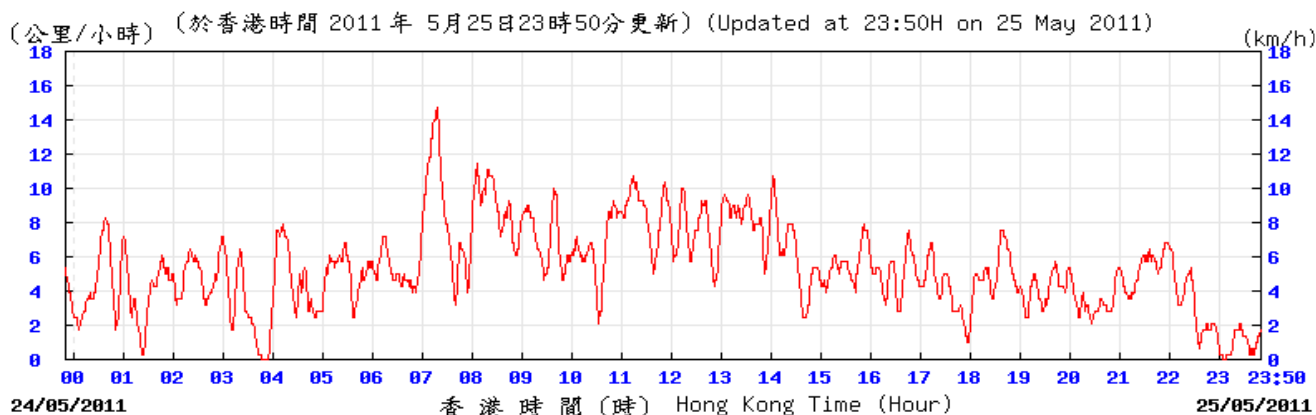

© 香港天文台 Hong Kong Observatory



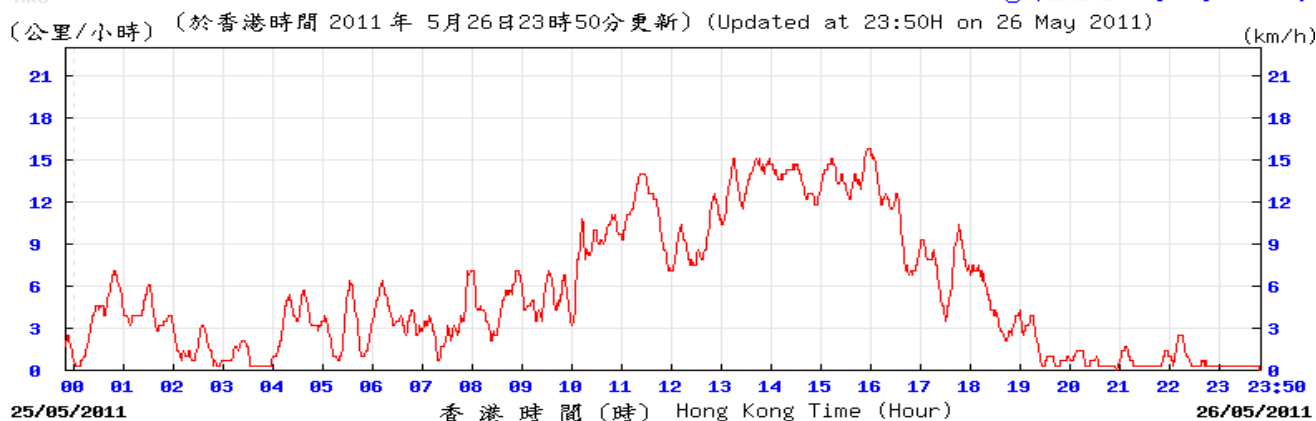


© 香港天文台 Hong Kong Observatory

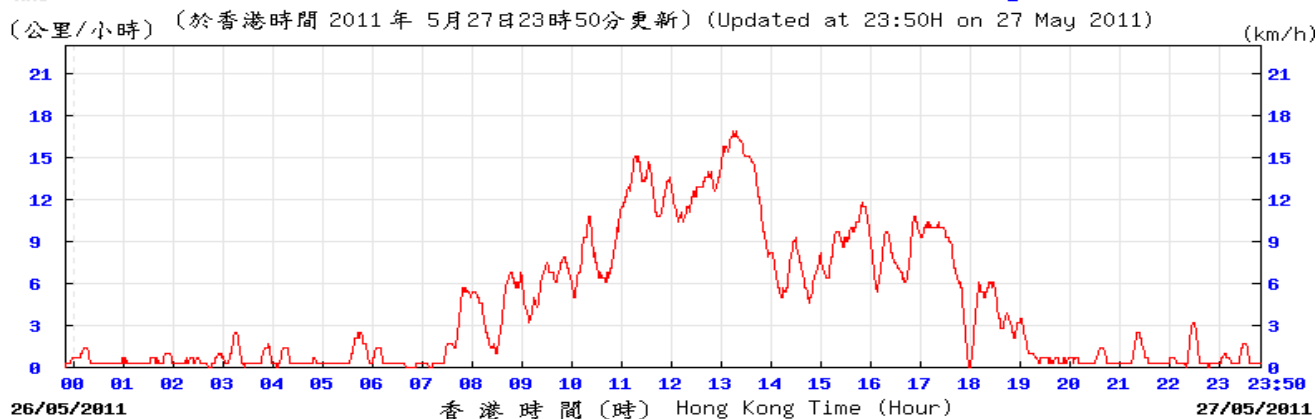

© 香港天文台 Hong Kong Observatory


Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

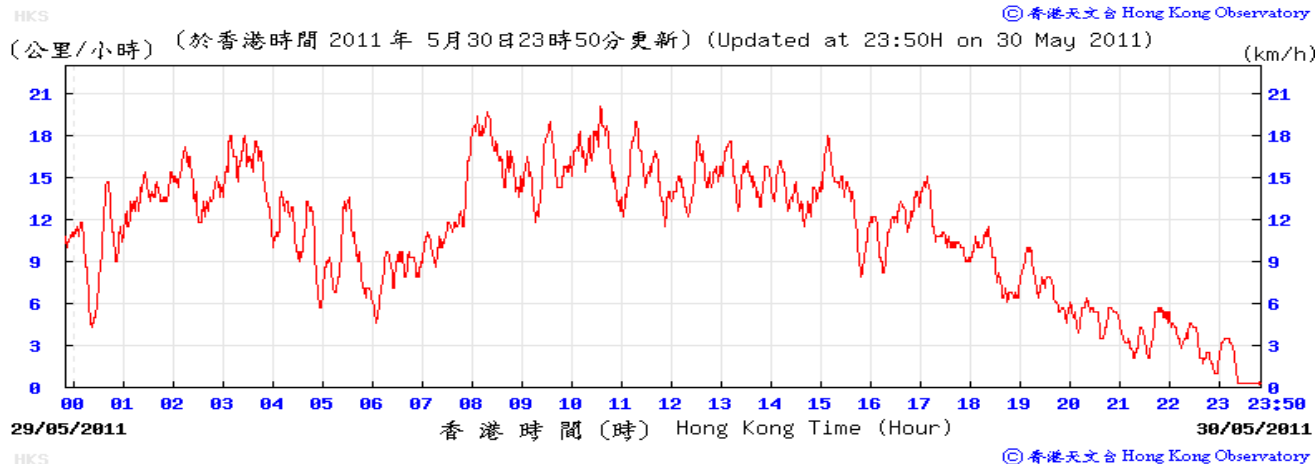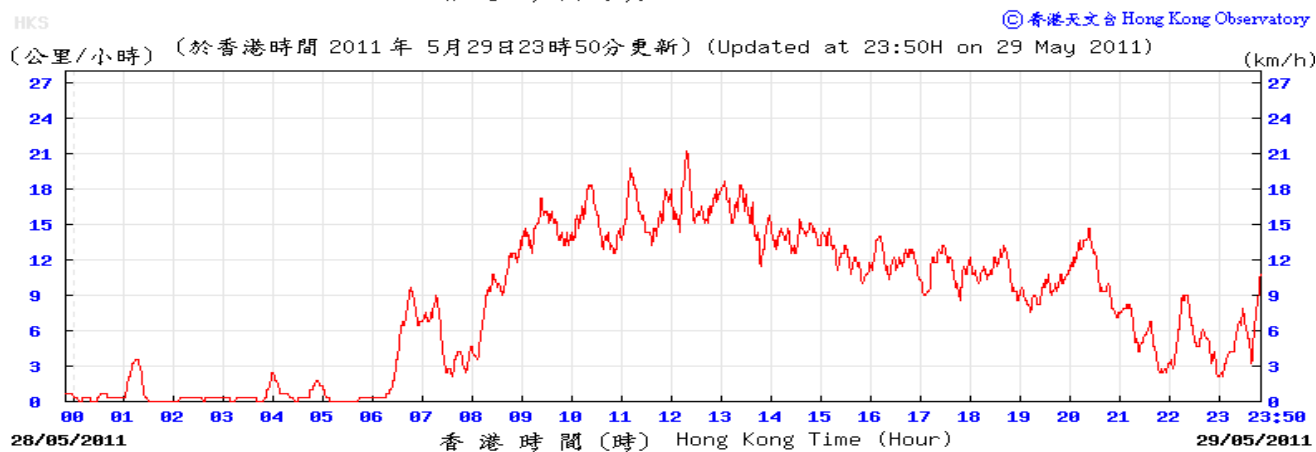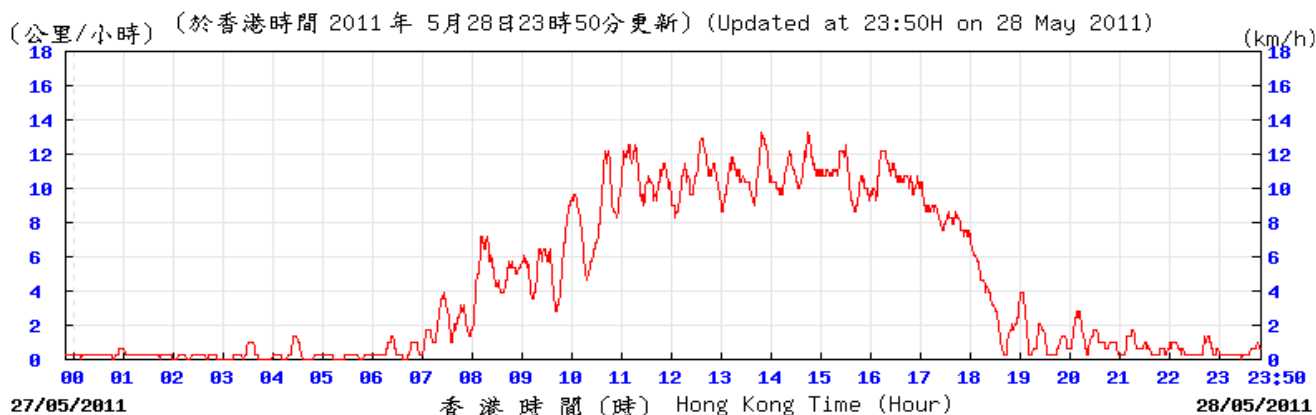

HKS © 香港天文台 Hong Kong Observatory

Weather Conditions at Wong Chuk Hang Weather Station during Monitoring Period

(公里/小時) (於香港時間 2011 年 5 月 31 日 23 時 50 分更新) (Updated at 23:50H on 31 May 2011) (km/h)

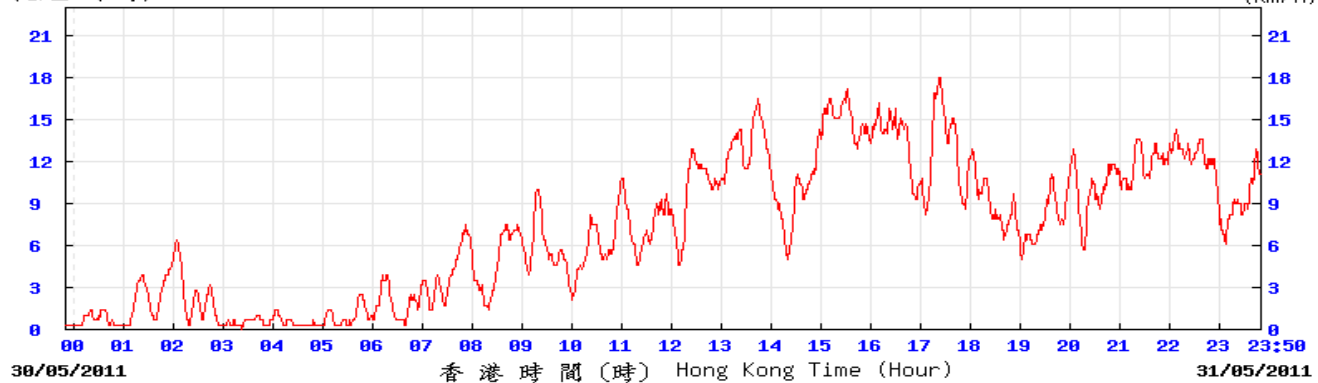

HKS

© 香港天文台 Hong Kong Observatory

APPENDIX F

CALIBRATION CERTIFICATES FOR NOISE AND AIR QUALITY MONITORING EQUIPMENT



輝創工程有限公司

Sun Creation Engineering Limited Calibration and Testing Laboratory

Certificate No. : C105014

Certificate of Calibration

This is to certify that the equipment

Description : Integrating Sound Level Meter

Manufacturer : Bruel & Kjaer

Model No. : 2238

Serial No. : 2684502

*has been calibrated for the specific items and ranges.
The results are shown in the Calibration Report No. C105014.*

The equipment is supplied by

Co. Name : Atkins China Limited

Address : 5/F., Wharf T&T Centre, Harbour City, Tsim Sha Tsui, Kowloon

Date of Issue : 8 September 2010

Certified by :

K C Lee

The test equipment used for calibration are traceable to the National Standards as specified in this report.
This report shall not be reproduced except in full and with prior written approval from this laboratory.

Calibration and Testing Laboratory of Sun Creation Engineering Limited

c/o 4/F, Tsing Shan Wan Exchange Building, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

Tel: 2927 2606

Fax: 2744 8986

E-mail: callab@suncreation.com

Website: www.suncreation.com



輝創工程有限公司

Sun Creation Engineering Limited Calibration and Testing Laboratory

Certificate No. : C106345

Certificate of Calibration

This is to certify that the equipment

RECEIVED
16 DEC 2010

BY: 

Description : Acoustical Calibrator

Manufacturer : Bruel & Kjaer

Model No. : 4231

Serial No. : 2656516

has been calibrated for the specific items and ranges.

The results are shown in the Calibration Report No. C106345.

The equipment is supplied by

Co. Name : Leighton-LNS Joint Venture

Address : 39/F., Sun Hung Kai Centre, 30 Harbour Road, Wanchai,
Hong Kong

Date of Issue : 18 November 2010

Certified by : 

K C Lee

The test equipment used for calibration are traceable to the National Standards as specified in this report.
This report shall not be reproduced except in full and with prior written approval from this laboratory.

Calibration and Testing Laboratory of Sun Creation Engineering Limited

c/o 4/F, Tsing Shan Wan Exchange Building, 1 Hing On Lane, Tuen Mun, New Territories, Hong Kong

Tel: 2927 2606 Fax: 2744 8986 E-mail: callab@suncreation.com Website: www.suncreation.com

High-Volume TSP Sampler
5-Point Calibration Record

Location : Sai Ying Pun
Calibrated by : K.T.Ho
Date : 18/03/2011

Sampler

Model : TE-5170
Serial Number : S/N 2146

Calibration Orifice and Standard Calibration Relationship

Serial Number : 1785
Service Date : 10 May 2010
Slope (m) : 2.01637
Intercept (b) : -0.02316
Correlation Coefficient(r) : 0.99996

Standard Condition

Pstd (hpa) : 1013
Tstd (K) : 298.18

Calibration Condition

Pa (hpa) : 1017
Ta(K) : 288

| Resistance Plate | dH [green liquid] (inch water) | Z | X=Qstd (cubic meter/min) | IC | Y |
|------------------|--------------------------------|-------|--------------------------|----|------|
| 1 18 holes | 11.0 | 3.380 | 1.688 | 60 | 61.2 |
| 2 13 holes | 9.8 | 3.191 | 1.594 | 56 | 57.1 |
| 3 10 holes | 8.0 | 2.883 | 1.441 | 51 | 52.0 |
| 4 7 holes | 4.8 | 2.233 | 1.119 | 39 | 39.7 |
| 5 5 holes | 3.0 | 1.765 | 0.887 | 30 | 30.6 |

Sampler Calibration Relationship

Slope(m): 37.799 Intercept(b): -2.762 Correlation Coefficient(r): 0.9997

Checked by: Magnum Fan

Date: 20/03/2011

ENVIROTECH SERVICES CO.

**High-Volume TSP Sampler
5-Point Calibration Record**

Location : Aberdeen
 Calibrated by : K.F.Ho
 Date : 29/04/2011

Sampler

Model : TE-5170
 Serial Number : S/N2099

Calibration Orifice and Standard Calibration Relationship

Serial Number : 1785
 Service Date : 10 May 2010
 Slope (m) : 2.01637
 Intercept (b) : -0.02316
 Correlation Coefficient(r) : 0.99996

Standard Condition

Pstd (hpa) : 1013
 Tstd (K) : 298.18

Calibration Condition

Pa (hpa) : 1012
 Ta(K) : 298

| Resistance Plate | dH [green liquid] (inch water) | Z | X=Qstd (cubic meter/min) | IC | Y |
|------------------|--------------------------------|-------|--------------------------|----|------|
| 1 18 holes | 11.4 | 3.375 | 1.685 | 60 | 59.9 |
| 2 13 holes | 9.5 | 3.081 | 1.539 | 54 | 53.9 |
| 3 10 holes | 7.6 | 2.755 | 1.378 | 48 | 47.7 |
| 4 7 holes | 5.0 | 2.235 | 1.120 | 37 | 36.8 |
| 5 5 holes | 3.0 | 1.731 | 0.870 | 27 | 26.8 |

Sampler Calibration Relationship

Slope(m):40.531 Intercept(b): -8.261 Correlation Coefficient(r): 0.9999

Checked by: Magnum Fan

Date: 03/05/2011

ENVIROTECH SERVICES CO.

High-Volume TSP Sampler
5-Point Calibration Record

Location : Cyber Port
Calibrated by : K.F.Ho
Date : 29/04/2011

Sampler

Model : TE-5170
Serial Number : S/N 2098

Calibration Orfice and Standard Calibration Relationship

Serial Number : 1785
Service Date : 10 May 2010
Slope (m) : 2.01637
Intercept (b) : -0.02316
Correlation Coefficient(r) : 0.99996

Standard Condition

Pstd (hpa) : 1013
Tstd (K) : 298.18

Calibration Condition

Pa (hpa) : 1020
Ta(K) : 289

| Resistance Plate | dH [green liquid] (inch water) | Z | X=Qstd (cubic meter/min) | IC | Y |
|------------------|--------------------------------|-------|--------------------------|----|------|
| 1 18 holes | 11.4 | 3.375 | 1.685 | 60 | 59.9 |
| 2 13 holes | 9.6 | 3.097 | 1.547 | 54 | 53.9 |
| 3 10 holes | 7.5 | 2.737 | 1.369 | 47 | 46.8 |
| 4 7 holes | 5.6 | 2.365 | 1.185 | 39 | 38.9 |
| 5 5 holes | 3 | 1.731 | 0.870 | 27 | 26.7 |

Sampler Calibration Relationship

Slope(m):40.488 Intercept(b): -8.520 Correlation Coefficient(r): 0.9997

Checked by: Magnum Fan

Date: 03/05/2011

ENVIROTECH SERVICES CO.

**High-Volume TSP Sampler
5-Point Calibration Record**

Location : Wah Fu Estate
 Calibrated by : K.F.Ho
 Date : 29/04/2010

Sampler

Model : TE-5170
 Serial Number : S/N 2100

Calibration Orifice and Standard Calibration Relationship

Serial Number : 1785
 Service Date : 10 May 2010
 Slope (m) : 2.01637
 Intercept (b) : -0.02316
 Correlation Coefficient(r) : 0.99996

Standard Condition

Pstd (hpa) : 1013
 Tstd (K) : 298.18

Calibration Condition

Pa (hpa) : 1012
 Ta(K) : 298

| Resistance Plate | dH [green liquid] (inch water) | Z | X=Qstd (cubic meter/min) | IC | Y |
|------------------|--------------------------------|-------|--------------------------|----|------|
| 1 18 holes | 11.2 | 3.345 | 1.670 | 56 | 55.9 |
| 2 13 holes | 9.2 | 3.032 | 1.515 | 50 | 49.9 |
| 3 10 holes | 7.2 | 2.682 | 1.342 | 43 | 42.8 |
| 4 7 holes | 5.3 | 2.301 | 1.153 | 35 | 34.9 |
| 5 5 holes | 3.3 | 1.816 | 0.912 | 26 | 25.7 |

Sampler Calibration Relationship

Slope(m):39.859 Intercept(b): -10.568 Correlation Coefficient(r): 0.9998

Checked by: Magnum Fan

Date: 03/05/2011

High-Volume TSP Sampler**5-Point Calibration Record**

Location : Sai Ying Pun
 Calibrated by : K.T.Ho
 Date : 16/05/2011

Sampler

Model : TE-5170
 Serial Number : S/N 2146

Calibration Orifice and Standard Calibration Relationship

Serial Number : 1785
 Service Date : 10 May 2011
 Slope (m) : 2.01637
 Intercept (b) : -0.02316
 Correlation Coefficient(r) : 0.99996

Standard Condition

Pstd (hpa) : 1013
 Tstd (K) : 298.18

Calibration Condition

Pa (hpa) : 1010
 Ta(K) : 298

| Resistance Plate | dH [green liquid] (inch water) | Z | X=Qstd (cubic meter/min) | IC | Y |
|------------------|--------------------------------|-------|--------------------------|----|------|
| 1 18 holes | 11.4 | 3.377 | 1.686 | 61 | 61.0 |
| 2 13 holes | 9.6 | 3.099 | 1.548 | 55 | 55.0 |
| 3 10 holes | 7.8 | 2.793 | 1.397 | 49 | 49.0 |
| 4 7 holes | 4.7 | 2.168 | 1.087 | 36 | 36.0 |
| 5 5 holes | 2.9 | 1.703 | 0.856 | 27 | 27.0 |

Sampler Calibration Relationship

Slope(m):40.985 Intercept(b): -8.283 Correlation Coefficient(r): 0.9999

Checked by: Magnum Fan

Date: 20/05/2011

Summary of Calibration Date of Monitoring Equipment

| Equipment | Description | ID | Latest Calibration Date | Next Calibration Date |
|-----------------------------------|-------------|------------------------------|--------------------------------|--------------------------------|
| Integrated Sound Level Meters | B&K 2238 | 2684502 | 8 th September 2010 | 7 th September 2011 |
| Calibrator for Sound Level Meters | B&K 4231 | 2656516 | 18 th November 2010 | 17 th November 2011 |
| Laser Dust Monitor | LD-3B-001 | 974350 | 19 th October 2010 | 18 th October 2011 |
| Laser Dust Monitor | LD-3B-002 | 934393 | 19 th October 2010 | 18 th October 2011 |
| High Volume Sampler | TE-5170 | 2098 (Cyberport PTW) | 29 th April 2011 | 28 rd June 2011 |
| High Volume Sampler | TE-5170 | 2099 (Aberdeen PTW) | 29 th April 2011 | 28 rd June 2011 |
| High Volume Sampler | TE-5170 | 2100 (Wah Fu PTW) | 29 th April 2011 | 28 rd June 2011 |
| High Volume Sampler | TE-5170 | 2146 (Fung Mat Road Site) | 18 th March 2011 | 17 th May 2011 |
| High Volume Sampler | TE-5170 | 2146 (Fung Mat Road Site) | 16 th May 2011 | 15 th July 2011 |

EQUIPMENT CALIBRATION RECORD

Type : Laser Dust Monitor
 Manufacturer / Brand : SIBATA
 Model No.: LD-3B
 Equipment No.: LD-3B-001
 Sensitivity Adjustment Scale Setting : 640 CPM

Operator: _____

Standard Equipment

Equipment : MFC High Volume Air Sampler
 Venue : Ice Factory (Aberdeen)
 Model No.: TE-5170 Total Suspended Particulated
 Serial No.: 2099

Last Calibration Date 11/11/2009

Calibration Result

Sensitivity Adjustment Scale Setting (Before Calibration) : 640 CPM
 Sensitivity Adjustment Scale Setting (After Calibration) : 640 CPM


| Hour | Date (dd-mmm-yy) | Time | | Ambient Condition | | Concentration (ug/m3) Y-axis | Total Count | Count/Minute X-axis |
|------|---------------------|-------|-------|-------------------|----------|------------------------------------|-------------|------------------------|
| | | | | Temp (C) | R.H. (%) | | | |
| 1 | 19-Oct-10 | 09:12 | 10:12 | 26.1 | 62% | 113 | 4140 | 69.00 |
| 2 | 19-Oct-10 | 10:12 | 11:12 | 26.1 | 62% | 114 | 4230 | 70.50 |
| 3 | 19-Oct-10 | 11:12 | 12:12 | 26.1 | 62% | 110 | 3900 | 65.00 |

Be Linear Regression of Y or X

Slope (K-factor): 0.732

Correlation coefficient : 0.9994

Remark: _____

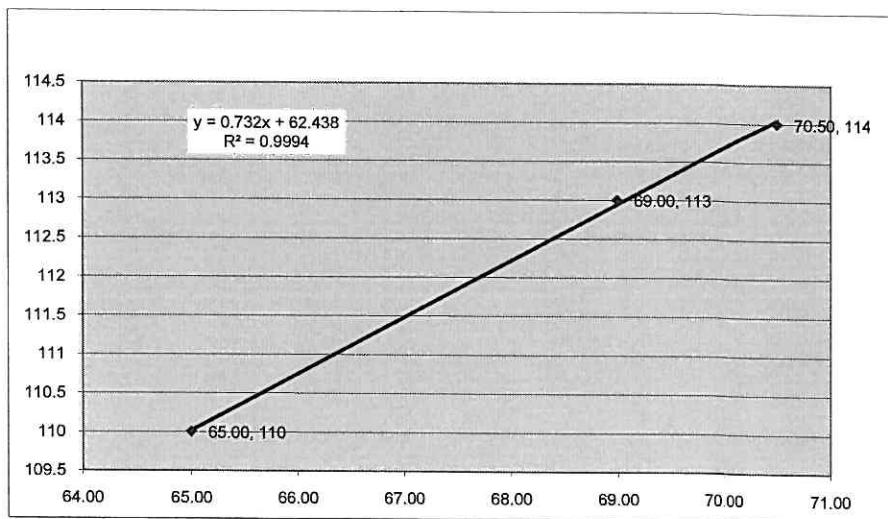

Recorded by: Ruby Law

Signature: 

Date: 21/10/2010

Checked by: Keith Chau

Signature: 

Date: 21/10/2010

EQUIPMENT CALIBRATION RECORD

Type : Laser Dust Monitor
 Manufacturer / Brand : SIBATA
 Model No.: LD-3B
 Equipment No.: LD-3B-002
 Sensitivity Adjustment Scale Setting : 622 CPM

Operator: _____

Standard Equipment

Equipment : MFC High Volume Air Sampler
 Venue : Wah Ming House, Wah Fu Estate
 Model No.: TE-5170 Total Suspended Particulated
 Serial No.: 2100

Last Calibration Date 11/11/2009

Calibration Result


Sensitivity Adjustment Scale Setting (Before Calibration) : 622 CPM
 Sensitivity Adjustment Scale Setting (After Calibration) : 622 CPM

| Hour | Date (dd-mmm-yy) | Time | | Ambient Condition | | Concentration (ug/m3) Y-axis | Total Count | Count/Minute X-axis |
|------|---------------------|-------|-------|-------------------|----------|------------------------------------|-------------|------------------------|
| | | | | Temp (C) | R.H. (%) | | | |
| 1 | 19-Oct-10 | 14:00 | 15:00 | 26.1 | 62% | 69 | 2490 | 41.50 |
| 2 | 19-Oct-10 | 15:00 | 16:00 | 26.1 | 62% | 82 | 3300 | 55.00 |
| 3 | 19-Oct-10 | 16:00 | 17:00 | 26.1 | 62% | 97 | 3990 | 66.50 |

Be Linear Regression of Y or X

Slope (K-factor): 1.1155
 Correlation coefficient : 0.9924

Remark: _____

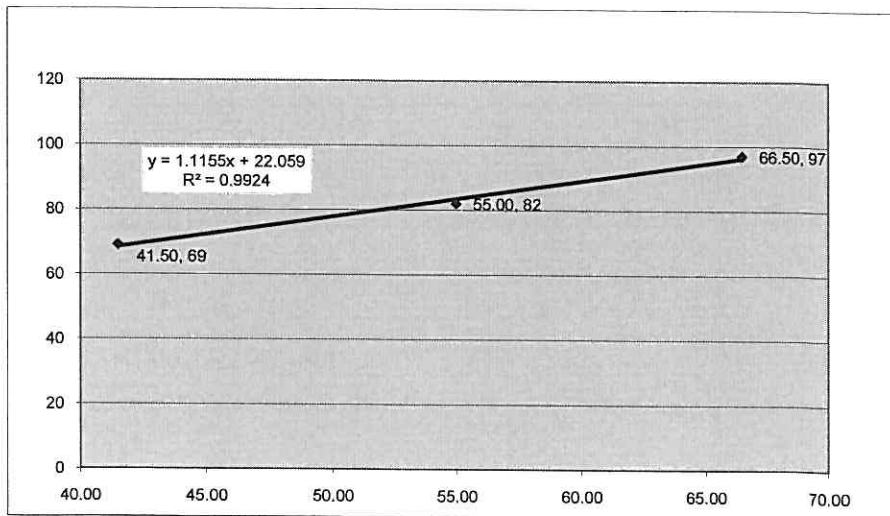

Recorded by: Ruby Law

Signature: *Ruby Law*

Date: 21/10/2010

Checked by: Keith Chau

Signature: *Keith Chau*

Date: 21/10/2010

APPENDIX G

MONITORING SCHEDULE FOR THE PRESENT AND NEXT REPORTING PERIOD

Monitoring Schedule during the Reporting Period

| Parameter | Monitoring Station | Date |
|--------------------|----------------------|---|
| Noise | M3, Normal Daytime | 06-May-11 ; 12-May-11 ; 18-May-11 ; 24-May-11 and 30-May-11 |
| | M3, Evening Time | 09-May-11 |
| | M5, Normal Daytime | 03-May-11 ; 09-May-11 ; 19-May-11 ; 25-May-11 and 31-May-11 |
| | M5a, Holiday Daytime | 08-May-11 |
| | M5a, Evening Time | 05-May-11 |
| | M5a, Night-time | 05-May-11 and 19-May-11 |
| | M6a, Normal Daytime | 05-May-11 ; 11-May-11 ; 17-May-11 and 23-May-11 |
| | M6a, Holiday Daytime | 15-May-11 |
| | M6a, Evening Time | 19-May-11 and 25-May-11 |
| | M6a, Night-time | 09-May-11 and 25-May-11 |
| | M7a | 05-May-11 ; 11-May-11 ; 17-May-11 and 23-May-11 |
| | M8 | 03-May-11 ; 09-May-11 ; 19-May-11 ; 25-May-11 and 31-May-11 |
| | M8, Holiday Daytime | 29-May-11 |
| Air: 1-hr TSP | CM FM1 | 05-May-11 ; 11-May-11 ; 17-May-11 ; 23-May-11 and 27-May-11 |
| | CM CB1a | 03-May-11 ; 09-May-11 ; 13-May-11 ; 19-May-11 ; 25-May-11 and 31-May-11 |
| | CM WF1a | 05-May-11 ; 11-May-11 ; 17-May-11 ; 23-May-11 and 27-May-11 |
| | CM AB1a | 03-May-11 ; 09-May-11 ; 13-May-11 ; 19-May-11 ; 25-May-11 and 31-May-11 |
| Air: 24-hrs TSP | CM FM1 | 05-May-11 ; 11-May-11 ; 17-May-11 ; 23-May-11 and 27-May-11 |
| | CM CB1a | 05-May-11 ; 11-May-11 ; 17-May-11 ; 23-May-11 and 27-May-11 |
| | CM WF1a | 05-May-11 ; 11-May-11 ; 17-May-11 ; 23-May-11 and 27-May-11 |
| | CM AB1a | 05-May-11 ; 11-May-11 ; 17-May-11 ; 23-May-11 and 27-May-11 |

Proposed Monitoring Schedule for Coming Reporting Period

| Parameter | Monitoring Station | Date |
|--------------------|----------------------|---|
| Noise | M3, Normal Daytime | 10-Jun-11 ; 16-Jun-11 ; 22-Jun-11 and 28-Jun-11 |
| | M3, Evening Time | 15-Jun-11 |
| | M5, Normal Daytime | 09-Jun-11 ; 15-Jun-11 ; 21-Jun-11 ; 27-Jun-11 and 30-Jun-11 |
| | M5a, Holiday Daytime | 05-Jun-11 |
| | M5a, Evening Time | 01-Jun-11 and 29-Jun-11 |
| | M5a, Night-time | 01-Jun-11 ; 15-Jun-11 and 29-Jun-11 |
| | M6a, Normal Daytime | 01-Jun-11 ; 07-Jun-11 ; 13-Jun-11 ; 23-Jun-11 and 29-Jun-11 |
| | M6a, Holiday Daytime | 12-Jun-11 |
| | M6a, Evening Time | 09-Jun-11 |
| | M6a, Night-time | 09-Jun-11 and 21-Jun-11 |
| | M7a, Normal Daytime | 01-Jun-11 ; 07-Jun-11 ; 13-Jun-11 ; 23-Jun-11 and 29-Jun-11 |
| | M8, Normal Daytime | 09-Jun-11 ; 15-Jun-11 ; 21-Jun-11 ; 27-Jun-11 and 30-Jun-11 |
| | M8, Holiday Daytime | 19-Jun-11 |
| Air: 1-hr TSP | CM FM1 | 02-Jun-11 ; 08-Jun-11 ; 14-Jun-11 ; 20-Jun-11 ; 24-Jun-11 and 29-Jun-11 |
| | CM CB1a | 03-Jun-11 ; 09-Jun-11 ; 15-Jun-11 ; 21-Jun-11 ; 27-Jun-11 and 30-Jun-11 |
| | CM WF1a | 01-Jun-11 ; 07-Jun-11 ; 13-Jun-11 ; 17-Jun-11 ; 23-Jun-11 and 29-Jun-11 |
| | CM AB1a | 03-Jun-11 ; 09-Jun-11 ; 15-Jun-11 ; 21-Jun-11 ; 27-Jun-11 and 30-Jun-11 |
| Air: 24-hrs TSP | CM FM1 | 02-Jun-11 ; 08-Jun-11 ; 14-Jun-11 ; 20-Jun-11 ; 24-Jun-11 and 29-Jun-11 |
| | CM CB1a | 02-Jun-11 ; 08-Jun-11 ; 14-Jun-11 ; 20-Jun-11 ; 24-Jun-11 and 29-Jun-11 |
| | CM WF1a | 02-Jun-11 ; 08-Jun-11 ; 14-Jun-11 ; 20-Jun-11 ; 24-Jun-11 and 29-Jun-11 |
| | CM AB1a | 02-Jun-11 ; 08-Jun-11 ; 14-Jun-11 ; 20-Jun-11 ; 24-Jun-11 and 29-Jun-11 |

APPENDIX H

NOISE MONITORING RESULT

Daytime Noise Monitoring Results – Normal weekday

Station M3, Kwan Yick building(*)

| Date | Start Time | End Time | Weather | Noise level (dB(A), 30 min) | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|-----------------------------|------|------|------------------------------------|--------------------------------|---------|------------|------------------|----------------------------|----------------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 06-May-11 | 14:35 | 15:05 | Fine | 68.7 | 70.3 | 66.7 | Lifting, excavation work | Mainly traffic noise | - | 27.0 | 0.3 | RION- NL31 (S/N: 00983400) | RION- NC73 (S/N: 10997142) |
| 12-May-11 | 10:25 | 10:55 | Sunny | 69.6 | 71.1 | 67.0 | Lifting, excavation work | Mainly traffic noise | - | 30.0 | 0.5 | RION- NL31 (S/N: 00983400) | RION- NC73 (S/N: 10997142) |
| 18-May-11 | 10:45 | 11:15 | Sunny | 68.6 | 70.0 | 66.1 | Lifting, excavation work | Mainly traffic noise | - | 25.0 | 0.4 | RION- NL31 (S/N: 00983400) | RION- NC73 (S/N: 10997142) |
| 24-May-11 | 13:20 | 13:50 | Cloudy | 68.6 | 70.0 | 66.3 | Lifting, excavation work | Mainly traffic noise | - | 22.0 | 0.5 | RION- NL31 (S/N: 00983400) | RION- NC73 (S/N: 10997142) |
| 30-May-11 | 10:43 | 11:13 | Sunny | 68.8 | 70.3 | 66.9 | Lifting, excavation work | Mainly traffic noise | - | 26.0 | 0.2 | RION- NL31 (S/N: 00983400) | RION- NC73 (S/N: 10997142) |
| | | | | Min. | 68.6 | | | | | | | | |
| | | | | Max. | 69.6 | | | | | | | | |

Remark: (*): The data were provided by Contract No. DC/2007/23. Calibration certificates for the noise meter(s) and calibrator(s) used were included in the corresponding Monthly EM&A Report for this Contract

Station M5, Chuk Lam Ming Tong

| Date | Start Time | End Time | Weather | Noise level (dB(A), 30 min) | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|-----------------------------|------|------|------------------------------------|--------------------------------|---------|------------|------------------|------------------------|-----------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 03-May-11 | 14:58 | 15:28 | Sunny | 60.0 | 63.0 | 57.0 | Loading activities | Road traffic noise | N.A | 27.3 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 09-May-11 | 13:54 | 14:24 | Sunny | 63.0 | 65.0 | 56.0 | Loading activities and drilling | Road traffic noise | N.A | 27.3 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 19-May-11 | 11:16 | 11:46 | Fine | 64.0 | 66.0 | 58.0 | Loading activities and drilling | Road traffic noise | N.A | 25.8 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 25-May-11 | 09:39 | 10:09 | Fine | 63.0 | 66.0 | 58.0 | Loading activities and grouting | Road traffic noise | N.A | 23.0 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 31-May-11 | 14:57 | 15:27 | Drizzle | 61.0 | 64.0 | 57.0 | No major construction works | Road traffic noise | N.A | 26.7 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 60.0 | | | | | | | | |
| | | | | Max. | 64.0 | | | | | | | | |

Station M6a, Aegean Terrace

| Date | Start Time | End Time | Weather | Noise level (dB(A), 30 min) | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|-----------------------------|------|------|------------------------------------|--|--|------------|------------------|------------------------|-----------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 05-May-11 | 10:49 | 11:19 | Sunny | 59.0 | 60.0 | 55.0 | No major construction works | Loading activities and operating hydraulic excavator from the construction site near Cyberport PTW | Free-field measurement, +3dB correction. | 23.6 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 11-May-11 | 10:36 | 11:06 | Sunny | 62.0 | 65.0 | 55.0 | No major construction works | Loading activities and operating hydraulic excavator from the | Free-field measurement, +3dB correction. | 29.3 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 17-May-11 | 10:45 | 11:15 | Drizzle | 58.6 | 62.0 | 51.6 | No major construction works | Loading activities and operating hydraulic excavator from the construction site near Cyberport PTW | Free-field measurement, +3dB correction. | 25.6 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 23-May-11 | 10:09 | 10:39 | Cloudy | 61.0 | 64.0 | 55.0 | Grouting | Loading activities and operating hydraulic excavator from the | Free-field measurement, +3dB correction. | 24.2 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 58.6 | | | | | | | | |
| | | | | Max. | 62.0 | | | | | | | | |

Remark: Free-field measurement, +3dB correction.

Station M7a, Wah Ming House

| Date | Start Time | End Time | Weather | Noise level (dB(A), 30 min) | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|-----------------------------|------|------|------------------------------------|--------------------------------------|---------|------------|------------------|------------------------|-----------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 05-May-11 | 09:45 | 10:15 | Sunny | 61.0 | 63.0 | 57.0 | No major construction works | Welding on roof of Wah Kei House | N.A | 23.6 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 11-May-11 | 13:05 | 13:35 | Sunny | 58.7 | 60.2 | 56.2 | No major construction works | Work renovation inside Wah Kei House | N.A | 29.3 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 17-May-11 | 13:05 | 13:35 | Drizzle | 58.0 | 59.0 | 56.0 | No major construction works | Work renovation inside Wah Kei House | N.A | 26.3 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 23-May-11 | 09:12 | 09:42 | Cloudy | 59.6 | 60.9 | 56.8 | No major construction works | N.A | N.A | 24.2 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 58.0 | | | | | | | | |
| | | | | Max. | 61.0 | | | | | | | | |

Station M8, Wah Lai House

| Date | Start Time | End Time | Weather | Noise level (dB(A), 30 min) | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|-----------------------------|------|------|---------------------------------------|---|---------|------------|------------------|------------------------|-----------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 03-May-11 | 13:32 | 14:02 | Sunny | 63.4 | 65.1 | 60.9 | Welding | Road Traffic noise from Shek Pai Wan Road | N.A | 27.3 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 09-May-11 | 09:55 | 10:25 | Sunny | 64.6 | 66.0 | 61.6 | Drilling | Road Traffic noise from Shek Pai Wan Road | N.A | 27.3 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 19-May-11 | 09:47 | 10:17 | Fine | 65.9 | 67.2 | 64.3 | Loading and operation of mobile crane | Road Traffic noise from Shek Pai Wan Road | N.A | 25.8 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 25-May-11 | 13:34 | 14:04 | Fine | 65.1 | 66.4 | 62.9 | Loading | Road Traffic noise from Shek Pai Wan Road | N.A | 23.0 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| 31-May-11 | 13:36 | 14:06 | Drizzle | 64.1 | 65.6 | 61.7 | Mixing and loading | Road Traffic noise from Shek Pai Wan Road | N.A | 26.7 | <5 | B&K 2238 S/N: 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 63.4 | | | | | | | | |
| | | | | Max. | 65.9 | | | | | | | | |

Restricted Hours Noise Monitoring Results – Daytime on Public Holiday

Station M5a, Chuk Lam Ming Tong

| Date | Start Time | End Time | Weather | Noise level (dB(A)), 5 min | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|----------------------------|------|------|------------------------------------|---|---------|------------|------------------|---------------------------|--------------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 08-May-11 | 14:36 | 14:51 | Sunny | 63.6 | 67.7 | 54.7 | No major construction works | Road traffic noise at San Wan Drive and noise from opening/closing of the | N.A | 26.9 | <5 | B&K 2238 S/N : 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 63.6 | | | | | | | | |
| | | | | Max. | 63.6 | | | | | | | | |

Station M6a, Aegean Terrace

| Date | Start Time | End Time | Weather | Noise level (dB(A)), 5 min | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|----------------------------|------|------|------------------------------------|---------------------------------------|--|------------|------------------|---------------------------|--------------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 15-May-11 | 11:44 | 11:59 | Cloudy | 62.7 | 64.2 | 59.0 | No major construction works | Cars from residents of Aegean Terrace | According to contractor, general construction works was in process accordance to CNP. Free-field measurement, +3dB correction. | 24.4 | <5 | B&K 2238 S/N : 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 62.7 | | | | | | | | |
| | | | | Max. | 62.7 | | | | | | | | |

Station M8, Wah Lai House

| Date | Start Time | End Time | Weather | Noise level (dB(A)), 5 min | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|----------------------------|------|------|------------------------------------|---|---------|------------|------------------|---------------------------|--------------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 29-May-11 | 13:09 | 13:24 | Drizzle | 59.5 | 62.7 | 50.6 | No major construction works | Road Traffic noise from Shek Pai Wan Road | N.A | 26.9 | <5 | B&K 2238 S/N : 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 59.5 | | | | | | | | |
| | | | | Max. | 59.5 | | | | | | | | |

Restricted Hours Noise Monitoring Results – Evening time

Station M3, Kwan Yick building

| Date | Start Time | End Time | Weather | Noise level (dB(A)), 5 min | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|----------------------------|------|------|------------------------------------|---|---------|------------|------------------|---------------------------|--------------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 09-May-11 | 19:00 | 19:15 | Fine | 68.3 | 69.3 | 66.9 | Jet grouting | Road traffic noise from Western Harbour Crossing, engine of turbojet, planes and helicopter overhead. | N.A | 24.1 | <5 | B&K 2238 S/N : 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 68.3 | | | | | | | | |
| | | | | Max. | 68.3 | | | | | | | | |

Station M5a, Chuk Lam Ming Tong


| Date | Start Time | End Time | Weather | Noise level (dB(A)), 5 min | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|----------------------------|------|------|------------------------------------|--------------------------------|---|------------|------------------|---------------------------|--------------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 05-May-11 | 22:45 | 23:00 | Fine | 59.7 | 59.1 | 48.9 | No major construction works | Road traffic at San Wan Drive | According to contractor, general construction works was in process accordance to CNP. | 23.6 | <5 | B&K 2238 S/N : 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 59.7 | | | | | | | | |
| | | | | Max. | 59.7 | | | | | | | | |


Station M6a, Aegean Terrace


| Date | Start Time | End Time | Weather | Noise level (dB(A)), 5 min | | | Major Construction Noise Source(s) | Other Noise Source(s) Observed | Remarks | Temp. (°C) | Wind Speed (m/s) | Noise Meter Model / ID | Calibrator Model / ID |
|-----------|------------|----------|---------|----------------------------|------|------|------------------------------------|----------------------------------|--|------------|------------------|---------------------------|--------------------------|
| | | | | Leq | L10 | L90 | | | | | | | |
| 19-May-11 | 22:40 | 22:55 | Fine | 53.6 | 52.7 | 49.8 | No major construction works | Local traffics of Aegean Terrace | According to contractor, general construction works was in process accordance to CNP. Free-field measurement, +3dB correction. | 25.8 | <5 | B&K 2238 S/N : 2684502 | B&K 4231 S/N: 2656516 |
| 25-May-11 | 22:41 | 22:56 | Fine | 50.6 | 52.2 | 49.6 | No major construction works | Local traffics of Aegean Terrace | According to contractor, general construction works was in process accordance to CNP. Free-field | 23.0 | <5 | B&K 2238 S/N : 2684502 | B&K 4231 S/N: 2656516 |
| | | | | Min. | 50.6 | | | | | | | | |
| | | | | Max. | 53.6 | | | | | | | | |


APPENDIX I

GRAPHICAL PRESENTATION OF NOISE MONITORING DATA

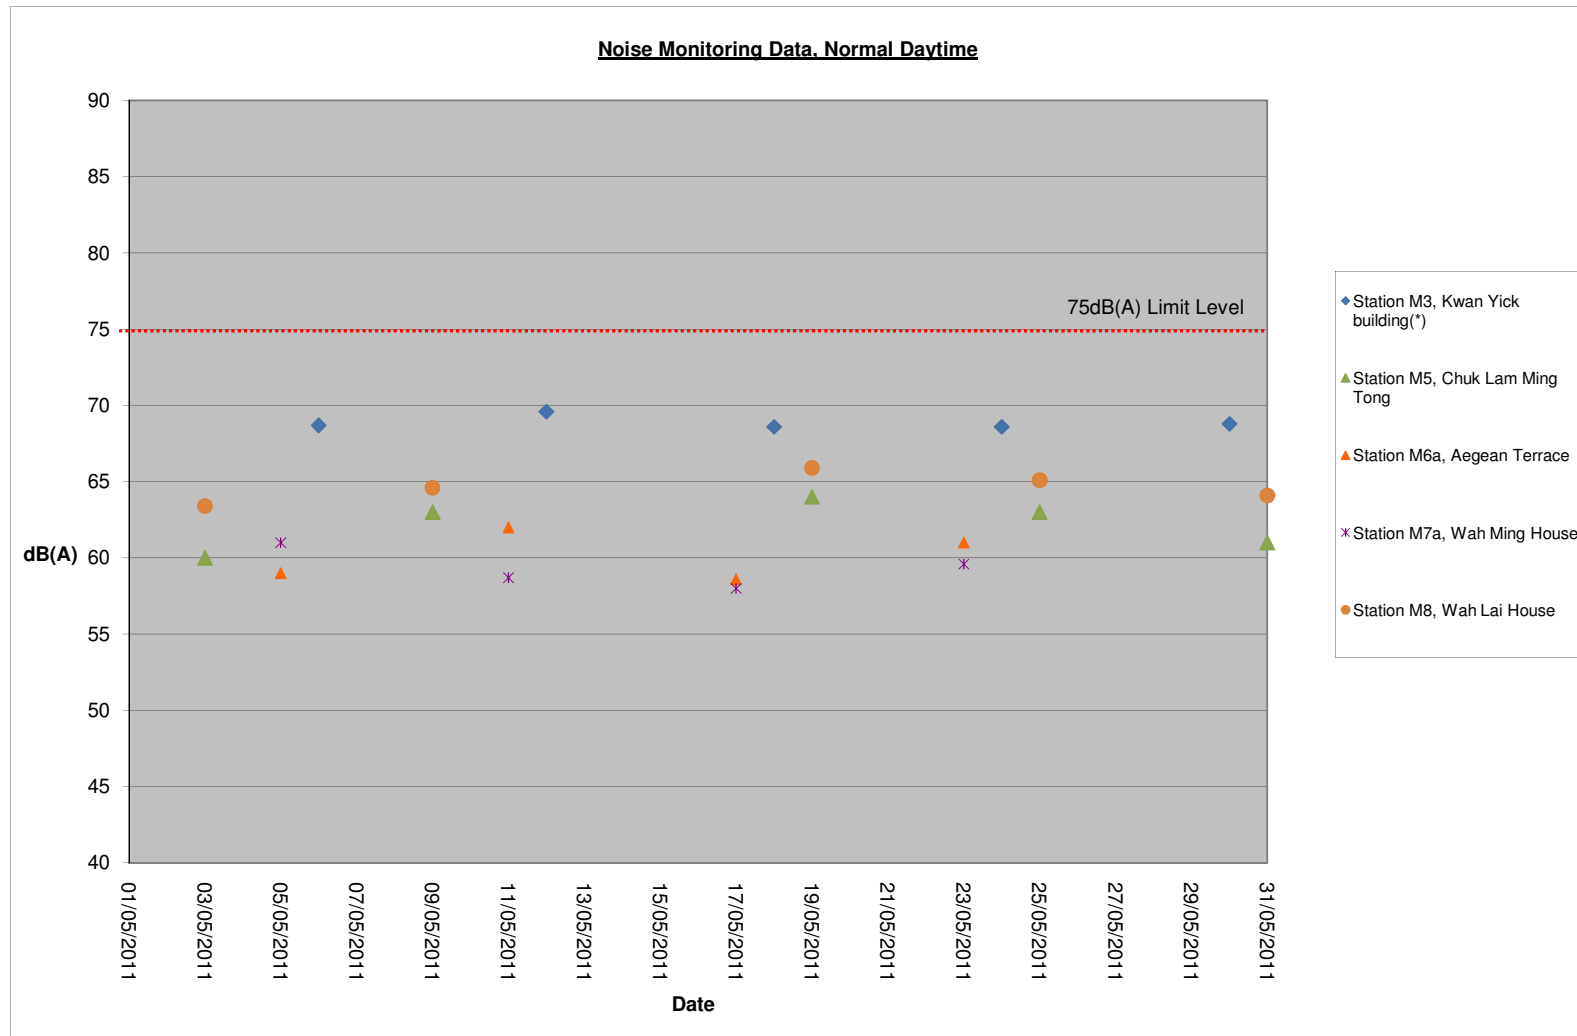

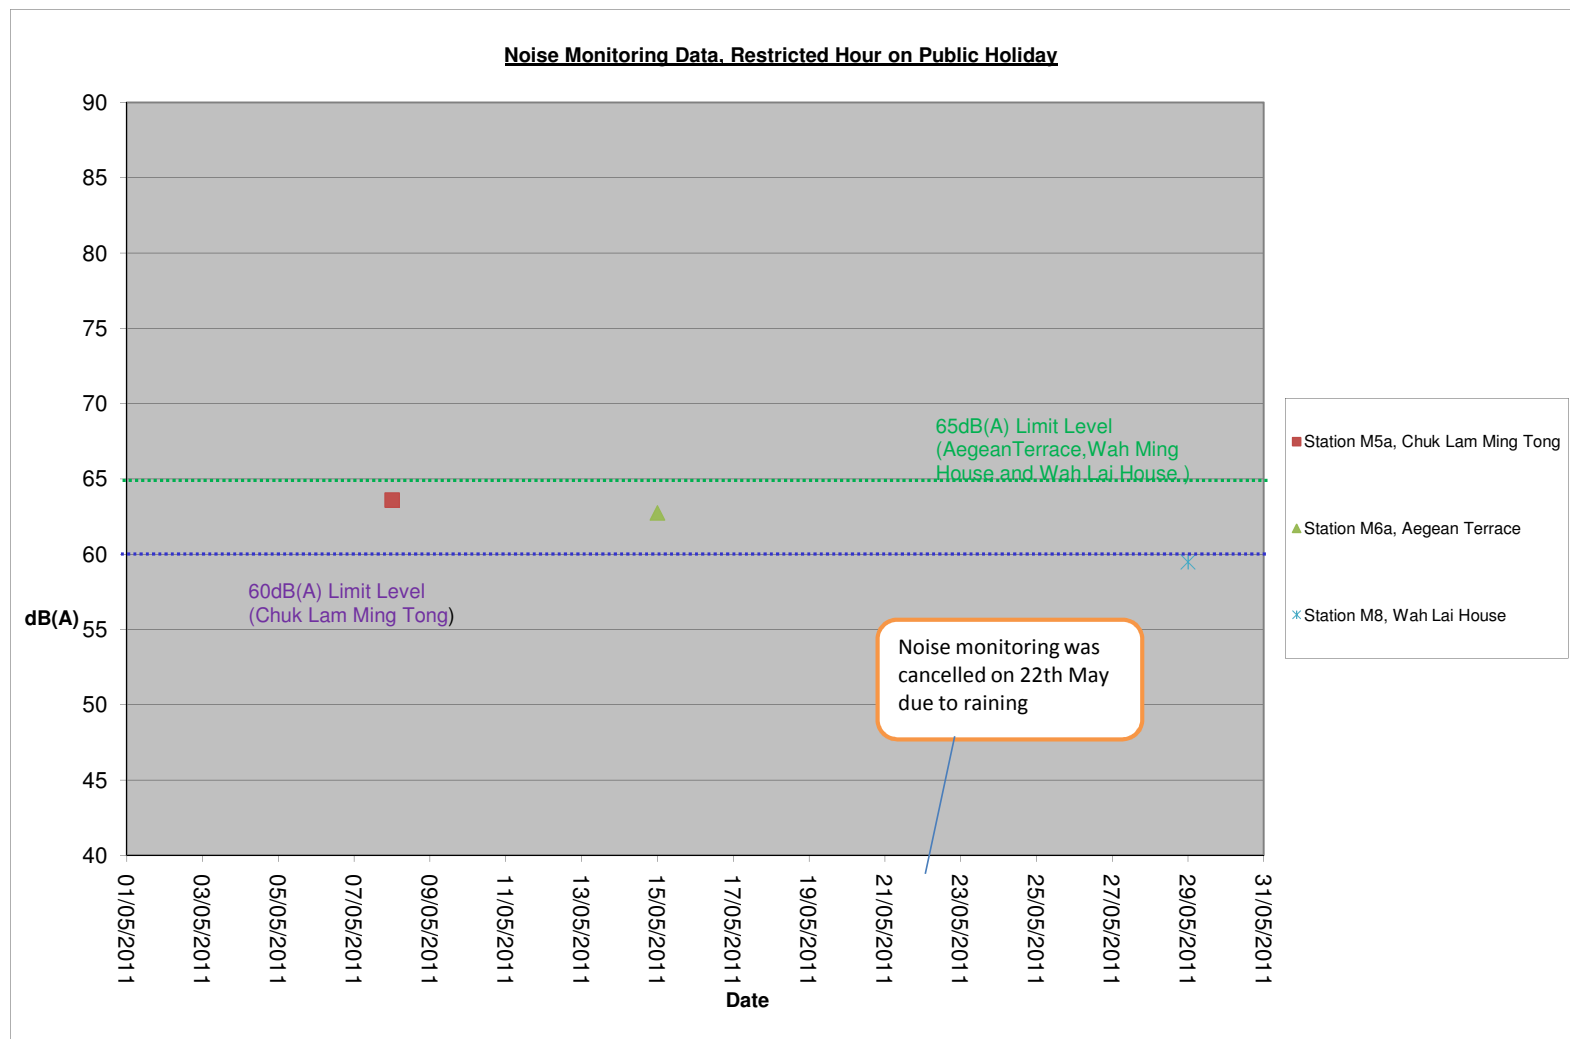

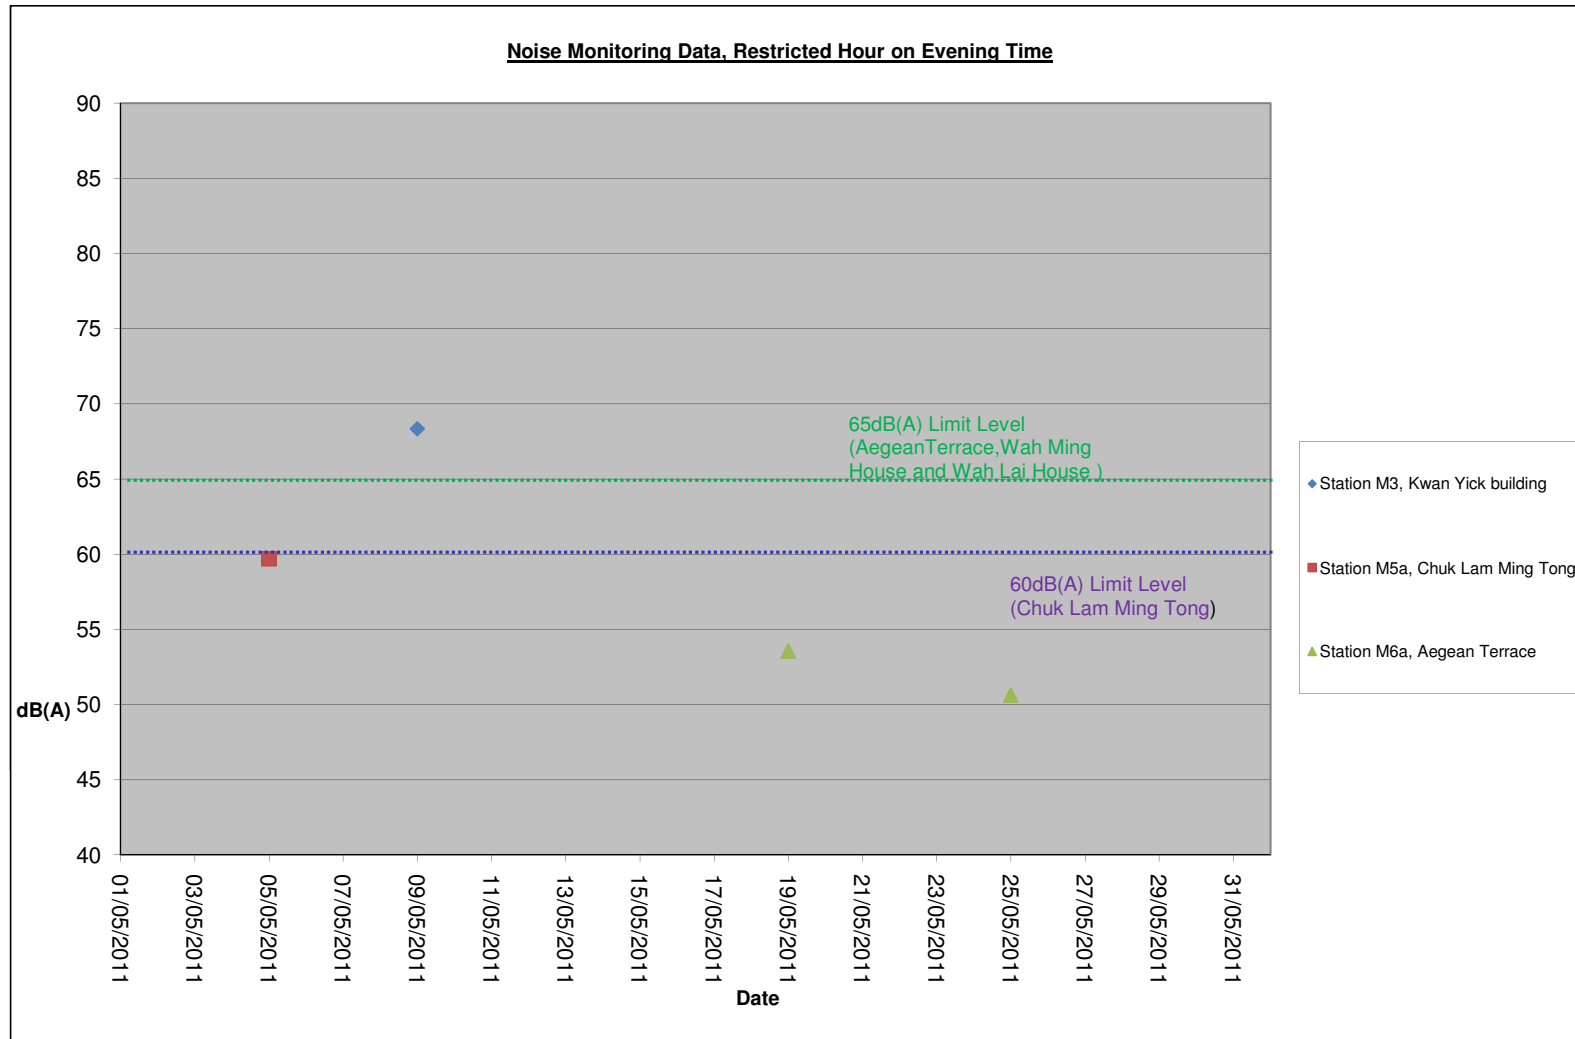

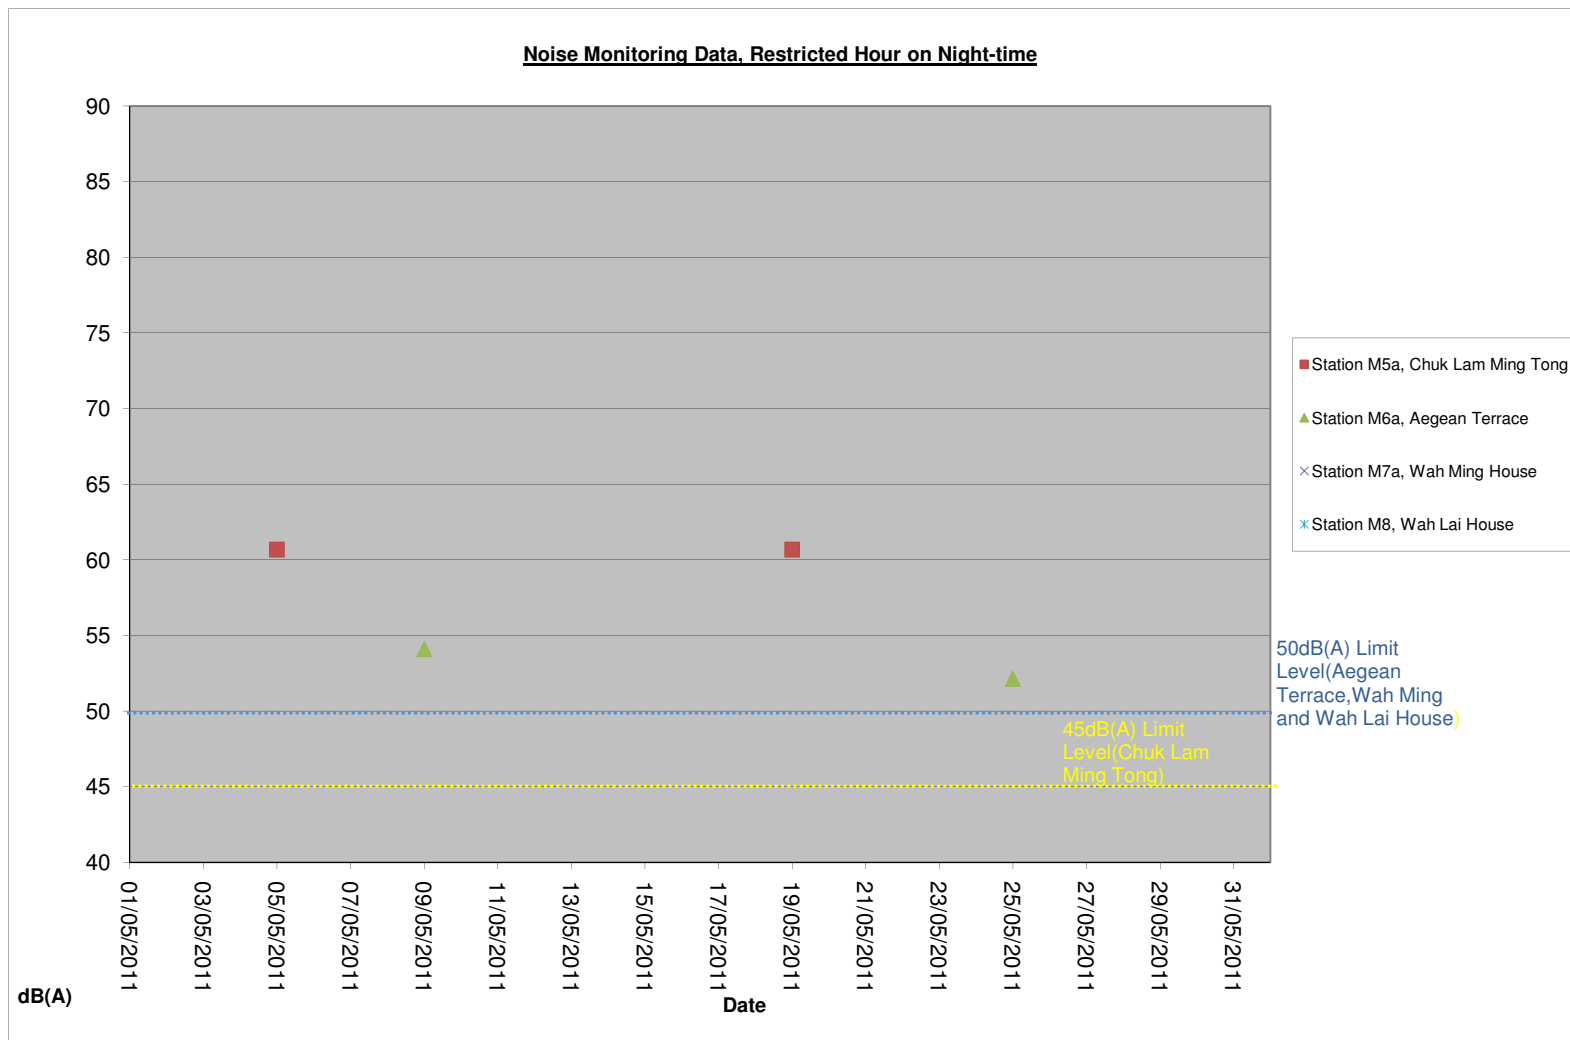

APPENDIX J

AIR QUALITY MONITORING RESULT

1-hour TSP Monitoring Results

Station CM_FM1, Western Wholesale Food Market

| Date | Start Time | Finish Time | Weather | TSP Concentration ($\mu\text{g}/\text{m}^3$) | Action Level ($\mu\text{g}/\text{m}^3$) | Limit Level ($\mu\text{g}/\text{m}^3$) | Site Conditions / Observations / Remarks | Temperature ($^{\circ}\text{C}$) | Wind Speed (m/s) | Sampler ID | Filter ID |
|------------|----------------------|-------------|---------|--|---|--|--|------------------------------------|------------------|-------------------------------|-----------|
| 05/05/2011 | Power supply failure | | | | | | | | | N.A | N.A |
| 05/05/2011 | | | | | | | | | | N.A | N.A |
| 05/05/2011 | | | | | | | | | | N.A | N.A |
| 11/05/2011 | 15:35 | 16:35 | Sunny | 301.3 | 331.9 | 500 | Grouting works | 27.6 | <5 | Western Wholesale Food Market | 581 |
| 11/05/2011 | 16:41 | 17:41 | Sunny | 76.5 | 331.9 | 500 | Grouting works | 27.6 | <5 | Western Wholesale Food Market | 588 |
| 11/05/2011 | 17:43 | 18:43 | Sunny | 65.5 | 331.9 | 500 | Grouting works | 27.6 | <5 | Western Wholesale Food Market | 589 |
| 17/05/2011 | 08:00 | 09:00 | Cloudy | 221.4 | 331.9 | 500 | Grouting works and shearing pin | 26.6 | <5 | Western Wholesale Food Market | 595 |
| 17/05/2011 | 13:30 | 14:30 | Cloudy | 57.5 | 331.9 | 500 | Grouting works and shearing pin | 26.6 | <5 | Western Wholesale Food Market | 596 |
| 17/05/2011 | 14:50 | 15:50 | Cloudy | 51.2 | 331.9 | 500 | Grouting works and shearing pin | 26.6 | <5 | Western Wholesale Food Market | 597 |
| 23/05/2011 | 14:20 | 15:20 | Fine | 235.0 | 331.9 | 500 | Grouting works and shearing pin | 24.2 | <5 | Western Wholesale Food Market | 601 |
| 23/05/2011 | 15:28 | 16:28 | Fine | 221.7 | 331.9 | 500 | Grouting works and shearing pin | 24.2 | <5 | Western Wholesale Food Market | 602 |
| 23/05/2011 | 16:32 | 17:32 | Fine | 202.5 | 331.9 | 500 | Grouting works and shearing pin | 24.2 | <5 | Western Wholesale Food Market | 603 |
| 27/05/2011 | 08:00 | 09:00 | Sunny | 281.8 | 331.9 | 500 | Grouting works and shearing pin | 26.7 | <5 | Western Wholesale Food Market | 607 |
| 27/05/2011 | 15:28 | 16:28 | Sunny | 215.0 | 331.9 | 500 | Grouting works and shearing pin | 26.7 | <5 | Western Wholesale Food Market | 608 |
| 27/05/2011 | 16:32 | 17:32 | Sunny | 222.5 | 331.9 | 500 | Grouting works and shearing pin | 26.7 | <5 | Western Wholesale Food Market | 609 |
| | | | | Min. | 51.2 | | | | | | |
| | | | | Max. | 301.3 | | | | | | |
| | | | | Average | 179 | | | | | | |

Station CM_CB1a, The Arcade, Cyberport

| Date | Start Time | Finish Time | Weather | TSP Concentration ($\mu\text{g}/\text{m}^3$) | Action Level ($\mu\text{g}/\text{m}^3$) | Limit Level ($\mu\text{g}/\text{m}^3$) | Site Conditions / Observations / Remarks | Temperature ($^{\circ}\text{C}$) | Wind Speed (m/s) | Sampler ID | Filter ID |
|------------|------------|-------------|---------|--|---|--|--|------------------------------------|------------------|------------|-----------|
| 03/05/2011 | 08:58 | 09:58 | Sunny | 17.9 | 279.9 | 500 | Loading | 27.3 | <5 | LD-3B-001 | N/A |
| 03/05/2011 | 09:58 | 10:58 | Sunny | 15.0 | 279.9 | 500 | Loading | 27.3 | <5 | LD-3B-001 | N/A |
| 03/05/2011 | 10:58 | 11:58 | Sunny | 13.5 | 279.9 | 500 | Loading | 27.3 | <5 | LD-3B-001 | N/A |
| 09/05/2011 | 13:00 | 14:00 | Fine | 16.5 | 279.9 | 500 | No major construction works | 27.3 | <5 | LD-3B-001 | N/A |
| 09/05/2011 | 14:00 | 15:00 | Fine | 18.3 | 279.9 | 500 | No major construction works | 27.3 | <5 | LD-3B-001 | N/A |
| 09/05/2011 | 15:00 | 16:00 | Fine | 18.3 | 279.9 | 500 | No major construction works | 27.3 | <5 | LD-3B-001 | N/A |
| 13/05/2011 | 09:05 | 10:05 | Cloudy | 10.6 | 279.9 | 500 | Mud out | 26.9 | <5 | LD-3B-001 | N/A |
| 13/05/2011 | 10:05 | 11:05 | Cloudy | 27.5 | 279.9 | 500 | Mud out | 26.9 | <5 | LD-3B-001 | N/A |
| 13/05/2011 | 11:05 | 12:05 | Cloudy | 20.1 | 279.9 | 500 | Mud out | 26.9 | <5 | LD-3B-001 | N/A |
| 19/05/2011 | 13:05 | 14:05 | Fine | 38.4 | 279.9 | 500 | Rock excavation | 25.8 | <5 | LD-3B-001 | N/A |
| 19/05/2011 | 14:05 | 15:05 | Fine | 34.4 | 279.9 | 500 | Rock excavation | 25.8 | <5 | LD-3B-001 | N/A |
| 19/05/2011 | 15:05 | 16:05 | Fine | 33.7 | 279.9 | 500 | Rock excavation | 25.8 | <5 | LD-3B-001 | N/A |
| 25/05/2011 | 09:02 | 10:02 | Sunny | 57.1 | 279.9 | 500 | Fruntion and loading activities | 23 | <5 | LD-3B-001 | N/A |
| 25/05/2011 | 10:02 | 11:02 | Sunny | 57.1 | 279.9 | 500 | Fruntion and loading activities | 23 | <5 | LD-3B-001 | N/A |
| 25/05/2011 | 11:02 | 12:02 | Sunny | 35.1 | 279.9 | 500 | Fruntion and loading activities | 23 | <5 | LD-3B-001 | N/A |
| 31/05/2011 | 08:50 | 09:50 | Sunny | 39.2 | 279.9 | 500 | Fruntion and loading activities | 26.7 | <5 | LD-3B-001 | N/A |
| 31/05/2011 | 09:50 | 10:50 | Sunny | 34.8 | 279.9 | 500 | Fruntion and loading activities | 26.7 | <5 | LD-3B-001 | N/A |
| 31/05/2011 | 10:50 | 11:50 | Sunny | 34.4 | 279.9 | 500 | Fruntion and loading activities | 26.7 | <5 | LD-3B-001 | N/A |
| | | | | Min. | 10.6 | | | | | | |
| | | | | Max. | 57.1 | | | | | | |
| | | | | Average | 29 | | | | | | |

Station CM_WF1a, The Wah Ming House

| Date | Start Time | Finish Time | Weather | TSP Concentration (µg/m ³) | Action Level (µg/m ³) | Limit Level (µg/m ³) | Site Conditions / Observations / Remarks | Temperature (°C) | Wind Speed (m/s) | Sampler ID | Filter ID |
|------------|------------|-------------|---------|--|-----------------------------------|----------------------------------|--|------------------|------------------|------------|-----------|
| 05/05/2011 | 09:30 | 10:30 | Fine | 70.8 | 284.5 | 500 | No major construction works | 27.3 | <5 | LD-3B-002 | N/A |
| 05/05/2011 | 10:30 | 11:30 | Fine | 94.8 | 284.5 | 500 | No major construction works | 27.3 | <5 | LD-3B-002 | N/A |
| 05/05/2011 | 11:30 | 12:30 | Fine | 71.4 | 284.5 | 500 | No major construction works | 27.3 | <5 | LD-3B-002 | N/A |
| 11/05/2011 | 13:40 | 14:40 | Sunny | 22.9 | 284.5 | 500 | No major construction works | 30 | <5 | LD-3B-002 | N/A |
| 11/05/2011 | 14:40 | 15:40 | Sunny | 23.4 | 284.5 | 500 | No major construction works | 30 | <5 | LD-3B-002 | N/A |
| 11/05/2011 | 15:40 | 16:40 | Sunny | 22.3 | 284.5 | 500 | No major construction works | 30 | <5 | LD-3B-002 | N/A |
| 17/05/2011 | 09:40 | 10:40 | Drizzle | 20.6 | 284.5 | 500 | No major construction works | 30 | <5 | LD-3B-002 | N/A |
| 17/05/2011 | 10:40 | 11:40 | Drizzle | 21.2 | 284.5 | 500 | No major construction works | 30 | <5 | LD-3B-002 | N/A |
| 17/05/2011 | 11:40 | 12:40 | Drizzle | 21.8 | 284.5 | 500 | No major construction works | 30 | <5 | LD-3B-002 | N/A |
| 23/05/2011 | 09:10 | 10:10 | Cloudy | 75.9 | 284.5 | 500 | No major construction works | 24.2 | <5 | LD-3B-002 | N/A |
| 23/05/2011 | 10:10 | 11:10 | Cloudy | 79.8 | 284.5 | 500 | No major construction works | 24.2 | <5 | LD-3B-002 | N/A |
| 23/05/2011 | 11:10 | 12:10 | Cloudy | 73.1 | 284.5 | 500 | No major construction works | 24.2 | <5 | LD-3B-002 | N/A |
| 27/05/2011 | 09:02 | 10:02 | Drizzle | 85.9 | 284.5 | 500 | No major construction works | 26.7 | <5 | LD-3B-002 | N/A |
| 27/05/2011 | 10:02 | 11:02 | Drizzle | 69.2 | 284.5 | 500 | No major construction works | 26.7 | <5 | LD-3B-002 | N/A |
| 27/05/2011 | 11:02 | 12:02 | Drizzle | 73.6 | 284.5 | 500 | No major construction works | 26.7 | <5 | LD-3B-002 | N/A |
| | | | | Min. | 20.6 | | | | | | |
| | | | | Max. | 94.8 | | | | | | |
| | | | | Average | 55 | | | | | | |

Station CM_AB1a, The Hong Kong Ice and Cold Storage (Aberdeen)

| Date | Start Time | Finish Time | Weather | TSP Concentration (µg/m ³) | Action Level (µg/m ³) | Limit Level (µg/m ³) | Site Conditions / Observations / Remarks | Temperature (°C) | Wind Speed (m/s) | Sampler ID | Filter ID |
|------------|------------|-------------|---------|--|-----------------------------------|----------------------------------|--|------------------|------------------|------------|-----------|
| 03/05/2011 | 13:05 | 14:05 | Sunny | 15.4 | 282.5 | 500 | Welding | 27.3 | <5 | LD-3B-001 | N/A |
| 03/05/2011 | 14:05 | 15:05 | Sunny | 13.5 | 282.5 | 500 | Welding | 27.3 | <5 | LD-3B-001 | N/A |
| 03/05/2011 | 15:05 | 16:05 | Sunny | 14.6 | 282.5 | 500 | Welding | 27.3 | <5 | LD-3B-001 | N/A |
| 09/05/2011 | 09:10 | 10:10 | Fine | 17.9 | 282.5 | 500 | Loading | 27.3 | <5 | LD-3B-001 | N/A |
| 09/05/2011 | 10:10 | 11:10 | Fine | 19.8 | 282.5 | 500 | Loading | 27.3 | <5 | LD-3B-001 | N/A |
| 09/05/2011 | 11:10 | 12:10 | Fine | 14.3 | 282.5 | 500 | Loading | 27.3 | <5 | LD-3B-001 | N/A |
| 13/05/2011 | 13:20 | 14:20 | Cloudy | 17.2 | 282.5 | 500 | Loading and shearing pin | 26.9 | <5 | LD-3B-001 | N/A |
| 13/05/2011 | 14:20 | 15:20 | Cloudy | 61.9 | 282.5 | 500 | Loading and shearing pin | 26.9 | <5 | LD-3B-001 | N/A |
| 13/05/2011 | 15:20 | 16:20 | Cloudy | 120.8 | 282.5 | 500 | Loading and shearing pin | 26.9 | <5 | LD-3B-001 | N/A |
| 19/05/2011 | 09:10 | 10:10 | Cloudy | 23.4 | 282.5 | 500 | Loading and operation of mobile crane | 25.8 | <5 | LD-3B-001 | N/A |
| 19/05/2011 | 10:10 | 11:10 | Cloudy | 28.2 | 282.5 | 500 | Loading and operation of mobile crane | 25.8 | <5 | LD-3B-001 | N/A |
| 19/05/2011 | 11:10 | 12:10 | Cloudy | 35.5 | 282.5 | 500 | Loading and operation of mobile crane | 25.8 | <5 | LD-3B-001 | N/A |
| 25/05/2011 | 13:20 | 14:20 | Sunny | 41.4 | 282.5 | 500 | Loading and operation of mobile crane | 23 | <5 | LD-3B-001 | N/A |
| 25/05/2011 | 14:20 | 15:20 | Sunny | 57.5 | 282.5 | 500 | Loading and operation of mobile crane | 23 | <5 | LD-3B-001 | N/A |
| 25/05/2011 | 15:20 | 16:20 | Sunny | 42.8 | 282.5 | 500 | Loading and operation of mobile crane | 23 | <5 | LD-3B-001 | N/A |
| 31/05/2011 | 13:12 | 14:12 | Sunny | 31.8 | 282.5 | 500 | Loading and operation of mobile crane | 26.7 | <5 | LD-3B-001 | N/A |
| 31/05/2011 | 14:12 | 15:12 | Sunny | 38.8 | 282.5 | 500 | Loading and operation of mobile crane | 26.7 | <5 | LD-3B-001 | N/A |
| 31/05/2011 | 15:12 | 16:12 | Sunny | 49.0 | 282.5 | 500 | Loading and operation of mobile crane | 26.7 | <5 | LD-3B-001 | N/A |
| | | | | Min. | 13.5 | | | | | | |
| | | | | Max. | 120.8 | | | | | | |
| | | | | Average | 36 | | | | | | |

24-hour TSP Monitoring Results

Station CM_FM1, Western Wholesale Food Market

| Date | Start | | Finish | | Weather | Filter Weight (g) | | Elapsed Time Reading | | Sampling Time (hrs) | Flow Rate (m ³ /min) | | | TSP Conc. (µg/m ³) | Action Level (µg/m ³) | Limit Level (µg/m ³) | Observations / Remarks | Sampler ID | Filter ID | | |
|-----------|-------|-----------|--------|--------|---|-------------------|---------|----------------------|-------|---------------------|---------------------------------|--------|---------|--------------------------------|-----------------------------------|----------------------------------|-------------------------------|------------|-----------|---|---|
| | Time | Date | Time | Date | | Initial | Final | Initial | Final | | Initial | Final | Average | | | | | | | | |
| 05-May-11 | 13:00 | 06-May-11 | 13:00 | Sunny | Power supply failure (The contractor propose some mitigation methods to minimize the power supply failure to both HVS and truck shop in FM) | | | | | | | | | | | | | | | 0 | 0 |
| 11-May-11 | 18:45 | 12-May-11 | 18:45 | Fine | 2.7546 | 2.8321 | 2303.93 | 2327.93 | 24.00 | 1.0154 | 1.0154 | 1.0154 | 53 | 188.5 | 260 | Grouting works | Western Wholesale Food Market | 590 | | | |
| 17-May-11 | 15:15 | 18-May-11 | 15:15 | Cloudy | 2.7533 | 2.8731 | 2330.92 | 2354.92 | 24.00 | 1.1308 | 1.1308 | 1.1308 | 74 | 188.5 | 260 | Grouting works | Western Wholesale Food Market | 587 | | | |
| 23-May-11 | 17:40 | 24-May-11 | 17:40 | Fine | 2.7331 | 2.8264 | 2357.93 | 2381.93 | 27.60 | 1.0303 | 1.0303 | 1.0303 | 63 | 188.5 | 260 | Grouting works | Western Wholesale Food Market | 604 | | | |
| 27-May-11 | 12:05 | 28-May-11 | 12:05 | Sunny | 2.7524 | 3.0067 | 2384.93 | 2408.93 | 27.60 | 1.1238 | 1.1238 | 1.1238 | 157 | 188.5 | 260 | Grouting works | Western Wholesale Food Market | 610 | | | |
| | | | | | | | | | | | | | Min. | 53 | | | | | | | |
| | | | | | | | | | | | | | Max. | 157 | | | | | | | |
| | | | | | | | | | | | | | Average | 87 | | | | | | | |

Station CM_CB1a, The Arcade, Cyberport

| Date | Start | | Finish | | Weather | Filter Weight (g) | | Elapsed Time Reading | | Sampling Time (hrs) | Flow Rate (m ³ /min) | | | TSP Conc. (µg/m ³) | Action Level (µg/m ³) | Limit Level (µg/m ³) | Observations / Remarks | Sampler ID | Filter ID |
|-----------|-------|-----------|--------|---------|---------|-------------------|---------|----------------------|-------|---------------------|---------------------------------|--------|---------|--------------------------------|-----------------------------------|----------------------------------|------------------------|------------|-----------|
| | Time | Date | Time | Date | | Initial | Final | Initial | Final | | Initial | Final | Average | | | | | | |
| 05-May-11 | 08:00 | 06-May-11 | 08:00 | Fine | 2.7418 | 2.8656 | 2586.67 | 2610.67 | 24.00 | 1.0018 | 1.0018 | 1.0018 | 86 | 178.1 | 260 | Mud out | Arcade | 582 | |
| 11-May-11 | 08:00 | 12-May-11 | 08:00 | Fine | 2.7473 | 2.7998 | 2610.67 | 2634.67 | 24.00 | 1.0902 | 1.0902 | 1.0902 | 33 | 178.1 | 260 | Excavation | Arcade | 586 | |
| 17-May-11 | 08:00 | 18-May-11 | 08:00 | Cloudy | 2.7326 | 2.7979 | 2634.67 | 2658.67 | 24.00 | 1.1011 | 1.1011 | 1.1011 | 41 | 178.1 | 260 | Excavation | Arcade | 593 | |
| 23-May-11 | 08:00 | 24-May-11 | 08:00 | Fine | 2.7323 | 2.8856 | 2658.67 | 2682.67 | 24.00 | 1.1228 | 1.1228 | 1.1228 | 95 | 178.1 | 260 | Excavation | Arcade | 599 | |
| 27-May-11 | 08:00 | 28-May-11 | 08:00 | Drizzle | 2.7309 | 2.8937 | 2682.67 | 2706.67 | 24.00 | 1.1189 | 1.1189 | 1.1189 | 101 | 178.1 | 260 | Excavation | Arcade | 605 | |
| | | | | | | | | | | | | | Min. | 33 | | | | | |
| | | | | | | | | | | | | | Max. | 101.0 | | | | | |
| | | | | | | | | | | | | | Average | 71.3 | | | | | |

Station CM_WF1a, The Wah Ming House


| Date | Start | | Finish | | Weather | Filter Weight (g) | | Elapsed Time Reading | | Sampling Time (hrs) | Flow Rate (m ³ /min) | | | TSP Conc. (µg/m ³) | Action Level (µg/m ³) | Limit Level (µg/m ³) | Observations / Remarks | Sampler ID | Filter ID |
|-----------|-------|-----------|--------|---------|-------------|-------------------|---------|----------------------|-------|---------------------|---------------------------------|--------|---------|--------------------------------|-----------------------------------|----------------------------------|------------------------|------------|-----------|
| | Time | Date | Time | Date | | Initial | Final | Initial | Final | | Initial | Final | Average | | | | | | |
| 05-May-11 | 13:00 | 06-May-11 | 13:00 | Fine | 2.7435 | 2.8134 | 2254.86 | 2278.86 | 24.00 | 1.0690 | 1.0690 | 1.0690 | 45 | 185.3 | 260 | no works in progress | Wah Fu | 584 | |
| 11-May-11 | 17:00 | 12-May-11 | 17:00 | Fine | 2.7403 | 2.7668 | 2278.86 | 2302.86 | 24.00 | 0.8370 | 0.8370 | 0.8370 | 22 | 185.3 | 260 | no works in progress | Wah Fu | 592 | |
| 17-May-11 | 13:23 | 18-May-11 | 13:23 | Cloudy | supply fail | 0 | 0.00 | 0.00 | 0.00 | 0.0000 | 0.0000 | 0.0000 | 0 | 0 | 0 | 0 | 0 | 0 | |
| 23-May-11 | 12:20 | 24-May-11 | 12:20 | Fine | 2.7453 | 2.8564 | 2326.85 | 2350.85 | 24.00 | 1.0667 | 1.0667 | 1.0667 | 72 | 185.3 | 260 | no works in progress | Wah Fu | 600 | |
| 27-May-11 | 13:00 | 28-May-11 | 13:00 | Drizzle | 2.7347 | 2.8914 | 2350.85 | 2374.85 | 24.00 | 1.0634 | 1.0634 | 1.0634 | 102 | 185.3 | 260 | no works in progress | Wah Fu | 611 | |
| | | | | | | | | | | | | | Min. | 0 | | | | | |
| | | | | | | | | | | | | | Max. | 102 | | | | | |
| | | | | | | | | | | | | | Average | 48 | | | | | |


Station CM_AB1a, The Hong Kong Ice and Cold Storage (Aberdeen)


| Date | Start | | Finish | | Weather | Filter Weight (g) | | Elapsed Time Reading | | Sampling Time (hrs) | Flow Rate (m ³ /min) | | | TSP Conc. (µg/m ³) | Action Level (µg/m ³) | Limit Level (µg/m ³) | Observations / Remarks | Sampler ID | Filter ID |
|-----------|-------|-----------|--------|---------|---------|-------------------|---------|----------------------|-------|---------------------|---------------------------------|--------|---------|--------------------------------|-----------------------------------|----------------------------------|------------------------|------------|-----------|
| | Time | Date | Time | Date | | Initial | Final | Initial | Final | | Initial | Final | Average | | | | | | |
| 05-May-11 | 08:00 | 06-May-11 | 08:00 | Fine | 2.7452 | 2.8375 | 2481.57 | 2505.57 | 24.00 | 0.8955 | 0.8955 | 0.8955 | 72 | 174.2 | 260.00 | Welding | Ice Factory | 583 | |
| 11-May-11 | 08:00 | 12-May-11 | 08:00 | Cloudy | 2.7333 | 2.8755 | 2505.57 | 2529.57 | 24.00 | 0.8873 | 0.8873 | 0.8873 | 111 | 174.2 | 260 | Welding | Ice Factory | 585 | |
| 17-May-11 | 08:00 | 18-May-11 | 08:00 | Cloudy | 2.7296 | 2.7997 | 2529.57 | 2553.57 | 24.00 | 0.9452 | 0.9452 | 0.9452 | 52 | 174.2 | 260 | Rock drilling | Ice Factory | 594 | |
| 23-May-11 | 08:00 | 24-May-11 | 08:00 | Fine | 2.7393 | 2.8506 | 2553.57 | 2577.57 | 24.00 | 0.9428 | 0.9428 | 0.9428 | 82 | 174.2 | 260 | Rock drilling | Ice Factory | 598 | |
| 27-May-11 | 08:00 | 28-May-11 | 08:00 | Drizzle | 2.7401 | 2.8748 | 2577.57 | 2601.57 | 24.00 | 0.9398 | 0.9398 | 0.9398 | 100 | 174.2 | 260 | Loading | Ice Factory | 606 | |
| | | | | | | | | | | | | | Min. | 72 | | | | | |
| | | | | | | | | | | | | | Max. | 111 | | | | | |
| | | | | | | | | | | | | | Average | 83 | | | | | |


APPENDIX K


GRAPHICAL PRESENTATION OF AIR QUALITY MONITORING DATA

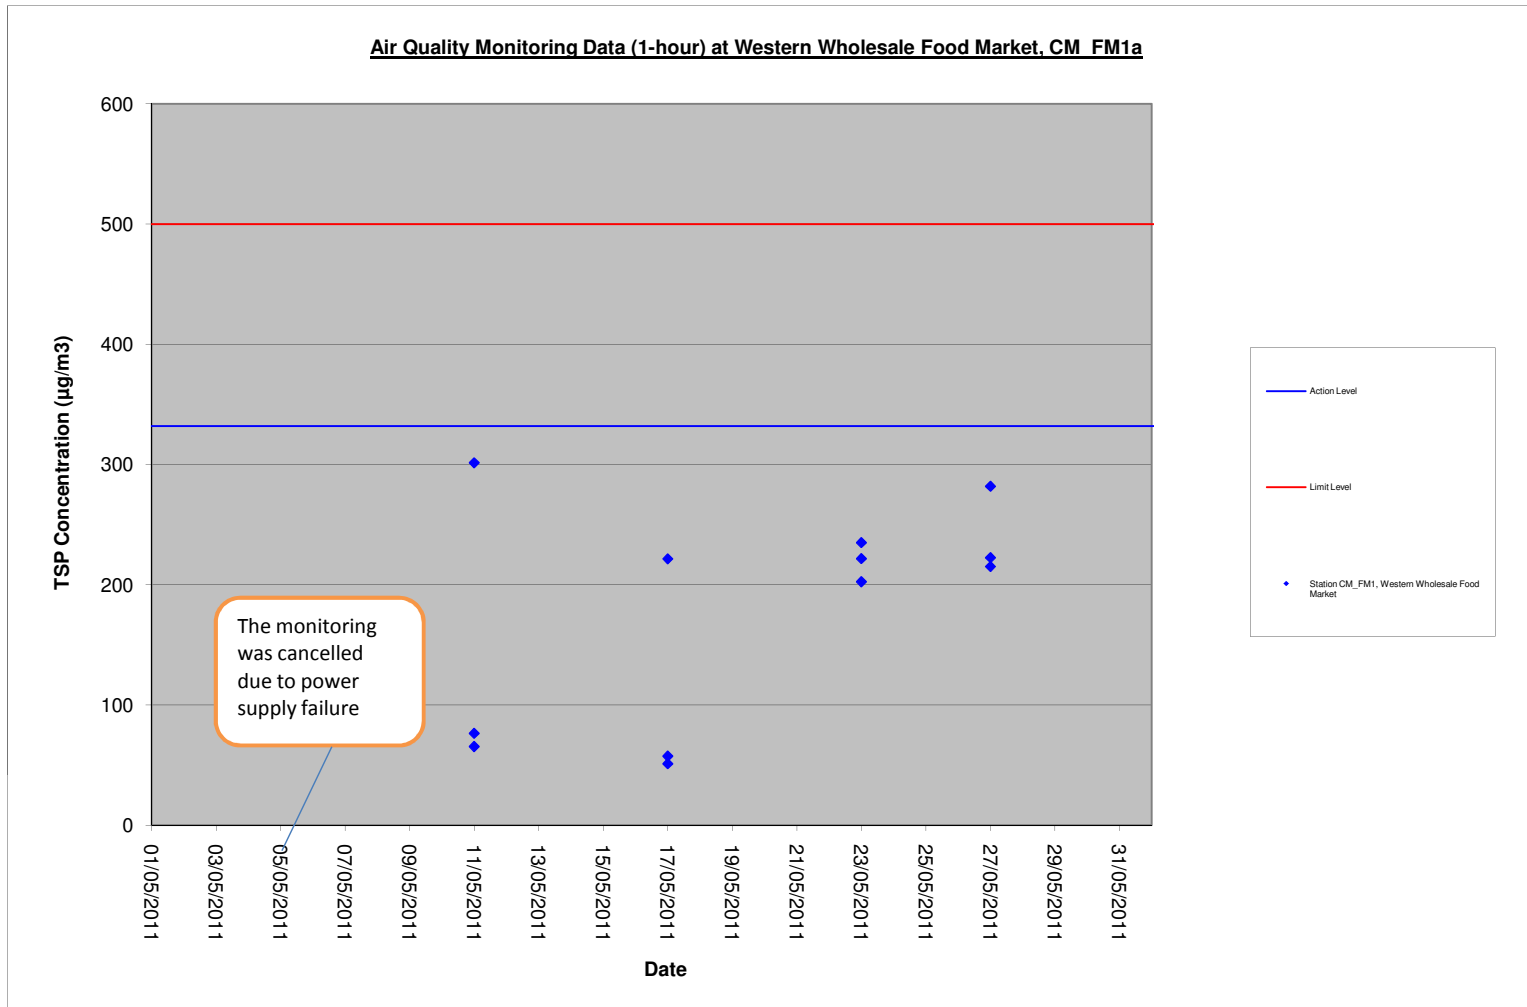


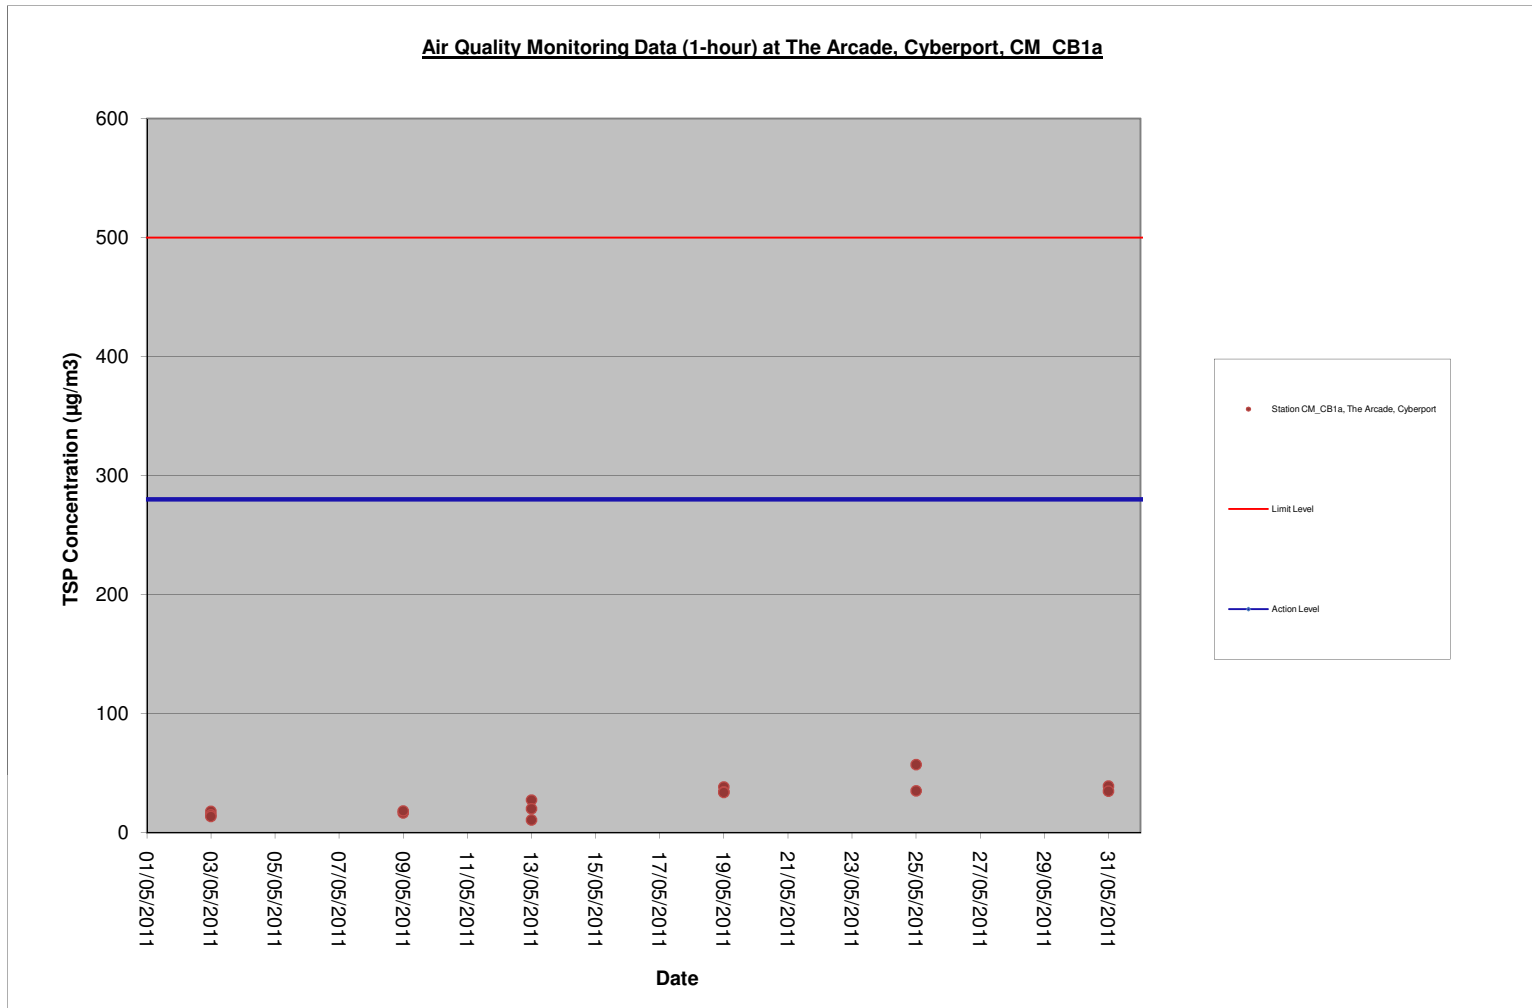


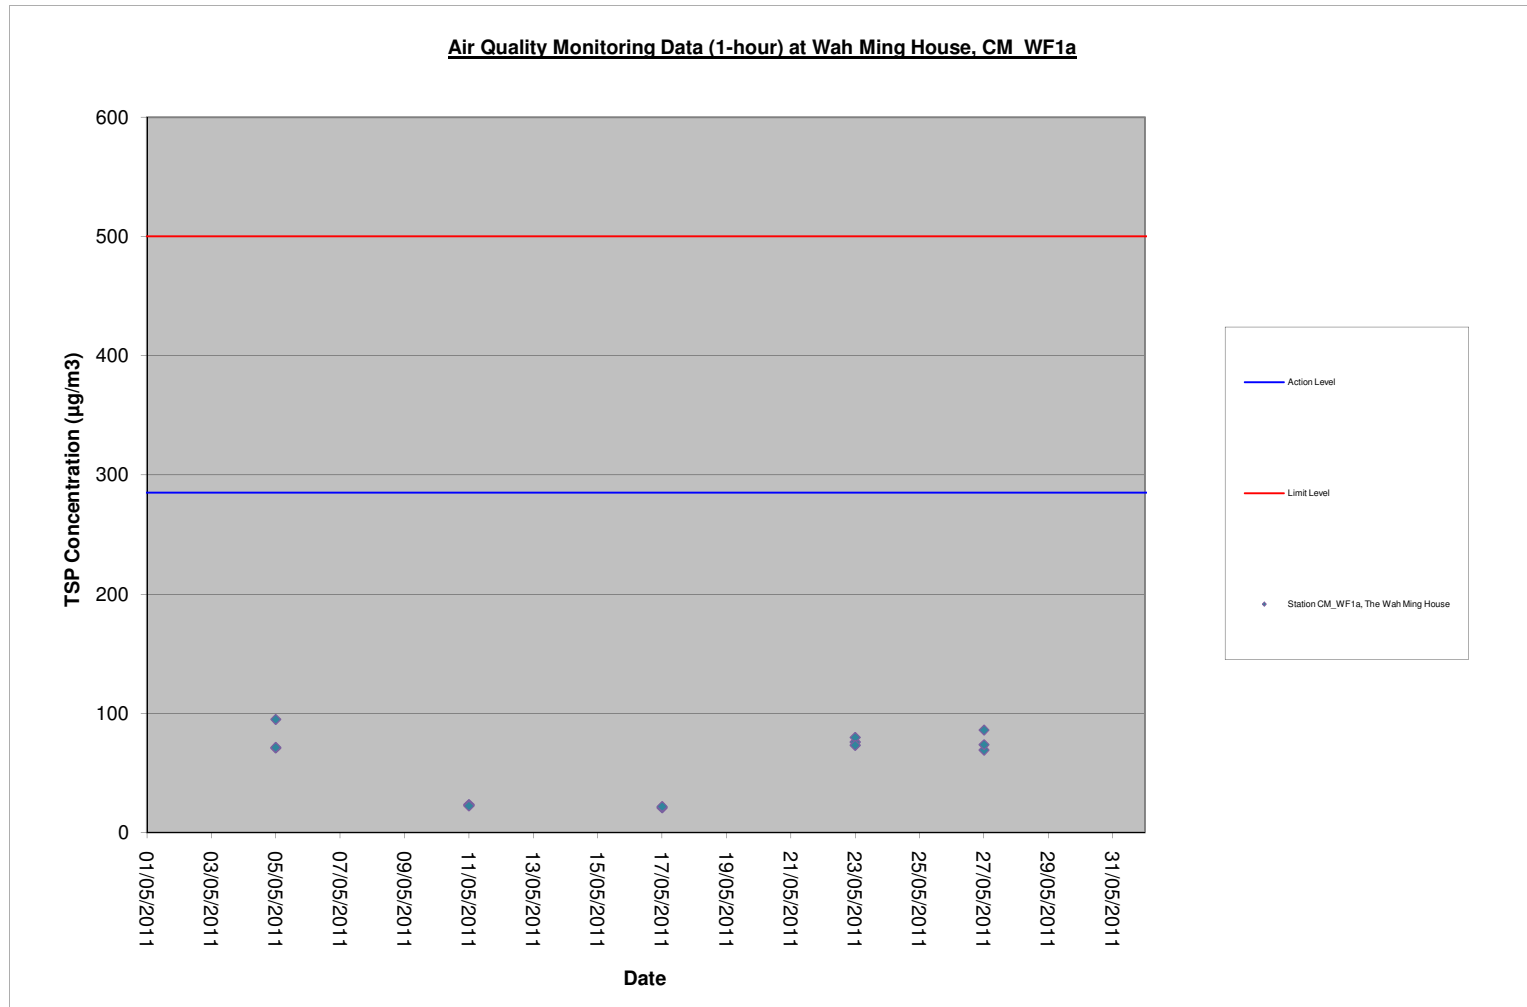


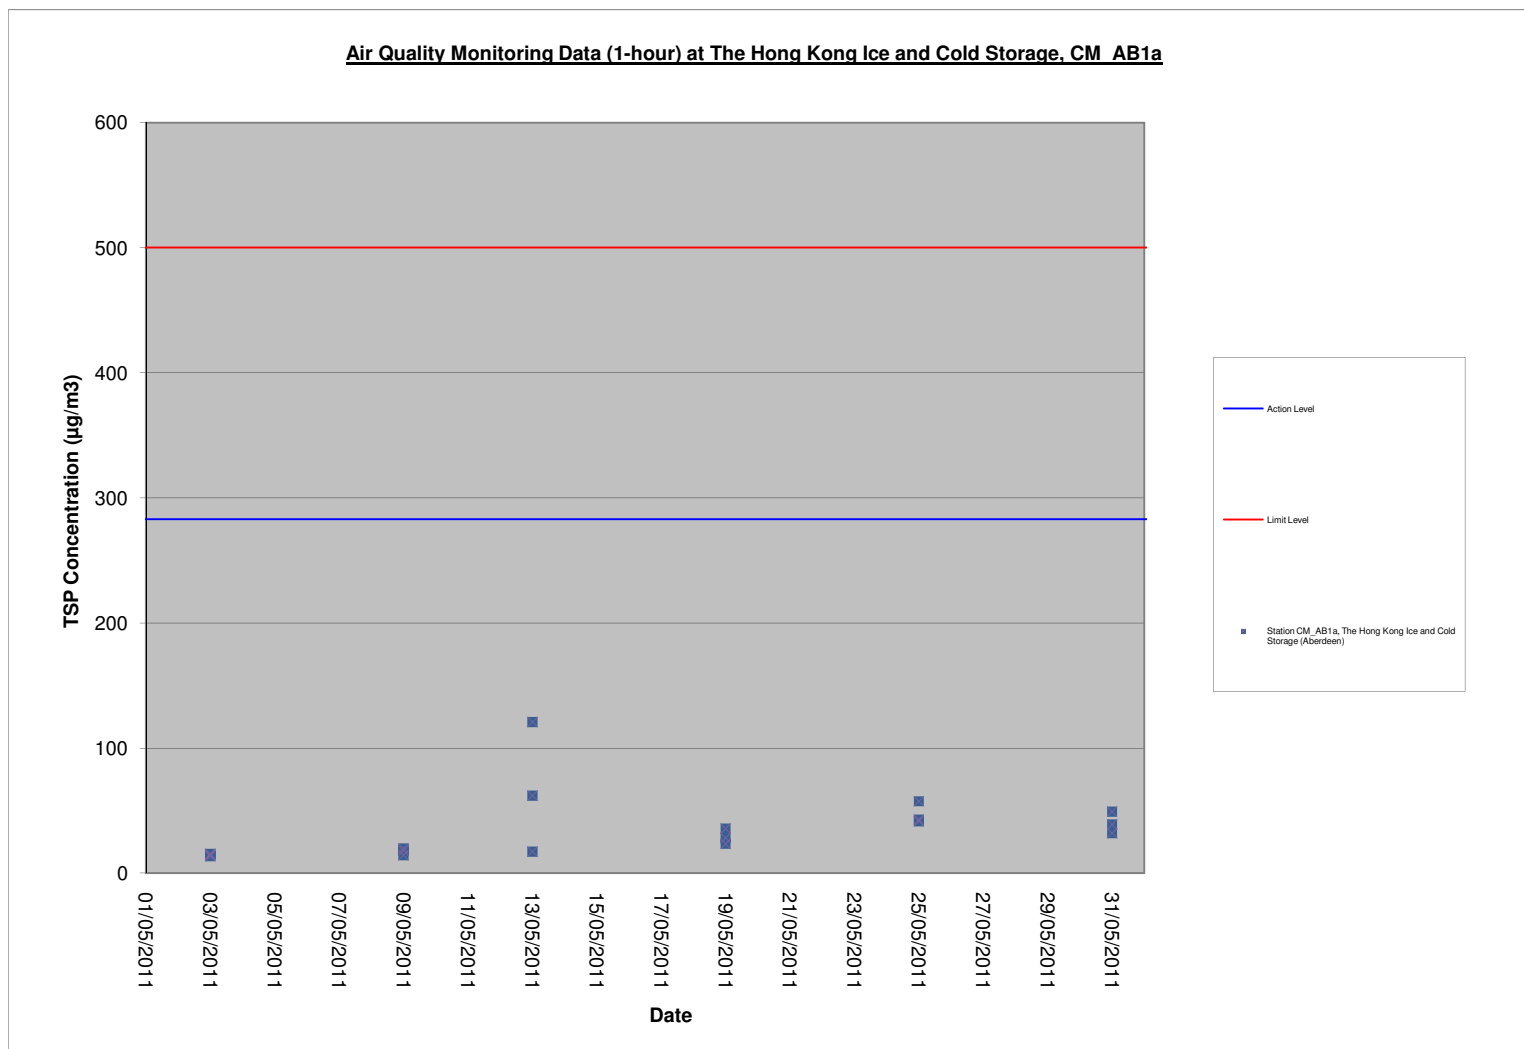

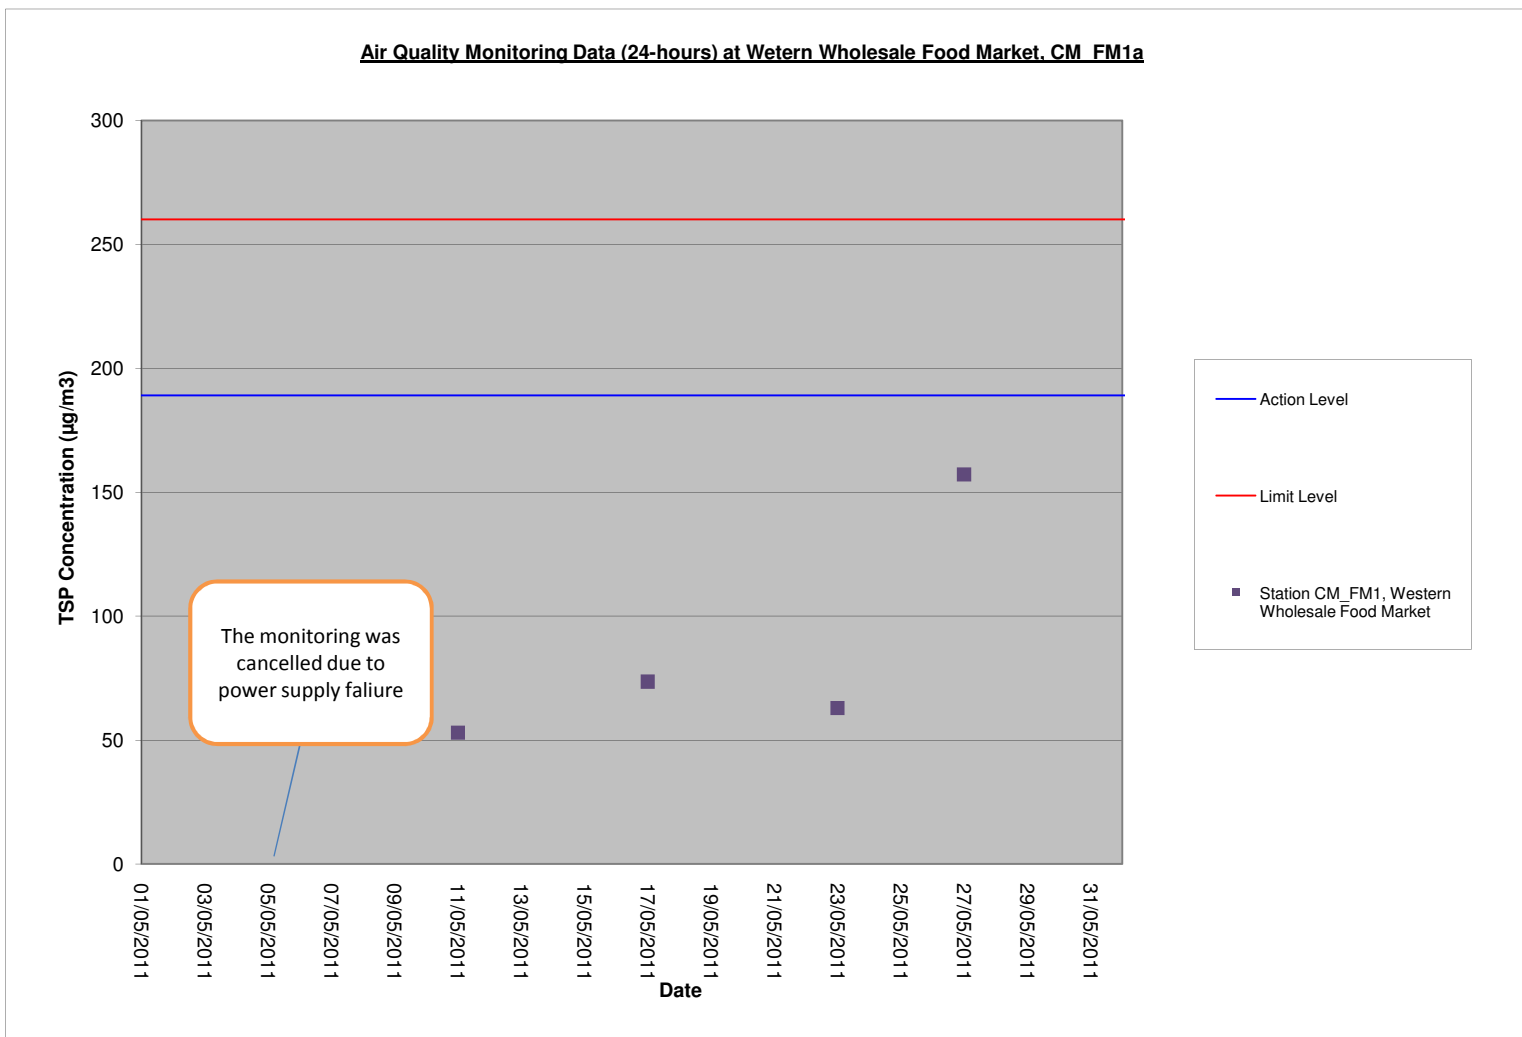

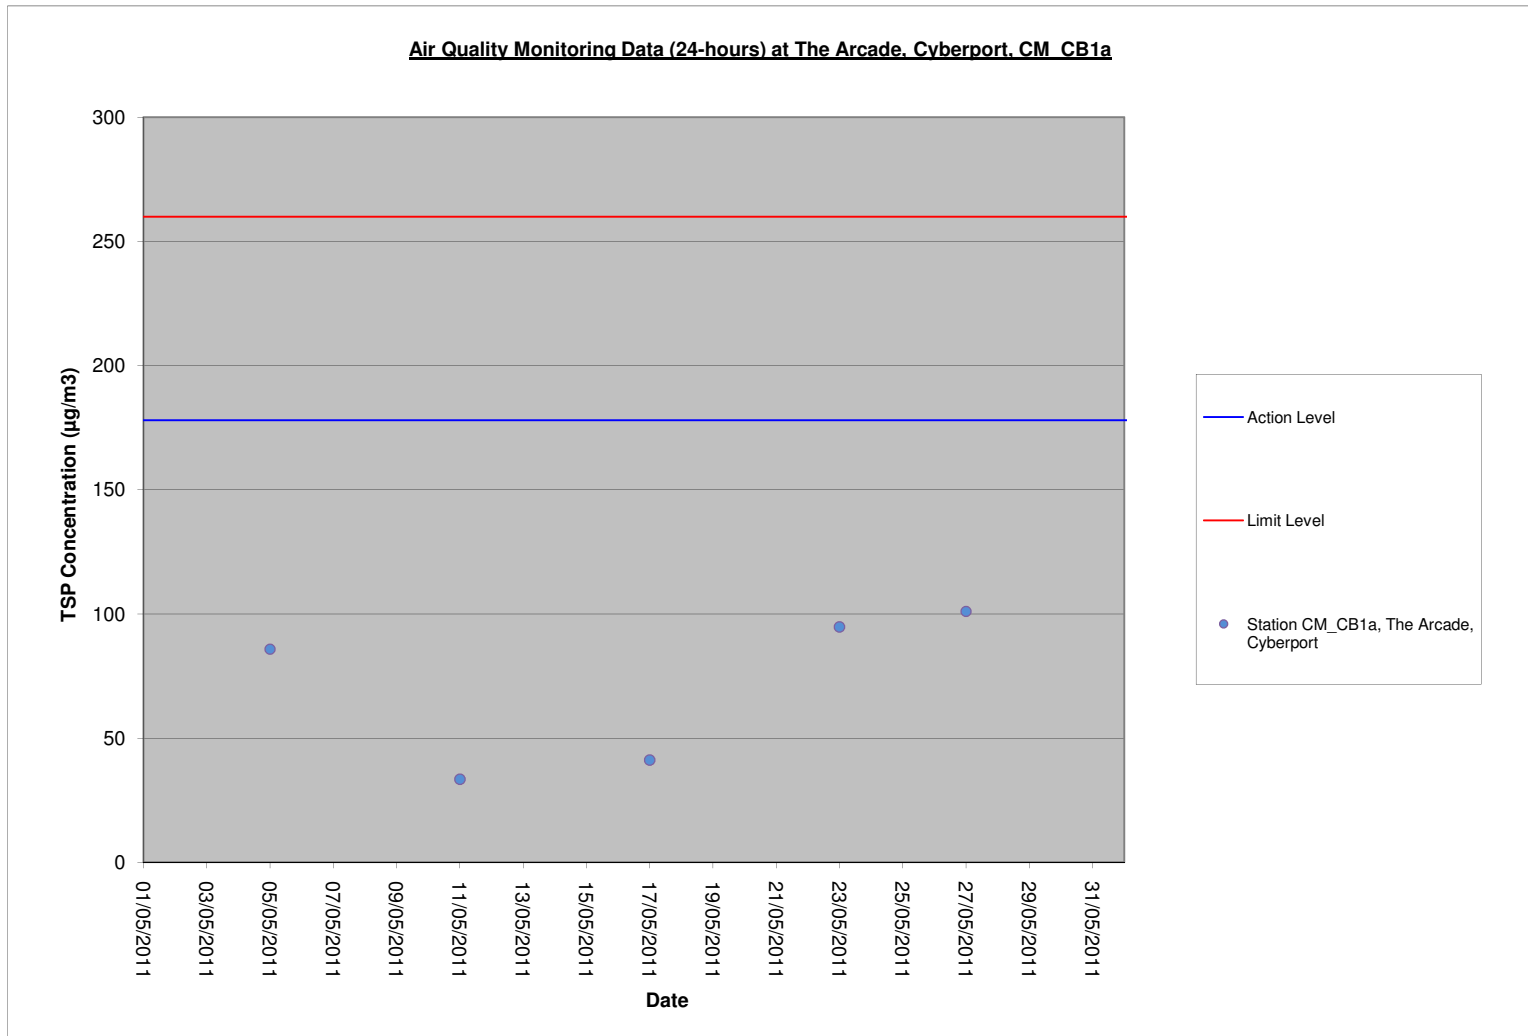

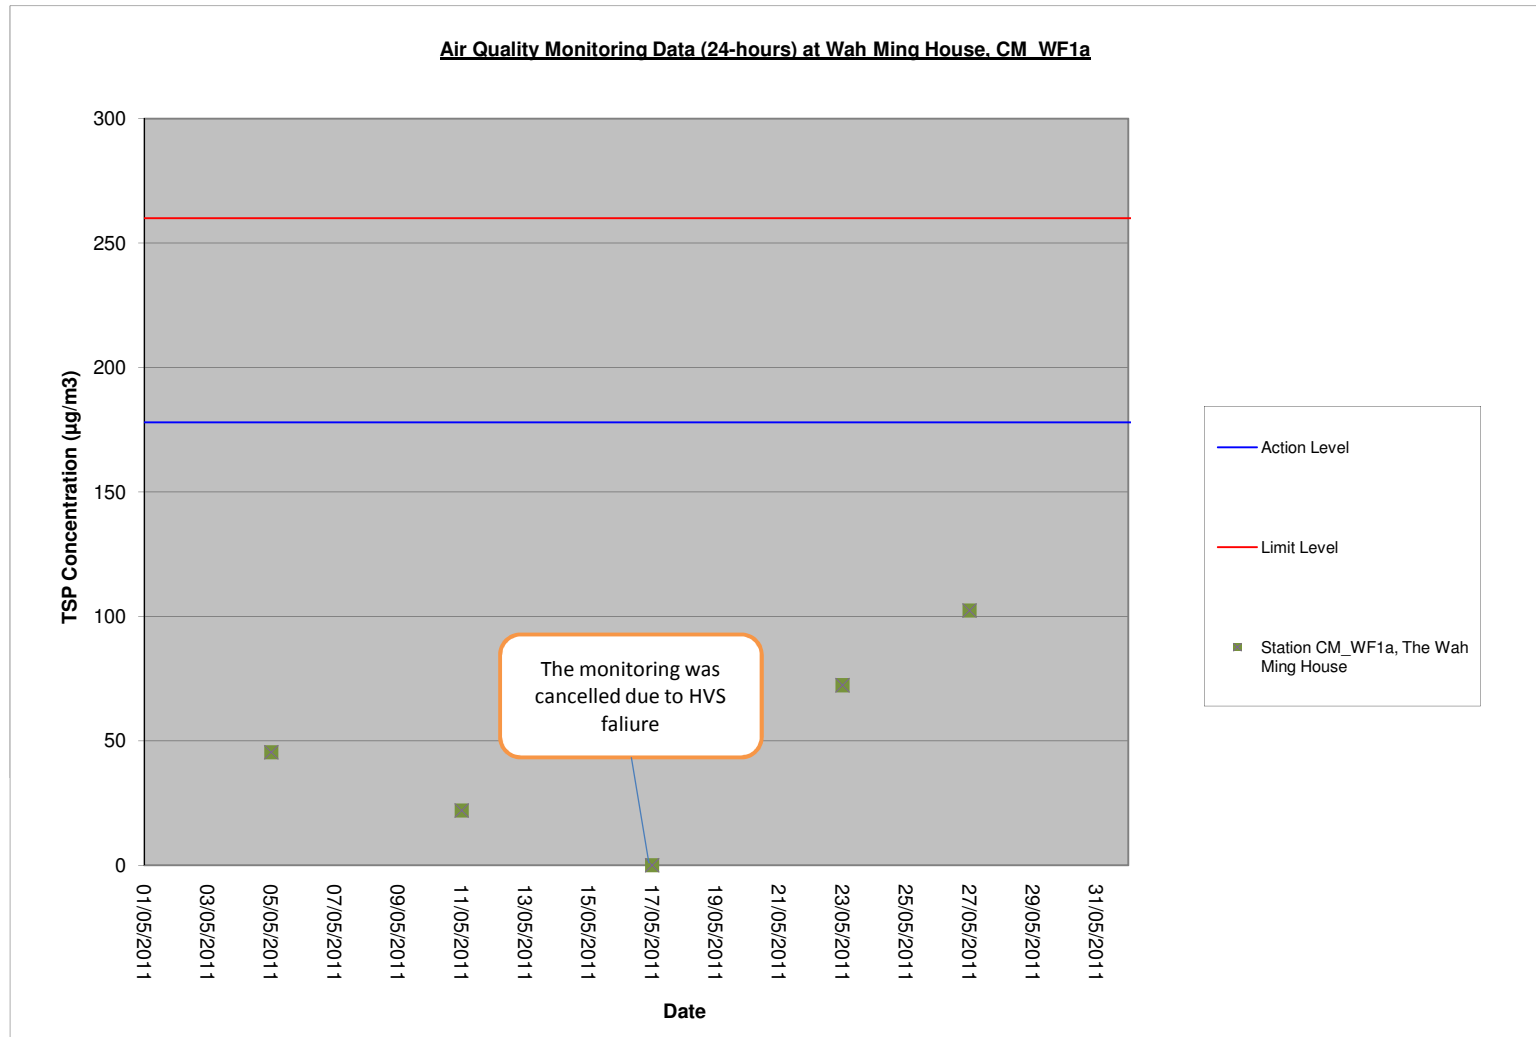

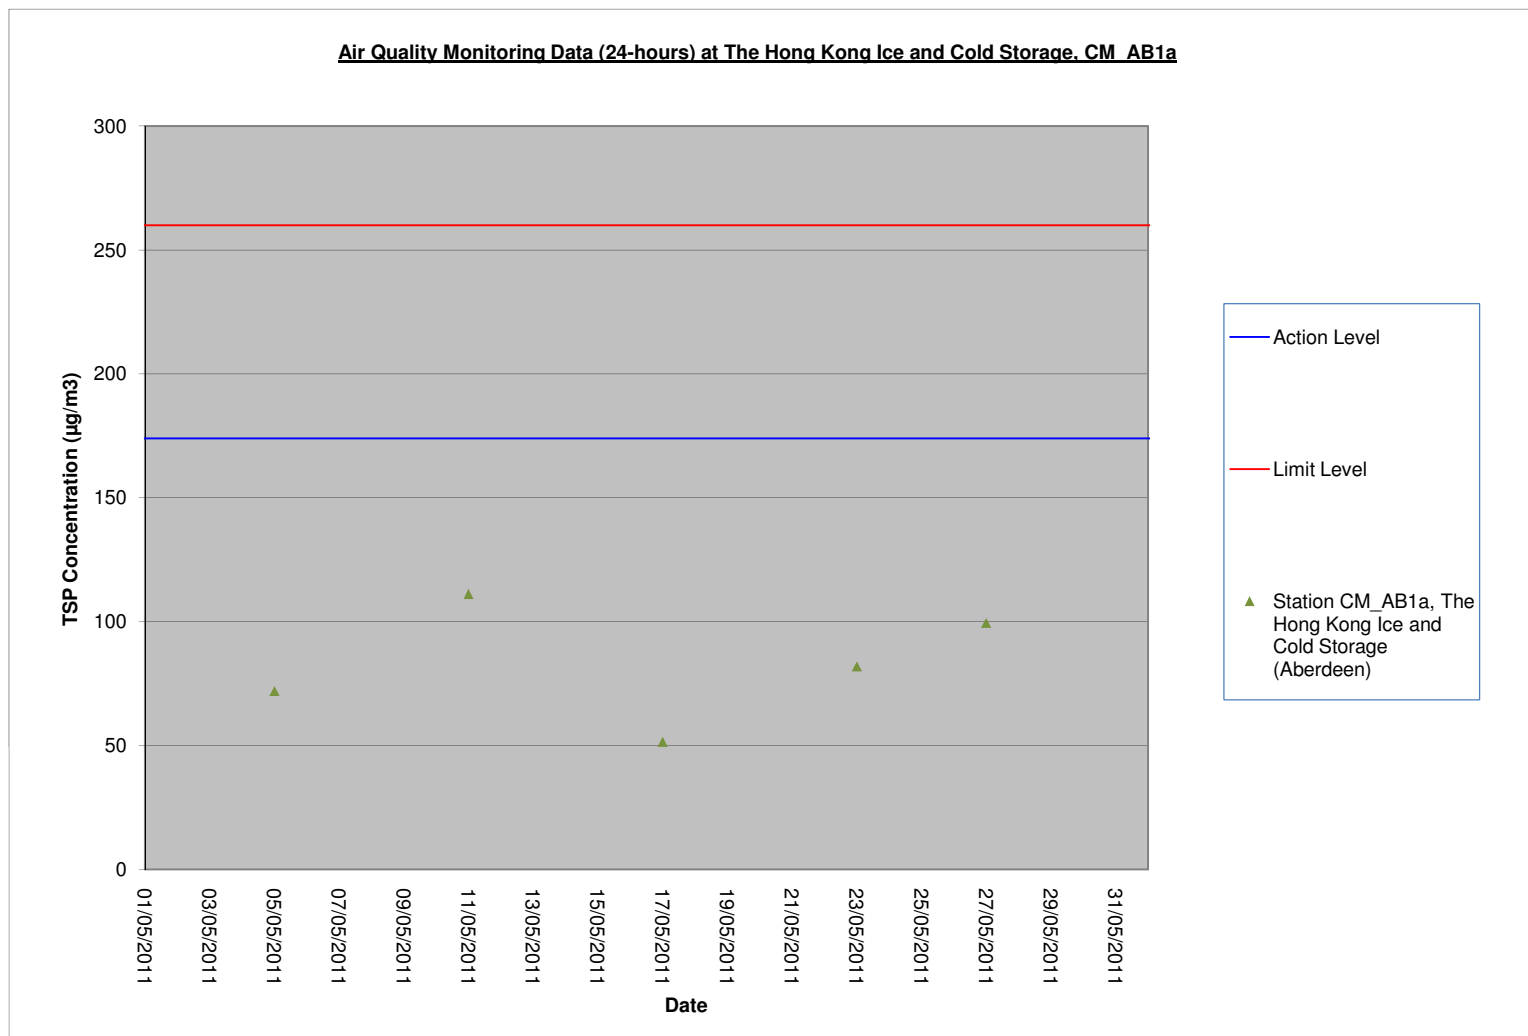

APPENDIX L

LANDSCAPE AND VISUAL MONITORING REPORT

Leighton - LNS Joint Venture

Contract No. DC/2007/24
Harbour Area Treatment Scheme
Stage 2A - Construction of Sewage
Conveyance System from
Aberdeen to Sai Ying Pun:
*17th Monthly Landscape & Visual
Monitoring Report*

May 2011

Environmental Resources Management

21/F Lincoln House
979 King's Road
Taikoo Place
Island East, Hong Kong
Telephone: (852) 2271 3000
Facsimile: (852) 2723 5660
E-mail: post.hk@erm.com
<http://www.erm.com>

Leighton - LNS Joint Venture

Contract No. DC/2007/24
Harbour Area Treatment Scheme
Stage 2A - Construction of Sewage
Conveyance System from
Aberdeen to Sai Ying Pun:
*17th Monthly Landscape & Visual
Monitoring Report*

May 2011


Reference 0109356

For and on behalf of ERM-Hong Kong, Limited

Approved by: Frank Wan

Signed: 

Position: Partner

Certified by: 
Registered Landscape Architect,
Christina Ip

Date: 03 June 2011

CONTENTS

| | | |
|------------|---|----------|
| 1 | IMPACT LANDSCAPE AND VISUAL MONITORING | 1 |
| 1.1 | INTRODUCTION | 1 |
| 1.2 | MONITORING PARAMETERS | 1 |
| 1.3 | SITE AUDIT FINDINGS AND OBSERVATIONS | 2 |
| 2 | CONCLUSIONS | 3 |

ANNEXES

- Annex A Landscape Mitigation Measures (Reference to Approved EIA Report (EIA-148/2008))*
- Annex B Site Inspection Checklist*

1.1 INTRODUCTION

The construction works of DC/2007/24 of Harbour Area Treatment Scheme Stage 2A (HATS2A) - Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun (the Project) commenced on 23 December 2009. This is the seventeenth monthly impact landscape and visual (L&V) monitoring report presenting the monthly L&V site audit findings conducted during the period from 1 May to 31 May 2011.

1.2 MONITORING PARAMETERS

According to the EM&A Manual, the L&V monitoring should include checking of the design and auditing of the implementation and maintenance of L&V mitigation measures to ensure that they are undertaken in accordance with the recommendations of the approved EIA Report (EIA-148/2008).

The seventeenth monthly site audit was undertaken on 31 May 2011 to check the design, implementation and maintenance of the L&V mitigation measures at work sites in Aberdeen, Wah Fu, Cyberport, Sandy Bay and Sai Ying Pun.

The proposed L&V mitigation measures during the construction phase recommended in the approved EIA Report (EIA-148/2008) are listed in *Table 1.1* and shown in *Annex A*.

Table 1.1 Proposed Landscape Mitigation Measures for Construction Phase

| ID No. | Landscape and Visual Mitigation Measures | Sites |
|--------|---|---|
| CM1 | Topsoil, where identified, should be stripped and stored for re-use in the construction of the soft landscape works, where practical. | Aberdeen, Wah Fu, Cyberport, Sandy Bay and Sai Ying Pun |
| CM2 | Existing trees to be retained on site should be carefully protected during construction. | Aberdeen, Wah Fu, Cyberport, Sandy Bay |
| CM3 | Trees unavoidably affected by the works should be transplanted where practical. | Aberdeen, Cyberport, Sandy Bay |
| CM4 | Compensatory tree planting should be provided to compensate for felled trees. | Aberdeen, Cyberport, Sandy Bay |
| CM5 | Control of night-time lighting. | Aberdeen, Wah Fu, Cyberport, Sandy Bay and Sai Ying Pun |
| CM6 | Erection of decorative screen hoarding compatible with the surrounding setting. | Aberdeen, Wah Fu, Cyberport, Sandy Bay and Sai Ying Pun |

1.3

SITE AUDIT FINDINGS AND OBSERVATIONS

The findings and observations of the site audit are recorded and summarised in *Annex B*.

The seventeenth monthly landscape and visual site audit was undertaken on 31 May 2011 to check the design, implementation and maintenance of L&V mitigation measures at work sites in Aberdeen, Wah Fu, Cyberport, Sandy Bay and Sai Ying Pun under the Contract *DC/2007/24 of Harbour Area Treatment Scheme Stage 2A (HATS2A) - Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun*.

2.1***FOLLOW-UP ACTIONS TAKEN AFTER PREVIOUS SITE AUDIT***

Health condition of retained trees T036(R), T037(R) and T018(R) were showing poor health condition due to previously observed formation of stagnant water in Sandy Bay site. For general tree issues from the previous site audits (ie, poor health condition of transplanted trees and stored construction materials and debris close to the roots of retained trees) follow up actions still remain outstanding at Sand Bay site.

2.2***OBSERVATIONS AND RECOMMENDATIONS***

All L&V mitigation measures presented in *Table 1.1* have been implemented in full except for CM2 and CM3 at Sandy Bay.

Sandy Bay Site

The construction materials and debris stored very near to the roots of the retained trees T027(R) and T028(R) were still observed. The Contractor was advised to remove the construction materials and debris stored near the roots of the retained trees immediately and to ensure its health condition.

Transplanted trees T004 (T) and T005 (T) were still found to be in very poor health condition or it might be dead since the last five monthly audits. The Contractor was advised to take appropriate actions to restore the health condition of the transplanted trees or replace it if confirmed dead.

It was also observed that retained trees T036(R), T037(R) and T018(R) were showing poor health condition due to stagnant water formation in the area. This amount of water came from washing construction machines, etc. in the area. The Contractor was advised to divert the water from the retained trees and avoid the formation of stagnant water that might affect the roots of the retained trees.

Annex A

Landscape Mitigation
Measures
(Reference to Approved EIA
Report (EIA-148/2008))

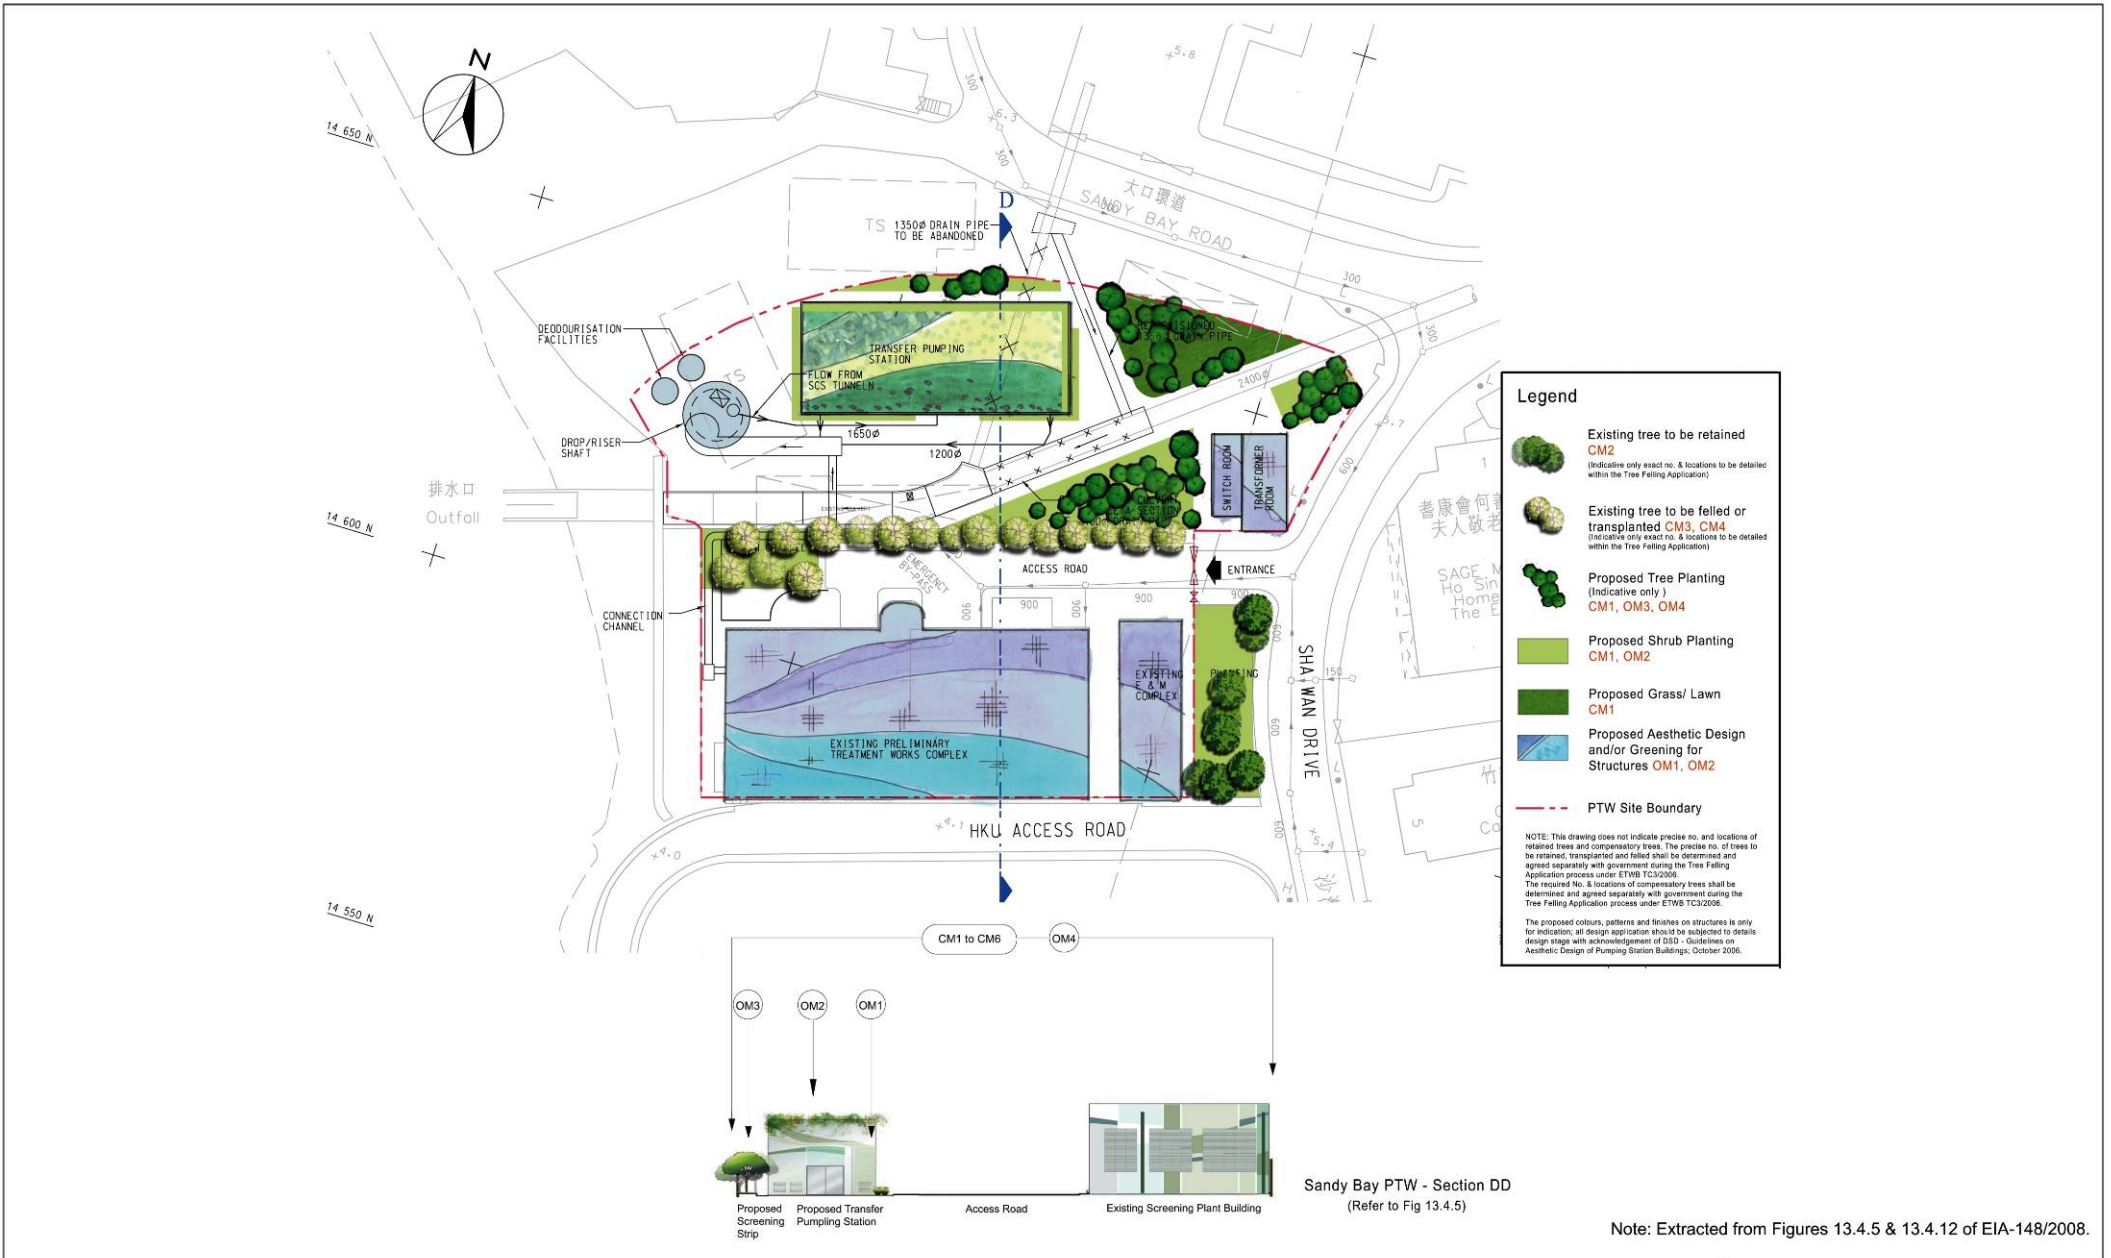


Figure 1.1 Landscape Mitigation Measure in Sandy Bay


FILE: 0109356-ILV-SB-Fig1.1
DATE: 30 March 2010



Note: Extracted from Figures 13.4.6 & 13.4.13 of EIA-148/2008.

Figure 1.2



Landscape Mitigation Measure in Cyberport

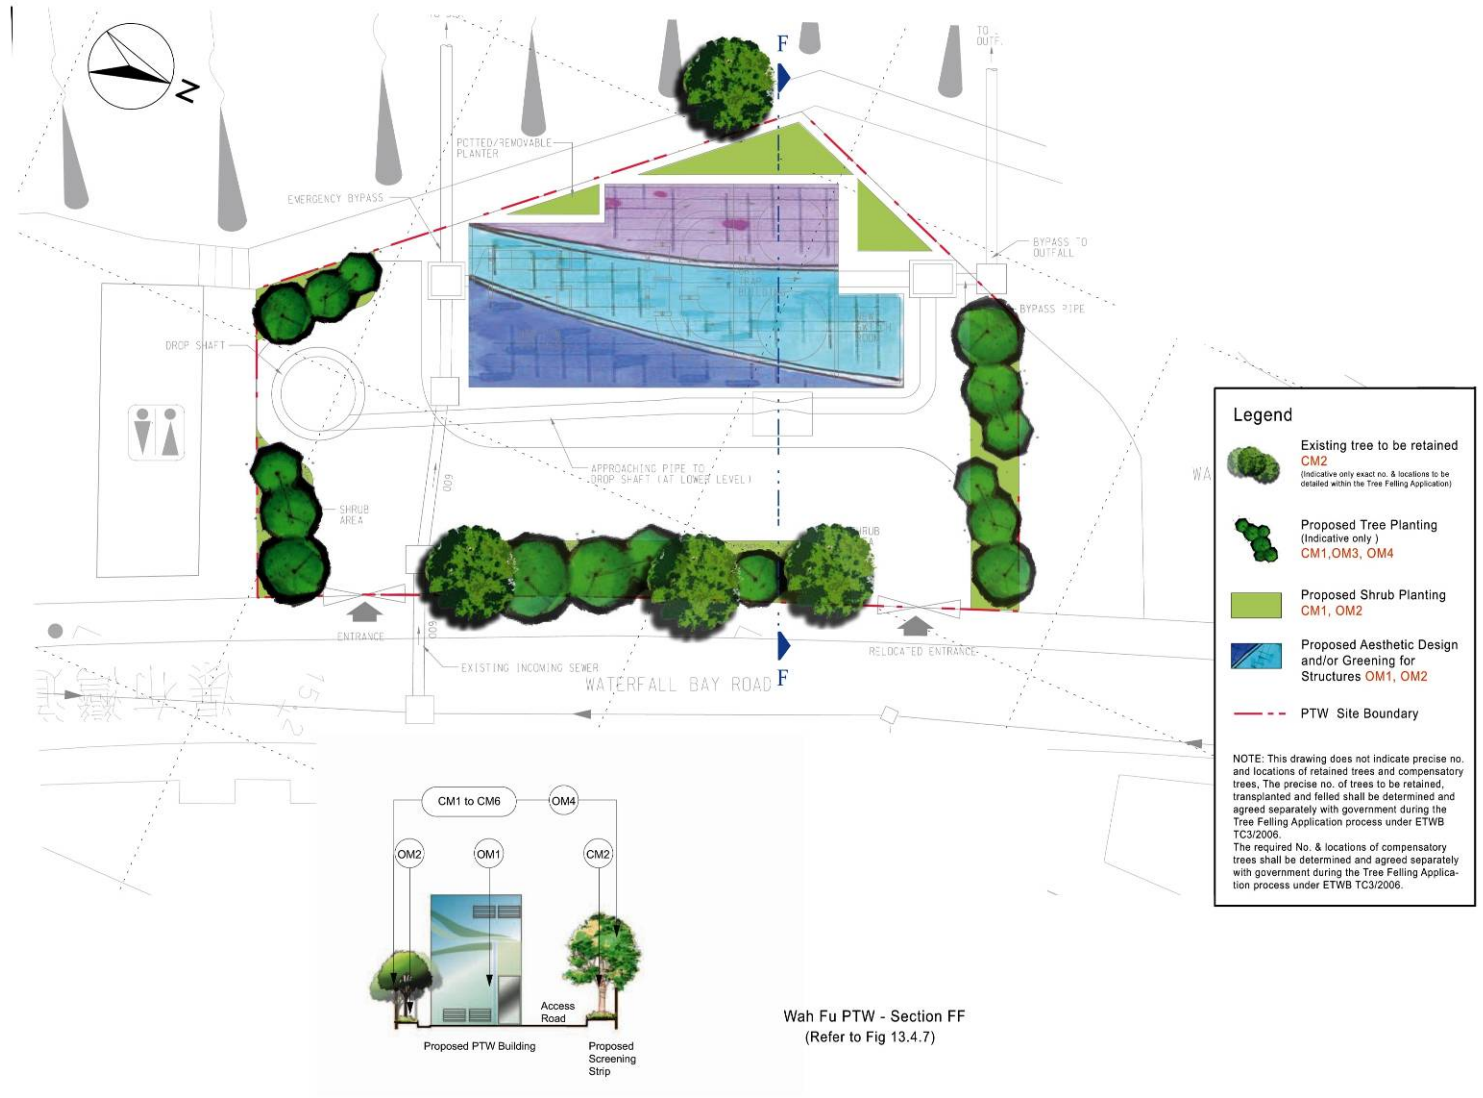

Note: Extracted from Figures 13.4.7 & 13.4.13 of EIA-148/2008.

Figure 1.3

Landscape Mitigation Measure in Wah Fu

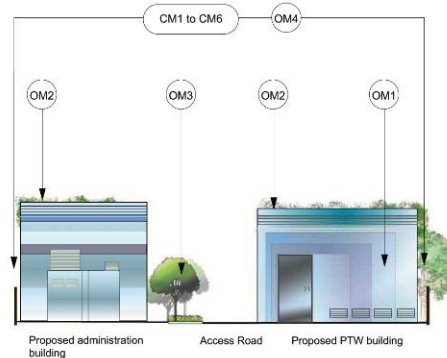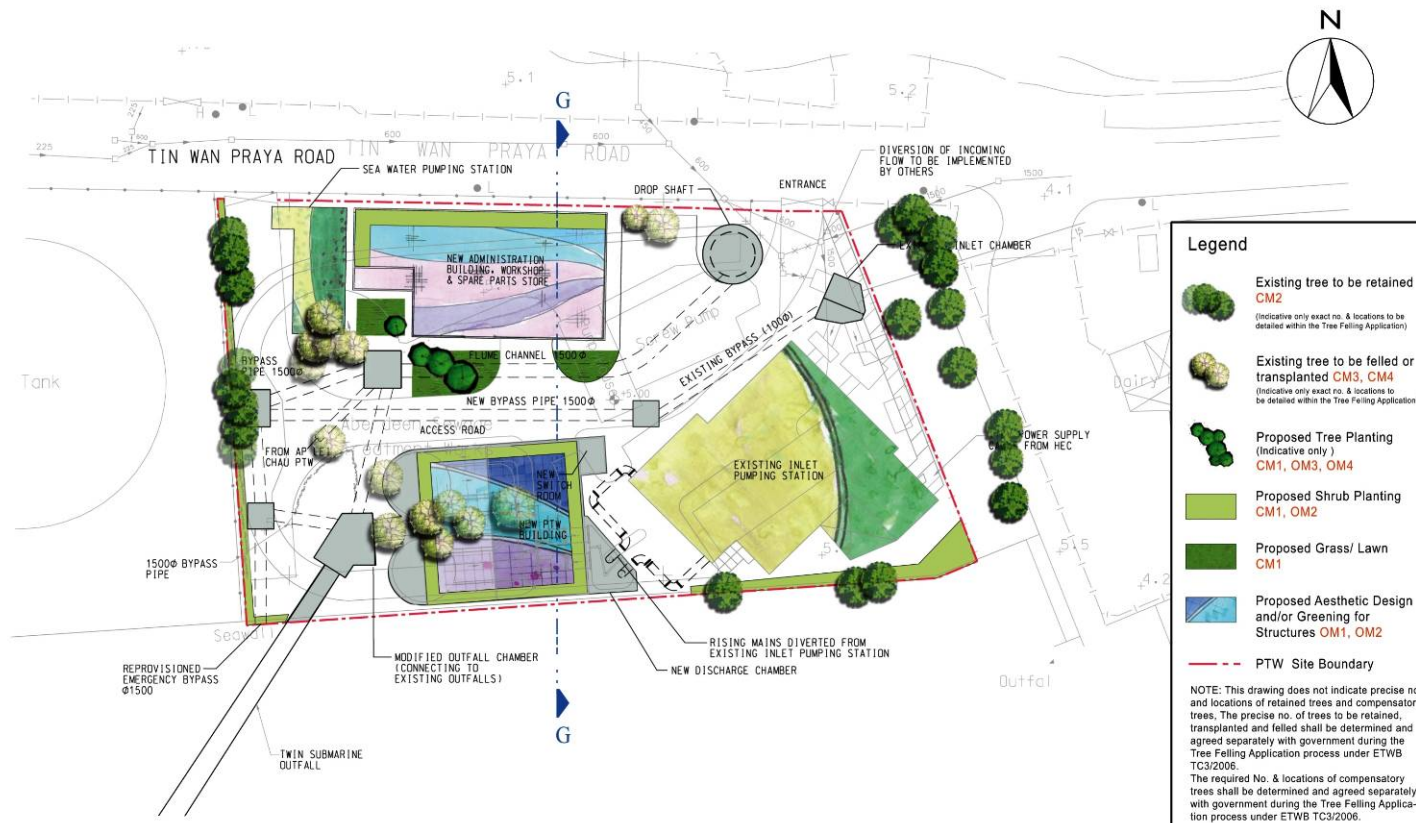

Aberdeen PTW - Section GG
(Refer to Fig 13.4.8)

Note: Extracted from Figures 13.4.8 & 13.4.14 of EIA-148/2008.


Figure 1.4

Landscape Mitigation Measure in Aberdeen

Annex B

Site Inspection Checklist

Harbour Area Treatment Scheme (HATS) Stage 2A
 Contract No. DC/2007/24
 Construction of Sewage Conveyance from Aberdeen to Sai Ying Pun
 Landscape & Visual Monitoring Report



Reporting Period : 1 May to 31 May 2011
 Site Inspection Date : 31 May 2011
 Inspected By : Jon Binalay

| Site | CM1 Topsoil identified stripped and stored for re-use in the construction of soft landscape works, where practical | CM2 Existing trees to be retained on site should be carefully protected during construction | CM3 Trees unavoidably affected by the works should be transplanted where practical. | CM4 Compensatory tree planting should be provided to compensate for felled trees. | CM5 Control of night-time lighting. | CM6 Erection of decorative screen hoarding compatible with the surrounding setting. | Recommendations |
|--------------|---|--|--|--|---|--|--|
| Sai Ying Pun | No major excavation works were conducted. No stockpile of excavated soil was observed. | Not Applicable - No tree was identified at the Sai Ying Pun Area | Not Applicable - No tree was identified at the Sai Ying Pun Area | Not applicable - No tree was identified at the Sai Ying Pun Area | Not applicable - No night-time lighting was used. | Decorative screen hoarding were erected and was compatible to the surrounding setting. | Not required |
| Sandy Bay | No major excavation works were conducted. No stockpile of excavated soil was observed. | Existing trees have been retained on site, fenced off and protected. The construction materials and debris that were observed from the last audit are still stored very near to the roots of T027(R) and T028(R) (see <i>Photo 1</i>), | No tree was transplanted during this reporting month. T004(T) and T005(T) were still found to be in very poor health condition and might be dead (see <i>Photo 4</i>). | Not applicable - Compensatory tree planting has not been started. | Night-time lighting was used for 24 hours per day on 1 st to 31 st of May, except for 1 st , 8 th , 15 th , 22 nd and 29 th where night-time lighting was used until 19:00 only. | Decorative screen hoarding were erected and was compatible to the surrounding setting. | Contractor was advised to remove the construction materials and debris stored very near to the roots of T027(R), T028(R), T057(R) and T058(R) immediately and ensures the good health condition of the retained trees. The Contractor is also advised to consult their tree consultant and take appropriate actions to restore the health conditions of |


| Site | CM1 Topsoil identified stripped and stored for re-use in the construction of soft landscape works, where practical | CM2 Existing trees to be retained on site should be carefully protected during construction | CM3 Trees unavoidably affected by the works should be transplanted where practical. | CM4 Compensatory tree planting should be provided to compensate for felled trees. | CM5 Control of night-time lighting. | CM6 Erection of decorative screen hoarding compatible with the surrounding setting. | Recommendations |
|------|---|---|--|--|--|--|--|
| | | Retained trees T036(R), T037(R) and T018(R) were showing poor health condition due to formation of stagnant water in the area (see <i>Photos 2 & 3</i>). | | | | | <p>the transplanted trees T004(T), and T005(T) immediately or replaced it if found dead..</p> <p>The Contractor was also advised to divert the water flow in the area where site workshops and washing are done. It is also advised to avoid the formation of stagnant water that will affect the health conditions of nearby retained trees in the area. The Contractor was also recommended to consult their tree consultant regarding the soil condition of the area to ensure the health condition of the retained trees T036(R), T037(R) and T018(R).</p> |

| Site | CM1 | CM2 | CM3 | CM4 | CM5 | CM6 | Recommendations |
|-----------|---|--|---|--|---|--|-----------------|
| | Topsoil identified stripped and stored for re-use in the construction of soft landscape works, where practical | Existing trees to be retained on site should be carefully protected during construction | Trees unavoidably affected by the works should be transplanted where practical. | Compensatory tree planting should be provided to compensate for felled trees. | Control of night-time lighting. | Erection of decorative screen hoarding compatible with the surrounding setting. | |
| Cyberport | No major excavation works were conducted. No stockpile of excavated soil was observed. | Existing trees have been retained on site, fenced off and protected properly. | No tree was transplanted during this reporting month. | Not applicable - Compensatory tree planting has not been started. | Night-time lighting was used for 24 hours per day on 1 st to 31 th of May, except for 1 st , 8 th , 15 th , 22 nd and 29 th where night-time lighting was used until 19:00 only. | Noise enclosure was erected over the shaft. A yellow color was used for the materials of the noise enclosure, similar to the color of the existing STW façade. | Not required |
| Wah Fu | No major excavation works were conducted. No stockpile of excavated soil was observed. | Not Applicable - No existing trees were identified to be affected within the works area. | Not Applicable - No existing trees were identified to be affected within the works area. | Not applicable - No existing trees were identified to be affected within the works area. | Not applicable - No night-time lighting was used. | Screening was erected and was compatible to the surrounding setting. | Not required |
| Aberdeen | No major excavation works were conducted. No stockpile of excavated soil was observed. | Existing trees have been retained on site, fenced off and protected properly. | All tree transplantation works have been completed and all transplanted trees are properly supported by tripod. | Not applicable - Compensatory tree planting has not been started. | Night-time lighting was used until 2300 hours on 28 th , 30 th and 31 st of May. | Screen hoarding was erected and the grey colour was compatible to the surrounding setting. | Not Required. |



Sandy Bay site --- Photo 1

Construction materials and debris were still stored very near to the roots of retained tree T027(R) and T028(R).

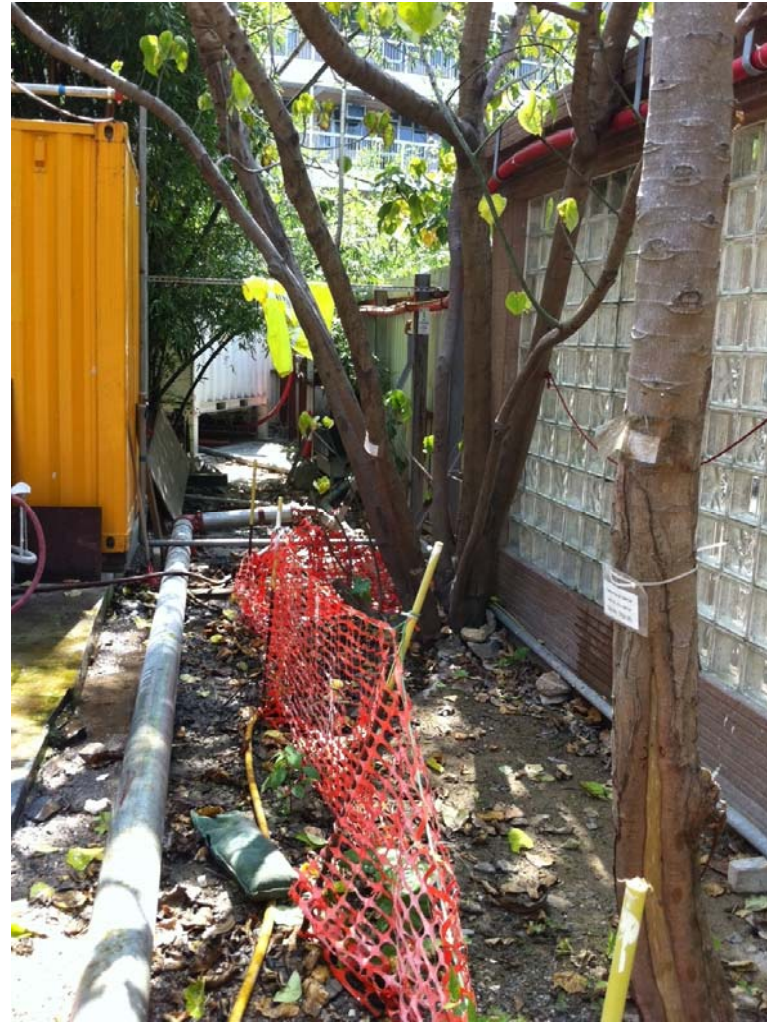

Sandy Bay site --- Photo 2

Retained Trees T036(R), T037(R) and T018(R) were showing poor health condition due to formation of stagnant water in the area.



Sandy Bay site --- Photo 3

Stagnant water formation very near to the roots of retained Tree T037(R).



Sandy Bay site --- Photo 4

The transplanted Trees T004 (T) and T005 (T) were still observed to be in poor health condition and might be dead.

(Name: Christina Ip,
Registered Landscape Architect)

APPENDIX M

NOTIFICATION OF EXCEEDANCES

| | | | | | |
|---|----------------|-------------|---------------------------------|---|-----------------|
| Contract No. DC/2007/24 Harbour Area Treatment Scheme Stage 2A Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun Notification of Environmental Quality Limit Exceedance | | | | Notification No.: 059 | |
| Date of Notification: 12 th May 2011 | | | | | |
| Works Inspected: Data collected from night time (between 23:00-07:00 hrs of next day) noise monitoring on 5 th May 2011 | | | | | |
| Noise Monitoring Location: M5a — near entrance of Chuk Lam Ming Tong | | | | | |
| Parameter: Noise - $L_{eq(5 \text{ min})}$ | | | | | |
| Action & Limit Levels | | | Measured Noise Level * | | |
| Time Period | Action Level | Limit Level | Time : | 23:00 – 23:15 hrs on 5 th May 2011 | |
| 23:00–07:00 hrs Normal weekday | 1 complaint | 45dB(A) | $L_{eq(5 \text{ min})}$ reading | 1 st | 2 nd |
| | | | | 57.7 dB(A) | 63.1 dB(A) |
| * façade measurement | | | | | |
| Possible Reason for Action or Limit Level Non-compliance: An exceedance in Limit Level was recorded during night-time noise monitoring at M5a on 5 th May 2011. From the Contractor's record, powered mechanical equipment (PME) used in the Sandy Bay works site during noise monitoring period included powered mechanical equipments as listed in Construction Noise Permit (CNP) No. GW-RS0379-11. A baseline noise level monitoring at this monitoring location (for restricted hours) was conducted on 6 th November 2010 from 23:00 to 23:15 hrs. All PMEs listed under the CNP No. GW-RS0133-11 were ensure to shut down during the measurement. The average 5-min baseline noise level was found to be 60.5dB (A), which already exceeded the Limit Level of 45dB (A) set out in the Project EM&A Manual. It is also noted from the Project Baseline Environmental Monitoring Report (Doc No. GEN/026) that the night-time BGL at M5 (roof of Chuk Lam Ming Tong) ranged from 54.4dB(A) to 70.2dB(A). Hence, the above exceedance was considered to be non-project related. Based on observations during the noise monitoring period, the major noise source was road traffic noise at San Wan Drive. | | | | | |
| Actions taken/ to be taken: As the noise exceedance was not considered to be related to project works, no immediate actions are considered necessary. | | | | | |

Inspected by : Ruby Law


Title : Environmental Technician



Date : 12th May 2011

Reviewed and approved by : Susana Halliday

Title : Environmental Team Leader



Date : 12th May 2011

Sent to: Engineer's Representative, Contractor, EPD & IEC

| | | | | | | |
|--|----------------|-------------|---------------------------------|---|-----------------|-----------------|
| Contract No. DC/2007/24 Harbour Area Treatment Scheme Stage 2A Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun Notification of Environmental Quality Limit Exceedance | | | | Notification No.: 063 | | |
| Date of Notification: 10 th June 2011 | | | | | | |
| Works Inspected: Data collected from daytime and evening during general holiday (between 07:00-23:00 hrs) noise monitoring on 8 th May 2011 | | | | | | |
| Noise Monitoring Location: M5a — near the entrance of Chuk Lam Ming Tong | | | | | | |
| Parameter: Noise - $L_{eq(5 \text{ min})}$ | | | | | | |
| Action & Limit Levels | | | Measured Noise Level * | | | |
| Time Period | Action Level | Limit Level | Time : | 14:36 – 14:51 hrs on 8 th May 2011 | | |
| 07:00–23:00 hrs | 1 complaint | 60dB(A) | $L_{eq(5 \text{ min})}$ reading | 1 st | 2 nd | |
| | | | | 60.2 dB(A) | 65.6 dB(A) | 3 rd |
| <td>63.4 dB(A)</td> | | | | | | 63.4 dB(A) |
| * façade measurement | | | | | | |
| Possible Reason for Action or Limit Level Non-compliance: An exceedance in Limit Level was recorded daytime and evening during general holiday noise monitoring at M5a on 8 th May 2011. From the Contractor's record, powered mechanical equipment (PME) used in the Sandy Bay works site during noise monitoring period included powered mechanical equipments as listed in Construction Noise Permit (CNP) No. GW-RS0133-11. A baseline noise level monitoring at this monitoring location (for restricted hours) was conducted on 7 th November 2010 from 16:19 to 16:34 hrs. All PMEs listed under the CNP No. GW-RS0133-11 were ensure to shut down during the measurement. The average 5-min baseline noise level was found to be 65.9dB (A), which already exceeded the Limit Level of 60dB (A) set out in the Project EM&A Manual. It is also noted from the Project Baseline Environmental Monitoring Report (Doc No. GEN/026) that the night-time BGL at M5 (roof of Chuk Lam Ming Tong) ranged from 55.1dB (A) to 75.2dB(A). Hence, the above exceedance was considered to be non-project related. Based on observations during the noise monitoring period, the major noise source was road traffic noise at San Wan Drive and the noise from opening/closing of the gate at the entrance of Chuk Lam Ming Tong. | | | | | | |
| Actions taken/ to be taken: As the noise exceedance was not considered to be related to project works, no immediate actions are considered necessary. | | | | | | |

Inspected by : Ruby Law


Title : Environmental Technician



Date : 10th June 2011

Reviewed and approved by : Susana Halliday


Title : Environmental Team Leader




Date : 10th June 2011

Sent to: Engineer's Representative, Contractor, EPD & IEC

| | | | | | | |
|---|----------------|-------------|---------------------------------|---|-----------------|-----------------|
| Contract No. DC/2007/24 Harbour Area Treatment Scheme Stage 2A Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun Notification of Environmental Quality Limit Exceedance | | | | Notification No.: 060 | | |
| Date of Notification: 12 th May 2011 | | | | | | |
| Works Inspected: Data collected from night-time (between 23:00-07:00 hrs of next day) noise monitoring on 9 th May 2011 | | | | | | |
| Noise Monitoring Location: M6a — Aegean Terrace | | | | | | |
| Parameter: Noise - $L_{eq(5 \text{ min})}$ | | | | | | |
| Action & Limit Levels | | | Measured Noise Level * | | | |
| Time Period | Action Level | Limit Level | Time : | 23:00 – 23:15 hrs on 9 th May 2011 | | |
| 23:00–07:00 hrs Normal weekday | 1 complaint | 50 dB(A) | $L_{eq(5 \text{ min})}$ reading | 1 st | 2 nd | 3 rd |
| | | | | 49.3 dB(A) | 52.9 dB(A) | 56.9 dB(A) |
| * Free-field measurement, +3dB correction | | | | | | |
| Possible Reason for Action or Limit Level Non-compliance: An exceedance in Limit Level was recorded during night-time noise monitoring at M6a on 9 th May 2011. From the Contractor's record, powered mechanical equipment (PME) used in the Cyberport PTW works site during noise monitoring period included powered mechanical equipments as listed in Construction Noise Permit (CNP) No. GW-RS0395-11. According to the Project Baseline Environmental Monitoring Report (Doc No. GEN/026), the average 5-min baseline noise level was found to be 50.8 dB(A), which already exceeded the Limit Level of 50 dB(A) set out in the Project EM&A Manual. It is also noted that the night-time BGL at M6a ranged from 41.6 dB(A) to 67.0 dB(A). Hence, the above exceedance was considered to be non-project related. Based on observations during the noise monitoring period, the major noise source were the local traffics of Aegean Terence. | | | | | | |
| Actions taken/ to be taken: As the noise exceedance was not considered to be related to project works, no immediate actions are considered necessary. | | | | | | |

Inspected by : Ruby Law


Title : Environmental Technician
 Date : 12th May 2011

Reviewed and approved by : Susana Halliday


Title : Environmental Team Leader
 Date : 12th May 2011

Sent to: Engineer's Representative, Contractor, EPD & IEC

| | | | | | | | | | | | |
|--|-----------------|-----------------|---|---------------------------------|-----------------|-----------------|-----------------|--|------------|------------|------------|
| Contract No. DC/2007/24 | | | | | | | | | | | |
| Harbour Area Treatment Scheme Stage 2A | | | | | | | | | | | |
| Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun | | | | | | | | | | | |
| Notification of Environmental Quality Limit Exceedance | | | Notification No.: 061 | | | | | | | | |
| Date of Notification: 24 th May 2011 | | | | | | | | | | | |
| Works Inspected: Data collected from night time (between 23:00-07:00 hrs of next day) noise monitoring on 19 th May 2011 | | | | | | | | | | | |
| Noise Monitoring Location: M5a — near entrance of Chuk Lam Ming Tong | | | | | | | | | | | |
| Parameter: Noise - $L_{eq(5 \text{ min})}$ | | | | | | | | | | | |
| Action & Limit Levels | | | Measured Noise Level * | | | | | | | | |
| Time Period | Action Level | Limit Level | Time : 23:00 – 23:15 hrs on 19 th May 2011 | | | | | | | | |
| 23:00–07:00 hrs Normal weekday | 1 complaint | 45dB(A) | <table border="1"> <tr> <td>$L_{eq(5 \text{ min})}$ reading</td> <td>1st</td> <td>2nd</td> <td>3rd</td> </tr> <tr> <td></td> <td>63.1 dB(A)</td> <td>56.7 dB(A)</td> <td>61.0 dB(A)</td> </tr> </table> | $L_{eq(5 \text{ min})}$ reading | 1 st | 2 nd | 3 rd | | 63.1 dB(A) | 56.7 dB(A) | 61.0 dB(A) |
| $L_{eq(5 \text{ min})}$ reading | 1 st | 2 nd | 3 rd | | | | | | | | |
| | 63.1 dB(A) | 56.7 dB(A) | 61.0 dB(A) | | | | | | | | |
| * façade measurement | | | | | | | | | | | |
| Possible Reason for Action or Limit Level Non-compliance: | | | | | | | | | | | |
| An exceedance in Limit Level was recorded during night-time noise monitoring at M5a on 19 th May 2011. | | | | | | | | | | | |
| From the Contractor's record, powered mechanical equipment (PME) used in the Sandy Bay works site during noise monitoring period included powered mechanical equipments as listed in Construction Noise Permit (CNP) No. GW-RS0379-11. | | | | | | | | | | | |
| A baseline noise level monitoring at this monitoring location (for restricted hours) was conducted on 6 th November 2010 from 23:00 to 23:15 hrs. All PMEs listed under the CNP No. GW-RS0133-11 were ensure to shut down during the measurement. The average 5-min baseline noise level was found to be 60.5dB (A), which already exceeded the Limit Level of 45dB (A) set out in the Project EM&A Manual. It is also noted from the Project Baseline Environmental Monitoring Report (Doc No. GEN/026) that the night-time BGL at M5 (roof of Chuk Lam Ming Tong) ranged from 54.4dB(A) to 70.2dB(A). | | | | | | | | | | | |
| Hence, the above exceedance was considered to be non-project related. Based on observations during the noise monitoring period, the major noise source was road traffic noise at San Wan Drive. | | | | | | | | | | | |
| Actions taken/ to be taken: | | | | | | | | | | | |
| As the noise exceedance was not considered to be related to project works, no immediate actions are considered necessary. | | | | | | | | | | | |

Inspected by : Ruby Law


Title : Environmental Technician



Date : 24th May 2011

Reviewed and approved by : Susana Halliday


Title : Environmental Team Leader




Date : 24th May 2011

Sent to: Engineer's Representative, Contractor, EPD & IEC

| | | | | | | | | | | | |
|--|-----------------|-----------------|---|---------------------------------|-----------------|-----------------|-----------------|--|------------|------------|------------|
| Contract No. DC/2007/24 | | | | | | | | | | | |
| Harbour Area Treatment Scheme Stage 2A | | | | | | | | | | | |
| Construction of Sewage Conveyance System from Aberdeen to Sai Ying Pun | | | | | | | | | | | |
| Notification of Environmental Quality Limit Exceedance | | | Notification No.: 062 | | | | | | | | |
| Date of Notification: 30 th May 2011 | | | | | | | | | | | |
| Works Inspected: Data collected from night-time (between 23:00-07:00 hrs of next day) noise monitoring on 25 th May 2011 | | | | | | | | | | | |
| Noise Monitoring Location: M6a — Aegean Terrace | | | | | | | | | | | |
| Parameter: Noise - $L_{eq(5 \text{ min})}$ | | | | | | | | | | | |
| Action & Limit Levels | | | Measured Noise Level * | | | | | | | | |
| Time Period | Action Level | Limit Level | Time : 23:00 – 23:15 hrs on 25 th May 2011 | | | | | | | | |
| 23:00–07:00 hrs Normal weekday | 1 complaint | 50 dB(A) | <table border="1"> <tr> <td>$L_{eq(5 \text{ min})}$ reading</td> <td>1st</td> <td>2nd</td> <td>3rd</td> </tr> <tr> <td></td> <td>49.1 dB(A)</td> <td>51.0 dB(A)</td> <td>54.5 dB(A)</td> </tr> </table> | $L_{eq(5 \text{ min})}$ reading | 1 st | 2 nd | 3 rd | | 49.1 dB(A) | 51.0 dB(A) | 54.5 dB(A) |
| $L_{eq(5 \text{ min})}$ reading | 1 st | 2 nd | 3 rd | | | | | | | | |
| | 49.1 dB(A) | 51.0 dB(A) | 54.5 dB(A) | | | | | | | | |
| * Free-field measurement, +3dB correction | | | | | | | | | | | |
| Possible Reason for Action or Limit Level Non-compliance: | | | | | | | | | | | |
| An exceedance in Limit Level was recorded during night-time noise monitoring at M6a on 25 th May 2011. | | | | | | | | | | | |
| From the Contractor's record, powered mechanical equipment (PME) used in the Cyberport PTW works site during noise monitoring period included powered mechanical equipments as listed in Construction Noise Permit (CNP) No. GW-RS0395-11. | | | | | | | | | | | |
| According to the Project Baseline Environmental Monitoring Report (Doc No. GEN/026), the average 5-min baseline noise level was found to be 50.8 dB(A), which already exceeded the Limit Level of 50 dB(A) set out in the Project EM&A Manual. It is also noted that the night-time BGL at M6a ranged from 41.6 dB(A) to 67.0 dB(A). | | | | | | | | | | | |
| Hence, the above exceedance was considered to be non-project related. Based on observations during the noise monitoring period, the major noise source were the local traffics of Aegean Terence. | | | | | | | | | | | |
| Actions taken/ to be taken: | | | | | | | | | | | |
| As the noise exceedance was not considered to be related to project works, no immediate actions are considered necessary. | | | | | | | | | | | |

Inspected by : Ruby Law


Title : Environmental Technician
 Date : 30th May 2011

Reviewed and approved by : Susana Halliday


Title : Environmental Team Leader
 Date : 30th May 2011

Sent to: Engineer's Representative, Contractor, EPD & IEC

APPENDIX N

SUMMARY RECORDS OF SITE INSPECTIONS

3 May 2011

Aberdeen PTW

| |
|--|
| Notes / Issues Recorded On Site: Nil |
| Corrective Actions – Mitigation Measures Implemented or Proposed (if any): Previous Environmental Site Inspection Checklist – Report No. 110426 General Housekeeping: Nil Current Environmental Site Inspection Checklist – Report No. 110503 Nil |

Cyberport PTW

| |
|--|
| Notes / Issues Recorded On Site: Nil. |
| Corrective Actions – Mitigation Measures Implemented or Proposed (if any): Previous Environmental Site Inspection Checklist – Report No. 110426 Waste/General Housekeeping: Nil. Current Environmental Site Inspection Checklist – Report No. 110503 Nil. |

Fung Mat Road Site

| |
|---|
| Notes / Issues Recorded On Site: Site Maintenance: 1. A leaking oil hydraulic excavator was observed. (Photo 2) |
| Corrective Actions – Mitigation Measures Implemented or Proposed (if any): Previous Environmental Site Inspection Checklist – Report No. 110426 Air Quality: 1. Water spraying was applied on access road. (Photo 1) Current Environmental Site Inspection Checklist – Report No. 110503 Air Quality: 1. The contractor was suggested to repair the hydraulic excavator and treated the leaking oil as chemical waste. |

Photo 1: Water spraying was applied on access road.



Photo 2: A leaking oil hydraulic excavator was observed



Sandy Bay

Notes / Issues Recorded On Site

General Housekeeping:

1. Accumulated leaves was observed near site boundary.(Photo 1)
2. Some materials placed improperly.(Photo 2)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110426

General Housekeeping:

1. The water leaking from the toilet was reduced. (Photo 3)
2. The accumulated materials near the site hoarding were cleared. (Photo 4)
3. Worker was clearing the accumulated water near the site hoarding during site inspection. (Photo 5)

Water Quality :

1. The U-channel had been cleared (Photo 6)

Current Environmental Site Inspection Checklist – Report No. 110503

General Housekeeping:

1. To clear accumulated leaves
2. The contractor was reminded to keep the site tidiness

Photo 1: Accumulated leaves was observed near site boundary



Photo 2: Some materials placed improperly

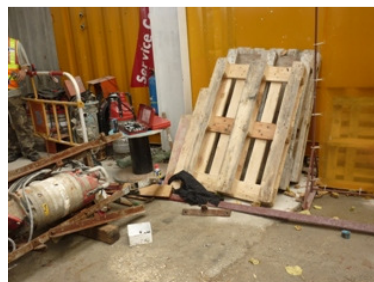


Photo 3: The water leaking from the toilet was reduced



Photo 4: The accumulated materials near the site hoarding were cleared.



Photo 5: Worker was clearing the accumulated water near the site hoarding during site inspection.



Photo 6: The U-channel had been cleared



Wah Fu PTW

Notes / Issues Recorded On Site:

Nil.

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110426

Nil.

Current Environmental Site Inspection Checklist – Report No. 110503

Nil.

11 May 2011

Aberdeen PTW

Notes / Issues Recorded On Site:

Air Quality:

1. A mixer with improper cover was observed.(Photo 1)

Waste oil:

1. Oil spot was found near the generator. (Photo 2)

Chemical storage:

1. Chemical drums without drip tray were found in PTW(Photo 3)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110503

Nil.

Current Environmental Site Inspection Checklist – Report No. 110511

Air Quality:

1. The contractor is suggested to cover the top and 3 sides of the mixer during operation.

Waste oil:

1. The contractor should investigate the leakage and clean the oil spots with oil-dispenser.

Chemical storage:

1. To provide drip tray for the chemical drums.

Photo 1: A mixer with improper cover was observed



Photo 2: Oil spot was found near the generator



Photo 3: Chemical drums without drip tray were found in PTW



Cyberport PTW

| |
|---|
| <p>Notes / Issues Recorded On Site: Site Maintenance:</p> <ol style="list-style-type: none"> Water leaking from air conditioner and cause the waste water accumulation near the EP notice board.(Photo 1 and 2) <p>Corrective Actions – Mitigation Measures Implemented or Proposed (if any):</p> |
| <p>Previous Environmental Site Inspection Checklist – Report No. 110503 Nil.</p> <p>Current Environmental Site Inspection Checklist – Report No. 110511 Site Maintenance:</p> <ol style="list-style-type: none"> The contractor is recommended to make a temporary channel for waste water from air conditioner to discharge. |

Photos 1 and 2: Water leaking from air conditioner and cause the waste water accumulation near the EP notice board.



Fung Mat Road Site

| |
|---|
| <p>Notes / Issues Recorded On Site: Nil.</p> <p>Corrective Actions – Mitigation Measures Implemented or Proposed (if any):</p> |
| <p>Previous Environmental Site Inspection Checklist – Report No. 110503 Site Maintenance:</p> <ol style="list-style-type: none"> The oil hydraulic excavator was still observed oil leakage and the Contractor temporarily used the drum for storage. <p>Current Environmental Site Inspection Checklist – Report No. 110511 Site Maintenance:</p> <ol style="list-style-type: none"> The Contractor is recommended to treat the waste oil as chemical waste. |

Sandy Bay

| |
|--|
| <p>Notes / Issues Recorded On Site Air Quality:</p> <ol style="list-style-type: none"> Cement bags near entrance of noise enclosure were covered improperly .(Photo 1) <p>General Refuse:</p> <ol style="list-style-type: none"> Construction materials were accumulated near the welding zone. (Photo 2) <p>Corrective Actions – Mitigation Measures Implemented or Proposed (if any):</p> |
|--|

Previous Environmental Site Inspection Checklist – Report No. 110503

General Housekeeping:

1. The accumulated leaves were reduced. (Photo 3)

Current Environmental Site Inspection Checklist – Report No. 110511

Air Quality:

3. To cover the cement bags near the entrance of the noise enclosure properly.

General Refuse:

1. To tidy the construction materials near the welding zone.

General Housekeeping:

1. The contractor is suggested to pave the soil with granules to prevent water accumulation. (Photo 4)

Photo 1: Cement bags near entrance of noise enclosure were covered improperly



Photo 2: Construction materials were accumulated near the welding zone



Photo 3: The accumulated leaves were reduced



Photo 4: The contractor is suggested to pave the soil with granules to prevent water accumulation



Wah Fu PTW

No inspection in this site inspection.

17 May 2011

Aberdeen PTW

Notes / Issues Recorded On Site:

General Housekeeping:

1. Rainwater was accumulated in the gap of piles (Photo 2)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110511

Air Quality:

1. According to contractor, the mixer was temporary storage in the site and will be relocate in coming further.(Photo 1)

Waste oil:

1. Oil spot was cleared near the generator.(Photo 3)

Current Environmental Site Inspection Checklist – Report No. 110517

General Housekeeping:

1. According to contractor's schedule, the gap of piles will be pave by cement in coming few days.
2. The contractor was reminded to spay the larvicidal oil regularly to prevent mosquito breeding.

Photo 1: A mixer with improper cover was observed. According to contractor, the mixer was temporary storage in the site and will be relocating in coming further.



Photo 2: Rainwater was accumulated in gap of piles.



Photo 3: Oil spot was cleared near the generator




Cyberport PTW

| |
|--|
| <p>Notes / Issues Recorded On Site: Site Maintenance: 1. The water leakage was found from air conditioner.(Photo 1) Corrective Actions – Mitigation Measures Implemented or Proposed (if any):</p> |
| <p>Previous Environmental Site Inspection Checklist – Report No. 110511 Site Maintenance: 1. The accumulation water was cleared. (Photo 2) Current Environmental Site Inspection Checklist – Report No. 110517 Site Maintenance: 1. The contractor is recommended to provide the temporary duct to prevent the water leakage from the air-conditioner. General Housekeeping: 1. The contractor was reminded to spay the larvicidal oil regularly to prevent mosquito breeding.</p> |

Photo 1: The water leakage was found from air conditioner.



Photo 2: The accumulation water was cleared

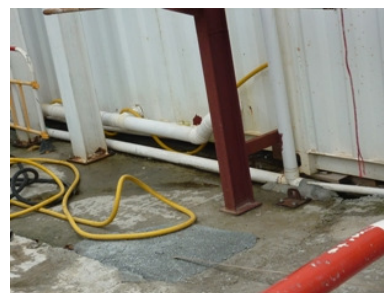

Fung Mat Road Site

| |
|---|
| <p>Notes / Issues Recorded On Site: Site Maintenance: 1. The label of recycle bins was missing. General Housekeeping : 1. The accumulated water was found under construction materials and cargo.(Photo 1) Corrective Actions – Mitigation Measures Implemented or Proposed (if any):</p> |
| <p>Previous Environmental Site Inspection Checklist – Report No. 110511 Nil. Current Environmental Site Inspection Checklist – Report No. 110517 Site Maintenance: 1. The contractor was reminded to provide the labels for recycle bins. General Housekeeping : 1. To clear water accumulation under construction materials and cargo 2. The contractor was reminded to spay the larvicidal oil regularly to prevent mosquito breeding.</p> |

Photo 1 The label of recycle bins was missing

Photo 2 Water accumulation was found under construction materials and cargo

Wah Fu PTW

Notes / Issues Recorded On Site:

Nil.

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110511

Nil.

Current Environmental Site Inspection Checklist – Report No. 110517

General Housekeeping:

1. The contractor was reminded to spay the larvicidal oil regularly to prevent mosquito breeding.

24 May 2011

Aberdeen PTW

Notes / Issues Recorded On Site:

General Housekeeping:

1. Water accumulation was found in container (Photo 2)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110517

General Housekeeping:

1. The piles had been paved with cement.(Photo 1)

Current Environmental Site Inspection Checklist – Report No. 110524

General Housekeeping:

1. The Contractor is suggested to clear accumulated water and spray larvicidal oil regularly to prevent mosquito breeding.

Photo 1: The piles had been paved with cement

Photo 2: Rainwater was accumulated in container



Cyberport PTW

Notes / Issues Recorded On Site:

Nil.

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110517

Site Maintenance:

1. According to Contractor, the temporary channel will be completed in few days.

Current Environmental Site Inspection Checklist – Report No. 110524

Nil.

Photos 1: According to contractor, the temporary channel will be completed in few days



Fung Mat Road Site

Notes / Issues Recorded On Site:

Site Maintenance:

1. The labels of recycle bins were missing since last inspection.(Photo 1)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110517

General Housekeeping :

1. Accumulated water was being cleared during inspection. (Photo 2)

Current Environmental Site Inspection Checklist – Report No. 110524

Site Maintenance:

1. The Contractor is reminded to renew the labels of recycle bins.

Photo 1 The labels of recycle bins were missing

Photo 2 Accumulated water was being cleared during inspection



Sandy Bay PTW

Notes / Issues Recorded On Site:

Landscape and Visual Impacts :

1. Lots of construction materials were found near the tree protection zone (Photo 1)
2. A rope hanged on a branch of a tree that outside the site boundary. (Photo 2)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110517

Chemical Waste storage:

1. The information of chemical waste storage had been updated and locked.(Photo 3)

General Housekeeping:

1. Larvicidal oil has been sprayed regularly to prevent mosquito breeding.

Current Environmental Site Inspection Checklist – Report No. 110524


Landscape and Visual Impacts:

1. The Contractor is reminded to move construction materials away from the tree protection zone.
1. The Contractor is suggested to remove the rope from the tree.

Photo 1: Lots of construction materials were found near the tree protection zone



Photo 2: A rope hanged on a branch of a tree that outside the site boundary

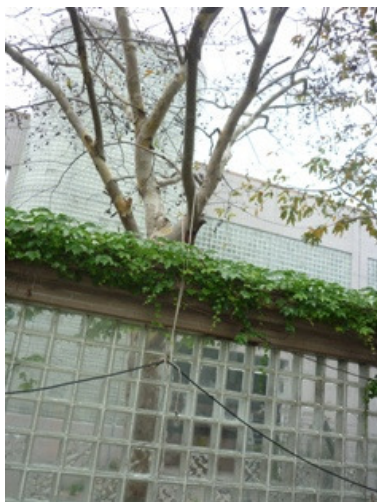

Photos 3 and 4 : The information of chemical waste storage had been updated and locked



Wah Fu PTW

Remark: No inspection since no construction work in progress

31 May 2011

Aberdeen PTW

Notes / Issues Recorded On Site:
 Nil.

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):
Previous Environmental Site Inspection Checklist – Report No. 110524
General Housekeeping:
 1. The container has been removed.(Photo 1)

Current Environmental Site Inspection Checklist – Report No. 110531
 Nil.

Photo 1: The container has been removed



Cyberport PTW

| |
|--|
| <p>Notes / Issues Recorded On Site: General Housekeeping: 1. No improvement on the leaking air-conditioner since last inspection.</p> |
| <p>Corrective Actions – Mitigation Measures Implemented or Proposed (if any):</p> |
| <p>Previous Environmental Site Inspection Checklist – Report No. 110524 Nil. Current Environmental Site Inspection Checklist – Report No. 110531 General Housekeeping: 1. The contractor is suggested to provide a temporary duct to the air-conditioner.</p> |

Photos 1: No improvement on the leaking air-conditioner since last inspection



Fung Mat Road PTW

| |
|--|
| <p>Notes / Issues Recorded On Site: Nil.</p> |
| <p>Corrective Actions – Mitigation Measures Implemented or Proposed (if any):</p> |
| <p>Previous Environmental Site Inspection Checklist – Report No. 110524 Site Maintenance: 1. The label of recycle bin had been replaced. (Photo 1) Current Environmental Site Inspection Checklist – Report No. 110531 Nil.</p> |

Photo 1 The label of recycle bin had been replaced



Sandy Bay PTW

Notes / Issues Recorded On Site:

General Housekeeping:

1. The U- channel near noise enclosure was found with accumulated leaves and mud.(Photo1)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110524

Landscape and Visual Impacts:

1. The construction materials had been removed away from tree protection zone.(Photo 2)
2. The rope had been removed (Photo 3)

Current Environmental Site Inspection Checklist – Report No. 110531

General Housekeeping:

1. The contractor is suggested to spray larvicidal oil regularly.
2. The contractor is suggested to clear the accumulated materials in channel.

Photo 1: The U- channel near noise enclosure was found with accumulated leaves and mud



Photo 2: The construction materials had been removed away from tree protection zone



Photo 3: The rope had been removed



Wah Fu PTW

Notes / Issues Recorded On Site:

General Housekeeping:

1. Broken sailcloth was found along the site boundary. (Photo 1)
2. Leaves were scattered on the floor (photo 2)

Corrective Actions – Mitigation Measures Implemented or Proposed (if any):

Previous Environmental Site Inspection Checklist – Report No. 110524

Nil.

Current Environmental Site Inspection Checklist – Report No. 110531

General Housekeeping:

1. To replace the broken sailcloth
2. To clear the leaves on the floor

Photo 1: Broken sailcloth was found along the site boundary



Photo2 : Leaves were scattered on the floor



**Contract No. DC/2007/24
Harbour Area Treatment Scheme Stage 2A
Construction of Sewage Conveyance System
From Aberdeen to Sai Ying Pun**

Comments and Responses

Submission Title: Monthly EM&A Report No. 17 (EMA/020) Rev B

| Comments | Designer (Atkins)'s Responses |
|--|-------------------------------|
| Independent Environmental Checker E-mail Date : 21st June 2011 | |
| 1 Section 2.1 | |
| Please amend "edit" to "adit". | Noted and revised |