QUARTERLY EM&A REPORT

OSCAR Bioenergy Joint Venture

Contract No. EP/SP/61/10
Organic Resources Recovery
Centre (Phase 1):
Twenty-first Quarterly EM&A
Summary Report

1 June 2020 - 31 August 2020

Environmental Resources Management

2507, 25/F, One Harbourfront, 18 Tak Fung Street, Hunghom, Kowloon, Hong Kong Telephone: (852) 2271 3000 Facsimile: (852) 2723 5660 E-mail: post.hk@erm.com http://www.erm.com

Meinhardt Infrastructure and Environment Limited

Organic Resources Recovery Centre, Phase I

Quarterly EM&A Report (1 Jun 2020 – 31 August 2020)

(September 2020)

Verified by: W. K. Chiu

Position: Independent Environmental Checker

Date: 22 September 2020

QUARTERLY EM&A REPORT

OSCAR Bioenergy Joint Venture

Contract No. EP/SP/61/10
Organic Resources Recovery
Centre (Phase 1):
Twenty-first Quarterly EM&A
Summary Report

1 June 2020 - 31 August 2020 Reference 0279222

For and on behalf of ERM-Hong Kong, Limited		
Approved by: Frank Wan		
Signed: March 4		
Position: Partner		
Certified by:(Environmental Team Leader - Mandy To)		
Date:17 September 2020		

CONTENTS

EXECUTIVE SUMMARY

1	INTRODUCTION	1
1.1	PURPOSE OF THE REPORT	1
1.2	STRUCTURE OF THE REPORT	1
2	PROJECT INFORMATION	3
2.1	BACKGROUND	3
2.2	GENERAL SITE DESCRIPTION	4
2.3	MAJOR ACTIVITIES UNDERTAKEN	4
2.4	PROJECT ORGANISATION AND MANAGEMENT STRUCTURE	4
2.5	STATUS OF ENVIRONMENTAL APPROVAL DOCUMENTS	4
3	ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS	6
3.1	ENVIRONMENTAL MONITORING	6
3.1.1	Air Quality	6
3.1.2	Odour	8
3.2	SITE AUDIT	11
3.2.1	Water Quality	11
3.2.2	Landscape and Visual	11
4	MONITORING RESULTS	12
4.1	AIR QUALITY	12
4.1.1	Commissioning Phase Monitoring	12
4.1.2	Operation Phase Monitoring	12
4.2	Odour	16
4.2.1	Operation Phase Monitoring	16
4.3	WATER QUALITY	16
4.3.1	Operation Phase Monitoring	16
4.4	WASTE MANAGEMENT	18
4.4.1	Operation Phase Monitoring	18
5	SITE AUDIT	19
5.1	ENVIRONMENTAL SITE AUDIT	19
5.1.1	Operation Phase	19
5.2	LANDSCAPE AND VISUAL AUDIT	19
6	ENVIRONMENTAL NON-CONFORMANCE	21
6.1	SUMMARY OF ENVIRONMENTAL NON-COMPLIANCE	21
6.2	SUMMARY OF ENVIRONMENTAL COMPLAINT	21
6.3	SUMMARY OF ENVIRONMENTAL SUMMON AND SUCCESSFUL PROSECUTION	22
7	FUTURE KEY ISSUES	23

7.1	KEY ISSUES FOR THE COMING REPORTING PERIOD	23
8	CONCLUSIONS	24
	LIST OF TABLES	
TABLE 2.1	SUMMARY OF ACTIVITIES UNDERTAKEN IN THE REPORTING PERIOD	
TABLE 2.2	SUMMARY OF ENVIRONMENTAL LICENSING, NOTIFICATION AND PERMIT STA	ATUS
<i>TABLE</i> 3.1	SAMPLING AND LABORATORY ANALYSIS METHODOLOGY	
<i>TABLE</i> 3.2	EMISSION LIMIT FOR CAPCS STACK	
<i>TABLE</i> 3.3	EMISSION LIMIT FOR CHP STACK	
<i>TABLE</i> 3.4	EMISSION LIMIT FOR ASP STACK	
<i>TABLE</i> 3.5	EMISSION LIMIT FOR STANDBY FLARING GAS UNIT ⁰	
<i>TABLE</i> 3.6	ODOUR INTENSITY LEVEL	
<i>TABLE</i> 3.7	ACTION AND LIMIT LEVELS FOR ODOUR NUISANCE	
<i>TABLE</i> 3.8	EVENT AND ACTION PLAN FOR ODOUR MONITORING	
<i>TABLE</i> 3.9	DISCHARGE LIMITS FOR EFFLUENT	
TABLE 4.1	HOURLY AVERAGE OF PARAMETERS RECORDED FOR CAPCS	
<i>TABLE</i> 4.2	HOURLY AVERAGE OF PARAMETERS RECORDED FOR CHP 1	
<i>TABLE</i> 4.3	HOURLY AVERAGE OF PARAMETERS RECORDED FOR CHP 2	
<i>TABLE</i> 4.4	HOURLY AVERAGE OF PARAMETERS RECORDED FOR CHP 3	
<i>TABLE</i> 4.5	HOURLY AVERAGE OF PARAMETERS RECORDED FOR ASP	
<i>TABLE</i> 4.6	RESULTS OF THE DISCHARGE SAMPLE COLLECTED ON 2 MARCH 2020	
<i>TABLE</i> 4.7	RESULTS OF THE DISCHARGE SAMPLE COLLECTED ON 8 APRIL 2020	
<i>TABLE</i> 4.8	RESULTS OF THE DISCHARGE SAMPLE COLLECTED ON 6 MAY 2020	
<i>TABLE</i> 4.10	QUANTITIES OF WASTE GENERATED FROM THE OPERATION OF THE PROJECT	7
	LIST OF ANNEXES	
ANNEX A	LOCATION OF PROJECT	
ANNEX B	PROJECT ORGANISATION CHART AND CONTACT DETAIL	
ANNEX C	CALIBRATION CERTIFICATION FOR THE ON-LINE STACK	
7111111221	MONITORING SYSTEM	
ANNEX D	IMPLEMENTATION SCHEDULE OF MITIGATION MEASURES	
ANNEX E	LABORATORY RESULTS FOR NMVOCS	
ANNEX F	WASTE FLOW TABLE	
ANNEX G	G ENVIRONMENTAL COMPLAINT, ENVIRONMENTAL SUMMONS AND PROSECUTION LOG	
ANNEX H	INVESTIGATION REPORT	

ANNEX I ODOUR PATROL RESULT

EXECUTIVE SUMMARY

The construction works of *No. EP/SP/61/10 Organic Resources Recovery Centre Phase 1 (the Project)* commenced on 21 May 2015. This is the 21st quarterly Environmental Monitoring and Audit (EM&A) report presenting the EM&A works carried out during the period from 1 June 2020 to 31 August 2020 in accordance with the EM&A Manual. Substantial completion of the construction works was confirmed on 3 December 2018. In the meantime, the operation phase EM&A programme had commenced in March 2019. Substantial Completion in respect of substantial part of the Works was confirmed on 24 February 2020. The construction phase EM&A programme was completed in the end of February 2020.

Summary of Works undertaken during the Reporting Month

Works undertaken in the reporting month included:

- Operation of the Project, including organic waste reception, and operation
 of the pre-treatment facilities, anaerobic digesters, composting facilities,
 air pollution control systems, on-line emission monitoring system for the
 Centralised Air Pollution Control Unit (CAPCS), Co-generation Units
 (CHP)s and Ammonia Stripping Plant (ASP), and the wastewater
 treatment plant; and
- Process fine-tune, including adjustment of the ASP with new treatment media, modification of Continuous Environmental Monitoring System (CEMS) and Supervisory Control and Data Acquisition System (SCADA) rectification and improvement works following equipment failures and the alteration of different operation modes and measures to adapt to the high variation of SSOW nature and sources.

Environmental Monitoring and Audit Progress

Air Quality Monitoring

Exceedances on NO_x and SO₂ from CHP and Carbon Monoxide, NO_x, VOCs (including methane) and NH₃ from ASP were recorded on the on-line monitoring system in June 2020. Exceedances on Odour (including NH₃ and H₂S), NO_x and SO₂ from CHP and Carbon Monoxide, NO_x, SO₂, VOCs (including methane), NH₃, HCL and HF from ASP were recorded on the online monitoring system in July 2020. Exceedances on NO_x from CHP and NO_x and NH₃ from ASP were recorded on the on-line monitoring system in August 2020. It should be noted that measurements recorded under abnormal operating conditions, e.g. start up and stopping of stacks, unstable operation, test runs and interference of sensor, are disregarded.

Exceedances in emission parameters of CAPCS, CHP and ASP were found to be a result of problems with system maintenance at CAPCS, low biogas loading at CHP and incomplete combustion of biogas at ASP.

The Contractor has implemented mitigation measures to control the exceedance (including continuous monitoring of CAPCS, arranging for the

supplier of CHP to perform on-site adjustment to improve CHP performance and tuning the thermal combustion unit of the ASP to optimise combustion efficiency and overall performance).

The Contractor is recommended to closely monitor the processes of the modification of the ASP and the post-modification monitoring of emission level to avoid any exceedance.

Odour

Odour patrols were conducted by the independent odour patrol team of ALS Technichem (HK) Pty Ltd on 3 July 2020 and 14 August 2020. No Level 2 Odour Intensity was recorded during odour patrols.

Water Quality

No non-compliance to the effluent discharge limit stipulated in the discharge licence issued by the EPD under the *Water Pollution Control Ordinance* was recorded during this reporting period.

Waste Management

Waste generated from the operation of the Project includes chemical waste, waste generated from pre-treatment process and general refuse.

200 L of chemical waste was collected by licenced waste collector from the operation of the Project.

1,899.55 tonnes of waste generated from pre-treatment process from the operation of the Project was disposed of at landfill. Among the recyclable waste generated from pre-treatment process from the operation of the Project, 0.00 kg of metals, 0.00 kg of papers/ cardboard packing and 0.00 kg of plastics were sent to recyclers for recycling during the reporting period.

Around 8.76 tonnes of general refuse from the operation of the Project was disposed of at landfill. Among the recycled general refuse from the operation of the Project, 0.00 kg of metals, 1,200 kg of papers/ cardboard packing and 0.00 kg of plastics were sent to recyclers for recycling during the reporting period.

Findings of Environmental Site Audit

A summary of the monitoring activities undertaken in this reporting period is listed below:

• Joint Environmental Site Inspections

3 times

• Landscape & Visual Inspections

3 times

Monthly joint environmental site inspections were carried out. The environmental control/mitigation measures (related to air quality, water quality, waste (including land contamination prevention), hazard-to-life and landscape and visual) recommended in the approved EIA Report and the EM&A Manual were properly implemented by the Contractor during the

reporting month.

Environmental Exceedance/Non-conformance/Compliant/Summons and Prosecution

Exceedances for the air emission limits for the CAPCS, CHP and ASP stacks were recorded during the reporting period.

No complaint/ summon/prosecution was received in this reporting period.

Future Key Issues

Activities to be undertaken in the next reporting month include:

- Operation of the Project.
- Modification of the ASP to control the air emission.

1 INTRODUCTION

ERM-Hong Kong, Limited (ERM) was appointed by OSCAR Bioenergy Joint Venture (the Contractor) as the Environmental Team (ET) to undertake the construction Environmental Monitoring and Audit (EM&A) programme for the *Contract No. EP/SP/61/10 of Organic Waste Treatment Facilities Phase I*, which the project name has been updated to *Organic Resources Recovery Centre (Phase I)* (*the Project*) since November 2017. ERM was also appointed by the Contractor to undertake the operation EM&A programme starting 1 March 2019.

1.1 PURPOSE OF THE REPORT

This is the 21st Quarterly EM&A report which summarises the monitoring results and audit findings for the EM&A programme during the reporting period from **1 June 2020** to **31 August 2020**.

1.2 STRUCTURE OF THE REPORT

The structure of the report is as follows:

Section 1: Introduction

It details the scope and structure of the report.

Section 2: Project Information

It summarises the background and scope of the Project, site description, project organisation and status of the Environmental Permits (EP)/licences.

Section 3: Environmental Monitoring and Audit Requirements

It summarises the environmental monitoring requirements including monitoring parameters, programmes, methodologies, frequency, locations, Action and Limit Levels, Event/Action Plans, as well as environmental audit requirements as recommended in the EM&A Manual and approved EIA report.

Section 4: Monitoring Results

It summarises monitoring results of the reporting period.

Section 5: Site Audit

It summarises the audit findings of the environmental as well as landscape and visual site audits undertaken within the reporting period.

Section 6: Environmental Non-conformance

It summarises any exceedance of environmental performance standard, environmental complaints and summons received within the reporting period. Section 7: Further Key Issues

It summarises the impact forecast for the next reporting month.

Section 8: Conclusions

2 PROJECT INFORMATION

2.1 BACKGROUND

The Organic Resources Recovery Centre (ORRC) Phase I development (hereinafter referred to as "the Project") is to design, construct and operate a biological treatment facility with a capacity of about 200 tonnes per day and convert source-separated organic waste from commercial and industrial sectors (mostly food waste) into compost and biogas through proven biological treatment technologies. The location of the Project site is shown in *Annex A*.

The environmental acceptability of the construction and operation of the Project had been confirmed by findings of the associated Environmental Impact Assessment (EIA) Study completed in 2009. The Director of Environmental Protection (DEP) approved this EIA Report under the *Environmental Impact Assessment Ordinance* (EIAO) (Cap. 499) in February 2010 (Register No.: AEIAR-149/2010) (hereafter referred to as the approved EIA Report). Subsequent Report on Re-assessment on Environmental Implications and Report on Re-assessment on Hazard to Life Implications were completed in 2013, respectively.

An Environmental Permit (EP) (No. EP-395/2010) was issued by the DEP to the EPD (Project Team), the Permit Holder, on 21 June 2010 and varied on 18 March 2013 (No. EP-395/2010/A) and 21 May 2013 (No. EP-395/2010/B), respectively. The Design Build and Operate Contract for the ORRC Phase 1 (Contract No. EP/SP/61/10 Organic Resources Recovery Centre (Phase 1) (the Contract)) was awarded to SITA Waste Services Limited, ATAL Engineering Limited and Ros-Roca, Sociedad Anonima jointly trading as the OSCAR Bioenergy Joint Venture (OSCAR or the Contractor). A Further EP (No. FEP-01/395/2010/B) was issued by the DEP to the OSCAR on 16 February 2015. Variation to both EPs (Nos. EP-395/2010/B and FEP-01/395/2010/B) were made in December 2015. The latest EPs, Nos. EP-395/2010/C and FEP-01/395/2010/C, were issued by the DEP on 21 December 2015.

Under the requirements of Condition 5 of the EP (No. FEP-01/395/2010/C), an Environmental Monitoring and Audit (EM&A) programme as set out in the approved EM&A Manual (hereinafter referred to as EM&A Manual) is required to be implemented during the construction and operation of the Project. ERM-Hong Kong, Ltd (ERM) has been appointed by OSCAR as the Environmental Team (ET) for the construction phase EM&A programme and the Monitoring Team (MT) for the operation phase EM&A programme for the implementation of the EM&A programme in accordance with the requirements of the EP and the approved EM&A Manual.

The construction works commenced on 21 May 2015. The operation phase of

the EM&A programme commenced on 1 March 2019 (1). The construction phase EM&A programme was completed in the end of February 2020.

2.2 GENERAL SITE DESCRIPTION

The Project Site is located at Siu Ho Wan in North Lantau with an area of about 2 hectares. The layout of the Project Site is illustrated in *Annex A*. The facility received and treated an average of 100 tonnes of source separated organic waste per day during the reporting month.

2.3 MAJOR ACTIVITIES UNDERTAKEN

A summary of the major activities undertaken in the reporting period is shown in *Table 2.1*.

Table 2.1 Summary of Activities Undertaken in the Reporting Period

Activities Undertaken in the Reporting Period

- Systems being operated waste reception, pre-treatment, CAPCS extraction, the digesters, the centrifuge, , the composting tunnels the desulphurisation, the emergency flare, the CHPs, the ASP and the biological waste water treatment plant (about 100-130 t/d SSOW input); and
- Process fine-tune adjustment of the ASP operational parameters with new treatment media, CEMS/SCADA modification and improvement work following equipment failures and the alteration of different operation modes and measures to adapt to the high variation of SSOW nature and sources.

2.4 PROJECT ORGANISATION AND MANAGEMENT STRUCTURE

The project organisation chart and contact details are shown in *Annex B*.

2.5 STATUS OF ENVIRONMENTAL APPROVAL DOCUMENTS

A summary of the valid permits, licences, and/or notifications on environmental protection for this Project is presented in *Table 2.2*.

Table 2.2 Summary of Environmental Licensing, Notification and Permit Status

Permit/ Licences/	Reference	Validity Period	Remarks
Notification			
Environmental	FEP-01/395/2010/C	Throughout the	Permit granted on 21
Permit		Contract	December 2015
Notification of	Ref No. 386715	Throughout the	-
Construction Works		Contract	
under the Air			
Pollution Control			

As some of the minor items are yet to be closed out in March 2019, the construction phase EM&A programme and Operation Phase EM&A programme were undertaking in parallel in March 2019.

Permit/ Licences/	Reference	Validity Period	Remarks
Notification			
(Construction Dust)			
Regulation			
Effluent Discharge	WT00024352-2016	3 June 2016 - 30	Approved on 3 June
License		June 2021	2016
Construction Noise	GW-RW0538-18	21 January 2019-20	Approved on 31
Permit - P1&P2	(Superseded CNP	July 2019	December 2018
	GW-RW0229-18)		
Chemical Waste	WPN 5213-961-	Throughout the	Approved on 29 April
Producer Registration	O2231-01	Contract	2015
Chemical Waste	WPN 5213-961-	Throughout the	Approved on 10
Producer Registration	O2231-02	implementation of	November 2017
Ü		the Project	
Waste Disposal	Account number:	Throughout the	-
Billing Account	702310	Contract	

3 ENVIRONMENTAL MONITORING AND AUDIT REQUIREMENTS

3.1 ENVIRONMENTAL MONITORING

The air quality (including odour) monitoring to be carried out during the commissioning and operation phase of the Project are described below. Although water quality monitoring is not required for the operation phase under the EM&A programme, there are water quality monitoring requirement under the Water Discharge Licence of the plant under the *Water Pollution Control Ordinance* (WPCO). As part of this EM&A programme, the monitoring results will be reviewed to check the compliance with the WPCO requirements.

3.1.1 Air Quality

According to the EM&A Manual and EP requirements, stack monitoring are required during the commissioning and operation phase of the Project.

On-line monitoring (using continuous environmental monitoring system (CEMS) shall be carried out for the centralised air pollution unit (CAPCS), cogeneration units (CHP) and the ammonia stripping plant (ASP) during the commissioning and operation phase. The calibration certificate for the online monitoring equipment is provided in *Annex C*.

The monitoring data is transmitted instantaneously to EPD (Regional Office) by telemetry system.

When the on-line monitoring for certain parameter cannot be undertaken, monitoring will be carried out using the following methodology approved by the EPD.

Table 3.1 Sampling and Laboratory Analysis Methodology

Parameters	Method	Stacks to be Monitored
Gaseous and vaporous organic	USEPA Method 18	• CAPCS
substances (including methane)		• CHP
		• ASP
Particulate	USEPA Method 5	• CAPCS
		• CHP
		• ASP
Carbon monoxide (CO)	USEPA Method 10	• CHP
		• ASP
Nitrogen oxides (NO _x)	USEPA Method 7E	• CHP
		• ASP
Sulphur dioxide (SO ₂);	USEPA Method 6	• CHP
		• ASP
Hydrogen chloride (HCl)	USEPA Method 26A	• CHP
		• ASP

Parameters	Method	Stacks to be Monitored
Hydrogen fluoride (HF)	USEPA Method 26A	• CHP
		• ASP
Oxygen (O ₂);	USEPA Method 3A	 CAPCS
		• CHP
		• ASP
Velocity and Volumetric Flow	USEPA Method 2	 CAPCS
		• CHP
		• ASP
Ammonia (NH ₃)	USEPA CTM 027	• ASP
Odour (including NH ₃ and H ₂ S)	EN 13725	• CAPCS
Water vapour content (continuous	USEPA Method 4	• CAPCS
measurement of the water vapour		• CHP
content should not be required if the sample exhaust gas is dried before the		• ASP
emissions are analysed)		
Temperature	USEPA Method 4	• CAPCS
		• CHP
		• ASP

With reference to the EM&A Manual, the air emission of the stacks shall meet the following emission limits as presented in *Tables 3.2* to *3.5*.

Table 3.2 Emission Limit for CAPCS Stack

Parameter	Emission Level (mg/Nm³) (a)	
VOCs (including methane)	680	
Dust (or Total Suspended Particulates (TSP))	6	
Odour (including NH ₃ & H ₂ S)	220 (b)	
Notes:		
(a) Hourly average concentration		
(b) The odour unit is OU/Nm³		

Table 3.3 Emission Limit for CHP Stack

Parameter	Maximum Emission Level (mg/Nm³) (a) (b)
Dust (or Total Suspended Particulates)	15
Carbon Monoxide	650
NO_x	300
SO ₂	50
NMVOCs (c)	150
VOCs (including methane) (d)	1,500
HCl	10
HF	1

- (a) All values refer to an oxygen content in the exhaust gas of 6% and dry basis.
- (b) Hourly average concentration
- (c) NMVOCs should be monitored by gas sampling and laboratory analysis at an agreed interval. For the first 12 months (starting from August 2019), monitoring should be carried out at quarterly intervals. The monitoring frequency should then be reduced to half-yearly for next 12 months (starting from August 2020).

Parameter Maximum Emission		Maximum Emission Level (mg/Nm³) (a) (b)
(d)	The VOCs	emission limit include methane as biogas is adopted as fuel in the combustion
	process.	

Table 3.4 Emission Limit for ASP Stack

Maximum Emission Level (mg/Nm³) (a) (b)
5
100
200
50
20
35
10
1

Notes:

- (a) All values refer to an oxygen content in the exhaust gas of 11% and dry basis.
- (b) Hourly average concentration
- (c) The VOCs emission limit include methane as biogas is adopted as fuel in the combustion process.

Table 3.5 Emission Limit for Standby Flaring Gas Unit (1)

Parameter	Maximum Emission level (mg/Nm³) (a) (b)
Dust (or Total Suspended Particulates)	5
Carbon Monoxide	100
NO_x	200
SO_2	50
VOCs (including methane) (c)	20
HCl	10
HF	1

Notes:

- (a) All values refer to an oxygen content in the exhaust gas of 11% and dry basis.
- (b) Hourly average concentration
- (c) The VOCs emission limit include methane as biogas is adopted as fuel in the combustion process.

3.1.2 *Odour*

To determine the effectiveness of the proposed odour mitigation measures and to ensure that the operation of the ORRC1 will not cause adverse odour impacts, odour monitoring of the CAPCS stack (see *Section 3.1.1*) and odour patrol will be carried out.

Odour patrol shall be conducted by independent trained personnel/competent persons in summer months (i.e. from July to September) for the first two operational years of ORRC1 at monthly intervals along an odour patrol route at the Project Site boundary as shown in *Annex A*.

A standby facility. Only operate when the CHPs are not in operation or when the biogas generated exceeded the utilisation rate of the CHPs.

The perceived odour intensity is divided into 5 levels. *Table 3.6* describes the odour intensity for different levels.

Table 3.6 Odour Intensity Level

Level	Odour Intensity
0	Not detected. No odour perceived or an odour so weak that it cannot be easily characterised or described
1	Slight identifiable odour, and slight chance to have odour nuisance
2	Moderate identifiable odour, and moderate chance to have odour nuisance
3	Strong identifiable, likely to have odour nuisance
4	Extreme severe odour, and unacceptable odour level

Table 3.7 shows the action level and limit level to be used for odour patrol. Should any exceedance of the action and limit levels occurs, actions in accordance with the event and action plan in *Table 3.8* should be carried out.

Table 3.7 Action and Limit Levels for Odour Nuisance

Parameter	Action Level	Limit Level
Odour Nuisance (from odour patrol)	When one documented compliant is received ^(a) , or Odour Intensity of 2 is measured from odour patrol.	Two or more documented complaints are received ^(a) within a week; or Odour intensity of 3 or above is measured from odour patrol.

Note:

(a) Once the complaint is received by the Project Proponent (EPD), the Project Proponent would investigate and verify the complaint whether it is related to the potential odour emission from the ORRC1 and its on-site wastewater treatment unit.

Table 3.8 Event and Action Plan for Odour Monitoring

Event	Action				
	Person-in-charge of Odour Monitoring	Project Proponent (a)			
Action Level					
Exceedance of action level	1. Identify source/reason of exceedance;	1. Carry out investigation to identify the source/reason of exceedance.			
(Odour Patrol)	Repeat odour patrol to confirm finding.	Investigation should be completed within 2 weeks;			
		2. Rectify any unacceptable practice;			
		3. Implement more mitigation measures if necessary;			
		4. Inform Drainage Services Department (DSD) or the operator of the Siu Ho Wan Sewage Treatment Works (SHWSTW) if exceedance is considered to be caused by the operation of the SHWSTW.			
		5. Inform North Lantau Refuse Transfer Station (NLTS) operator if exceedance is considered to be caused by the operation of NLTS.			
Exceedance of	1. Identify source/reason of	1. Carry out investigation and verify the			
action level (Odour Complaints)	exceedance; 2. Carry out odour patrol to determinate odour intensity.	complaint whether it is related to potential odour emission from the nearby SHWSTW;			
	determinate odour intensity.	2. Carry out investigation to identify the source/reason of exceedance. Investigation should be completed within 2 weeks;			
		3. Rectify any unacceptable practice;			
		4. Implement more mitigation measures if necessary;			
		5. Inform DSD or the operator of the SHWSTW if exceedance is considered to be caused by the operation of the SHWSTW.			
		6. Inform NLTS operator if exceedance is considered to be caused by the operation of NLTS.			
Limit Level					
Exceedance of limit level	1. Identify source/reason of exceedance;	1. Carry out investigation to identify the source/reason of exceedance.			
	2. Inform EPD;	Investigation should be completed within 2 week;			
	3. Repeat odour patrol to	2. Rectify any unacceptable practice;			
	confirm findings; 4. Increase odour patrol	3. Formulate remedial actions;			
	frequency to bi-weekly;	4. Ensure remedial actions properly			
	5. Assess effectiveness of	implemented;			
	remedial action and keep EPD informed of the results;	5. If exceedance continues, consider what more/enhanced mitigation measures			
	If exceedance stops, cease additional odour patrol.	should be implemented; 6. Inform DSD or the operator of the			
	additional odour pation.	SHWSTW if exceedance is considered to be caused by the operation of the SHWSTW.			
Note:					

(a) Project Proponent shall identify an implementation agent.

3.2 SITE AUDIT

Environmental mitigation measures (related to air quality, water quality, waste, land contamination, hazard-to-life, and landscape and visual) to be implemented during the operation phase of the Project are recommended in the approved EIA Report and EM&A Manual and are summarised in *Annex D*. Monthly site audits for operation phase will be carried out to check the implementation of these measures.

3.2.1 Water Quality

Compliance audits are to be undertaken to ensure that a valid discharge licence has been issued by EPD prior to the discharge of effluent from the operation of the Project site. The audit shall be conducted to ensure that the effluent quality is in compliance with the discharge licence requirements. The effluent quality shall meet the discharge limits as described in *Table 3.9*.

Table 3.9 Discharge Limits for Effluent

Parameters	Discharge Limit (mg/L)
Flow Rate (m ³ /day)	685
pH (pH units)	6-10 (a)
Suspended Solids	800
Biochemical Oxygen Demand (5 days, 20°)	800
Chemical Oxygen Demand	2,000
Oil & Grease	40
Total Nitrogen	200
Total Phosphorus	50
Surfactants (total)	25
Note:	
(a) Range.	

3.2.2 Landscape and Visual

In accordance with EM&A Manual, the landscape and visual mitigation measures shall be implemented.

For operation phase, site inspection shall be conducted once a month for the first year of operation of the Project. All measures as stated in the implementation schedule of the EM&A Manual (see *Annex D*), including compensatory planting, undertaken by both the Contractor and the specialist Landscape Sub-Contractor during the first year of the operation phase shall be audited by a Registered Landscape Architect (RLA) to ensure compliance with the intended aims of the measures and the effectiveness of the mitigation measures.

4 MONITORING RESULTS

4.1 AIR QUALITY

4.1.1 Commissioning Phase Monitoring

Monitoring results of air quality parameters from stack emissions of the centralised air pollution control system, the ammonia stripping plant and the cogeneration units will be provided once available to show compliance with the monitoring requirements stated in the EM&A Manual (Rev. F) to support the termination of the construction phase EM&A programme.

4.1.2 Operation Phase Monitoring

The concentrations of concerned air pollutants emitted from the stacks of the CAPCS, CHP, and ASP during the reporting period are monitored on-line by the continuous environmental monitoring system (CEMS). During the reporting period, there is no need to operate the standby flare and therefore no monitoring of the flare stack was undertaken.

With reference to the emission limits shown in *Tables 3.2, 3.3* and *3.4*, the hourly average concentrations and the number of exceedances of the concerned air emissions monitored for the CAPCS, CHP and ASP during this reporting period are presented in *Tables 4.1* to *4.5*.

It should be noted that measurements recorded under abnormal operating conditions, e.g. start up and stopping of stacks, unstable operation, test runs and interference of sensor, are disregarded.

Table 4.1 Hourly Average of Parameters Recorded for CAPCS

Parameter	Range of Hourly Average Conc. (mg/Nm³)	Emission Limit (mg/Nm³)	Exceedance Identified	Remarks
VOCs (including methane)	0 - 15	680	Nil	Nil
Dust (or TSP)	0.2 - 5.9	6	Nil	Nil
Odour (including NH ₃ & H ₂ S) ^(b)	0 - 376	220	Identified (b)	System Maintenance

- (a) The odour unit is OU/Nm³.
- (b) 2 exceedances on Odour (including NH₃ & H₂S) were identified on 19 July 2020.

Table 4.2 Hourly Average of Parameters Recorded for CHP 1

Parameter	Range of Hourly Average Conc. (mg/Nm³) (a)	Max. Emission Limit (mg/Nm³)	Exceedance Identified	Remarks
Dust (or TSP)	0 - 6	15	Nil	Nil
Carbon Monoxide	0 - 426	650	Nil	Nil
NO _x	0 - 352	300	Identified (d)	Low biogas loading resulting in low CHP efficiency. Supplier had been arranged to fine-tune the equipment. Close monitoring of the biogas loading is performed to prevent further exceedance.
SO ₂	0 - 56	50	Identified (e)	Tripping of desulphurisation unit
NMVOCs (b)	Nil	150	Nil	Nil
VOCs (including methane) (c)	0 - 989	1,500	Nil	Nil
HCl	0 - 3	10	Nil	Nil
HF	0.0 - 0.9	1	Nil	Nil

- (a) All values refer to an oxygen content in the exhaust gas of 6% and dry basis.
- (b) No sampling was undertaken at CHP 1 as biogas production rate could not sustain the operation of the CHP stack for the scheduled sampling on 14 August 2020.
- (c) The VOCs emission limit include methane as biogas is adopted as fuel in the combustion process.
- (d) Dates with exceedances on SO_2 (number of exceedances on the day) were identified on 17 (1) and 18 (6) June 2020.
- (e) 1 exceedance on NO_x was identified on 15 July 2020.

Table 4.3 Hourly Average of Parameters Recorded for CHP 2

Parameter	Range of Hourly Average Conc. (mg/Nm³) (a) (b)	Max. Emission Limit (mg/Nm³)	Exceedance Identified	Remarks
Dust (or TSP)	0 - 11	15	Nil	Nil
Carbon Monoxide	0 - 206	650	Nil	Nil
NO _x	0 - 433	300	Identified (d)	Low biogas loading resulting in low CHP efficiency. Supplier had been arranged to fine-tune the equipment. Close monitoring of the biogas loading is performed to prevent further exceedance.
SO ₂	0 - 61	50	Identified (e)	Tripping of desulphurisation unit
NMVOCs (b)	2.7	150	Nil	See <i>Annex E</i> for final results

Parameter	Range of Hourly Average Conc. (mg/Nm³) (a) (b)	Max. Emission Limit (mg/Nm³)	Exceedance Identified	Remarks
VOCs (including methane) (c)	0 - 941	1,500	Nil	Nil
HCl	0 - 3	10	Nil	Nil
HF	0 - 0.8	1	Nil	Nil

Notes:

- (a) All values refer to an oxygen content in the exhaust gas of 6% and dry basis.
- (b) Bi-annual sampling of NMVOCs was conducted in CHP 2 on 14 August 2020.
- (c) The VOCs emission limit include methane as biogas is adopted as fuel in the combustion process.
- (d) Dates with exceedances on NO_x (number of exceedances on the day) were identified on 5 (1), 16 (3), 17 (13), 26 (2), 27 (3), 28 (9), 29 (12), 30 (3) and 31 (3) July 2020 and 3 (2), 4 (15), 5 (8), 6 (7), 7 (18), 8 (19), 9 (22), 10 (22), 11 (23), 12 (8) and 16 (7) August 2020.
- (e) Dates with exceedances on SO₂ (number of exceedances on the day) were identified on 17 (1) and 18 (6) June 2020 and 2 (2) July 2020.

Table 4.4 Hourly Average of Parameters Recorded for CHP 3

Parameter	Range of Hourly Average Conc. (mg/Nm³) (a)	Max. Emission Limit (mg/Nm³)	Exceedances Identified	Remarks
Dust (or TSP)	0 - 5	15	Nil	Nil
Carbon Monoxide	0 - 573	650	Nil	Nil
NO _x	0 - 536	300	Identified (d)	Low biogas loading resulting in low CHP efficiency. Supplier had been arranged to fine-tune the equipment. Close monitoring of the biogas loading is performed to prevent further exceedance.
SO ₂	0 - 47	50	Nil	Nil
NMVOCs (b)	Nil	150	Nil	Nil
VOCs (including methane) (c)	0 - 1,254	1,500	Nil	Nil
HCl	0 - 1	10	Nil	Nil
HF	0 - 1.0	1	Nil	Nil

- (a) All values refer to an oxygen content in the exhaust gas of 6% and dry basis.
- (b) Sampling was conducted on 11 February 2020.
- (c) The VOCs emission limit include methane as biogas is adopted as fuel in the combustion process.
- (d) Dates with exceedances on NO_x (number of exceedances on the day) were identified on 4 (2), 5 (4), 6 (11), 7 (13), 8 (13), 9 (10), 13 (4), 14 (6) and 15 (8) June 2020 and 23 (5) and 24 (1) July 2020.

Table 4.5 Hourly Average of Parameters Recorded for ASP

Parameter	Range of Hourly Average Conc. (mg/Nm³) (a)	Max. Emission Limit (mg/Nm³)	Exceedances Identified	Remarks
Dust (or TSP)	0.0 - 4.6	5	Nil	Nil
Carbon Monoxide	0 - 956	100	Identified (c)	System instability due to unstable column temperature. System maintenance were performed to maintain operation efficiency
NOx	0 - 603	200	Identified (d)	System instability due to unstable column temperature. System maintenance were performed to maintain operation efficiency
SO ₂	0 -113	50	Identified (e)	System instability due to unstable column temperature. System maintenance were performed to maintain operation efficiency
VOCs (including methane) (b)	0 - 2,147	20	Identified (f)	System instability due to unstable column temperature. System maintenance were performed to maintain operation efficiency
NH ₃	0 - 209	35	Identified (g)	System instability due to unstable column temperature. System maintenance were performed to maintain operation efficiency
HCl	0 - 11	10	Identified (h)	System instability due to unstable column temperature. System maintenance were performed to maintain operation efficiency
HF	0 - 2	1	Identified (i)	System instability due to unstable column temperature. System maintenance were performed to maintain operation efficiency

- (a) All values refer to an oxygen content in the exhaust gas of 11% and dry basis.
- (b) The VOCs emission limit include methane as biogas is adopted as fuel in the combustion process.
- (c) Dates with exceedances on Carbon Monoxide (number of exceedances on the day) were identified on 22 (1) and 23 (1) June 2020 and 3 (1), 6 (3), 9 (1), 10 (8), and 18 (1) July 2020.
- (d) Dates with exceedances on NO $_x$ (number of exceedances on the day) were identified on 2 (3), 3 (3), 6 (3), 7 (1), 9 (5), 15 (4), 21 (3), 23 (2), 25 (1) and 28 (1) June 2020, 3 (1), 6 (1), 9 (2), 10 (6), 16 (1), 17 (1), 18 (1), 19 (6), 20 (5), 21 (8) and 22 (1) July 2020 and 2 (8), 3 (8), 5 (5), 8 (2), 10 (3), 19 (1), 25 (2), 28 (1) and 31 (2) August 2020.
- (e) 1 exceedance on SO₂ was identified on 6 July 2020.
- (f) Dates with exceedances on VOCs (including methane) (number of exceedances on the day) were identified on 2 (1), 17 (1), 22 (1), 23 (1) and 27 (1) June 2020 and 3 (1), 6 (4), 9 (2), 10 (8), 16 (3), 17 (7), 18 (5), 19 (9) and 20 (5) July 2020.
- (g) Dates with exceedances on NH₃ (number of exceedances on the day) were identified on 12 (14), 17 (2), 22 (10), 23 (11), 24 (8), 25 (5), 26 (19), 27 (10), 28 (1) and 30 (1) June 2020, 2

Parameter	Range of Hourly Average Conc.	Max. Emission Limit (mg/Nm³)	Exceedances Remarks Identified
	$(mg/Nm^3)^{(a)}$		

(2), 3 (6), 5 (6), 6 (13), 7 (2), 8 (8), 9 (11), 10 (15), 11 (4), 14 (3), 15 (6), 16 (1), 17 (2), 18 (8), 19 (20), 20 (18), 21 (10), 22 (6), 23 (8), 26 (6), 27 (4), 30 (3) and 31 (6) July 2020 and 3 (1), 5 (6), 6 (3), 7 (3), 8 (7), 10 (5), 13 (1), 19 (2), 21 (1), 24 (1), 25 (5), 28 (1) and 31 (4) August 2020.

- (h) 1 exceedance on HCl was identified on 6 July 2020
- (i) Dates with exceedances on HF (number of exceedances on the day) were identified on 6 (1), 10 (2), 16 (1), 17 (4) and 19 (1) July 2020.

4.2 ODOUR

4.2.1 Operation Phase Monitoring

June 2020

No odour patrol was required to be conducted for this reporting period.

July 2020

Odour patrol was conducted by the independent odour patrol team of ALS Technichem (HK) Pty Ltd on 3 July 2020. According to the EM&A Manual and EP requirements, it is considered an exceedance if the odour intensity recorded by the panellists is Level 2 or above. During this reporting period, no Level 2 Odour Intensity was recorded. The odour patrol result is shown in *Annex I*.

August 2020

Odour patrol was conducted by the independent odour patrol team of ALS Technichem (HK) Pty Ltd on 14 August 2020. According to the EM&A Manual and EP requirements, it is considered an exceedance if the odour intensity recorded by the panellists is Level 2 or above. During this reporting period, no Level 2 Odour Intensity was recorded. The odour patrol result is shown in *Annex I*.

4.3 WATER QUALITY

4.3.1 Operation Phase Monitoring

Effluent discharge was sampled monthly from the Effluent Storage Tank as stipulated in the operation phase discharge licence. The results of the discharge sample is recorded in *Table 4.6* to *4.8*.

Table 4.6 Results of the Discharge Sample Collected on 2 June 2020

Parameters	Discharged Effluent Concentration (mg/L)	U	Compliance with Discharge Limit
pH (pH units)	6.73 - 7.53	6-10 (a)	Yes
Suspended Solids	78	800	Yes

Parameters	Discharged Effluent Concentration (mg/L)	· ·	Compliance with Discharge Limit
Biochemical Oxygen Demand (5 days, 20°)	40	800	Yes
Chemical Oxygen Demand	599	2,000	Yes
Oil & Grease	<5	40	Yes
Total Nitrogen	66.3	200	Yes
Total Phosphorus	26.9	50	Yes
Surfactants (total)	<1.0	25	Yes
Notes:			
(a) Daily Average.			

Table 4.7 Results of the Discharge Sample Collected on 7 July 2020

Parameters	Discharged Effluent Concentration (mg/L)	O	Compliance with Discharge Limit
pH (pH units)	6.83 - 7.95	6-10 (a)	Yes
Suspended Solids	24	800	Yes
Biochemical Oxygen Demand (5 days, 20°)	12	800	Yes
Chemical Oxygen Demand	381	2,000	Yes
Oil & Grease	<5	40	Yes
Total Nitrogen	122	200	Yes
Total Phosphorus	26.3	50	Yes
Surfactants (total)	<1.0	25	Yes
Notes: (a) Daily Average.			

Table 4.8 Results of the Discharge Sample Collected on 6 August 2020

Parameters	Discharged Effluent Concentration (mg/L)	Discharge Limit (mg/L)	Compliance with Discharge Limit
pH (pH units)	6.77 - 7.49	6-10 (a)	Yes
Suspended Solids	241	800	Yes
Biochemical Oxygen Demand (5 days, 20°)	63	800	Yes
Chemical Oxygen Demand	653	2,000	Yes
Oil & Grease	11	40	Yes
Total Nitrogen	165	200	Yes
Total Phosphorus	34.8	50	Yes
Surfactants (total)	<1.0	25	Yes
Notes: (a) Daily Average.			

No exceedance of discharge limit was recorded during the reporting period.

4.4 WASTE MANAGEMENT

4.4.1 Operation Phase Monitoring

Wastes generated from the operation of the Project include chemical waste, wastes generated from pre-treatment process and general refuse ⁽¹⁾. Reference has been made to the Monthly Summary Waste Flow Table prepared by the Contractor (see *Annex F*). With reference to the relevant handling records and trip tickets of this Project, the quantities of different types of waste generated from the operation of the Project in the reporting month are summarised in *Table 4.9*.

Table 4.9 Quantities of Waste Generated from the Operation of the Project

Month/Year	Chemical Waste	Waste Generated from Pre-treatment Process		General Refuse	
_	Disposal of at CWTC	Disposed of at Landfill (a)	Recycled (b)	Disposed of at Landfill (a) (d)	Recycled (c)
June 2020	0 L	347.23 tonnes	0.00 tonnes	2.88 tonnes (d)	0 kg
July 2020	2 00 L	852.07 tonnes	0.00 tonnes	3.00 tonnes (d)	0 kg
August 2020	0 L	700.25 tonnes	0.00 tonnes	2.88 tonnes (d)	1,200 kg

- (a) Waste generated from pre-treatment process and general refuse other than chemical waste and recyclables were disposed of at NENT landfill by sub-contractors.
- (b) Among waste generated from pre-treatment process, 0.00 kg of metals, 0.00 kg of papers/cardboard packing and 0.00 kg of plastics were sent to recyclers for recycling during the reporting period.
- (c) Among general refuse, 0.00 kg of metals, 1,200 kg of papers/ cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.
- (d) It was assumed that four 240-litre bins filled with 80% of general refuse were collected at each collection. The general refuse density was assumed to be around 0.15~kg/L.

Public fill and construction waste may only be generated during maintenance works when there are civil or structural works.

5 SITE AUDIT

5.1 ENVIRONMENTAL SITE AUDIT

5.1.1 *Operation Phase*

The monthly inspections of the landscape and visual mitigation measures for the operation phase of the Project covered the operation phase environmental site inspections. The inspections checked the implementation of the recommended mitigation measures for air quality, landscape and visual, water quality, waste (land contamination) and hazard-to-life stated in the Implementation Schedule (see *Annex D*).

Follow-up actions resulting from the site inspections were generally taken as reported by the Contractor. The Contractor has implemented environmental mitigation measures recommended in the approved EIA Report and EM&A Manual.

June 2020

The monthly inspection of the landscape and visual mitigation measures for the operation phase of the Project on 29 June 2020 covered the operation phase environmental site audit. Joint site inspections was conducted by representatives of the Contractor, ER, IEC and the MT on 29 June 2020 as required for the operation of the Project.

July 2020

The monthly inspection of the landscape and visual mitigation measures for the operation phase of the Project on 31 July 2020 covered the operation phase environmental site audit. Joint site inspections was conducted by representatives of the Contractor, ER, IEC and the MT on 31 July 2020 as required for the operation of the Project.

August 2020

The monthly inspection of the landscape and visual mitigation measures for the operation phase of the Project on 24 August 2020 covered the operation phase environmental site audit. Joint site inspections was conducted by representatives of the Contractor, IEC and the MT on 24 August 2020 as required for the operation of the Project.

5.2 LANDSCAPE AND VISUAL AUDIT

It was confirmed that the necessary landscape and visual mitigation measures during the operation phase as summarised in *Annex D* were generally implemented by the Contractor. No non-compliance in relation to the landscape and visual mitigation measures was identified during the site audits in this reporting period and therefore no further actions are required. The ET/MT will keep track of the EM&A programme to check compliance with environmental requirements and the proper implementation of all necessary mitigation measures.

June 2020

Inspection of the landscape and visual mitigation measures for the operation phase of the Project was performed on 29 June 2020.

July 2020

Inspection of the landscape and visual mitigation measures for the operation phase of the Project was performed on 31 July 2020.

August 2020

Inspection of the landscape and visual mitigation measures for the operation phase of the Project was performed on 24 August 2020.

6 ENVIRONMENTAL NON-CONFORMANCE

6.1 SUMMARY OF ENVIRONMENTAL NON-COMPLIANCE

June 2020

Non-compliance of emission limits for CHP and ASP were recorded during the reporting period.

The Contractor has reviewed the organic waste treatment processes (i.e. waste reception, waste pre-treatment, anaerobic digesters, and composting processes) and found that they were operated normally during the reporting period. The Contractor has investigated air pollution control systems for the CHP and ASP and identified several potential causes for the exceedance. Remedial and follow-up actions had been recommended to the Contractor to perform accordingly. The Investigation Report is show in *Annex H*.

July 2020

Non-compliance of emission limits for CAPCS, CHP and ASP were recorded during the reporting period.

The Contractor has reviewed the organic waste treatment processes (i.e. waste reception, waste pre-treatment, anaerobic digesters, and composting processes) and found that they were operated normally during the reporting period. The Contractor has investigated air pollution control systems for the CAPCS, CHP and ASP and identified several potential causes for the exceedance. Remedial and follow-up actions had been recommended to the Contractor to perform accordingly. The Investigation Report is show in *Annex H*.

August 2020

Non-compliance of emission limits for CHP and ASP were recorded during the reporting period.

The Contractor has reviewed the organic waste treatment processes (i.e. waste reception, waste pre-treatment, anaerobic digesters, and composting processes) and found that they were operated normally during the reporting period. The Contractor has investigated air pollution control systems for the CHP and the ASP and identified several potential causes for the exceedance. Remedial and follow-up actions had been recommended to the Contractor to perform accordingly. The Investigation Report is show in *Annex H*.

6.2 SUMMARY OF ENVIRONMENTAL COMPLAINT

No complaint was received during the reporting period.

6.3 SUMMARY OF ENVIRONMENTAL SUMMON AND SUCCESSFUL PROSECUTION

No summon/prosecution was received during the reporting period. The cumulative summons/prosecution log is shown in *Annex G*.

7 FUTURE KEY ISSUES

7.1 KEY ISSUES FOR THE COMING REPORTING PERIOD

Activities to be undertaken for the coming reporting period are:

- Operation of the Project.
- Modification of the ASP to control the air emission.

8 CONCLUSIONS

This EM&A Report presents the EM&A programme undertaken during the reporting period from **1 June 2020** to **31 August 2020** in accordance with EM&A Manual (Version F) and requirements of EP (FEP-01/395/2010/C).

For the operation phase, exceedances of the emission limits for stack monitoring (including CAPCS, CHP and ASP stacks) were recorded under normal operating conditions during the reporting period (see *Table 8.1*).

Table 8.1 Exceedances for Stack Emissions

Stack	Exceedances During the Reporting Period	
Centralised Air Pollution Control Unit (CAPCS)	Exceeded emission limit of Odour (including NH $_3$ & H $_2$ S) on 19 July 2020	
Cogeneration Unit (CHP)	 Exceeded emission limit of NO_x on 4, 5, 6, 7, 8, 9, 13, 14 and 15 June 2020, 5, 15, 16, 17, 23, 24, 26, 27, 28, 29, 30 and 31 July 2020 and 3, 4, 5, 6, 7, 8, 9, 10, 11, 12 and 16 August 2020 	
	 Exceeded emission limit of SO₂ on 17 and 18 June 2020 and 2 July 2020 	
Ammonia Stripping Plant (ASP)	• Exceeded emission limit on Carbon Monoxide on 22 and 23 June 2020 and 3, 6, 9, 10, 18 and 22 July 2020	
	• Exceeded emission limit of NO _x on 2, 3, 6, 7, 9, 15, 21, 23, 25 and 28 June 2020, 3, 6, 9, 10, 16, 17, 18, 19, 20, 21 and 22 July 2020 and 2, 3, 5, 8, 10, 19, 25, 28 and 31 August 2020	
	 Exceeded emission limit of SO₂ on 6 July 2020 	
	 Exceeded emission limit of VOCs (including methane) on 2, 17, 22, 23 and 27 June 2020 and 3, 6, 9, 10, 16, 17, 18, 19 and 20 July 2020 	
	• Exceeded emission limit of NH ₃ on 12, 17, 22, 23, 24, 25, 26, 27, 28 and 30 June 2020, 2, 3, 5, 6, 7, 8, 9, 10, 11, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 26, 27, 30 and 21 July 2020 and 3, 5, 6, 7, 8, 10, 13, 19, 21, 24, 25, 28 and 31 August 2020	
	• Exceeded emission limit of HCl on 6 July 2020	
	• Exceeded emission limit of HF on 6, 10, 16, 17 and 19 July 2020	

Exceedances in emission parameters of CAPCS, CHP and ASP were found to be results of system maintenance at CAPCS, low biogas loading at CHP and incomplete combustion of biogas at ASP.

The Contractor has implemented mitigation measures to control the exceedance including the continuous monitoring of CAPCS, CHP and ASP to optimise overall performance.

Odour patrols were conducted in accordance to the EM&A requirements. No exceedance of odour intensity limit for the odour patrols.

No non-compliance to the effluent discharge limit was recorded during this reporting period.


The environmental control / mitigation measures related to air quality, water quality, waste (including land contamination prevention), hazard-to-life and landscape and visual recommended in the approved EIA Report and the EM&A Manual were properly implemented by the Contractor during the reporting period.

Monthly landscape and visual monitoring were conducted in the reporting period. The necessary landscape and visual mitigation measures recommended in the approved EIA Report were generally implemented by the Contractor.

No complaint/summon/prosecution was received.

Annex A

Project Layout

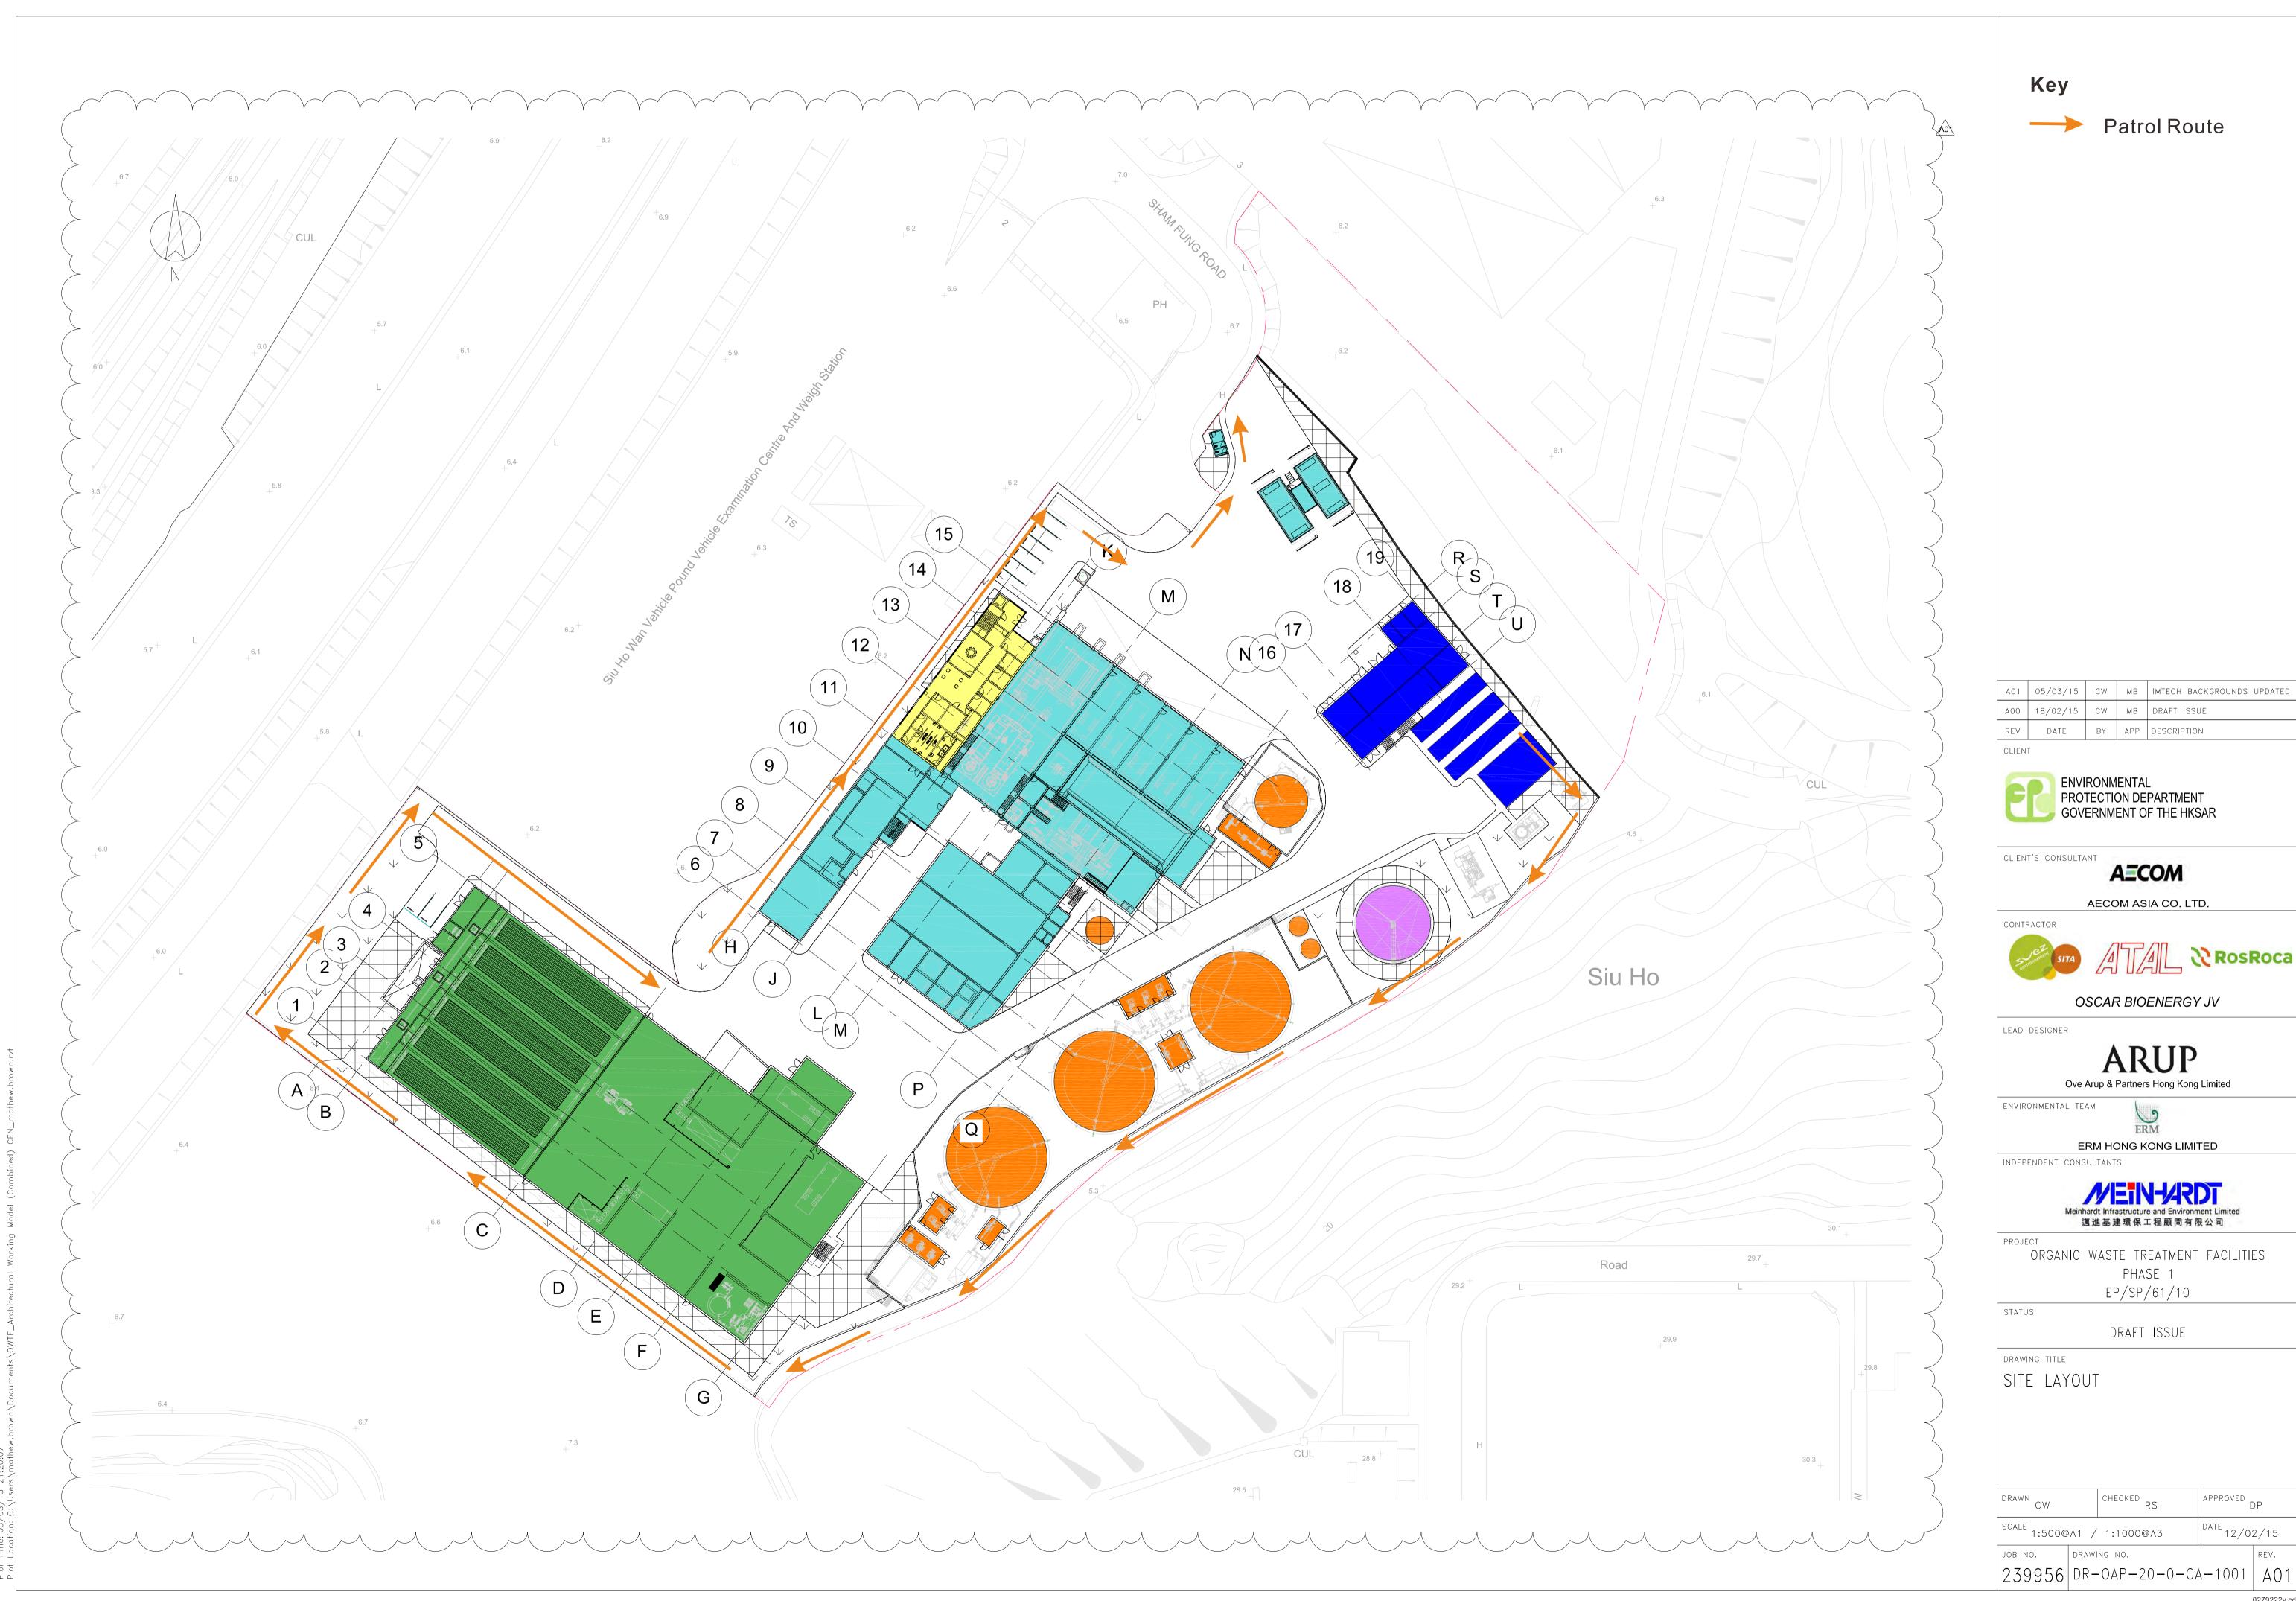


0279222v.cdr

Annex B

Project Organisation Chart with Contact Details

Project Organization (with contact details)

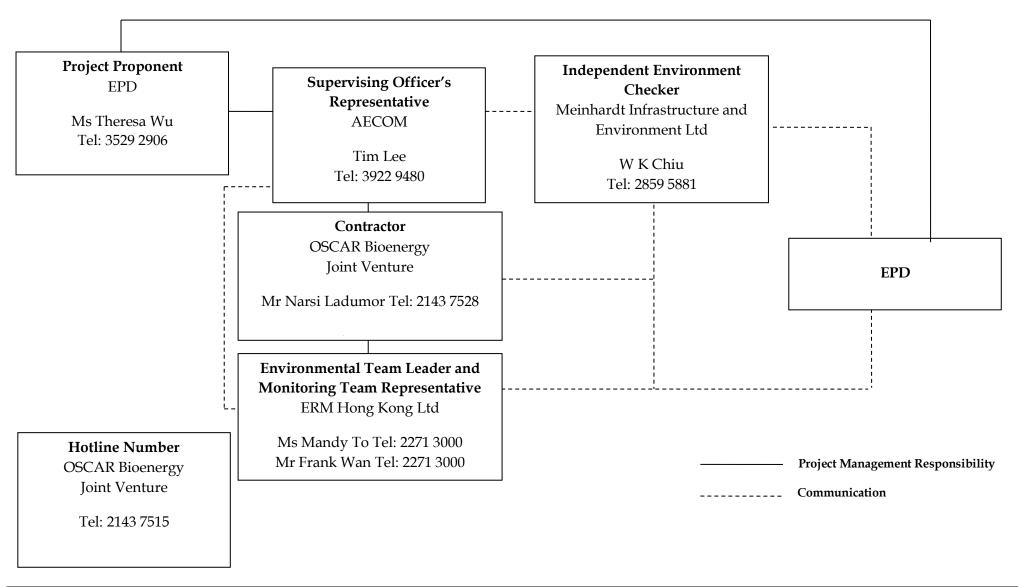

Annex C

Calibration Certification for the On-line Stack Monitoring System

Annex C1

Calibration Certification for the CEMS

Commissioning Check List 试运行检查项目表 MCS100FT

Cus	stomer data 客户资料						
	Customer: OSCA		Plant: OWTE				
	Location: SHW						
	Device data 设备资料 Device type 设备类型: McS[0 Serial no. 序列号: 1607 Sample probe type 取样探头类型: SFU	1					
2.	Plant data 电厂资料						
	entation of the stack 取样点	Outside 室外 Horizontal 水平	Under cove 有保护罩 Vertica 垂直	量□ 室内 ☑ cal			
	entation of sample gas probe 探头方向	Horizontal 水平 🗹	Vertica 垂直				
	Plant operating status	010 hpa	Gas ten	mperature 烟气温度 <u>4(c)</u>	_°C		
3.	Prerequisite 系统运行条件		Y N	Remarks 备注			
3.1.	Documentation + Delivery co 文件+货物是否齐全	mplete	0				
3.2.	Platform at measurement sponsuitable dimension? 测量点平台的尺寸是否合适?	ot has	d o				
3.3.	If this measurement location legal regulation, has it been acknowledged by an official b如果安装位置需要符合法律法位置是否被官方认可?	oody?	d 0				
3.4.	Customer specific data for parameterization available? 用户对系统参数的特殊要求是	否可行?					
5.5.	Cables, tubes and sample linbut not connected? 电缆、管线和取样管线安装但	e installed					
.6.	Compressed air station instal compressed air available? 压缩空气站已安装并且压缩空用?	led and					

4. 1	Preliminary work 预备工作				7
		Y	N	Remarks 备注	
4.1.	Mounting of flanges like described in the Operating Instruction? 法兰安装是否按照图纸?	Ø			
4.2.	Check for damage 检查外部损伤	Ø			
4.3.	Check ambient conditions 检查环境条件	Ø			
4.4.	Check mounting conditions 检查安装条件	D			
4.5.	Check cables / wires for correct installation 检查电缆/电线及其连接状况	D			
4.6.	Check main power supply voltage 检查总供电电压	Ø	П		
5. F	Periphery 外部设备				
		Y	N	Remarks 备注	
5.1.	Check compressed air supply 检查压缩空气供应	D/			
	Inlet 入口(5 bar):				
6. 5	Sample probe 取样探头	30	70.0	COLUMN TO STATE OF THE STATE OF	
		Υ	N	Remarks 备注	
6.1.	管线和电缆的连接	Ø			
6.2.	Install probe 探头安装	Ø			

7	MCS100FT			
	MICC TOUT T	Y	N	Remarks 备注
	Switch on analyzer and wait for warm up 打开分析仪并等待预热	Ø		
7.2.	Check sample conditions 检查样气情况	M		
	Flow rate 流量: 230 l/h			
7.3.	Check zero conditions 检查零点情况	Ø		
	Flow rate 流量: 160 l/h			
7.4.	Perform zero point setting 零点设置	Ø	07	Test results within specification,
7.5.	Perform span test 量程测试	Ø		
7.6.	Parameterize the I/O Module 设置 I/O 模块参数	Ø		
7.7.	Measured values are plausible 测量值是否合理	Ø		
7.8.	Save device data 储存设备数据	Q		
7.9.	Complete Commissioning Sign-Off Sheet 完成试运行签署表	Ø		
7.10	Instruct the operator personnel 操作员培训 Hand over the maintenance manual and check lists 移交维护手册和检查表 - Measurement reading 读取测量值 - Perform customer maintenance 演示维护方法 - Read messages 读取信息	Þ		

8. Measured value

Index Source		Unit	Range	e 范围	Reading	Output	
编号	信号源	单位	Start 开始	End 结束	(actual) 实际读数	value 产值	
1	HCL	mg/Nm3	0	(20	60.22 PPM	60,22 ppm	
2	HF	ma/Nm3	0	5	4,34 pm	4,34 ppm	
3	CO	ma/Nm3	0	1000	128.21ppm	128,20 ppm	
4	NO	ma/Nm3	0	500	122.01PPM	122,00 PPh	
5	NO ₂	ma/Nm3	0	200	98.81 ppm	98.80 PP4	
6	NO _X	ma/Nm3	0	500	4/21/10/13	4/2.12 ma	
7	SO ₂	max/Nm3	0	300	83,21 Ppm	83.21 PPH	
8	CO ₂	Vol 0/0	0	25	20,010/0	20.01.010	
9	H₂O	Vololo	0	40	32.020/0	32,010/0	
10	O ₂	10000	0	21	20,950/5	20,950/5	
11	TOC	mos/Nm3	0	300	122,01 ppm	122,01 pps	
12	NH ₃	ma/Nm3	0	100	53,30 ppm	53,3/pph	
13	CH4	ma/Nm3	0	100	112.01 ppm	112.01 PPW	
14		1 100		T. Ne	11-10-1-1-1	112011770	
15							

temarks 备注		
Date / 1	Name 签名	
Date 日期: 25/7/20/8 Engineer 工程师: Whith	Plant personnel 用户代表:	

(2)

Commissioning Check List 试运行检查项目表 MCS100FT

Cus	stomer data 客户资料						
	Customer: Oscar		Plant: OWTF				
	Location: SHW						
	Device data 设备资料 Device type 设备类型: MCS (00FT () Serial no. 序列号: 1607 0494 Sample probe type 取样探头类型: SFU						
2.	Plant data 电厂资料						
Loca	outside ation 标签编号 室外		nder cover Inside 有保护單				
Orientation of the stack 取样点 方向 水平		al	Vertical 垂直 ☑				
	Horizont 採头方向 水平	al	Vertical 垂直 □				
	Pressure 压力 <u>fo fo</u> Plant operating status 电厂运行情况 <u>Norma</u>	hpa	Gas temperature 烟气温度 <u>410</u> °C				
3.	Prerequisite 系统运行条件	Y	N Remarks 备注				
3.1.	Documentation + Delivery complete 文件+货物是否齐全	Ø					
3.2.	Platform at measurement spot has suitable dimension? 测量点平台的尺寸是否合适?	Ø					
3.3.	If this measurement location is under legal regulation, has it been acknowledged by an official body? 如果安装位置需要符合法律法规,此多位置是否被官方认可?	M					
3.4.	Customer specific data for parameterization available? 用户对系统参数的特殊要求是否可行?	Ø					
3,5.	Cables, tubes and sample line installed but not connected? 电缆、管线和取样管线安装但没有连接	M					
3.6.	Compressed air station installed and compressed air available? 压缩空气站已安装并且压缩空气可以使用?	ŧ 🗹					

4 1	Preliminary work 预备工作				_
7	Telliminary Work Don't Live	Y	N	Remarks 备注	
4.1.	Mounting of flanges like described in the Operating Instruction? 法兰安装是否按照图纸?	Ø			
4.2.	Check for damage 检查外部损伤	Ø			
4.3.	Check ambient conditions 检查环境条件	Ø			
4.4.	Check mounting conditions 检查安装条件	Ø.			
4.5.	Check cables / wires for correct installation 检查电缆/电线及其连接状况	Ø			
4.6.	Check main power supply voltage 检查总供电电压	M			
5. F	Periphery 外部设备				
		Y	N	Remarks 备注	
5.1.	Check compressed air supply 检查压缩空气供应	D			
	Inlet 入口(5 bar): 6 Bar				
6. 5	Sample probe 取样探头				
		Y	N	Remarks 备注	
6.1.	Connect bundle of tubes and cables 管线和电缆的连接	Ø			
6.2.	Install probe 探头安装	A			

7.	MCS100FT	Υ	N	Remarks 备注
7.1.	Switch on analyzer and wait for warm up 打开分析仪并等待预热	<u></u>		Nemans 甘仁
7.2.	Check sample conditions 检查样气情况	d		
	Flow rate 流量: 240 l/h			
7.3.	Check zero conditions 检查零点情况	M		
	Flow rate 流量: 150 l/h	1		
7.4.	Perform zero point setting 零点设置	V		
7.5.	Perform span test 量程测试	Ø		Test results within specification
7.6.	Parameterize the I/O Module 设置 I/O 模块参数	M		1
7.7.	Measured values are plausible 测量值是否合理	Ø		
7.8.	Save device data 储存设备数据	d		
7.9.	Complete Commissioning Sign-Off Sheet 完成试运行签署表	$ \sqrt{} $		
7.10	Instruct the operator personnel 操作员培训 Hand over the maintenance manual and check lists 移交维护手册和检查表 - Measurement reading 读取测量值 - Perform customer maintenance 演示维护方法 - Read messages 读取信息			

8. Measured value

Index	Source	Unit	Range	e 范围	Reading	Output	
编号	信号源	单位	Start 开始	End 结束	(actual) 实际读数	value 产值	
1	HCL	mg/N/m3	0	120	60.21 ppm	60.21 PP	
2	HF	ma/Nn3	0	5	4,32 ppm	4,32 ppm	
3	СО	ma/Nm3	0	1000	128.20 ppm	128.20 20	
4	NO	ma/Nm3	0	500	122,00 PPh	122,00 ppm	
5	NO ₂	ma/Nm3	0	200	98.80 ppin	98.81 PD	
6	NO _X	mal Nm2	0	500	4/2,22 mg/m	4/2,2/my/	
7	SO ₂	ma/Nm3	(2)	300	83,21 PPm	83.21 PPIn	
8	CO ₂	10/0/0	0	25	20.000/0	20.00 0/0	
9	H ₂ O	Vol do	0	40	32.0/0/0	32,010/0	
10	O ₂	Vol 0/0	0	21	20,950/0	20,950/0	
11	TOC	ma/Nm3	0	300	122,01 PPM	122,01 pm	
12	NH ₃	ma/Nin3	0	100	53,30 PPM	53,30 PP	
13	CH4	mg/Nm3	0	100	112.02 PPM	112,02 pp	
14		37.7.01			113	1	
15							

Remarks 备注		
Date	118	Name 签名
Date 日期: 25/7/2018 Engineer 工程师: Lullie Luw	Plant personnel 用户代表:	w.

		ns and their n Span Gas	Carbon Dioxide (CO2)	Oxygen (O2)	Methane (CH4)	Carbon Monoxide (CO)	Nitric Oxide (NO)	Sulphur Dioxide (SO2)	Nitrogen Dioxide (NO2)	Hydrogen Chloride (HCl)	Ammonia (NH3)	Hydrogen Floride (HF)	Propane (C3H8
Cal. Date and Line#			20	2.1	839	128.2	122	83.2	98.8	60.2	53.3	4.31	1117
07/May/2019	L1	Before				129.81	135.82	81.84	97.86	X			
07/Way/2013		After				127.93	123.07	83.37	99.1				
07/May/2019	L2	Before				126.03	118.64	82.58	97.71				
07/1VIAY/2019	LZ	After				129.02	122.17	83.17	98.57				
09/May/2019	L1	Before									52.15		
09/Way/2019	LT	After									53.17		
09/May/2019	L2	Before									51.76		
09/Way/2019	LZ	After									54.01		
05/Jun/2019	L1	Before	T-V	2.5									
05/101/2019	LT	After		2.1									
05/Jun/2019	L2	Before		2.4									
05/1011/2019	LZ	After		2.1									
	L1	Before				,							
		After											
	L2	Before											
	LZ	After		•									
	L1	Before											
		After											
	L2	Before											
	LZ	After											
	L1	Before											
	LI	After											
	L2	Before											
	LZ	After											
	L1	Before											
	LI	After											
	L2	Before											
	LZ	After											
	L1	Before											
		After											
	L2	Before											
	LZ	After											
	14	Before			7				A I V - T TE				
	L1	After											
		Before					1						
	L2	After											

Annex C2

Calibration Certification for the CAPCS

QM Zertifikat / QM certificate

Dusthunter SP30



Identifikation / identification

Artikel Nr. / Part No.:

1089203

DHSP30-T2V2FPNNNNNXXS

败

Ident Nr. / Ident no :

00116

Serien Nr. / Serial no.:

18168223

Firmware Version / Firmware version:

01.02.06 (Feb 27 2018 11:37:54)

Hardware Revision / Hardware version:

1.2

1

Geräteausführung / Device version:

BUS-Adresse / Bus address:

Bootloader Version / Bootloader version: 01.00.02

Parameter / Parameter

Sensorantwortzeit Sensor response time 60.0 sec.

Gebläse / Blower:

SN: 00014 / 08518553

Spantest 70 Laser /

Span 70 Laser

Relais 3:

installiert

installed

Referenzgerät Streulicht DHSP100 Serien-Nr.: Reference measuring device DHSP100 Serial no.:

Messgrößen u. Koeffizienten / Measuring variables and coefficients

Streulichtfaktoren / Scattered light coefficients:

CC0 (abs.):

-0.3800

CC1 (lin.):

Gain 0:

0.6850

CC2 (square):

0.0000

Verstärkungsfaktor, Offset / Gain factor, Offset:

10.0000

Offset 0: 0.00045

Faktoren Analogausgang / Analog Output factors:

CC0 (abs.): CC1 (lin.):

2.00 170.85

CC2 (square):

0.00

Koeffizientensätze Messbereich 0 / Coefficient Sets meas. range 0:

Koeff. Satz 1 / Coeff. set 1:

0.0000

CC 0 (abs.): CC 1 (lin.):

1.0000 0.0000

CC 2 (square):

CC 0 (abs.):

CC 1 (lin.):

CC 2 (square):

1.0000

0.0000

70.00 %

Wartung / Maintenance

0.0000

Messbereich, Grenzwert / Meas. range, limit:

Koeff, Satz 2 / Coeff, set 2:

Protokoll / protocol:

Modbus Schnittstelle / Modbus interface:

RTU

Meas. range switch: Messbereich Wert1 /

0.0 mg

0 (Software)

Adresse / address:

1

Meas. range low value:

Messbereichsschalter /

Baudrate / baudrate:

19200

Messbereich Wert2 /

75.0 mg

Datenbits Parität Stopbits / Databits parity stopbits:

8 EVEN 1

Meas. range high value:

Endian Codierung / endian code:

NONE

Grenzwert / Limit value:

50.0 mg

Gebläse Druck/Blower Pressure:

10.0 mbar

Das Gerät mit der o.g. Serien-Nr. wurde überprüft und kalibriert nach den Qualitätsstandards der SICK-Gruppe basierend auf einem nach ISO9001 zertifizierten Qualitätssicherungssystem.

This device with the serial no. noted above has been tested and calibrated according to the quality standards of the SICK-Group, which are based on a ISO9001 certified Quality Assurance System.

Ottendorf-Okrilla, 16.04.2018

Unterschrift:

Signature:



Annex D

Implementation Schedule of Mitigation Measures

Annex D Summary of Mitigation Measures Implementation Schedule for Operation Phase

EIA Ref.	EM&A	Environmental Protection Measures	Location/ Timing	Status
	Log Ref.			
	·	al Mitigation Measures in the EIA and EM&A Manual		
	ir Quality		T	T 1
3.78	2.7 & 2.13 - 2.19	Air Pollution Control (Construction Dust) Regulation & Good Site Practices	OWTF Stacks/ During	V
	- 2.19	•Commissioning tests shall be conducted to confirm the centralized air pollution control unit,	Commissioning Stage	
		the cogen units, the standby flaring unit and ASP against the design emission levels as stated in Tables 2.2 - 2.5.		
		•Odour monitoring shall be conducted at the stack exhaust of the centralized air pollution		
2.70	2.7.2.12	control unit weekly in the first month of the commissioning stage.		
3.78	2.7-2.12	Air Pollution Control and Stack Monitoring	During Operation	V
		•Stack monitoring shall be installed for the centralized air pollution control unit, cogen units		
		and ASP of OWTF to ensure that the air emissions from OWTF would meet the design emission		
		limits as well as EPD criteria.		
3.78	2.20- 2.28	•Odour Patrol at site boundary of OWTF	OWTF Site Boundary/During	N/A
			Operation (The need to continue	
			the odour patrol after the end of	
			the 2-year monitoring period	
			would depend on the monitoring	
			results and should be agreed	
			with EPD)	
В. Н	lazard to Life	<u></u>	with El D)	<u> </u>
4.103	3.4	Operation Phase	Work Site / During Operation	V
		•3m high fence should be constructed along the boundary facing the SHWWTW	Period	
		•Emergency evacuation procedures should be formulated and the Contractor should ensure		
		on site staff should be familiar with these procedures. Diagram showing the escape routes to a		
		safe place should be posted in the site notice boards and at the entrance/exit of site. A copy of		
		the latest version emergency procedures should be dispatched to Tung Chung Fire Station for reference once available.		
		•The emergency procedures should specify means of providing a rapid and direct warning		
		(e.g. Siren and Flashing Light) to personnel on site in the event of chlorine gas release in the SHWWTW.		

EIA Ref.	EM&A	Environmental Protection Measures	Location/ Timing	Status
	Log Ref.			
		•The Contractor should establish a communication channel with the SHWWTW operation personnel and FSD. In case of any hazardous incidents in the treatment works, operation personnel of SHWWTW should advise the Contractor to inform personnel on site to proceed		
		with emergency procedure. The Contractor should appoint a Liaison Officer to communicate with FSD Incident Commander on site in case of emergency.		
		•Periodic drills should be coordinated and conducted to ensure all on site personnel are		
		familiar with the emergency procedures. Upon completion of the drills, a review on every		
		step taken should be conducted to identify area of improvement. Prior notice of periodic drills		
		should be given to Station Commander of Tung Chung Fire Station. Joint operational exercise		
		with FSD and SHWWTW is recommended.		
	later Quality	I W C O W . T P	T	
5.44	4.5	Wastewater from Organic Waste Treatment Process	Work Site / During Design &	V
		The Project site will be equipped with an adequately sized wastewater treatment plant. A	Operation Period	
		high rate type of active sludge system specifically designed for the removal of nitrogen components from the wastewater in combination with conversion of residual BOD and COD		
		would be deployed. The wastewater treatment plant would also be incorporated with		
		SHARON or annamox technology or equivalent to achieve high total overall nitrogen		
		removal. Wastewater generated from the OWTF (including wastewater from dewatering		
		process, leachate from waste reception area, condensate from biogas handling, wastewater		
		from scrubber of air treatment system and any surplus water from truck washing facility)		
		will be diverted to the wastewater treatment plant. Treated effluent will then be stored		
		temporarily in order to be used as process water within the plants. The storage volume		
		would be around 20 m3. Overflow from the tank will be discharged to foul sewers. The		
		polluting parameters in effluent shall be in compliance with the requirements specified in		
		the TM- DSS. The design, installation and operation of the wastewater treatment plant shall be licensed under the Waste Disposal Ordinance and subject to the effluent monitoring as		
		required under the WPCO which is under the ambit of regional office (RO) of EPD. To		
		ensure that wastewater can be adequately treated and effluent from treatment plant can		
		meet the standards listed in TM- DSS, the following mitigation measure should be		
		conducted.		
		Cleaning and maintenance of treatment facilities should be conducted on a regular		
		basis to ensure that removal rate of each treatment facility would not be reduced.		
		Cleaning and maintenance of pipelines should be carried out on a regular basis to		
		prevent block of pipeline and leaching of wastewater, and therefore prevent		
		overflowed or leached wastewater discharging into nearby drainages and water		
		streams.		
		Regular site inspection should be conducted to ensure that no wastewater can be directly discharged into property victor through		
		directly discharged into nearby water streams.		

EIA Ref.	EM&A	Environmental Protection Measures	Location/ Timing	Status
	Log Ref.			
5.55	4.5	In the scrubber, spraying water should be re-circulated to minimize the need for external water.	Work Site / During Design &	$\sqrt{}$
		The spraying water would be collected at the bottom of the scrubber. Excess water would be discharged to the wastewater treatment plant as described in Section 5.54.	Operation Period	
5.56	4.5	The waste reception, treatment facilities and compost storages of OWTF should be located in	Work Site / During Design &	√ √
		enclosed buildings to prevent generation of contaminated rain runoff. All surface runoff such	Operation Period	
		as washed water generated in the treatment processes areas should be properly collected and	_	
		diverted to the on-site wastewater treatment plant as described in Section 5.54.		
5.57	4.5	All drainage system for collection and transferring wastewater generated in the OWTF to the	Work Site / During Design &	$\sqrt{}$
		on-site wastewater treatment plant as described in Section 5.54 should be capable of preventing clogging and easy maintenance and cleaning.	Operation Period	
D. V	Vaste Managem		1	
6.50	5.12	Good Site Practices	During Operation Period	V
		Good operational practices should be adopted to Minimize waste management impacts:		
		•Obtain the necessary waste disposal permits from the appropriate authorities, in accordance		
		with the Waste Disposal Ordinance (Cap. 354), Waste Disposal (Chemical Waste) (General)		
		Regulation and the Land (Miscellaneous Provision) Ordinance (Cap. 28);		
		•Nomination of an approved person to be responsible for good site practice, arrangements for		
		collection and effective disposal to an appropriate facility of all wastes generated at the site;		
		•Use of a waste haulier licensed to collect specific category of waste;		
		•A trip-ticket system should be included as one of the contractual requirements and		
		implemented by the Environmental Team to monitor the disposal of solid wastes at public		
		filling facilities and landfills, and to control fly tipping. Reference should be made to ETWB		
		TCW No. 31/2004.		
		•Training of site personnel in proper waste management and chemical waste handling		
		procedures;		
		•Separation of chemical wastes for special handling and appropriate treatment at a licensed		
		facility;		
		•Routine cleaning and maintenance programme for drainage systems, sumps and oil		
		interceptors;		
		•Provision of sufficient waste disposal points and regular collection for disposal;		
		•Adoption of appropriate measures to minimize windblown litter and dust during		
		transportation of waste, such as covering trucks or transporting wastes in enclosed containers; and		
		•Implementation of a recording system for the amount of wastes generated, recycled and		

EIA Ref.	EM&A Log Ref.	Environmental Protection Measures	Location/ Timing	Status
		disposed of (including the disposal sites).		
6.51	5.13	Waste Reduction Measures Good management and control can prevent the generation of significant amounts of waste. It is recommended that the following good operational practices should be adopted to ensure waste reduction:	During Operation Period	√
		•Segregation and storage of different types of waste in different containers, skips or stockpiles		
		to enhance reuse or recycling of materials and their proper disposal;		
		•Encourage collection of aluminum cans, plastic bottles and packaging material (e.g. carton		
		boxes) and office paper by individual collectors. Separate labelled bins should be provided to help segregate this waste from other general refuse generated by the work force; and •Any unused chemicals or those with remaining functional capacity should be reused as far as		
		practicable.		
6.52	5.14	Wastes Generated from Pre-Treatment Process	Pre-Treatment Process/ During	 √
		Wastes generated from pre-treatment process should be recycled as far as possible. Wastes generated from pre- treatment process should also be separated from any chemical waste and stored in covered skips. The recyclables should be collected by licensed collectors, while the rest of the waste should be removed from the site on a daily basis to minimize odour, pest and litter impacts. Open burning must be strictly prohibited.	Operation Period	
6.53-6.56	5.15-5.18	<u>Chemical Wastes</u>	Whole Site / During Operation	√
		•Chemical waste generated from machinery maintenance and servicing should be managed in accordance with Code of Practice on the Packaging, Labelling and storage of Chemical Wastes under the provisions of Waste Disposal (Chemical Waste) (General) Regulation. The chemical waste should be collected by drum-type containers and removed by licensed chemical waste contractors.	Period	
		•Plant / equipment maintenance schedules should be planned in order to minimize the		
		generation of chemical waste.		
		•Non-recyclable chemical wastes and lubricants should be disposed of at appropriate facilities, such as CWTC. Copies or counterfoils from collection receipts issued by the licensed waste collector should be kept for recording purpose.		
		•Recyclable chemical waste will be transported off-site for treatment by a licensed collector. The Contractor will need to register with EPD as a chemical waste producer. Where possible, chemical wastes (e.g. waste lubricants) would be recycled at appropriate facilities, such as		
		Dunwell's oil re-refinery.		
6.57-6.58	5.19-5.20	General Refuse	Whole Site / During Operation	√

EIA Ref.	EM&A Log Ref.	Environmental Protection Measures	Location/ Timing	Status
		•Waste generated in offices should be reduced through segregation and collection of	Period	
		recyclables. To promote the recycling of wastes such as used paper, aluminum cans and plastic bottles, it is recommended that recycling bins should be clearly labelled and placed at locations with easy access. For the collection of recyclable materials, they should be collected by licensed collectors.		
		•General refuse, other than segregated recyclable wastes, should be separated from any		
		chemical waste and stored in covered skips. The general refuse should be removed from the site on a daily basis to minimize odour, pest and litter impacts. Also, open burning of refuse must be strictly prohibited.		
Е. Р		Contamination Preventive Measures		
6.65	5.21 (i)	 Fuel Oil Containers Fuel oil should be stored in suitable containers. All fuel oil containers should be securely closed. Appropriate labels showing the name of fuel oil should be posted on the containers. Drip trays should be provided for all containers. 	Fuel Oil Storage Containers /During Operation Period	√
6.65	5.21 (ii)	 Storage Area Distance between the fuel oil refuelling points and the fuel oil containers should be minimized. The storage area should be used for fuel oil storage only. No surface water drains or foul sewers should be connected to the storage area. The storage area should be enclosed by three sides by a wall and have an impermeable floor or surface. 	Fuel Oil Storage Area / During Operation Period	√
6.65	5.21 (iii)	Fuel Oil Spillage Response An Oil Spill Response Plan should be prepared by the operator to document the appropriate response procedures for oil spillage incident in detail. General procedures to be taken in case of fuel oil spillage are presented below. • Training Training on oil spill response actions should be given to relevant staff. The training should cover the followings: - Tools & resources to combat oil spillage and fire, e.g. locations of oil spill handling equipment and firefighting equipment; - General methods to deal with oil spillage and fire incidents; - Procedures for emergency drills in the event of oil spills and fire; and - Regular drills should be carried out. • Communication Establish communication channel with the Fire Services Department (FSD) and EPD to	Whole Site / During Operation Phase	√

EIA Ref.	EM&A	Environmental Protection Measures	Location/ Timing	Status
	Log Ref.			
		report any oil spillage incident so that necessary assistance from relevant department could be quickly sought. • Response Procedure Any fuel oil spillage within the Project Site should be immediately reported to the Site Manager with necessary details including location, source, possible cause and extent of the spillage Site Manager should immediately attend to the spillage and initiate any appropriate action to confine and clean up the spillage. The response procedures should include the following: - Identify and isolate the source of spillage as soon as possible. - Contain the oil spillage and avoid infiltration into soil / groundwater and discharge to storm water channels. - Remove the oil spillage. - Clean up the contaminated area. - If the oil spillage occurs during refuelling, the refuelling operation should immediately be stopped. - Recovered contaminated fuel oil and the associated material to remove the spilled oil should be considered as chemical waste. The handling and disposal procedures for chemical wastes are discussed in the following		
6.66	5.22 (i)	 Chemicals and Chemical Wastes Handling & Storage Chemicals and chemical wastes should only be stored in suitable containers in purpose-built areas. The storage of chemical wastes should comply with the requirements of the Code of Practice on the Packaging, Labelling and Storage of Chemical Wastes. The storage areas for chemicals and chemical wastes should have an impermeable floor or surface. The impermeable floor I surface should possess the following properties: Not liable to chemically react with the materials and their containers to be stored. Able to withstand normal loading and physical damage caused by container handling The integrity and condition of the impermeable floor or surface should be inspected at regular intervals to ensure that it is satisfactorily maintained For liquid chemicals and chemical wastes storage, the storage area should be bonded to contain at least 110% of the storage capacity of the largest containers or 20% of the total quantity of the chemicals/chemical wastes stored, whichever is the greater. 	Whole Site / During Operation Period	

EIA Ref.	EM&A Log Ref.	Environmental Protection Measures	Location/ Timing	Status
		 Storage container should be checked at regular intervals for their structural integrity and to ensure that the caps or fill points are tightly closed. Chemical handling should be conducted by trained workers under supervision. 		
6.66	5.22 (ii)	Chemicals and Chemical Wastes Spillage Response A Chemicals and / or Chemical Wastes Spillage Response Plan should be prepared by the operator to document in detail the appropriate response procedures for chemicals or chemical wastes spillage incidents. General procedures to be undertaken in case of chemicals I chemical wastes spillage incidents. General procedures to be undertaken in case of chemicals I chemical waste spillages are presented below • Training • Training on spill response actions should be given to relevant staff. The training should cover the followings: - Tools & resources to handle spillage, e.g. locations of spill handling equipment; - General methods to deal with spillage; and - Procedures for emergency drills in the event of spills. • Communication Establish communication channel with Fire Services Department (FSD) and EPD to report the spillage incident so that necessary assistance from relevant department could be quickly sought. • Response Procedures Any spillage within OWTF site should be reported to the Site Manager. Site Manager shall attend to the spillage and initiate any appropriate actions needed to confine and clean up the spillage. The response procedures should include the followings: - Identify and isolate the source of spillage as soon as possible; - Contain the spillage and avoid infiltration into soil / groundwater and discharge to storm water channels (in case the spillage occurs at locations out of the designated storage areas); - Remove the spillage; the removal method / procedures documented in the Material Safety Data Sheet (MSDS) of the chemicals spilled should be observed; - Clean up the contaminated area (in case the spillage occurs at locations out of the designated storage areas); and - The waste arising from the cleanup operation should be considered as chemical wastes.	Whole Site / During Operation Period	
6.67 - 6.69	5.23- 5.25	Incident Record • After any spillage, an incident report should be prepared by the Site Manager. The incident report should contain details of the incident including the cause of the	Whole Site / During Operation Period	√

EIA Ref.	EM&A	Environmental Protection Measures	Location/ Timing	Status
	Log Ref.			
		 incident, the material spilled and estimated spillage amount, and also the response actions undertaken. The incident record should be kept carefully and able to be retrieved when necessary. The incident report should provide sufficient details for the evaluation of any environmental impacts due to the spillage and assessment of the effectiveness of measures taken. In case any spillage or accidents results in significant land contamination, EPD should be informed immediately and the Project operator should be responsible for the cleanup of the affected area. The responses procedures described in Sections 6.65 - 6.66 of the EIA Report should be followed accordingly together with the land contamination assessment and remediation guidelines stipulated in the Guidance Manual for Use of Risk-based Remediation Goals for Contaminated Land Management and the Guidance Note for Contaminated Land Assessment and Remediation. 		
	andscape and V			
7.98 & Table 7.8	Table 6.2	 Operation Phase Aesthetic design of the facade, including its colour theme, pattern, texture, materials, finishing and associated structures to harmonize with the surrounding settings Grass / groundcover planting to soften the roof Heavy standard tree planting to screen proposed associated structures Grasscrete paving to soften the harshness of large paved surface areas wherever possible 	Within Project Area / During Design & Operation Stages	

Remark:

- √ Compliance of Mitigation Measures
- Compliance of Mitigation but need improvement
- x Non-compliance of Mitigation Measures
- ▲ Non-compliance of Mitigation Measures but rectified by OSCAR Bioenergy JV
- Δ Deficiency of Mitigation Measures but rectified by OSCAR Bioenergy JV
- N/A Not Applicable in Reporting Period

Annex E

Laboratory Results for NMVOCs



ALS Technichem (HK) Pty Ltd 11/F, Chung Shun Knitting Centre 1-3 Wing Yip Street Kwai Chung, N.T., Hong Kong I +852 2610 1044 F+852 2610 2021

CERTIFICATE OF ANALYSIS

CLIENT:

Oscar Bioenergy Joint

WORK ORDER:

HK2030690

Venture

CONTACT: ADDRESS:

Mr Edwin wong

No. 5, Sham Fung Road,

LABORATORY:

Hong Kong

Siu Ho Wan, Lantau Island,

SUB-BATCH:

Hong Kong

NT, Hong Kong

DATE RECEIVED:

14th August, 2020

DATE OF ISSUE:

27th August, 2020

PROJECT:

Stack Gas Sampling - CHP2

SAMPLE TYPE:

Air

SITE:

O·Park1, Siu Ho Wan, Lantau Island

NO. OF SAMPLES:

1

PO: ---

COMMENTS

One (1) stack gas sample for CHP-2 was collected by ALS Technichem (HK) staff on 14th August, 2020 at the O·Park1 (Organic Resources Recovery Centre) in Lantau Island.

Sampling information (Project name, Sample ID) is provided by client.

The sample(s) was analysed and reported on as received basis.

NOTES

This is the Final Report and supersedes any preliminary report with this batch number.

Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

Richard Jung Managing Director - Hong Kong

This report may not be reproduced except with prior written approval from ALS Technichem (HK) Pty Ltd,



Work Order No.: HK2030690

1. Summary of Work

This document is the final report for the stack gas sampling and testing event for Oscar Bioenergy Joint Venture in Siu Ho Wan, North Lantau Island.

Sampling Date: 14th August 2020 Location of Stack: ORRC1, Siu Ho Wan

No. of Stack: 1

Name of Stack: CHP-2

Methods for Stack Sampling and Analysis:

Parameter	Method Reference	Sampling Time (minutes)
Volatile Organic Compounds (VOCs)[1]	US EPA Method 18	60
Non-Methane Volatile Organic Compounds (NMCOCs)[1]	US EPA Method 18	60

Note:

[1]: Results expressed as carbon

2. Sampling Summary

Volatile Organic Compounds (VOCs)

Sample gas was collected by using a stainless steel sampling probe, from the centroid of the stack, into the Tedlar bag by passive sampling technique.

The measurement of total volatile organic compounds (VOCs) content in the sample was conducted in references to BS EN 12619. VOCs content was determined by measuring the methane and non-methane volatile organic compounds of the sample by Gas Chromatograph-Flame Ionisation Detector (GC-FID).

VOCs was reported as the sum of methane and non-methane organics content in the sample.

3. Sampling Period and Stack Parameter

Test Parameter	Sampling Period
Volatile Organic Compounds (VOCs)	14 August 2020 11:17 - 12:17

Stack Parameter	Unit	Concentration
Oxygen	%	10.5



Work Order No.: HK2030690

4. Result

Parameter	Unit	Reporting Limit	Result ^{[1] [2]}
Gaseous & vaporous organic substances (VOCs)	mg/m³	0.7	894
Methane (CH ₄)	mg/m³	0.5	892
Non-Methane Organic Carbon (NMOC)	mg/m³	0.2	2.7

Note:

^[1] Results expressed as dry, at 0 degree Celsius temperature, 101.325 kilopascal pressure and $6\% O_2$ content conditions. [2] Results expressed as carbon.

Annex F

Waste Flow Table

No. EP/SP/61/10 of Organic Resources Recovery Centre (Phase 1) Monthly Summary Waste Flow Table

		Wast	e Generated from Pr	etreatment Process					Genera	l Refuse			
Month	Chemical Waste	Disposed of at Landfill (see Note 1)	Metals (see Note 2)	Paper/ cardboard packaging (see Note 2)	Plastics (see Note 3)	Dispose Landfill (se & 4	ee Note 1	Metals (se	e Note 2)	Paper/ ca packaging 2)	(see Note	Plas (see No	
	Litre	tonne	kilogram	kilogram	kilogram	No. of collection	tonne	No. of collection	kilogram	No. of collection	kilogram	No. of collection	kilogram
March 2019	1,200	477.08	0	0	0	26	1.50	0	0	0	0	0	0
April 2019	0	455.60	0	0	0	22	1.27	0	0	0	0	0	0
May 2019	1,000	528.22	0	0	0	25	2.88	0	0	0	0	1	390
June 2019	0	459.23	0	0	0	24	2.76	0	0	0	0	0	0
July 2019	0	521.79	0	0	0	26	3.00	0	0	0	0	0	0
August 2019	40	441.05	0	0	0	27	3.11	0	0	0	0	0	0
September 2019	1,800	576.28	0	0	0	24	2.76	0	0	0	0	0	0
October 2019	0	441.22	0	0	0	25	2.88	0	0	0	0	0	0
November 2019	1,600	451.57	0	0	0	26	3.00	0	0	0	0	0	0
December 2019	1,009	488.13	0	0	0	24	2.76	0	0	0	0	0	0
January 2020	0	388.20	0	0	0	23	2.65	0	0	0	0	0	0
February 2020	4,525	372.97	0	0	0	24	2.76	0	0	0	0	0	0
March 2020	1,200	351.71	0	0	0	27	3.11	0	0	0	0	0	0
April 2020	0	363.92	0	0	0	21	2.42	0	0	0	0	0	0
May 2020	800	294.36	0	0	0	25	2.88	0	0	0	0	0	0
June 2020	0	347.23	0	0	0	25	2.88	0	0	0	0	0	0
July 2020	200	852.07	0	0	0	26	3.00	0	0	0	0	0	0
August 2020	0	700.25	0	0	0	25	2.88	0	0	1	1,200	0	0
Total	13,374	7,810.64	0	0	0	420	45.62	0	0	1	1,200	1	390

Notes:

- 1. General refuse was disposed of at NENT by subcontractors.
- Metal and paper/cardboard packaging were collected by recycler for recycling.

 Plastics refer to plastic bottles/containers, plastic sheets/foam from packaging material collected by recycler for recycling.
- It was assumed that four 240-litre bins filled with 80% of general refuse were collected at each collection. The general refuse density was assumed to be around 0.15 kg/L.

Annex G

Environmental Complaint, Environmental Summons and Persecution Log

Annex G Cumulative Complaint and Summons/Prosecutions Log

Reporting Month	Number of Complaints in Reporting Month	Number of Summons/Prosecutions in Reporting Month
May 2015	0	0
June 2015	0	0
July 2015	0	0
August 2015	0	0
September 2015	0	0
October 2015	0	0
November 2015	0	0
December 2015	0	0
January 2016	0	0
February 2016	0	0
March 2016	0	0
April 2016	0	0
May 2016	0	0
June 2016	0	0
July 2016	0	0
August 2016	0	0
September 2016	0	0
October 2016	0	0

Reporting Month	Number of Complaints in Reporting Month	Number of Summons/Prosecutions in Reporting Month
November 2016	0	0
December 2016	0	0
January 2017	0	0
February 2017	0	0
March 2017	0	0
April 2017	0	0
May 2017	0	0
June 2017	0	0
July 2017	0	0
August 2017	0	0
September 2017	0	0
October 2017	0	0
November 2017	0	0
December 2017	0	0
January 2018	0	0
February 2018	0	0
March 2018	0	0
April 2018	0	0
May 2018	0	0
June 2018	0	0

Reporting Month	Number of Complaints in Reporting Month	Number of Summons/Prosecutions in Reporting Month
July 2018	0	0
August 2018	0	0
September 2018	1	0
October 2018	0	0
November 2018	0	0
December 2018	0	0
January 2019	0	0
February 2019	0	0
March 2019	0	0
April 2019	0	0
May 2019	0	0
June 2019	0	0
July 2019	0	0
August 2019	0	0
September 2019	0	0
October 2019	0	0
November 2019	0	0
December 2019	0	0
January 2020	0	0
February 2020	0	0

Reporting Month	Number of Complaints in Reporting Month	Number of Summons/Prosecutions in Reporting Month
March 2020	0	0
April 2020	0	0
May 2020	0	0
June 2020	0	0
July 2020	0	0
August 2020	0	0
Overall Total	1	0

Annex H

Investigation Report

Annex H1

Investigation Report - ⅓ bY2020

Investigation Report of CEMS Exceedances

Monitoring Location	Date	1 – 30 June 2020
Parameter Various emission parameters of the Cogeneration Unit (CHP) and Ammonia Stripping Plan (ASP) 1. Continuous monitoring was carried out at the CAPCS, CHP and ASP throughout the reporting period using the CEMS. According to the EM&A Manual, exceedance is considered if the emission concentration of the concerned pollutants is higher than the emission limits stated in Tables 2.2, 2.3 and 2.5 of the EM&A Manual (Version F) for CAPCS, CHP and ASP respectively. The concentration of the concerned air pollutants were monitored on-line by the CEMS. Exceedances of various emission parameters were recorded on the CEMS including: SO ₂ and NO ₃ in the CHP Carbon Monoxide, NO ₄ VOCs (including methane) and NH ₃ in the ASP. 2. According to the Contractor, the plant was receiving around 100 tonnes of SSOW daily and was operated normally. 3. The Contractor explained that the exceedances recorded in the ASP was because the thermal combustion unit of the ASP still require tuning to optimise the combustion efficiency. Action Taken / Action to be Taken Action Taken / Action to be Taken Action Taken / Action to be Taken The Contractor explained that the exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is able to travel to Hong Kong. The Contractor is recommended to closely monitor the	Time	Continuous monitoring throughout June 2020
Exceedance Description 1. Continuous monitoring was carried out at the CAPCS, CHP and ASP throughout the reporting period using the CEMS. According to the EM&A Manual, exceedance is considered if the emission concentration of the concerned pollutants is higher than the emission limits stated in Tables 2.2, 2.3 and 2.5 of the EM&A Manual (Version F) for CAPCS, CHP and ASP respectively. The concentration of the concerned air pollutants were monitored on-line by the CEMS. Exceedances of various emission parameters were recorded on the CEMS including; • SO ₂ and NO ₃ in the CHP • Carbon Monoxide, NO ₃ VOCs (including methane) and NH ₃ in the ASP. 2. According to the Contractor, the plant was receiving around 100 tonnes of SSOW daily and was operated normally. 3. The Contractor explained that the exceedances recorded in the ASP still require tuning to optimise the combustion efficiency. • It was arranged with the supplier of CHPs to check the performance of the stacks onsite during the reporting period. The supplier conducted a detailed investigation of the remaining exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. • Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong. Hong we to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is able to travel to Hong Kong.	Monitoring Location	Continuous Environmental Monitoring System (CEMS)
Exceedance Description 1. Continuous monitoring was carried out at the CAPCS, CHP and ASP throughout the reporting period using the CEMS. According to the EM&A Manual, exceedance is considered if the emission concentration of the concerned pollutants is higher than the emission limits stated in Tables 2.2, 2.3 and 2.5 of the EM&A Manual (Version F) for CAPCS, CHP and ASP respectively. The concentration of the concerned air pollutants were monitored on-line by the CEMS. Exceedances of various emission parameters were recorded on the CEMS including: SO ₂ and NO ₃ in the CHP Carbon Monoxide, NO ₃ VOCs (including methane) and NH ₃ in the ASP. According to the Contractor, the plant was receiving around 100 tonnes of SSOW daily and was operated normally. The Contractor explained that the exceedances recorded in the ASP still require tuning to optimise the combustion efficiency. Action Taken / Action to be Taken Action Taken / Action to be Taken The Contractor is particularly and was operated normally. It was arranged with the supplier of CHPs to check the performance of the stacks onsite during the reporting period. The supplier conducted a detailed investigation of the remaining exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is able to travel to Hong Kong. The Contractor is recommended to closely monitor the	Parameter	, , ,
CHP and ASP throughout the reporting period using the CEMS. According to the EM&A Manual, exceedance is considered if the emission concentration of the concerned pollutants is higher than the emission limits stated in Tables 2.2, 2.3 and 2.5 of the EM&A Manual (Version F) for CAPCS, CHP and ASP respectively. The concentration of the concerned air pollutants were monitored on-line by the CEMS. Exceedances of various emission parameters were recorded on the CEMS including: SO ₂ and NO _x in the CHP Carbon Monoxide, NO _x VOCs (including methane) and NH ₃ in the ASP. According to the Contractor, the plant was receiving around 100 tonnes of SSOW daily and was operated normally. The Contractor explained that the exceedances recorded in the ASP was because the thermal combustion unit of the ASP still require tuning to optimise the combustion efficiency. Action Taken / Action to be Taken Action Taken / Action to be Taken Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is able to travel to Hong Kong. Remedial Works and The Contractor is recommended to closely monitor the		
normally. 3. The Contractor explained that the exceedances recorded in the ASP was because the thermal combustion unit of the ASP still require tuning to optimise the combustion efficiency. Action Taken / Action to be Taken • It was arranged with the supplier of CHPs to check the performance of the stacks onsite during the reporting period. The supplier conducted a detailed investigation of the remaining exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. • Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is able to travel to Hong Kong. Remedial Works and	Exceedance Description	CHP and ASP throughout the reporting period using the CEMS. According to the EM&A Manual, exceedance is considered if the emission concentration of the concerned pollutants is higher than the emission limits stated in Tables 2.2, 2.3 and 2.5 of the EM&A Manual (Version F) for CAPCS, CHP and ASP respectively. The concentration of the concerned air pollutants were monitored on-line by the CEMS. Exceedances of various emission parameters were recorded on the CEMS including: • SO ₂ and NO _x in the CHP • Carbon Monoxide, NO _x VOCs (including methane) and NH ₃ in the ASP. 2. According to the Contractor, the plant was receiving
in the ASP was because the thermal combustion unit of the ASP still require tuning to optimise the combustion efficiency. Action Taken / Action to be Taken It was arranged with the supplier of CHPs to check the performance of the stacks onsite during the reporting period. The supplier conducted a detailed investigation of the remaining exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is able to travel to Hong Kong. Remedial Works and The Contractor is recommended to closely monitor the		around 100 tonnes of SSOW daily and was operated
Taken performance of the stacks onsite during the reporting period. The supplier conducted a detailed investigation of the remaining exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. • Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is able to travel to Hong Kong. Remedial Works and		in the ASP was because the thermal combustion unit of the ASP still require tuning to optimise the combustion efficiency.
Remedial Works and The Contractor is recommended to closely monitor the		 performance of the stacks onsite during the reporting period. The supplier conducted a detailed investigation of the remaining exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive travel arrangement during this reporting period. The modification work will continue once the supplier is
, and the second se	Remedial Works and	5 5
Follow-up Actions processes, including the modification work and follow-up	Follow-up Actions	processes, including the modification work and follow-up

OSCAR Bioenergy Joint Venture EP/SP/61/10 - Organic Resources Recovery Centre Phase 1

emission monitoring of the ASP to avoid exceedance. MT will
carry out follow-up audit regarding the progress next month.

Prepared by: Bonia Leung, MT Representative

Date 6 July 2020

Annex H2

Investigation Report - ⅓ `m2020

Investigation Report of CEMS Exceedances

Date	1 - 31 July 2020
Time	Continuous monitoring throughout July 2020
Monitoring Location	Continuous Environmental Monitoring System (CEMS)
Parameter	Various emission parameters of the Cogeneration Unit (CHP)
	and Ammonia Stripping Plan (ASP)
Exceedance Description	 Continuous monitoring was carried out at the CAPCS, CHP and ASP throughout the reporting period using the CEMS. According to the EM&A Manual, exceedance is considered if the emission concentration of the concerned pollutants is higher than the emission limits stated in Tables 2.2, 2.3 and 2.5 of the EM&A Manual (Version F) for CAPCS, CHP and ASP respectively. The concentration of the concerned air pollutants were monitored on-line by the CEMS. Exceedances of various emission parameters were recorded on the CEMS including: Odour (including NH₃ and H₂S) in the CAPCS SO₂ and NO_x in the CHP Carbon Monoxide, NO_x, SO₂, VOCs (including methane), NH₃, HCL and HF in the ASP. According to the Contractor, the plant was receiving around 100 tonnes of SSOW daily and was operated normally. The Contractor explained that the exceedances recorded
	in the ASP was because the thermal combustion unit of
	the ASP still require tuning to optimise the combustion
Action Taken / Action to be Taken	 CAPCS was undergoing system maintenance during the report period which results in the fluctuation in readings. The supplier will monitor the CAPCS to improve the performance in the next reporting period. It was arranged with the supplier of CHPs to check the performance of the stacks onsite during the reporting period. The supplier will conduct a detailed investigation of the remaining exceedance recorded on the CHPs. After the investigation, the Contractor will perform the maintenance work according to suggestions raised by the supplier. Parts of the modification works on the ASP has been completed, with more components waiting to be delivered to Hong Kong. The Contractor has scheduled the remaining modification work for the next few reporting periods with schedule shutdown of the ASP to facilitate the installation of equipment for performance optimisation. However, the supplier could not travel to Hong Kong due to the restrictive

OSCAR Bioenergy Joint Venture EP/SP/61/10 - Organic Resources Recovery Centre Phase 1

	travel arrangement during this reporting period. The
	modification work will continue once the supplier is
	able to travel to Hong Kong.
Remedial Works and	The Contractor is recommended to closely monitor the
Follow-up Actions	processes, including the modification work and follow-up
_	emission monitoring of the ASP to avoid exceedance. MT will
	carry out follow-up audit regarding the progress next month.

Prepared by: Bonia Leung, MT Representative

Date 7 August 2020

Annex H3

Investigation Report - 5 i [i gh2020

Investigation Report of CEMS Exceedances

Date	1 – 31 August 2020
Time	Continuous monitoring throughout August 2020
Monitoring Location	Continuous Environmental Monitoring System (CEMS)
Parameter	Various emission parameters of the Cogeneration Unit (CHP)
	and Ammonia Stripping Plan (ASP)
Exceedance Description	 Continuous monitoring was carried out at the CAPCS, CHP and ASP throughout the reporting period using the CEMS. According to the EM&A Manual, exceedance is considered if the emission concentration of the concerned pollutants is higher than the emission limits stated in Tables 2.2, 2.3 and 2.5 of the EM&A Manual (Version F) for CAPCS, CHP and ASP respectively. The concentration of the concerned air pollutants were monitored on-line by the CEMS. Exceedances of various emission parameters were recorded on the CEMS including: NO_x in the CHP NO_x and NH₃ in the ASP.
	 According to the Contractor, the plant was receiving around 100 tonnes of SSOW daily and was operated normally. The Contractor explained that exceedances recorded in the CHP was due to the low biogas loading which results in the poor performance efficiency in CHP. Exceedances in ASP was caused by unstable column temperature in biogas combustion
Action Taken / Action to be Taken	 CHP improvement was conducted in previous reporting periods, including tuning equipment set points, changing filters and cleaning of equipment components. Supplier was arranged to perform finetuning of equipment on-site. The Contractor will continue to monitor the emission of CHP and avoid the running of CHPs when biogas loading is lower than optimal performance efficiency in order to prevent further exceedances. Parts of the modification works were completed in previous reporting periods, including the installation of the air blast cooler and the heat exchanger. These equipment aim to stablise the temperature of the ASP column to allow complete combustion of biogas in the ASP. Column stripping and packing cleaning were performed in this reporting period to maintain operation efficiency. For the remaining exceedances, it was arranged with the supplier of ASP to check the performance of the stacks onsite. However the supplier could not travel to Hong Kong during this

OSCAR Bioenergy Joint Venture EP/SP/61/10 - Organic Resources Recovery Centre Phase 1

	reporting period due to restrictive travel arrangement.							
	Communication with supplier was maintained and							
	fine-tuning of equipment was performed according to							
	supplier's instructions. The Contractor continues to							
	carry out maintenance measures as per the supplier's							
	manual.							
Remedial Works and	The Contractor is recommended to closely monitor the							
Follow-up Actions	processes, including the modification work and follow-up							
	emission monitoring of the CHP and ASP to avoid							
	exceedance. MT will carry out follow-up audit regarding the							
	progress next month.							

Prepared by: Bonia Leung, MT Representative
Date 9 September 2020

Annex =

Odour Patrol Result

Annex **=**1

Odour Patrol Result - July 208\$



ALS Technichem (HK) Pty Ltd
11/F, Chung Shun Knitting Centre
1-3 Wing Yip Street
Kwai Chung, N.T., Hong Kong
T+852 2610 1044 F+852 2610 2021

CERTIFICATE OF ANALYSIS

CLIENT:

Oscar Bioenergy Joint

WORK ORDER:

HK2024844

CONTACT:

Venture Mr Terence Chan

ADDRESS: No

No. 5, Sham Fung Road, Siu

LABORATORY:

Hong Kong

Ho Wan, North Lantau

Island, NT, Hong Kong

SUB-BATCH:

DATE OF ISSUE:

nong kong

DATE OF PATROL:

3rd July 2020 11th July 2020

PROJECT:

Odour Patrol for the Organic

Resources Recovery Centre

Phase 1 in Siu Ho Wan

SITE:

Organic Resources Recovery

Centre Phase 1 (O-Park 1)

COMMENTS

Odour Patrol was conducted by ALS Technichem (HK) Pty Ltd staff during 10:34 - 10:52 and 15:46 - 16:03.

Sampling information (Project name, Sample ID) is provided by client.

NOTES

This is the Final Report and supersedes any preliminary report with this batch number.

Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

Richard Fung

Managing Director - Hong Kong

This report may not be reproduced except with prior written approval from ALS Technichem (HK) Pty Ltd.



1. Summary of Work

Work Order: HK2024844

The odour patrol was conducted during daytime and evening time.

2. Odour Patrol

Odour patrolling is a process to make use of the calibrated olfactory senses (ie the nasal sense) of the patrol members to evaluate the odour and its intensity during a patrol exercise at the site.

The patrol work was conducted by two odour patrol team members from ALS Technichem (HK) Pty Ltd during each time session. All members are free from any respiratory diseases during patrol day. None of the members has been working or living in the area of the vicinity of the inspection zone.

The patrol team was required to move slowly from one to the other monitoring locations and use their olfactory senses to detect odour at each location.

The location of odour sources and the areas to be affected by the odour nuisance were identified as much as possible.

During the patrolling, the meteorological and surrounding information were recorded:

- the prevailing weather condition;
- the wind direction;
- the wind speed:
- location where odour is spotted;
- possible source of odour;
- perceived intensity of the odour;
- duration of odour: and
- characteristics of the odour detected.

The perceived intensity is to be divided into 5 levels which are ranked in an ascending order as follows:

0	Not detected	No odour perceives or an odour so weak that it cannot be easily characterised or described
1	Slight	Identifiable odour, slight
2	Moderate	Identifiable odour, moderate
3	Strong	Identifiable odour, strong
4	Extreme	Severe odour

The odour patrol location was shown in Appendix 1.



Odour Patrol Result: 3. 3.1.


Daytime:

Location	Panellist	Weather	다 다 RH WS 으로 Odour Duration o		Duration of	Direction from	On-Site Observation									
Loca	Pane	Wea	Time	(°C)	(%)	(m/s)	WD (Degree)	Intensity	Odour	Source	Odour Characteristics	Potential Odour Source				
8	1	Cloudy	10:34	31.0	90.3	1.8	171	0	NA	NA	NA	NA				
0	2	Cloudy	10.54	31.0	90.5	1.0	1/1	0	NA	NA	NA .	NA NA				
7	1	Claudy	10.27	10:37	10.27	10.27	10.27	30.8	88.7	1.0	175	1	Intermittent	Downwind	Diograf	Biogas Holder
/	2	Cloudy	10.57	30.8	00.7	1.0	1/3	1	memmatem	Downwina	Biogas	Tank Relief Valve				
2	1	Claudy	10.40	30.4	89.2	0.6	108	100	1	Intermittent	Side wind	Diograf	Biogas Holder			
2	2	Cloudy	10:40	30.4	69.2	0.6		1	mtermittent	Side Willd	Biogas	Tank Relief Valve				
3	1	Claudy	10.42	20.0	000	0.4	109	0	NIA	NIA	NIA	NA				
3	2	Cloudy	10:42	30.0	88.2	0.4		109	0	NA	NA	NA	NA			
F	1		1 10 15	21.2	90.0	0.0		0	NIA	NIA	NA	NA				
5	5 Clo	Cloudy	10:45	5 31.2	2 89.9			0	NA	NA						



Location	T RH WS C	D iree)	Odour Odour	Duration of	Direction from	On-Site Observation								
Loca	Panellist	Weather	Time	(°C)	(%)	(m/s)	WD (Degree)	Intensity Odour	Odour	Source	Odour Characteristics	Potential Odour Source		
6	1	Cloudy	10:48	30.6	88.4	0.8	132 0	NA	NA	NA	NA			
	2							0						
9	1	Claudy	10:50	30.4	86.2	0.0				0	- NA	NA	NIA	NIA
9	2	Cloudy	10.50	30.4	60.2	0.0		0	INA INA	NA	NA	NA		
10	$ \begin{array}{c c} 1 & \text{Cloudy} \\ \hline 2 & \end{array} $	10:52	25.6	70.1	0.0		1		N/A	Marata	At a Casa divisa a sa			
10		Cloudy	10.32	23.6	70.1	0.0		1	Continuous	NA	Musty smell	Air Conditioner		

Remark: T: A Air Temperature; Relative Humidity; Wind Speed; Wind Direction. RH: WS: WD:





3.2. Evening time:

tion	Illist	ther	T'	Т	DII (0/)	WS	D ree)	Odour	Duration of	Direction uration of from	On-Site O	bservation	
Location	Panellist	Weather	Time	(°C)	RH (%)	(m/s)	WD (Degree)	Intensity	Odour	Source	Odour Characteristics	Potential Odour Source	
8	1	Cloudy	15:46	30.1	88.3	0.0		0	NA	NA	NA	NA	
0	2	Cloudy	13.40	30.1	00.3	0.0		0	INA	INA		IVA	
7	1	Cloudy	15 40 30 3	30.3	86.1	0.8	199	0.0 100	1	Intermittent	Side wind	Garbage	Pre-treatment
	2	Cloudy	15:48	50.5	80.1	0.8	199	1	mennicent	Side Willu	Garbage	Hall	
2	1	Cloudy	1 1	5:51 29.2	90.4	0.0		0	NA	NA	NA	NA	
2	2	Cloudy	15:51	29.2	90.4			0	INA .	NA	IVA	IVA	
3	1	Cloudy	15.53	29.8	00.7	0.2	0.3 335	225	1	Continuous	6:1	Biogas and	Biogas Holder
3	2	Cloudy	15:52	29.0	90.7	0.5		1	Continuous	Side wind	rotten eggs	Tank Relief Valve and Sewage	
5	1	Claudy	15:55 30	15.55	90.5	0.0		1		NI A	_		
)	2	Cloudy		30.0				1	Continuous	NA	Grassy	Nearby vegetation	



Location	Panellist	Weather	Time	Т	RH	WS	WD (Degree)	Odour	Duration of	Direction	IIration of I		servation
Loca	Pane	Wea	Time	(°C)	(%)	(m/s)	M (Deg	Intensity	Odour	from Source	Odour Characteristics	Potential Odour Source	
6	1	Claudy	15.55	0.2	182	0	NA	NI A	NA	NA			
	2 Cloudy 15:57	13.37	30.1	90.2	0.2	102	0	INA	NA	IVA	IVA		
9	1	Claudy	16:00	29.8	88.3	0.5	333	0	NA	NI A	NIA	NIA	
9	2	Cloudy	10.00	29.0	00.3			0	NA	NA	NA	NA	
10	1	Claudy	loudy 16:03	25.1	70.4	0.0		1	_		M. at a see II	A' Carditi and	
10	2	Cloudy		25.1		0.0		1	Continuous	NA	Musty smell	Air Conditioner	


Remark:


T: Air Temperature; RH: Relative Humidity; WS: Wind Speed; WD: Wind Direction.




APPENDIX 1

Odour Patrol Route

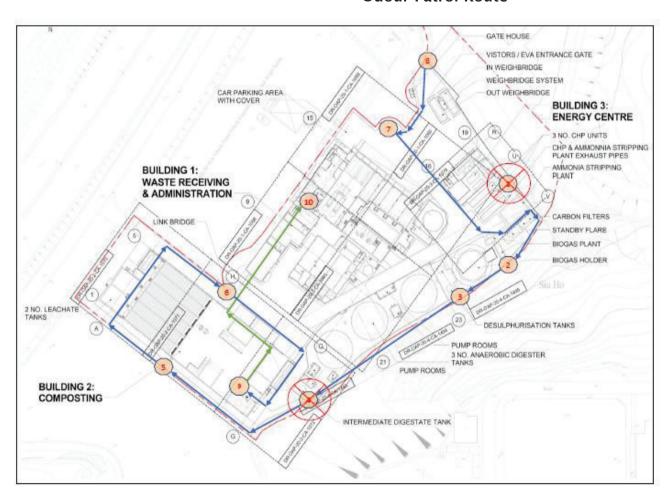









APPENDIX 2


Extract of Meteorological Observations from Hong Kong Airport Observatory Station

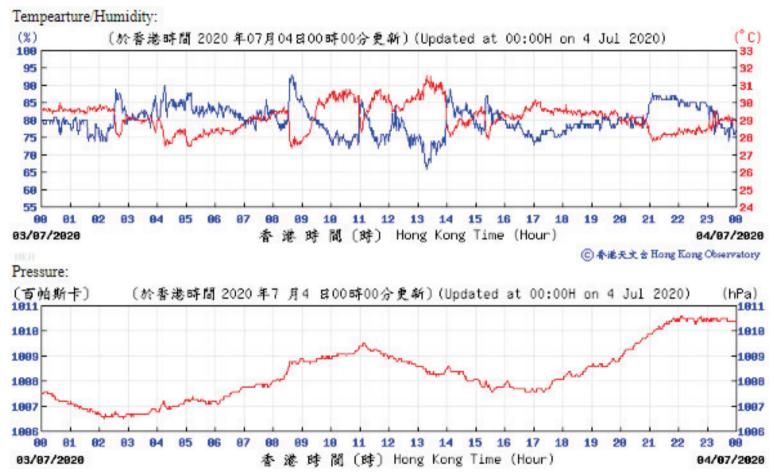






Wind Direction:

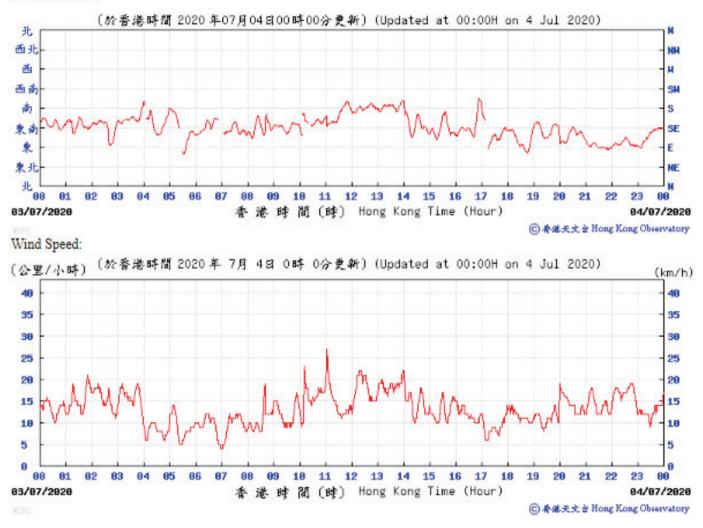





APPENDIX 3

A3.1. Odour Patrol at Different Locations - Daytime



Location: 2



Location: 7



Location: 3



Location: 8



Location: 5




Location: 9



Location: 6



Location: 10





A3.2. Odour Patrol at Different Locations - Evening time



Location: 2



Location: 7



Location: 3



Location: 8



Location: 5



Location: 9



Location: 6



Location: 10

Annex **=**2

Odour Patrol Result - August 20&\$



ALS Technichem (HK) Pty Ltd
11/F, Chung Shun Knitting Centre
1-3 Wing Yip Street
Kwai Chung, N.T., Hong Kong
T +852 2610 1044 F +852 2610 2021

CERTIFICATE OF ANALYSIS

CLIENT:

Oscar Bioenergy Joint

WORK ORDER:

HK2024844

CONTACT:

Venture Mr Terenc

ADDRESS:

Mr Terence Chan

No. 5, Sham Fung Road, Siu Ho Wan, North Lantau

Island, NT, Hong Kong

LABORATORY:

Hong Kong

SUB-BATCH: DATE OF PATROL:

0 3rd luly 2020

DATE OF ISSUE:

11th July 2020

PROJECT:

Odour Patrol for the Organic

Resources Recovery Centre

Phase 1 in Siu Ho Wan

SITE:

Organic Resources Recovery

Centre Phase 1 (O-Park 1)

COMMENTS

Odour Patrol was conducted by ALS Technichem (HK) Pty Ltd staff during 10:34 - 10:52 and 15:46 - 16:03.

Sampling information (Project name, Sample ID) is provided by client.

NOTES

This is the Final Report and supersedes any preliminary report with this batch number.

Results apply to sample(s) as submitted. All pages of this report have been checked and approved for release.

Richard Fung Managing Director - Hong Kong

This report may not be reproduced except with prior written approval from ALS Technichem (HK) Pty Ltd.



1. Summary of Work

Work Order: HK2024844

The odour patrol was conducted during daytime and evening time.

2. Odour Patrol

Odour patrolling is a process to make use of the calibrated olfactory senses (ie the nasal sense) of the patrol members to evaluate the odour and its intensity during a patrol exercise at the site.

The patrol work was conducted by two odour patrol team members from ALS Technichem (HK) Pty Ltd during each time session. All members are free from any respiratory diseases during patrol day. None of the members has been working or living in the area of the vicinity of the inspection zone.

The patrol team was required to move slowly from one to the other monitoring locations and use their olfactory senses to detect odour at each location.

The location of odour sources and the areas to be affected by the odour nuisance were identified as much as possible.

During the patrolling, the meteorological and surrounding information were recorded:

- the prevailing weather condition;
- the wind direction;
- the wind speed:
- location where odour is spotted;
- possible source of odour;
- perceived intensity of the odour;
- duration of odour: and
- characteristics of the odour detected.

The perceived intensity is to be divided into 5 levels which are ranked in an ascending order as follows:

0	Not detected	No odour perceives or an odour so weak that it cannot be easily characterised or described
1	Slight	Identifiable odour, slight
2	Moderate	Identifiable odour, moderate
3	Strong	Identifiable odour, strong
4	Extreme	Severe odour

The odour patrol location was shown in Appendix 1.



Odour Patrol Result: 3. 3.1.


Daytime:

Location	Panellist	Weather	Time	т	RH	WS	WD (Degree)	Odour	Duration of	Direction from Source	On-Site Observation	
Loca	Pane	Wea	Time	(°C)	(%)	(m/s)	W (Deg	Intensity	Odour		Odour Characteristics	Potential Odour Source
8	1	Cloudy	10:34	31.0	00.3	1.0	171	0	NIA	NIA	NIA	N.A.
0	2	Cloudy	10.54	31.0	90.3	1.8	171	0	NA	NA	NA	NA
7	1	Claudy	Cloudy 10:37	30.8	88.7	1.0	175	1	Intermittent	Downwind	Biogas	Biogas Holder Tank Relief Valve
/	2	Cloudy		30.8				1				
2	1	Claudy	10:40	30.4	4 89.2	0.6	108	1	Intermittent	Side wind	Biogas	Biogas Holder Tank Relief Valve
2	2	Cloudy						1				
3	1	Claudy	10:42	30.0	88.2	0.4	109	0	NA	NA	NA	NA
3	2	Cloudy						0				
F	1	Claudy	10:45	5 31.2	89.9	0.0		0	- NA	NA	NA	NA
5	2	Cloudy						0				



Location	Panellist	Weather	Time	T (°C)	RH (%)	WS (m/s)	WD (Degree)	Odour Intensity	Duration of Odour	Direction from Source	On-Site Observation	
Loca	Pane										Odour Characteristics	Potential Odour Source
6	1	Cloudy	10:48	30.6	88.4	0.8	132	0	NA	NA	NA	NA
	2							0				
9	1	Claudy	10:50	30.4	86.2	0.0		0	NA	NA	NA	NA
9	2 Cloud	Cloudy		30.4	00.2			0				
10	1	Claudy	10.52	25.6	70.1	0.0		1	- Continuous	NA	Musty smell	Air Conditioner
10	2	Cloudy	10:52					1				

Remark: T: A Air Temperature; Relative Humidity; Wind Speed; Wind Direction. RH: WS: WD:





3.2. Evening time:

Location	Panellist Weather		T:	Т	DII (0/)	WS	WD (Degree)	Odour	Duration of	Direction from	On-Site O	bservation
Loca	Pane	Wea	Time	(°C)	RH (%)	(m/s)	W (Deg	Intensity	Odour	Source	Odour Characteristics	Potential Odour Source
8	1	Cloudy	15.46	30.1	88.3	0.0		0		NA	NA	NA
0	2	Cloudy	15:46					0	NA			
7	1	Claudy	y 15:48	30.3	86.1	0.8	199	1	Intermittent	Side wind	Garbage	Pre–treatment Hall
	2	Cloudy						1				
2	1	Cloudy	15:51	29.2	90.4	0.0		0	NA	NA	NA	NA
2	2							0				
3	1	Cloudy	15:52 29	29.8	90.7	0.3	335	1	Continuous	Side wind	Biogas and rotten eggs	Biogas Holder Tank Relief Valve and Sewage
3	2	Cloudy			90.7	0.3		1				
5	1	Claudy	15:55	:55 30.6	90.5	0.0		1	6 .:	NA	Grassy	Nearby vegetation
)	2	Cloudy						1	Continuous			



Location	Panellist	Weather	Time	Т	RH	WS	WD (Degree)	Odour	Duration of	Direction from Source	On-Site Observation	
Loca	Pane	Wea	Time	(°C)	(%)	(m/s)	W (Deg	Intensity	Odour		Odour Characteristics	Potential Odour Source
6	1	Cloudy	15:57	30.1	90.2	0.2	182	0	NA	NA	NA	NA
	2	Cloudy		50.1				0				
9	1	Claudy	16:00	29.8	88.3	0.5	333	0	NA	NA	NA	NA
9	Cloudy 1	10.00	29.6	00.3	0.5	333	0	NA	NA	NA	IVA	
10	1	Claudy	udy 16:03 2	25.1	70.4	0.0		1	.	NA	Musty smell	Air Conditioner
10	2	Cloudy						1	Continuous			


Remark:


T: Air Temperature; RH: Relative Humidity; WS: Wind Speed; WD: Wind Direction.




APPENDIX 1

Odour Patrol Route

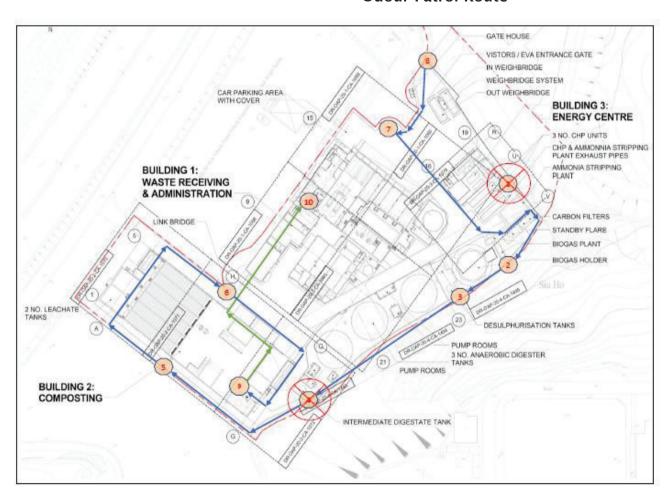









APPENDIX 2


Extract of Meteorological Observations from Hong Kong Airport Observatory Station

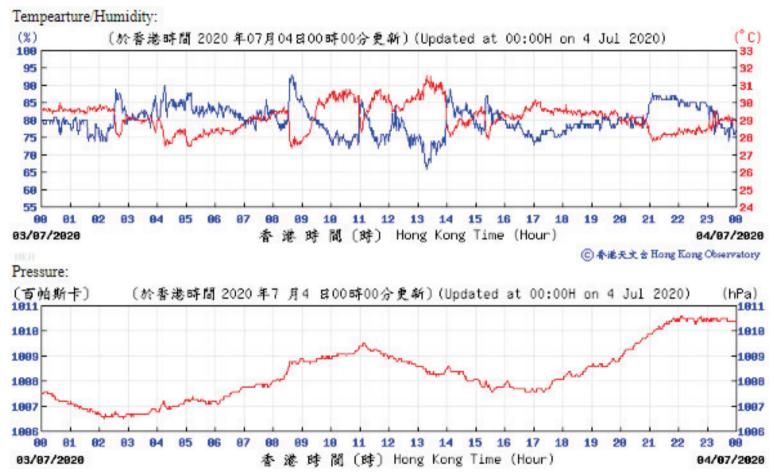






Wind Direction:

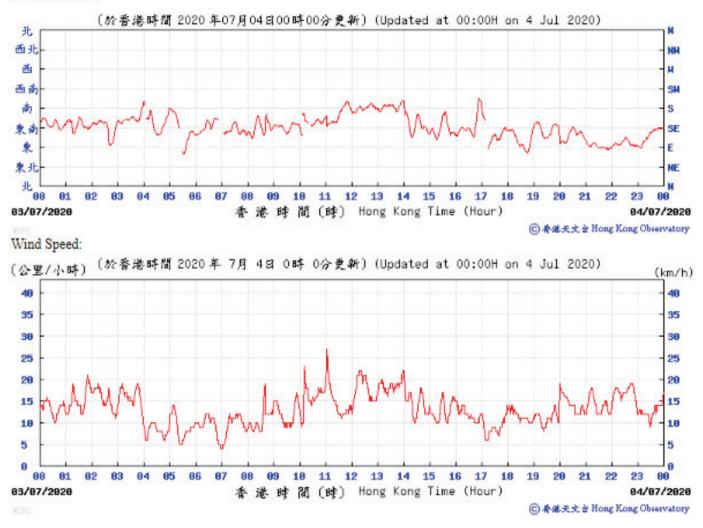





APPENDIX 3

A3.1. Odour Patrol at Different Locations - Daytime



Location: 2



Location: 7



Location: 3



Location: 8



Location: 5




Location: 9



Location: 6



Location: 10





A3.2. Odour Patrol at Different Locations - Evening time



Location: 2



Location: 7



Location: 3



Location: 8



Location: 5



Location: 9



Location: 6



Location: 10