


1. The conductor is retrieved by tension support of an Anti-twisting steel wire rope, the Anti-twisting steel wire rope is retrieved by Dyneema rope, then the Dyneema rope is retrieved by tension support of 6mm rope.

1. 無扭編織鋼絲繩以張力支撐收回導體，迪尼瑪繩索以張力支撐收回無扭編織鋼絲繩，然後6毫米繩索以張力支撐收回迪尼瑪繩索

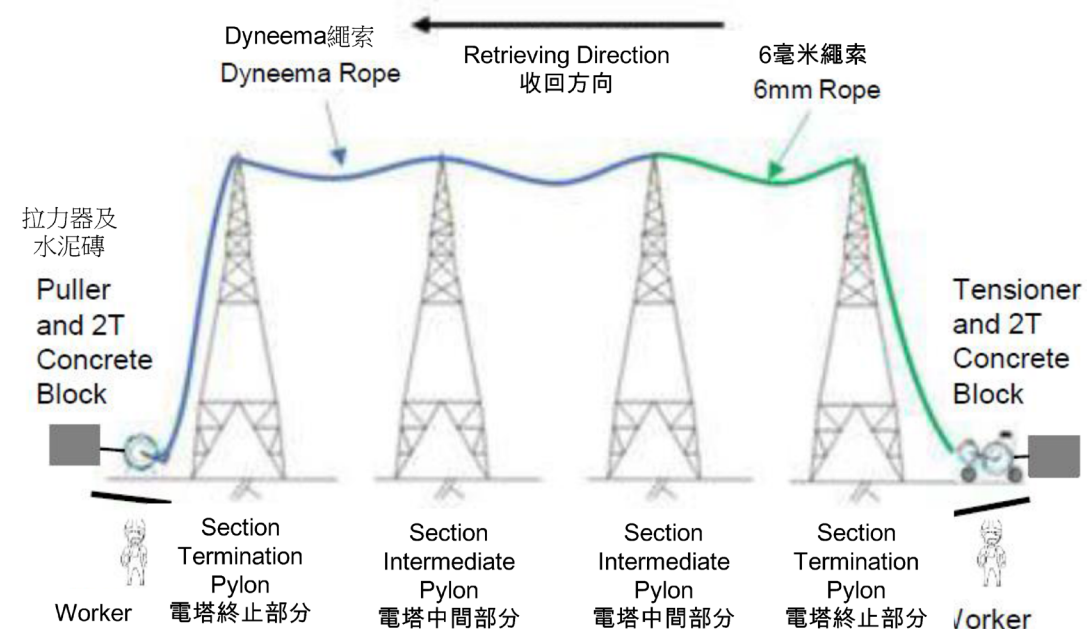

2. When the whole session is covered by the 6mm rope, then the 6mm rope is gently lowered down to the ground level.

2. 當整節電纜都被6毫米繩索覆蓋時，將6毫米繩索輕輕降低到地面

Project Title
工程項目名稱

Removal of 132kV Overhead Line and Pylons for B-Line and W-Line
寶雲段及黃泥涌段 132kV 架空電纜及電纜塔的拆除工程

Environmental Permit No.: EP-642/2024
環境許可證編號: EP-642/2024



Figure 16:
圖 16:

Work Method - Retraction of Conductor and Retrieval of Dyneema Rope (Page 1 of 2)
施工方法 - 收回導體和迪尼瑪繩索 (第 1 頁, 共 2 頁)