



Detail A
1:30

200mm thick additional concrete paving
A layer of general fill material of varying depth (refer to Fig.14 & 15) to make up for level differences if necessary

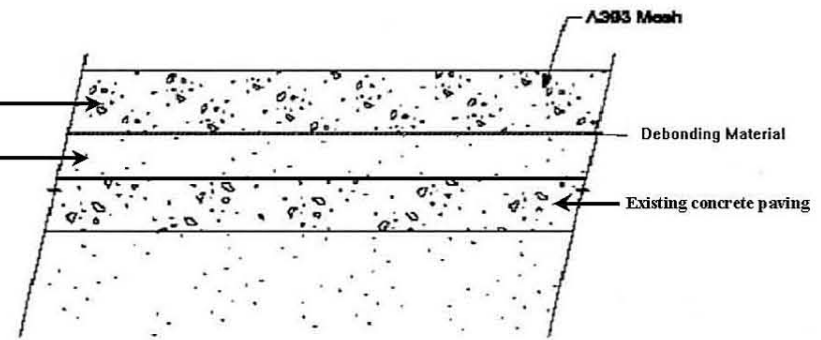

Detail B
1:30

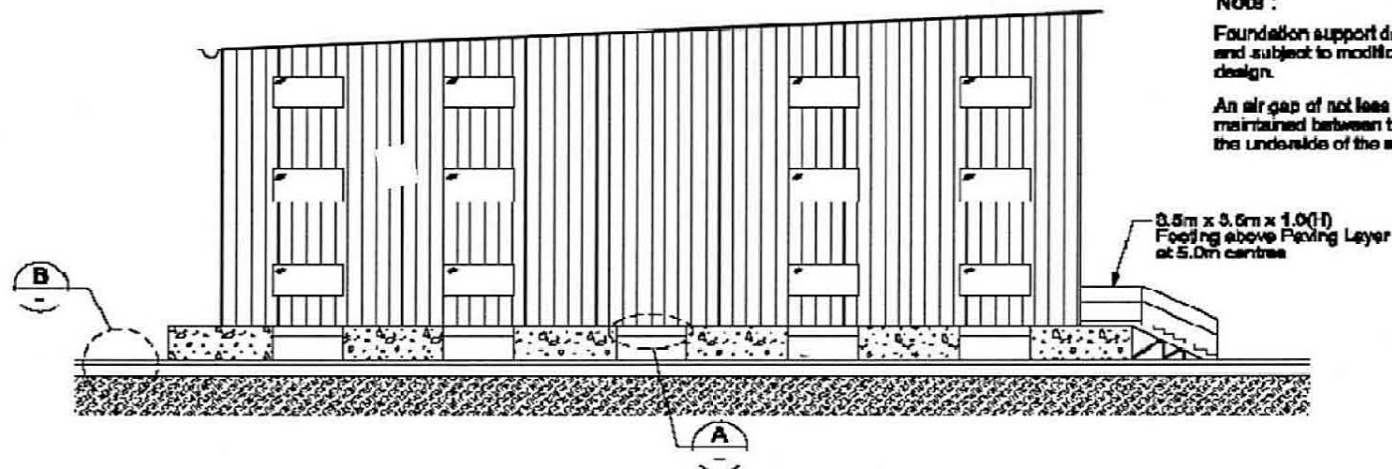

Notes :

Foundation support details indicative only and subject to modification during detailed design.

An air gap of not less than 500mm will be maintained between the ground slab and the underside of the site offices.



Project Title: West Island Line
工程項目名稱：西港島綫

Environmental Permit No. : EP-313/2008/J
環境許可證編號 : EP-313/2008/J

Figure 13: Mitigation Design at Works Area B

圖 13: 乙施工區的緩解設計

(This figure was prepared based on Figure 4 of the Environmental Permit (EP-136/2002/B))
(本圖是根據申請更改環境許可證 (EP-136/2002/B) 圖 4 編制)