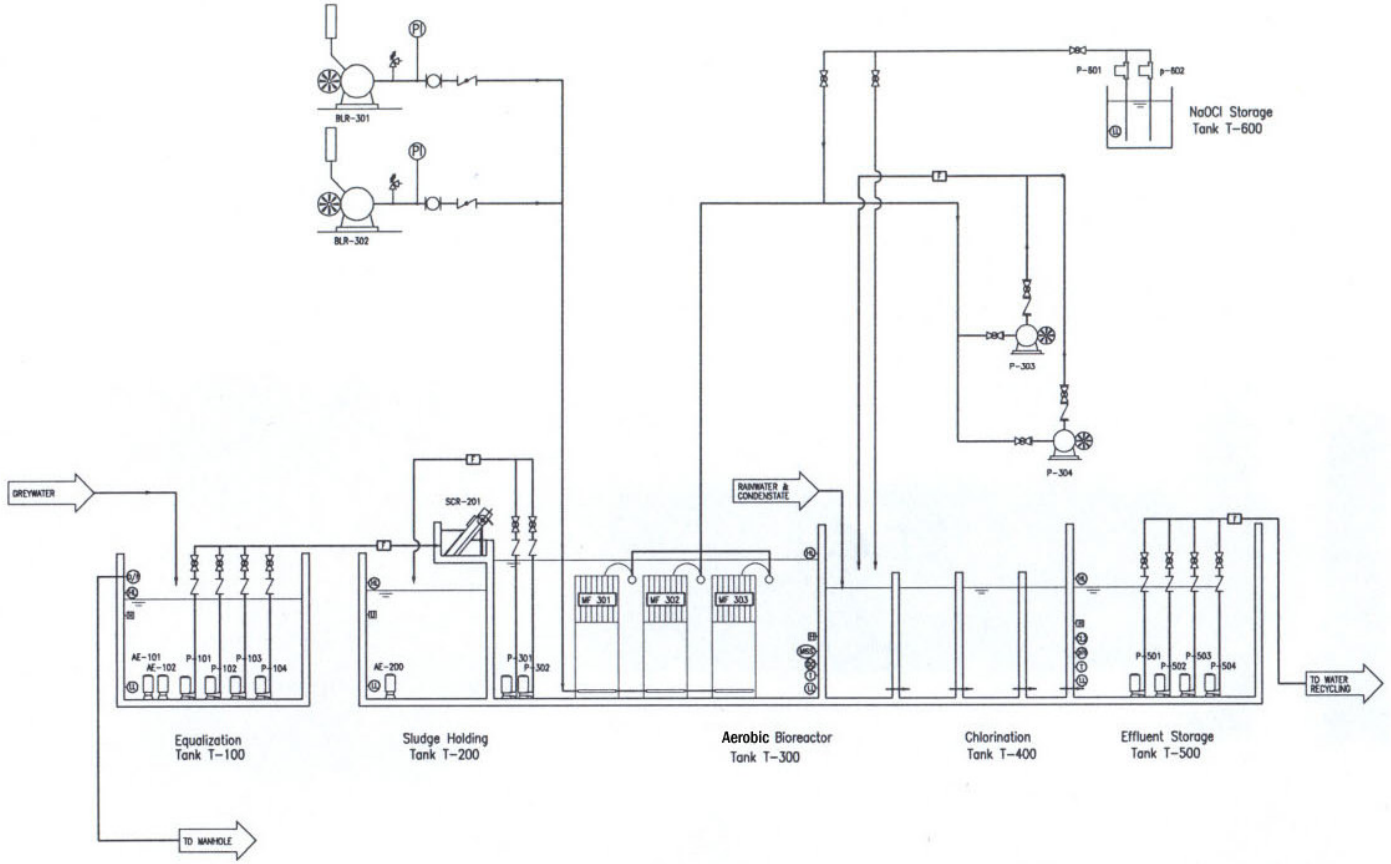

EXPLANATORY NOTES																	
	MARK																
	TITLE	GATE VALVE	BUTTERFLY VALVE	COCK VALVE	BALL VALVE	CHECK VALVE	DAMPER	FLEXIBILTY JOINT	SAFETY VALVE	MOTOR VALVE	AIR BLOWER	PARMEATE PUMP	MEMBRANE UNIT	BAR SCREEN	TOP ENTRY MIXER	STOP GATE	SAMPLING PUMP
	MARK	F				PI	PGR	H	U	MLSS	O/F	HL	LL	DO	T	pH	CL2
	TITLE	FLOW METER	SUBMERSIBLE PUMP	METERING PUMP	SUBMERSIBLE AERATOR	PRESSURE GAUGE	PRESSURE TRANSMITTER	HYDROSTATIC LEVEL SENSOR	ULTRASONIC LEVEL SENSOR	MLSS SENSOR	OVERFLOW ALARM	HIGH LEVEL ALARM	LOW LEVEL ALARM	DISSOLVED OXYGEN SENSOR	TEMPERATURE SENSOR	pH SENSOR	RESIDUAL CHLORINE SENSOR

REV. 修訂	DESCRIPTION 內容簡要	DRAWN 繪圖	CHECKED 審查	DATE 日期

地鐵公司
MTR Corporation

TSEUNG KWAN O AREA 86 PROPERTY DEVELOPMENT – RAINWATER AND GREY WATER RECYCLING

CONCEPTUAL PROCESS & INSTRUMENTATION DIAGRAM GREYWATER TREATMENT SYSTEM

MAUNSELL | AECOM
Maunsell Environmental Management Consultants Ltd.
茂盛環境管理顧問有限公司

DRG.NO. 圖紙編號 FIGURE 3

DESIGNED BY 設計	CONTRACT NO. 合同編號	P. 2 Dr. APPROVED 批准
DRAWN BY 繪圖 X.H	STATUS 狀態	
SCALE 比例 N.T.S.		
DIMENSIONS ARE IN 尺寸以 METERS	© C PYRIGHT RESERVED 版權所有	

P:\PROJECTS\71405\DRAWING\FIGURE\FIGURE 6.3.DWG