

Future Condition (With Emergency Bypass Culvert)

Status of Facilities (✓ = Normal Operation, x = Totally Out of Operation)			Effluent	Discharge Location
San Wai STW	Ha Tsuen PS	NWNT Tunnel		
✓	✓	✓	Treated Effluent	Urmston Road Outfall
✓	✓	x	Treated Effluent	TSW Drainage Channel/Deep Bay
x	✓	✓	Raw Sewage	Urmston Road Outfall
✓	x	✓	Raw Sewage	TSW Drainage Channel/Deep Bay

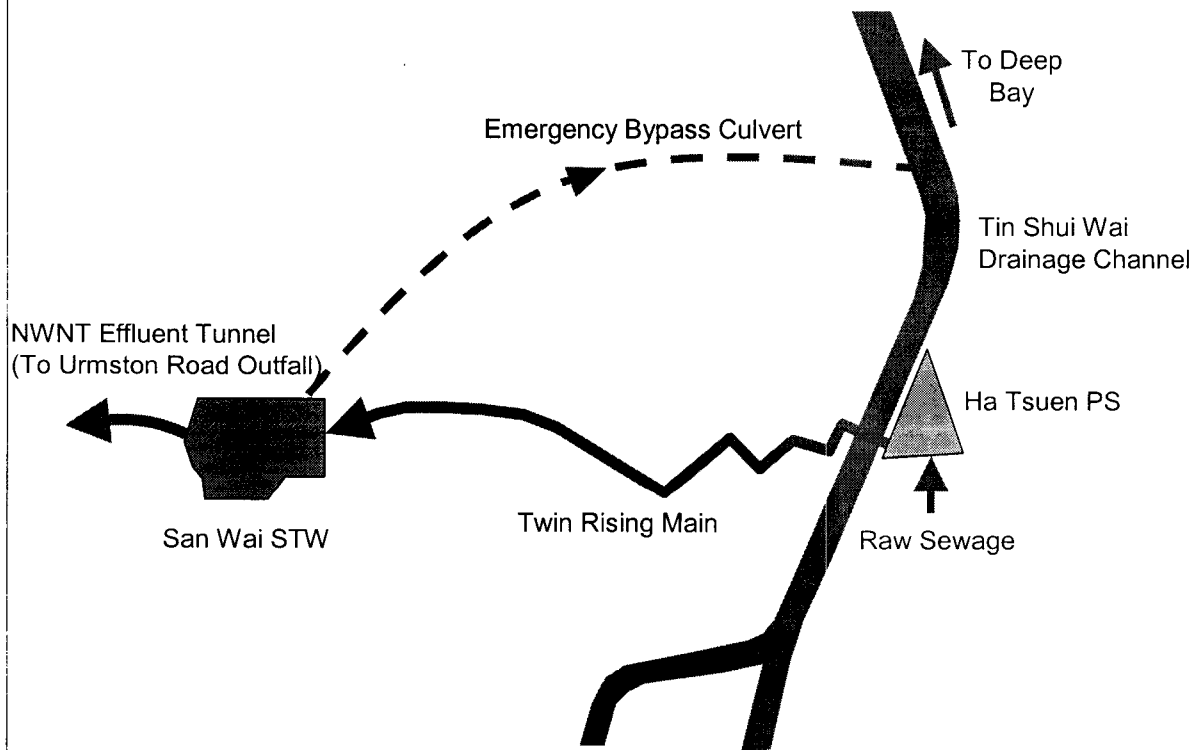


Figure 1.7
Emergency Discharge Scenarios
for the Future San Wai STW
and Ha Tsuen PS

Agreement No. CE62/2000
EIA Study for the Upgrading and
Expansion of San Wai Sewage
Treatment Works and the Expansion
of Ha Tsuen Pumping Station

