




Air Quality Acceptable Criteria : 1.8 ug/m³
 Background : 0.00022 ug/m³ included
 Unit : ug/m³

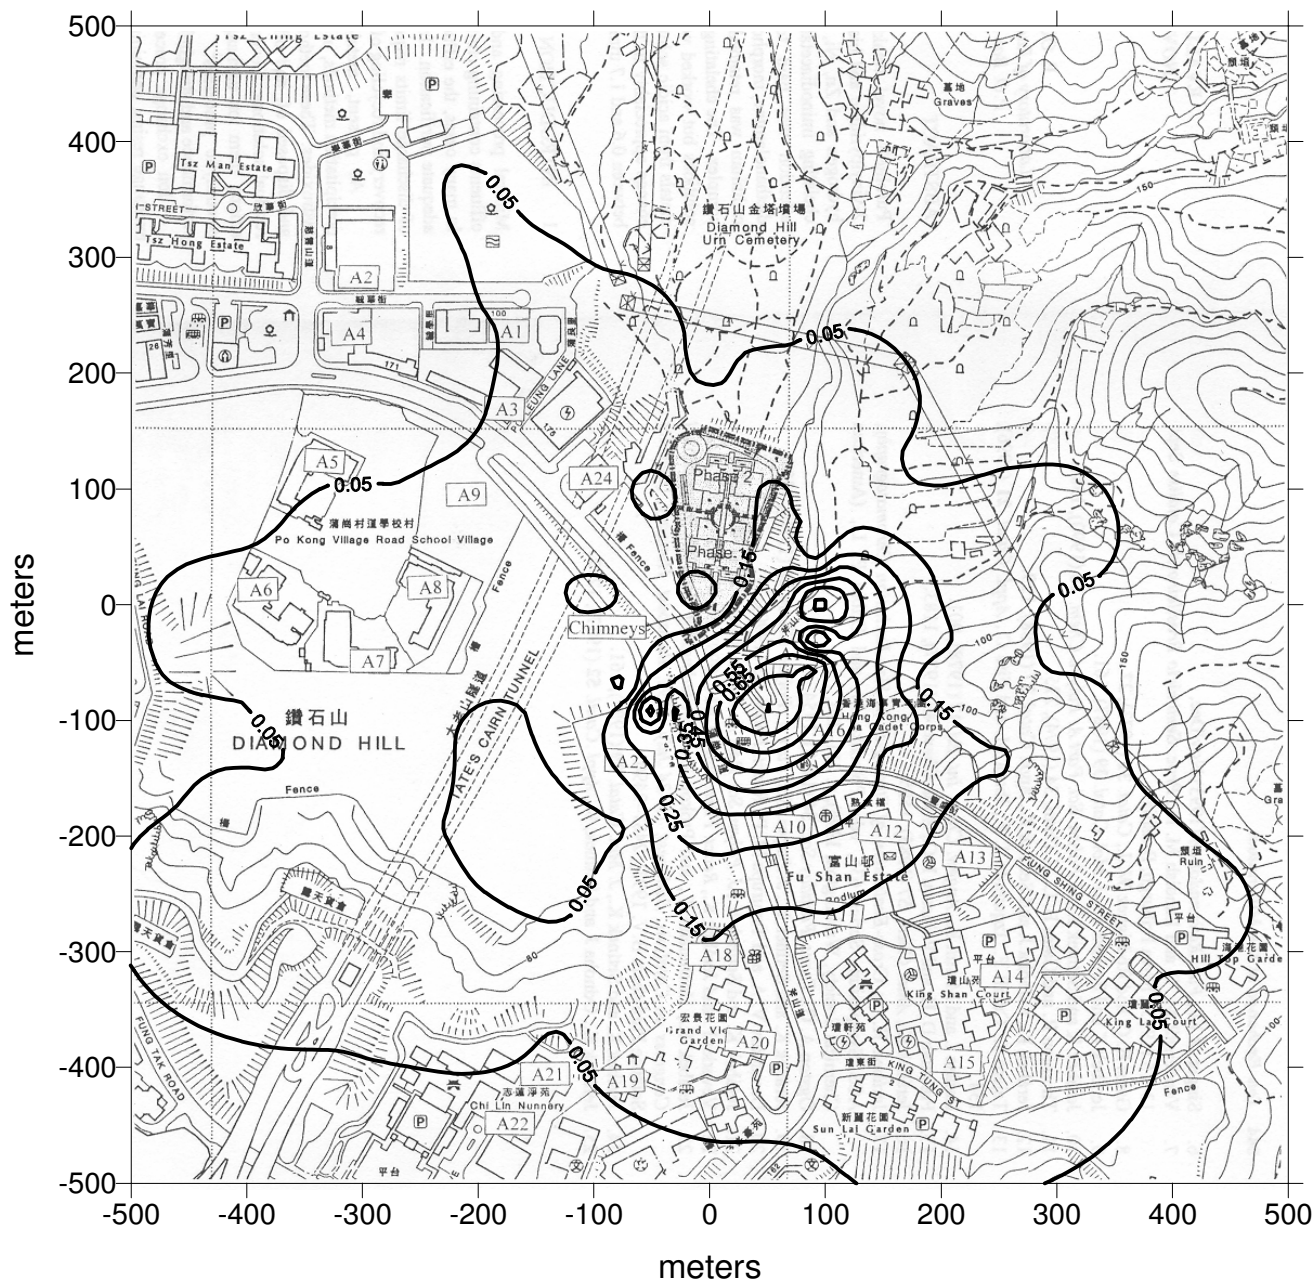

**Hong Kong
Productivity Council**
 香港生產力促進局

Project Title : Reprovisioning of Diamond Hill Crematorium EIA

Figure 4.27 : Maximum level of Mercury During Operation at 61.5 mA.G.
 (worst hit level, 1-hour average)