


KEY VIEW 3 (KV 3)




Existing View of KV 3



Photomontage of KV 3
without Mitigation Measures

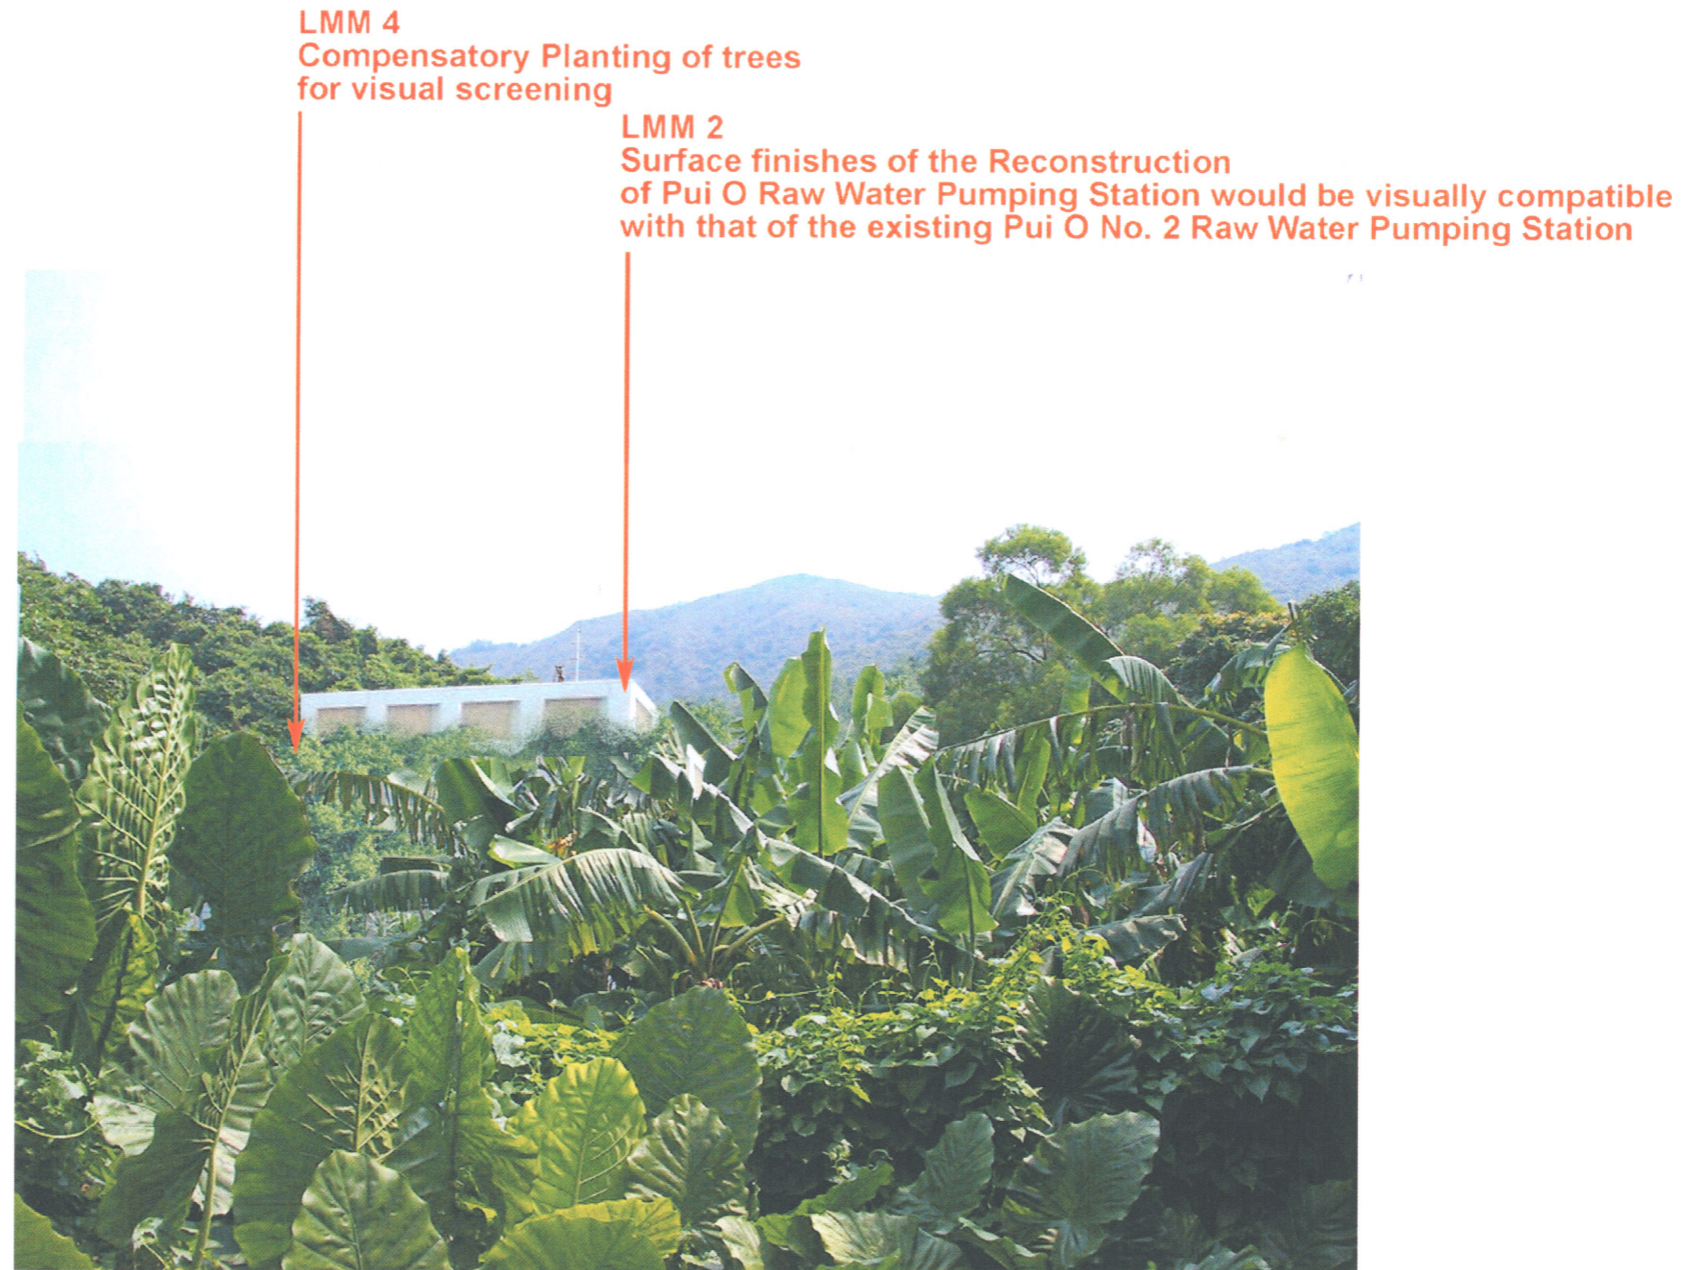

**KV 3 - PROPOSED RECONSTRUCTION OF PUI O RAW WATER PUMPING STATION.
DAY 1 OF THE OPERATION WITH MITIGATION MEASURES**

 水 務 署 WATER SUPPLIES DEPARTMENT			
SCALE	N.T.S.	DATE	AUG 2004
CHECK	—	DRAWN	AKYL
JOB No.	71503	DRAWING No.	7.7c
		REV	A