

KEY VIEW 1a (KV 1a)



KV 1a - DAY 1 OF THE OPERATION WITH MITIGATION MEASURES




KV 1a - PROPOSED SHW RAW WATER BOOSTER PUMPING STATION YEAR 10 OPERATION WITH MITIGATION MEASURES

Trees and shrubs would be well-grown in entrance amenity area at both sides of the access at the proposed SHW Raw Water Booster Pumping Station & Compensatory Planting of trees along the site boundary at the proposed SHW WTW Extension for effective visual screening




**(Alternative Option)
KV 1a - DAY 1 OF THE OPERATION WITH MITIGATION MEASURES**

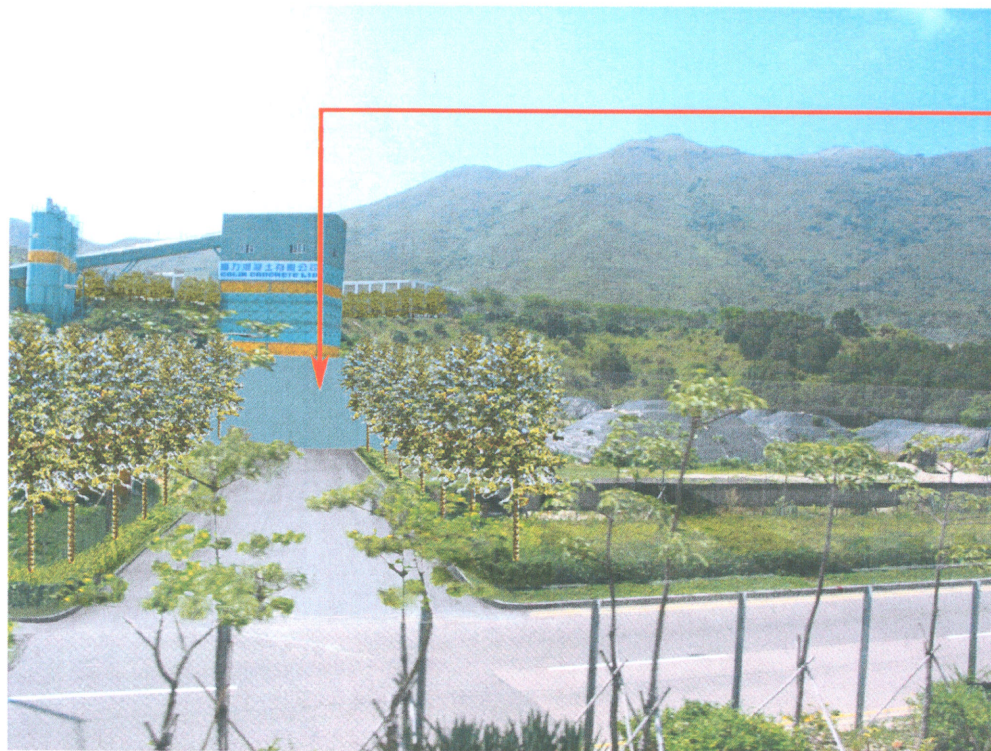

KV 1a - PROPOSED SHW RAW WATER BOOSTER PUMPING STATION YEAR 10 OPERATION WITH MITIGATION MEASURES

Visually recessive colours like greyish blue as surface finishes, rectangular building form of the Proposed SHW Raw Water Booster Pumping Station would be visually compatible with the well-grown surrounding landscape

 水 務 署 WATER SUPPLIES DEPARTMENT			
SCALE	N.T.S.	DATE	AUG 2004
CHECK	-	DRAWN	EHNF
JOB No.	71503	DRAWING No.	7.8aa
		REV	A