








**Appendix 3.15**  
**Tunnel Ventilation Schematic Diagram**

**LEGEND**





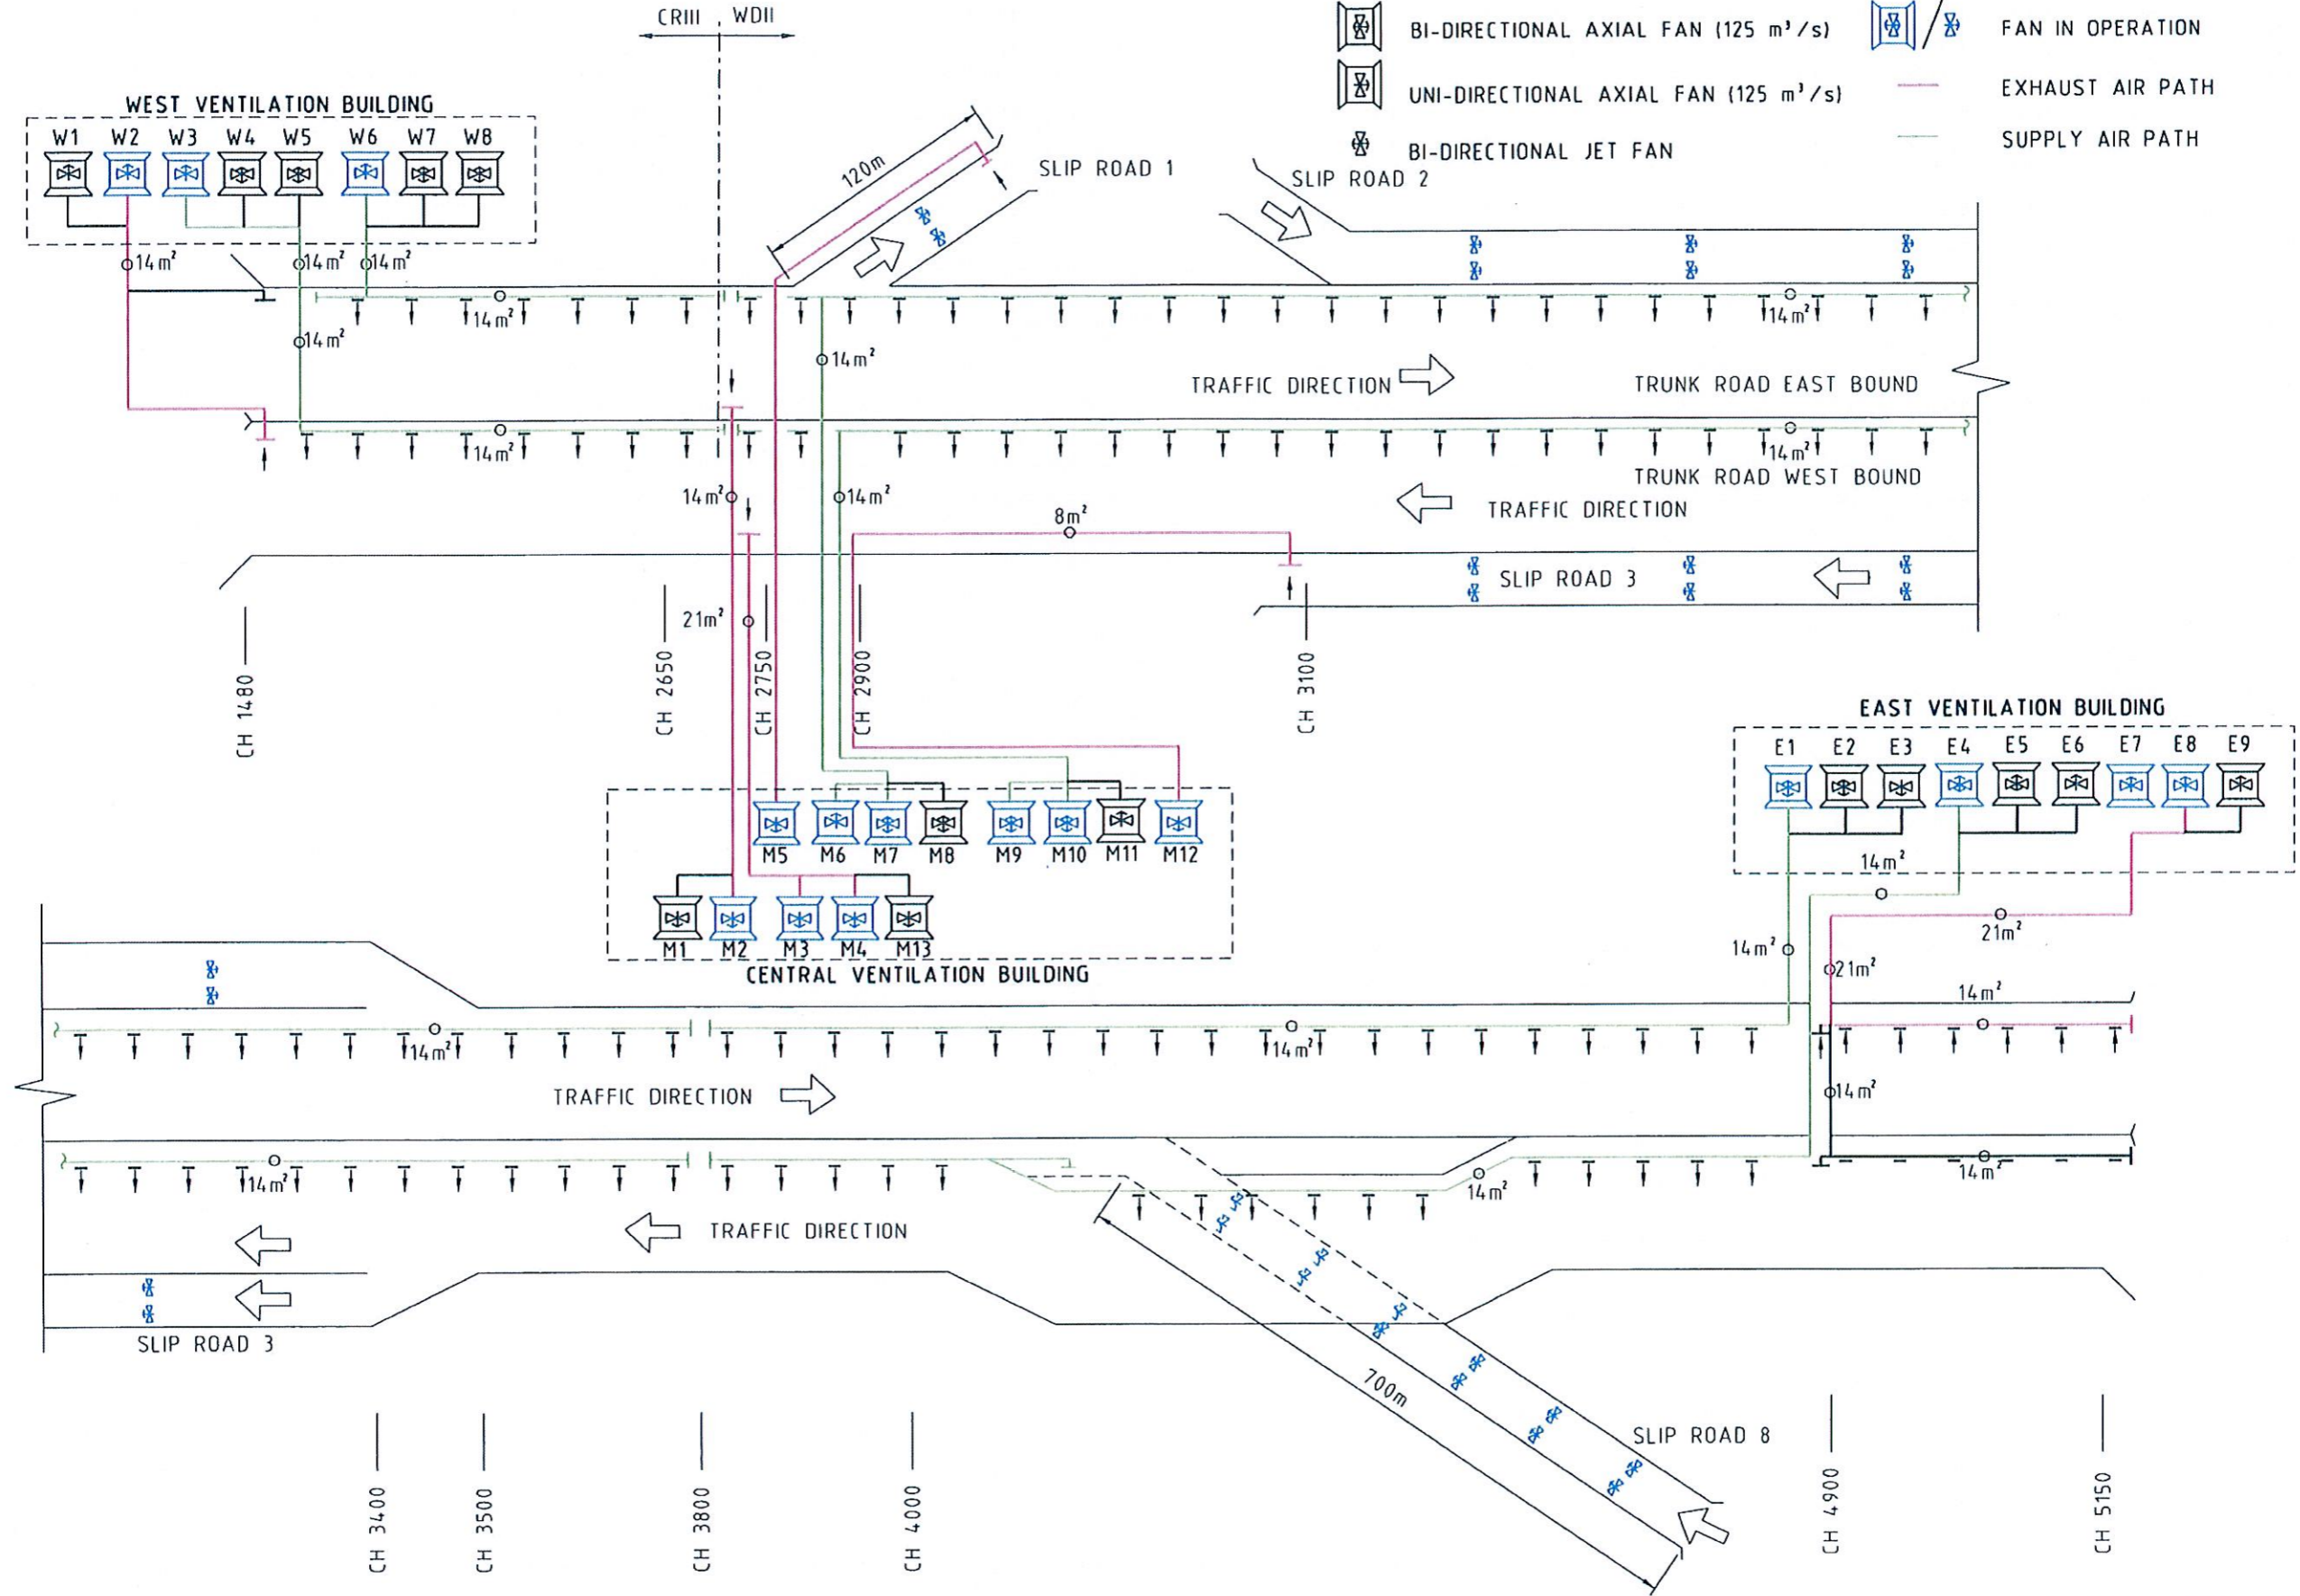

-  BI-DIRECTIONAL AXIAL FAN (125 m<sup>3</sup>/s)
-  UNI-DIRECTIONAL AXIAL FAN (125 m<sup>3</sup>/s)
-  BI-DIRECTIONAL JET FAN
-  FAN IN OPERATION
-  EXHAUST AIR PATH
-  SUPPLY AIR PATH




SCALE 1:2



**LEGEND**

-  BI-DIRECTIONAL AXIAL FAN (125 m<sup>3</sup>/s)
-  UNI-DIRECTIONAL AXIAL FAN (125 m<sup>3</sup>/s)
-  BI-DIRECTIONAL JET FAN
-  FAN IN OPERATION
-  EXHAUST AIR PATH
-  SUPPLY AIR PATH

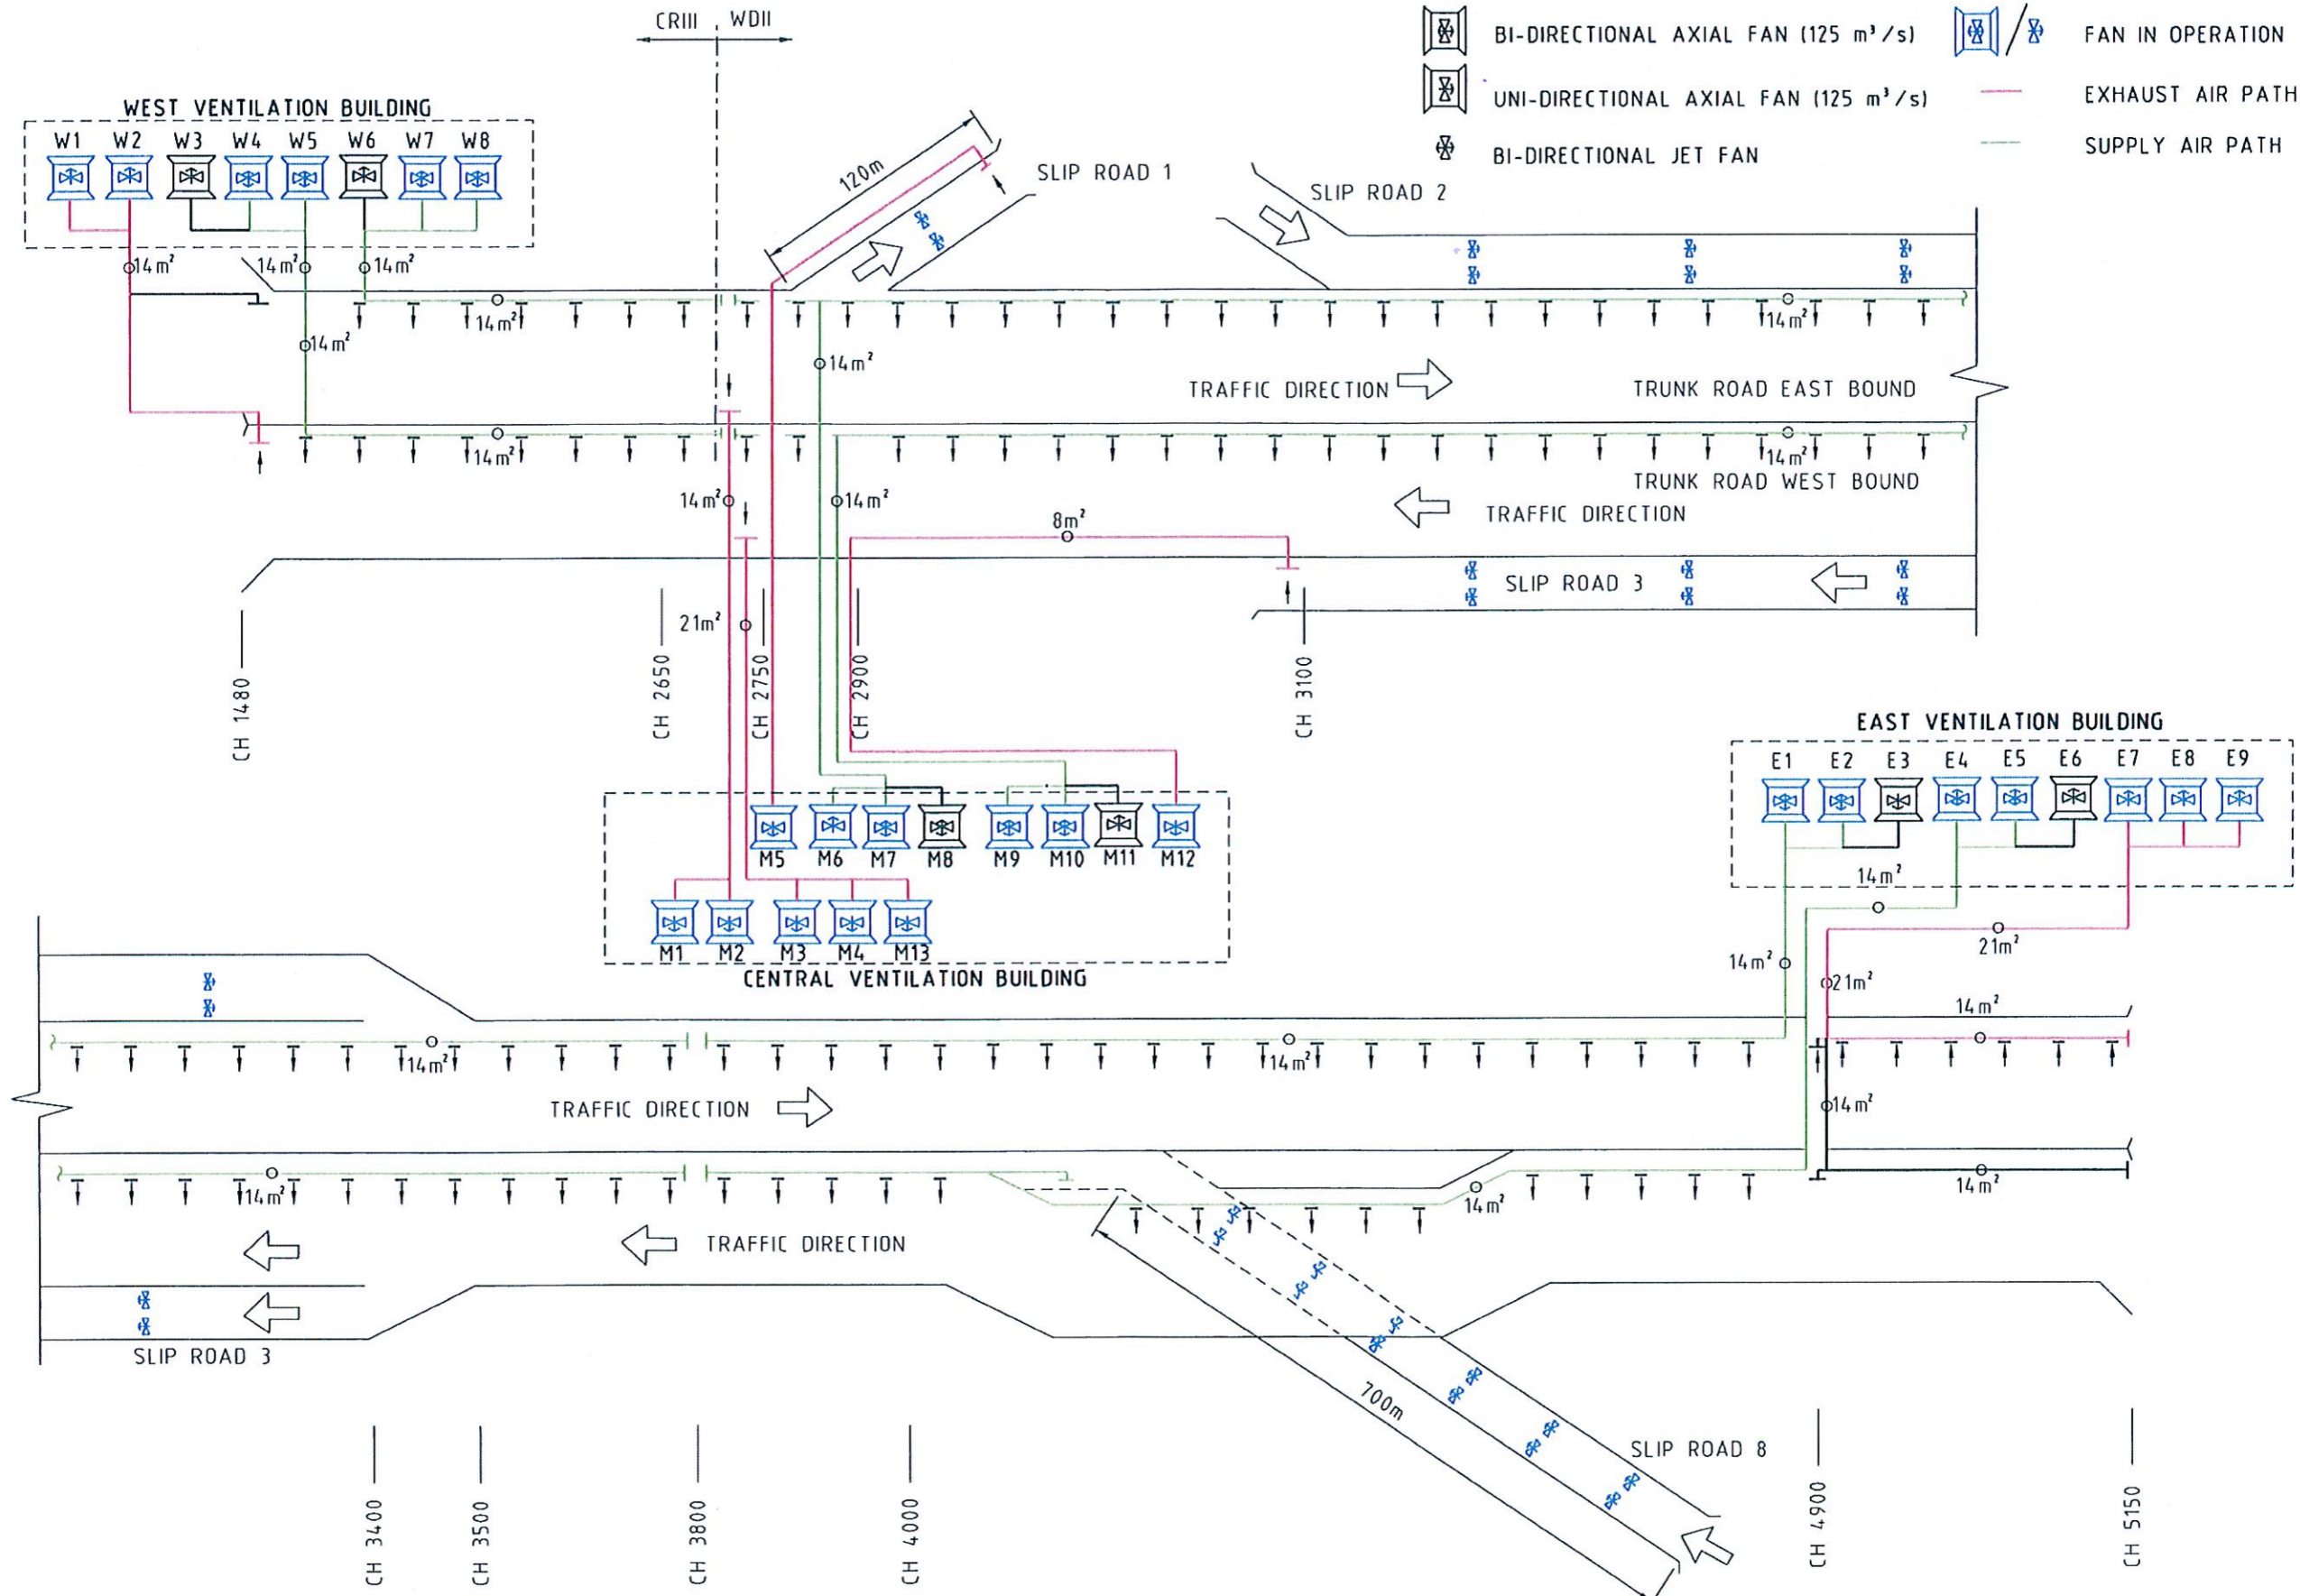

SCALE 1:2