




WSD4 - Tsuen Wan WSD Flushing Water Intake

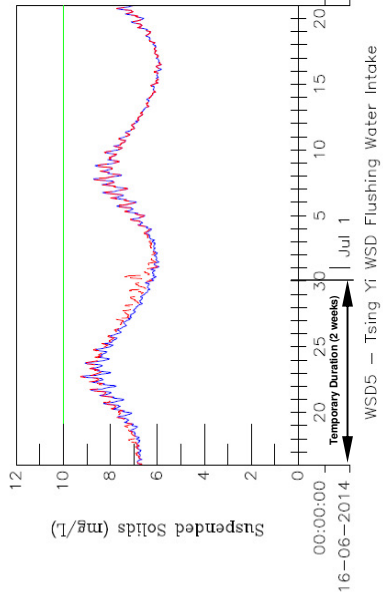


WSD5 - Tsing Yi WSD Flushing Water Intake

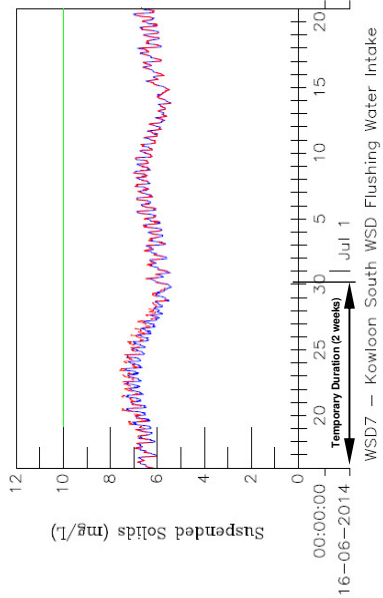


WSD7 - Kowloon South WSD Flushing Water Intake

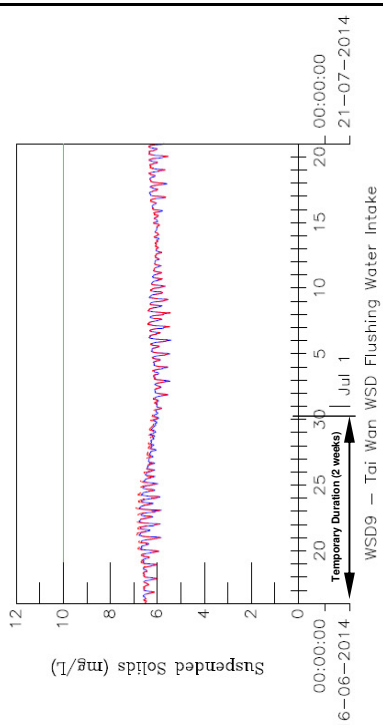


WSD9 - Tai Wan WSD Flushing Water Intake

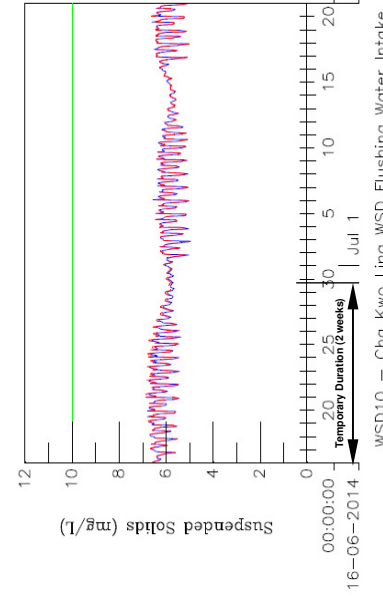


WSD10 - Cha Kwo Ling WSD Flushing Water Intake

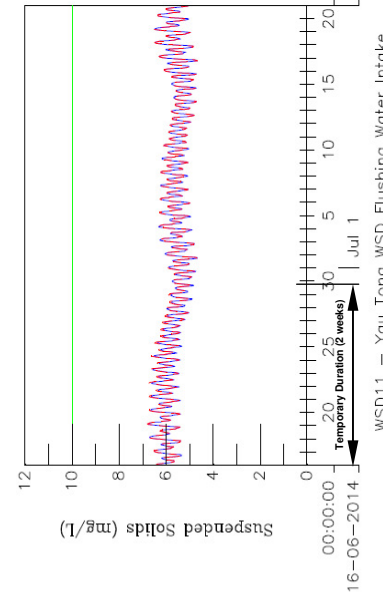


WSD11 - You Tong WSD Flushing Water Intake

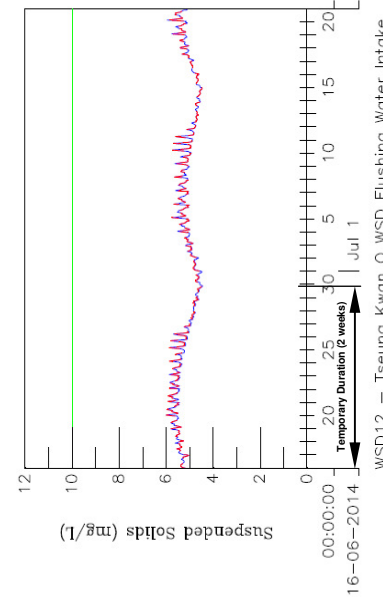


WSD12 - Tseung Kwan O WSD Flushing Water Intake

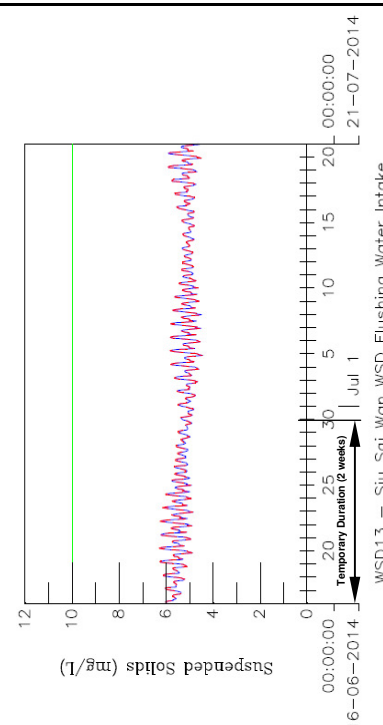


WSD13 - Siu Sai Wan WSD Flushing Water Intake

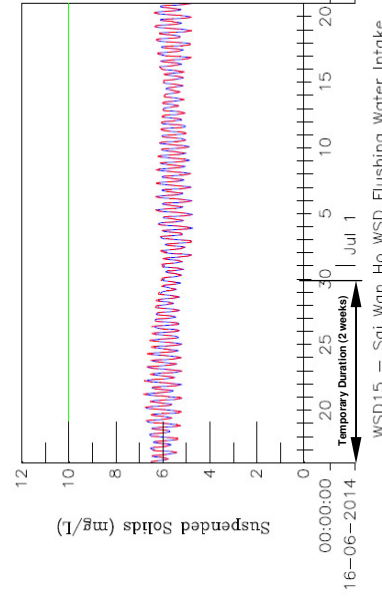


WSD15 - Sai Wan Ho WSD Flushing Water Intake

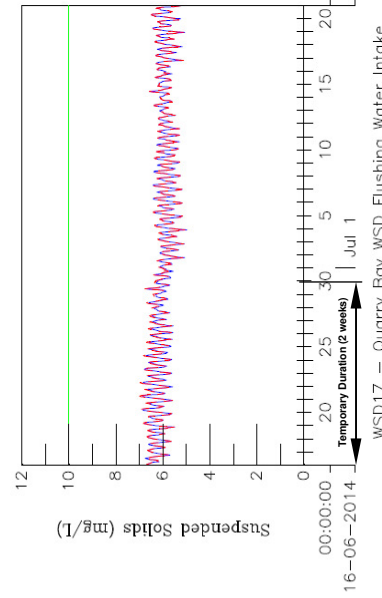


WSD17 - Quarry Bay WSD Flushing Water Intake

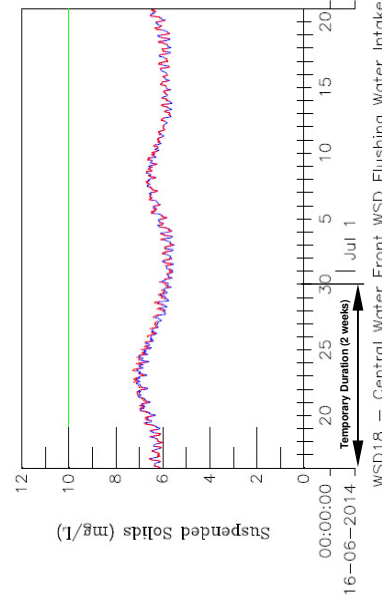


WSD18 - Central Water Front WSD Flushing Water Intake

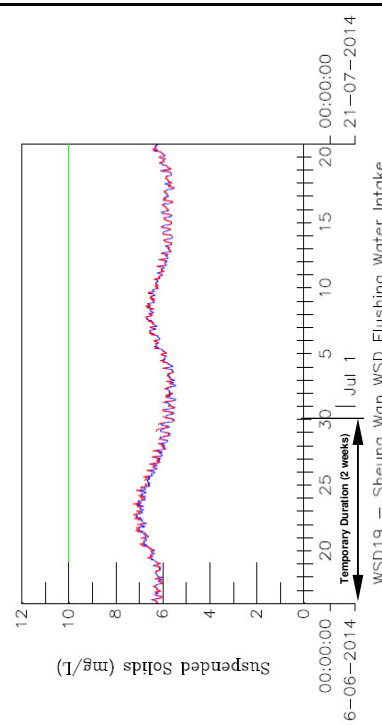

WSD19 - Sheung Wan WSD Flushing Water Intake

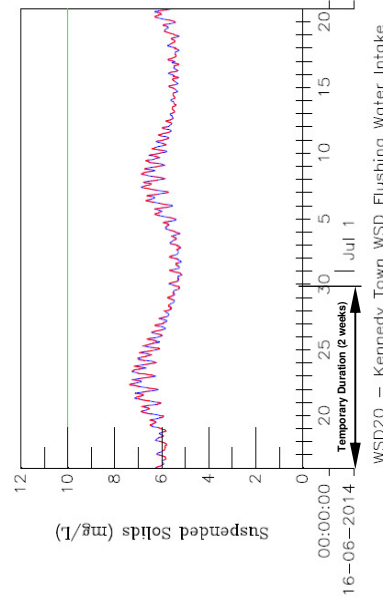

WSD20 - Kennedy Town WSD Flushing Water Intake

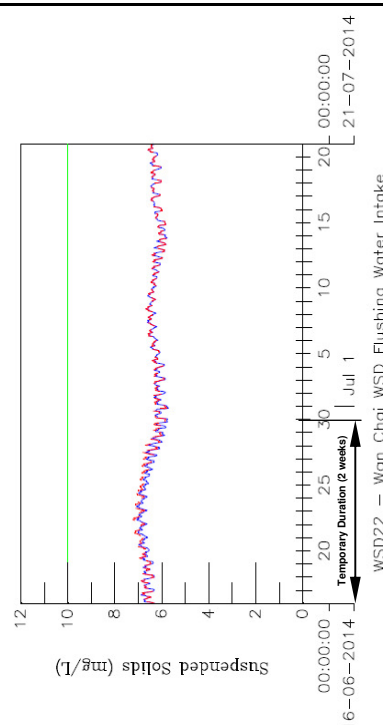

WSD22 - Wan Chai WSD Flushing Water Intake

**Legend:**

- Scenario 1a - 2014 HATS Stage 1 ADF under Normal Operation
- Scenario E - 2014 HATS Stage 1 ADF - Temporary Sewage Bypass due to Modification to the NWKPS for Construction of HATS Stage 2A
- WSD Water Quality Criteria (<10mL)

SCALE	N.T.S.	DATE	FEB 2008
CHECK	AKYC	DRAWN	WCM
JOB NO.	60017198	DRAWING No.	6.83
Rev			-