
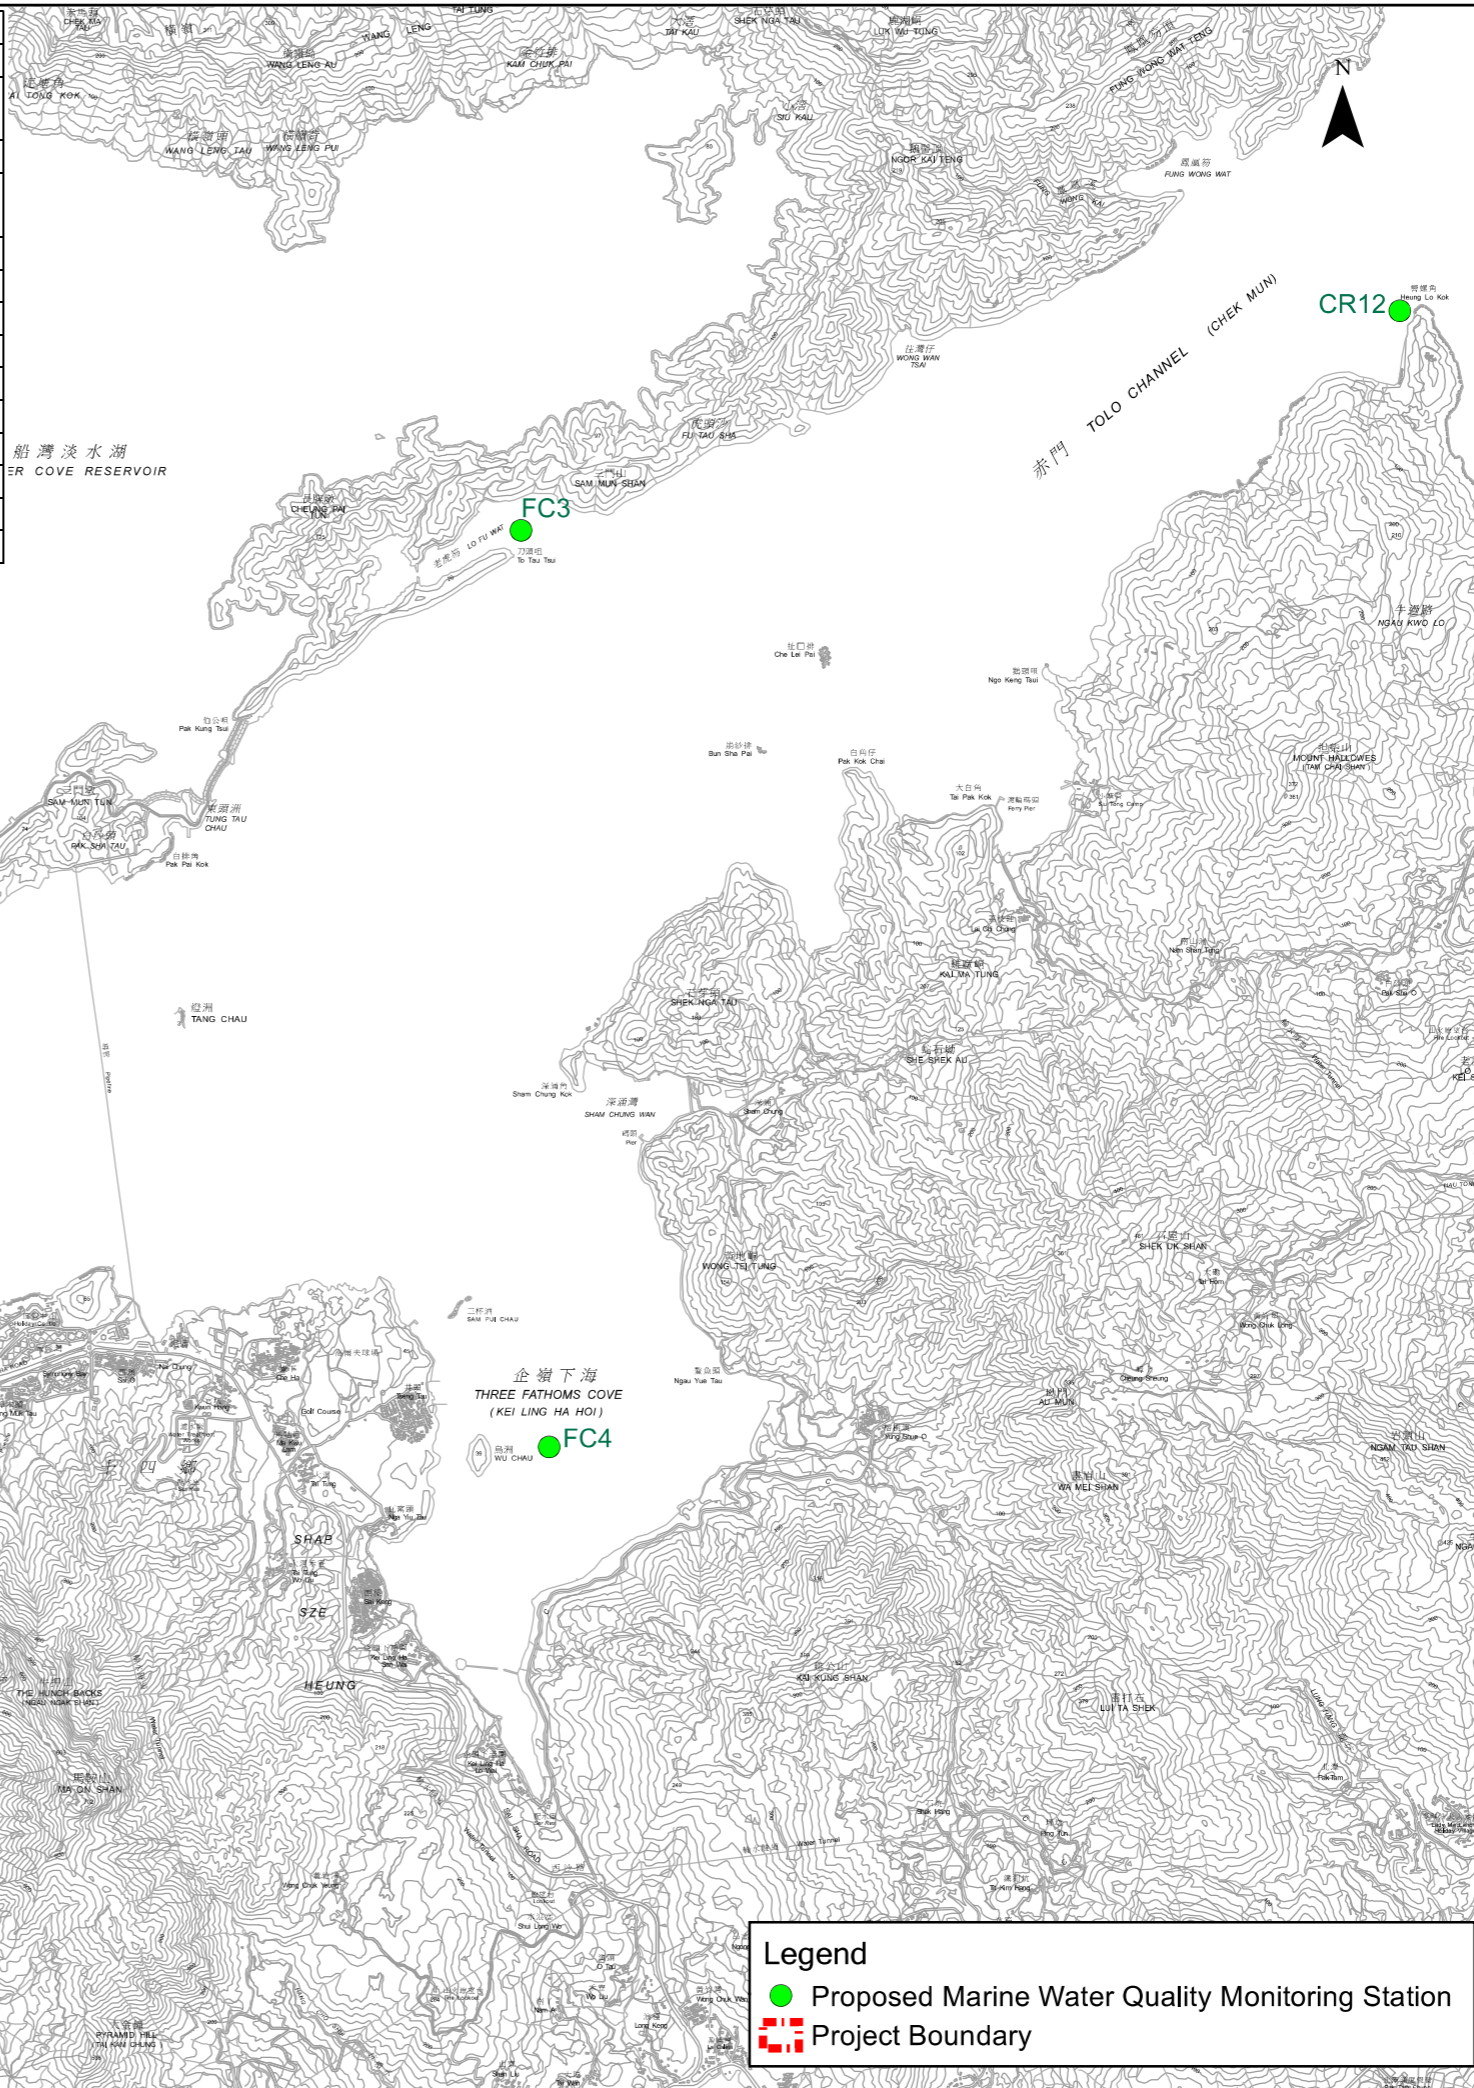


Station	Description	Easting	Northing
Impact Station			
F7 / CR1	WSD Flushing Water Intake at Tai Po / Corals at Tai Po Industrial Estate	837786	834619
F8	WSD Flushing Water Intake at Sha Tin	840249	830072
E1	Seawater Intake for Experimental Mariculture at Marine Science Laboratory of CUHK	840160	831888
FC1	Yim Tin Tsai Fish Culture Zone	839228	834940
FC2	Yim Tin Tsai (East) Fish Culture Zone	840830	834904
FC3	Lo Fu Wat Fish Culture Zone	846391	836694
FC4	Yung Shue Au Fish Culture Zone	846537	831845
CR2	Corals at Shuen Wan Golf Course	838276	834652
CR3	Corals at Providence Bay	839193	832655
CR4	Corals at Ma Liu Shui	840308	831611
CR5	Corals at Sha Tin Hoi	840247	830596
Control Station			
CR12	Corals at Gruff Head	851041	837859

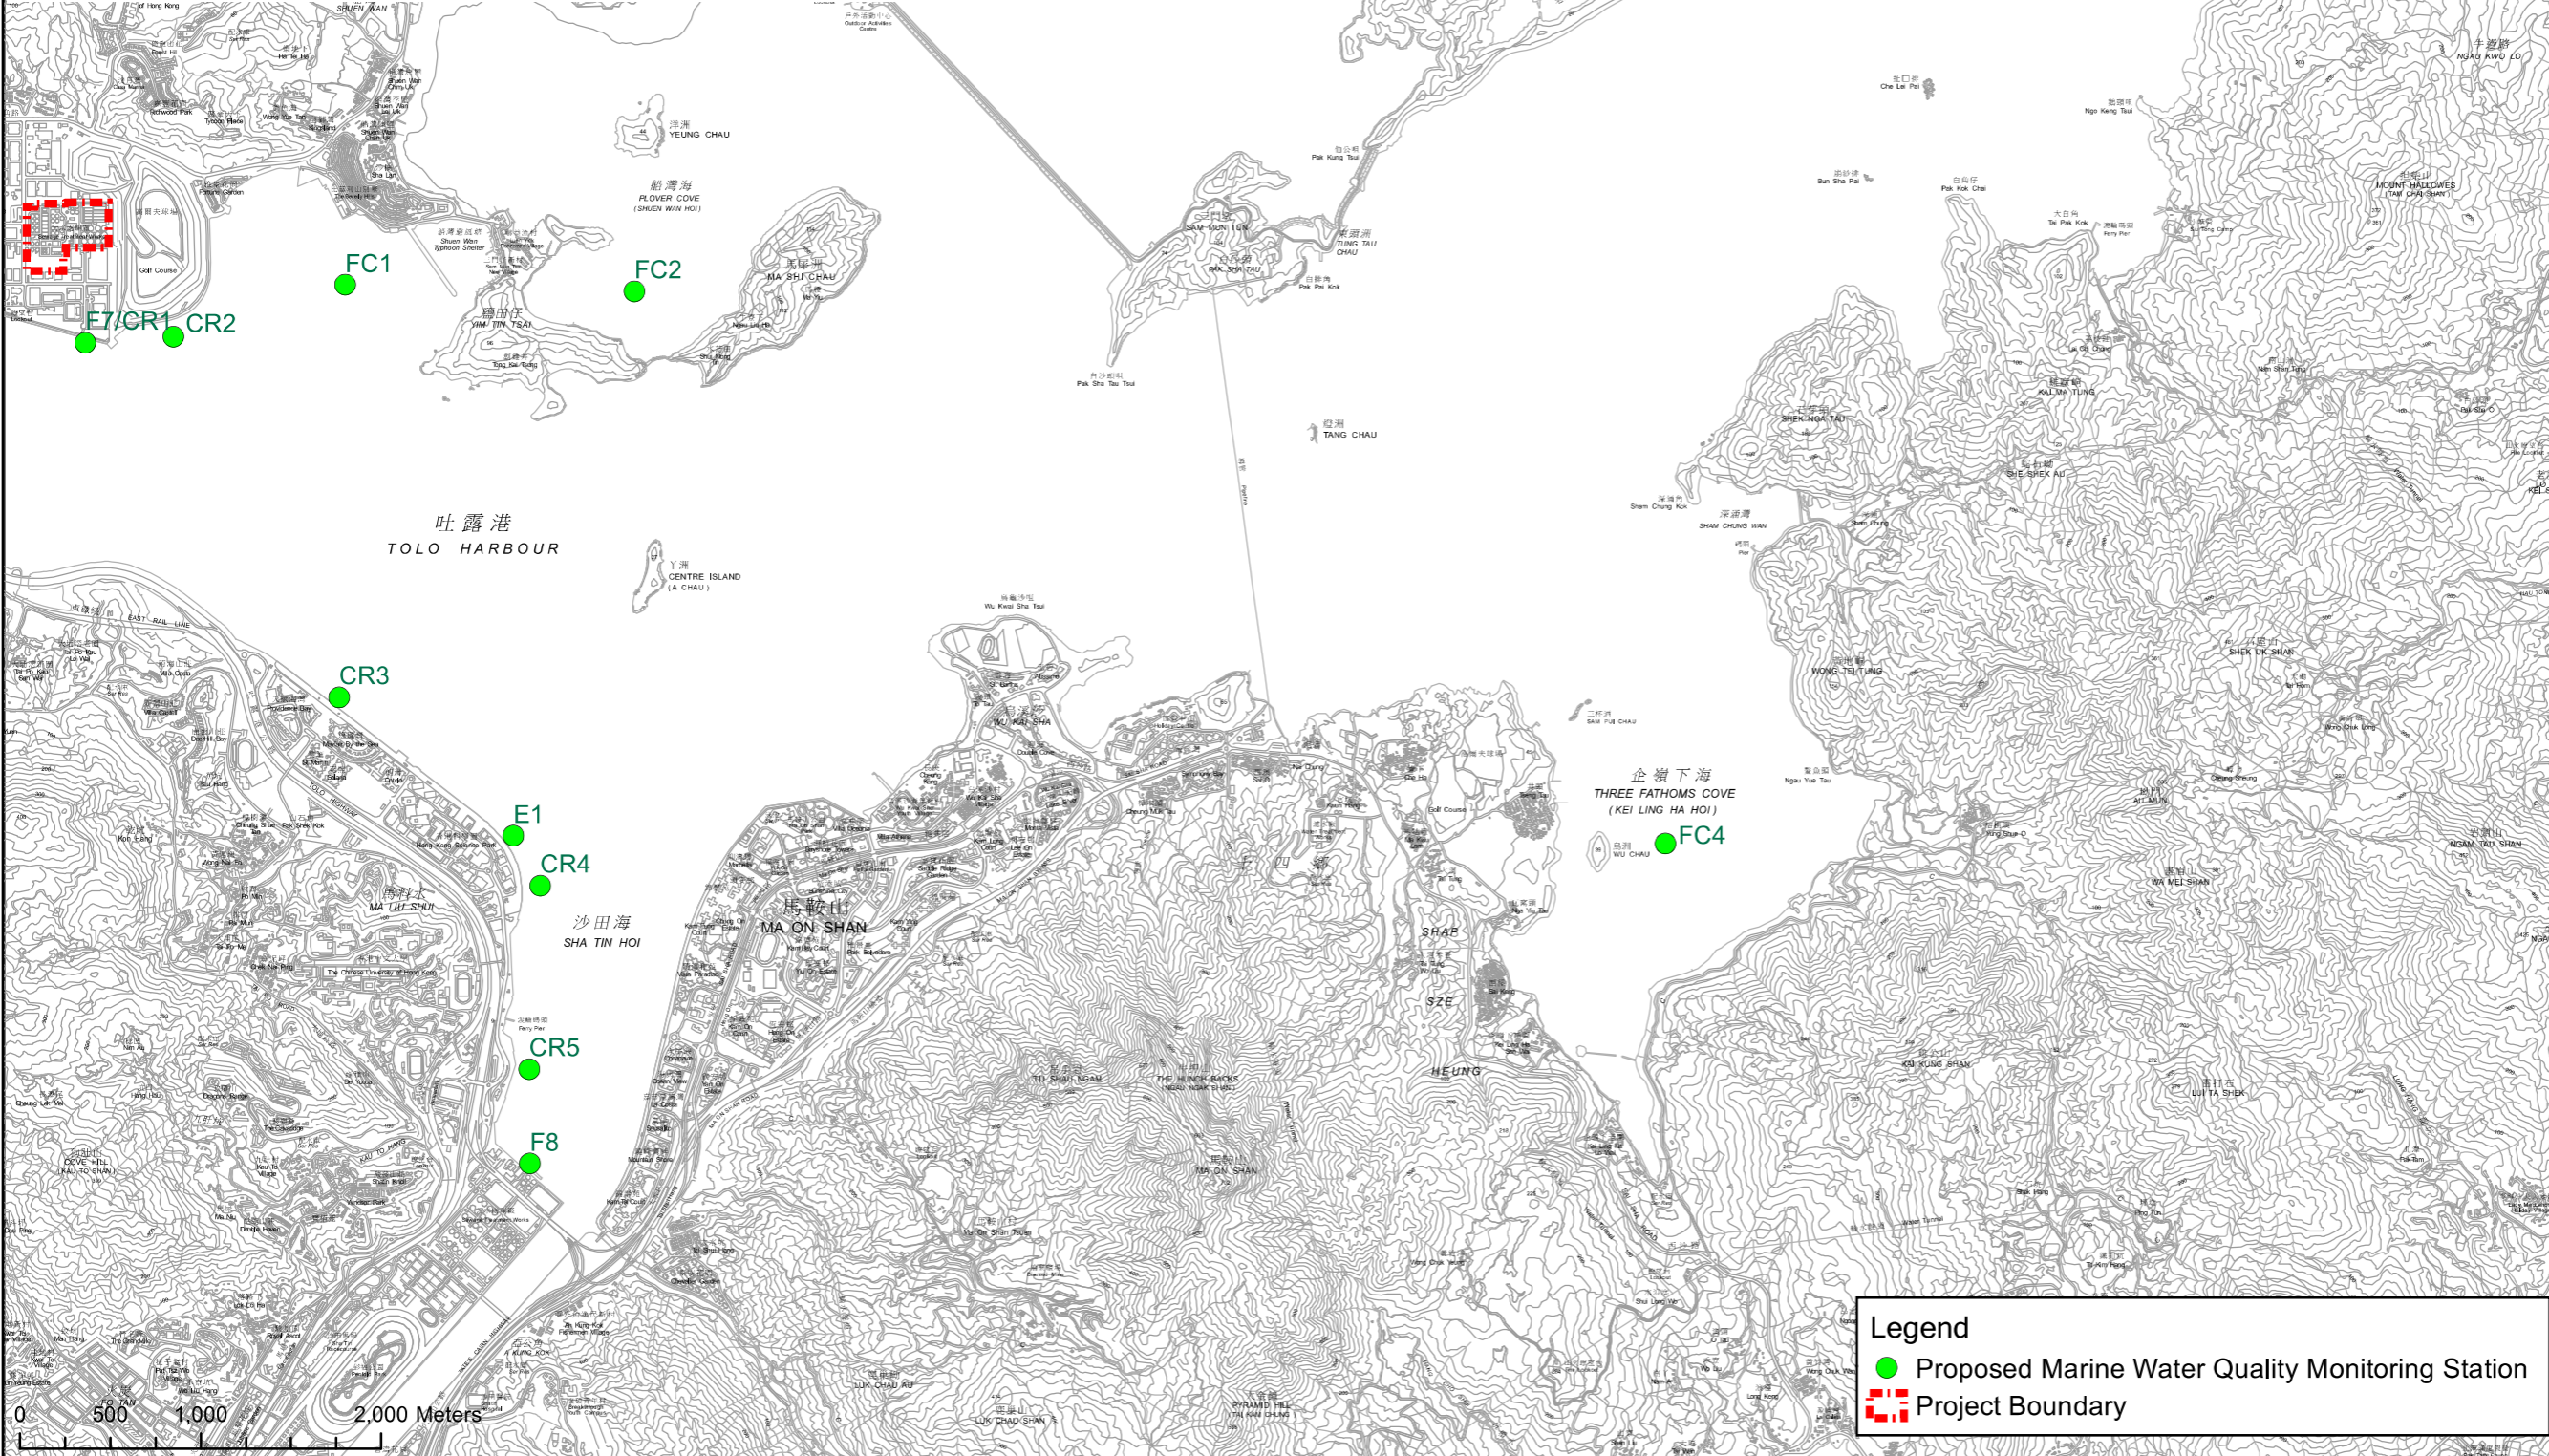

© Copyright by Binnies Hong Kong Limited

Revision	Description			
	Designed	Reviewed	Drawn	Checked
Initial	PSY	Amy	PSY	Amy
Date	03/22	03/22	03/22	03/22
Approved				
Agreement No.	CE 50/2019 (DS)			
Project Title	Upgrading of Tai Po Sewage Treatment Works - Investigation			
Figure Title	Proposed Marine Water Quality Monitoring Stations in Tolo Harbour and Tolo Channel			
Drawing No.	Figure 3.3	Revision -		
Scale	A3: 1:40,000			
Client	 香港特別行政區政府渠務署 THE GOVERNMENT OF THE HONG KONG SPECIAL ADMINISTRATIVE REGION DRAINAGE SERVICES DEPARTMENT			
Consultant	 BINNIES HONG KONG LIMITED 寶尼新工務顧問有限公司			