
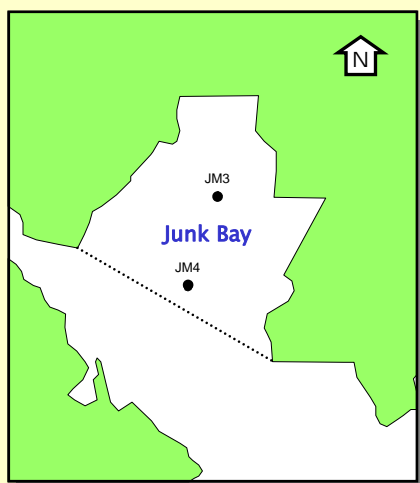


Levels of compliance with key Water Quality Objectives in the Junk Bay WCZ

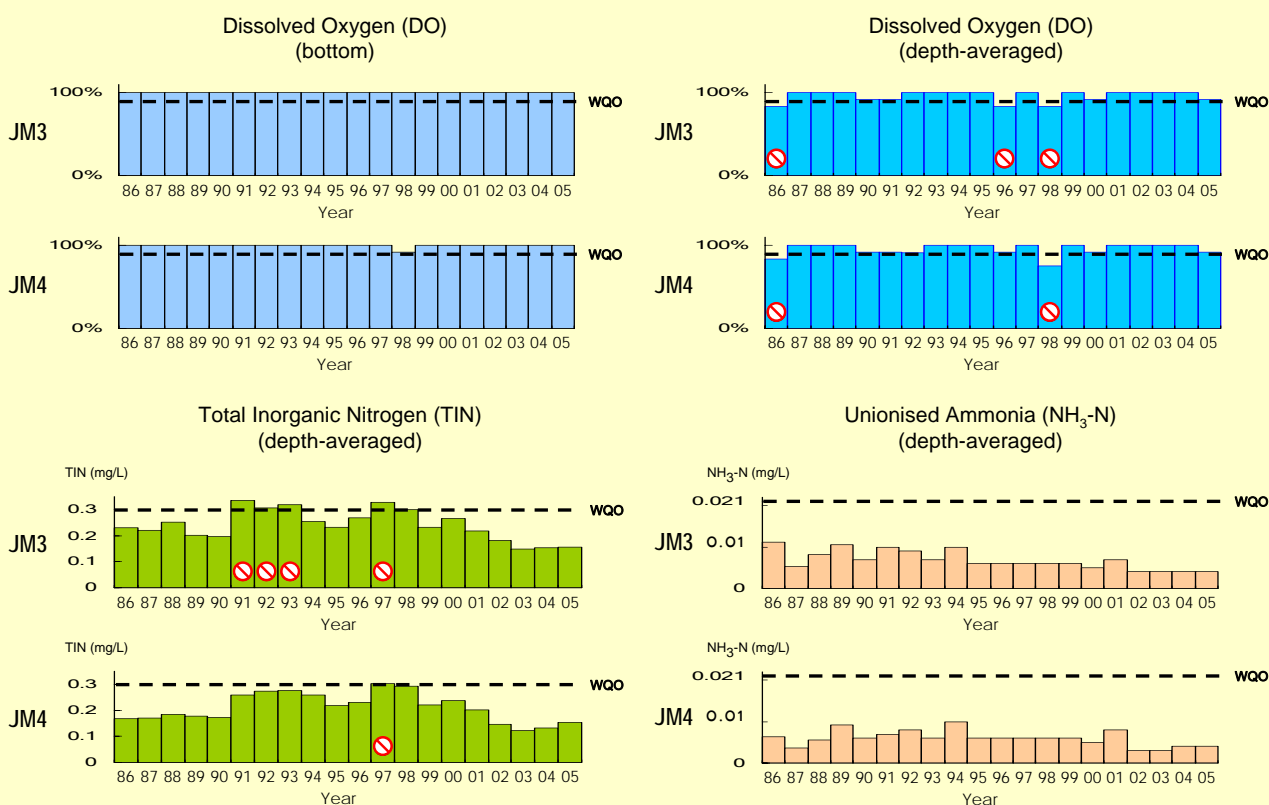

Dissolved Oxygen (DO)

1. Bottom

WQO : 90% sample with bottom DO \geq 2 mg/L

% sample with bottom DO \geq 2 mg/L

2. Depth-averaged

WQO : 90% sample with depth-averaged DO \geq 4 mg/L

% sample with depth-averaged DO \geq 4 mg/L

Total Inorganic Nitrogen (TIN)

WQO : annual mean for depth-averaged TIN \leq 0.3 mg/L

annual mean for depth-averaged TIN

Unionised Ammonia (NH₃-N)

WQO : annual mean for depth-averaged NH₃-N \leq 0.021 mg/L

annual mean for depth-averaged NH₃-N

Non-compliance